

## Idaho National Engineering Laboratory

Operated by the U.S. Department of Energy

# Parameters That Influence Damping In Nuclear Power Plant Piping Systems

8301100033 821231  
PDR NUREG  
CR-3022 R PDR

**Arthur G. Ware**

**November 1982**

Prepared for the

**U.S. Nuclear Regulatory Commission**

Under DOE Contract No. DE-AC07-76IDO1570



Available from

GPO Sales Program  
Division of Technical Information and Document Control  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

and

National Technical Information Service  
Springfield, Virginia 22161

#### NOTICE

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product or process disclosed in this report, or represents that its use by such third party would not infringe privately owned rights.

NUREG/CR-3022  
EGG-2232  
Distribution Category: RM

# PARAMETERS THAT INFLUENCE DAMPING IN NUCLEAR POWER PLANT PIPING SYSTEMS

Arthur G. Ware

Published November 1982

EG&G Idaho, Inc.  
Idaho Falls, Idaho 83415

Prepared for the  
U.S. Nuclear Regulatory Commission  
Washington D.C. 20555  
Under DOE Contract No. DE-AC07-76ID01570  
FIN No. A6052

## **ABSTRACT**

This report gives the present status of the guidelines for structural damping in dynamic analyses of nuclear power plant piping systems. A brief description of the present state of knowledge of piping system damping in the U.S. is included, as are gaps in the overall understanding of the phenomenon. The report concludes with proposed EG&G Idaho efforts to contribute to the satisfactory establishment of reasonable damping values to be used in structural analyses.

## SUMMARY

The present U.S. Nuclear Regulatory Commission (NRC) guidelines for structural damping to be used in dynamic stress analyses of nuclear power plant piping systems are generally considered to be overly conservative and not in the best interests of the nuclear industry as a whole. In order to generate revised guidelines, solidly based on technical data, a good deal of new experimental data needs to be generated and assessed, and the parameters that influence damping need to be quantitatively identified. From data gathered to date, the relative importance of these parameters appears to be:

1. Strong Influence
  - a. Type of Supports
2. Weak Influence
  - a. Response Amplitude
  - b. Response Frequency
  - c. Insulation
3. Little or Unknown Influence
  - a. Geometry
  - b. Type of Excitation
  - c. Direction of Excitation or Response
  - d. Pipe size.

As part of the NRC piping system damping study program, EG&G Idaho Applied Mechanics Branch will be actively involved in assessing and generating new data and in participating in revising the present guidelines. In FY 1983 EG&G proposes to test a simple system with a variety of support configurations to gain a more basic understanding of the damping phenomenon. In subsequent years, more complex systems would be evaluated. The final goal of such a program would be to make blind predictions of reasonable values of damping for a given piping system.

## **ACKNOWLEDGMENTS**

Gary Thinnes supplied Sections 5.1, 5.2, and Appendix A of this report. Special thanks also go to Gene Heaton, Gary Thinnes, and Jim Arendts for providing figures.

# CONTENTS

|   |     |
|---|-----|
| ABSTRACT .....  | ii  |
| SUMMARY .....   | iii |
| ACKNOWLEDGMENTS .....   | iv  |
| INTRODUCTION .....  | 1   |
| BACKGROUND .....  | 2   |
| Definition of Damping .....   | 2   |
| Mathematical Representation of Damping .....  | 2   |
| Experimental Measurement Techniques .....   | 3   |
| Present Guidelines .....  | 4   |
| PARAMETERS THAT INFLUENCE PIPING SYSTEM DAMPING<br>STATE-OF-THE-ART .....           | 7   |
| Parameters That Influence Damping .....   | 7   |
| New Data .....  | 10  |
| IDENTIFICATION OF PARAMETRIC EFFECTS .....  | 15  |
| Gaps in Present Knowledge .....   | 15  |
| Potential Goals .....   | 21  |
| EG&G PROGRAM .....  | 23  |
| Damping Test Layout and Configuration .....   | 23  |
| Excitation and Data Reduction .....   | 23  |
| Test Plan .....   | 26  |
| Future Work .....   | 31  |
| REFERENCES .....  | 31  |
| APPENDIX A—PROCEDURE FOR DETERMINATION OF TRANSFER AND<br>COHERENCE FUNCTIONS ..... | 35  |

# PARAMETERS THAT INFLUENCE DAMPING IN NUCLEAR POWER PLANT PIPING SYSTEMS

## INTRODUCTION

One of the more influential parameters used in dynamic stress analyses of nuclear power plant piping is the value of damping assigned to the particular piping system. In general, damping is a measure of energy dissipation in a structure.<sup>a</sup> The energy losses associated with higher damping values result in reducing the computed response motion of a piping system to a given excitation, and therefore can greatly influence the number and strength of supports required. At present, the damping in a system cannot be mathematically predicted accurately, but must be determined from vibration experiments. Since piping systems must be designed and analyzed to be structurally in compliance with industry requirements before they can be built and tested, damping values must be estimated from data obtained from existing systems or laboratory experiments. Unfortunately, the body of experimental data is sparse, there is a great deal of scatter in existing data, and conclusive representative values of damping for nuclear power plant piping have not been agreed upon. In lieu of best estimate damping values, the U.S. Nuclear Regulatory Commission (NRC) has established conservative values, discussed in "Present Guidelines" section, which would cause response amplitudes and the corresponding stresses to be overpredicted. This has resulted in piping systems that have more supports than would be required if more realistic damping values were used, to keep mathematically computed piping stresses below allowable values. These stiffer systems, although highly resistant to dynamic loads, become more severely stressed during thermal growth transients.

It is widely recognized that higher allowable damping values would be more reasonable, and would be beneficial to the nuclear industry by reducing the number of required piping supports. More accurate stress analyses would be possible; expenses would be reduced in design, analysis, procurement, and installation of supports. There would be less chance of a support malfunction (since there would be fewer); and piping systems

would undergo less stress when responding to thermal transients. However, the complexity of damping and the lack of consistency in available data have provided a substantial barrier to establishing a generally acceptable value or values of system damping to replace those presently allowed.

In response to this problem, a number of organizations have begun to assess the available data to make a recommended change, and to generate additional data to fill in the gaps in the present understanding of damping. With the recognized need to adjust the allowable values, data exchanges and cooperative testing efforts have been initiated between members of the nuclear industry.

An earlier EG&G report<sup>1</sup> presented recent experimental data from a number of sources, and described trends in damping values due to several influencing parameters. This earlier report has been cited extensively in many recent communications among government and industry experts who are active in revising the allowable damping values in structural analysis standards. Both the strengths and shortcomings of this report, the latter which relate primarily to the lack of data in answering vital questions, have been pointed out. This present report details some of the ongoing EG&G efforts designed to supplement the information in Reference 1.

The purpose of this report is to describe the EG&G involvement in the investigation of piping damping. Included are a brief summary of the present state of knowledge in the United States (U.S.), recommended short and long term goals for the U.S. program, and EG&G experiments which will be designed to supplement other test data and programs in clarifying the overall concept of piping damping.

The presentation of experiment data reported by EG&G Idaho, Inc., normally includes the uncertainty of the data. For this document, however, no uncertainties are shown on the data plots. The data plots used here are examples, intended to illustrate the trends in the overall data.

a. For a more complete discussion of damping, refer to "Background" section.



## BACKGROUND

This section presents a definition of damping, its causes, and how it is calculated. Since a discussion of these subjects would be quite lengthy, and since they are adequately covered in textbooks and manuals, only the basic concepts are outlined. To complete the background, a discussion of the current NRC guidelines on damping is included.

### Definition of Damping

The term damping refers to the energy dissipation properties of a material or system under cyclic motion. These energy losses are important because they reduce the response motion of the piping system when the system is vibrated. Damping is generally classified into two categories: material and system. Material damping represents the phenomenon by which energy is dissipated within a volume of continuous solid matter. Examples are plastic slip or flow, and friction at grain boundaries. Under cyclic motion, these mechanisms lead to a stress-strain hysteresis. Material damping contributes only a small percentage to the overall damping, in the range of 0.04 to 0.2% of critical damping for steels stressed below the yield point.<sup>2</sup> This type damping becomes more pronounced at plastic stress levels. In contrast, system damping refers to energy losses between distinguishable parts. Examples are linear slippage between contacting parts, rotations at joints, and closing of gaps resulting in impacts. Lumping the system damping effects together can result in contributions of 1 to 2 orders of magnitude greater than material damping. In this report, damping refers to energy dissipation due to all sources, both material and system. Reference 3 gives a more detailed discussion on types of damping.

### Mathematical Representation of Damping

Damping in a system is a complex phenomenon, and usually more than one type of damping exists in a system at a single time. The complex problem is generally reduced to a simplified mathematical description by assuming that if the damping is small, the effect can be represented by equivalent viscous dampers.<sup>4</sup> For a single degree of freedom oscillator, the expression of motion would be

$$M\ddot{x} + C\dot{x} + Kx = F(t)$$

where

$M$  = mass

$x$  = displacement

$\dot{x}$  = velocity

$\ddot{x}$  = acceleration

$C$  = damping

$K$  = stiffness

$F(t)$  = applied force.

The coefficient  $C$  represents damping proportional to the velocity of the oscillator. The critical damping of the system ( $C_c$ ) is as a function of the circular frequency  $\omega$ , and is defined as

$$C_c = 2 M\omega.$$

It is often convenient to express damping as the ratio

$$\zeta = \frac{C}{C_c} = \frac{C}{2 M\omega}.$$

When expressed as a fraction,  $\zeta$  is called the fraction of critical damping; when expressed as percent,  $\zeta$  is called percent of critical damping.

The true damping characteristics of structural systems are very complex and difficult to determine. In fact, purely nonlinear systems cannot be characterized at all by parameters such as natural frequency and percent of critical damping, but only by response histories. However, it is common practice to express the damping of real systems in terms of  $\zeta$ . This is reasonable if the system is only slightly nonlinear. In such cases a linear dynamic system analysis is commonly performed, with the nonlinearities approximated by a larger value of damping.

By transforming the equations of motion of the system into modal coordinates  $q_n$  by letting  $x = \phi_n q_n$ , the modal equation for the  $n$  degrees of freedom can be written

$$\ddot{q}_n + 2 \zeta_n \omega_n \dot{q}_n + \omega_n^2 q_n = \frac{F_n(t)}{M_n}$$

where

$$M_n = \phi_n^t M \phi_n$$

$$C_n = \phi_n^t C \phi_n = 2 \zeta_n \omega_n M_n$$

$$K_n = \phi_n^t K \phi_n = \omega_n^2 M_n$$

$$F_n(t) = \phi_n^t F(t)$$

Damping values are sometimes assumed to be constant under all conditions. This assumption has not been found to be realistic under some circumstances and other approximations have been formulated. For uniform mass damping, the damping force on each mass is proportional to the mass

$$(F_d)_j = \alpha M_j \dot{x}_j$$

where  $\alpha$  is a constant,

$$C_j = \alpha M_j, \zeta_j = \frac{C}{C_c} = \frac{\alpha M_j}{2 M_j \omega_j} = \frac{\alpha}{2 \omega_j}$$

and

$$\alpha = 2 \zeta_j \omega_j$$

Thus, the fraction of critical damping for each mode is *inversely proportional* to circular frequency. A second assumption is uniform structural damping in which the damping is proportional to the stiffness, written as

$$(F_d)_j = \beta K_j \dot{x}_j$$

then

$$C_j = \beta K_j, K_j = \omega_j^2 M_j$$

$$\zeta_j = \frac{C}{C_c} = \frac{\beta K_j}{2 M_j \omega_j} = \frac{\beta \omega_j}{2}$$

and

$$\beta = \frac{2 \zeta_j}{\omega_j}$$

In this case the fraction of critical damping is *proportional* to the circular frequency.

Rayleigh proposed a damping matrix consisting of both mass and structural damping. Damping of the form

$$\zeta = \frac{\alpha}{2 \omega} + \frac{\beta \omega}{2}$$

is called Rayleigh damping.

## Experimental Measurement Techniques

A number of techniques have been developed to estimate damping from experimental data. The simplest and most commonly used are the logarithmic decrement and half power methods.<sup>4</sup> In the logarithmic decrement method the ratios of the amplitude of vibration  $x_n$  at any time and the amplitude after  $m$  cycles  $x_{n+m}$  are used to form the logarithmic decrement

$$\delta_m = \ln \frac{x_n}{x_{n+m}}$$

then

$$\zeta = \frac{\delta_m}{2 \pi m \frac{\omega}{\omega_d}} \approx \frac{\delta_m}{2 \pi m} = \frac{1}{2 \pi m} \ln \frac{x_n}{x_{n+m}}$$

where  $\omega$  and  $\omega_d$  are the undamped and damped natural frequencies, respectively. If the damping is less than 20%, the approximate form that neglects the change in frequency due to damping is sufficiently accurate (the error in calculating  $\zeta$  is less than 2%). The method is generally used with snap-back testing, in which the structure is displaced, released, and allowed to vibrate freely. A typical experimentally determined time displacement history suitable for use with this technique is shown in Figure 1.

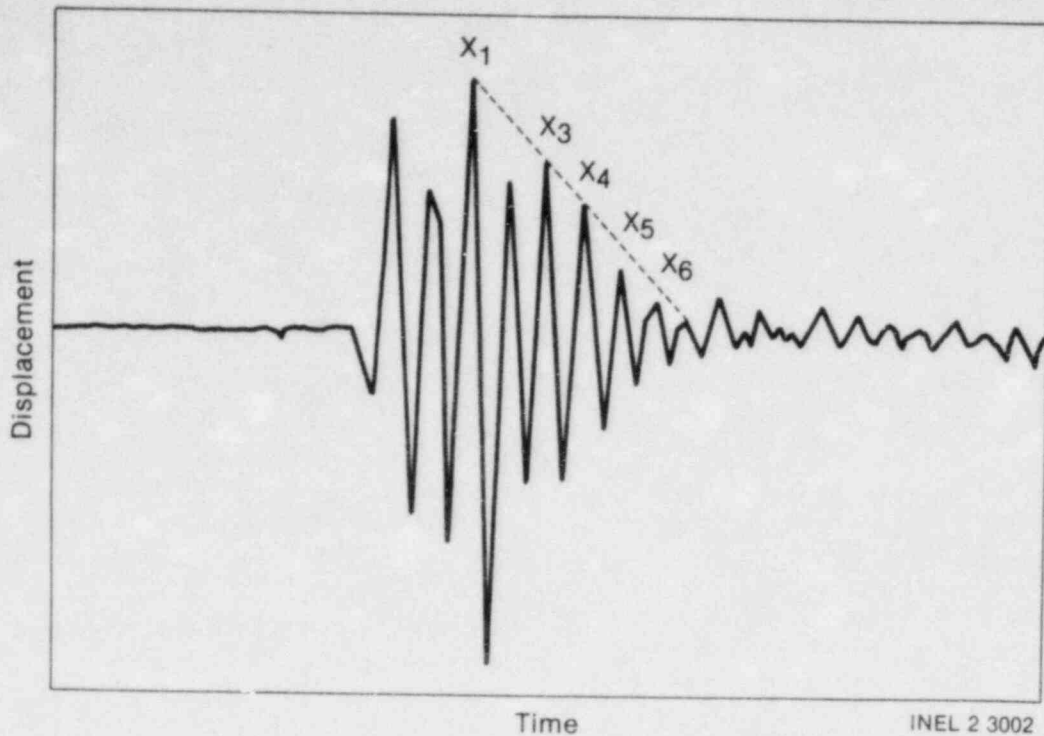


Figure 1. Typical logarithmic decrement curve.

The half power method uses a plot of response amplitude as a function of frequency to determine damping.<sup>4</sup> The damping ratio is approximately equal to

$$\zeta = \frac{f_2 - f_1}{f_2 + f_1}$$

where  $f_1$  and  $f_2$  are the frequencies where the response amplitude is 0.707 times the peak amplitude (see Figure 2). This method is useful for tests in which the excitation is sufficient to generate a frequency response curve, such as with shaker tests. Figure 3 shows a typical experimentally determined frequency response curve.

More precise (but also more complicated) procedures such as curve fitting and circle fitting have been developed and have been used to evaluate some of the data in the literature. A discussion and literature survey of these methods is contained in Reference 5. Reference 5 also describes some of the various methods used in structural dynamic testing.

One type of curve fitting method that will be used by EG&G to evaluate some of the damping data is discussed in "EG&G Program" section of this report and is called the complex exponential

method. This method obtains the inverse Fourier transform of the transfer function (see Appendix A) to give the impulse response in the time domain. This response form, which can be written as the sum of complex exponential functions, is approximated by an interactive polynomial curve fitting procedure. The roots of this polynomial yield the natural frequencies and modal damping of the measured response.

## Present Guidelines

The current NRC position on damping values to be used in dynamic structural modeling for the seismic design of nuclear power plant piping is set forth in Regulatory Guide 1.61.<sup>6</sup> The percent of critical damping for operating basis earthquake (OBE) and safe shutdown earthquake (SSE) load conditions are listed in Table 1 and are derived from recommendations given by Newmark, Blume, and Kapur.<sup>7</sup> Since the data base at the time the recommendations were made was limited, and since the values were designed to apply to a wide variety of piping systems, the values were deliberately set lower than the data would indicate. Lower bound damping values would ensure that response amplitudes and thus the corresponding stresses that would be compared to allowable values would not be underpredicted.

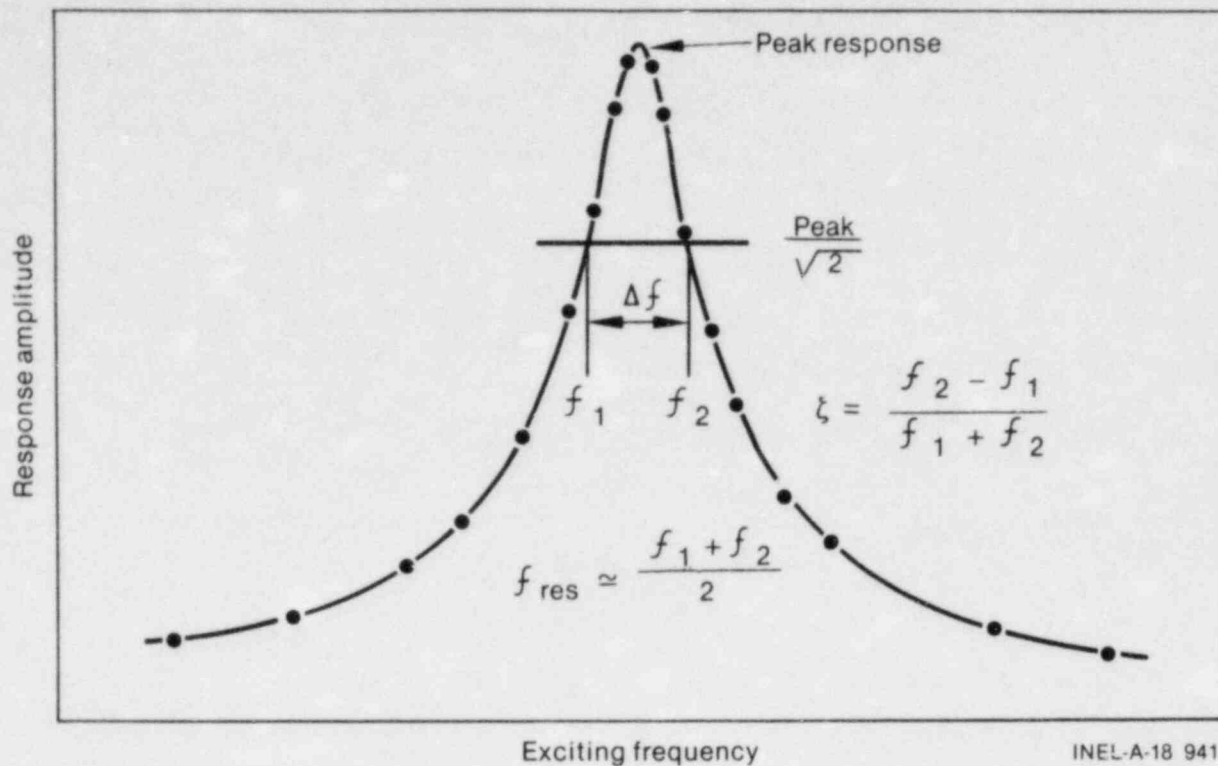


Figure 2. Half power method computation.

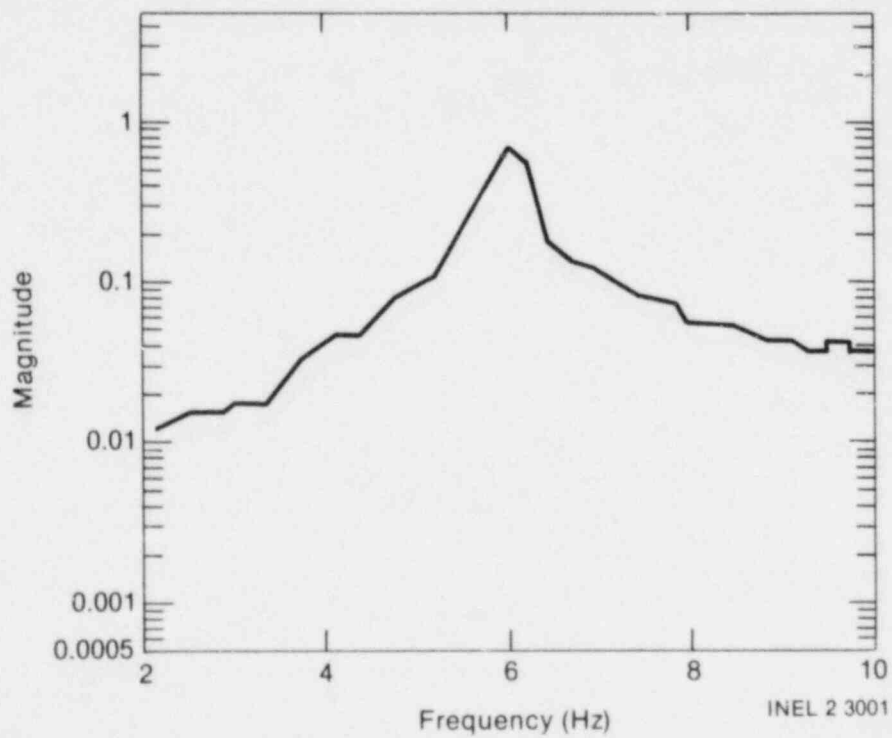


Figure 3. Typical frequency response curve.

**Table 1. Damping values from Regulatory Guide 1.61<sup>6</sup> (percent of critical damping)**

| Pipe Size                       | OBE or<br>1/2 SSE | SSE |
|---------------------------------|-------------------|-----|
| Large diameter (< 12 in.)       | 2                 | 3   |
| Small diameter ( $\leq$ 12 in.) | 1                 | 2   |

Since it was recognized that damping increased at higher response levels, the SSE levels were set at 1% of critical damping higher than OBE levels. Listing separate values for SSE and OBE allows a single analysis to be performed for each seismic event without first identifying system response and stress amplitudes. A more exact, but inefficient, method would be to first determine the amplitudes and then make use of the damping values associated with those amplitudes. Since damping affects response level, the process would have to be repeated a number of times until convergence was achieved.

Regulatory Guide 1.61 also allows an additional 1% of critical damping for piping over 12 in. in diameter than for piping equal to or smaller than this diameter. Experimental data indicates that the

larger diameter piping systems typically have higher damping values. However, upon more extensive interpretation of experimental data, a conclusion can be supported that the higher damping values may be a function of piping supports rather than pipe diameter.<sup>1</sup> This would result from the fact that larger diameter piping is typically supported by devices that tend to dissipate energy (snubbers, constant force hangers), while smaller diameter piping would be more likely to be supported by rigid restraints and spring hangers in which less energy is dissipated.

The Regulatory Guide 1.61 values were approved on an interim basis in 1973, but due to a continued lack of consensus on what the values should be, a revision has not been agreed upon. The ASME Code,<sup>8</sup> presents a lengthy discussion of methods to incorporate damping into structural analyses, but contains the same values as Table 1. No values are recommended for transients other than seismic events, such as fluid induced vibrations, by either the Regulatory Guide or the ASME Code.

Although the Regulatory Guide allows damping values higher than Table 1 if documented test data are provided to support higher values, few, if any, attempts have been made to use other values in analyses. Thus the newest generation of nuclear power plants have their piping systems designed with the damping values of Table 1.

## PARAMETERS THAT INFLUENCE PIPING SYSTEM DAMPING STATE-OF-THE-ART

Since the issue of Regulatory Guide 1.61 there have been a series of summary papers that have contained experimentally determined damping values.<sup>9,10,11</sup> Actually, Ibáñez and the ANCO Engineers group have contributed a considerable number of state-of-the-art papers on damping. For convenience, the previous ANCO papers have not all been referenced, since most are cited by Reference 11. It is not the purpose of this section to summarize all the damping data in previously published state-of-the-art articles, but to concentrate on identifying those articles that specifically relate to parametric influences on damping.

In general, the previously cited references have tended to give an estimated range for damping applicable to the entire system rather than concentrating on parameters that may have an influence on damping. This is due to several reasons. First, there is considerable scatter in the damping data, so an average value is typically reported. Secondly, most of the data were not taken for the expressed purpose of computing system damping, but for characterizing the overall dynamic behavior of a specific piping system. Finally, some of the new data were reported as justification for changing the Regulatory Guide 1.61 values on a one-for-one basis, rather than considering parameters other than pipe diameter and type of earthquake, which are the only factors considered in Table 1.

There has been no comprehensive program in the U.S. that has varied one parameter at a time to systematically determine its influence on pipe damping. The Japanese have been working on their Seismic Damping Ratio Evaluation Program (SDREP) for several years in which parameters that influence damping were varied and existing data were evaluated using multiple regression analysis. The bulk of the data is unavailable in the U.S., and only brief summaries were presented in several SMiRT papers.<sup>12,13,14</sup> In the previous EG&G report,<sup>1</sup> data from German and U.S. sources were used to qualitatively assess factors that affect damping. This effort was only partially successful, because the data did not identify all parameters during the testing, (for example, the stress amplitude was not generally computed) nor were the data generated specifically to evaluate damping.

In summary, there are insufficient data to effectively characterize the influence of various parameters on damping available in the U.S. at the present time. The following sections describe the present state of knowledge of parametric influences on damping, and discuss new data expected to become publicly available in the near future. To complete the overall picture, a discussion of what is not known, or "Gaps In The Present Knowledge" section, should be reviewed in the context of the present section. To repeat, this section is not intended to be a complete state-of-the-art discussion on damping itself, but to give a brief overview of the current knowledge on parameters that influence damping.

### Parameters That Influence Damping

In Reference 1, the author listed a number of parameters that were judged intuitively and from previous articles to be the principal factors influencing damping. In a slightly modified format, these parameters are:

1. Excitation parameters
  - a. Type of excitation (seismic, fluid induced)
  - b. Level of excitation (low, intermediate, high)
  - c. Direction of excitation (vertical, along pipe axis, in support direction)
2. Physical parameters
  - a. Type of pipe (diameter, material, thickness)
  - b. System condition (hot or cold, filled or empty)
  - c. Insulation
  - d. Type of supports (spring hangers, snubbers, etc.)
  - e. Geometry (support spacing, number of bends and elbows)

3. Response parameters
  - a. Response frequency
  - b. Response amplitude
  - c. Response direction (vertical, longitudinal, transverse).

The two major attempts to answer a broad segment of these questions have been through the Japanese Seismic Damping Ratio Evaluation Program<sup>12</sup> and the previously cited EG&G report.<sup>1</sup> The Japanese results by Shibata are reproduced verbatim in Table 2. For a simple comparison between the EG&G results and a paraphrase of the Shibata results, refer to Table 3. A more detailed discussion of each parameter is provided below.

In Reference 1, EG&G reported a very slight trend that indirect methods, i.e., when the piping system vibration was induced through the supporting structure, produced lower damping than when the excitation was placed on the piping directly. However, the effect represented only about 1/2 of 1% of critical damping, which was judged to be insignificant. Shibata reported that the correlation was hardly observed. The EG&G report found that higher levels of excitation produced higher damping levels. The Japanese did not consider this parameter. Intuitively, larger excitation levels would be expected to produce higher stresses, and more impacting of supports and other nonlinear effects, which would induce higher damping levels. Since excitation level is closely associated with response level, which is the parameter more often reported by investigators, this parameter should also be considered in conjunction with the discussion on response level below. Although neither source reported a correlation between excitation direction and damping, intuitively, response in the direction of an energy dissipating support would be expected to produce greater damping values than excitation perpendicular to the axes of supports.

Neither source concluded that the pipe size influenced damping. This is contrary to the philosophy of Regulatory Guide 1.61, which lists pipe diameter as one of the two parameters on which allowable damping for piping analyses is based. However, as previously stated, the supports themselves may be the parameter contributing to the damping, rather than the pipe size, since larger diameter piping systems typically have

supports that dissipate more energy than the supports of smaller diameter piping. Shibata found that carbon steel piping had slightly higher damping than did stainless steel piping. Further, Reference 12 reported that fluid filled piping systems had higher damping values than empty piping; although in Reference 15, the effect was reported to be negligible in comparison to the effect provided by insulation. In the one case cited, EG&G in Reference 1 reported no change in damping values computed when the system was varied from empty to water filled. Intuitively, fluid friction in the piping system could dissipate more energy and thus produce slightly higher damping. However, based on available data, the effect may be negligible. While Reference 12 reported that the correlation of damping with insulation was low, Shibata in Reference 15 concluded that insulation makes a more substantial contribution to overall damping, and that the damping increases with the thickness of the thermal insulation. The EG&G report did not have sufficient information to investigate the influence of insulation on damping. The strongest contributor to piping system damping in both References 1 and 12 was the type of supports used. A consistent finding was that systems supported by snubbers and constant force hangers were judged to have higher damping values than systems supported by rigid restraints. The Japanese reported<sup>12</sup> that an effect due to the number of elbows was not observed, and that a correlation of damping with the number of supports was hardly observed. EG&G<sup>1</sup> did not have enough data to conclude if system geometry was an important factor.

In the EG&G report,<sup>1</sup> considerable effort was made to relate response frequency to damping. The response frequency is a parameter that includes support stiffness and spacing, mass distribution, pipe size, and geometry. Conveniently, it is also typically reported for all piping system dynamic characterization tests. In several cases, particularly that of the data from the Heissdampfreaktor (HDR) piping, an inverse frequency/damping correlation is seen. Shibata's data also shows a weak correlation of frequency with damping. In other data, damping seems to be constant with frequency. This anomaly is discussed in more detail in "Gaps in Present Knowledge" section. Both the EG&G and Shibata results indicate that there is a weak correlation between response amplitude and damping. This seems to be an intuitively reasonable

**Table 2. Shibata's results  
(from Reference 12)**

| Damping-Contributing Factor                  | Discussion About the Correlation Between Damping and Each Factor  |
|--|---|
| 1. Type of plant                             | The results show a strong correlation. It is considered that this is not only due to essential difference between BWR and PWR, but is the damping characteristics not explained with factors.   |
| 2. Test method                               | The correlation with test method is hardly observed.  |
| 3. Pipe diameter                             | The correlation is observed in some cases. These two factors have basically high correlations.  |
| 4. Thickness of pipe                         | With many other factors such as "fluid in pipe," "supporting conditions" and so on. Therefore, it is doubtful whether this result shows a true correlation.   |
| 5. Pipe material                             | The data of pre-operating tests were measured at small amplitudes where material damping is considered small, observed correlation with material is not easily conceivable. Results show CS pipings have slightly high damping than SS pipings. |
| 6. Insulation                                | The correlation with damping is low.  |
| 7. Fluid in pipe                             | Weak correlation with fluid in pipe is observed. In other words pipings containing fluid have higher damping values.  |
| 8. Support-type                              | Strong correlation with support-type is observed. Contribution to damping becomes greater, in the order of rigid hanger, restraint, U bolt and oil snubber.   |
| 9. Deflection amplitude                      | The correlation with amplitude is weak. This results seems to be caused by that most of the data of pre-operating tests were measured at very small amplitudes.   |
| 10. Frequency                                | The weak correlation with frequency is observed. Damping value decreases as frequency increases.  |
| 11. Number of supports                       | The correlation with the number of support is hardly observed.  |
| 12. Piping equipped with/without valve, pump | The correlation is observed in some groups of the data. It is considered to be caused by the effect of bias in sampling data.   |
| 13. Number of elbows                         | This factor is selected to be one expressing geometric effect. The distinct correlation with the number of elbow is not observed.   |



**Table 3. Parameter influence on damping as reported by Ware and Shibata**

| Parameters       | Reference 1<br>(Ware) | Reference 12<br>(Shibata) |
|------------------|-----------------------|---------------------------|
| Excitation       |                       |                           |
| Type             | No                    | No                        |
| Level            | Weak                  | —                         |
| Direction        | No                    | —                         |
| Physical         |                       |                           |
| Type of pipe     | No                    | No                        |
| System condition | No                    | Weak                      |
| Insulation       | —                     | Weak                      |
| Support type     | Strong                | Strong                    |
| Geometry         | —                     | None                      |
| Response         |                       |                           |
| Frequency        | Weak                  | Weak                      |
| Amplitude        | Weak                  | Weak                      |
| Direction        | No                    | —                         |

relationship because with larger amplitudes, the stress level increases and nonlinear effects such as gaps become more pronounced. Unfortunately, most of the data was generated at low stress levels, and in addition, the actual stress levels were not reported. Other researchers have as a general rule concluded that damping increases with response level, although an applicable quantitative correlation has not yet been determined. This relationship is discussed in more detail in "Gaps in Present Knowledge" section. No correlation was found in the response direction by EG&G, although as in the case of the excitation direction, one might expect higher damping in the direction of the support axes.

Other investigators have commented on one or more of these parameters in their reports and papers,<sup>9,10,11,16,17,18,19</sup> These results will in part, be discussed in the related material in Gaps in Present Knowledge section.

In summary, only a few qualitative trends have been observed that correlate damping with its influencing parameters, and the comprehensive task of defining the quantitative relationships that are necessary to fully understand the phenomenon

is just beginning in the U.S. The following section describes some of the new data released and expected to be released during 1982, and early 1983.

### New Data

Other than the substantial quantity of Japanese data that is not presently available in the U.S., the major U.S. test data completed by 1982 and not previously released are the EPRI/ANCO testing at the Indian Point plant and in the ANCO labs, General Electric (GE) safety/relief valve piping results, and U.S. Department of Energy (DOE) testing of thin walled liquid metal fast breeder reactor (LMFBR) nuclear grade piping. In addition, Battelle Institute in Frankfurt, West Germany, has released results from testing on a loop removed from the HDR plant.

The testing at the Indian Point plant was conducted on a feedwater line for EPRI by ANCO Engineers, who have the most experience performing large scale shaking of piping of all organizations in the U.S. Preliminary results can be found in Reference 16, but the final report has not yet

been released. Summary papers of the testing<sup>17,18</sup> show that the data from these experiments will make a substantial contribution to the understanding of nuclear power plant damping. ANCO has also conducted tests on a Z-bend piping configuration in its laboratories for EPRI. The data, when released, is expected to be used both for analysis/experiment benchmarking purposes, and for pipe damping results.


A GE report<sup>19</sup> summarizes the data for a number of safety/relief valve tests on boiling water reactor (BWR) plants and subsystems. The significant conclusions from the report were:

1. The GE damping test data reported here (in Reference 19) showed no strong dependency upon either frequency or pipe size but did tend to increase with nominal pipe bending stress.
2. The GE damping data, when plotted as a function of stress, did indicate that the damping in these BWR piping systems was at least 5% (of critical damping) for measured stresses considerably less than the ASME Code service level A and B limits.

See "Gaps in Present Knowledge" section for GE data as it relates to response amplitude.

The Battelle Institute report<sup>20</sup> contains some damping values found during test rig experiments on piping performed at MPA Stuttgart and shows the influence of snubbers and hangers. An isometric of the system is shown in Figure 4, and the line diagram in Figure 5 identifies the measurement locations. Results are listed in Table 4. The most significant result is that for the main line, the damping for the X-Z plane mode dramatically increased when a hanger or snubber was added.

Several additional tests are expected to be conducted and reports issued in the U.S. in the 1982 to 1983 period that will further assist in contributing to the overall understanding of piping damping. Hanford Engineering Development Laboratory (HEDL) has been testing small piping systems in the LMFBR thin walled pipe area of research conducted through the DOE.<sup>21</sup> Detailed results of this series and testing of a larger LMFBR line by Schott and Hulbert of Westinghouse Advanced Reactors Division (WARD) are expected to be made available in 1983. Further tests in the EPRI/ANCO series have been proposed, possibly in cooperation with the NRC. Finally, EG&G anticipates conducting a series of tests that would be run at the Idaho National Engineering Laboratory (INEL). The outline for these tests will be presented in "EG&G Program" section of this report.

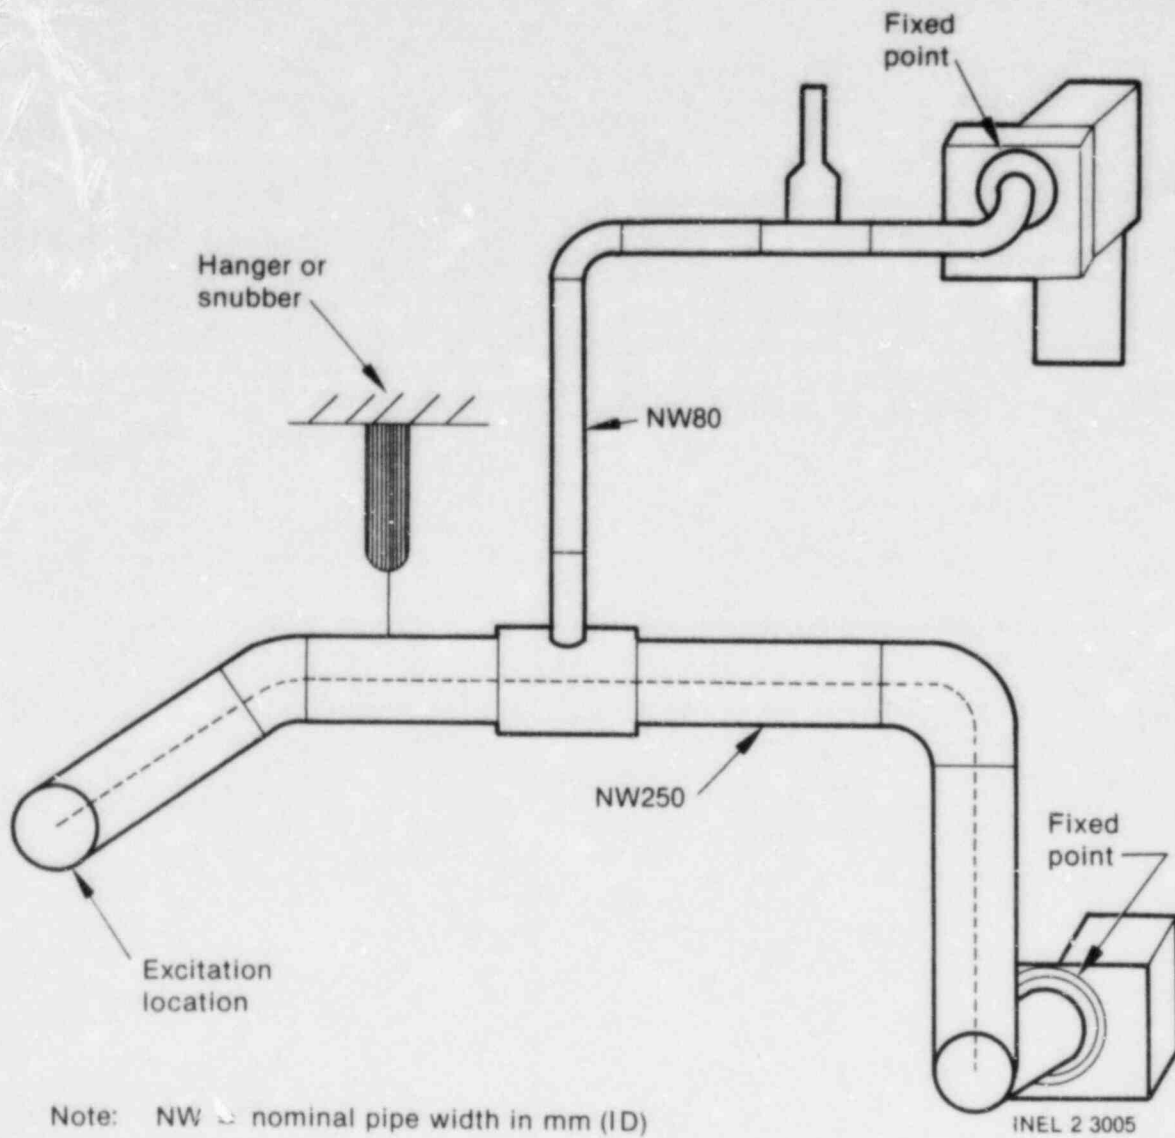

Note: NW = nominal pipe width in mm (ID)

Figure 4. Battelle Institute test system.

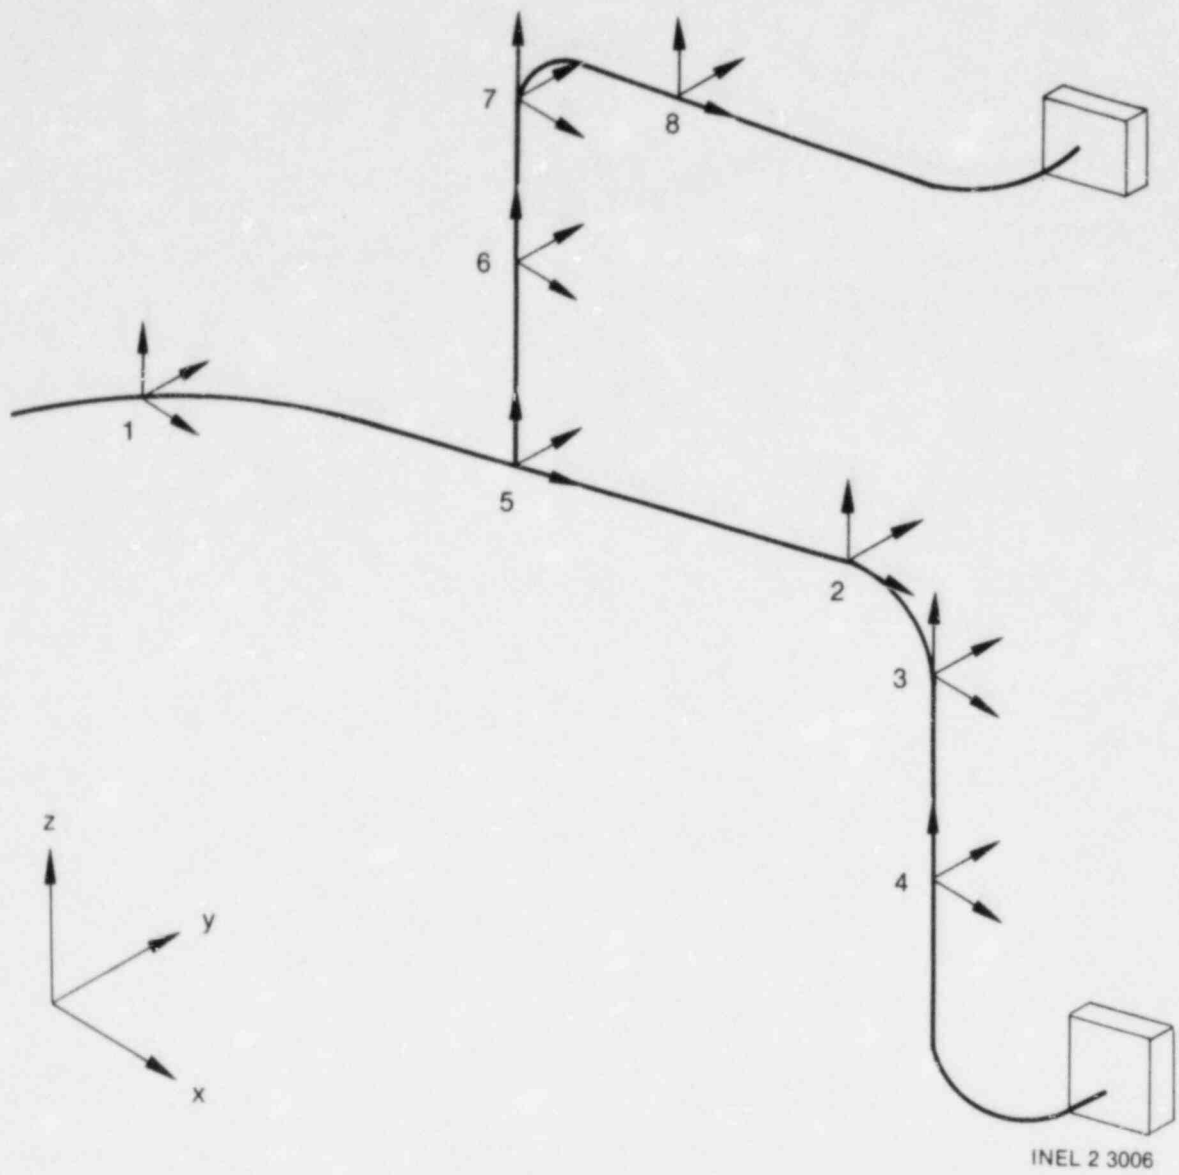


Figure 5. Schematic of Battelle Institute test configuration.

**Table 4. Battelle Institute modal damping results  
(piping empty and unpressurized)**

| Bending Mode             | Percent of Critical Damping |            |            |                               |                |                | Frequency <sup>a</sup><br>(Hz) |
|--------------------------|-----------------------------|------------|------------|-------------------------------|----------------|----------------|--------------------------------|
|                          | Without Hanger or Snubber   |            |            | With Hanger<br>in Z-Direction | With snubber   |                |                                |
|                          | X-Response                  | Y-Response | Z-Response |                               | In Y-Direction | In Z Direction |                                |
| Y-direction              | 0.35                        | 0.5        | 0.4        | 0.5                           | —              | 0.4            | 5.08 to 5.28                   |
| X-Z plane<br>(+X/+Z)     | 0.4                         | 0.45       | 0.45       | 9.3                           | 0.6            | 11.2           | 6.13 to 8.88                   |
| X-Z plane<br>(-X/+Z)     | 0.4                         | 0.3        | 0.25       | — <sup>b</sup>                | 1.4            | —              | 14.01 to 15.31                 |
| Y-direction              | 0.35                        | 0.4        | 0.4        | 0.42                          | 1.8            | 0.5            | 15.08 to 15.79                 |
| Bypass in<br>Y-direction | 0.4                         | 0.4        | 0.5        | 0.4                           | 0.6            | 0.4            | 18.00 to 18.33                 |
| Bypass in<br>X-direction | 0.2                         | 0.15       | 0.15       | 0.2                           | 0.23           | 0.15           | 42.95 to 43.11                 |
| Bypass in<br>Y-direction | 0.3                         | 0.25       | 0.40       | 0.4                           | 0.3            | 0.4            | 45.49 to 45.54                 |

a. Varies slightly with support type.

b. Nonlinear resonance characteristic (higher damping).

## IDENTIFICATION OF PARAMETRIC EFFECTS

From the brief discussion above on the state-of-the-art, it was concluded that from the sparse data base, only overall trends in parameters that affect damping have been identified. Most of the tests have been for general characterization of the dynamic response of piping systems rather than damping, so that the supplementary data necessary for a parameter study (such as stress levels) are not typically reported. This section gives a more detailed discussion of the gaps in the present overall understanding of piping damping, and identifies some goals that the U.S. program could strive to accomplish in the next several years.

### Gaps in Present Knowledge

From the state-of-the-art discussion above trends from available data were identified. Qualitatively, the parametric influences in order of importance would seem to be:

1. Strong Influence
  - a. Type of Supports
2. Weak Influence
  - a. Response Amplitude
  - b. Response Frequency
  - c. Insulation
3. Little or Unknown Influence
  - a. Geometry
  - b. Type of Excitation
  - c. Direction of Excitation or Response
  - d. Pipe Size.

Even with these trends there are inconsistencies in the data, and a lack of quantitative information. To further clarify the gaps in knowledge some examples are given below.


**Support Type.** It has been conclusively demonstrated<sup>12,20</sup> that the addition of energy

dissipating supports adds damping to a system. An example is shown in Figure 6, which is taken from Reference 12. However, data on the quantitative influence of the wide variety of types of supports (sway braces, rigid restraints, spring hangers, constant force hangers, and snubbers) under varying levels of response amplitude are not currently available in the U.S. Further questions can be raised as to what effect multiple supports would have over a single support, and how various combinations of supports would change the damping of a system.


**Response Amplitude.** In general, it has been established that increased response amplitude results in higher damping.<sup>11,19</sup> It was pointed out in Reference 1 that the relationship between excitation/response levels and damping is not altogether straightforward, since if the increased excitation causes higher damping, the higher damping would in turn inhibit response motion. Furthermore, the data are sometimes contradictory. Figures 7 and 8 (from References 22 and 19, respectively) show increased damping with response (stress) level up to and beyond yield stresses. On the other hand, Figure 6 shows that damping decreases with stress level. This anomaly can perhaps be explained by the fact that the Figure 6 data were taken at low response levels, and that the damping mechanism may have been Coulomb friction that would decrease with response level. Such a phenomenon was also observed by ANCO in testing a 5 in. pipe at the Diablo Canyon nuclear power plant<sup>22</sup> in which the damping decreased, then increased with acceleration level, as shown in Figure 9.

One constraint in determining the influence of response amplitude is that much of the test data was taken at low stress levels for safety reasons during in-situ testing. Also, the stress level was not generally computed or reported. Consequently, the task of determining system damping at high stress levels must usually be determined in laboratory experiments. Reference 5 discusses various methods that could be used to extrapolate low level excitation damping results to high level excitation situations, but the lack of actual data is a present barrier to such an effort.

**Response Frequency.** Another parameter sometimes characterized by contradictory data is

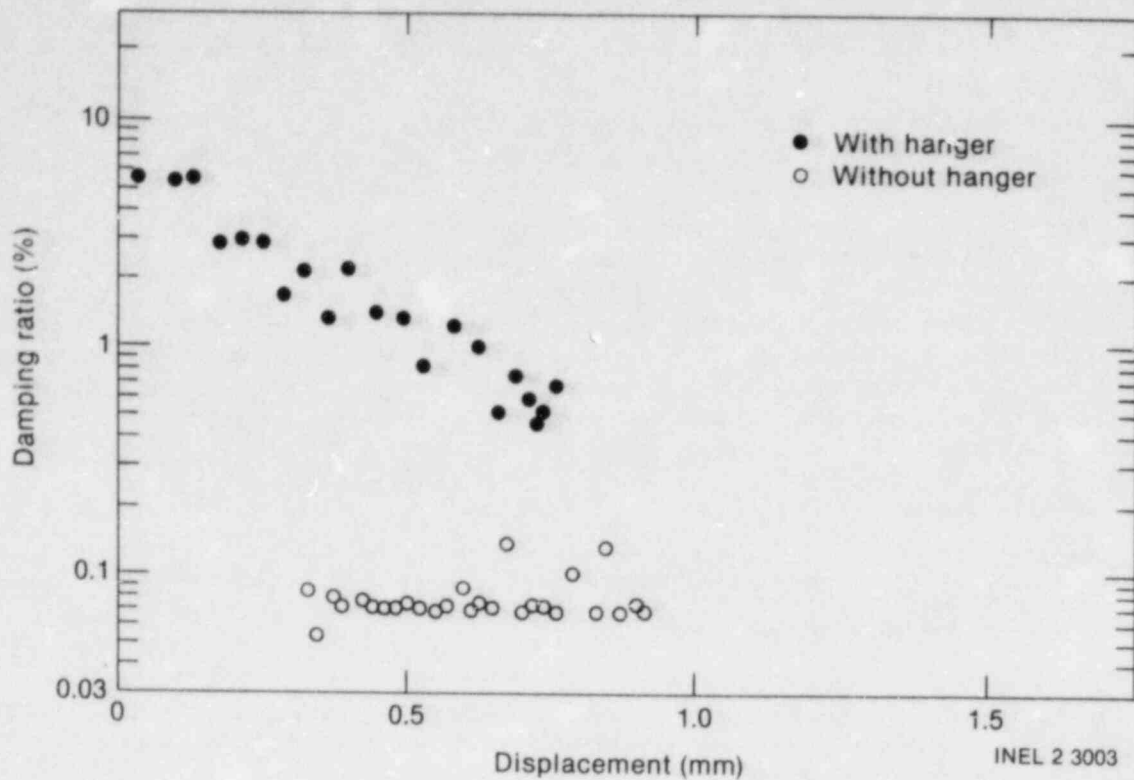


(A) Straight Piping Model

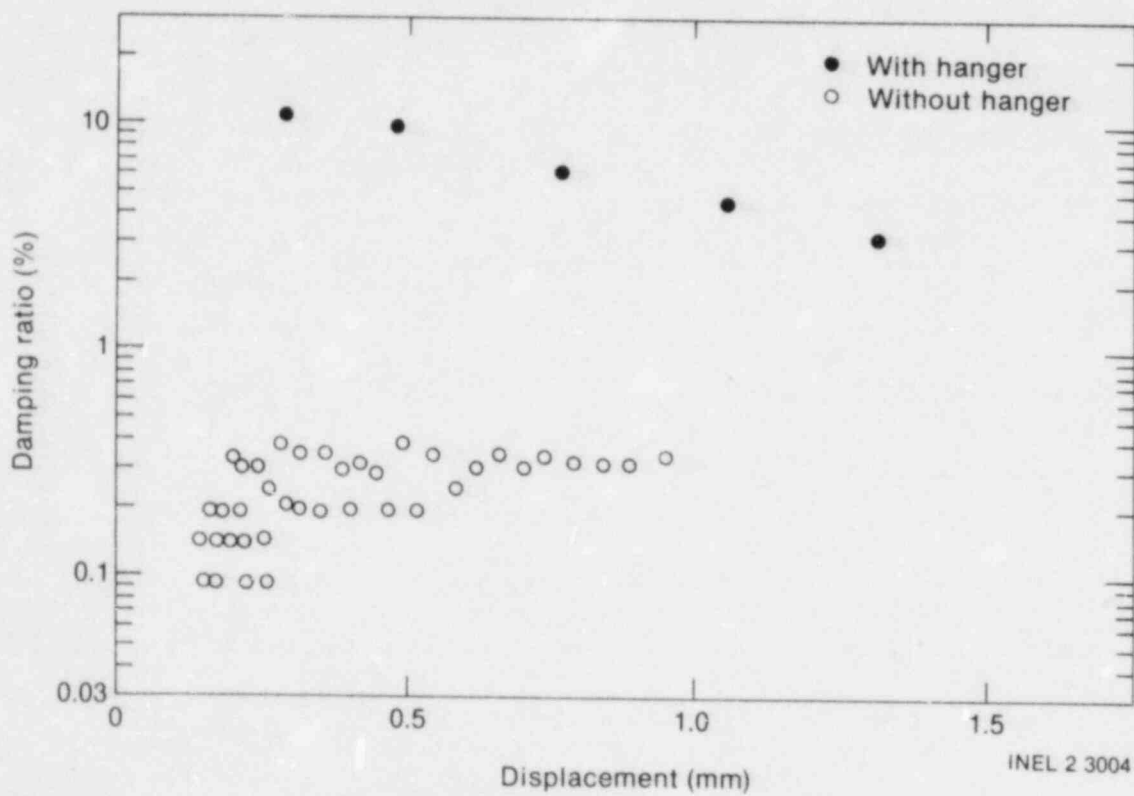

(B) 3-Dimensional Piping Model

Figure 6. Effect of energy dissipating supports.

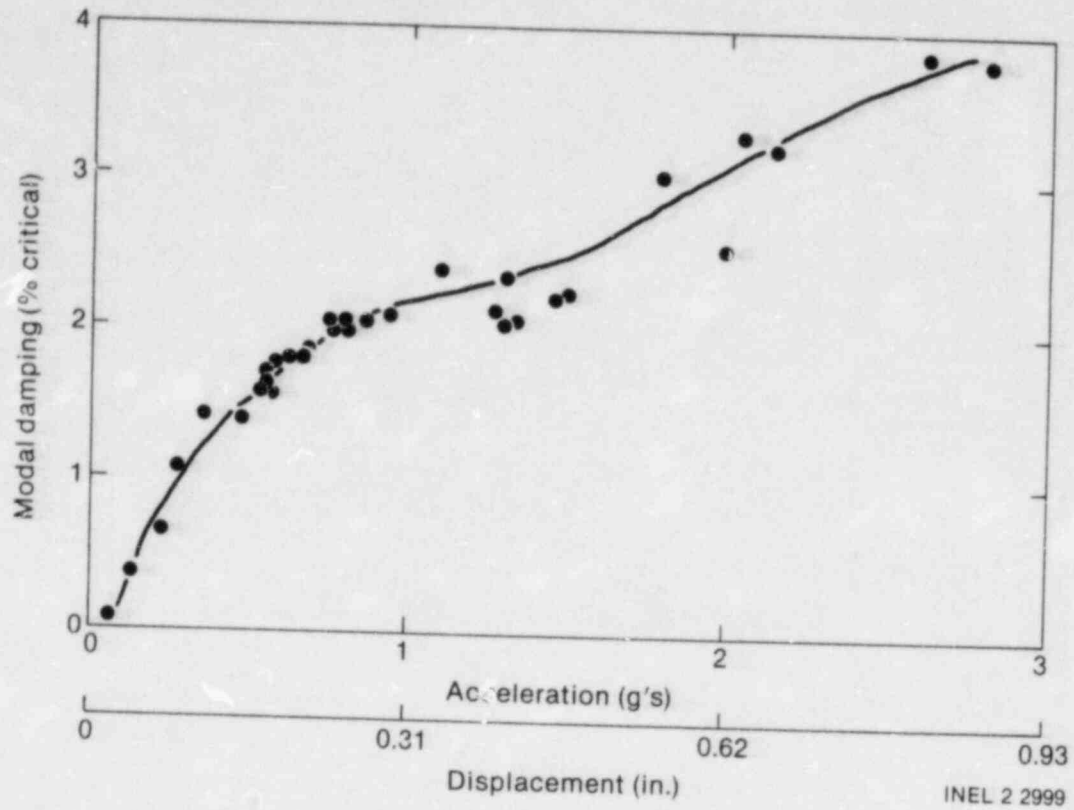

Damping vs Response Amplitude

Figure 7. ANCO test data.

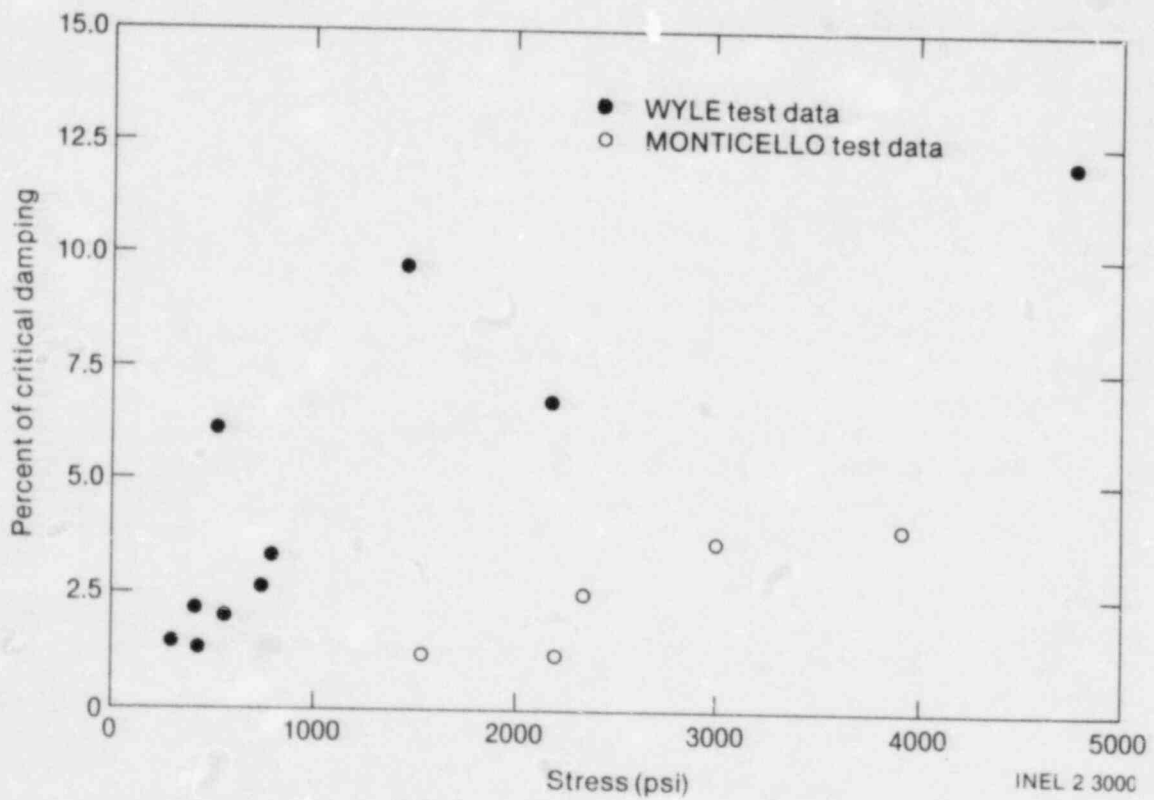


Figure 8. GE test data.



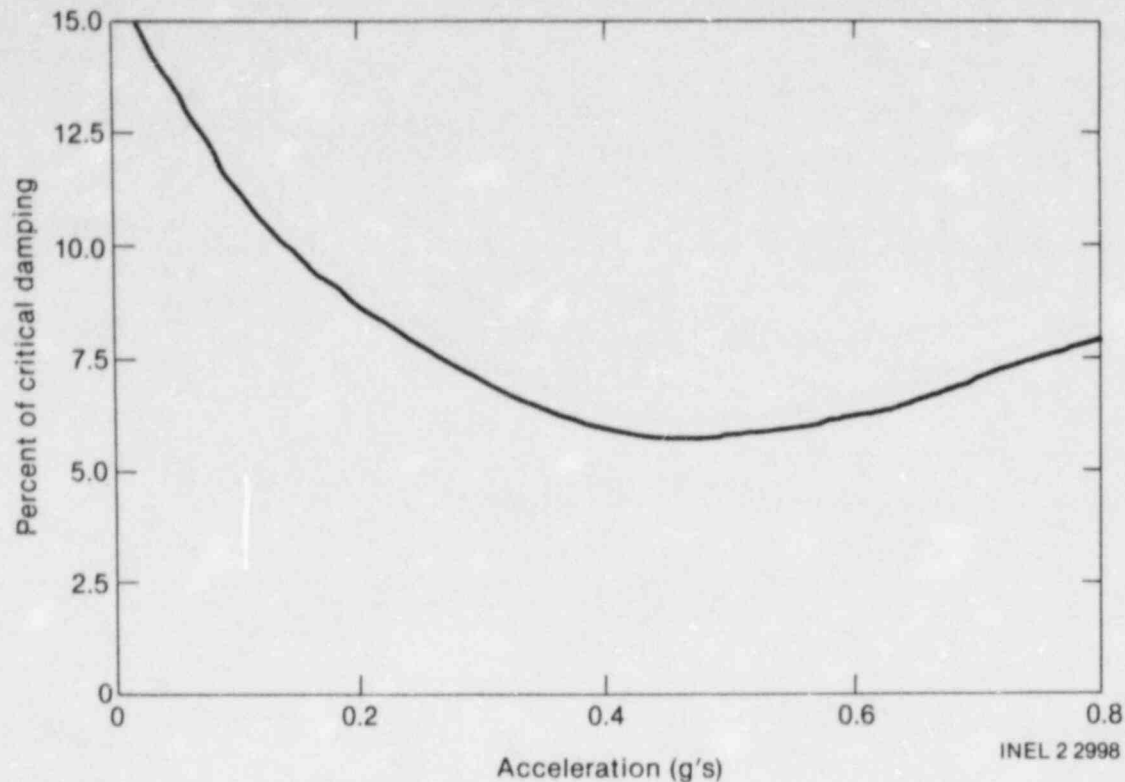


Figure 9. Diablo Canyon test data.

the response frequency. In Reference 1 the author postulated that this might be a parameter of convenience since it related many of the stiffness and mass variables. Several of the piping systems surveyed in Reference 1 showed an inverse frequency/damping relation, especially below 10 Hz, as demonstrated by Figures 10, 11, and 12. This phenomenon was also observed by the Japanese.<sup>12</sup> However, other data does not tend to support the premise that damping varies with frequency. The GE test data report<sup>19</sup> states that no such trend was observed, and the preliminary Indian Point data<sup>1,16</sup> shows that damping is relatively constant with frequency as shown in Figure 13. When the remaining EPRI/ANCO data from the Indian Point test series is finally released, this point may be further clarified.

**Insulation.** No program to thoroughly assess the affect of insulation has been carried out and reported in the U.S. Since the EPRI/ANCO tests at Indian Point were undertaken with both insulated and noninsulated conditions, the resulting data, when released, may shed more light on the subject. In the meantime, the Japanese conclusions reported in Reference 15 offer the best

available insights at this time. These are quoted from Reference 15 as follows:

1. Thermal insulator (calcium silicate) contributes to increasing of the damping of piping system.
2. The component characteristics test of thermal insulator indicated that the damping ratio of piping with the calcium silicate thermal insulator increases as the thermal insulator becomes thicker and the pipe diameter becomes larger, and as the response acceleration becomes larger and the vibration frequency becomes higher. While the damping ratio of the reflective metal insulator is observed considerably lower than that of the calcium silicate thermal insulator.
3. As an example of an estimating formula for damping ratio of piping system with thermal insulator, the following equation was obtained from the component damping characteristics test.

$$\text{Log } h = 0.09 D + 1.699 Rm + 0.088 d - 1.173$$

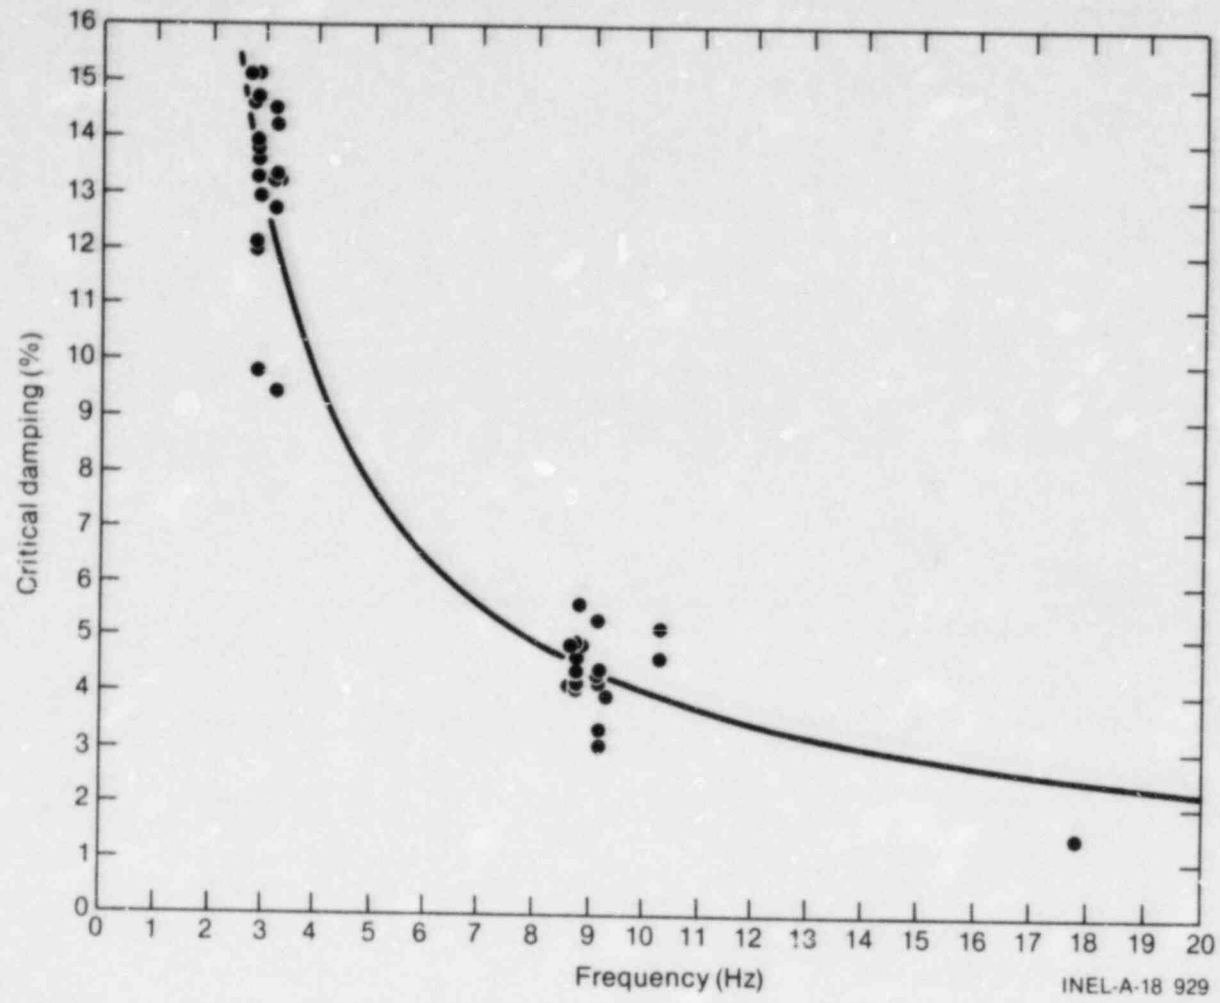


Figure 10. HDR PDL snapback test data.

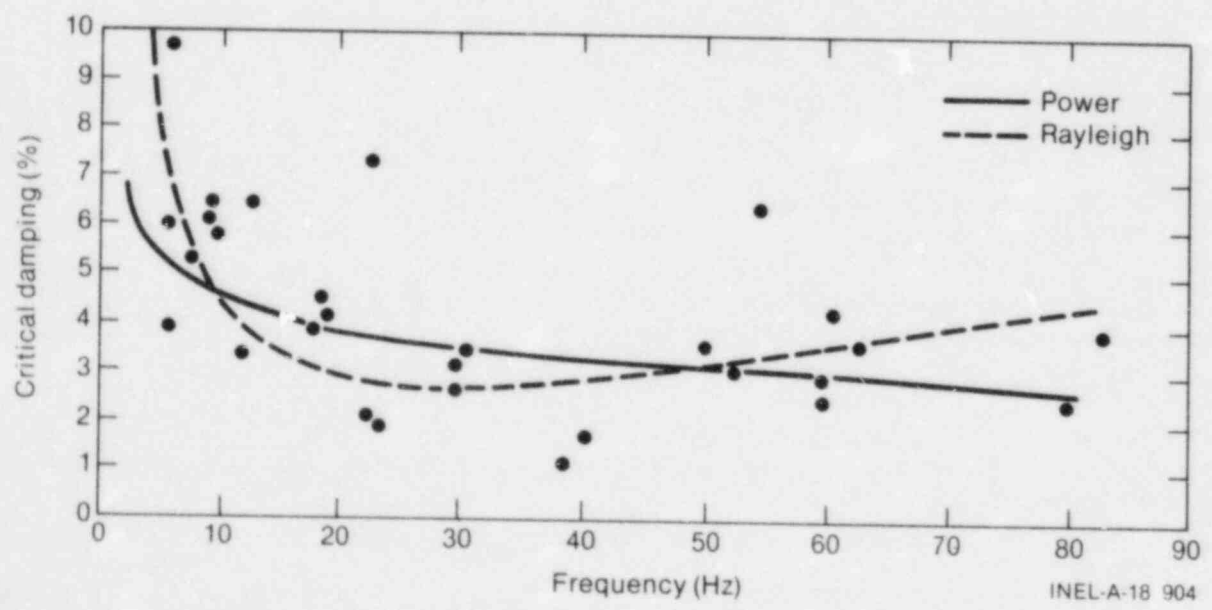


Figure 11. LaSalle recirculation line data.

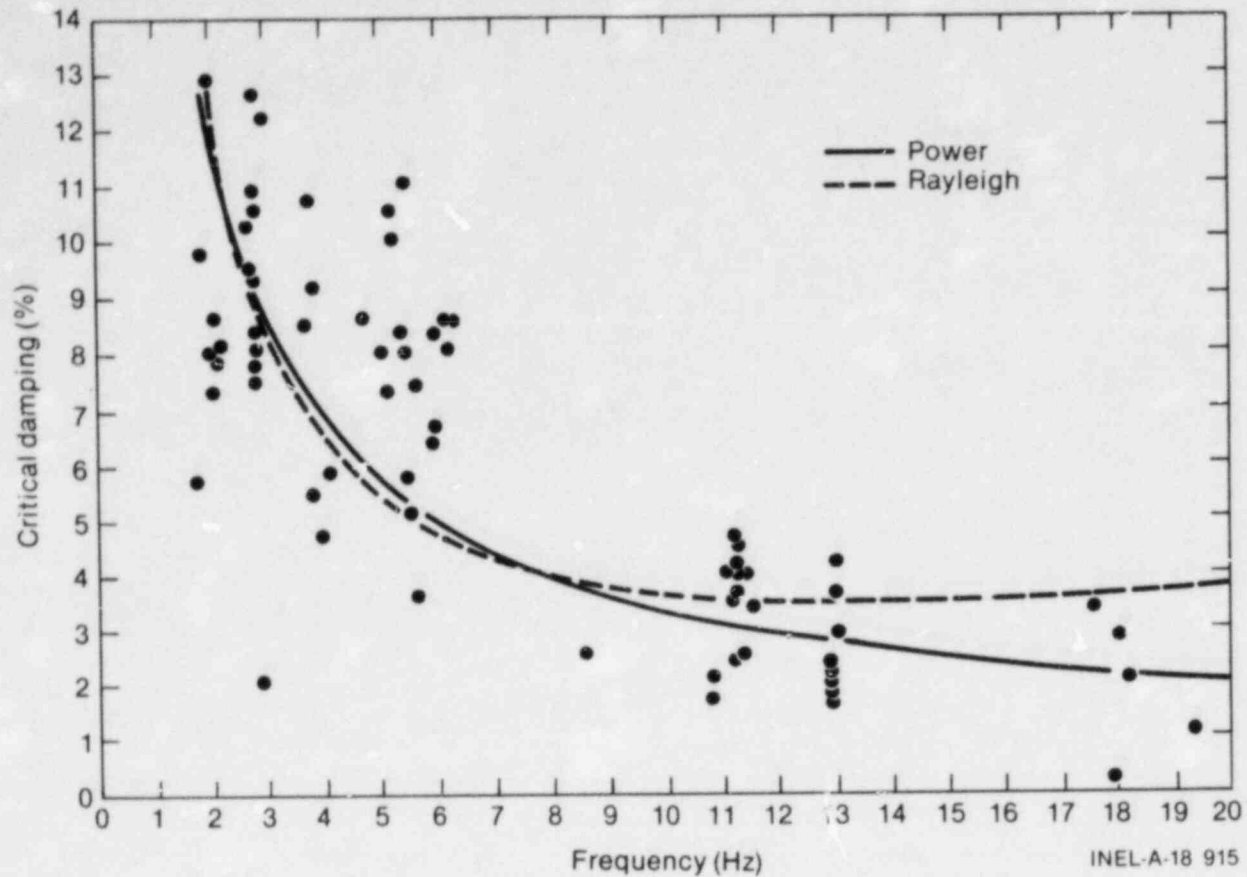


Figure 12. HDR URL snapback test data.

where

$h$  = damping ratio (%)

$D$  = nominal diameter (inch)

$R_m$  = mass ratio of thermal insulator to piping


$d$  = response displacement (mm).

4. The damping effect of internal fluid is negligibly small as compared with that of thermal insulator.
5. The simplified piping model tests showed that the damping effect of the thermal insulator is assumed to be 1/2 by the translational motion of piping and thermal insulator, and also to be 1/2 by the friction at the overlapped portions of aluminum plate. Furthermore, the restraint without gap does not affect the

damping, and conversely piping supported by the restraint with gap shows nonlinear behavior and the response acceleration does not develop more than a certain value.

6. The scale model test showed that the large damping ratio is obtained by gaps between piping and the thermal insulator, and by gap and friction at supporting parts of piping system.
7. In seismic design of piping system for nuclear power plant, the damping ratio, 0.5% is specified in Japan. From above-mentioned results, it may be concluded that the larger damping ratio than the specified value is applicable to actual design of piping system with thermal insulator."

**Summary.** Obviously, there are many gaps in our understanding of the phenomenon of piping damping, which can only be filled in by continued testing and data evaluation. A discussion of

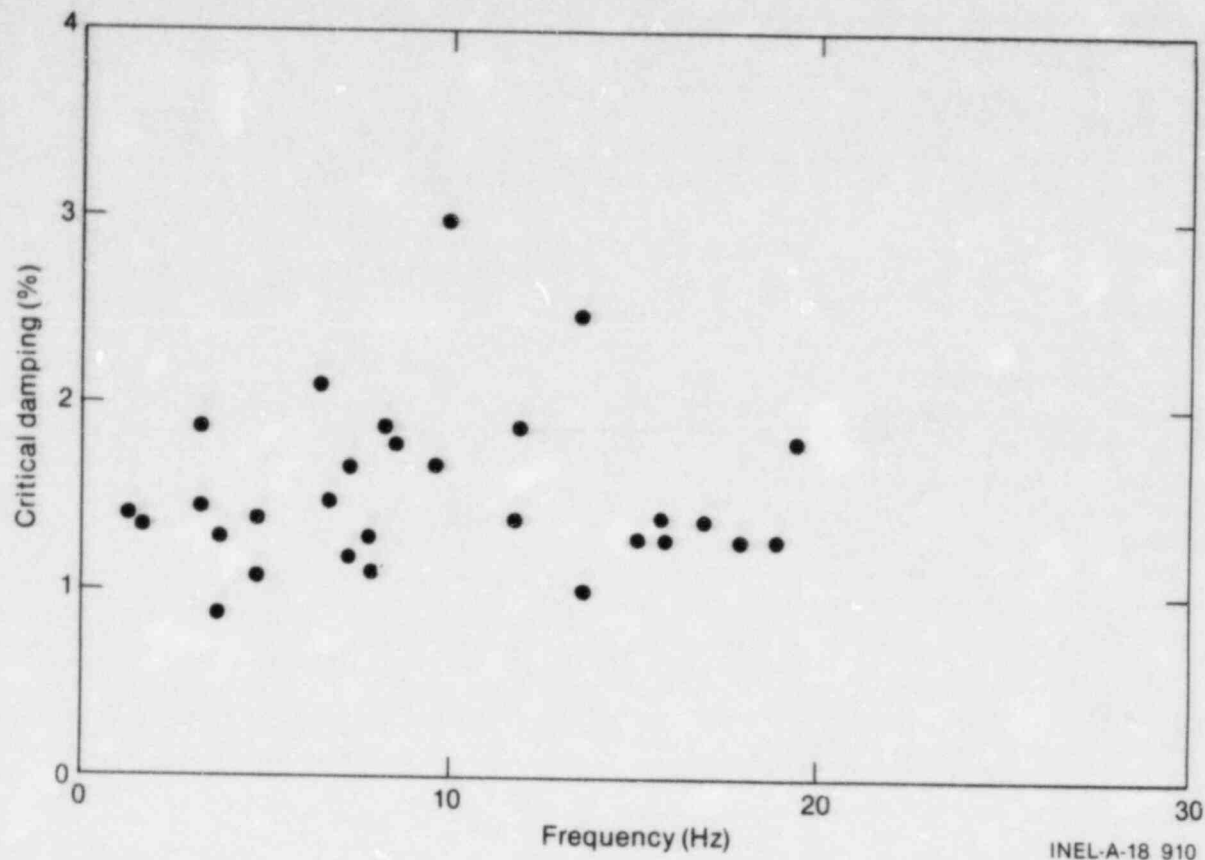

INEL-A-18 910

Figure 13. Indian Point feedwater line data.

potential goals is described below for the U.S. program. Anticipated EG&G contributions to such a program are presented in the "EG&G Program" section.

## Potential Goals

For a program to keep on a consistent course, it is helpful for a set of goals to be established and followed as the outline of the program develops. The program should be flexible enough so that changes can be made to the goals, and new goals added, based on the information obtained from previous stages. This section outlines some potential short and long range goals for which the U.S. damping study program could strive. The Pressure Vessel Research Committee (PVRC) Technical Committee on Piping Systems has already established a Damping Value Task Group<sup>23,24</sup> to begin efforts to bring about revisions to the current guidelines. The following recommendations do not contradict the approach the PVRC Committee has adopted to date.

**Short Term Goals.** It will doubtlessly take several years to acquire the knowledge of damping values and their influencing parameters required to form an adequately justifiable basis, backed up by solid technical sources, for allowable damping values to be used in nuclear power plant piping analyses. Meanwhile, the nuclear industry would be saddled with the present guidelines, which are generally accepted to be too conservative and are further considered not to be in the best interests of the country as a whole. For a number of years, there have been continued calls for revisions to the current guidelines.<sup>25</sup> Based on the available data, immediate changes have been recommended from an allowable of 5% of critical damping by GE<sup>19</sup> to 10% by Rodabaugh (in a letter appended to Reference 24). J. D. Stevenson<sup>26</sup> compiled best estimates of mean values of damping below 10 Hz and arrived at 5.8% of critical damping for the actual stress levels at which the tests were conducted, and 7.3% of critical damping at SSE stress levels.

In order to initiate a change before many more nuclear power plants are designed and built, it

seems feasible that the present allowable percent of critical damping guidelines could be raised based on the data reported since the release of Regulatory Guide 1.61. However, it should be recognized that the pipe diameter and the seismic excitation level are not the only parameters on which such an immediate change might be based, and that due to the present lack of sufficient data that identifies the effect of the various influencing parameters, a good deal of judgment by the experts in the field would need to be injected into the decisionmaking process. It should further be pointed out that although a single value might be the simplest way to set an allowable damping value, the result could be nonconservative for rigidly supported small piping lines, and overly restrictive for larger lines heavily supported by snubbers. A method of including the influencing parameters would seem to be both reasonable and achievable and is discussed below.

The PVRC will be actively pursuing such a recommendation by gathering available data and possibly applying regression analysis techniques.<sup>24</sup> A cooperative effort to revise the present guidelines involving electric utilities through EPRI, nuclear plant vendors and architect/engineers, and the Nuclear Regulatory Commission and its consultant EG&G is expected.

**Long Range Goals.** The long range goals of the damping program do not have the immediacy associated with the short term goals. Consequently, time can be taken to obtain a basic understanding of the interrelationships between damping in piping systems and the influencing parameters. From this research work, an expanded table of allowable damping values for various types of piping systems could be constructed to take the place of Table 1. As an example, Table 5 illustrates a conceivable format including a combination of factors that might be incorporated into such a table.

This table could be further modified by allowing certain Rayleigh damping coefficients for particular systems. Reference 1 showed that many piping systems could be characterized by Rayleigh damping and that several commonly used structural computer codes accept this type damping.

Additionally, more response levels (other than simply OBE and SSE) could be allowed.

The ultimate goal of the program should be to provide for the engineer the ability to select a piping system, consider its geometry and supports, and make an accurate prediction as to what would be reasonable damping values to be used in an analysis. In achieving this goal, several blind predictions based on actual piping systems might be made, and parameters adjusted by trial and error until reasonable agreement of results could be obtained. This approach is similar to the tack now being used to improve finite element modeling of systems.

While EG&G expects to be an active participant in short term plans, the major thrust of activities will be concentrated on the long term goals.

**Table 5. Hypothetical form of allowable damping values**

| Type of Support       | OBE<br>LF/HF <sup>a</sup> | SSE<br>LF/HF <sup>a</sup> |
|-----------------------|---------------------------|---------------------------|
| Rigid strut           | X1/X2                     | X11/X12                   |
| Sway brace            | X3/X4                     | X13/X14                   |
| Spring hanger         | X5/X6                     | X15/X16                   |
| Constant force hanger | X7/X8                     | X17/X18                   |
| Snubber               | X9/X10                    | X19/X20                   |

a. LF (low frequency, below 10 Hz)  
HF (high frequency, above 10 Hz).

Note: For insulators add the following percentages: Calcium Silicate Y  
For insulators add the following percentages: Reflective Z.

## EG&G PROGRAM

There are several areas of interest to be undertaken in FY 1983 by EG&G. As previously stated, it is intended that close cooperation will be maintained with the PVRC, EPRI, and others who are actively acquiring data on pipe damping. Further efforts to share in the vast resources of the Japanese will be pursued.

To supplement these efforts and to fill in some of the gaps in damping knowledge, EG&G will perform a testing program of its own. The overall test plan will follow a basic building block approach in which simple configurations will first be tested in a laboratory environment, with the complexity gradually increased, until in future years, in-situ testing of actual piping systems might be undertaken to verify blind predictions.

This section provides a general description of the proposed FY 1983 test layout and configuration, the excitation and data acquisition systems, and the basic test plan. Some possibilities of potential tests beyond FY 1983 are also included.

### Damping Test Layout and Configuration

After surveying a number of sites at the INEL, it was determined that the best location for the proposed damping tests is at the Auxiliary Reactor Area III (ARA III). ARA III, located as shown in Figure 14, was originally the site of a gas cooled test reactor. After being decommissioned, the site has been used for various physics and materials tests. Building 608 at ARA III presently houses some of these tests and provides a space and services that would be needed for performing the contemplated damping tests.

Figure 15 indicates the arrangement of test equipment and test fixture setup within the area. The test area is approximately 40 ft long and 15 ft wide. The test fixture will extend along the length of the area with the hydraulic power supply for the actuator and the modal analyzer to be located nearby.

The test fixture will consist of a rigid beam approximately 35 ft long anchored to the floor with moveable end fixtures mounted upon it. These end fixtures will be rigid in comparison to

the stiffness of the test pipe and test supports. They will also provide end conditions for the pipe section varying from pinned to fixed conditions. A straight section of pipe will be supported between the end fixtures by typical piping supports such as snubbers, spring hangers, constant force hangers, and sway braces that will be anchored to the steel floor beam. The hydraulic actuator and snapback apparatus will also be anchored to this beam and attached to the pipe for excitation purposes. A typical test configuration is shown in Figure 16. There will be two sizes of stainless steel pipe used in the test arrangements, such as 3 and 8 in. nominal diameter Schedule 40 pipe. It is anticipated that provisions can be made to test each pipe empty, filled with water, and insulated.

### Excitation and Data Reduction

Several means of excitation will be employed. A hydraulic actuator will be used as the primary source of energy input. This actuator can either be attached to the test component with a reaction mass added or attached to a nearby rigid support structure with a force supplied between the support structure and the tested component. The latter arrangement would be used in these tests. The actuator weighs approximately 300 lb and can develop a maximum dynamic force of 2200 lb with good response characteristics well above the 33 Hz range to be considered in these tests. The shaker operates on an oil pressure produced by a power supply consisting of a gear pump driven by an electric motor. Oil cooling is supplied by way of an oil/water heat exchanger that requires a water supply and drain at the test location. This power supply with its oil reservoir is mounted on a steel frame with casters. A third component of the hydraulic system is the hydraulic manifold that regulates the high pressure surges in the hydraulic lines. Hydraulic hose lines allow the power supply to be located up to 25 ft away from the hydraulic shaker. Electronics for this system consist of the hydraulic power supply control console, the servo controller for the actuator valve on the shaker, and an input signal wave generator.

Snapback tests will be performed by imposing an initial displacement on the system and then instantaneously releasing the imposed displacement. In this type of test, damping will be determined by the logarithmic decrement method

# IDAHO NATIONAL ENGINEERING LABORATORY

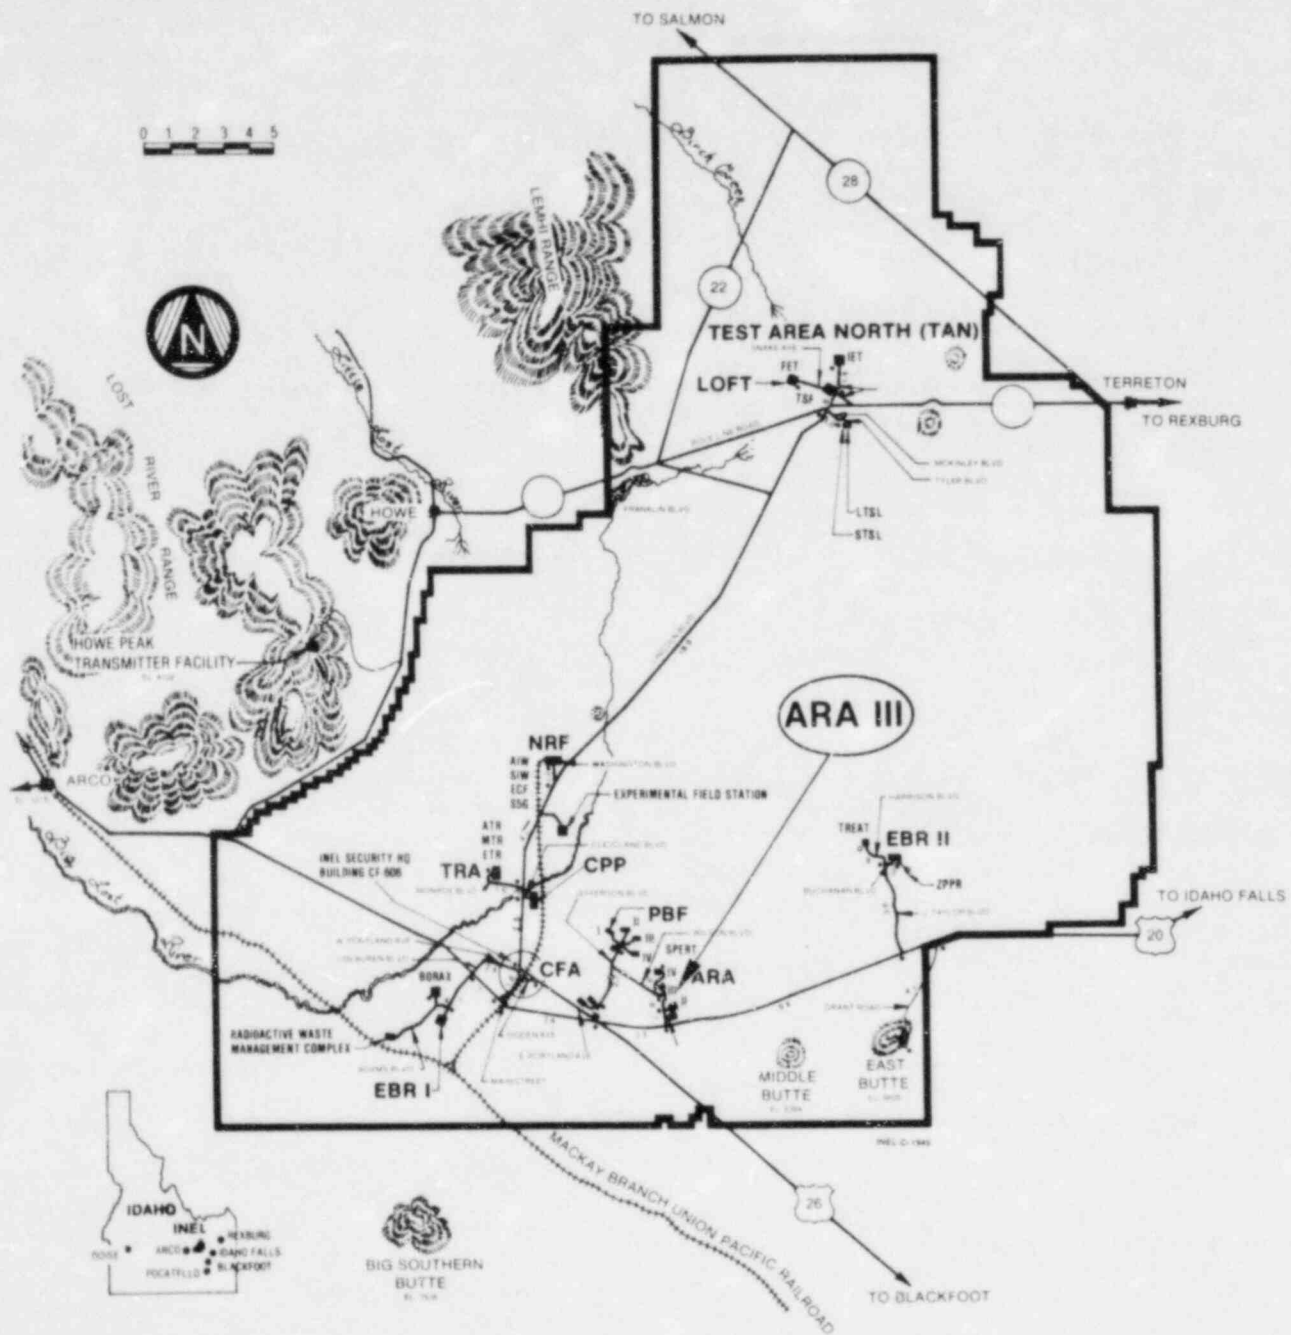


Figure 14. Location of ARA III.

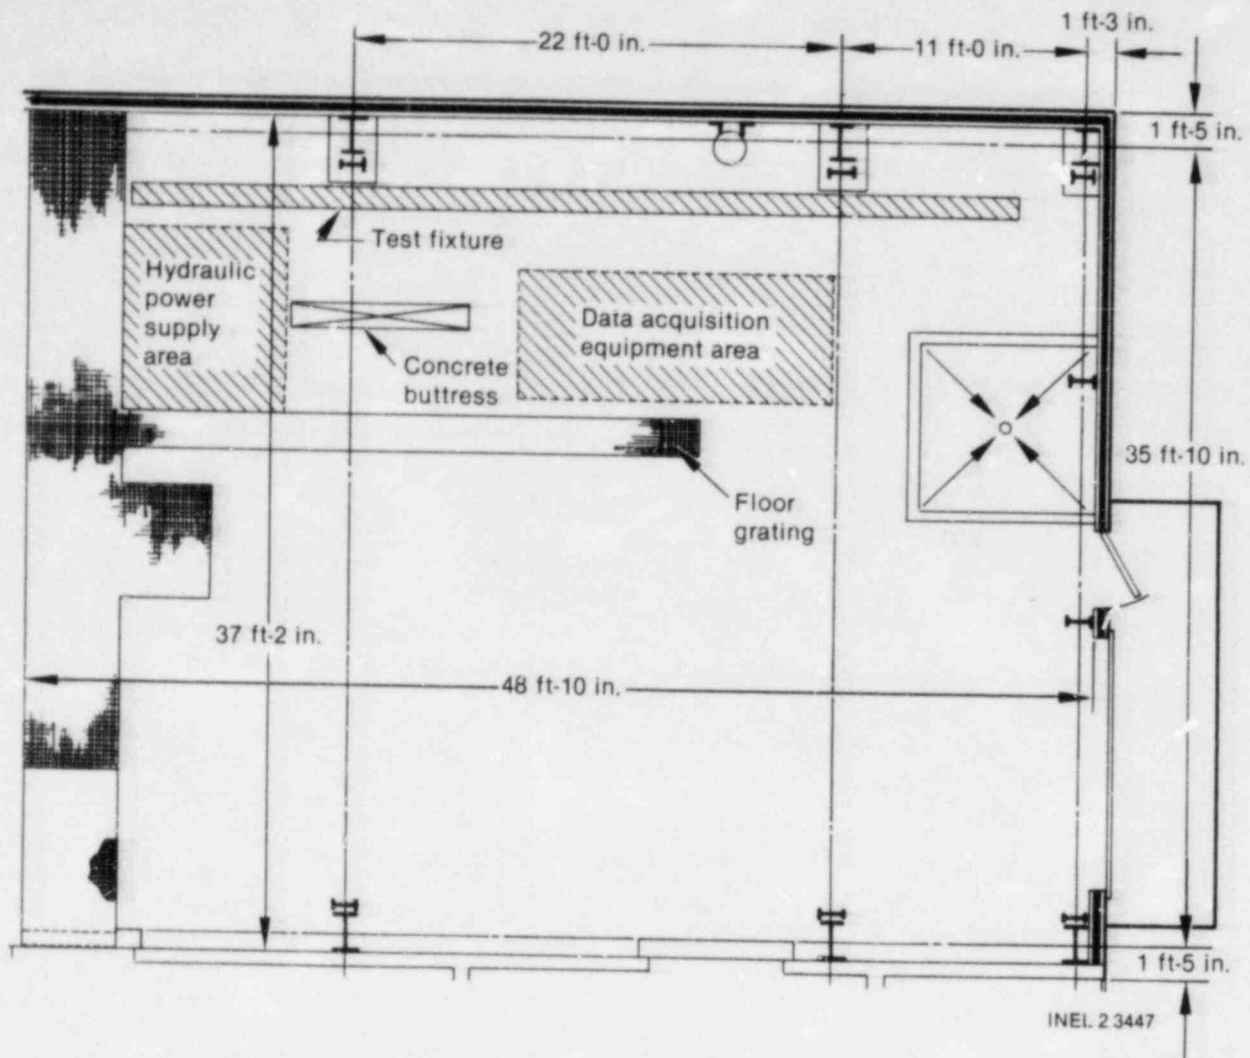


Figure 15. Arrangement of test equipment.

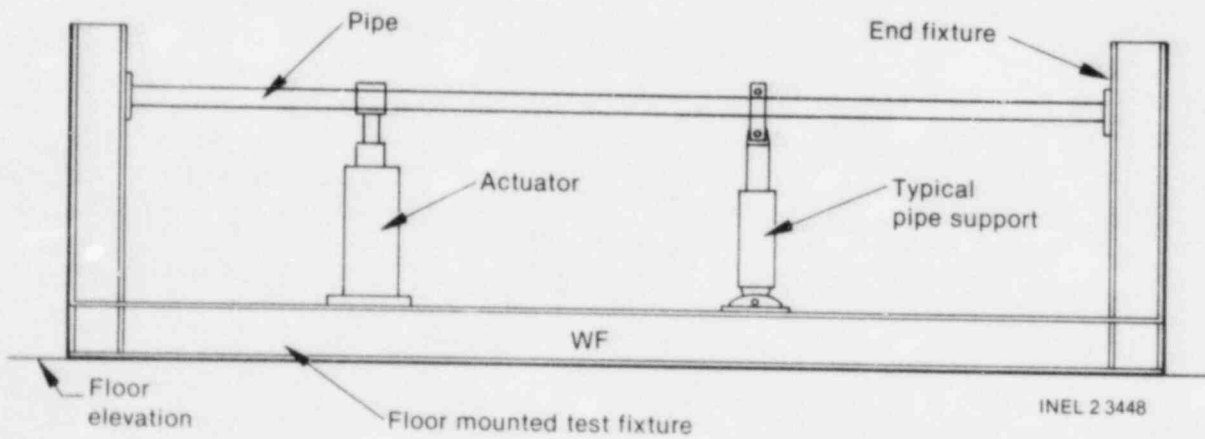


Figure 16. Typical test configuration.



applied to the structural response in the time domain. Impact tests using hammers will also be performed on the test setup. Pictures of the actuator, its hydraulic power supply, and the impact hammers are shown in Figures 17, 18, and 19.

Input forces to the system will be measured by load cells located between the actuator and the pipe for the shaker tests and in the head of the hammer in the impact tests. Response of the system will be measured by accelerometers, displacement transducers, and strain gauges attached at various locations on the pipe. Response signals will be sent from the transducers to the analyzer by way of coaxial cables with signal amplifiers. Strain gauge data will be transmitted to strain conditioners to be reduced and recorded for documentation of strain levels during the tests.

The structural analysis system that is to be used in the tests (see Figure 20) is capable of simultaneously recording eight channels of data and then analyzing each channel. Modal analysis testing utilizes a structure's calculated frequency response functions to determine modal frequencies, damping, and mode shapes.

During the tests, coherence functions will be calculated to determine the quality of the frequency response functions. Mathematical details of the transfer and coherence functions are given in Appendix A. Evaluation of the coherence functions during the tests allows for immediate correction or modification of the test procedure to ensure the best results possible.

The modal analysis techniques to be used for determining system damping utilize the complex exponential method and the frequency response function. This function is a ratio of the Fourier transform of the response output (displacement or acceleration in this case) to the Fourier transform of the input force. Therefore, this type of testing generally consists of some means of exciting the structure, electronic equipment to record input excitation and response, transmission lines from the recording equipment to the data storage device, and the analyzer/storage device.

## Test Plan

The EG&G research program will start with simple test configurations and gradually increase their complexity. The goal of the initial phase is to

first characterize the damping capabilities of individual supports. Data has been collected from a number of support vendors on the general stiffness characteristics of their products. Characteristics of specific supports that will be used in the test program will be further tested by EG&G.

The goals of the first phase of the program will be to investigate the following effects using the simple configuration described herein:

1. Pipe with and without individual supports
2. Effect of adding additional supports
3. Effect of using two different types of supports
4. Effect of support spacing
5. Effect of adding water to pipe
6. Effect of changing pipe size
7. Effect of response amplitude
8. Effect of response frequency.

These parameters will be investigated by varying only one at a time whenever possible. The proposed sequence of events to be followed in carrying out the test plan are:

1. Design fixture, initiate procurement
2. Test individual supports
3. Install fixture
4. Test pipe with and without individual supports up to approximately 80% yield stress
5. Vary support types and spacing
6. Vary mass spacing
7. Increase response amplitude to beyond yield stress
8. Repeat 4 through 7 for different size pipe
9. Complete data reduction
10. Write report.

A detailed test plan and schedule will be issued before commencing testing.

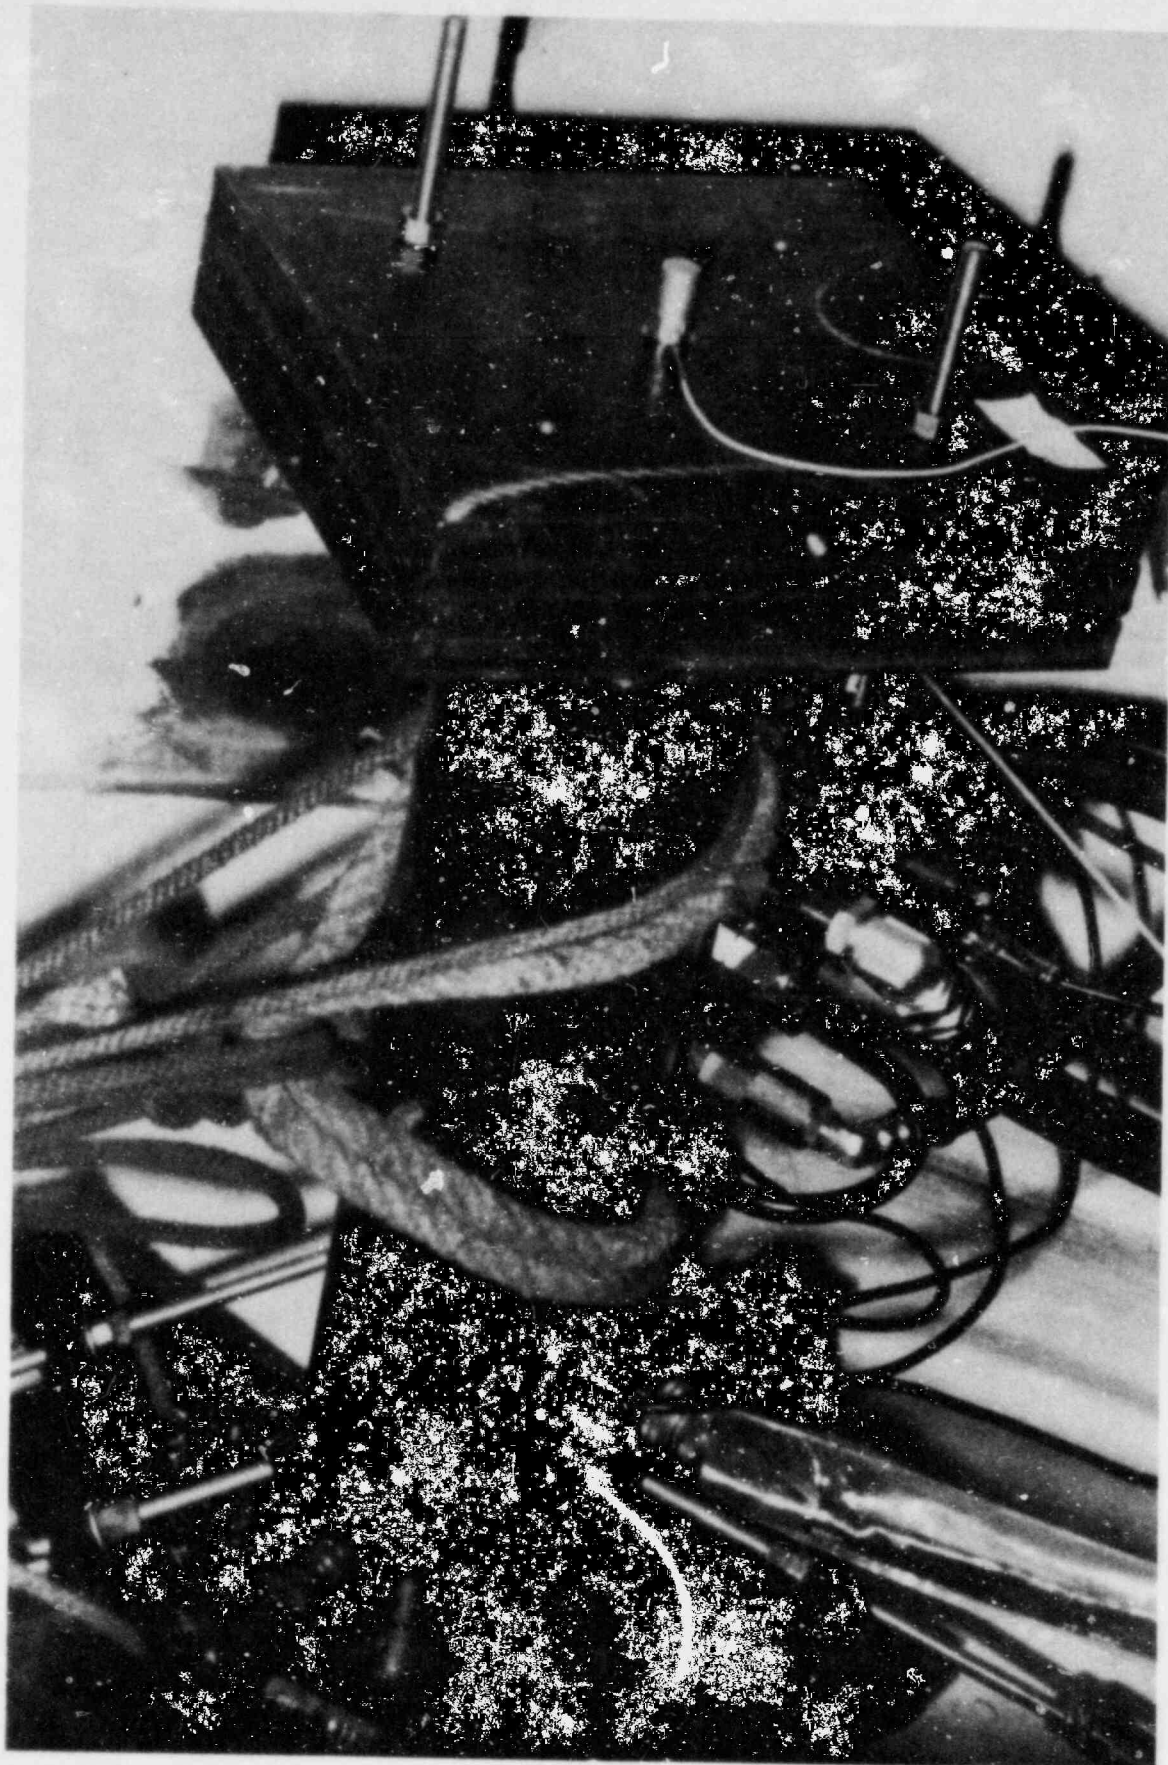


Figure 17. Hydraulic actuator.

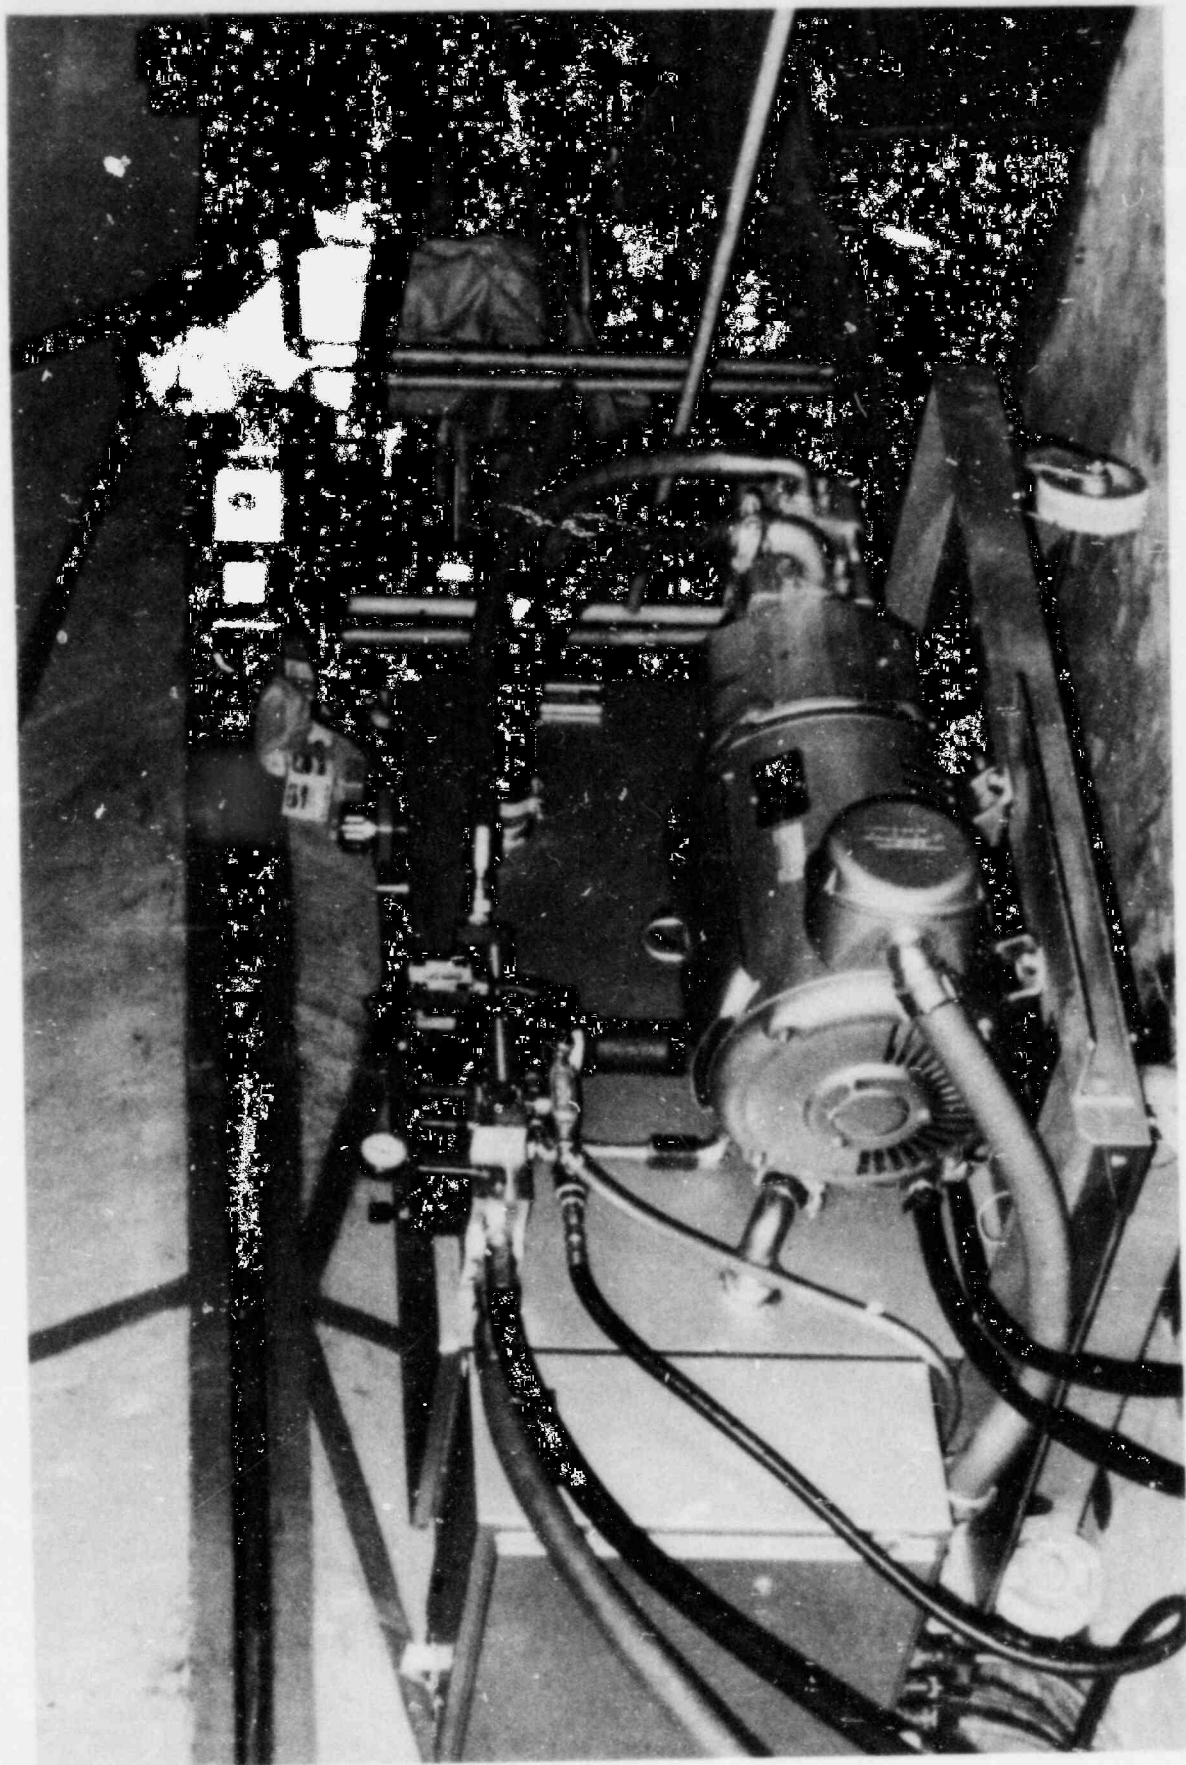


Figure 18. Hydraulic power supply.

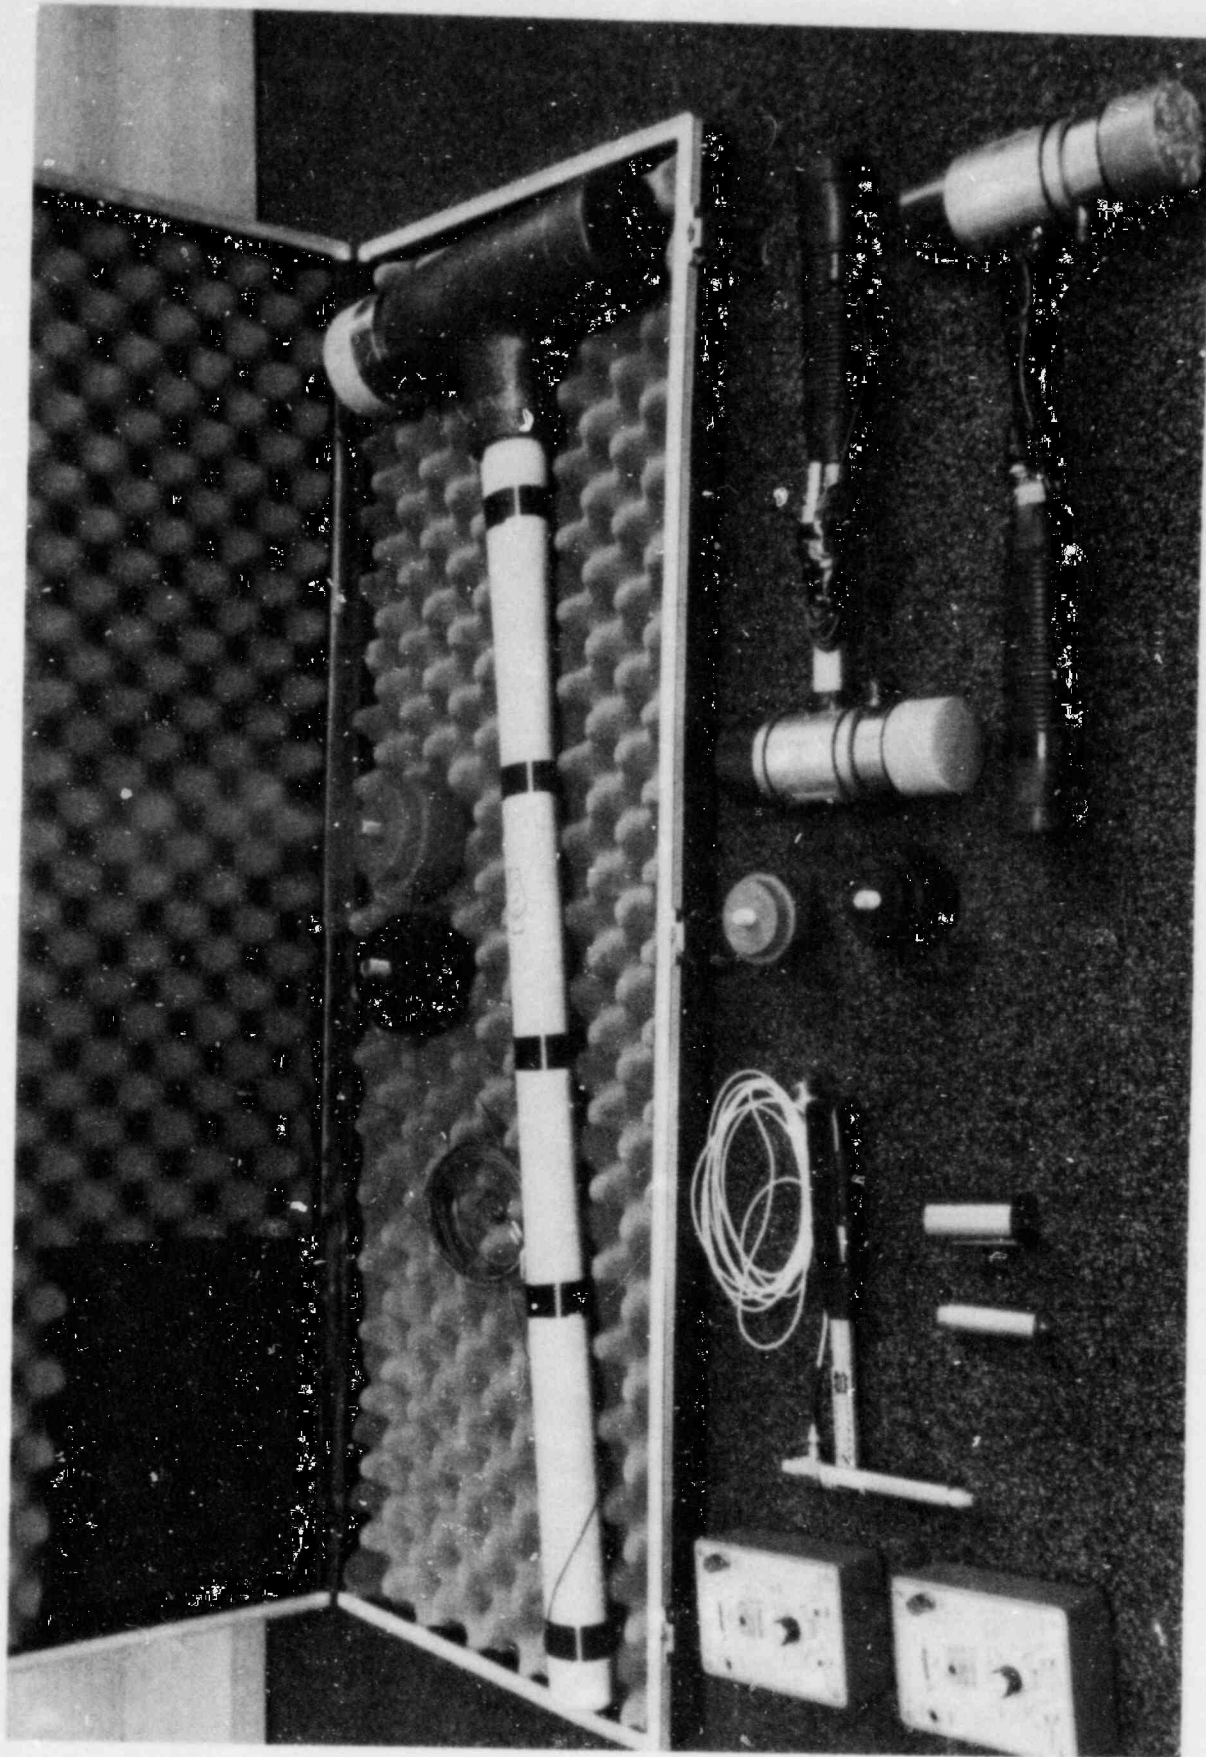


Figure 19. Impact hammers.

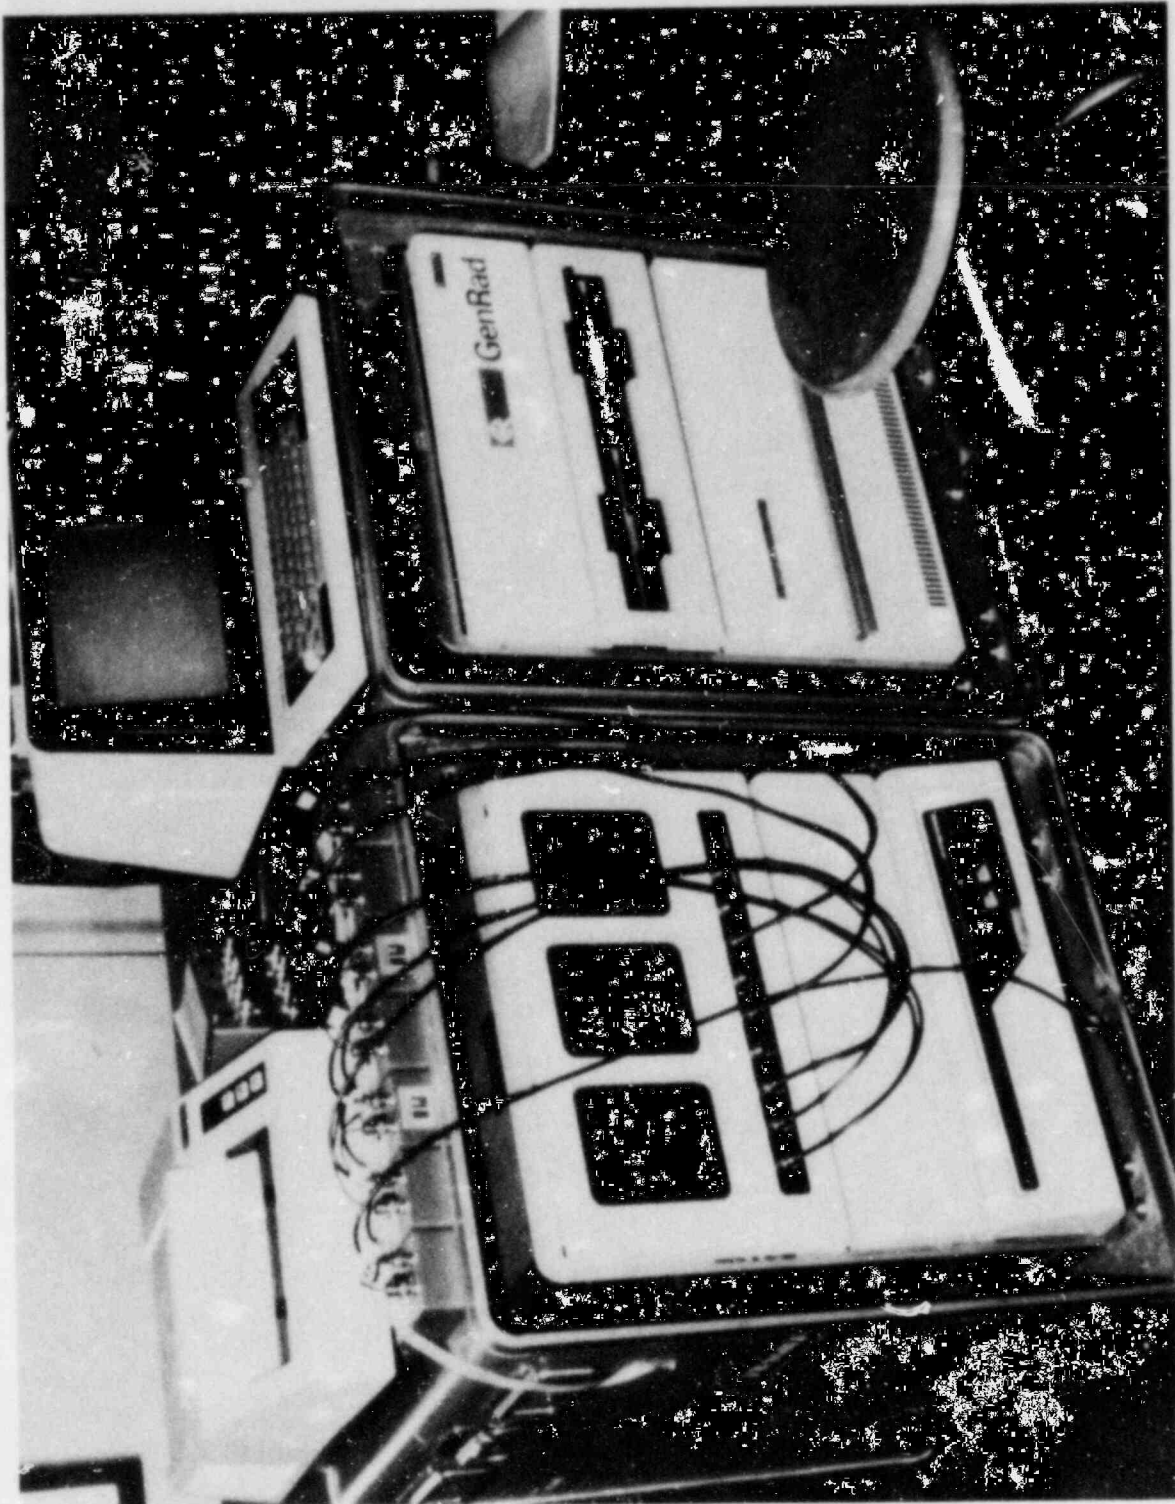


Figure 20. Data acquisition system.

## **Future Work**

After completing the initial phase, a more complicated three dimensional test setup will be constructed. The next set of experiments will rely heavily upon the results of the initial phase of testing and the EPRI/ANCO results. Tentative plans would include large magnitude inertance testing.

Once the laboratory phase of the program has been carried out, parameters associated with damping in nuclear power plant piping systems would be characterized, and blind predictions associated with in-situ testing could be undertaken. A number of decommissioned facilities at the Idaho National Engineering Laboratory have been surveyed as part of this program, and would be suitable for such experiments.

## REFERENCES

1. A. G. Ware, *A Survey of Experimentally Determined Damping Values in Nuclear Power Plant Piping Systems*, NUREG/CR-2406, EGG-2143, EG&G Idaho, Inc., November 1981.
2. R. D. Blevins, *Flow Induced Vibration*, Chapter 8, Van Nostrand Reinhold, New York, 1977.
3. C. M. Harris and C. E. Crede, *Shock and Vibration Handbook*, Second Edition, McGraw-Hill, Inc., 1976.
4. R. W. Clough and J. Penzien, *Dynamics of Structures*, McGraw-Hill, Inc., 1975.
5. M. H. Richardson, *Detection of Damage in Structures from Changes in Their Dynamic (Modal) Properties—A Survey*, NUREG/CR-1431, UCRL-15103, Lawrence Livermore Laboratory, Livermore, California, April 1980.
6. Regulatory Guide 1.61, *Damping Values for Seismic Design of Nuclear Power Plants*, U.S. Atomic Energy Commission, October 1973.
7. N. M. Newmark, J. A. Blume, and K. K. Kapur, "Design Response Spectra for Nuclear Power Plants," *ASCE Structural Engineering Meeting, San Francisco, April 1973*.
8. American Society of Mechanical Engineers, *ASME Boiler and Pressure Vessel Code*, Section III, Nuclear Power Plant Components, Appendix N, 1980 Edition.
9. A. Morrone, "Damping Values of Nuclear Power Plant Components," *Nuclear Engineering and Design*, Vol. 26, 1974, pp. 343-363.
10. J. D. Stevenson, "Structural Damping Values as a Function of Dynamic Response Stress and Deformation Levels," *Nuclear Engineering and Design*, Vol. 60, 1980, pp. 211-237.
11. P. Ibáñez et al., "Methods and Benefits of Experimental Structural Dynamic Evaluation of Nuclear Power Plants," *Nuclear Engineering and Design*, Vol. 64, 1982, pp. 1-32.
12. H. Shibata et al., "Investigation on the Design Damping Values for Seismic Analysis of Nuclear Power Plant Piping Systems," Paper K11/3, *Fifth Structural Mechanics in Reactor Technology Conference, Berlin, West Germany, 1979*.
13. H. Shibata et al., "A Study on Damping Characteristics of Equipments and Piping Systems for Nuclear Power Plant Facilities (Seismic Damping Ratio Evaluation Program)," Paper K13/4, *Sixth Structural Mechanics in Reactor Technology Conference, Paris, France, 1981*.
14. H. Shibata et al., "Test and Evaluation about Damping Characteristics of Hanger Supports for Nuclear Power Plant Piping Systems (Seismic Damping Ratio Evaluation Program)," Paper K6/4, *Sixth Structural Mechanics in Reactor Technology Conference, Paris, France, 1981*.
15. H. Shibata et al., "An Experimental Study of Damping Characteristics with Emphasis on Insulation for Nuclear Power Plant Piping System (Seismic Damping Ratio Evaluation Program)," Paper K6/5, *Sixth Structural Mechanics in Reactor Technology Conference, Paris, France, 1981*.
16. EPRI NP-1505, *Seismic Piping Test and Analysis*, Interim Report, September 1980.

17. G. E. Howard et al., "Dynamic Response of Piping Systems at Varying Load Amplitudes: Experimental Studies of Damping," ANCO Engineers, Culver City, California, to be presented at the *1982 ASME Winter Annual Meeting in Phoenix, Arizona, November 14-19, 1982*.
18. D. E. Chitty, W. B. Walton, and G. E. Howard, "Damping in Nonlinear Piping Systems," ANCO Engineers, Culver City, California, to be presented at the *1982 ASME Winter Annual Meeting in Phoenix, Arizona, November 14-19, 1982*.
19. H. L. Hwang, "Experimentally Determined Damping Values," Report presented to Pressure Vessel Research Committee Technical Committee on Piping Systems, Damping Value Task Group, July 27, 1982.
20. P. Corvin et al., "Schwingungsmessungen an einer Rohrleitung bei Prüfstandsversuchen HDR-Sicherheitsprogramm EV 2000," Battelle-Institut E.V. Frankfurt am Main, West Germany, October 1981.
21. D. A. Barta, L. K. Severud, and M. J. Anderson, "Seismic Testing and Analysis for a Prototypic Nonlinear Piping System," Westinghouse Hanford Co., Richland, Washington, to be presented at the *1982 ASME Winter Annual Meeting in Phoenix, Arizona, November 14-19, 1982*.
22. P. Ibáñez, "Review of Analytical and Experimental Techniques for Improved Structural Dynamic Models," *Welding Research Council Bulletin 249*, June 1979.
23. PVRC-TCPS-82-03, "Damping Value Task Group Actions Prior to Next Meeting," July 6, 1982.
24. PVRC-TCPS-82-04, "Task Group on Damping Values, July 26, 1982, Meeting Minutes," August 5, 1982.
25. G. E. Howard, P. Ibáñez, and C. B. Smith, "Seismic Design of Nuclear Power Plants—An Assessment," *Nuclear Engineering and Design*, Vol. 38, 1976, pp. 385-461.
26. J. D. Stevenson to members of PVRC Steering Committee on Piping, "Immediate Implementation of Changes to Nuclear Plant Piping Construction Requirement," June 3, 1982.



**APPENDIX A**

**PROCEDURE FOR DETERMINATION OF  
TRANSFER AND COHERENCE FUNCTIONS**

## APPENDIX A PROCEDURE FOR DETERMINATION OF TRANSFER AND COHERENCE FUNCTIONS

By definition,

$$H_{ij} = \frac{A(\omega)_i}{F(\omega)_j} \quad (\text{A-1})$$

where  $H_{ij}$  is the transfer function for acceleration response at DOF  $i$  caused by the force at DOF  $j$ , and the argument  $\omega$  denotes functions of frequency.

During testing, measured quantities are  $a(t)_i$  and  $f(t)_j$  acceleration and force at, respectively, DOF  $i$  and DOF  $j$  as functions of time.

Then

$$A(\omega)_i = \mathcal{F}[a(t)_i] \quad (\text{A-2})$$

$$F(\omega)_j = \mathcal{F}[f(t)_j] \quad (\text{A-3})$$

respectively, and are Fourier Transforms of  $a(t)_i$  and  $f(t)_j$ .

The equivalent definition of  $H_{ij}$  is used for computational purposes because of inherent noise cancellation properties and is written

$$H_{ij} = \frac{A(\omega)_i F(\omega)_j^*}{F(\omega)_j F(\omega)_i^*} = \frac{S_{ij}}{S_{jj}} \quad (\text{A-4})$$

where

$$S_{jj} = A(\omega)_i F(\omega)_j^*$$

$$S_{jj} = F(\omega)_j F(\omega)_i^*$$

and  $F(\omega)_j^*$  is the complex conjugate of  $F(\omega)_j$ .

The coherence function,  $\gamma^2$ , which is a measure of the quality of  $H_{ij}$ , is defined

$$\gamma^2 = \frac{S_{ij} S_{ij}^*}{S_{jj} S_{ii}} \quad (\text{A-5})$$

where

$$S_{ii} = A(\omega)_i A(\omega)_i^*, \quad 0 \leq \gamma^2 \leq 1$$

and

$$\gamma^2 = 1, \text{ implies perfect coherence.}$$

An additional improvement in the quality of  $H_{ij}$  is obtained by measuring a number of similarly obtained acceleration and force time histories,  $a^n(t)_i$  and  $f^n(t)_j$ , and averaging. That is

$$H_{ij} = \frac{\sum_{n=1}^{\dot{n}} S_{ij}^n}{\sum_{n=1}^{\dot{n}} S_{ij}^n} \quad (\text{A-6})$$

The corresponding form of the coherence function is

$$\gamma^2 = \frac{\sum_{n=1}^{\dot{n}} S_{ij}^n \sum_{n=1}^{\dot{n}} (S_{ij}^n)^*}{\sum_{n=1}^{\dot{n}} S_{jj}^n \sum_{n=1}^{\dot{n}} S_{ii}^n} \quad (\text{A-7})$$

where, if

$$A^n(\omega)_i = \mathcal{F}[a^n(t)_i]$$

and

$$F^n(\omega)_j = \mathcal{F}[f^n(t)_j]$$

then

$$S_{ij}^n = A^n(\omega)_i [F^n(\omega)_j]^*$$

$$S_{jj}^n = A^n(\omega)_j [F^n(\omega)_j]^*$$

and finally

$$S_{ii}^n = A^n(\omega)_i [A^n(\omega)_i]^*$$

Equations (A-6) and (A-7) represent the computations that are performed during data acquisition. The value of  $n$  is typically equal to about 20.

120555078877 1 ANRM  
US NRC  
ADM DIV OF TIDC  
POLICY & PUBLICATIONS MGT BR  
PDR NUREG COPY  
LA 212  
WASHINGTON DC 20555

EG&G Idaho, Inc.  
P.O. Box 1625  
Idaho Falls, Idaho 83415