

ATTACHMENT 2

PROPOSED CHANGE TO  
TECHNICAL SPECIFICATION  
SURVEILLANCE 4.4.6.2.2d

9101240009 910117  
PDR ADCK 05000498  
P PDR

SURVEILLANCE REQUIREMENTS (Continued)

4.4.6.2.1 Reactor Coolant System leakages shall be demonstrated to be within each of the above limits by:


- a. Monitoring the containment atmosphere gaseous radioactivity and particulate radioactivity channels at least once per 12 hours;
- b. Monitoring the containment normal sump inventory and discharge at least once per 12 hours;
- c. Performance of a Reactor Coolant System water inventory balance at least once per 72 hours; and
- d. Monitoring the Reactor Head Flange Leakoff System at least once per 24 hours.

4.4.6.2.2 Each Reactor Coolant System Pressure Isolation Valve specified in Table 3.4-1 shall be demonstrated OPERABLE by verifying leakage to be within its limit:

- a. At least once per 18 months,
- b. Prior to entering MODE 2 whenever the plant has been in COLD SHUTDOWN for 72 hours or more and if leakage testing has not been performed in the previous 9 months,
- c. Prior to returning the valve to service following maintenance, repair or replacement work on the valve, and  
*Prior to entering MODE 2*
- d. ~~Within 24 hours~~ following valve actuation due to automatic or manual action or flow through the valve except for valves XRH0060 A,B,C and XRH0061 A,B,C.
- e. As outlined in the ASME Code, Section XI, paragraph IWV-3427(b).

The provisions of Specification 4.0.4 are not applicable for entry into MODE 3 or 4.

# TRAIN C CHECK VALVE LEAKAGE DETECTION SYSTEM

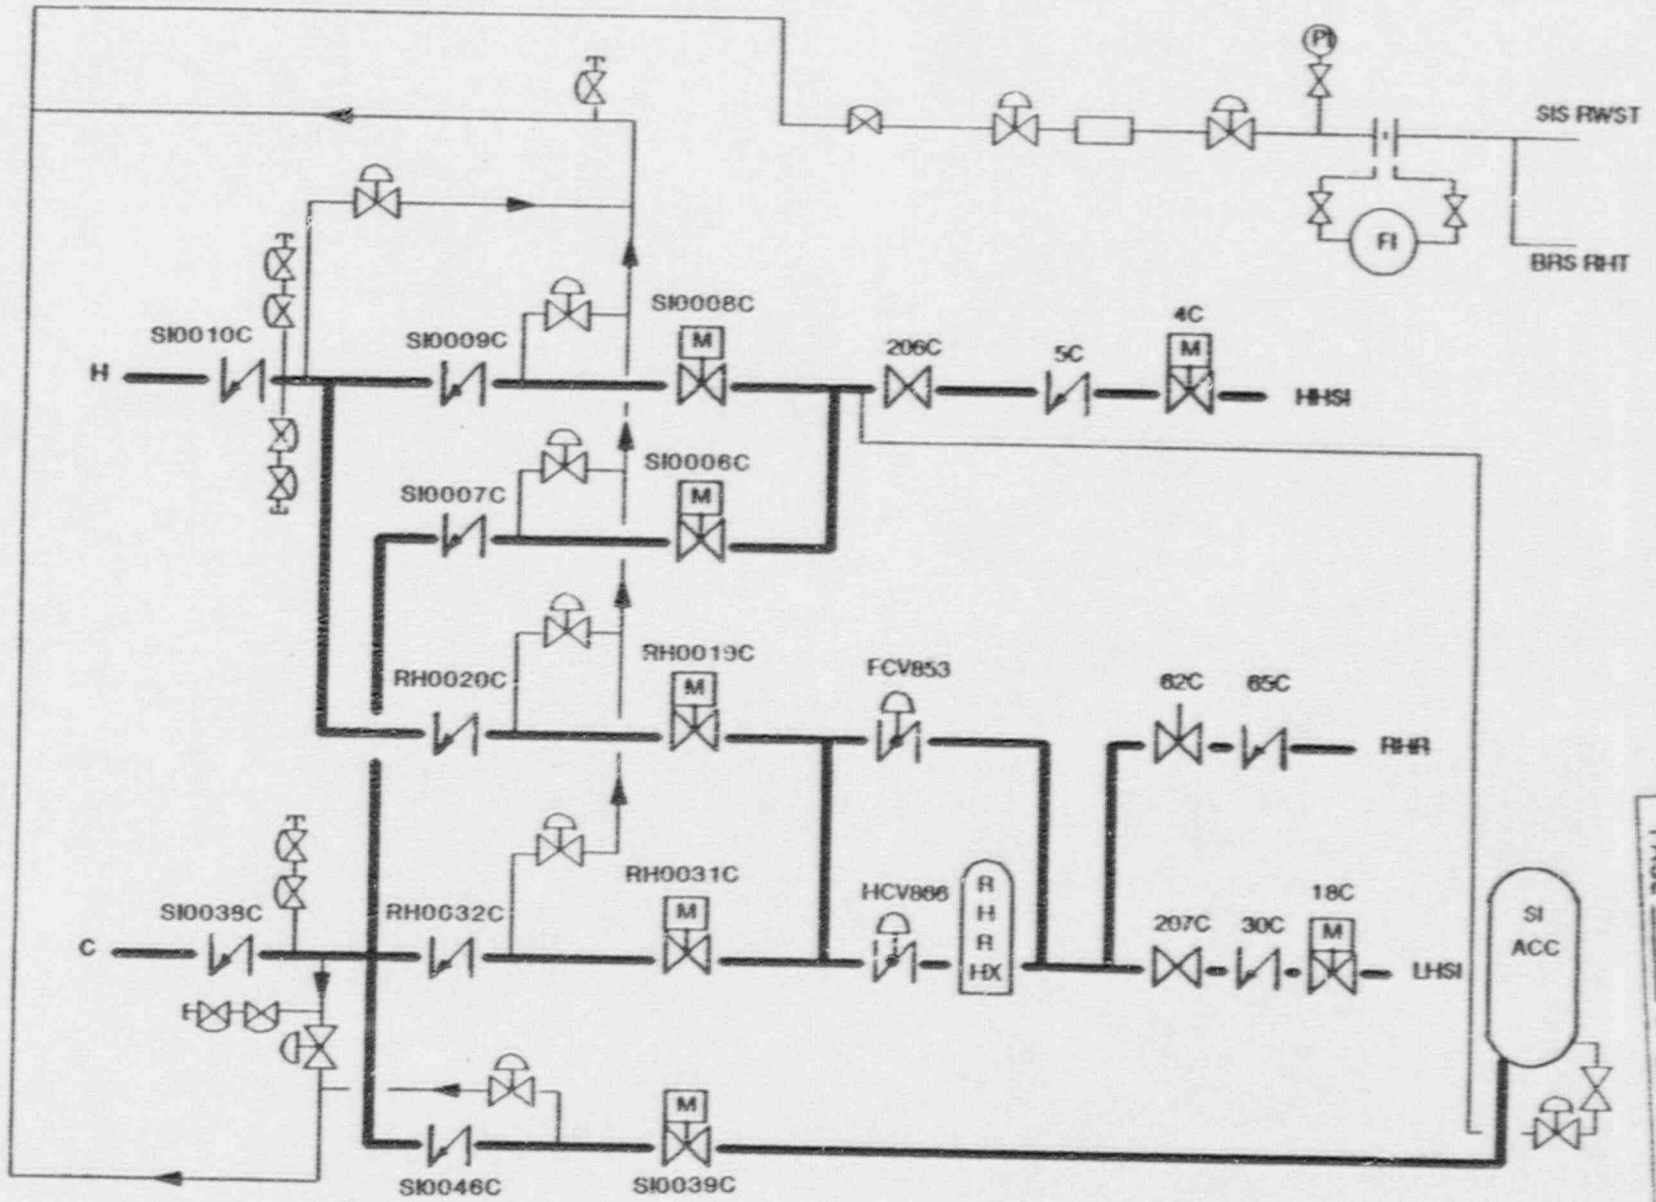

ATTACHMENT 2  
 ST-HL-AE-3673  
 PAGE 2 OF 2