

Charles W. Jackson
Vice President

Consolidated Edison Company of New York, Inc.
Indian Point Station
Broadway & Bleakley Ave.
Buchanan, NY 10511
Telephone (914) 737-8116

Date: March 2, 1983

Re: Indian Point Unit No. 2
Docket No. 50-247

Mr. Ronald C. Haynes, Regional Administrator
Region I
U.S. Nuclear Regulatory Commission
631 Park Avenue
King of Prussia, Pennsylvania 19406


Dear Mr. Haynes:

In accordance with the Technical Specifications of Facility Operating License No. DPR-26, the following confirms our notification on March 1, 1983 to Mr. Thomas Foley of your office, of a potential Reportable Occurrence LER 83-004. This event is the type defined in Technical Specification Section 6.9.1.7.

On March 1, 1983, Con Edison determined that the shaft material in square motor housing residual heat removal pump No. 22 was carbon steel instead of stainless steel. A safety evaluation concluded that the change does not involve an unreviewed safety question based on use of the present RHR pump shaft material and configuration for a period not longer than 24 calendar months of normal operation. The present equipment will be replaced within this time period in accordance with the recommendations of the nuclear components manufacturer. The manufacturer and motor model number is Westinghouse 5008-P20. The manufacturer and pump model number is Ingersoll-Rand 8X20W.

We are continuing our investigation and will report the results as soon as they are available.

Very truly yours,

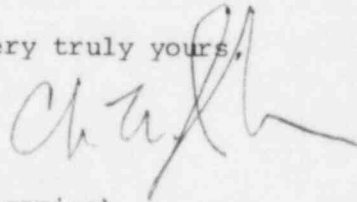

dmc

cc: Mr. William McDonald, Director (2 copies)
Office of Management Information and
Program Control
c/o Distribution Services Branch, DDC, ADM
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Mr. Thomas Foley, Senior Resident Inspector
U.S. Nuclear Regulatory Commission
P.O. Box 38
Buchanan, New York 10511

8303160249 830302
PDR ADOCK 05000247
S PDR

IE29