

FARLEY NUCLEAR PLANT  
EMERGENCY PLAN IMPLEMENTING PROCEDURE  
FNP-0-EIP-16

S  
A  
F  
E  
T  
Y  
  
R  
E  
L  
A  
T  
E  
D

EMERGENCY EQUIPMENT AND SUPPLIES

Approved:

W. S. Hunter III  
Plant Manager

Date Issued: 8-31-82

List of Effective Pages

Page	Rev.
1-5	11
<u>Checklists</u>	
16A-16E	11
16F, 16M, 16Q	11
16G-16K	11
16L pg. 1	7
pg. 2	11
16N pg. 1&2	11
16O pg. 1&2	11
16P pg. 1-10	11
16R	11
16S pg. 1	10
16S pg. 2	11
16T pg. 1	10
16T pg. 2&3	11
16U-16BB	11
16CC	11
16DD	11
16EE	11

Disk EIP-3

DOCUMENT CONTROL  
CONTROLLED COPY  
DO NOT REPRODUCE  
COPY NO. 058

## EMERGENCY EQUIPMENT AND SUPPLIES

1.0 Purpose

This procedure establishes the actions to be taken to ensure the operational readiness of emergency equipment and supplies.

2.0 References

- 2.1 Joseph M. Farley Nuclear Plant Emergency Plan
- 2.2 FNP Operating Manual, Vol. 10, FNP-0-RCP-103, Maintenance and Care of Respiratory Protection Equipment
- 2.3 FNP-1-GMP-1.0, Preventive Maintenance Procedures

11

3.0 General

- 3.1 The Chemistry and Health Physics Group shall be responsible for implementing the requirements of this procedure.
- 3.2 An inventory checklist shall be posted on the front of each emergency cabinet.
- 3.3 An inventory shall be performed:
  - 3.3.1 Quarterly
  - 3.3.2 After each emergency or drill during which the cabinet is opened.
  - 3.3.3 Any time the seal on a cabinet is found to be broken.
- 3.4 This procedure applies only to equipment and supplies stored for emergency use.

4.0 Procedure

- 4.1 The following actions shall be performed monthly.  
Respiratory Protection Equipment
  - 4.1.1 Respirators
    - a. Check the expiration date on the filter cartridge. If the filter will expire prior to the next check date, replace the respirator.

- b. Ensure that the seal of the protective bag containing the respirator is not broken. If the seal is broken, replace the respirator.

#### 4.1.2 Self-contained breathing apparatus

- a. Check the pressure in the air tank. If the tank is not full, replace the tank.
- b. Check the regulator and warning device to ensure that they function properly.

### 4.2 The following actions shall be performed quarterly.

#### 4.2.1 Portable instrumentation

Insure portable instruments are within calibration using manufacturer's recommendations as guidelines and replace portable instruments with newly calibrated units (survey instruments and air samplers) as required.

#### 4.2.2 Personnel dosimetry devices

##### 4.2.2.1 Thermoluminescent dosimeters (TLD)

Insure TLD's are within calibration and replace as required.

##### 4.2.2.2 Pocket dosimeter charger

- a. Check battery compartment for leakage from batteries. If leakage is found, clean compartment and replace batteries.
- b. Rezero at least one pocket dosimeter to ensure that the charger is functional. If unit is not functional, replace it.

- 4.2.3 Other battery operated devices
    - 4.2.3.1 Check the battery compartment for leakage from batteries. If leakage is found, clean compartment and replace batteries.
    - 4.2.3.2 Operate the device. If the device is not functional, replace it.
  - 4.2.4 Verify operation of the two-way radio in the Plant Emergency Vehicle and the Environmental Vehicle by establishing communications with the Security Tower.
  - 4.2.5 Inventory all items at all emergency equipment locations.
  - 4.2.6 Run the portable air samplers for at least 1 minute.
  - 4.2.7 Check all supplies for deterioration.
  - 4.2.8 Replace any non-serviceable items.
- 4.3 The following actions shall be performed semi-annually.
- 4.3.1 Direct-reading pocket dosimeter.
    - a. Insure pocket dosimeters are within calibration and replace as required.
    - b. Ensure that each pocket dosimeter is zeroed.
  - 4.4 Upon closing the cabinet, affix a seal to the door in such a manner that the seal must be broken if the cabinet is opened.
  - 4.5 Initiate correction of discrepancies found.
- 5.0 Records and Reports
- 5.1 On each Equipment and Supplies Checklist, FNP-0-EIP-16A through FNP-0-EIP-16CC, initial the appropriate space after completing the actions as required by 4.1, 4.2, 4.3 or 4.4.
  - 5.2 Sign and date the Checklists and forward them to the Environmental and Emergency Planning Supervisor.

5.3 After reviewing the Checklist, the Environmental and Emergency Planning Supervisor shall forward them to Document Control.

## 6.0 Checklists

The following is a listing by location of the emergency equipment and supplies which are included in the checklists:

<u>Location</u>	<u>Checklist</u>
Aux. bldg. entrance west non-rad hallway, EL 155, Unit 1.....	16R
Aux. bldg. EL 155, Unit 2.....	16D
Aux. bldg. EL 139, Unit 1.....	16V
Aux. bldg. EL 121, Unit 2.....	16E
Aux. bldg. EL 100, Unit 1.....	16W
Aux. bldg. EL 83, Unit 1.....	16F
Aux. bldg. EL 83, Unit 2.....	16X
Aux. bldg. EL 83, Unit 2.....	16BB
CSC, Ambulance kit.....	16I
CSC, Fire Department.....	16J
CSC, Radiation Monitoring Team.....	16K
Control Room.....	16A
Drawings; EOF, Switchhouse, TSC.....	16P
Environmental Vehicle.....	16Q
EOF.....	16M
First Aid Room, EL 155, Service bldg.....	16G
Health Physics Office, EL 155, Aux. bldg.....	16B
Hot Shutdown Panel, Commo Room, Unit 1.....	16Y
Hot Shutdown Panel, Corridor, Unit 1.....	16U
Hot Shutdown Panel, Commo Room, Unit 2.....	16AA
Hot Shutdown Panel, Corridor, Unit 2.....	16Z
Kitchen, Control Room, Food.....	16T
Locker Room, EL 155, Aux. bldg.....	16C
Maintenance Shop, Service bldg.....	16S
Plant Emergency Vehicle.....	16H
Plant Emergency Vehicle.....	16Q
Southeast Alabama Medical Center.....	16N
Stretchers.....	16O
Switchhouse.....	16L
Technical Support Center.....	16CC
Location of Fire Brigade Protective Clothing...	16DD

## 7.0 Plant-Emergency-Vehicle-Preventive-Maintenance

7.1 A monthly inspection of the plant emergency vehicle is performed in FNP-1-GMP-1.0, Preventive Maintenance Procedures, by Maintenance.

7.2 The plant emergency vehicle shall be started, test driven, and given a visual inspection by Security once a week per Appendix A.

- 7.3 Security shall start the plant emergency vehicle, visually verify the following on a daily basis and take corrective action if appropriate.
  - 7.3.1 Tire inflation adequate
  - 7.3.2 Gas Tank near full
  - 7.3.3 Doors Locked
- 7.4 Following any use of the emergency vehicle, the user will verify items 7.3.1 through 7.3.3 and take corrective action, if necessary.
- 7.5 Records and reports
  - 7.5.1 For Appendix A, initial the appropriate space after completing the action required by section 7.2.
  - 7.5.2 Sign and date the check list and forward it to the Emergency Planning and Environmental Sector Supervisor.
  - 7.5.3 After reviewing the checklist, the Emergency Planning and Environmental Sector Supervisor shall forward it to Document Control.

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Control Room

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Coveralls, Work Type.....	4	_____
First Aid Kit.....	1	_____
Flashlights.....	2	_____
Battery Compartment Operational.....		_____
Knives, Pocket.....	1	_____
Polybags.....	20	_____
Polysheets, roll.....	1	_____
Record Materials		
Clipboard, Paper, Pencil .....	2	_____
Emergency Plan .....	1	_____
Emergency Plan Implementing Procedures (Supply Cabinet).....		_____
Logbook .....	1	_____
Protective Action Sector Map .....	1	_____
Respirators		
Full Face .....	2	_____
Iodine Cannister .....	2	_____
Chlorine Cannister .....	8	_____
Next check prior to filter expiration date.....		_____
Protective Bag Unbroken.....		_____
Self-Contained Breathing Apparatus .....	8	_____
Full Tank.....		_____
Regulator and warning device operational.....		_____
Voice amplifier.....	8	_____
Operational.....		_____
Battery Compartment Operational.....		_____
Scissors.....	2	_____
Survey Instrument		
Ion Chamber .....	1	_____
Calibration O.K.....		_____
Tape, Electrical.....	2	_____
Tape, Masking.....	2	_____
Tool Kit		
Channel Locks (1).....		_____
Hacksaw (1).....		_____
Hammer, Carpenters (1).....		_____
Hammer, Sledge (1).....		_____
Pliers (1).....		_____
Screwdriver Set (1).....		_____
Side Cutters (1).....		_____
Wrench, Pipe (1).....		_____
Wrench, Large Adjustable (1).....		_____
Wrench, Small Adjustable (1).....		_____

REASON FOR INSPECTION

Monthly                      Lock Broken  
 Quarterly    Post-Drill    Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Health Physics Office, El. 155, Auxiliary Building

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Bucket.....	1.....	_____
Charger, Dosimeter.....	1.....	_____
Battery Compartment Operational.....		_____
Dosimeters, Pocket (20R).....	5.....	_____
Calibration O.K.....		_____
First Aid Kit, .....	1.....	_____
Flashlights.....	2.....	_____
Battery Compartment Opertional.....		_____
Gloves, Disposable, box.....	1.....	_____
Kimwipes, box.....	2.....	_____
Mop.....	1.....	_____
Paper, Absorbent, roll.....	1.....	_____
Polysheets, roll.....	1.....	_____
Protective Clothing		
Coveralls (5).....		_____
Cloth Gloves, pr (5).....		_____
Rubber Gloves, pr (5).....		_____
Cloth Shoe Covers, pr (5).....		_____
Rubber Shoe Covers, pr (5).....		_____
Hood (5).....		_____
Surgeons Cap (5).....		_____
Respirator, Full-Face and Cannister.....	5.....	_____
Next check date prior to filter expiration date.....		_____
Protective Bag Unbroken.....		_____
Rope, Radiation, 100'.....	1.....	_____
Scissors, pr.....	1.....	_____
Signs		
Airborne Radioactivity Area (3).....		_____
Contaminated Area (3).....		_____
High Radiation Area (3).....		_____
Radiation Area (3).....		_____
Tape, Masking, roll.....	2.....	_____
Tide, box.....	2.....	_____

REASON FOR INSPECTION  
 Monthly      Semi-Annual      Lock Broken  
 Quarterly    Post-Drill        Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Locker Room, El. 155, Auxiliary Building

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Applicators, Cotton Tufted box.....	1.....	_____
Backboard.....	1.....	_____
Bags, Plastic.....	20.....	_____
Blankets.....	4.....	_____
Brushes, Hand.....	2.....	_____
Clippers, Hair.....	1.....	_____
Decon. Solution, btl.....	2.....	_____
Detergent Soap, box.....	1.....	_____
First Aid Kit.....	1.....	_____
Gloves, Disposable, box.....	1.....	_____
Icebags.....	2.....	_____
*Lamp, Floor.....	1.....	_____
Protective Clothing		
Coveralls (5).....		_____
Cloth Gloves, pr (5).....		_____
Rubber Gloves, pr (5).....		_____
Cloth Shoe Covers, pr (5).....		_____
Rubber Shoe Covers, pr (5).....		_____
Hood (5).....		_____
Surgeons Cap (5).....		_____
Scissors.....	1.....	_____
Splints, Air Kit.....	1.....	_____
Splints, Arm.....	2.....	_____
Survey Meter, G.M.....	1.....	_____
Pancake Probe (1).....		_____
Medical Probe (1).....		_____
Calibration O.K.....		_____
Swabs, Nasal.....	20.....	_____
Tape, Masking, roll.....	2.....	_____
Tweezers.....	2.....	_____
Wristbands.....	10.....	_____

\*In cal lab

REASON FOR INSPECTION

Quarterly    Post-Drill    Lock Broken  
Other \_\_\_\_\_    Emergency Use

CHECKED BY: \_\_\_\_\_

TITLE: \_\_\_\_\_

DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Auxiliary Building, El. 155 - Unit 2

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Blankets.....	2.....	_____
Bucket.....	1.....	_____
Decon. Solution, btl.....	1.....	_____
First Aid Kit, .....	1.....	_____
Gloves, Disposable, box.....	1.....	_____
Kimwipes, box.....	1.....	_____
Mop.....	1.....	_____
Paper, Absorbent, roll.....	1.....	_____
Polysheets, roll.....	1.....	_____
Protective Clothing		
Coveralls (3).....		_____
Cloth Gloves, pr (3).....		_____
Rubber Gloves, pr (3).....		_____
Cloth Shoe Covers, pr (3).....		_____
Rubber Shoe Covers, pr (3).....		_____
Hood (3).....		_____
Surgeons Cap (3).....		_____
Respirator, Full-Face and Cannister.....	2.....	_____
Next check date prior to filter expiration date.....		_____
Rope, Radiation 100'.....	1.....	_____
Scissors, pr.....	1.....	_____
Signs		
Airborne Radioactivity Area (3).....		_____
Contaminated Area (3).....		_____
High Radiation Area (3).....		_____
Radiation Area (3).....		_____
Tape, Masking, roll.....	2.....	_____

REASON FOR INSPECTION

Monthly \_\_\_\_\_ Lock Broken  
 Quarterly Post-Drill \_\_\_\_\_ Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Auxiliary Building, El. 121 - Unit 2

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Blankets.....	2.....	_____
Bucket.....	1.....	_____
Decon. Solution, btl.....	1.....	_____
First Aid Kit, .....	1.....	_____
Gloves, Disposable, box.....	1.....	_____
Kimwipes, box.....	1.....	_____
Mop.....	1.....	_____
Paper, Absorbent, roll.....	1.....	_____
Polysheets, roll.....	1.....	_____
Protective Clothing		
Coveralls (3).....		_____
Cloth Gloves, pr (3).....		_____
Rubber Gloves, pr (3).....		_____
Cloth Shoe Covers, pr (3).....		_____
Rubber Shoe Covers, pr (3).....		_____
Hood ( )3.....		_____
Surgeons Cap (3).....		_____
Respirator, Full-Face and Cannister.....	2.....	_____
Next check date prior to filter expiration date.....		_____
Rope, Radiation 100'.....	1.....	_____
Scissors, pr.....	1.....	_____
Signs		
Airborne Radioactivity Area (3).....		_____
Contaminated Area (3).....		_____
High Radiation Area (3).....		_____
Radiation Area (3).....		_____
Tape, Masking, roll.....	2.....	_____

REASON FOR INSPECTION

Monthly  
 Quarterly      Post-Drill      Lock Broken  
 Other \_\_\_\_\_      Emergency Use

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Auxiliary Building, El. 83 - Unit 1

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Respirator		
Self-Contained Breathing Apparatus (1).....		_____
Full Tank.....		_____
Regulator and warning device operational.....		_____

REASON FOR INSPECTION

Monthly                      Lock Broken  
                                   Post-Drill                Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - First Aid Room, El. 155, Service Building

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Applicators, Cotton Tufted box.....	1.....	_____
Backboard.....	1.....	_____
Bags, Plastic.....	20.....	_____
Blankets.....	4.....	_____
Brushes, Hand.....	2.....	_____
Clippers, Hair.....	1.....	_____
Decon. Solution, btl.....	2.....	_____
Detergent Soap, box.....	1.....	_____
Gloves, Disposable, box.....	1.....	_____
First Aid Kit.....	1.....	_____
Icebags.....	2.....	_____
Lamp, Floor.....	1.....	_____
Pen.....	1.....	_____
Protective Clothing		
Coveralls (5).....		_____
Cloth Gloves, pr (5).....		_____
Rubber Gloves, pr (5).....		_____
Cloth Shoe Covers, pr (5).....		_____
Rubber Shoe Covers, pr (5).....		_____
Hood (5).....		_____
Surgeons Cap (5).....		_____
Scissors.....	1.....	_____
Splints, Air Kit.....	1.....	_____
Splints, Arm.....	2.....	_____
Smears, box.....	1.....	_____
Survey Meter, G.M.....	1.....	_____
Pancake Probe (1).....		_____
Medical Probe (1).....		_____
Calibration O.K.....		_____
Swabs, Nasal.....	20.....	_____
Tape, Masking, roll.....	2.....	_____
TLD's.....	5.....	_____
Tweezers.....	2.....	_____
Wristbands.....	10.....	_____

REASON FOR INSPECTION

Quarterly  
Other \_\_\_\_\_

Post-Drill

Lock Broken  
Emergency Use

CHECKED BY: \_\_\_\_\_

TITLE: \_\_\_\_\_

DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Plant Emergency Vehicle

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Backboard, long.....	1.....	_____
Backboard, short.....	1.....	_____
Bags, Plastic.....	10.....	_____
Blankets.....	2.....	_____
Charger, Dosimeter.....	1.....	_____
Battery Compartment Operational.....	.....	_____
Dosimeters, Pocket (5R).....	2.....	_____
First Aid Kit, .....	1.....	_____
Gloves, Disposable, box.....	1.....	_____
Labels, Self Sticking "RADIOACTIVE" roll.....	1.....	_____
Lead Covering Material, sheet.....	1.....	_____
Pen.....	2.....	_____
Protective Clothing		
Lab Coats (4).....	.....	_____
Cloth Gloves, pr (4).....	.....	_____
Rubber Gloves, pr (4).....	.....	_____
Canvas Shoe Covers, pr (4).....	.....	_____
Surgeons Caps (4).....	.....	_____
Rubber Shoe Covers, pr (4).....	.....	_____
Radio, Two-way operational.....	1.....	_____
Signs "RADIOACTIVE".....	4.....	_____
Tape, Masking, roll.....	1.....	_____
TLD's.....	5.....	_____
Wristbands.....	10.....	_____

REASON FOR INSPECTION  
 Quarterly      Semi-Annual      Lock Broken  
 Other            Post-Drill        Emergency Use  
 \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Central Security Control Building, Ambulance Kit

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Bags, Plastic.....	10.....	_____
Blanket.....	1.....	_____
Charger, Dosimeter.....	1.....	_____
Battery Compartment Operational.....	.....	_____
Dosimeters, Pocket (5R).....	4.....	_____
Labels, Self Sticking "RADIOACTIVE" roll.....	1.....	_____
Lead Covering Material, sheet.....	1.....	_____
Pen.....	2.....	_____
Protective Clothing		
Lab Coats (4).....	.....	_____
Cloth Gloves, pr (4).....	.....	_____
Rubber Gloves, pr (4).....	.....	_____
Cloth Shoe Covers, pr (4).....	.....	_____
Rubber Shoe Covers, pr (4).....	.....	_____
Hood (4).....	.....	_____
Surgeons Caps (4).....	.....	_____
Signs "RADIOACTIVE".....	4.....	_____
Tape, Masking, roll.....	1.....	_____
TLD's.....	4.....	_____
Wristbands.....	10.....	_____

PURPOSE OF INSPECTION  
 Semi-Annual      Lock Broken  
 Quarterly        Post-Drill        Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Central Security Control Building, Fire Department

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Charger, Dosimeter.....	1.....	_____
Battery Compartment Operational.....		_____
Dosimeters, Pocket (5R).....	5.....	_____
Calibration O.K.....		_____
Fire Rescue Suit.....	1.....	_____
Gloves, pr.....	5.....	_____
Respirator		
Self Contained Breathing Apparatus (2).....		_____
Full Tank.....		_____
Regulator and warning device operational.....		_____
Survey Meter G.M.....	2.....	_____
Pancake Probe (1).....		_____
Calibration O.K.....		_____
Survey Instrument Ion Chamber.....	2.....	_____
Calibration O.K.....		_____
TLD's.....	10.....	_____

REASON FOR INSPECTION  
 Monthly      Semi-Annual      Lock Broken  
 Quarterly    Post-Drill      Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Central Security Control Bldg., Radiation Monitoring Team Kit/Fire Dept.  
Each of 2 Kits Should Contain Items Listed Below.

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Air Sampler.....	1.....	_____
Calibration O.K.....		_____
Bags, Plastic.....	10.....	_____
Cartridges, Silver Zeolite.....	6.....	_____
Charger, Dosimeter.....	1.....	_____
Battery Compartment Operational.....		_____
Dosimeters, Pocket (5R).....	2.....	_____
Calibration O.K.....		_____
Filter Paper, box.....	1.....	_____
Flashlights.....	2.....	_____
Battery Compartment Operational.....		_____
Key to Monitoring Cabinet.....	1.....	_____
Protective Clothing		
Coveralls (2).....		_____
Cloth Gloves, pr (2).....		_____
Rubber Gloves, pr (2).....		_____
Cloth Shoe Covers, pr (2).....		_____
Rubber Shoe Covers, pr (2).....		_____
Hood (2).....		_____
Surgeons Cap (2).....		_____
Rain Coats.....	4.....	_____
Rain Pants, pr.....	4.....	_____
Rain Boots, pr.....	4.....	_____
Records Materials		
Clipboard, Paper, Pencil (1).....		_____
Logbook (1).....		_____
Protective Action Sectors Map (1).....		_____
Site Map (1).....		_____
Survey Forms.....		_____
Respirator		
Full Face (2).....		_____
Iodine Cannister (2).....		_____
Next check prior to filter expiration date.....		_____
Protective Bag Unbroken.....		_____
TLD's.....	5.....	_____
Tweezers.....	1.....	_____
EIP-4.....	1.....	_____
RCP-234.....	1.....	_____

REASON FOR INSPECTION  
 Monthly      Semi-Annual      Lock Broken  
 Quarterly    Post-Drill      Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Survey Meter, G.M.....	1	_____
Pancake Probe (1) or Sidewindow Probe (1).....		_____
Calibration O.K.....		_____
Survey Instrument Ion Chamber.....	1	_____
Calibration O.K.....		_____
Tape, Electrical, roll.....	2	_____
Tape, Masking, roll.....	2	_____
TLD's.....	20	_____
Tool Kit		
Channel Locks (1).....		_____
Hacksaw (1).....		_____
Hammer, Carpenters (1).....		_____
Pliers (1).....		_____
Screwdriver Set (1).....		_____
Side Cutters (1).....		_____
Wrench, Pipe (1).....		_____
Wrench, Large Adjustable (1).....		_____
Wrench, Small Adjustable (1).....		_____

REASON FOR INSPECTION

Monthly      Semi-Annual      Lock Broken  
 Quarterly    Post-Drill      Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Emergency Operations Facility

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Records Materials		
Clipboard, Paper, Pencil.....	1.....	_____
Drawings of Facility, Set.....	1.....	_____
Emergency Plan.....	1.....	_____
Emergency Plan Implementing Procedures, Set..	1.....	_____
Protective Action Sectors Map.....	1.....	_____
INPO Emergency Resources Manual.....	1.....	_____
Potassium Iodide Bottle.....	50.....	_____
Dosimeters, Pocket (5R).....	20.....	_____
TLD's.....	20.....	_____

REASON FOR INSPECTION

Quarterly      Semi-Annual      Lock Broken  
 Other            Post-Drill            Emergency Use  
 \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Southeast Alabama Medical Center

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Applicators, Cotton Tip, pkg.....	1.....	_____
Bags, Plastic.....	20.....	_____
Basin.....	1.....	_____
Brushes, Hand.....	2.....	_____
Charger, Dosimeter.....	1.....	_____
Battery Compartment Operational.....		_____
Clippers, Hair.....	1.....	_____
Containers, Specimen.....	10.....	_____
Cotton Balls box.....	1.....	_____
Decon. Solution, btl.....	1.....	_____
Detergent Soap, box.....	1.....	_____
Dosimeter, Pocket (5R).....	5.....	_____
Drums, Waste.....	3.....	_____
Filter Paper, box.....	2.....	_____
Labels, Self Sticking "RADIOACTIVE" roll.....	1.....	_____
Lead pig.....	1.....	_____
Mask, Surgeon's Face.....	4.....	_____
Needles, pkg.....	1.....	_____
Paper, Absorbent, roll.....	1.....	_____
Poly Sheets, roll.....	1.....	_____
Protective Clothing		
Lab Coats (6).....		_____
Rubber Gloves, pr (20).....		_____
Surgeon's Gloves, pr (8).....		_____
Plastic Shoe Covers, pr (20).....		_____
Surgeons Cap (4).....		_____
Records Materials		
Clipboard, Paper, Pencil (1).....		_____
Logbook (1).....		_____
Pen, w/waterproof ink (1).....		_____
Survey Forms, (1 set).....		_____
Rope, Radiation 100'.....	1.....	_____
Scissors, Metzenbalm, Small..	1.....	_____
Scissors, Sewing.....	1.....	_____
Signs, Radiation.....	10.....	_____
Suits, Surgical.....	4.....	_____
Survey Meter, G.M.....	1.....	_____
Pancake Probe (1).....		_____
Medical Probe (1).....		_____
Calibration O.K.....		_____
Survey Instrument Ion Chamber.....	1.....	_____
Calibration O.K.....		_____

11

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Suture Set.....	1	_____
Syringe Bulb.....	1	_____
Tags.....	10	_____
Tape, Masking, roll.....	2	_____
TLD's.....	10	_____
Curved Murphy Kelly Forceps 5½.....	3	_____
St. Murphy Kelley Forceps 5½.....	2	_____
Dressing Forcep no teeth.....	1	_____
Adron Forcep with mouse teeth.....	1	_____
Adron Forcep w/o teeth.....	1	_____
Needle Holder 5".....	1	_____
Needle Holder 6".....	1	_____
Mosquito Forcep St.....	3	_____
Towel Clips Backhaus.....	2	_____
Allis Forceps (4x5) 5½".....	2	_____
Operating Scissors S&B 5½".....	1	_____
#3 Knife Handle.....	1	_____
Butcher Tray 19x12½x5/8".....	1	_____
Medicine Cup.....	1	_____
Round Basin 1 7/8 qt.....	1	_____
Medicine Glass.....	1	_____
Syringe 2 c.c. LL.....	1	_____
Syringe 10 c.c. LL.....	1	_____
Hyponeedle Reusable 22G.....	1	_____
Hyponeedle Reusable 25G.....	1	_____

REASON FOR INSPECTION  
 Semi-Annual      Lock Broken  
 Quarterly        Post-Drill        Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - FNP Stretcher Cabinets

<u>Description</u>	<u>Location</u>	<u>Quantity</u>	<u>Initials</u>
Stretcher, Pole.....	Utility Building.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Basket.....	Water Treatment Plant.....	1.....	_____
4-Point Sling.....		1.....	_____
Body Straps.....		4.....	_____
Blankets.....		2.....	_____
Stretcher, Basket.....	Srv. Bldg. First Aid Room.....	1.....	_____
4-Point Sling.....		1.....	_____
Body Straps.....		4.....	_____
Blankets.....		2.....	_____
Stretcher, Pole.....	C.S.C. Building.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole.....	Switchhouse.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole.....	Control Room.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Basket Unit I.....	Aux-RCA 155' W. Stairs.....	1.....	_____
4-Point Sling.....		1.....	_____
Body Straps.....		4.....	_____
Blankets.....		2.....	_____
Stretcher, Pole Unit I.....	Aux-RCA 139' W. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit I.....	Aux-RCA 121' E. Hall.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit I.....	Aux-RCA 100' W. Stairs.....	1.....	_____ 11
Blanket.....		1.....	_____
Stretcher, Basket Unit I.....	Aux-RCA 83' W. Stairs.....	1.....	_____
4-Point Sling.....		1.....	_____
Body Straps.....		4.....	_____
Blanket.....		2.....	_____
Stretcher, Pole Unit I.....	Aux-NON-RAD 139' Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit I.....	Aux-NON-RAD 121' Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit I.....	Aux-NON-RAD 100' Stairs.....	1.....	_____ 11
Blanket.....		1.....	_____
Stretcher, Pole Unit I.....	Turb Bldg 189' W. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit I.....	Turb Bldg 137' S. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole.....	Srv. Wtr. NE Entrance.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole.....	River Wtr. S. Compartment.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole.....	Diesel Gen Bldg W. Entrance.....	1.....	_____
Blanket.....		1.....	_____

<u>Description</u>	<u>Location</u>	<u>Quantity</u>	<u>Initials</u>
Stretcher, Basket, Unit I.....	Fire Protection Building.....	1.....	_____
4-Point Sling.....		1.....	_____
Body Straps.....		4.....	_____
Blankets.....		2.....	_____
Stretcher, Basket, Unit II.....	Turbine Bldg. El. 155'.....	1.....	_____
4-Point Sling.....		1.....	_____
Body Straps.....		4.....	_____
Blankets.....		2.....	_____
Stretcher, Basket, Unit II.....	Aux-Rad 155' E. Stairs.....	1.....	_____
4-Point Sling.....		1.....	_____
Body Straps.....		4.....	_____
Blankets.....		1.....	_____
Stretcher, Pole Unit II.....	Turbine Bldg. 137' N. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II.....	Turbine Bldg. 189' N. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II.....	Aux-NON-RAD 139' Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II.....	Aux-NON-RAD 121' Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II.....	Aux-NON-RAD 100' Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II.....	Aux RAD 139' E. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II.....	Aux RAD 121' E. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II.....	Aux RAD 100' E. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II.....	Aux RAD 83' W. Stairs.....	1.....	_____
Blanket.....		1.....	_____
Stretcher, Pole Unit II....	Cl <sub>2</sub> House/Cooling Twoer A.....	1.....	_____
Blanket.....		1.....	_____

REASON FOR INSPECTION  
 Quarterly    Post-Drill    Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location: Switchhouse, Emergency Operations Facility,, Technical Support Center

11

Description: Each location should contain the following listed drawings:

Unit 1: pp. 2 - 6

Unit 2: pp. 7 - 10

REASON FOR INSPECTION

- Quarterly
- Post-drill
- Lock broken
- Emergency use
- Other \_\_\_\_\_

Checked By: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

Emergency Planners Review \_\_\_\_\_

UNIT 1 EMERGENCY PLAN DRAWINGS

	<u>EOF</u>	<u>Switch Yard</u>	<u>TSC</u>
D-170064	_____	_____	_____
D-170066	_____	_____	_____
D-170067	_____	_____	_____
D-170069	_____	_____	_____
D-170070 Sh. 1, 2, 3	_____	_____	_____
D-170071	_____	_____	_____
D-170076	_____	_____	_____
D-170077	_____	_____	_____
D-170079	_____	_____	_____
D-170080	_____	_____	_____
D-170084	_____	_____	_____
D-170085	_____	_____	_____
D-170087	_____	_____	_____
D-170089	_____	_____	_____
D-170110	_____	_____	_____
D-170111	_____	_____	_____
D-170112	_____	_____	_____
D-170113	_____	_____	_____
D-170114 Sh. 1, 2	_____	_____	_____
D-170117 Sh. 1 through 4	_____	_____	_____
D-170118	_____	_____	_____
D-170119 Sh. 1 through 11	_____	_____	_____
D-170120	_____	_____	_____
D-170121	_____	_____	_____
D-170124 Sh. 1, 2, 3, 4, 5, 6	_____	_____	_____

11

	<u>EOF</u>	<u>Switch Yard</u>	<u>TSC</u>
D-170125	_____	_____	_____
D-170127	_____	_____	_____
D-175029 Sh. 1, 2	_____	_____	_____
D-170130 Sh. 1, 2, 3, 4, 5	_____	_____	_____
D-170131 Sh. 1, 2, 3, 4	_____	_____	_____
D-170132 Sh. 1, 2	_____	_____	_____
D-170133	_____	_____	_____
D-170177	_____	_____	_____
D-170208	_____	_____	_____
D-170295	_____	_____	_____
D-170296	_____	_____	_____
D-170381 Sh. 1, 2, 3, 4, 5, 6	_____	_____	_____
D-170382 Sh. 1, 2	_____	_____	_____
D-170384 Sh. 1, 2, 3, 4, 5	_____	_____	_____
D-170385 Sh. 1, 2, 3	_____	_____	_____
D-170386	_____	_____	_____
D-170473 Sh. 1, 2, 3, 4, 5	_____	_____	_____
D-170475	_____	_____	_____
D-170476	_____	_____	_____
D-170481	_____	_____	_____
D-170800 Sh. 1, 2	_____	_____	_____
D-170801 Sh. 1, 2	_____	_____	_____
D-170802 Sh. 1, 2	_____	_____	_____
D-170803 Sh. 1, 2	_____	_____	_____
D-170804 Sh. 1, 2	_____	_____	_____

11

	<u>EOF</u>	<u>Switch Yard</u>	<u>TSC</u>
D-170805 Sh. 1, 2	_____	_____	_____
D-170806 Sh. 1, 2	_____	_____	_____
D-170807 Sh. 1, 2	_____	_____	_____
D-170808 Sh. 1, 2	_____	_____	_____
D-170809 Sh. 1, 2	_____	_____	_____
D-170810	_____	_____	_____
D-170811	_____	_____	_____
D-170812 Sh. 1, 2	_____	_____	_____
D-170813	_____	_____	_____
D-170814	_____	_____	_____
D-171276	_____	_____	_____
D-171331	_____	_____	_____
D-171815	_____	_____	_____
D-171827	_____	_____	_____
D-171829	_____	_____	_____
D-174001	_____	_____	_____
D-174002	_____	_____	_____
D-175000 Sh. 1, 2	_____	_____	_____
D-175001	_____	_____	_____
D-175002 Sh. 1, 2, 3	_____	_____	_____
D-175003 Sh. 1, 2, 3	_____	_____	_____
D-175004 Sh. 1, 2	_____	_____	_____
D-175005	_____	_____	_____
D-175006	_____	_____	_____
D-175007	_____	_____	_____
D-175008	_____	_____	_____

11

	<u>EOF</u>	<u>Switch Yard</u>	<u>TSC</u>
D-175009 Sh. 1, 2	_____	_____	_____
D-175010 Sh. 1, 2	_____	_____	_____
D-175011 Sh. 1, 2, 3	_____	_____	_____
D-175012	_____	_____	_____
D-175014 Sh. 1, 2	_____	_____	_____
D-175016 Sh. 2	_____	_____	_____
D-175017	_____	_____	_____
D-175022	_____	_____	_____
D-175027 Sh. 1, 2	_____	_____	_____
D-175031 Sh. 1, 2	_____	_____	_____
D-175033 Sh. 1, 2	_____	_____	_____
D-175034 Sh. 1, 2, 3	_____	_____	_____
D-175035 Sh. 1, 2	_____	_____	_____
D-175036	_____	_____	_____
D-175037 Sh. 1, 2, 3	_____	_____	_____
D-175038 Sh. 1, 2, 3	_____	_____	_____
D-175039 Sh. 1, 3, 4	_____	_____	_____
D-175040	_____	_____	_____
D-175041	_____	_____	_____
D-175042 Sh. . 2, 3, 4, 5, 6, 7	_____	_____	_____
D-175043	_____	_____	_____
D-175044	_____	_____	_____
D-175045	_____	_____	_____
D-175047	_____	_____	_____
D-175050	_____	_____	_____
D-17055	_____	_____	_____

11

	<u>EOF</u>	<u>Switch Yard</u>	<u>*TSC</u>
D-175056	_____	_____	_____
D-175057	_____	_____	_____
D-175058	_____	_____	_____
D-175059	_____	_____	_____
D-175060	_____	_____	_____
D-175063	_____	_____	_____
D-175071 Sh. 1, 2, 3	_____	_____	_____
D-175073	_____	_____	_____
D-175074	_____	_____	_____
*D-176075	_____	_____	_____
*D-176076	_____	_____	_____
*D-176077	_____	_____	_____
*D-176078	_____	_____	_____
*D-176079	_____	_____	_____
D-170072	_____	_____	_____
D-170073	_____	_____	_____
D-170074	_____	_____	_____
D-170075	_____	_____	_____

11

\*Located with RCP-25 in supplies cabinet.

UNIT 2 EMERGENCY PLAN DRAWINGS

	<u>EOF</u>	<u>Switch Yard</u>	<u>TSC</u>
D-200002 Sh. 1, 2, 3	_____	_____	_____
D-200003	_____	_____	_____
D-200004	_____	_____	_____
D-200005	_____	_____	_____
D-200007	_____	_____	_____
D-200008 Sh. 1, 2, 3, 4, 5, 6	_____	_____	_____
D-200011 Sh. 1, 2	_____	_____	_____
D-200013 Sh. 1, 2, 3, 4, 5, 6, 7, 8, 9	_____	_____	_____
D-200014	_____	_____	_____
D-200016	_____	_____	_____
D-200017	_____	_____	_____
D-200018	_____	_____	_____
D-200019 Sh. 1, 2	_____	_____	_____
D-200022	_____	_____	_____
D-200023	_____	_____	_____
D-200024	_____	_____	_____
D-200025	_____	_____	_____
D-200027	_____	_____	_____
D-200028	_____	_____	_____
D-200042	_____	_____	_____
D-200049	_____	_____	_____
D-200067 Sh. 1, 2	_____	_____	_____
D-200118	_____	_____	_____
D-200132	_____	_____	_____
D-200149	_____	_____	_____

11

	<u>EOF</u>	<u>Switch Yard</u>	<u>TSC</u>
D-200150	_____	_____	_____
D-200151	_____	_____	_____
D-200152	_____	_____	_____
D-200153	_____	_____	_____
D-200175	_____	_____	_____
D-200176	_____	_____	_____
D-200177	_____	_____	_____
D-200180	_____	_____	_____
D-200183	_____	_____	_____
D-200195 Sh. 1, 2, 3, 4, 5, 6	_____	_____	_____
D-200196	_____	_____	_____
D-200197 Sh. 1, 2	_____	_____	_____
D-200198	_____	_____	_____
D-200209	_____	_____	_____
D-200210	_____	_____	_____
D-200211	_____	_____	_____
D-200212	_____	_____	_____
D-200213	_____	_____	_____
D-200215	_____	_____	_____
D-200216	_____	_____	_____
D-200217 Sh. 1, 2	_____	_____	_____
D-200218	_____	_____	_____
D-200222	_____	_____	_____
D-201250	_____	_____	_____
D-201829	_____	_____	_____

11

	<u>EOF</u>	<u>Switch Yard</u>	<u>TSC</u>
D-205000 Sh. 1, 2	_____	_____	_____
D-205002 Sh. 1, 2, 3	_____	_____	_____
D-205003 Sh. 1, 2, 3	_____	_____	_____
D-205004 Sh. 1, 2	_____	_____	_____
D-205005	_____	_____	_____
D-205006	_____	_____	_____
D-205007	_____	_____	_____
D-205008	_____	_____	_____
D-205009 Sh. 1, 2, 3	_____	_____	_____
D-205010 Sh. 1, 2	_____	_____	_____
D-205011 Sh. 1, 2, 3, 4	_____	_____	_____
D-205012	_____	_____	_____
D-205014 Sh. 1, 2	_____	_____	_____
D-205016 Sh. 1, 2	_____	_____	_____
D-205017	_____	_____	_____
D-205021	_____	_____	_____
D-205022	_____	_____	_____
D-205027	_____	_____	_____
D-205031 Sh. 1, 2	_____	_____	_____
D-205033 Sh. 1, 2	_____	_____	_____
D-205034 Sh. 1, 2, 3, 4	_____	_____	_____
D-205035 Sh. 1, 2	_____	_____	_____
D-205036	_____	_____	_____
D-205037 Sh. 1, 2, 3	_____	_____	_____
D-205038 Sh. 1, 2, 3	_____	_____	_____
D-205039 Sh. 1, 3, 4	_____	_____	_____

11

	<u>EOF</u>	<u>Switch Yard</u>	<u>*TSC</u>
D-205040	_____	_____	_____
D-205041	_____	_____	_____
D-205042 Sh. 1, 2, 3, 4, 5, 6, 7	_____	_____	_____
D-205043	_____	_____	_____
D-205044	_____	_____	_____
D-205045	_____	_____	_____
D-205047	_____	_____	_____
D-205050	_____	_____	_____
D-205055	_____	_____	_____
D-205056	_____	_____	_____
D-205057	_____	_____	_____
D-205058	_____	_____	_____
D-205059	_____	_____	_____
D-205060	_____	_____	_____
D-205063	_____	_____	_____
D-205071 Sh. 1, 2, 3	_____	_____	_____
D-205073	_____	_____	_____
D-205074	_____	_____	_____
*D-206075	_____	_____	_____
*D-206076	_____	_____	_____
*D-206077	_____	_____	_____
*D-206078	_____	_____	_____
*D-206079	_____	_____	_____
*Located with RCP-25			
D-170069 Sh. 1	_____	_____	_____
D-170084	_____	_____	_____

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Plant Emergency Vehicle and Environmental Vehicle

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Plant Emergency Vehicle		
Two-Way Radio.....	1.....	_____
Operational.....		_____
Environmental Vehicle		
Two-Way Radio.....	1.....	_____
Operational.....		_____

REASON FOR INSPECTION  
Quarterly    Post-Drill    Emergency Use  
Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
TITLE: \_\_\_\_\_  
DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Aux. Bldg. Entrance West Non-Rad Hallway - Unit 1

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Self Contained Breathing Apparatus (upper rack)		
Air Bottles.....	48.....	_____
Full Tank.....		_____
Self Contained Breathing Apparatus (lower rack)		
Air Bottles.....	48.....	_____
Full Tank.....		_____

REASON FOR INSPECTION

Monthly \_\_\_\_\_  
 Post-Drill      Emergency Use \_\_\_\_\_  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Service Bldg. Maintenance Shop

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Masking Tape (roll).....	4.....	_____
Protective Clothing		
Cloth Gloves, pr. (20).....	.....	_____
Cloth Shoe Covers, pr. (20).....	.....	_____
Coveralls (20).....	.....	_____
Hood (20).....	.....	_____
Plastic Shoe Covers (20).....	.....	_____
Rubber Gloves, pr. (20).....	.....	_____
Rubber Shoe Covers, pr. (20).....	.....	_____
Surgeons Cap (20).....	.....	_____

\*Chlorine Institute Emergency Kit "A"

Hood (#1A).....	1.....	_____
Gasket, Flat, Neoprene, 4 ID x 6½ OD x ½ (#1B).....	3.....	_____
Yoke (#1C).....	1.....	_____
Cap Screw (#1D).....	1.....	_____
Base Assembly with Chains (#1EH).....	1.....	_____
Spacer Plat (#1P).....	1.....	_____
Ramp (#1R).....	1.....	_____
Vent Valve (part of 1A) (#1V).....	1.....	_____
Block (#2A).....	1.....	_____
Gasket, Garlock 951, 15/16 dia. x 1/16 (#2B).....	10.....	_____
Clamp (#2C).....	1.....	_____
Set Screw (#2D).....	1.....	_____
Chain (#8A).....	1.....	_____
Yoke (#8B).....	1.....	_____
Cap Screw (#8C).....	1.....	_____
Steel Patch (#8D).....	1.....	_____
Gasket, Neoprene, 2-1/2 sq. x 1/8 (#8E).....	3.....	_____
Wrench, 3/8 sq. box, 1-½ open end x 5-1/8 (#200).....	1.....	_____
Wrench, straight open end, 1-½x1-1/8x12-3/8 (#201).....	1.....	_____
Wrench, double box 7/16 x 9/16 x 8-3/8 (#203).....	1.....	_____
Hammer, Machinist 3 lb (#A-1).....	1.....	_____
Hacksaw, 10" and 3 blades (#A-2).....	1.....	_____
Drift Pin, 9/32 x 1/2 x 6 (#A-3).....	2.....	_____
Drift Pin, 7/8 x 1-1/4 x 8(A-4).....	2.....	_____
Ring, vent valve packing, set of 5, 7/8 OD x 15/32 ID x 1/4 sq. (#A-5).....	5.....	_____
Metal Railroad Car Seal (#A-6).....	15.....	_____
Gasket Sack (#A-7).....	1.....	_____
Paint Scraper, 1-1/4 blade (#A-8).....	1.....	_____
Valve Yoke (#A-9).....	1.....	_____
Valve Adapter (823 - Hose) (#A-10).....	1.....	_____
Packing Pick #8 (#A-11).....	1.....	_____
Washer, valve outlet 35/64 ID x 15/16 OD x 1/16 (#A-12).....	5.....	_____
Plastic Box (#A-13).....	1.....	_____
File, 8" (#A-14).....	1.....	_____

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
*Chlorine Institute Emergency Kit "A" (con't)		
Tool Room (#144).....	1.....	_____
Steel Box (#152A).....	1.....	_____
*Chlorine Institute Emergency Kit "B"		
Hood (#4A).....	1.....	_____
Gasket, Neoprene, 4OD x 2-3/8 ID x 1/4 (#4B).....	3.....	_____
Yoke (#4C).....	1.....	_____
Gasket, Garlock, 1-1/2 OD x 11/16 ID x 1/16 (#4D).....	3.....	_____
Stud (#4E).....	1.....	_____
Cap Nut (#4F).....	1.....	_____
Gasket, Garlock, 15/16 dia. x 1/16 (#4G).....	5.....	_____
Chain (#9A).....	1.....	_____
Yoke (#9B).....	1.....	_____
Cap Screw (#9C).....	1.....	_____
Steel Patch (#9D).....	1.....	_____
Gasket, Neoprene, 3" sq. x 1/8 (#9E).....	3.....	_____
Hood Assembly (#12A).....	1.....	_____
Gasket, Neoprene, 5 OD x 2 ID x 1/4 (#12B).....	3.....	_____
Gasket, Neoprene, 5 OD x 2 ID x 1/2 (#12BB).....	1.....	_____
Bar Assembly (#12C).....	1.....	_____
Gasket, Neoprene, Molded 5-1/5 OD x 2-1/4 ID x 3/4 (#12M).....	1.....	_____
Vent Valve (Part of 12A) (#12V).....	1.....	_____
Wrench, straight open end, 1-14 x 12 (#101).....	1.....	_____
Wrench, socket, 1-1/4 hex (#104).....	1.....	_____
Wrench extension, 1" sq. drive x 9 (#104A).....	1.....	_____
Wrench bar, 1" dia. x 20 (#104B).....	1.....	_____
Wrench, crowfoot special, 1-5/32 x 11 (#106).....	1.....	_____
Wrench, 3/8 sq. box & 1-1/2 open end x 7-1/2 (#200).....	1.....	_____
Drift Pin, 9/32 x 1/2 x 6 (#B-1).....	2.....	_____
Drift Pin, 7/8 x 1-1/4 x 8 (#B-2).....	2.....	_____
Drift Pin, 1-1/6 x 1-7/16 x 8 (#B-3).....	2.....	_____
Ring, vent valve packing (#B-4).....	5.....	_____
Paint Scraper, 1-1/4 blade (#B-5).....	1.....	_____
Hammer, Machinist, 3# (#B-6).....	1.....	_____
Metal Railroad Car Seal (#B-7).....	15.....	_____
Gasket Sack (#B-8).....	1.....	_____
Valve Yoke (#B-9).....	1.....	_____
Valve Adapter (#B-10).....	1.....	_____
Gasket, Garlock 15/16 OD x 9/16 ID x 1/16 (#B-11).....	5.....	_____
Plastic Box (#B-12).....	1.....	_____
Steel Box (#151B).....	1.....	_____
Tool Roll (#153).....	1.....	_____

\*Chlorine Emergency Repair Kits (A and B) - Inventory all items separately only if seal is broken on outside of kit.

REASON FOR INSPECTION  
 Lock Broken  
 Quarterly Post-Drill Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

EMERGENCY PLAN  
 FOOD SUPPLY  
 CHECKLIST

Location - Control Room Kitchen

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Locker #1		
Case #1		
Meat Flav. Textured Vegetable Protein (#10 can).....	5.....	_____
Bacon Flavored Bits (#10 can).....	1.....	_____
Case #2		
Whole Wheat Flour (#10 can).....	6.....	_____
Case #3		
White Flour (#10 can).....	6.....	_____
Case #4		
Powdered Butter (#10 can).....	6.....	_____
Case #5		
Culinary Capers Cookbook.....	1.....	_____
Plastic lids (#10).....	38.....	_____
Plastic lids (#3).....	5.....	_____
Allocation Sheet.....	1.....	_____
Case #6		
Whole Wheat Flour (#10 can).....	6.....	_____
Case #7		
Cheddar Cheese Mix (#10 can).....	1.....	_____
Egg Mix (#10 can).....	3.....	_____
Gelatin Dessert (#10 can).....	2.....	_____
Case #8		
Cornstarch (#10 can).....	1.....	_____
Egg Mix (#10 can).....	1.....	_____
Beef Gravy (#10 can).....	1.....	_____
Salt (#10 can).....	1.....	_____
Beef Bouillion (#10 can).....	1.....	_____
Chicken Gravy (#10 can).....	1.....	_____
Case #9		
Elbow Spaghetti (#10 can).....	2.....	_____
Yellow Cornmeal (#10 can).....	1.....	_____
White Rice (#10 can).....	3.....	_____
Case #10		
Powdered Shortening (#10 can).....	6.....	_____
Case #11		
White Flour (#10 can).....	6.....	_____

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Case #12		
Breakfast Drink (#10 can).....	2.....	_____
Syrup Mix (#10 can).....	2.....	_____
Non-dairy Creamer (#10 can).....	2.....	_____
Case #13		
Multi-purpose Food (#10 can).....	1.....	_____
Pinto Beans (#10 can).....	1.....	_____
Green Beans (#10 can).....	1.....	_____
Banana Chips (#10 can).....	1.....	_____
Chicken Flavored Granules (#10 can).....	1.....	_____
Yam Flakes (#10 can).....	1.....	_____
Case #14		
Crispy Chips (#10 can).....	1.....	_____
Ham Flavored Granules (#10 can).....	1.....	_____
Egg Mix (#10 can).....	1.....	_____
Chili Beans (#10 can).....	1.....	_____
Fruit Galaxy (#10 can).....	1.....	_____
Cracked Wheat Cereal (#10 can).....	1.....	_____
Case #15		
White Flour (#10 can).....	6.....	_____
Case #16		
Chicken Flavored Gravy Mix (#3 can).....	1.....	_____
Orange Drink (#3 can).....	1.....	_____
Baking Powder (#3 can).....	1.....	_____
Yeast (#3 can).....	1.....	_____
Yukon Biscuits (#10 can).....	3.....	_____
Dry Milk (#10 can).....	1.....	_____
Case #17		
Whole Wheat Flour (#10 can).....	5.....	_____
White Flour (#10 can).....	1.....	_____
Case #18		
Whole Wheat Flour (#10 can).....	6.....	_____
Case #19		
Whole Wheat Flour (#10 can).....	6.....	_____
Locker #2		
Case #1		
Dry Beans (#10 can).....	3.....	_____
Quick Cooking Oatmeal (#10 can).....	2.....	_____
Pear Barley (#10 can).....	1.....	_____
Case #2		
Yam Flakes (#10 can).....	1.....	_____
Vegetable Soup Blend (#10 can).....	1.....	_____

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Minced Onions (#10 can).....	1.....	_____
Carrots (#10 can).....	1.....	_____
Green Beans (#10 can).....	1.....	_____
Sweet Corn (#10 can).....	1.....	_____
Case #3		
Apple Flavored Nuggets (#10 can).....	2.....	_____
Fruit Galaxy (#10 can).....	1.....	_____
Peach Slices (#10 can).....	1.....	_____
Apple Nuggets (#10 can).....	1.....	_____
Apple Pieces (#10 can).....	1.....	_____
Case #4		
Granulated Sugar (#10 can).....	6.....	_____
Case #5		
Regular Non-Fat Milk (#10 can).....	6.....	_____
Case #6		
Regular Non-Fat Milk (#10 can).....	6.....	_____
Case #7		
Powdered Shortening (#10 can).....	6.....	_____
Case #8		
Whole Wheat Flour (#10 can).....	6.....	_____
Case #9		
Tomato Crystals (#10 can).....	1.....	_____
Peas (#10 can).....	1.....	_____
Gran. Potatoes w/Milk (#10 can).....	2.....	_____
Diced Potatoes (#10 can).....	1.....	_____
Carrots (#10 can).....	1.....	_____
Case #10		
Salad Blend (#10 can).....	1.....	_____
Dry Milk (#10 can).....	3.....	_____
Egg Mix (#10 can).....	1.....	_____
Mashed Potato (#10 can).....	1.....	_____
Case #11		
Cracked Wheat Cereal (#10 can).....	6.....	_____
Case #12		
Whole Wheat Flour (#10 can).....	6.....	_____
Case #13		
Whole Wheat Flour (#10 can).....	6.....	_____
Case #14		
Whole Wheat Flour (#10 can).....	6.....	_____

REASON FOR INSPECTION

Lock Broken

Quarterly Post-Drill

Emergency Use

Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_

TITLE: \_\_\_\_\_

DATE: \_\_\_\_\_

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Hot Shutdown Panel - Corridor - Unit 1

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
EIP Procedures - EIP 8.....	1.....	_____
EIP-18.....	1.....	_____
Operating Procedures FNP-1-UOP-2.1.....	1.....	_____
FNP-1-SOP-2.3.....	1.....	_____
FNP-1-EOP-8.0.....	1.....	_____
FNP-1-STP-29.1.....	1.....	_____
FNP-1-STP-29.2.....	1.....	_____
Headset, sound-powered.....	1.....	_____
Operational.....		_____
Extension cord, headset.....	1.....	_____
Flashlight.....	1.....	_____

REASON FOR INSPECTION

Lock Broken  
Quarterly Post-Drill      Emergency Use  
Other \_\_\_\_\_

Checked By: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Auxiliary Building, El. 139 - Unit 1

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Blanket.....	2.....	_____
Bucket.....	1.....	_____
Decon. Solution, btl.....	1.....	_____
First Aid Kit.....	1.....	_____
Gloves, Disposable, box.....	1.....	_____
Kimwipes, box.....	1.....	_____
Mop.....	1.....	_____
Paper, Absorbent, roll.....	1.....	_____
Polysheets, roll.....	1.....	_____
Protective Clothing		
Coveralls (3).....		_____
Cloth Gloves, pr (3).....		_____
Rubber Gloves, pr (3).....		_____
Cloth Shoe Covers, pr (3).....		_____
Rubber Shoe Covers, pr (3).....		_____
Hood (3).....		_____
Surgeons Cap (3).....		_____
Respirator, Full-Face and Cannister.....	2.....	_____
Next check date prior to filter expiration date.....		_____
Rope, Radiation 100'.....	1.....	_____
Scissors, pr.....	1.....	_____
Signs		
Airborne Radioactivity Area (3).....		_____
Contaminated Area (3).....		_____
High Radiation Area (3).....		_____
Radiation Area (3).....		_____
Tape, Masking, roll.....	2.....	_____

REASON FOR INSPECTION  
 Monthly      Lock Broken  
 Quarterly    Post-Drill      Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Auxiliary Building, El. 100 - Unit 1

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Blanket.....	2	_____
Bucket.....	1	_____
Decon. Solution, btl.....	1	_____
First Aid Kit.....	1	_____
Gloves, Disposable, box.....	1	_____
Kimwipes, box.....	1	_____
Mop.....	1	_____
Paper, Absorbent, roll.....	1	_____
Polysheets, roll.....	1	_____
Protective Clothing		
Coveralls (3).....		_____
Cloth Gloves, pr (3).....		_____
Rubber Gloves, pr (3).....		_____
Cloth Shoe Covers, pr (3).....		_____
Rubber Shoe Covers, pr (3).....		_____
Hood (3).....		_____
Surgeons Cap (3).....		_____
Respirator, Full-Face and Cannister.....	2	_____
Next check date prior to filter expiration date.....		_____
Rope, Radiation 100'.....	1	_____
Scissors, pr.....	1	_____
Signs		
Airborne Radioactivity Area (3).....		_____
Contaminated Area (3).....		_____
High Radiation Area (3).....		_____
Radiation Area (3).....		_____
Tape, Masking, roll.....	2	_____

REASON FOR INSPECTION  
 Monthly      Lock Broken  
 Quarterly    Post-Drill      Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Auxiliary Building, El. 83' - Unit 2

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Blanket.....	2	_____
Bucket.....	1	_____
Decon. Solution, btl.....	1	_____
First Aid Kit.....	1	_____
Gloves, Disposable, box.....	1	_____
Kimwipes, box.....	1	_____
Mop.....	1	_____
Paper, Absorbent, roll.....	1	_____
Polysheets, roll.....	1	_____
Protective Clothing		
Coveralls (3).....		_____
Cloth Gloves, pr (3).....		_____
Rubber Gloves, pr (3).....		_____
Cloth Shoe Covers, pr (3).....		_____
Rubber Shoe Covers, pr (3).....		_____
Hood (3).....		_____
Surgeons Cap (3).....		_____
Respirator, Full-Face and Cannister.....	2	_____
Next check date prior to filter expiration date.....		_____
Rope, Radiation 100'.....	1	_____
Scissors, pr.....	1	_____
Signs		
Airborne Radioactivity Area (3).....		_____
Contaminated Area (3).....		_____
High Radiation Area (3).....		_____
Radiation Area (3).....		_____
Tape, Masking, roll.....	2	_____

REASON FOR INSPECTION  
 Monthly      Lock Broken  
 Quarterly    Post-Drill      Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Hot Shutdown Panel - Communications Room - Unit 1

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
EIP Procedures - EIP 8.....	1.....	_____
EIP-18.....	1.....	_____
Operating Procedures FNP-1-UOP-2.1.....	1.....	_____
FNP-1-SOP-2.3.....	1.....	_____
FNP-1-EOP-8.0.....	1.....	_____
FNP-1-STP-29.1.....	1.....	_____
FNP-1-STP-29.2.....	1.....	_____
Headset, sound-powered.....	1.....	_____
Operational.....		_____
Extension cord, headset.....	1.....	_____
Flashlight.....	1.....	_____

REASON FOR INSPECTION

Lock Broken  
Quarterly Post-Drill      Emergency Use  
Other \_\_\_\_\_

Checked By: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Hot Shutdown Panel - Corridor - Unit 2

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
EIP Procedures - EIP 8.....	1.....	_____
EIP-18.....	1.....	_____
Operating Procedures FNP-2-UOP-2.1.....	1.....	_____
FNP-2-SOP-2.3.....	1.....	_____
FNP-2-EOP-8.0.....	1.....	_____
FNP-2-STP-29.1.....	1.....	_____
FNP-2-STP-29.2.....	1.....	_____
Headset, sound-powered.....	1.....	_____
Operational.....		_____
Extension cord, headset.....	1.....	_____
Flashlight.....	1.....	_____

REASON FOR INSPECTION

Lock Broken  
Quarterly Post-Drill      Emergency Use  
Other \_\_\_\_\_

Checked By: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Hot Shutdown Panel - Communications Room - Unit 2

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
EIP Procedures - EIP 8.....	1.....	_____
EIP-18.....	1.....	_____
Operating Procedures FNP-2-UOP-2.1.....	1.....	_____
FNP-2-SOP-2.3.....	1.....	_____
FNP-2-EOP-8.0.....	1.....	_____
FNP-2-STP-29.1.....	1.....	_____
FNP-2-STP-29.2.....	1.....	_____
Headset, sound-powered.....	1.....	_____
Operational.....		_____
Extension cord, headset.....	1.....	_____
Flashlight.....	1.....	_____

REASON FOR INSPECTION

Lock Broken

Quarterly Post-Drill

Emergency Use

Other \_\_\_\_\_

11

Checked By: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Auxiliary Building, El. 83 - Unit 2

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Respirator		
Self-Contained Breathing Apparatus (1).....		_____
Full Tank.....		_____
Regulator and warning device operational.....		_____

REASON FOR INSPECTION  
 Monthly \_\_\_\_\_  
 Post-Drill      Emergency Use \_\_\_\_\_  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

11

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIES  
CHECKLIST

Location - Technical Support Center

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Abnormal Operating Procedures, Unit 1, set.....	1.....	_____
Abnormal Operating Procedures, Unit 2, set.....	1.....	_____
Dictionary (Document Room).....	1.....	_____
Emergency Operating Procedures, Unit 1, set.....	1.....	_____
Emergency Operating Procedures, Unit 2, set.....	1.....	_____
Emergency Plan.....	1.....	_____
Emergency Plan Implementing Procedures, set.....	1.....	_____
FNP-0-RCP-25, C&IP Activities During an Emergency.....	1.....	_____
FNP-0-SOP-56.1, TSC HVAC System.....	1.....	_____
INPO Emergency Resources Manual.....	1.....	_____
Radios (two-way) - Cabinet		
Security.....	1.....	_____
Operational.....	1.....	_____
Plant.....	1.....	_____
Operational.....	1.....	_____
Division.....	1.....	_____
Operational.....	1.....	_____
Records Materials - Monitoring Area (Filing Cabinet)		
Clips, bulldog, small, box.....	2.....	_____
Clips, bulldog, medium, box.....	2.....	_____
Clips, bulldog, large, box.....	2.....	_____
Clips, paper, small, box.....	10.....	_____
Clips, paper, medium, box.....	10.....	_____
Clips, paper, large, box.....	2.....	_____
Envelopes, routing, letter size.....	36.....	_____
Envelopes, routing, legal size.....	36.....	_____
Eraser.....	2.....	_____
Hi-liter, blue, box.....	4.....	_____
Hi-liter, green, box.....	4.....	_____
Hi-liter, pink, box.....	4.....	_____
Hi-liter, yellow, box.....	4.....	_____
Liquid paper, regular, bottle.....	12.....	_____
Liquid paper, copier type, bottle.....	12.....	_____
Marker, black, box.....	1.....	_____
Marker, blue, box.....	1.....	_____
Marker, green, box.....	1.....	_____
Marker, red, box.....	1.....	_____
Paper, pad.....	30.....	_____
Pen, ballpoint, medium point, black.....	36.....	_____
Pen, ballpoint, medium point, red.....	36.....	_____
Pen, felt tip, black.....	36.....	_____
Pen, felt tip, red.....	36.....	_____
Pencils, box.....	4.....	_____
Pencil trimmer.....	2.....	_____
Rubber bands, large, box.....	1.....	_____
Rubber bands, regular, box.....	1.....	_____
Ruler.....	2.....	_____
Scissors, pair.....	2.....	_____

11

<u>Description</u>	<u>Quantity</u>	<u>Initials</u>
Stapler.....	2	_____
Staples, box.....	2	_____
Staple remover.....	2	_____
Telephone call memo pad.....	20	_____
Records Materials - Planning & Coordination Area - Each Desk		
Clips, assorted set.....	1	_____
Mi-liter, assorted colors.....	2	_____
Paper, pad.....	2	_____
Pen, ball point, assorted colors (black & red).....	2	_____
Pen, felt tip, assorted colors (black & red).....	2	_____
Pencils.....	2	_____
Standard Technical Specifications, Unit 1.....	1	_____
Standard Technical Specifications, Unit 2.....	1	_____
Technical Manuals (Document Room), set.....	1	_____
Telephone directory, APCo (Document Room).....	4	_____
Telephone directory, Southeast Division.....	2	_____
Telephones		
Communications Area		
6014 CBX.....	1	_____
Operational.....		_____
Communications Cabinet		
ENN (white phone).....	1	_____
NRC Ring down (red phone).....	1	_____
6015 CBX w/speaker.....	1	_____
Operational.....		_____
1155 OPX.....	1	_____
Operational.....		_____
1601 OPX w/speaker.....	1	_____
Operational.....		_____
Sound powered jack (operational).....	1	_____
Desks		
6016 CBX (Emergency Director).....	1	_____
Operational.....		_____
6017 CBX (Operations Manager).....	1	_____
Operational.....		_____
6018 CBX (Maintenance Manager).....	1	_____
Operational.....		_____
6011 CBX (Technical Manager).....	1	_____
Operational.....		_____
6012 CBX (H.P. Manager).....	1	_____
Operational.....		_____
Filing Cabinet - Monitoring Area		
6010 CBX (Monitoring Area).....	1	_____
Operational.....		_____
6013 CBX (NRC).....	1	_____
Operational.....		_____
6019 CBX (NRC).....	1	_____
Operational.....		_____
Unit Operating Procedures, Unit 1, set.....	1	_____
Unit Operating Procedures, Unit 2, set.....	1	_____

11

REASON FOR INSPECTION  
 Lock Broken  
 Quarterly Post-Drill Emergency Use  
 Other \_\_\_\_\_

CHECKED BY: \_\_\_\_\_  
 TITLE: \_\_\_\_\_  
 DATE: \_\_\_\_\_

EMERGENCY PLAN  
EQUIPMENT AND SUPPLIED  
CHECKLIST

Locations of Fire Brigade Protective Clothing

I. Two Central Locations (5 Lockers at Each)

11

- A. Unit #1 Aux Bldg. (El-155') Corridor adjacent to Control Room (S. End). Each locker contains coat, helmet, gloves, and boots for one individual. The following equipment is distributed to the five cabinets as space allows:

<u>Description</u>	<u>Quantity</u>
Crowbar	1
Fire Axes	2
Fire Rescue Suit	1
Hand Lantern	1
Rope, Coil $\frac{1}{2}$ diam 100'	1

- B. Unit #1 Turbine Bldg. (El-155") N. Wall at entrance to Unit #2 Turbine Bldg. The following equipment is stored at this location.

<u>Description</u>	<u>Quantity</u>
Foam Cart	1
Hand Lantern	1


II. Single Locations(1 Locker At Each)

- A. Service Water Structure  
B. River Water Structure - Train "A"

III. Diesel Bldg (2 Lockers)

The following equipment is stored at this location.

<u>Description</u>	<u>Quantity</u>
Foam Cart(Outside Diesel (Generator Room 2B)	1

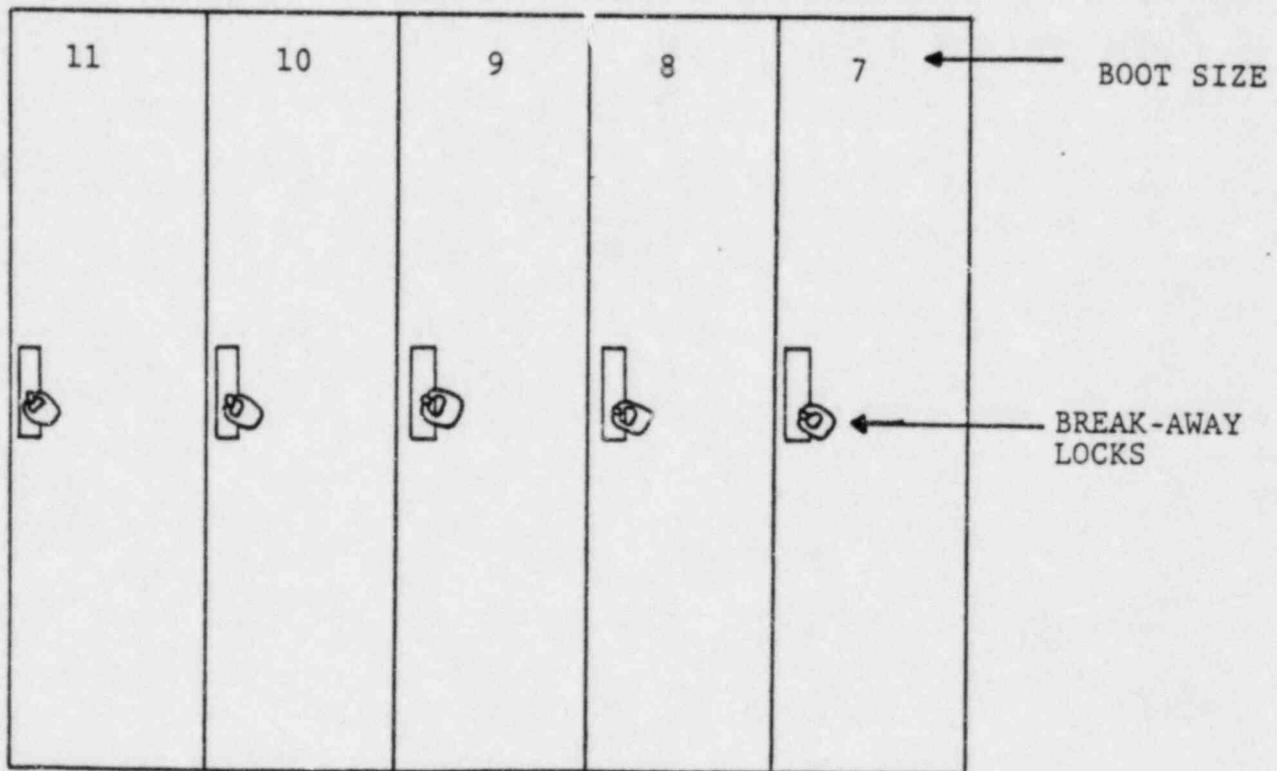

TYPICAL CENTRAL LOCATION

REASON FOR INSPECTION

Quarterly \_\_\_\_\_  
 Post-Drill \_\_\_\_\_  
 Lock Broken \_\_\_\_\_  
 Other \_\_\_\_\_  
 Emergency Use \_\_\_\_\_

CHECKED BY: \_\_\_\_\_

TITLE: \_\_\_\_\_

DATE: \_\_\_\_\_

Emergency Planners Review \_\_\_\_\_

PLANT EMERGENCY VEHICLE WEEKLY CHECK LIST

DESCRIPTION	SAT./JNSAT.	INITIALS
1. Check engine coolant level	SAT./JNSAT.	_____
2. Start vehicle	SAT./UNSAT.	_____
3. Test drive		
a. Drive vehicle, minimum of 5 minutes		_____
b. Establish two-way radio communications with Security Tower.		_____
c. Check the clutch	SAT./UNSAT	_____
d. Check the brakes	SAT./UNSAT.	_____
e. Check the steering	SAT./UNSAT.	_____
f. Check the transmission	SAT./UNSAT.	_____
4. Visual Check		
a. Tires inflated	SAT./UNSAT	_____
b. Cooling system hoses and clamps	SAT./UNSAT	_____
c. Fan belts condition	SAT./UNSAT.	_____
d. Engine oil level	SAT./UNSAT.	_____
e. Battery water level	SAT./UNSAT.	_____
f. All lights operable	SAT./UNSAT.	_____
g. Gasoline tank near full**	SAT./UNSAT.	_____
h. Windshield wipers	SAT./UNSAT.	_____
i. Doors locked	SAT./UNSAT.	_____
j. Trauma case present (Blue color)	SAT./UNSAT.	_____

\*NOTE: Any unsatisfactory mechanical conditions will be reported to Maintenance via a Shop Work Order and the Shift Supervisor will be notified of the plant emergency vehicle status.

\*\*NOTE: Security will maintain the plant emergency vehicle gasoline tank near full.

CHECKED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_