

File

METROPOLITAN EDISON COMPANY

Subsidiary of General Public Utilities Corporation

Subject Plant Status - Unit II

Location TMI-II-R-29485
TMI/U-2 Site Ops

Date September 9, 1980

To R. C. Arnold, Sr. Vice President, Met-Ed
P. C. Clark, Executive Vice President, Nuclear
F. Glickman, Director Administration
R. W. Heward, Director Radiological & Environmental Controls
G. K. Hovey, Director, TMI-2
R. L. Long, Acting Director Maintenance & Construction
F. F. Manganaro, Director Maintenance & Construction
W. A. Verrochi, Prospective President, Met-Ed
R. F. Wilson, Director Technical Functions

Plant Status: Plant in an Outage from 0800 September 8, 1980 to 0800 September 9, 1980

1. Primary Plant Condition

- A. Pressure P.S.I.G. 90 using Standby Pressure Control System
- B. Temperature - 139.5°F
- C. Cooling Mode - Natural Circulation
- D. Water Level - N/A
- E. Boron Concentration - 3680 ppm

2. Steam Plant Condition

Generator - Wet - Steaming "A" OTSG Level 412"
Turbine - On Jacking Gear

3. Tech. Spec. Clock Items

- A. Deluge/Sprinkler System for Reactor Building Purge filter isolated waiting T.S. Change, 14 day limit, need 30 day report
- B. Remote shutdown instrumentation failure Decay Heat Panel at 0300 on September 5, 1980, 30 day limit

4. Reportable Events

None

5. Actual Radiation Release (Based on Preliminary Data)

Kr85 > 9.7 Ci (Less Than Background)

Particulate > 12 μ Ci non-detectable

6. Planned Release or Discharge Next Period

None

7. Radiological Waste Shipments

A. Special Limits on Shipments - none

B. Shipments Past Period (Last Working Day)

RCS Sample to Lynchburg, Virginia, September 8, 1980

C. Planned Shipment Next Period (Next 2 Working Days)

Auxiliary Building sludge sample to SAI in Rockville, Md.,
on September 11, 1980

8. Major Evaluations Next 24 hours

A. Functional Testing in Mini Decay Heat Removal System Continues
Projected Start-up September 22, 1980

B. Flush Auxiliary Sump Filter 3A & 3B Filter Housing

C. Take Auxiliary Building Sump sludge sample, September 9, 1980

D. Close up AH-8A & 8B Train. Making available one more fan in
Auxiliary Building Exhaust Flow

9. Problems

None

10. Progress vs. Schedule


Functional Testing on MDHR. Projected Start-up September 22, 1980

11. N/A

12. Potential Public Interest Items

None

13. Non-routine NRC Audits - None

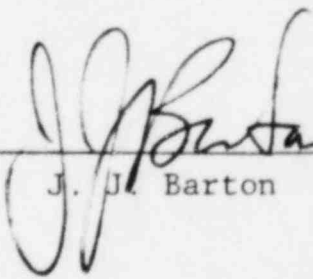

J. J. Barton

JJB/jw
cc: J. W. Brasher
J. T. Collins, U.S. NRC
J. C. Devine
B. D. Elam
S. Polon
File