

WCAP 8587

"Equipment Qualification Data Packages"

Supplement 1

EQDP-ESE-3B

Veritrak Differential Pressure Transmitters: Qualification Group A

Revision 1

Instruction Sheet

The following instructional information and checklist is being furnished to help insert the following into WCAP-8587 Supplement 1 EQDP-ESE-3B Class 3 (Non-Proprietary). Discard the old Revision 0 and insert the new Revision 1 as listed below. Revised information is indicated by a bar and number 1 on the outside margin of the page.

Remove  
(Front/Back)

Revision 0

Insert  
(Front/Back)

Revision 1


8309150393 830907  
PDR TOPRP EMVWEST  
C PDR

EQUIPMENT QUALIFICATION DATA PACKAGE

This document contains information, relative to the qualification of the equipment identified below in accordance with the methodology of WCAP-8587. The Specification section (Part 1) defines the assumed limits for the equipment qualification and constitute interface requirements to the user.

Veritrak Differential Pressure Transmitters: Qualification Group A

APPROVED:

  
\_\_\_\_\_  
E. P. Rahe, Manager  
Nuclear Safety Department

WESTINGHOUSE ELECTRIC CORPORATION  
NUCLEAR ENERGY SYSTEMS  
PITTSBURGH, PENNSYLVANIA 15230

SECTION 1 - SPECIFICATIONS

1.0 PERFORMANCE SPECIFICATIONS

1.1 Electrical Requirements

1.1.1 Voltage: 20 - 45 VDC  $\pm$  1V

1.1.2 Frequency: N/A

1.1.3 Load: 4 - 20 MA

1.1.4 Electromagnetic Interference: None

1.1.5 Other: None

1.2 Installation Requirements: Wall mounted per Westinghouse Drawing 8765D69, Rev. 5.

1.3 Auxiliary Devices: None

1.4 Preventative Maintenance Schedule: Per the Westinghouse Equipment Qualification test program, the maintenance required to maintain the qualified life stated in Section 1.9 is that the cover o-ring must be replaced each time the cover is removed. This does not preclude development of preventive maintenance program designed to enhance equipment performance and identify unanticipated equipment degradation as long as this program does not compromise the qualification status of the equipment. Surveillance activities may also be considered to support the basis for/and a possible extension of the qualified life.

1.5 Design Life: 40 years

1.6 Operating Cycles (Expected number of cycles during design life, including test): Continuous duty.

## 1.7 Performance Requirements for Function (b): Pressurizer Level

Parameter	Normal Conditions	Abnormal Conditions	Containment Test Conditions	DBE Conditions (a)			Post DBE Conditions (a)		
				FLB/SLB	LOCA	Seismic	FLB/SLB	LOCA	Seismic
1.7.1 Time requirement	Continuous	Included under normal	Test Duration	Event Duration	Event Durat.	Event Duration	4 months	4 months	Continuous
1.7.2 Performance (c) requirement (d)	+ 1% 0.4 Sec	Included under normal	No damage	+ 16% 10 secs.	+ 16% 10 secs.	+ 11% 0.4 secs.	+ 16% 10 secs	+ 16% 10 secs	+ 1% 0.4 secs

## 1.8 Environmental Conditions for Same Function (b)

1.8.1 Temperature (°F)	50 - 120	Included under normal	Ambient	Figure 2	Figure 3	Ambient	Figure 2	Figure 3	Ambient
1.8.2 Pressure (psig)	-0.1/+0.3	Included under normal	70	Figure 2	Figure 3	0	Figure 2	Figure 3	0
1.8.3 Humidity (% RH)	0 - 95	Included under normal	Ambient	100	100	Ambient	100	100	Ambient
1.8.4 Radiation (R)	< 10 <sup>4</sup>	Included under normal	None	Included Under Post DBE	Included Under Post DBE	None	3.9x10 <sup>4</sup> <sub>Y</sub> 6.4x10 <sup>5</sup> <sub>p</sub>	4.1x10 <sup>7</sup> <sub>Y</sub> 9x10 <sup>8</sup> <sub>p</sub>	None
1.8.5 Chemicals	None	Included under normal	None	Figure 2	Figure 3	None	Figure 2	Figure 3	None
1.8.6 Vibration	None	Included under normal	None	None	None	None	None	None	None
1.8.7 Acceleration (g)	None	Included under normal	None	None	None	Figure 1	None	None	None

- Notes:
- (a) DBE is the Design Basis Event.
  - (b) Margin is not included in the parameters of this section.
  - (c) Reference accuracy specified. Values shown for accuracy under DBE and Post DBE conditions include + 1% for normal conditions which is not part of the DBE induced effects.
  - (d) Time Response
  - (e) Continued operation required, no specified accuracy or time response.

1.7 Performance Requirements for Function (b): Steam Generator Water Level (NR)

Parameter	Normal	Abnormal	Containment	DBE Conditions (a)			Post DBE Conditions (a)		
	Conditions	Conditions	Test Conditions	FLB	LOCA/SLB	Seismic	FLB/SLB	LOCA	Seismic
1.7.1 Time requirement	Continuous	Included under normal	Test Duration	< 5 min	Event Duration	Event Duration	4 months	4 months	Continuous
1.7.2 Performance (c) requirement (d)	+ 1% 0.4 sec	Included under normal	No damage	+ 11% 0.4 secs.	+ 16% 10 secs.	+ 11% 0.4 secs.	+ 16% 10 secs	+ 16% 10 secs	+ 1% 0.4 secs

1.8 Environmental Conditions for Same Function (b)

1.8.1 Temperature (°F)	50 - 120	Included under normal	Ambient	Figure 2	Figure 2/3	Ambient	Figure 2	Figure 3	Ambient
1.8.2 Pressure (psig)	-0.1/+0.3	Included under normal	70	Figure 2	Figure 2/3	0	Figure 2	Figure 3	0
1.8.3 Humidity (% RH)	0 - 95	Included under normal	Ambient	100	100	Ambient	100	100	Ambient
1.8.4 Radiation (R)	< 10 <sup>4</sup>	Included under normal	None	Included Under Post DBE	Included Under Post DBE	None	3.9x10 <sup>4</sup> <sub>Y</sub> 6.4x10 <sup>5</sup> <sub>B</sub>	4.1x10 <sup>7</sup> <sub>Y</sub> 9x10 <sup>8</sup> <sub>B</sub>	None
1.8.5 Chemicals	None	Included under normal	None	Figure 2	Figure 2/3	None	Figure 2	Figure 3	None
1.8.6 Vibration	None	Included under normal	None	None	None	None	None	None	None
1.8.7 Acceleration (g)	None	Included under normal	None	None	None	Figure 1	None	None	None

- Notes:
- (a) DBE is the Design Basis Event
  - (b) Margin is not included in the parameters of this section.
  - (c) Reference accuracy specified. Values shown for accuracy under DBE and Post DBE conditions include + 1% for normal conditions which is not part of the DBE induced effect.
  - (d) Time Response

### WESTINGHOUSE CLASS 3

- 1.9 Qualified Life: The currently demonstrated qualified life is 14 years based on an average ambient temperature of 40°C (104°F). The demonstrated qualified life based on an average ambient temperature of 120°F is 7.4 years (see Table 1).
- 1.10 Remarks: Beta dose only applicable to transmitter seals

EQUIPMENT QUALIFICATION DATA (PART 2 - QUALIFICATION BY TEST)

## 2.0 TEST PLAN

The thermal aging and mechanical/electrical cycling tests were performed at Westinghouse Veritrak in Tempe, Arizona. The gamma irradiation of the transmitters was performed at Process Technology in West Memphis, Arkansas. Design basis event seismic simulation was performed at Westinghouse Advanced Energy Systems Division (AESD), in Large Pennsylvania. The high energy line break simulation was performed at the Westinghouse Forest Hills Site in Pittsburgh, Pennsylvania.

2.1 Equipment Description: Westinghouse Veritrak - Differential Pressure Transmitter Model 76DP2

## 2.2 Number Tested:

## 2.2.1 Phase 1

11 Veritrak Units

## 2.2.2 Phase 2

2 Veritrak Units

2.3 Mounting: Per Westinghouse Drawing 8765D69 Rev. 5

2.4 Connections: (a) Electrical connections, two wires  
(b) Process connections, capillary tube

## 2.5 Aging Simulation Procedure

Sequential simulation of thermal, radiation and vibrational mechanisms as part of the overall test sequence.

2.6 Simulated Service Conditions<sup>(1)</sup>: See Section 2.11 for notes.

		Normal/ Abnormal	Thermal Aging/ Electrical and Mechanical Cycling	Radiation	Cont. Test	Seismic	HELB/ Post-HELB
2.6.1	Temp (°F)	40 - 120°F	104°F (10 years)	Ambient	Covered by HELB	Ambient	Figure 4
2.6.2	Pressure (psig)	Atmos.	Atmos.	Atmos.		Atmos.	Figure 4
2.6.3	Humidity (% RH)	0 - 95	Ambient	Ambient		Ambient	100
2.6.4	Radiation (R)	None	None	$5 \times 10^7$ $9 \times 10^8$		None	Included under radiation
2.6.5	Chemicals	None	None	None		None	Figure 4
2.6.6	Vibration	None	None	None		5 OBE's	None
2.6.7	Acceleration (g)	None	None			TRS RRS Figure 1	None
2.6.8	Process Cycling	None	$10^6$ Mech. Cycling 50 Elec. Cycling	None		None	None



## 2.7 Measured Variables

		Not	
		<u>Required</u>	<u>Required</u>
2.7.1	Category I - Environment		
2.7.1.1	Temperature	A,B,C,D,E	
2.7.1.2	Pressure	E	A,B,C,D
2.7.1.3	Moisture	A,E	B,C,D
2.7.1.4	Gas Composition		A,B,C,D,E
2.7.1.5	Vibration	D	A,B,C,E
2.7.1.6	Time	A,B,C,D,E	
2.7.2	Category II - Input Electrical Characteristics		
2.7.2.1	Voltage	A,B,C,D,E	
2.7.2.2	Current		A,B,C,D,E
2.7.2.3	Frequency		A,B,C,D,E
2.7.2.4	Power		A,B,C,D,E
2.7.2.5	Other		A,B,C,D,E
2.7.3	Category III - Fluid Characteristics		
2.7.3.1	Chemical Composition	E	A,B,C,D
2.7.3.2	Flow Rate	E	A,B,C,D
2.7.3.3	Spray	E	A,B,C,D
2.7.3.4	Temperature		A,B,C,D,E
2.7.4	Category IV - Radiological Features		
2.7.4.1	Energy Type	C	A,B,D,E
2.7.4.2	Energy Level	C	A,B,D,E
2.7.4.3	Dose Rate	C	A,B,D,E
2.7.4.4	Integrated Dose	C	A,B,D,E

# WESTINGHOUSE CLASS 3

	<u>Required</u>	<u>Not Required</u>
2.7.5 Category V - Electrical Characteristics		
2.7.5.1 Insulation Resistance		A,B,C,D,E
2.7.5.2 Output Voltage		A,B,C,D,E
2.7.5.3 Output Current	A,B,C,D,E	
2.7.5.4 Output Power		A,B,C,D,E
2.7.5.5 Response Time		A,B,C,D,E
2.7.5.6 Frequency Characteristics		A,B,C,D,E
2.7.5.7 Simulated Load		A,B,C,D,E
2.7.6 Category VI - Mechanical Characteristics		
2.7.6.1 Thrust		A,B,C,D,E
2.7.6.2 Torque		A,B,C,D,E
2.7.6.3 Time		A,B,C,D,E
2.7.6.4 Load Profile		A,B,C,D,E
2.7.7 Category VII - Auxiliary Equipment		
None		

- 
- A: Normal/Abnormal (Type Test)  
 B: Thermal Aging/Mechanical Cycling/Electrical Cycling  
 C: Radiation  
 D: Seismic  
 E: HELB/Post-HELB

## 2.8 Test Sequence Preferred

This section identifies the preferred test sequence as specified in IEEE-323-74.

- 2.8.1 Inspection of Test Item
- 2.8.2 Operation (Normal Condition)
- 2.8.3 Operation (Performance Specifications Extremes, Section 1)
- 2.8.4 Simulated Aging
- 2.8.5 Vibration
- 2.8.6 Operation (Simulated High Energy Line Break Conditions)
- 2.8.7 Operation (Simulated Post HELB Conditions)
- 2.8.8 Inspection

## 2.9 Test Sequence Actual

This section identifies the actual test sequence to which the differential pressure transmitters were subjected. Exceptions from adherence to the preferred test sequence and justification are provided. Sections 2.8.2 and 2.8.3, operation at normal conditions and at performance extremes are covered in production tests on all units.

High energy line break and post-HELB radiation doses are included with normal dose in testing and are not combined with temperature/humidity conditions. Because of the possibility of radiation induced effects on the physical properties of the oil fill in the transmitters, time response tests before and after the test sequence were performed. Because any radiation induced viscosity changes in the oil would be permanent, adverse effects on time response, if any, could be detected after concluding the test sequence. As no other mechanism resulting from test conditions would be expected to affect time response, test before and after the sequence are sufficient.

## WESTINGHOUSE CLASS 3

### 2.9.1 Test Sequence Actual (Phase 1)

- 2.8.1 Inspection
- 2.8.2 Operation (including time response)
- 2.8.4 Mechanical Cycling/Electrical Cycling/Accelerated Thermal Aging
- 2.8.4 Radiation - Normal 10 Year Dose
- 2.8.6 Radiation HELB/Post HELB Dose
- 2.8.5 Seismic Simulation/Vibration
- 2.8.6 Operation (Simulated High Energy Line Break Conditions)
- 2.8.7 Operation (Simulated Post-HELB Conditions)
- 2.8.2 Operation (Including time response)
- 2.8.8 Inspection

### 2.9.2 Test Sequence Actual (Phase 2)

- 2.8.1 Inspection
- 2.8.2 Operation
- 2.8.4 Accelerated Thermal Aging
- 2.8.4 Radiation - Normal 10 Year Dose
- 2.8.6 Radiation HELB/Post HELB Dose
- 2.8.5 Seismic Simulated Vibration (See Section 2.10.3.2.3)
- 2.8.6 Operation (Simulated High Energy Line Break Conditions)
- 2.8.7 Operation (Simulated Post-HELB Conditions)
- 2.8.2 Operation
- 2.8.8 Inspection

## 2.10 Type Test Data

### 2.10.1 Objective

The objective of this test program is to demonstrate, employing the recommended practices of Reg. Guide 1.89 (IEEE 323-1974) and Reg. Guide 1.100 (IEEE 344-1975), the capability of the electronic differential pressure transmitters to perform their safety related functions described in EQDP 1.7 while exposed to the environments defined in EQDP Section 1.8.

## 2.10.2 Equipment Tested

### 2.10.2.1 Phase 1 Testing

Eleven (11) Westinghouse Veritrak Model 76 DP2 Differential Pressure Transmitters were subjected to the test environments of the sequence shown in section 2.9.1.

### 2.10.2.2 Phase 2 Testing

Two (2) Westinghouse Veritrak Model 76 DP2 Differential Pressure Transmitters modified to reflect Phase 1 concerns were subjected to the test environments of the sequence shown in section 2.9.2.

## 2.10.3 Test Summary

### 2.10.3.1 Test Summary (Phase 1)

#### 2.10.3.1.1 Normal Environment Testing

Operation of the differential pressure transmitters under normal/abnormal environment conditions is reflected by calibrations and temperature compensations performed on a production basis.

#### 2.10.3.1.2 Simulated Aging

The units were pre-conditioned to a simulated ten year aged condition prior to subjecting them to the design basis seismic event and high

### WESTINGHOUSE CLASS 3

energy line break simulations. The aged condition was achieved by separate phases of mechanical cycling, electrical cycling, accelerated thermal aging and gamma radiation dose equivalent to the ten year normal gamma dose plus the design basis accident gamma dose plus the gamma equivalent beta dose. Throughout the pre-conditioning phases the transmitter outputs were monitored and recorded.

#### 2.10.3.1.3 Seismic Tests

The seismic testing employed multi-axis multi-frequency inputs in accordance with Reg. Guide 1.100 (IEEE-344-1975). The generic required response spectra (RRS) shown in Figures 1A, 1B, and 1C contains significant margin with respect to any single plant application referencing this program<sup>(1)</sup>. Each plant should compare to the applicable RRS (A, B, or C) to assure that a 10 percent margin exists based on their actual plant location.

#### 2.10.3.1.4 High Energy Line Break/Post HELB Simulation

Due to design concerns which appeared during Phase 1 testing, the Phase 2 test sequence was used to justify qualification.

#### 2.10.3.2 Test Summary Actual (Phase 2)

##### 2.10.3.2.1 Normal Environment Testing

Operation of the differential pressure transmitters under normal/abnormal environment conditions is reflected by calibrations and

temperature compensations performed on a production basis.

#### 2.10.3.2.2 Simulated Aging

The units were pre-conditioned to a simulated ten year aged condition prior to subjecting them to the design basis seismic event and high energy line break simulations. The aged condition was achieved by separate phases of accelerated thermal aging and gamma radiation dose equivalent to the ten year normal gamma dose plus the design basis accident gamma dose plus the gamma equivalent beta dose. Throughout the pre-conditioning phases the transmitter outputs were monitored and recorded.

#### 2.10.3.2.3 Seismic Tests

No seismic test was performed during Phase 2 testing. The test sequence from Phase 1 was considered valid.

#### 2.10.3.2.4 High Energy Line Break/Post HELB Simulation

The differential pressure transmitters were subjected to the HELB simulation profile of Figure 4. Following the 300°F temperature peak, the temperature gradually declines to 225°F and is held at saturated steam conditions for 15 days, simulating a four month period of post-HELB operation.

## WESTINGHOUSE CLASS 3

### 2.10.4 Conclusion

The qualification status of Qualification Group A Differential Pressure Transmitters is demonstrated by the completion of the simulated aging and design basis event condition testing described herein and reported in Reference 1.

### 2.11 Section 2 Notes

- (1) The generic tests completed by Westinghouse employ parameters designed to envelope a number of plant applications. Margin is a plant specific parameter and will be established by the applicant.

### 2.12 References

1. Skeers, D. M., Drost, P. S., Black, J. P., Rygg, D. E., "Equipment Qualification Test Report Differential Pressure Transmitters - Qualification Group A (Seismic and Environmental Testing)" WCAP-8687-Supp. 2-E03B (Proprietary).



SECTION 3 AND 4 QUALIFICATION BY EXPERIENCE AND/OR ANALYSIS

Westinghouse does not employ operating experience or analysis in support of the qualification program for the Differential Pressure Transmitters - Qualification Group A.

TABLE 1

ACTUAL QUALIFICATION TEST CONDITIONS

EQUIPMENT (1) SYSTEM/CATEGORY	LOCATION STRUCTURE/AREA	MANUFACTURER TYPE/MODEL	ABNORMAL/ACCIDENT ENVIRONMENTAL EXTREMES		OPERABILITY		ACCURACY (%)		QUAL LIFE (4)	QUAL METHOD	QUAL REF	QUAL PROGRAM STATUS
			PARAMETER	SPECIFIED (2)	QUALIFIED	REQ	DEM	REQ (3)	DEM			
Pressurizer level transmitter/ RBM's/ Category a	Containment Bldg./outside missile shield	Veritrak 76DP2	Temperature Pressure Rel. humidity Radiation Chemistry		420°F 57 psig 100% $5 \times 10^7$ R( $\gamma$ ) $9 \times 10^8$ R( $\beta$ ) 2500 ppm $H_3BO_3$ NaOH 10.7 pH	Post DBE 4 Mo.	Same	+15	Same	14 yrs.	Seq. test 3B	Est - 3B Completed
Steam Gen. level transmitter/ RBM's, RPS/ Category a	Containment Bldg./outside missile shield	Veritrak 76DP2	Temperature Pressure Rel. humidity Radiation Chemistry		420°F 57 psig 100% $5 \times 10^7$ R( $\gamma$ ) $9 \times 10^8$ R( $\beta$ ) 2500 ppm $H_3BO_3$ NaOH 10.7 pH	Trip <5 min Post DBE 4 Mo.	Same	+10	Same	14 yrs.	Seq. test 3B	Est - 3B Completed

Notes: (1) For definition of the equipment category, refer to NUREG-0588 "Interim Staff Position on Environmental Qualification of Safety-Related Equipment Electrical Equipment," Appendix E Section 2.

(2) Plant specific environmental parameters are to be inserted by the applicant.

(3) The accuracies are changes in the transmitter accuracy due to severe environments. The error during normal and abnormal conditions is 1% of span. These errors do not include drift or signal processing inaccuracies.

(4) Qualified life is based on a service condition of 104°F (40°C).

(5) Serial numbers qualified are defined in the test report.

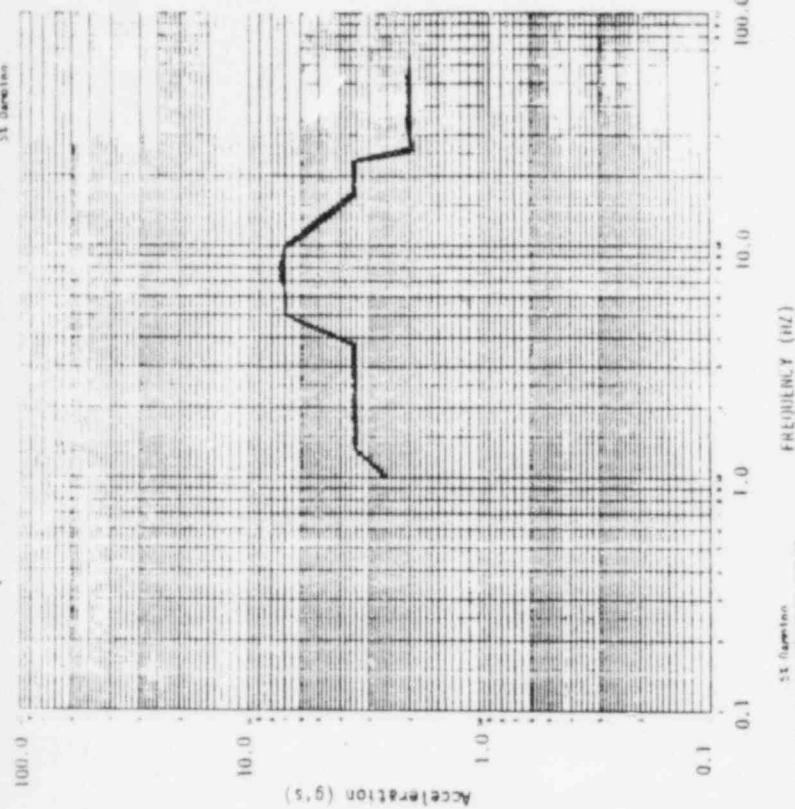


FIGURE 1A REQUIRED RESPONSE SPECTRUM  
FOR SAFE SHUTDOWN EARTHQUAKE (INPUT A)

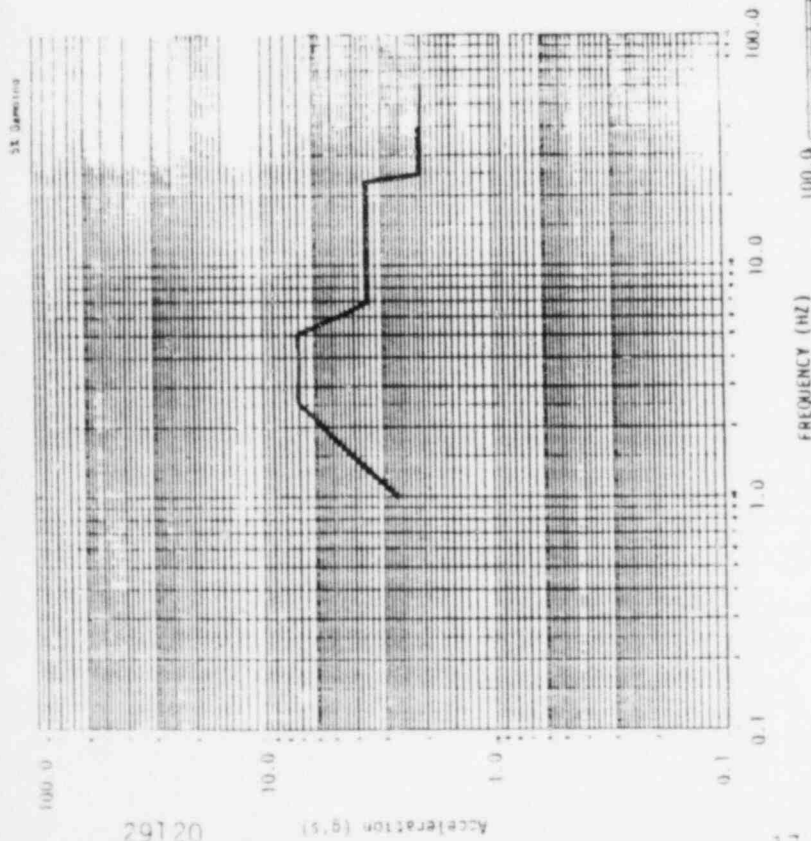


FIGURE 1B REQUIRED RESPONSE SPECTRUM  
FOR SAFE SHUTDOWN EARTHQUAKE (INPUT B)

FREQUENCY (HZ)

55 Damping

FREQUENCY (HZ)

17

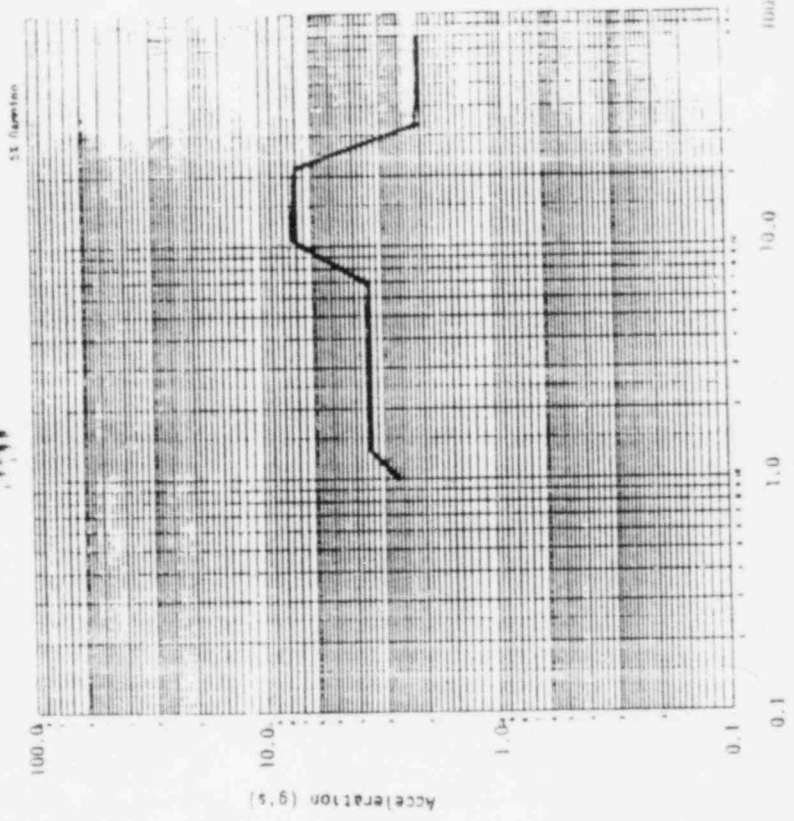



FIGURE 1C  
REQUIRED RESPONSE SPECTRUM FOR  
SAFE SHUTDOWN EARTHQUAKE (INPUT C)

FREQUENCY (HZ)

55 Damping


FREQUENCY (HZ)

17

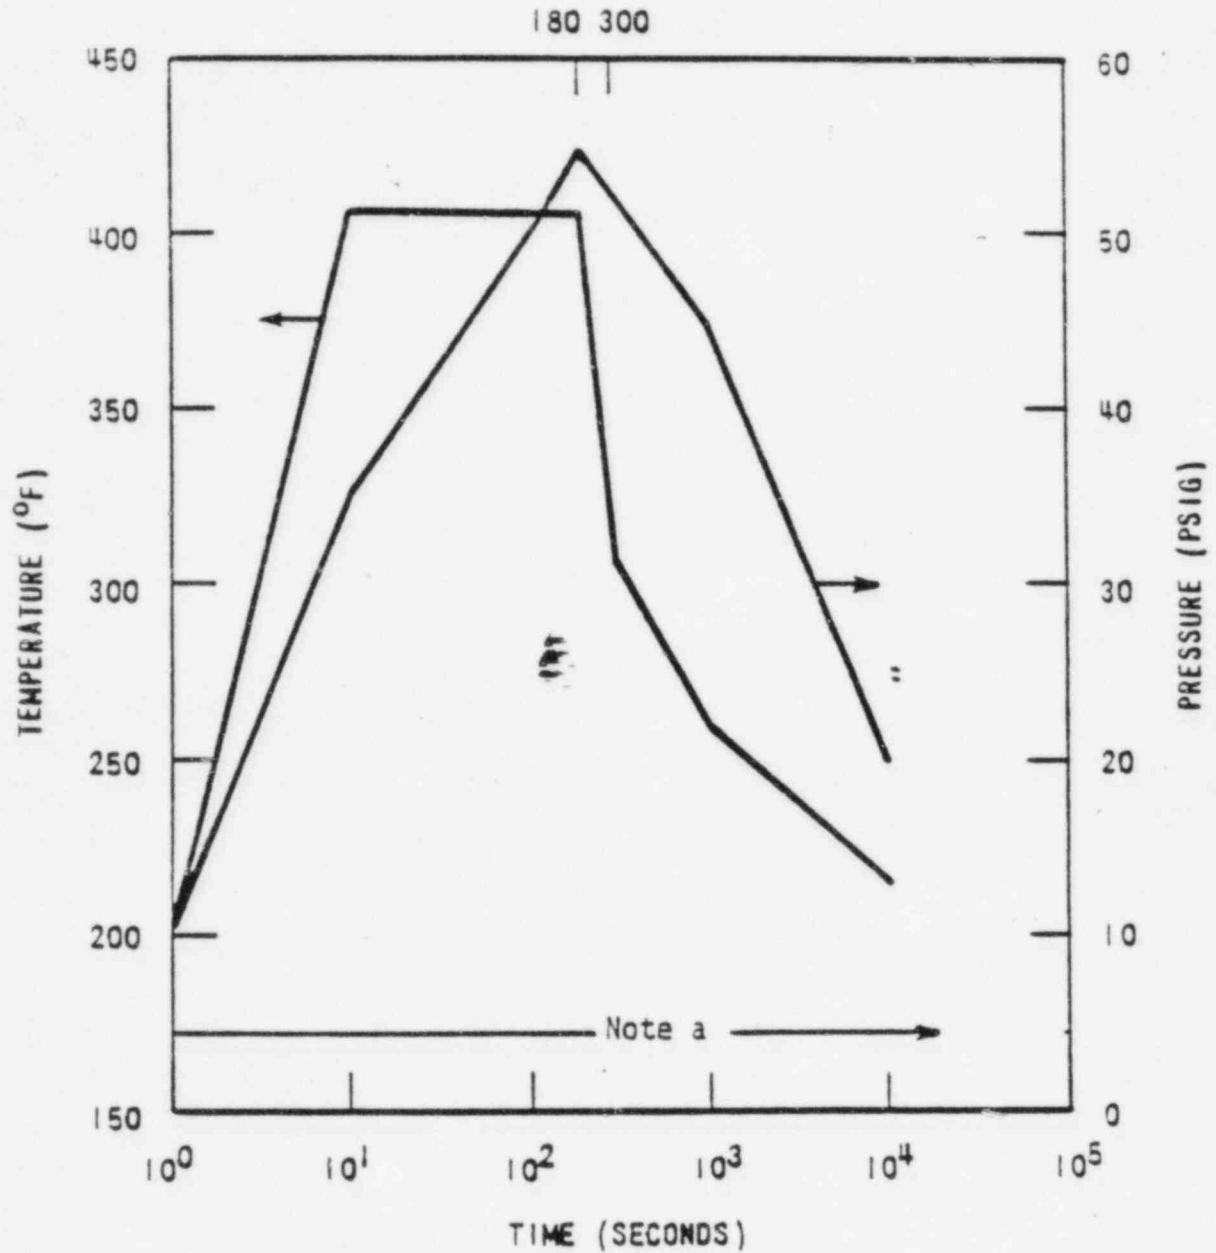

Note a: Initial 24 hour containment spray solution of 2500 PPM Boron in water buffered with NaOH to yield a pH of 10.7

Figure 2. Containment Environmental Design Conditions  
Main Steam Line Break and Feedline Break

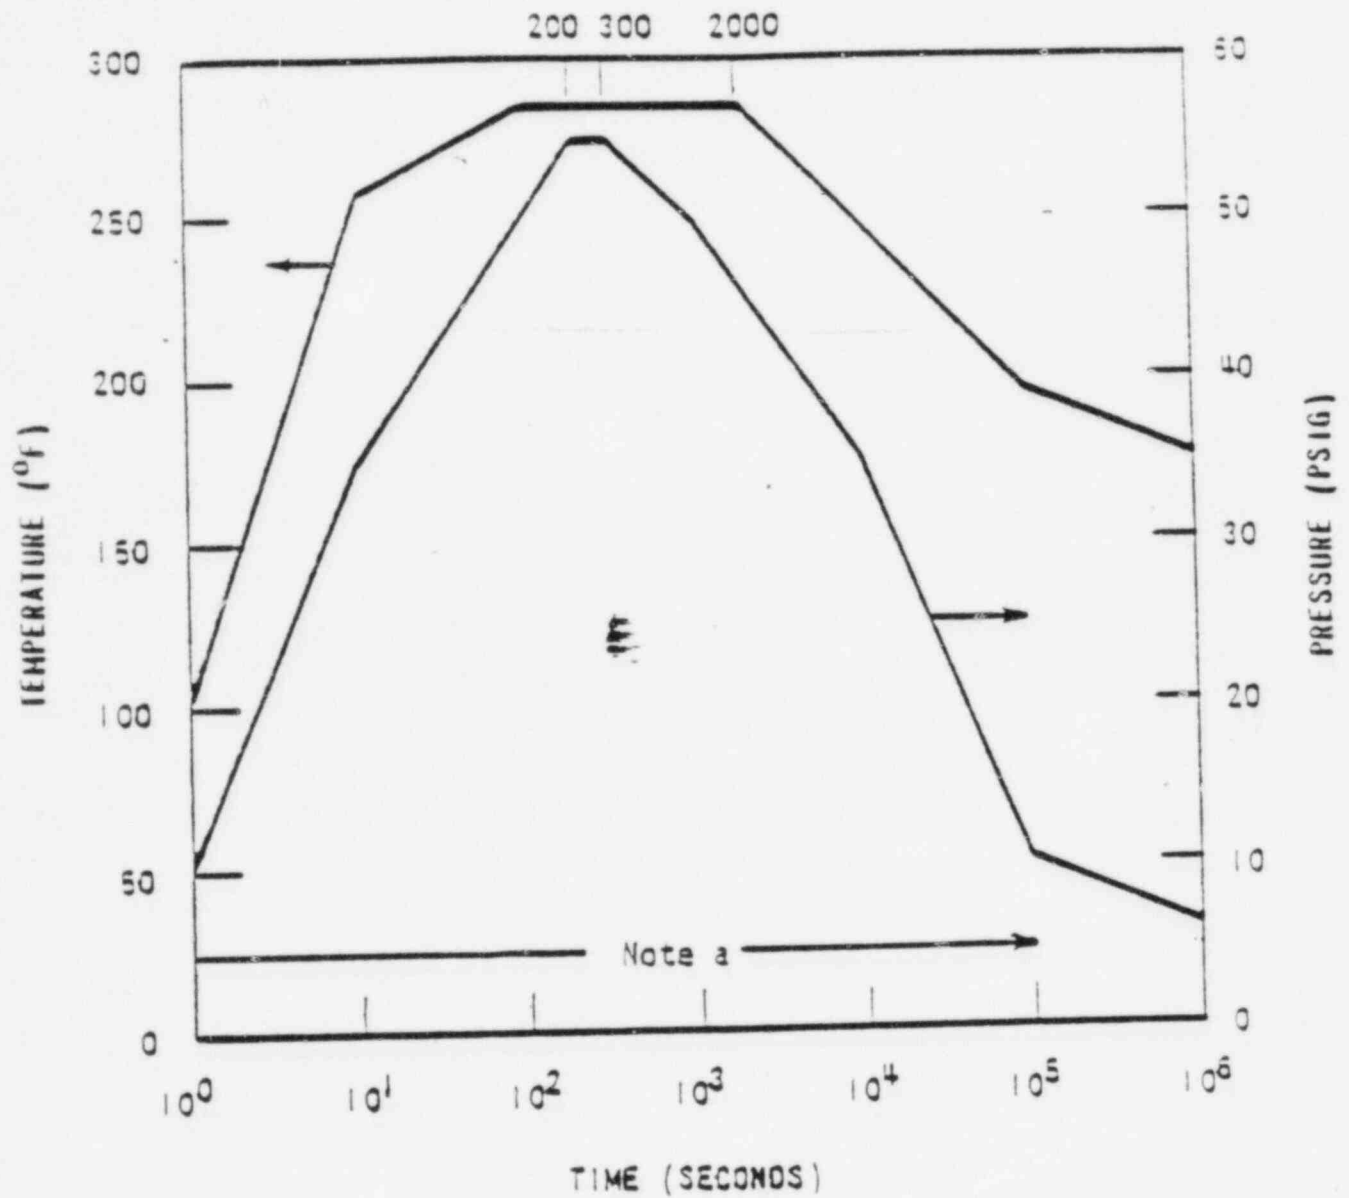

Note a: Initial 24 hour containment  
 spray solution of 2500 PPM  
 Boron in water buffered with  
 NaOH to yield a pH of 10.7

Figure 3. Containment Environmental Design Conditions - LOCA

