

North Anna Unit No. 1  
Technical Specifications Changes  
Tavg = 587.8°F

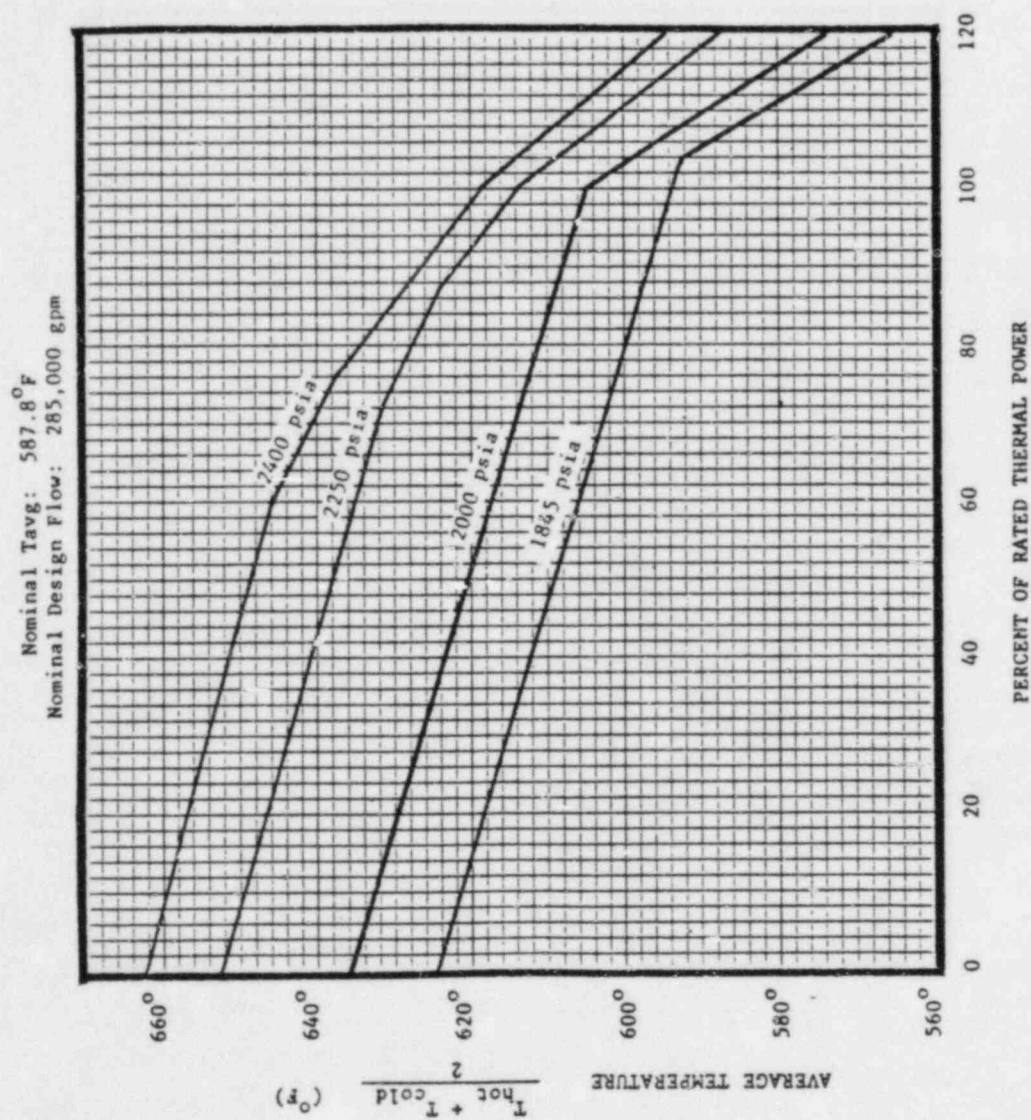


FIGURE 2.1-1 REACTOR CORE SAFETY LIMITS FOR THREE LOOP OPERATION, 100% FLOW

TABLE 2.2-1 (Continued)  
 REACTOR TRIP SYSTEM INSTRUMENTATION TRIP SETPOINTS

NOTATION (Continued)		
Operation with 3 Loops	Operation with 2 Loops (no loops isolated)*	Operation with 2 Loops (1 loop isolated)*
$K_1 = 1.085$	$K_1 = ( \quad )$	$K_1 = ( \quad )$
$K_2 = 0.0150$	$K_2 = ( \quad )$	$K_2 = ( \quad )$
$K_3 = 0.000670$	$K_3 = ( \quad )$	$K_3 = ( \quad )$

and  $f_1(\Delta I)$  is a function of the indicated difference between top and bottom detectors of the power-range nuclear ion chambers; with gains to be selected based on measured instrument response during plant startup tests such that:

- (i) for  $q_t - q_b$  between - 32 percent and + 9 percent,  $f_1(\Delta I) = 0$   
 (where  $q_t$  and  $q_b$  are percent RATED THERMAL POWER in the top and bottom halves of the core respectively, and  $q_t + q_b$  is total THERMAL POWER in percent of RATED THERMAL POWER).
- (ii) for each percent that the magnitude of  $(q_t - q_b)$  exceeds - 32 percent, the  $\Delta T$  trip setpoint shall be automatically reduced by 1.92 percent of its value at RATED THERMAL POWER.
- (iii) for each percent that the magnitude of  $(q_t - q_b)$  exceeds + 9 percent, the  $\Delta T$  trip setpoint shall be automatically reduced by 1.77 percent of its value at RATED THERMAL POWER.

\*Values dependent on NRC approval of ECCS evaluation for these operating conditions.

TABLE 2.2-1 (Continued)

## REACTOR TRIP SYSTEM INSTRUMENTATION TRIP SETPOINTS

## NOTATION (Continued)

NOTE 2: Overpower  $\Delta T \leq \Delta T_o \left[ K_4 - K_5 \left( \frac{\tau_3 S}{1 + \tau_3 S} \right) T - K_6 (T - T'') - f_2(\Delta I) \right]$

Where:  $\Delta T_o$  = Indicated  $\Delta T$  at RATED THERMAL POWER

$T$  = Average temperature, °F

$T''$  = Indicated  $T_{avg}$  at RATED THERMAL POWER  $\leq 587.8^\circ\text{F}$

$K_4$  = 1.091

$K_5$  = 0.02/°F for increasing average temperature

$K_5$  = 0 for decreasing average temperatures

$K_6$  = 0.00121 for  $T > T''$ ;  $K_6 = 0$  for  $T \leq T''$

$\frac{\tau_3 S}{1 + \tau_3 S}$  = The function generated by the rate lag controller for  $T_{avg}$  dynamic compensation

$\tau_3$  = Time constant utilized in the rate lag controller for  $T_{avg}$   
 $\tau_3 = 10$  secs.

$S$  = Laplace transform operator ( $\text{sec}^{-1}$ )

$f_2(\Delta I) = 0$  for all  $\Delta I$

Note 3: The channel's maximum trip point shall not exceed its computed trip point by more than 2 percent span.

## SAFETY LIMITS

### BASES

---

The curves are based on an enthalpy hot channel factor,  $F_{\Delta H}^N$ , of 1.55 and a reference cosine with a peak of 1.55 for axial power shape. An allowance is included for an increase in  $F_{\Delta H}^N$  at reduced power based on the expression:

$$F_{\Delta H}^N = 1.55 [1 + 0.3 (1-P)]$$

where P is the fraction of RATED THERMAL POWER

These limiting heat flux conditions are higher than those calculated for the range of all control rods fully withdrawn to the maximum allowable control rod insertion assuming the axial power imbalance is within the limits of the  $f(\Delta I)$  function of the Overtemperature trip. When the axial power imbalance is not within the tolerance, the axial power imbalance effect on the Overtemperature  $\Delta T$  trips will reduce the setpoints to provide protection consistent with core safety limits.

#### 2.1.2 REACTOR COOLANT SYSTEM PRESSURE

The restriction of this Safety Limit protects the integrity of the Reactor Coolant System from overpressurization and thereby prevents the release of radionuclides contained in the reactor coolant from reaching the containment atmosphere.

The reactor pressure vessel and pressurizer are designed to Section III of the ASME Code for Nuclear Power Plant which permits a maximum transient pressure of 110% (2735 psig) of design pressure. The Reactor Coolant System piping, valves and fittings, were initially designed to ANSI B 31.1 1967 Edition and ANSI B 31.7 1969 Edition (Table 5.2.1-1 of FSAR) which permits a maximum transient pressure of 120% (2985 psig) of component design pressure. The Safety Limit of 2735 psig is therefore consistent with the design criteria and associated code requirements.

The entire Reactor Coolant System is hydrotested at 3107 psig, 125% of design pressure, to demonstrate integrity prior to initial operation.

POWER DISTRIBUTION LIMITS

NUCLEAR ENTHALPY HOT CHANNEL FACTOR -  $F_{\Delta H}^N$

LIMITING CONDITION FOR OPERATION

---

3.2.3  $F_{\Delta H}^N$  shall be limited by the following relationship:

$$F_{\Delta H}^N \leq 1.55 [1 + 0.3 (1-P)] [1-RBP (BU)]$$

where:  $P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$ , and

RBP (BU) = Rod Bow Penalty as a function of region average burnup as shown in Figure 3.2-3, where a region is defined as those assemblies with the same loading date (reloads) or enrichment (first cores).

APPLICABILITY: MODE 1.

ACTION:

With  $F_{\Delta H}^N$  exceeding its limit:

- a. Reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within 2 hours and reduce the Power Range Neutron Flux-High Trip Setpoints to less than or equal to 55% of RATED THERMAL POWER within the next 4 hours,
- b. Demonstrate through in-core mapping that  $F_{\Delta H}^N$  is within its limit within 24 hours after exceeding the limit or reduce THERMAL POWER to less than 5% of RATED THERMAL POWER within the next 2 hours, and
- c. Identify and correct the cause of the out of limit condition prior to increasing THERMAL POWER above the reduced limit required by a. or b., above; subsequent POWER OPERATION may proceed provided that  $F_{\Delta H}^N$  is demonstrated through in-core mapping to be within its limit at a nominal 50% of RATED THERMAL POWER prior to exceeding this THERMAL POWER, at a nominal 75% of RATED THERMAL POWER prior to exceeding this THERMAL power and within 24 hours after attaining 95% or greater RATED THERMAL POWER.

North Anna Unit No. 2

Technical Specifications Changes

$T_{avg} = 587.8^{\circ}\text{F}$

Nominal Tav<sub>g</sub>: 587.8°F  
 Nominal Design Flow: 285,000 gpm

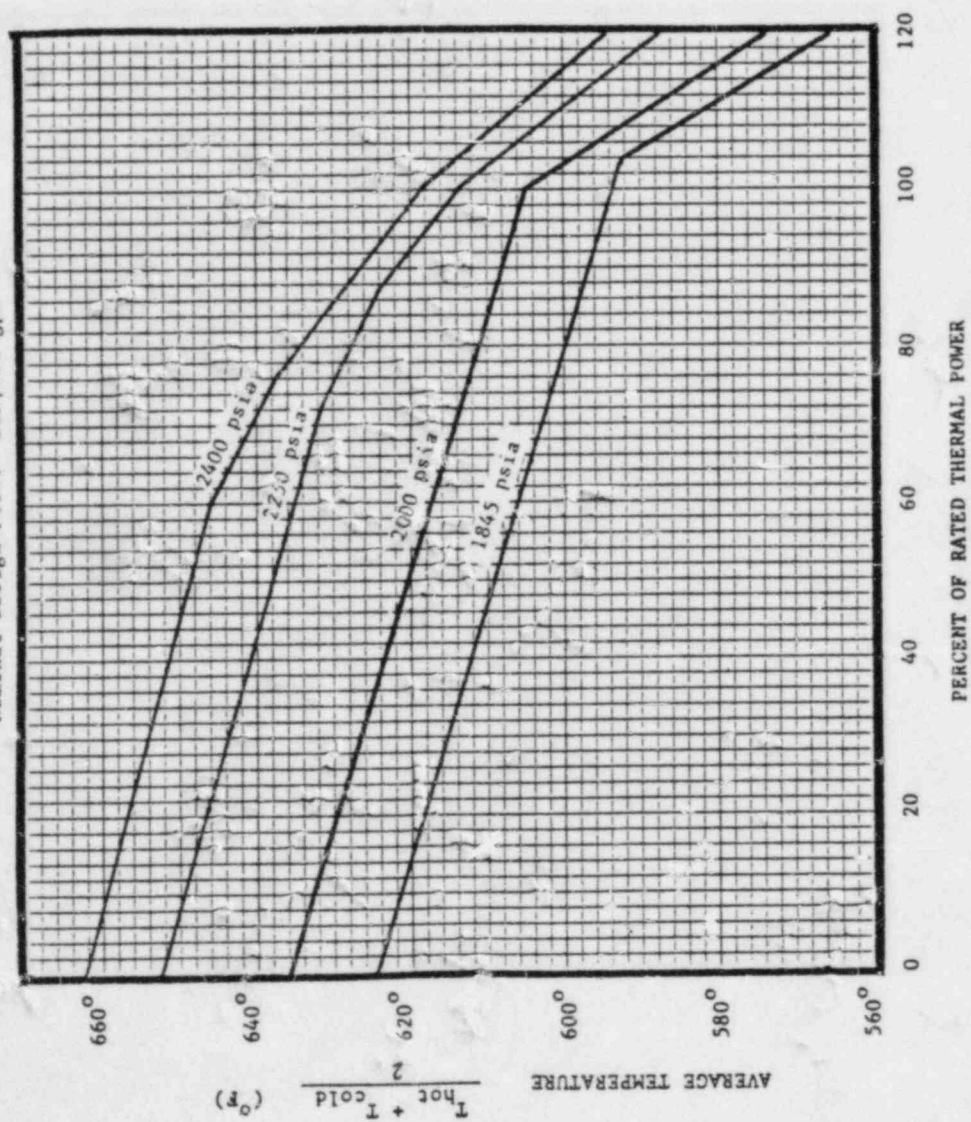


FIGURE 2.1-1 REACTOR CORE SAFETY LIMITS FOR THREE LOOP OPERATION, 100% FLOW

TABLE 2.2-1 (Continued)

REACTOR TRIP SYSTEM INSTRUMENTATION TRIP SETPOINTSNOTATION (Continued)

Operation with 3 Loops	Operation with 2 Loops (no loops isolated)*	Operation with 2 Loops (1 loop isolated)*
$K_1 = 1.085$	$K_1 = ( \quad )$	$K_1 = ( \quad )$
$K_2 = 0.0150$	$K_2 = ( \quad )$	$K_2 = ( \quad )$
$K_3 = 0.000670$	$K_3 = ( \quad )$	$K_3 = ( \quad )$

and  $f_1(\Delta I)$  is a function of the indicated difference between top and bottom detectors of the power-range nuclear ion chambers; with gains to be selected based on measured instrument response during plant startup tests such that:

- (i) for  $q_t - q_b$  between - 32 percent and + 9 percent,  $f_1(\Delta I) = 0$   
(where  $q_t$  and  $q_b$  are percent RATED THERMAL POWER in the top and bottom halves of the core respectively, and  $q_t + q_b$  is total THERMAL POWER in percent of RATED THERMAL POWER).
- (ii) for each percent that the magnitude of  $(q_t - q_b)$  exceeds - 32 percent, the  $\Delta T$  trip setpoint shall be automatically reduced by 1.92 percent of its value at RATED THERMAL POWER.
- (iii) for each percent that the magnitude of  $(q_t - q_b)$  exceeds + 9 percent, the  $\Delta T$  trip setpoint shall be automatically reduced by 1.77 percent of its value at RATED THERMAL POWER.

\*Values dependent on NRC approval of ECCS evaluation for these operating conditions.

TABLE 2.2-1 (Continued)

## REACTOR TRIP SYSTEM INSTRUMENTATION TRIP SETPOINTS

## NOTATION (Continued)

NOTE 2: Overpower  $\Delta T \leq \Delta T_o \left[ K_4 - K_5 \left( \frac{\tau_3 S}{1 + \tau_3 S} \right) T - K_6 (T - T'') - f_2(\Delta I) \right]$

Where:  $\Delta T_o$  = Indicated  $\Delta T$  at RATED THERMAL POWER

$T$  = Average temperature, °F

$T''$  = Indicated  $T_{avg}$  at RATED THERMAL POWER  $\leq 587.8^\circ\text{F}$

$K_4$  = 1.091

$K_5$  = 0.02/°F for increasing average temperature

$K_5$  = 0 for decreasing average temperatures

$K_6$  = 0.00121 for  $T > T''$ ;  $K_6$  = 0 for  $T \leq T''$

$\frac{\tau_3 S}{1 + \tau_3 S}$  = The function generated by the rate lag controller for  $T_{avg}$  dynamic compensation

$\tau_3$  = Time constant utilized in the rate lag controller for  $T_{avg}$   
 $\tau_3$  = 10 secs.

$S$  = Laplace transform operator ( $\text{sec}^{-1}$ )

$f_2(\Delta I)$  = 0 for all  $\Delta I$

Note 3: The channel's maximum trip point shall not exceed its computed trip point by more than 2 percent span.

## SAFETY LIMITS

### BASES

---

The curves are based on an enthalpy hot channel factor,  $F_{\Delta H}^N$ , of 1.55 and a reference cosine with a peak of 1.55 for axial power shape. An allowance is included for an increase in  $F_{\Delta H}^N$  at reduced power based on the expression:

$$F_{\Delta H}^N = 1.55 [1 + 0.3 (1-P)]$$

where P is the fraction of RATED THERMAL POWER

These limiting heat flux conditions are higher than those calculated for the range of all control rods fully withdrawn to the maximum allowable control rod insertion assuming the axial power imbalance is within the limits of the  $f(\Delta I)$  function of the Overtemperature trip. When the axial power imbalance is not within the tolerance, the axial power imbalance effect on the Overtemperature  $\Delta T$  trips will reduce the setpoints to provide protection consistent with core safety limits.

#### 2.1.2 REACTOR COOLANT SYSTEM PRESSURE

The restriction of this Safety Limit protects the integrity of the Reactor Coolant System from overpressurization and thereby prevents the release of radionuclides contained in the reactor coolant from reaching the containment atmosphere.

The reactor pressure vessel and pressurizer are designed to Section III of the ASME Code for Nuclear Power Plant which permits a maximum transient pressure of 110% (2735 psig) of design pressure. The Reactor Coolant System piping, valves and fittings, were initially designed to ANSI B 31.1 1967 Edition and ANSI B 31.7 1969 Edition (Table 5.2.1-1 of FSAR) which permits a maximum transient pressure of 120% (2985 psig) of component design pressure. The Safety Limit of 2735 psig is therefore consistent with the design criteria and associated code requirements.

The entire Reactor Coolant System is hydrotested at 3107 psig, 125% of design pressure, to demonstrate integrity prior to initial operation.

## POWER DISTRIBUTION LIMITS

### NUCLEAR ENTHALPY HOT CHANNEL FACTOR - $F_{\Delta H}^N$

#### LIMITING CONDITION FOR OPERATION

---

3.2.3  $F_{\Delta H}^N$  shall be limited by the following relationship:

$$F_{\Delta H}^N \leq 1.55 [1 + 0.3 (1-P)] [1-RBP (BU)]$$

where:  $P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$ , and

RBP (BU) = Rod Bow Penalty as a function of region average burnup as shown in Figure 3.2-3, where a region is defined as those assemblies with the same loading date (reloads) or enrichment (first cores).

APPLICABILITY: MODE 1.

#### ACTION:

With  $F_{\Delta H}^N$  exceeding its limit:

- a. Reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within 2 hours and reduce the Power Range Neutron Flux-High Trip Setpoints to less than or equal to 55% of RATED THERMAL POWER within the next 4 hours,
- b. Demonstrate through in-core mapping that  $F_{\Delta H}^N$  is within its limit within 24 hours after exceeding the limit or reduce THERMAL POWER to less than 5% of RATED THERMAL POWER within the next 2 hours, and
- c. Identify and correct the cause of the out of limit condition prior to increasing THERMAL POWER above the reduced limit required by a. or b., above; subsequent POWER OPERATION may proceed provided that  $F_{\Delta H}^N$  is demonstrated through in-core mapping to be within its limit at a nominal 50% of RATED THERMAL POWER prior to exceeding this THERMAL POWER, at a nominal 75% of RATED THERMAL POWER prior to