



GULF STATES UTILITIES COMPANY

POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704


AREA CODE 713 838-6631

July 13, 1983

RBG - 15,457

File Nos. G9.5, G9.25.1.1

Mr. John T. Collins, Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV, Office of Inspection and Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76011

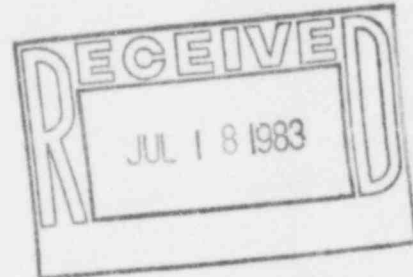

Dear Mr. Collins:

River Bend Station Unit 1
Docket No. 50-458
Final Report/DR-100

On February 22, 1983, Gulf States Utilities Company (GSU) notified Region IV of a condition potentially reportable under 10CFR50.55(e) concerning Category I motor control center MOV feeder breakers supplied to River Bend Station by Gould-Brown Boveri (DR-100). The breaker settings are larger than required. GSU subsequently issued Interim Reports dated March 24, 1983; May 12, 1983; and June 20, 1983.

GSU has completed its evaluation and determined that DR-100 does not meet the reporting requirements of 10CFR50.55(e) because the design of the system had not been finalized. This completes GSU's response on this matter.

Sincerely,

William J. Booker
for J. E. Booker
Manager-Engineering,
Nuclear Fuels & Licensing
River Bend Nuclear Group

J PJD
JEB/PJD/do

cc: Director of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

R. L. Brown (SRI)

8307250284 830713
PDR ADOCK 05000458
S PDR

IE-27 1/0