

CONTROL BLOCK: [] [] [] [] [] [] (1) (PLEASE PRINT OR TYPE ALL REQUIRED INFORMATION)

[01] [S][C][V][C][S][1] [2] [0][0] - [0][0] [0][0][0] - [0][0] [3] [4] [1][0][0][0] [4] [] [] [5]

CONT [01] REPORT SOURCE [1] [6] [0][5] [0][0][0] [3][9] [5] [7] [0] [9][0][2] [8][3] [8] [0] [9] [7] [3] [8] [3] [9]

EVENT DESCRIPTION AND PROBABLE CONSEQUENCES (10)
[02] On September 2, 1983, at 1510 hours, with the Plant in Mode 1, Component Cooling
[03] System Snubber CCH-082 was declared inoperable due to being out of alignment in
[04] excess of six degrees (6°). As found condition was ten degrees (10°). There
[05] were no adverse consequences due to this event. The Licensee complied with the
[06] Action Statement of Technical Specification 3.7.7, "Snubbers".

[09] SYSTEM CODE [W][B] (11) CAUSE CODE [X] (12) CAUSE SUBCODE [Z] (13) COMPONENT CODE [S][U][P][O][R][T] (14) COMP. SUBCODE [D] (15) VALVE SUBCODE [Z] (16)
[17] LER/RO REPORT NUMBER [8][3] (17) SEQUENTIAL REPORT NO. [1][0][1] (18) OCCURRENCE CODE [0][3] (19) REPORT TYPE [L] (20) REVISION NO. [0] (21)
ACTION TAKEN [B] (22) FUTURE ACTION [Z] (23) EFFECT ON PLANT [Z] (24) SHUTDOWN METHOD [Z] (25) HOURS [0][0][0] (26) ATTACHMENT SUBMITTED [N] (27) NPSD-4 FORM SUB. [N] (28) PRIME COMP. SUPPLIER [A] (29) COMPONENT MANUFACTURER [P][O][P] (30)

CAUSE DESCRIPTION AND CORRECTIVE ACTIONS (27)
[10] The cause of this event was due to a loose clamp. The clamp was realigned,
[11] the applicable surveillance test was performed, and the unit was declared
[12] operable at 1815 hours, September 2, 1983. Total time inoperable was 3 hours,
[13] five minutes. The Licensee plans no further corrective action in addition to
[14] scheduled surveillance activities.

[15] FACILITY STATUS [E] (28) % POWER [1][0][0] (29) OTHER STATUS [N/A] (30) METHOD OF DISCOVERY [A] (31) DISCOVERY DESCRIPTION [Resident Inspector Observation] (32)

[16] ACTIVITY CONTENT RELEASED OF RELEASE [Z] (33) AMOUNT OF ACTIVITY [N/A] (34) LOCATION OF RELEASE [N/A] (35)

[17] PERSONNEL EXPOSURES NUMBER [0][0][0] (36) TYPE [Z] (37) DESCRIPTION [N/A] (38)

[18] PERSONNEL INJURIES NUMBER [0][0][0] (39) DESCRIPTION [N/A] (40)

[19] LOSS OF OR DAMAGE TO FACILITY TYPE [Z] (41) DESCRIPTION [N/A] (42)

[20] PUBLICITY ISSUED DESCRIPTION [N] (43) (44)

8309300163 830923
PDR ADOCK 05000395
S PDR

NRC USE ONLY

NAME OF PREPARER [Signature] N/A
[Signature] Bouknight

PHONE: (803) 345-5209

SOUTH CAROLINA ELECTRIC & GAS COMPANY

POST OFFICE 764

COLUMBIA, SOUTH CAROLINA 29218

O. W. DIXON, JR.
VICE PRESIDENT
NUCLEAR OPERATIONS

83 SEP 27 A 9:13

September 23, 1983

Mr. James P. O'Reilly
Regional Administrator
U.S. Nuclear Regulatory Commission
Region II, Suite 2900
101 Marietta Street, N.W.
Atlanta, Georgia 30303


SUBJECT: Virgil C. Summer Nuclear Station
Docket No. 50/395
Operating License No. NPF-12
Thirty Day Written Report
LER 83-101

Dear Mr. O'Reilly:

Please find attached Licensee Event Report #83-101 for Virgil C. Summer Nuclear Station. This Thirty Day Report is required by Technical Specification 6.9.1.13.(b) as a result of entry into the Action Statement of Technical Specification 3.7.7, "Snubbers," on September 2, 1983.

Should there be any questions, please call us at your convenience.

Very truly yours,

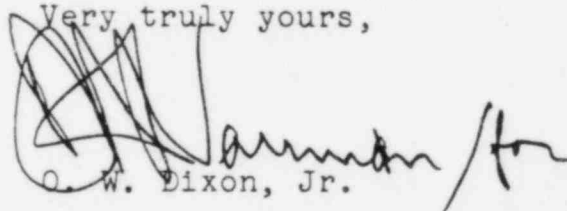

O. W. Dixon, Jr.

RJB:OWD/mac
Attachment

cc: V. C. Summer
E. H. Crews, Jr.
T. C. Nichols, Jr., /O. W. Dixon, Jr.
E. C. Roberts
H. N. Cyrus
Group/General Managers
O. S. Bradham
R. B. Clary
C. A. Price
A. R. Koon
D. A. Lavigne
J. F. Heilman

C. L. Ligon (NSRC)
G. J. Braddick
J. C. Miller
J. L. Skolds
J. B. Knotts, Jr.
I&E (Washington)
Document Management
Branch
INPO Records Center
NPCF
File (Lic./Eng.)

OFFICIAL COPY

IE 22 11