

SEP 12 1983

Georgia Power Company
 ATTN: Mr. R. J. Kelly
 Executive Vice President
 P. O. Box 4545
 Atlanta, GA 30302

50-321
 50-366

Gentlemen:

SUBJECT: UPDATE OF INCIDENT RESPONSE INFORMATION

Enclosed are the Technical Support Center (TSC) and Emergency Operations Facility (EOF) floor plans, route maps to these Emergency Response Facilities (ERFs) and telephone listings for the Hatch plant as they now appear in our files. We would appreciate an update of this information, if necessary. We also request that you provide any personnel access documents required by the Region II Site Team responding to an emergency at your site. This will assist in expediting the Site Team's access to the TSC if these documents are prepared in route. Having accurate telephone numbers, route maps, access documents and layouts for the TSC and the EOF will enable the NRC site team and the licensee personnel to concentrate their time and effort toward resolving the situation at hand.

If there are any questions, please contact Mr. Walter Stansberry, 404/221-5238.

Sincerely yours,

H. C. Dance, Chief
 Project Branch 2
 Division of Project and
 Resident Programs

Enclosures:

1. EOF/TSC Floor Plans
2. Route Maps to ERFs (If any)
3. Telephone Listings

cc w/encls:

J. T. Beckham, Vice President and
 General Manager-Nuclear Generation
 H. C. Nix, Site General Manager
 C. E. Belflower, Site QA Supervisor

bcc w/encls:

NRC Resident Inspector
 Document Management Branch
 State of Georgia
 Hugh S. Jordan, Executive Secretary

8310040351 830912
 PDR ADOCK 05000321
 F PDR

IE 35 1/1

RII
 CTBanks:jw
 8/9/83

RII
 GRJenkins
 9/1/83

RII
 DCollins
 08/6/83

RII
 JPStohr
 08/7/83

RII
 HCDance
 08/1/83



UNITED STATES
NUCLEAR REGULATORY COMMISSION
REGION II
101 MARIETTA STREET, N.W.
ATLANTA, GEORGIA 30303

SEP 12 1983

Georgia Power Company
ATTN: Mr. R. J. Kelly
Executive Vice President
P. O. Box 4545
Atlanta, GA 30302

Gentlemen:

SUBJECT: UPDATE OF INCIDENT RESPONSE INFORMATION

Enclosed are the Technical Support Center (TSC) and Emergency Operations Facility (EOF) floor plans, route maps to these Emergency Response Facilities (ERFs) and telephone listings for the Hatch plant as they now appear in our files. We would appreciate an update of this information, if necessary. We also request that you provide any personnel access documents required by the Region II Site Team responding to an emergency at your site. This will assist in expediting the Site Team's access to the TSC if these documents are prepared in route. Having accurate telephone numbers, route maps, access documents and layouts for the TSC and the EOF will enable the NRC site team and the licensee personnel to concentrate their time and effort toward resolving the situation at hand.

If there are any questions, please contact Mr. Walter Stansberry, 404/221-5238.

Sincerely,

A handwritten signature in dark ink, appearing to read "H. C. Dance", is written over the typed name.

H. C. Dance, Chief
Project Branch 2
Division of Project and
Resident Programs


Enclosures:

1. EOF/TSC Floor Plans
2. Route Maps to ERFs (If any)
3. Telephone Listings

cc w/encls:

J. T. Beckham, Vice President and
General Manager-Nuclear Generation
H. C. Nix, Site General Manager
C. E. Belflower, Site QA Supervisor

FIGURE 1

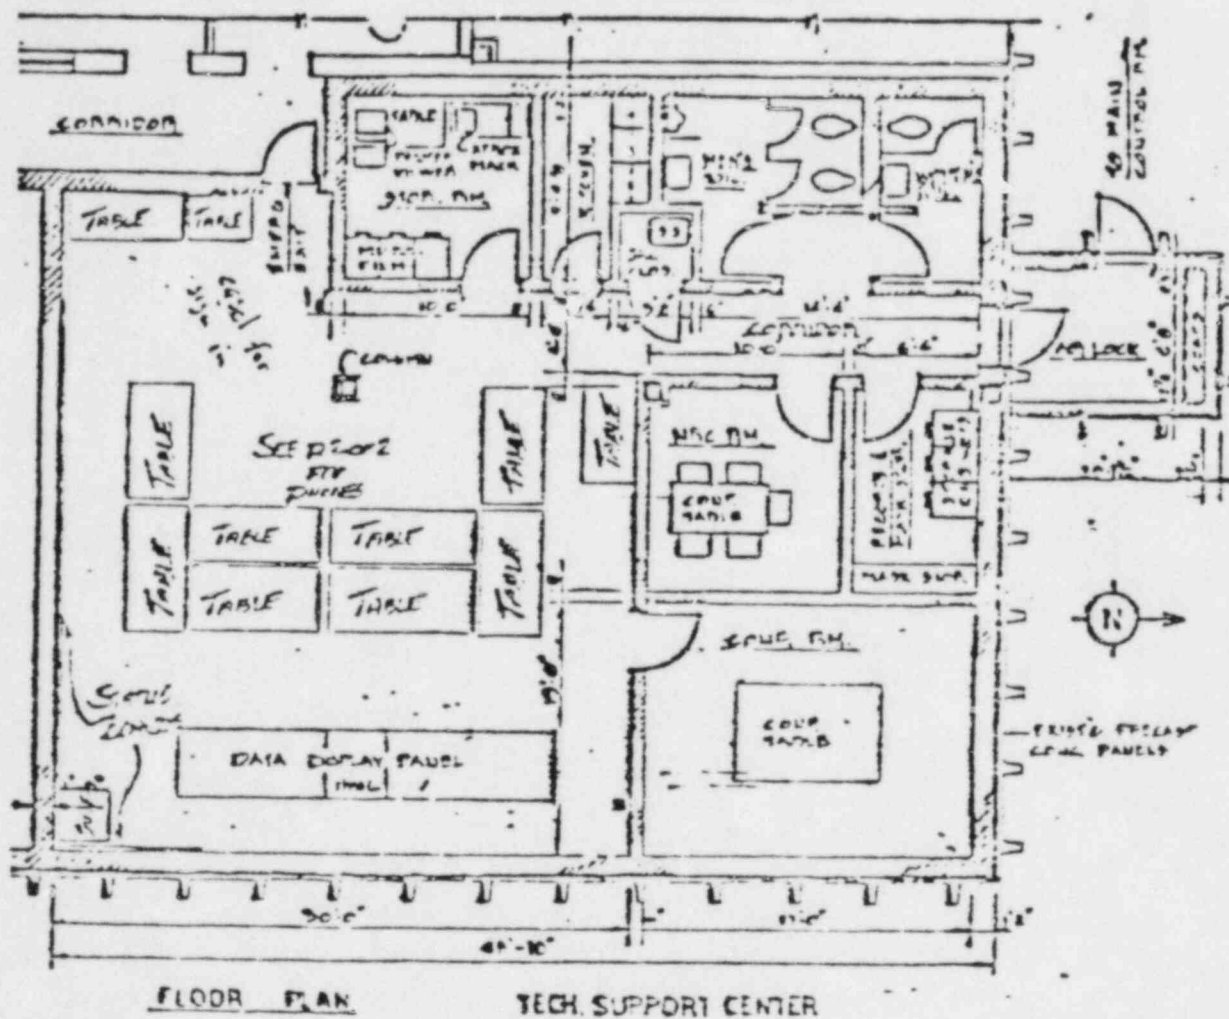


REVISION
See Title Page
DATE
See Title Page


E. I. HATCH NUCLEAR PLANT

Georgia Power 

PROJECT NO.	HNP-4806
REV. NO.	0
PAGE NO.	4 of 34


FIGURE 1
EOF FLOOR PLAN

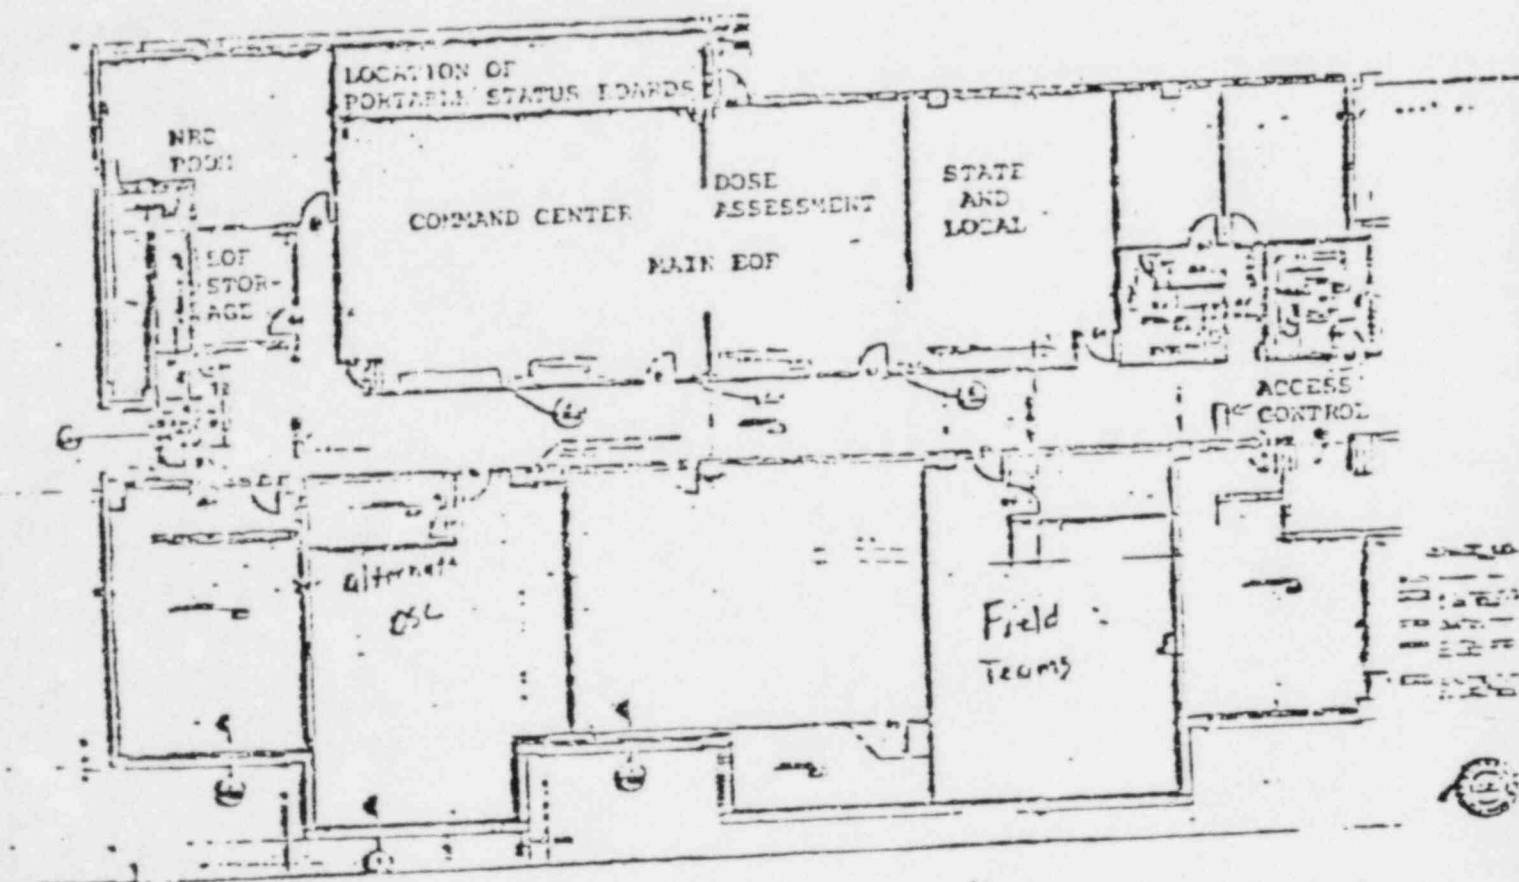



PLANT: **HATCH**
LICENSEE: Georgia Power Co.

LOCATION: **Baxley, GA.**

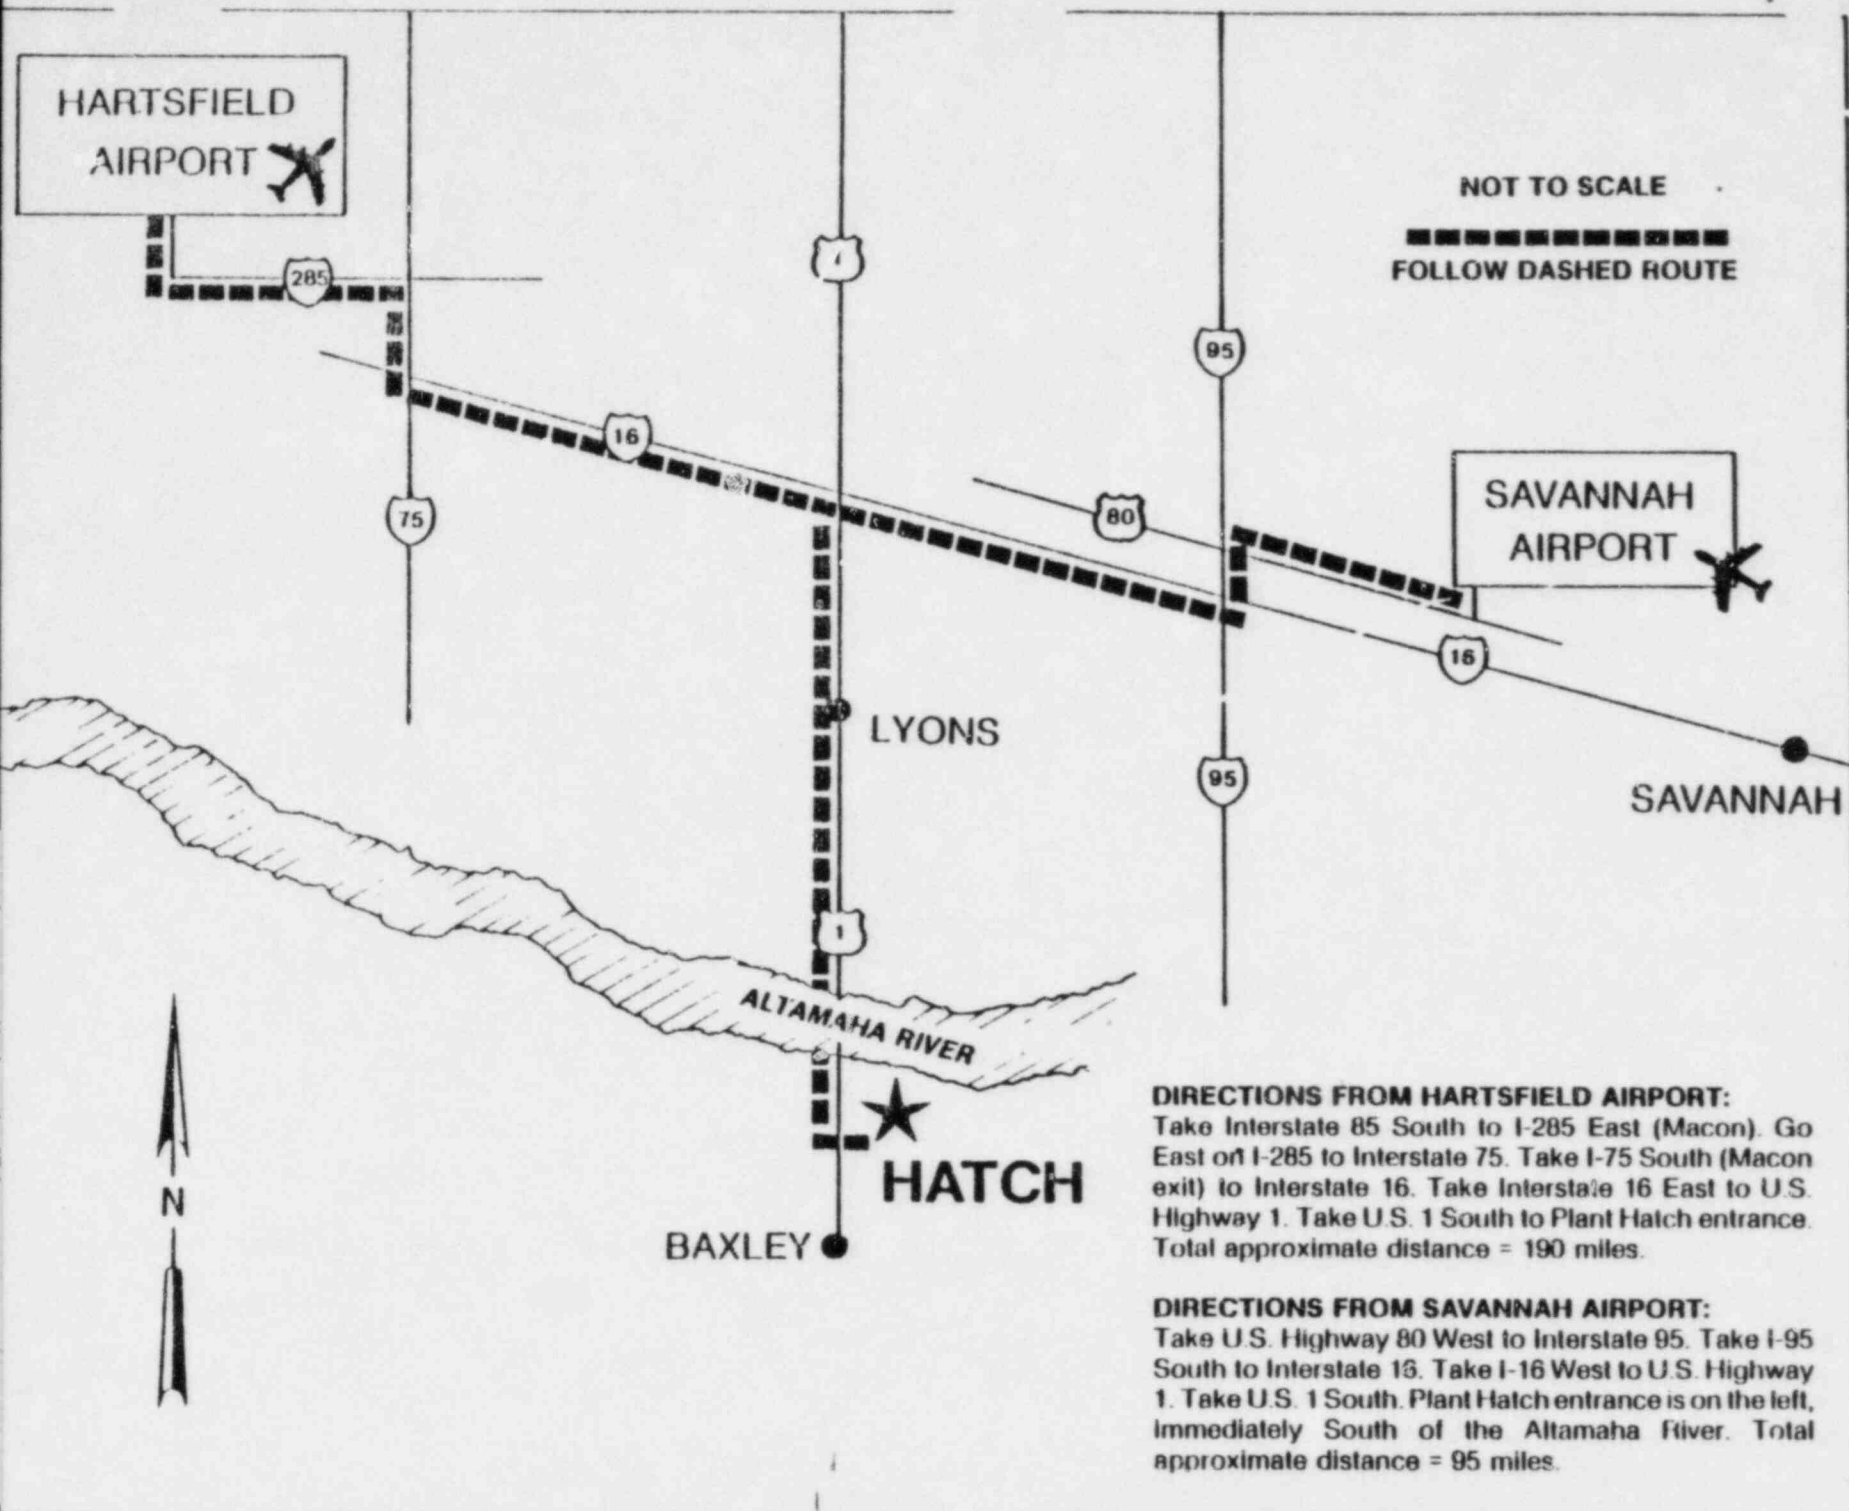

GEORGIA POWER COMPANY PLANT HATCH EMERGENCY TELEPHONE LISTING

- 1.) None dedicated for NRC use only.
- 2.) None dedicated for NRC use only.
- 3.) TSC numbers 912-367-7851 x613,614,615.
- 4.) EOF numbers 912-367-7851 x204,205
912-367-7179
912-537-0500
- 5.) No telephone lines dedicated for NRC Press Officer.
- 6.) No telephone lines dedicated for NRC State Liaison Officer.
- 7.) EOF Telecopier Tel. No. 912-367-3668
912-367-3669

Xerox 400 I Telecopier 4 or 6 minutes.
TSC telecopier - plant telecopier Tel. No. 912-367-7851 x116
DAX 580 3 or 6 minutes.
- 8.) Power Generation Duty Officer 404-811-7869
- 9.) H.P. Supervisors Office 912-367-7851 x120
Counting Room 912-367-7851 x370
Security Control Point 912-367-7307
Control Room Unit 1 912-367-7851 x145
Control Room Unit 2 912-367-7851 x245
Shift Supervisors Office 912-367-7851 x617
- 10.) Alternate EOF Location - Appling County Sheriffs Office
912-367-7851 + NRC Hotline
- 11.) 2 incoming circuits to site, 2 dedicated for outgoing.
- 12.) 9 microwave circuits to site.
- 13.) 4 Radio Systems Frequencies: A) 153.725 MHz (Security)
B) 153.425 MHz (Maintenance)
C) 3762 MHz - Low Band - Fed. Power Comm. Requirement
D) Transmit 456.275 MHz General
E) Recieve 451.275 MHz
- 14.) System load dispatcher - system operator 404-811-2112.

TELECOPY TELEPHONE NUMBERS

Hatch

Site 912/367-7781 (DEX 580)

Corporate

R. J. Kelley - Omni 404/526-6924 (Auto)
404/526-7943 (Verify)

T. J. Beckham 404/526-7873 (Auto)
404/526-7018 (Verify)

[REDACTED]

TSC 912/367-7851, x116 (DEX 580)

EOF 912/367-3668/3669 (Xerox 400)