

Nebraska Public Power District
Cooper Nuclear Station

Annual Radiological Environmental Operating Report

Environmental Radiation Monitoring Program
January 1, 1994 - December 31, 1994

USNRC Docket Number 50-298



Prepared by

TELEDYNE
ISOTOPES

9505030035 941231
PDR ADOCK 05000298
R PDR

G35741.PM5



Nebraska Public Power District

GENERAL OFFICE
P.O. BOX 499, COLUMBUS, NEBRASKA 68602-0499
TELEPHONE (402) 564-8561
FAX (402) 563-5551

GUY R. HORN

Vice-President, Nuclear
(402) 563-5518

NLS950082

April 17, 1995

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555

Gentlemen:


Subject: Annual Radiological Environmental Report
Cooper Nuclear Station
NRC Docket No. 50-298, DPR-46

In accordance with Specification 6.5.1.E of the Cooper Nuclear Station Technical Specifications, the Nebraska Public Power District submits the Cooper Nuclear Station Annual Radiological Environmental Report for the period of January 1, 1994 through December 31, 1994.

In accordance with 10 CFR 50.4(b)(1), we are enclosing one signed original of the report for your use, one copy to the Regional Office and one copy to the NRC Resident Inspector.

Should you have any questions or comments regarding this report, please contact my office.

Sincerely,



G. R. Horn
Vice President Nuclear

GRH:TJA/nrc/arer

cc: U. S. Nuclear Regulatory Commission
Regional Office, Region IV

NRC Resident Inspector
Cooper Nuclear Station

NPG Distribution

IE25
111

LIST OF NRC COMMITMENTS

ATTACHMENT 3

Correspondence No: NLS950082

The following table identifies those actions committed to by the District in this document. Any other actions discussed in the submittal represent intended or planned actions by the District. They are described to the NRC for the NRC's information and are not regulatory commitments. Please notify the Licensing Manager at Cooper Nuclear Station of any questions regarding this document or any associated regulatory commitments.

COMMITMENT	COMMITTED DATE OR OUTAGE
"NONE"	


 TELEDYNE
BROWN ENGINEERING
Environmental Services

REPORT TO
NEBRASKA PUBLIC POWER DISTRICT
COLUMBUS, NEBRASKA
RADIATION ENVIRONMENTAL MONITORING PROGRAM
COOPER NUCLEAR STATION
NEMAHIA COUNTY, NEBRASKA

ANNUAL REPORT
JANUARY 1 TO DECEMBER 31, 1994

PREPARED BY
TELEDYNE BROWN ENGINEERING
ENVIRONMENTAL SERVICES
50 VAN BUREN AVENUE
WESTWOOD, NEW JERSEY 07675-1235

REPORT APPROVED BY:



J. DAVID MARTIN, MANAGER
ENVIRONMENTAL ANALYSIS DEPARTMENT

PREFACE

This report covers the period of January 1 through December 31, 1994. All sample collections were made by a contractor and personnel of the Nebraska Public Power District. Analyses were performed and reports of analyses were prepared by Teledyne Brown Engineering - Environmental Services and forwarded to Nebraska Public Power District.

TABLE OF CONTENTS

	<u>PAGE</u>
Preface.....	ii
List of Tables.....	vi
List of Figures.....	vii
I. Introduction	1
II. Summary	2
III. Sampling and Analyses Program, Stations and Maps	3
IV. Discussion	12
A. Program Objectives and Data Interpretation	
B. Atmospheric Nuclear Detonations	
V. Radiological Environmental Monitoring Program Summary Table 3....	14
RE MPS TABLE 3 ANNUAL SUMMARY OF ALL STATIONS OF THE	15
ISOTOPES OF INTEREST WITH YEARLY AVERAGE	
ACTIVITY, NUMBER OF DETECTIONS PER TOTAL	
STATION WITH HIGHEST AVERAGE ACTIVITY,	
AVERAGE OF CONTROL STATION AND INCLUSIVE	
DATES OF ANALYSES	
VI.	
DISCUSSION, IMPACT ON THE ENVIRONMENT, GRAPHS OF	26
RESULTS AND STATISTICAL TABLES FOR EACH QUARTER	
A and B. AIR PARTICULATES - GROSS BETA - GROSS ALPHA	27
C. CHARCOAL FILTER, I-131	41
D. COMPOSITE OF AIR PARTICULATE FILTERS - GAMMA	48
E. FISH	55
F. MILK - NEAREST PRODUCER	60
G. MILK - OTHER PRODUCERS	67

TABLE OF CONTENTS

	<u>PAGE</u>
H. GROUNDWATER	74
I. RIVER WATER	79
J. THERMOLUMINESCENT DOSIMETERS	86
K. FOOD - BROADLEAF VEGETATION	93
L. SHORELINE SEDIMENT	98
 VII. COMPLETE DATA TABLES	102
A.B.C. AIR PARTICULATE FILTERS - GROSS ALPHA,	103
GROSS BETA, I-131	
D. COMPOSITE - AIR PARTICULATE FILTERS	124
E. FISH	135
F. MILK - NEAREST PRODUCER	138
G. MILK - OTHER PRODUCERS	145
H. GROUNDWATER	148
I. RIVER WATER	151
J. THERMOLUMINESCENT DOSIMETERS	158
K. FOOD - BROADLEAF VEGETATION	163
L. SHORELINE SEDIMENT	176
REFERENCES.....	178

TABLE OF CONTENTS

	<u>PAGE</u>
VIII. Appendix	
A. LAND USE CENSUS.....	A-1
B. INTERLABORATORY COMPARISON PROGRAM	B-1
C. STATISTICAL NOTES.....	C-1
D. NOTIFICATION LEVELS.....	D-1
E. CONVENTIONS.....	E-1
F. DETECTION CAPABILITIES.....	F-1
G. SAMPLE STATION LOCATION AND SAMPLE TYPES	G-1
H. SUMMARY OF DOSES TO A MEMBER OF THE PUBLIC.....	H-1
OFF-SITE	

LIST OF TABLES

<u>TABLES</u>	<u>TITLE</u>	<u>PAGE</u>
1	Sampling schedule and analysis, 1994, Cooper Nuclear Station	6
2	Sample Station Location with Distance and Direction from the Elevated Release Point (ERP)	8
3	Summary of Radiological Monitoring Program	14
A to L	Statistical Summary Tables - Section VI pages By Sample Type	26-101
A to L	Data Tables - Section VII By Sample Type and Station	pages 102-177

LIST OF FIGURES

<u>No.</u>	<u>Title</u>	<u>Page</u>
1.	Maps of sampling stations, Cooper Nuclear Station.....	10.11
A-1	Air Particulate, Gross Beta - CNS.....	29,30,49,50
A-2	Air Particulates, Gross Beta - ERAMS.....	31,32,51,52
B-1	Air Particulates, Gross Alpha - CNS.....	29,30,49,50
C-1	Airborne - Iodine, CNS.....	42,43
D-1	Air Particulates - Ce-144 - CNS.....	29,30,49,50
D-2	Air Particulates Ce-144 - EMI.....	51,52
E-1	Fish, Gross Beta, K-40, Sr-90 and Cs-137 - All Locations.....	56,57
F-1	Milk - Nearest Producer, K-40, I-131 and Cs-137.....	61,62
F-2	Milk - Nearest Producer, Sr-89, Sr-90 and Elem. Ca.....	63,64
G-1	Milk - Commercial Producers, K-40, I-131 and Cs-137.....	68,69
G-2	Milk - Commercial Producers, Sr-89, Sr-90 and Elem. Ca.....	70,71
H-1	Groundwater - All Locations, Gross Alpha, Beta and H-3.....	75,76
I-1	River Water - All Locations, Gross Alpha, Beta.....	80,81
I-2	River Water - All Locations, Sr-89, Sr-90 and H-3.....	82,83
J-1	Thermoluminescent Dosimetry - All Locations.....	87,88
K-1	Food - Broadleaf Vegetation - All Locations.....	94
L-1	Shoreline Sediment - K-40, I-131, Cs-134 and Cs-137.....	99

L INTRODUCTION

This report contains a complete tabulation of data collected during the period January through December 1994, for the operational Radiological Environmental Monitoring Program performed for the Cooper Nuclear Station (CNS) of the Nebraska Public Power District (NPPD) by Teledyne Brown Engineering - Environmental Services.

Cooper Nuclear Station is located in Nemaha County in the southeast corner of Nebraska on the Missouri River. A portion of the site extends into Missouri. The reactor is a 778 megawatt boiling water reactor. Initial criticality was attained on February 21, 1974. The reactor reached 50% power on June 25, 1974 and 100% power on November 20, 1974.

Radiological environmental monitoring began in 1971 before the plant became operational and has continued to the present. The program monitors radiation levels in air, terrestrial and aquatic environments. Most samples are collected by NPPD personnel. All are shipped for analysis to a contractor's laboratory where there exists special facilities required for measurements of extremely low levels of radioactivity. From 1971 through 1976 the contractor was Teledyne Isotopes, Westwood, New Jersey. NALCO Environmental Sciences assumed responsibility for the analyses effective January 1, 1977.

On November 1, 1978 Hazelton Environmental Sciences Corporation (HESC) assumed responsibility for the program. Prior to November 1, 1978 Hazelton Environmental Sciences operated as NALCO Environmental Sciences. Teledyne Isotopes (now trading as Teledyne Brown Engineering - Environmental Services) again assumed responsibility for the analyses effective January 1, 1979 through December 31, 1994.

II. SUMMARY

Presented in this report are summaries and discussions of the data generated for the Radiological Environmental Monitoring Program (REMP) for the Cooper Nuclear Station (CNS) of the Nebraska Public Power District (NPPD) for 1994.

Part V, Table 3 presents the yearly summary of the program with the total number of samples of each type analyzed, the yearly average for all samples, the number of detections per total number of samples, the station with the highest average, the average of the control station, and the inclusive dates of the analyses.

Part VI is a discussion of each type of sample analyzed and its impact, if any, on the environment. Included also is a graph of the isotopes of interest since 1977 and the statistical results for each quarter of the year. This is followed by a complete tabulation of the data by sample type and station number.

The 1994 radiological environmental measurements for CNS indicates that there has been no residual fallout resulting from the explosion and fire at the Chernobyl Reactor in the Soviet Union which occurred on April 26, 1986. It may be concluded from all measurements taken that the operations of CNS had no detectable impact on the environment in the vicinity of CNS.

III. SAMPLING AND ANALYSES PROGRAM, STATIONS AND MAPS

The 1994 sampling and analysis program is described in Table 1. Teledyne Brown Engineering - Environmental Services has a comprehensive quality assurance/quality control program designed to assure the reliability of data obtained. The results for 1994 of the Intercomparison Program conducted by the EPA Environmental Monitoring Systems Laboratory in Las Vegas, Nevada, are contained in Appendix B.

Sampling locations are summarized in Table 2. The type or status of each location and its distance and direction from the reactor elevated release point are specified. A map of locations follows (Figure 1). Complete descriptions of current and earlier sampling locations are given in Appendix G.

The annual land use census for 1994 is described in Appendix A. There were no milk animals found within three miles of CNS in 1994 and no evidence of potable water use from the river. Gardens were found in 11 sectors in 1994 while only 4 sectors contained gardens during 1993 due to the flooding of the Missouri River.

All of the required samples were analyzed in 1994 except for the following:

PATHWAY	SAMPLE	STATION	COLLECTION PERIOD	REASON
Airborne	Air Particulate	02	12/28-01/04	Low air volume.
Airborne	Charcoal	02	12/28-01/04	Low air volume.
Airborne	Air Particulate	05	12/28-01/04	Sample not collected.
Airborne	Charcoal	05	12/28-01/04	Sample not collected.
Airborne	Air Particulate	05	01/04-01/11	Sample not collected.
Airborne	Charcoal	05	01/04-01/11	Sample not collected.
Airborne	Air Particulate	05	01/17-01/18	LLD could not be met because of low air volume.

<u>PATHWAY</u>	<u>SAMPLE</u>	<u>STATION</u>	<u>COLLECTION PERIOD</u>	<u>REASON</u>
Airborne	Charcoal	05	01/17-01/18	LLD could not be met because of low air volume.
Airborne	Air Particulate	04	06/07-06/14	Out of service.
Airborne	Charcoal	04	06/07-06/14	Out of service.
Airborne	Air Particulate	09	07/06-07/12	Pump was not running when collected 7/6/94. New pump installed 7/12/94.
Airborne	Charcoal	09	07/06-07/12	Pump was not running when collected 7/6/94. New pump installed 7/12/94.
Airborne	Air Particulate	08	07/12-07/19	Pump Failure
Airborne	Charcoal	08	07/12-07/19	Pump Failure
Airborne	Air Particulate	08	07/19-07/26	Replaced (7/26/94) and recalibrated; no sample this week.
Airborne	Charcoal	08	07/19-07/26	Replaced (7/26/94) and recalibrated; no sample this week.

<u>PATHWAY</u>	<u>SAMPLE</u>	<u>STATION</u>	<u>COLLECTION PERIOD</u>	<u>REASON</u>
Airborne	Air Particulate	06	07/26-08/02	Low air volume.
Airborne	Charcoal	06	07/26-08/02	Low air volume.
Airborne	Air Particulate	06	08/02-08/09	Power off.
Airborne	Charcoal	06	08/02-08/09	Power off.
Airborne	Air Particulate	05	08/16-08/23	Out of Service.
Airborne	Charcoal	05	08/16-08/23	Out of Service.
Airborne	Air Particulate	06	09/27-10/04	Low air volume.
Airborne	Charcoal	06	09/27-10/04	Low air volume.
Airborne	Air Particulate	06	10/04-10/11	Pump Inoperable.
Airborne	Charcoal	06	10/04-10/11	Pump Inoperable
Waterborne	River Water	12	03/01	Sample not collected; unsafe conditions.
Waterborne	River Water	35	06/07	June sample collected from Station 35 because of unsafe conditions at Station #12.

TABLE 1

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
ENVIRONMENTAL RADIATION SURVEILLANCE PROGRAM
SAMPLING SCHEDULE AND ANALYSIS
ONCE PER 7 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Airborne - Particulate	1 - 10	Gross alpha, beta, Gamma isotopic on quarterly composite of each station and on each sample in which gross beta activity is > 10 times the yearly mean of control samples.
Airborne - Iodine	1-10	I-131

ONCE PER 15 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Milk - Nearest Producer (peak pasture only)	99	I-131 (low level) Gamma isotopic
		Sr-89, Sr-90, Elem. Ca. on monthly composite

ONCE PER 31 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
River Water	12,28	Gross alpha - sus and dis Gross beta - sus and dis, Sr-89, Sr-90, Gamma isotopic
		Tritium on quarterly composite

ONCE PER 31 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Milk - Nearest Producer (except peak pasture season)	99	I-131 (low level) Sr-89, Sr-90 Elem. Ca Gamma isotopic
Food Products - Broad- leaf Vegetation (when available)	28, 35, 44	I-131 Gamma isotopic

ONCE PER 92 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Background Radiation	1 - 10, 20, 44, 56, 58, 59, 66, 67, 71, 79 - 91, 94	TLD Readout (gamma dose)
Groundwater	11, 47	Gross alpha, beta Gamma isotopic Tritium
Milk - Commercial and Other Milk Producers	42, 100	I-131 (low level) Sr-89, Sr-90 Elem. Ca Gamma isotopic

2 TIMES/YEAR

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Fish (Summer and Fall)	28, 35	Gross beta Sr-89, Sr-90 Gamma isotopic
Shoreline Sediment	28	Gamma isotopic

TABLE 2


NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 BROWNVILLE, NEBRASKA

DISTANCE AND DIRECTION FROM THE ELEVATED RELEASE POINT (ERP)
 TO THE SAMPLE STATION LOCATIONS

<u>STATION NUMBER</u>	<u>DISTANCE^a (MILES)</u>	<u>DIRECTION^a (DEGREES)</u>	<u>CLASSIFICATION^b</u>
1	0.10	225	IND
2	0.75	225	IND
3	2.5	338	IND
4	3.0	43	IND
5	3.5	102	IND
6	3.0	165	IND
7	2.5	230	IND
8	2.5	260	IND
9	7.3	335	IND
10	10.0	160	IND
11	0.15	225	IND
12	0.10	360	CON
20	0.96	315	IND
28	1.8	150	IND
35	2.0	350	IND AND CON
42	12.9	156	IND
44	10.3	270	CON
47	25.8	154	IND
56	1.9	118	IND
58	1.1	219	IND
59	1.0	189	IND
66	4.5	200	IND
67	4.8	325	IND
71	4.3	71	IND
79	0.85	299	IND
80	0.75	284	IND
81	0.80	265	IND
82	0.80	176	IND
83	4.4	189	IND
84	4.4	297	IND
85	3.1	3	IND
86	4.6	16	IND
87	1.75	20	IND
88	1.75	63	IND

<u>STATION NUMBER</u>	<u>DISTANCE^a (MILES)</u>	<u>DIRECTION^a (DEGREES)</u>	<u>CLASSIFICATION^b</u>
89	2.0	86	IND
90	2.25	134	IND
91	6.9	54	IND
94	3.6	108	IND
99	10.25	189	IND
100	11.5	197	IND

- a Distance and direction are specified with respect to reactor Elevated Release Point.
- b Classification codes: IND = indicator; CON = control.

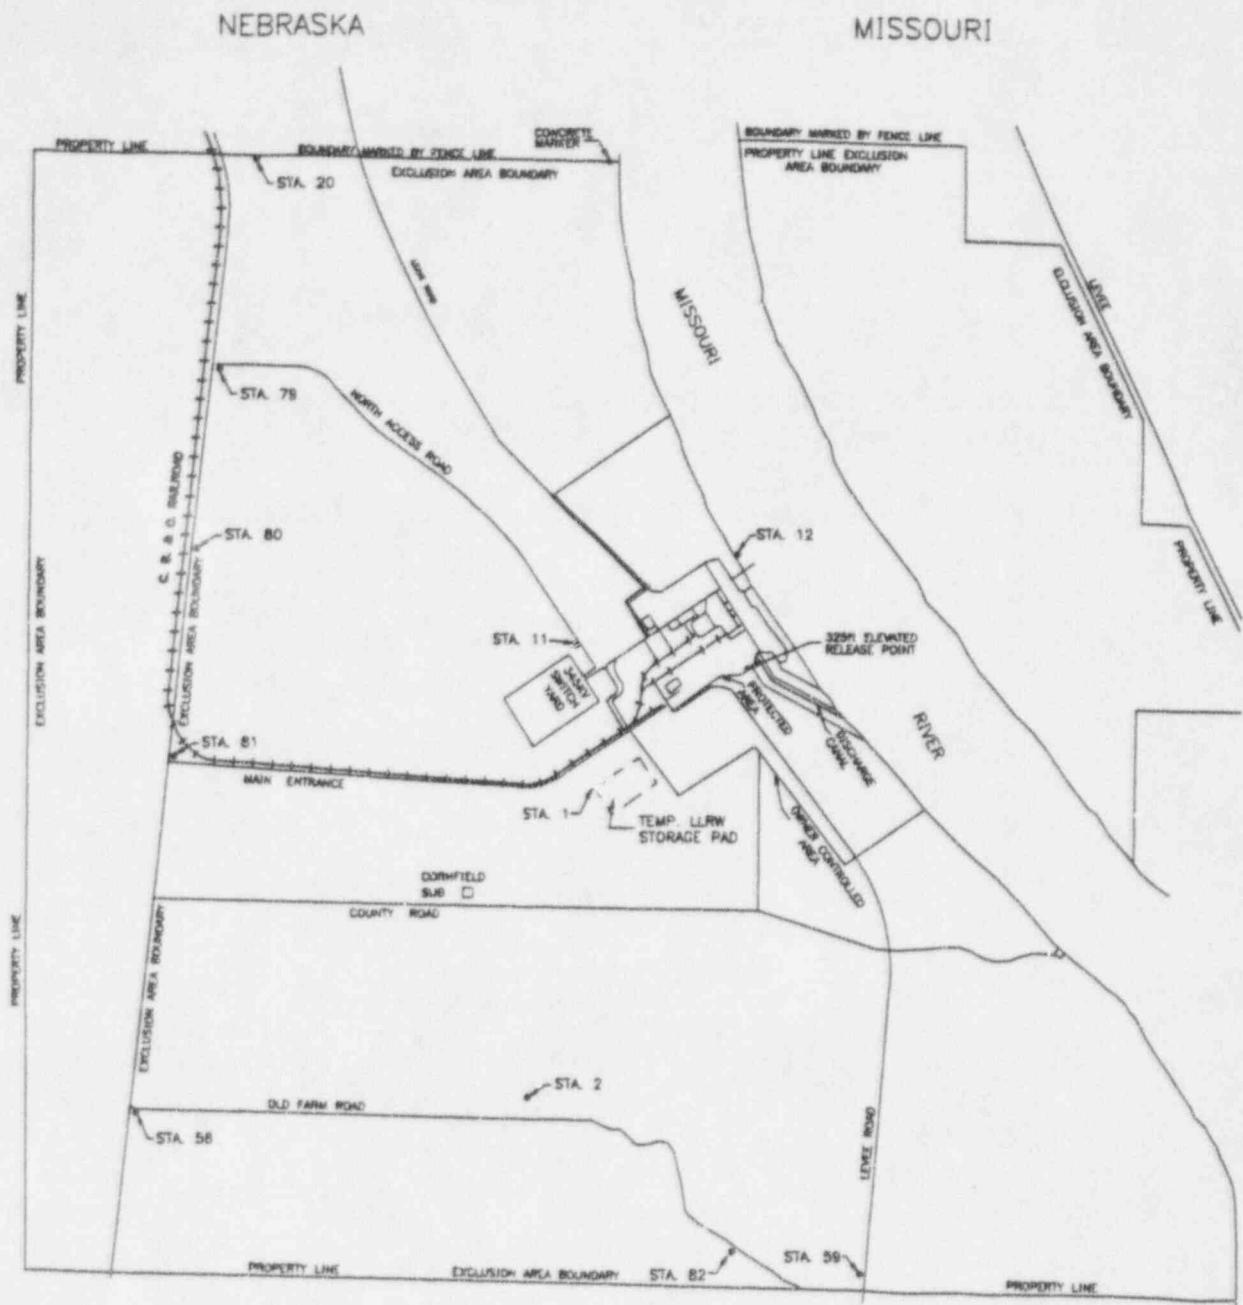


NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION


SITE
SAMPLING STATION
LOCATIONS MAP

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

AREA
SAMPLING STATION
LOCATION MAP

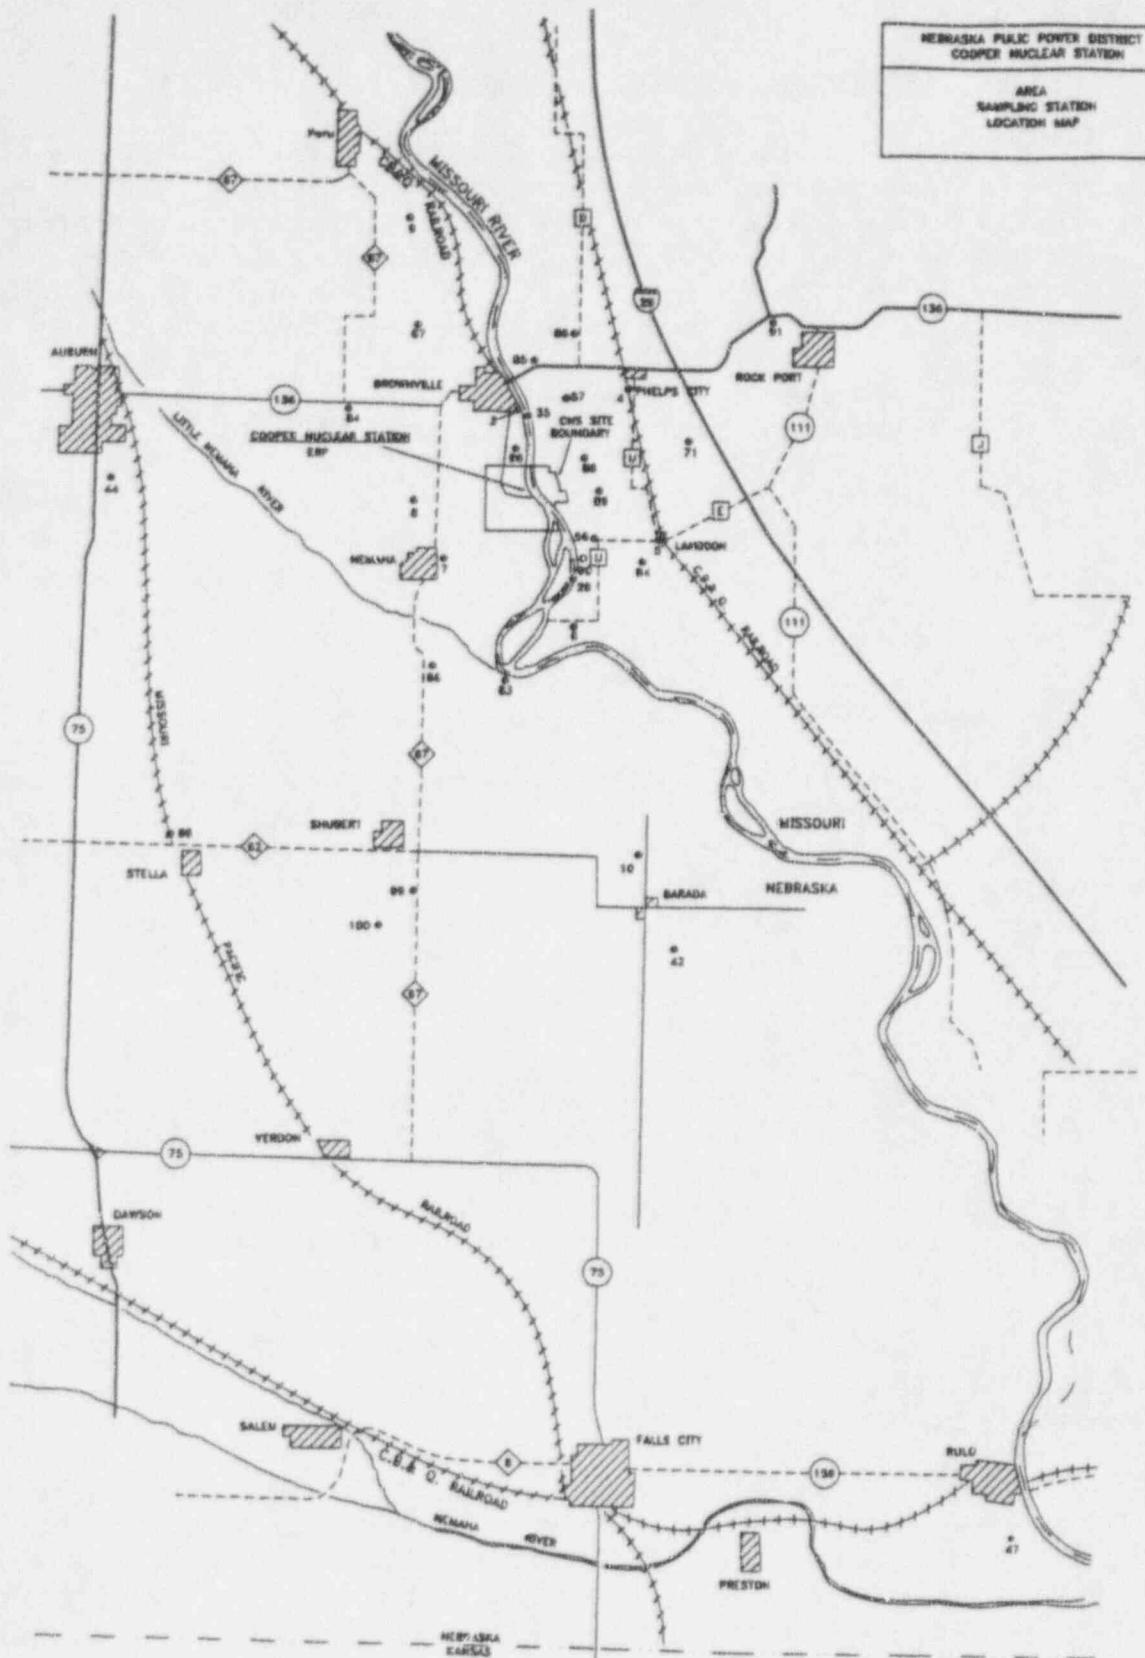

SCALE IN MILES



IV. DISCUSSION

A Program Objectives and Data Interpretation

The objective of the monitoring program is to detect and assess the impact of possible releases to the environs of radionuclides from the operations of the Cooper Nuclear Station. This objective requires measurements of low levels of radioactivity equal to or lower than pre-determined limits of detection. In addition the source of the environmental radiation must be established. Sources of environmental radiation include:

- (1) Natural background radiation from cosmic rays (Be-7).
- (2) Terrestrial, primordial radionuclides from the environment (K-40, Ra-226, Th-228).
- (3) Fallout from atmospheric nuclear tests such as the September 1977 detonation by the Peoples' Republic of China and the atmospheric weapons test of October 16, 1980 (fission products and fusion products).
- (4) Releases from nuclear power plants such as CNS (fission products and neutron activation products).
- (5) Fallout from the Chernobyl Nuclear Reactor Accident.

Radiation levels measured in the vicinity of an operating power station are compared with preoperational measurements at the same locations to distinguish power plant effects from other sources. Also, results of the monitoring program are related to events known to cause elevated levels of radiation in the environment, e.g., atmospheric nuclear detonations or abnormal plant releases.

B Atmospheric Nuclear Tests

Three atmospheric nuclear detonations in the People's Republic of China influenced program results significantly in late 1976 and in 1977. Two of these detonations occurred in late 1976 (September 26 and November 17) and one in late 1977 (September 17). As a consequence of these tests elevated activities of gross beta in air particulate filters and I-131 in milk were observed throughout most of the United States.

No atmospheric nuclear tests have been conducted since 1977, thus no short-lived fission products were detected in air particulate samples. Also no I-131 was detected from radiogases from any sources.

On April 26, 1986 the fire and explosion of Chernobyl Reactor No. 4 in the Soviet Union resulted in the release of fission products to the atmosphere and worldwide fallout. Following the explosion, elevated levels of gross beta activities in air particulates and I-131 in charcoal filters and milk samples were measured. Additionally, in 1986, Cs-137 and the short-lived isotopes I-131, Ru-106, and Cs-134 were detected in broadleaf vegetation. Similar results occurred in other areas of the United States and the entire Northern Hemisphere.

V. RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM TABLES

Presented in Table 3 are the radiological environmental monitoring program summaries (REMPs) generated from the reports of analyses performed during 1994 for the NPPD sampling and analyses program. The REMPS tables conform to the requirements of Table 1 in Regulatory Guide 4.8 (Reference 6).

The average activity level for all samples collected for the year for each sample type are summarized in this table. The mean, range and fraction of detections to total samples assayed are presented. The station location and station number with the highest annual mean is also tabulated. If a control station is specified the comparable results of the control are listed.

From the REMPS table it is possible to determine the total number of each type of sample analyzed and the average activity of all samples from all stations of each nuclide. If there were no positive detections the maximum of the lowest levels of detection is listed. The station having the highest level of activity is specified. From this data it is possible to determine any high levels of activity and the source. The dose impact on the population can thus be evaluated.

TABLE 3
RADIOLOGICAL ENVIRONMENTAL
MONITORING PROGRAM SUMMARIES
(REMP)
1994

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - AIRBORNE
SAMPLE - AIR PARTICULATE FILTERS
UNITS - PCI/CL, I.

COMPILED - ANNUAL SUMMARY
CONTROL -

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS NO	LIMIT OF DETECTION	ALL INDICATOR SAMPLES		LOCATION WITH HIGHEST MEAN MEAN X E-00	MEAN X E-00	NON-ROUTINE MEAN X E-00	REPORTING PERIOD
		MEAN X E-00	RANGE	STATION FRACTION	RANGE	STATION DESCRIPTION	FRACTION
GR-A	517	0.00200	0.0008- 0.0081	0.00233 517/517	4	052/052 0.0010- 0.0069	0 12/28/93-01/03/95
GR-B	517	0.00300	0.00200- 0.10000	0.0270 517/517	04	052/052 0.0084- 0.1000 STATION 4 - 3.0 MI. 43 DEG. IND.	0 12/28/93-01/03/95

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - AIRBORNE
SAMPLE - CHARCOAL FILTERS
UNITS - PCI/CU.M.

COMPILEATION - ANNUAL SUMMARY
CONTROL -

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS NO	LIMIT OF DETECTION	ALL INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN	CONTROL LOCATION	NON-ROUTINE REPORTING PERIOD	REPORTING PERIOD
MEAN X E-00	RANGE	FRACTION	STATION FRACTION	RANGE	FRACTION	
I-131 517	LT 0.05000 LT 0.00800- LT 0.05000 000/517				0	12/31/93-01/03/95

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - AIRBORNE
SAMPLE - COMPOSITE OF AIR PARTICULATE FILTERS
UNITS - PCI/CU.M.

PATHWAY - AIRBORNE
SAMPLE - COMPOSITE OF AIR PARTICULATE FILTERS
UNITS - PCI/CU.M.

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION	ALL INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN			NON-ROUTINE	REPORTING PERIOD
				MEAN X E-00	RANGE	STATION FRACTION		
BE-7	40	0.05000	0.13900 0.0865- 0.2070 040/040	0.4	004/004 STATION 04 - 3.0 MI.	0.1825 0.145- 0.2070 43 DEG. IND.	0	12/28/93-01/03/95
K-40	40	0.06000	0.0353 0.0056- 0.0821 005/040	0.5	002/004 STATION 05 - 3.5 MI.	0.06010 0.03810- 0.08210 102 DEG. IND.	0	12/28/93-01/03/95
I-131	40		LT 0.2000 LT 0.0300- LT 0.2000 000/040				0	12/28/93-01/03/95
CS-137	40	0.00300	LT 0.00080 LT 0.00030- LT 0.00080 000/040					

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - INGESTION
 SAMPLE - FISH
 UNITS - PCI/GM WET

COMPILED - ANNUAL SUMMARY
 CONTROL -

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION	ALL INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN	CONTROL LOCATION	NON-ROUTINE	REPORTING PERIOD
		MEAN X E-00	MEAN X E-00	MEAN X E-00	MEAN X E-00	RANGE	
		RANGE	RANGE	RANGE	RANGE	FRACTION	
		FRACTION	FRACTION	STATION DESCRIPTION	STATION DESCRIPTION	FRACTION	

GR-B	10	0.250	4.4 0.10/010	5.8 STATION 35 - 2.0 MI. 350 DEG. IND.	005/005 STATION 35 - 2.0 MI. 350 DEG. IND.	3.6-5.8 0.01700	06/09/94-10/06/94
SR-89	10	0.0300	LT 0.00200- LT 0.0100 000/010	0.0100 0.00200- LT 0.0100 000/010	003/005 STATION 35 - 2.0 MI. 350 DEG. IND.	0.001100-0.02800 0.01700	06/09/94-10/06/94
SR-90	10	0.0300	0.0140 0.00250- 0.0280 008/010	0.0280 0.00250- 0.0280 008/010	005/005 STATION 35 - 2.0 MI. 350 DEG. IND.	0.001100-0.02800 0.01700	06/09/94-10/06/94
K-40	10	0.4700	2.80 1.38- 010/010	3.21 LT 0.0500 0.03000- LT 0.0500 000/010	28 STATION 28 - 1.8 MI. 150 DEG. IND.	2.05-3.21 2.90	06/09/94-10/06/94
T-131	10	0.03100	LT 0.01000- LT 0.02000 000/010	0.0500 LT 0.02000 000/010	0.02000 LT 0.02000 000/010	0.02000 LT 0.02000 000/010	06/09/94-10/06/94
CS-137	10	0.03100	LT 0.01000- LT 0.02000 000/010	0.02000 LT 0.02000 000/010	0.02000 LT 0.02000 000/010	0.02000 LT 0.02000 000/010	06/09/94-10/06/94

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - INGESTION
SAMPLE - MILK - NEAREST
UNITS - PCI/LITER

COMPILED - ANNUAL SUMMARY
CONTROL.

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS	NO. OF INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN	CONTROL LOCATION	NON-ROUTINE	REPORTING PERIOD
	MEAN X E-00	MEAN X E-00	MEAN X E-00	RANGE	
	MEAN X E-00	RANGE	FRACTION	RANGE	
CA (mg/l)	16	3.7	016/016	1.5- 3.7	0 01/04/94-12/06/94
I-131	22	LT 0.100- LT 1.0 000/022			0 01/04/94-12/06/94
SR-89	16	LT 0.6- LT 2.0 000/016			0 01/04/94-12/06/94
SR-90	16	1.0- 1.7 013/016	99	016/016 1.0- 1.7	0 01/04/94-12/06/94
K-40	22	1200- 1380- 1680. 023/023	99	023/023 1200- 1380- 1680.	0 01/04/94-12/06/94
I-131	22	LT 4.00- LT 90.00 000/022			0 01/04/94-12/06/94
CS-137	22	LT 3.00- LT 5.00 000/022			0 01/04/94-12/06/94

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - INGESTION
SAMPLE - MILK OTHER PRODUCERS
UNITS - PCI/LITER

COMPILEATION - ANNUAL SUMMARY
CONTROL

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS NO	DETECTION MEAN X E-00	ALL INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN MEAN X E-00	NON-ROUTINE		REPORTING PERIOD
				RANGE	STATION FRACTION	
	FRACTION		STATION DESCRIPTION	FRACTION		
CA (mg/l) 8	1.7. 008/008	1.8 LT 0.200- 000/008	1.9 00 STATION 100 - 11.5 MI. 197 DEG. IND	1.8 004/004	1.8- LT 0.300 0.8- 000/008	1.9 00 01/12/94-10/11/94
I-131	8	0.780	LT 0.300 0.200- 000/008			0 01/12/94-10/11/94
SR-89	8	2.0	LT 0.8- 000/008			0 01/12/94-10/11/94
SR-90	8	1.4	LT 1.0 0.8- 000/008			0 01/12/94-10/11/94
K-40	8	140.0	1210. 008/008	1350. 1530. 008/008	100 00 LT 09.000 6.00- 000/008	004/004 00 LT 09.00 LT 09.00 1360. 1210. 1530. STATION 42 - 12.9 MI. 156 DEG. IND
I-131	8	0.7800	LT 0.00- 000/008			0 01/12/94-10/11/94
CS-137	8	9.00	LT 3.00- 000/008			0 01/12/94-10/11/94

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - WATERBORNE
SAMPLE - WATER - GROUND
UNITS - PCI/LITER

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION	ALL INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN MEAN X E-00	MEAN X E-00	NON-ROUTINE MEAN X E-00	REPORTING PERIOD
			MEAN X E-00 RANGE	STATION FRACTION	RANGE	RANGE	
			FRACTION	STATION DESCRIPTION		FRACTION	
GR-A	8	4.0	LT 4.0 000/008	LT 4.0 LT 2.0. LT 4.0	10	10	0 01/25/94-10/25/94
GR-B	8	1.8	10.0 7.6- 008/008	13	11 004/004	8.6- 13 STATION 11 - 0.15 MI. 225 DEG. IND.	0 01/25/94-10/25/94
I-131	8	9.00	LT 7.00 000/008	LT 7.00 LT 4.00. LT 7.00			0 01/25/94-10/25/94
CS-137	8	9.00	LT 4.00 000/008	LT 4.00 LT 3.00. LT 4.00			0 01/25/94-10/25/94
H-3	8	140.	LT 100. 000/008	LT 100. LT 100. 100.			0 01/25/94-10/25/94

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - WATERBORNE
SAMPLE - WATER - RIVER
UNITS - PC/LITER

COMPILEATION - ANNUAL SUMMARY
CONTROL - STATION 12 - 0.1 MI. 360 DEG. CON.

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS	NO LIMIT OF DETECTION	ALL INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN				CONTROL LOCATION MEAN X E-00	NON- ROUTINE	REPORTING PERIOD
			MEAN X E-00	MEAN X E-00	STATION	FRACTION			
GR-A DIS 25	4.0	3.8 2.8- 008/025	6.7	4.3	12	004/012	2.9- 6.7	4.3 2.9- 004/012	6.7 01/04/94-12/06/94
GR-A SUS 25	4.0	3.0 0.49- 018/025	31.0	4.9	28	008/013	0.62- 31	1.5 0.49- 010/012	6.1 01/04/94-12/06/94
GR-B DIS 25	1.8	11.0 5.5- 025/025	15	11.2	28	013/013	5.9- 15	10.8 5.5- 012/012	15 01/04/94-12/06/94
GR-B SUS 25	1.8	7.7 0.78- 023/025	56	8.4	28	011/013	1.0- 56.0	7.1 0.78- 012/012	51.0 01/04/94-12/06/94
SR-89	25	1.1 LT 0.5- 000/025	LT 1.0				LT 1.0 LT 0.500- 000/012	LT 1.0 LT 1.0	01/04/94-12/06/94
SR-90	25	0.930 LT 0.200 000/025	LT 0.900 LT 0.900						01/04/94-12/06/94
K-40	25	140.0 47.5- 004/025	67.7 79.6	77.4	12	001/012	77.4- 77.4	77.4 77.4- 001/012	77.4 77.4 01/04/94-12/06/94
I-131	25	9.00 LT 4.0- 000/025	LT 20.0 LT 20.0				LT 9.0 LT 4.0- 000/012	LT 9.0 LT 9.0	01/04/94-12/06/94
CS-137	25	9.00 LT 3.0- 000/025	LT 5.0 LT 5.0				LT 5.0 LT 3.0- 000/012	LT 5.0 LT 5.0	01/04/94-12/06/94
H-3	8	140. LT 100. 000/008	LT 100. LT 100.						01/04/94-12/06/94

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - GAMMA EXPOSURE
SAMPLE - ENVIRONMENTAL TLD
UNITS - mR

COMPILEATION - ANNUAL SUMMARY
CONTROL -

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION	ALL INDICATOR SAMPLES		LOCATION WITH HIGHEST MEAN MEAN X E-00		STATION FRACTION	LOCATION WITH HIGHEST MEAN MEAN X E-00	STATION DESCRIPTION	CONTROL LOCATION MEAN X E-00	NON- ROUTINE REPORTING PERIOD
			MEAN X E-00	RANGE FRACTION	STATION	RANGE					
TLD	128	2mR									
Total Exposure/year			71.3 mR 63.7- 78.9 128/128		78.9 mR 90 004/004 STATION 90 - 2.25 MI. 134 DEG. IND.			75.9 44 004/004 STATION 44 - 10.25 MI. 270 DEG. CON.		0	01/11/94-01/05/95
Average Exposure/ quarter			17.8 mR 12.1- 23.8 032/032		19.7mR 15.4- 23.0 90 004/004 STATION 90 - 2.25 MI. 134 DEG. IND.			19.0 mR 15.5- 22.4 44 004/004 STATION 44 - 10.25 MI. 270 DEG. CON.		0	01/11/94-01/05/95

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - INGESTION
 SAMPLE - BROADLEAF TERRESTRIAL VEGETATION
 UNITS - PCI/GM WET

NEBRASKA PUBLIC POWER DISTRICT
 ANNUAL SUMMARY
 CONTROL - STATION 44 - 10.3 MI. 270 DEG. CON.
 COOPER NUCLEAR STATION

ANALYSIS	No.	LIMIT OF DETECTION	ALL INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN	CONTROL LOCATION	NON-ROUTINE	REPORTING PERIOD
		MEAN X E-00	MEAN X E-00	MEAN X E-00	MEAN X E-00	RANGE	
		MEAN X E-00	RANGE	STATION FRACTION	RANGE	STATION DESCRIPTION	FRACTION
I-131	60	0.0500	LT 0.03 0.004- 000/060	LT 0.03 0.004- 000/060	44 STATION 44 - 10.25 MI. 270 DEG. CON.	2.11 0.740- 8.99	0 05/10/94-10/18/94
BE-7	60	1.20	0.186- 059/060	1.63 8.99	44 STATION 44 - 10.25 MI. 270 DEG. CON.	2.11 0.740- 8.99	0 05/10/94-10/18/94
K-40	60	0.9300	2.46- 006/060	6.13 11.7	35 STATION 35 - 2.0 MI. 350 DEG. IND and CON.	7.09 3.87- 11.7	0 05/10/94-10/18/94
I-131	60	0.05000	LT 0.0600 0.008- 000/060	LT 0.0600 0.008- 000/060			0 05/10/94-10/18/94
CS-137	60	0.1600	0.0163 0.01630 001/060	0.0163 0.01630 001/060	44 STATION 44 - 10.25 MI. 270 DEG. CON.	0.0163 0.0163- 0.0163	0 05/10/94-10/18/94
RA-226	60	0.8000	LT 0.600 0.0700- 000/060	LT 0.600 0.0700- 000/060			0 05/10/94-10/18/94
TH-228	60	0.4700	0.0502 0.0427- 002/060	0.0502 0.0576 002/060	28 STATION 28 - 1.8 MI. 150 DEG. IND.	0.0576 0.0576- 0.0576	0 05/10/94-10/18/94

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - AQUATIC
SAMPLE - SHORELINE SEDIMENT
UNITS - PCI/GM DRY

COMPILED - ANNUAL SUMMARY
CONTROL -

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION	ALL INDICATOR SAMPLES	LOCATION WITH HIGHEST MEAN	CONTROL LOCATION	NON-ROUTINE	REPORTING PERIOD
		MEAN X E-00	MEAN X E-00	MEAN X E-00	MEAN X E-00	RANGE	
		RANGE	RANGE	RANGE	RANGE	FRACTION	
		FRACTION		STATION DESCRIPTION			
BE-7	3	0.2300	0.0941- 002/003	0.1370 0.179	28 STATION 28 - 1.8 MI.	0.1370 0.0941 0.179	0 05/03/94-10/25/94
K-40	3	0.4700	15.7- 003/003	16.8 18.4	28 STATION 28 - 1.8 MI.	15.7 16.8 18.4	0 05/03/94-10/25/94
MN-54	3	0.03100	0.0079- 003/003	0.0144 0.0181	28 STATION 28 - 1.8 MI.	0.0144 0.0079 0.0181	0 05/03/94-10/25/94
I-131	3	0.03100	LT 0.0100- 000/003	LT 0.0100 LT 0.0100			0 05/03/94-10/25/94
CS-137	3	0.03100	0.0760- 003/003	0.0820 0.0879	28 STATION 28 - 1.8 MI.	0.0820 0.0760 0.0879	0 05/03/94-10/25/94
CE-141	3	0.04700	LT 0.0100- 000/003	LT 0.0100 0.0100			0 05/03/94-10/25/94
RA-226	3	0.1100	1.56- 003/003	1.73 1.96	28 STATION 28 - 1.8 MI.	1.73 1.56 1.96	0 05/03/94-10/25/94
TH-228	3	0.1100	0.8000- 003/003	0.8700 0.9930	28 STATION 28 - 1.8 MI.	0.8700 0.8000 0.9930	0 05/03/94-10/25/94

VI. DISCUSSION, IMPACT ON THE ENVIRONMENT
GRAPH OF RESULTS FROM 1977 - 1994
AND
STATISTICAL TABLES
FOR
EACH QUARTER

A and B. AIR PARTICULATE SAMPLES - GROSS BETA AND GROSS ALPHA

(See Tables A-1 - A-4, B-1 - B-4)

STATIONS 01 to 10

Air particulates were collected on membrane filters at ten locations (01-10). The filters were changed weekly and analyzed for gross beta and gross alpha activities. Quarterly composites are analyzed for gamma emitting isotopes.

The average gross beta activity of all stations for each quarter c. 1993 and 1994 is summarized below:

1993	First Quarter	0.030	pCi/Cu. M.
	Second Quarter	0.015	pCi/Cu. M.
	Third Quarter	0.020	pCi/Cu. M.
	Fourth Quarter	0.029	pCi/Cu. M.
	Average 1993	0.024	pCi/Cu. M.
1994	First Quarter	0.029	pCi/Cu. M.
	Second Quarter	0.020	pCi/Cu. M.
	Third Quarter	0.024	pCi/Cu. M.
	Fourth Quarter	0.034	pCi/Cu. M.
	Average 1994	0.027	pCi/Cu. M.

The level of beta activity was at normal environmental levels in 1994 showing the natural seasonal variations. There was a slight decrease in the level of gross beta activity during the first quarter; there was a slight increase from the second quarter of 1993 and from the third quarter of 1993.; the fourth quarter was slightly higher as shown in Table A-4. The increase and decline in activity often occurs and is attributed to natural phenomena.

The gross alpha activity continued low and close to the limits of detection. Gross alpha activity is probably due to the alpha emitters found in soil and particulates drawn into the filters.

No effect attributable to the Cooper Nuclear Station was observed in the results of monitoring air particulates.

A and B. AIR PARTICULATE SAMPLES - GROSS BETA AND GROSS ALPHA
(See Tables A-1 - A-4, B-1 - B-4)

STATIONS 01 to 10

Figure A1, B1 shows the gross beta, gross alpha and Ce-144 activity in the environs of CNS. The results for 1986 through 1994 are on the second page of Figure A-1, B-1. The gross beta activity in 1994 was similar to previous years in which there were no nuclear atmospheric weapons tests or nuclear accidents. The gross alpha activity remained low and near the normal detection level. Cesium-144 was below the level of detection.

Figure A-2 shows the gross beta activity in air samples through April 1989 at Jefferson City, Missouri as reported by the Environmental Radiation Monitoring System (ERAMS) of the US Environmental Protection Agency. No more recent data was available. This data was taken from Environmental Radiation Data distributed by the Eastern Environmental Radiation Facility, Montgomery, Alabama. The measurements by ERAMS were made after a waiting period which may explain the somewhat lower results because of decay of the isotopes having a shorter half-life. Measurements of Ce-144 were no longer reported because the activity has approached the limit of detection by the analytical techniques now used.

FIGURE A1, B1
AIR PARTICULATES - CNS
ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS
CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

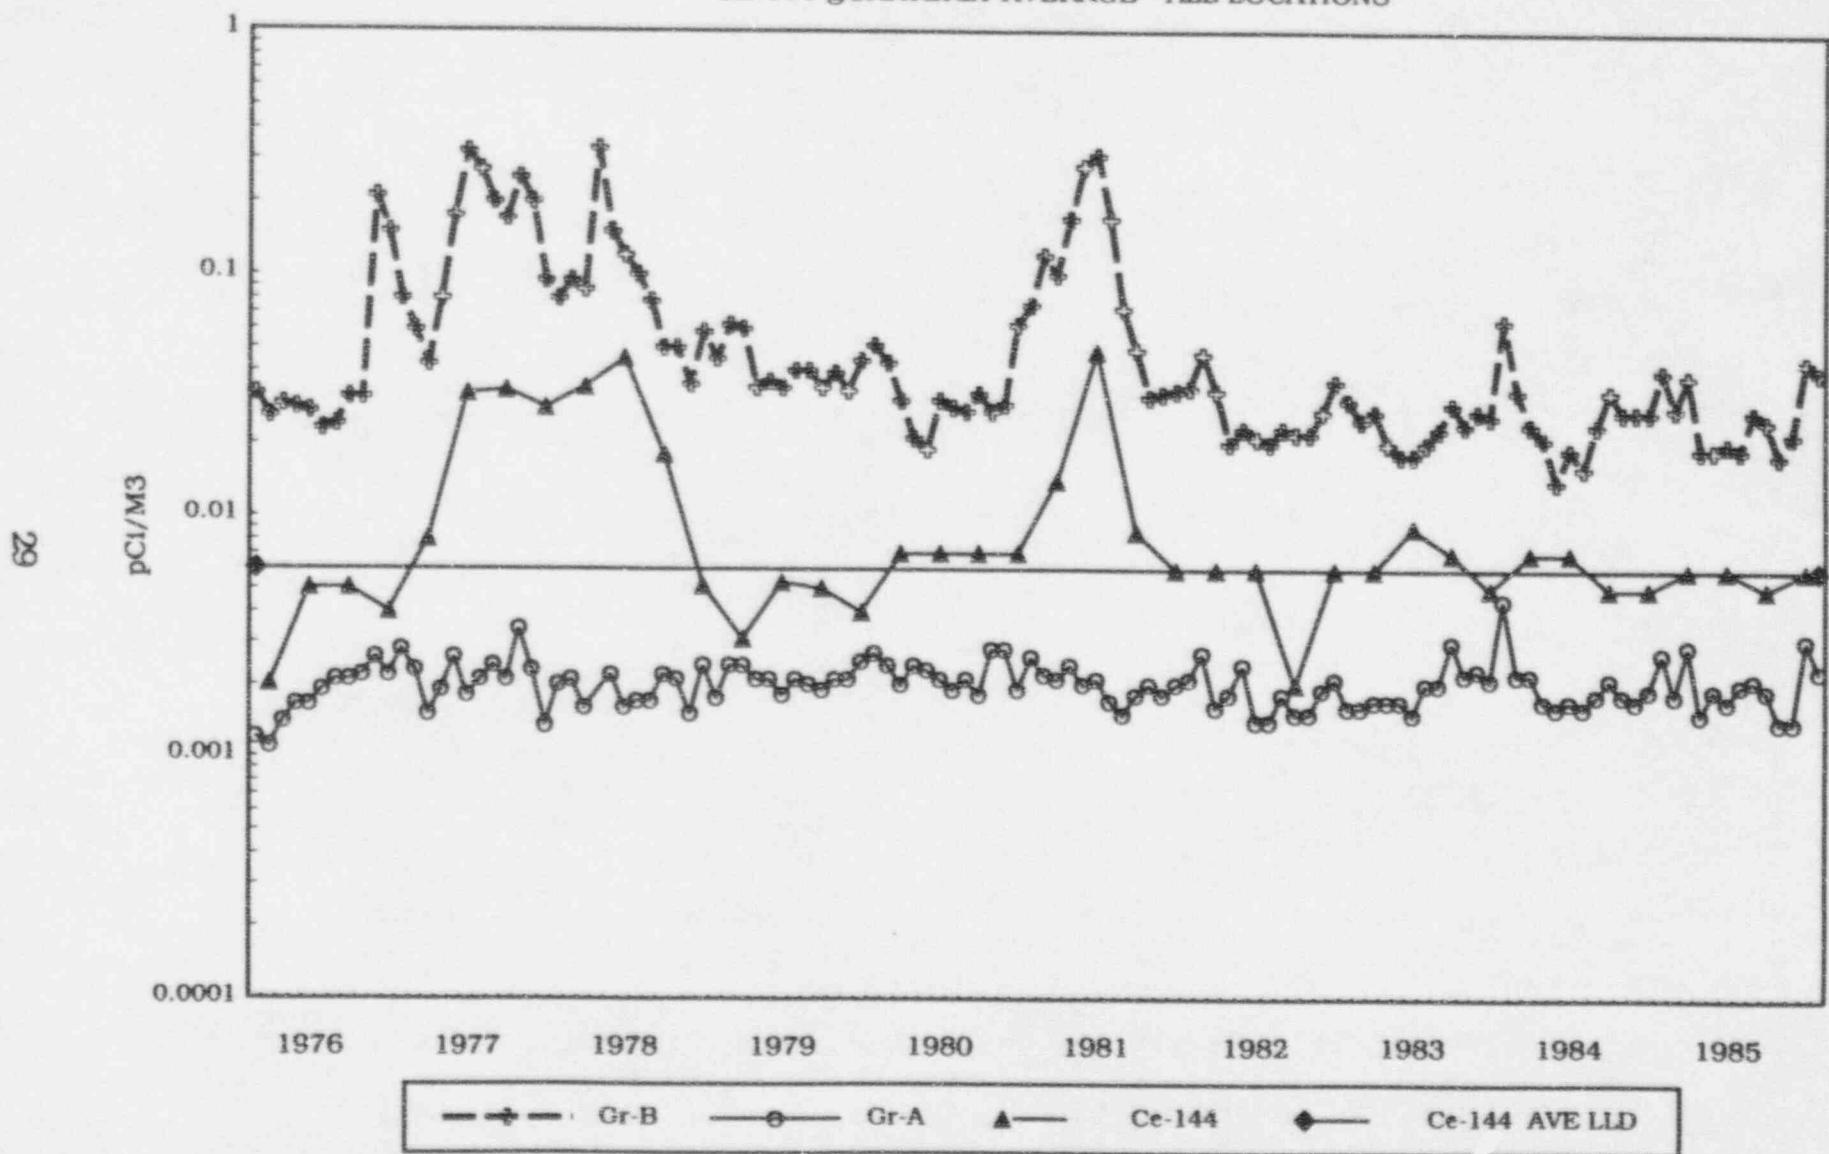


FIGURE A1, B1
AIR PARTICULATES - CNS
ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS
CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

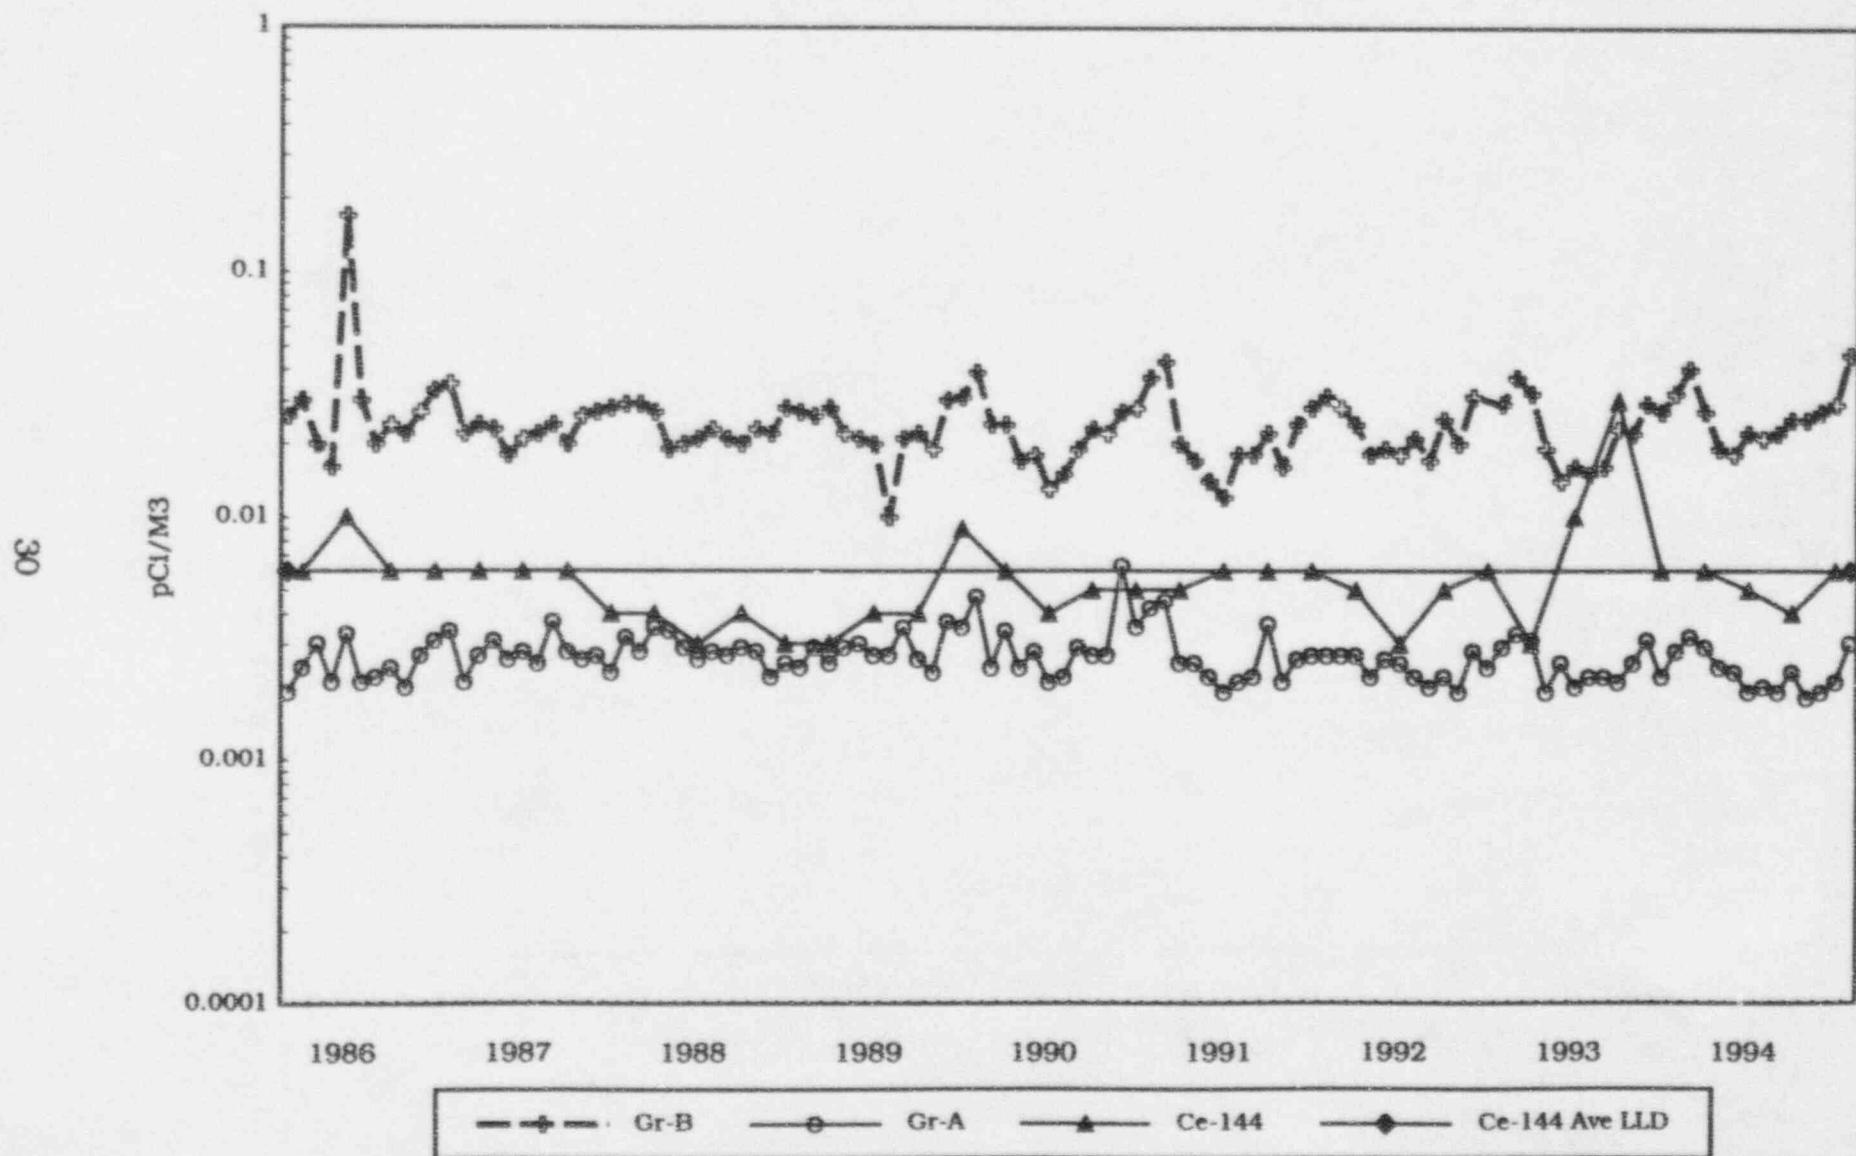


FIGURE A-2
AIR PARTICULATES
BETA MONTHLY AVERAGE - JEFFERSON CITY
MISSOURI ERAMS EPA

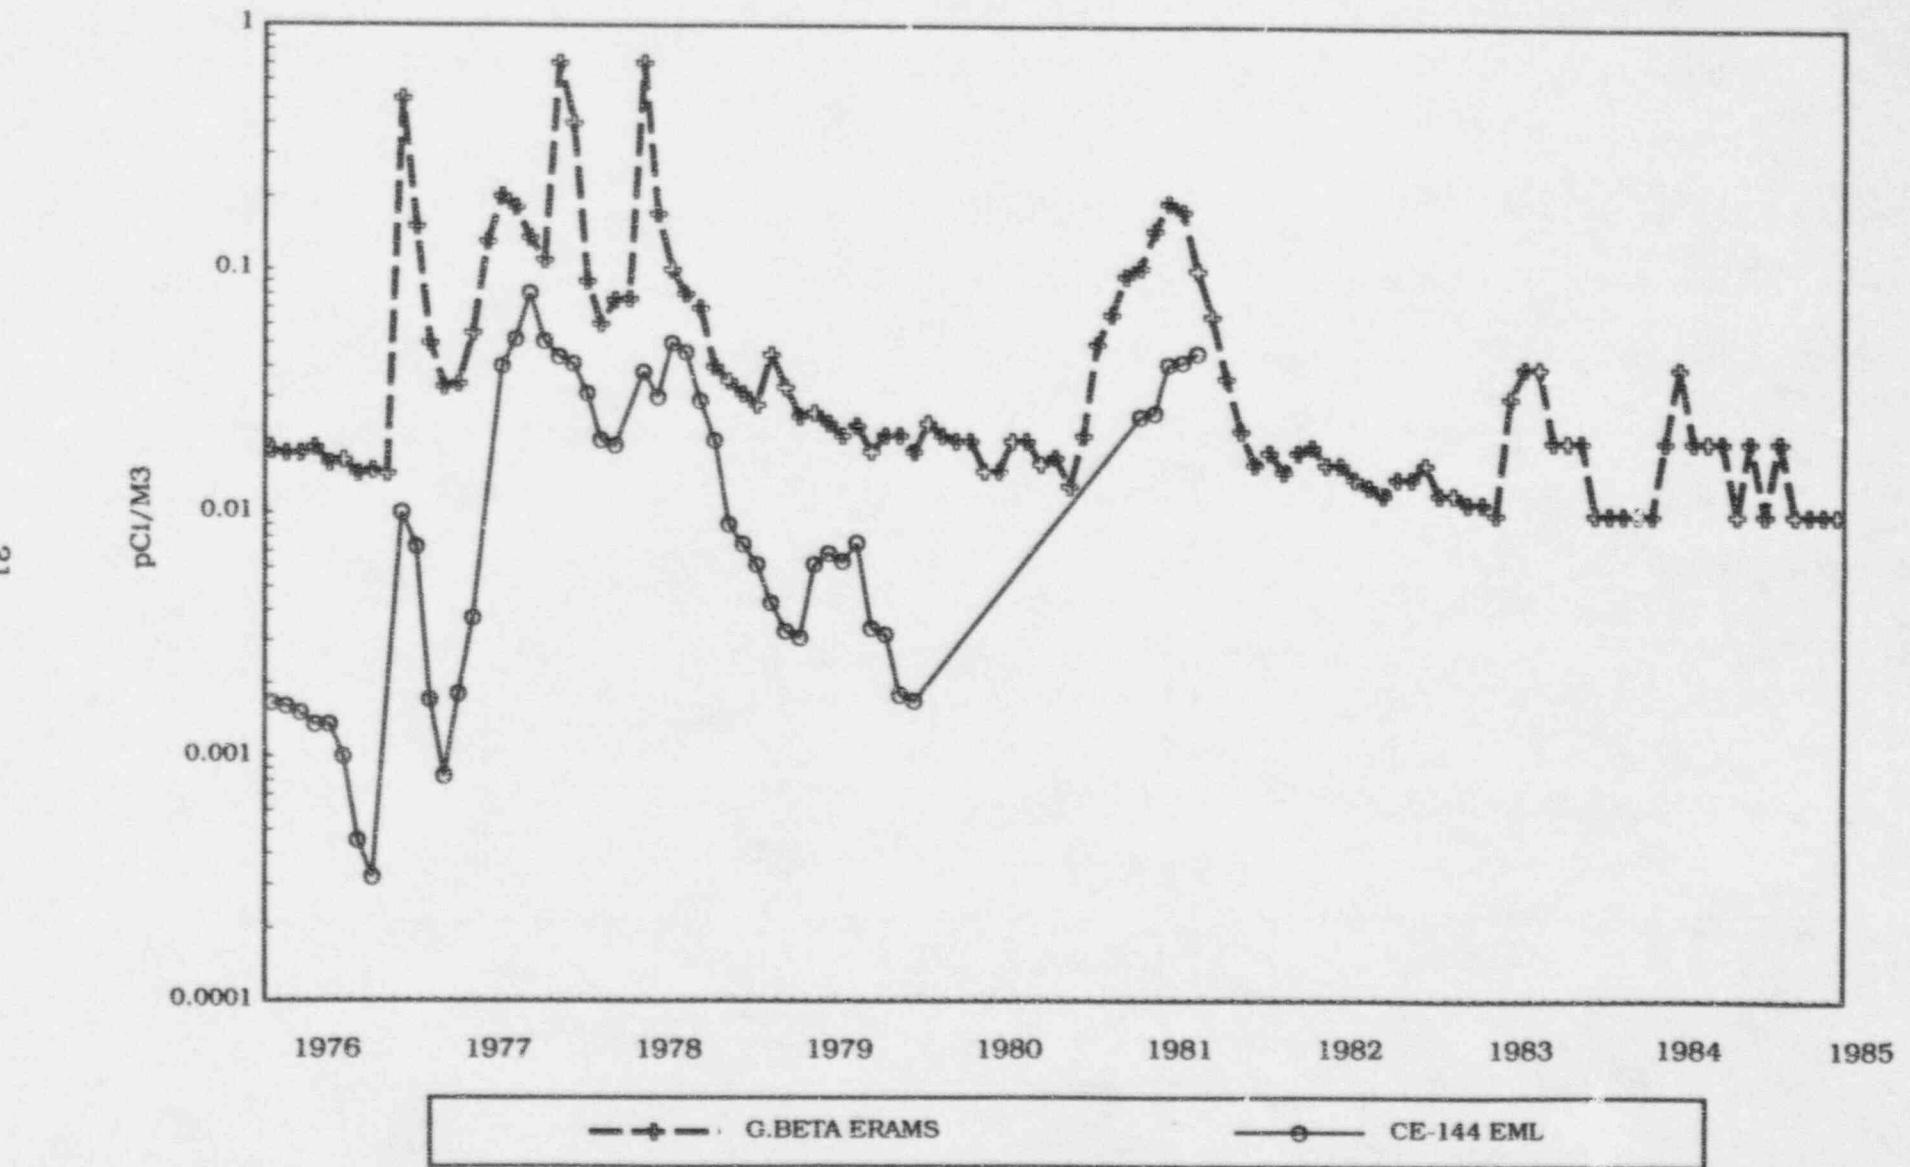


FIGURE A-2
AIR PARTICULATES
BETA MONTHLY AVERAGE - JEFFERSON CITY
MISSOURI ERAMS EPA

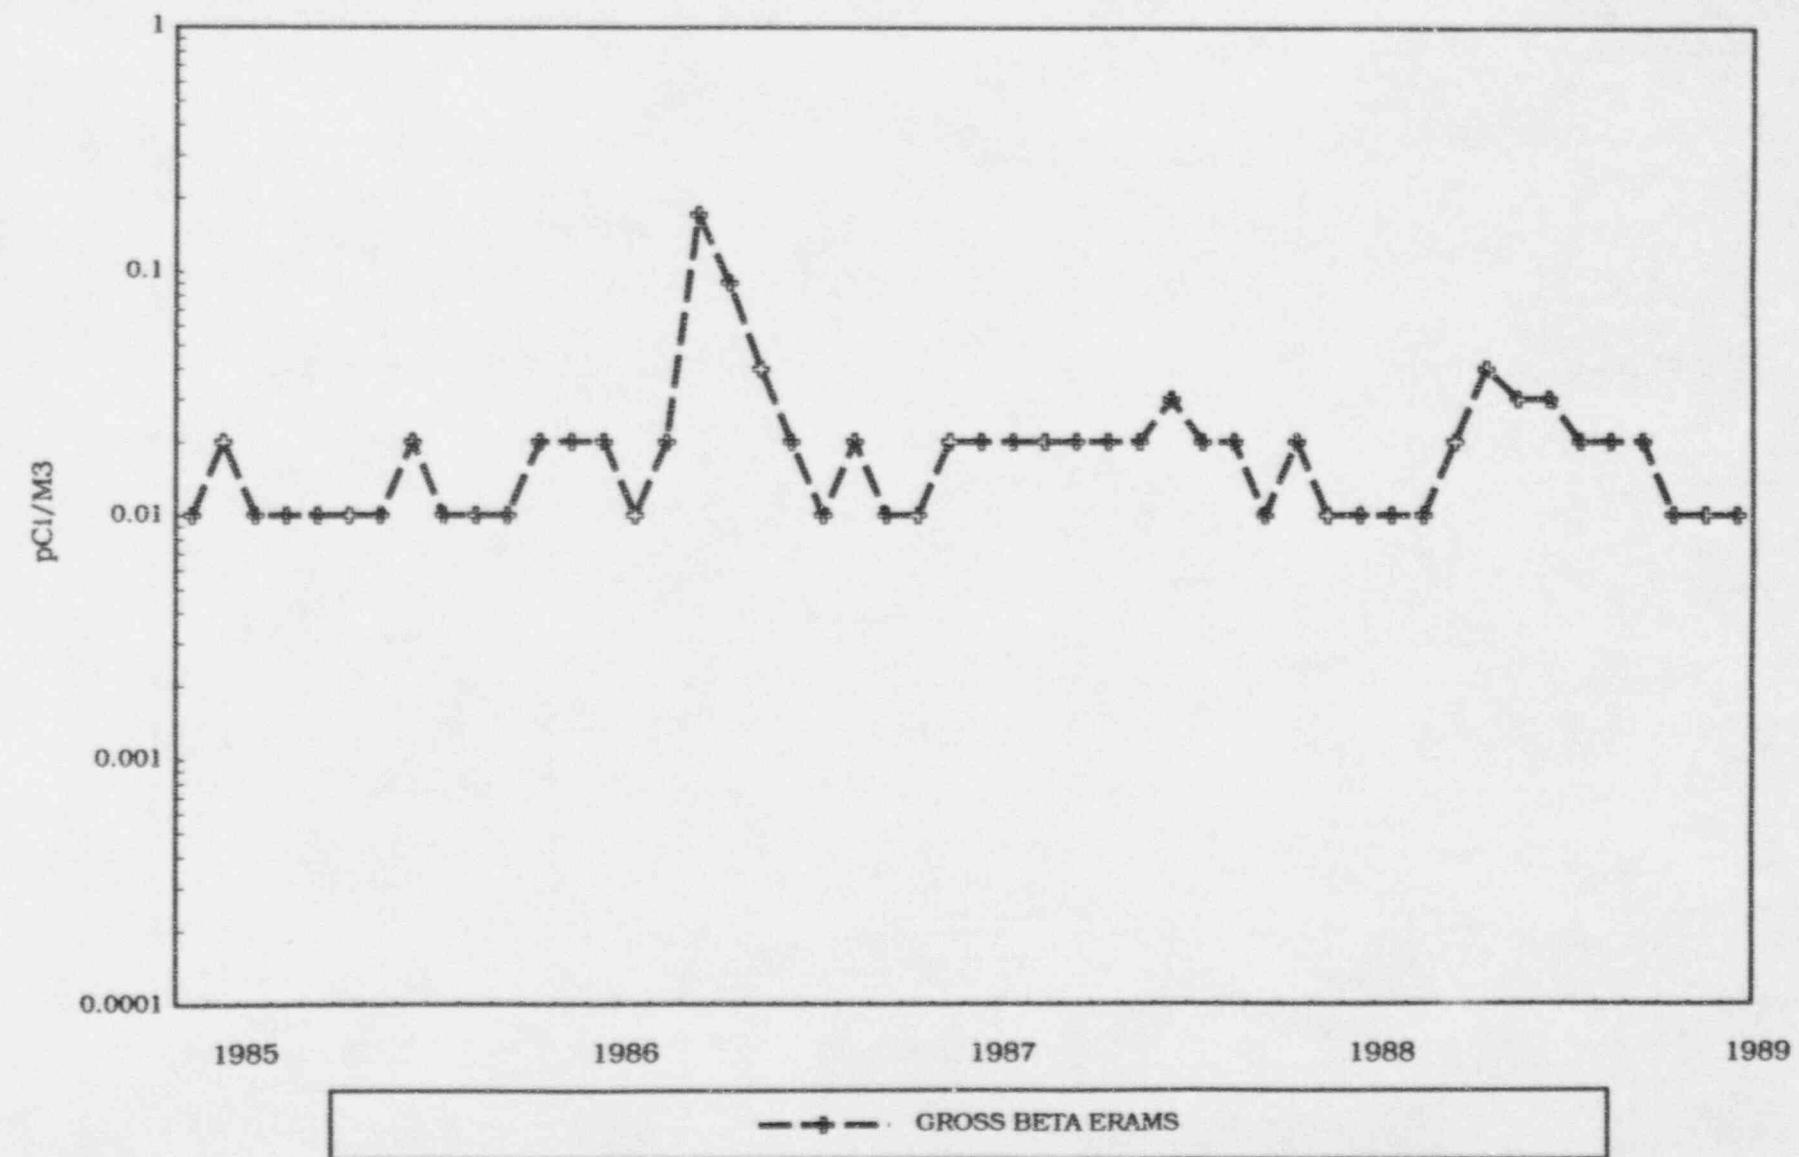


TABLE A-1
 WEEKLY COLLECTIONS FIRST QUARTER 1994
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE FILTERS
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 12/28-02/01	MONTHLY SUMMARY 02/01-03/01	MONTHLY SUMMARY 03/01-03/29	FIRST QUARTER SUMMARY 12/28-03/29
GROSS BETA	01	3.7 ± 0.6 E-02	2.9 ± 0.5 E-02	2.0 ± 0.6 E-02	2.9 ± 0.9 E-02
	02	3.8 ± 0.3 E-02	2.3 ± 0.4 E-02	1.6 ± 0.5 E-02	2.5 ± 1.0 E-02
	03	3.4 ± 0.3 E-02	2.7 ± 0.5 E-02	1.9 ± 0.4 E-02	2.7 ± 0.7 E-02
	04	5.4 ± 0.5 E-02	4.2 ± 0.9 E-02	2.9 ± 0.4 E-02	4.3 ± 1.2 E-02
	05	3.8 ± 0.3 E-02	2.3 ± 0.6 E-02	1.9 ± 0.4 E-02	2.5 ± 0.9 E-02
	06	3.7 ± 0.6 E-02	2.5 ± 0.2 E-02	1.7 ± 0.5 E-02	2.7 ± 1.0 E-02
	07	3.6 ± 0.4 E-02	2.7 ± 0.1 E-02	1.9 ± 0.3 E-02	2.8 ± 0.8 E-02
	08	3.5 ± 0.9 E-02	2.4 ± 0.4 E-02	1.7 ± 0.2 E-02	2.6 ± 1.0 E-02
	09	3.5 ± 0.5 E-02	2.5 ± 0.1 E-02	1.7 ± 0.6 E-02	2.6 ± 0.9 E-02
	10	5.0 ± 2.6 E-02	2.5 ± 0.4 E-02	2.0 ± 0.7 E-02	3.3 ± 2.1 E-02
AVERAGE ALL STATIONS	01-10	4.0 ± 1.1 E-02	2.7 ± 0.7 E-02	1.9 ± 0.5 E-02	2.9 ± 1.2 E-02

\bar{x} and s

Grand \bar{x} and s

TABLE A-2

WEEKLY COLLECTIONS SECOND QUARTER 1994

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

AIR PARTICULATE FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 03/29-05/03	MONTHLY SUMMARY 05/03-05/31	MONTHLY SUMMARY 05/31-06/28	SECOND QUARTER SUMMARY 03/29-06/28
GROSS BETA	01	1.7 ± 0.4 E-02	2.2 ± 0.4 E-02	1.9 ± 0.3 E-02	1.9 ± 0.4 E-02
	02	1.8 ± 0.4 E-02	2.0 ± 0.2 E-02	2.0 ± 0.3 E-02	1.9 ± 0.3 E-02
	03	1.8 ± 0.8 E-02	1.8 ± 0.2 E-02	3.2 ± 2.6 E-02	2.2 ± 1.5 E-02
	04	2.3 ± 0.8 E-02	2.1 ± 0.4 E-02	2.1 ± 0.6 E-02	2.2 ± 0.6 E-02
	05	1.6 ± 0.6 E-02	2.1 ± 0.1 E-02	1.6 ± 0.2 E-02	1.8 ± 0.4 E-02
	06	1.8 ± 0.7 E-02	2.9 ± 0.7 E-02	2.3 ± 1.0 E-02	2.3 ± 0.9 E-02
	07	1.7 ± 0.7 E-02	2.0 ± 0.3 E-02	1.9 ± 0.4 E-02	1.9 ± 0.5 E-02
	08	1.8 ± 0.7 E-02	2.5 ± 0.4 E-02	1.9 ± 0.4 E-02	2.0 ± 0.6 E-02
	09	1.8 ± 0.7 E-02	1.9 ± 0.3 E-02	1.8 ± 0.3 E-02	1.8 ± 0.4 E-02
	10	1.7 ± 0.6 E-02	2.1 ± 0.2 E-02	2.2 ± 0.3 E-02	2.0 ± 0.4 E-02
AVERAGE ALL STATIONS	01-10	1.8 ± 0.6 E-02	2.2 ± 0.4 E-02	2.1 ± 0.9 E-02	2.0 ± 0.7 E-02

34

 \bar{x} and sGrand \bar{x} and s

TABLE A-3

WEEKLY COLLECTIONS - THIRD QUARTER 1994
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE FILTERS
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 06/28-08/02	MONTHLY SUMMARY 08/02-08/30	MONTHLY SUMMARY 08/30-09/27	THIRD QUARTER SUMMARY 06/28-09/27
GROSS BETA	01	2.5 ± 0.4 E-02	2.4 ± 0.5 E-02	2.4 ± 0.7 E-02	2.4 ± 0.5 E-02
	02	2.2 ± 0.3 E-02	2.3 ± 0.4 E-02	2.1 ± 1.0 E-02	2.2 ± 0.6 E-02
	03	1.9 ± 0.2 E-02	2.4 ± 0.4 E-02	2.2 ± 0.7 E-02	2.1 ± 0.5 E-02
	04	2.4 ± 0.2 E-02	2.8 ± 0.2 E-02	2.6 ± 0.7 E-02	2.6 ± 0.4 E-02
	05	2.0 ± 0.7 E-02	2.4 ± 0.9 E-02	3.4 ± 1.3 E-02	2.6 ± 1.1 E-02
	06	2.9 ± 0.4 E-02	2.5 ± 0.4 E-02	2.5 ± 0.8 E-02	2.7 ± 0.5 E-02
	07	1.8 ± 1.0 E-02	2.3 ± 0.3 E-02	2.0 ± 0.6 E-02	2.0 ± 0.7 E-02
	08	2.0 ± 0.7 E-02	2.6 ± 0.4 E-02	2.3 ± 0.7 E-02	2.3 ± 0.6 E-02
	09	1.9 ± 0.7 E-02	2.6 ± 0.3 E-02	2.4 ± 0.9 E-02	2.3 ± 0.7 E-02
	10	2.4 ± 0.4 E-02	3.0 ± 0.4 E-02	2.8 ± 0.9 E-02	2.7 ± 0.6 E-02
AVERAGE ALL STATIONS	01-10	2.2 ± 0.6 E-02	2.5 ± 0.4 E-02	2.5 ± 0.8 E-02	2.4 ± 0.6 E-02

 \bar{x} and sGrand \bar{x} and s

TABLE A-4
 WEEKLY COLLECTIONS FOURTH QUARTER 1994
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE FILTERS
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 09/27-11/01	MONTHLY SUMMARY 11/01-11/29	MONTHLY SUMMARY 11/29-01/03	FOURTH QUARTER SUMMARY 09/27-01/03
GROSS BETA	01	$2.4 \pm 0.2 \text{ E-02}$	$2.6 \pm 0.5 \text{ E-02}$	$4.0 \pm 0.8 \text{ E-02}$	$3.1 \pm 0.9 \text{ E-02}$
	02	$2.4 \pm 0.6 \text{ E-02}$	$2.6 \pm 0.5 \text{ E-02}$	$3.7 \pm 1.0 \text{ E-02}$	$2.9 \pm 0.9 \text{ E-02}$
	03	$2.4 \pm 0.2 \text{ E-02}$	$2.5 \pm 0.3 \text{ E-02}$	$4.1 \pm 0.7 \text{ E-02}$	$3.0 \pm 0.9 \text{ E-02}$
	04	$3.0 \pm 0.6 \text{ E-02}$	$5.4 \pm 1.1 \text{ E-02}$	$8.9 \pm 1.2 \text{ E-02}$	$5.8 \pm 2.8 \text{ E-02}$
	05	$3.7 \pm 1.3 \text{ E-02}$	$3.0 \pm 0.6 \text{ E-02}$	$5.3 \pm 1.3 \text{ E-02}$	$4.0 \pm 1.5 \text{ E-02}$
	06	$2.1 \pm 0.6 \text{ E-02}$	$2.9 \pm 0.7 \text{ E-02}$	$4.5 \pm 1.8 \text{ E-02}$	$3.4 \pm 1.6 \text{ E-02}$
	07	$2.3 \pm 0.5 \text{ E-02}$	$2.5 \pm 0.5 \text{ E-02}$	$3.7 \pm 0.9 \text{ E-02}$	$2.9 \pm 0.9 \text{ E-02}$
	08	$2.8 \pm 0.8 \text{ E-02}$	$2.5 \pm 0.7 \text{ E-02}$	$4.0 \pm 1.0 \text{ E-02}$	$3.1 \pm 1.0 \text{ E-02}$
	09	$2.5 \pm 0.3 \text{ E-02}$	$2.7 \pm 0.4 \text{ E-02}$	$4.4 \pm 1.5 \text{ E-02}$	$3.2 \pm 1.3 \text{ E-02}$
	10	$2.7 \pm 0.9 \text{ E-02}$	$2.6 \pm 0.7 \text{ E-02}$	$3.8 \pm 1.0 \text{ E-02}$	$3.0 \pm 1.0 \text{ E-02}$
AVERAGE ALL STATIONS	01-10	$2.7 \pm 0.7 \text{ E-02}$	$2.9 \pm 1.0 \text{ E-02}$	$4.6 \pm 1.9 \text{ E-02}$	$3.4 \pm 1.6 \text{ E-02}$

\bar{x} and s

Grand \bar{x} and s

TABLE B-1
 WEEKLY COLLECTIONS FIRST QUARTER 1994
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE FILTERS
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 12/28-02/01	MONTHLY SUMMARY 02/01-03/01	MONTHLY SUMMARY 03/01-03/29	FIRST QUARTER SUMMARY 12/28-03/29
GROSS ALPHA	01	3.8 ± 0.7 E-03	2.8 ± 1.2 E-03	2.6 ± 0.3 E-03	3.8 ± 0.9 E-03
	02	3.0 ± 0.4 E-03	2.3 ± 0.4 E-03	1.7 ± 0.5 E-03	2.3 ± 0.7 E-03
	03	2.9 ± 0.7 E-03	3.1 ± 0.9 E-03	1.9 ± 0.9 E-03	2.7 ± 0.9 E-03
	04	4.7 ± 0.9 E-03	4.0 ± 1.3 E-03	3.3 ± 0.7 E-03	4.1 ± 1.1 E-03
	05	2.2 ± 0.9 E-03	2.3 ± 0.5 E-03	2.5 ± 0.2 E-03	2.4 ± 0.4 E-03
	06	2.8 ± 0.7 E-03	3.4 ± 0.9 E-03	1.4 ± 0.4 E-03	2.5 ± 1.1 E-03
	07	2.7 ± 0.3 E-03	2.3 ± 0.6 E-03	2.6 ± 0.8 E-03	2.6 ± 0.5 E-03
	08	2.6 ± 0.4 E-03	3.0 ± 1.3 E-03	2.5 ± 2.1 E-03	2.7 ± 1.3 E-03
	09	3.0 ± 0.6 E-03	2.6 ± 1.2 E-03	2.1 ± 0.8 E-03	2.6 ± 0.9 E-03
	10	3.7 ± 1.5 E-03	3.0 ± 0.5 E-03	3.3 ± 1.9 E-03	3.4 ± 1.4 E-03
AVERAGE ALL STATIONS	01-10	3.2 ± 1.0 E-03	2.9 ± 1.0 E-03	2.4 ± 1.1 E-03	2.8 ± 1.1 E-03

\bar{x} and s

Grand \bar{x} and s

TABLE B-2
WEEKLY COLLECTIONS SECOND QUARTER 1994

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

AIR PARTICULATE FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 03/29-05/03	MONTHLY SUMMARY 05/03-05/31	MONTHLY SUMMARY 05/31-06/28	SECOND QUARTER SUMMARY 03/29-06/28
GROSS ALPHA	01	2.0 ± 0.5 E-03	1.9 ± 1.4 E-03	1.8 ± 1.0 E-03	1.9 ± 0.9 E-03
	02	2.1 ± 1.2 E-03	1.6 ± 0.8 E-03	2.3 ± 1.7 E-03	2.0 ± 1.2 E-03
	03	2.2 ± 0.7 E-03	1.9 ± 0.4 E-03	3.3 ± 3.2 E-03	2.4 ± 1.8 E-03
	04	3.2 ± 2.0 E-03	1.7 ± 0.8 E-03	2.0 ± 0.8 E-03	2.4 ± 1.5 E-03
	05	2.5 ± 1.1 E-03	2.0 ± 0.9 E-03	1.3 ± 0.4 E-03	2.0 ± 1.0 E-03
	06	2.1 ± 0.7 E-03	2.7 ± 1.0 E-03	2.4 ± 1.3 E-03	2.4 ± 1.0 E-03
	07	2.2 ± 0.8 E-03	1.9 ± 1.1 E-03	1.8 ± 0.9 E-03	2.0 ± 0.9 E-03
	08	2.4 ± 1.2 E-03	1.8 ± 0.3 E-03	1.7 ± 0.7 E-03	2.0 ± 0.9 E-03
	09	2.5 ± 1.1 E-03	1.6 ± 0.7 E-03	1.7 ± 0.7 E-03	2.0 ± 0.9 E-03
	10	2.4 ± 1.1 E-03	1.8 ± 0.9 E-03	1.7 ± 1.0 E-03	2.0 ± 1.0 E-03
AVERAGE ALL STATIONS	01-10	2.3 ± 1.1 E-03	1.9 ± 0.8 E-03	2.0 ± 1.4 E-03	2.1 ± 1.1 E-03

\bar{x} and s

Grand \bar{x} and s

TABLE B-3

WEEKLY COLLECTIONS - THIRD QUARTER 1994

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

AIR PARTICULATE FILTERS

/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 06/28-08/02	MONTHLY SUMMARY 08/02-08/30	MONTHLY SUMMARY 08/30-09/27	THIRD QUARTER SUMMARY 06/28-09/27
GROSS ALPHA	01	1.7 ± 0.5 E-03	2.3 ± 0.4 E-03	1.7 ± 0.7 E-03	1.9 ± 0.6 E-03
	02	2.3 ± 1.0 E-03	2.2 ± 0.5 E-03	1.8 ± 1.0 E-03	2.1 ± 0.8 E-03
	03	1.8 ± 0.7 E-03	2.1 ± 0.4 E-03	1.9 ± 0.8 E-03	2.0 ± 0.6 E-03
	04	1.9 ± 0.6 E-03	2.6 ± 0.4 E-03	2.0 ± 1.2 E-03	2.2 ± 0.8 E-03
	05	2.2 ± 0.8 E-03	2.0 ± 0.5 E-03	2.1 ± 1.0 E-03	2.1 ± 0.7 E-03
	06	2.0 ± 0.6 E-03	1.9 ± 0.9 E-03	1.5 ± 0.5 E-03	1.8 ± 0.6 E-03
	07	1.9 ± 0.7 E-03	2.2 ± 0.2 E-03	2.0 ± 0.8 E-03	2.0 ± 0.6 E-03
	08	1.8 ± 0.2 E-03	2.3 ± 0.7 E-03	1.7 ± 0.9 E-03	2.0 ± 0.7 E-03
	09	1.6 ± 0.9 E-03	2.4 ± 0.6 E-03	1.8 ± 0.6 E-03	1.9 ± 0.7 E-03
	10	2.0 ± 0.6 E-03	2.9 ± 1.3 E-03	2.0 ± 0.9 E-03	2.3 ± 1.0 E-03
AVERAGE ALL STATIONS	01-10	1.9 ± 0.7 E-03	2.3 ± 0.6 E-03	1.8 ± 0.8 E-03	2.0 ± 0.7 E-03

 \bar{x} and sGrand \bar{x} and s

TABLE B-4
WEEKLY COLLECTIONS FOURTH QUARTER 1994

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

AIR PARTICULATE FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 09/27-11/01	MONTHLY SUMMARY 11/01-11/29	MONTHLY SUMMARY 11/29-01/03	FOURTH QUARTER SUMMARY 09/27-01/03
GROSS ALPHA	01	1.8 ± 0.7 E-03	2.0 ± 0.7 E-03	2.6 ± 0.7 E-03	2.2 ± 0.7 E-03
	02	1.8 ± 0.7 E-03	2.0 ± 0.8 E-03	2.5 ± 0.5 E-03	2.1 ± 0.7 E-03
	03	1.7 ± 0.5 E-02	2.0 ± 0.7 E-03	3.2 ± 1.2 E-03	2.3 ± 1.1 E-03
	04	1.5 ± 0.5 E-02	3.9 ± 1.6 E-03	5.0 ± 1.5 E-03	3.4 ± 2.0 E-03
	05	2.1 ± 0.8 E-02	2.3 ± 0.3 E-02	3.6 ± 0.9 E-03	2.7 ± 1.0 E-02
	06	1.7 ± 0.5 E-02	2.3 ± 1.2 E-03	3.4 ± 1.6 E-03	2.6 ± 1.4 E-03
	07	2.4 ± 1.0 E-03	2.2 ± 0.5 E-03	2.2 ± 0.6 E-03	2.3 ± 0.7 E-03
	08	1.5 ± 0.6 E-03	1.5 ± 0.4 E-03	2.3 ± 1.3 E-03	1.8 ± 0.9 E-03
	09	2.1 ± 0.4 E-03	1.4 ± 0.6 E-03	3.2 ± 1.5 E-03	2.3 ± 1.2 E-03
	10	1.9 ± 0.7 E-03	1.8 ± 1.2 E-03	2.3 ± 0.5 E-03	2.0 ± 0.8 E-03
AVERAGE ALL STATIONS	01-10	1.9 ± 0.7 E-03	2.1 ± 1.0 E-03	3.0 ± 1.3 E-03	2.4 ± 1.1 E-03

\bar{x} and s

Grand \bar{x} and s

C. AIR RADIOIODINE - CHARCOAL FILTERS (See Tables C-1 through C-4)

STATIONS 01 TO 10

Charcoal filters used in series with air particulate filters were collected weekly during 1994 at stations 01 through 10 and monitored for radioiodine.

Tables C-1 through C-4 show the average monthly and quarterly results for each station and the average of all 10 stations. Airborne I-131 levels were below the limits of detection for all of 1994.

Figure C-1 plots the results of I-131 as monitored in charcoal filters and summarized monthly in 1994 compared with previous years. Results for 1994 were below the normal limits of detection indicating no atmospheric effect from the operations of CNS.

FIGURE C-1
AIRBORNE I-131
MONTHLY AVERAGE - ALL LOCATIONS

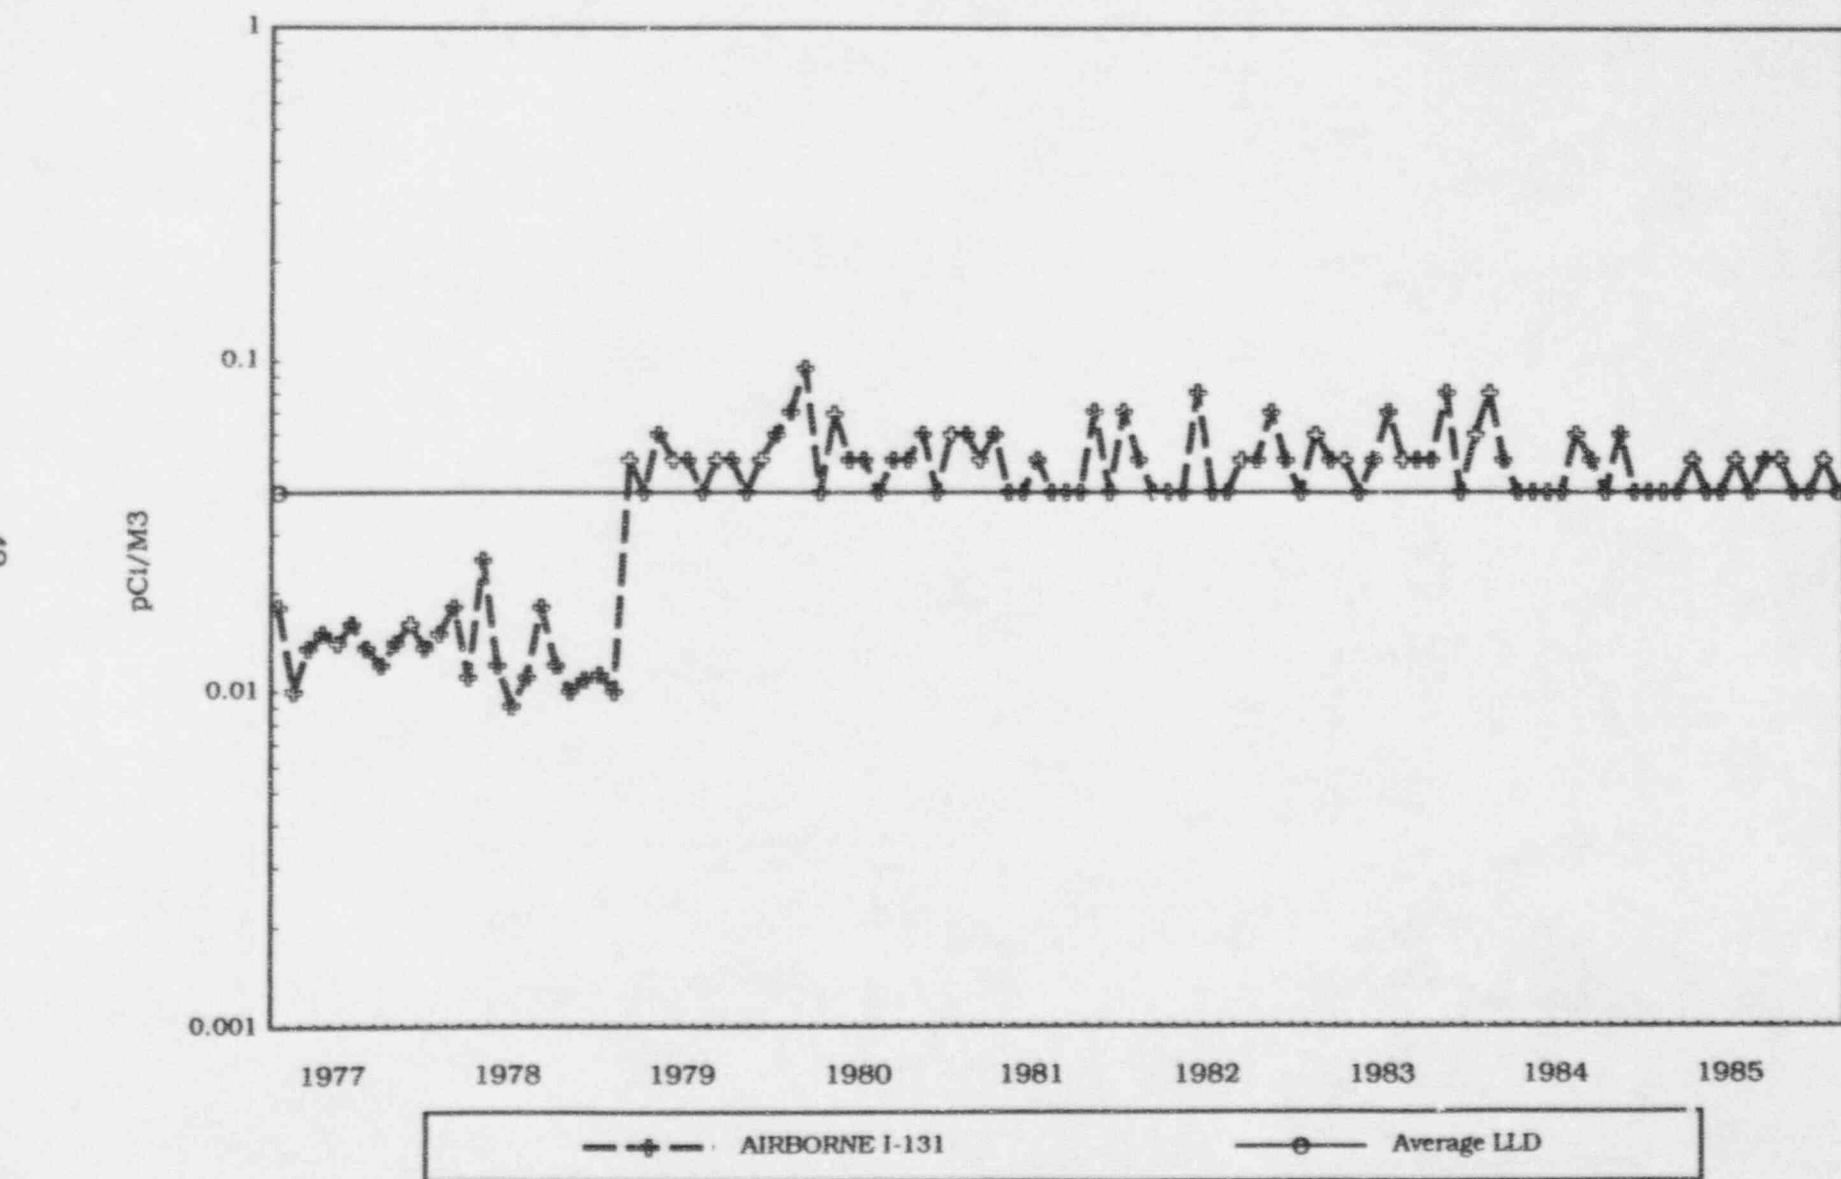


FIGURE C-1
AIRBORNE I-131
MONTHLY AVERAGE - ALL LOCATIONS

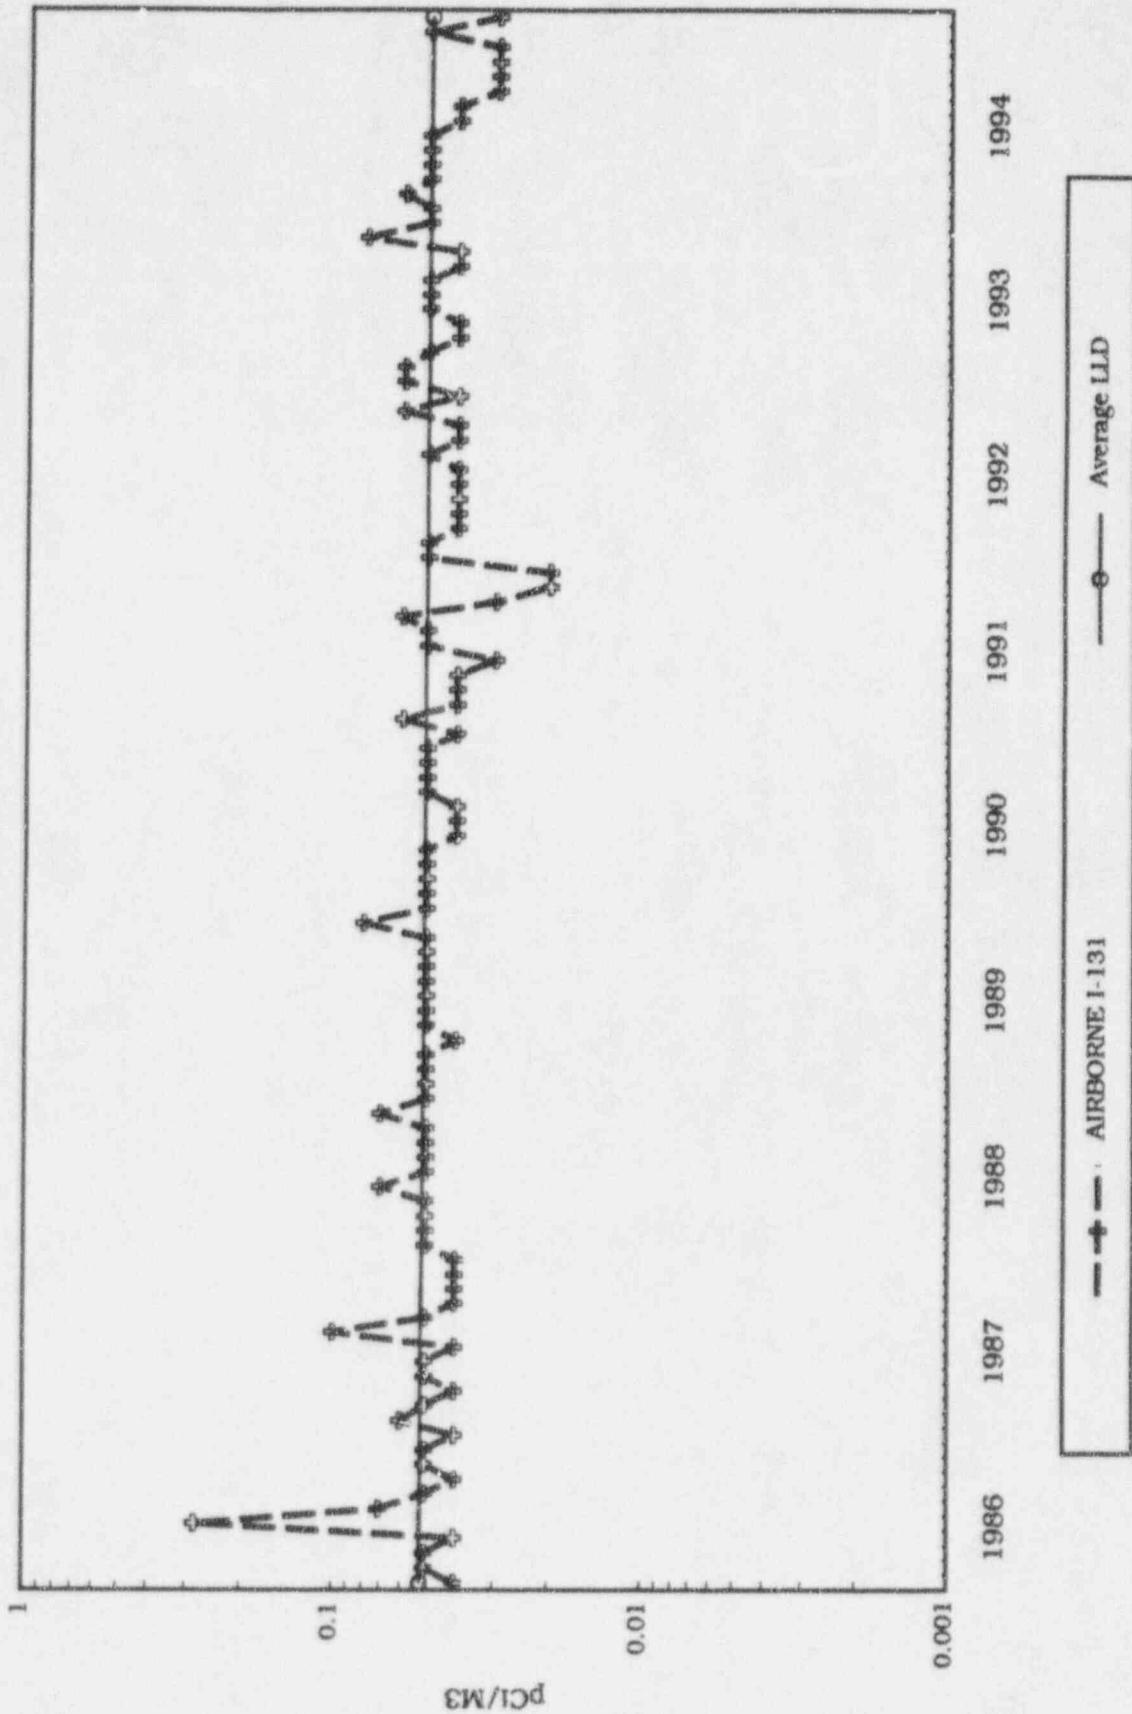


TABLE C-1
 WEEKLY COLLECTIONS FIRST QUARTER 1994
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 CHARCOAL FILTERS
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 12/28-02/01	MONTHLY SUMMARY 02/01-03/01	MONTHLY SUMMARY 03/01-03/29	QUARTERLY SUMMARY 12/28-03/29	DET./ TOTAL	RANGE
IODINE-131	01	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	02	L.T. 5. E-02	L.T. 4. E-02	L.T. 3. E-02	L.T. 5. E-02	0/12	(L.T.1.-L.T.5.)E-02
	03	L.T. 5. E-02	L.T. 4. E-02	L.T. 3. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	04	L.T. 5. E-02	L.T. 5. E-02	L.T. 4. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	05	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	0/10	(L.T.1.-L.T.2.)E-02
	06	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	L.T. 5. E-02	0/13	(L.T.1.-L.T.5.)E-02
	07	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	L.T. 5. E-02	0/13	(L.T.1.-L.T.5.)E-02
	08	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	09	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	10	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	0/13	(L.T.1.-L.T.4.)E-02
	01-10	L.T. 5. E-02	L.T. 5. E-02	L.T. 5. E-02	L.T. 5. E-02	--	--
DET./TOTAL		0/46	0/40	0/40	0/126	0/126	--
RANGE		(L.T.1.-L.T.5.)E-02	(L.T.1.-L.T.5.)E-02	(L.T.1.-L.T.5.)E-02	(L.T.1.-L.T.5.)E-02	--	(L.T.1.-L.T.5.)E-02

TABLE C-2
 WEEKLY COLLECTIONS SECOND QUARTER 1993
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 CHARCOAL FILTERS
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 03/29-05/03	MONTHLY SUMMARY 05/03-05/31	MONTHLY SUMMARY 05/31-06/28	QUARTERLY SUMMARY 03/29-06/28	DET./ TOTAL	RANGE
IODINE-131	01	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	0/13	(L.T.2.-L.T.4.)E-02
	02	L.T. 4 E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 4 E-02	0/13	(L.T.2.-L.T.4.)E-02
	03	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	0/13	(L.T.2.-L.T.4.)E-02
	04	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	0/12	(L.T.2.-L.T.4.)E-02
	05	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	0/13	(L.T.1.-L.T.3.)E-02
	06	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	07	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	08	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	09	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	10	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	0/13	(L.T.1.-L.T.3.)E-02
	01-10	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	--	
DET./TOTAL		0/50	0/40	0/39	0/129	0/129	--
RANGE		(L.T.1.-L.T.5.)E-02	(L.T.1.-L.T.4.)E-02	(L.T.1.-L.T.4.)E-02	(L.T.1.-L.T.5.)E-02	--	(L.T.1.-L.T.5.)E-02

TABLE C-3
 WEEKLY COLLECTIONS THIRD QUARTER 1994
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 CHARCOAL FILTERS
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 06/28-08/02		MONTHLY SUMMARY 08/02-08/30		MONTHLY SUMMARY 08/30-09/27		QUARTERLY SUMMARY 06/28-09/27		DET./ TOTAL	RANGE
IODINE-131	01	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/13 (L.T.1.-L.T.3.)E-02
	02	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/13 (L.T.1.-L.T.3.)E-02
	03	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/13 (L.T.1.-L.T.3.)E-02
	04	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/13 (L.T.1.-L.T.3.)E-02
	05	L.T.	2.	E-02	L.T.	2.	E-02	L.T.	2.	E-02	0/12 (L.T.1.-L.T.2.)E-02
	06	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/11 (L.T.2.-L.T.3.)E-02
	07	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/13 (L.T.2.-L.T.3.)E-02
	08	L.T.	2.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/11 (L.T.2.-L.T.3.)E-02
	09	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/12 (L.T.2.-L.T.3.)E-02
	10	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	2.	E-02	0/13 (L.T.1.-L.T.3.)E-02
01-10		L.T.	3.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	--
DET./TOTAL		0/46		0/38		0/40		0/124		--	
RANGE		(L.T.1.-L.T.3.)E-02		(L.T.1.-L.T.3.)E-02		(L.T.1.-L.T.3.)E-02		(L.T.1.-L.T.3.)E-02		-- (L.T.1.-L.T.3.)E-02	

TABLE C-4
 WEEKLY COLLECTIONS FOURTH QUARTER 1994
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 CHARCOAL FILTERS
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 09/27-11/01		MONTHLY SUMMARY 11/01-11/29		MONTHLY SUMMARY 11/29-01/03		QUARTERLY SUMMARY 09/27-01/03		DET./ TOTAL	RANGE
IODINE-131	01	L.T.	3.	E-02	L.T.	5.	E-02	L.T.	3.	E-02	L.T.1.-L.T.5.)E-02
	02	L.T.	3	E-02	L.T.	4.	E-02	L.T.	3.	E-02	(L.T.1.-L.T.4.)E-02
	03	L.T.	3	E-02	L.T.	5.	E-02	L.T.	3.	E-02	(L.T.1.-L.T.5.)E-02
	04	L.T.	3	E-02	L.T.	4.	E-02	L.T.	3.	E-02	(L.T.1.-L.T.4.)E-02
	05	L.T.	2	E-02	L.T.	2	E-02	L.T.	2	E-02	(L.T.1.-L.T.2.)E-02
	06	L.T.	3	E-02	L.T.	3.	E-02	L.T.	2.	E-02	(L.T.1.-L.T.3.)E-02
	07	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	2.	E-02	(L.T.1.-L.T.3.)E-02
	08	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	2.	E-02	(L.T.1.-L.T.3.)E-02
	09	L.T.	3.	E-02	L.T.	3.	E-02	L.T.	2.	E-02	(L.T.1.-L.T.3.)E-02
	10	L.T.	2.	E-02	L.T.	2.	E-02	L.T.	2.	E-02	(L.T.1.-L.T.2.)E-02
01-10		L.T.	3.	E-02	L.T.	5.	E-02	L.T.	3.	E-02	0/138
DET./TOTAL		0/48		0/40		0/50		0/138			
RANGE		(L.T.1.-L.T.3.)E-02		(L.T.1.-L.T.5.)E-02		(L.T.1.-L.T.3.)E-02		(L.T.1.-L.T.5.)E-02		--	(L.T.1.-L.T.5.)E-02

D. COMPOSITES OF AIR PARTICULATE FILTERS - GAMMA

(See Tables D-1 and D-2)

STATIONS 01 TO 10

Air Particulate Filters, which were collected weekly, were composited for each station for a quarterly gamma spectral analysis during the four quarters of 1994.

Beryllium-7, a naturally occurring cosmogenic nuclide, was detected in 40 of 40 samples at a level of 0.14 pCi per cubic meter which is similar to the levels of past years. Potassium-40, also a naturally occurring nuclide, was detected in five of 40 samples at a level near the normal level of detection.

Figure D-1 graphs the gross beta, gross alpha and Ce-144 activity as measured on air particulate filters collected weekly at CNS. (This is the same as Figure A-1, B-1). The plot illustrates that there were no detections of Ce-144 above the normal level of detection as measured by the quarterly gamma scan of samples from CNS.

Figure D-2 shows that measurements of Ce-144 are no longer reported by the Environmental Measurements Laboratory of the US Department of Energy because the artificial nuclides such as Ce-144, have reached the limits of detection by the analytical techniques now used.

FIGURE D-1
AIR PARTICULATES - CNS
ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS
CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

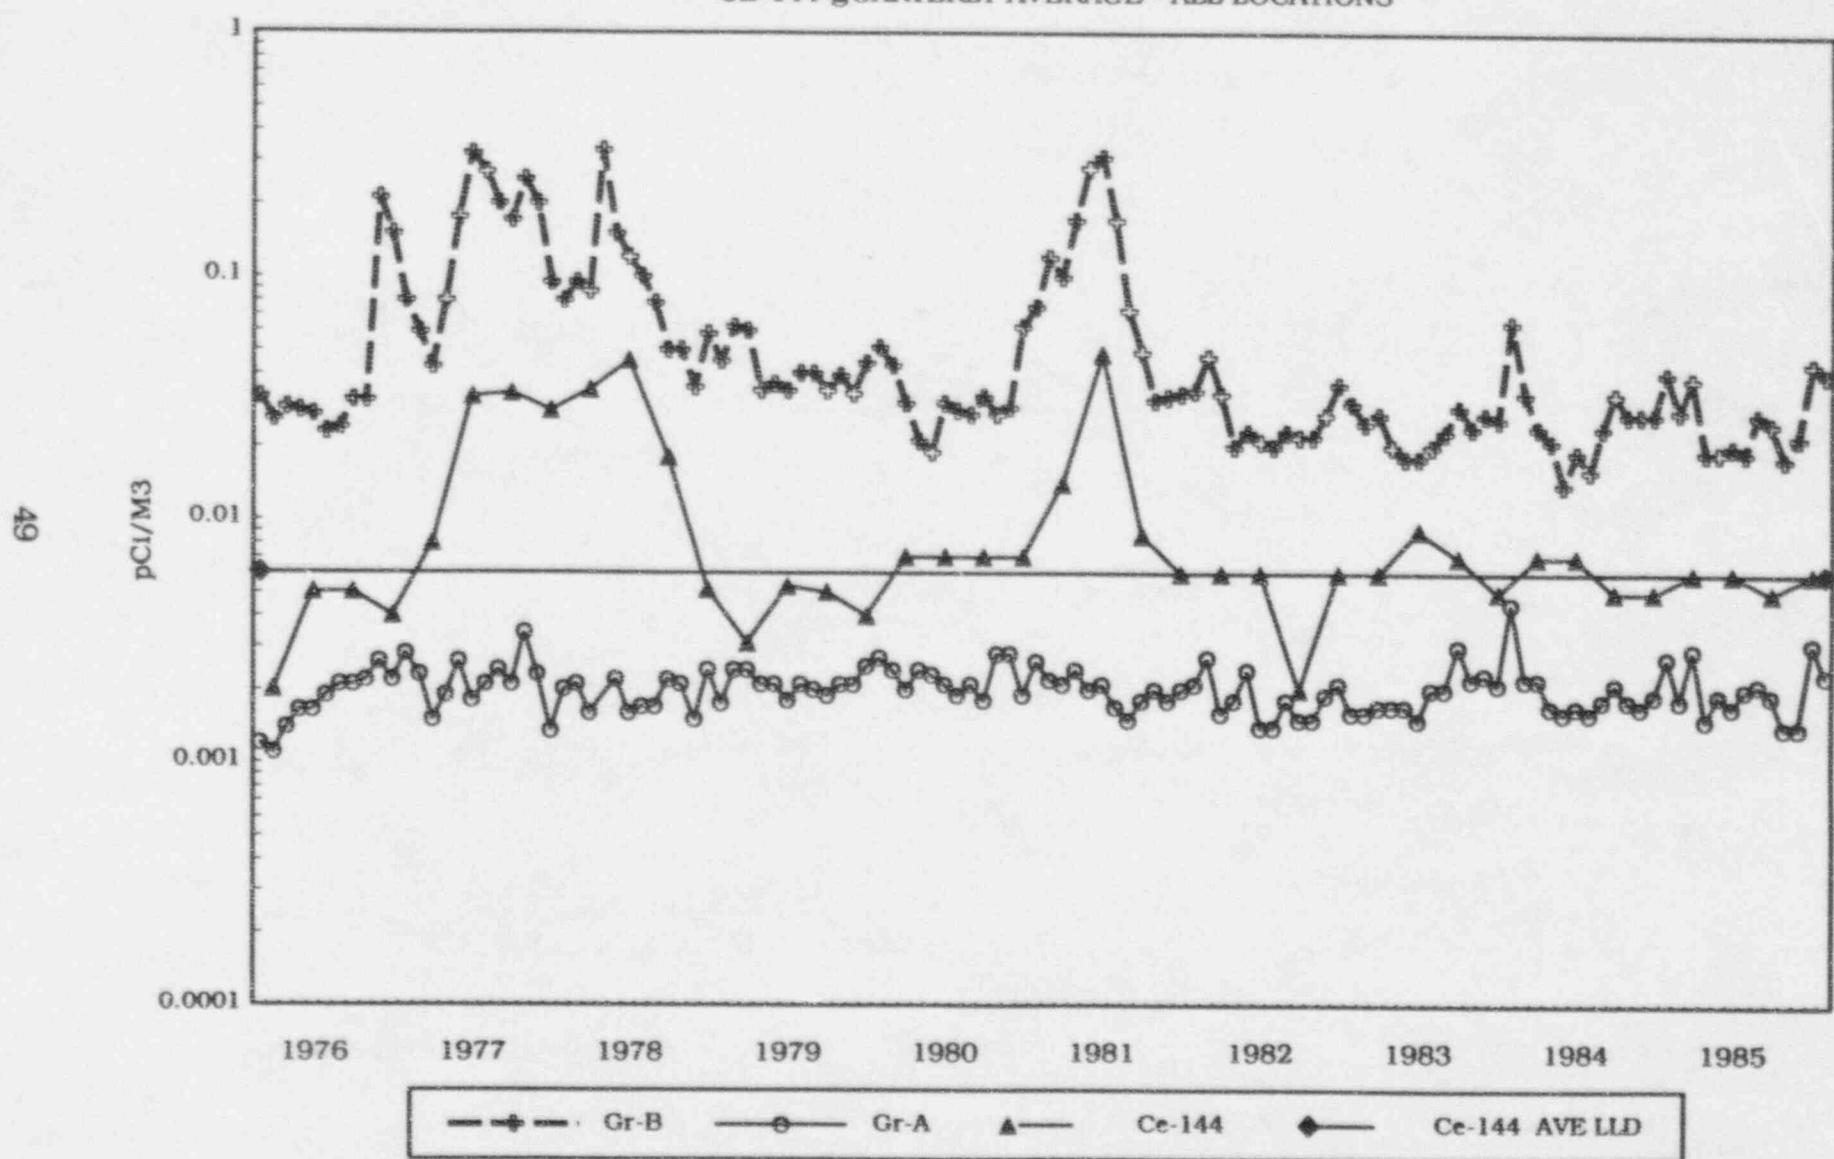


FIGURE D-1
AIR PARTICULATES - CNS
ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS
CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

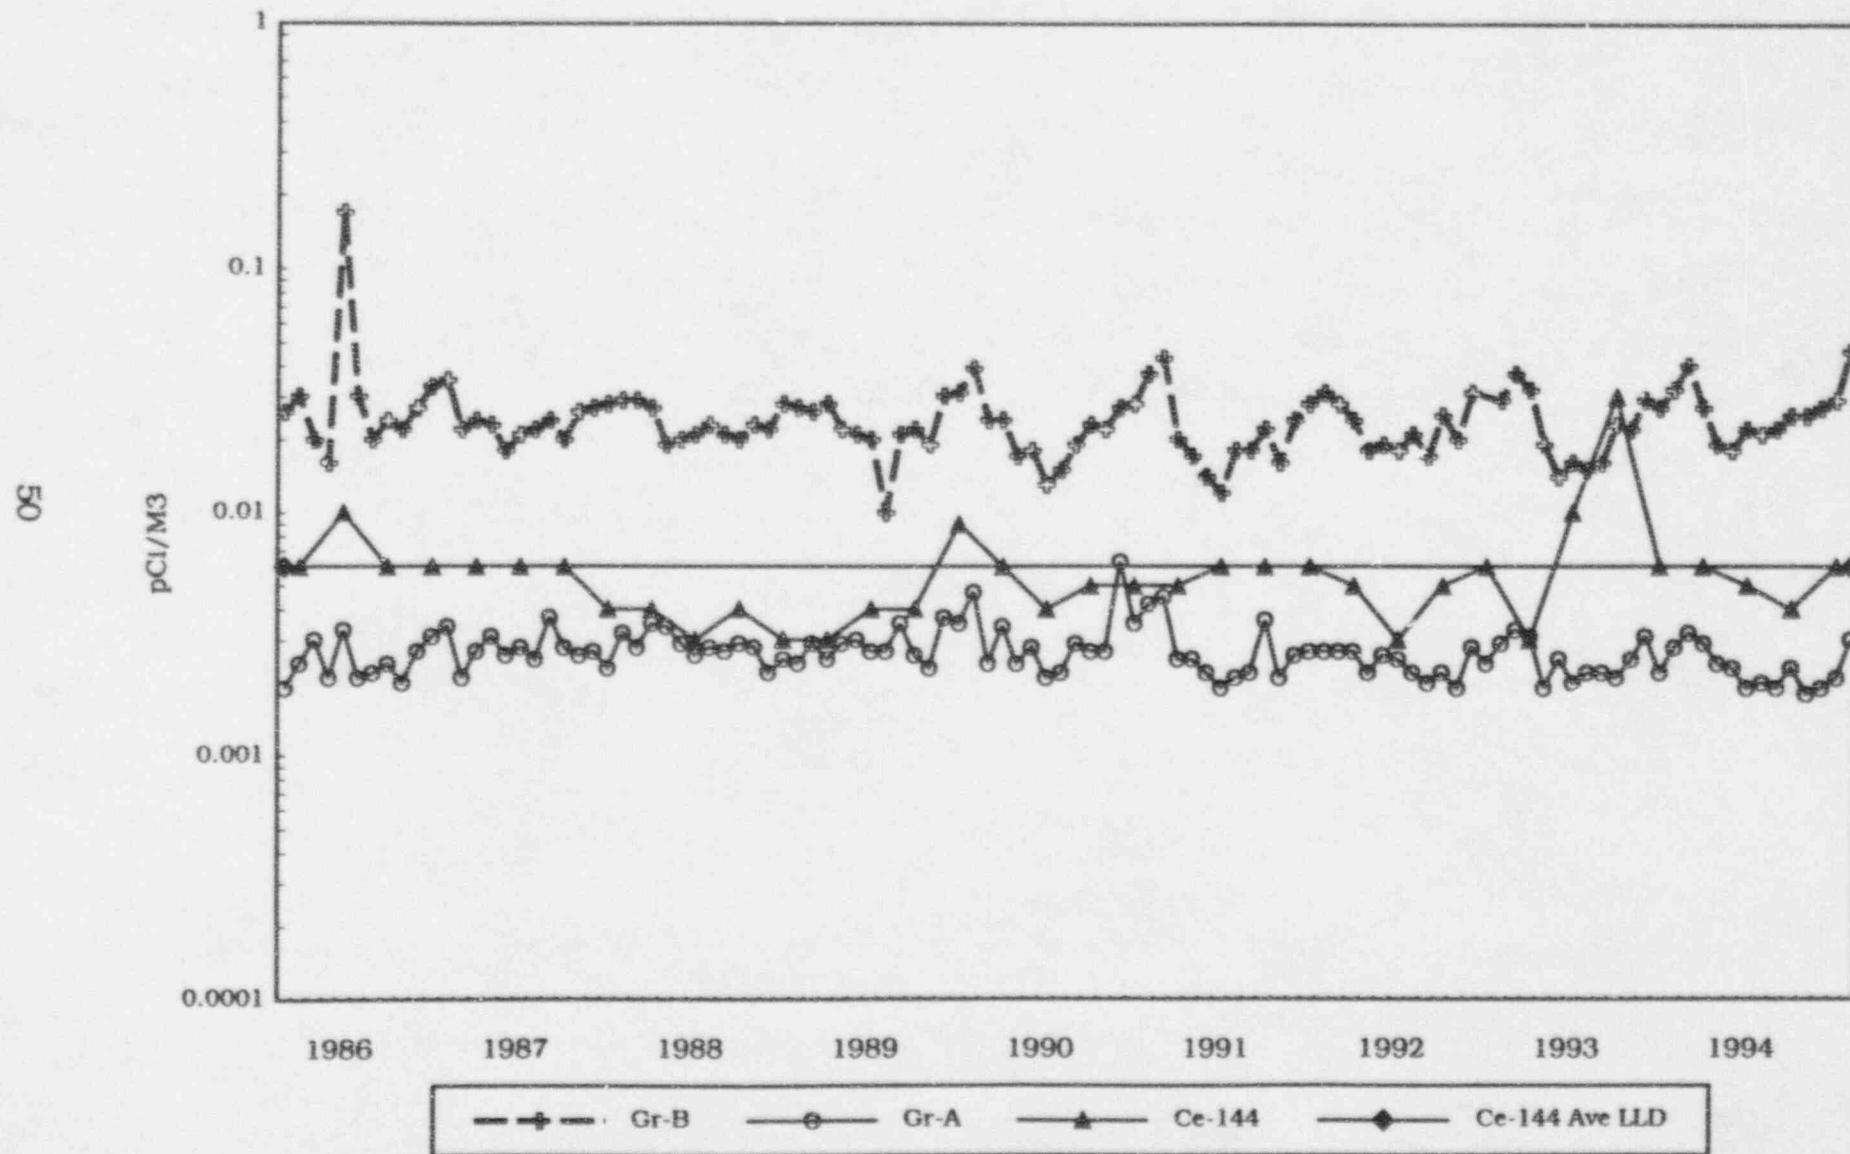


FIGURE D-2
AIR PARTICULATES
BETA MONTHLY AVERAGE - JEFFERSON CITY
MISSOURI ERAMS EPA

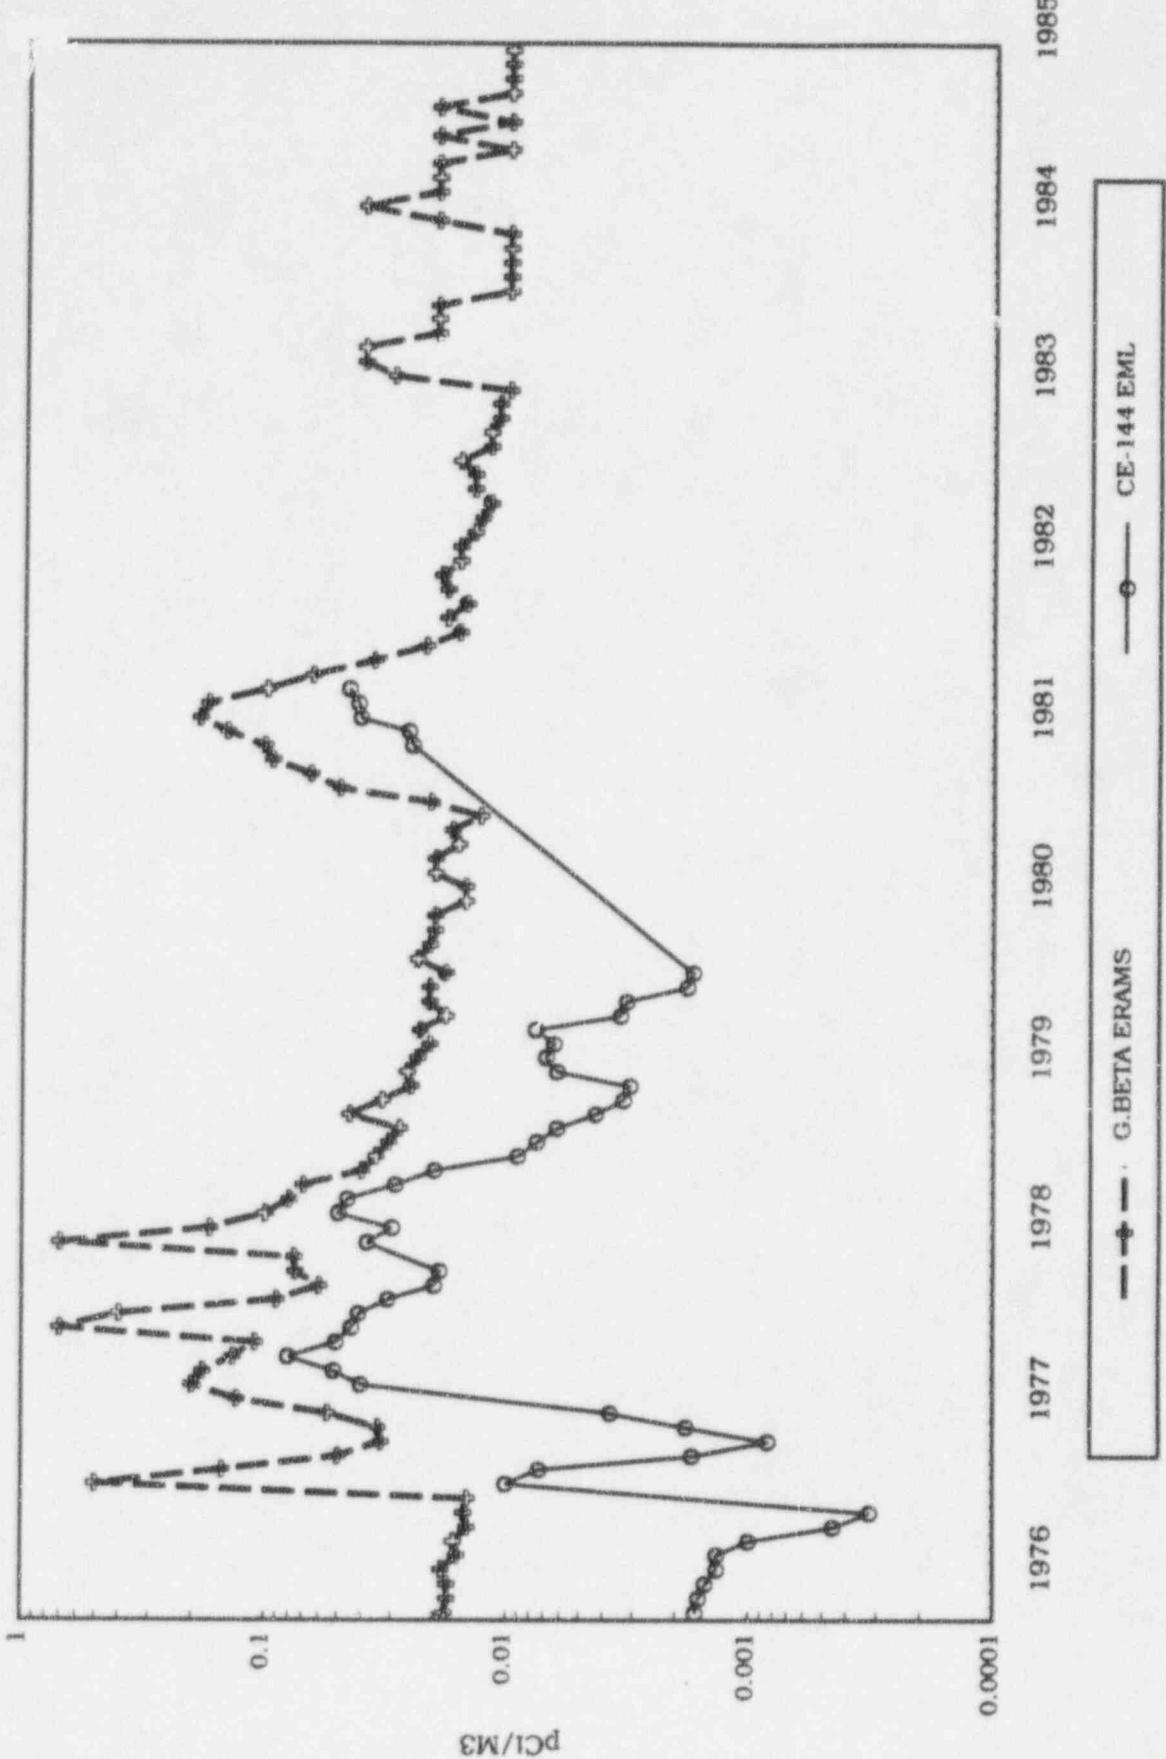


FIGURE D-2
AIR PARTICULATES
BETA MONTHLY AVERAGE - JEFFERSON CITY
MISSOURI ERAMS EPA

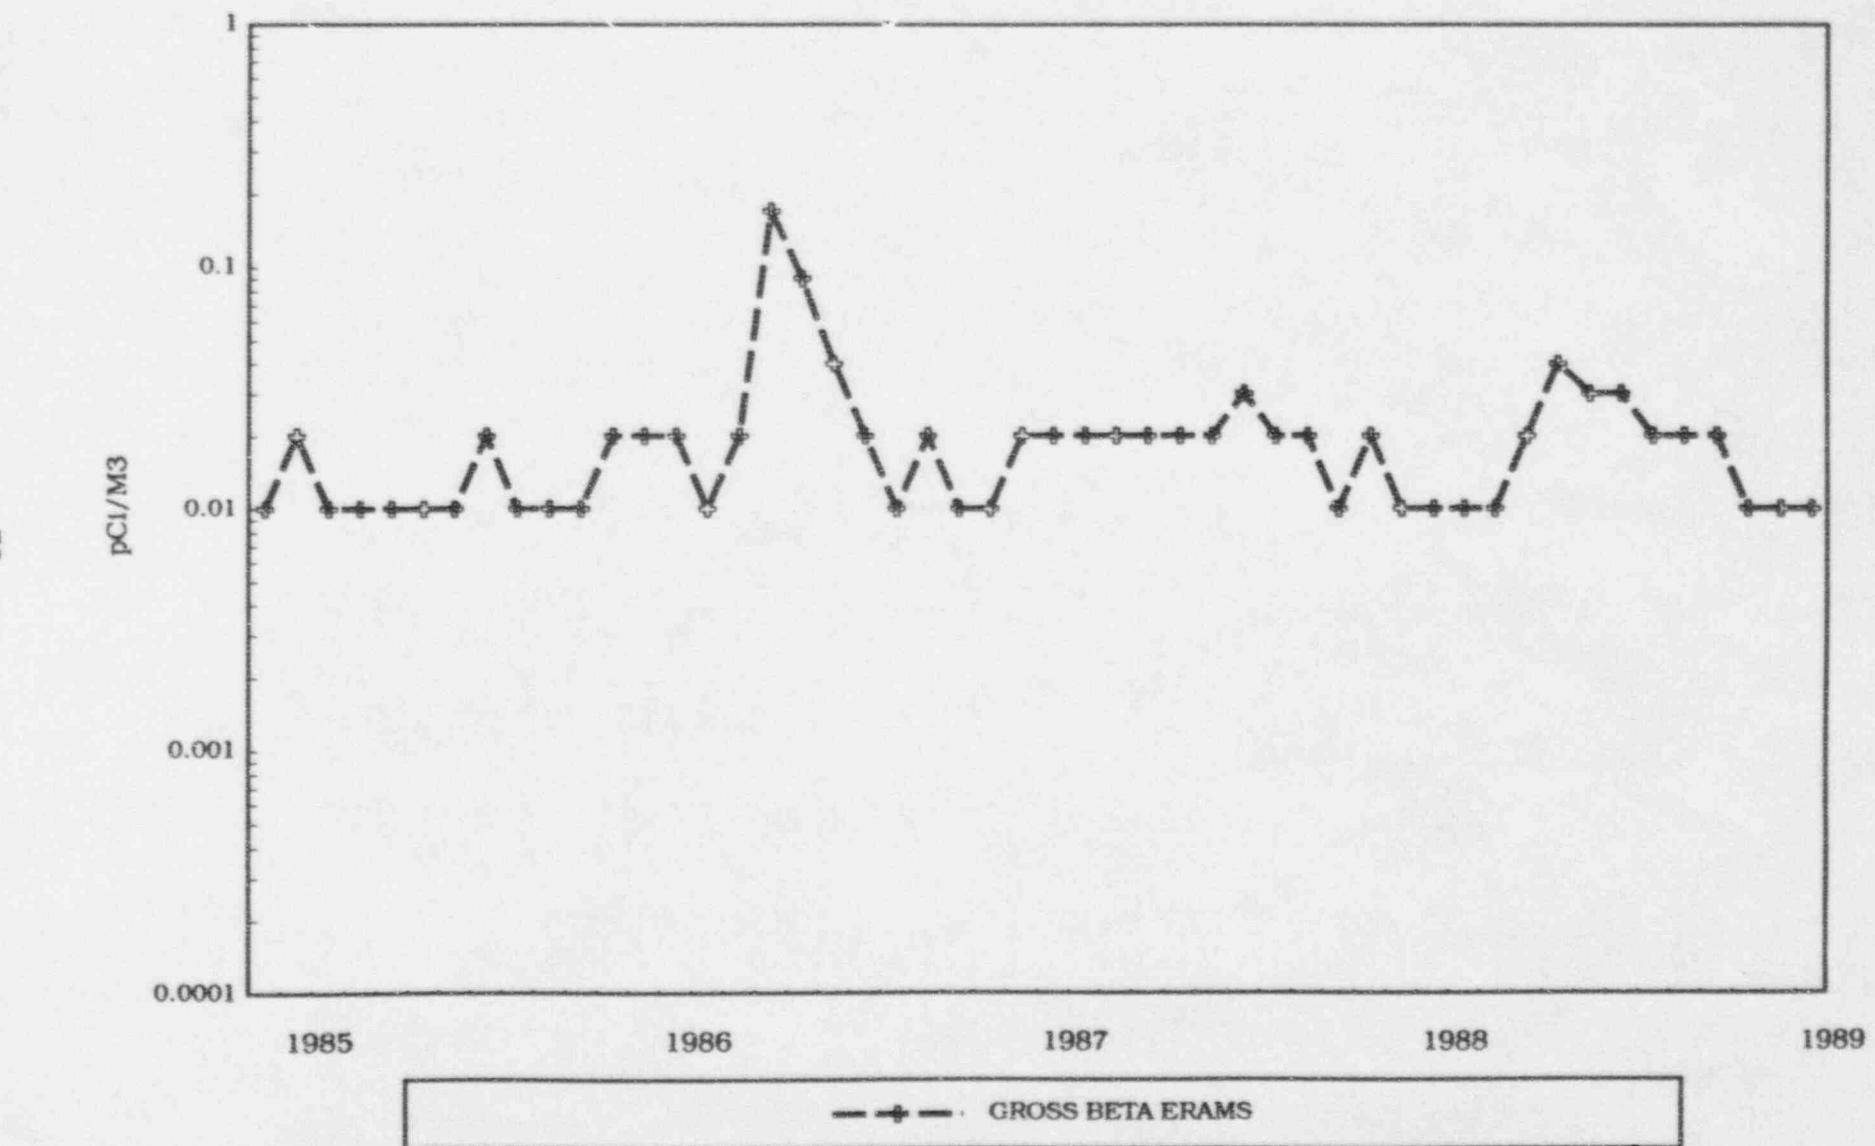


TABLE D-1
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - AIRBORNE
COMPOSITE OF WEEKLY AIR PARTICULATE FILTERS
pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 12/28-03/29	SECOND QUARTER 03/29-06/28	THIRD QUARTER 06/28-09/27	FOURTH QUARTER 09/27-01/03
BE-7	01-10	Mean/std.dev. det./total range	1.42 ± 0.3 E-01 10/10 (1.21-2.07)E-01	1.65 ± 0.2 E-01 10/10 (1.32-2.01)E-01	1.34 ± 0.09E-01 10/10 (1.10-1.70)E-01	1.12 ± 0.29E-01 10/10 (0.86-1.85)E-01
K-40	01-10	Mean/std.dev. det./total range	4.38 ± 5.41E-02 2/10 (0.56-8.21)E-02	L.T. 2. E-02 0/10 --	3.81 ± 0.59E-02 1/10 --	2.53±1.06E-02 2/10 (1.78±3.28)E-02
I-131 (by gamma spectroscopy)	01-10	Mean/std.dev. det./total range	L.T. 2. E-01 0/10 --	L.T. 1. E-01 0/10 --	L.T. 6. E-02 0/10 --	L.T. 2. E-01 0/10 --
Cs-134	01-10	Mean/std.dev. det./total range	L.T. 7. E-04 0/10 --	L.T. 7. E-04 0/10 --	L.T. 7. E-04 0/10 --	L.T. 8. E-04 0/10 --
Cs-137	01-10	Mean/std.dev. det./total range	L.T. 8. E-04 0/10 --	L.T. 6. E-04 0/10 --	L.T. 7. E-04 0/10 --	L.T. 8. E-04 0/10 --
Ra-226	01-10	Mean/std.dev. det./total range	L.T. 1. E-02 0/10 --	L.T. 1. E-02 0/10 --	L.T. 1. E-02 0/10 --	L.T. 1. E-02 0/10 --
Th-228	01-10	Mean/std.dev. det./total range	L.T. 1. E-03 0/10 --	L.T. 1. E-03 0/10 --	L.T. 1. E-03 0/10 --	L.T. 1. E-03 0/10 --

TABLE D-2
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - AIRBORNE
COMPOSITE OF WEEKLY AIR PARTICULATE FILTERS - PCI/CU.M.

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 12/28-03/29	SECOND QUARTER 03/29-06/28	THIRD QUARTER 06/28-09/27	FOURTH QUARTER 09/27-01/03
Be-7	1-10	1.42 ± 0.3 E-01(10/10)	1.65 ± 0.2 E-01(10/10)	1.34 ± 0.09E-01(10/10)	1.12 ± 0.29E-01(10/10)
K-40	1-10	4.38 ± 5.41E-02(2/10)	L.T. 2. E-02 (0/10)	3.81 ± 0.59E-02(1/10)	2.53 ± 1.06E-02 (2/10)
Mn-54	1-10	L.T. 7. E-04 (0/10)	L.T. 6. E-04 (0/10)	L.T. 7. E-04 (0/10)	L.T. 7. E-04 (0/10)
Co-58	1-10	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 9. E-04 (0/10)	L.T. 1. E-03 (0/10)
Fe-59	1-10	L.T. 4. E-03 (0/10)	L.T. 3. E-03 (0/10)	L.T. 3. E-03 (0/10)	L.T. 4. E-03 (0/10)
Co-60	1-10	L.T. 7. E-04 (0/10)	L.T. 6. E-04 (0/10)	L.T. 8. E-04 (0/10)	L.T. 7. E-04 (0/10)
Zn-65	1-10	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)
Zr-95	1-10	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)
Ru-103	1-10	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 2. E-03 (0/10)
Ru-106	1-10	L.T. 6. E-03 (0/10)	L.T. 6. E-03 (0/10)	L.T. 5. E-03 (0/10)	L.T. 6. E-03 (0/10)
I-131	1-10	L.T. 2. E-01 (0/10)	L.T. 1. E-01 (0/10)	L.T. 6. E-02 (0/10)	L.T. 2. E-01 (0/10)
Cs-134	1-10	L.T. 7. E-04 (0/10)	L.T. 7. E-04 (0/10)	L.T. 7. E-04 (0/10)	L.T. 8. E-04 (0/10)
Cs-137	1-10	L.T. 8. E-04 (0/10)	L.T. 6. E-04 (0/10)	L.T. 7. E-04 (0/10)	L.T. 8. E-04 (0/10)
Ba-140	1-10	L.T. 3. E-02 (0/10)	L.T. 2. E-02 (0/10)	L.T. 1. E-02 (0/10)	L.T. 3. E-02 (0/10)
Ce-141	1-10	L.T. 5. E-03 (0/10)	L.T. 4. E-03 (0/10)	L.T. 3. E-03 (0/10)	L.T. 4. E-03 (0/10)
Ce-144	1-10	L.T. 6. E-03 (0/10)	L.T. 5. E-03 (0/10)	L.T. 4. E-03 (0/10)	L.T. 6. E-03 (0/10)
Ra-226	1-10	L.T. 1. E-02 (0/10)	L.T. 1. E-02 (0/10)	L.T. 1. E-02 (0/10)	L.T. 1. E-02 (0/10)
Th-228	1-10	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)

E. FISH (See Tables E-1, E-2)

STATIONS 28, 35

Fish samples were collected during the summer and fall at the above stations and analyzed for gross beta, Sr-89, Sr-90, and gamma emitting isotopes. An attempt was made to collect a middle-top feeding fish (carp) and a bottom feeding fish (catfish). Both types of fish were collected during the summer and fall sampling periods.

The gross beta and Sr-90 activities were similar to the levels of previous years. Strontium-90 was detected in eight of ten samples at a level of 0.0140 pCi/gram, wet, which is below the normal level of detection. There were no detections of Sr-89. Naturally occurring K-40 was detected in all samples at an average level of 2.80 pCi/gm, wet.

There were no detections of Cs-137 during 1994.

Plotted in Figure E-1 are the radionuclides gross beta, K-40, Sr-90 and Cs-137 monitored in fish samples which show no appreciable change from 1977 through 1994. The plot of the nuclides shows that most of the gross beta activity is due to the terrestrial nuclide K-40.

FIGURE E-1
FISH

SEMIANNUAL AVERAGE - ALL LOCATIONS

GR-B K-40 SR-90 CS-137

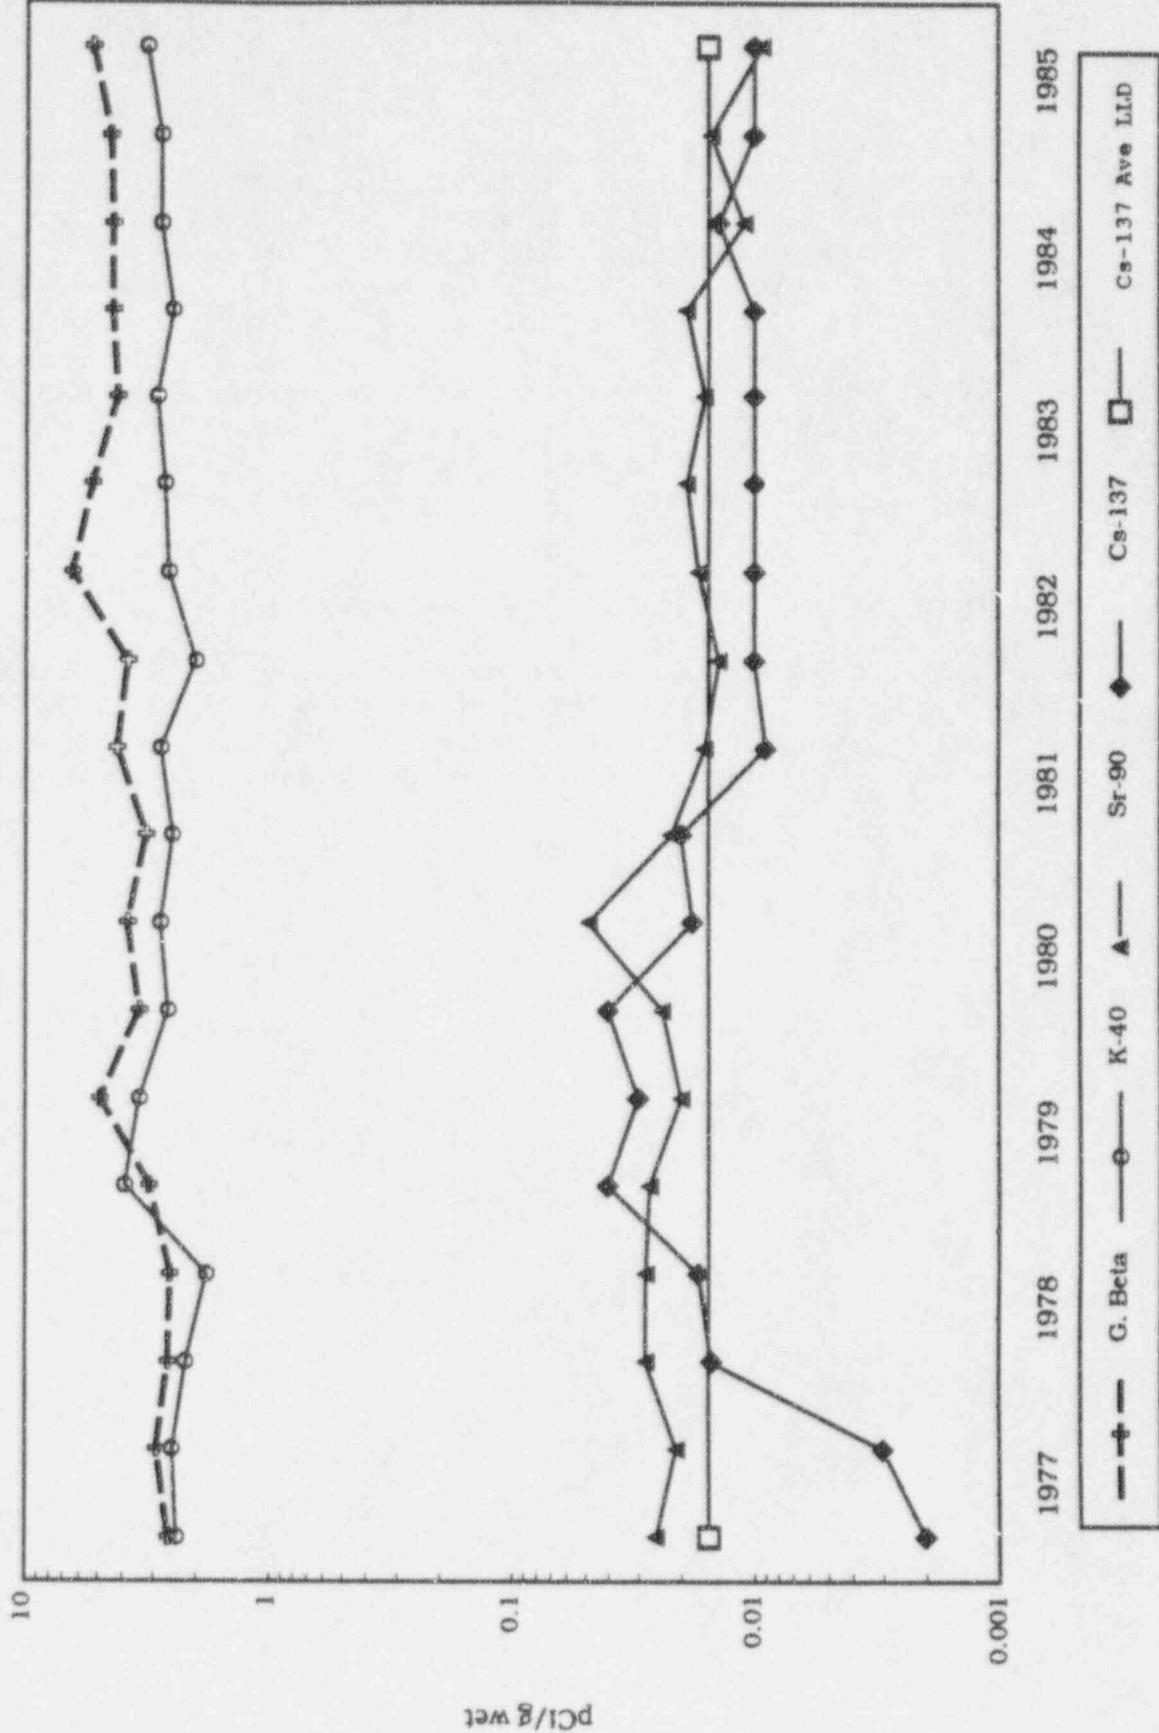


FIGURE E-1

FISH

SEMIANNUAL AVERAGE - ALL LOCATIONS
GR-B K-40 SR-90 CS-137

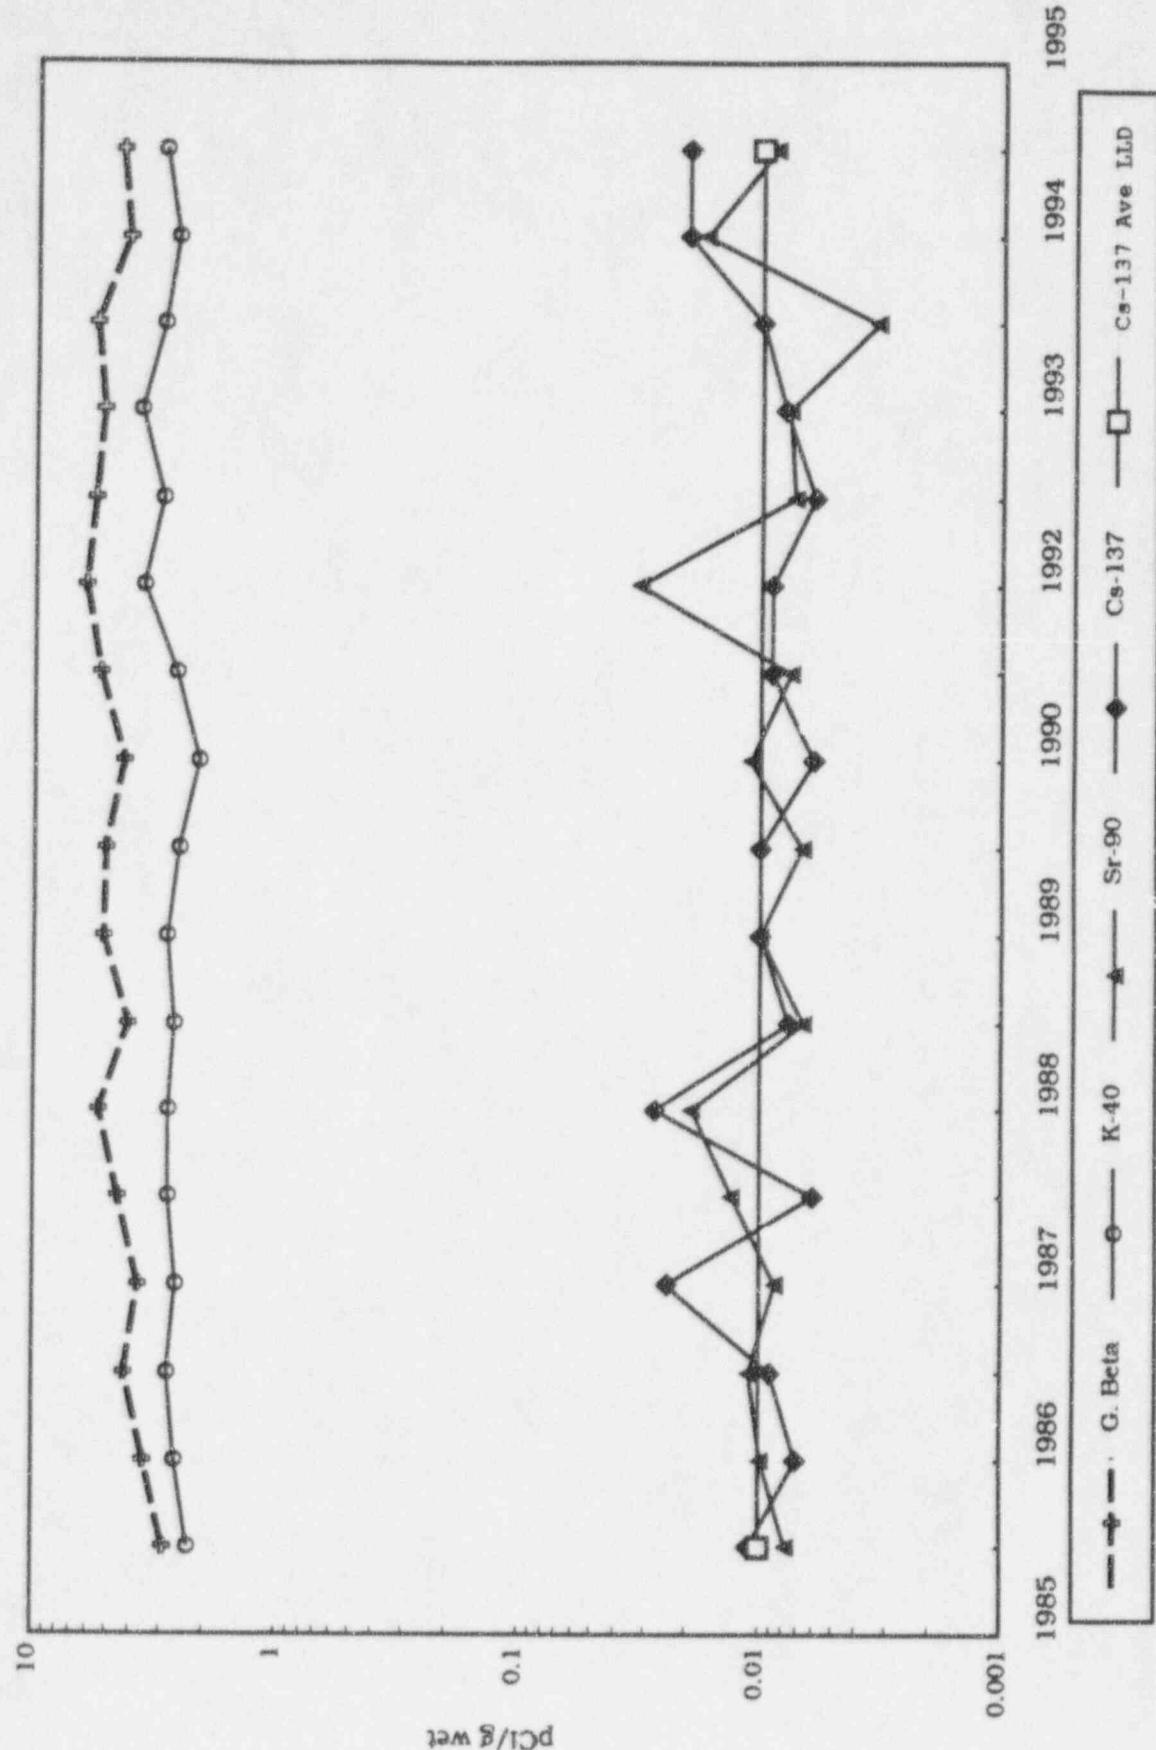


TABLE E-1
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 FISH - PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER	SECOND QUARTER 06/08, 06/09	THIRD QUARTER	FOURTH QUARTER 10/05, 10/06
Gross Beta	28, 35	Mean±std.dev. det./total range	4.2 ± 1.1 E 00 5/5 (2.4-5.3)E 00		4.5 ± 0.9 E 00 5/5 (3.6-5.8)E 00
Sr-89	28, 35	Mean±std.dev. det./total range	L.T. 8. E-03 0/5 --		L.T. 1. E-02 0/5 --
Sr-90	28, 35	Mean±std.dev. det./total range	1.7 ± 0.8 E-02 5/5 (0.8-2.8)E-02		8.8 ± 5.6 E-03 3/5 (0.25-1.3)E-02
K-40	28, 35	Mean±std.dev. det./total range	2.64±0.6 E 00 5/5 (1.9-3.2)E 00		3.0 ± 0.2 E 00 5/5 (2.8-3.2)E 00
Co-60	28, 35	Mean±std.dev. det./total range	L.T. 1. E-02 0/5 --		L.T. 2. E-02 0/5 --
I-131	28, 35	Mean±std.dev. det./total range	L.T. 4. E-02 0/5 --		L.T. 5. E-02 0/5 --
Cs-134	28, 35	Mean±std.dev. det./total range	L.T. 2. E-02 0/5 --		L.T. 2. E-02 0/5 --
Cs-137	28, 35	Mean±std.dev. det./total range	L.T. 2. E-02 0/5 --		L.T. 2. E-02 0/5 --

TABLE E-2
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 FISH - PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER	SECOND QUARTER 06/08, 06/09	THIRD QUARTER	FOURTH QUARTER 10/05, 10/06
BE-7	28, 35		L.T. 1. E-01(0/5)		L.T. 2. E-01(0/5)
K-40	28, 35		2.64 ± 0.6E 00(5/5)		3.0 ± 0.2 E 00(5/5)
Mn-54	28, 35		L.T. 1. E-02(0/5)		L.T. 2. E-02(0/5)
Co-58	28, 35		L.T. 2. E-02(0/5)		L.T. 2. E-02(0/5)
Fe-59	28, 35		L.T. 3. E-02(0/5)		L.T. 4. E-02(0/5)
Co-60	28, 35		L.T. 1. E-02(0/5)		L.T. 2. E-02(0/5)
Zn-65	28, 35		L.T. 3. E-02(0/5)		L.T. 4. E-02(0/5)
Zr-95	28, 35		L.T. 2. E-02(0/5)		L.T. 2. E-02(0/5)
Ru-103	28, 35		L.T. 2. E-02(0/5)		L.T. 2. E-02(0/5)
Ru-106	28, 35		L.T. 1. E-01(0/5)		L.T. 2. E-01(0/5)
I-131	28, 35		L.T. 4. E-02(0/5)		L.T. 5. E-02(0/5)
Cs-134	28, 35		L.T. 2. E-02(0/5)		L.T. 2. E-02(0/5)
Cs-137	28, 35		L.T. 2. E-02(0/5)		L.T. 2. E-02(0/5)
Ba-140	28, 35		L.T. 3. E-02(0/5)		L.T. 3. E-02(0/5)
Ce-141	28, 35		L.T. 2. E-02(0/5)		L.T. 3. E-02(0/5)
Ce-144	28, 35		L.T. 8. E-02(0/5)		L.T. 1. E-01(0/5)
Ra-226	28, 35		L.T. 2. E-01(0/5)		L.T. 3. E-01(0/5)
Th-228	28, 35		L.T. 3. E-02(0/5)		L.T. 3. E-02(0/5)

F. MILK (See Tables F-1, F-2)

STATION 99 (NEAREST PRODUCER)

Milk samples from the nearest producer Station 99, 10.25 miles, 189 degrees from the elevated release point of CNS were collected once every 15 days in peak pasture season and once every 31 days the rest of the year. The monthly samples collected January through May and October through December were analyzed for I-131 by chemical separation, for elemental calcium and strontium 89 and 90. In addition they were analyzed for gamma emitting isotopes on a high resolution gamma spectrometer. The samples collected every 15 days during peak pasture season were analyzed upon receipt for I-131 and gamma emitting isotopes. A monthly composite was prepared and analyzed as described above.

There were no detections of I-131 in the twenty-two samples analyzed by chemical separation. There were no detections of Sr-89 in the samples analyzed. Strontium-90 was detected at an average level of 1.7 pCi/liter, which is a normal environmental level. Elemental calcium was found at an average level of 3.7 mg/liter. Potassium-40, a naturally occurring isotope, was detected at an average level of 1380 pCi/liter.

Cesium-137 was not detected in any of the samples analyzed. There was no indication of an effect on the milk of the producer nearest the plant from the operations of CNS.

Shown in Figure F-1 and F-2 are the plots of radionuclides monitored from 1977 through 1994 in milk samples from producers nearest the reactor. The levels of K-40, elemental calcium and Sr-90 remained stable. There were no detections of I-131, Sr-89 or Cs-137. This indicates no effect on milk samples from the operations of CNS.

FIGURE F-1

MILK - NEAREST PRODUCER
QUARTERLY AVERAGE - STATION 61
K-40 I-131 CS-137

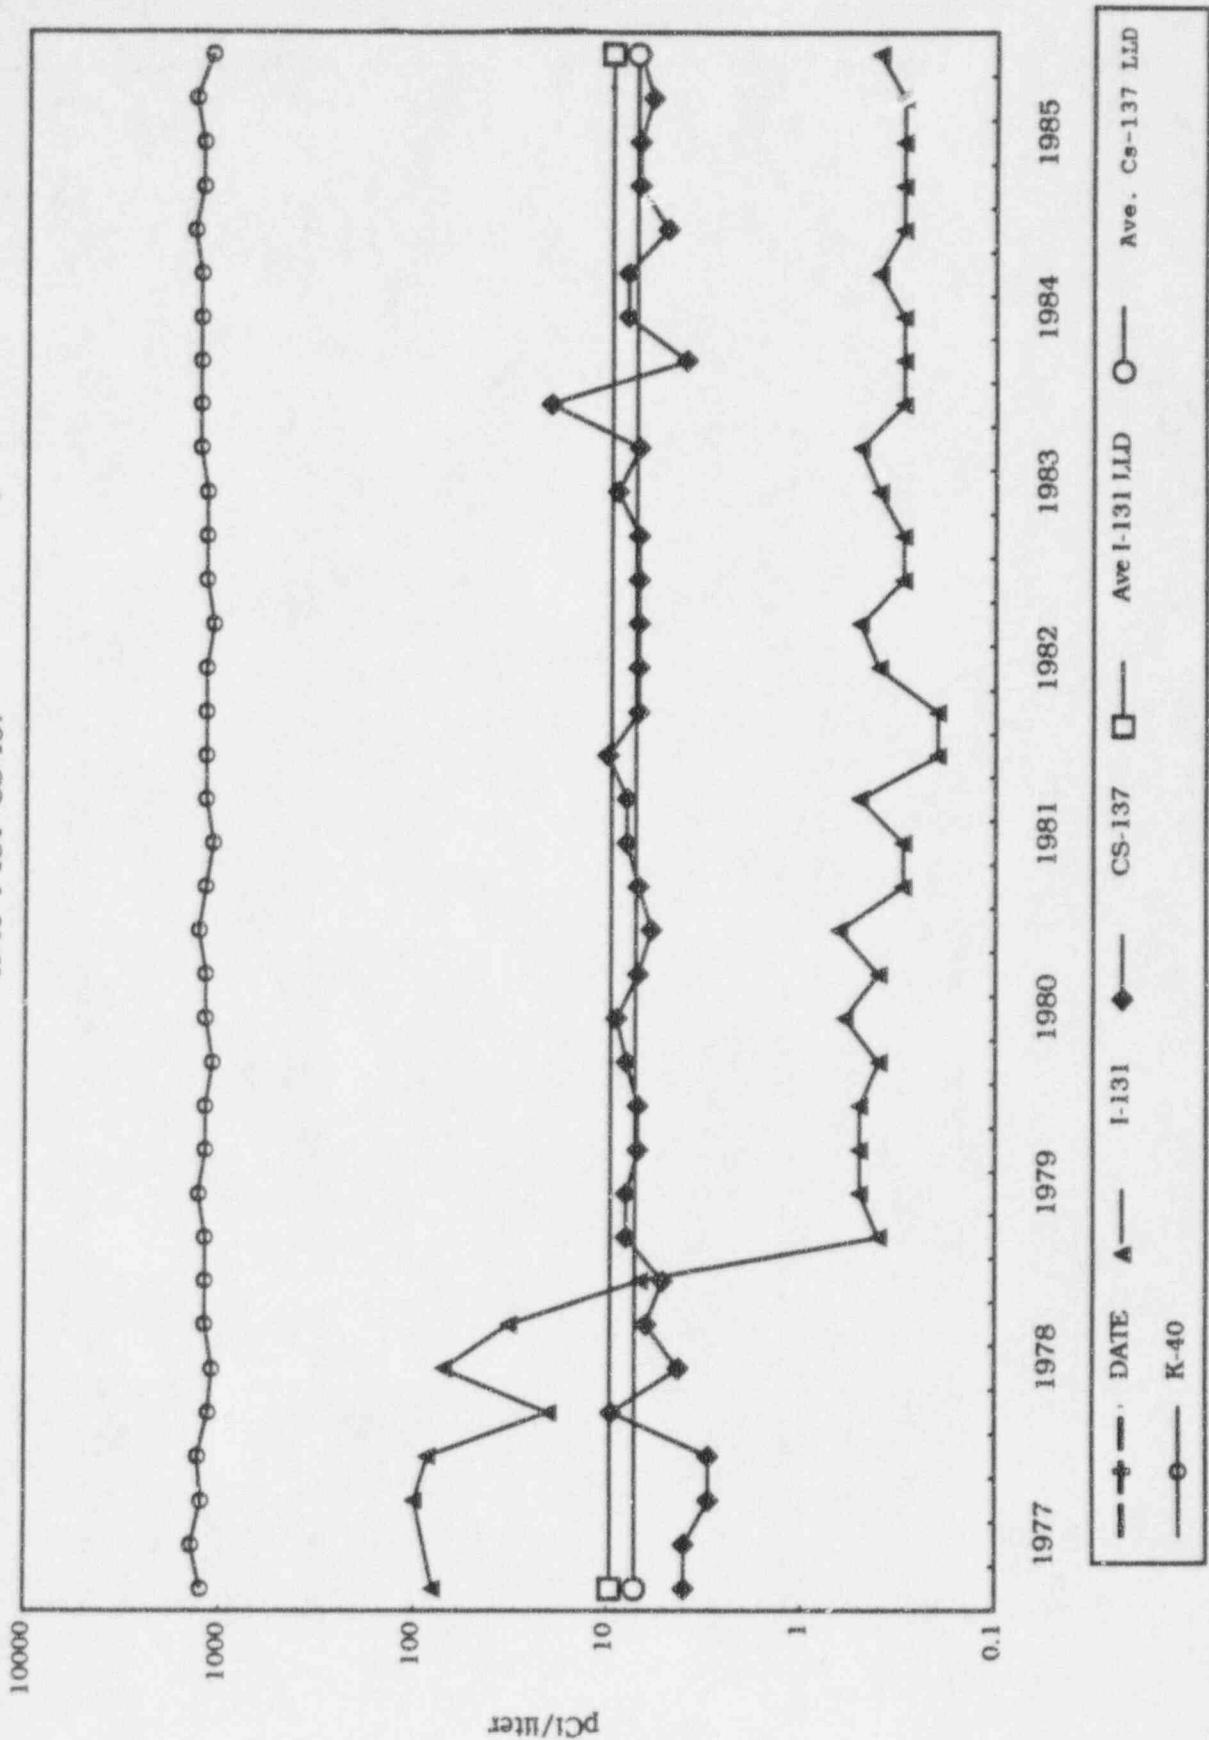


FIGURE F-1

MILK - NEAREST PRODUCER
QUARTERLY AVERAGE - STATION 99
K-40 I-131 CS-137

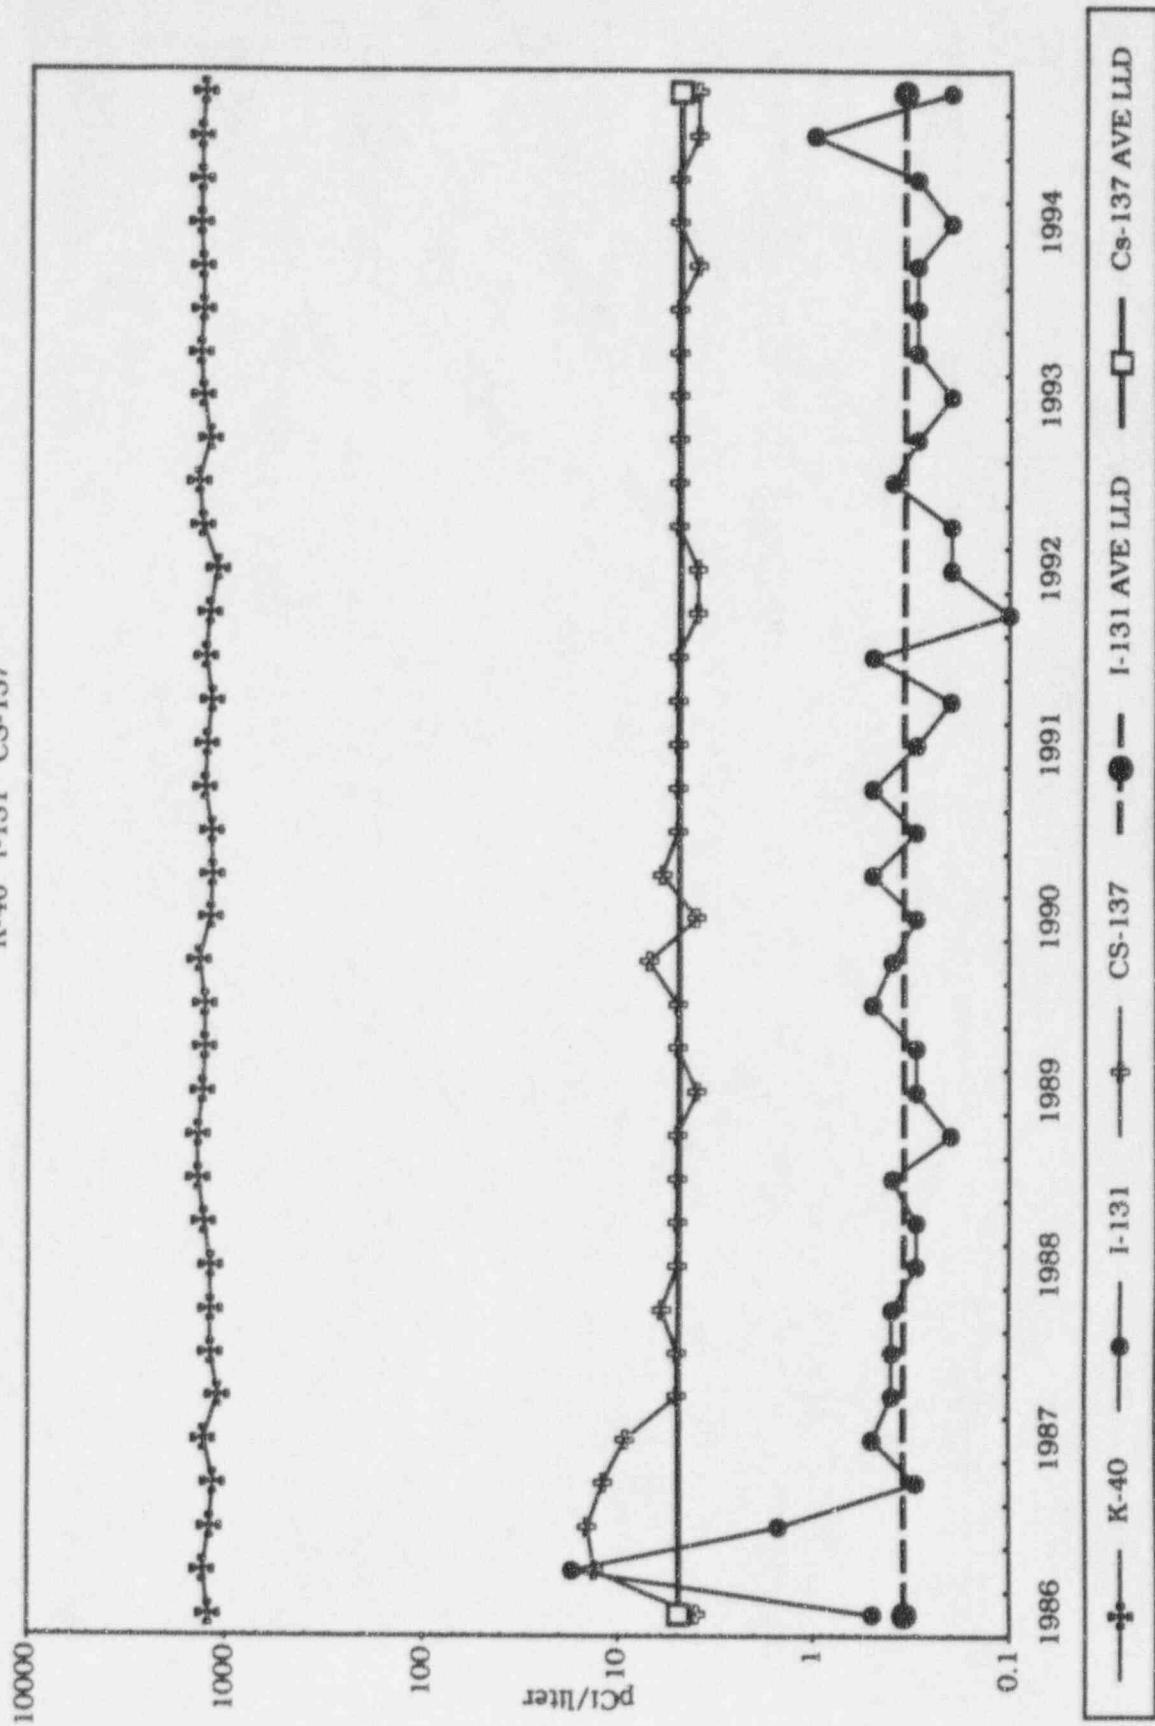


FIGURE F-2

MILK- NEAREST PRODUCER
QUARTERLY AVERAGE - STATION 61
SR-89 SR-90 ELEM. CA.

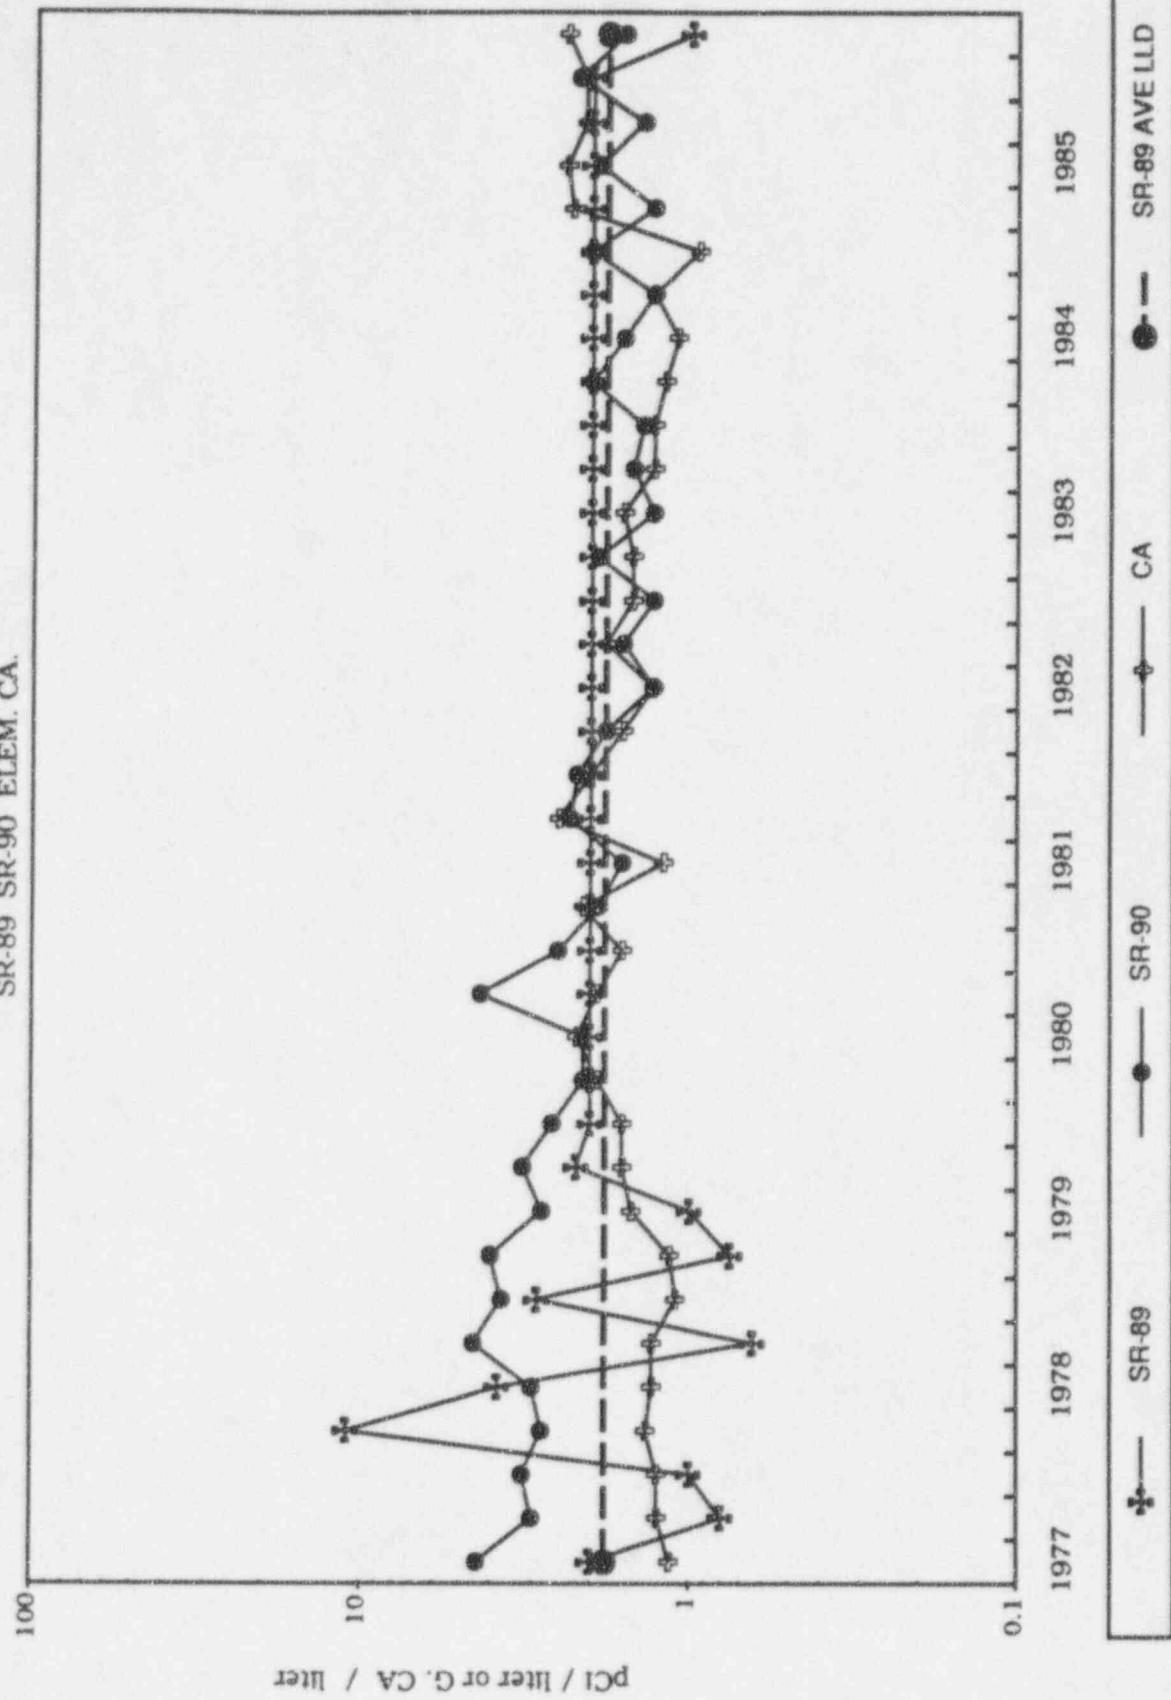


FIGURE F-2
MILK- NEAREST PRODUCER
QUARTERLY AVERAGE - STATION 99
SR-89 SR-90 ELEM. CA.

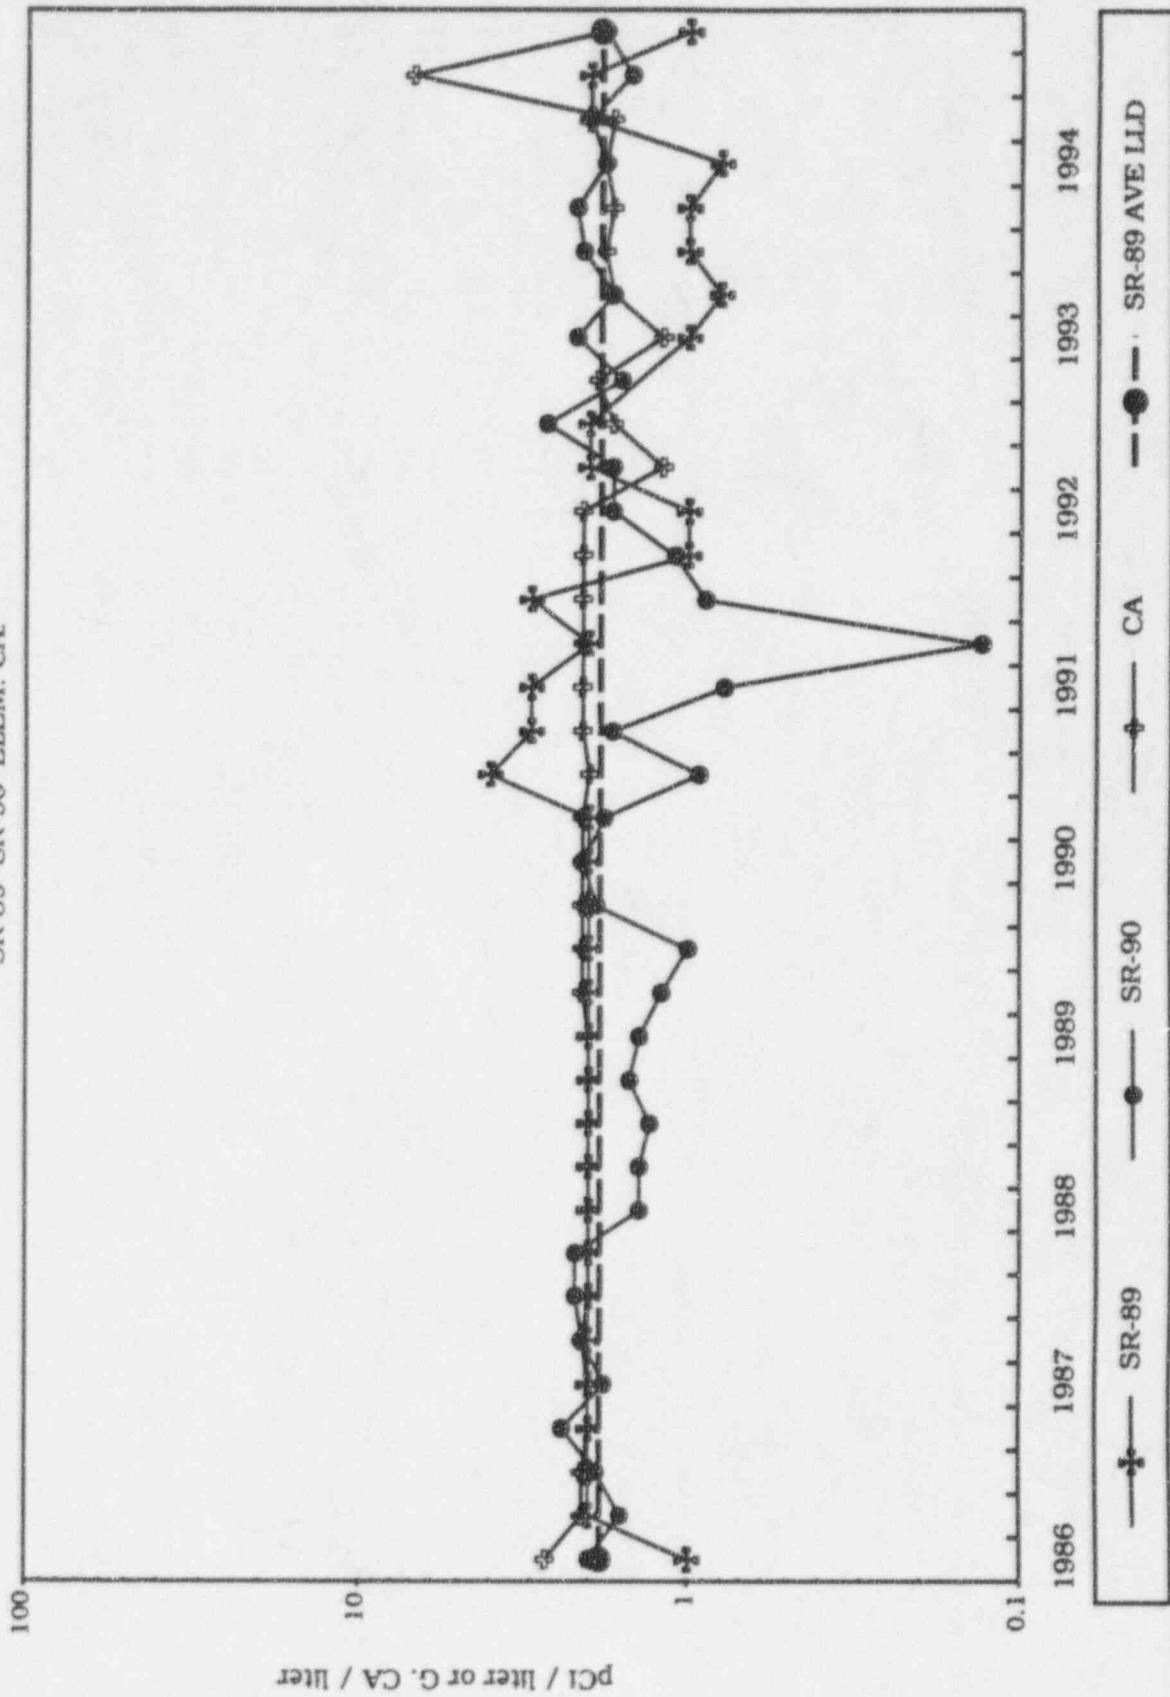


TABLE F-1
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
MILK - NEAREST PRODUCER - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/04-03/01	SECOND QUARTER 04/05-06/21	THIRD QUARTER 07/06-09/27	FOURTH QUARTER 10/04-12/05
SR-89	99	Mean±std.dev. det./total range	L.T. 8. E-01 0/4 --	L.T. 2. E 00 0/3 --	L.T. 2. E 00 0/6 --	L.T. 1. E 00 0/3 --
SR-90	99	Mean±std.dev. det./total range	1.8 ± 0.2 E 00 4/4 (1.6-2.1)E 00	2.0 ± 0.9 E 00 3/3 (1.2-3.0)E 00	1.5 ± 0.3 E 00 6/6 (1.0-1.9)E 00	1.8 ± 0.3 E 00 3/3 (1.6-2.1)E 00
I-131 by chemical separation	99	Mean±std.dev. det./total range	L.T. 2. E-01 0/4 --	L.T. 3. E-01 0/5 --	L.T. 1. E 00 0/10 --	L.T. 2. E-01 0/3 --
Ca gm/liter	99	Mean±std.dev. det./total range	1.8 ± 0.1 E 00 4/4 (1.7-1.8) E 00	1.7 ± 0.2 E 00 3/3 (1.5-1.8)E 00	6.9 ± 7.9 E 00 6/6 (1.7-17)E 00	1.8 ± 0.1 E 00 3/3 (1.7-1.9)E 00
K-40	99	Mean±std.dev. det./total range	1.40 ± 0.05E 03 4/4 (1.34-1.45)E 03	1.38±0.11E 03 5/5 (1.20-1.51)E 03	1.39±0.12E 03 10/10 (1.25-1.68)E 03	1.33±0.05E 03 3/3 (1.28-1.38)E 03
I-131 by gamma spectroscopy	99	Mean±std.dev. det./total range	L.T. 9. E 00 0/4 --	L.T. 8. E 00 0/5 --	L.T. 9. E 01 0/10 --	L.T. 8. E 00 0/3 --
Cs-134	99	Mean±std.dev. det./total range	L.T. 5. E 00 0/4 --	L.T. 5. E 00 0/5 --	L.T. 4. E 00 0/10 --	L.T. 4. E 00 0/3 --
Cs-137	99	Mean±std.dev. det./total range	L.T. 5. E 00 0/4 --	L.T. 5. E 00 0/5 --	L.T. 4. E 00 0/10 --	L.T. 4. E 00 0/3 --

TABLE F-2
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 MILK - NEAREST PRODUCER - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/04-03/01	SECOND QUARTER 04/05-06/21	THIRD QUARTER 07/06-09/27	FOURTH QUARTER 10/04-12/06
BE-7	99	L.T. 4. E 01 (0/4)	L.T. 4. E 01 (0/5)	L.T. 5. E 01 (0/10)	L.T. 3. E 01 (0/3)
K-40	99	1.40±0.05 E 03 (4/4)	1.38±0.11 E 03 (5/5)	1.39 ± 0.12E 03(10/10)	1.33±0.05 E 03 (3/3)
Mn-54	99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 4. E 00 (0/10)	L.T. 4. E 00 (0/3)
Co-58	99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 5. E 00 (0/10)	L.T. 4. E 00 (0/3)
Fe-59	99	L.T. 1. E 01 (0/4)	L.T. 1. E 01 (0/5)	L.T. 1. E 01 (0/10)	L.T. 9. E 00 (0/3)
Co-60	99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 4. E 00 (0/10)	L.T. 4. E 00 (0/3)
Zn-65	99	L.T. 1. E 01 (0/4)	L.T. 1. E 01 (0/5)	L.T. 1. E 01 (0/10)	L.T. 1. E 01 (0/3)
Zr-95	99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 5. E 00 (0/10)	L.T. 5. E 00 (0/3)
Ru-103	99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 7. E 00 (0/10)	L.T. 4. E 00 (0/3)
Ru-106	99	L.T. 4. E 01 (0/4)	L.T. 5. E 01 (0/5)	L.T. 4. E 01 (0/10)	L.T. 3. E 01 (0/3)
I-131	99	L.T. 9. E 00 (0/4)	L.T. 8. E 00 (0/5)	L.T. 9. E 01 (0/10)	L.T. 8. E 00 (0/3)
Cs-134	99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 4. E 00 (0/10)	L.T. 4. E 00 (0/3)
Cs-137	99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 4. E 00 (0/10)	L.T. 4. E 00 (0/3)
Ba-140	99	L.T. 7. E 00 (0/4)	L.T. 6. E 00 (0/5)	L.T. 3. E 01 (0/10)	L.T. 8. E 00 (0/3)
Ce-141	99	L.T. 8. E 00 (0/4)	L.T. 8. E 00 (0/5)	L.T. 1. E 01 (0/10)	L.T. 8. E 00 (0/3)
Ce-144	99	L.T. 3. E 01 (0/4)	L.T. 3. E 01 (0/5)	L.T. 3. E 01 (0/10)	L.T. 3. E 01 (0/3)
Ra-226	99	L.T. 9. E 01 (0/4)	L.T. 9. E 01 (0/5)	L.T. 9. E 01 (0/10)	L.T. 8. E 01 (0/3)
Th-228	99	L.T. 8. E 00 (0/4)	L.T. 8. E 00 (0/5)	L.T. 7. E 00 (0/10)	L.T. 7. E 00 (0/3)

G. MILK (SEE TABLES G-1, G-2)
STATIONS 42, 100 (OTHER PRODUCERS)

Milk samples were collected quarterly from other producers, Station 42, 12.9 miles from the plant and Station 100 which is 11.5 miles from the plant. The samples were analyzed for I-131 by chemical separation, for elemental calcium, for Sr-89 and 90 and for gamma emitting isotopes. There were no detections of I-131 in the eight samples monitored.

There were no detections of Sr-89. Strontium-90 was found at an average level of 2.0 pCi/liter. There were 1.8 mg of calcium per liter of milk. Potassium-40 was detected at an average level of 1310. pCi/liter. The strontium-90, K-40 and elemental calcium were at normal environmental levels and were similar to the results obtained from analyses of milk from the nearest producer. There were no detections of Cs-137 in the samples collected. It can be concluded that the operations of CNS had no effect on milk samples and thus no dose impact on the population.

The levels of radioactivities of the nuclides K-40, I-131 and Cs-137 are plotted on Figure G-1. Potassium-40 was at normal environmental levels as in previous years. There were no detections of I-131 or Cs-137. Figure G-2 shows that Sr-90 and elemental calcium are at a level comparable to previous years and there were no detections of Sr-89. These graphs indicate that there was no appreciable difference between the levels of activity of the nearest producer and the commercial producers. This indicated no effect on milk samples from the operations of CNS.

FIGURE G-1
 MILK- COMMERCIAL PRODUCERS
 QUARTERLY AVERAGE - ALL LOCATIONS
 K-40 I-131 Cs-137

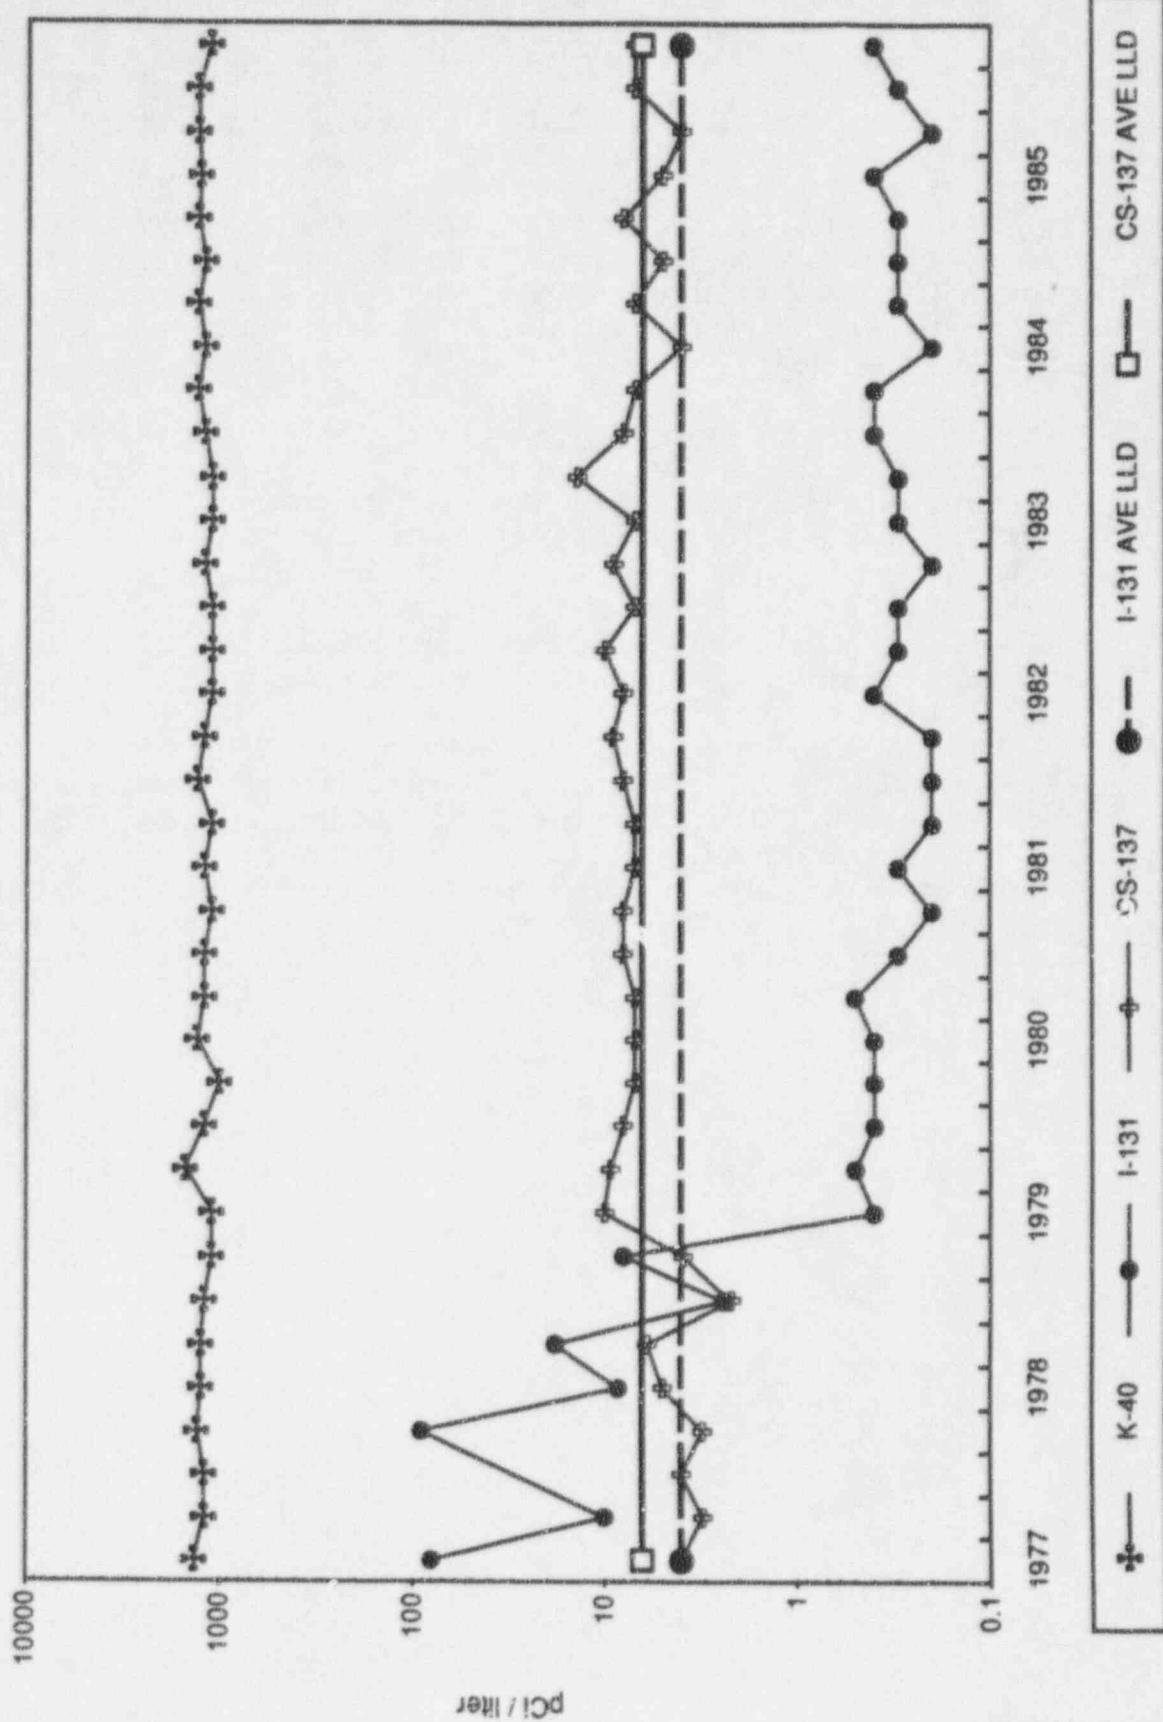


FIGURE G-1

MILK- COMMERCIAL PRODUCERS
QUARTERLY AVERAGE - ALL LOCATIONS
K-40 I-131 Cs-137

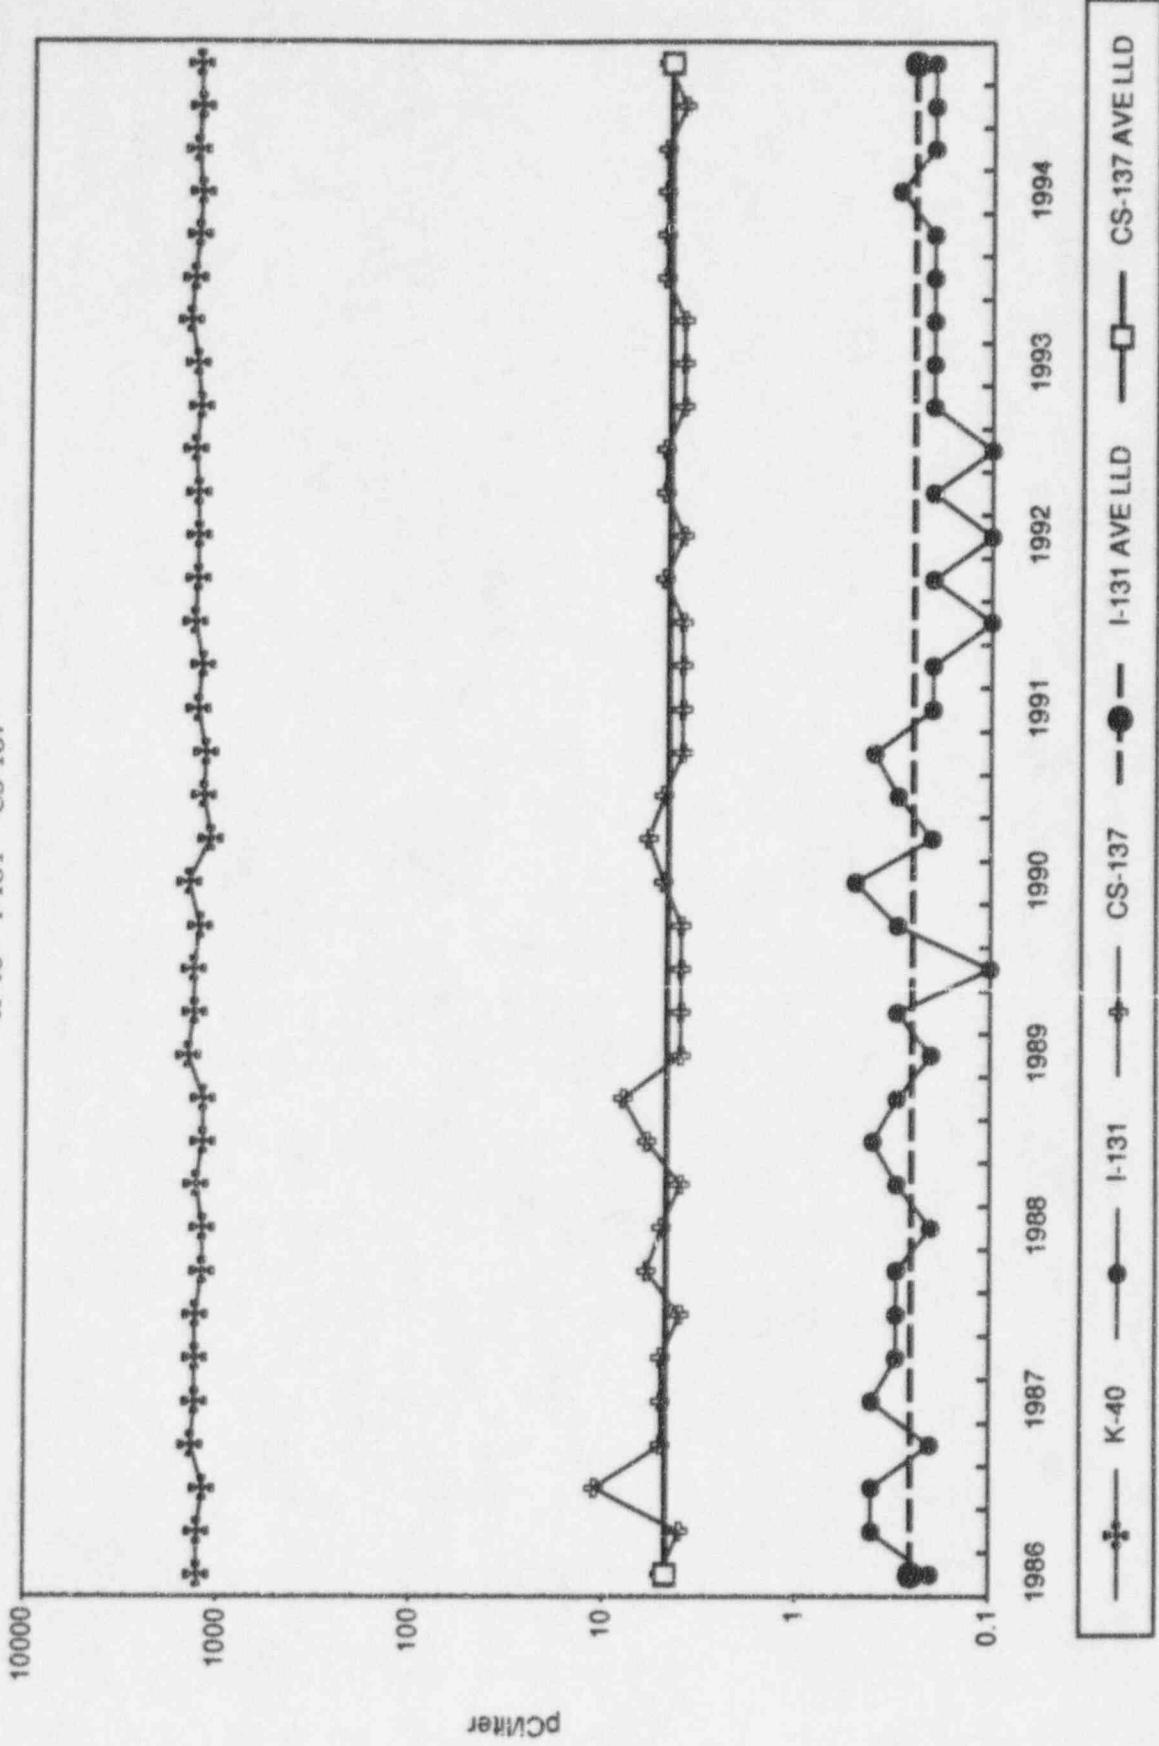


FIGURE G-2
MILK- COMMERCIAL PRODUCERS
QUARTERLY AVERAGE - ALL LOCATIONS
SR-89 SR-90 ELEM. CA.

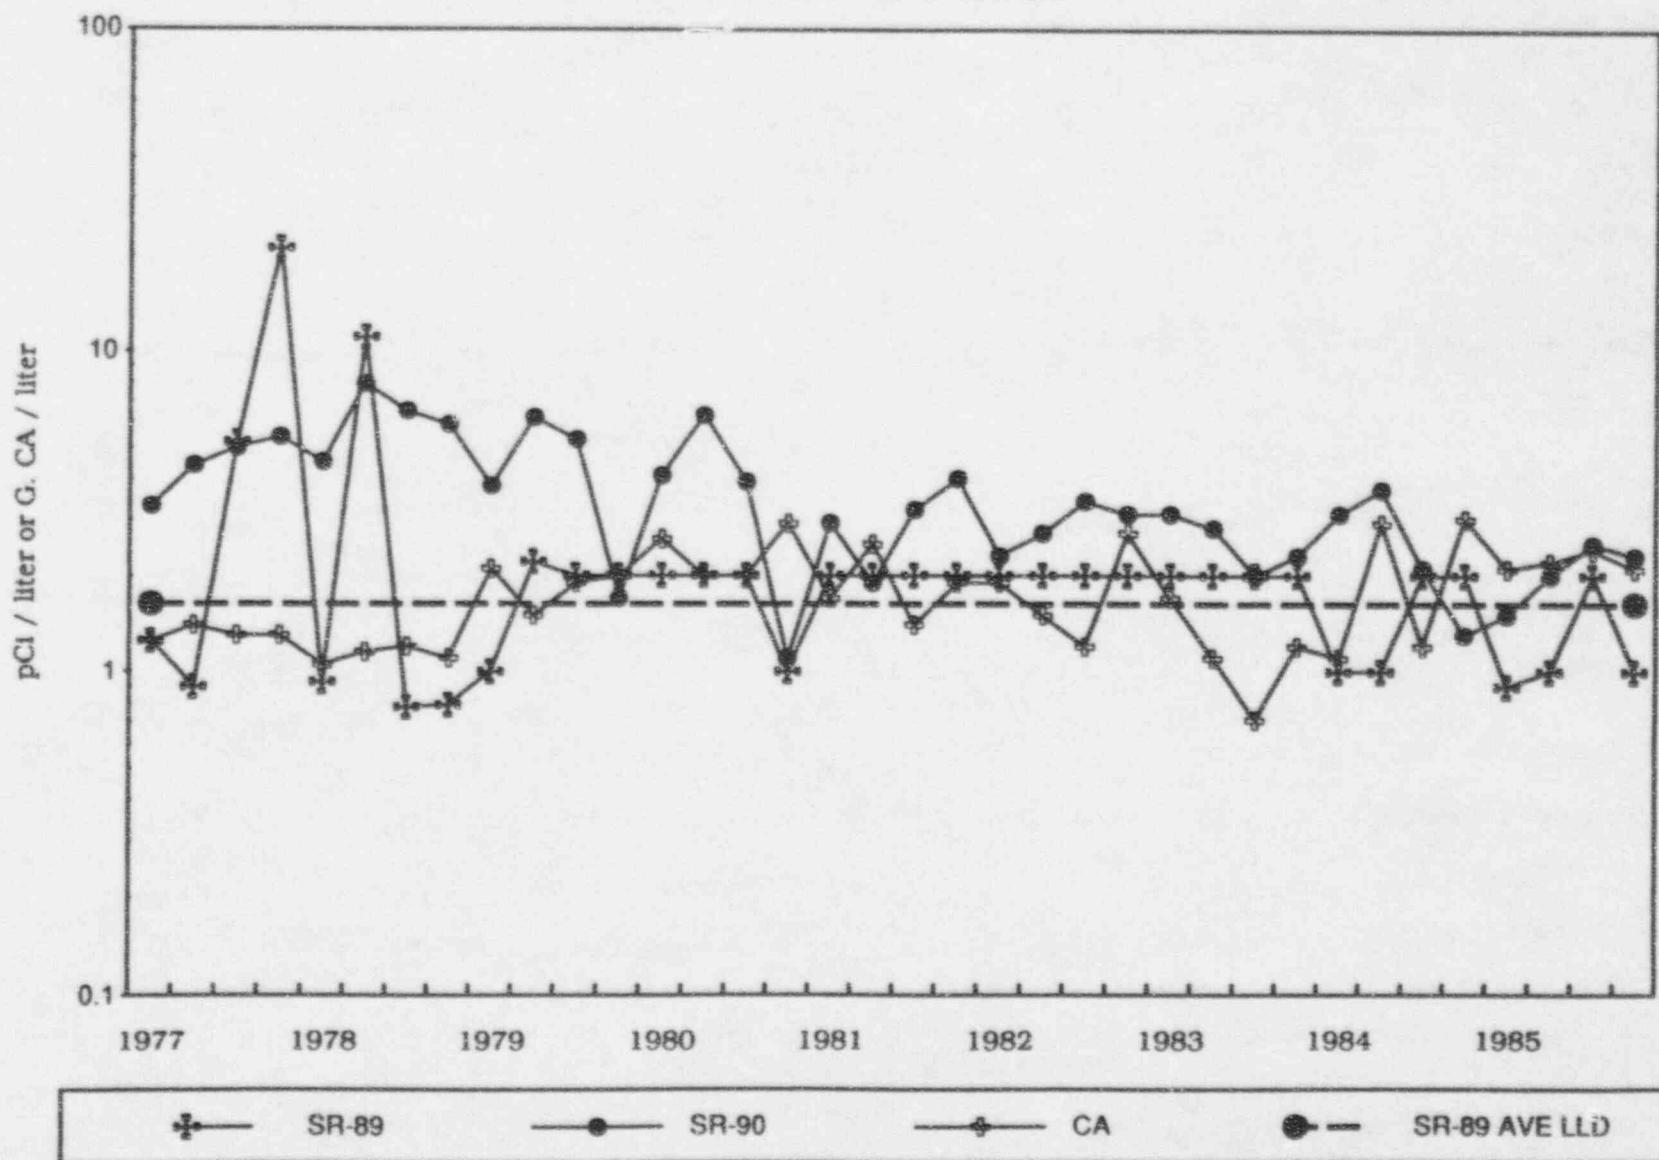


FIGURE G-2

MILK- COMMERCIAL PRODUCERS
QUARTERLY AVERAGE - ALL LOCATIONS
SR-89 SR-90 ELEM. CA.

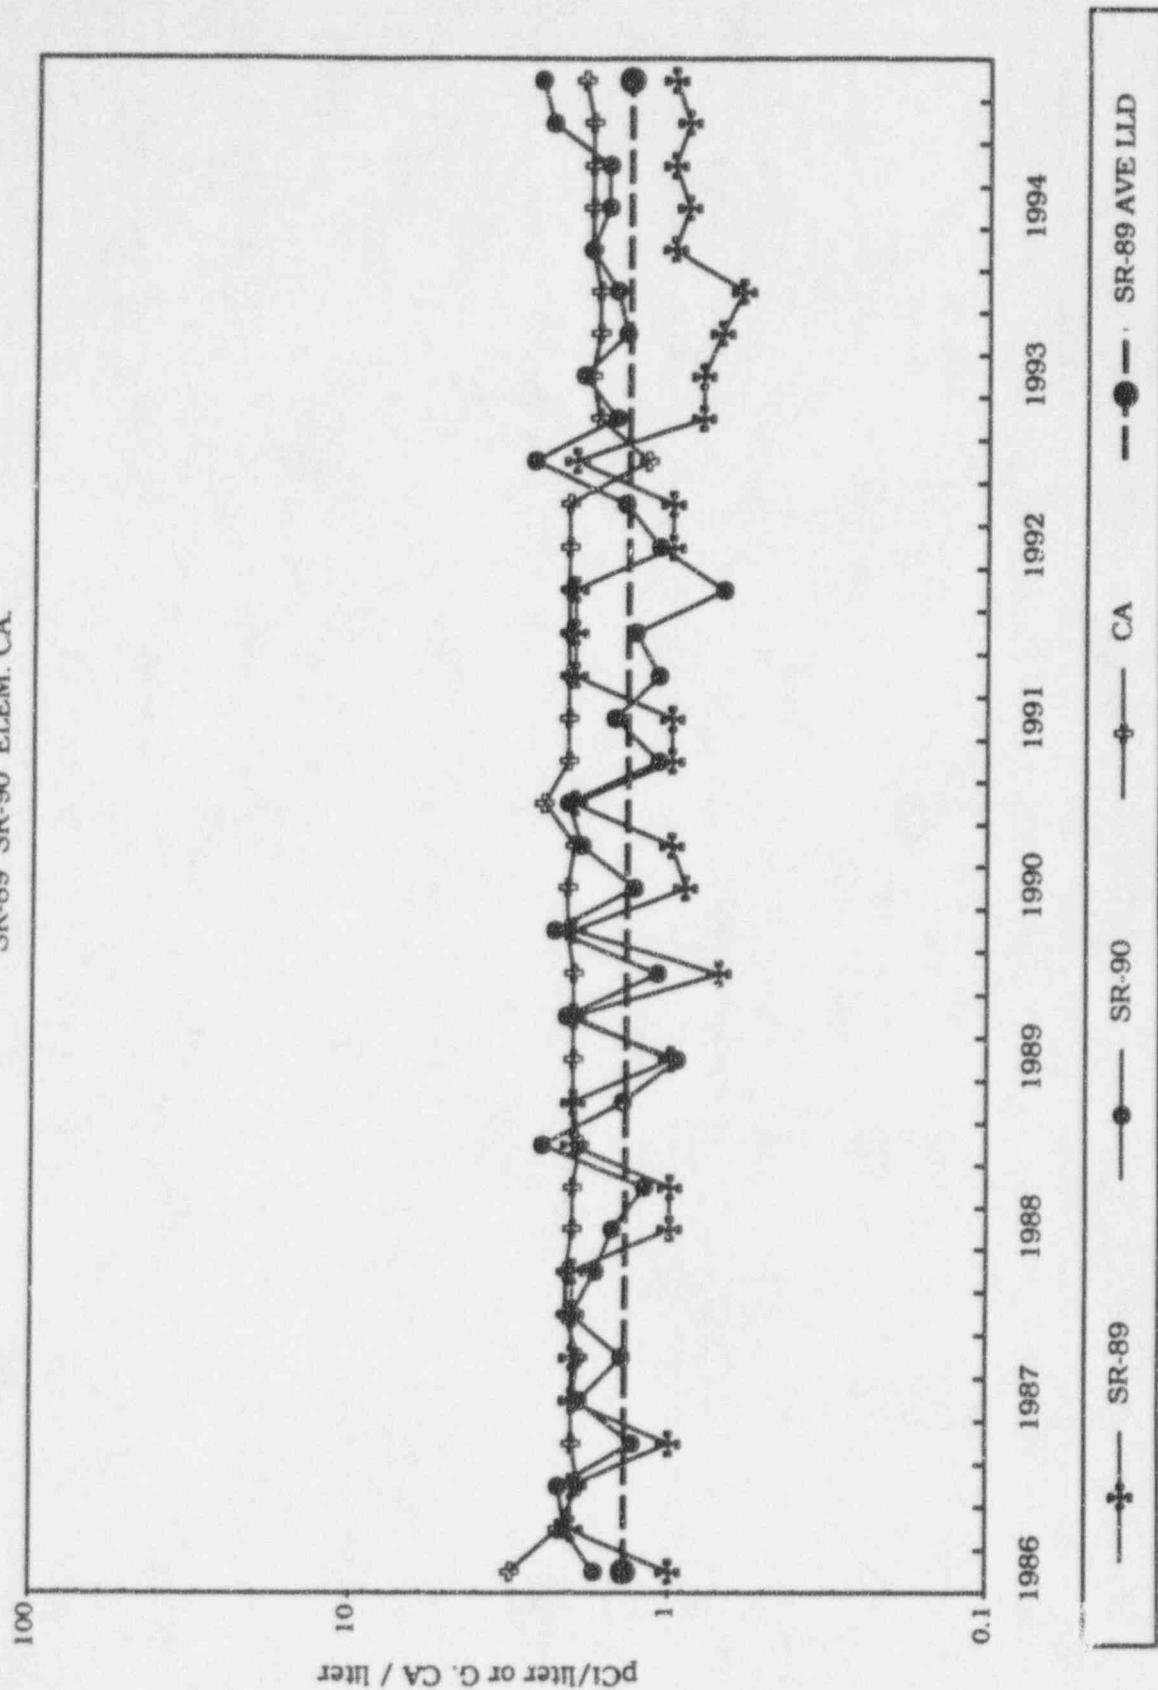


TABLE G-1
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
MILK - OTHER PRODUCERS - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/12	SECOND QUARTER 04/12	THIRD QUARTER 07/12	FOURTH QUARTER 10/11
SR-89	42, 100	Mean/std.dev. det./total range	L.T. 9. E-01 0/2 --	L.T. 1. E 00 0/2 --	L.T. 9. E-01 0/2 --	L.T. 1. E 00 0/2 --
SR-90	42, 100	Mean/std.dev. det./total range	1.6 ± 0.3 E 00 2/2 (1.4-1.8)E 00	1.6 ± 0.1 E 00 2/2 (1.5-1.7)E 00	2.4 ± 0.2 E 00 2/2 (2.2-2.5)E 00	2.6 ± 0.4 E 00 2/2 (2.3-2.8)E 00
I-131 (by chemical separation)	42, 100	Mean/std.dev. det./total range	L.T. 3. E-01 0/2 --	L.T. 2. E-01 0/2 --	L.T. 2. E-01 0/2 --	L.T. 2. E-01 0/2 --
Ca gm/liter	42, 100	Mean/std.dev. det./total range	1.8 ± 0.2 E 00 2/2 (1.8-1.8) E 00	1.8 ± 0.1 E 00 2/2 (1.7-1.8)E 00	1.8 ± 0.07 E 00 2/2 (1.7-1.8)E 00	1.9 ± 0.2 E 00 2/2 (1.9-1.9)E 00
K-40	42, 100	Mean/std.dev. det./total range	1.32 ± 0.2E 03 2/2 (1.21-1.43)E 03	1.39±0.2E 03 2/2 (1.53-1.24)E 03	1.33±0.1E 03 2/2 (1.33-1.33)E 03	1.36±0.14 E 03 2/2 (1.36-1.36)E 03
I-131 (by gamma spectroscopy)	42, 100	Mean/std.dev. det./total range	L.T. 7. E 00 0/2 --	L.T. 9. E 00 0/2 --	L.T. 7. E 00 0/2 --	L.T. 8. E 00 0/2 --
Cs-137	42, 100	Mean/std.dev. det./total range	L.T. 5. E 00 0/2 --	L.T. 5. E 00 0/2 --	L.T. 4. E 00 0/2 --	L.T. 5. E 00 0/2 --

TABLE G-2
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
MILK - OTHER PRODUCERS - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/12	SECOND QUARTER 04/12	THIRD QUARTER 07/12	FOURTH QUARTER 10/11
BE-7	42, 100	L.T. 4. E 01 (0/2)	L.T. 4. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 4. E 01 (0/2)
K-40	42, 100	1.32 ± 0.2E 03 (2/2)	1.39 ± 0.2E 03 (2/2)	1.33 ± 0.1E 03 (2/2)	1.36±0.14E 03 (2/2)
Mn-54	42, 100	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)
Co-58	42, 100	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)
Fe-59	42, 100	L.T. 9. E 00 (0/2)	L.T. 1. E 01 (0/2)	L.T. 9. E 00 (0/2)	L.T. 1. E 01 (0/2)
Co-60	42, 100	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)
Zn-65	42, 100	L.T. 9. E 00 (0/2)	L.T. 1. E 01 (0/2)	L.T. 9. E 00 (0/2)	L.T. 1. E 01 (0/2)
Zr-95	42, 100	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)
Ru-103	42, 100	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)
Ru-106	42, 100	L.T. 4. E 01 (0/2)	L.T. 4. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 4. E 01 (0/2)
I-131	42, 100	L.T. 7. E 00 (0/2)	L.T. 9. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 8. E 00 (0/2)
Cs-134	42, 100	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)
Cs-137	42, 100	L.T. 5. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 5. E 00 (0/2)
Ba-140	42, 100	L.T. 5. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 6. E 00 (0/2)
Ce-141	42, 100	L.T. 6. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 9. E 00 (0/2)
Ce-144	42, 100	L.T. 2. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 4. E 01 (0/2)
Ra-226	42, 100	L.T. 8. E 01 (0/2)	L.T. 8. E 01 (0/2)	L.T. 9. E 01 (0/2)	L.T. 1. E 02 (0/2)
Th-228	42, 100	L.T. 7. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 1. E 01 (0/2)

H. GROUNDWATER (See Tables H-1 and H-2)

STATIONS 11, 47

Groundwater was collected from two stations quarterly and analyzed for gross beta and gross alpha activity, for tritium and for gamma emitting radionuclides. Station 11 is 0.15 miles from the plant and station 47 is 25.75 miles from the plant.

The gross beta activity averaged 10.0 pCi/liter which is statistically similar to past years. There were no detections of gross alpha. There were no detections of gamma emitters above the normal level of detection. The tritium level averaged 100 pCi/liter for the year which is the normal environmental level.

There was no difference in levels of beta activity or tritium for the station close to the plant as compared with the more distant station. It may be concluded that there was no impact from the operations of CNS on the environment as shown by measurements of radionuclides in groundwater.

Shown in Figure H-1 are the gross alpha, gross beta and tritium levels in groundwater. The levels of these activities have remained essentially unchanged.

FIGURE H-1
 GROUNDWATER
 QUARTERLY AVERAGE - ALL LOCATIONS
 GROSS ALPHA GROSS BETA H-3

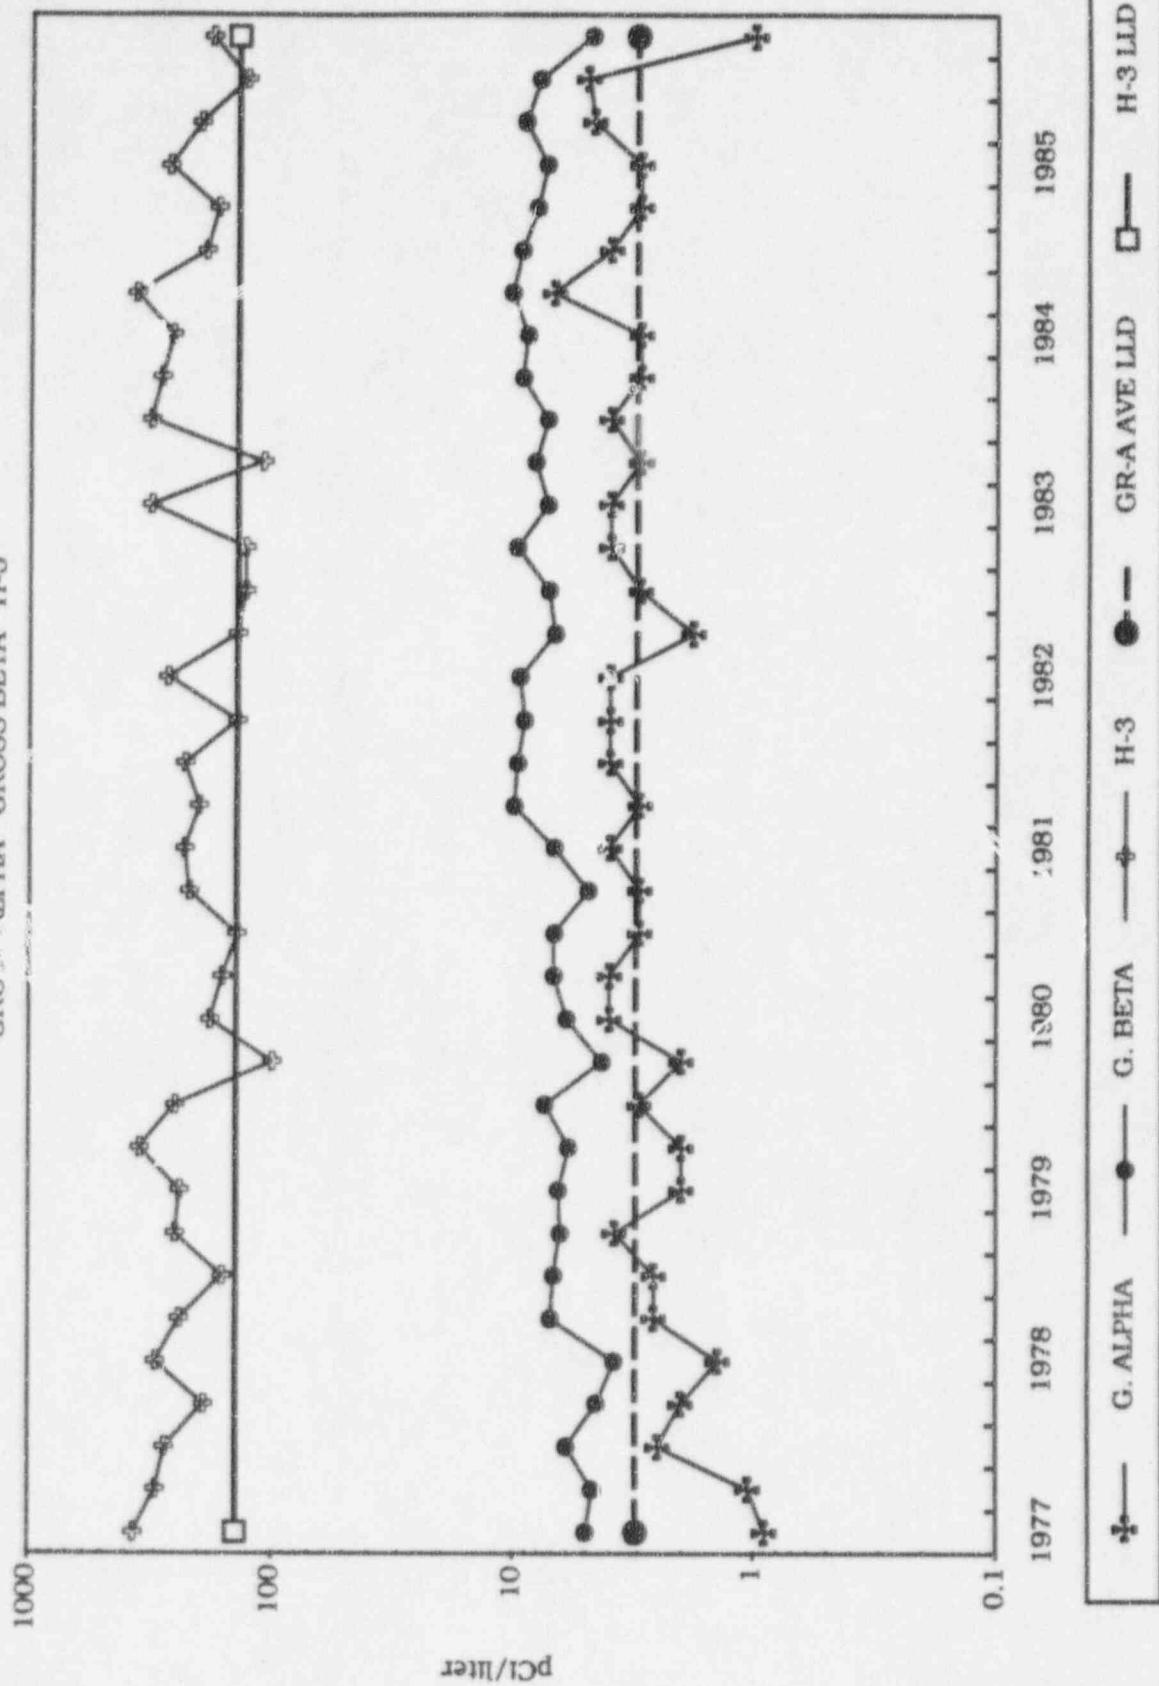


FIGURE H-1
GROUNDWATER
QUARTERLY AVERAGE - ALL LOCATIONS
GROSS ALPHA GROSS BETA H-3

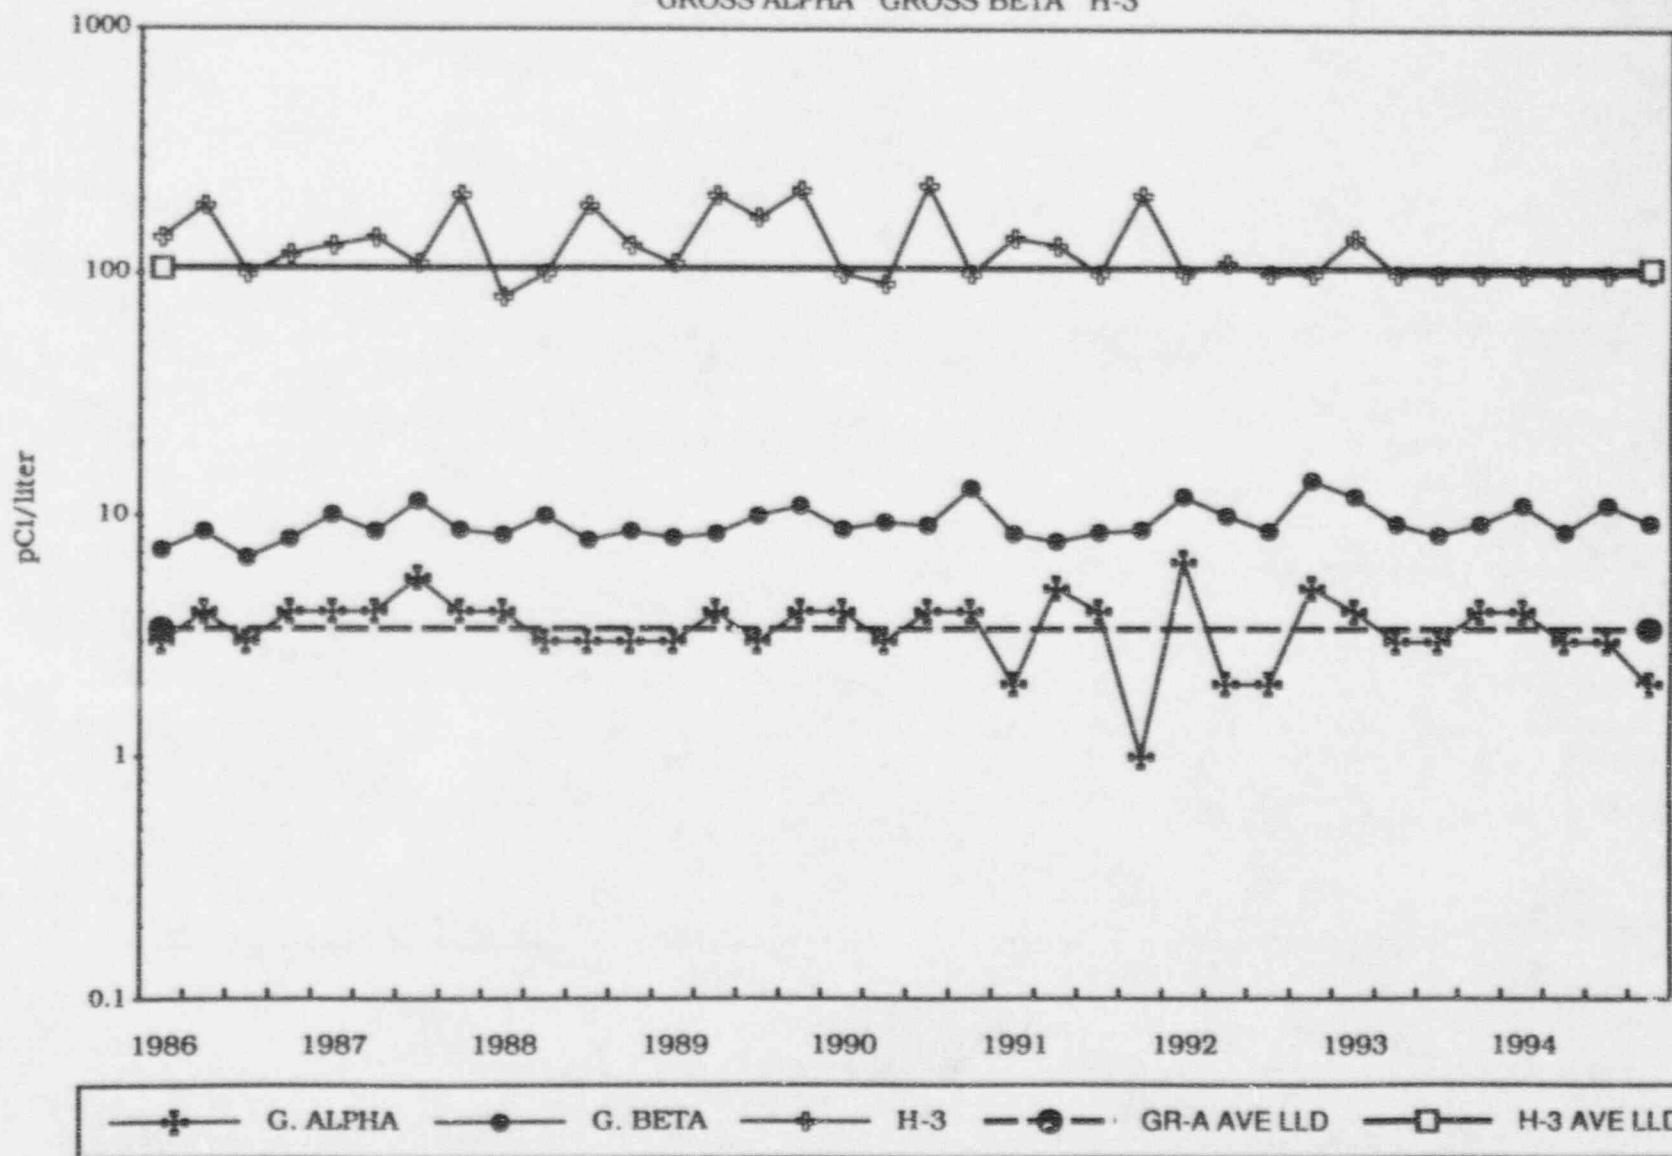


TABLE E-1
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - WATERBORNE
GROUNDWATER - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/25, 01/26	SECOND QUARTER 04/26	THIRD QUARTER 07/26	FOURTH QUARTER 10/25
GROSS ALPHA	11, 47	Mean/std.dev. det./total range	L.T. 4. E 00 0/2 --	L.T. 3. E 00 0/2 --	L.T. 3. E 00 0/2 --	L.T. 2. E 00 0/2 --
GROSS BETA	11, 47	Mean/std.dev. det./total range	1.1 ± 0.1 E 01 2/2 (1.0-1.2) E 01	8.5 ± 1.2 E 00 2/2 (7.6-9.3) E 00	1.1 ± 0.2 E 01 2/2 0.99-1.3) E 01	9.3 ± 0.9 E 00 2/2 (8.6-9.9) E 00
K-40	11, 47	Mean/std.dev. det./total range	L.T. 5. E 01 0/2 --	L.T. 7. E 01 0/2 --	L.T. 9. E 01 0/2 --	5.88±2.78 E 01 1/2 --
I-131 (by gamma spectroscopy)	11, 47	Mean/std.dev. det./total range	L.T. 7. E 00 0/2 --	L.T. 7. E 00 0/2 --	L.T. 5. E 00 0/2 --	L.T. 6. E 00 0/2 --
Cs-137	11, 47	Mean/std.dev. det./total range	L.T. 3. E 00 0/2 --	L.T. 4. E 00 0/2 --	L.T. 4. E 00 0/2 --	L.T. 4. E 00 0/2 --
H-3	11, 47	Mean/std.dev. det./total range	L.T. 1 E 02 0/2 --	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --

TABLE E-2
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - WATERBORNE
GROUNDWATER - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/25, 01/26	SECOND QUARTER 04/26	THIRD QUARTER 07/26	FOURTH QUARTER 10/25
BE-7	11, 47	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)
K-40	11, 47	L.T. 5. E 01 (0/2)	L.T. 7. E 01 (0/2)	L.T. 9. E 01 (0/2)	5.88±2.78 E 01 (1/2)
Mn-54	11, 47	L.T. 3. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 3. E 00 (0/2)
Co-58	11, 47	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 3. E 00 (0/2)
Fe-59	11, 47	L.T. 7. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 8. E 00 (0/2)
Co-60	11, 47	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 3. E 00 (0/2)
Zn-65	11, 47	L.T. 7. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 8. E 00 (0/2)
Zr-95	11, 47	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ru-103	11, 47	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ru-106	11, 47	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)
I-131	11, 47	L.T. 7. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 6. E 00 (0/2)
Cs-134	11, 47	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Cs-137	11, 47	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ba-140	11, 47	L.T. 6. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 6. E 00 (0/2)
Ce-141	11, 47	L.T. 6. E 00 (0/2)	L.T. 9. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 6. E 00 (0/2)
Ce-144	11, 47	L.T. 2. E 01 (0/2)	L.T. 4. E 01 (0/2)	L.T. 2. E 01 (0/2)	L.T. 3. E 01 (0/2)
Ra-226	11, 47	L.T. 6. E 01 (0/2)	L.T. 1. E 02 (0/2)	L.T. 7. E 01 (0/2)	L.T. 7. E 01 (0/2)
Th-228	11, 47	L.T. 6. E 00 (0/2)	L.T. 9. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 7. E 00 (0/2)

I. RIVER WATER (See Table I-1 and I-2)

STATIONS 12, 28

River water was collected monthly and monitored for gross beta and gross alpha, suspended and dissolved, Sr-89 and Sr-90 plus gamma emitting isotopes. A quarterly composite was measured for tritium.

There were four detections of potassium-40 with an average of (67.7 pCi/l) above the normal level of detection. There were no detections of Sr-89 and Sr-90.

The average gross alpha and gross beta readings were similar to previous years as indicated in the summary of 1993 and 1994 averages below:

	1993 Average pCi/liter	1994 Average pCi/liter
Gross Alpha (dissolved)	4.0	3.8
Gross Alpha (suspended)	3.9	3.0
Gross Beta (dissolved)	13.0	11.0
Gross Beta (suspended)	15.0	7.7

Figure I-1, which follows, is a plot of the gross alpha and gross beta of suspended and dissolved particles. The results for 1986 through 1994 are on the second page. The levels of activity continued to rise and fall within statistical limits depending on water levels and turbulence and were probably due to naturally occurring isotopes. No fission or reactor activation products were detected. Figure I-2 illustrates the level of activity for tritium, Sr-89 and Sr-90.

FIGURE I-1
RIVER WATER
QUARTERLY AVERAGE - ALL LOCATIONS
GROSS ALPHA AND GROSS BETA (SUSPENDED AND DISSOLVED SOLIDS)

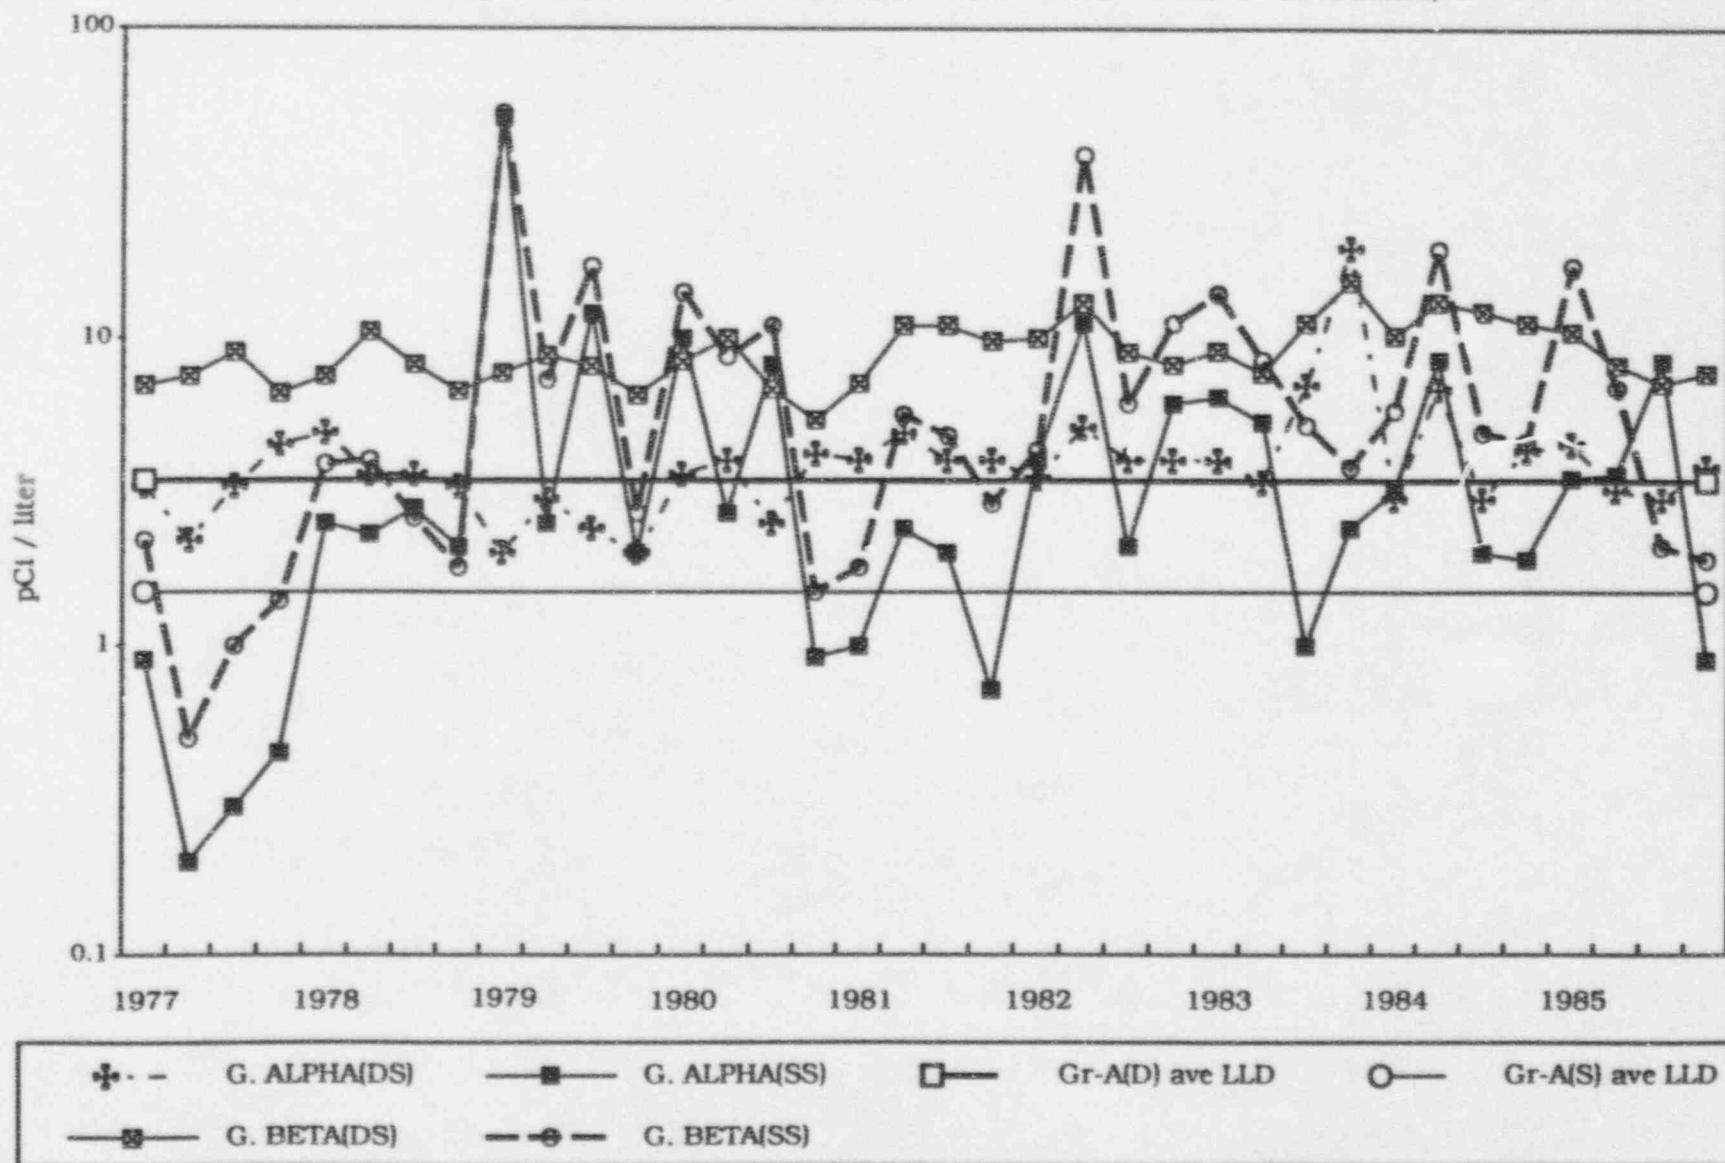


FIGURE I-1

RIVER WATER

QUARTERLY AVERAGE - ALL LOCATIONS

GROSS ALPHA AND GROSS BETA (SUSPENDED AND DISSOLVED SOLIDS)

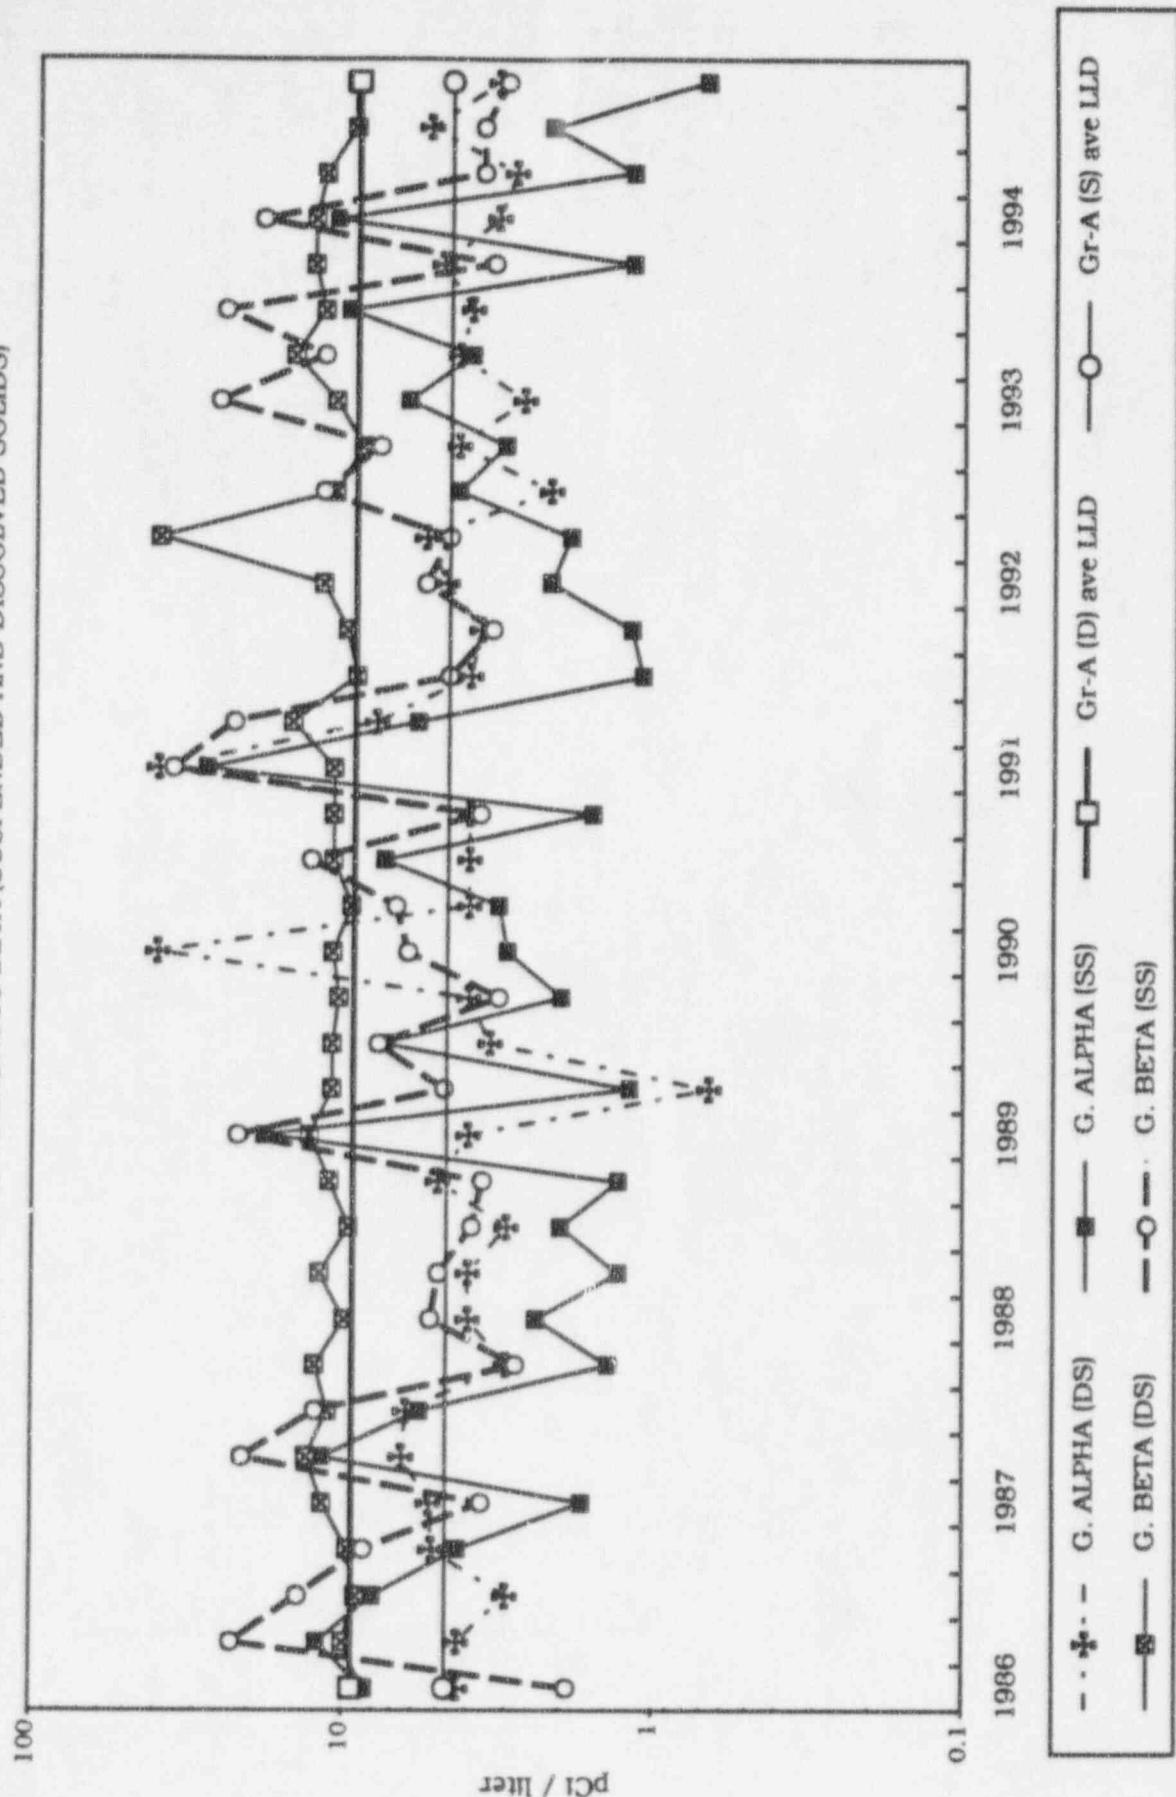


FIGURE I-2
RIVER WATER
QUARTERLY AVERAGE - ALL LOCATIONS
SR-89 SR-90 H-3

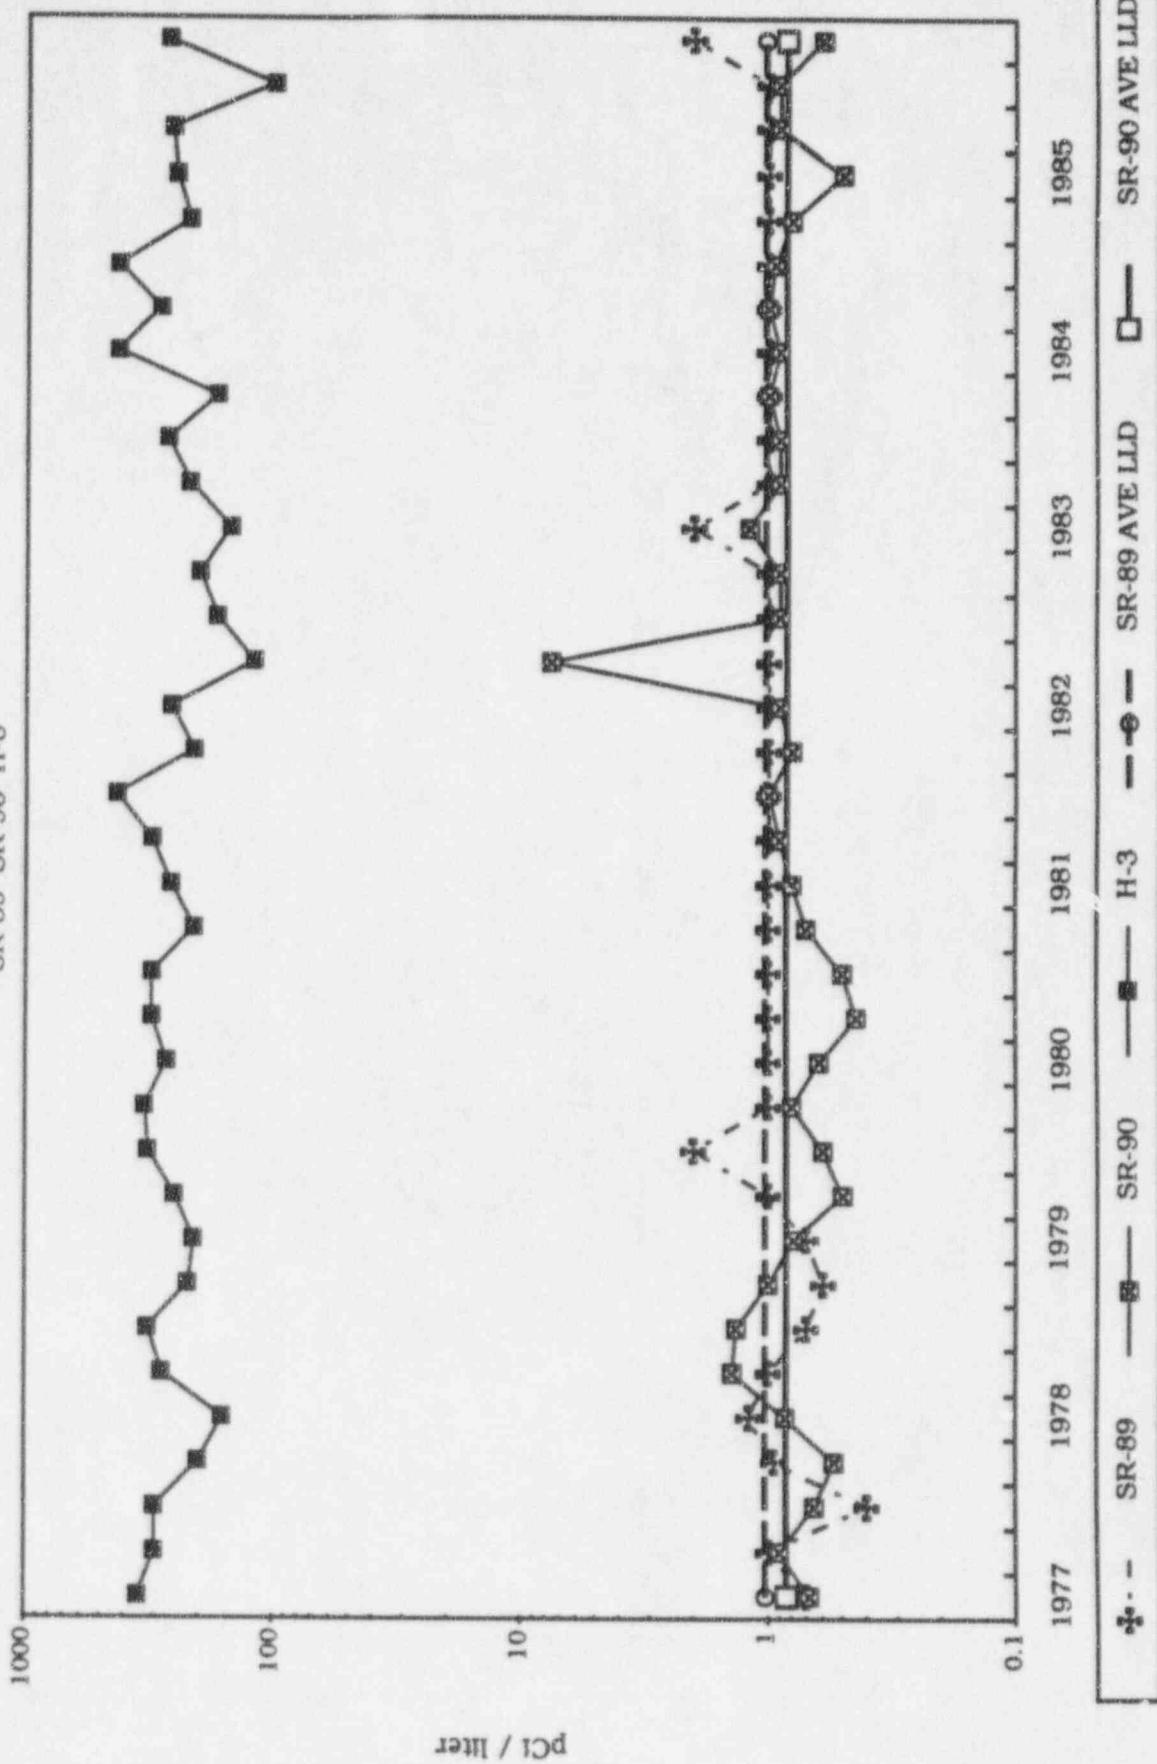


FIGURE 1-2
RIVER WATER

QUARTERLY AVERAGE - ALL LOCATIONS
SR-89 SR-90 H-3

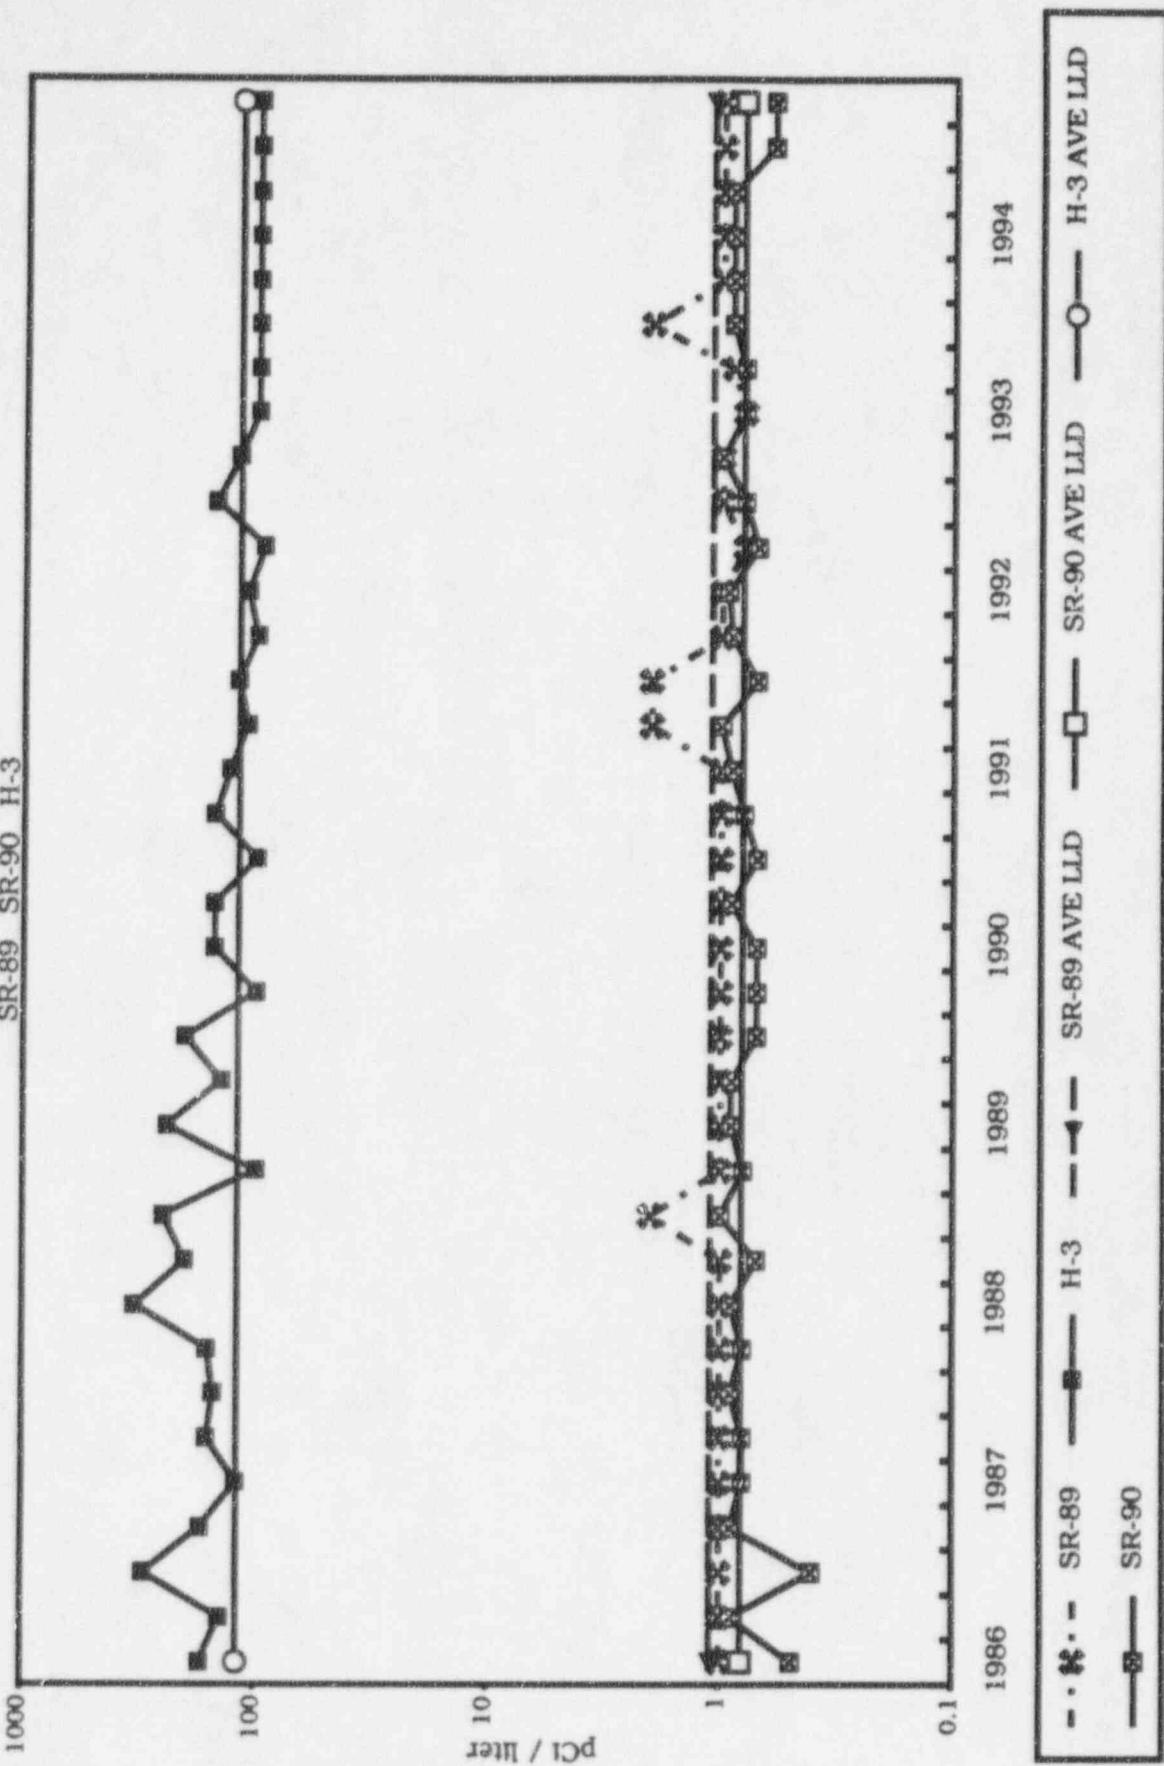


TABLE I-1
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - WATERBORNE
 WATER - RIVER
 PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/04-03/08	SECOND QUARTER 04/05-06/07*	THIRD QUARTER 07/06-09/06	FOURTH QUARTER 10/04-12/06
GROSS ALPHA (dissolved)	12, 28	Mean/std.dev. det./total range	3.3 ± 2.2 E 00 1/7 --	2.9 ± 0.1 E 00 2/6 (2.8-2.9)E 00	5.5 ± 1.7 E 00 2/6 (4.3-6.7)E 00	3.3 ± 0.7 E 00 3/6 (2.8-4.1)E 00
GROSS ALPHA (suspended)	12, 28	Mean/std.dev. det./total range	1.1 ± 1.7 E 01 3/7 (0.08-3.1) E 01	1.2 ± 0.7 E 00 6/6 (0.6-2.6)E 00	2.2 ± 2.2 E 00 5/6 (0.8-6.1)E 00	6.9 ± 1.4 E-01 4/6 (4.9-8.4)E-01
GROSS BETA (dissolved)	12, 28	Mean/std.dev. det./total range	1.3 ± 0.2 E 01 7/7 (0.9-1.5)E 01	1.2 ± 0.2 E 01 6/6 (9.7-15)E 00	9.6 ± 3.0 E 00 6/6 (0.55-1.2)E 01	9.7 ± 2.4 E 00 6/6 (7.0-13)E 00
GROSS BETA (suspended)	12, 28	Mean/std.dev. det./total range	1.9 ± 2.6 E 01 6/7 (0.08-5.6)E 01	3.7 ± 2.9 E 00 6/6 (0.8-8.3) E 00	3.7 ± 2.2 E 00 6/6 (2.0-7.5)E 00	3.1 ± 1.0 E 00 5/6 (1.5-3.9)E 00
Sr-89	12, 28	Mean/std.dev. det./total range	L.T. 1. E 00 0/7 --	L.T. 1. E 00 0/6 --	L.T. 1. E 00 0/6 --	L.T. 1. E 00 0/6 --
Sr-90	12, 28	Mean/std.dev. det./total range	L.T. 9 E-01 0/7 --	L.T. 9. E-01 0/6 --	L.T. 6. E-01 0/6 --	L.T. 6. E-01 0/6 --
H-3 (a)	12, 28	Mean/std.dev. det./total range	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --
I-131 (by gamma spectroscopy)	12, 28	Mean/std.dev. det./total range	L.T. 9. E 00 0/7 --	L.T. 9. E 00 0/6 --	L.T. 2. E 01 0/6 --	L.T. 1. E 01 0/6 --
Cs-137	12, 28	Mean/std.dev. det./total range	L.T. 4. E 00 0/7 --	L.T. 5. E 00 0/6 --	L.T. 4. E 00 0/6 --	L.T. 5. E 00 0/6 --

(a) Tritium analysis is performed on the quarterly composite of each station only.

*The June sample was collected from Station 35 because conditions at Station 12 were unsafe.

TABLE I-2
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - WATERBORNE
 WATER - RIVER
 PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/04-03/08	SECOND QUARTER 04/05-06/07*	THIRD QUARTER 07/06-09/06	FOURTH QUARTER 10/04-12/06
BE-7	12, 28	L.T. 4. E 01 (0/7)	L.T. 4. E 01 (0/6)	L.T. 3. E 01 (0/6)	L.T. 4. E 01 (0/6)
K-40	12, 28	4.75±2.21 E 01 (1/7)	7.44±0.72 E 01 (3/6)	5.2 ± 0.4 E 01 (6/6)	L.T. 1. E 02 (0/6)
Mn-54	12, 28	L.T. 4. E 00 (0/7)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Co-58	12, 28	L.T. 4. E 00 (0/7)	L.T. 5. E 00 (0/6)	L.T. 3. E 00 (0/6)	L.T. 4. E 00 (0/6)
Fe-59	12, 28	L.T. 8. E 00 (0/7)	L.T. 9. E 00 (0/6)	L.T. 7. E 00 (0/6)	L.T. 1. E 01 (0/6)
Co-60	12, 28	L.T. 4. E 00 (0/7)	L.T. 5. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Zn-65	12, 28	L.T. 8. E 00 (0/7)	L.T. 9. E 00 (0/6)	L.T. 6. E 00 (0/6)	L.T. 1. E 01 (0/6)
Zr-95	12, 28	L.T. 4. E 00 (0/7)	L.T. 5. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 5. E 00 (0/6)
Ru-103	12, 28	L.T. 4. E 00 (0/7)	L.T. 5. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 5. E 00 (0/6)
Ru-106	12, 28	L.T. 3. E 01 (0/7)	L.T. 4. E 01 (0/6)	L.T. 3. E 01 (0/6)	L.T. 4. E 01 (0/6)
I-131	12, 28	L.T. 9. E 00 (0/7)	L.T. 9. E 00 (0/6)	L.T. 2. E 01 (0/6)	L.T. 1. E 01 (0/6)
Cs-134	12, 28	L.T. 4. E 00 (0/7)	L.T. 5. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 5. E 00 (0/6)
Cs-137	12, 28	L.T. 4. E 00 (0/7)	L.T. 5. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 5. E 00 (0/6)
Ba-140	12, 28	L.T. 8. E 00 (0/7)	L.T. 8. E 00 (0/6)	L.T. 8. E 00 (0/6)	L.T. 7. E 00 (0/6)
Ce-141	12, 28	L.T. 9. E 00 (0/7)	L.T. 9. E 00 (0/6)	L.T. 8. E 00 (0/6)	L.T. 9. E 00 (0/6)
Ce-144	12, 28	L.T. 3. E 01 (0/7)	L.T. 4. E 01 (0/6)	L.T. 3. E 01 (0/6)	L.T. 3. E 01 (0/6)
Ra-226	12, 28	L.T. 1. E 02 (0/7)	L.T. 1. E 02 (0/6)	L.T. 1. E 02 (0/6)	L.T. 1. E 02 (0/6)
Th-228	12, 28	L.T. 9. E 00 (0/7)	L.T. 1. E 01 (0/6)	L.T. 9. E 00 (0/6)	L.T. 1. E 01 (0/6)

*The June sample was collected from Station 35 because conditions at Station 12 were unsafe.

J. AMBIENT RADIATION - THERMOLUMINESCENT DOSIMETERS

(TLDs - See Tables J-1 AND J-2)

STATIONS 01-10, 20, 44, 56, 58, 59, 66, 67, 71, 79-91, 94

Ambient radiation was monitored at 32 locations within a 10 mile radius of CNS and collected quarterly. The quarterly averages for all stations of ambient net gamma radiation ranged from 12.1 milliRoentgen/quarter to 23.8 milliRoentgen/quarter. The highest exposure during each of the four quarters was at Station 90 (2.25 miles, 134 degrees) and averaged 19.7 mR/quarter. The lowest exposure was at Station 04 (3.0 miles, 43 degrees) averaging 15.9 milliRoentgen/quarter.

The radiation at station 44, (10.5 miles, 270 degrees) which is the control station, was an average of 19.0 mR/quarter. This was similar to other stations and to the average of all stations which was 17.8 mR/quarter.

The average total exposure for the year was 71.3 mR which is considerably below the 125 millirems per quarter specified in 10 CFR 20.105 for an unrestricted area. The relationship between milliRoentgen (mR) and millirems (mr) is approximately one for the exposure conditions encountered. No plant effect from CNS was indicated.

The gamma exposures monitored by thermoluminescent dosimeters from 1977 through 1994 are plotted on Figure J-1. The data from year to year is in good agreement and indicates no adverse changes in radiation exposure to the population near CNS.

FIGURE J-1
AMBIENT RADIATION
THERMOLUMINESCENT DOSIMETRY
QUARTERLY AVERAGE - ALL LOCATIONS


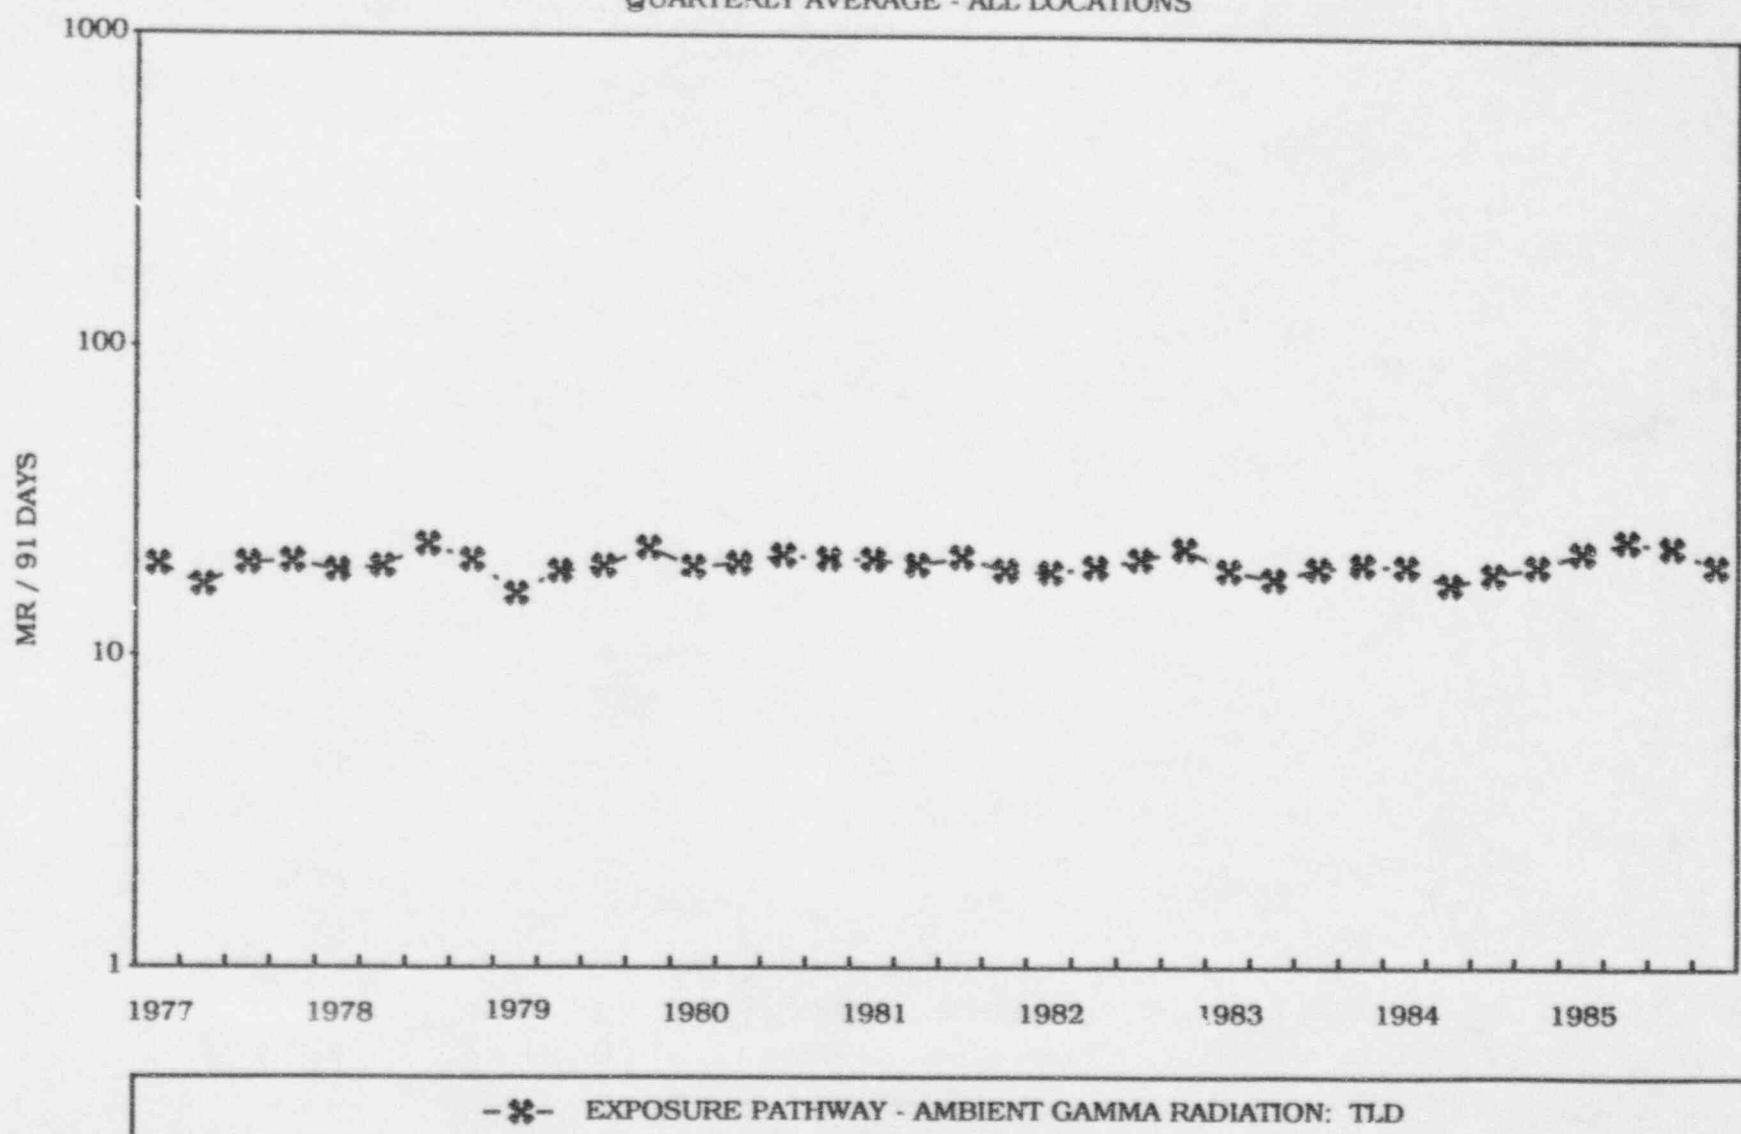


FIGURE J-1
AMBIENT RADIATION
THERMOLUMINESCENT DOSIMETRY
QUARTERLY AVERAGE - ALL LOCATIONS

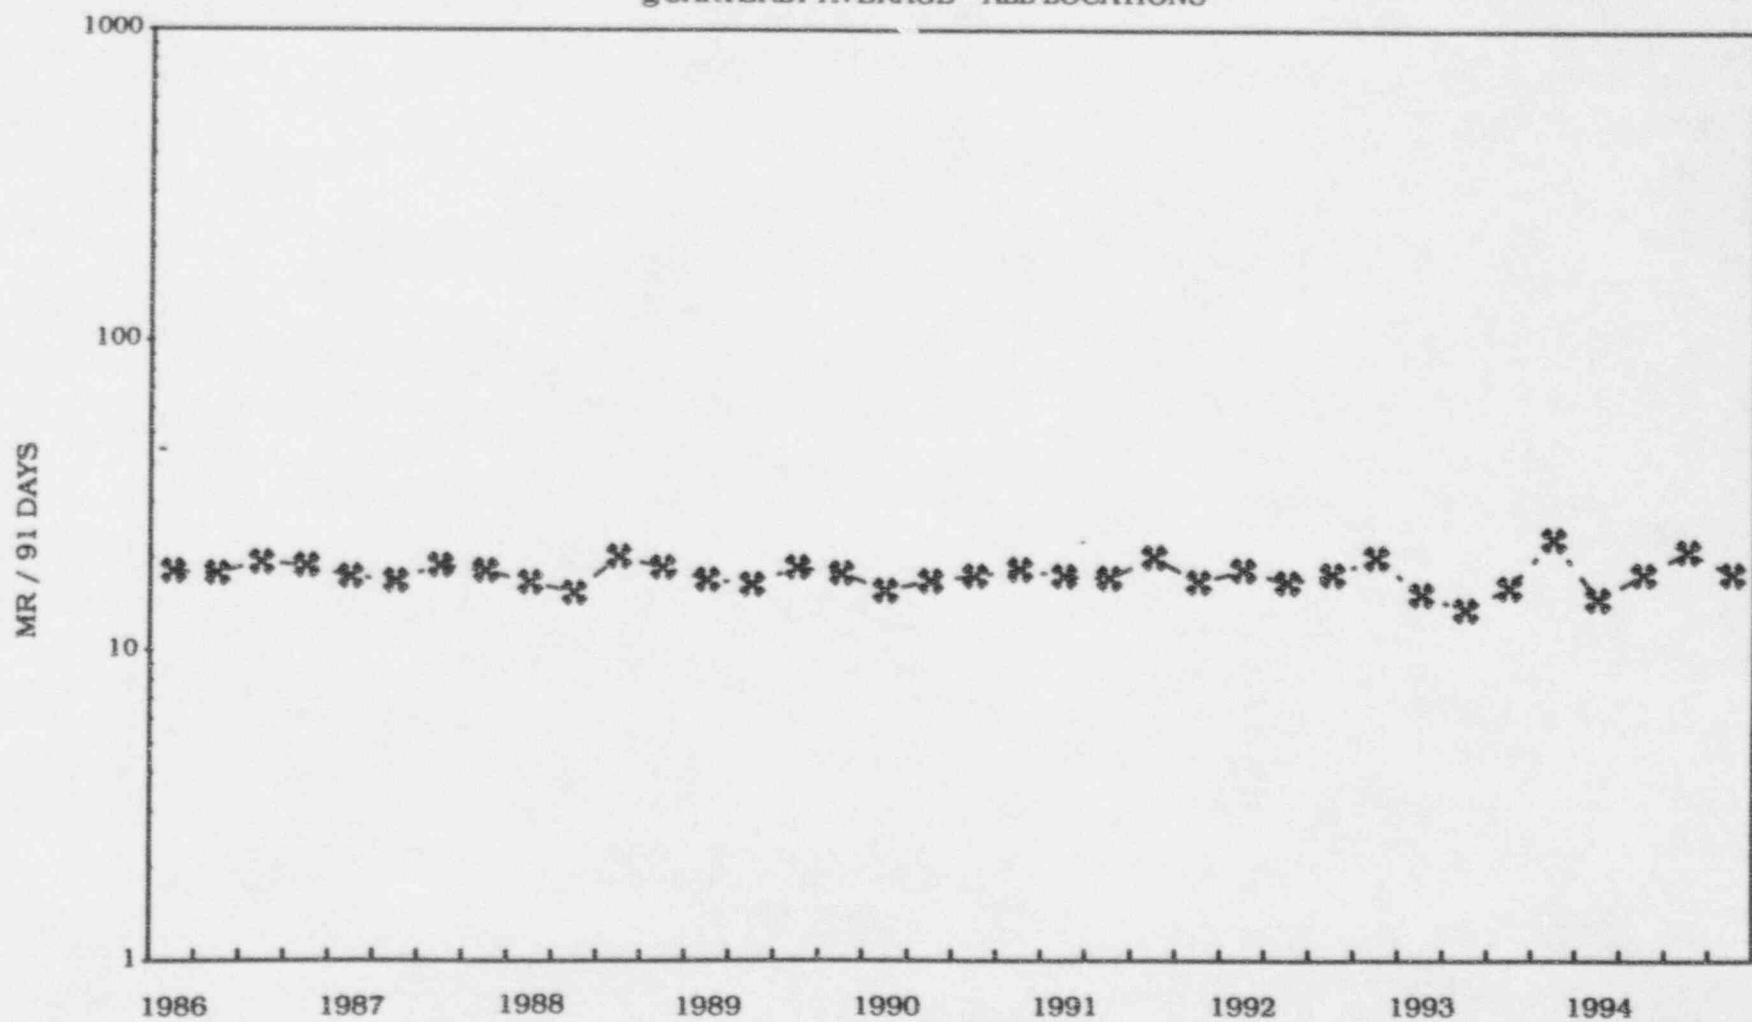

- x - EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD

TABLE J-1
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/07-04/13	SECOND QUARTER 04/12-06/29	THIRD QUARTER 06/28-10/12	FOURTH QUARTER 10/12/94-01/05/95
TLD (Gamma)	01	13.9 ± 0.8	15.9 ± 0.4	19.9 ± 1.3	17.0 ± 0.7
	02	13.0 ± 0.8	16.3 ± 1.9	18.9 ± 0.5	17.1 ± 0.6
	03	12.9 ± 1.0	18.4 ± 0.8	17.7 ± 2.3	15.5 ± 0.5
	04	12.1 ± 1.4	15.5 ± 0.8	19.6 ± 1.0	16.5 ± 0.9
	05	12.7 ± 1.4	17.9 ± 2.4	19.9 ± 1.5	16.1 ± 0.9
	06	14.1 ± 1.0	16.0 ± 1.5	20.0 ± 0.8	16.4 ± 0.7
	07	13.1 ± 0.6	17.6 ± 1.2	20.1 ± 0.9	17.1 ± 0.8
	08	14.2 ± 1.0	16.5 ± 1.5	20.1 ± 1.1	17.6 ± 1.2
	09	12.6 ± 1.9	15.6 ± 0.7	18.9 ± 1.1	19.1 ± 0.9
	10	12.9 ± 0.9	17.6 ± 0.8	19.3 ± 0.5	16.3 ± 1.1
	20	13.7 ± 1.8	15.7 ± 1.1	22.4 ± 1.1	18.0 ± 0.7
	44	15.5 ± 1.1	16.6 ± 2.4	22.4 ± 1.4	21.4 ± 0.5
	56	12.2 ± 2.0	17.4 ± 1.2	20.7 ± 0.9	18.7 ± 0.7
	58	13.2 ± 0.6	18.0 ± 1.9	21.1 ± 1.3	20.1 ± 0.7
	59	14.7 ± 0.6	16.5 ± 0.5	21.9 ± 1.3	17.4 ± 0.8
	66	17.1 ± 0.8	18.0 ± 0.8	23.4 ± 1.4	18.8 ± 1.1
	67	15.7 ± 1.1	20.0 ± 2.5	22.4 ± 1.4	16.2 ± 0.6
	71	16.5 ± 0.9	17.0 ± 1.2	23.8 ± 1.2	20.0 ± 0.9

TABLE J-1
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/07-04/13	SECOND QUARTER 04/12-06/29	THIRD QUARTER 06/28-10/12	FOURTH QUARTER 10/12/94-01/05/95
TLD (Gamma)	79	15.4 ± 1.0	17.2 ± 0.4	20.5 ± 0.7	17.1 ± 0.7
	80	15.9 ± 0.9	17.9 ± 0.8	21.4 ± 1.6	17.1 ± 1.1
	81	17.0 ± 1.1	19.3 ± 2.2	22.2 ± 0.6	18.0 ± 1.1
	82	15.6 ± 1.6	18.2 ± 1.4	21.4 ± 1.4	19.7 ± 1.8
	83	16.1 ± 1.0	19.0 ± 1.8	22.4 ± 1.1	17.0 ± 0.5
	84	19.3 ± 2.0	19.3 ± 0.6	21.9 ± 1.2	18.1 ± 0.6
	85	14.6 ± 1.0	19.5 ± 0.5	20.5 ± 1.4	17.2 ± 0.6
	86	15.7 ± 1.1	17.7 ± 0.7	21.4 ± 1.0	21.5 ± 1.1
	87	15.9 ± 0.7	18.2 ± 1.2	21.4 ± 1.6	17.1 ± 1.1
	88	14.0 ± 1.3	17.4 ± 1.3	20.6 ± 0.9	17.9 ± 0.9
	89	15.3 ± 1.2	17.4 ± 0.6	23.0 ± 1.6	17.4 ± 0.7
	90	15.4 ± 1.1	23.0 ± 0.8	21.5 ± 1.3	19.0 ± 0.9
	91	13.9 ± 0.9	16.5 ± 0.9	19.8 ± 1.2	16.4 ± 0.5
	94	16.3 ± 1.0	20.6 ± 1.4	22.5 ± 1.7	16.7 ± 1.6
Average/Quarter		94.9 days 14.7±1.7 mR/94.9 days	76.4 days 17.7±1.6 mR/76.4 days	106.4 days 21.0±1.4 mR/106.4 days	84.48 days 18 ± 1.5 mR/84.48 days
Average/Day		0.15±0.02 mR/day	0.23±0.02 mR day	0.20±0.01 mR day	0.21±0.02 mR day
Range		(12-19)mR/94.9 days	(16-23)mR 76.4 days	(18-24)mR 106.4 days	(16-22)mR 84.48 days
Det./Total		32/32	32/32	32/32	32/32

TABLE J-2
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD
 milliRoentgen/Quarter

<u>SAMPLE NUCLIDE</u>	<u>STATION NUMBER</u>	<u>Aver./Quarter</u>	<u>TOTAL mR/year</u>
			01/11/94-01/05/95
TLD (Gamma)	01	16.7 ± 2.5	66.7
	02	16.3 ± 2.5	65.3
	03	16.1 ± 2.5	64.5
	04	15.9 ± 3.1	63.7
	05	16.7 ± 3.1	66.6
	06	16.6 ± 2.5	66.5
	07	17.0 ± 2.9	67.9
	08	17.4 ± 2.9	69.4
	09	16.6 ± 3.1	66.2
	10	16.5 ± 2.7	66.1
	20	17.5 ± 3.7	69.8
	44	19.0 ± 3.4	75.9
	56	17.3 ± 3.6	69.0
	58	16.1 ± 3.5	72.4
	59	17.6 ± 3.1	70.5
	66	19.3 ± 2.8	77.3
	67	18.6 ± 3.2	74.3
	71	19.3 ± 3.4	77.3

91

TABLE J-2

1994 QUARTERLY REPORT

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION:
TLD

milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	Aver./Quarter	TOTAL mR/year 01/11/94-01/05/95
TLD (Gamma)	79	17.6 ± 2.1	70.2
	80	18.1 ± 2.4	72.3
	81	19.1 ± 2.3	76.5
	82	18.7 ± 2.5	74.9
	83	18.6 ± 2.8	74.5
	84	19.7 ± 1.6	78.6
	85	18.0 ± 2.6	71.8
	86	19.1 ± 2.9	76.3
	87	18.2 ± 2.4	72.6
	88	17.5 ± 2.7	69.9
	89	18.3 ± 3.3	73.1
	90	19.7 ± 3.3	78.9
	91	16.7 ± 2.4	66.6
	94	19.0 ± 3.0	76.1
		17.8 ± 0.5 Average mR/Quarter	71.3 ± 4.5
		Range(16-20)	Aver. total mR year. All stations
			Range (63.7-78.9)

K. VEGETATION, BROADLEAF (See Tables K-1 and K-2)

STATIONS 28, 35, 44

Broadleaf vegetation was collected each month during the growing season, May through October. Three samples were collected each month from each station plus a quality control sample. The samples were tested for I-131 by chemical separation and for gamma emitting isotopes by high resolution spectrometry.

The naturally occurring isotopes Be-7, K-40, Ra-226 and Th-228 were detected in the samples at normal environmental levels. No I-131 was detected in any of the 60 samples. Cesium-137 was detected in one sample at an average of 0.016 pCi/gm, wet. Cesium-137 is detected in other areas of the United States and is attributed to fallout from previous atomic weapons testing. The amounts detected are not considered to be significant.

See Figure K-1 for the levels of activities in food samples as represented in broadleaf vegetation in 1994.

FIGURE K-1
 FOOD - BROADLEAF VEGETATION
 QUARTERLY AVERAGE - ALL STATIONS
 K-40 I-131 CS-137

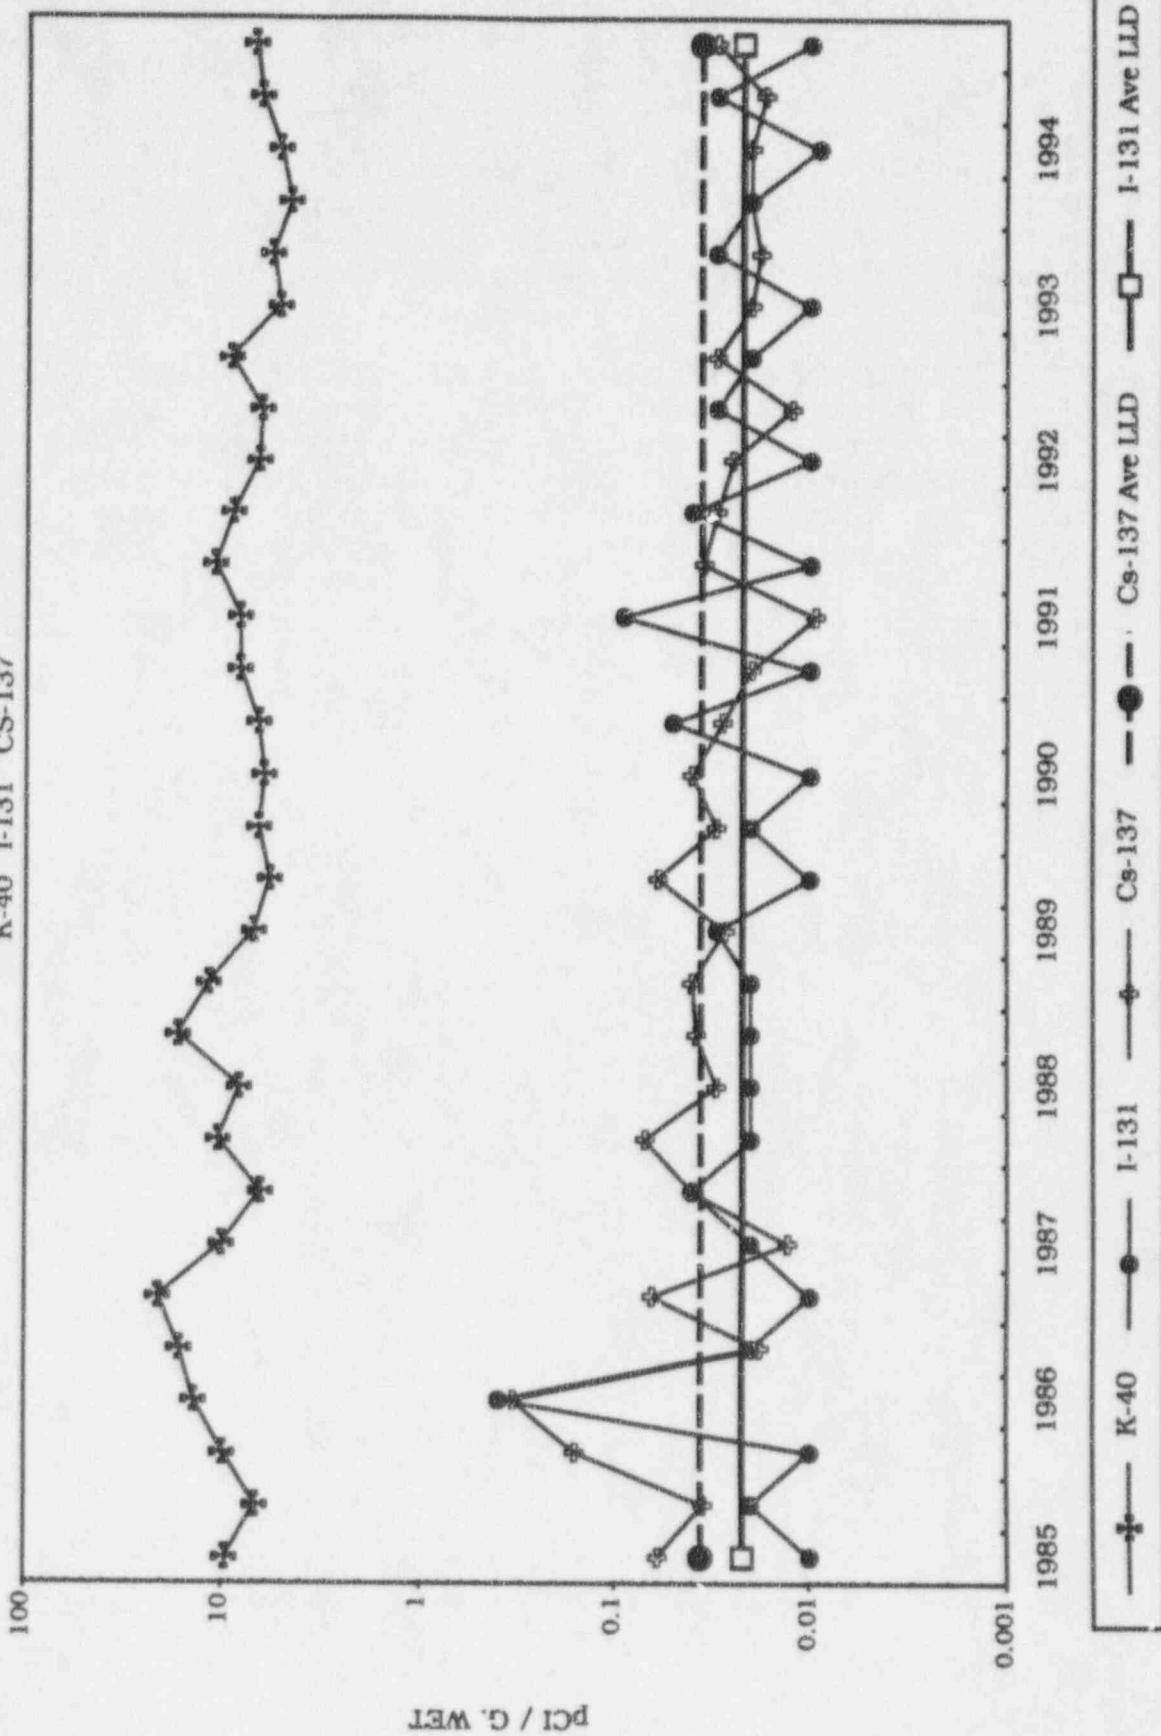


TABLE K-1
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
BROADLEAF TERRESTRIAL VEGETATION
PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER		SECOND QUARTER 05/10, 06/21	THIRD QUARTER 07/19, 08/16, 09/20	FOURTH QUARTER 10/18
I-131 (by chemical (separation)	28,35,44	Mean/std.dev. det./total range	L.T. 9. E-03 0/20 --	L.T. 3. E-02 0/30 --	L.T. 1. E-02 0/10 --
Be-7	28,35,44	Mean/std.dev. det./total range	8.7 ± 4.4 E-01 20/20 (0.2 - 2.0)E 00	1.79±1.0 E 00 29/30 (0.2-4.8)E 00	2.71±2.49 E 00 10/10 (0.78-8.99)E 00
K-40	28,35,44	Mean/std.dev. det./total range	5.2 ± 1.1 E 00 20/20 (3.1 - 7.9)E 00	6.47±2.52E 00 30/30 (2.5-12)E 00	6.98±2.91E 00 10/10 (3.06-11)E 00
Co-60	28,35,44	Mean/std.dev. det./total range	L.T. 2. E-02 0/20 --	L.T. 3. E-02 0/30 --	L.T. 3. E-02 0/10 --
Ru-103	28,35,44	Mean/std.dev. det./total range	L.T. 2. E-02 0/20 --	L.T. 3. E-02 0/30 --	L.T. 3. E-02 0/10 --
I-131 (by gamma spectroscopy)	28,35,44	Mean/std.dev. det./total range	L.T. 4. E-02 0/20 --	L.T. 5. E-02 0/30 --	L.T. 6. E-02 0/10 --
Cs-134	28,35,44	Mean/std.dev. det./total range	L.T. 2. E-02 0/20 --	L.T. 3. E-02 0/30 --	L.T. 3. E-02 0/10 --
Cs-137	28,35,44	Mean/std.dev. det./total range	L.T. 2. E-02 0/20 --	1.7 ± 0.5E-02 4/30 (1.0-2.0)E-02	L.T. 3. E-02 0/10 --

TABLE K-1
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 BROADLEAF TERRESTRIAL VEGETATION
 PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER		SECOND QUARTER 05/10, 06/21	THIRD QUARTER 07/19, 08/16, 09/20	FOURTH QUARTER 10/18
Ba-140	28, 35, 44	Mean and std.dev. det./total range	L. T. 3. E-02 0/20 --	L. T. 4. E-02 0/30 --	L. T. 4. E-02 0/10 --
Ra-226	28, 35, 44	Mean and std.dev. det./total range	L. T. 4. E-01 0/20 --	L. T. 6. E-01 0/30 --	L. T. 5. E-01 0/10 --
Th-228	28, 35, 44	Mean and std.dev. det./total range	L. T. 4. E-02 0/20 --	5.02 ± 1.1 E-02 2/30 (4.3-5.8)E-02	L. T. 4. E-02 0/10 --

TABLE K-2
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 BROADLEAF TERRESTRIAL VEGETATION - PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER	SECOND QUARTER 05/10, 06/21	THIRD QUARTER 07/19, 08/16, 09/20	FOURTH QUARTER 10/18
BE-7	28,35,44		8.7 ± 4.4 E-01 (20/20)	1.79± 1.0 E 00 (29/30)	2.71±2.49E 00 (10/10)
K-40	28,35,44		5.2 ± 1.1 E 00 (20/20)	6.47±2.52E 00 (30/30)	6.98±2.91E 00 (10/10)
Mn-54	28,35,44		L.T. 2. E-02 (0/20)	L.T. 2. E-02 (0/30)	L.T. 2. E-02 (0/10)
Co-58	28,35,44		L.T. 2. E-02 (0/20)	L.T. 2. E-02 (0/30)	L.T. 2. E-02 (0/10)
Fe-59	28,35,44		L.T. 4. E-02 (0/20)	L.T. 6. E-02 (0/30)	L.T. 6. E-02 (0/10)
Co-60	28,35,44		L.T. 2. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 3. E-02 (0/10)
Zn-65	28,35,44		L.T. 4. E-02 (0/20)	L.T. 6. E-02 (0/30)	L.T. 6. E-02 (0/10)
Zr-95	28,35,44		L.T. 2. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 3. E-02 (0/10)
Ru-103	28,35,44		L.T. 2. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 3. E-02 (0/10)
Ru-106	28,35,44		L.T. 2. E-01 (0/20)	L.T. 2. E-01 (0/30)	L.T. 2. E-01 (0/10)
I-131	28,35,44		L.T. 4. E-02 (0/20)	L.T. 5. E-02 (0/30)	L.T. 6. E-02 (0/10)
Cs-134	28,35,44		L.T. 2. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 3. E-02 (0/10)
Cs-137	28,35,44		L.T. 2. E-02 (0/20)	1.7 ± 0.5 E-02 (4/30)	L.T. 3. E-02 (0/10)
Ba-140	28,35,44		L.T. 3. E-02 (0/20)	L.T. 4. E-02 (0/30)	L.T. 4. E-02 (0/10)
Ce-141	28,35,44		L.T. 4. E-02 (0/20)	L.T. 5. E-02 (0/30)	L.T. 4. E-02 (0/10)
Ce-144	28,35,44		L.T. 1. E-01 (0/20)	L.T. 2. E-01 (0/30)	L.T. 2. E-01 (0/10)
Ra-226	28,35,44		L.T. 4. E-01 (0/20)	L.T. 6. E-01 (0/30)	L.T. 5. E-01 (0/10)
Th-228	28,35,44		L.T. 4. E-02 (0/20)	5.02± 1.1 E-02 (2/30)	L.T. 4. E-02 (0/10)

L SHORELINE SEDIMENT

STATION 28

Shoreline sediment samples were collected in the spring and fall from Station 28, 1.8 miles, 150 degrees downstream of the release point of CNS. They were analyzed for gamma emitters by means of a high resolution gamma spectrometer. In the samples collected the naturally occurring isotopes Be-7, K-40, Ra-226 and Th-228 were detected at normal environmental levels. Cesium-137, a fission product, was detected at an average level of 0.082 pCi/gm, dry.

For the samples collected in the fourth quarter the naturally occurring isotopes K-40, Ra-226 and Th-228 were detected at about the same level as in the second quarter. Beryllium-7 was below the normal detection level in the second quarter and 0.14 in the fourth quarter. The average manganese-54, an activation product, was detected at a level of 0.014 pCi/gm dry. All other nuclides were below the detection limit for both the spring and fall.

Presented in Figure L-1 are the plots of the radionuclides K-40, I-131, Cs-134 and Cs-137 in shoreline sediment since 1985. No detections of I-131 nor Cs-134 were seen and K-40 was at a normal environmental level. The Cs-137 was at a low level which is found in many areas and media. Since sediment tends to trap and retain any elements in the water pathway, it acts as a good indicator of the effects on the water pathway of any reactor effluents.

FIGURE L-1
SHORELINE SEDIMENT
QUARTERLY AVERAGE - STATION 28
K-40 I-131 CS-134 CS-137

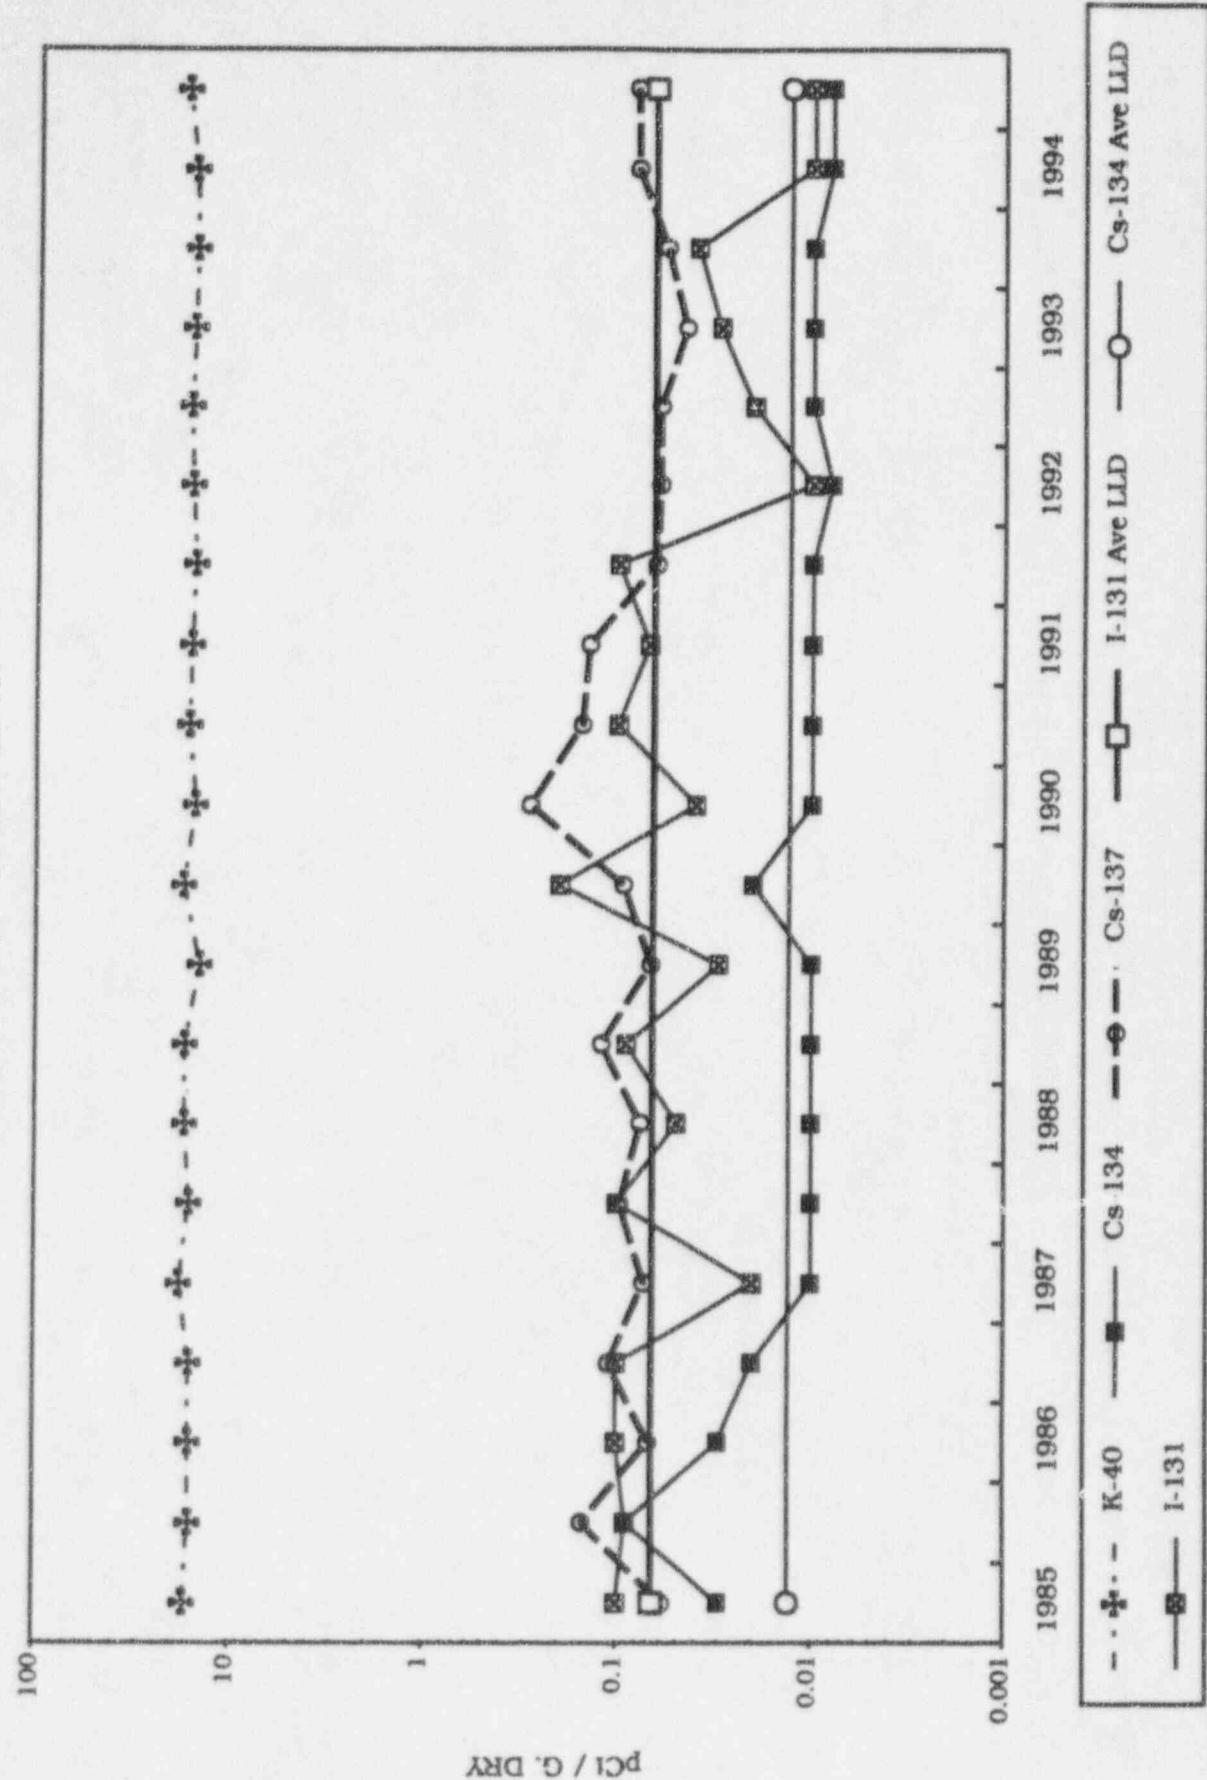


TABLE L-1
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AQUATIC
 SHORELINE SEDIMENT - PCI/GM, DRY

SAMPLE NUCLIDE	STATION NUMBER		SECOND QUARTER 05/03	THIRD QUARTER	FOURTH QUARTER 10/25
Be-7	28	Mean±std.dev. det./total range	L.T. 6. E-02 0/1 --		1.37±0.6 E-01 2/2 (0.9-1.8)E-01
K-40	28	Mean±std.dev. det./total range	1.57 ± 0.16E 01 1/1 --		1.73±0.16E 01 2/2 (1.62-1.84)E 01
Mn-54	28	Mean±std.dev. det./total range	1.81 ± 0.43E-02 1/1 --		1.26±0.66E-02 2/2 (0.79-1.73)E-02
CO-60	28	Mean±std.dev. det./total range	L.T. 6. E-03 0/1 --		L.T. 6. E-03 0/2 --
I-131 (by gamma spectroscopy)	28	Mean±std.dev. det./total range	L.T. 1. E-02 0/1 --		L.T. 1. E-02 0/2 --
Cs-134	28	Mean±std.dev. det./total range	L.T. 8. E-03 0/1 --		L.T. 8. E-03 0/2 --
Cs-137	28	Mean±std.dev. det./total range	8.16 ± 0.82E-02 1/1 --		8.20±0.84E-02 2/2 (7.60-8.79)E-02
Ra-226	28	Mean±std.dev. det./total range	1.56 ± 0.16E 00 1/1 --		1.81±0.21E 00 2/2 (1.66-1.96)E 00
Th-228	28	Mean±std.dev. det./total range	8.00 ± 0.80E-01 1/1 --		9.05±1.24E-01 2/2 (8.17-9.93)E-01

TABLE L-2
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AQUATIC
 SHORELINE SEDIMENT - PCI/GM, DRY

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER	SECOND QUARTER 05/03	THIRD QUARTER	FOURTH QUARTER 10/25
BE-7	28		L.T. 6. E-02(0/1)		1.37±0.6 E-01(2/2)
K-40	28		1.57±0.16 E 01(1/1)		1.73±0.16E 01(2/2)
Mn-54	28		1.81 ±0.43E-02(1/1)		1.26±0.66E-02(2/2)
Co-58	28		L.T. 6. E-03(0/1)		L.T. 6. E-03(0/2)
Fe-59	28		L.T. 2. E-02(0/1)		L.T. 1. E-02(0/2)
Co-60	28		L.T. 6. E-03(0/1)		L.T. 6. E-03(0/2)
Zn-65	28		L.T. 2. E-02(0/1)		L.T. 2. E-02(0/2)
Zr-95	28		L.T. 8. E-03(0/1)		L.T. 8. E-03(0/2)
Ru-103	28		L.T. 7. E-03(0/1)		L.T. 7. E-03(0/2)
Ru-106	28		L.T. 5. E-02(0/1)		L.T. 5. E-02(0/2)
I-131	28		L.T. 1. E-02(0/1)		L.T. 1. E-02(0/2)
Cs-134	28		L.T. 8. E-03(0/1)		L.T. 8. E-03(0/2)
Cs-137	28		8.16±0.82 E-02(1/1)		8.20±0.84 E-02(0/2)
Ba-140	28		L.T. 1. E-02(0/1)		L.T. 1. E-02(0/2)
Ce-141	28		L.T. 1. E-02(0/1)		L.T. 1. E-02(0/2)
Ce-144	28		L.T. 5. E-02(0/1)		L.T. 5. E-02(0/2)
Ra-226	28		1.56±0.16 E 00(1/1)		1.61±0.21 E 00(2/2)
Th-228	28		8.00±0.80 E-01(1/1)		9.05±1.24 E-01(2/2)

SECTION VII
COMPLETE DATA TABLES

A, B, C,

GROSS ALPHA, GROSS BETA, I-131

STATIONS 01-10

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 01

STATION 01 - 0.1 MI. 225 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04	1.01E 04	CU. FT.	2.9 ± 0.3 E-02	3.7 ± 1.7 E-03	01/12	L.T. 4. E-02
01/04	01/11	1.01E 04	CU. FT.	4.4 ± 0.4 E-02	4.4 ± 1.7 E-03	01/18	L.T. 4. E-02
01/11	01/18	1.01E 04	CU. FT.	3.9 ± 0.4 E-02	4.5 ± 1.6 E-03	01/25	L.T. 5. E-02
01/18	01/25	1.01E 04	CU. FT.	4.1 ± 0.4 E-02	3.1 ± 1.5 E-03	01/29	L.T. 2. E-02
01/25	02/01	9.80E 03	CU. FT.	3.2 ± 0.3 E-02	3.1 ± 1.5 E-03	02/05	L.T. 3. E-02
02/01	02/08	1.02E 04	CU. FT.	3.2 ± 0.3 E-02	1.2 ± 1.0 E-03	02/16	L.T. 4. E-02
02/08	02/15	1.02E 04	CU. FT.	2.6 ± 0.3 E-02	2.5 ± 1.4 E-03	02/19	L.T. 3. E-02
02/15	02/22	1.03E 04	CU. FT.	3.4 ± 0.3 E-02	3.7 ± 1.5 E-03	02/25	L.T. 2. E-02
02/22	03/01	1.02E 04	CU. FT.	2.4 ± 0.3 E-02	3.6 ± 1.5 E-03	03/08	L.T. 4. E-02
03/01	03/08	8.48E 03	CU. FT.	2.7 ± 0.4 E-02	2.5 ± 1.5 E-03	03/12	L.T. 4. E-02
03/08	03/15	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	2.9 ± 1.4 E-03	03/19	L.T. 3. E-02
03/15	03/22	1.00E 04	CU. FT.	1.4 ± 0.3 E-02	2.7 ± 1.5 E-03	03/26	L.T. 2. E-02
03/22	03/29	1.03E 04	CU. FT.	1.7 ± 0.3 E-02	2.1 ± 1.3 E-03	04/03	L.T. 3. E-02
03/29	04/05	9.80E 03	CU. FT.	1.6 ± 0.3 E-02	1.9 ± 1.5 E-03	04/08	L.T. 2. E-02
04/05	04/12	1.02E 04	CU. FT.	2.1 ± 0.3 E-02	1.8 ± 1.2 E-03	04/19	L.T. 4. E-02
04/12	04/19	9.91E 03	CU. FT.	2.0 ± 0.3 E-02	2.5 ± 1.5 E-03	04/23	L.T. 2. E-02
04/19	04/26	1.02E 04	CU. FT.	1.7 ± 0.3 E-02	2.5 ± 1.5 E-03	05/03	L.T. 4. E-02
04/26	05/03	1.00E 04	CU. FT.	1.2 ± 0.3 E-02	1.3 ± 1.1 E-03	05/07	L.T. 2. E-02
05/03	05/10	1.00E 04	CU. FT.	2.0 ± 0.3 E-02	L.T. 1. E-03	05/17	L.T. 4. E-02
05/10	05/17	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	3.9 ± 1.6 E-03	05/22	L.T. 4. E-02
05/17	05/24	1.01E 04	CU. FT.	2.7 ± 0.4 E-02	L.T. 1. E-03	05/28	L.T. 4. E-02
05/24	05/31	1.01E 04	CU. FT.	1.8 ± 0.3 E-02	1.6 ± 1.0 E-03	06/05	L.T. 2. E-02
05/31	06/07	1.01E 04	CU. FT.	1.9 ± 0.3 E-02	1.3 ± 1.0 E-03	06/12	L.T. 2. E-02
06/07	06/14	1.00E 04	CU. FT.	1.7 ± 0.3 E-02	L.T. 1. E-03	06/18	L.T. 2. E-02
06/14	06/21	1.05E 04	CU. FT.	1.8 ± 0.3 E-02	1.5 ± 1.2 E-03	06/26	L.T. 3. E-02
06/21	06/28	9.67E 03	CU. FT.	2.3 ± 0.3 E-02	3.3 ± 1.7 E-03	06/30	L.T. 4. E-02
06/28	07/06	1.15E 04	CU. FT.	2.3 ± 0.3 E-02	1.9 ± 1.1 E-03	07/09	L.T. 1. E-02
07/06	07/12	8.63E 03	CU. FT.	1.8 ± 0.3 E-02	L.T. 2. E-03	07/16	L.T. 3. E-02
07/12	07/19	1.01E 04	CU. FT.	2.9 ± 0.4 E-02	1.1 ± 1.1 E-03	07/22	L.T. 2. E-02
07/19	07/26	1.02E 04	CU. FT.	2.6 ± 0.3 E-02	1.4 ± 1.1 E-03	07/30	L.T. 3. E-02
07/26	08/02	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	2.3 ± 1.6 E-03	08/05	L.T. 2. E-02
08/02	08/09	9.99E 03	CU. FT.	2.9 ± 0.3 E-02	2.8 ± 1.7 E-03	08/12	L.T. 3. E-02
08/09	08/16	1.00E 04	CU. FT.	1.9 ± 0.3 E-02	2.1 ± 1.2 E-03	08/20	L.T. 3. E-02
08/16	08/23	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	2.4 ± 1.4 E-03	08/27	L.T. 3. E-02
08/23	08/30	1.04E 04	CU. FT.	2.2 ± 0.3 E-02	2.0 ± 1.1 E-03	09/02	L.T. 3. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 01

STATION 01 - 0.1 MI. 225 DEG. IND.

COLL. START DATE	TIME STOP DATE	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
VOLUME	UNITS						
08/30	09/06	9.92E 03	CU. FT.	2.0 ± 0.3 E-02	2.6 ± 1.3 E-03	09/10	L.T. 2. E-02
09/06	09/13	1.05E 04	CU. FT.	3.5 ± 0.4 E-02	1.7 ± 1.4 E-03	09/17	L.T. 3. E-02
09/13	09/20	9.82E 03	CU. FT.	2.2 ± 0.3 E-02	1.3 ± 1.0 E-03	09/23	L.T. 3. E-02
09/20	09/27	9.94E 03	CU. FT.	1.9 ± 0.3 E-02	L.T. 1. E-03	10/01	L.T. 2. E-02
09/27	10/04	9.87E 03	CU. FT.	2.4 ± 0.3 E-02	2.5 ± 1.4 E-03	10/07	L.T. 3. E-02
10/04	10/11	9.94E 03	CU. FT.	2.7 ± 0.3 E-02	1.3 ± 1.1 E-03	10/15	L.T. 3. E-02
10/11	10/18	1.02E 04	CU. FT.	2.2 ± 0.3 E-02	L.T. 2. E-03	10/21	L.T. 1. E-02
10/18	10/25	9.98E 03	CU. FT.	2.3 ± 0.3 E-02	2.5 ± 1.4 E-03	10/28	L.T. 3. E-02
10/25	11/01	1.06E 04	CU. FT.	2.6 ± 0.3 E-02	0.94± 0.81 E-03	11/05	L.T. 3. E-02
11/01	11/08	9.65E 03	CU. FT.	2.7 ± 0.3 E-02	2.8 ± 1.5 E-03	11/12	L.T. 3. E-02
11/08	11/15	1.05E 04	CU. FT.	3.3 ± 0.4 E-02	1.3 ± 1.1 E-03	11/19	L.T. 3. E-02
11/15	11/22	9.72E 03	CU. FT.	2.2 ± 0.3 E-02	2.2 ± 1.3 E-03	11/30	L.T. 5. E-02
11/22	11/29	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	1.6 ± 1.2 E-03	12/03	L.T. 3. E-02
11/29	12/06	9.94E 03	CU. FT.	3.5 ± 0.4 E-02	1.6 ± 1.0 E-03	12/10	L.T. 3. E-02
12/06	12/13	9.76E 03	CU. FT.	5.0 ± 0.4 E-02	3.1 ± 1.6 E-03	12/17	L.T. 3. E-02
12/13	12/20	9.88E 03	CU. FT.	4.6 ± 0.4 E-02	3.4 ± 1.4 E-03	12/23	L.T. 3. E-02
12/20	12/27	1.04E 04	CU. FT.	2.9 ± 0.3 E-02	2.1 ± 1.3 E-03	12/31	L.T. 3. E-02
12/27	01/03	9.83E 03	CU. FT.	4.2 ± 0.4 E-02	2.7 ± 1.3 E-03	01/05	L.T. 3. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 02

STATION 02 - 0.75 MI. 225 DEG. IND.

COLL. START DATE	TIME STOP DATE	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
VOLUME	UNITS						
12/28	01/04*						
01/04	01/11	1.02E 04	CU. FT.	4.1 ± 0.4 E-02	3.2 ± 1.5 E-03	01/18	L.T. 4. E-02
01/11	01/18	1.01E 04	CU. FT.	3.7 ± 0.4 E-02	3.5 ± 1.5 E-03	01/25	L.T. 5. E-02
01/18	01/26	1.07E 04	CU. FT.	3.9 ± 0.4 E-02	2.5 ± 1.3 E-03	01/29	L.T. 1. E-02
01/26	02/01	8.55E 03	CU. FT.	3.4 ± 0.4 E-02	2.8 ± 1.5 E-03	02/05	L.T. 3. E-02
02/01	02/08	1.02E 04	CU. FT.	2.0 ± 0.3 E-02	2.1 ± 1.2 E-03	02/16	L.T. 4. E-02
02/08	02/15	1.02E 04	CU. FT.	2.4 ± 0.3 E-02	1.9 ± 1.3 E-03	02/19	L.T. 3. E-02
02/15	02/22	1.03E 04	CU. FT.	2.7 ± 0.3 E-02	2.7 ± 1.3 E-03	02/25	L.T. 2. E-02
02/22	03/01	1.02E 04	CU. FT.	1.9 ± 0.3 E-02	2.6 ± 1.3 E-03	03/08	L.T. 4. E-02
03/01	03/08	9.58E 03	CU. FT.	1.6 ± 0.3 E-02	2.1 ± 1.3 E-03	03/12	L.T. 3. E-02
03/08	03/15	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	1.8 ± 1.2 E-03	03/19	L.T. 3. E-02
03/15	03/22	1.00E 04	CU. FT.	1.4 ± 0.3 E-02	L.T. 1. E-03	03/26	L.T. 2. E-02
03/22	03/29	1.03E 04	CU. FT.	1.0 ± 0.3 E-02	1.7 ± 1.2 E-03	04/03	L.T. 3. E-02
03/29	04/05	9.79E 03	CU. FT.	1.6 ± 0.3 E-02	1.9 ± 1.5 E-03	04/08	L.T. 2. E-02
04/05	04/12	1.02E 04	CU. FT.	1.5 ± 0.3 E-02	1.1 ± 1.1 E-03	04/19	L.T. 4. E-02
04/12	04/19	9.98E 03	CU. FT.	1.9 ± 0.3 E-02	3.8 ± 1.7 E-03	04/23	L.T. 2. E-02
04/19	04/26	9.39E 03	CU. FT.	2.4 ± 0.3 E-02	2.7 ± 1.6 E-03	05/03	L.T. 4. E-02
04/26	05/03	1.00E 04	CU. FT.	1.5 ± 0.3 E-02	L.T. 1. E-03	05/07	L.T. 2. E-02
05/03	05/10	1.00E 04	CU. FT.	1.7 ± 0.3 E-02	L.T. 1. E-03	05/17	L.T. 4. E-02
05/10	05/17	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	1.8 ± 1.2 E-03	05/22	L.T. 4. E-02
05/17	05/24	1.01E 04	CU. FT.	2.0 ± 0.3 E-02	2.6 ± 1.4 E-03	05/28	L.T. 4. E-02
05/24	05/31	1.01E 04	CU. FT.	2.0 ± 0.3 E-02	1.0 ± 0.9 E-03	06/05	L.T. 2. E-02
05/31	06/07	1.01E 04	CU. FT.	1.6 ± 0.3 E-02	L.T. 1. E-03	06/12	L.T. 2. E-02
06/07	06/14	9.98E 03	CU. FT.	2.2 ± 0.3 E-02	4.6 ± 1.7 E-03	06/18	L.T. 2. E-02
06/14	06/21	1.02E 04	CU. FT.	1.9 ± 0.3 E-02	2.5 ± 1.4 E-03	06/26	L.T. 3. E-02
06/21	06/28	9.75E 03	CU. FT.	2.1 ± 0.3 E-02	L.T. 1. E-03	06/30	L.T. 4. E-02
06/28	07/06	1.15E 04	CU. FT.	2.2 ± 0.3 E-02	2.3 ± 1.1 E-03	07/09	L.T. 1. E-02
07/06	07/12	8.63E 03	CU. FT.	2.1 ± 0.3 E-02	L.T. 2. E-03	07/16	L.T. 3. E-02
07/12	07/19	1.01E 04	CU. FT.	1.8 ± 0.3 E-02	1.5 ± 1.2 E-03	07/22	L.T. 2. E-02
07/19	07/26	1.06E 04	CU. FT.	2.1 ± 0.3 E-02	1.5 ± 1.1 E-03	07/30	L.T. 3. E-02
07/26	08/02	9.01E 03	CU. FT.	2.6 ± 0.3 E-02	4.0 ± 2.0 E-03	08/05	L.T. 3. E-02
08/02	08/09	9.98E 03	CU. FT.	2.0 ± 0.3 E-02	2.1 ± 1.5 E-03	08/12	L.T. 3. E-02
08/09	08/16	1.00E 04	CU. FT.	2.0 ± 0.3 E-02	1.7 ± 1.1 E-03	08/20	L.T. 3. E-02
08/16	08/23	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	2.8 ± 1.5 E-03	08/27	L.T. 3. E-02
08/23	08/30	1.04E 04	CU. FT.	2.5 ± 0.3 E-02	2.2 ± 1.1 E-03	09/02	L.T. 3. E-02

*Low air volume.

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 02

STATION 02 - 0.75 MI. 225 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
08/30	09/06	1.03E 04	CU. FT.	2.1 ± 0.3 E-02	2.5 ± 1.3 E-03	09/10	L.T. 2. E-02
09/06	09/13	1.01E 04	CU. FT.	3.5 ± 0.4 E-02	2.8 ± 1.6 E-03	09/17	L.T. 3. E-02
09/13	09/20	9.86E 03	CU. FT.	1.4 ± 0.3 E-02	L.T. 1. E-03	09/23	L.T. 3. E-02
09/20	09/27	9.96E 03	CU. FT.	1.4 ± 0.3 E-02	L.T. 1. E-03	10/01	L.T. 2. E-02
09/27	10/04	1.04E 04	CU. FT.	3.4 ± 0.4 E-02	2.6 ± 1.4 E-03	10/07	L.T. 3. E-02
10/04	10/11	9.96E 03	CU. FT.	2.2 ± 0.3 E-02	L.T. 1. E-03	10/15	L.T. 3. E-02
10/11	10/18	1.03E 04	CU. FT.	2.2 ± 0.3 E-02	2.2 ± 1.5 E-03	10/21	L.T. 1. E-02
10/18	10/25	1.00E 04	CU. FT.	2.1 ± 0.3 E-02	2.2 ± 1.4 E-03	10/28	L.T. 3. E-02
10/25	11/01	1.01E 04	CU. FT.	1.9 ± 0.3 E-02	1.2 ± 0.9 E-03	11/05	L.T. 3. E-02
11/01	11/08	9.89E 03	CU. FT.	3.2 ± 0.4 E-02	2.7 ± 1.4 E-03	11/12	L.T. 3. E-02
11/08	11/15	1.03E 04	CU. FT.	2.6 ± 0.3 E-02	1.6 ± 1.2 E-03	11/1-	L.T. 3. E-02
11/15	11/22	1.01E 04	CU. FT.	2.0 ± 0.3 E-02	2.5 ± 1.3 E-03	11/30	L.T. 4. E-02
11/22	11/29	1.01E 04	CU. FT.	2.6 ± 0.3 E-02	L.T. 1. E-03	12/03	L.T. 3. E-02
11/29	12/06	9.91E 03	CU. FT.	3.5 ± 0.4 E-02	1.9 ± 1.1 E-03	12/10	L.T. 3. E-02
12/06	12/13	9.95E 03	CU. FT.	3.7 ± 0.4 E-02	3.0 ± 1.6 E-03	12/17	L.T. 3. E-02
12/13	12/20	9.56E 03	CU. FT.	5.1 ± 0.4 E-02	2.9 ± 1.3 E-03	12/23	L.T. 3. E-02
12/20	12/27	1.06E 04	CU. FT.	2.3 ± 0.3 E-02	2.2 ± 1.3 E-03	12/31	L.T. 3. E-02
12/27	01/03	9.60E 03	CU. FT.	3.7 ± 0.4 E-02	2.6 ± 1.3 E-03	01/05	L.T. 3. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 03

STATION 03 - 2.5 MI. 338 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04	1.00E 04	CU. FT.	3.2 ± 0.4 E-02	3.6 ± 1.7 E-03	01/12	L.T. 4. E-02
01/04	01/11	1.02E 04	CU. FT.	3.7 ± 0.4 E-02	2.8 ± 1.5 E-03	01/18	L.T. 4. E-02
01/11	01/18	9.96E 03	CU. FT.	3.1 ± 0.3 E-02	3.7 ± 1.5 E-03	01/25	L.T. 5. E-02
01/18	01/25	9.58E 03	CU. FT.	3.6 ± 0.4 E-02	2.4 ± 1.4 E-03	01/29	L.T. 2. E-02
01/25	02/01	9.93E 03	CU. FT.	3.2 ± 0.3 E-02	2.0 ± 1.2 E-03	02/05	L.T. 3. E-02
02/01	02/08	1.02E 04	CU. FT.	2.7 ± 0.3 E-02	2.9 ± 1.4 E-03	02/16	L.T. 4. E-02
02/08	02/15	1.02E 04	CU. FT.	2.3 ± 0.3 E-02	1.9 ± 1.3 E-03	02/19	L.T. 3. E-02
02/15	02/22	9.95E 03	CU. FT.	3.3 ± 0.3 E-02	3.9 ± 1.5 E-03	02/25	L.T. 2. E-02
02/22	03/01	9.61E 03	CU. FT.	2.4 ± 0.3 E-02	3.8 ± 1.6 E-03	03/08	L.T. 4. E-02
03/01	03/08	1.01E 04	CU. FT.	1.8 ± 0.3 E-02	2.6 ± 1.3 E-03	03/12	L.T. 3. E-02
03/08	03/15	1.02E 04	CU. FT.	2.3 ± 0.3 E-02	1.4 ± 1.1 E-03	03/19	L.T. 3. E-02
03/15	03/22	1.00E 04	CU. FT.	1.4 ± 0.2 E-02	L.T. 1. E-03	03/26	L.T. 2. E-02
03/22	03/29	1.03E 04	CU. FT.	2.0 ± 0.3 E-02	2.7 ± 1.5 E-03	04/03	L.T. 3. E-02
03/29	04/05	9.79E 03	CU. FT.	2.0 ± 0.3 E-02	2.8 ± 1.7 E-03	04/08	L.T. 2. E-02
04/05	04/12	1.03E 04	CU. FT.	2.7 ± 0.4 E-02	2.1 ± 1.3 E-03	04/19	L.T. 4. E-02
04/12	04/19	9.86E 03	CU. FT.	1.7 ± 0.3 E-02	2.5 ± 1.5 E-03	04/23	L.T. 2. E-02
04/19	04/26	1.01E 04	CU. FT.	2.0 ± 0.3 E-02	2.4 ± 1.5 E-03	05/03	L.T. 4. E-02
04/26	05/03	1.01E 04	CU. FT.	6.5 ± 2.6 E-03	L.T. 1. E-03	05/07	L.T. 2. E-02
05/03	05/10	1.00E 04	CU. FT.	1.8 ± 0.3 E-02	1.7 ± 1.3 E-03	05/17	L.T. 4. E-02
05/10	05/17	1.02E 04	CU. FT.	1.6 ± 0.3 E-02	1.6 ± 1.1 E-03	05/22	L.T. 4. E-02
05/17	05/24	1.00E 04	CU. FT.	2.0 ± 0.3 E-02	2.4 ± 1.4 E-03	05/28	L.T. 4. E-02
05/24	05/31	1.01E 04	CU. FT.	1.9 ± 0.3 E-02	1.8 ± 1.1 E-03	06/05	L.T. 2. E-02
05/31	06/07	1.03E 04	CU. FT.	1.8 ± 0.3 E-02	1.5 ± 1.1 E-03	06/12	L.T. 2. E-02
06/07	06/14	9.91E 03	CU. FT.	1.6 ± 0.3 E-02	1.6 ± 1.1 E-03	06/18	L.T. 2. E-02
06/14	06/21	1.02E 04	CU. FT.	2.1 ± 0.3 E-02	1.8 ± 1.3 E-03	06/26	L.T. 3. E-02
06/21	07/28	9.94E 03	CU. FT.	7.1 ± 1.0 E-02	8.1 ± 4.9 E-03	06/30	L.T. 4. E-02
06/28	07/06	1.15E 04	CU. FT.	2.2 ± 0.3 E-02	2.3 ± 1.1 E-03	07/09	L.T. 1. E-02
07/06	07/12	8.68E 03	CU. FT.	1.8 ± 0.3 E-02	L.T. 2. E-03	07/16	L.T. 3. E-02
07/12	07/19	1.00E 04	CU. FT.	1.8 ± 0.3 E-02	L.T. 1. E-03	07/22	L.T. 2. E-02
07/19	07/26	1.01E 04	CU. FT.	1.9 ± 0.3 E-02	1.3 ± 1.1 E-03	07/30	L.T. 3. E-02
07/26	08/02	9.83E 03	CU. FT.	1.8 ± 0.3 E-02	2.6 ± 1.7 E-03	08/05	L.T. 2. E-02
08/02	08/09	9.80E 03	CU. FT.	2.1 ± 0.3 E-02	L.T. 2. E-03	08/12	L.T. 3. E-02
08/09	08/16	1.01E 04	CU. FT.	1.9 ± 0.3 E-02	1.8 ± 1.1 E-03	08/20	L.T. 3. E-02
08/16	08/23	1.00E 04	CU. FT.	2.7 ± 0.3 E-02	2.0 ± 1.3 E-03	08/27	L.T. 3. E-02
08/23	08/30	1.05E 04	CU. FT.	2.7 ± 0.3 E-02	2.7 ± 1.2 E-03	09/04	L.T. 3. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 03

STATION 03 - 2.5 MI. 338 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
08/30	09/06	8.75E 03	CU. FT.	2.4 ± 0.3 E-02	2.7 ± 1.5 E-03	09/10	L.T. 2. E-02
09/06	09/13	1.02E 04	CU. FT.	3.1 ± 0.4 E-02	2.5 ± 1.5 E-03	09/17	L.T. 3. E-02
09/13	09/20	1.01E 04	CU. FT.	2.0 ± 0.3 E-02	1.5 ± 1.0 E-03	09/23	L.T. 3. E-02
09/20	09/27	1.01E 04	CU. FT.	1.4 ± 0.3 E-02	L.T. 1. E-03	10/01	L.T. 2. E-02
09/27	10/04	1.00E 04	CU. FT.	2.6 ± 0.3 E-02	1.6 ± 1.2 E-03	10/07	L.T. 3. E-02
10/04	10/11	9.95E 03	CU. FT.	2.0 ± 0.3 E-02	L.T. 1. E-03	10/15	L.T. 3. E-02
10/11	10/18	1.03E 04	CU. FT.	2.4 ± 0.3 E-02	L.T. 2. E-03	10/21	L.T. 1. E-02
10/18	10/25	9.92E 03	CU. FT.	2.5 ± 0.3 E-02	2.3 ± 1.4 E-03	10/28	L.T. 3. E-02
10/25	11/01	1.04E 04	CU. FT.	2.5 ± 0.3 E-02	1.6 ± 1.0 E-03	11/05	L.T. 3. E-02
11/01	11/08	9.86E 03	CU. FT.	2.7 ± 0.3 E-02	2.3 ± 1.4 E-03	11/12	L.T. 3. E-02
11/08	11/15	1.02E 04	CU. FT.	2.1 ± 0.3 E-02	2.6 ± 1.4 E-03	11/19	L.T. 3. E-02
11/15	11/22	9.95E 03	CU. FT.	2.3 ± 0.3 E-02	2.1 ± 1.2 E-03	11/30	L.T. 5. E-02
11/22	11/29	1.01E 04	CU. FT.	2.8 ± 0.3 E-02	L.T. 1. E-03	12/03	L.T. 3. E-02
11/29	12/06	9.93E 03	CU. FT.	3.5 ± 0.4 E-02	1.6 ± 1.0 E-03	12/10	L.T. 3. E-02
12/06	12/13	1.02E 04	CU. FT.	4.6 ± 0.4 E-02	2.8 ± 1.5 E-03	12/17	L.T. 3. E-02
12/13	12/20	1.00E 04	CU. FT.	4.9 ± 0.4 E-02	4.8 ± 1.6 E-03	12/23	L.T. 2. E-02
12/20	12/27	1.02E 04	CU. FT.	3.4 ± 0.4 E-02	3.3 ± 1.5 E-03	12/31	L.T. 3. E-02
12/27	01/03	1.00E 04	CU. FT.	4.0 ± 0.4 E-02	3.7 ± 1.5 E-03	01/05	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - AIRBORNE
AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 04

STATION 04 - 3.0 MI. 43 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04	1.01E 04	CU. FT.	5.0 ± 0.4 E-02	6.0 ± 2.0 E-03	01/12	L.T. 4. E-02
01/04	01/11	9.66E 03	CU. FT.	5.6 ± 0.5 E-02	4.4 ± 1.8 E-03	01/18	L.T. 4. E-02
01/11	01/18	9.97E 03	CU. FT.	5.4 ± 0.4 E-02	5.2 ± 1.7 E-03	01/25	L.T. 5. E-02
01/18	01/25	1.00E 04	CU. FT.	5.0 ± 0.4 E-02	4.1 ± 1.7 E-03	01/29	L.T. 2. E-02
01/25	02/01	9.85E 03	CU. FT.	6.1 ± 0.5 E-02	4.0 ± 1.6 E-03	02/05	L.T. 3. E-02
02/01	02/08	1.01E 04	CU. FT.	4.4 ± 0.4 E-02	3.7 ± 1.5 E-03	02/16	L.T. 4. E-02
02/08	02/15	9.97E 03	CU. FT.	2.9 ± 0.3 E-02	2.8 ± 1.5 E-03	02/19	L.T. 3. E-02
02/15	02/22	9.83E 03	CU. FT.	4.5 ± 0.4 E-02	3.8 ± 1.6 E-03	02/25	L.T. 2. E-02
02/22	03/01	7.78E 03	CU. FT.	5.0 ± 0.5 E-02	5.8 ± 2.2 E-03	03/08	L.T. 5. E-02
03/01	03/08	1.01E 04	CU. FT.	2.9 ± 0.3 E-02	2.6 ± 1.3 E-03	03/12	L.T. 3. E-02
03/08	03/15	1.01E 04	CU. FT.	3.4 ± 0.3 E-02	4.2 ± 1.6 E-03	03/19	L.T. 3. E-02
03/15	03/22	1.00E 04	CU. FT.	2.7 ± 0.3 E-02	3.3 ± 1.6 E-03	03/26	L.T. 2. E-02
03/22	03/29	7.97E 03	CU. FT.	2.5 ± 0.4 E-02	3.1 ± 1.8 E-03	04/03	L.T. 4. E-02
03/29	04/05	9.77E 03	CU. FT.	2.9 ± 0.3 E-02	5.8 ± 2.2 E-03	04/08	L.T. 2. E-02
04/05	04/12	1.04E 04	CU. FT.	2.3 ± 0.3 E-02	1.6 ± 1.2 E-03	04/19	L.T. 4. E-02
04/12	04/19	9.79E 03	CU. FT.	2.8 ± 0.3 E-02	4.6 ± 1.9 E-03	04/23	L.T. 2. E-02
04/19	04/26	1.01E 04	CU. FT.	2.6 ± 0.3 E-02	2.9 ± 1.6 E-03	05/03	L.T. 4. E-02
04/26	05/03	1.01E 04	CU. FT.	8.4 ± 2.8 E-03	L.T. 1. E-03	05/07	L.T. 2. E-02
05/03	05/10	1.00E 04	CU. FT.	1.7 ± 0.3 E-02	L.T. 1. E-03	05/17	L.T. 4. E-02
05/10	05/17	1.02E 04	CU. FT.	2.2 ± 0.3 E-02	2.9 ± 1.4 E-03	05/22	L.T. 4. E-02
05/17	05/24	1.00E 04	CU. FT.	2.0 ± 0.3 E-02	1.6 ± 1.2 E-03	05/28	L.T. 4. E-02
05/24	05/31	1.01E 04	CU. FT.	2.6 ± 0.3 E-02	1.3 ± 1.0 E-03	06/05	L.T. 2. E-02
05/31	06/07	1.02E 04	CU. FT.	1.5 ± 0.2 E-02	L.T. 1. E-03	06/12	L.T. 2. E-02
06/07	06/14*						
06/14	06/21	1.02E 04	CU. FT.	2.2 ± 0.3 E-02	2.5 ± 1.4 E-03	06/26	L.T. 3. E-02
06/21	06/28	9.89E 03	CU. FT.	2.6 ± 0.3 E-02	2.4 ± 1.5 E-03	06/30	L.T. 4. E-02
06/28	07/06	1.15E 04	CU. FT.	2.3 ± 0.3 E-02	2.1 ± 1.1 E-03	07/09	L.T. 1. E-02
07/06	07/12	8.65E 03	CU. FT.	2.4 ± 0.3 E-02	L.T. 2. E-03	07/16	L.T. 3. E-02
07/12	07/19	1.01E 04	CU. FT.	2.7 ± 0.4 E-02	1.1 ± 1.1 E-03	07/22	L.T. 2. E-02
07/19	07/26	1.02E 04	CU. FT.	2.5 ± 0.3 E-02	1.4 ± 1.1 E-03	07/30	L.T. 3. E-02
07/26	08/02	9.88E 03	CU. FT.	2.2 ± 0.3 E-02	2.7 ± 1.7 E-03	08/05	L.T. 2. E-02
08/02	08/09	9.99E 03	CU. FT.	2.7 ± 0.3 E-02	2.5 ± 1.6 E-03	08/12	L.T. 3. E-02
08/09	08/16	1.01E 04	CU. FT.	2.6 ± 0.3 E-02	2.3 ± 1.3 E-03	08/20	L.T. 3. E-02
08/16	08/23	1.00E 04	CU. FT.	3.0 ± 0.3 E-02	2.5 ± 1.4 E-03	08/27	L.T. 3. E-02
08/23	08/30	1.04E 04	CU. FT.	2.7 ± 0.3 E-02	3.2 ± 1.3 E-03	09/02	L.T. 3. E-02

*Out of Service - Sample Not Collected

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 04

STATION 04 - 3.0 MI. 43 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
08/30	09/06	9.89E 03	CU. FT.	2.4 ± 0.3 E-02	1.8 ± 1.2 E-03	09/10	L.T. 2. E-02
09/06	09/13	9.85E 03	CU. FT.	3.7 ± 0.4 E-02	3.7 ± 1.8 E-03	09/17	L.T. 3. E-02
09/13	09/20	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	1.1 ± 1.0 E-03	09/23	L.T. 3. E-02
09/20	09/27	1.00E 04	CU. FT.	2.1 ± 0.3 E-02	1.5 ± 1.1 E-03	10/01	L.T. 2. E-02
09/27	10/04	1.00E 04	CU. FT.	3.1 ± 0.3 E-02	L.T. 1. E-03	10/07	L.T. 3. E-02
10/04	10/11	9.98E 03	CU. FT.	2.5 ± 0.3 E-02	1.4 ± 1.1 E-03	10/15	L.T. 3. E-02
10/11	10/18	1.03E 04	CU. FT.	2.3 ± 0.3 E-02	L.T. 2. E-03	10/21	L.T. 1. E-02
10/18	10/25	9.88E 03	CU. FT.	3.3 ± 0.4 E-02	2.0 ± 1.3 E-03	10/28	L.T. 3. E-02
10/25	11/01	1.03E 04	CU. FT.	3.7 ± 0.4 E-02	1.1 ± 0.9 E-03	11/05	L.T. 3. E-02
11/01	11/08	9.11E 03	CU. FT.	6.5 ± 0.5 E-02	3.0 ± 1.5 E-03	11/12	L.T. 3. E-02
11/08	11/15	9.05E 03	CU. FT.	5.4 ± 0.5 E-02	6.0 ± 2.1 E-03	11/19	L.T. 3. E-02
11/15	11/22	9.99E 03	CU. FT.	3.9 ± 0.4 E-02	3.9 ± 1.6 E-03	11/30	L.T. 4. E-02
11/22	11/29	1.01E 04	CU. FT.	5.6 ± 0.4 E-02	2.5 ± 1.3 E-03	12/03	L.T. 3. E-02
11/29	12/06	9.06E 03	CU. FT.	8.6 ± 0.6 E-02	3.4 ± 1.7 E-03	12/10	L.T. 3. E-02
12/06	12/13	8.85E 03	CU. FT.	10. ± 1.0 E-02	6.9 ± 2.4 E-03	12/17	L.T. 3. E-02
12/13	12/20	8.17E 03	CU. FT.	10. ± 1.0 E-02	5.6 ± 2.3 E-03	12/23	L.T. 3. E-02
12/20	12/27	1.03E 04	CU. FT.	7.1 ± 0.5 E-02	5.7 ± 1.9 E-03	12/31	L.T. 3. E-02
12/27	01/03	9.51E 03	CU. FT.	9.0 ± 0.5 E-02	3.5 ± 1.7 E-03	01/05	L.T. 3. E-02

I
II
III

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 05

STATION 05 - 3.5 MI. 102 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04*						
01/04	01/11*						
01/11	01/18**						
01/18	01/25	1.00E 04	CU. FT.	4.0 ± 0.4 E-02	2.8 ± 1.4 E-03	01/29	L.T. 1. E-02
01/25	02/01	9.85E 03	CU. FT.	3.6 ± 0.4 E-02	1.6 ± 1.1 E-03	02/05	L.T. 1. E-02
02/01	02/08	1.02E 04	CU. FT.	2.9 ± 0.3 E-02	2.1 ± 1.2 E-03	02/16	L.T. 2. E-02
02/08	02/15	1.04E 04	CU. FT.	2.9 ± 0.3 E-02	2.4 ± 1.4 E-03	02/19	L.T. 2. E-02
02/15	02/22	9.83E 03	CU. FT.	1.6 ± 0.3 E-02	1.8 ± 1.1 E-03	02/25	L.T. 2. E-02
02/22	03/01	1.00E 04	CU. FT.	2.0 ± 0.3 E-02	2.9 ± 1.4 E-03	03/08	L.T. 2. E-02
03/01	03/08	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	2.8 ± 1.4 E-03	03/12	L.T. 2. E-02
03/08	03/15	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	2.4 ± 1.3 E-03	03/19	L.T. 2. E-02
03/15	03/22	1.00E 04	CU. FT.	1.4 ± 0.2 E-02	2.4 ± 1.4 E-03	03/26	L.T. 2. E-02
03/22	03/29	1.03E 04	CU. FT.	1.8 ± 0.3 E-02	2.4 ± 1.4 E-03	04/03	L.T. 2. E-02
03/29	04/05	9.77E 03	CU. FT.	1.8 ± 0.3 E-02	3.3 ± 1.8 E-03	04/08	L.T. 1. E-02
04/05	04/12	1.04E 04	CU. FT.	1.7 ± 0.3 E-02	1.6 ± 1.2 E-03	04/19	L.T. 2. E-02
04/12	04/19	9.78E 03	CU. FT.	1.6 ± 0.3 E-02	3.4 ± 1.7 E-03	04/23	L.T. 1. E-02
04/19	04/26	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	3.3 ± 1.6 E-03	05/03	L.T. 2. E-02
04/26	05/03	1.01E 04	CU. FT.	7.1 ± 2.7 E-03	L.T. 1. E-03	05/07	L.T. 1. E-02
05/03	05/10	1.00E 04	CU. FT.	2.1 ± 0.3 E-02	L.T. 1. E-03	05/17	L.T. 2. E-02
05/10	05/17	1.02E 04	CU. FT.	2.0 ± 0.3 E-02	2.6 ± 1.3 E-03	05/22	L.T. 3. E-02
05/17	05/24	1.00E 04	CU. FT.	2.1 ± 0.3 E-02	1.5 ± 1.2 E-03	05/28	L.T. 2. E-02
05/24	05/31	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	2.9 ± 1.3 E-03	06/05	L.T. 1. E-02
05/31	06/07	1.02E 04	CU. FT.	1.8 ± 0.3 E-02	L.T. 1. E-03	06/12	L.T. 1. E-02
06/07	06/14	9.97E 03	CU. FT.	1.6 ± 0.3 E-02	1.6 ± 1.1 E-03	06/18	L.T. 2. E-02
06/14	06/21	1.02E 04	CU. FT.	1.5 ± 0.3 E-02	1.6 ± 1.2 E-03	06/26	L.T. 2. E-02
06/21	06/28	9.92E 03	CU. FT.	1.4 ± 0.2 E-02	L.T. 1. E-03	06/30	L.T. 2. E-02
06/28	07/06	1.15E 04	CU. FT.	1.5 ± 0.2 E-02	1.5 ± 1.0 E-03	07/09	L.T. 3. E-03
07/06	07/12	8.65E 03	CU. FT.	1.6 ± 0.3 E-02	L.T. 2. E-03	07/16	L.T. 2. E-02
07/12	07/19	1.01E 04	CU. FT.	1.6 ± 0.3 E-02	1.6 ± 1.2 E-03	07/22	L.T. 2. E-02
07/19	07/26	1.02E 04	CU. FT.	2.4 ± 0.3 E-02	2.2 ± 1.3 E-03	07/30	L.T. 1. E-02
07/26	08/02	1.01E 04	CU. FT.	3.1 ± 0.4 E-02	3.5 ± 1.8 E-03	08/05	L.T. 2. E-02
08/02	08/09	9.98E 03	CU. FT.	2.5 ± 0.3 E-02	L.T. 2. E-03	08/12	L.T. 1. E-02
08/09	08/16	1.00E 04	CU. FT.	1.4 ± 0.3 E-02	2.5 ± 1.3 E-03	08/20	L.T. 1. E-02
08/16	08/23*						
08/23	08/30	1.04E 04	CU. FT.	3.2 ± 0.3 E-02	1.6 ± 1.0 E-03	09/02	L.T. 2. E-02

*Sample not collected.

**The LLD for station 5 could not be met for the AP or C because of the low air volume.

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 05

STATION 05 - 3.5 MI. 102 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
08/30	09/06	9.65E 03	CU. FT.	2.8 ± 0.3 E-02	2.9 ± 1.4 E-03	09/10	L.T. 1. E-02
09/06	09/13	9.91E 03	CU. FT.	5.2 ± 0.4 E-02	3.0 ± 1.7 E-03	09/17	L.T. 1. E-02
09/13	09/20	1.01E 04	CU. FT.	3.2 ± 0.3 E-02	1.1 ± 1.0 E-03	09/23	L.T. 2. E-02
09/20	09/27	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	1.4 ± 1.1 E-03	10/01	L.T. 1. E-02
09/27	10/04	9.16E 03	CU. FT.	5.9 ± 0.5 E-02	1.0 ± 1.4 E-03	10/07	L.T. 2. E-02
10/04	10/11	9.95E 03	CU. FT.	3.6 ± 0.4 E-02	2.1 ± 1.2 E-03	10/15	L.T. 1. E-02
10/11	10/18	1.03E 04	CU. FT.	3.3 ± 0.4 E-02	2.0 ± 1.5 E-03	10/21	L.T. 1. E-02
10/18	10/25	9.91E 03	CU. FT.	3.0 ± 0.3 E-02	3.4 ± 1.6 E-03	10/28	L.T. 2. E-02
10/25	11/01	1.03E 04	CU. FT.	2.5 ± 0.3 E-02	1.1 ± 0.9 E-03	11/05	L.T. 1. E-02
11/01	11/08	9.87E 03	CU. FT.	3.7 ± 0.4 E-02	2.0 ± 1.3 E-03	11/12	L.T. 2. E-02
11/08	11/15	9.81E 03	CU. FT.	3.2 ± 0.4 E-02	2.6 ± 1.5 E-03	11/19	L.T. 1. E-02
11/15	11/22	1.24E 04	CU. FT.	2.4 ± 0.3 E-02	2.4 ± 1.1 E-03	11/30	L.T. 2. E-02
11/22	11/29	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	2.3 ± 1.3 E-03	12/03	L.T. 1. E-02
11/29	12/06	9.95E 03	CU. FT.	3.8 ± 0.4 E-02	2.2 ± 1.2 E-03	12/10	L.T. 1. E-02
12/06	12/13	1.02E 04	CU. FT.	6.3 ± 0.5 E-02	4.1 ± 1.7 E-03	12/17	L.T. 1. E-02
12/13	12/20	9.94E 03	CU. FT.	6.6 ± 0.5 E-02	4.1 ± 1.8 E-03	12/23	L.T. 2. E-02
12/20	12/27	1.03E 04	CU. FT.	3.9 ± 0.4 E-02	4.5 ± 1.7 E-03	12/31	L.T. 2. E-02
12/27	01/03	9.92E 03	CU. FT.	5.7 ± 0.4 E-02	3.1 ± 1.4 E-03	01/05	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 06

STATION 06 - 3.0 MI. 165 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04	1.01E 04	CU. FT.	3.4 ± 0.4 E-02	2.8 ± 1.6 E-03	01/12	L.T. 4. E-02
01/04	01/11	1.02E 04	CU. FT.	4.6 ± 0.4 E-02	3.5 ± 1.6 E-03	01/18	L.T. 3. E-02
01/11	01/18	9.98E 03	CU. FT.	3.7 ± 0.4 E-02	3.2 ± 1.4 E-03	01/25	L.T. 2. E-02
01/18	01/25	9.75E 03	CU. FT.	3.8 ± 0.4 E-02	2.9 ± 1.5 E-03	01/29	L.T. 2. E-02
01/25	02/01	9.85E 03	CU. FT.	3.1 ± 0.3 E-02	1.7 ± 1.2 E-03	02/05	L.T. 1. E-02
02/01	02/08	1.02E 04	CU. FT.	2.5 ± 0.3 E-02	3.5 ± 1.5 E-03	02/16	L.T. 4. E-02
02/08	02/15	1.04E 04	CU. FT.	2.6 ± 0.3 E-02	2.0 ± 1.3 E-03	02/19	L.T. 3. E-02
02/15	02/22	9.82E 03	CU. FT.	2.5 ± 0.3 E-02	4.0 ± 1.6 E-03	02/25	L.T. 2. E-02
02/22	03/01	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	3.9 ± 1.6 E-03	03/08	L.T. 4. E-02
03/01	03/08	1.01E 04	CU. FT.	1.9 ± 0.3 E-02	1.6 ± 1.1 E-03	03/12	L.T. 2. E-02
03/08	03/15	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	1.8 ± 1.2 E-03	03/19	L.T. 2. E-02
03/15	03/22	1.00E 04	CU. FT.	1.2 ± 0.2 E-02	L.T. 1. E-03	03/26	L.T. 3. E-02
03/22	03/29	1.02E 04	CU. FT.	1.4 ± 0.3 E-02	1.1 ± 1.1 E-03	04/05	L.T. 5. E-02
03/29	04/05	9.78E 03	CU. FT.	1.9 ± 0.3 E-02	L.T. 2. E-03	04/08	L.T. 2. E-02
04/05	04/12	1.04E 04	CU. FT.	1.8 ± 0.3 E-02	3.1 ± 1.5 E-03	04/19	L.T. 5. E-02
04/12	04/19	9.77E 03	CU. FT.	1.5 ± 0.3 E-02	2.1 ± 1.4 E-03	04/23	L.T. 2. E-02
04/19	04/26	9.81E 03	CU. FT.	2.9 ± 0.3 E-02	2.0 ± 1.5 E-03	05/03	L.T. 5. E-02
04/26	05/03	1.01E 04	CU. FT.	9.2 ± 2.8 E-03	1.1 ± 1.0 E-03	05/07	L.T. 2. E-02
05/03	05/10	1.00E 04	CU. FT.	2.1 ± 0.3 E-02	1.4 ± 1.2 E-03	05/17	L.T. 4. E-02
05/10	05/17	1.02E 04	CU. FT.	2.8 ± 0.3 E-02	3.8 ± 1.5 E-03	05/22	L.T. 2. E-02
05/17	05/24	9.76E 03	CU. FT.	3.8 ± 0.4 E-02	3.0 ± 1.6 E-03	05/29	L.T. 2. E-02
05/24	05/31	1.01E 04	CU. FT.	2.8 ± 0.3 E-02	2.4 ± 1.2 E-03	06/05	L.T. 3. E-02
05/31	06/07	9.94E 03	CU. FT.	2.6 ± 0.3 E-02	1.7 ± 1.2 E-03	06/13	L.T. 4. E-02
06/07	06/14	9.77E 03	CU. FT.	.92 ± .24 E-02	L.T. 1. E-03	06/18	L.T. 2. E-02
06/14	06/21	9.68E 03	CU. FT.	2.8 ± 0.3 E-02	2.9 ± 1.5 E-03	06/26	L.T. 2. E-02
06/21	06/28	8.08E 03	CU. FT.	3.0 ± 0.4 E-02	4.0 ± 2.0 E-03	06/30	L.T. 2. E-02
06/28	07/06	1.11E 04	CU. FT.	3.0 ± 0.3 E-02	2.4 ± 1.2 E-03	07/10	L.T. 2. E-02
07/06	07/12	8.22E 03	CU. FT.	3.0 ± 0.4 E-02	L.T. 2. E-03	07/16	L.T. 2. E-02
07/12	07/19	1.00E 04	CU. FT.	2.3 ± 0.4 E-02	2.4 ± 1.4 E-03	07/23	L.T. 3. E-02
07/19	07/26	1.02E 04	CU. FT.	3.1 ± 0.4 E-02	1.1 ± 1.0 E-03	07/30	L.T. 3. E-02
07/26	08/02*						
08/02	08/09**						
08/09	08/16	9.55E 04	CU. FT.	2.7 ± 0.3 E-02	2.6 ± 1.4 E-03	08/20	L.T. 3. E-02
08/16	08/23	1.00E 04	CU. FT.	2.8 ± 0.3 E-02	2.3 ± 1.4 E-03	08/27	L.T. 2. E-02
08/23	08/30	1.04E 04	CU. FT.	2.1 ± 0.3 E-02	0.96±0.83 E-03	09/02	L.T. 2. E-02

*At the customer's request results were reported in total pCi.

**Sample not collected - pump inoperable.

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 06

STATION 06 - 3.0 MI. 165 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
08/30	09/06	9.92E 03	CU. FT.	2.4 ± 0.3 E-02	1.8 ± 1.2 E-03	09/11	L.T. 3. E-02
09/06	09/13	9.44E 03	CU. FT.	3.6 ± 0.4 E-02	L.T. 2. E-03	09/17	L.T. 3. E-02
09/13	09/20	1.02E 04	CU. FT.	2.2 ± 0.3 E-02	1.2 ± 1.0 E-03	09/23	L.T. 2. E-02
09/20	09/27	9.90E 03	CU. FT.	1.9 ± 0.3 E-02	L.T. 1. E-03	10/01	L.T. 2. E-02
09/27	10/04*						
10/04	10/11**						
10/12	10/18	9.01E 03	CU. FT.	1.8 ± 0.3 E-02	L.T. 2. E-03	10/21	L.T. 2. E-02
10/18	10/25	9.91E 03	CU. FT.	2.8 ± 0.3 E-02	2.0 ± 1.3 E-03	10/28	L.T. 3. E-02
10/25	11/01	1.03E 04	CU. FT.	1.7 ± 0.3 E-02	1.2 ± 0.9 E-03	11/05	L.T. 1. E-02
11/01	11/08	9.54E 03	CU. FT.	3.8 ± 0.4 E-02	3.8 ± 1.7 E-03	11/12	L.T. 2. E-02
11/08	11/15	1.02E 04	CU. FT.	2.4 ± 0.3 E-02	1.6 ± 1.2 E-03	11/19	L.T. 3. E-02
11/15	11/22	9.98E 03	CU. FT.	2.5 ± 0.3 E-02	2.7 ± 1.3 E-03	11/30	L.T. 2. E-02
11/22	11/29	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	L.T. 1. E-03	12/03	L.T. 2. E-02
11/29	12/06	9.93E 03	CU. FT.	3.3 ± 0.4 E-02	2.5 ± 1.2 E-03	12/10	L.T. 2. E-02
12/06	12/13	6.70E 03	CU. FT.	7.0 ± 0.6 E-02	6.0 ± 2.6 E-03	12/17	L.T. 2. E-02
12/13	12/20	9.93E 03	CU. FT.	5.9 ± 0.4 E-02	3.6 ± 1.4 E-03	12/23	L.T. 2. E-02
12/20	12/27	1.03E 04	CU. FT.	2.7 ± 0.3 E-02	2.4 ± 1.3 E-03	12/31	L.T. 2. E-02
12/27	01/03	9.92E 03	CU. FT.	3.7 ± 0.4 E-02	2.3 ± 1.2 E-03	01/05	L.T. 2. E-02

*At the customer's request results were reported in total pCi.

**Sample not collected - pump inoperable.

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 07

STATION 07 - 2.5 MI. 230 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04	1.01E 04	CU. FT.	3.1 ± 0.4 E-02	3.1 ± 1.6 E-03	01/12	L.T. 4. E-02
01/04	01/11	1.01E 04	CU. FT.	3.9 ± 0.4 E-02	2.6 ± 1.4 E-03	01/18	L.T. 3. E-02
01/11	01/18	1.03E 04	CU. FT.	3.9 ± 0.4 E-02	3.0 ± 1.3 E-03	01/25	L.T. 2. E-02
01/18	01/26	1.11E 04	CU. FT.	4.0 ± 0.4 E-02	2.5 ± 1.3 E-03	01/29	L.T. 1. E-02
01/26	02/01	8.57E 03	CU. FT.	3.3 ± 0.4 E-02	2.5 ± 1.5 E-03	02/05	L.T. 2. E-02
02/01	02/08	1.02E 04	CU. FT.	2.7 ± 0.3 E-02	1.9 ± 1.2 E-03	02/16	L.T. 4. E-02
02/08	02/15	1.03E 04	CU. FT.	2.5 ± 0.3 E-02	1.8 ± 1.3 E-03	02/19	L.T. 3. E-02
02/15	02/22	1.03E 04	CU. FT.	2.8 ± 0.3 E-02	2.7 ± 1.3 E-03	02/25	L.T. 2. E-02
02/22	03/01	1.01E 04	CU. FT.	2.6 ± 0.3 E-02	2.9 ± 1.4 E-03	03/08	L.T. 4. E-02
03/01	03/08	9.41E 03	CU. FT.	2.2 ± 0.3 E-02	2.1 ± 1.3 E-03	03/12	L.T. 2. E-02
03/08	03/15	1.01E 04	CU. FT.	2.1 ± 0.3 E-02	3.7 ± 1.5 E-03	03/19	L.T. 2. E-02
03/15	03/22	1.00E 04	CU. FT.	1.5 ± 0.3 E-02	2.4 ± 1.4 E-03	03/26	L.T. 3. E-02
03/22	03/29	1.03E 04	CU. FT.	1.7 ± 0.3 E-02	2.1 ± 1.3 E-03	04/05	L.T. 5. E-02
03/29	04/05	9.79E 03	CU. FT.	2.2 ± 0.3 E-02	L.T. 2. E-03	04/08	L.T. 2. E-02
04/05	04/12	1.04E 04	CU. FT.	1.9 ± 0.3 E-02	1.6 ± 1.2 E-03	04/19	L.T. 5. E-02
04/12	04/19	9.72E 03	CU. FT.	1.7 ± 0.3 E-02	3.3 ± 1.6 E-03	04/23	L.T. 2. E-02
04/19	04/26	1.02E 04	CU. FT.	2.2 ± 0.3 E-02	2.6 ± 1.5 E-03	05/03	L.T. 5. E-02
04/26	05/03	1.00E 04	CU. FT.	6.1 ± 2.6 E-03	1.4 ± 1.1 E-03	05/07	L.T. 2. E-02
05/03	05/10	1.00E 04	CU. FT.	1.6 ± 0.3 E-02	L.T. 1. E-03	05/17	L.T. 4. E-02
05/10	05/17	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	3.4 ± 1.5 E-03	05/22	L.T. 2. E-02
05/17	05/24	1.01E 04	CU. FT.	1.9 ± 0.3 E-02	1.1 ± 1.1 E-03	05/29	L.T. 2. E-02
05/24	05/31	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	2.0 ± 1.1 E-03	06/05	L.T. 3. E-02
05/31	06/07	1.01E 04	CU. FT.	1.8 ± 0.3 E-02	1.4 ± 1.1 E-03	06/13	L.T. 4. E-02
06/07	06/14	1.00E 04	CU. FT.	1.5 ± 0.3 E-02	1.6 ± 1.1 E-03	06/18	L.T. 2. E-02
06/14	06/21	1.04E 04	CU. FT.	1.9 ± 0.3 E-02	L.T. 1. E-03	06/26	L.T. 2. E-02
06/21	06/28	9.76E 03	CU. FT.	2.4 ± 0.3 E-02	3.1 ± 1.6 E-03	06/26	L.T. 2. E-02
06/28	07/06	1.15E 04	CU. FT.	L.T. 2. E-03	L.T. 8. E-04	07/10	L.T. 2. E-02
07/06	07/12	8.65E 03	CU. FT.	1.8 ± 0.3 E-02	2.3 ± 1.6 E-03	07/16	L.T. 2. E-02
07/12	07/19	1.01E 04	CU. FT.	2.3 ± 0.4 E-02	2.4 ± 1.4 E-03	07/23	L.T. 3. E-02
07/19	07/26	1.06E 04	CU. FT.	2.0 ± 0.3 E-02	1.8 ± 1.2 E-03	07/30	L.T. 2. E-02
07/26	08/02	9.69E 03	CU. FT.	2.8 ± 0.3 E-02	2.2 ± 1.6 E-03	08/05	L.T. 2. E-02
08/02	08/09	9.98E 03	CU. FT.	2.2 ± 0.3 E-02	L.T. 2. E-03	08/12	L.T. 3. E-02
08/09	08/16	1.00E 04	CU. FT.	2.2 ± 0.3 E-02	2.2 ± 1.2 E-03	08/20	L.T. 3. E-02
08/16	08/23	1.01E 04	CU. FT.	2.8 ± 0.3 E-02	2.0 ± 1.3 E-03	08/27	L.T. 2. E-02
08/23	08/30	1.04E 04	CU. FT.	2.1 ± 0.3 E-02	2.5 ± 1.2 E-03	09/02	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 07

STATION 07 - 2.5 MI. 230 DEG. IND.

COLL. START DATE	TIME STOP DATE	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
VOLUME	UNITS						
08/30	09/06	1.02E 04	CU. FT.	2.3 ± 0.3 E-02	2.9 ± 1.4 E-03	09/11	L.T. 3. E-02
09/06	09/13	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	L.T. 2. E-03	09/17	L.T. 3. E-02
09/13	09/20	1.03E 04	CU. FT.	1.7 ± 0.3 E-02	1.9 ± 1.1 E-03	09/23	L.T. 2. E-02
09/20	09/27	9.55E 03	CU. FT.	1.4 ± 0.3 E-02	L.T. 1. E-03	10/01	L.T. 2. E-02
09/27	10/04	1.04E 04	CU. FT.	3.2 ± 0.3 E-02	1.9 ± 1.2 E-03	10/07	L.T. 2. E-02
10/04	10/11	9.96E 03	CU. FT.	2.1 ± 0.3 E-02	2.2 ± 1.3 E-03	10/14	L.T. 2. E-02
10/11	10/18	1.03E 04	CU. FT.	1.9 ± 0.3 E-02	3.4 ± 1.7 E-03	10/21	L.T. 2. E-02
10/18	10/25	1.00E 04	CU. FT.	2.3 ± 0.3 E-02	3.3 ± 1.6 E-03	10/28	L.T. 3. E-02
10/25	11/01	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	1.1 ± 0.9 E-03	11/05	L.T. 1. E-02
11/01	11/08	9.91E 03	CU. FT.	3.1 ± 0.3 E-02	2.6 ± 1.4 E-03	11/12	L.T. 2. E-02
11/08	11/15	1.02E 04	CU. FT.	1.9 ± 0.3 E-02	2.3 ± 1.4 E-03	11/19	L.T. 3. E-02
11/15	11/22	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	2.5 ± 1.3 E-03	11/30	L.T. 2. E-02
11/22	11/29	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	1.5 ± 1.2 E-03	12/03	L.T. 2. E-02
11/29	12/06	9.91E 03	CU. FT.	3.1 ± 0.3 E-02	1.6 ± 1.0 E-03	12/10	L.T. 2. E-02
12/06	12/13	1.02E 04	CU. FT.	4.4 ± 0.4 E-02	3.0 ± 1.6 E-03	12/17	L.T. 1. E-02
12/13	12/20	9.55E 03	CU. FT.	4.9 ± 0.4 E-02	2.2 ± 1.2 E-03	12/23	L.T. 2. E-02
12/20	12/27	1.06E 04	CU. FT.	2.6 ± 0.3 E-02	1.8 ± 1.2 E-03	12/31	L.T. 2. E-02
12/27	01/03	9.62E 03	CU. FT.	3.5 ± 0.4 E-02	2.6 ± 1.3 E-03	01/05	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 08

STATION 08 - 2.5 MI. 260 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04	1.01E 04	CU. FT.	2.4 ± 0.3 E-02	2.3 ± 1.4 E-03	01/12	L.T. 4. E-02
01/04	01/11	1.00E 04	CU. FT.	4.7 ± 0.4 E-02	3.0 ± 1.5 E-03	01/18	L.T. 3. E-02
01/11	01/18	1.01E 04	CU. FT.	3.8 ± 0.4 E-02	2.2 ± 1.2 E-03	01/25	L.T. 2. E-02
01/18	01/25	1.01E 04	CU. FT.	3.7 ± 0.4 E-02	3.1 ± 1.5 E-03	01/29	L.T. 2. E-02
01/25	02/01	9.60E 03	CU. FT.	2.9 ± 0.3 E-02	2.5 ± 1.4 E-03	02/05	L.T. 2. E-02
02/01	02/08	1.02E 04	CU. FT.	2.7 ± 0.3 E-02	1.4 ± 1.1 E-03	02/16	L.T. 4. E-02
02/08	02/15	1.05E 04	CU. FT.	2.7 ± 0.3 E-02	2.7 ± 1.4 E-03	02/19	L.T. 3. E-02
02/15	02/22	9.88E 03	CU. FT.	1.9 ± 0.3 E-02	3.5 ± 1.5 E-03	02/25	L.T. 2. E-02
02/22	03/01	9.95E 03	CU. FT.	2.2 ± 0.3 E-02	4.5 ± 1.7 E-03	03/08	L.T. 4. E-02
03/01	03/08	9.30E 03	CU. FT.	1.9 ± 0.3 E-02	1.3 ± 1.1 E-03	03/12	L.T. 2. E-02
03/08	03/15	9.63E 03	CU. FT.	1.7 ± 0.3 E-02	5.5 ± 1.9 E-03	03/19	L.T. 2. E-02
03/15	03/22	1.00E 04	CU. FT.	1.9 ± 0.3 E-02	2.1 ± 1.4 E-03	03/26	L.T. 3. E-02
03/22	03/29	1.03E 04	CU. FT.	1.4 ± 0.3 E-02	1.1 ± 1.1 E-03	04/05	L.T. 5. E-02
03/29	04/05	9.79E 03	CU. FT.	1.8 ± 0.3 E-02	3.7 ± 1.9 E-03	04/08	L.T. 2. E-02
04/05	04/12	1.03E 04	CU. FT.	1.9 ± 0.3 E-02	1.3 ± 1.1 E-03	04/19	L.T. 5. E-02
04/12	04/19	9.78E 03	CU. FT.	1.8 ± 0.3 E-02	3.4 ± 1.7 E-03	04/23	L.T. 2. E-02
04/19	04/26	1.01E 04	CU. FT.	2.6 ± 0.3 E-02	2.5 ± 1.5 E-03	05/03	L.T. 5. E-02
04/26	05/03	1.01E 04	CU. FT.	6.7 ± 2.7 E-03	L.T. 1. E-03	05/07	L.T. 2. E-02
05/03	05/10	1.00E 04	CU. FT.	2.2 ± 0.3 E-02	1.7 ± 1.3 E-03	05/17	L.T. 4. E-02
05/10	05/17	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	2.0 ± 1.2 E-03	05/22	L.T. 2. E-02
05/17	05/24	1.01E 04	CU. FT.	3.0 ± 0.4 E-02	1.5 ± 1.2 E-03	05/29	L.T. 2. E-02
05/24	05/31	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	2.1 ± 1.2 E-03	06/05	L.T. 3. E-02
05/31	06/07	1.02E 04	CU. FT.	1.8 ± 0.3 E-02	1.6 ± 1.1 E-03	06/13	L.T. 4. E-02
06/07	06/14	9.97E 03	CU. FT.	1.4 ± 0.3 E-02	.93 ± .88 E-03	06/18	L.T. 2. E-02
06/14	06/21	1.04E 04	CU. FT.	2.1 ± 0.3 E-02	1.7 ± 1.2 E-03	06/26	L.T. 2. E-02
06/21	06/28	9.76E 03	CU. FT.	2.4 ± 0.3 E-02	2.6 ± 1.5 E-03	06/30	L.T. 2. E-02
06/28	07/06	1.15E 04	CU. FT.	2.7 ± 0.3 E-02	1.6 ± 1.0 E-03	07/10	L.T. 2. E-02
07/06	07/12	8.66E 03	CU. FT.	1.9 ± 0.3 E-02	1.8 ± 1.5 E-03	07/16	L.T. 2. E-02
07/12	07/19*						
07/19	07/26**						
07/26	08/02	9.68E 03	CU. FT.	1.4 ± 0.3 E-02	L.T. 2. E-03	08/05	L.T. 2. E-02
08/02	08/09	1.00E 04	CU. FT.	2.1 ± 0.3 E-02	L.T. 2. E-03	08/12	L.T. 3. E-02
08/09	08/16	9.67E 03	CU. FT.	2.7 ± 0.3 E-02	2.0 ± 1.2 E-03	08/20	L.T. 3. E-02
08/16	08/23	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	3.4 ± 1.6 E-03	08/27	L.T. 2. E-02
08/23	08/30	1.04E 04	CU. FT.	2.9 ± 0.3 E-02	1.9 ± 1.1 E-03	09/02	L.T. 2. E-02

*Pump F.I.R.

**Station #8 replaced (7/26/94) and calibrated; no sample this week.

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 08

STATION 08 - 2.5 MI. 260 DEG. IND.

COLL. DATE	TIME			AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
START DATE	STOP DATE	VOLUME	UNITS				
08/30	09/06	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	1.7 ± 1.2 E-03	09/11	L.T. 3. E-02
09/06	09/13	9.59E 03	CU. FT.	3.2 ± 0.4 E-02	2.9 ± 1.7 E-03	09/17	L.T. 3. E-02
09/13	09/20	1.04E 04	CU. FT.	1.9 ± 0.3 E-02	1.1 ± 0.9 E-03	09/23	L.T. 2. E-02
09/20	09/27	9.83E 03	CU. FT.	1.6 ± 0.3 E-02	L.T. 1. E-03	10/01	L.T. 2. E-02
09/27	10/04	1.01E 04	CU. FT.	4.1 ± 0.4 E-02	2.3 ± 1.3 E-03	10/07	L.T. 2. E-02
10/04	10/11	9.95E 03	CU. FT.	2.7 ± 0.3 E-02	L.T. 1. E-03	10/14	L.T. 2. E-02
10/11	10/18	1.02E 04	CU. FT.	2.1 ± 0.3 E-02	L.T. 2. E-03	10/21	L.T. 2. E-02
10/18	10/25	9.98E 03	CU. FT.	2.4 ± 0.3 E-02	L.T. 1. E-03	10/28	L.T. 3. E-02
10/25	11/01	1.02E 04	CU. FT.	2.8 ± 0.3 E-02	1.3 ± 0.9 E-03	11/05	L.T. 1. E-02
11/01	11/08	9.91E 03	CU. FT.	3.4 ± 0.4 E-02	1.5 ± 1.2 E-03	11/12	L.T. 2. E-02
11/08	11/15	1.03E 04	CU. FT.	2.0 ± 0.3 E-02	2.0 ± 1.3 E-03	11/19	L.T. 3. E-02
11/15	11/22	1.02E 04	CU. FT.	1.9 ± 0.3 E-02	1.6 ± 1.1 E-03	11/30	L.T. 2. E-02
11/22	11/29	9.95E 03	CU. FT.	2.6 ± 0.3 E-02	L.T. 1. E-03	12/03	L.T. 2. E-02
11/29	12/06	9.89E 03	CU. FT.	3.7 ± 0.4 E-02	1.1 ± 0.9 E-03	12/10	L.T. 2. E-02
12/06	12/13	9.60E 03	CU. FT.	5.1 ± 0.4 E-02	4.3 ± 1.8 E-03	12/17	L.T. 1. E-02
12/13	12/20	9.74E 03	CU. FT.	4.9 ± 0.4 E-02	2.8 ± 1.3 E-03	12/23	L.T. 2. E-02
12/20	12/27	1.05E 04	CU. FT.	2.9 ± 0.3 E-02	1.7 ± 1.2 E-03	12/31	L.T. 2. E-02
12/27	01/03	9.74E 03	CU. FT.	3.3 ± 0.3 E-02	1.8 ± 1.1 E-03	01/05	L.T. 2. E-02

119

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 09

STATION 09 - 7.25 MI. 335 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04	1.01E 04	CU. FT.	2.8 ± 0.3 E-02	4.0 ± 1.7 E-03	01/12	L.T. 4. E-02
01/04	01/11	1.02E 04	CU. FT.	3.9 ± 0.4 E-02	3.2 ± 1.5 E-03	01/18	L.T. 3. E-02
01/11	01/18	1.01E 04	CU. FT.	3.6 ± 0.4 E-02	3.0 ± 1.4 E-03	01/25	L.T. 2. E-02
01/18	01/25	1.01E 04	CU. FT.	3.9 ± 0.4 E-02	2.4 ± 1.3 E-03	01/29	L.T. 2. E-02
01/25	02/01	9.65E 03	CU. FT.	3.1 ± 0.3 E-02	2.5 ± 1.3 E-03	02/05	L.T. 2. E-02
02/01	02/08	1.02E 04	CU. FT.	2.6 ± 0.3 E-02	2.3 ± 1.3 E-03	02/16	L.T. 4. E-02
02/08	02/15	1.01E 04	CU. FT.	2.5 ± 0.3 E-02	1.4 ± 1.2 E-03	02/19	L.T. 3. E-02
02/15	02/22	9.97E 03	CU. FT.	2.4 ± 0.3 E-02	2.5 ± 1.3 E-03	02/25	L.T. 2. E-02
02/22	03/01	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	4.2 ± 1.7 E-03	03/08	L.T. 4. E-02
03/01	03/08	9.91E 03	CU. FT.	2.0 ± 0.3 E-02	2.9 ± 1.4 E-03	03/12	L.T. 2. E-02
03/08	03/15	1.02E 04	CU. FT.	2.3 ± 0.3 E-02	2.5 ± 1.3 E-03	03/19	L.T. 2. E-02
03/15	03/22	1.00E 04	CU. FT.	1.2 ± 0.2 E-02	L.T. 1. E-03	03/26	L.T. 3. E-02
03/22	03/29	9.88E 03	CU. FT.	1.2 ± 0.3 E-02	2.1 ± 1.4 E-03	04/05	L.T. 5. E-02
03/29	04/05	9.79E 03	CU. FT.	1.9 ± 0.3 E-02	2.1 ± 1.6 E-03	04/08	L.T. 2. E-02
04/05	04/12	1.03E 04	CU. FT.	2.4 ± 0.3 E-02	3.2 ± 1.6 E-03	04/19	L.T. 5. E-02
04/12	04/19	9.87E 03	CU. FT.	2.0 ± 0.3 E-02	3.8 ± 1.7 E-03	04/23	L.T. 2. E-02
04/19	04/26	1.01E 04	CU. FT.	2.1 ± 0.3 E-02	2.2 ± 1.5 E-03	05/03	L.T. 5. E-02
04/26	05/03	1.01E 04	CU. FT.	6.5 ± 2.6 E-03	L.T. 1. E-03	05/07	L.T. 2. E-02
05/03	05/10	1.00E 04	CU. FT.	1.6 ± 0.3 E-02	L.T. 1. E-03	05/17	L.T. 4. E-02
05/10	05/17	1.01E 04	CU. FT.	2.1 ± 0.3 E-02	2.4 ± 1.3 E-03	05/22	L.T. 2. E-02
05/17	05/24	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	1.1 ± 1.1 E-03	05/29	L.T. 2. E-02
05/24	05/31	1.01E 04	CU. FT.	1.7 ± 0.3 E-02	2.0 ± 1.1 E-03	06/05	L.T. 3. E-02
05/31	06/07	1.04E 04	CU. FT.	1.5 ± 0.2 E-02	1.3 ± 1.0 E-03	06/13	L.T. 4. E-02
06/07	06/14	9.78E 03	CU. FT.	1.7 ± 0.3 E-02	1.8 ± 1.1 E-03	06/18	L.T. 2. E-02
06/14	06/21	1.00E 04	CU. FT.	1.9 ± 0.3 E-02	L.T. 1. E-03	06/26	L.T. 2. E-02
06/21	06/28	9.94E 03	CU. FT.	2.1 ± 0.3 E-02	2.5 ± 1.5 E-03	06/30	L.T. 2. E-02
06/28	07/06	1.15E 04	CU. FT.	9.5 ± 1.9 E-03	1.7 ± 1.0 E-03	07/10	L.T. 2. E-02
07/06	07/12*						
07/12	07/19	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	L.T. 1. E-03	07/23	L.T. 3. E-02
07/19	07/26	1.04E 04	CU. FT.	2.4 ± 0.3 E-02	L.T. 1. E-03	07/30	L.T. 3. E-02
07/26	08/02	9.98E 03	CU. FT.	2.2 ± 0.3 E-02	2.8 ± 1.7 E-03	08/05	L.T. 2. E-02
08/02	08/09	9.97E 03	CU. FT.	2.6 ± 0.3 E-02	L.T. 2. E-03	08/12	L.T. 3. E-02
08/09	08/16	9.80E 03	CU. FT.	2.4 ± 0.3 E-02	3.0 ± 1.4 E-03	08/20	L.T. 3. E-02
08/16	08/23	1.01E 04	CU. FT.	3.0 ± 0.3 E-02	2.8 ± 1.5 E-03	08/27	L.T. 2. E-02
08/23	08/30	1.04E 04	CU. FT.	2.3 ± 0.3 E-02	1.7 ± 1.0 E-03	09/02	L.T. 2. E-02

*Station #9 wasn't running when collected 7/6/94; new pump installed 7/12/94.

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 09

STATION 09 - 7.25 MI. 335 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
08/30	09/06	1.00E 04	CU. FT.	2.3 ± 0.3 E-02	2.4 ± 1.3 E-03	09/11	L.T. 3. E-02
09/06	09/13	9.67E 03	CU. FT.	3.7 ± 0.4 E-02	L.T. 2. E-03	09/17	L.T. 3. E-02
09/13	09/20	1.04E 04	CU. FT.	1.6 ± 0.3 E-02	1.1 ± 0.9 E-03	09/23	L.T. 2. E-02
09/20	09/27	9.94E 03	CU. FT.	1.9 ± 0.3 E-02	1.5 ± 1.1 E-03	10/01	L.T. 2. E-02
09/27	10/04	9.79E 03	CU. FT.	3.0 ± 0.3 E-02	1.5 ± 1.2 E-03	10/07	L.T. 2. E-02
10/04	10/11	9.96E 03	CU. FT.	2.3 ± 0.3 E-02	2.2 ± 1.3 E-03	10/14	L.T. 2. E-02
10/11	10/18	1.03E 04	CU. FT.	2.1 ± 0.3 E-02	L.T. 2. E-03	10/21	L.T. 2. E-02
10/18	10/25	9.88E 03	CU. FT.	2.4 ± 0.3 E-02	2.5 ± 1.4 E-03	10/28	L.T. 3. E-02
10/25	11/01	1.02E 04	CU. FT.	2.6 ± 0.3 E-02	2.2 ± 1.1 E-03	11/05	L.T. 1. E-02
11/01	11/08	9.86E 03	CU. FT.	2.5 ± 0.3 E-02	L.T. 1. E-03	11/12	L.T. 2. E-02
11/08	11/15	1.02E 04	CU. FT.	2.4 ± 0.3 E-02	L.T. 1. E-03	11/19	L.T. 3. E-02
11/15	11/22	1.00E 04	CU. FT.	2.6 ± 0.3 E-02	2.2 ± 1.2 E-03	11/30	L.T. 2. E-02
11/22	11/29	1.02E 04	CU. FT.	3.2 ± 0.3 E-02	1.3 ± 1.1 E-03	12/03	L.T. 2. E-02
11/29	12/06	9.91E 03	CU. FT.	3.6 ± 0.4 E-02	1.5 ± 1.0 E-03	12/10	L.T. 2. E-02
12/06	12/13	1.00E 04	CU. FT.	5.0 ± 0.4 E-02	4.1 ± 1.8 E-03	12/17	L.T. 1. E-02
12/13	12/20	9.80E 03	CU. FT.	6.7 ± 0.5 E-02	5.3 ± 1.9 E-03	12/23	L.T. 2. E-02
12/20	12/27	1.04E 04	CU. FT.	2.9 ± 0.3 E-02	2.5 ± 1.3 E-03	12/31	L.T. 2. E-02
12/27	01/03	9.80E 03	CU. FT.	3.8 ± 0.4 E-02	2.6 ± 1.3 E-03	01/05	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 10

STATION 10 - 10.0 MI. 160 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
12/28	01/04	1.01E 04	CU. FT.	3.3 ± 0.4 E-02	3.0 ± 1.6 E-03	01/12	L.T. 2. E-02
01/04	01/11	1.01E 04	CU. FT.	4.4 ± 0.4 E-02	4.5 ± 1.7 E-03	01/18	L.T. 2. E-02
01/11	01/18	4.33E 03	CU. FT.	9.5 ± 0.9 E-02	5.8 ± 2.9 E-03	01/25	L.T. 4. E-02
01/18	01/25	1.01E 04	CU. FT.	4.4 ± 0.4 E-02	3.3 ± 1.5 E-03	01/29	L.T. 1. E-02
01/25	02/01	9.67E 03	CU. FT.	3.5 ± 0.4 E-02	1.8 ± 1.2 E-03	02/05	L.T. 1. E-02
02/01	02/08	1.00E 04	CU. FT.	2.8 ± 0.3 E-02	3.0 ± 1.4 E-03	02/16	L.T. 3. E-02
02/08	02/15	1.03E 04	CU. FT.	2.9 ± 0.3 E-02	3.1 ± 1.5 E-03	02/19	L.T. 2. E-02
02/15	02/22	1.02E 04	CU. FT.	2.1 ± 0.3 E-02	2.3 ± 1.2 E-03	02/25	L.T. 1. E-02
02/22	03/01	1.02E 04	CU. FT.	2.3 ± 0.3 E-02	3.4 ± 1.5 E-03	03/08	L.T. 2. E-02
03/01	03/08	6.38E 03	CU. FT.	2.9 ± 0.4 E-02	5.8 ± 2.4 E-03	03/12	L.T. 2. E-02
03/08	03/15	1.01E 04	CU. FT.	2.0 ± 0.3 E-02	3.1 ± 1.4 E-03	03/19	L.T. 1. E-02
03/15	03/22	1.00E 04	CU. FT.	1.7 ± 0.3 E-02	3.3 ± 1.6 E-03	03/26	L.T. 2. E-02
03/22	03/29	1.03E 04	CU. FT.	1.4 ± 0.3 E-02	1.1 ± 1.1 E-03	04/05	L.T. 3. E-02
03/29	04/05	9.79E 03	CU. FT.	2.2 ± 0.3 E-02	3.1 ± 1.8 E-03	04/08	L.T. 1. E-02
04/05	04/12	1.02E 04	CU. FT.	1.8 ± 0.3 E-02	1.4 ± 1.2 E-03	04/19	L.T. 3. E-02
04/12	04/19	9.88E 03	CU. FT.	1.7 ± 0.3 E-02	3.1 ± 1.6 E-03	04/23	L.T. 1. E-02
04/19	04/26	1.04E 04	CU. FT.	2.2 ± 0.3 E-02	3.2 ± 1.6 E-03	05/03	L.T. 3. E-02
04/26	05/03	9.77E 03	CU. FT.	8.3 ± 2.8 E-03	L.T. 1. E-03	05/07	L.T. 1. E-02
05/03	05/10	1.00E 04	CU. FT.	2.0 ± 0.3 E-02	1.7 ± 1.3 E-03	05/17	L.T. 2. E-02
05/10	05/17	1.01E 04	CU. FT.	2.0 ± 0.3 E-02	3.1 ± 1.4 E-03	05/22	L.T. 2. E-02
05/17	05/24	1.01E 04	CU. FT.	2.4 ± 0.4 E-02	1.1 ± 1.1 E-03	05/29	L.T. 1. E-02
05/24	05/31	1.01E 04	CU. FT.	2.0 ± 0.3 E-02	1.3 ± 1.0 E-03	06/05	L.T. 2. E-02
05/31	06/07	.02E 04	CU. FT.	2.1 ± 0.3 E-02	1.2 ± 1.0 E-03	06/13	L.T. 2. E-02
06/07	06/14	9.98E 03	CU. FT.	2.0 ± 0.3 E-02	3.1 ± 1.4 E-03	06/18	L.T. 1. E-02
06/14	06/21	1.04E 04	CU. FT.	2.1 ± 0.3 E-02	L.T. 1. E-03	06/26	L.T. 1. E-02
06/21	06/28	9.51E 03	CU. FT.	2.6 ± 0.3 E-02	1.6 ± 1.3 E-03	06/30	L.T. 1. E-02
06/28	07/06	1.17E 04	CU. FT.	2.5 ± 0.3 E-02	2.8 ± 1.2 E-03	07/10	L.T. 1. E-02
07/06	07/12	8.68E 03	CU. FT.	1.9 ± 0.3 E-02	L.T. 2. E-03	07/16	L.T. 2. E-02
07/12	07/19	1.01E 04	CU. FT.	2.5 ± 0.4 E-02	1.1 ± 1.1 E-03	07/23	L.T. 1. E-02
07/19	07/26	1.02E 04	CU. FT.	2.2 ± 0.3 E-02	1.9 ± 1.2 E-03	07/30	L.T. 3. E-02
07/26	08/02	9.88E 03	CU. FT.	2.9 ± 0.3 E-02	L.T. 2. E-03	08/05	L.T. 1. E-02
08/02	08/09	9.99E 03	CU. FT.	2.6 ± 0.3 E-02	L.T. 2. E-03	08/12	L.T. 3. E-02
08/09	08/16	1.01E 04	CU. FT.	2.7 ± 0.3 E-02	2.1 ± 1.2 E-03	08/20	L.T. 2. E-02
08/16	08/23	1.00E 04	CU. FT.	3.4 ± 0.3 E-02	4.8 ± 1.8 E-03	08/27	L.T. 1. E-02
08/23	08/30	1.04E 04	CU. FT.	3.1 ± 0.3 E-02	2.7 ± 1.2 E-03	09/02	L.T. 1. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 10

STATION 10 - 10.0 MI. 160 DEG. IND.

COLL. START DATE	TIME STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
08/30	09/06	1.02E 04	CU. FT.	2.5 ± 0.3 E-02	2.8 ± 1.4 E-03	09/11	L.T. 1. E-02
09/06	09/13	1.01E 04	CU. FT.	4.1 ± 0.4 E-02	2.8 ± 1.6. E-03	09/17	L.T. 2. E-02
09/13	09/20	1.03E 04	CU. FT.	2.4 ± 0.3 E-02	1.1 ± 0.9 E-03	09/23	L.T. 1. E-02
09/20	09/27	1.03E 04	CU. FT.	4.0 ± 0.4 E-02	1.3 ± 1.1 E-03	10/01	L.T. 1. E-02
09/27	10/04	1.03E 04	CU. FT.	4.0 ± 0.4 E-02	L.T. 1. E-03	10/07	L.T. 1. E-02
10/04	10/11	9.95E 03	CU. FT.	2.5 ± 0.3 E-02	1.7 ± 1.2 E-03	10/14	L.T. 2. E-02
10/11	10/18	1.03E 04	CU. FT.	1.6 ± 0.3 E-02	L.T. 2. E-03	10/21	L.T. 1. E-02
10/18	10/25	9.88E 03	CU. FT.	3.0 ± 0.3 E-02	2.8 ± 1.5 E-03	10/28	L.T. 2. E-02
10/25	11/01	1.02E 04	CU. FT.	2.5 ± 0.3 E-02	1.9 ± 1.1 E-03	11/05	L.T. 1. E-02
11/01	11/08	9.99E 03	CU. FT.	3.5 ± 0.4 E-02	1.5 ± 1.2 E-03	11/12	L.T. 1. E-02
11/08	11/15	1.02E 04	CU. FT.	2.2 ± 0.3 E-02	L.T. 1. E-03	11/19	L.T. 2. E-02
11/15	11/22	1.01E 04	CU. FT.	2.4 ± 0.3 E-02	3.5 ± 1.5 E-03	11/30	L.T. 2. E-02
11/22	11/29	1.00E 04	CU. FT.	2.1 ± 0.3 E-02	L.T. 1. E-03	12/03	L.T. 1. E-02
11/29	12/06	9.90E 03	CU. FT.	3.2 ± 0.4 E-02	2.1 ± 1.2 E-03	12/10	L.T. 1. E-02
12/06	12/13	1.02E 04	CU. FT.	5.2 ± 0.4 E-02	3.0 ± 1.6 E-03	12/17	L.T. 1. E-02
12/13	12/20	9.67E 03	CU. FT.	4.3 ± 0.4 E-02	1.8 ± 1.1 E-03	12/23	L.T. 1. E-02
12/20	12/27	1.05E 04	CU. FT.	3.0 ± 0.3 E-02	2.3 ± 1.3 E-03	12/31	L.T. 2. E-02
12/27	01/03	9.68E 03	CU. FT.	3.1 ± 0.3 E-02	2.5 ± 1.3 E-03	01/05	L.T. 1. E-02

**D. QUARTERLY COMPOSITES OF AIR PARTICULATE FILTERS
STATIONS 01-10**

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (PCI/CU. M.)
 STATION NUMBER 01
 STATION 01 - 0.1 MI. 225 DEG. IND.

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
-----------------	-------------	-------------	-------------	-------------

GAMMA SPECTRUM ANALYSIS:

BE-7	1.42 ± 0.14 E-01	1.36 ± 0.14 E-01	1.23 ± 0.12 E-01	8.65 ± 0.86 E-02
K-40	L.T. 9. E-03	L.T. 1. E-02	L.T. 6. E-03	3.28 ± 0.52 E-02
MN-54	L.T. 6. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 5. E-04
CO-58	L.T. 1. E-03	L.T. 8. E-04	L.T. 6. E-04	L.T. 9. E-04
FE-59	L.T. 2. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03
CO-60	L.T. 5. E-04	L.T. 6. E-04	L.T. 5. E-04	L.T. 5. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 9. E-04	L.T. 1. E-03
ZR-95	L.T. 1. E-03	L.T. 8. E-04	L.T. 6. E-04	L.T. 9. E-04
RU-103	L.T. 1. E-03	L.T. 1. E-03	L.T. 9. E-04	L.T. 1. E-03
RU-106	L.T. 5. E-03	L.T. 4. E-03	L.T. 3. E-03	L.T. 4. E-03
I-131	L.T. 2. E-01	L.T. 1. E-01	L.T. 4. E-02	L.T. 1. E-01
CS-134	L.T. 5. E-04	L.T. 5. E-04	L.T. 4. E-04	L.T. 5. E-04
CS-137	L.T. 6. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 5. E-04
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 8. E-03	L.T. 2. E-02
CE-141	L.T. 3. E-03	L.T. 3. E-03	L.T. 1. E-03	L.T. 2. E-03
CE-144	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 3. E-03
RA-226	L.T. 1. E-02	L.T. 9. E-03	L.T. 7. E-03	L.T. 7. E-03
TH-228	L.T. 9. E-04	L.T. 1. E-03	L.T. 6. E-04	L.T. 7. E-04

125

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (PCI/CU. M.)
 STATION NUMBER 02
 STATION 02 - 0.75 MI. 225 DEG. IND.

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
-----------------	-------------	-------------	-------------	-------------

GAMMA SPECTRUM ANALYSIS:

BE-7	1.21±0.12 E-01	1.58±0.16 E-01	1.21±0.12 E-01	1.13±0.13 E-01
K-40	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02
MN-54	L.T. 6. E-04	L.T. 6. E-04	L.T. 6. E-04	L.T. 5. E-04
CO-58	L.T. 9. E-04	L.T. 9. E-04	L.T. 7. E-04	L.T. 8. E-04
FE-59	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03
CO-60	L.T. 6. E-04	L.T. 6. E-04	L.T. 6. E-04	L.T. 5. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 2. E-03	L.T. 1. E-03
ZR-95	L.T. 1. E-03	L.T. 1. E-03	L.T. 9. E-04	L.T. 1. E-03
RU-103	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 2. E-03
RU-106	L.T. 5. E-03	L.T. 5. E-03	L.T. 5. E-03	L.T. 5. E-03
I-131	L.T. 2. E-01	L.T. 1. E-01	L.T. 5. E-02	L.T. 2. E-01
CS-134	L.T. 6. E-04	L.T. 6. E-04	L.T. 5. E-04	L.T. 6. E-04
CS-137	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04
BA-140	L.T. 3. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
CE-141	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 3. E-03
CE-144	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 3. E-03
RA-226	L.T. 7. E-03	L.T. 6. E-03	L.T. 7. E-03	L.T. 9. E-03
TH-228	L.T. 7. E-04	L.T. 7. E-04	L.T. 6. E-04	L.T. 9. E-04

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (PCI/CU. M.)
 STATION NUMBER 03
 STATION 03 - 2.5 MI. 338 DEG. IND.

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.27±0.13 E-01	1.45±0.15 E-01	1.17±0.12 E-01	9.41±1.05 E-02
K-40	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 8. E-03
MN-54	L.T. 6. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 4. E-04
CO-58	L.T. 1. E-03	L.T. 1. E-03	L.T. 6. E-04	L.T. 6. E-04
FE-59	L.T. 4. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03
CO-60	L.T. 7. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 5. E-04
ZN-65	L.T. 2. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 1. E-03	L.T. 1. E-03	L.T. 7. E-04	L.T. 8. E-04
RU-103	L.T. 2. E-03	L.T. 2. E-03	L.T. 9. E-04	L.T. 1. E-03
RU-106	L.T. 5. E-03	L.T. 5. E-03	L.T. 4. E-03	L.T. 4. E-03
I-131	L.T. 2. E-01	L.T. 1. E-01	L.T. 4. E-02	L.T. 1. E-01
CS-134	L.T. 7. E-04	L.T. 7. E-04	L.T. 5. E-04	L.T. 5. E-04
CS-137	L.T. 6. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 3. E-04
BA-140	L.T. 3. E-02	L.T. 2. E-02	L.T. 8. E-03	L.T. 2. E-02
CE-141	L.T. 3. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 2. E-03
CE-144	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 3. E-03
RA-226	L.T. 9. E-03	L.T. 9. E-03	L.T. 6. E-03	L.T. 8. E-03
TH-228	L.T. 8. E-04	L.T. 8. E-04	L.T. 6. E-04	L.T. 7. E-04

127

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (PCI/CU. M.)
 STATION NUMBER 04
 STATION 04 - 3.0 MI. 43 DEG. IND.

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
-----------------	-------------	-------------	-------------	-------------

GAMMA SPECTRUM ANALYSIS:

BE-7	2.07±0.21 E-01	1.93±0.19 E-01	1.45±0.14 E-01	1.85±0.18 E-01
K-40	L.T. 9. E-03	L.T. 7. E-03	L.T. 8. E-03	L.T. 1. E-02
MN-54	L.T. 5. E-04	L.T. 5. E-04	L.T. 4. E-04	L.T. 6. E-04
CO-58	L.T. 8. E-04	L.T. 6. E-04	L.T. 6. E-04	L.T. 9. E-04
FE-59	L.T. 2. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 3. E-03
CO-60	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04
ZN-65	L.T. 8. E-04	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 1. E-03	L.T. 9. E-04	L.T. 7. E-04	L.T. 1. E-03
RU-103	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 2. E-03
RU-106	L.T. 4. E-03	L.T. 4. E-03	L.T. 4. E-03	L.T. 6. E-03
I-131	L.T. 2. E-01	L.T. 9. E-02	L.T. 4. E-02	L.T. 2. E-01
CS-134	L.T. 3. E-04	L.T. 3. E-04	L.T. 4. E-04	L.T. 6. E-04
CS-137	L.T. 6. E-04	L.T. 5. E-04	L.T. 4. E-04	L.T. 6. E-04
BA-140	L.T. 3. E-02	L.T. 1. E-02	L.T. 3. E-03	L.T. 3. E-02
CE-141	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 4. E-03
CE-144	L.T. 4. E-03	L.T. 3. E-03	L.T. 3. E-03	L.T. 6. E-03
RA-226	L.T. 1. E-02	L.T. 8. E-03	L.T. 8. E-03	L.T. 1. E-02
TH-228	L.T. 1. E-03	L.T. 8. E-04	L.T. 8. E-04	L.T. 1. E-03

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (PCI/CU. M.)
 STATION NUMBER 05
 STATION 05 - 3.5 MI. 102 DEG. IND.

DATE COLLECTED:	01/17-03/29	03/29-06/28	06/28-09/27	09/27-01/03
-----------------	-------------	-------------	-------------	-------------

GAMMA SPECTRUM ANALYSIS:

BE-7	1.25±0.12 E-01	1.72±0.17 E-01	1.41±0.14 E-01	1.28±0.13 E-01
K-40	8.21±0.91 E-02	L.T. 1. E-02	3.81±0.59 E-02	L.T. 2. E-02
MN-54	L.T. 7. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 6. E-04
CO-58	L.T. 9. E-04	L.T. 8. E-04	L.T. 7. E-04	L.T. 9. E-04
FE-59	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 3. E-03
CO-60	L.T. 7. E-04	L.T. 5. E-04	L.T. 6. E-04	L.T. 6. E-04
ZN-65	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 2. E-03
ZR-95	L.T. 1. E-03	L.T. 9. E-04	L.T. 8. E-04	L.T. 1. E-03
RU-103	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 2. E-03
RU-106	L.T. 6. E-03	L.T. 5. E-03	L.T. 4. E-03	L.T. 5. E-03
I-131	L.T. 8. E-02	L.T. 1. E-01	L.T. 5. E-02	L.T. 2. E-01
CS-134	L.T. 7. E-04	L.T. 6. E-04	L.T. 6. E-04	L.T. 5. E-04
CS-137	L.T. 7. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 6. E-04
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
CE-141	L.T. 2. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03
CE-144	L.T. 3. E-03	L.T. 4. E-03	L.T. 2. E-03	L.T. 2. E-03
RA-226	L.T. 9. E-03	L.T. 9. E-03	L.T. 7. E-03	L.T. 7. E-03
TH-228	L.T. 1. E-03	L.T. 9. E-04	L.T. 7. E-04	L.T. 7. E-04

129

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - AIRBORNE
COMPOSITE AIR PARTICULATE FILTERS
(PCI/CU. M.)
STATION NUMBER 06
STATION 06 - 3.0 MI. 165 DEG. IND.

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
-----------------	-------------	-------------	-------------	-------------

GAMMA SPECTRUM ANALYSIS:

BE-7	1.54±0.15 E-01	2.01±0.20 E-01	1.48±0.15 E-01	1.17±0.12 E-01
K-40	L.T. 1. E-02	L.T. 9. E-03	L.T. 7. E-03	L.T. 1. E-02
MN-54	L.T. 5. E-04	L.T. 4. E-04	L.T. 5. E-04	L.T. 6. E-04
CO-58	L.T. 9. E-04	L.T. 7. E-04	L.T. 6. E-04	L.T. 1. E-03
FE-59	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 3. E-03
CO-60	L.T. 5. E-04	L.T. 4. E-04	L.T. 4. E-04	L.T. 7. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 9. E-04	L.T. 8. E-04	L.T. 7. E-04	L.T. 1. E-03
RU-103	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 2. E-03
RU-106	L.T. 5. E-03	L.T. 4. E-03	L.T. 4. E-03	L.T. 5. E-03
I-131	L.T. 2. E-01	L.T. 1. E-01	L.T. 5. E-02	L.T. 2. E-01
CS-134	L.T. 5. E-04	L.T. 4. E-04	L.T. 4. E-04	L.T. 6. E-04
CS-137	L.T. 5. E-04	L.T. 4. E-04	L.T. 4. E-04	L.T. 8. E-04
BA-140	L.T. 3. E-02	L.T. 2. E-02	L.T. 9. E-03	L.T. 3. E-02
CE-141	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 3. E-03
CE-144	L.T. 3. E-03	L.T. 3. E-03	L.T. 3. E-03	L.T. 3. E-03
RA-226	L.T. 9. E-03	L.T. 9. E-03	L.T. 7. E-03	L.T. 1. E-02
TH-228	L.T. 9. E-04	L.T. 8. E-04	L.T. 7. E-04	L.T. 1. E-03

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (PCI/CU. M.)
 STATION NUMBER 07
 STATION 07 - 2.5 MI. 230 DEG. 1ND.

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.38±0.14 E-01	1.53±0.15 E-01	1.10±0.11 E-01	9.18±0.92 E-02
K-40	5.56±3.20 E-03	L.T. 8. E-03	L.T. 6. E-03	L.T. 8. E-03
MN-54	L.T. 4. E-04	L.T. 5. E-04	L.T. 3. E-04	L.T. 5. E-04
CO-58	L.T. 7. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 6. E-04
FE-59	L.T. 2. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 2. E-03
CO-60	L.T. 5. E-04	L.T. 4. E-04	L.T. 4. E-04	L.T. 5. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 7. E-04	L.T. 1. E-03
ZR-95	L.T. 9. E-04	L.T. 8. E-04	L.T. 5. E-04	L.T. 8. E-04
RU-103	L.T. 1. E-03	L.T. 1. E-03	L.T. 7. E-04	L.T. 1. E-03
RU-106	L.T. 4. E-03	L.T. 4. E-03	L.T. 3. E-03	L.T. 4. E-03
I-131	L.T. 1. E-01	L.T. 9. E-02	L.T. 3. E-02	L.T. 1. E-01
CS-134	L.T. 3. E-04	L.T. 4. E-04	L.T. 3. E-04	L.T. 4. E-04
CS-137	L.T. 4. E-04	L.T. 5. E-04	L.T. 3. E-04	L.T. 5. E-04
BA-140	L.T. 2. E-02	L.T. 1. E-02	L.T. 7. E-03	L.T. 2. E-02
CE-141	L.T. 2. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 2. E-03
CE-144	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03
RA-226	L.T. 8. E-03	L.T. 8. E-03	L.T. 6. E-03	L.T. 7. E-03
TH-228	L.T. 8. E-04	L.T. 8. E-04	L.T. 5. E-04	L.T. 6. E-04

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (P.M./CU. M.)
 STATION NUMBER 08
 STATION 08 - 2.5 MI. 260 DEG. IND.

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.46±0.17 E-01	1.86±0.19 E-01	1.48±0.15 E-01	1.06±0.12 E-01
K-40	L.T. 1. E-02	L.T. 1. E-02	L.T. 8. E-03	L.T. 2. E-02
MN-54	L.T. 7. E-04	L.T. 5. E-04	L.T. 4. E-04	L.T. 7. E-04
CO-58	L.T. 1. E-03	L.T. 9. E-04	L.T. 7. E-04	L.T. 1. E-03
FE-59	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 4. E-03
CO-60	L.T. 5. E-04	L.T. 5. E-04	L.T. 4. E-04	L.T. 7. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 2. E-03
ZR-95	L.T. 1. E-03	L.T. 1. E-03	L.T. 8. E-04	L.T. 1. E-03
RU-103	L.T. 2. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 2. E-03
RU-106	L.T. 5. E-03	L.T. 5. E-03	L.T. 4. E-03	L.T. 6. E-03
I-131	L.T. 2. E-01	L.T. 1. E-01	L.T. 5. E-02	L.T. 2. E-01
CS-134	L.T. 6. E-04	L.T. 7. E-04	L.T. 4. E-04	L.T. 8. E-04
CS-137	L.T. 6. E-04	L.T. 6. E-04	L.T. 5. E-04	L.T. 7. E-04
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 3. E-02
CE-141	L.T. 5. E-03	L.T. 4. E-03	L.T. 3. E-03	L.T. 3. E-03
CE-144	L.T. 6. E-03	L.T. 5. E-03	L.T. 4. E-03	L.T. 4. E-03
RA-226	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
TH-228	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (PCI/CU. M.)
 STATION NUMBER 09
 STATION 09 - 7.25 MI. 335 DEG. IND

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
-----------------	-------------	-------------	-------------	-------------

GAMMA SPECTRUM ANALYSIS:

BE-7	1.22 ± 0.12 E-01	1.32 ± 0.13 E-01	1.21 ± 0.12 E-01	1.10 ± 0.13 E-01
K-40	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 9. E-03
MN-54	L.T. 6. E-04	L.T. 6. E-04	L.T. 7. E-04	L.T. 4. E-04
CO-58	L.T. 1. E-03	L.T. 1. E-03	L.T. 9. E-04	L.T. 9. E-04
FE-59	L.T. 3. E-03	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03
CO-60	L.T. 6. E-04	L.T. 6. E-04	L.T. 8. E-04	L.T. 5. E-04
ZN-65	L.T. 2. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 7. E-04
RU-103	L.T. 2. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03
RU-106	L.T. 5. E-03	L.T. 6. E-03	L.T. 5. E-03	L.T. 5. E-03
I-131	L.T. 2. E-01	L.T. 1. E-01	L.T. 6. E-02	L.T. 1. E-01
CS-134	L.T. 7. E-04	L.T. 6. E-04	L.T. 7. E-04	L.T. 4. E-04
CS-137	L.T. 6. E-04	L.T. 6. E-04	L.T. 7. E-04	L.T. 4. E-04
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 3. E-02
CE-141	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 3. E-03
CE-144	L.T. 3. E-03	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03
RA-226	L.T. 8. E-03	L.T. 8. E-03	L.T. 8. E-03	L.T. 9. E-03
TH-228	L.T. 8. E-04	L.T. 8. E-04	L.T. 9. E-04	L.T. 9. E-04

133

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AIRBORNE
 COMPOSITE AIR PARTICULATE FILTERS
 (PCI/CU. M.)
 STATION NUMBER 10
 STATION 10 - 10.0 MI. 160 DEG. IND.

DATE COLLECTED:	12/28-03/29	03/29-06/28	06/28-09/27	09/27-01/03
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.44±0.14 E-01	1.77±0.18 E-01	1.70±0.17 E-01	9.31±1.03 E-02
K-40	L.T. 1. E-02	L.T. 9. E-03	L.T. 8. E-03	1.78±0.52 E-02
MN-54	L.T. 6. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 6. E-04
CO-58	L.T. 9. E-04	L.T. 9. E-04	L.T. 5. E-04	L.T. 9. E-04
FE-59	L.T. 3. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 3. E-03
CO-60	L.T. 6. E-04	L.T. 5. E-04	L.T. 4. E-04	L.T. 5. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 9. E-04	L.T. 1. E-03
ZR-95	L.T. 1. E-03	L.T. 9. E-04	L.T. 6. E-04	L.T. 1. E-03
RU-103	L.T. 2. E-03	L.T. 1. E-03	L.T. 8. E-04	L.T. 1. E-03
RU-106	L.T. 5. E-03	L.T. 5. E-03	L.T. 3. E-03	L.T. 5. E-03
I-131	L.T. 2. E-01	L.T. 1. E-01	L.T. 4. E-02	L.T. 2. E-01
CS-134	L.T. 5. E-04	L.T. 5. E-04	L.T. 4. E-04	L.T. 6. E-04
CS-137	L.T. 8. E-04	L.T. 6. E-04	L.T. 5. E-04	L.T. 5. E-04
BA-140	L.T. 3. E-02	L.T. 1. E-02	L.T. 7. E-03	L.T. 2. E-02
CE-141	L.T. 3. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 2. E-03
CE-144	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 3. E-03
RA-226	L.T. 9. E-03	L.T. 8. E-03	L.T. 6. E-03	L.T. 8. E-03
TH-228	L.T. 9. E-04	L.T. 8. E-04	L.T. 7. E-04	L.T. 7. E-04

134

E. FISH

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 FISH
 (PCI/GM WET)
 STATION NUMBER 28
 STATION 28 - 1.8 MI. 150 DEG. IND.

DATE COLLECTED:	06/09 FISH-CATFISH	06/09 FISH-CARP	06/09 FISH-CARP QA	10/06 FISH-CARP	10/05 FISH-CATFISH
RADIOCHEMICAL ANALYSIS:					
GR-B	2.4 ± 0.2 E 00	4.2 ± 0.3 E 00	5.3 ± 0.3 E 00	4.5 ± 0.2 E 00	3.8 ± 0.2 E 00
SR-89	L.T. 5. E-03	L.T. 6. E-03	L.T. 7. E-03	L.T. 4. E-03	L.T. 2. E-03
SR-90	7.9 ± 1.1 E-03	1.9 ± 0.2 E-02	1.7 ± 0.3 E-02	1.3 ± 0.1 E-02	2.5 ± 0.5 E-03
GAMMA SPECTRUM ANALYSIS:					
BE-7	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01
K-40	3.11±0.31 E 00	3.21±0.32 E 00	2.05±0.20 E 00	2.98±0.30 E 00	3.17±0.32 E 00
MN-54	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CO-58	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
FE-59	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02
CO-60	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02
ZN-65	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02
ZR-95	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-103	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-106	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01
I-131	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02
CS-134	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02
CS-137	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02
BA-140	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02
CE-141	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02
CE-144	L.T. 6. E-02	L.T. 6. E-02	L.T. 7. E-02	L.T. 9. E-02	L.T. 8. E-02
RA-226	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 3. E-01	L.T. 2. E-01
TH-228	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
FISH
(PCI/GM WET)
STATION NUMBER 35
STATION 35 - 2.0 MI. 350 DEG. CON.

DATE COLLECTED:	06/08 FISH-CARP	06/08 FISH-CATFISH	10/05 FISH-CARP	10/05 FISH-CATFISH	10/05 FISH-CATFISH QA
RADIOCHEMICAL ANALYSIS:					
GR-B	4.9 ± 0.3 E 00	4.2 ± 0.3 E 00	3.6 ± 0.2 E 00	4.9 ± 0.3 E 00	5.8 ± 0.3 E 00
SR-89	L.T. 8. E-03	L.T. 8. E-03	L.T. 4. E-03	L.T. 4. E-03	L.T. 1. E-02
SR-90	2.8 ± 0.2 E-02	1.3 ± 0.2 E-02	1.1 ± 0.1 E-02	L.T. 1. E-03	L.T. 7. E-03
GAMMA SPECTRUM ANALYSIS:					
BE-7	L.T. 1. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 1. E-01	L.T. 1. E-01
K-40	2.96±0.30 E 00	1.88±0.19 E 00	3.02±0.30 E 00	2.80±0.28 E 00	2.79±0.28 E 00
MN-54	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
CO-58	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
FE-59	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 3. E-02
CO-60	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
ZN-65	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 1. E-02	L.T. 1. E-02
ZR-95	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
RU-103	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
RU-106	L.T. 1. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 1. E-01	L.T. 1. E-01
I-131	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	L.T. 3. E-02	L.T. 4. E-02
CS-134	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
CS-137	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
BA-140	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02
CE-141	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02
CE-144	L.T. 7. E-02	L.T. 8. E-02	L.T. 1. E-01	L.T. 6. E-02	L.T. 7. E-02
RA-226	L.T. 2. E-01	L.T. 2. E-01	L.T. 3. E-01	L.T. 2. E-01	L.T. 2. E-01
TH-228	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02

F. MILK - NEAREST PRODUCERS

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 MILK NEAREST PRODUCER
 (PCI/LITER)
 STATION NUMBER 99
 STATION 99 - 10.25 MI. 189 DEG. IND.

DATE COLLECTED:	01/04	02/01	03/01	03/01 QA	04/05
RADIOCHEMICAL ANALYSIS:					
SR-89	L.T. 8. E-01	L.T. 7. E-01	L.T. 7. E-01	L.T. 8. E-01	L.T. 6. E-01
SR-90	1.9 ± 0.2 E 00	1.7 ± 0.2 E 00	1.6 ± 0.2 E 00	2.1 ± 0.2 E 00	1.7 ± 0.2 E 00
I-131	L.T. 2. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01
CA (gm/liter)	1.8 ± 0.2 E 00	1.7 ± 0.2 E 00	1.7 ± 0.2 E 00	1.8 ± 0.2 E 00	1.8 ± 0.2 E 00
GAMMA SPECTRUM ANALYSIS:					
BE-7	L.T. 3. E 01	L.T. 4. E 01	L.T. 4. E 01	L.T. 4. E 01	L.T. 3. E 01
K-40	1.34±0.13 E 03	1.42±0.14 E 03	1.40±0.14 E 03	1.45±0.15 E 03	1.42±0.14 E 03
MN-54	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00
CO-58	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00
FE-59	L.T. 9. E 00	L.T. 1. E 01	L.T. 1. E 01	L.T. 1. E 01	L.T. 7. E 00
CO-60	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00
ZN-65	L.T. 9. E 00	L.T. 1. E 01	L.T. 9. E 00	L.T. 1. E 01	L.T. 7. E 00
ZR-95	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00
RU-103	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00
RU-106	L.T. 3. E 01	L.T. 4. E 01	L.T. 3. E 01	L.T. 4. E 01	L.T. 3. E 01
I-131	L.T. 8. E 00	L.T. 8. E 00	L.T. 7. E 00	L.T. 9. E 00	L.T. 5. E 00
CS-134	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00
CS-137	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00
BA-140	L.T. 6. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 7. E 00	L.T. 4. E 00
CE-141	L.T. 7. E 00	L.T. 8. E 00	L.T. 6. E 00	L.T. 8. E 00	L.T. 6. E 00
CE-144	L.T. 2. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01
RA-226	L.T. 7. E 01	L.T. 8. E 01	L.T. 7. E 01	L.T. 9. E 01	L.T. 7. E 01
TH-228	L.T. 7. E 00	L.T. 8. E 00	L.T. 6. E 00	L.T. 8. E 00	L.T. 6. E 00

139

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
MILK NEAREST PRODUCER
(PCI/LITER)
STATION NUMBER 99
STATION 99 - 10.25 MI. 189 DEG. IND.

	DATE COLLECTED:	05/03	06/07	06/07 QA	06/21	06/07-06/21
RADIOCHEMICAL ANALYSIS:						
SR-89		L.T. 7. E-01				L.T. 2. E 00
SR-90		1.2 ± 0.1 E 00				3.0 ± 0.3 E 00
I-131		L.T. 2. E-01	L.T. 3. E-01	L.T. 3. E-01	L.T. 2. E-01	
CA (gm/liter)		1.5 ± 0.2 E 00				1.7 ± 0.2 E 00
GAMMA SPECTRUM ANALYSIS:						
BE-7		L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 4. E 01	
K-40		1.40±0.14 E 03	120±0.12 E 03	1.39±0.14 E 03	1.51±0.15 E 03	
MN-54		L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 5. E 00	
CO-58		L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 5. E 00	
FE-59		L.T. 8. E 00	L.T. 8. E 00	L.T. 8. E 00	L.T. 1. E 01	
CO-60		L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 5. E 00	
ZN-65		L.T. 9. E 00	L.T. 9. E 00	L.T. 8. E 00	L.T. 1. E 01	
ZR-95		L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 5. E 00	
RU-103		L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 5. E 00	
RU-106		L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 5. E 01	
I-131		L.T. 7. E 00	L.T. 8. E 00	L.T. 7. E 00	L.T. 8. E 00	
CS-134		L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 5. E 00	
CS-137		L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 5. E 00	
BA-140		L.T. 5. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 6. E 00	
CE-141		L.T. 7. E 00	L.T. 7. E 00	L.T. 6. E 00	L.T. 8. E 00	
CE-144		L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 3. E 01	
RA-226		L.T. 9. E 01	L.T. 8. E 01	L.T. 6. E 01	L.T. 9. E 01	
TH-228		L.T. 7. E 00	L.T. 7. E 00	L.T. 5. E 00	L.T. 8. E 00	

140

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
MILK NEAREST PRODUCER
(PCI/LITER)
STATION NUMBER 99
STATION 99 - 10.25 MI. 189 DEG. IND.

DATE COLLECTED:	07/06	07/06 QA	07/19	07/06-07/19	08/02
-----------------	-------	----------	-------	-------------	-------

RADIOCHEMICAL ANALYSIS:

SR-89		L.T. 1. E 00		L.T. 1. E 00	
SR-90		1.7 ± 0.2 E 00		1.0 ± 0.3 E 00	
I-131	L.T. 2. E-01	L.T. 1. E 00	L.T. 3. E-01		
CA (gm/liter)		1.7 ± 0.2 E 01		1.7 ± 0.2 E 00	L.T. 1. E-01

GAMMA SPECTRUM ANALYSIS:

BE-7	L.T. 3. E 01	L.T. 5. E 01	L.T. 3. E-01	L.T. 3. E 01
K-40	1.68±0.17 E 03	1.42±0.14 E 03	1.33±0.13 E 03	1.34±0.13 E 03
MN-54	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00
CO-58	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00	L.T. 3. E 00
FE-59	L.T. 8. E 00	L.T. 1. E 01	L.T. 7. E 00	L.T. 7. E 00
CO-60	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00
ZN-65	L.T. 9. E 00	L.T. 1. E 01	L.T. 7. E 00	L.T. 7. E 00
ZR-95	L.T. 4. E 00	L.T. 6. E 00	L.T. 3. E 00	L.T. 3. E 00
RU-103	L.T. 4. E 00	L.T. 7. E 00	L.T. 3. E 00	L.T. 3. E 00
RU-106	L.T. 3. E 01	L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01
I-131	L.T. 6. E 00	L.T. 9. E 01	L.T. 6. E 00	L.T. 4. E 00
CS-134	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
CS-137	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00
BA-140	L.T. 5. E 00	L.T. 3. E 01	L.T. 5. E 00	L.T. 4. E 00
CE-141	L.T. 6. E 00	L.T. 1. E 01	L.T. 6. E 00	L.T. 5. E 00
CE-144	L.T. 2. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 2. E 01
RA-226	L.T. 7. E 01	L.T. 7. E 01	L.T. 6. E 01	L.T. 6. E 01
TH-228	L.T. 7. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 5. E 00

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 MILK NEAREST PRODUCER
 (PCI/LITER)
 STATION NUMBER 99
 STATION 99 - 10.25 MI. 189 DEG. IND.

DATE COLLECTED: 08/02 QA 08/02-08/30 08/16 08/30 09/13

RADIOCHEMICAL ANALYSIS:

SR-89	L.T. 9. E-01	L.T. 2. E 00			
SR-90	1.4 ± 0.2 E 00	1.9 ± 0.2 E 00			
I-131	L.T. 1. E-01		L.T. 2. E-01	L.T. 1. E-01	L.T. 2. E-01
CA (gm/liter)	1.7 ± 0.2 E 01	1.8 ± 0.2 E 00			

GAMMA SPECTRUM ANALYSIS:

142

BE-7	L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 3. E 01
K-40	1.36±0.14 E 03	1.28±0.13 E 03	1.25±0.12 E 03	1.38±0.14 E 03
MN-54	L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00
CO-58	L.T. 3. E 00	L.T. 4. E 00	L.T. 2. E 00	L.T. 3. E 00
FE-59	L.T. 7. E 00	L.T. 9. E 00	L.T. 6. E 00	L.T. 8. E 00
CO-60	L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
ZN-65	L.T. 8. E 00	L.T. 8. E 00	L.T. 6. E 00	L.T. 9. E 00
ZR-95	L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-103	L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-106	L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 3. E 01
I-131	L.T. 5. E 00	L.T. 7. E 00	L.T. 4. E 00	L.T. 6. E 00
CS-134	L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
CS-137	L.T. 3. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00
BA-140	L.T. 4. E 00	L.T. 6. E 00	L.T. 3. E 00	L.T. 5. E 00
CE-141	L.T. 5. E 00	L.T. 8. E 00	L.T. 5. E 00	L.T. 7. E 00
CE-144	L.T. 2. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 3. E 01
RA-226	L.T. 6. E 01	L.T. 9. E 01	L.T. 6. E 01	L.T. 8. E 01
TH-228	L.T. 5. E 00	L.T. 7. E 00	L.T. 5. E 00	L.T. 7. E 00

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 MILK NEAREST PRODUCER
 (PCI/LITER)
 STATION NUMBER 79
 STATION 99 - 10.25 MI. 1d9 DEG. IND.

DATE COLLECTED:	09/13 QA	09/13-09/27	09/27	10/04	11/08
RADIOCHEMICAL ANALYSIS:					
SR-89	L.T. 7. E-01	L.T. 9. E-01		L.T. 9. E-01	L.T. 1. E 00
SR-90	1.7 ± 0.2 E 00	1.5 ± 0.2 E 00		1.8 ± 0.3 E 00	2.1 ± 0.3 E 00
I-131	L.T. 2. E-01		L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01
CA (gm/liter)	1.8 ± 0.2 E 00	1.8 ± 0.2 E 00		1.9 ± 0.2 E 00	1.8 ± 0.2 E 00
GAMMA SPECTRUM ANALYSIS:					
BE-7	L.T. 3. E 01		L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01
K-40	1.44±0.14 E 03		1.42±0.14 E 03	1.28±0.13 E 03	1.38±0.14 E 03
MN-54	L.T. 3. E 00		L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00
CO-58	L.T. 3. E 00		L.T. 3. E 00	L.T. 4. E 00	L.T. 2. E 00
FE-59	L.T. 7. E 00		L.T. 7. E 00	L.T. 9. E 00	L.T. 6. E 00
CO-60	L.T. 3. E 00		L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00
ZN-65	L.T. 8. E 00		L.T. 8. E 00	L.T. 1. E 01	L.T. 6. E 00
ZR-95	L.T. 3. E 00		L.T. 3. E 00	L.T. 4. E 00	L.T. 5. E 00
RU-103	L.T. 4. E 00		L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00
RU-106	L.T. 3. E 01		L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01
I-131	L.T. 6. E 00		L.T. 4. E 00	L.T. 8. E 00	L.T. 4. E 00
CS-134	L.T. 3. E 00		L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00
CS-137	L.T. 3. E 00		L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00
BA-140	L.T. 4. E 00		L.T. 4. E 00	L.T. 6. E 00	L.T. 8. E 00
CE-141	L.T. 6. E 00		L.T. 5. E 00	L.T. 8. E 00	L.T. 5. E 00
CE-144	L.T. 2. E 01		L.T. 2. E 01	L.T. 3. E 01	L.T. 2. E 01
RA-226	L.T. 7. E 01		L.T. 7. E 01	L.T. 8. E 01	L.T. 6. E 01
TH-228	L.T. 6. E 00		L.T. 5. E 00	L.T. 7. E 00	L.T. 5. E 00

I
4
G

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
MILK NEAREST PRODUCER
(PCI/LITER)
STATION NUMBER 99
STATION 99 - 10.25 MI. 189 DEG. IND.

DATE COLLECTED: 12/06

RADIOCHEMICAL ANALYSIS:

SR-89	L.T. 7. E-01
SR-90	1.6 ± 0.2 E 00
I-131	L.T. 2. E-01
CA (gm/liter)	1.7 ± 0.2 E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	L.T. 3. E 01
K-40	1.33±0.13 E 03
MN-54	L.T. 3. E 00
CO-58	L.T. 3. E 00
FE-59	L.T. 7. E 00
CO-60	L.T. 3. E 00
ZN-65	L.T. 7. E 00
ZR-95	L.T. 3. E 00
RU-103	L.T. 3. E 00
RU-106	L.T. 3. E 01
I-131	L.T. 4. E 00
CS-134	L.T. 3. E 00
CS-137	L.T. 3. E 00
BA-140	L.T. 3. E 00
CE-141	L.T. 5. E 00
CE-144	L.T. 2. E 01
RA-226	L.T. 6. E 01
TH-228	L.T. 5. E 00

G. MILK - OTHER PRODUCERS

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 MILK OTHER PRODUCERS
 (PCI/LITER)
 STATION NUMBER 42
 STATION 42 - 12.85 MI. 156 DEG. IND.

	DATE COLLECTED:	01/12	04/12	07/12	10/11
RADIOCHEMICAL ANALYSIS:					
SR-89		L.T. 8. E-01	L.T. 8. E-01	L.T. 9. E-01	L.T. 1. E 00
SR-90		1.8 ± 0.2 E 00	1.5 ± 0.2 E 00	2.5 ± 0.2 E 00	2.3 ± 0.2 E 00
I-131		L.T. 3. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01
CA (gm/liter)		1.8 ± 0.2 E 00	1.7 ± 0.2 E 00	1.7 ± 0.2 E 00	1.9 ± 0.2 E 00
GAMMA SPECTRUM ANALYSIS:					
BE-7		L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 4. E 01
K-40		1.21±0.12 E 03	1.53±0.15 E 03	1.33±0.13 E 03	1.36±0.14 E 03
MN-54		L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
CO-58		L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
FE-59		L.T. 9. E 00	L.T. 7. E 00	L.T. 9. E 00	L.T. 1. E 01
CO-60		L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00	L.T. 5. E 00
ZN-65		L.T. 9. E 00	L.T. 7. E 00	L.T. 9. E 00	L.T. 1. E 01
ZR-95		L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00	L.T. 5. E 00
RU-103		L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00	L.T. 5. E 00
RU-106		L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 4. E 01
I-131		L.T. 7. E 00	L.T. 6. E 00	L.T. 7. E 00	L.T. 8. E 00
CS-134		L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00	L.T. 5. E 00
CS-137		L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 5. E 00
BA-140		L.T. 5. E 00	L.T. 5. E 00	L.T. 6. E 00	L.T. 6. E 00
CE-141		L.T. 6. E 00	L.T. 6. E 00	L.T. 8. E 00	L.T. 9. E 00
CE-144		L.T. 2. E 01	L.T. 2. E 01	L.T. 3. E 01	L.T. 4. E 01
RA-226		L.T. 8. E 01	L.T. 7. E 01	L.T. 9. E 01	L.T. 1. E 02
TH-228		L.T. 7. E 00	L.T. 6. E 00	L.T. 7. E 00	L.T. 1. E 01

140

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 MILK OTHER PRODUCERS
 (PCI/LITER)
 STATION NUMBER 100
 STATION 100 - 11.5 MI. 197 DEG. IND.

DATE COLLECTED:	01/12	04/12	07/12	10/11
RADIOCHEMICAL ANALYSIS:				
SR-89	L.T. 9. E-01	L.T. 1. E 00	L.T. 8. E 01	L.T. 1. E 00
SR-90	1.4 ± 0.2 E 00	1.7 ± 0.3 E 00	2.2 ± 0.2 E 00	2.8 ± 0.2 E 00
I-131	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01
CA (gm/liter)	1.8 ± 0.2 E 00	1.8 ± 0.2 E 00	1.8 ± 0.2 E 00	1.9 ± 0.2 E 00
GAMMA SPECTRUM ANALYSIS:				
BE-7	L.T. 3. E 01	L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01
K-40	1.43±0.14 E 03	1.24±0.12 E 03	1.33±0.13 E 03	1.36±0.14 E 03
MN-54	L.T. 3. E 00	L.T. 5. E 00	L.T. 3. E 00	L.T. 4. E 00
CO-58	L.T. 3. E 00	L.T. 5. E 00	L.T. 3. E 00	L.T. 4. E 00
FE-59	L.T. 8. E 00	L.T. 1. E 01	L.T. 8. E 00	L.T. 8. E 00
CO-60	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00	L.T. 4. E 00
ZN-65	L.T. 8. E 00	L.T. 1. E 01	L.T. 7. E 00	L.T. 9. E 00
ZR-95	L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00	L.T. 3. E 00
RU-103	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 4. E 00
RU-106	L.T. 3. E 01	L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01
I-131	L.T. 6. E 00	L.T. 9. E 00	L.T. 6. E 00	L.T. 6. E 00
CS-134	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 4. E 00
CS-137	L.T. 5. E 00	L.T. 5. E 00	L.T. 3. E 00	L.T. 4. E 00
BA-140	L.T. 5. E 00	L.T. 6. E 00	L.T. 4. E 00	L.T. 6. E 00
CE-141	L.T. 6. E 00	L.T. 8. E 00	L.T. 5. E 00	L.T. 5. E 00
CE-144	L.T. 2. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 2. E 01
RA-226	L.T. 7. E 01	L.T. 8. E 01	L.T. 7. E 01	L.T. 6. E 01
TH-228	L.T. 7. E 00	L.T. 8. E 00	L.T. 5. E 00	L.T. 6. E 00

H. GROUNDWATER

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - WATERBORNE
 WATER - GROUND
 (PCI/LITER)
 STATION NUMBER 11
 STATION 11 - 0.15 MI. 225 DEG. IND.

	DATE COLLECTED:	01/26	04/26	07/26	10/25							
RADIOCHEMICAL ANALYSIS:												
GR-A	L.T.	3.	E 00	L.T.	3.	E 00	L.T.	3.	E 00	L.T.	2.	E 00
GR-B	1.0	± 0.2	E 01	9.3	± 1.8	E 00	1.3	± 0.2	E 01	8.6	± 1.7	E 00
GAMMA SPECTRUM ANALYSIS:												
BE-7	L.T.	3.	E 01	L.T.	3.	E 01	L.T.	3.	E 01	L.T.	3.	E 01
K-40	L.T.	5.	E 01	L.T.	6.	E 01	L.T.	9.	E 01	L.T.	6.	E 01
MN-54	L.T.	2.	E 00	L.T.	3.	E 00	L.T.	3.	E 00	L.T.	3.	E 00
CO-58	L.T.	3.	E 00	L.T.	4.	E 00	L.T.	3.	E 00	L.T.	3.	E 00
FE-59	L.T.	5.	E 00	L.T.	7.	E 00	L.T.	7.	E 00	L.T.	6.	E 00
CO-60	L.T.	3.	E 00	L.T.	4.	E 00	L.T.	3.	E 00	L.T.	3.	E 00
ZN-65	L.T.	5.	E 00	L.T.	8.	E 00	L.T.	8.	E 00	L.T.	8.	E 00
ZR-95	L.T.	3.	E 00	L.T.	3.	E 00	L.T.	3.	E 00	L.T.	4.	E 00
RU-103	L.T.	3.	E 00	L.T.	4.	E 00	L.T.	4.	E 00	L.T.	3.	E 00
RU-106	L.T.	3.	E 01	L.T.	3.	E 01	L.T.	3.	E 01	L.T.	3.	E 01
I-131	L.T.	5.	E 00	L.T.	6.	E 00	L.T.	5.	E 00	L.T.	5.	E 00
CS-134	L.T.	3.	E 00	L.T.	3.	E 00	L.T.	4.	E 00	L.T.	4.	E 00
CS-137	L.T.	3.	E 00	L.T.	4.	E 00	L.T.	4.	E 00	L.T.	4.	E 00
BA-140	L.T.	4.	E 00	L.T.	5.	E 00	L.T.	4.	E 00	L.T.	5.	E 00
CE-141	L.T.	6.	E 00	L.T.	8.	E 00	L.T.	5.	E 00	L.T.	6.	E 00
CE-144	L.T.	2.	E 01	L.T.	3.	E 01	L.T.	2.	E 01	L.T.	3.	E 01
RA-226	L.T.	6.	E 01	L.T.	9.	E 01	L.T.	7.	E 01	L.T.	7.	E 01
TH-228	L.T.	5.	E 00	L.T.	7.	E 00	L.T.	6.	E 00	L.T.	7.	E 00
TRITIUM ANALYSIS:												
H-3	L.T.	1.	E 02	L.T.	1.	E 02	L.T.	1.	E 02	L.T.	1.	E 02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - WATERBORNE
 WATER - GROUND
 (PCI/LITER)
 STATION NUMBER 47
 STATION 47 - 25.75 MI. 154 DEG. IND.

DATE COLLECTED:	01/25	04/26	07/26	10/25
RADIOCHEMICAL ANALYSIS:				
GR-A	L.T. 4. E 00	L.T. 3. E 00	L.T. 2. E 00	L.T. 2. E 00
GR-B	1.2 ± 0.2 E 01	7.6 ± 1.6 E 00	9.9 ± 1.8 E 00	9.9 ± 1.8 E 00
GAMMA SPECTRUM ANALYSIS:				
BE-7	L.T. 3. E 01			
K-40	L.T. 5. E 01	L.T. 7. E 01	L.T. 9. E 01	5.88±2.78 E 01
MN-54	L.T. 3. E 00			
CO-58	L.T. 3. E 00			
FE-59	L.T. 7. E 00	L.T. 7. E 00	L.T. 7. E 00	L.T. 8. E 00
CO-60	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00
ZN-65	L.T. 7. E 00	L.T. 8. E 00	L.T. 7. E 00	L.T. 8. E 00
ZR-95	L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-103	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-106	L.T. 3. E 01			
I-131	L.T. 7. E 00	L.T. 7. E 00	L.T. 4. E 00	L.T. 6. E 00
CS-134	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
CS-137	L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
BA-140	L.T. 6. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 6. E 00
CE-141	L.T. 6. E 00	L.T. 9. E 00	L.T. 5. E 00	L.T. 6. E 00
CE-144	L.T. 2. E 01	L.T. 4. E 01	L.T. 2. E 01	L.T. 2. E 01
RA-226	L.T. 6. E 01	L.T. 1. E 02	L.T. 6. E 01	L.T. 7. E 01
TH-228	L.T. 6. E 00	L.T. 9. E 00	L.T. 6. E 00	L.T. 7. E 00
TRITIUM ANALYSIS:				
H-3	L.T. 1. E 02			

L RIVER WATER

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - WATERBORNE
 WATER - RIVER
 (PCI/LITER)
 STATION NUMBER 12
 STATION 12 - 0.1 MI. 360 DEG. CON

DATE COLLECTED:	01/04	02/01	03/01*	03/08	04/05
-----------------	-------	-------	--------	-------	-------

RADIOCHEMICAL ANALYSIS:

SR-89	L.T. 1. E 00	L.T. 5. E-01		L.T. 9. E-01	L.T. 1. E 00
SR-90	L.T. 5. E-01	L.T. 2. E-01		L.T. 5. E-01	L.T. 7. E-01
GR-A DIS	L.T. 4. E 00	L.T. 4. E 00		3.3 ± 2.2 E 00	L.T. 4. E 00
GR-A SUS	8.1 ± 4.9 E-01	L.T. 6. E-01		L.T. 2. E-01	1.4 ± 1.1 E 00
GR-B DIS	9.0 ± 1.8 E 00	1.3 ± 0.2 E 01		1.4 ± 0.2 E 01	1.5 ± 0.2 E 01
GR-B SUS	2.2 ± 0.7 E 00	8.3 ± 5.6 E-01		5.1 ± 1.5 E 01	5.8 ± 1.0 E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	L.T. 3. E 01	L.T. 3. E 01		L.T. 3. E 01	L.T. 4. E 01
K-40	L.T. 6. E 01	L.T. 8. E 01		L.T. 5. E 01	L.T. 6. E 01
MN-54	L.T. 3. E 00	L.T. 3. E 00		L.T. 3. E 00	L.T. 4. E 00
CO-58	L.T. 3. E 00	L.T. 3. E 00		L.T. 3. E 00	L.T. 4. E 00
FE-59	L.T. 8. E 00	L.T. 5. E 00		L.T. 7. E 00	L.T. 7. E 00
CO-60	L.T. 4. E 00	L.T. 3. E 00		L.T. 4. E 00	L.T. 4. E 00
ZN-65	L.T. 8. E 00	L.T. 6. E 00		L.T. 8. E 00	L.T. 7. E 00
ZR-95	L.T. 4. E 00	L.T. 3. E 00		L.T. 4. E 00	L.T. 4. E 00
RU-103	L.T. 4. E 00	L.T. 3. E 00		L.T. 4. E 00	L.T. 4. E 00
RU-106	L.T. 3. E 01	L.T. 3. E 01		L.T. 3. E 01	L.T. 4. E 01
I-131	L.T. 9. E 00	L.T. 4. E 00		L.T. 6. E 00	L.T. 7. E 00
CS-134	L.T. 4. E 00	L.T. 3. E 00		L.T. 4. E 00	L.T. 4. E 00
CS-137	L.T. 4. E 00	L.T. 3. E 00		L.T. 3. E 00	L.T. 4. E 00
BA-140	L.T. 6. E 00	L.T. 4. E 00		L.T. 6. E 00	L.T. 6. E 00
CE-141	L.T. 8. E 00	L.T. 5. E 00		L.T. 6. E 00	L.T. 9. E 00
CE-144	L.T. 3. E 01	L.T. 2. E 01		L.T. 2. E 01	L.T. 4. E 01
RA-226	L.T. 9. E 01	L.T. 6. E 01		L.T. 6. E 01	L.T. 9. E 01
TH-228	L.T. 7. E 00	L.T. 5. E 00		L.T. 6. E 00	L.T. 9. E 00

TRITIUM ANALYSIS: 01/04-03/08

H-3 L.T. 1. E 02

*Sample not collected - unsafe conditions

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - WATERBORNE
 WATER - RIVER
 (PCI/LITER)
 STATION NUMBER 12
 STATION 12 - 0.1 MI. 360 DEG. CON

	DATE COLLECTED:	05/03	06/07*	07/06	08/02	09/06
RADIOCHEMICAL ANALYSIS:						
SR-89		L.T. 9. E-01	L.T. 1. E 00	L.T. 9. E-01	L.T. 9. E-01	L.T. 1. E 00
SR-90		L.T. 3. E-01	L.T. 4. E-01	L.T. 4. E-01	L.T. 3. E-01	L.T. 6. E-01
GR-A DIS		2.9 ± 2.2 E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 1. E 00	6.7 ± 3.4 E 00
GR-A SUS		5.9 ± 3.9 E-01	9.8 ± 7.7 E-01	8.0 ± 6.1 E-01	6.1 ± 2.7 E 00	2.3 ± 0.8 E 00
GR-B DIS		1.1 ± 0.2 E 01	9.7 ± 1.6 E 00	1.2 ± 0.2 E 01	5.5 ± 0.9 E 00	1.1 ± 0.2 E 01
GR-B SUS		7.8 ± 5.4 E-01	3.7 ± 0.9 E 00	2.2 ± 0.7 E 00	7.5 ± 1.3 E 00	3.2 ± 0.7 E 00
GAMMA SPECTRUM ANALYSIS:						
BE-7		L.T. 3. E 01	L.T. 4. E 01	L.T. 2. E 01	L.T. 2. E 01	L.T. 3. E 01
K-40		7.74±2.65 E 01	L.T. 7. E 01	L.T. 5. E 01	L.T. 5. E 01	L.T. 6. E 01
MN-54		L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
CO-58		L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
FE-59		L.T. 8. E 00	L.T. 9. E 00	L.T. 5. E 00	L.T. 6. E 00	L.T. 7. E 00
CO-60		L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
ZN-65		L.T. 7. E 00	L.T. 8. E 00	L.T. 6. E 00	L.T. 5. E 00	L.T. 6. E 00
ZR-95		L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-103		L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-106		L.T. 3. E 01	L.T. 4. E 01	L.T. 2. E 01	L.T. 2. E 01	L.T. 3. E 01
I-131		L.T. 7. E 00	L.T. 9. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 6. E 00
CS-134		L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
CS-137		L.T. 4. E 00	L.T. 5. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
BA-140		L.T. 5. E 00	L.T. 6. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 5. E 00
CE-141		L.T. 6. E 00	L.T. 9. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 8. E 00
CE-144		L.T. 3. E 01	L.T. 4. E 01	L.T. 2. E 01	L.T. 2. E 01	L.T. 3. E 01
RA-226		L.T. 7. E 01	L.T. 1. E 02	L.T. 7. E 01	L.T. 7. E 01	L.T. 1. E 02
TH-228		L.T. 6. E 00	L.T. 1. E 01	L.T. 6. E 00	L.T. 7. E 00	L.T. 9. E 00
TRITIUM ANALYSIS:						
H-3		04/05-06/07	07/06-09/06			
		L.T. 1. E 02	L.T. 1. E 02			

*The June sample was collected from Station 35 because conditions at Station 12 were unsafe.

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - WATERBORNE
 WATER - RIVER
 (PCI/LITER)
 STATION NUMBER 12
 STATION 12 - 0.1 MI. 360 DEG. CON

DATE COLLECTED:	10/04	11/01	12/06
-----------------	-------	-------	-------

RADIOCHEMICAL ANALYSIS:

SR-89	L.T. 8. E-01	L.T. 1. E 00	L.T. 1. E 00
SR-90	L.T. 4. E-01	L.T. 6. E-01	L.T. 5. E-01
GR-A DIS	L.T. 2. E 00	L.T. 2. E 00	4.1 ± 2.6 E 00
GR-A SUS	4.9 ± 3.9 E-01	$7. \pm 5.7$ E-01	7.0 ± 5.6 E-01
GR-B DIS	9.5 ± 1.5 E 00	1.2 ± 2.2 E 00	1.3 ± 0.2 E 01
GR-B SUS	1.5 ± 0.6 E 00	2.9 ± 0.6 E 00	3.4 ± 0.8 E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01
K-40	L.T. 9. E 01	L.T. 6. E 01	L.T. 1. E 02
MN-54	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00
CO-58	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00
FE-59	L.T. 8. E 00	L.T. 6. E 00	L.T. 7. E 00
CO-60	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
ZN-65	L.T. 8. E 00	L.T. 7. E 00	L.T. 8. E 00
ZR-95	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-103	L.T. 5. E 00	L.T. 4. E 00	L.T. 4. E 00
RU-106	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01
I-131	L.T. 8. E 00	L.T. 6. E 00	L.T. 6. E 00
CS-134	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
CS-137	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00
BA-140	L.T. 6. E 00	L.T. 5. E 00	L.T. 5. E 00
CE-141	L.T. 7. E 00	L.T. 7. E 00	L.T. 6. E 00
CE-144	L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01
RA-226	L.T. 7. E 01	L.T. 7. E 01	L.T. 6. E 01
TH-228	L.T. 6. E 00	L.T. 6. E 00	L.T. 6. E 00

TRITIUM ANALYSIS:	10/04-12/06
-------------------	-------------

H-3	L.T. 1. E 00
-----	--------------

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - WATERBORNE
WATER - RIVER
(PCI/LITER)
STATION NUMBER 28
STATION 28 - 1.8 MI. 150 DEG. IND.

DATE COLLECTED:	01/04	02/01	03/01	03/08	04/05
RADIOCHEMICAL ANALYSIS:					
SR-89	L.T. 1. E 00	L.T. 5. E-01	L.T. 1. E 00	L.T. 1. E 00	L.T. 1. E 00
SR-90	L.T. 9. E-01	L.T. 2. E-01	L.T. 7. E-01	L.T. 7. E-01	L.T. 9. E-01
GR-A DIS	L.T. 4. E 00	L.T. 4. E 00	L.T. 2. E 00	L.T. 2. E 00	L.T. 4. E 00
GR-A SUS	L.T. 4. E-01	L.T. 6. E-01	9.1 ± 7.3 E-01	3.1 ± 1.7 E 01	2.6 ± 1.5 E 00
GR-B DIS	1.2 ± 0.2 E 01	1.2 ± 0.2 E 01	1.5 ± 0.2 E 01	1.3 ± 0.2 E 01	1.4 ± 0.2 E 01
GR-B SUS	1.0 ± 0.6 E 00	L.T. 8. E-01	5.9 ± 1.1 E 00	5.6 ± 1.6 E 01	8.3 ± 1.2 E 00
GAMMA SPECTRUM ANALYSIS:					
BE-7	L.T. 4. E 01	L.T. 3. E 01			
K-40	L.T. 7. E 01	L.T. 1. E 02	L.T. 7. E 01	4.75±2.21 E 01	L.T. 5. E 01
MN-54	L.T. 4. E 00	L.T. 3. E 00			
CO-58	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
FE-59	L.T. 7. E 00	L.T. 8. E 00	L.T. 7. E 00	L.T. 6. E 00	L.T. 7. E 00
CO-60	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
ZN-65	L.T. 7. E 00	L.T. 8. E 00	L.T. 6. E 00	L.T. 5. E 00	L.T. 7. E 00
ZR-95	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
RU-103	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-106	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 3. E 01
I-131	L.T. 9. E 00	L.T. 5. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 6. E 00
CS-134	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
CS-137	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
BA-140	L.T. 8. E 00	L.T. 4. E 00	L.T. 5. E 00	L.T. 4. E 00	L.T. 6. E 00
CE-141	L.T. 9. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 5. E 00
CE-144	L.T. 3. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 2. E 01	L.T. 2. E 01
RA-226	L.T. 1. E 02	L.T. 7. E 01	L.T. 6. E 01	L.T. 7. E 01	L.T. 6. E 01
TH-228	L.T. 9. E 00	L.T. 6. E 00			
TRITIUM ANALYSIS:					
H-3	L.T. 1. E 02				

155

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - WATERBORNE
 WATER - RIVER
 (PCI/LITER)
 STATION NUMBER 28
 STATION 28 - 1.8 MI. 150 DEG. IND.

DATE COLLECTED:	05/03	06/07	07/06	08/02	09/06
RADIOCHEMICAL ANALYSIS:					
SR-89	L.T. 8. E-01	L.T. 8. E-01	L.T. 1. E 00	L.T. 1. E 00	L.T. 7. E-01
SR-90	L.T. 3. E-01	L.T. 3. E-01	L.T. 5. E-01	L.T. 6. E-01	L.T. 3. E-01
GR-A DIS	L.T. 2. E 00	2.8 ± 2.3 E 00	4.3 ± 3.2 E 00	L.T. 1. E 00	L.T. 3. E 00
GR-A SUS	6.2 ± 4.1 E-01	1.1 ± 0.8 E 00	1.1 ± 0.7 E 00	L.T. 4. E 00	8.9 ± 4.7 E-01
GR-B DIS	1.2 ± 0.2 E 01	1.0 ± 0.2 E 01	1.2 ± 0.2 E 01	5.9 ± 1.0 E 00	1.1 ± 0.2 E 01
GR-B SUS	1.2 ± 0.6 E 00	2.7 ± 0.8 E 00	2.3 ± 0.8 E 00	5.1 ± 1.5 E 00	2.0 ± 0.6 E 00
GAMMA SPECTRUM ANALYSIS:					
BE-7	L.T. 4. E 01	L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01
K-40	6.62±3.63 E 01	7.96±2.98 E 01	L.T. 5. E 01	L.T. 5. E 01	L.T. 5. E 01
MN-54	L.T. 4. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
CO-58	L.T. 5. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
FE-59	L.T. 9. E 00	L.T. 9. E 00	L.T. 6. E 00	L.T. 7. E 00	L.T. 6. E 00
CO-60	L.T. 5. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
ZN-65	L.T. 9. E 00	L.T. 9. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 6. E 00
ZR-95	L.T. 5. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
RU-103	L.T. 5. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00	L.T. 3. E 00
RU-106	L.T. 4. E 01	L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01
I-131	L.T. 9. E 00	L.T. 8. E 00	L.T. 4. E 00	L.T. 2. E 01	L.T. 4. E 00
CS-134	L.T. 5. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
CS-137	L.T. 5. E 00	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
BA-140	L.T. 8. E 00	L.T. 6. E 00	L.T. 4. E 00	L.T. 8. E 00	L.T. 4. E 00
CE-141	L.T. 8. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 8. E 00	L.T. 4. E 00
CE-144	L.T. 3. E 01	L.T. 2. E 01	L.T. 3. E 01	L.T. 2. E 01	L.T. 2. E 01
RA-226	L.T. 9. E 01	L.T. 7. E 01	L.T. 8. E 01	L.T. 7. E 01	L.T. 6. E 01
TH-228	L.T. 8. E 00	L.T. 7. E 00	L.T. 7. E 00	L.T. 6. E 00	L.T. 6. E 00
TRITIUM ANALYSIS:	04/05-06/07	07/06-09/06			
H-3	L.T. 1. E 02	L.T. 1. E 02			

156

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - WATERBORNE
WATER - RIVER
(PCI/LITER)
STATION NUMBER 28
STATION 28 - 1.8 MI. 150 DEG. IND.

DATE COLLECTED:	10/04	11/01	12/06
-----------------	-------	-------	-------

RADIOCHEMICAL ANALYSIS:

SR-89	L.T. 9. E-01	L.T. 8. E-01	L.T. 9. E-01
SR-90	L.T. 5. E-01	L.T. 5. E-01	L.T. 3. E-01
GR-A DIS	3.1 ± 2.5 E 00	L.T. 2. E 00	2.8 ± 2.2 E 00
GR-A SUS	L.T. 3. E-01	L.T. 6. E-01	8.4 ± 6.3 E-01
GR-B DIS	1.2 ± 0.2 E 01	7.0 ± 2.2 E 00	9.2 ± 1.6 E 00
GR-B SUS	L.T. 7. E-01	3.9 ± 1.3 E 00	3.9 ± 0.9 E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	L.T. 4. E 01	L.T. 3. E 01	L.T. 4. E 01
K-40	L.T. 1. E 02	L.T. 8. E 01	L.T. 6. E 01
MN-54	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00
CO-58	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00
FE-59	L.T. 1. E 01	L.T. 7. E 00	L.T. 8. E 00
CO-60	L.T. 4. E 00	L.T. 3. E 00	L.T. 4. E 00
ZN-65	L.T. 1. E 01	L.T. 6. E 00	L.T. 8. E 00
ZR-95	L.T. 5. E 00	L.T. 3. E 00	L.T. 4. E 00
RU-103	L.T. 5. E 00	L.T. 4. E 00	L.T. 5. E 00
RU-106	L.T. 4. E 01	L.T. 3. E 01	L.T. 4. E 01
I-131	L.T. 1. E 01	L.T. 5. E 00	L.T. 8. E 00
CS-134	L.T. 5. E 00	L.T. 3. E 00	L.T. 4. E 00
CS-137	L.T. 5. E 00	L.T. 3. E 00	L.T. 5. E 00
BA-140	L.T. 7. E 00	L.T. 4. E 00	L.T. 7. E 00
CE-141	L.T. 8. E 00	L.T. 5. E 00	L.T. 9. E 00
CE-144	L.T. 3. E 01	L.T. 2. E 01	L.T. 3. E 01
RA-226	L.T. 9. E 01	L.T. 6. E 01	L.T. 1. E 02
TH-228	L.T. 7. E 00	L.T. 6. E 00	L.T. 1. E 01

TRITIUM ANALYSIS:	10/04-12/06
-------------------	-------------

H-3	L.T. 1. E 02
-----	--------------

J. THERMOLUMINESCENT DOSIMETRY - RADIATION DOSE

TABLE J-1
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/07-04/13	SECOND QUARTER 04/12-06/29	THIRD QUARTER 06/28-10/12	FOURTH QUARTER 10/12/94-01/05/95
TLD (Gamma)	01	13.9 ± 0.8	15.9 ± 0.4	19.9 ± 1.3	17.0 ± 0.7
	02	13.0 ± 0.8	16.3 ± 1.9	18.9 ± 0.5	17.1 ± 0.6
	03	12.9 ± 1.0	18.4 ± 0.8	17.7 ± 2.3	15.5 ± 0.5
	04	12.1 ± 1.4	15.5 ± 0.8	19.6 ± 1.0	16.5 ± 0.9
	05	12.7 ± 1.4	17.9 ± 2.4	19.9 ± 1.5	16.1 ± 0.9
	06	14.1 ± 1.0	16.0 ± 1.5	20.0 ± 0.8	16.4 ± 0.7
	07	13.1 ± 0.6	17.6 ± 1.2	20.1 ± 0.9	17.1 ± 0.8
	08	14.2 ± 1.0	16.5 ± 1.5	20.1 ± 1.1	17.6 ± 1.2
	09	12.6 ± 1.9	15.6 ± 0.7	18.9 ± 1.1	19.1 ± 0.9
	10	12.9 ± 0.9	17.6 ± 0.8	19.3 ± 0.5	16.3 ± 1.1
	20	13.7 ± 1.8	15.7 ± 1.1	22.4 ± 1.1	18.0 ± 0.7
	44	15.5 ± 1.1	16.6 ± 2.4	22.4 ± 1.4	21.4 ± 0.5
	56	12.2 ± 2.0	17.4 ± 1.2	20.7 ± 0.9	18.7 ± 0.7
	58	13.2 ± 0.6	18.0 ± 1.9	21.1 ± 1.3	20.1 ± 0.7
	59	14.7 ± 0.6	16.5 ± 0.5	21.9 ± 1.3	17.4 ± 0.8
	66	17.1 ± 0.8	18.0 ± 0.8	23.4 ± 1.4	18.8 ± 1.1
	67	15.7 ± 1.1	20.0 ± 2.5	22.4 ± 1.4	16.2 ± 0.6
	71	16.5 ± 0.9	17.0 ± 1.2	23.8 ± 1.2	20.0 ± 0.9

TABLE J-1
 1994 QUARTERLY REPORT
 NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/07-04/13	SECOND QUARTER 04/12-06/29	THIRD QUARTER 06/28-10/12	FOURTH QUARTER 10/12/94-01/05/95
TLD (Gamma)	79	15.4 ± 1.0	17.2 ± 0.4	20.5 ± 0.7	17.1 ± 0.7
	80	15.9 ± 0.9	17.9 ± 0.8	21.4 ± 1.6	17.1 ± 1.1
	81	17.0 ± 1.1	19.3 ± 2.2	22.2 ± 0.6	18.0 ± 1.1
	82	15.6 ± 1.6	18.2 ± 1.4	21.4 ± 1.4	19.7 ± 1.8
	83	16.1 ± 1.0	19.0 ± 1.8	22.4 ± 1.1	17.0 ± 0.5
	84	19.3 ± 2.0	19.3 ± 0.6	21.9 ± 1.2	18.1 ± 0.6
	85	14.6 ± 1.0	19.5 ± 0.5	20.5 ± 1.4	17.2 ± 0.6
	86	15.7 ± 1.1	17.7 ± 0.7	21.4 ± 1.0	21.5 ± 1.1
	87	15.9 ± 0.7	18.2 ± 1.2	21.4 ± 1.6	17.1 ± 1.1
	88	14.0 ± 1.3	17.4 ± 1.3	20.6 ± 0.9	17.9 ± 0.9
	89	15.3 ± 1.2	17.4 ± 0.6	23.0 ± 1.6	17.4 ± 0.7
	90	15.4 ± 1.1	23.0 ± 0.8	21.5 ± 1.3	19.0 ± 0.9
	91	13.9 ± 0.9	16.5 ± 0.9	19.8 ± 1.2	16.4 ± 0.5
	94	16.3 ± 1.0	20.6 ± 1.4	22.5 ± 1.7	16.7 ± 1.6
Average/Quarter		94.9 days 14.7±1.7 mR/94.9 days	76.4 days 17.7±1.6 mR/76.4 days	106.4 days 21.0±1.4 mR/106.4 days	84.48 days 18 ± 1.5 mR/84.48 days
Average/Day		0.15±0.02 mR/day	0.23±0.02 mR day	0.20±0.01 mR day	0.21±0.02 mR day
Range		(12-19)mR/94.9 days	(16-23)mR 76.4 days	(18-24)mR 106.4 days	(16-22)mR 84.48 days
Det./Total		32/32	32/32	32/32	32/32

TABLE J-2
1994 QUARTERLY REPORT

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD

milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	Aver./Quarter	TOTAL mR/year 01/11/94-01/05/95
TLD (Gamma)	01	16.7 ± 2.5	66.7
	02	16.3 ± 2.5	65.3
	03	16.1 ± 2.5	64.5
	04	15.9 ± 3.1	63.7
	05	16.7 ± 3.1	66.6
	06	16.6 ± 2.5	66.5
	07	17.0 ± 2.9	67.9
	08	17.4 ± 2.9	69.4
	09	16.6 ± 3.1	66.2
	10	16.5 ± 2.7	66.1
	20	17.5 ± 3.7	69.8
	44	19.0 ± 3.4	75.9
	56	17.3 ± 3.6	69.0
	58	18.1 ± 3.5	72.4
	59	17.6 ± 3.1	70.5
	66	19.3 ± 2.8	77.3
	67	18.6 ± 3.2	74.3
	71	19.3 ± 3.4	77.3

TABLE J-2
1994 QUARTERLY REPORT
NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD
milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	Aver./Quarter	TOTAL mR/year 01/11/94-01/05/95
TLD (Gamma)	79	17.6 ± 2.1	70.2
	80	18.1 ± 2.4	72.3
	81	19.1 ± 2.3	76.5
	82	18.7 ± 2.5	74.9
	83	18.6 ± 2.8	74.5
	84	19.7 ± 1.6	78.6
	85	18.0 ± 2.6	71.8
	86	19.1 ± 2.9	76.3
	87	18.2 ± 2.4	72.6
	88	17.5 ± 2.7	69.9
	89	18.3 ± 3.3	73.1
	90	19.7 ± 3.3	78.9
	91	16.7 ± 2.4	66.6
	94	19.0 ± 3.0	76.1
		17.6 ± 0.5 Average mR/Quarter	71.3 ± 4.5
		Range(16-20)	Aver. total mR year. All stations
			Range (63.7-78.9)

K. FOOD - BROADLEAF VEGETATION

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
VEGETATION - TERRESTRIAL, BROADLEAF
(PCI/GM WET)
STATION NUMBER 28
STATION 28 - 1.8 MI. 150 DEG. IND

DATE COLLECTED:	05/10 HEDGE MUSTARD	05/10 CURLY DOCK	05/10 SMARTWEED	05/10 QA HEDGE MUSTARD	06/21 CURLY DOCK
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 6. E-03	L.T. 7. E-03	L.T. 6. E-03	L.T. 6. E-03	L.T. 8. E-03
GAMMA SPECTRUM ANALYSIS:					
BE-7	1.09±0.13 E 00	3.67±0.71 E-01	6.00±1.17 E-01	1.16±0.12 E 00	3.47±0.37 E-01
K-40	5.23±0.52 E 00	6.40±0.64 E 00	5.05±0.51 E 00	6.18±0.62 E 00	5.09±0.51 E 00
MN-54	L.T. 1. E-02	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 4. E-03
CO-58	L.T. 1. E-02	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 5. E-03
FE-59	L.T. 4. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 1. E-02
CO-60	L.T. 2. E-02	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 6. E-03
ZN-65	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 1. E-02
ZR-95	L.T. 2. E-02	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 4. E-03
RU-103	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 5. E-03
RU-106	L.T. 1. E-01	L.T. 8. E-02	L.T. 1. E-01	L.T. 9. E-03	L.T. 4. E-02
I-131	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 8. E-03
CS-134	L.T. 1. E-02	L.T. 9. E-03	L.T. 2. E-02	L.T. 1. E-02	L.T. 5. E-03
CS-137	L.T. 1. E-02	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 5. E-03
BA-140	L.T. 3. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 5. E-03
CE-141	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 6. E-03
CE-144	L.T. 8. E-02	L.T. 7. E-02	L.T. 9. E-02	L.T. 6. E-02	L.T. 3. E-02
RA-226	L.T. 2. E-01	L.T. 2. E-01	L.T. 3. E-01	L.T. 2. E-01	L.T. 7. E-02
TH-228	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 7. E-03

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 VEGETATION - TERRESTRIAL, BROADLEAF
 (PCI/GM WET)
 STATION NUMBER 28
 STATION 28 - 1.8 MI. 150 DEG. IND

DATE COLLECTED:	06/21 MUSTARD	06/21 SWAMP SMARTWEED	07/19 WILD GRAPE	07/19 SWAMP SMARTWEED	07/19 SUNFLOWER
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 5. E-03	L.T. 7. E-03	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
GAMMA SPECTRUM ANALYSIS:					
BE-7	6.83±1.30 E-01	4.97±0.78 E-01	1.27±0.13 E 00	9.58±1.00 E-01	7.92±0.82 E-01
K-40	4.86±0.49 E 00	4.69±0.47 E 00	3.15±0.32 E 00	4.16±0.42 E 00	5.85±0.59 E 00
MN-54	L.T. 1. E-02	L.T. 9. E-03	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02
CO-58	L.T. 1. E-02	L.T. 9. E-03	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02
FE-59	L.T. 4. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02
CO-60	L.T. 2. E-02	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
ZN-65	L.T. 4. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02
ZR-95	L.T. 2. E-02	L.T. 9. E-03	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02
RU-103	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
RU-106	L.T. 1. E-01	L.T. 8. E-02	L.T. 8. E-02	L.T. 1. E-01	L.T. 9. E-02
I-131	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
CS-134	L.T. 2. E-02	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CS-137	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
BA-140	L.T. 3. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CE-141	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
CE-144	L.T. 9. E-02	L.T. 5. E-02	L.T. 8. E-02	L.T. 7. E-02	L.T. 6. E-02
RA-226	L.T. 3. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01
TH-228	L.T. 3. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	5.76±0.95 E-02

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
VEGETATION - TERRESTRIAL, BROADLEAF
(PCI/GM WET)
STATION NUMBER 28
STATION 28 - 1.8 MI. 150 DEG. IND

DATE COLLECTED:	08/16 WILD GRAPE	08/16 SUNFLOWER	08/16 SWAMP SMARTWEED	08/16 OA WILD GRAPE	09/20 SMARTWEED
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
GAMMA SPECTRUM ANALYSIS:					
BE-7	1.26±0.14 E 00	2.74±0.27 E 00	4.84±0.48 E 00	1.54±0.25 E 00	2.49±0.25 E 00
K-40	3.65±0.36 E 00	3.58±0.36 E 00	5.24±0.52 E 00	2.46±0.25 E 00	4.54±0.45 E 00
MN-54	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02
CO-58	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02
FE-59	L.T. 4. E-02	L.T. 5. E-02	L.T. 3. E-02	L.T. 5. E-02	L.T. 3. E-02
CO-60	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02
ZN-65	L.T. 4. E-02	L.T. 5. E-02	L.T. 3. E-02	L.T. 5. E-02	L.T. 3. E-02
ZR-95	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02
RU-103	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 1. E-02
RU-106	L.T. 2. E-01	L.T. 2. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 1. E-01
I-131	L.T. 3. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 5. E-02	L.T. 2. E-02
CS-134	L.T. 2. E-01	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CS-137	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02
BA-140	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 4. E-02	L.T. 2. E-02
CE-141	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 4. E-02	L.T. 2. E-02
CE-144	L.T. 1. E-01	L.T. 1. E-01	L.T. 9. E-02	L.T. 1. E-01	L.T. 8. E-02
RA-226	L.T. 3. E-01	L.T. 4. E-01	L.T. 3. E-01	L.T. 4. E-01	L.T. 3. E-01
TH-228	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
VEGETATION - TERRESTRIAL, BROADLEAF
(PCI/GM WET)
STATION NUMBER 28
STATION 28 - 1.8 MI. 150 DEG. IND

DATE COLLECTED:	09/20 LAMBSQUARTERS	09/20 MO WHITEFLOWER	10/18 LAMBSQUARTER	10/18 GOLDENHEAD	10/18 CANE GRASS
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 8. E-03	L.T. 7. E-03	L.T. 8. E-03	L.T. 5. E-03	L.T. 6. E-03
GAMMA SPECTRUM ANALYSIS:					
BE-7	1.86±0.93 E-01	1.29±0.19 E 00	7.82±1.31 E-01	3.52±0.35 E 00	9.67±1.74 E-01
K-40	1.05±0.11 E 01	8.42±0.84 E 00	1.03±0.10 E 01	6.81±0.68 E 00	6.43±0.64 E 00
MN-54	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CO-58	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
FE-59	L.T. 3. E-02	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02
CO-60	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
ZN-65	L.T. 3. E-02	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02
ZR-95	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-103	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-106	L.T. 1. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01
I-131	L.T. 2. E-02	L.T. 5. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02
CS-134	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CS-137	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
BA-140	L.T. 2. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02
CE-141	L.T. 2. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 4. E-02
CE-144	L.T. 9. E-02	L.T. 2. E-01	L.T. 9. E-02	L.T. 1. E-01	L.T. 1. E-01
RA-226	L.T. 3. E-01	L.T. 5. E-01	L.T. 3. E-01	L.T. 4. E-01	L.T. 4. E-01
TH-228	L.T. 3. E-02	L.T. 5. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - INGESTION
VEGETATION - TERRESTRIAL, BROADLEAF
(PCI/GM WET)
STATION NUMBER 35
STATION 35 - 2.0 MI. 350 DEG. CON.

DATE COLLECTED:	05/10 HEDGE MUSTARD	05/10 BUSHY WALLFLOWER	05/10 CURLY DOCK	06/21 SWAMP SMARTWEED	06/21 GIANT RAGWEED
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 8. E-03	L.T. 5. E-03	L.T. 7. E-03	L.T. 4. E-03	L.T. 5. E-03
GAMMA SPECTRUM ANALYSIS:					
BE-7	6.97±1.13 E-01	8.03±1.25 E-01	2.39±0.52 E-01	5.76±1.19 E-01	1.05±0.11 E 00
K-40	5.39±0.54 E 00	4.83±0.48 E 00	6.51±0.65 E 00	5.59±1.56 E 00	7.91±0.79 E 00
MN-54	L.T. 1. E-02	L.T. 1. E-02	L.T. 7. E-03	L.T. 1. E-02	L.T. 1. E-02
CO-58	L.T. 1. E-02	L.T. 1. E-02	L.T. 7. E-03	L.T. 2. E-02	L.T. 1. E-02
FE-59	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 4. E-02	L.T. 3. E-02
CO-60	L.T. 1. E-02	L.T. 2. E-02	L.T. 8. E-03	L.T. 2. E-02	L.T. 1. E-02
ZN-65	L.T. 3. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02
ZR-95	L.T. 1. E-02	L.T. 1. E-02	L.T. 7. E-03	L.T. 2. E-02	L.T. 1. E-02
RU-103	L.T. 2. E-02	L.T. 2. E-02	L.T. 8. E-03	L.T. 2. E-02	L.T. 1. E-02
RU-106	L.T. 1. E-01	L.T. 1. E-01	L.T. 6. E-02	L.T. 1. E-01	L.T. 1. E-01
I-131	L.T. 3. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 3. E-02	L.T. 2. E-02
CS-134	L.T. 2. E-02	L.T. 2. E-02	L.T. 7. E-03	L.T. 2. E-02	L.T. 1. E-02
CS-137	L.T. 1. E-02	L.T. 2. E-02	L.T. 7. E-03	L.T. 2. E-02	L.T. 1. E-02
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 9. E-03	L.T. 2. E-02	L.T. 2. E-02
CE-141	L.T. 3. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 3. E-02	L.T. 2. E-02
CE-144	L.T. 1. E-01	L.T. 8. E-02	L.T. 5. E-02	L.T. 1. E-01	L.T. 6. E-02
RA-226	L.T. 3. E-01	L.T. 3. E-01	L.T. 1. E-01	L.T. 4. E-01	L.T. 2. E-01
TH-228	L.T. 3. E-02	L.T. 3. E-02	L.T. 1. E-02	L.T. 3. E-02	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 VEGETATION - TERRESTRIAL, BROADLEAF
 (PCI/GM WET)
 STATION NUMBER 35
 STATION 35 - 2.0 MI. 350 DEG. CON.

DATE COLLECTED:	06/21 MUSTARD	07/19 SWAMP SMARTWEED	07/19 GIANT RAGWEED	07/19 LAMBSQUARTER	07/19 QA GIANT RAGWEED
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 4. E-03	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
GAMMA SPECTRUM ANALYSIS:					
BE-7	7.75±1.43 E-01	1.02±0.14 E 00	1.10±0.15 E 00	L.T. 1. E-01	1.75±0.18 E 00
K-40	5.35±0.53 E 00	4.87±0.49 E 00	8.96±0.90 E 00	1.16±0.12 E 01	7.54±0.75 E 00
MN-54	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
CO-58	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02
FE-59	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 3. E-02	L.T. 4. E-02
CO-60	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
ZN-65	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 3. E-02	L.T. 4. E-02
ZR-95	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
RU-103	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
RU-106	L.T. 2. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 9. E-02	L.T. 2. E-01
I-131	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 4. E-02
CS-134	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
CS-137	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
BA-140	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 1. E-02	L.T. 2. E-02
CE-141	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
CE-144	L.T. 1. E-01	L.T. 1. E-01	L.T. 8. E-02	L.T. 7. E-02	L.T. 9. E-02
RA-226	L.T. 4. E-01	L.T. 3. E-01	L.T. 3. E-01	L.T. 2. E-01	L.T. 3. E-01
TH-228	L.T. 4. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02

169

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 VEGETATION - TERRESTRIAL, BROADLEAF
 (PCI/GM WET)
 STATION NUMBER 35
 STATION 35 - 2.0 MI. 350 DEG. CON.

DATE COLLECTED:	08/16 GIANT RAGWEED	08/16 SWAMP SMARTWEED	08/16 SUNFLOWER	09/20 LAMBSQUARTERS	09/20 GIANT RAGWEED
-----------------	------------------------	--------------------------	--------------------	------------------------	------------------------

RADIOCHEMICAL ANALYSIS:

I-131	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 7. E-03	L.T. 8. E-03
-------	--------------	--------------	--------------	--------------	--------------

GAMMA SPECTRUM ANALYSIS:

BE-7	2.34±0.24 E 00	1.54±0.15 E 00	2.32±0.23 E 00	3.66±1.59 E-01	2.41±0.24 E 00
K-40	7.33±0.73 E 00	4.52±0.45 E 00	7.03±0.70 E 00	1.17±0.12 E 01	9.56±0.96 E 00
MN-54	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CO-58	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
FE-59	L.T. 6. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 6. E-02	L.T. 5. E-02
CO-60	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02
ZN-65	L.T. 6. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 6. E-02	L.T. 6. E-02
ZR-95	L.T. 3. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-103	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
RU-106	L.T. 2. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 2. E-01
I-131	L.T. 5. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02
CS-134	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
CS-137	L.T. 3. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
BA-140	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02
CE-141	L.T. 5. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02
CE-144	L.T. 2. E-01	L.T. 8. E-02	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01
RA-226	L.T. 6. E-01	L.T. 2. E-01	L.T. 3. E-01	L.T. 4. E-01	L.T. 4. E-01
TH-228	L.T. 5. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 VEGETATION - TERRESTRIAL, BROADLEAF
 (PCI/GM WET)
 STATION NUMBER 35
 STATION 35 - 2.0 MI. 350 DEG. CON.

DATE COLLECTED:	09/20 VINE	10/18 LAMBSQUARTER	10/18 GIANT RAGWEED	10/18 REZABVINE	10/18 LAMBSQUARTER QA
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 8. E-03	L.T. 1. E-02	L.T. 9. E-03	L.T. 6. E-03	L.T. 1. E-02
GAMMA SPECTRUM ANALYSIS:					
BE-7	1.30±0.16 E 00	1.20±0.19 E 00	2.46±0.25 E 00	3.68±0.37 E 00	1.13±0.14E 00
K-40	5.33±0.53 E 00	9.88±1.00 E 00	5.22±0.52 E 00	3.87±0.39 E 00	8.66±0.87E 00
MN-54	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CO-58	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
FE-59	L.T. 4. E-02	L.T. 5. E-02	L.T. 4. E-02	L.T. 6. E-02	L.T. 4. E-02
CO-60	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
ZN-65	L.T. 5. E-02	L.T. 5. E-02	L.T. 4. E-02	L.T. 6. E-02	L.T. 4. E-02
ZR-95	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02
RU-103	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02
RU-106	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 1. E-01
I-131	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	L.T. 3. E-02
CS-134	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02
CS-137	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02
BA-140	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02
CE-141	L.T. 3. E-02	L.T. 4. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 2. E-02
CE-144	L.T. 1. E-01	L.T. 2. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 9. E-02
RA-226	L.T. 3. E-01	L.T. 5. E-01	L.T. 3. E-01	L.T. 5. E-01	L.T. 3. E-01
TH-228	L.T. 3. E-02	L.T. 4. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 3. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 VEGETATION - TERRESTRIAL, BROADLEAF
 (PCI/GM WET)
 STATION NUMBER 44
 STATION 44 - 10.25 MI. 270 DEG. CON.

DATE COLLECTED:	05/10 DANDELION	05/10 PALE DOCK	05/10 SWEET CLOVER	06/21 SWEET CLOVER	06/21 CURLY DOCK
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 7. E-03	L.T. 5. E-03	L.T. 8. E-03	L.T. 9. E-03	L.T. 6. E-03
GAMMA SPECTRUM ANALYSIS:					
BE-7	1.49±0.15 E 00	7.40±0.99 E-01	1.09±0.16 E 00	8.37±0.84 E-01	2.00±0.20 E 00
K-40	6.01±0.60 E 00	4.72±0.47 E 00	4.71±0.47 E 00	3.30±0.33 E 00	4.91±0.49 E 00
MN-54	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 9. E-03	L.T. 9. E-03
CO-58	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 9. E-03	L.T. 9. E-03
FE-59	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 2. E-02
CO-60	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
ZN-65	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 2. E-02
ZR-95	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
RU-103	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
RU-106	L.T. 1. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 9. E-02	L.T. 9. E-02
I-131	L.T. 3. E-02	L.T. 2. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 2. E-02
CS-134	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
CS-137	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 1. E-02	L.T. 1. E-02
CE-141	L.T. 2. E-02	L.T. 2. E-02	L.T. 4. E-02	L.T. 1. E-02	L.T. 2. E-02
CE-144	L.T. 9. E-02	L.T. 8. E-02	L.T. 1. E-01	L.T. 5. E-02	L.T. 8. E-02
RA-226	L.T. 3. E-01	L.T. 2. E-01	L.T. 4. E-01	L.T. 2. E-01	L.T. 2. E-01
TH-228	L.T. 2. E-02	L.T. 2. E-02	L.T. 4. E-02	L.T. 2. E-02	L.T. 2. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 VEGETATION - TERRESTRIAL, BROADLEAF
 (PCI/GM WET)
 STATION NUMBER 44
 STATION 44 - 10.25 MI. 270 DEG. CON.

DATE COLLECTED:	06/21 MILKWEED	06/21 QA SWEET CLOVER	07/19 SUNFLOWER	07/19 COMMON RAGWEED	07/19 MILKWEED
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 9. E-03	L.T. 8. E-03	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
GAMMA SPECTRUM ANALYSIS:					
BE-7	1.57±0.16 E 00	8.21±0.82 E-01	1.24±0.12 E 00	1.70±0.17 E 00	2.07±0.21 E 00
K-40	3.98±0.40 E 00	3.14±0.31 E 00	5.39±0.54 E 00	6.66±0.67 E 00	8.09±0.18 E 00
MN-54	L.T. 8. E-03	L.T. 7. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CO-58	L.T. 9. E-03	L.T. 7. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
FE-59	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02
CO-60	L.T. 9. E-03	L.T. 8. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
ZN-65	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02
ZR-95	L.T. 9. E-03	L.T. 7. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
RU-103	L.T. 9. E-03	L.T. 8. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02
RU-106	L.T. 8. E-02	L.T. 6. E-02	L.T. 1. E-01	L.T. 9. E-02	L.T. 1. E-01
I-131	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
CS-134	L.T. 9. E-03	L.T. 8. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CS-137	L.T. 9. E-03	L.T. 7. E-03	L.T. 1. E-02	1.63±0.75 E-02	L.T. 1. E-02
BA-140	L.T. 1. E-02	L.T. 8. E-03	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
CE-141	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CE-144	L.T. 7. E-02	L.T. 6. E-02	L.T. 7. E-02	L.T. 6. E-02	L.T. 8. E-02
RA-226	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 3. E-01
TH-228	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	4.27±0.91 E-02	L.T. 2. E-02

173

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 VEGETATION - TERRESTRIAL, BROADLEAF
 (PCI/GM WET)
 STATION NUMBER 44
 STATION 44 - 10.25 MI. 270 DEG. CON.

DATE COLLECTED:	08/16 MILKWEED	08/16 VELVETWEED	08/16 ELDERBERRY	09/20 GOLDENROD	09/20 ELDERBERRY
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 7. E-03	L.T. 7. E-03
GAMMA SPECTRUM ANALYSIS:					
BE-7	3.77±0.38 E 00	1.59±0.16 E 00	3.95±0.40 E 00	1.88±0.19 E 00	1.43±0.14 E 00
K-40	4.08±0.41 E 00	6.92±0.69 E 00	4.77±0.48 E 00	5.78±0.58 E 00	7.73±0.77 E 00
MN-54	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CO-58	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
FE-59	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 3. E-02
CO-60	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02
ZN-65	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 3. E-02
ZR-95	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
RU-103	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-106	L.T. 2. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01
I-131	L.T. 4. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02
CS-134	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CS-137	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
BA-140	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CE-141	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02
CE-144	L.T. 1. E-01	L.T. 6. E-02	L.T. 1. E-01	L.T. 9. E-02	L.T. 9. E-02
RA-226	L.T. 3. E-01	L.T. 2. E-01	L.T. 3. E-01	L.T. 3. E-01	L.T. 3. E-01
TH-228	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 EXPOSURE PATHWAY - INGESTION
 VEGETATION - TERRESTRIAL, BROADLEAF
 (PCI/GM WET)
 STATION NUMBER 44
 STATION 44 - 10.25 MI. 270 DEG. CON.

DATE COLLECTED:	09/20 LAMBSQUARTERS	09/20 QA ELDERBERRY	10/18 ELDERBERRY	10/18 LAMBSQUARTER	10/18 MILo
RADIOCHEMICAL ANALYSIS:					
I-131	L.T. 7. E-03	L.T. 7. E-03	L.T. 8. E-03	L.T. 9. E-03	L.T. 1. E-02
GAMMA SPECTRUM ANALYSIS:					
BE-7	9.37±1.09 E-01	1.84±0.18 E 00	3.30±0.33 E 00	1.03±0.15 E 00	8.99±0.90 E 00
K-40	1.00±0.10 E 01	4.72±0.47 E 00	3.06±0.31 E 00	1.12±0.11 E 01	4.28±0.43 E 00
MN-54	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02
CO-58	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02
FE-59	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02
CO-60	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
ZN-65	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 6. E-02
ZR-95	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
RU-103	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02
RU-106	L.T. 1. E-01	L.T. 2. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 2. E-01
I-131	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 6. E-02
CS-134	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CS-137	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 4. E-02
CE-141	L.T. 2. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 4. E-02
CE-144	L.T. 9. E-02	L.T. 1. E-01	L.T. 9. E-02	L.T. 1. E-01	L.T. 1. E-01
RA-226	L.T. 3. E-01	L.T. 3. E-01	L.T. 3. E-01	L.T. 3. E-01	L.T. 4. E-01
TH-228	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02

L SHORELINE SEDIMENT

NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
EXPOSURE PATHWAY - AIRBORNE
SHORELINE SEDIMENT
(PCI/GM DRY)
STATION NUMBER 28
STATION 28 - 1.8 MI. 150 DEG. IND.

DATE COLLECTED: 05/03 10/25 10/25 *

GAMMA SPECTRUM ANALYSIS:

BE-7	L.T. 6. E-02	1.79±0.43 E-01	9.41±3.67 E-02
K-40	1.57±0.16 E 01	1.84±0.18 E 01	1.62±0.16 E 01
MN-54	1.81±0.43 E-02	1.73±0.38 E-02	7.90±3.84 E-03
CO-58	L.T. 6. E-03	L.T. 6. E-03	L.T. 6. E-03
FE-59	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02
CO-60	L.T. 6. E-03	L.T. 6. E-03	L.T. 6. E-03
ZN-65	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
ZR-95	L.T. 8. E-03	L.T. 8. E-03	L.T. 7. E-03
RU-103	L.T. 7. E-03	L.T. 7. E-03	L.T. 6. E-03
RU-106	L.T. 5. E-02	L.T. 5. E-02	L.T. 5. E-02
I-131	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CS-134	L.T. 8. E-03	L.T. 8. E-03	L.T. 8. E-03
CS-137	8.16±0.82 E-02	8.79±0.88 E-02	7.60±0.76 E-02
BA-140	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CE-141	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CE-144	L.T. 5. E-02	L.T. 5. E-02	L.T. 4. E-02
RA-226	1.56±0.16 E 00	1.96±0.20 E 00	1.66±0.17 E 00
TH-228	8.00±0.80 E-01	9.93±0.99 E-01	8.17±0.82 E-01

*Duplicate

REFERENCES

1. Nebraska Public Power District, Cooper Nuclear Station Environmental Radiation Monitoring Program, Annual Report, January 1, 1982-December 31, 1982 (prepared by Teledyne Isotopes).
2. Nebraska Public Power District, Cooper Nuclear Station Environmental Radiation Monitoring Program, Annual Report, January 1, 1983-December 31, 1983 (prepared by Teledyne Isotopes).
3. Nebraska Public Power District Cooper Nuclear Station, Environmental Monitoring Program, Annual Report, January 1, 1984 to December 31, 1984. (Prepared by Teledyne Isotopes).
4. U.S. Department of Energy; EML 440 March 1985; EML-444 April 1989; Environmental Measurements Laboratory, US Department of Energy, New York, New York 10014.
5. U.S. Environmental Protection Agency; Environmental Radiation Data, Report 35, July -- September 1983, Report 39, July -- September 1985; Report 40, October -- December 1984; Report 41, January -- March 1985. Report 42, April -- June 1985; Report 43, July-September 1985, Report 44-45, October-March 1986; Report 46, April-June 1986; Report 47, July-September 1986; Report 48, October-December 1986; Report 49, January-March 1987. Environmental Radiation Facility, Montgomery, Alabama.
6. U.S. Department of Energy; EML 460, October 1, 1986; Environmental Measurements Laboratory, US Department of Energy, New York, New York 10014.
7. U.S. Nuclear Regulatory Commission, 1975, Regulatory Guide 4.8, Environmental Technical Specifications for Nuclear Power Plants.

APPENDIX

APPENDIX A
LAND USE CENSUS

LAND USE CENSUS
July 8, 1994
0-3 Miles

Cooper Nuclear Station (CNS) Radiological Effluent Technical Specifications (RETS) require an annual land use census. This census identifies the location of the nearest garden that is greater than 500 square feet in area and yields leafy green vegetables, the nearest milk animal, and the location of the nearest resident in each of the 16 meteorological sectors within 3 miles of CNS.

In accordance with CNS RETS, a land use census was performed on July 8, 1994. Many changes have taken place since the census of 1993. Several families whose homes were ravaged by the 1993 flood have decided to return or reconstruct and some have not. Unrelated construction of a home in sector Q has been completed and the new family is gardening.

Because of the flood last year, the number of gardens found in 1994 were much greater than in 1993. Gardens were found in 11 sectors in 1994 while only 4 sectors contained gardens last year. The nearest garden to CNS is in sector L, 1.3 miles from CNS.

The number of residences found within 3 miles of CNS has also increased since 1993. 11 Sectors contained residences within 3 miles of CNS in 1994 while only 6 sectors had residences last year. The nearest resident to CNS is in sector Q, 0.9 miles from CNS.

No milk animals were found within 3 miles of CNS in 1994 and there was no evidence of potable water use from the river.

LAND USE CENSUS

July 8, 1994

0-3 Miles

SECTOR	NEAREST RESIDENT		NEAREST GARDEN		NEAREST MILK ANIMAL
A	3.0 Miles	1.0°	3.0 Miles	1.0°	NONE
B	2.7 Miles	13.0°	2.7 Miles	13.0°	NONE
C	NONE		NONE		NONE
D	1.7 Miles	62.0°	1.7 Miles	62.0°	NONE
E	2.0 Miles	83.0°	2.0 Miles	83.0°	NONE
F	2.75 Miles	110.0°	2.4 Miles	112.0°	NONE
G	NONE		2.2 Miles	133.5°	NONE
H	NONE		NONE		NONE
J	NONE		NONE		NONE
K	NONE		NONE		NONE
L	1.3 Miles	221.0°	1.3 Miles	221.0°	NONE
M	1.3 Miles	251.0°	2.6 Miles	251.0°	NONE
N	1.0 Miles	266.5°	NONE		NONE
P	1.6 Miles	293.5°	1.6 Miles	293.5°	NONE
Q	0.9 Miles	307.0°	1.9 Miles	317.0°	NONE
R	1.9 Miles	335.0°	1.9 Miles	335.0°	NONE

APPENDIX B
INTERLABORATORY COMPARISON PROGRAM

1994

A summary of the Results of the Analyses by Teledyne Isotopes of the EPA
Cross Check Samples

Compared with the Known Activity as reported by the Environmental
Monitoring Systems Laboratory, Las Vegas, Nevada

All results which exceed three sigma deviation from the known are
appended with a note giving the possible cause of the deviation and
corrective action taken.

EPA INTERLABORATORY COMPARISON PROGRAM 1994
Environmental

Collection Date	Media	Nuclide	EPA Result(a)		Teledyne Brown Engineering Result(b)		Deviation(c)
01/14/94	Water	Sr-89	25.0 ±	5.0	24.00 ±	1.00	-0.35
		Sr-90	15.0 ±	5.0	15.67 ±	1.53	0.23
01/28/94	Water	Gr-Alpha	15.0 ±	5.0	21.67 ±	0.58	2.31
		Gr-Beta	62.0 ±	10.0	72.33 ±	3.79	1.79
02/04/94	Water	I-131	119.0 ±	12.0	110.33 ±	0.00	-1.30
02/11/94	Water	Ra-226	19.9 ±	3.0	21.00 ±	1.00	0.64
		Ra-228	14.7 ±	3.7	15.67 ±	1.53	0.45
03/04/94	Water	H-3	4936.0 ±	494.0	4833.33 ±	152.75	-0.36
04/19/94	Water	Gr-Beta	117.0 ±	18.0	102.67 ±	6.43	-1.38
		Sr-89	20.0 ±	5.0	19.00 ±	1.00	-0.35
		Sr-90	14.0 ±	5.0	13.00 ±	0.00	-0.35
		Co-60	20.0 ±	5.0	23.67 ±	3.21	1.27
		Cs-134	34.0 ±	5.0	34.00 ±	1.73	0.00
		Cs-137	29.0 ±	5.0	34.00 ±	2.65	1.73
		Gr-Alpha	86.0 ±	22.0	78.00 ±	3.00	-0.63
		Ra-226	20.0 ±	3.0	15.67 ±	1.53	-2.50
		Ra-228	20.1 ±	5.0	15.33 ±	0.58	-1.65
06/10/94	Water	Co-60	50.0 ±	5.0	43.00 ±	2.00	-2.42
		Zn-65	134.0 ±	13.0	13.33 ±	0.58	-16.08
		Ru-106	252.0 ±	25.0	201.33 ±	9.29	-3.51
		Cs-134	40.0 ±	5.0	29.33 ±	3.79	-3.70
		Cs-137	49.0 ±	5.0	49.67 ±	1.53	0.23
		Ba-133	98.0 ±	10.0	85.00 ±	3.00	-2.25
06/17/94	Water	Ra-226	15.0 ±	2.3	15.33 ±	0.58	0.25
		Ra-228	15.4 ±	3.9	16.33 ±	1.53	0.41
07/15/94	Water	Sr-89	30.0 ±	5.0	26.00 ±	1.73	-1.39
		Sr-90	20.0 ±	5.0	19.00 ±	0.00	-0.35
07/22/94	Water	Gr-Alpha	32.0 ±	8.0	25.33 ±	2.89	-1.44
		Gr-Beta	10.0 ±	5.0	16.00 ±	0.00	2.08
08/05/94	Water	H-3	9951.0 ±	995.0	9700.00 ±	100.04	-0.44
08/26/94	Air Filter	Gr-Alpha	35.0 ±	9.0	31.33 ±	2.08	-0.71
		Gr-Beta	56.0 ±	10.0	59.33 ±	3.21	0.58
		Sr-90	20.0 ±	5.0	18.00 ±	1.00	-0.69
		Cs-137	15.0 ±	5.0	17.00 ±	1.73	0.69
09/16/94	Water	U	35.0 ±	3.0	38.67 ±	0.58	2.12
		Ra-226	10.0 ±	1.5	10.67 ±	0.58	0.77
		Ra-228	10.2 ±	2.6	9.70 ±	0.52	-0.33

EPA INTERLABORATORY COMPARISON PROGRAM 1994
Environmental

Collection Date	Media	Nuclide	EPA Result(a)		Teledyne Brown Engineering Result(b)		Deviation(c)
09/30/94	Milk	Sr-89	25.0 ±	5.0	24.33 ±	2.52	-0.23
		Sr-90	15.00 ±	5.0	17.67 ±	1.53	0.92
		I-131	75.0 ±	8.0	81.67 ±	5.86	1.44
		Cs-137	59.0 ±	5.0	70.33 ±	4.62	3.93
		K	1715.0 ±	86.0	1740.00 ±	153.95	0.50 (n)
10/07/94	Water	I-131	79.0 ±	8.0	71.00 ±	3.00	-1.73
10/28/94	Water	Gr-Alpha	57.0 ±	14.0	47.00 ±	3.00	-1.24
		Gr-Beta	23.0 ±	5.0	25.33 ±	1.53	0.81
11/04/94	Water	Co-60	59.0 ±	5.0	52.00 ±	0.00	-2.42 (n)
		Zn-65	100.0 ±	10.0	81.33 ±	7.02	-3.23 (n)
		Cs-134	24.0 ±	5.0	19.67 ±	2.52	-1.50
		Cs-137	49.0 ±	5.0	54.33 ±	2.31	1.85
		Ba-133	73.0 ±	7.0	58.33 ±	2.89	-3.63 (n)

Footnotes:

- (a) EPA Results-Expected laboratory precision (1 sigma). Units are pCi/liter for water and milk except K is in mg/liter. Units are total pCi for air particulate filters.
- (b) Teledyne Results - Average ± one sigma. Units are pCi/liter for water and milk except K is in mg/liter. Units are total pCi for air particulate filters.
- (c) Normalized deviation from the known.
- (d) There appears to be variation in self-absorption matrix. The EPA confirms that the composition of their tap water from Lake Mead, varies seasonally which can cause variation in alpha, beta results. No corrective action required at this time since results are within ± 3 sigma control limits.
- (e) No specific or apparent reason found. Data sheets verified and detector efficiencies calibrated. Will exert extra care in making dilutions and using correct sample type on concentration of acids. Will check future samples to see if a pattern develops.
- (f) A second aliquot was analyzed, paying particular attention to volume aliquoted. The result, 52 pCi/l, was in good agreement with the EPA. The three original results, each counted on a different detector, showed good precision. The measurement of Co-60 has not been a problem. Future EPA cross-checks will be weighed and results followed to check for a possible trend "out of control".
- (g) The average value of three analyses on the "Report of Analysis" was 133 pCi/liter which is in good agreement with the EPA. Apparently, incorrect results were entered into the EPA computer. Future data will be printed from the computer screen to check entries.
- (h) The EPA has indicated that the Radiation Quality Assurance Program has been experiencing problems with the ruthenium-106 analysis. See attached letter from EPA.

EPA INTERLABORATORY COMPARISON PROGRAM 1994
Environmental

Collection Date	Media	Nuclide	EPA Result(a)	Teledyne Brown Engineering Result(b)	Deviation(c)
-----------------	-------	---------	---------------	--------------------------------------	--------------

- (l) The first aliquot, prepared according to EPA dilution instructions was counted on four detectors in the 1 liter Marinelli geometry with Cs-134 results (based on the 796 KeV peak) in pCi/l of 32.0, 25.1, 31.7, and 30.8. The 31.7 result was not reported. Had that been reported instead of 25.1, the average would have been 31.5 and the normalized deviation would have been -2.94 instead of -3.70. A second aliquot was prepared and a single measurement was made with the result of 31.1 pCi/l. An undiluted aliquot was measured in a 150 ml geometry with the result of 33.5 pCi/l. That result is comparable with the Marinelli results. Thus none of : sample preparation (dilution, volume determination, maintaining correct pH, etc.), sample geometry, or detector efficiency seem to be the cause of the low results.
- (j) There is no apparent reason for the low result, however the average value, 85 pCi/l is in good agreement to the grand average (86.46). Corrective action planned.
- (k) EPA results for gross beta in water were corrected for 20% crosstalk into the beta channel from the Th-230 alpha spike. Recent measurements show that the crosstalk can be much higher (37% for Tennelec counter #3 and 54% for gamma products counter #1). The normalized deviation from the grand average was only 0.38. Future results will be corrected with specific crosstalk values determined by counting Th-230 standards.
- (l) Possible aliquoting error. The instrument calibration, spike, and blank results all appear normal. No procedural changes are planned. Previous results were well within one normalized deviation. Future measurements will be reviewed to determine if a trend in results above the two sigma warning limit is occurring.
- (m) The milk sample was counted four times. The reported Cs-137 values were based on one aliquot of 1 liter volume and an aliquot of 0.865 liter counted two times. It is suspected that the 0.865 liter volume was incorrectly determined. If 1 liter (the usual volume for counting milk samples) is used in the calculation, then the average of three results equals 63.6 pCi/l which gives a normalized deviation to the Known of 1.59. The fourth count (a 1 liter aliquot) had a Cs-137 equal to 64.2 pCi/l which is in good agreement with the average of the other three. Teledyne will set up a log for recording aliquots used for EPA samples and record how the aliquot volume was determined.
- (n) An investigation is being conducted: the results will be available shortly.



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY

OFFICE OF RESEARCH AND DEVELOPMENT
ENVIRONMENTAL MONITORING SYSTEMS LABORATORY-LAS VEGAS
PO BOX 93478
LAS VEGAS NEVADA 89193-3478
(702/798-2100 FTS 545-2100)

Dear Participant:

The Radiation Quality Assurance Program has been experiencing problems with the Ruthenium-106 currently used in the Performance Evaluation (PE) Studies and in the Standards Distribution Program. If these problems can be satisfactorily resolved, this analyte will once again be placed into this PE Study. If the problems cannot be resolved, the Ruthenium-106 will be replaced.

Formal written notice will be given to all participants that are enrolled in the Gamma in Water PE Study before the Ruthenium-106 is reintroduced or replaced. At that time, new calibration standards will be available to all participants in the Gamma in Water PE Study.

Sincerely,

A handwritten signature in black ink that reads "George Dilbeck". The signature is cursive and fluid, with "George" on top and "Dilbeck" below it.

George Dilbeck
Chemist
Performance Evaluation Program
Radioanalysis Branch (RSA-RADQA)

APPENDIX C
STATISTICAL NOTES

APPENDIX C
STATISTICAL NOTES

1. Each activity is reported in one of two forms:

$x \pm s$ or

<L,

where

x = value of measurement;

s = counting error at the 95%
confidence level (2 sigma error);

L = detection limit based on 4.66 sigma error
for counter background

2. All activities are corrected to collection time except for gross alpha and gross beta.

3. Computation of means:

- (a) In any statistical table, the values are entered as

$\bar{x} \pm \bar{s}$

or <L

where

$\bar{x} = \text{sample mean} = \frac{\sum x}{n};$

n = number of data points averaged;

$\bar{s} = \text{average of the 2 sigma counting errors} = \frac{\sum s}{n}$

- (b) For gross beta and gross alpha results in air particulates, averaging includes values which are less than the lower limits of detection. The detection limit is used as the sample activity in these cases.
- (c) In all cases, if all values in an averaging group are below detection limits, the highest of the detection limits is reported as a "less than" value without an associated tolerance. If some values are above detection limits and some are below, then:

- (1) The mean of the positive results is reported and the number of positives is listed in parentheses.
- (d) Means are reported on a quarterly basis except for air particulate and airborne iodine data which are reported monthly. For air particulate and charcoal filters, data for samples collected on the 1st, 2nd, and 3rd day of a month are assigned to the previous month.
- (e) In rounding off, numbers followed by a 5 or higher digit are rounded upwards.

Appendix D
Notification Levels

NEBRASKA PUBLIC POWER DISTRICT
 COOPER NUCLEAR STATION
 ENVIRONMENTAL RADIATION SURVEILLANCE PROGRAM
 NOTIFICATION LEVELS

Media and Nuclide

Notification Level

Air

Gross Alpha	0.1	pCi/m ³
Gross Beta	1.0	pCi/m ³
I-131	0.31	pCi/m ³
Cs-134	3.3	pCi/m ³
Cs-137	6.7	pCi/m ³

Milk

I-131 (low level)	1.09	pCi/l
Sr-89	6.04	pCi/l
Sr-90	14.82	pCi/l
Cs-134	20.0	pCi/l
Cs-137	23.0	pCi/l

Groundwater

Gross Alpha	12.0	pCi/l
Gross Beta.	33.8	pCi/l
H-3	6700	pCi/l
Mn-54	330	pCi/l
Fe-59	130	pCi/l
Co-58	330	pCi/l
Co-60	100	pCi/l
Zn-65	100	pCi/l
Zr-Nb-95	67	pCi/l
I-131	0.67	pCi/l
Cs-134	10	pCi/l
Cs-137	17	pCi/l
Ba-La-140	67	pCi/l

Food Products

I-131	0.1	pCi/g wet
Cs-134	0.33	pCi/g wet
Cs-137	0.66	pCi/g wet

Fish

Gross Beta.	10.8	pCi/g wet
Sr-89	3.3	pCi/g wet
Sr-90	1.2	pCi/g wet
Mn-54	10	pCi/g wet

Media and NuclideNotification Level

Fish (Continued)

Fe-59	3.3	pCi/g wet
Co-58	10	pCi/g wet
Co-60	3.3	pCi/g wet
Zn-65	6.7	pCi/g wet
Cs-134	0.33	pCi/g wet
Cs-137	0.67	pCi/g wet

River Water

Gross Alpha Sus	22.0	pCi/l
Gross Alpha Dis	27.6	pCi/l
Gross Beta Sus	58.8	pCi/l
Gross Beta Dis	88.6	pCi/l
Sr-89	1000.0	pCi/l
Sr-90	100.0	pCi/l
H-3	6700	pCi/l
Mn-54	330	pCi/l
Fe-59	130	pCi/l
Co-58	330	pCi/l
Co-60	100	pCi/l
Zn-65	100	pCi/l
Zr-Nb-95	67	pCi/l
I-131	0.67	pCi/l
Cs-134	10	pCi/l
Cs-137	17	pCi/l
Ba-La-140	67	pCi/l

Shoreline Sediment

Co-60	0.1	pCi/g dry
Cs-134	0.75	pCi/g dry
Cs-137	0.75	pCi/g dry

APPENDIX E
CONVENTIONS USED IN DATA TREND GRAPHS

APPENDIX E

Conventions used in Data Trend Graphs

1. The data trend plots are based on statistical summaries of Section VI.
2. Monthly or quarterly averages are plotted.
3. The conventions used to determine if a "less than" (<) value or detectable result is plotted are those given in Appendix C.
4. Lowest levels of detection (LLD) are noted by a straight line on the graphs.
5. A typical less-than value arising from delayed counting of short-lived isotopes (such as I-131 or Ba-140) or reduced sample size are omitted.

APPENDIX F
DETECTION CAPABILITIES

DETECTION CAPABILITIES
FOR
ENVIRONMENTAL SAMPLE ANALYSIS
Radiochemical Methods
Lower Limit of Detection

LLD*

	Water (pCi/l)	Milk (pCi/l)	Air Part (pCi/m ³)	Food Products <u>Broadleaf Vegetation^b</u> (pCi/g wet)	Fish (pci/g wet)
Quantity ^c	0.4 l	-	280 m ³		0.1 g ash
Ash Wt. % ^d	-	-	-		4
α^e	4.0	-	0.002		-
β^e	1.4	-	0.003		0.25
Quantity	2 l	1 l	-		3 g ash
Ash Wt. %	-	-	-		4
Sr-89	1.08	2.02	-		0.03
Sr-90	0.93	1.39	-		0.03
Quantity	-	1 l	280 m ³	20 g	-
I-131	-	0.78	0.05 ^f	0.05	-
H-3	140	-	-	-	-

*LLD = lower limit of detection based on $4.66s_b$; where s_b is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute), specified for listed quantity and ash weight percentage.

^bThe minimum sensitivity will vary with the weight reduction achieved by ashing the sample. Minimum sensitivities for three typical ash weight percentages are specified.

^cTypical analysis quantity.

^dTypical ash weight percentage of wet weight.

^eListed α and β LLD's are for weightless sample. Self-absorption in sample will increase these LLD's. Typical increases will be factors in the range 1 to 1.3 for β analysis and 1-5 for α analysis.

^fIodine collected Charcoal Cartridge air filter.

^aLLD = lower limit of detection based on $4.66s_b$; & where s_b is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute). The LLD is at counting time and must be corrected to collection time. The LLDs given above are based on the quantities indicated and the background count rate in the absence of any radionuclides in the sample. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry, the background shall include the typical contributions of other radio-nuclides normally present in the samples (e.g., potassium-40 in milk samples).

Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLD's unachievable. In such cases, the contributing factors will be identified and described in the Environmental Radiation Monitoring Program Annual Report.

Note: All LLD's which we require are listed in this table for Ge(Li) Gamma Spectroscopy. If any nuclide is detected, it shall be reported quantitatively whether or not it is one of the 20 nuclides listed above.

LOWER LIMITS OF DETECTION (LLD)
OF
ANALYSES FOR Ge (Li) DETECTOR

LLD^a

	Milk, Water (pCi/l)	Air Part (pCi/m ³)	Fish, (pCi/kg wet)	Food Products (pCi/kg wet)	Shoreline Sediment (pCi/kg dry)
Quantity:	3.5 l	3600 m ³	400 g wet	200 g wet	600 g dry
Isotope	Half-life				
Be-7	53.2 d	78	6.05	311	1243
K-40	1.26x10 ⁹ y	140	0.06	466	932
Mn-54	313 d	8	0.003	31	124
Co-58	70.8 d	8	0.003	31	124
Fe-59	45 d	30	0.006	260	311
Co-60	5.26 y	8	0.005	31	124
Zn-65	245 d	30	0.003	260	711
Nb-95	35.2 d	9	0.003	31	74
Zr-95	65 d	9	0.005	47	93
Ru-103	39.4 d	8	0.003	31	124
Ru-106	368 d	62	0.03	311	1243
I-131	8.04 d	9	0.003	31	60
Cs-134	2.06 y	9	0.003	31	60
Cs-137	30.2 y	9	0.003	31	80
Ba-140	12.8 d	15	0.09	109	621
La-140	40.2 h	15	0.09	109	621
Ce-141	32.5 d	16	0.003	47	155
Ce-144	284 d	78	0.01	155	621
Ra-226	1600 y	100	0.08	200	800
Th-228	1.91 y	31	0.01	93	466

^aLLD = lower limit of detection based on $4.66s_b$; and where s_b is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute). The LLD is at counting time and must be corrected to collection time. The LLDs given above are based on the quantities indicated and the background count rate in the absence of any radionuclides in the sample. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry, the background shall include the typical contributions of other radio-nuclides normally present in the samples (e.g., potassium-40 in milk samples).

Occasionally background fluctuations, unavoidable small sample size, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLD's unachievable. In such cases, the contributing factors will be identified and described in the Environmental Radiation Monitoring Program Annual Report.

Note: All LLD's which we require are listed in this table for Ge(Li) Gamma Spectroscopy. If any nuclide is detected, it shall be reported quantitatively whether or not it is one of the 20 nuclides listed above.

APPENDIX G

SAMPLE STATION LOCATIONS AND SAMPLE TYPES

<u>Sample Station*</u>	<u>Sample Description -- Type and Location</u>
No. 1	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: Outside the northwest edge of fence, east of the gate to the LLRW storage pad on the CNS site, NW1/4, S32, T5N, R16E, Nemaha County, Nebraska.
No. 2	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: North side of county road access to the south portion of CNS site about 275 feet west of the Broady farmstead, SW1/4, S32, T5N, R16E, Nemaha County, Nebraska.
No. 3	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: Located on the north side of the Brownville State Recreation Park access road near water gauging station, SE1/4, S18, T5N, R16E, Nemaha County, Nebraska.
No. 4	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: $\frac{1}{2}$ mile south of Phelps City, Missouri, west side of Hwy "U", NE1/4, S2, T64N, R42W, Atchison County, Missouri.
No. 5	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: 1/4 mile south and 1/4 mile east of Langdon, Missouri, on north side of road, west of railroad tracks, SW1/4, S18, T64N, R41W, Atchison County, Missouri.
No. 6	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: 1 mile west of the end of Missouri State Highway "U", south side of road, SW corner of the intersection, NW 1/4, S34, T64N, R42W, Atchison County, Missouri.
No. 7	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: 300 yards east of Hwy 67, north side of road, west of Nemaha elevator, SW1/4, S6, T4N, R16E, Nemaha County, NE
No. 8	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: $\frac{1}{2}$ mile north, 3/4 mile west and 3/4 mile north of Nemaha, west side of road adjacent to Moore Transmission Line, NE1/4, S35, T5N, R15E, Nemaha County, Nebraska.
No. 9	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: 4 miles north of Highway #136 on Highway #67. 1 mile east of Highway #67 and $\frac{1}{2}$ mile north on west side of road, SW1/4, S26, T6N, R15E, Nemaha County, Nebraska.

<u>Sample Station</u>	<u>Sample Description -- Type and Location</u>
No. 10	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry Location: 1 mile north of Barada, in SW corner of intersec ⁿ NE1/4, S14, T3N, R16E, Richardson County, Nebraska.
No. 11	Type: (1) Water - Ground Location: Plant well water supply header at well pits, NW 1/4, S32, T5N, R16E, Nemaha County, Nebraska.
No. 12	Type: (1) Water - River Location: Sample (1) is taken from the Missouri River immediately upstream from the CNS Intake Structure (River Mile 532.5).
No. 20	Type: (1) Environmental Thermoluminescent Dosimetry Location: On NNW boundary of NPPD property, about 20 yards east of county road, SE1/4, S30, T5N, R16E, Nemaha county, NE.
No. 28	Type: (1) Water - River (2) Fish (3) Sediment from Shoreline (4) Food Products - Broadleaf Vegetation Location: Samples (1), (3), & (4) are taken from the Missouri River or its shore, below the CNS Discharge Outfall near River Mile 530. Sample (2) is taken from the Missouri River 1/4 to 3 miles downstream of the plant site.
No. 35	Type: (1) Fish (2) Food Products - Broadleaf Vegetation Location: Sample (1) is taken from the Missouri River about 1 to 3 miles above the CNS intake structure. Sample (2) is taken about 1/4 mile south of the Brownville State Recreation Area in Sector A.
No. 42	Type: (1) Milk (Other Producer) Location: 1 mile south, 1-1/4 miles east of Barada, south side of county road, NW 1/4, S30, T3N, R17E, Richardson County, NE.
No. 44	Type: (1) Environmental Thermoluminescent Dosimetry (2) Food Products - Broadleaf Vegetation Location: 2-1/4 miles south of Auburn stoplight on Hwy #73-75, 1/4 mile east of Hwy #73-75 at fence line north of county road, SE1/4, S27, T5N, R14E, Nemaha County, Nebraska.
No. 47	Type: (1) Water - Ground Location: Falls City water supply well south of Rulo, main header flow meter, SW1/4, S20, T1N, R18E, Richardson County, NE.
No. 56	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1-1/4 miles SW of Langdon on Hwy "U", on the right side of road, NW 1/4, S23, T64N, R42W, Atchison County, Missouri.

<u>Sample Station</u>	<u>Sample Description - Type and Location</u>
No. 58	Type: (1) Environmental Thermoluminescent Dosimetry Location: 3 miles south of Brownville, Nebraska, on county road, at SE corner of the intersection with farm road leading to Station No. 2, SE1/4, S31, T5N, R16E, Nemaha County, NE.
No. 59	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1 mile SSE of the CNS Elevated Release Point, 50 yards west of the levee at the south boundary of NPPD property, SE1/4, S32, T5N, R16E, Nemaha County, Nebraska.
No. 66	Type: (1) Environmental Thermoluminescent Dosimetry Location: 2 miles south of Nemaha, NE, on Hwy 67 - east side of road, NW 1/4, S19, T4N, R16E, Nemaha County, Nebraska.
No. 67	Type: (1) Environmental Thermoluminescent Dosimetry Location: 2 miles west of Brownville, on Hwy #136, north 1-1/2 miles on county road, east 1/2 mile (north side of road), NE1/4, S11, T5N, R15E, Nemaha County, Nebraska.
No. 71	Type: (1) Environmental Thermoluminescent Dosimetry Location: 2 miles east of Phelps City, MO, on Hwy #136, south 1-1/2 miles on county road, and west 1/4 mile, SE1/4, S6, T64N, R41W, Atchison County, Missouri.
No. 79	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1-7/8 miles south of Brownville, east side of paved road, NPPD property, SE1/4, S30, T5N, R16E, Nemaha County, NE.
No. 80	Type: (1) Environmental Thermoluminescent Dosimetry Location: 2-1/8 miles south of Brownville, east side of paved road, NPPD property, NE1/4, S31, T5N, R16E, Nemaha County, NE.
No. 81	Type: (1) Environmental Thermoluminescent Dosimetry Location: 2-3/8 miles south of Brownville, in the NE corner of the intersection of the paved county road and CNS access road, NPPD property, NE1/4, S31, T5N, R16E, Nemaha County, NE.
No. 82	Type: (1) Environmental Thermoluminescent Dosimetry Location: 7/8 mile south of CNS in a field, on NPPD property, SW1/4, S32, T5N, R16E, Nemaha County, Nebraska.
No. 83	Type: (1) Environmental Thermoluminescent Dosimetry Location: 2-1/4 miles south of Nemaha on Hwy 67, east 1 mile to the junction of the driveway and county road (east side of driveway), NE1/4, S19, T4N, R16E, Nemaha County, Nebraska.
No. 84	Type: (1) Environmental Thermoluminescent Dosimetry Location: 2-1/2 miles west of Brownville, south side of Hwy 136 west of school, NW 1/4, S22, T5N, R15E, Nemaha County, NE.

<u>Sample Station</u>	<u>Sample Description - Type and Location</u>
No. 85	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1 mile east of Brownville on Hwy 136, north 1/4 mile on east side of county road, NE1/4, S33, T65N, R42W, Atchison County, Missouri.
No. 86	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1 mile west of Phelps City, MO, on Hwy 136, north 1-1/2 miles on Highway "D", west side, SE1/4, S22, T65N, R43W, Atchison County, Missouri.
No. 87	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1 mile west of Phelps City, MO, on Hwy 136, south $\frac{1}{4}$ mile on county road and 3/4 mile west on county road (to end of road), SW1/4, S3, T64N, R42W, Atchison County, Missouri.
No. 88	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1 mile west of Phelps City, MO, on Hwy 136, south 2 miles at end of county road, NW 1/4, S11, T64N, R42W, Atchison County, Missouri.
No. 89	Type: (1) Environmental Thermoluminescent Dosimetry Location: 2-1/2 miles south of Phelps City, MO, on Hwy "U", $\frac{1}{4}$ mile west in the SE corner of county road intersection, NE1/4, S14, T64N, R42W, Atchison County, Missouri.
No. 90	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1-1/2 miles west and 3/4 mile south of Langdon, MO, on Hwy "U", then 1/4 mile west, SW1/4, S23, T64N, R42W, Atchison County, Missouri.
No. 91	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1/2 mile west of Rock Port, MO, on the south side of the intersection of Hwy 136 and Hwy 275, at the water tower, NW 1/4, S28, T65N, R41W, Atchison County, Missouri.
No. 94	Type: (1) Environmental Thermoluminescent Dosimetry Location: 1/4 mile south of Langdon, MO, on the west side of the road, NE1/4, S24, T64N, R42W, Atchison County, Missouri.
No. 99	Type: (1) Milk (Nearest Producer) Location: 1-1/4 miles south of Shubert, Nebraska, on west side of Hwy 67, NE1/4, S24, T3N, R15E, Richardson County, NE.
No. 100	Type: (1) Milk (Other Producer) Location: 2 miles south and 1 mile west of Shubert, NE, SW1/4, S23, T3N, R15E, Richardson County, Nebraska.

NOTES: (a) Sample Station numbers missing from the sequence are inactive or discontinued Sample Stations.

APPENDIX H

SUMMARY OF DOSES TO A MEMBER OF THE PUBLIC OFF-SITE

DOSES TO MAXIMUM INDIVIDUAL (MREM), JANUARY-DECEMBER 1994

COOPER NUCLEAR STATION JANUARY-DECEMBER 1994
 SPECIAL LOCATION # 1 SITE BOUNDARY
 AT 0.67 MILES N

PATHWAY	T.BODY	GI-TRACT	BONE	LIVER	KIDNEY	THYROID	LUNG	SKIN
ADULT	7.26E-03	8.32E-03	7.12E-03	7.18E-03	7.12E-03	7.51E-03	7.51E-03	8.99E-03
TEEN	7.32E-03	8.28E-03	7.12E-03	7.21E-03	7.12E-03	7.66E-03	7.68E-03	8.99E-03
CHILD	7.51E-03	7.85E-03	7.12E-03	7.26E-03	7.13E-03	8.15E-03	7.58E-03	8.99E-03
INFANT	7.16E-03	7.16E-03	7.13E-03	7.14E-03	7.13E-03	9.30E-03	7.41E-03	8.99E-03

H1

COOPER NUCLEAR STATION JANUARY-DECEMBER 1994
 SPECIAL LOCATION # 2 NEAR RESIDENCE
 AT 0.90 MILES NW

PATHWAY	T.BODY	GI-TRACT	BONE	LIVER	KIDNEY	THYROID	LUNG	SKIN
ADULT	3.11E-03	3.47E-03	3.06E-03	3.08E-03	3.06E-03	3.35E-03	3.17E-03	4.56E-03
TEEN	3.13E-03	3.46E-03	3.06E-03	3.09E-03	3.06E-03	3.46E-03	3.21E-03	4.56E-03
CHILD	3.19E-03	3.31E-03	3.06E-03	3.11E-03	3.06E-03	3.81E-03	3.18E-03	4.56E-03
INFANT	3.07E-03	3.07E-03	3.06E-03	3.07E-03	3.07E-03	4.65E-03	3.14E-03	4.56E-03

Summary of Doses to Maximum individual at the Site Boundary, Resulting From Exposure to
Radioactivity Discharged in Liquid Effluents, January - December 1994, Cooper Nuclear Station

Period	Dose, mrem							
	Skin	Bone	Liver	Body	Thyroid	Kidney	Lung	GI-LLI
H2								
1st Quarter	2.05E-05	5.20E-04	6.66E-04	7.18E-04	1.75E-05	1.52E-04	6.66E-05	4.53E-03
2nd Quarter	2.56E-05	2.20E-03	2.63E-03	2.18E-03	2.17E-05	8.10E-04	2.80E-04	5.5E-03
3rd Quarter	2.06E-06	2.41E-04	3.66E-04	2.86E-04	1.76E-06	1.11E-04	3.50E-05	8.31E-04
4th Quarter	3.25E-06	1.70E-04	3.05E-04	2.81E-04	2.76E-06	8.53E-05	2.97E-05	1.15E-03
Totals For 1994	5.14E-05	3.13E-03	3.97E-03	3.47E-03	4.37E-05	1.16E-03	4.11E-04	1.21E-02