

ATTACHMENT A

ODCM, Revision 25

9203240102 920313  
PDR ADDCK 05000361  
R PDR

RECEIVED ODM

February 28, 1992

FEB 28 1992

SITE FILE COPY

SUBJECT: UNITS 2/3 OFFSITE DOSE CALCULATION MANUAL Revision 25

Enclosed is Revision 25 to the Units 2/3 Offsite Dose Calculation Manual (ODCM). This revision added steam generator blowdown and the Full Flow Condensate Polisher Demineralizer (FFCPD) holdup tank (HUT) as liquid release points and revised the Turbine Plant Sump discharge flowrates to reflect the replacement of the pump per DCP 2-6747. In recognition of unequal mixing in the plant vent stack, minimum instrument requirements for noble gases were revised to require both radiation monitors on the unit-specific branches whenever the radiation monitor on the common plenum is out of service. Additionally, radiation monitor calibration constants were updated to reflect recent surveillances and there was one editorial change for typographical errors. This revision also encompasses the update of tables used in liquid and gaseous dose calculations that resulted specifically from the 1991 Land Use Census. None of the changes result in any modifications to either the plant configuration or operation. As such, there is no impact on the accuracy or reliability of methods for determining effluent dose or setpoint values.

A complete list of the changes is attached to this letter and safety reviews have been performed for the following changes:

- o batch release of steam generator blowdown via 2(3)RT-6759 or 2(3)RT-6753 respectively
- o batch release of the FFCPD HUT via 2(3)RT-7821
- o instrument requirements for the plant vent stack

No positive findings were found in any of the safety evaluations.

No safety evaluations were performed for updating radiation monitor calibration constants or implementing changes from the 1991 Land Use Census. Similarly, the increase in the discharge rate from the turbine plant sump will be factored into the existing setpoint equation. These changes reflect results from routine surveillances and as such do not constitute a modification in methodology for determining activity released from the Site and subsequent dose to a member of the public.

Per NRC Generic Letter 89-01, no safety review was required or performed for the correction of typographical errors.

The following is a complete list of the changes:

- \* Indicates typographical, sequential sectional and page numbering, and format changes
- GEN\* Added S023-ODCM above rev # in lower right corner of all pages to facilitate incorporation into SDMS
- GEN\* The Food and Ground (GF) pathway values for child, teen, and adult (infant is zero) were increased by a factor of (1/0.7) or 43% in Sector P, 0.4 mile (page 2-38), Sector Q, 0.7 mile (page 2-43), and Sector Q, 1.1 mile (page 2-44). The increase is due to the fact that a shielding factor of 0.7 used in the Regulatory Guide 1.109, equation C-2, for calculation of ground exposure is not applicable to beach use since no structural shielding is provided for beach users. The increase in GF values does not affect the controlling location factors but it does increase the dose parameters columns for "Food and Ground" for the mentioned uses. Because, there no food pathway contribution for the beach uses, then the increase in the "Food and Ground" column will be only due to an increase in the ground GF factor (Food=0) and is expected to be 43% higher than the 1990 values. The modification to the GF factor was made per recommendation of Dr. James Brown, a consultant to the Station's Effluent Engineering group.
- 1-2 Added SG Blowdown and FFCPD HUT as liquid batch release points
- 1-15 Added discharge value for FFCPD Holdup Tank
- 1-23 Added separate discharge flowrate value for Unit 2 per DCP 2-6747
- 1-26 Table 1-3, updated liquid calibration constants for 2RT-6753, 2RT-6759, and 3RT-6753
- 1-28\* Table 1-4, in notes, changed NUREG-0172 to NUREG-0472
- 1-29\* same as pg 1-28
- 1-30 Provided regulatory references for representative sampling
- 2-35\* Table 2-4, deleted note "1.17E+3 = 1.17 X 10<sup>3</sup>"
- 2-37 Table 2-6, added controlling sector location to table
- 2-38\* Surf Beach Life Guard occupancy factor increased from 0.0685 to 0.0716 (Sector P, 0.4 mile).
- 2-39 Point Loran Military housing was deleted. It was not used for military housing in 1991 due to cutback in budget (Sector P, 2.7 miles).
- 2-43 Surf Beach Guard Shack occupancy factor increased from 0.0571 to 0.1712 (Sector Q, 0.7 mile). Also, the "guard shack" for infant, child, and teen uses was deleted and beach use parameters were added to these age groups.

- 2-44 Enlisted Beach campground (a new use) was added with an occupancy factor of 0.0104 (Sector Q, 1.1 mile).
- 2-49 San Clemente Ranch Administrative Office occupancy factor decreased from 0.5833 to 0.3425 (Sector R, 2.6 miles).
- 2-51\* Child Food and Ground pathway Cs-137 corrected: 2.2E+10 changed to 2.3E+10
- 2-52 San Clemente Ranch Packing With Resident occupancy factor decreased from 0.5833 to 0.3425 (Sector R, 2.6 miles).
- 2-55\* Adult Food and Ground pathway Co-60 corrected: 2.3E+10 changed to 2.2E+10
- 2-58\* Adult Inhalation Cs-137 corrected: 3.4E+2 changed to 3.4E+3
- 2-64 Sheep Meat D/Q changed from 5.3E-8 to 6.1E-8. This does not affect the dose parameters which do not contain the D/Q factor (Sector C, 0.2 mile). [Adult Inhalation Cr-136 corrected: 8.1E+3 changed to 8.1E+2\*]
- 2-72 San Onofre State Park Guard Shack occupancy factor increased from 0.0571 to 0.1712 (Sector F, 0.8 mile). The X/Q changed from 8.1E-7 to 8.6E-7 and D/Q changed from 7.1E-9 to 7.5E-9 in that same sector. The "guard shack" description for infant, child, and teen was deleted. GF and ZIN are zero because the uses for San Onofre State Park are listed in Sector G (Campground, the closest use).
- 2-73 (old 2-73) Beach concession use was deleted due to the closure of the stand (Sector F, 0.9 mile).
- 2-76 San Onofre Beach Campground occupancy factor for maintenance workers increased to 0.2283 (Sector G, 0.8 mile).
- 2-80\* Reformatted definitions
- 2-81\* Reformatted definitions
- 2-82\* Reformatted definitions
- 4-2\* Table 4-1, to 1.c, added Auxiliary Building Sump, Component Cooling Water Sumps, and Storage Tank Area Sumps
- 4-7 Modified noble gas monitoring requirement for plant vent stack to require both RT-7865s when 2/3RT-7808 is inoperable
- 4-8 Modified footnote (2) to require process flow verification on the plant vent stack if either RT7865 is not available. Added footnote (3).
- 5-17 Removed TLD 99, Transit Dose, at completion of comparative study on LiF and CaSO<sub>4</sub> TLDs
- 6-4\* Added definition for Ventilation Exhaust Treatment System

OFFSITE DOSE CALCULATION MANUAL

NUCLEAR ORGANIZATION

UNITS 2 AND 3

S023-ODCM  
Rev 12/25  
02-25-87

## ODCM

## TABLE OF CONTENTS

	Page
LIST OF FIGURES . . . . .	iv
LIST OF TABLES . . . . .	v-vi
INTRODUCTION . . . . .	vii
 1.0 LIQUID EFFLUENTS . . . . .	1-1 thru 1-30
1.1 Concentration . . . . .	1-1
1.1.1 Specification . . . . .	1-1
1.1.1.1, 1.1.1.2 Surveillances . . . . .	1-1
1.2 Dose . . . . .	1-5
1.2.1 Specification . . . . .	1-5
1.2.1.1 Surveillance . . . . .	1-5
1.3 Liquid Waste Treatment . . . . .	1-6
1.3.1 Specification . . . . .	1-6
1.3.1.1, 1.3.1.2, 1.3.1.3 Surveillances . . . . .	1-6
1.4 Liquid Effluent Monitor Setpoints . . . . .	1-8
1.4.1 Batch Release Setpoint Determination . . . . .	1-10
1.4.2 Continuous Release Setpoint Determination . . . . .	1-16
1.5 Dose Calculations for Liquid Effluents . . . . .	1-27
1.6 Representative Sampling . . . . .	1-30
 2.0 GASEOUS EFFLUENTS . . . . .	2-1 thru 2-82
2.1 Dose Rate . . . . .	2-1
2.1.1 Specification . . . . .	2-1
2.1.1.1, 2.1.1.2 Surveillances . . . . .	2-1
2.2 Dose - Noble Gas . . . . .	2-5
2.2.1 Specification . . . . .	2-5
2.2.1.1 Surveillance . . . . .	2-5
2.3 Dose - Radioiodines, Radioactive Materials in Particulate Form and Tritium . . . . .	2-6
2.3.1 Specification . . . . .	2-6
2.3.1.1 Surveillance . . . . .	2-6

## ODCM

## TABLE OF CONTENTS (Continued)

	<u>Page</u>
2.4 Gaseous Radwaste Treatment . . . . .	2-7
2.4.1 Specification . . . . .	2-7
2.4.1.1 Surveillance . . . . .	2-7
2.4.1.2, 2.4.1.3 Surveillances . . . . .	2-8
2.5 Total Dose . . . . .	2-9
2.5.1 Specification . . . . .	2-9
2.5.1.1 Surveillance . . . . .	2-9
2.6 Gaseous Effluent Monitor Setpoints . . . . .	2-11
2.6.1 Plant Stack . . . . .	2-11
2.6.2 Condenser Evacuation System . . . . .	2-15
2.6.3 Containment Purge . . . . .	2-18
2.6.4 Waste Gas Header . . . . .	2-21
2.7 Gaseous Effluent Dose Rate . . . . .	2-26
2.7.1 Noble Gases . . . . .	2-26
2.7.2 Radioiodines and Particulates . . . . .	2-27
2.8 Gaseous Effluent Dose Calculation . . . . .	2-29
2.8.1 Noble Gases . . . . .	2-29
2.8.1.1 Historical Meteorology . . . . .	2-29
2.8.1.2 Concurrent Meteorology . . . . .	2-30
2.8.2 Radioiodines and Particulates . . . . .	2-31
2.8.2.1 Historical Meteorology . . . . .	2-31
2.8.2.2 Concurrent Meteorology . . . . .	2-33
2.9 Total Dose Calculations . . . . .	2-80
2.9.1 Total Dose to Most Likely Member of the Public . . . . .	2-80
2.9.1.1 Annual Total Organ Dose . . . . .	2-80
2.9.1.2 Annual Total Whole Body Dose . . . . .	2-81
2.9.1.3 Annual Total Thyroid Dose . . . . .	2-82
<b>3.0 PROJECTED DOSES</b>	
3.1 Liquid Dose Projection . . . . .	1 thru 3-1
3.2 Gaseous Dose Projection . . . . .	3-1
<b>4.0 EQUIPMENT</b> . . . . .	4-1 thru 4-15
4.1 Radioactive Liquid Effluent Monitoring Instrumentation . . . . .	4-1
4.1.1 Specification . . . . .	4-1
4.1.1.1, 4.1.1.2 Surveillances . . . . .	4-1

## ODCM

## TABLE OF CONTENTS (Continued)

	<u>Page</u>
4.2 Radioactive Gaseous Effluent Monitoring Instrumentation . . . . .	4-6
4.2.1 Specification . . . . .	4-6
4.2.1.1 Surveillance . . . . .	4-6
4.3 Operability of Radioactive Waste Equipment . . . . .	4-13
5.0 Radiological Environmental Monitoring . . . . .	5-1 thru 5-25
5.1 Monitoring Program . . . . .	5-1
5.1.1 Specification . . . . .	5-1
5.1.1.1 Surveillance . . . . .	5-2
5.2 Land Use Census . . . . .	5-11
5.2.1 Specification . . . . .	5-11
5.2.1.1 Surveillance . . . . .	5-11
5.3 Interlaboratory Comparison Program . . . . .	5-12
5.3.1 Specification . . . . .	5-12
5.3.1.1 Surveillance . . . . .	5-12
5.4 Annual Radiological Environmental Operating Report . . . . .	5-13
5.5 Sample Locations . . . . .	5-14
6.0 Administrative . . . . .	6-1 thru 6-16
6.1 Definitions . . . . .	6-1
6.2 Administrative Controls . . . . .	6-7
6.3 Major Changes to Radioactive Waste Treatment Systems (Liquid and Gaseous) . . . . .	6-9
6.4 Bases . . . . .	6-10

## LIST OF FIGURES

Figure	Title	Page
1-2	Site Boundary for Liquid Effluents . . . . .	1-7
2-2	Site Boundary for Gaseous Effluents . . . . .	2-10
4-5	SONGS 2 and 3 Radioactive Liquid Waste Treatment Systems . . . . .	4-14
4-6	SONGS 2 and 3 Radioactive Gaseous Waste Treatment Systems . . . . .	4-15
4-7	Solid Waste Handling . . . . .	4-16
5-1	Radiological Environmental Monitoring Sample Locations . . . . .	5-23

## LIST OF TABLES

<u>Table</u>	<u>Title</u>	<u>Page</u>
1-1	Radioactive Liquid Waste Sampling and Analysis Program . . .	1-2
1-3	Liquid Effluent Radiation Monitors Calibration Constants . . . . .	1-26
1-4	Dose Commitment Factors $A_{ik}$ . . . . .	1-28
2-1	Radioactive Gaseous Waste Sampling and Analysis Program . .	2-2
2-3	Gaseous Effluent Radiation Monitor Calibration Constants . . . . .	2-25
2-4	Dose Factors for Noble Gas and Daughters . . . . .	2-35
2-5	Dose Parameters $P_{ik}$ . . . . .	2-36
2-6	Controlling Location Factors . . . . .	2-37
2-7	Dose Parameters $R_i$ for Sector P . . . . .	2-38
2-8	Dose Parameters $R_i$ for Sector Q . . . . .	2-40
2-9	Dose Parameters $R_i$ for Sector R . . . . .	2-50
2-10	Dose Parameters $R_i$ for Sector A . . . . .	2-55
2-11	Dose Parameters $R_i$ for Sector B . . . . .	2-58
2-12	Dose Parameters $R_i$ for Sector C . . . . .	2-61
2-13	Dose Parameters $R_i$ for Sector D . . . . .	2-66
2-14	Dose Parameters $R_i$ for Sector E . . . . .	2-69
2-15	Dose Parameters $R_i$ for Sector F . . . . .	2-72
2-16	Dose Parameters $R_i$ for Sector G . . . . .	2-76
4-1	Radioactive Liquid Effluent Monitoring Instrumentation . . .	4-2
4-2	Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements . . . . .	4-4
4-3	Radioactive Gaseous Effluent Monitoring Instrumentation . .	4-7
4-4	Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements . . . . .	4-10

## ODCM

## LIST OF TABLES (Continued)

Table	Title	Page
5-1	Radiological Environmental Monitoring Program . . . . .	5-3
5-2	Reporting Levels for Radioactivity Concentrations in Environmental Samples . . . . .	5-7
5-3	Maximum Values for the Lower Limits of Detection (LLD) . . .	5-8
5-4	Radiological Environmental Monitoring Sample Locations . . .	5-15
5-5	PIC Radiological Environmental Monitoring Locations . . .	5-21
5-6	Sector and Direction Designation for Radiological Environmental Monitoring Sample Location Map . . . . .	5-22
6-1	Operational Modes . . . . .	6-5
6-2	Frequency Notation . . . . .	6-6

## INTRODUCTION

The OFFSITE DOSE CALCULATION MANUAL (ODCM) is a supporting document of the RADIOLOGICAL EFFLUENT TECHNICAL SPECIFICATIONS (NUREG 0472). The ODCM enumerates dose and concentration specifications, instrument requirements, as well as describes the methodology and parameters to be used in the calculation of offsite doses from radioactive liquid and airborne effluents. In order to set release limits, it additionally provides calculations for liquid and gaseous effluent monitoring instrumentation alarm/trip setpoints. The environmental section contains a list of the sample locations for the radiological environmental monitoring program.

## 1.0 LIQUID EFFLUENTS

### 1.1 CONCENTRATION

#### SPECIFICATION

1.1.1 The concentration of radioactive material released from the site (see Figure 1-2) shall be limited to the concentrations specified in 10 CFR Part 20, Appendix B, Table II, column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to  $2 \times 10^{-4}$  microcuries/ml total activity.

APPLICABILITY: At all times

#### ACTION:

- a. With the concentration of radioactive material released from the site exceeding the above limits, immediately restore the concentration to within the above limits.

#### SURVEILLANCE REQUIREMENTS

- .1 Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program of Table 1-1.
- .2 The results of the radioactivity analyses shall be used in accordance with the methodology and parameters in Section 1.4 to assure that the concentrations at the point of release are maintained within the limits of Specification 1.1.1.

TABLE 1-1  
RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

Liquid Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) ( $\mu\text{Ci}/\text{ml}$ ) <sup>a</sup>
A. Batch Waste Release <sup>d</sup>	P Each Batch	P Each Batch	Principal Gamma Emitters <u>I-131</u>	$5 \times 10^{-7}$ $1 \times 10^{-6}$
	P One Batch/M	M	Dissolved and Entrained Gases (Gamma emitters)	$1 \times 10^{-5}$
	P Each Batch	M Composite <sup>b</sup>	H-3 <u>Gross Alpha</u>	$1 \times 10^{-5}$ $1 \times 10^{-7}$
	P Each Batch	Q Composite <sup>b</sup>	Sr-89, Sr-90 Fe-55	$5 \times 10^{-8}$ $1 \times 10^{-6}$

NOTE BATCH RELEASE POINTS: Primary Plant Makeup Storage Tanks, Radwaste Primary Tanks, Radwaste Secondary Tanks, Miscellaneous Waste Condensate Monitor Tanks, Blowdown Processing Sump, FFCPD sumps (high conductivity, low conductivity) and holdup tank, Component Cooling Water Sump, Storage Tank Area Sump, S/G Blowdown.

B. Continuous Releases <sup>e</sup> ,	D Grab Sample	W Composite <sup>c</sup>	Principal Gamma Emitters <u>I-131</u>	$5 \times 10^{-7}$ $1 \times 10^{-6}$
	M Grab Sample	M	Dissolved and Entrained Gases (Gamma emitters)	$1 \times 10^{-5}$
	D Grab Sample	M Composite <sup>c</sup>	H-3 <u>Gross Alpha</u>	$1 \times 10^{-5}$ $1 \times 10^{-7}$
	D Grab Sample	Q Composite <sup>c</sup>	Sr-89, Sr-90 Fe-55	$5 \times 10^{-8}$ $1 \times 10^{-6}$

NOTE CONTINUOUS RELEASE POINTS: Turbine Plant Sump", Blowdown Processing Sump," S/G Blowdown Bypass Line", S/G Blowdown, Salt Water Discharge from CCW Heat Exchanger, Auxiliary Building Sump.

TABLE 1-1 (Continued)

TABLE NOTATION

- a. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

where:

LLD is the "a priori" lower limit of detection as defined above (as microcurie per unit mass or volume),

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

$2.22 \times 10^6$  is the number of transformations per minute per microcurie,

Y is the fractional radiochemical yield (when applicable),

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  is the elapsed time between midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of  $s_b$  used in the calculation of the LLD for a particular measurement system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance.

In calculating the LLD for a radionuclide determined by gamma ray spectrometry, the background should include the typical contributions of other radionuclides normally present in the samples. Typical values of E, V, Y and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of the measurement system and not as a posteriori (after the fact) limit for a particular measurement.\*

\*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem. 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotopic Counting Techniques," Atlantic Richfield Hanford Company Report ARH-2537 (June 22, 1972).

TABLE 1-1 (Continued)

TABLE NOTATION

- b. A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen which is representative of the liquids released.
  - c. To be representative of the quantities and concentrations of radioactive materials in liquid effluents, samples shall be collected continuously in proportion to the rate of flow of the effluent stream. Prior to analysis, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluent release.
  - d. A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed, by a method described in the ODCM, to assure representative sampling.
  - e. A continuous release is the discharge of liquid wastes of a nondiscrete volume; e.g., from a volume of system that has an input flow during the continuous release.
  - f. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141, and Ce-144. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported.
- \* Administrative controls shall ensure that only one continuous release point is discharging through a discharge path at any given time. The normal continuous release point via 2(3)RT-7821 is the turbine plant sump.
- \*\* The first sump volume of BPS ion exchanger regeneration process shall be treated as a batch release.
- \*\*\* Sampling of this flow is not required if at least once per 31 days blowdown bypass isolation valve (S21301MU618 for Steam Generator 2E088, S21301MU619 for Steam Generator 2E089, S31301MU618 for Steam Generator 3E088 and S31301MU619 for Steam Generator 3E089) is verified locked shut.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.2 DOSE

#### SPECIFICATION

1.2.1 The dose or dose commitment to an individual from radioactive materials in liquid effluents released, from each reactor unit, from the site (see Figure 1-2) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times

#### ACTION:

- a. With calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, in lieu of any other report required by Technical Specification 6.9.1, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions taken to reduce the releases and the proposed actions to be taken to assure that subsequent releases will be in compliance with Specification 1.2.1.

#### SURVEILLANCE REQUIREMENTS

1. Dose Calculation. Cumulative dose contributions from liquid effluents shall be determined in accordance with Section 1.5 at least once per 31 days.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.3 LIQUID WASTE TREATMENT

#### SPECIFICATION

1.3.1 The liquid radwaste treatment system shall be OPERABLE. The appropriate portions of the system shall be used to reduce the radioactive materials in liquid wastes prior to their discharge when the projected doses due to the liquid effluent from the site (see Figure 1-2) when averaged over 31 days, would exceed 0.06 mrem to the total body or 0.2 mrem to any organ.

APPLICABILITY: At all times

#### ACTION:


- a. With radioactive liquid waste being discharged without treatment and in excess of the above limits, in lieu of any other report required by Technical Specification 6.9.1, prepare and submit to the Commission within 30 days pursuant to Technical Specification 6.9.2 a Special Report which includes the following information:
  1. Explanation of why liquid radwaste was being discharged without treatment, identification of the inoperable equipment or subsystems and the reason for inoperability,
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.

#### SURVEILLANCE REQUIREMENTS

- .1 Doses due to liquid releases shall be projected at least once per 31 days, in accordance with Section 3.1.
- .2 During plant operation (Mode 1-4), the appropriate portions of the liquid radwaste treatment system shall be demonstrated OPERABLE by operating the liquid radwaste treatment system equipment for at least 15-minutes at least once per 92 days unless the liquid radwaste system has been utilized to process radioactive liquid effluents during the previous 92 days.
- .3 In plant shut-down (Mode 5, 6) the appropriate portions of the liquid radwaste treatment system shall be demonstrated OPERABLE by operating the liquid radwaste treatment system equipment for at least 15-minutes prior to processing liquids unless the appropriate liquid radwaste system has been utilized to process radioactive liquid effluents during the previous 92 days.

\*Per reactor unit

SAN ONOFRE NUCLEAR  
GENERATING STATION  
UNITS L 2 & 3

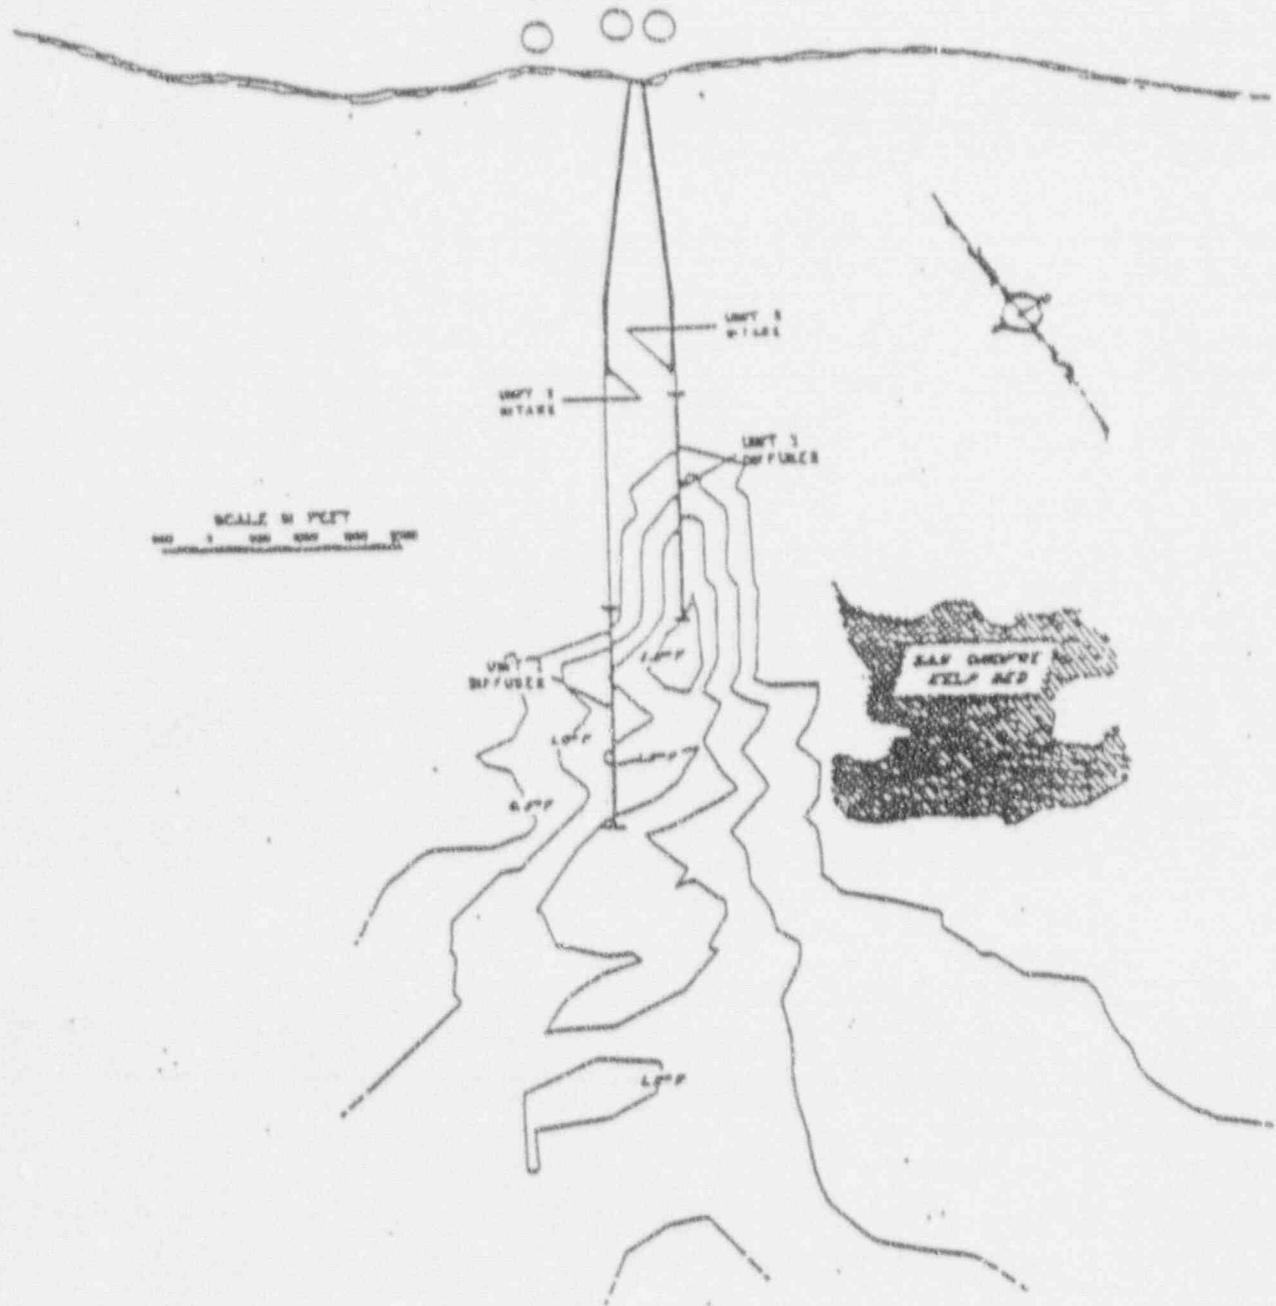

SITE BOUNDARY FOR LIQUID EFFLUENTS

FIGURE 1-2

REFERENCE: TECHNICAL SPECIFICATIONS, FIGURE 5.1-4

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4 Liquid Effluent Monitor Methods of Setpoint Calculation

Liquid Radwaste Effluent Line Monitors provide alarm and automatic termination of release prior to exceeding the concentration limits specified in 10CFR20, Appendix B, Table II, Column 2 at the release point to the unrestricted area. To meet this specification and for the purpose of implementation of Specification 1.1.1, the alarm/trip setpoints for liquid effluent monitors and flow measurement devices are set to assure that the following equation is satisfied:

$$\frac{C_R}{F+R} \leq MPC_{eff} \quad (1-1)$$

where:

$MPC_{eff}$  = effective effluent maximum concentration permissible limit ( $\mu\text{Ci}/\text{ml}$ ) at the release point to the unrestricted area for the radionuclide mixture being released,

$$= \frac{1}{\sum_{i=1}^N \left( \frac{F_i}{MPC_i} \right)} \quad (1-2)$$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4 Liquid Effluent Monitor Methods of Setpoint Calculation (Continued)

where:

- $F_i$  = fractional concentration of the  $i^{\text{th}}$  radionuclide as obtained by sample analysis.
- $N$  = number of radionuclides identified in sample analysis.
- $MPC_i$  = MPC of the  $i^{\text{th}}$  radionuclide (10CFR20, App B, Table II, Column 2).
- $C_s$  = setpoint, representative of a radionuclide concentration for the radiation monitor measuring the radioactivity in the waste effluent line prior to dilution and subsequent release,  $\mu\text{Ci}/\text{ml}$ .
- $R$  = permissible waste effluent flow rate at the radiation monitor location, in volume per unit time in the same units as for  $F$ .
- $F$  = dilution water flow in volume per unit time. The dilution water flow ( $F$ ) is 185,000 gpm per circ pump (4 total) and 17,000 gpm per saltwater pump (2 total).

The design flowrate of each circulating water pump is 205,000 gpm. The value used in the determination of  $F$  takes into account factors such as frictional losses, pump inefficiency, and tidal flow, and provides reasonable assurance that the radioactive release concentration is not underestimated.

## 1.0 LIQUID E'FLUENTS (Continued)

### 1.4 Liquid Effluent Monitor Methods of Setpoint Calculation (Continued)

Administrative values are used to reduce each setpoint to account for the potential activity in other releases. These administrative values shall be periodically reviewed based on actual release data (including, for example, any seawater discharge of the component cooling water heat exchanger) and revised as necessary.

#### 1.4.1 Batch Release Setpoint Determination

The waste flow ( $R$ ) and monitor setpoint ( $c$ ) are set to meet the condition of equation (1-1) for the effective MPC ( $MPC_{eff}$ ) limit.

The method by which this is accomplished is as follows:

STEP 1: The isotopic concentration for each batch tank (or sump) to be released is obtained from the sum of the measured concentrations in the tank (or sump) as determined by analysis.

$$C = \sum_i C_{y,i} + C_{e} + C_s + C_t + C_{Fe} \quad (1-3)$$

where:

$C$  = total concentration in each batch tank,  $\mu\text{Ci}/\text{ml}$

$\sum_i C_{y,i}$  = sum of the measure concentrations for each radionuclide,  $i$ , in the gamma spectrum,  $\mu\text{Ci}/\text{ml}$

$C_{Fe}$  = Fe-55 concentration as determined in the previous quarterly composite sample,  $\mu\text{Ci}/\text{ml}$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.1 Batch Release Setpoint Determination (Continued)

$C_s$  = gross alpha concentration determined in the previous monthly composite sample,  $\mu\text{Ci}/\text{ml}$

$C_s$  = Sr-89 and Sr-90 concentrations as determined in the previous quarterly composite sample,  $\mu\text{Ci}/\text{ml}$

$C_t$  = H-3 concentration as determined in the previous monthly composite sample,  $\mu\text{Ci}/\text{ml}$

STEP 2: The effective MPC ( $MPC_{eff}$ ) for each batch tank (or sump) is determined using:

$$MPC_{eff} = \frac{1}{\sum_i \left( \frac{C_{\gamma_i}/C}{MPC_{\gamma_i}} + \frac{C_s/C}{MPC_s} + \frac{C_t/C}{MPC_t} + \frac{C_e/C}{MPC_e} + \frac{C_{Fe}/C}{MPC_{Fe}} \right)} \quad (1-4)$$

$MPC_{\gamma_1}$ ,  $MPC_s$ ,  $MPC_t$ ,  $=$  the limiting concentrations of the appropriate radionuclide from 10CFR20, Appendix B, Table II, Column 2.

**NOTE:** For dissolved or entrained noble gases, the concentration shall be limited to 2.0E-4  $\mu\text{Ci}/\text{ml}$  total activity.

STEP 3: The radioactivity monitor setpoint  $C_r$ ,  $\mu\text{Ci}/\text{ml}$ , may now be specified based on the values of  $C$ ,  $\Sigma_i C_{\gamma_i}$ ,  $F$ ,  $MPC_{eff}$ , and  $R$  to provide compliance with the limits of 10CFR20, Appendix B, Table II, Column 2. The monitor setpoint, cpm, is taken from the applicable calibration constants given in Table 1-3 to correspond to the calculated monitor concentration limit  $C_r$ ,  $\mu\text{Ci}/\text{ml}$ .

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.1 Batch Release Setpoint Determination (Continued)

#### 1.4.1.1 RADWASTE DISCHARGE LINE MONITOR (2/3-7813)

The value for  $C_s$ , the concentration limit at the detector, is determined by using:

$$C_s = \frac{(RW) (F) (C_{eff})}{\frac{R_1 C_1}{MPC_{eff1}} + \frac{R_2 C_2}{MPC_{eff2}} + \dots + \frac{R_n C_n}{MPC_{effn}}} \quad (1-5)$$

where:

n = number of tanks to be released.

$C_{eff}$  = effective gamma isotopic concentration at the monitor for the tank combination to be released (equal to  $\Sigma_i C_{yi}$  for single tank releases).

$$= \frac{R_1 (\Sigma_i C_{yi})_1 + R_2 (\Sigma_i C_{yi})_2 + \dots + R_n (\Sigma_i C_{yi})_n}{R_1 + R_2 + \dots + R_n} \quad (1-6)$$

$(\Sigma_i C_{yi})_1$ ,  $(\Sigma_i C_{yi})_2$ , etc. = total gamma isotopic concentration of first tank, second tank, etc. ( $\mu\text{Ci}/\text{ml}$ ).

$R_1$ ,  $R_2$ , etc. = effluent flow rate from first tank, second tank, etc. Values of R for each tank are as follows:

Radwaste Primary Tanks  $R = 140 \text{ gpm/pump} (\times \text{ no. of pumps to be run})$

Radwaste Secondary Tanks  $R = 140 \text{ gpm/pump} (\times \text{ no. of pumps to be run})$

Primary Plant Make-up Tank  $R = 160 \text{ gpm/pump} (\times \text{ no. of pumps to be run})$

Condensate Monitor Tanks  $R = 100 \text{ gpm/pump} (\times \text{ no. of pumps to be run})$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.1.1 RADWASTE DISCHARGE LINE MONITOR (2/3-7813) (Continued)

NOTE: Since the values of R are much smaller than F, the term (F + R) in equation (1-1) may be replaced by F.

$MPC_{eff1}$ ,  $MPC_{eff2}$ , etc. = values of  $MPC_{eff}$  from equation (1-4) for first tank, second tank, etc.

$C_1$ ,  $C_2$ , etc. = values of C, total concentration, from equation (1-3) for the first tank, second tank, etc., in  $\mu Ci/ml$ .

$RW_{7813}$  and  $SG_{88-2}$ ,  $SG_{88-2}$ ,  $SG_{88-3}$ ,  $SG_{88-3}$ ,  $B_2$ ,  $B_3$ ,  $T_2$ ,  $T_3$  are administrative values used for simultaneous releases from the Radwaste Effluent discharge and any or all of the four Steam Generators as well as continuous discharges from the two Blowdown Processing Systems and the two Turbine Plant Sumps. The fractions  $RW_{7813}$  and  $SG_{88-2}$ ,  $SG_{88-2}$ ,  $SG_{88-3}$ ,  $SG_{88-3}$ ,  $B_2$ ,  $B_3$ ,  $T_2$ ,  $T_3$  will be assigned such that  $(RW_{7813} + SG_{88-2} + SG_{88-2} + SG_{88-3} + SG_{88-3} + B_2 + B_3 + T_2 + T_3) \leq 1.0$ .

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.1.1 RADIOWASTE DISCHARGE LINE MONITOR (2/3-7813) (Continued)

The 1.0 is an administrative value used to account for the potential activity released simultaneously from other release points. This assures that the total concentration from all release points to the plant discharge will not result in a release of concentrations exceeding the limits of 10 CFR 20, Appendix B, Table II, Column 2 from the Site.

NOTE: If  $C_m \leq C_{eff}$ , then no release is possible. To increase  $C_m$ , increase dilution flow F (by running more circulating water pumps in the applicable discharge structure), and/or decrease the effluent flow rates  $R_1$ ,  $R_2$ , etc., (by throttling the combined flow as measured on 2/3FI-7643, 2FIC-4055, 2FIC-4056, 3FIC-4055 or 3FIC-4056 as appropriate) and recalculate  $C_m$  using the new F, R and equation (1-5).

If there is no release associated with this monitor, the monitor setpoint should be established as close to background as practical to prevent spurious alarms and yet assure an alarm should an inadvertent release occur.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.1.2 NEUTRALIZATION SUMP/FULL FLOW CONDENSATE POLISHER DEMINERALIZER (FFCPD) SUMP DISCHARGE LINE MONITOR (batch) (2RT-7817, 3RT-7817)

The value for  $C_2$  or  $C_3$ , the concentration limit at the Unit 2 or Unit 3 detector, is determined by using:

$$C_2 \leq \frac{(B_2)(F)\Sigma_i C_{Ti}}{(R)(C/MPC_{eff})} \quad (1-7)$$

$$C_3 \leq \frac{(B_3)(F)\Sigma_i C_{Ti}}{(R)(C/MPC_{eff})} \quad (1-8)$$

where:

$C$ ,  $\Sigma_i C_{Ti}$ ,  $MPC_{eff}$  = values of  $C$ ,  $\Sigma_i C_{Ti}$ , and  $MPC_{eff}$  as defined in STEPS 1) and 2) for the Neutralization Sump/FFCPD Sumps.

$R$  = 500 gpm Neutralization Sump

$R$  = 500 gpm FFCPD High Conductivity Sump

$R$  = 600 gpm FFCPD Low Conductivity Sump

$R$  = 600 gpm FFCPD Holdup Tank

$C_2$  = instantaneous concentration at the detector (2RT-7817) in  $\mu\text{Ci}/\text{cc}$

$C_3$  = instantaneous concentration at the detector (3RT-7817) in  $\mu\text{Ci}/\text{cc}$

$B_2$  and  $B_3$  are administrative values used to account for simultaneous releases from both SONGS 2 and SONGS 3 neutralization sumps. The fractions  $B_2$  and  $B_3$  (each normally set to 0.05) will be assigned such that  $(RW_{7813} + SG_{88-2} + SG_{89-2} + SG_{88-3} + SG_{89-3} + B_2 + B_3 + T_2 + T_3) \leq 1.0$ .

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.1.2 NEUTRALIZATION SUMP/FULL FLOW CONDENSATE POLISHER DEMINERALIZER (FFCPD) SUMP DISCHARGE LINE MONITOR (batch) (2RT-7817, 3RT-7817) (Continued)

NOTE: If  $C_2$  or  $C_3 \leq \sum_i C_{yi}$ , then no release is possible. To increase  $C_2$  or  $C_3$ , increase dilution flow F (by running more pumps), and/or decrease the effluent flow rate R, (by throttling the flow as measured on 2FI-3722 and 3FI-3772), and recalculate  $C_2$  or  $C_3$  using the new F, R and equation (1-7) or (1-8).

If there is no release associated with this monitor, the monitor setpoint should be established as close to background as practical to prevent spurious alarms and yet assure an alarm should an inadvertent release occur.

### 1.4.2 Continuous Release Setpoint Determination

The waste flow (R) and monitor setpoint ( $C_s$ ) are set to meet the condition of equation (1-1) for the effective MPC ( $MPC_{eff}$ ) limit. The method by which this is accomplished is as follows:

STEP 1: The isotopic concentration for the continuous releases are obtained for each release stream (steam generator blowdown, steam generator blowdown bypass, blowdown neutralization sump and turbine plant sump) from the sum of the respective measured concentrations as determined by analysis:

$$C = \sum_i C_{yi} + C_s + C_t + C_s + C_{Fe} \quad (1-9)$$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2 Continuous Release Setpoint Determination (Continued)

where:

$C$  = total concentration ( $\mu\text{Ci}/\text{ml}$ )

$\Sigma_i C_{\gamma i}$  = total gamma activity associated with each radionuclide,  $i$ , in the weekly composite analysis for the release stream,  $\mu\text{Ci}/\text{ml}$

$C_s$  = total measured gross alpha concentration determined from the previous monthly composite analysis for the release stream,  $\mu\text{Ci}/\text{ml}$

$C_{Fe}$  = total Fe-55 concentration as determined in the previous quarterly composite sample for the release stream,  $\mu\text{Ci}/\text{ml}$

$C_t$  = total measured H-3 concentration determined from the previous monthly composite analysis for the release stream,  $\mu\text{Ci}/\text{ml}$

$C_{sr}$  = total measured concentration of Sr-89 and Sr-90 as determined from the previous quarterly composite analysis for the release stream,  $\mu\text{Ci}/\text{ml}$

STEP 2: The effective MPC ( $MPC_{eff}$ ) for each release stream (steam generator blowdown, blowdown neutralization sump, or turbine plant sump) is determined using:

$$MPC_{eff} = \frac{1}{\sum_i \left( \frac{C_{\gamma i}/C}{MPC_i} + \frac{C_s/C}{MPC_s} + \frac{C_{Fe}/C}{MPC_{Fe}} + \frac{C_t/C}{MPC_t} \right)} \quad (1-10)$$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2 Continuous Release Setpoint Determination (Continued)

STEP 3: The setpoint,  $C_s$  ( $\mu\text{Ci}/\text{ml}$ ), for each continuous release radioactivity monitor may now be specified based on the respective values of  $C$ ,  $\Sigma C_{ij}$ ,  $F$ ,  $MPC_{eff}$ , and  $R$  to provide compliance with the limits of 10CFR20, Appendix B, Table II, Column 2. The monitor setpoint, cpm, is taken from the applicable calibration constants given in Table 1-3 to correspond to the calculated monitor limit  $C_s$ ,  $\mu\text{Ci}/\text{ml}$ .

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.1 NEUTRALIZATION SUMP DISCHARGE LINE MONITORS (2RT-7817, 3RT-7817)

The value for  $C_2$  or  $C_3$ , the concentration limit at the Unit 2 or Unit 3 detector is determined by using:

$$C_2 \leq \frac{(B_2)(F)\Sigma_i C_{\gamma i}}{(R)(C/MPC_{eff})} \quad (1-11)$$

$$C_3 \leq \frac{(B_3)(F)\Sigma_i C_{\gamma i}}{(R)(C/MPC_{eff})} \quad (1-12)$$

where:

$C$ ,  $\Sigma_i C_{\gamma i}$ ,  $MPC_{eff}$  = values of  $C$ ,  $\Sigma_i C_{\gamma i}$  and  $MPC_{eff}$  as defined in STEPS 1 and 2 for the Steam Generator blowdown/BPS neutralization sump.

$R$  = effluent flow rate at the radiation monitor as defined in STEP 2 (maximum of 500 gpm).

$C_2$  = instantaneous concentration at the Unit 2 detector (2RT-7817) in  $\mu\text{Ci}/\text{cc}$

$C_3$  = instantaneous concentration at the Unit 3 detector (3RT-7817) in  $\mu\text{Ci}/\text{cc}$

$B_2$  and  $B_3$  are administrative values used to account for simultaneous releases from both SONGS 2 and SONGS 3 neutralization sums. The fractions  $B_2$  and  $B_3$  will be assigned such that  $(RW_{7813} + SG_{88-2} + SG_{89-2} + SG_{88-3} + SG_{89-3} + B_2 + B_3 + T_2 + T_3) \leq 1.0$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.1 NEUTRALIZATION SUMP DISCHARGE LINE MONITOR (2RT-7817, 3RT-7817) (Continued)

NOTE: If  $C_2$  or  $C_3 \leq \Sigma C_{yi}$ , then no release is possible. To increase  $C_2$  or  $C_3$ , increase dilution flow F (by running more circulating water pumps), and/or decrease the effluent flow rate R, (by throttling the flow as measured on 2FI-3722 and 3FI-3772), and recalculate  $C_2$  or  $C_3$  using the new F, R and equation (1-11) or (1-12).

If there is no release associated with this monitor, the monitor setpoint should be established as close to background as practical to prevent spurious alarms and yet assure an alarm should an inadvertent release occur.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.2 STEAM GENERATOR BLOWDOWN BYPASS DISCHARGE LINE MONITORS (2RT-6753, 2RT-6759, 3RT-6753, 3RT-6759)

The value for  $C_{59-2}$ ,  $C_{53-2}$ ,  $C_{59-3}$  or  $C_{53-3}$ , the concentration limit at the Unit 2 or Unit 3 detectors, is determined by using:

$$C_{59-2} \leq \frac{(SG_{BS-2})(F)\Sigma_i C_{\gamma i}}{(R)(C/MPC_{eff})} \quad (1-13)$$

$$C_{53-2} \leq \frac{(SG_{BS-2})(F)\Sigma_i C_{\gamma i}}{(R)(C/MPC_{eff})} \quad (1-14)$$

$$C_{59-3} \leq \frac{(SG_{BS-3})(F)\Sigma_i C_{\gamma i}}{(R)(C/MPC_{eff})} \quad (1-15)$$

$$C_{53-3} \leq \frac{(SG_{BS-3})(F)\Sigma_i C_{\gamma i}}{(R)(C/MPC_{eff})} \quad (1-16)$$

where:

$C$ ,  $\Sigma_i C_{\gamma i}$ ,  $MPC_{eff}$  = values of  $C$ ,  $\Sigma_i C_{\gamma i}$  and  $MPC_{eff}$  (as defined in STEPS 1 and 2 above) for the steam generator blowdown bypass.

$R$  = maximum blowdown bypass effluent flowrate per steam generator, 200 gpm.

$C_{59-2}$  = instantaneous concentration at the Unit 2 detector (2RT-6759) in  $\mu\text{Ci}/\text{ml}$

$C_{53-2}$  = instantaneous concentration at the Unit 2 detector (2RT-6753) in  $\mu\text{Ci}/\text{ml}$

$C_{59-3}$  = instantaneous concentration at the Unit 3 detector (3RT-6759) in  $\mu\text{Ci}/\text{ml}$

$C_{53-3}$  = instantaneous concentration at the Unit 3 detector (3RT-6753) in  $\mu\text{Ci}/\text{ml}$

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.2 STEAM GENERATOR BLOWDOWN BYPASS DISCHARGE LINE MONITORS (2RT-6753, 2RT-6759, 3RT-6753, 3RT-6759) (Continued)

RW<sub>7813</sub> and SG<sub>88-2</sub>, SG<sub>89-2</sub>, SG<sub>88-3</sub>, SG<sub>89-3</sub>, B<sub>2</sub>, B<sub>3</sub>, T<sub>2</sub>, T<sub>3</sub> are administrative values used for simultaneous releases from the Radwaste Effluent discharge and any or all of the four Steam Generators as well as continuous discharges from the two Blowdown Processing Systems and the two Turbine Plant Sumps. The fractions RW<sub>7813</sub> and SG<sub>88-2</sub>, SG<sub>89-2</sub>, SG<sub>88-3</sub>, SG<sub>89-3</sub>, B<sub>2</sub>, B<sub>3</sub>, T<sub>2</sub>, T<sub>3</sub> will be assigned such that (RW<sub>7813</sub> + SG<sub>88-2</sub> + SG<sub>89-2</sub> + SG<sub>88-3</sub> + SG<sub>89-3</sub> B<sub>2</sub> + B<sub>3</sub> + T<sub>2</sub> + T<sub>3</sub>) ≤ 1.0.

The 1.0 is an administrative value used to account for the potential activity released simultaneously from other release points. This assures that the total concentration from all release points to the plant discharge will not result in a release of concentrations exceeding the limits of 10 CFR 20, Appendix B, Table II, Column 2 from the site.

NOTE: If C<sub>59-2</sub>, C<sub>53-2</sub>, C<sub>59-3</sub>, or C<sub>53-3</sub> ≤ I<sub>1</sub>C<sub>1</sub> (for the respective steam generator), then no release is possible. To increase C<sub>59-2</sub>, C<sub>53-2</sub>, C<sub>59-3</sub> or C<sub>53-3</sub>, increase dilution flow F (by running more circulating water pumps), and/or decrease the effluent flow rate R (by throttling the flow as measured on 2FIC-4055, 2FIC-4056, 3FIC-4055, 3FIC-4056 or 2/3FI-7643, as appropriate) and recalculate C<sub>59-2</sub>, C<sub>53-2</sub>, C<sub>59-3</sub> or C<sub>53-3</sub> using the new values of F, R and equation (1-13), (1-14), (1-15) or (1-16).

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.2 STEAM GENERATOR BLOWDOWN BYPASS DISCHARGE LINE MONITORS (2RT-6753, 2RT-6759, 3RT-6753, 3RT-6759) (Continued)

If there is no release associated with this monitor, the monitor setpoint should be established as close to background as practical to prevent spurious alarms and yet assure an alarm should an inadvertent release occur.

### 1.4.2.3 TURBINE PLANT SUMP MONITORS (2RT-7821, 3RT-7821)

The value for  $C_2$  or  $C_3$  (the concentration limit at the Unit 2 or Unit 3 detector) is determined by using:

$$C_2 \leq \frac{(T_2)(F)\Sigma_i C_{Yi}}{(R)(C/MPC_{eff})} \quad (1-17)$$

$$C_3 \leq \frac{(T_3)(F)\Sigma_i C_{Yi}}{(R)(C/MPC_{eff})} \quad (1-18)$$

where:

$C$ ,  $\Sigma_i C_{Yi}$ ,  $MPC_{eff}$  = values of  $C$ ,  $\Sigma_i C_{Yi}$  and  $MPC_{eff}$  (as defined in STEPS 1 and 2 above) for the turbine plant sump

$R$  = 100 gpm/pump (x no. sump pumps to be run) Unit 2 | A  
50 gpm/pump (x no. sump pumps to be run) Unit 3

$C_2$  = instantaneous concentration at the Unit 2 detector (2RT-7821),  $\mu\text{Ci}/\text{ml}$ .

$C_3$  = instantaneous concentration at the Unit 3 detector (3RT-7821),  $\mu\text{Ci}/\text{ml}$ .

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.3 TURBINE PLANT SUMP MONITORS (2RT-7821, 3RT-7821) (Continued)

$T_2$  and  $T_3$  are administrative values used to account for simultaneous releases from both SONGS 2 and SONGS 3 turbine plant sums. The fractions  $T_2$  and  $T_3$  will be assigned such that  $(RW_{7821} + SG_{88-2} + SG_{89-2} + SG_{88-3} + SG_{89-3} B_2 + B_3 + T_2 + T_3) \leq 1.0$ .

NOTE: If  $C_2$  or  $C_3 \leq \Sigma C_i$ , (for the respective sump), then no release is possible. To increase  $C_2$  or  $C_3$ , increase the dilution flow F (by running more circulating water pumps) and recalculate  $C_2$  or  $C_3$  using the new value of F and equation (1-17) or (1-18).

Use of a temporary discharge path from the Turbine Plant Sump is allowed providing the radiation monitor, 7821, in service and the normal discharge path is used concurrently. Temporary pumps facilitate faster discharge when draining the condenser to the outfall via this pathway. The following conditions shall be met:

- a. The release permit shall account for the entire volume of water discharged from the Turbine Plant Sump.
- b. The alarm setpoint for the monitor shall be adjusted to take into account the entire discharge flow through both the normal and temporary paths.
- c. Procedures shall require the immediate termination of the discharge via the temporary path if the monitor on the normal path alarms.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.4.2.3 TURBINE PLANT SUMP MONITORS (2RT-7821, 3RT-7821) (Continued)

If there is no release associated with this monitor, the monitor setpoint should be established as close to background as practical to prevent spurious alarms and yet assure an alarm should an inadvertent release occur.

Table 1-3  
 Liquid Effluent Radiation Monitor  
 Calibration Constants  
 ( $\mu\text{Ci}/\text{cc}/\text{cpm}$ )

MONITOR	Co-60	Ba-133	Cs-137
ZRT-6753		1.74E-8	1.91E-8
ZRT-6759		1.74E-8	1.93E-8
3RT-6753		1.66E-8	1.93E-8
3RT-6759		1.79E-8	1.94E-8
2/3RT-7813	2.12E-9	3.59E-9	5.20E-9
ZRT-7817	2.43E-9	3.40E-9	4.89E-9
ZRT-7821	2.14E-9	3.63E-9	5.21E-9
3RT-7817	2.33E-9	3.22E-9	4.73E-9
3RT-7821	2.13E-9	3.64E-9	5.20E-9

(a) This table provides typical ( $\pm 20\%$ ) calibration constants for the liquid effluent radiation monitors.

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.5 Dose Calculation for Liquid Effluents

The liquid releases considered in the following dose calculations are described in Section 1.4. The dose commitment to an individual from radioactive materials in liquid effluents released to unrestricted areas are calculated for the purpose of implementing Specification 1.2.1 using the following expression.

$$D_i = \sum_i [A_{i,i} \sum_j (\Delta t_j C_{i,j} F_j)] \quad (1-19)$$

where:

- $A_{i,i}$  = Site-related adult ingestion dose commitment factor to the total body or an organ,  $\tau$ , for each identified principal gamma and beta emitter,  $i$ , from Table 1-4 in mrem/hr per  $\mu\text{Ci}/\text{ml}$ .
- $C_{i,j}$  = average concentration of radionuclide,  $i$ , in the undiluted liquid effluent during time period,  $\Delta t_j$ , in  $\mu\text{Ci}/\text{ml}$ .
- $D_i$  = dose commitment to the total body or an organ,  $\tau$ , from the liquid effluent for the time period,  $\Delta t_j$ , in mrem.
- $F_j$  = near field average dilution factor for  $C_{i,j}$  during the time period,  $\Delta t_j$ . This factor is the ratio of the maximum undiluted liquid waste flow during time period,  $\Delta t_j$ , to the average flow from the site discharge structure to unrestricted receiving waters,  
or maximum liquid radioactive waste flow  
discharge structure exit flow
- $\Delta t_j$  = length of the  $j^{\text{th}}$  time period over which  $C_{i,j}$  and  $F_j$  are averaged for all liquid releases, in hours.

TABLE 1-4  
 DOSE COMMITMENT FACTORS\*, A<sub>i</sub>,  
 (mrem/hr per  $\mu\text{Ci}/\text{ml}$ )

Radio-Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
H-3		2.82E-1	2.82E-1	2.82E-1	2.82E-1	2.82E-1	2.82E-1
Na-24	4.57E-1	4.57E-1	4.57E-1	4.57E-1	4.57E-1	4.57E-1	4.57E-1
Cr-51			5.58E+0	3.34E+0	1.23E+0	7.40E+0	1.40E+3
Mn-54		7.06E+3	1.35E+3		2.10E+3		2.16E+4
Mn-56		1.78E+2	3.15E+1		2.26E+2		5.67E+3
Fe-55	5.11E+4	3.53E+4	8.23E+3			1.97E+4	2.03E+4
Fe-59	8.06E+4	1.90E+5	7.27E+4			5.30E+4	6.32E+5
Co-57		1.42E+2	2.38E+2				3.59E+3
Co-58		6.03E+2	1.35E+3				1.22E+4
Co-60		1.73E+3	3.82E+3				3.25E+4
Cu-64		2.14E+2	1.01E+2		5.40E+2		1.83E+4
Zn-65	1.61E+5	5.13E+5	2.32E+5		3.43E+5		3.23E+5
Br-84			9.39E-2				7.37E-7
Rb-88		1.79E+0	9.49E-1				2.47E-11
Sr-89	4.99E+3		1.43E+2				8.00E+2
Sr-90	1.23E+5		3.01E+4				3.55E+3
Sr-91	9.18E+1		3.71E+0				4.37E+2
Sr-92	3.48E+1		1.51E+0				6.90E+2
Y-90	6.06E+0		1.53E-1				6.42E+4
Y-91m	5.73E-2		2.22E-3				1.68E-1
Y-92	5.32E-1		1.56E-2				9.32E+3
Zr-95	1.59E+1	5.11E+0	3.46E+0		8.02E+0		1.62E+4
Zr-97	8.81E-1	1.78E-1	8.13E-2		2.68E-1		5.51E+4
Nb-95	1.84E+0	1.03E+0	5.51E-1		1.01E+0		6.22E+3
Nb-95m	1.84E+0	1.03E+0	5.51E-1		1.01E+0		6.22E+3
Nb-97	1.55E-2	3.91E-3	1.43E-3		4.56E-3		1.44E+1
Mo-99		1.28E+2	2.43E+1		2.89E+2		2.96E+2
Tc-99m	1.30E+2	3.66E-2	4.66E-1		5.56E-1	1.79E-2	2.17E+1
Ru-103	1.07E+2		4.60E+1		4.07E+2		1.25E+4
Ru-106	1.59E+3		2.01E+2		3.06E+3		1.03E+5
Ag-110m	1.42E+3	1.32E+3	7.82E+2		2.59E+3		5.37E+5
Sn-113							2.26E+5
Sn-117m							2.26E+5
Sb-124	2.76E+2	5.22E+0	1.09E+2	6.70E-1		2.15E+2	7.84E+3
Sb-125	1.77E+2	1.97E+0	4.20E+1	1.79E-1		1.36E+2	1.94E+3
Te-129m	9.31E+2	3.47E+2	1.47E+2	3.20E+2	3.89E+3		4.69E+3
Te-132	2.04E+2	1.77E+2	1.24E+2	1.46E+2	1.27E+3		6.24E+3
I-131	2.18E+2	3.12E+2	1.79E+2	1.02E+5	5.35E+2		8.23E+1
I-132	1.06E+1	2.85E+1	9.96E+0	9.96E+2	4.54E+1		5.35E+0
I-133	7.45E+1	1.30E+2	3.95E+1	1.90E+4	2.26E+2		1.16E+2
I-134	5.56E+0	1.51E+1	5.40E+0	2.62E+2	2.40E+1		1.32E-2
I-135	2.32E+1	6.08E+1	2.24E+1	4.01E+3	9.75E+1		6.87E+1

NOTE: where no value is given, no data are available.

\*Source: Reg. Guide 1.109, Table E-11, Table A-1  
 USNRC NUREG-0472, Table 4

Methodology: USNRC NUREG-0133, Section 4.3.1

TABLE 1-4  
 DOSE COMMITMENT FACTORS\*, A<sub>i</sub>,  
 (mrem/hr per  $\mu\text{Ci}/\text{ml}$ )

Radio-Nuclide	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
Cs-134	6.84E+3	1.63E+4	1.33E+4		5.27E+3	1.75E+3	2.85E+2
Cs-136	7.16E+2	2.83E+3	2.04E+3		1.57E+3	2.16E+2	3.21E+2
Cs-137	8.77E+3	1.20E+4	7.85E+3		4.07E+3	1.35E+3	2.32E+2
Cs-138	6.07E+0	1.20E+1	5.94E+0		8.81E+0	8.70E-1	5.12E-5
Ba-139	7.85E+0	5.59E-3	2.30E-1		5.23E-3	3.17E-3	1.39E+1
Ba-140	1.64E+3	2.06E+0	1.08E+2		7.02E-1	1.18E+0	3.38E+3
La-140	1.57E+0	7.94E-1	2.10E-1				5.83E+4
Ce-141	3.43E+0	2.32E+0	2.63E-1		1.08E+0		8.86E+3
Ce-143	6.04E-1	4.46E+2	4.94E-2		1.97E-1		1.67E+4
Ce-144	1.79E+2	7.47E+1	9.59E+0		4.43E+1		6.04E+4
Nd-147	3.96E+0	4.58E+0	2.74E-1		2.68E+0		2.20E+4
W-187	9.16E+0	7.66E+0	2.68E+0				2.51E+3
Hg-239	3.53E-2	3.47E-3	1.91E-3		1.08E-2		7.11E+2

NOTE: where no value is given, no data are available.

\*Source: Reg. Guide 1.109, Table E-11, Table A-1  
 USNRC NUREG-0472, Table 4

Methodology: USNRC NUREG-0133, Section 4.3.1

## 1.0 LIQUID EFFLUENTS (Continued)

### 1.6 Representative Sampling

Prior to sampling of a batch release, each batch shall be thoroughly mixed to assure representative sampling in accordance with the requirements of Regulatory Guide 1.21 and NUREG-0800, Section 11.5. The methodology for mixing and sampling is described in S0123-III-5.11.23, "Units 2/3 Liquid Effluent Release Permit" and S0123-III-5.2.23, "Units 2/3 Liquid Effluent Sample Collection".

## 2.0 GASEOUS EFFLUENTS

### 2.1 DOSE RATE

#### SPECIFICATION

2.1.1 The dose rate in unrestricted areas due to radioactive materials released in gaseous effluents from the site (see Figure 2-2) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin, and
- b. For all radiciodines, tritium and for all radioactive materials in particulate form with half lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times

#### ACTION:

- a. With dose rate(s) exceeding the above limits, immediately decrease the release rate to within the above limit(s).

#### SURVEILLANCE REQUIREMENTS

- .1 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with Section 2.7.
- .2 The dose rate due to radiciodines, tritium and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with Section 2.7 by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 2-1.

TABLE 2-1  
RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

Gaseous Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection ( $\mu\text{Ci}/\text{ml}$ ) <sup>a</sup>
Batch Waste Gas Decay Tank	P Each Tank Grab Sample	P Each Tank	Principal Gamma Emitters <sup>b</sup>	$1 \times 10^{-4}$
Incinerated Oil <sup>c</sup>	Each Batch <sup>d</sup> Grab Sample	Each Batch <sup>d</sup>	Principal Gamma Emitters <sup>b</sup>	$5 \times 10^{-7}$
Continuous	*	*	Principal Gamma Emitters <sup>b</sup>	$1 \times 10^{-4}$
	*	*	Tritium	$1 \times 10^{-6}$
Continuous <sup>e</sup> Sampler	W <sup>f</sup> Charcoal Sample	I-131		$1 \times 10^{-12}$
Continuous <sup>e</sup> Sampler	W <sup>f</sup> Particulate Sample	I-133		$1 \times 10^{-10}$
Continuous <sup>e</sup> Sampler	M Composite Particulate Sample	Principal Gamma Emitters <sup>b</sup> (I-131 and Others)		$1 \times 10^{-11}$
Continuous <sup>e</sup> Sampler	Q Composite Particulate Sample	Gross Alpha		$1 \times 10^{-11}$
Continuous <sup>e</sup> Monitor	Noble Gas Monitor	Sr-89 and Sr-90		$1 \times 10^{-11}$
		Noble Gases Gross Beta or Gamma		$1 \times 10^{-6}$

\*Sampling frequencies for noble gases and tritium are:

CONTINUOUS PATHWAYS: Containment Purge - 42" : Each Purge<sup>b,c</sup>  
 Containment Purge - 8" : Monthly Grab<sup>b</sup>  
 Condenser Air Ejector : Monthly Grab<sup>b</sup>  
 Plant Vent Stack : Weekly Grab<sup>b,e</sup>

TABLE 2-1 (Continued)

TABLE NOTATION

- a. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$\text{LLD} = \frac{4.66 s_b}{E + V + 2.22 \times 10^6 + Y + \exp(-\lambda \Delta t)}$$

where:

LLD is the "a priori" lower limit of detection as defined above (as microcuries per unit mass or volume).

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

$2.22 \times 10^6$  is the number of transformations per minute per microcurie,

Y is the fractional radiochemical yield (when applicable),

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  is the elapsed time between midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of  $s_b$  used in the calculation of the LLD for a particular measurement system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance.

In calculating the LLD for a radionuclide determined by gamma ray spectrometry, the background should include the typical contributions of other radionuclides normally present in the samples. Typical values of E, V, Y and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of the measurement system and not as a a posteriori (after the fact) limit for a particular measurement.\*

\*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" *Anal. Chem.* 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotopic Counting Techniques," Atlantic Richfield Hanford Company Report ARH-2532 (June 22, 1972).

TABLE 2-1 (Continued)

TABLE NOTATION

- b. Analyses shall also be performed following shutdown, startup, or a THERMAL POWER change exceeding 15 percent of the RATED THERMAL POWER within a 1-hour period. This requirement does not apply if: (1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the reactor coolant has not increased more than a factor of 3; and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of 3.
- c. Tritium grab samples shall be taken at least once per 24 hours when the refueling canal is flooded.
- d. Samples shall be changed at least once per 7 days and analyses shall be completed within 48 hours after changing (or after removal from sampler). Sampling shall also be performed at least once per 24 hours for at least 7 days following each shutdown, startup, or a THERMAL POWER change exceeding 15 percent of RATED THERMAL POWER in 1 hour and analyses shall be completed within 48 hours of changing. This requirement does not apply if: (1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the reactor coolant has not increased more than a factor of 3; and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of 3. When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10.
- e. Tritium grab samples shall be taken at least one per 7 days from the ventilation exhaust from the spent fuel pool area, whenever spent fuel is in the spent fuel pool.
- f. The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Specifications 2.1, 2.2, 2.3.
- g. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emissions and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Ce-141 and Ce-144 for particulate emissions. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported.
- h. Incinerated oil may be discharged at points other than the plant vent stack. Release shall be accounted for based on pre-release grab sample data.
- i. Samples for incinerated oil releases shall be collected from representative samples of filtered oil in liquid form.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.2 DOSE - NOBLE GASES

#### SPECIFICATION

2.2.1 The air dose due to noble gases released in gaseous effluents, from each reactor unit, from the site (see Figure 2-2) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation and,
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABILITY: At all times

#### ACTION:

- a. With calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, in lieu of any other report required by Technical Specification 6.9.1, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions taken to reduce releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with Specification 2.2.1.

#### SURVEILLANCE REQUIREMENTS

- .1 Dose Calculations Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section 2.8 at least once per 31 days.

2.0 GASEOUS EFFLUENTS (Continued)

2.3 DOSE - RADIOIODINES, RADIOACTIVE MATERIALS IN PARTICULATE FORM AND TRITIUM

SPECIFICATION

2.3.1 The dose to an individual from tritium, radioiodines and radioactive materials in particulate form with half-lives greater than 8 days in gaseous effluents released, from each reactor unit, from the Site (see Figure 2-2) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
- b. During any calendar year: Less than or equal to 15 mrem to any organ.
- c. Less than 0.1% of the limits of 2.3.1 (a) and (b) as a result of burning contaminated oil.

APPLICABILITY: At all times

ACTION:

- a. With the calculated dose from the release of tritium, radiciodines, and radioactive materials in particulate form, with half lives greater than 8 days, in gaseous effluents exceeding any of the above limits, in lieu of any other report required by Technical Specification 6.9.1, prepare and submit to the Commission within 30 days pursuant to Technical Specification 6.9.2 a Special Report which identifies the cause(s) for exceeding the limit and defines the corrective actions taken to reduce releases and the proposed actions to be taken to assure that subsequent releases will be in compliance with Specification 2.3.i.

SURVEILLANCE REQUIREMENTS

- 1 Dose Calculations Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section 2.8 at least once per 31 days.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.4 GASEOUS RADWASTE TREATMENT

#### SPECIFICATION

2.4.1 The GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM shall be operable. The appropriate portions of the GASEOUS RADWASTE TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected gaseous effluent air doses due to gaseous effluent releases from the site (see Figure 2-2), when averaged over 31 days, would exceed 0.2 mrad for gamma radiation and 0.4 mrad for beta radiation. The appropriate portions of the VENTILATION EXHAUST TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected doses due to gaseous effluent releases from the site (see Figure 2-2) when averaged over 31 days would exceed 0.3 mrem to any organ.\*

APPLICABILITY: At all times

#### ACTION:

- a. With gaseous waste being discharged without treatment and in excess of the above limits, in lieu of any other report required by Technical Specification 6.9.1, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which includes the following information:
  1. Explanation of why gaseous radwaste was being discharged without treatment, identification of the inoperable equipment or subsystems and the reason for inoperability,
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.

#### SURVEILLANCE REQUIREMENTS

- .1 Doses due to gaseous releases from the site shall be projected at least once per 31 days, in accordance with Section 3.2.

\*These doses are per reactor unit.

2.0 GASEOUS EFFLUENTS (Continued)

2.4 GASEOUS RADWASTE TREATMENT (Continued)

SURVEILLANCE REQUIREMENTS (Continued)

- .2 During plant operation (Modes 1-4), the applicable portions of the GASEOUS RADWASTE TREATMENT SYSTEM and VENTILATION EXHAUST TREATMENT SYSTEM shall be demonstrated OPERABLE by operating the GASEOUS RADWASTE TREATMENT SYSTEM equipment and VENTILATION EXHAUST TREATMENT SYSTEM equipment for at least 15 minutes, at least once per 92 days unless the appropriate system has been utilized to process radioactive gaseous effluents during the previous 92 days.
- .3 In plant shut-down (Mode 5, 6) the applicable portions of the GASEOUS RADWASTE TREATMENT SYSTEM and VENTILATION EXHAUST TREATMENT SYSTEM shall be demonstrated OPERABLE by operating the GASEOUS RADWASTE TREATMENT SYSTEM equipment and VENTILATION EXHAUST TREATMENT SYSTEM equipment for at least 15-minutes prior to processing gases unless the appropriate gaseous radwaste system has been utilized to process radioactive gaseous effluents during the previous 92 days.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.5 TOTAL DOSE

#### SPECIFICATION

2.5.1 The dose or dose commitment to any member of the public, due to releases of radioactivity and radiation, from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the total body or any organ (except the thyroid, which shall be limited to less than or equal to 75 mrem) over 12 consecutive months.


APPLICABILITY: At all times


#### ACTION:

- a. With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Specifications 1.2.1.a, 1.2.1.b, 2.2.1.a, 2.2.1.b, 2.3.1.a, or 2.3.1.b in lieu of any other report required by Specification 6.9.1, prepare and submit a Special Report to the Director, Nuclear Reactor Regulation, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555, within 30 days, which defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the limits of Specification 2.5.1. This Special Report shall include an analysis which estimates the radiation exposure (dose) to a member of the public from uranium fuel cycle sources (including all effluent pathways and direct radiation) for a 12 consecutive month period that includes the release(s) covered by this report. If the estimated dose(s) exceeds the limits of Specification 2.5.1, and if the release condition resulting in violation of 40 CFR 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190 and including the specified information of paragraph 190.11(b). Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete. The variance only relates to the limits of 40 CFR 190, and does not apply in any way to the requirements for dose limitation of 10 CFR Part 20, as addressed elsewhere in this ODCM.

#### SURVEILLANCE REQUIREMENTS


- .1 Dose Calculations Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with surveillance 1.2.1.1, 2.2.1.1, and 2.3.1.1.

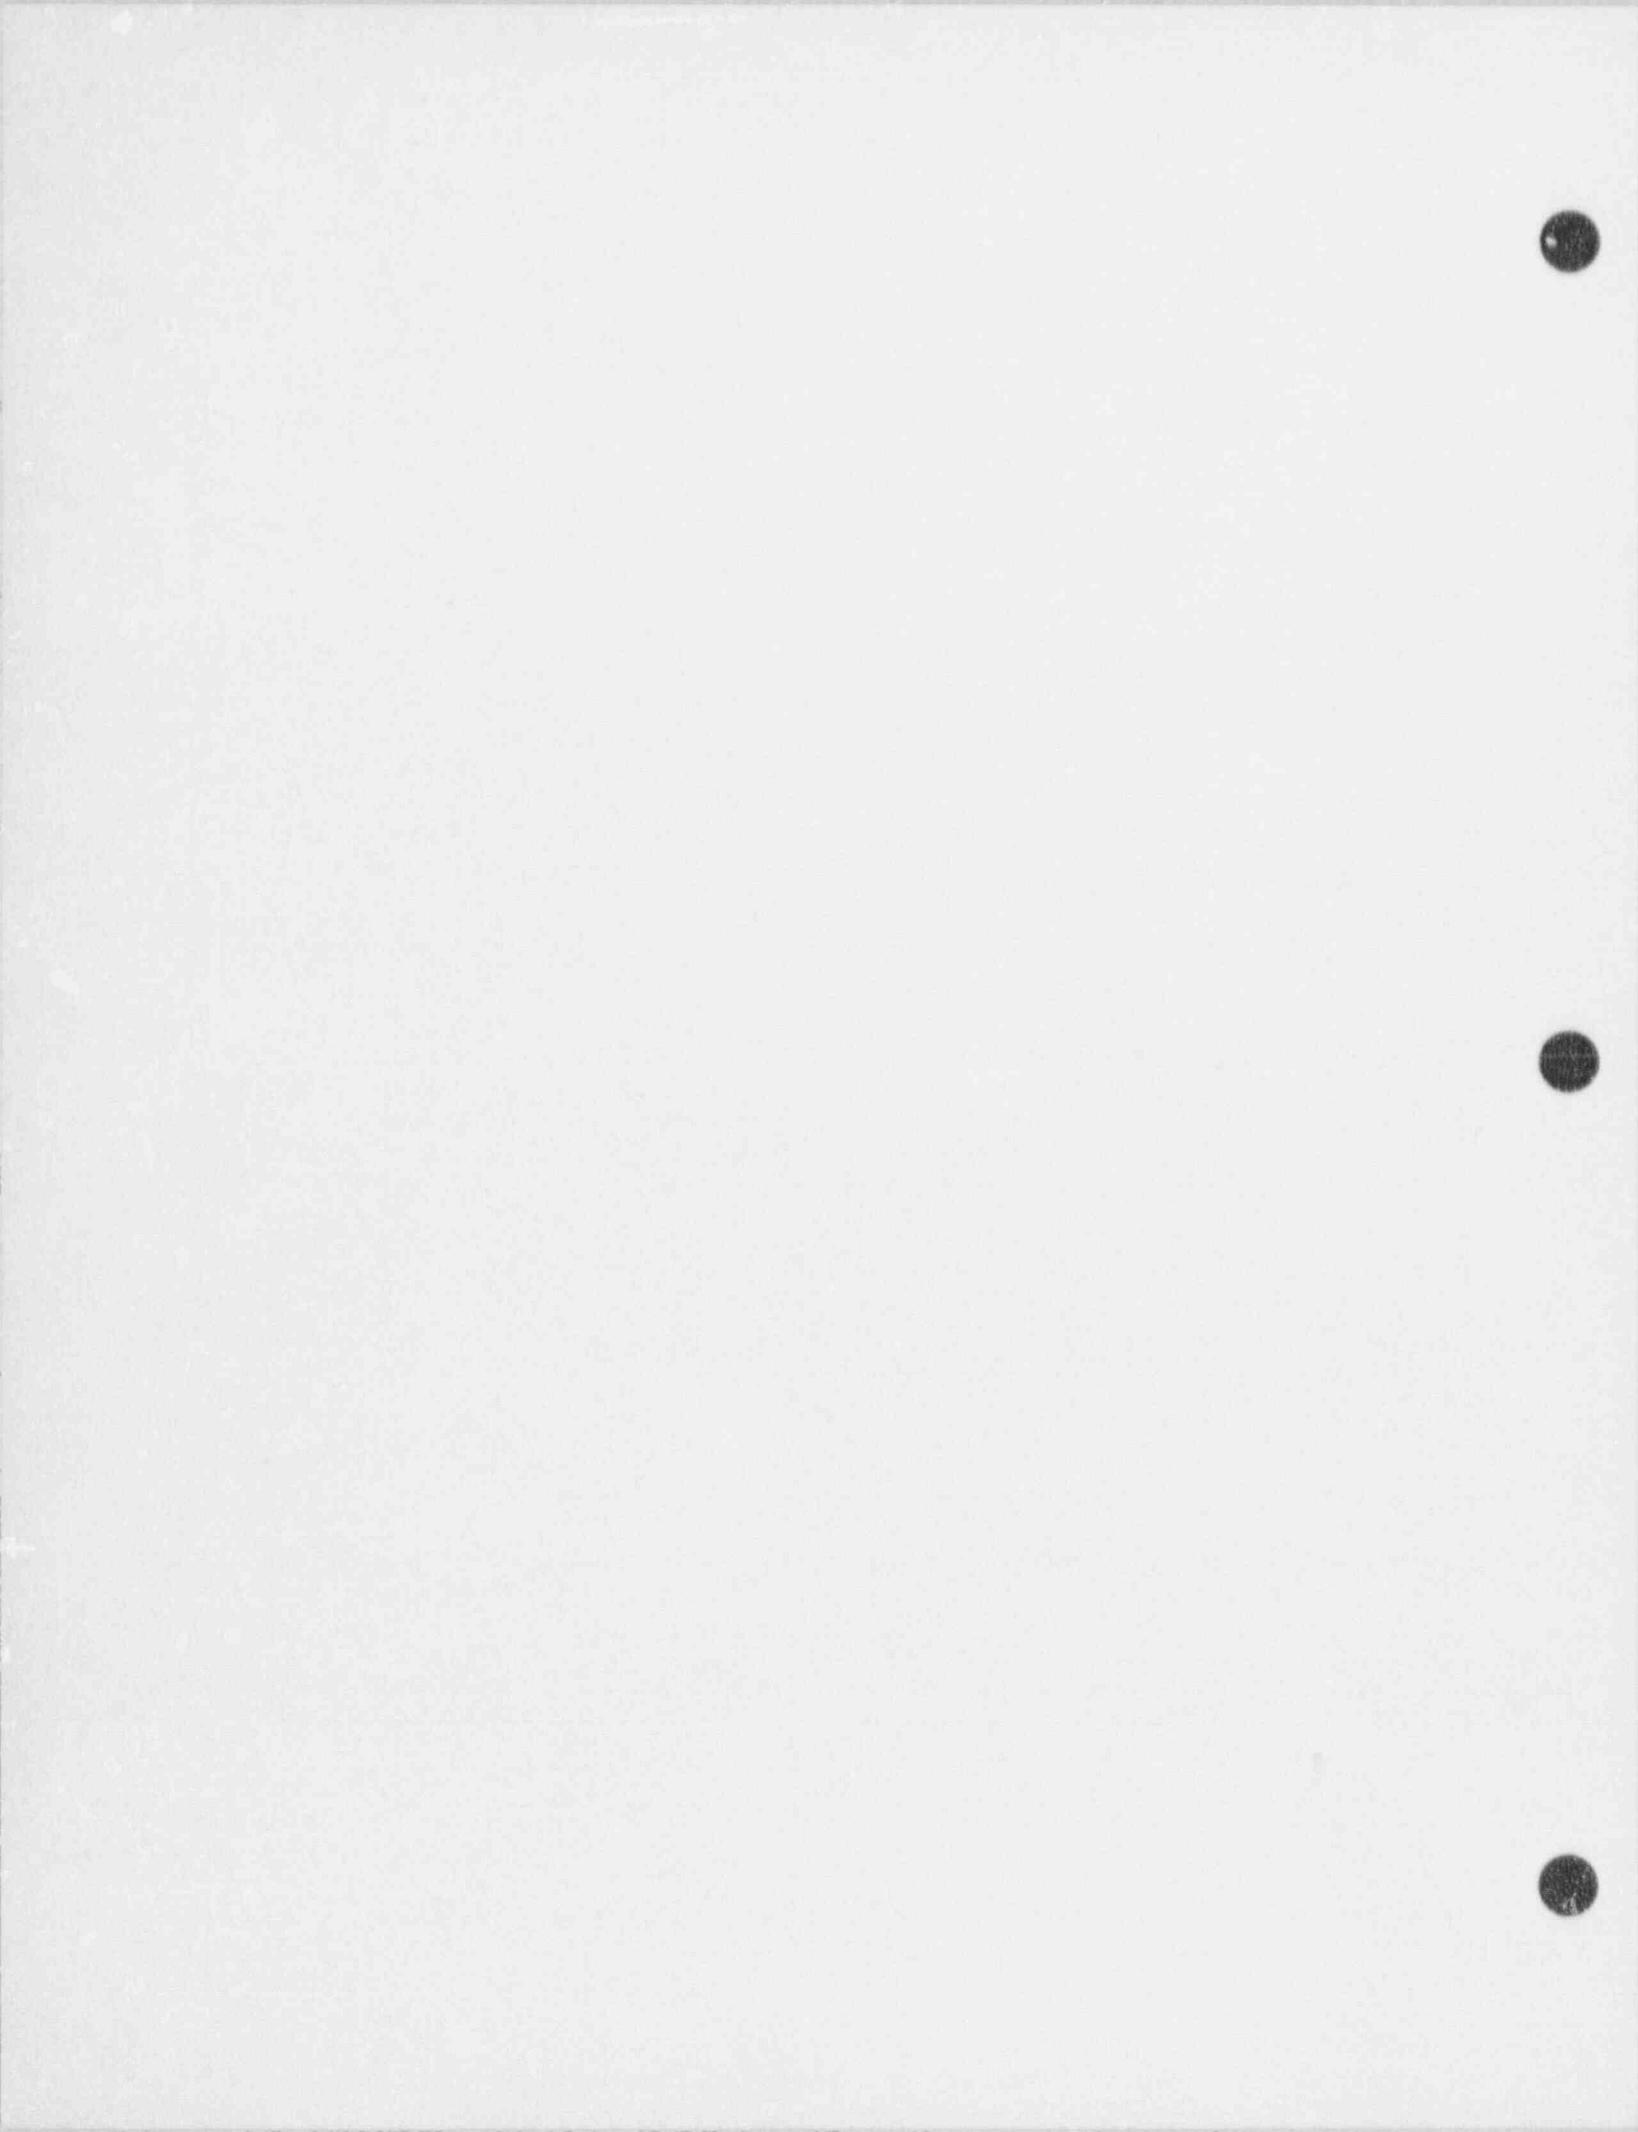

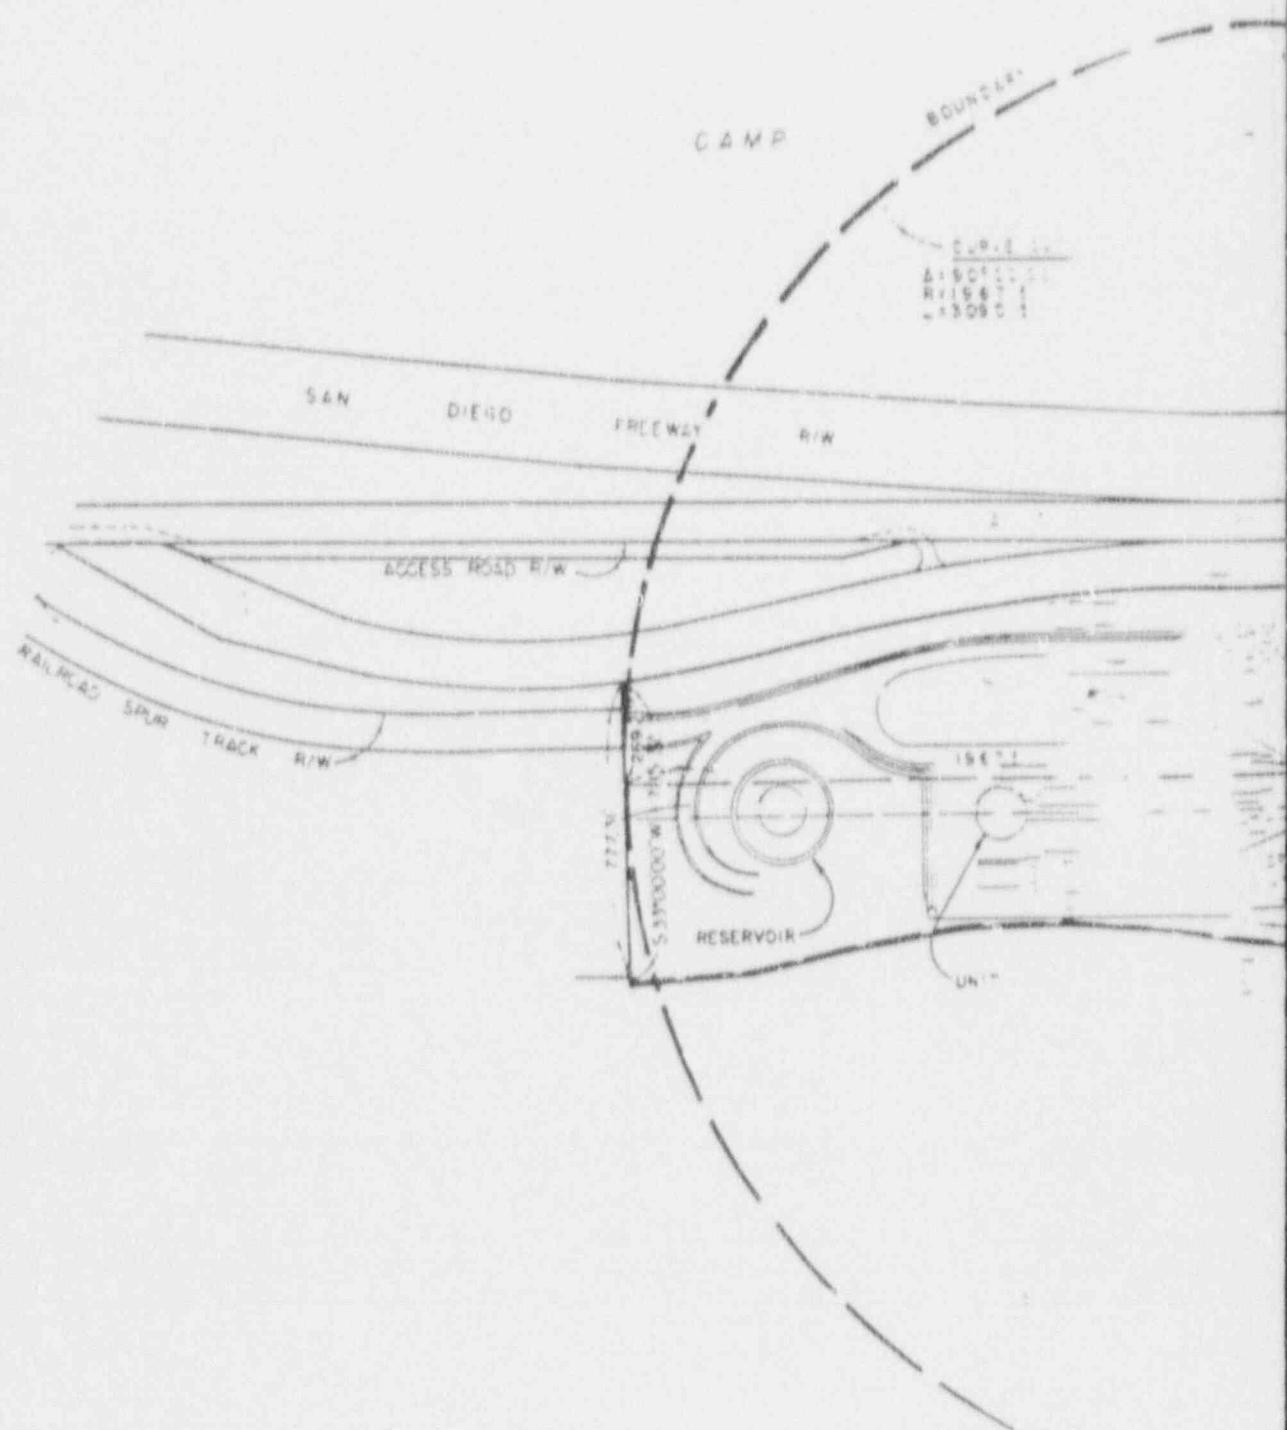

SITE BOUNDARY FOR GASEOUS EFFLUENTS

FIGURE 2-2

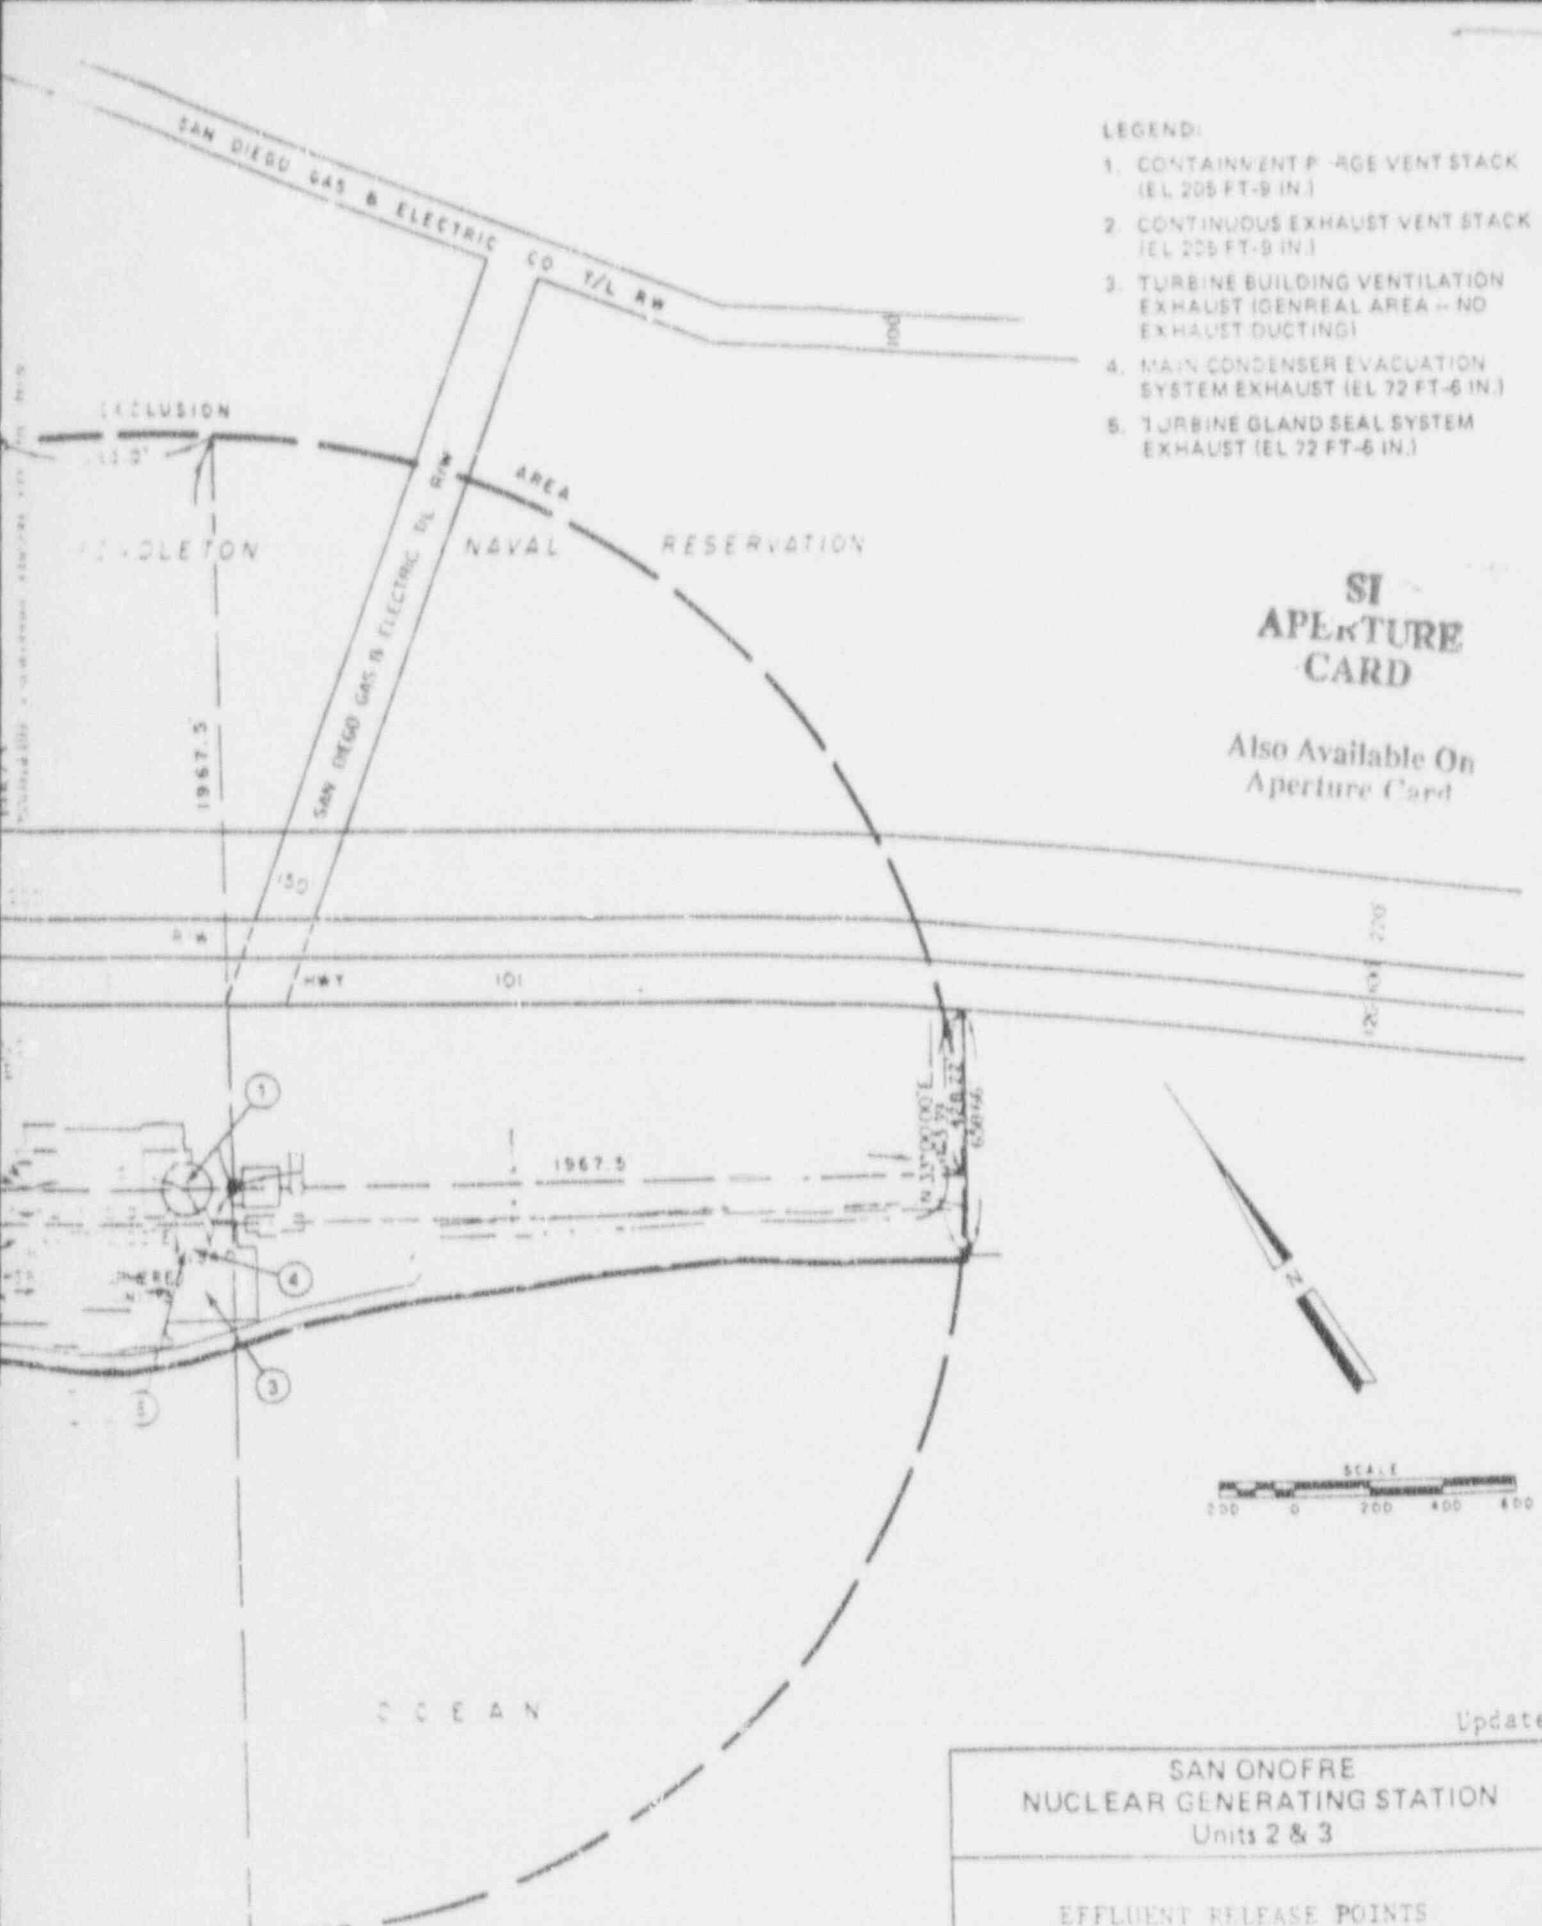

Updated

SAN ONOFRE NUCLEAR GENERATING STATION	
Units 2 & 3	
EFFLUENT RELEASE POINTS	

Figure 2.1-5

9203240102-01

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6 Methods of Calculation for Gaseous Effluent Monitor Setpoints

Administrative values are used to reduce each setpoint to account for the potential activity in other releases. These administrative values shall be periodically reviewed based on actual release data and revised as required.

#### 2.6.1 PLANT VENT STACK - 2/3RT-7808, 2RT-7865-1, 3RT-7865-1

##### 2.6.1.1 2/3RT-7808 - Plant Vent Stack Monitor

For the purpose of implementation of Specification 2.1.1, the alarm setpoint level for noble gas monitors is based on the gaseous effluent flow rate and the meteorological dispersion factor.

#### Total Body

The concentration at the detector corresponding to a 500 mrem/yr total body dose rate at the exclusion area boundary is determined by: (2-1)

$$C_{det} = \frac{(0.38) \left( 2120 \frac{cfm}{m^3/sec} \right) (500 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( K_i, \frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3} \right) \left( \frac{C_i}{C_{tot}} \right) \right]}$$

where:

$C_{det}$  = the instantaneous concentration at the detector,  
 $\mu\text{Ci}/\text{cc}$

0.38 = an administrative value used to account for potential activity from other gaseous release pathways

## 2.0 GASEOUS EFFLUENTS (Continued)

2.6.1 PLANT VENT STACK - 2/3RT-7808, 2RT-7865-1, 3RT-7865-1  
(Continued)

$K_i$	=	total body dose conversion factor from Table 2-4 for the $i^{\text{th}}$ gamma emitting noble gas, mrem/yr per $\mu\text{Ci}/\text{m}^3$
$C_i$	=	concentration of the $i^{\text{th}}$ noble gas as determined by sample analysis, $\mu\text{Ci}/\text{cc}$
$C_{\text{tot}}$	=	total concentration of noble gases as determined by sample analysis, $\mu\text{Ci}/\text{cc} = \Sigma C_i$
Flow Rate	=	plant vent flow rate, cfm
	=	82,000 cfm/fan ( $\times$ no. of fans to be run)
2120	=	conversion constant, cfm per $\text{m}^3/\text{sec}$
500 mrem/yr	=	total body dose rate limit, as specified by Specification 2.1.1.a
X/Q	=	historical annual average dispersion factor, $\text{sec}/\text{m}^3$
	=	4.8E-6 $\text{sec}/\text{m}^3$

Skin

The concentration at the detector corresponding to a 3000 mrem/yr skin dose rate at the exclusion area boundary is determined by:

(2-2)

$$C_{\text{det}} = \frac{(0.38) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (3000 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec}/\text{m}^3) \left[ \sum_i \left( L_i + 1.1M_i, \frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]}$$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.1 PLANT VENT STACK - 2/3RT-7808, 2RT-7865-1, 3RT-7865-1 (Continued)

where:

$L_i$  = skin Dose Conversion Factor from Table 2-4 for the  $i^{\text{th}}$  noble gas, mrem/yr per  $\mu\text{Ci}/\text{m}^3$

$M_i$  = air Dose Conversion Factor from Table 2-4 for the  $i^{\text{th}}$  noble gas, mrem/yr per  $\mu\text{Ci}/\text{m}^3$

$1.1$  = conversion factor to convert gamma air dose to skin dose

$3000 \text{ mrem/yr}$  = skin dose rate limit as specified by Specification 2.1.1.a

Other values in equation (2-2) are defined in equation (2-1).

The smaller of the values of  $C_{\text{det}}$  from equations (2-1) or (2-2) is to be used in the determination of the maximum permissible monitor alarm setpoint (cpm), as follows:

The maximum permissible alarm setpoint (cpm) is determined using the calibration constant for 2/3RT-7808 given in Table 2-3. The maximum permissible alarm setpoint is value "cpm" corresponding to the concentration,  $C_{\text{det}}$  (the smaller value from equation (2-1) or (2-2)). The calibration constant used is based on Kr-85 or on Xe-133, whichever yields a lower detection efficiency (the largest value in terms of  $\mu\text{Ci}/\text{cc}/\text{cpm}$ ).

The alarm setpoint will be maintained at a value not greater than the maximum permissible alarm setpoint.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.1 PLANT VENT STACK - 2/3RT-7808, 2RT-7865-1, 3RT-7865-1 (Continued)

If there is no release associated with this monitor, the monitor setpoint should be established as close as practical to background to prevent spurious alarms and yet assure an alarm should inadvertent release occur.

#### 2.6.1.2 2RT-7865-1 and 3RT-7865-1 Wide Range Gas Monitors

The maximum release rate ( $\mu\text{Ci/sec}$ ) for Wide Range Gas Monitors is determined by converting the concentration at the detector,  $C_{\text{det}}$  ( $\mu\text{Ci/cc}$ ) to an equivalent release rate in  $\mu\text{Ci/sec}$ , as follows:

$$A_{\text{max}} = \frac{(C_{\text{det}}, \mu\text{Ci/cc})(\text{flowrate}, \text{cc/sec})}{2} \quad (2-3)$$

where:

$A_{\text{max}}$  = maximum permissible release rate,  $\mu\text{Ci/sec}$

$C_{\text{det}}$  = smaller of the values of  $C_{\text{det}}$  obtained from equations (2-1) or (2-2).

Flow Rate = flow rate,  $\text{cc/sec}$   
=  $(3.87 \times 10^7 \text{ cc/sec per fan})$  (number of fans)

2 = a factor to compensate for the split flow between Unit 2 and Unit 3 plant vent stacks

The release rate setpoint will not be set greater than the maximum release rate determined above, when this monitor is being used to meet the requirements of Specification 2.1.1.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.1 PLANT VENT STACK - 2/3RT-7808, 2RT-7865-1, 3RT-7865-1 (Continued)

If there is no release associated with this monitor, the monitor setpoint should be established as close as practical to background to prevent spurious alarms and yet assure an alarm should an inadvertent release occur.

### 2.6.2 CONDENSER EVACUATION SYSTEM - 2RT-7818, 2RT-7870-1, 3RT-7818 or 3RT-7870-1

#### 2.6.2.1 2RT-7818 and 3RT-7818 Condenser Air Ejector Monitors

For the purpose of implementation of Specification 2.1.1, the alarm setpoint level for noble gas monitors is based on the gaseous effluent flow rate and the meteorological dispersion factor.

The concentration at the detector corresponding to a total body dose rate of 500 mrem/yr at the exclusion area boundary is determined by using:

Total Body (2-4)

$$C_{det} = \frac{(0.1)(0.5) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (500 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (\chi/Q, \text{ sec/m}^3) \left[ \sum_i \left( K_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{tot}} \right) \right]}$$

The concentration at the detector corresponding to a 3000 mrem/yr skin dose rate at the exclusion area boundary is determined by using:

Skin (2-4a)

$$C_{det} = \frac{(0.1)(0.5) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (3000 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (\chi/Q, \text{ sec/m}^3) \left[ \sum_i \left( L_i + 1.1M_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{tot}} \right) \right]}$$

## 2.0 GASEOUS EFFLUENTS

### 2.6.2 CONDENSER EVACUATION SYSTEM - 2RT-7818, 2RT-7870-1, 3RT-7818 or 3RT-7870-1 (Continued)

where:

0.1 is an administrative value used to account for potential activity from other gaseous release pathways. 0.5 is an administrative value used to account for releases from both SONGS 2 and SONGS 3 condenser air ejectors simultaneously. Other parameters are specified in 2.6.1.1, above.

The smaller of the values  $C_{det}$  from equations (2-4) or (2-4a) is to be used in determining the maximum permissible monitor alarm setpoint (cpm), as follows:

The maximum permissible alarm setting (cpm) is determined by using the calibration constant for the corresponding Condenser Evacuation System Monitor given in Table 2-3. The maximum permissible alarm setpoint is the cpm value corresponding to the concentration,  $C_{det}$ , [smaller value from equation (2-4) or (2-4a)].

The calibration constant used is based on Kr-85 or on Xe-133, whichever yields a lower detection efficiency (higher value in terms of  $\mu\text{Ci}/\text{cc}/\text{cpm}$ ). The alarm setpoint will not be set greater than the maximum permissible alarm setting determined above.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.2 CONDENSER EVACUATION SYSTEM - 2RT-7818, 2RT-7870-1, 3RT-7818 or 3RT-7870-1 (Continued)

If there is no release associated with this monitor, the monitor setpoint should be established as close as practical to background to prevent spurious alarms yet assure an alarm should an inadvertent release occur.

#### 2.6.2.2 2RT-7870-1 and 3RT-7870-1 Wide Range Gas Monitors

The maximum release rate ( $\mu\text{Ci/sec}$ ) for Wide Range Gas Monitor is determined by converting the concentration at the detector,  $C_{det}$  ( $\mu\text{Ci/cc}$ ), to an equivalent release rate in  $\mu\text{Ci/sec}$ .

$$A_{max} = (C_{det}, \mu\text{Ci/cc}) (\text{flow rate, cc/sec})$$

where:

$A_{max}$  = maximum permissible release rate,  $\mu\text{Ci/sec}$

$C_{det}$  = smaller value of  $C_{det}$ , as obtained from equations (2-4) and (2-4a)

flow rate = flow rate of the condenser air ejector, cc/sec  
= 4.719E5 cc/sec (conservatively assumed as design flow rate)

If there is no release associated with this monitor, the monitor setpoint should be established as close as practical to background to prevent spurious alarms yet assure an alarm should an inadvertent release occur.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.3 CONTAINMENT PURGE - 2RT-7828, 3RT-7828, 2RT-7865, 3RT-7865 For

The purpose of implementation of Specification 2.1.1, the alarm setpoint level for noble gas monitors is based on the gaseous effluent flow rate and the meteorological dispersion factor.

The concentration at the detector corresponding to a total body dose rate of 500 mrem/yr at the exclusion boundary is determined by using:

#### Total Body

$$C_{\text{det}2} = \frac{(0.38)(P_2) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (500 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( K_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]} \quad (2-6)$$

$$C_{\text{det}3} = \frac{(0.38)(P_3) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (500 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( K_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]} \quad (2-7)$$

The concentration at the detector corresponding to a 3000 mrem/yr skin dose rate at the exclusion area boundary is determined by using:

#### Skin

$$C_{\text{det}2} = \frac{(0.38)(P_2) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (3000 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( L_i + 1.1M_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]} \quad (2-6a)$$

$$C_{\text{det}3} = \frac{(0.38)(P_3) \left( 2120 \frac{\text{cfm}}{\text{m}^3/\text{sec}} \right) (3000 \text{ mrem/yr}) (10^{-6} \text{ m}^3/\text{cc})}{(\text{Flow rate, cfm}) (X/Q, \text{ sec/m}^3) \left[ \sum_i \left( L_i + 1.1M_i, \frac{\text{mrem/yr}}{\mu\text{Ci/m}^3} \right) \left( \frac{C_i}{C_{\text{tot}}} \right) \right]} \quad (2-7a)$$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.3 CONTAINMENT PURGE - 2RT-7828, 3RT-7828, 2RT-7865, 3RT-7865 (Continued)

where:

$C_{det2}$  = instantaneous concentration of the Unit 2 detector,  $\mu\text{Ci}/\text{cc}$ .

$C_{det3}$  = instantaneous concentration of the Unit 3 detector,  $\mu\text{Ci}/\text{cc}$ .

0.38 is an administrative values used to account for potential activity from other gaseous release pathways.

$P_2$  and  $P_3$  are administrative values used to account for simultaneous purges of both SONGS 2 and SONGS 3. The fractions  $P_2$  and  $P_3$  will be assigned such that  $P_2 + P_3 \leq 1.0$ .

Flow rate = observed maximum flowrate in cfm from the unit specific monitor 7828. Default values will be the following conservative measured flows:

- = 50,000 cfm full purge
- = 3,000 cfm mini-purge

(The above values replace the smaller design flowrates.)

Other parameters are as specified in 2.6.1.1 above. The smaller of the values of maximum permissible  $C_{det2}$  from equation (2-6) or (2-6a) and  $C_{det3}$  from equations (2-7) or (2-7a) is to be used in determining the maximum permissible monitor alarm setpoints.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.3 CONTAINMENT PURGE - 2RY-7828, 3RT-7828, 2RT-7855, 3RT-7865 (Continued)

#### 2.6.3.1 Maximum Permissible Alarm Setting (RT-7865)

The maximum permissible alarm setting for the Wide Range Gas Monitor expressed as a maximum release rate ( $\mu\text{Ci/sec}$ ) is determined by converting the concentration at the detector,  $C_{\text{det}}$  ( $\mu\text{Ci/cc}$ ), to an equivalent release rate in  $\mu\text{Ci/sec}$ .

$$A_{\text{max}} = (C_{\text{det}}, \mu\text{Ci/cc}) (\text{flow rate, cc/sec})$$

where:

$A_{\text{max}}$  = maximum permissible release rate,  $\mu\text{Ci/cc}$

$C_{\text{det}}$  = smaller value of  $C_{\text{det}}$ , as obtained from equation (2-6, 2-6a) for Unit 2 or (2-7, 2-7a) for Unit 3.

flow rate = flow rate, cc/sec

= 1.416E6 cc/sec for minor purge.

= 2.360E7 cc/sec for main purge.

#### .2 Maximum Permissible Alarm Setting (RT-7828)

The maximum permissible alarm setting for RT-7828 is in  $\mu\text{Ci/cc}$  and is the smaller of the values of  $C_{\text{det}2}$  ( $\mu\text{Ci/cc}$ ) from equations (2-6) and (2-6a).

If there is no release associated with this monitor, the monitor setpoint should be established as close as practical to background to prevent spurious alarms yet assure an alarm should an inadvertent release occur.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.4 WASTE GAS HEADER - 3RT-7865, 2/3RT-7808

For the purpose of Specification 2.1.1, the alarm setpoint level for noble gas monitors is based on the gaseous effluent flow rate and the meteorological dispersion factor. Since the waste gas header discharges to the plant vent stack, either 3RT-7865 or 2/3RT-7808 may be used to monitor waste gas header releases.

The concentration at the detector corresponding to a total body dose rate of 500 mrem/yr or a skin dose rate of 3000 mrem/yr at the exclusion area boundary is determined by using equations (2-1) & (2-2) with sample concentration ( $C_s$ ) and ( $C_{tot}$ ) being obtained from the waste gas decay tank to be released.

The smaller of the values of maximum permissible concentration ( $C_{det}$ ) from equation (2-1) or (2-2) is to be used in determining the maximum permissible monitor alarm setpoint.

#### 2/3RT-7808

The maximum permissible alarm setting (cpm) is determined by using the calibration constant for plant vent stack monitor 7808 given in Table 2-3. The maximum permissible setpoint is the cpm value corresponding to the concentration  $C_{det}$ , (smaller value from equation (2-1) or (2-2)).

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.4 WASTE GAS HEADER - 3RT-7865, 2/3RT-7808 (Continued)

#### 3RT-7865

The maximum permissible alarm setting is expressed as a maximum release rate ( $\mu\text{Ci/sec}$ ) and is determined by converting the concentration at the detector,  $C_{\text{det}}$ , to an equivalent release rate in  $\mu\text{Ci/sec}$  by equation (2-8).

$$A_{\text{max}} = \frac{(C_{\text{det}}, \mu\text{Ci/cc}) (\text{flowrate}, \text{cc/sec})}{2} \quad (2-8)$$

where:

- $A_{\text{det}}$  = the maximum permissible release rate,  $\mu\text{Ci/sec}$
- $C_{\text{det}}$  = the smaller value of  $C_{\text{det}}$ , as obtained from equation (2-1) or (2-2).
- flowrate = flowrate,  $\text{cc/sec}$ 
  - =  $7.74E7 \text{ cc/sec}$  for 2 fan operation or
  - =  $3.87E7 \text{ cc/sec}$  for 1 fan operation
- 2 = correction for 3-7865 viewing only 1/2 the total Plant Vent Stack flow.

.1 A release from the waste gas header is not possible if:

$$\left( \sum C_i \right) \left( \frac{f}{F} \right) > C_{\text{det}} \quad (2-9)$$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.6.4 WASTE GAS HEADER - 3RT-7865, 2/3RT-7808 (Continued)

#### 2.6.4.1 (Continued)

where:

$\Sigma_i C_i$  = total concentration in waste gas holdup tank to be released

f = waste gas header effluent flow rate, cfm

F = plant vent stack flowrate in cfm (166,000 cfm for 2 fan operation; 82,000 for 1 fan operation)

$C_{det}$  = smaller of the values of  $C_{det}$  from equation (2-1) or (2-2) with  $C_i$  being obtained from the waste gas holdup tank to be released

If a release is not possible, adjust the waste gas header flow by determining the maximum permissible waste gas header effluent flow rate corresponding to the Vent Stack Monitor setpoint in accordance with the following:

$$f < \frac{(0.9)(C_{det})(F)}{\Sigma_i C_i} \quad (2-10)$$

where:

f = waste gas header effluent flow rate (cfm)

F = plant vent stack flow rate (cfm) used in equation (2-1) or (2-2)

2.0 GASEOUS EFFLUENTS (Continued)

2.6.4 WASTE GAS HEADER - 3RT-7865, 2/3RT-7808 (Continued)

2.6.4.1 (Continued)

$C_{det}$  = smaller of the value of  $C_{det}$  from equation (2-1) or (2-2)

$\Sigma_i C_i$  = total gamma activity ( $\mu\text{Ci}/\text{cc}$ ) of the waste gas holdup tank to be released, as determined from the pre-release sample analysis.

The 0.9 is an administrative value to account for the potential activity from other releases in the same release pathway.

Table 2-3(a)

Gaseous Effluent Radiation Monitor  
 Calibration Constants  
 ( $\mu\text{Ci}/\text{cc}/\text{cm}^3$ )

MONITOR	Kr-85	Xe-133
2/3RT-7808C	3.90E-8	4.62E-8
2RT-7818A	4.27E-8	6.63E-8
2RT-7818B	7.31E-5	2.07E-5
3RT-7818A	3.73E-8	5.09E-8
3RT-7818B	9.31E-5	2.21E-5

(a) This table provides typical ( $\pm 20\%$ ) calibration constants for the gaseous effluent radiation monitors.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.7 Gaseous Effluent Dose Rate

The methodology used for the purpose of implementation of Specification 2.1.1 for the dose rate above background to an individual in an unrestricted area is calculated by using the following expressions:

#### 2.7.1 FOR NOBLE GASES:

$$\dot{D}_{TB} = \sum_i [K_i (X/Q) \dot{Q}_i] \quad (2-11)$$

$$\dot{D}_s = \sum_i [L_i + 1.1M_i] (X/Q) \dot{Q}_i \quad (2-12)$$

where:

$\dot{D}_{TB}$  = total body dose rate in unrestricted areas due to radioactive materials released in gaseous effluents, mrem/yr

$\dot{D}_s$  = skin dose rate in unrestricted areas due to radioactive materials released in gaseous effluents, mrem/yr

$K_i$  = the total body dose factor due to gamma emissions from Table 2-4 for each identified noble gas radionuclide, i, in mrem/yr per  $\mu\text{Ci}/\text{m}^3$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.7.1 FOR NOBLE GASES: (Continued)

- L<sub>i</sub> = skin dose factor due to the beta emissions from Table 2-4 for each identified noble gas radionuclide, i, in mrem/yr per  $\mu\text{Ci}/\text{m}^3$
- M<sub>i</sub> = air dose factor due to gamma emissions from Table 2-4 for each identified noble gas radionuclide, i, in mrad/yr per  $\mu\text{Ci}/\text{m}^3$
- (conversion constant of 1.1 mrem/mrad converts air dose to skin dose.)
- \* Q<sub>i</sub> = measured or calculated release rate of radionuclide, i, for either continuous or batch gaseous effluents, in  $\mu\text{Ci}/\text{sec}$
- (X/Q) = Maximum annual average atmospheric dispersion factor for any sector or distance at or beyond the unrestricted area boundary.  
= 4.8E-6 sec/m<sup>3</sup>.

### 2.7.2 FOR ALL RADIOIODINES, TRITIUM AND FOR ALL RADIOACTIVE MATERIALS IN PARTICULATE FORM WITH HALF LIVES GREATER THAN EIGHT DAYS:

(2-13)

$$\dot{D}_o = \sum_i \left[ \sum_k (P_{ik} R_k) \dot{Q}_i \right]$$

where:

- \*  $\dot{D}_o$  = organ dose rate in unrestricted areas due to radioactive materials released in gaseous effluents, mrem/yr

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.7.2 FOR ALL RADIOIODINES, TRITIUM AND FOR ALL RADIOACTIVE MATERIALS IN PARTICULATE FORM WITH HALF LIVES GREATER THAN EIGHT DAYS: (Continued)

- \*  $Q_i$  = measured or calculated release rate of radionuclide, i, for either continuous or batch gaseous effluents,  $\mu\text{Ci/sec}$
- \*  $P_{ik}$  = dose parameter for radionuclide, i, for pathway, k, from Table 2-5 for the inhalation pathway in mrem/yr per  $\mu\text{Ci/m}^3$ . The dose factors are based on the critical individual organ and the child age group.
- \*  $\bar{W}_k$  = highest calculated annual average dispersion parameter for estimating the dose to an individual at or beyond the unrestricted area boundary for pathway k.
- \*  $(X/\bar{Q})$ ,  $4.8\text{E-}6 \text{ sec/m}^3$  for the inhalation pathway. The location is the unrestricted area in the NW sector.
- \*  $(D/\bar{Q})$ ,  $4.3\text{E-}8 \text{ m}^2$  for the food and ground plane pathways. The location is the unrestricted area in the E sector.

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8 Gaseous Effluent Dose Calculation

#### 2.8.1 DOSE FROM NOBLE GASES IN GASEOUS EFFLUENTS

The gaseous releases considered in the following dose calculations are described in Section 2.6. The air dose in unrestricted areas due to noble gases released in gaseous effluents is calculated using the following expressions:

##### 2.8.1.1 For historical meteorology:

$$D_{\gamma} = 3.17 \times 10^{-8} \sum_i M_i [(X/Q) Q_i] \quad (2-14)$$

$$D_{\beta} = 3.17 \times 10^{-8} \sum_i N_i [(X/Q) Q_i] \quad (2-15)$$

where:

$D_{\gamma}$  = total gamma air dose from gaseous effluents, mrad

$D_{\beta}$  = total beta air dose from gaseous effluents, mrad

$3.17 \times 10^{-8}$  = inverse seconds per year

$M_i$  = air dose factor due to gamma emissions from Table 2-4 for each identified noble gas radionuclide,  $i$ , in mrad/yr per  $\mu\text{Ci}/\text{m}^3$

$N_i$  = air dose due to beta emissions from Table 2-4 for each identified noble gas radionuclide,  $i$ , in mrad/yr per  $\mu\text{Ci}/\text{m}^3$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8.1.1 For historical meteorology: (Continued)

$(X/Q)$  =  $4.8E-6$  sec/m<sup>3</sup>. The maximum annual average atmospheric dispersion factor for any sector or distance at or beyond the unrestricted area boundary.

$Q_i$  = amount of noble gas radionuclide, i, released in gaseous effluents.  $\mu\text{Ci}$ .

### 2.8.1.2 For meteorology concurrent with release:

NOTE: Consistent with the methodology provided in Regulatory Guide 1.109 and the following equations, RRRGS (Radioactive Release Report Generating System) software is used to perform the actual calculations.

$$D_{\gamma\theta} = 1.14 \times 10^{-4} \sum_i M_i \left[ \sum_j (\Delta t_j (X/Q)_{j\theta})^* Q_{ij} \right] \quad (2-16)$$

$$D_{\beta\theta} = 1.14 \times 10^{-4} \sum_i M_i \left[ \sum_j (\Delta t_j (X/Q)_{j\theta})^* Q_{ij} \right] \quad (2-17)$$

where:

$D_{\gamma\theta}$  = total gamma air dose from gaseous effluents in sector  $\theta$ , mrad

$D_{\beta\theta}$  = total beta air dose from gaseous effluents in sector  $\theta$ , mrad

$1.14 \times 10^{-4}$  = inverse hours/year

$M_i$  = air dose factor due to gamma emissions from Table 2-4 for each identified noble gas radionuclide, i, in mrad/yr per  $\mu\text{Ci}/\text{m}^3$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8.1.2 For meteorology concurrent with release: (Continued)

$N_i$  = air dose factor due to beta emissions from Table 2-4 for each identified noble gas radionuclide,  $i$ , in mrad/yr per  $\mu\text{Ci}/\text{m}^3$

$\Delta t_j$  = length of the  $j^{\text{th}}$  time period over which  $(X/Q)_{j\theta}$  and  $Q_{ij}$  are averaged for gaseous releases in hours

$(X/Q)_{j\theta}$  = atmospheric dispersion factor for time period  $\Delta t_j$  at exclusion boundary location in sector  $\theta$  determined by concurrent meteorology, sec/m<sup>3</sup>

$Q_{ij}$  = average release rate of radionuclide,  $i$ , in gaseous effluents during time period,  $\Delta t_j$ ,  $\mu\text{Ci/sec}$

### 2.8.2 DOSE FROM TRITIUM, RADIOIODINES AND RADIOACTIVE MATERIALS IN PARTICULATE FORM WITH HALF LIVES GREATER THAN 8 DAYS IN GASEOUS EFFLUENTS

The dose to an individual from tritium, radioiodines and radioactive materials in particulate form with half lives greater than eight days in gaseous effluents released to unrestricted areas is calculated using the following expressions:

#### 2.8.2.1 For historical meteorology:

$$D_o = 3.17 \times 10^{-8} \sum_i \left[ \left( \sum_k R_{ik} W_k \right) Q_i \right] \quad (2-18)$$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8.2.1 For historical meteorology: (Continued)

where:

$D_0$  = total projected dose from gaseous effluents to an individual, mrem

$Q_i$  = amount of each radionuclide, i, (tritium, radioiodine, radioactive material in particulate form with half lives greater than eight days), released in gaseous effluents,  $\mu\text{Ci}$

$\Sigma_k R_{ik} W_k$  = sum of all pathways, k, for radionuclide, i, of the  $R_i W$  product, in mrem/yr per  $\mu\text{Ci/sec}$ . The  $\Sigma_k R_{ik} W_k$  value for each radionuclide, i, is given in Table 2-6. The value given is the maximum  $\Sigma_k R_{ik} W_k$  for all locations and is based on the most restrictive age groups.

$R_{ik}$  = dose factor for each identified radionuclide, i, for pathway k, (for the inhalation pathway in mrem/yr per  $\mu\text{Ci}/\text{m}^3$  and for the food and ground plane pathways in  $\text{m}^2\text{-mrem}/\text{yr per } \mu\text{Ci/sec}$ ), at the controlling location. The  $R_{ik}$ 's for each controlling location for each age group are given in Tables 2-7 thru 2-16. Data in these tables are derived using the NRC code, PARTS. (See "Submittal of 1990 ODCM Dose Parameters for SONGS 1, 2, and 3" from E. S. Medling to P. H. Penseyres, dated 1/29/91).

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8.2.1 For historical meteorology: (Continued)

- $W_k$  = annual average dispersion parameter for estimating the dose to an individual at the controlling location for pathway k.
- $(\bar{X}/\bar{Q})$  for the inhalation pathway in sec/m<sup>3</sup>. The  $(\bar{X}/\bar{Q})$  for each controlling location is given in Tables 2-7 thru 2-16.
  - $(\bar{D}/\bar{Q})$  for the food and ground plane pathways in m<sup>-2</sup>. The  $(\bar{D}/\bar{Q})$  for each controlling location are given in Tables 2-7 thru 2-16.

### 2.8.2.2 For meteorology concurrent with releases:

NOTE: Consistent with the methodology provided in Regulatory Guide 1.109 and the following equations, RRRGS (Radioactive Release Report Generating System) software is used to perform the actual calculations.

$$D_\theta = 1.14 \times 10^{-4} \sum_{ijk}^{lmn} [(\Delta t_j)(R_{ik\theta})(W_{jke}) \left( \frac{*}{Q_{ij}} \right)] \quad (2-19)$$

where:

- $D_\theta$  = total annual dose from gaseous effluents to an in sector  $\theta$ , mrem.
- $\Delta t_j$  = length of the  $j^{\text{th}}$  period over which  $W_{jke}$  and  $Q_{ij}$  are averaged for gaseous released, hours
- $Q_{ij}$  = average release rate of radionuclide, i, in gaseous effluents during time period  $\Delta t_j$ ,  $\mu\text{Ci/sec}$

## 2.0 GASEOUS EFFLUENTS (Continued)

### 2.8.2.2 For meteorology concurrent with releases: (Continued)

$R_{ik\theta}$  = dose factor for each identified radionuclide i, for pathway k for sector  $\theta$  (for the inhalation pathway in mrem/yr per  $\mu\text{Ci}/\text{m}^3$  and for the food and ground plane pathways in  $\text{m}^2$  mrem/yr per  $\mu\text{Ci}/\text{sec}$ ) at the controlling location. A listing of  $R_{ik\theta}$  for the controlling locations in each landward sector for each group is given in Tables 2-7 thru 2-16. The  $\theta$  is determined by the concurrent meteorology.

$w_{jk\theta}$  = dispersion parameter for the time period  $\Delta t_j$  for each pathway k for calculating the dose to an individual at the controlling location in sector  $\theta$  using concurrent meteorological conditions.

- =  $(\bar{X}/\bar{Q})$  for the inhalation pathway,  $\text{sec}/\text{m}^3$
- =  $(\bar{D}/\bar{Q})$  for the food and ground plane pathways,  $\text{m}^{-2}$

TABLE 2-4  
DOSE FACTORS FOR NOBLE GASES AND DAUGHTERS\*\*

Radio-Nuclide	Total Body Dose Factor K, (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )	Skin Dose Factor L, (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )	Gamma Air Dose Factor M, (mrad/yr per $\mu\text{Ci}/\text{m}^3$ )	Beta Air Dose Factor N, (mrad/yr per $\mu\text{Ci}/\text{m}^3$ )
Kr-85m	1.17E+3	1.46E+3	1.23E+3	1.97E+3
Kr-85	1.61E+1	1.34E+3	1.72E+1	1.95E+3
Kr-87	5.92E+3	9.73E+3	6.17E+3	1.03E+4
Kr-88	1.47E+4	2.37E+3	1.52E+4	2.93E+3
Xe-131m	9.15E+1	4.76E+2	1.56E+2	1.11E+3
Xe-133m	2.51E+2	9.94E+2	3.27E+2	1.48E+3
Xe-133	2.94E+2	3.06E+2	3.53E+2	1.05E+3
Xe-135m	3.12E+3	7.11E+2	3.36E+3	7.39E+2
Xe-135	1.81E+3	1.86E+3	1.92E+3	2.46E+3
Xe-138	8.83E+3	4.13E+3	9.21E+3	4.75E+3
Ar-41	8.04E+3	2.69E+3	9.30E+3	3.28E+3

\*\*Source: USNRC Reg. Guide 1.109, Table B-1

TABLE 2-5  
**DOSE PARAMETER  $P_{ik}^*$**   
**CHILD AGE GROUP**  
**CRITICAL ORGAN**

Radionuclide	Inhalation Pathway (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )	Radionuclide	Inhalation Pathway (mrem/yr per $\mu\text{Ci}/\text{m}^3$ )
H - 3	1.1E+3	I - 131	1.6E+7
Cr-51	1.7E+4	I - 132	1.9E+5
Mn-54	1.6E+6	I - 133	3.8E+6
Co-57	5.1E+5	I - 134	5.1E+4
Co-58	1.1E+6	I - 135	7.9E+5
Co-60	7.1E+6	Cs-134	1.0E+6
Sr-89	2.2E+6	Cs-136	1.7E+5
Sr-90	1.0E+8	Cs-137	9.1E+5
Zr-95	2.2E+6	Ba-140	1.7E+6
Nb-95	6.1E+5	Ce-141	5.4E+5
Ru-103	6.6E+5	Ce-144	1.2E+7
Te-129m	1.8E+6		

\*Source: USNRC NUREG-0133, Section 5.2.1.1

TABLE 2-6  
CONTROLLING LOCATION FACTORS

Radionuclide	$\sum_k R_{ik} W_k$ mrem/yr per $\mu\text{Ci/sec}$	Use:
H -3	9.62E-4	Q: San Onofre Mobil.Homes
Cr-51	3.25E-2	Q: San Onofre Mobil.Homes
Mn-54	6.52E+0	Q: San Onofre Mobil.Homes
Co-57	1.66E+0	Q: San Onofre Mobil.Homes
Co-58	2.33E+0	Q: San Onofre Mobil.Homes
Co-60	8.56E+1	Q: San Onofre Mobil.Homes
Sr-89	4.34E+1	Q: SC Ranch (No. Res.)
Sr-90	1.82E+3	Q: SC Ranch (No. Res.)
Ir-95	2.90E+0	Q: San Onofre Mobil.Homes
Nb-95	6.81E+0	E: Deer Consumer
Ru-103	1.08E+1	E: Deer Consumer
Te-129m	5.32E+0	E: Deer Consumer
Cs-134	3.36E+1	Q: SC Ranch (No. Res.)
Cs-136	6.81E-1	Q: San Onofre Mobil.Homes
Cs-137	3.67E+1	Q: San Onofre Mobil.Homes
Ba-140	1.56E+0	Q: San Onofre Mobil.Homes
Ce-141	5.74E-1	Q: SC Ranch (No. Res.)
Ce-144	1.68E+1	Q: SC Ranch (No. Res.)
I -131	1.19E+1	Q: San Onofre Mobil.Homes
I -132	1.45E-1	Q: San Onofre Mobil.Homes
I -133	2.82E+0	Q: San Onofre Mobil.Homes
I -134	3.94E-2	Q: San Onofre Mobil.Homes
I -135	5.94E-1	Q: San Onofre Mobil.Homes
UN-ID	3.59E+0	Q: San Onofre Mobil.Homes

Footnote: These values to be used in manual calculations are the maximum  $\sum_k R_{ik} W_k$  for all locations based on the most restrictive age group.

TABLE 2-7  
DOSE PARAMETER R, FOR SECTOR P

Page 1 of 2

Pathway = Surf Beach X/Q = 1.8E-6 sec/m <sup>3</sup>				Distance = 0.4 miles D/Q = 8.2E-9 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	1.2E+1	-0-	5.1E+1	-0-	9.6E+1	-0-
Cr-51	-0-	-0-	1.8E+2	3.2E+4	8.4E+2	1.5E+5	1.1E+3	3.5E+5
Mn-54	-0-	-0-	1.6E+4	9.5E+6	8.0E+4	4.5E+7	1.1E+5	1.1E+8
Co-57	-0-	-0-	5.3E+3	2.4E+6	2.4E+4	1.1E+7	2.2E+4	2.6E+7
Co-58	-0-	-0-	1.2E+4	2.6E+6	5.4E+4	1.2E+7	7.1E+4	2.9E+7
Co-60	-0-	-0-	7.3E+4	1.5E+8	3.5E+5	7.0E+8	4.5E+5	1.6E+9
Sr-89	-0-	-0-	2.2E+4	1.5E+2	9.7E+4	7.1E+2	1.1E+5	1.6E+3
Sr-90	-0-	-0-	1.1E+6	-0-	4.4E+6	-0-	7.5E+6	-0-
Zr-95	-0-	-0-	2.3E+4	1.7E+6	1.1E+5	8.2E+6	1.3E+5	1.9E+7
Nb-95	-0-	-0-	6.4E+3	9.4E+5	3.0E+4	4.5E+6	3.8E+4	1.0E+7
Ru-103	-0-	-0-	6.9E+3	7.5E+5	3.2E+4	3.6E+6	3.8E+4	8.3E+6
Tc-129m	-0-	-0-	1.8E+4	1.4E+5	8.0E+4	6.4E+5	8.8E+4	1.5E+6
Cs-134	-0-	-0-	1.1E+4	4.7E+7	4.5E+4	2.2E+8	5.5E+4	5.2E+8
Cs-136	-0-	-0-	1.8E+3	1.0E+6	7.8E+3	4.9E+6	1.1E+4	1.1E+7
Cs-137	-0-	-0-	9.4E+3	7.1E+7	3.4E+4	3.4E+8	4.7E+4	7.8E+8
Ba-140	-0-	-0-	1.8E+4	1.4E+5	8.2E+4	6.7E+5	9.7E+4	1.6E+6
Ce-141	-0-	-0-	5.7E+3	9.4E+4	2.5E+4	4.5E+5	2.8E+4	1.0E+6
Ce-144	-0-	-0-	1.2E+5	4.8E+5	5.4E+5	2.3E+6	5.9E+5	5.3E+6
I -131	-0-	-0-	1.7E+5	1.2E+5	5.9E+5	5.6E+5	9.1E+5	1.3E+6
I -132	-0-	-0-	2.0E+3	8.5E+3	6.1E+3	4.1E+4	8.7E+3	9.4E+4
I -133	-0-	-0-	4.0E+4	1.7E+4	1.2E+5	8.0E+4	1.6E+5	1.9E+5
I -134	-0-	-0-	5.3E+2	3.1E+3	1.6E+3	1.5F+4	2.3E+3	3.4E+4
I -135	-0-	-0-	8.2E+3	1.7E+4	2.5E+4	8.2E+4	3.4E+4	1.9E+5
UN-ID	-0-	-0-	1.0E+4	5.1E+6	5.0E+4	2.4E+7	6.6E+4	5.7E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-7  
DOSE PARAMETER R, FOR SECTOR P

Page 2 of 2

	Pathway = Former Nixon Estate (no garden)		Distance = 2.8 miles					
	X/Q = 1.2E-7 sec/m <sup>3</sup>		D/Q = 3.4E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	3.8E+5	3.4E+8	5.1E+5	3.4E+8	5.9E+5	3.4E+8	3.7E+5	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Cj-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	4.1E+7	-0-	1.0E+8	-0-	1.1E+8	-0-	9.9E+7	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	7.0E+5	6.8E+9	1.0E+6	6.8E+9	1.1E+6	6.8E+9	8.5E+5	6.8E+9
Cs-136	1.3E+5	1.5E+8	1.7E+5	1.5E+8	1.9E+5	1.5E+8	1.5E+5	1.5E+8
Cs-137	6.1E+5	1.0E+10	9.1E+5	1.0E+10	8.5E+5	1.0E+10	6.2E+5	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	0.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I-131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I-132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I-133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I-134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I-135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-B  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 1 of 10

Pathway = Enlisted Bch Trailers X/Q = 9.3E-7 sec/m <sup>3</sup>			Distance = 1.1 miles D/Q = 4.6E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	7.2E+3	2.3E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	7.0E+5	6.9E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+5	1.7E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	4.6E+5	1.9E+8
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+6	1.1E+10
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	7.0E+5	1.1E+4
Rb-88	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+7	-0-
Rb-95	-0-	-0-	-0-	-0-	-0-	-0-	8.8E+5	1.3E+8
Sr-95	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+5	6.8E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+5	5.4E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	5.8E+5	9.8E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	4.2E+5	3.4E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	7.3E+4	7.5E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+5	5.1E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	6.4E+5	1.0E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+5	6.8E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	3.9E+6	3.5E+7
I-131	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	8.6E+6
I-132	-0-	-0-	-0-	-0-	-0-	-0-	5.7E+4	6.2E+5
I-133	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+6	1.2E+6
I-134	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+4	2.2E+5
I-135	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+5	1.3E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	4.3E+5	3.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-8  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 2 of 10

Pathway = San Onofre Mobil Homes X/Q = 7.4E-7 sec/m <sup>3</sup>			Distance = 1.3 miles D/Q = 3.6E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	3.8E+5	3.4E+8	5.1E+5	3.4E+8	5.9E+5	3.4E+8	3.7E+5	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+8	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+6	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	4.1E+7	-0-	1.0E+8	-0-	1.1E+8	-0-	9.9E+7	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+6	2.0E+7	1.2E+6	2.0E+7
Cs-134	7.0E+5	6.8E+9	1.0E+6	6.8E+9	1.1E+6	6.8E+9	8.5E+5	6.8E+9
Cs-136	1.3E+5	1.5E+8	1.7E+5	1.5E+8	1.9E+5	1.5E+8	1.5E+5	1.5E+8
Cs-137	6.1E+5	1.0E+10	9.1E+5	1.0E+10	8.5E+5	1.0E+10	6.2E+5	1.0E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-8  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 3 of 10

Pathway = State Park Office Trailer X/Q = 2.2E-6 sec/m <sup>3</sup>			Distance = 0.6 miles D/Q = 1.2E-8 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	5.8E+1	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	6.6E+2	2.1E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	6.4E+4	6.3E+7
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+4	1.6E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	4.2E+4	1.7E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+5	9.8E+8
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	6.4E+4	9.9E+2
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+6	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	8.1E+4	1.1E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+4	6.2E+6
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+4	5.0E+6
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	5.3E+4	9.0E+5
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	3.9E+4	3.1E+8
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	6.7E+3	6.9E+6
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	2.8E+4	4.7E+8
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	5.8E+4	9.4E+5
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+4	5.2E+5
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	3.2E+6
I -131	-0-	-0-	-0-	-0-	-0-	-0-	5.4E+5	7.9E+5
I -132	-0-	-0-	-0-	-0-	-0-	-0-	5.2E+3	5.7E+4
I -133	-0-	-0-	-0-	-0-	-0-	-0-	9.8E+4	1.1E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+3	2.1E+4
I -135	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+4	1.2E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	3.9E+4	3.4E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-8  
DOSE PARAMETER R, FOR SECTOR Q

Page 4 of 10

Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway						
H - 3	-0-	-0-	1.2E+1	-0-	5.1E+1	-0-	2.2E+2	-0-
Cr-51	-0-	-0-	1.8E+2	3.2E+4	8.4E+2	1.5E+5	2.5E+3	8.0E+5
Mn-54	-0-	-0-	1.6E+4	9.5E+6	8.0E+4	4.5E+7	2.4E+5	2.4E+8
Co-57	-0-	-0-	5.3E+3	2.4E+6	2.4E+4	1.1E+7	6.3E+4	5.9E+7
Co-58	-0-	-0-	1.2E+4	2.6E+6	5.4E+4	1.2E+7	1.6E+5	6.5E+7
Co-60	-0-	-0-	7.3E+4	1.5E+8	3.5E+5	7.0E+8	1.0E+6	3.7E+9
Sr-89	-0-	-0-	2.2E+4	1.5E+2	9.7E+4	7.1E+2	2.4E+5	3.7E+3
Sr-90	-0-	-0-	1.1E+6	-0-	4.4E+6	-0-	1.7E+7	-0-
Zr-95	-0-	-0-	2.3E+4	1.7E+6	1.1E+5	8.2E+6	3.0E+5	4.3E+7
Nb-95	-0-	-0-	6.4E+3	9.4E+5	3.0E+4	4.5E+6	8.6E+4	2.3E+7
Ru-103	-0-	-0-	6.9E+3	7.5E+5	3.2E+4	3.6E+6	8.6E+4	1.9E+7
Te-129m	-0-	-0-	1.8E+4	1.4E+5	8.0E+4	6.4E+5	2.0E+5	3.4E+6
Cs-134	-0-	-0-	1.1E+4	4.7E+7	4.5E+4	2.2E+8	1.5E+5	1.2E+9
Cs-136	-0-	-0-	1.8E+3	1.0E+6	7.8E+3	4.9E+6	2.5E+4	2.6E+7
Cs-137	-0-	-0-	9.4E+3	7.1E+7	3.4E+4	3.4E+8	1.1E+5	1.8E+9
Ba-140	-0-	-0-	1.8E+4	1.4E+5	8.2E+4	6.7E+5	2.2E+5	3.5E+6
Ce-141	-0-	-0-	5.7E+3	9.4E+4	2.5E+4	4.5E+5	6.2E+4	2.3E+6
Ce-144	-0-	-0-	1.2E+5	4.8E+5	5.4E+5	2.3E+6	1.3E+6	1.2E+7
I - 131	-0-	-0-	1.7E+5	1.2E+5	5.9E+5	5.6E+5	2.0E+6	2.9E+6
I - 132	-0-	-0-	2.0E+3	8.5E+3	6.1E+3	4.1E+4	2.0E+4	2.1E+5
I - 133	-0-	-0-	4.0E+4	1.7E+4	1.2E+5	8.0E+4	3.7E+5	4.2E+5
I - 134	-0-	-0-	5.3E+2	3.1E+3	1.6E+3	1.5E+4	5.1E+3	7.7E+4
I - 135	-0-	-0-	8.2E+3	1.7E+4	2.5E+4	8.2E+4	7.7E+4	4.3E+5
UN-ID	-0-	-0-	1.0E+4	5.1E+6	5.0E+4	2.4E+7	1.5E+5	1.3E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-8  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 5 of 10

Pathway = Enlisted Beach X/Q = 9.3E-07 sec/m <sup>3</sup>			Distance = 1.1 miles D/Q = 4.6E-09 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	1.2E+1	-0-	5.1E+1	-0-	1.3E+2	-0-
Cr-51	-0-	-0-	1.8E+2	3.2E+4	8.4E+2	1.5E+5	1.5E+3	4.7E+5
Mn-54	-0-	-0-	1.6E+4	9.5E+6	8.0E+4	4.5E+7	1.4E+5	1.4E+8
Co-57	-0-	-0-	5.3E+3	2.4E+6	2.4E+4	1.1E+7	3.7E+4	3.5E+7
Co-58	-0-	-0-	1.2E+4	2.6E+6	5.4E+4	1.2E+7	9.4E+4	3.9E+7
Co-60	-0-	-0-	7.3E+4	1.5E+8	3.5E+5	7.0E+8	6.1E+5	2.2E+9
Sr-89	-0-	-0-	2.2E+4	1.5E+2	9.7E+4	7.1E+2	1.4E+5	2.2E+3
Sr-90	-0-	-0-	1.1E+6	-0-	4.4E+6	-0-	1.0E+7	-0-
Zr-95	-0-	-0-	2.3E+4	1.7E+6	1.1E+5	8.2E+6	1.8E+5	2.5E+7
Nb-95	-0-	-0-	6.4E+3	9.4E+5	3.0E+4	4.5E+6	5.1E+4	1.4E+7
Ru-103	-0-	-0-	6.9E+3	7.5E+5	3.2E+4	3.6E+6	5.1E+4	1.1E+7
Te-129m	-0-	-0-	1.8E+4	1.4E+5	8.0E+4	5.4E+5	1.2E+5	2.0E+6
Cs-134	-0-	-0-	1.1E+4	4.7E+7	4.5E+4	2.2E+8	8.6E+4	6.9E+8
Cs-136	-0-	-0-	1.8E+3	1.0E+6	7.8E+3	4.9E+6	1.5E+4	1.5E+7
Cs-137	-0-	-0-	9.4E+3	7.1E+7	3.4E+4	3.4E+8	6.3E+4	1.0E+9
Ba-140	-0-	-0-	1.8E+4	1.4E+5	8.2E+4	6.7E+5	1.3E+5	2.1E+6
Ce-141	-0-	-0-	5.7E+3	9.4E+4	2.5E+4	4.5E+5	3.7E+4	1.4E+6
Ce-144	-0-	-0-	1.2E+5	4.8E+5	5.4E+5	2.3E+6	7.9E+5	7.1E+6
I -131	-0-	-0-	1.7E+5	1.2E+5	5.9E+5	5.6E+5	1.2E+6	1.7E+6
I -132	-0-	-0-	2.0E+3	8.5E+3	6.1E+3	4.1E+4	1.2E+4	1.3E+5
I -133	-0-	-0-	4.0E+4	1.7E+4	1.2E+5	8.0E+4	2.2E+5	2.1E+5
I -134	-0-	-0-	5.3E+2	3.1E+3	1.6E+3	1.5E+4	3.0E+3	4.6E+4
I -135	-0-	-0-	8.2E+3	1.7E+4	2.5E+4	8.2E+4	4.5E+4	2.6E+5
UN-ID	-0-	-0-	1.0E+4	5.1E+6	5.0E+4	2.4E+7	8.8E+4	7.6E+7

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-8  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 6 of 10

Pathway = Enlisted Beach Check-In X/Q = 6.8E-7 sec/m <sup>3</sup>				Distance = 1.4 miles D/Q = 3.2E-9 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H - 3	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+3	1.1E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	3.2E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	8.4E+4	7.8E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	8.7E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	4.9E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	4.9E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	5.7E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	3.1E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	2.5E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+5	4.5E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.9E+5	1.6E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+4	3.4E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	2.3E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+5	4.7E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	8.3E+4	3.1E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	1.6E+7
I - 131	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+6	3.9E+6
I - 132	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+4	2.8E+5
I - 133	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+5	5.6E+5
I - 134	-0-	-0-	-0-	-0-	-0-	-0-	6.8E+3	1.0E+5
I - 135	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+5	5.8E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	1.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-8  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 7 of 10

Pathway = Sheep (Meat) X/Q = 5.6E-7 sec/m <sup>3</sup>				Distance = 1.6 miles D/Q = 2.6E-9 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I -131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I -132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I -133	-0-	-0-	-0-	1.6E-2	-0-	8.7E-3	1.2E+4	1.3E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I -135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-B  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 8 of 10

Pathway = S. C. Res W Garden X/Q = 1.2E-07 sec/m <sup>3</sup>				Distance = 4.1 miles D/Q = 4.1E-10 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	3.8E+3	1.3E+3	2.4E+3	1.3E+3	1.9E+3
Cr-51	1.3E+4	4.7E+6	1.7E+4	9.4E+6	2.1E+4	1.2E+7	1.4E+4	1.1E+7
Mn-54	1.0E+6	1.4E+9	1.6E+6	2.0E+9	2.0E+6	2.2E+9	1.4E+6	2.2E+9
Co-57	3.8E+5	3.4E+8	5.1E+5	5.6E+8	5.9E+5	6.3E+8	3.7E+5	5.8E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	7.1E+8	1.3E+6	8.9E+8	9.3E+5	8.5E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.3E+10	8.7E+6	2.4E+10	6.0E+6	2.4E+10
Sr-59	2.0E+6	2.2E+4	2.2E+6	3.1E+10	2.4E+6	1.2E+10	1.4E+6	7.2E+9
Sr-90	4.1E+7	-0-	1.0E+8	1.3E+12	1.1E+8	7.7E+11	9.9E+7	5.8E+11
Zr-95	1.8E+6	2.5E+8	2.2E+6	1.0E+9	2.7E+6	1.3E+9	1.8E+6	1.2E+9
Nb-95	4.8E+5	1.4E+8	6.1E+5	3.8E+8	7.5E+5	4.9E+8	5.0E+5	4.5E+8
Ru-103	5.5E+5	1.1E+8	6.6E+5	4.4E+8	7.8E+5	5.6E+8	5.0E+5	4.9E+8
Te-129m	1.7E+5	2.0E+7	1.8E+5	2.4E+9	2.0E+6	1.4E+9	1.2E+6	9.7E+8
Cs-134	7.0E+5	6.8E+9	1.0E+6	3.1E+10	1.1E+6	2.2E+10	9.5E+5	1.6E+10
Cs-136	1.3E+5	1.5E+8	1.7E+5	2.4E+8	1.9E+5	2.1E+8	1.5E+5	1.9E+8
Cs-137	6.1E+5	1.0E+10	9.1E+5	3.4E+10	8.5E+5	2.3E+10	6.2E+5	1.8E+10
Ba-140	1.6E+6	2.1E+7	1.7E+6	1.3E+8	2.0E+6	8.8E+7	1.3E+6	7.4E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	3.4E+8	6.1E+5	4.2E+8	3.6E+5	3.3E+8
Ce-144	9.8E+6	7.0E+7	1.2E+7	9.3E+9	1.3E+7	1.2E+10	7.8E+6	9.0E+9
I -131	1.5E+7	1.7E+7	1.6E+7	4.1E+9	1.5E+7	2.1E+9	1.2E+7	1.4E+9
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+8	1.0E+6	3.3E+9	1.2E+6	2.4E+9	8.6E+5	1.8E+9

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-8  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 9 of 10

Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway						
H -3	-0-	-0-	-0-	3.8E+3	-0-	2.4E+3	-0-	1.9E+3
Cr-51	-0-	-0-	-0-	4.8E+6	-0-	7.4E+6	-0-	6.7E+6
Mn-54	-0-	-0-	-0-	6.1E+8	-0-	8.3E+8	-0-	8.0E+8
Co-57	-0-	-0-	-0-	2.2E+8	-0-	2.9E+8	-0-	2.4E+8
Co-58	-0-	-0-	-0-	3.3E+8	-0-	5.1E+8	-0-	4.7E+8
Co-60	-0-	-0-	-0-	2.0E+9	-0-	3.0E+9	-0-	2.7E+9
Sr-89	-0-	-0-	-0-	3.1E+10	-0-	1.2E+10	-0-	7.2E+9
Sr-90	-0-	-0-	-0-	1.3E+12	-0-	7.7E+11	-0-	5.8E+11
Zr-95	-0-	-0-	-0-	7.8E+8	-0-	1.1E+9	-0-	9.1E+8
Nb-95	-0-	-0-	-0-	2.4E+8	-0-	3.5E+8	-0-	3.1E+8
Ru-103	-0-	-0-	-0-	3.3E+8	-0-	4.5E+8	-0-	3.8E+8
Te-129m	-0-	-0-	-0-	2.3E+9	-0-	1.4E+9	-0-	9.5E+8
Cs-134	-0-	-0-	-0-	2.4E+10	-0-	1.5E+10	-0-	9.2E+9
Cs-136	-0-	-0-	-0-	9.0E+7	-0-	5.7E+7	-0-	3.6E+7
Cs-137	-0-	-0-	-0-	2.3E+10	-0-	1.3E+10	-0-	7.8E+9
Ba-140	-0-	-0-	-0-	1.1E+8	-0-	6.8E+7	-0-	5.3E+7
Ce-141	-0-	-0-	-0-	3.3E+8	-0-	4.1E+8	-0-	3.2E+8
Ce-144	-0-	-0-	-0-	9.2E+9	-0-	1.2E+10	-0-	9.0E+9
I -131	-0-	-0-	-0-	4.1E+9	-0-	2.1E+9	-0-	1.4E+9
I -132	-0-	-0-	-0-	6.0E-36	-0-	2.6E-36	-0-	1.7E-36
I -133	-0-	-0-	-0-	4.0E-11	-0-	1.7E-11	-0-	1.1E-11
I -134	-0-	-0-	-0-	6.1E-37	-0-	2.7E-37	-0-	1.7E-37
I -135	-0-	-0-	-0-	7.0E-35	-0-	3.1E-35	-0-	1.9E-35
UN-ID	-0-	-0-	-0-	2.5E+9	-0-	1.7E+9	-0-	1.1E+9

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-B  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR Q

Page 10 of 10

Pathway = San Clemente Ranch Adm. Offices X/Q = 2.7E-7 sec/m <sup>3</sup>				Distance = 2.5 miles D/Q = 1.1E-9 m <sup>2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+2	1.9E+3
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+3	7.8E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	1.1E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	8.4E+4	3.2E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	5.6E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	7.5E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	7.2E+9
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+7	5.8E+11
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	9.7E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	3.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	4.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+5	9.5E+8
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.9E+5	1.1E+10
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+4	7.0E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+5	5.8E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	8.5E+4	3.2E+8
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	9.0E+9
I-131	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+6	1.4E+9
I-132	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+4	2.8E+5
I-133	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+5	5.6E+5
I-134	-0-	-0-	-0-	-0-	-0-	-0-	5.8E+3	1.0E+5
I-135	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+5	5.8E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	1.2E+9

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2/\text{sec}) \cdot (\text{mrem/yr})}{\mu\text{Ci}}$

TABLE 2-9  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR R

Page 1 of 5

Pathway = San Onofre Mobile Homes X/Q = 5.3E-7 sec/m <sup>3</sup>			Distance = 1.2 miles D/Q = 3.2E-9 m <sup>2</sup>					
Radio- Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	6.5E+2	-0-	1.1E+3	-0-	1.3E+3	-0-	1.3E+3	-0-
Cr-51	1.3E+4	4.7E+6	1.7E+4	4.7E+6	2.1E+4	4.7E+6	1.4E+4	4.7E+6
Mn-54	1.0E+6	1.4E+9	1.6E+6	1.4E+9	2.0E+6	1.4E+9	1.4E+6	1.4E+9
Co-57	3.8E+5	3.4E+8	5.1E+5	3.4E+8	5.9E+5	3.4E+8	3.7E+5	3.4E+8
Co-58	7.8E+5	3.8E+8	1.1E+6	3.8E+8	1.3E+6	3.8E+3	9.3E+5	3.8E+8
Co-60	4.5E+6	2.2E+10	7.1E+6	2.2E+10	8.7E+6	2.2E+10	6.0E+5	2.2E+10
Sr-89	2.0E+6	2.2E+4	2.2E+6	2.2E+4	2.4E+6	2.2E+4	1.4E+6	2.2E+4
Sr-90	4.1E+7	-0-	1.0E+8	-0-	1.1E+8	-0-	9.9E+7	-0-
Zr-95	1.8E+6	2.5E+8	2.2E+6	2.5E+8	2.7E+6	2.5E+8	1.8E+6	2.5E+8
Nb-95	4.8E+5	1.4E+8	6.1E+5	1.4E+8	7.5E+5	1.4E+8	5.0E+5	1.4E+8
Ru-103	5.5E+5	1.1E+8	6.5E+5	1.1E+8	7.8E+5	1.1E+8	5.0E+5	1.1E+8
Te-129m	1.7E+6	2.0E+7	1.8E+6	2.0E+7	2.0E+5	2.0E+7	1.2E+6	2.0E+7
Cs-134	7.0E+5	6.8E+9	1.0E+6	6.8E+9	1.1E+6	6.7E+9	8.5E+5	6.8E+9
Cs-136	1.3E+5	1.5E+8	1.7E+5	1.5E+8	1.9E+5	1.9E+8	1.5E+5	1.5E+8
Cs-137	6.1E+5	1.0E+10	9.1E+5	1.0E+10	8.5E+5	1.0E+10	6.2E+5	1.0E+10
Ba-140	1.5E+6	2.1E+7	1.7E+6	2.1E+7	2.0E+6	2.1E+7	1.3E+6	2.1E+7
Ce-141	5.2E+5	1.4E+7	5.4E+5	1.4E+7	6.1E+5	1.4E+7	3.6E+5	1.4E+7
Ce-144	9.8E+6	7.0E+7	1.2E+7	7.0E+7	1.3E+7	7.0E+7	7.8E+6	7.0E+7
I -131	1.5E+7	1.7E+7	1.6E+7	1.7E+7	1.5E+7	1.7E+7	1.2E+7	1.7E+7
I -132	1.7E+5	1.2E+6	1.9E+5	1.2E+6	1.5E+5	1.2E+6	1.1E+5	1.2E+6
I -133	3.6E+6	2.4E+6	3.8E+6	2.4E+6	2.9E+6	2.4E+6	2.2E+6	2.4E+6
I -134	4.5E+4	4.5E+5	5.1E+4	4.5E+5	4.0E+4	4.5E+5	3.0E+4	4.5E+5
I -135	7.0E+5	2.5E+6	7.9E+5	2.5E+6	6.2E+5	2.5E+6	4.5E+5	2.5E+6
UN-ID	6.5E+5	7.5E+6	1.0E+6	7.5E+8	1.2E+6	7.5E+8	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-9  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR R

Page 2 of 5

Pathway = San Clemente Ranch (No Residents)			Distance = 2.3 miles		
X/Q = 2.0E-7 sec/m <sup>3</sup>			D/Q = 1.0E-9 m <sup>-2</sup>		
Radio-Nuclide	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway
H -3	-0-	-0-	-0-	3.8E+3	-0-
Cr-51	-0-	-0-	-0-	4.8E+6	-0-
Mn-54	-0-	-0-	-0-	6.1E+8	-0-
Co-57	-0-	-0-	-0-	2.2E+8	-0-
Co-58	-0-	-0-	-0-	3.3E+8	-0-
Co-60	-0-	-0-	-0-	2.0E+9	-0-
Sr-89	-0-	-0-	-0-	3.1E+10	-0-
Si-90	-0-	-0-	-0-	1.3E+12	-0-
Zr-95	-0-	-0-	-0-	7.8E+8	-0-
Nb-95	-0-	-0-	-0-	2.4E+8	-0-
Ru-103	-0-	-0-	-0-	3.3E+8	-0-
Te-129m	-0-	-0-	-0-	2.3E+9	-0-
Cs-134	-0-	-0-	-0-	2.4E+10	-0-
Cs-135	-0-	-0-	-0-	9.0E+7	-0-
Cs-137	-0-	-0-	-0-	2.3E+10	-0-
Ba-140	-0-	-0-	-0-	1.1E+8	-0-
Ce-141	-0-	-0-	-0-	3.3E+8	-0-
Ce-144	-0-	-0-	-0-	9.2E+9	-0-
I -131	-0-	-0-	-0-	4.1E+9	-0-
I -132	-0-	-0-	-0-	6.0E-36	-0-
I -133	-0-	-0-	-0-	4.0E-11	-0-
I -134	-0-	-0-	-0-	6.1E-37	-0-
I -135	-0-	-0-	-0-	7.0E-35	-0-
UN-ID	-0-	-0-	-0-	2.5E+9	-0-

Inhalation Pathway, units =  $\frac{\mu\text{rem}/\text{yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem}/\text{yr})}{\mu\text{Ci}/\text{sec}}$

TABLE 2-9  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR R

Page 3 of 5

Pathway = SC Ranch Packing X/Q = 1.7E-07 sec/m <sup>3</sup>				Distance = 2.6 miles D/Q = 8.2E-10 m <sup>2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	4.3E+2	1.9E+3
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+3	8.3E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	4.8E+5	1.3E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+5	3.6E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	6.0E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+6	7.1E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	4.8E+5	7.6E+9
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	3.4E+7	5.8E+11
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	6.1E+5	9.9E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+5	3.6E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+5	4.2E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	9.6E+8
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+5	1.2E+10
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+4	8.7E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	1.1E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	4.4E+5	6.0E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	3.2E+8
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+6	9.0E+9
I -131	-0-	-0-	-0-	-0-	-0-	-0-	4.1E+6	1.4E+9
I -132	-0-	-0-	-0-	-0-	-0-	-0-	3.9E+4	4.2E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	7.4E+5	6.4E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+4	1.5E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	8.6E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+5	1.3E+9

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-9  
DOSE PARAMETER R, FOR SECTOR R

Page 4 of 5

Pathway = Sheep Meat X/Q = 8.3E-7 sec/m <sup>3</sup>				Distance = 0.9 miles D/Q = 5.2E-9 m <sup>2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I-131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I-132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I-133	-0-	-0-	-0-	1.6E-2	-0-	8.7E-3	1.2E+4	1.3E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I-135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+2	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^2}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-9  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR R

Page 5 of 5

Pathway = Deer Consumer X/Q = 1.8E-7 sec/m <sup>3</sup>				Distance = 2.2 miles D/Q = 0.8E-10 m <sup>-2</sup>				
Radio- Nuclide	Infant		Child		Teen		Adult	
	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway	Inhala- tion Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.8E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I -131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I -132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I -133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I -135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-10  
DOSE PARAMETER R, FOR SECTOR A

Page 1 of 3

Pathway = Camp San Mateo X/Q = 7.1E-8 sec/m <sup>3</sup>				Distance = 3.6 miles D/Q = 4.1E-10 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.9E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	8.5E+5	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+5	1.0E+10
Ba-130	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I-131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I-132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I-133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I-134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I-135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	6.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-10  
DOSE PARAMETER  $K_i$  FOR SECTOR A

Page 2 of 3

Radio- Nuclide	Infant		Child		Teen		Adult	
	Inhala- tion Pathway	Food & Ground Pathway						
H-3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+5
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	3.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I-131	-0-	-0-	-0-	6.5E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I-132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I-133	-0-	-0-	-0-	1.6E-2	-0-	8.7E-3	1.2E+4	1.3E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I-135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-10  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR A

Page 3 of 3

Pathway = Deer Consumer X/Q = 1.9E-7 sec/m <sup>3</sup>				Distance = 2.2 miles, D/Q = 1.4E-9 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	5.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I-131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I-132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I-133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I-135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-11  
DOSE PARAMETER R<sub>i</sub> FF<sup>-</sup> SECTOR B

Page 1 of 3

Pathway = Sheep (Meat), X/Q = 6.1E-6 sec/m <sup>3</sup>				Distance = 0.2 miles, D/Q = 5.3E-8 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I-131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I-132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I-133	-0-	-0-	-0-	1.6E-2	-0-	8.7E-3	1.2E+4	1.3E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I-135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-10	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\mu\text{rem}/\text{yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem}/\text{yr})}{\mu\text{Ci}/\text{sec}}$

TABLE 2-11  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR B

Page 2 of 3

Pathway = Deer Consumer X/Q = 3.4E-7 sec/m <sup>3</sup>				Distance = 1.1 miles D/Q = 2.4E-9 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	0.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I-131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I-132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I-133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I-124	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I-135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-11  
 DOSE PARAMETER R<sub>i</sub> FOR SECTOR B

Page 3 of 3

Pathway = Sanitary Landfill X/Q = 1.4E-7 sec/m <sup>3</sup>				Distance = 2.1 miles D/Q = 1.2E-9 m <sup>2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+3	1.1E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	3.2E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	8.4E+4	7.8E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	8.7E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	4.9E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	4.9E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	5.7E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	3.1E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	2.5E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+5	4.5E+5
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.9E+5	1.6E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+4	3.4E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	2.3E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+5	4.7E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	8.3E+4	3.1E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	1.6E+7
I-131	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+6	3.9E+6
I-132	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+4	2.8E+5
I-133	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+5	5.6E+5
I-134	-0-	-0-	-0-	-0-	-0-	-0-	6.8E+3	1.0E+5
I-135	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+5	5.8E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	1.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-12  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR C

Page 1 of 5

Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway						
H-3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.9E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	8.5E+5	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+5	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.3E+6	7.0E+7
I-131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I-132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I-133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I-134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I-135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-12  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR C

Page 2 of 5

Pathway = Camp San Onofre Fr. Stn X/Q = 1.1E-7 sec/m <sup>3</sup>			Distance = 2.3 miles D/Q = 1.1E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	5.2E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	5.9E+3	1.9E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	5.8E+5	5.7E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	3.8E+5	1.6E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+6	8.8E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	5.8E+5	8.9E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	4.1E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	7.3E+5	1.0E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	5.6E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	4.5E+7
Te-129m	-0-	-0-	+0-	-0-	-0-	-0-	4.0E+5	8.1E+5
Cs-134	-0-	-0-	+0-	-0-	-0-	-0-	3.6E+5	2.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+4	6.2E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+5	4.2E+9
Ba-140	-0-	-0-	+0-	-0-	-0-	-0-	5.2E+5	8.4E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	5.6E+6
Ce-144	0-	-0-	-0-	-0-	-0-	-0-	3.2E+6	2.9E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+6	7.1E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	4.7E+4	5.1E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	8.8E+5	1.0E+6
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+4	1.0E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+5	1.0E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	3.1E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-12  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR C

Page 3 of 5

Pathway = Sewage Facility X/Q = 1.2E-7 sec/m <sup>3</sup>			Distance = 2.2 miles D/Q = 1.2E-9 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+3	1.1E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	3.2E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	8.4E+4	7.8E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	8.7E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	4.9E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	4.9E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	5.7E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	3.1E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	2.5E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+5	4.5E+5
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.9E+5	1.6E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+4	3.4E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	2.3E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+5	4.7E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	8.3E+4	3.1E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	1.6E+7
I-131	-0-	-0-	+0+	-0-	-0-	-0-	2.7E+6	3.9E+6
I-132	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+4	2.8E+5
I-133	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+5	5.6E+5
I-134	-0-	-0-	-0-	-0-	-0-	-0-	6.8E+3	1.0E+5
I-135	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+5	5.8E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	1.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-12  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR C

Page 4 of 5

Pathway = Sheep (Meat) X/Q = 6.5E-6 sec/m <sup>3</sup>				Distance = 0.2 miles D/Q = 6.1E-8 m <sup>2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	5.4E+3	7.5E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I -131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I -132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I -133	-0-	-0-	-0-	1.6E-2	-0-	8.7E-3	1.2E+4	1.3E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I -135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-12  
DOSE PARAMETER  $R_i$  FOR SECTOR C

Page 5 of 5

Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway						
H-3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+3
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I-131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I-132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I-133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I-135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-13  
DOSE PARAMETER R, FOR SECTOR D

Page 1 of 3

Pathway = Camp San Onofre X/Q = 6.6E-8 sec/m <sup>3</sup>				Distance = 2.8 miles D/Q = 6.4E-10 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.9E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	8.5E+5	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+5	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I-131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I-132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I-133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I-134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I-135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-13  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR D

Page 2 of 3

Pathway = Sheep (Meat) X/Q = 6.3E-6 sec/m <sup>3</sup>				Distance = 0.2 miles D/Q = 6.6E-8 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.5E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I-131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I-132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I-133	-0-	-0-	-0-	1.6E-2	-0-	8.7E-3	1.2E+4	1.3E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I-135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-15	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-13  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR D

Page 3 of 3

Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway						
H-3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I-131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I-132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I-133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I-135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-14  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR E

Page 1 of 3

Pathway = Camp Horro X/Q = 6.6E-8 sec/m <sup>3</sup>			Distance = 4.0 miles D/Q = 6.4E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H - 3	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+3	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+4	4.7E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	1.4E+9
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	3.4E+8
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	9.3E+5	3.8E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	6.0E+6	2.2E+10
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	2.2E+4
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	9.9E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	2.5E+8
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.4E+8
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	5.0E+5	1.1E+8
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+6	2.0E+7
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	8.5E+5	6.8E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.5E+8
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+5	1.0E+10
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	2.1E+7
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	1.4E+7
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	7.8E+6	7.0E+7
I - 131	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+7	1.7E+7
I - 132	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.2E+6
I - 133	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.4E+6
I - 134	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+4	4.5E+5
I - 135	-0-	-0-	-0-	-0-	-0-	-0-	4.5E+5	2.5E+6
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+5	7.5E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-14  
DOSE PARAMETER R, FOR SECTOR E

Page 2 of 3

Pathway = Sheep (Heat) X/Q = 4.5E-6 sec/m <sup>3</sup>				Distance = 0.3 miles D/Q = 5.9E-8 m <sup>2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+5
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I -131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I -132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I -133	-0-	-0-	-0-	1.6E-2	-0-	6.7E-3	1.2E+1	1.3E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I -135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-14  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR E

Page 3 of 3

Pathway = Deer Consumer X/Q = 3.7E-7 sec/m <sup>3</sup>				Distance = 1.2 miles D/Q = 8.3E-9 m <sup>2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
I-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I-131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I-132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I-133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I-135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-15  
DOSE PARAMETER R, FOR SECTOR F

Page 1 of 4

Pathway = San Onofre State Park Guard Shack X/Q = 8.6E-7 sec/m <sup>3</sup>			Distance = 0.8 miles, D/Q = 7.5E-9 m <sup>2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+3	0.0E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	2.4E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+4	5.9E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+5	6.5E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+6	3.7E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	3.7E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	3.0E+5	4.3E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	2.3E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	8.6E+4	1.9E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	3.4E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.2E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+4	2.6E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	1.8E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+5	3.5E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	6.2E+4	2.3E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+6	1.2E+7
I-131	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+6	2.9E+6
I-132	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+4	2.1E+5
I-133	-0-	-0-	-0-	-0-	-0-	-0-	3.7E+5	4.2E+5
I-134	-0-	-0-	-0-	-0-	-0-	-0-	5.1E+3	7.7E+4
I-135	-0-	-0-	-0-	-0-	-0-	-0-	7.7E+4	4.3E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	1.5E+5	1.3E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-15  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR F

Page 2 of 4

Pathway = Border Patrol Neckpt. X/Q = 2.4E-7 sec/m <sup>3</sup>			Distance = 1.8 miles D/Q = 1.8E-9 m <sup>2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	4.1E+3	1.3E+6
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	3.9E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	1.1E+5	9.8E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+5	1.1E+8
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.7E+6	6.1E+9
Sr-89	-0-	-0-	+0-	-0-	-0-	-0-	4.0E+5	6.2E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.8E+7	-0-
Zr-95	-0-	-0-	+0-	-0-	-0-	-0-	5.0E+5	7.2E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	3.9E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	3.1E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+5	5.6E+5
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	2.4E+5	1.9E+9
Cs-136	-0-	-0-	+0-	-0-	-0-	-0-	4.2E+4	4.3E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+5	2.9E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	3.6E+5	5.9E+5
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+5	3.9E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	2.2E+6	2.0E+7
I-131	-0-	-0-	-0-	-0-	-0-	-0-	3.4E+6	4.9E+6
I-132	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+4	3.5E+5
I-133	-0-	-0-	-0-	-0-	-0-	-0-	6.1E+5	7.0E+5
I-134	-0-	-0-	-0-	-0-	-0-	-0-	8.5E+3	1.3E+5
I-135	-0-	-0-	-0-	-0-	-0-	-0-	1.3E+5	7.2E+5
UN-ID	-0-	-0-	+0-	-0-	-0-	-0-	2.5E+5	2.1E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-15  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR F

Page 3 of 4

Pathway = Sheep (Meat) X/Q = 1.9E-6 sec/m <sup>3</sup>				Distance = 0.5 miles D/Q = 1.7E-8 m <sup>2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Cr-51	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Mn-54	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Co-57	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Co-58	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Co-60	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-90	-0-	-0-	-0-	1.0E+6	-0-	8.1E+5	5.5E+5	1.3E+6
Zr-95	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.6E+6
Nb-95	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Ce-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I-131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I-132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I-133	-0-	-0-	-0-	1.6E-2	-0-	8.7E-3	1.2E+4	1.3E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I-135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrrem/yr})}{\mu\text{Ci}/\text{sec}}$

TABLE 2-15  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR F

Page 4 of 4

Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway						
H-3	-0-	-0-	-0+	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0+	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0+	7	-0-	1.4E+6	3.8E+4	4.1E+7
Co-57	-0-	-0-	-0+		-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0+		-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0+	3.8E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0+	4.9E+7	-0-	2.6E+7	3.8E+4	3.1E+7
Sr-90	-0-	-0-	-0+	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0+	6.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0+	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0+	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0+	3.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0+	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0+	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0+	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0+	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0+	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0+	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I-131	-0-	-0-	-0+	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I-132	-0-	-0-	-0+	-0-	-0-	-0-	3.1E+3	3.4E+4
I-133	-0-	-0-	-0+	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I-134	-0-	-0-	-0+	-0-	-0-	-0-	8.2E+2	1.2E+4
I-135	-0-	-0-	-0+	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-1D	-0-	-0-	-0+	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-16  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR G

Page 1 of 4

Pathway = San Onofre State Beach Campground X/Q = 7.7E-7 sec/m <sup>3</sup>			Distance = 0.8 miles D/Q = 3.9E-9 m <sup>2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	8.0E+1	-0-	1.4E+2	-0-	1.6E+2	-0-	2.9E+2	-0-
Cr-51	1.6E+3	5.7E+5	2.1E+3	5.7E+5	2.6E+3	5.7E+5	3.3E+3	1.1E+6
Mn-54	1.2E+5	1.7E+8	1.9E+5	1.7E+8	2.4E+5	1.7E+8	3.2E+5	3.2E+8
Co-57	4.7E+4	4.2E+7	6.3E+4	4.2E+7	7.2E+4	4.2E+7	8.4E+4	7.8E+7
Co-58	9.6E+4	4.7E+7	1.4E+5	4.7E+7	1.7E+5	4.7E+7	2.1E+5	8.7E+7
Co-60	5.6E+5	2.7E+9	8.7E+5	2.7E+9	1.1E+6	2.7E+9	1.4E+6	4.9E+9
Sr-89	2.5E+5	2.7E+3	2.7E+5	2.7E+3	3.0E+5	2.7E+3	3.2E+5	4.9E+3
Sr-90	5.0E+6	-0-	1.2E+7	-0-	1.3E+7	-0-	2.3E+7	-0-
Zr-95	2.2E+5	3.1E+7	2.8E+5	3.1E+7	3.3E+5	3.1E+7	4.0E+5	5.7E+7
Nb-95	5.9E+4	1.7E+7	7.6E+4	1.7E+7	9.3E+4	1.7E+7	1.2E+5	3.1E+7
Ru-103	6.8E+4	1.3E+7	8.2E+4	1.3E+7	9.7E+4	1.3E+7	1.2E+5	2.5E+7
Te-129m	2.1E+5	2.4E+6	2.2E+5	2.4E+6	2.4E+5	2.4E+6	2.6E+5	4.5E+6
Cs-134	8.7E+4	8.4E+8	1.3E+5	8.4E+8	1.4E+5	8.4E+8	1.9E+5	1.6E+9
Cs-136	1.7E+4	1.9E+7	2.1E+4	1.9E+7	2.4E+4	1.9E+7	3.3E+4	3.4E+7
Cs-137	7.5E+4	1.3E+9	1.1E+5	1.3E+9	1.0E+5	1.3E+9	1.4E+5	2.3E+9
Ba-140	2.0E+5	2.5E+6	2.1E+5	2.5E+6	2.5E+5	2.5E+6	2.9E+5	4.7E+6
Ce-141	6.4E+4	1.7E+6	6.7E+4	1.7E+6	7.6E+4	1.7E+6	8.3E+4	3.1E+6
Ce-144	1.2E+6	8.6E+6	1.5E+6	8.6E+6	1.6E+6	8.6E+6	1.8E+6	1.6E+7
I-131	1.8E+6	2.1E+6	2.0E+6	2.1E+6	1.8E+6	2.1E+6	2.7E+6	3.9E+6
I-132	2.1E+4	1.5E+5	2.4E+4	1.5E+5	1.9E+4	1.5E+5	2.6E+4	2.8E+5
I-133	4.4E+5	3.0E+5	4.7E+5	3.0E+5	3.6E+5	3.0E+5	4.9E+5	5.6E+5
I-134	5.5E+3	5.5E+4	6.3E+3	5.5E+4	4.9E+3	5.5E+4	6.8E+3	1.0E+5
I-135	8.6E+4	3.1E+5	9.8E+4	3.1E+5	7.7E+4	3.1E+5	1.0E+5	5.8E+5
UN-10	8.0E+4	9.2E+7	1.2E+5	9.2E+7	1.5E+5	9.2E+7	2.0E+5	1.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci}/\text{sec}}$

TABLE 2-16  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR G

Page 2 of 4

Pathway = Hwy Patrol Weigh Station X/Q = 2.0E-7 sec/m <sup>3</sup>			Distance = 2.0 miles D/Q = 8.5E-10 m <sup>-2</sup>					
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H -3	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+2	-0-
Cr-51	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+3	1.1E+5
Mn-54	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	3.2E+8
Co-57	-0-	-0-	-0-	-0-	-0-	-0-	8.4E+4	7.8E+7
Co-58	-0-	-0-	-0-	-0-	-0-	-0-	2.1E+5	8.7E+7
Co-60	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+6	4.9E+9
Sr-89	-0-	-0-	-0-	-0-	-0-	-0-	3.2E+5	4.9E+3
Sr-90	-0-	-0-	-0-	-0-	-0-	-0-	2.3E+7	-0-
Zr-95	-0-	-0-	-0-	-0-	-0-	-0-	4.0E+5	5.7E+7
Nb-95	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	3.1E+7
Ru-103	-0-	-0-	-0-	-0-	-0-	-0-	1.2E+5	2.5E+7
Te-129m	-0-	-0-	-0-	-0-	-0-	-0-	2.5E+5	4.5E+6
Cs-134	-0-	-0-	-0-	-0-	-0-	-0-	1.9E+5	1.6E+9
Cs-136	-0-	-0-	-0-	-0-	-0-	-0-	3.3E+4	3.4E+7
Cs-137	-0-	-0-	-0-	-0-	-0-	-0-	1.4E+5	2.3E+9
Ba-140	-0-	-0-	-0-	-0-	-0-	-0-	2.9E+5	4.7E+6
Ce-141	-0-	-0-	-0-	-0-	-0-	-0-	8.3E+4	3.1E+6
Ce-144	-0-	-0-	-0-	-0-	-0-	-0-	1.8E+6	1.6E+7
I -131	-0-	-0-	-0-	-0-	-0-	-0-	2.7E+6	3.9E+6
I -132	-0-	-0-	-0-	-0-	-0-	-0-	2.6E+4	2.8E+5
I -133	-0-	-0-	-0-	-0-	-0-	-0-	4.9E+5	5.6E+5
I -134	-0-	-0-	-0-	-0-	-0-	-0-	6.8E+3	1.0E+5
I -135	-0-	-0-	-0-	-0-	-0-	-0-	1.0E+5	5.8E+5
UN-ID	-0-	-0-	-0-	-0-	-0-	-0-	2.0E+5	1.7E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-16  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR G

Page 3 of 4

Pathway = Sheep (Meat), X/Q = 2E-7 sec/m <sup>3</sup>			Distance = 2.7 miles D/Q = 4.8E-10 m <sup>-2</sup>					
Ra - Nuc,ide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
Ra-226	-0-	-0-	-0-	1.5E+0	-0-	1.2E+0	7.0E+0	2.1E+0
Ra-228	-0-	-0-	-0-	5.1E+1	-0-	1.0E+2	7.9E+1	2.6E+4
Ra-228	-0-	-0-	-0-	7.8E+2	-0-	1.4E+3	7.7E+3	7.6E+6
Ra-228	-0-	-0-	-0-	4.7E+3	-0-	8.1E+3	2.0E+3	1.9E+6
Ra-228	-0-	-0-	-0-	9.7E+3	-0-	2.0E+4	5.1E+3	2.1E+6
Ra-228	-0-	-0-	-0-	3.7E+4	-0-	7.3E+4	3.3E+4	1.2E+8
Sr-89	-0-	-0-	-0-	5.0E+4	-0-	2.6E+4	7.7E+3	3.1E+4
Sr-89	-0-	-0-	-0-	1.0E+5	-0-	8.1E+5	5.5E+5	1.3E+5
Zr-90	-0-	-0-	-0-	6.3E+4	-0-	1.1E+5	9.7E+3	1.8E+6
Nb-93	-0-	-0-	-0-	2.4E+5	-0-	4.5E+5	2.8E+3	1.6E+6
Ru-103	-0-	-0-	-0-	4.2E+5	-0-	7.6E+5	2.8E+3	1.9E+6
Te-129m	-0-	-0-	-0-	6.0E+5	-0-	4.5E+5	6.4E+3	7.6E+5
Cs-134	-0-	-0-	-0-	1.4E+5	-0-	1.2E+5	4.7E+3	3.8E+7
Cs-136	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	8.1E+2	8.3E+5
Cs-137	-0-	-0-	-0-	1.3E+5	-0-	9.5E+4	3.4E+3	5.7E+7
Ba-140	-0-	-0-	-0-	5.1E+3	-0-	4.3E+3	7.0E+3	1.2E+5
Cn-141	-0-	-0-	-0-	1.5E+3	-0-	2.4E+3	2.0E+3	7.9E+4
Ce-144	-0-	-0-	-0-	1.8E+4	-0-	3.0E+4	4.3E+4	4.3E+5
I -131	-0-	-0-	-0-	6.6E+5	-0-	4.4E+5	6.6E+4	7.0E+5
I -132	-0-	-0-	-0-	-0-	-0-	-0-	6.3E+2	6.8E+3
I -133	-0-	-0-	-0-	1.6E-2	-0-	8.7E-3	1.2E+4	1.3E+4
I -134	-0-	-0-	-0-	-0-	-0-	-0-	1.6E+2	2.5E+3
I -135	-0-	-0-	-0-	1.1E-18	-0-	6.4E-19	2.5E+3	1.4E+4
UN-ID	-0-	-0-	-0-	1.1E+5	-0-	9.5E+4	4.8E+3	4.2E+6

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

TABLE 2-16  
DOSE PARAMETER R<sub>i</sub> FOR SECTOR G

Page 4 of 4

Pathway = Deer Consumer X/Q = 8.8E-8 sec/m <sup>3</sup>				Distance = 3.3 miles D/Q = 3.2E-10 m <sup>-2</sup>				
Radio-Nuclide	Infant		Child		Teen		Adult	
	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway	Inhalation Pathway	Food & Ground Pathway
H-3	-0-	-0-	-0-	2.8E+1	-0-	2.3E+1	3.5E+1	3.9E+1
Cr-51	-0-	-0-	-0-	5.0E+4	-0-	1.0E+5	3.9E+2	3.2E+5
Mn-54	-0-	-0-	-0-	7.7E+5	-0-	1.4E+6	3.8E+4	4.1E+7
Cn-57	-0-	-0-	-0-	4.6E+6	-0-	8.0E+6	1.0E+4	2.3E+7
Co-58	-0-	-0-	-0-	9.6E+6	-0-	1.9E+7	2.5E+4	4.7E+7
Co-60	-0-	-0-	-0-	3.6E+7	-0-	7.2E+7	1.6E+5	7.2E+8
Sr-89	-0-	-0-	-0-	4.9E+7	-0-	2.6E+7	3.0E+4	3.1E+7
Sr-90	-0-	-0-	-0-	1.0E+9	-0-	8.0E+8	2.7E+6	1.2E+9
Zr-95	-0-	-0-	-0-	6.2E+7	-0-	1.1E+8	4.8E+4	2.0E+8
Nb-95	-0-	-0-	-0-	2.3E+8	-0-	4.5E+8	1.4E+4	8.2E+8
Ru-103	-0-	-0-	-0-	4.2E+8	-0-	7.5E+8	1.4E+4	1.3E+9
Te-129m	-0-	-0-	-0-	5.9E+8	-0-	4.5E+8	3.2E+4	6.4E+8
Cs-134	-0-	-0-	-0-	1.4E+8	-0-	1.2E+8	2.3E+4	3.4E+8
Cs-136	-0-	-0-	-0-	5.1E+6	-0-	4.2E+6	4.0E+3	9.5E+6
Cs-137	-0-	-0-	-0-	1.3E+8	-0-	9.3E+7	1.7E+4	4.0E+8
Ba-140	-0-	-0-	-0-	5.0E+6	-0-	4.2E+6	3.5E+4	7.4E+6
Ce-141	-0-	-0-	-0-	1.5E+6	-0-	2.4E+6	9.9E+3	4.2E+6
Ce-144	-0-	-0-	-0-	1.8E+7	-0-	2.9E+7	2.1E+5	4.9E+7
I-131	-0-	-0-	-0-	6.5E+8	-0-	4.3E+8	3.3E+5	5.9E+8
I-132	-0-	-0-	-0-	-0-	-0-	-0-	3.1E+3	3.4E+4
I-133	-0-	-0-	-0-	1.6E+1	-0-	8.6E+0	5.9E+4	6.7E+4
I-134	-0-	-0-	-0-	-0-	-0-	-0-	8.2E+2	1.2E+4
I-135	-0-	-0-	-0-	1.1E-15	-0-	6.3E-16	1.2E+4	6.9E+4
UN-ID	-0-	-0-	-0-	1.1E+8	-0-	9.4E+7	2.4E+4	1.4E+8

Inhalation Pathway, units =  $\frac{\text{mrem/yr}}{\mu\text{Ci}/\text{m}^3}$

Food & Ground Pathway, units =  $\frac{(\text{m}^2)(\text{mrem/yr})}{\mu\text{Ci/sec}}$

## 2.9 TOTAL DOSE CALCULATIONS

### 2.9.1 Total Dose to Most Likely Member of the Public

The total annual dose or total dose commitment to any member of the public, due to releases of radioactivity and to radiation, from uranium fuel cycle sources within 5 miles of the Site is calculated using the following expressions. This methodology is used to meet the dose limitations of 40 CFR 190 per twelve consecutive months. The transportation of radioactive material is excluded from the dose calculations.

The Annual Total Dose is determined monthly for maximum organ (gas & liquid), whole body (gas & liquid) and thyroid (gas & liquid) to verify that the Site total (Units 1, 2 and 3) is less than or equal to 25 mrem, 25 mrem, and 75 mrem respectively.

#### .1 Annual Total Organ Dose ( $D_{TOT}(O)$ )

$$D_{TOT}(O) = \sum_{j=1}^{12} \sum_{i=1}^{2/3} [D_{ji}(OG) + D_{ji}(OL) + D_{ji}^{H^3}(OG)] \quad (2-20)$$

where:

\*NOTE:  $D_{ji}^{H^3}(OG) = 0$  for one

\*\*All to be summed over the most recent 12 months.

$$D_{ji}(OG) = K \sum_{i=1}^n C_{ii} R_{ik} W_k \quad (2-21)$$

i = each isotope in specific organ category

j = Units 1, 2 and 3

l = months 1 - 12\*\*

$$K = 3.1688E-2 \frac{\text{year}-\mu\text{Ci}}{\text{sec}-\text{Ci}}$$

## 2.9 TOTAL DOSE CALCULATIONS (Continued)

### 2.9.1 Total Dose to Most Likely Member of the Public (Continued)

$n$  = number of isotopes in the specified organ category

$C_{ij}$  = total particulate gas curies released for the month

$\Sigma R_{ik} W_k$  = controlling location factors from ODCM Tables 2-6, Units 1 and 2/3

$D_{j1}(OL)$  = liquid organ dose for the specified organ in mrem for the month. [Reference ODCM Units 2/3 (1-19), Unit 1 (1-13)]

$D_{j1}^{H^3}(OG)*$  = gas organ dose from tritium in mrem for the month.

### .2 Annual Total Whole Body Dose $D_{TOT}(WB)$

$$D_{TOT}(WB) = \sum_{l=1}^{12} \sum_{j=1}^{2/3} \left[ D_{j1}(WBL) + D_{j1}^{H^3}(OG) - 0.9 D_{j1}(\gamma) \right] \rightarrow D(DIRECT) \quad (2-22)$$

where:

$j$  = Units 1, 2 and 3

$l$  = months 1 - 12, to be summed over the most recent 12 months

$D_{j1}(WBL)$  = liquid whole body organ dose in mrem for the whole month. [Reference ODCM Units 2/3 (1-19), ODCM Unit 1 (1-13)]

$D_{j1}^{H^3}(OG)$  = gas organ dose from tritium in mrem for the month. (from (2-21))

$D_{j1}(\gamma)$  = gamma air dose in mrads for the month.  
0.9 converts mrads to mrem.  
[Reference ODCM Units 2/3 (2-14), ODCM Unit 1 (2-10)]

$$D(DIRECT) = \sum_{q=1}^4 \left[ \max[D(beach)_p] - \frac{\sum_{p=1}^n D(bkgd)_p}{n} \right] .0342 \quad (2-23)$$

$p$  = for all TLDs per quarter

$q$  = for Quarters 1-4

## 2.9 TOTAL DOSE CALCULATIONS (Continued)

### 2.9.1.2 Annual Total Whole Body Dose $D_{TOT}(WB)$ (Continued)

#### \*Direct Radiation

The direct radiation levels are evaluated most recently using cadmium covered TLDs. The TLDs are placed at 59 locations around the site. The average dose from TLDs 5 to 50 miles from the site is used as background. These sites are subject to change.

The background is subtracted from the highest reading plant surrounding area TLD. This value is the direct dose but must be prorated by the occupancy factor.

Example: beach time of 300 hours, or 8 hours for landward occupancy.      yr      yr

#### .3 Annual Total Thyroid Dose $D_{TOT}(T)$

$$D_{TOT}(T) = \sum_{l=1}^{12} \sum_{j=1}^{2/3} [D_{jl}(OG) + D_{jl}(OL)] \quad (i-21)$$

where:

j = Units 1, 2 and 3

l = months 1 - 12, to be summed over the most recent 12 months

$D_{jl}(OG)$  = thyroid organ dose from gaseous iodine for the month in mrem. (from 2-21)

$D_{jl}(OL)$  = liquid thyroid organ dose for the month in mrem. [Reference ODCM Units 2/3 (1-19), Unit 1 ODCM (1-13)]

## 3.0 PROJECTED DOSES

### 3.1 Liquid Dose Projection

The methodology used for projecting a liquid dose over 31 days for Specification 1.3.1 is as follows:

1. Determine the monthly total body and organ doses resulting from releases during the previous twelve months.
2. Projected dose = Previous 12 months' dose divided by 12 for the total body and each organ.

### 3.2 Gaseous Dose Projection

The methodology used for projecting a gaseous dose over 31 days for Specification 2.4.1 is as follows:

1. Determine the monthly gamma, beta and organ dose resulting from releases during the previous twelve months.
2. Projected dose = Previous 12 months' dose divided by 12 for the gamma, beta and organ doses.

## 4.0 EQUIPMENT

### 4.1 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SPECIFICATION

4.1.1 The radioactive liquid effluent monitoring instrumentation channels shown in Table 4-1 shall be OPERABLE with the alarm/trip setpoints set to ensure that the limits of Specification 1.1.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with Section 1.4.

APPLICABILITY: At all times

ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above specification, immediately suspend the release of radioactive liquid effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 4-1. Exert best efforts to return the instrument to OPERABLE status within 30 days and, additionally, if the inoperable instrument(s) remain inoperable for greater than 30 days, explain in the next Semiannual Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner.
- c. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE and either the appropriate ACTION items in Table 4-1 not taken or the necessary surveillances not performed at the specified frequency prescribed in Table 4-2, an INVESTIGATIVE REPORT shall be prepared which identifies the cause(s) for the event and defines the corrective actions to be taken to preclude recurrence of the event.

SURVEILLANCE REQUIREMENTS

- .1 Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4-2.
- .2 At least once per 4 hours, all pumps required to be providing dilution to meet the site radioactive effluent concentration limits of Specification 1.1.1 shall be determined to be operating and providing dilution to the discharge structure.

TABLE 4-1  
RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT*</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
1. GROSS RADIOACTIVITY MONITORS PROVIDING ALARM TERMINATION OF RELEASE		
a. Liquid Radwaste Effluent Line - 2/3 RT-7813	1	28
b. Steam Generator Blowdown (Neutralization Sump), Full Flow Condensate Polisher Effluent Line - 2(3)RT-7817	1	29
c. Turbine Plant Sumps, Auxiliary Building Sump, Component Cooling Water Sumps, Storage Tank Area Sumps Effluent Line- 2(3)RT-7821	1	30
d. Steam Generator (E088) Blowdown Effluent Line - 2(3)RT6759	1	29
e. Steam Generator (E089) Blowdown Effluent Line - 2(3)RT6753	1	29
2. FLOW RATE MEASUREMENT DEVICES		
a. Liquid Radwaste Effluent Line	1	31
b. Steam Generator Blowdown (Neutralization Sump), Full Flow Condensate Polisher Effluent Line	1	31
c. Steam Generator (E088) Blowdown Bypass Effluent Line	1	31
d. Steam Generator (E089) Blowdown Bypass Effluent Line	1	31

TABLE 4-1 (Continued)

TABLE NOTATION

- \* Monitor Recorders are not required for the Operability of the monitor, providing the inoperable recorder does not cause the monitor to become inoperable (i.e., feedback signal). As long as the monitor has indication, alarm capability (if applicable), proper response (based upon surveillance requirements) and isolation function (if applicable), the loss of the recorder does not render the monitor inoperable.

ACTION 28 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, effluent releases may continue provided that prior to initiating a release:

- a. At least two independent samples are analyzed in accordance with Specification 1.1.1 and
- b. At least two technically qualified members of the Facility Staff independently verify the release rate calculation and discharge line valving;

Otherwise, suspend release of radioactive effluents via this pathway.

ACTION 29 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are analyzed for gross radioactivity (beta or gamma) at a limit of detection of at least  $10^7$  microcuries/gram:

- a. At least once per 8 hours when the specific activity of the secondary coolant is greater than 0.01 microcuries/gram DOSE EQUIVALENT I-131;
- b. At least once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01 microcuries/gram DOSE EQUIVALENT I-131; or
- c. Lock closed valve HV-3773 and divert flow to T-064 for processing as liquid radwaste.

ACTION 30 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that, at least once per 12 hours, grab samples are collected and analyzed within 4 hours of collection time for gross radioactivity (beta or gamma) at a limit of detection of at least  $10^7$  microcuries/ml or lock closed valve S2(3)2419MU077 or S2(3)2419MU078 and divert flow to the radwaste sump for processing as liquid radwaste.

ACTION 31 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours during actual releases. Pump curves may be used to estimate flow.

TABLE 4-2  
RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT**</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNELS CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>
1. GROSS BETA OR GAMMA RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE				
a. Liquid Radwaste Effluents Line - 2/3 RT-7813	D	P	R(2)	Q(1)
b. Steam Generator Blowdown (Neutralization Sump), Full Flow Condensate Polisher Effluent Line - 2(3)RT-7817	D	M	R(2)	Q(1)
c. Turbine Plant Sump, Auxiliary Building Sump, Component Cooling Water Sumps, Storage Tank Area Sumps Effluent Line - 2(3)RT-7821	D	M	R(2)	Q(1)
d. Steam Generator (E088) Blowdown Bypass Effluent Line - 2(3)RT-6759	D	K	R(2)	Q(1)
e. Steam Generator (E089) Blowdown Bypass Line - 2(3)RT6753	D	M	R(2)	Q(1)
2. FLOW RATE MEASUREMENT DEVICES				
a. Liquid Radwaste Effluent Line	D(3)	N.A.	R	Q
b. Steam Generator Blowdown (Neutralization Sump), Full Flow Condensate Polisher Effluent Line	D(3)	N.A.	R	Q
c. Steam Generator (E088) Blowdown Bypass Effluent Line	D(3)	N.A.	R	Q
d. Steam Generator (E089) Blowdown Bypass Effluent Line	D(3)	N.A.	R	Q

TABLE 4-2 (Continued)

TABLE NOTATION

\*\* Monitor Recorders are not required for the Operability of the monitor, providing the inoperable recorder does not cause the monitor to become inoperable (i.e., feedback signal). As long as the monitor has indication, alarm capability (if applicable), proper response (based upon surveillance requirements) and isolation function (if applicable), the loss of the recorder does not render the monitor inoperable.

- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate verification of effluent path isolation closure and Control Room alarm annunciation if any of the following conditions exist:<sup>\*</sup>
1. Instrument indicates measured levels above the alarm/trip setpoint.
  2. Circuit failure.
  3. Instrument indicates a downscale failure.
- (2) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.
- (3) CHANNEL CHECK shall consist of verifying indication of flow during periods of release CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made.

<sup>\*</sup>If the instrument controls are not in the operate mode, procedures shall require that the channel be declared inoperable.

## 4.0 EQUIPMENT

### 4.2 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SPECIFICATION

4.2.1 The radioactive gaseous effluent monitoring instrumentation channels shown in Table 4-3 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of Specification 2.1.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with ODCM.

APPLICABILITY: At all times

ACTION:

- a. With a radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above specification, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 4-3. Exert best efforts to return the instrument to OPERABLE status within 30 days and, additionally, if the inoperable instrument(s) remain inoperable for greater than 30 days, explain in the next Semiannual Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner.
- c. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE and either the appropriate ACTION items in Table 4-3 not taken or the necessary surveillances not performed at the specified frequency prescribed in Table 4-4, an INVESTIGATIVE REPORT shall be prepared which identifies the cause(s) for the event and defines the corrective actions to be taken to preclude recurrence of the event.

SURVEILLANCE REQUIREMENTS

- .1 Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4-4.

TABLE 4-3

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT***</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
1. WASTE GAS HOLDUP SYSTEM			
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release - 2/3 RT-7808, 2 RT-7865-1 or 3 RT-7865-1	1	*	35
b. Process Flow Rate Monitoring Device	1	*	36
2. CONDENSER EVACUATION SYSTEM			
a. Noble Gas Activity Monitor - 2(3)RT-7818 or 2(3)RT-7870-1	1	**	37
b. Iodine Sampler	1	**	40
c. Particulate Sampler	1	**	40
d. Associated Sample Flow Measuring Device	1	**	36
e. Process Flow Rate Monitoring Device	1(1)	**	36
3. PLANT VENT STACK			
a. Noble Gas Activity Monitor - 2/3 RT-7808, or 2RT-7865-1 and 3RT-7865-1	1(3)	*	37 R
b. Iodine Sampler	1(3)	*	40
c. Particulate Sampler	1(3)	*	40
d. Associated Sample Flow Measuring Device	1(3)	*	36
e. Process Flow Rate Monitoring Device	2(2)	*	36
4. CONTAINMENT PURGE SYSTEM			
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release - 2(3)RT-7828, or 2(3)RT-7865-1	1	*	38
b. Iodine Sampler	1	*	40
c. Particulate Sampler	1	*	40
d. Process Flow Rate Monitoring Device	1	*	36
e. Associated Sample Flow Measuring Device	1	*	36

TABLE 4-3 (Continued)

TABLE NOTATION

- \* At all times.
- \*\* MODES 1-4 with any main steam isolation valve and/or any main steam isolating bypass valve not fully closed.
- \*\*\* Monitor Recorders are not required for the Operability of the monitor, providing the inoperable recorder does not cause the monitor to become inoperable (i.e., feedback signal). As long as the monitor has indication, alarm capability (if applicable), proper response (based upon surveillance requirements) and isolation function (if applicable), the loss of the recorder does not render the monitor inoperable.

- (1) 2(3)RT-7818 is not equipped to monitor process flow. If another means of continuously monitoring process flow is not available, then comply with ACTION 36.
- (2) 2/3RT-7808 is not equipped to monitor process flow. If 2RT-7865 and 3RT-7865 is not available to continuously monitor plant vent stack flow, then comply with ACTION 36. | R
- (3) Due to unequal mixing in the Plant Vent Stack, both 2RT-7865 and 3RT-7865 are required to be operable when 2/3RT-7808 is inoperable. | A

ACTION 35 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment provided that prior to initiating the release:

- a. At least two independent samples of the tank's contents are analyzed, and
- b. At least two technically qualified members of the Facility Staff independently verify the release rate calculations and discharge valve lineup;

Otherwise, suspend releases of radioactive effluents via this pathway.

ACTION 36 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 8 hours. System design characteristics may be used to estimate flow.

ACTION 37 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided grab samples are taken at least once per 12 hours and these samples are analyzed for gross activity within 24 hours.

ACTION 38 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend PURGING of radioactive effluents via this pathway.

TABLE 4-3 (Continued)

TABLE NOTATION

ACTION 39 - Rema'ning in Technical Specifications.

ACTION 40 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the effected pathway may continue provided samples are continuously collected with auxiliary sampling equipment as required in Table 2-1.

TABLE 4-4

## RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT***</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNELS CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODE FOR WHICH SURVEILLANCE IS REQUIRED</u>
1. WASTE GAS HOLDUP SYSTEM					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release - 2/3 RT-7808, 2RT-7865-1, 3RT-7865-1	P	P	R(3)	Q(1)	*
b. Process Flow Rate Monitoring Device	P	N.A.	R	Q	*
2. CONDENSER EVACUATION SYSTEM					
a. Noble Gas Activity Monitor - 2(3)RT-7818, 2(3)RT-7870-1	O	M	R(3)	Q(2)	**
b. Iodine Sampler	M	N.A.	N.A.	N.A.	**
c. Particulate Sampler	M	N.A.	N.A.	N.A.	**
d. Associated Sample Flow Measuring Device	O	N.A.	R	Q	**
e. Process Flow Rate Monitoring Device (2(3)RT-7870-1)	O	N.A.	R	O	**

TABLE 4-4 (Continued)

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT***</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNELS CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODE FOR WHICH SURVEILLANCE IS REQUIRED</u>
3. PLANT VENT STACK					
a. Noble Gas Activity Monitor - 2/3 RT-7808, 2RT-7865-1, 3RT-7865-1	D	M	R(3)	Q(2)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Associated Sample Flow Measuring Device	D	N.A.	R	Q	*
e. Process Flow Rate Monitoring Device	D	N.A.	R	Q	*
4. CONTAINMENT PURGE SYSTEM					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release - 2(3)RT-7828, 2(2)RT-7865-1	D	P(4)	R(3)	Q(1)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Process Flow Rate Monitoring Device	D	N.A.	R	Q	*
e. Associated Sample Flow Measuring Device	D	N.A.	R	Q	*

TABLE 4-4 (Continued)

TABLE NOTATION


- \* At all times.
  - \*\* Modes 1-4 with any main steam isolation valve and/or any main steam isolating bypass valve not fully closed.
  - \*\*\* Monitor Recorders are not required for the Operability of the monitor, providing the inoperable recorder does not cause the monitor to become inoperable (i.e., feedback signal). As long as the monitor has indication, alarm capability (if applicable), proper response (based upon surveillance requirements) and isolation function (if applicable), the loss of the recorder does not render the monitor inoperable.
- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate verification of effluent path isolation closure and control room alarm annunciation if any of the following conditions exist:#
1. Instrument indicates measured level: above the alarm/trip setpoint.
  2. Circuit failure.
  3. Instrument indicates a downscale failure.
- (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:#
1. Instrument indicates measured levels above the alarm setpoint.
  2. Circuit failure.
  3. Instrument indicates a downscale failure.
- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Bureau of Standards or using standards that have been obtained from suppliers that participate in measurement assurance activities with NBS. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.
- (4) Prior to each release and at least once per month.

~~If the instrument controls are not set in the operate mode, procedures shall call for declaring the channel inoperable.~~

#### 4.3 OPERABILITY OF RADIOACTIVE WASTE EQUIPMENT

The flow diagrams defining the treatment paths and the components of the radioactive liquid, gaseous and solid waste management systems are shown in Figures 4-5 thru 4-7.

FIGURE 4-5 SONGS 2 & 3 RADIOACTIVE LIQUID WASTE TREATMENT SYSTEMS

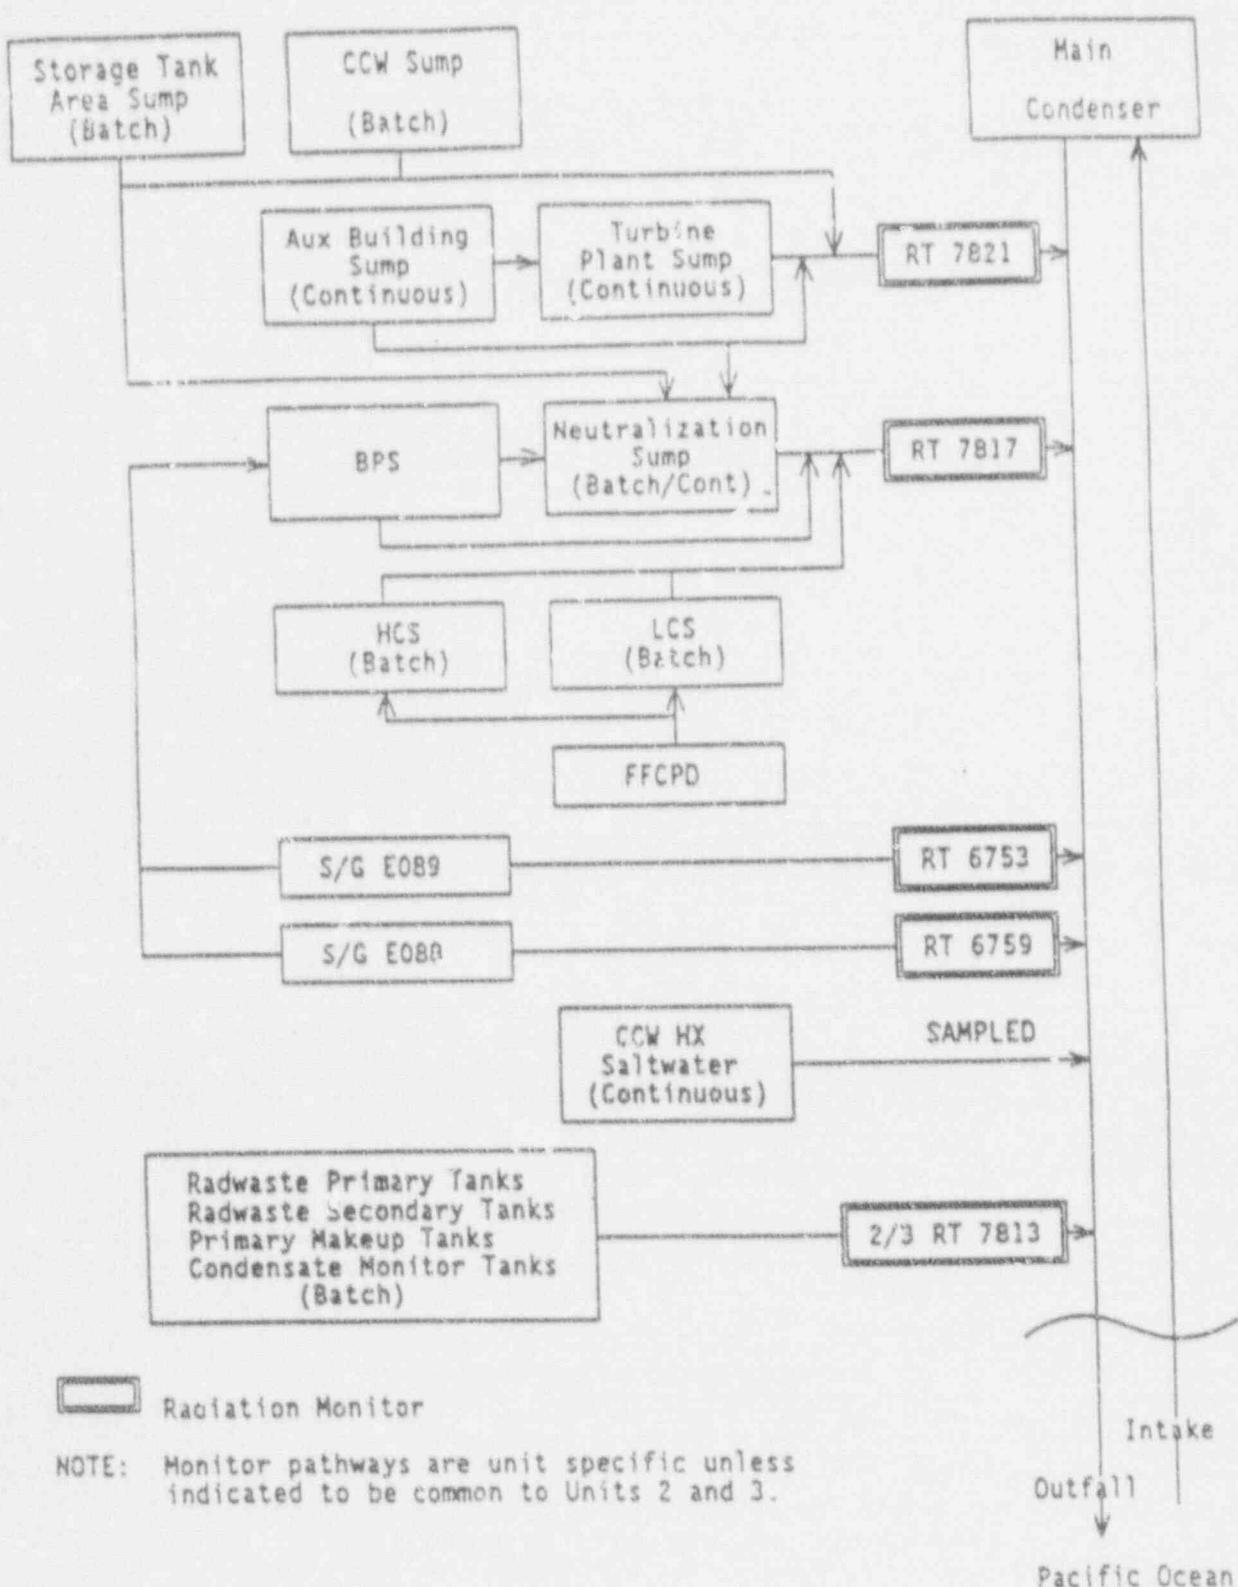

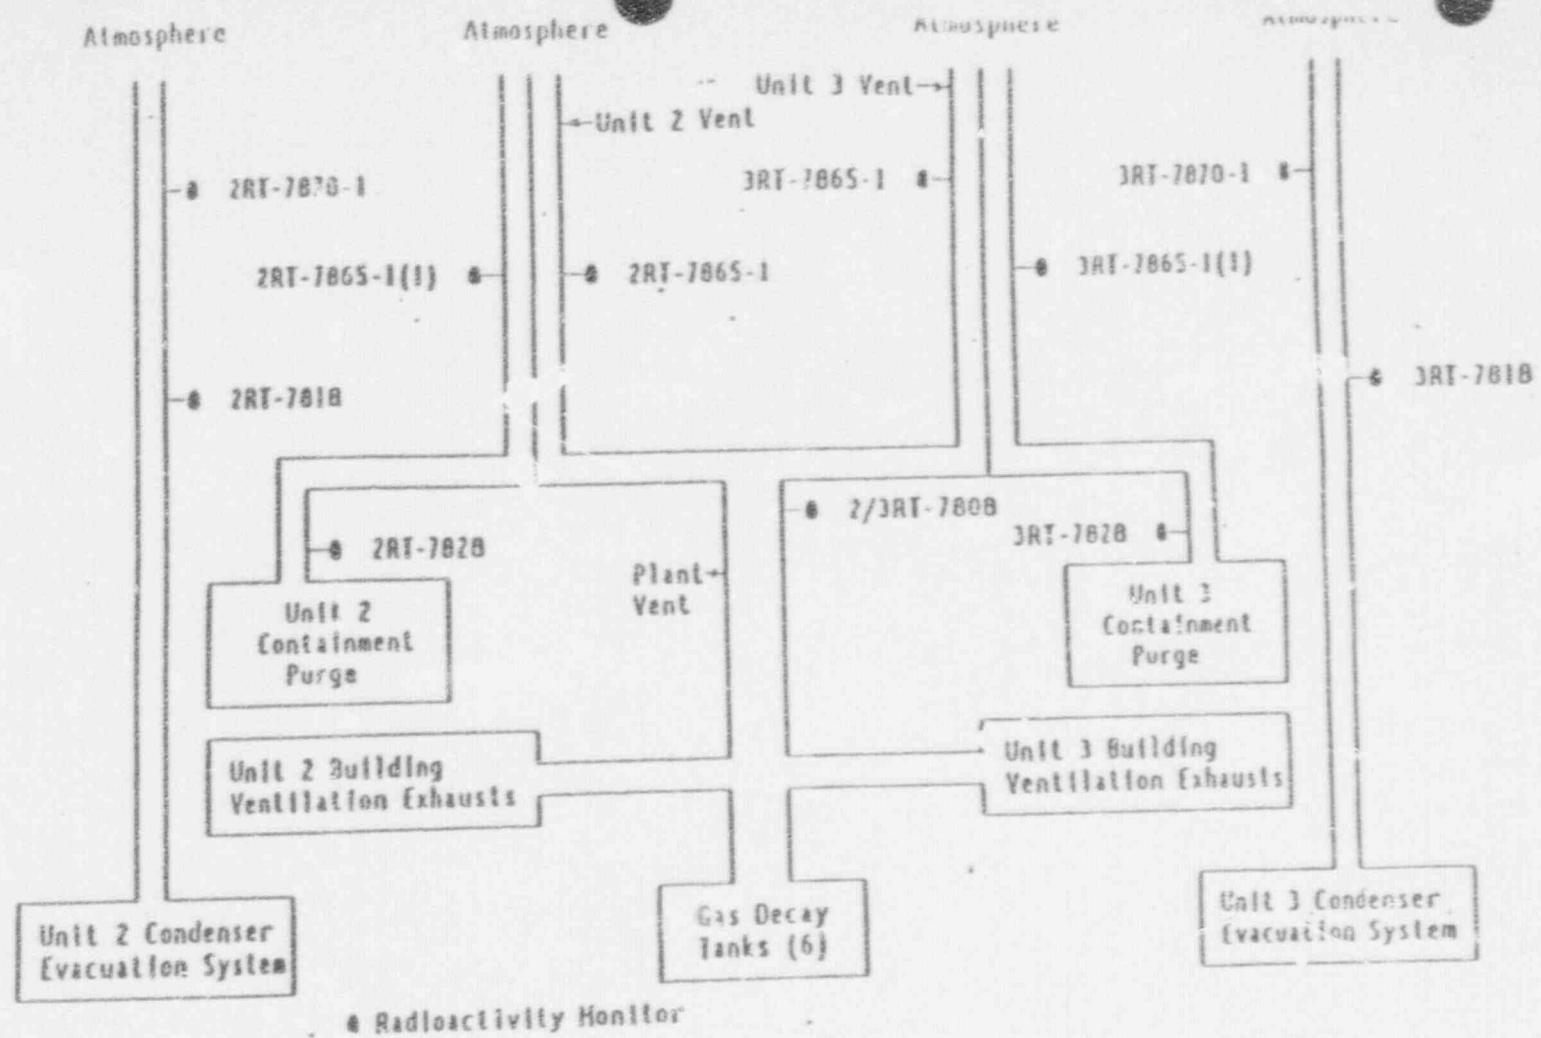


Figure 4-6 Release pathways and monitors of radioactive gaseous effluents for SONGS Units 2 and 3.

(1) RT-7865 can be aligned to either containment purge or the plant vent stack

#### FIGURE 4-6 SONGS 2 & 3 RADIOACTIVE GASEOUS WASTE TREATMENT SYSTEMS

SO23-ODCM  
Revision 24  
08-31-91

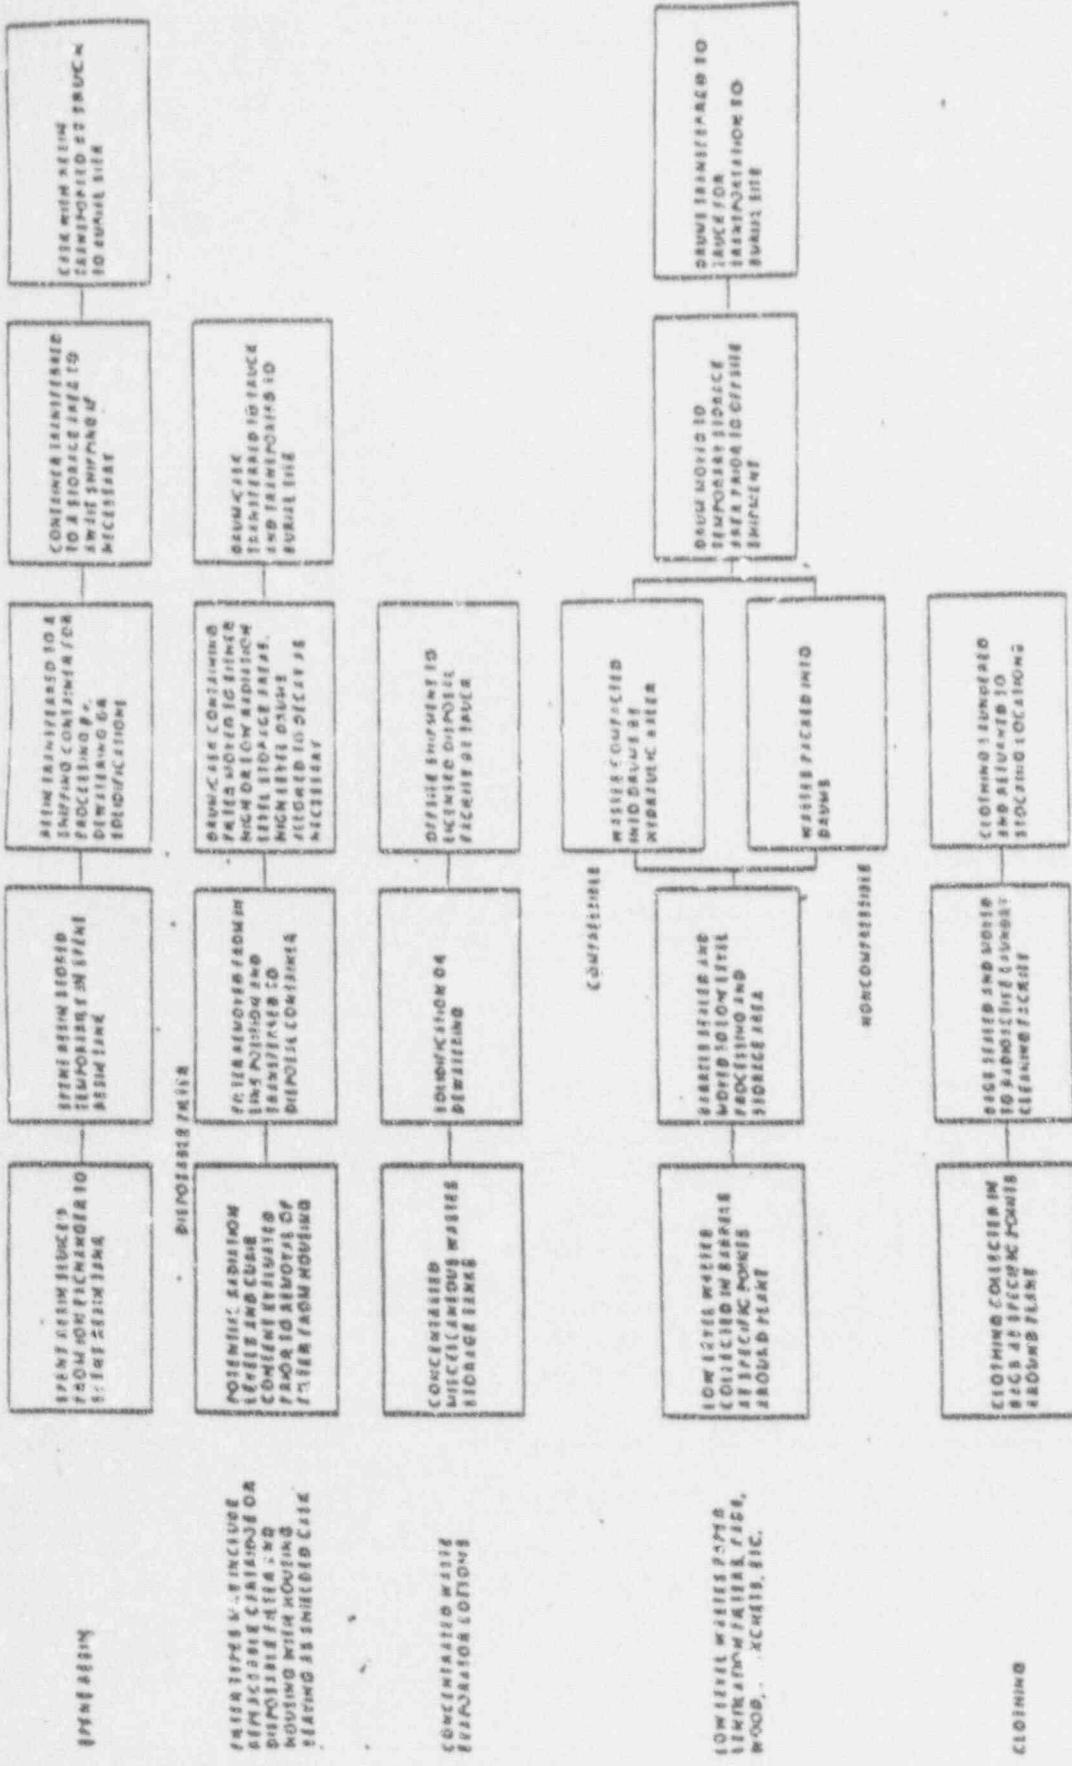


FIGURE 4-7 SOLID WASTE HANDLING

S023-ODCM  
Revision 21  
02-15-90

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING

### 5.1 Monitoring Program

#### SPECIFICATION

5.1.1 The radiological environmental monitoring program shall be conducted as specified in Table 5-1. The requirements are applicable at all times.

APPLICABILITY: At all times

#### ACTION:

a. Should the radiological environmental monitoring program not be conducted as specified in Table 5-1, in lieu of any other report required by Technical Specification(s) 6.9.1, prepare and submit to the Commission, in the Annual Radiological Operating Report (see Section 5.4), a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.

b. Should the level of radioactivity in an environmental sampling medium exceed the reporting levels of Table 5-2 when averaged over any calendar quarter, in lieu of any other report required by Technical Specification(s) 6.9.1, prepare and submit to the Commission, within 30 days from the end of the affected calendar quarter a Report pursuant to Technical Specification(s) 6.9.1.13. When more than one of the radionuclides in Table 5-2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{limit level (1)}} + \frac{\text{concentration (2)}}{\text{limit level (2)}} + \dots \geq 1.0$$

c. When radionuclides other than those in Table 5-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose to an individual is equal to or greater than the calendar year limits of Specification(s) 1.2.1, 2.2.1 or 2.3.1, as appropriate. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report (see Section 5.4).

d. With fresh leafy vegetable samples or fleshy vegetable samples unavailable from one or more of the sample locations required by Table 5-1, in lieu of any other report required by Technical Specification 6.9.1, prepare and submit to the commission within 30 days, pursuant to Technical Specifications 6.9.2, a Special Report which identifies the cause of the unavailability of samples and identifies locations for obtaining replacement samples. The locations from which samples were unavailable may then be deleted from those required by Table 5-1, provided the locations from which the replacement samples were obtained are added to the environmental monitoring program as replacement locations.

## 5.0 RADILOGICAL ENVIRONMENTAL MONITORING (Continued)

### SURVEILLANCE REQUIREMENTS

- .1 The radiological environmental monitoring samples shall be collected pursuant to Table 5-1 from the locations given in Tables 5-4 and 5-5 and Figure 5-1 and shall be analyzed pursuant to the requirements of Tables 5-1 and 5-3.

TABLE 5-1  
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

<u>Exposure Pathway and/or Sample</u>	<u>Number of Samples and Sample Locations<sup>a</sup></u>	<u>Sampling and Collection Frequency<sup>a</sup></u>	<u>Type and Frequency of Analyses</u>
1. AIRBORNE Radioiodine and Particulates	<p>Samples from at least 5 locations</p> <p>3 samples from offsite locations (in different sectors) of the highest calculated annual average ground level D/Q.</p> <p>1 sample from the vicinity of a community having the the highest calculated annual average ground-level D/Q.</p> <p>1 sample from a control location 15-30 km (10-20 miles) distant and in the least prevalent wind direction<sup>c</sup></p>	<p>Continuous operation of sampler with sample collection as required by dust loading, but at least once per 7 days.<sup>d</sup></p>	<p>Radioiodine cartridge. Analyze at least once per 7 days for I-131.</p> <p>Particulate sampler. Analyze for gross beta radioactivity <math>\geq</math> 24 hours following filter change. Perform gamma isotopic<sup>b</sup> analysis on each sample when gross beta activity is <math>&gt;</math> 10 times the yearly mean of control samples. Perform gamma isotopic analysis on composite (by location) sample at least once per 92 days.</p>
2. DIRECT RADIATION <sup>e</sup>	At least 30 locations including an inner ring of stations in the general area of the site boundary and an outer ring approximately in the 4 to 5 mile range from the site with a station in each sector of each ring. The balance of the stations is in special interest areas such as population centers, nearby residences, schools, and in 2 or 3 areas to serve as control stations.	At least once per 92 days.	Gamma dose. At least once per 92 days.

1

IMAGE EVALUATION  
TEST TARGET (MT-3)



150mm

6"



# 1

IMAGE EVALUATION  
TEST TARGET (MT-3)



150mm

6"

# 1

## IMAGE EVALUATION TEST TARGET (MT-3)



150mm

6"

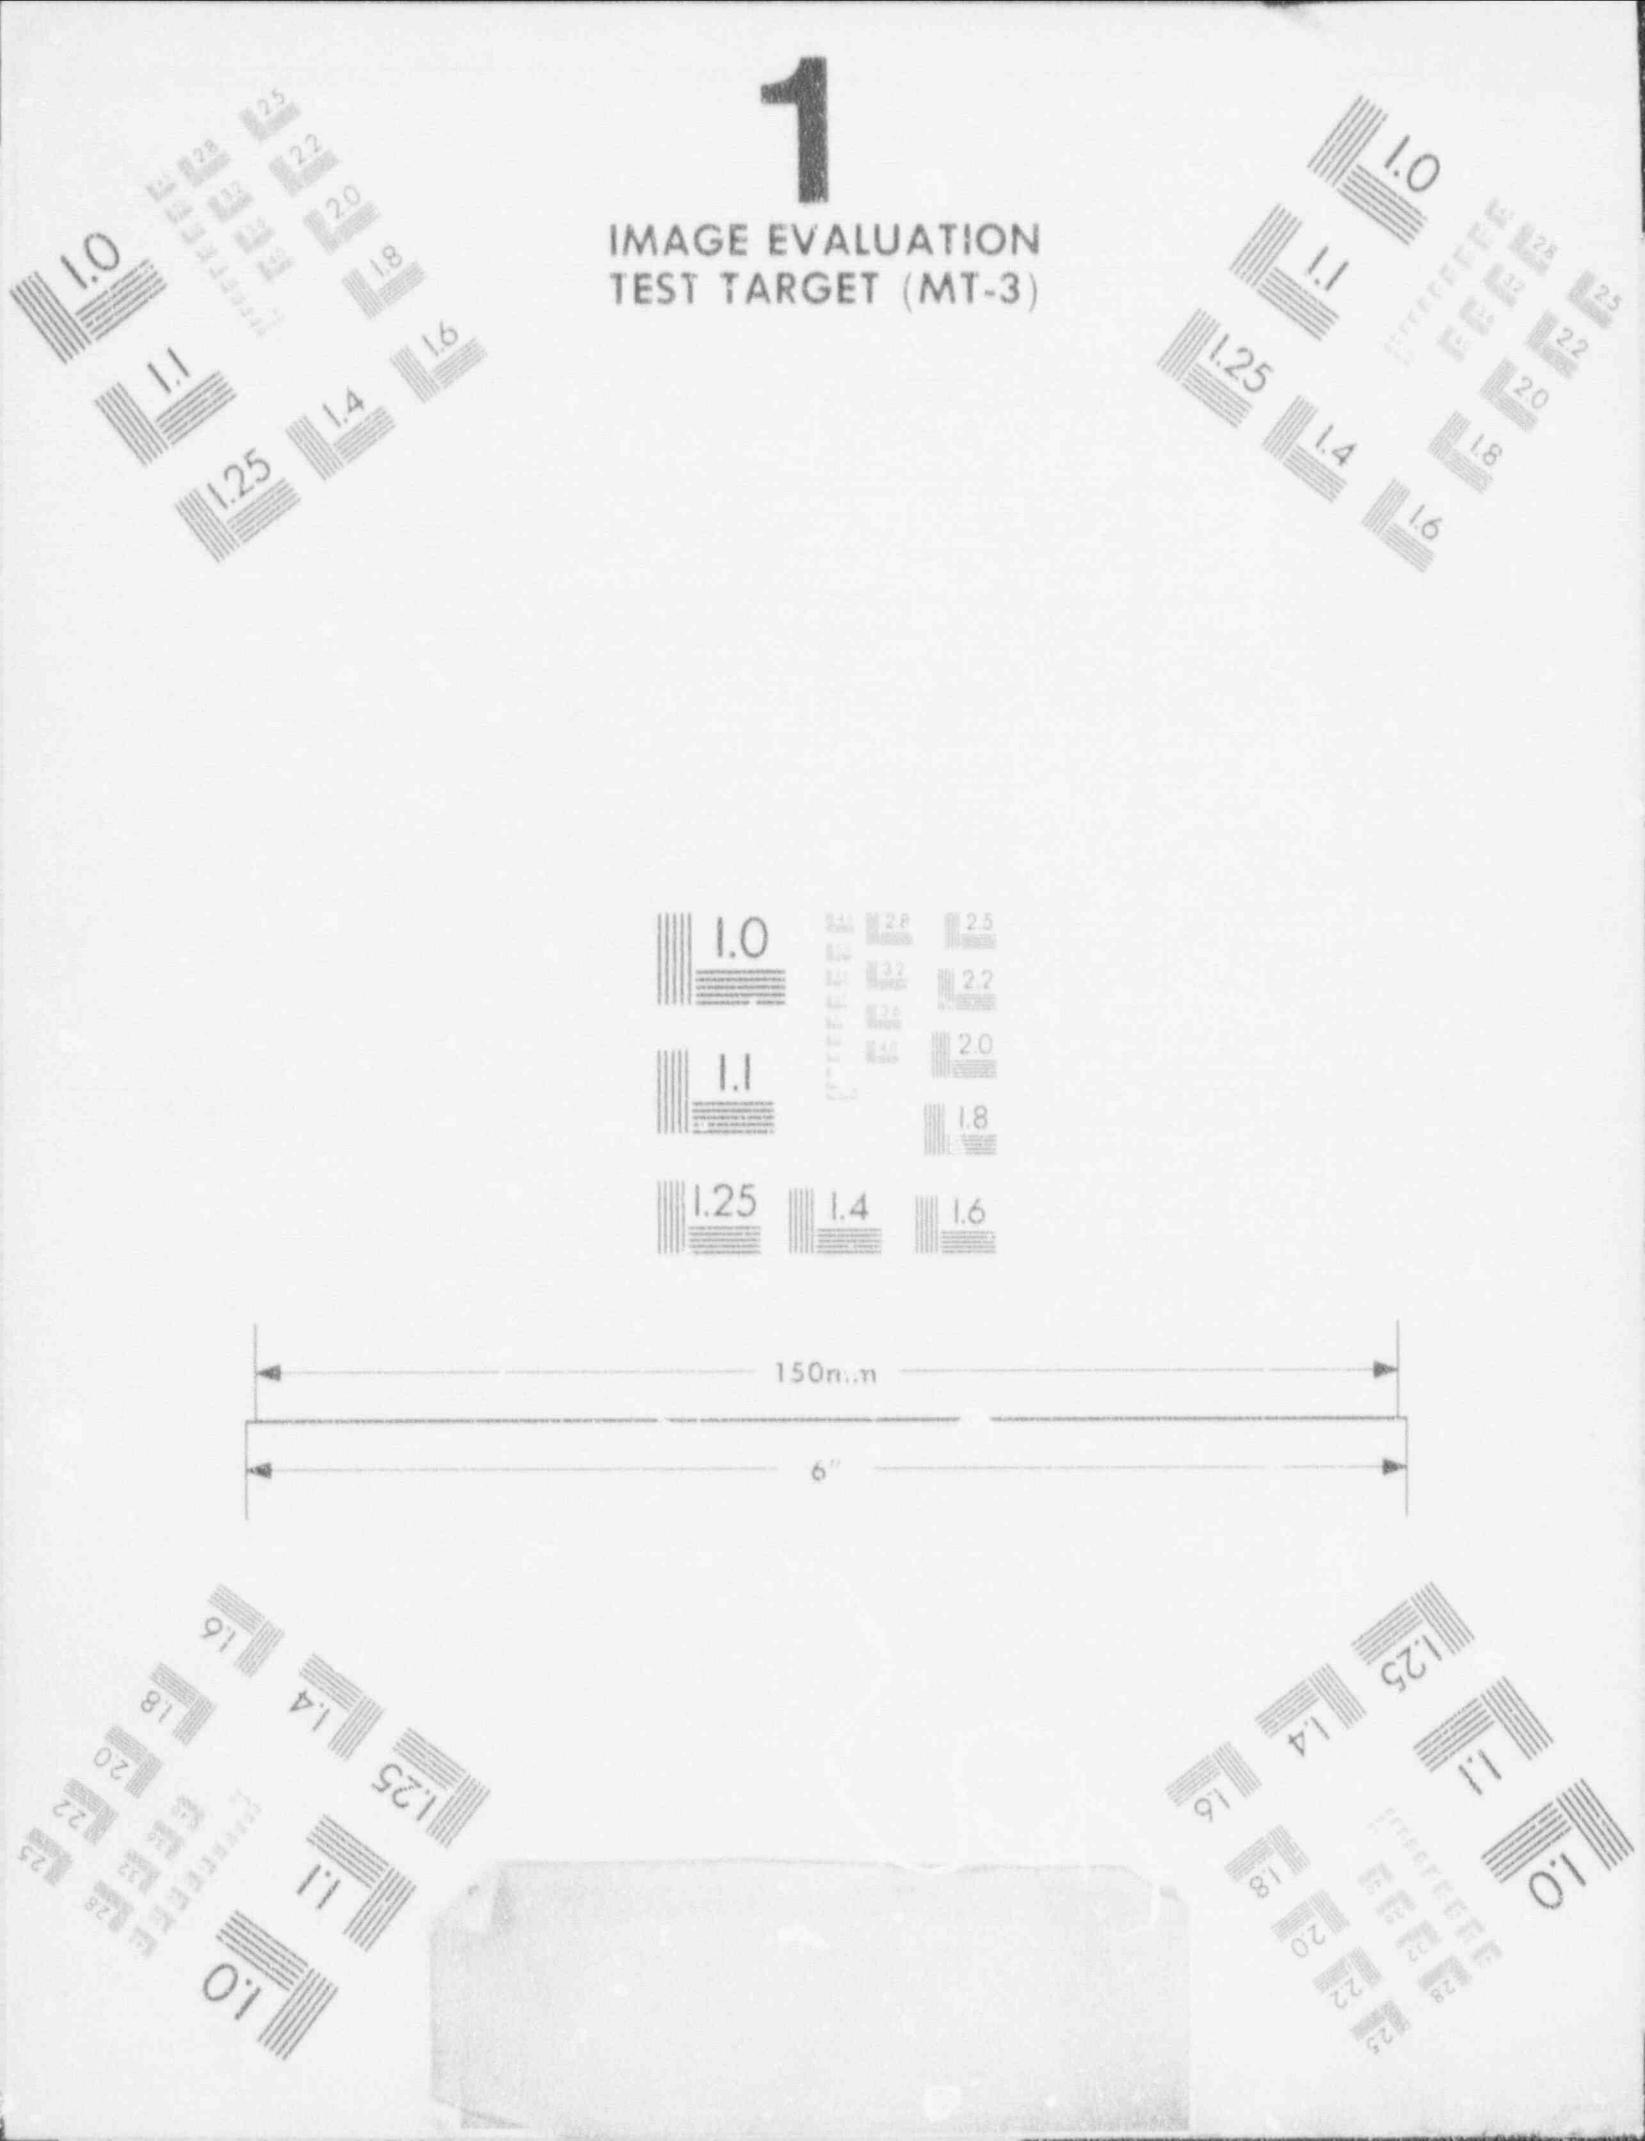


TABLE 5-1 (Continued)

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

<u>Exposure Pathway and/or Sample</u>	<u>Number of Samples and Sample Locations*</u>	<u>Sampling and Collection Frequency<sup>a</sup></u>	<u>Type and Frequency of Analyses</u>
3. WATERBORNE:			
a. Ocean	4 locations	At least once per month and composited quarterly	Gamma isotopic analysis of each monthly sample. Tritium analysis of composite sample at least once per 92 days.
b. Drinking	2 locations	Monthly at each location.	Gamma isotopic and tritium analyses of each sample.
c. Sediment	4 locations from Shoreline	At least once per 184 days.	Gamma isotopic analysis of each sample.
d. Ocean	5 locations Bottom Sediments	At least once per 184 days.	Gamma isotopic analysis of each sample.

TABLE 5-1 (Continued)

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

<u>Exposure Pathway and/or Sample</u>	<u>Number of Samples and Sample Locations*</u>	<u>Sampling and Collection Frequency*</u>	<u>Type and Frequency of Analyses</u>
<b>4. INGESTION</b>			
a. Nonmigratory Marine Animals	3 locations	<p>One sample in season, or at least once per 184 days if not seasonal. A sample of each of the following species:</p> <ol style="list-style-type: none"> <li>1. Fish-2 adult species such as perch or sheepshead.</li> <li>2. Crustaceae-such as crab or lobster.</li> <li>3. Mollusks-such as limpets, seahares or clams.</li> </ol>	Gamma isotopic analysis on edible portions.
b. Local Crops	2 locations	Representative vegetables, normally 1 leafy and 1 fleshy collected at harvest time. At least 2 vegetables collected semiannually from each location.	Gamma isotopic analysis on edible portions semiannually and I-131 analysis for leafy crops.

TABLE 5-1 (Continued)

TABLE NOTATION

- a. Sample locations are indicated on Figure 5-1.
- b. Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.
- c. The purpose of this sample is to obtain background information. If it is not practical to establish control locations in accordance with the distance and wind direction criteria, other sites which provide valid background data may be substituted.
- d. Canisters for the collection of radioiodine in air are subject to channeling. These devices should be carefully checked before operation in the field or several should be mounted in series to prevent loss of iodine.
- e. Regulatory Guide 4.13 provides minimum acceptable performance criteria for thermoluminescence dosimetry (TLD) systems used for environmental monitoring. One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. For the purpose of this table, a thermoluminescent dosimeter may be considered to be one phosphor and two or more phosphors in a packet may be considered as two or more dosimeters. Film badges should not be used for measuring direct radiation.
- f. Composite samples should be collected with equipment (or equivalent) which is capable of collecting an aliquot at time intervals which are very short (e.g., hourly) relative to the compositing period (e.g., monthly).

TABLE 5-2

## REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES

## Reporting Levels

Analysis	Water (pCi/l)	Airborne Particulate or Gases (pCi/m <sup>3</sup> )	Marine Animals (pCi/Kg, wet)	Local Crops (pCi/Kg, wet)
H-3	$2 \times 10^4$ (*)			
Mn-54	$1 \times 10^3$		$3 \times 10^4$	
Fe-59	$4 \times 10^2$		$1 \times 10^4$	
Co-58	$1 \times 10^3$		$3 \times 10^4$	
Co-60	$3 \times 10^2$		$1 \times 10^4$	
Zn-65	$3 \times 10^2$		$2 \times 10^4$	
Zr Nb-95	$4 \times 10^2$			
I-131	2	0.9		$1 \times 10^2$
Cs-134	30	10	$1 \times 10^3$	$1 \times 10^3$
Cs-137	50	20	$2 \times 10^3$	$2 \times 10^3$
Ba La-140	$2 \times 10^2$			

(a) For drinking water samples. This is 40 CFR Part 141 value.

TABLE 5-3  
MAXIMUM VALUES FOR THE LOWER LIMITS OF DETECTION (LLD)<sup>a,c</sup>

Analysis	Water (pCi/l)	Airborne Particulate or Gases (pCi/m <sup>3</sup> )	Marine Animals (pCi/Kg, wet)	Local Crops (pCi/Kg, wet)	Sediment (pCi/Kg, dry)
gross beta	4	$1 \times 10^{-2}$			
H-3	2000				
Mn-54	15		130		
Fe-59	30		260		
Co-58, 60	15		130		
Zn-65	30		260		
Zr-95	30				
Nb-95	15				
I-131	1 <sup>b</sup>	$7 \times 10^{-2}$		60	
Cs-134	15	$5 \times 10^{-2}$	130	60	150
Cs-137	18	$6 \times 10^{-2}$	150	80	180
Ba-140	60				
La-140	15				

TABLE 5-3 (Continued)

TABLE NOTATION

- a. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.65 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

where:

LLD is the "a priori" lower limit of detection as defined above (as microcurie per unit mass or volume),

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

$2.22 \times 10^6$  is the number of transformations per minute per microcurie,

Y is the fractional radiochemical yield (when applicable),

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  is the elapsed time between midpoint of sample collection or end of the collection period and time of counting (for environmental samples, not plant effluents).

The value of  $s_b$  used in the calculation of the LLD for a detection system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. In calculating the LLD for a radionuclide determined by gamma-ray Spectrometry, the background shall include the typical contributions of other radionuclides normally present in the samples (e.g., potassium-40 in milk samples). Typical values of E, V, Y and  $\Delta t$  shall be used in the calculations.

TABLE 5-3 (Continued)

TABLE NOTATION

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of the measurement system and not as a posteriori (after the fact) limit for a particular measurement.\*

- b. LLD for drinking water.
- c. Other peaks which are measurable and identifiable, together with the radionuclides in Table 5-3, shall be identified and reported.

\*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem. 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotope Counting Techniques," Atlantic Richfield Hanford Company Report 4H-2537 (June 22, 1972).

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING (Continued)

### 5.2 LAND USE CENSUS

#### SPECIFICATION

5.2.1 A land use census shall be conducted and shall identify the location of the nearest milk animal, the nearest residence and the nearest garden\* of greater than 500 square feet producing fresh leafy vegetables in each of the 16 meteorological sectors within a distance of five miles. For elevated releases as defined in Regulatory Guide 1.111, Revision 1, July 1977, the land use census shall also identify the locations of all milk animals and all gardens of greater than 500 square feet producing fresh leafy vegetables in each of the 16 meteorological sectors within a distance of three miles.

APPLICABILITY: At all times

ACTION:

- a. With a land use census identifying a location(s) which yields a calculated dose or dose commitment greater than the values currently being calculated in Specification 2.3.1, in lieu of any other report required by Technical Specification 6.9.1, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the new location(s).
- b. With a land use census identifying a location(s) which yields a calculated dose or dose commitment via the same exposure pathway 20 percent greater than at a location from which samples are currently being obtained in accordance with Section 5.1, in lieu of any other report required by Technical Specification 6.9.1, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the new location. The new location shall be added to the radiological environmental monitoring program within 30 days. The sampling location, excluding the control station location, having the lowest calculated doses or dose commitment via the same exposure pathway may be deleted from this monitoring program after October 31 of the year in which this land use census was conducted.

#### SURVEILLANCE REQUIREMENTS

- .1 The land use census shall be conducted at least once per 12 months between the dates of June 1 and October 1 using that information which will provide the best results, such as by a door-to-door survey, aerial survey, or by consulting local agriculture authorities.

\*Broad leaf vegetation sampling may be performed at the site boundary in the direction sector with the highest D/Q in lieu of the garden census.

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING (Continued)

### 5.3 INTERLABORATORY COMPARISON PROGRAM

#### SPECIFICATION

5.3.1 Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program which has been approved by the Commission.

APPLICABILITY: At all times

#### ACTION:

- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report.

#### SURVEILLANCE REQUIREMENTS

- .1 A summary of the results contained as part of the above required Interlaboratory Comparison Program and in accordance with Section 5.4.1 of this document shall be included in the Annual Radiological Environmental Operating Report (see Section 5.4).

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING (Continued)

### 5.4 ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT\*

#### 5.4.1

The annual radiological environmental operating reports shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison with preoperational studies, operational controls (as appropriate), and previous environmental surveillance reports and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of land use censuses required by Section 5.2. If harmful effects or evidence of irreversible damage are detected by the monitoring, the report shall provide an analysis of the problem and a planned course of action to alleviate the problem.

The annual radiological environmental operating reports shall include summarized and tabulated results in the format of Regulatory Guide 4.8, December 1975 of all radiological environmental samples taken during the report period. In the event that some results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplementary report.

The reports shall also include the following: a summary description of the radiological environmental monitoring program; a map of all sampling locations keyed to a table giving distances and directions from the mid-point of reactor Units 2 and 3; and the results of licensee participation in the Interlaboratory Comparison Program, required by Section 5.3.

\* A single submittal may be made for a multiple unit station, combining those sections that are common to all units at the station.

## 5.0 RADIOLOGICAL ENVIRONMENTAL MONITORING (Continued)

### 5.5 SAMPLE LOCATIONS

The Radiological Environmental Monitoring Sample Locations are identified in Figure 5-1. These sample locations are described in Tables 5-4 and 5-5 and indicate the distance in miles and the direction, determined from degrees true north, from the center of the Units 2 and 3 building complex. Table 5-6 gives the sector and direction designation for the Radiological Environmental Monitoring Sample Location on Map, Figure 5-1.

TABLE 5-4

## RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS

<u>TYPE OF SAMPLE AND SAMPLING LOCATION***</u>	<u>DISTANCE*</u> (miles)	<u>DIRECTION*</u>
<b>Direct Radiation</b>		
1 City of San Clemente (Former SDG&E Offices)	5.6	NW
2 Camp San Mateo (MCB, Camp Pendleton)	3.5	N
3 Camp San Onofre (MCB, Camp Pendleton)	2.6	NE
4 Camp Horne (MCB, Camp Pendleton)	4.5	E
5 Camp Las Pulgas (MCB, Camp Pendleton)	8.5	E
6 Old Route 101 (East-Southeast)	3.0	ESE
7 Old Route 101 (East-Northeast)	0.5	ENE
8 Noncommissioned Officers' Beach Club	1.5	NW
9 Basilone Road/I-5 Freeway Offramp	2.0	NW
10 Bluff (Adjacent to PIC #1)	0.7	WNW
11 Former Visitors' Center	0.3**	NW
12 South Edge of Switchyard	0.2**	E
13 Southeast Site boundary (Bl. 17)	0.4**	SE
14 Huntington Beach Generating Station	37.0	NW
15 Southeast Site Boundary (Office Building)	0.2**	SE
16 East Southeast Site Boundary	0.4**	ESE
17 Transit Dose	-	-
18 Transit Dose	-	-
19 San Clemente Highlands	5.0	NNW
20 San Clemente Pier	5.3	NW
21 Concordia Elementary School - San Clemente	3.5	NW
22 Former U.S. Coast Guard Station - San Mateo Point	2.7	WNW
23 San Clemente General Hospital	8.2	NW
24 San Clemente High School	6.0	NW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Distances are within the Units 2 and 3 Site Boundary (0.4 mile in all sectors) and not required by Technical Specification.

\*\*\* MCB - Marine Corps Base PIC - Pressurized Ion Chamber

TABLE 5-4

## RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS

<u>TYPE OF SAMPLE AND SAMPLING LOCATION***</u>	<u>DISTANCE*</u> (miles)	<u>DIRECTION*</u>
<b>Direct Radiation (Continued)</b>		
25 Convalescent Home - San Clemente	8.0	NW
26 Dana Hills High School	11.0	NW
27 U.S. Post Office - Dana Point	10.6	NW
28 Doheny Fire Station - Capistrano Beach	9.5	NW
29 San Juan Capistrano Fire Station	10.8	NW
30 Laguna Beach Fire Station	17.5	NW
31 Aurora Park-Mission Viejo	18.7	NNW
32 Santa Ana Police Department	32.0	NW
33 Camp Tulega (MCB, Camp Pendleton)	5.7	N
34 San Onofre School (MCB, Camp Pendleton)	1.9	NW
35 Range 312 (MCB, Camp Pendleton)	4.7	NNE
36 Range 208C (MCB, Camp Pendleton)	4.2	NE
37 Laguna Niguel Fire Station	14.2	NW
38 San Onofre State Beach Park	3.3	SE
39 Basilone Road Trailer Park (MCB, Camp Pendleton)	1.4	NNW
40 SCE Training Center - Mesa (Adjacent to PIC #3)	0.7	NNW
41 Old Route 101 - East	0.4	E
42 Horne Canyon (MCB, Camp Pendleton)	4.7	E
43 Edison Range (MCB, Camp Pendleton)	10.6	SE
44 Fallbrook Fire Station	18.0	E
45 Interstate 5 Weigh Station	2.0	ESE
46 San Onofre State Beach Park	1.0	SE
47 Camp Las Flores (MCB, Camp Pendleton)	8.6	SE
48 Mainside (MCB, Camp Pendleton)	15.0	ESE

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Distances are within the Units 2 and 3 Site Boundary (0.4 mile in all sectors) and not required by Technical Specification.

\*\*\* MCB - Marine Corps Base PIC - Pressurized Ion Chamber

TABLE 5-4

## RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS

<u>TYPE OF SAMPLE AND SAMPLING LOCATION***</u>	<u>DISTANCE*</u> (miles)	<u>DIRECTION*</u>
Direct Radiation (Continued)		
49 Camp Chappo (MCB, Camp Pendleton)	12.8	ESE
50 Oceanside Fire Station	15.5	SE
51 Carlsbad Fire Station	18.6	SE
52 Vista Fire Station	21.0	ESE
53 San Diego County Operations Center	45.0	SE
54 Escondido Fire Station	32.0	ESE
55 San Onofre State Beach (Unit 1, West Southwest)	0.2**	WSW
56 San Onofre State Beach (Unit 1, Southwest)	0.1**	SW
57 San Onofre State Beach (Unit 2)	0.1**	SSW
58 San Onofre State Beach (Unit 3)	0.1**	S
59 SONGS Meteorological Tower	0.3**	WNW
60 Transit Control Storage Area	-	-
61 Mesa - East Boundary (Adjacent to PIC #4)	0.7	N
62 MCB - Camp Pendleton (Adjacent to PIC #5)	0.6	NNE
63 MCB - Camp Pendleton (Adjacent to PIC #6)	0.6	NE
64 MCB - Camp Pendleton (Adjacent to PIC #7)	0.5	ENE
65 MCB - Camp Pendleton (Adjacent to PIC #8)	0.7	E
66 San Onofre State Beach (Adjacent to PIC #9)	0.6	ESE
67 Former SONGS Evaporation Pond (Adjacent to PIC #2)	0.6	NW
68 Range 21OC (MCB, Camp Pendleton)	4.3	ENE

|P

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Distances are within the Units 2 and 3 Site Boundary (0.4 mile in all sectors) and not required by Technical Specification.

\*\*\* MCB - Marine Corps Base PIC - Pressurized Ion Chamber

TABLE 5-4

## RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS

TYPE OF SAMPLE AND SAMPLING LOCATION	DISTANCE*	DIRECTION*
	(miles)	
<b>Airborne</b>		
1 City of San Clemente (City Hall)	5.5	NW
2 Camp San Onofre (Camp Pendleton)	1.8	NE
3 Huntington Beach Generating Station	37.0	NW
5 Units 2 and 3 Switchyard	0.13**	NNE
6 SONGS Meteorological Tower	0.3**	WNW
9 State Beach Park	0.6	ESE
10 Bluff	0.7	WNW
11 Mesa EOF	0.7	NNW
12 Former SONGS Evaporation Pond	0.6	NW
13 Marine Corps Base (Camp Pendleton East)	0.7	E
<b>Soil Samples</b>		
1 Camp San Onofre	2.5	NE
2 Old Route 101 - East Southeast	3.0	ESE
3 Baseline Road/I-5 Freeway Offramp	2.0	NW
4 Huntington Beach Generating Station	37.0	NW
5 Former Visitor's Center	0.2**	NNW
<b>Ocean Water</b>		
A Station Discharge Outfall - Unit 1	0.5	SSW
B Outfall - Unit 2	0.7	SW
C Outfall - Unit 3	0.7	SW
D Newport Beach	30.0	NW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

\*\* Distances are within the Units 2 and 3 Site boundary (0.4 mile in all sectors) and not required by Technical Specification.

TABLE 5-4

## RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS

<u>TYPE OF SAMPLE AND SAMPLING LOCATION</u>	<u>DISTANCE*</u> (miles)	<u>DIRECTION*</u>
<b>Drinking Water</b>		
1 Tri-Cities Municipal Water District Reservoir	8.7	NW
2 San Clemente Golf Course Well	3.5	NNW
3 Huntington Beach	37.0	NW
<b>Shoreline Sediment (Beach Sand)</b>		
1 San Onofre State Beach (0.6 mile Southeast)	0.6	SE
2 San Onofre Surfing Beach	-	0.9
3 San Onofre State Beach (3.1 miles Southeast)	3.1	SE
4 Newport Beach (North End)	30.0	NW
<b>Local Crops</b>		
1 San Mateo Canyon (San Clemente Ranch)	2.6	NW
2 Southeast of Oceanside	22.0	SE

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

TABLE 5-4

## RADIOLOGICAL ENVIRONMENTAL MONITORING SAMPLE LOCATIONS

TYPE OF SAMPLE AND SAMPLING LOCATION	DISTANCE*	DIRECTION*
	(miles)	
<b>Non-Migratory Marine Animals</b>		
A Unit 1 Outfall	0.9	WSW
B Units 2 and 3 Outfall	1.7	SSW
C Newport Beach	18.2	NW
<b>Kelp</b>		
A San Onofre Kelp Bed	1.5	S
B San Mateo Kelp Bed	3.8	WNW
C Barn Kelp Bed	6.3	SSE
D Newport Beach	15.6	NW
<b>Ocean Bottom Sediments</b>		
A Unit 1 Outfall (0.5 mile West)	0.6	W
B Unit 1 Outfall (0.6 mile West)	0.8	SSW
C Unit 2 Outfall	1.6	SW
D Unit 3 Outfall	1.2	SSW
E Newport Beach	18.2	NW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true north.

TABLE 5-5  
 PIC - RADIOLOGICAL ENVIRONMENTAL MONITORING LOCATIONS


PRESSURIZED ION CHAMBERS	(Degrees)*	Theta	DISTANCE*		DIRECTION/SECTOR*	
			Meters	miles		
S1	San Onofre Beach	298°	1070	0.7	WNW	P
S2	SONGS Former Evap. Pnd	313°	890	0.6	NW	Q
S3	Japanese Mesa	340°	1150	0.7	NNW	R
S4	MCB - Camp Pendleton	3°	1120	0.7	N	A
S5	MCB - Camp Pendleton	19°	1050	0.6	NNE	B
S6	MCB - Camp Pendleton	46°	940	0.6	NE	C
S7	MCB - Camp Pendleton	70°	870	0.5	ENE	D
S8	MCB - Camp Pendleton	98°	1120	0.7	E	E
S9	San Onofre State Beach	121°	940	0.6	ESE	F


\* Distance (meters/miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Theta direction is determined from degrees true north.


TABLE 5-6  
SECTOR AND DIRECTION DESIGNATION FOR RADIOLOGICAL  
ENVIRONMENTAL MONITORING SAMPLE LOCATION MAP

DEGREES TRUE NORTH FROM SONGS 2 AND 3 MID-POINT			NOMENCLATURE	
<u>Sector Limit</u>	<u>Center Line</u>	<u>Sector Limit</u>	22.5° <u>Sector*</u>	<u>Direction</u>
348.75	0 & 360	11.25	A	N
11.25	22.5	33.75	B	NNE
33.75	45.0	56.25	C	NE
56.25	67.5	78.75	D	ENE
78.75	90.0	101.25	E	E
101.25	112.0	123.75	F	ESE
123.75	135.0	146.25	G	SE
146.25	157.0	168.75	H	SSE
168.75	180.0	191.25	J	S
191.25	202.5	213.75	K	SSW
213.75	225.0	236.25	L	SW
236.25	247.5	258.75	M	WSW
258.75	270.0	281.15	N	W
281.25	292.5	303.75	P	WNW
303.75	315.0	326.25	Q	NW
326.25	337.5	348.75	R	NNW

\* Distance (miles) and Direction (sector) are measured relative to Units 2 and 3 midpoint. Direction is determined from degrees true North.

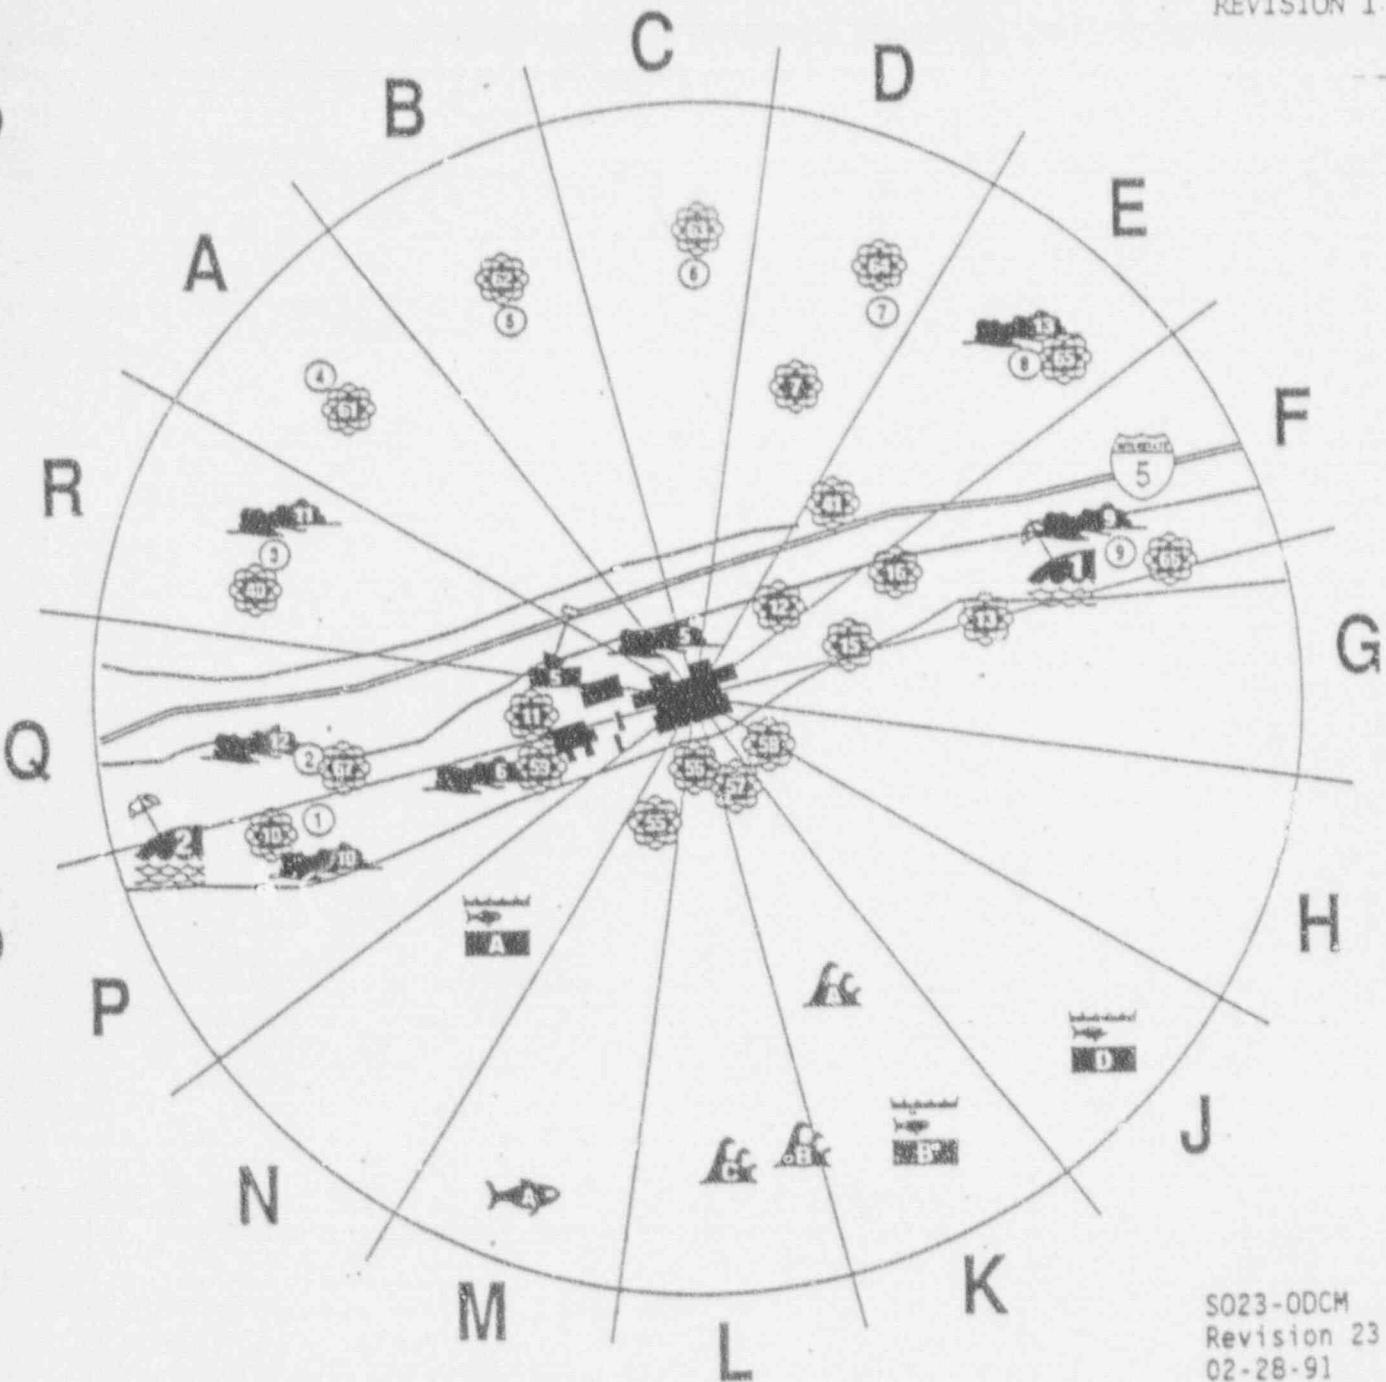

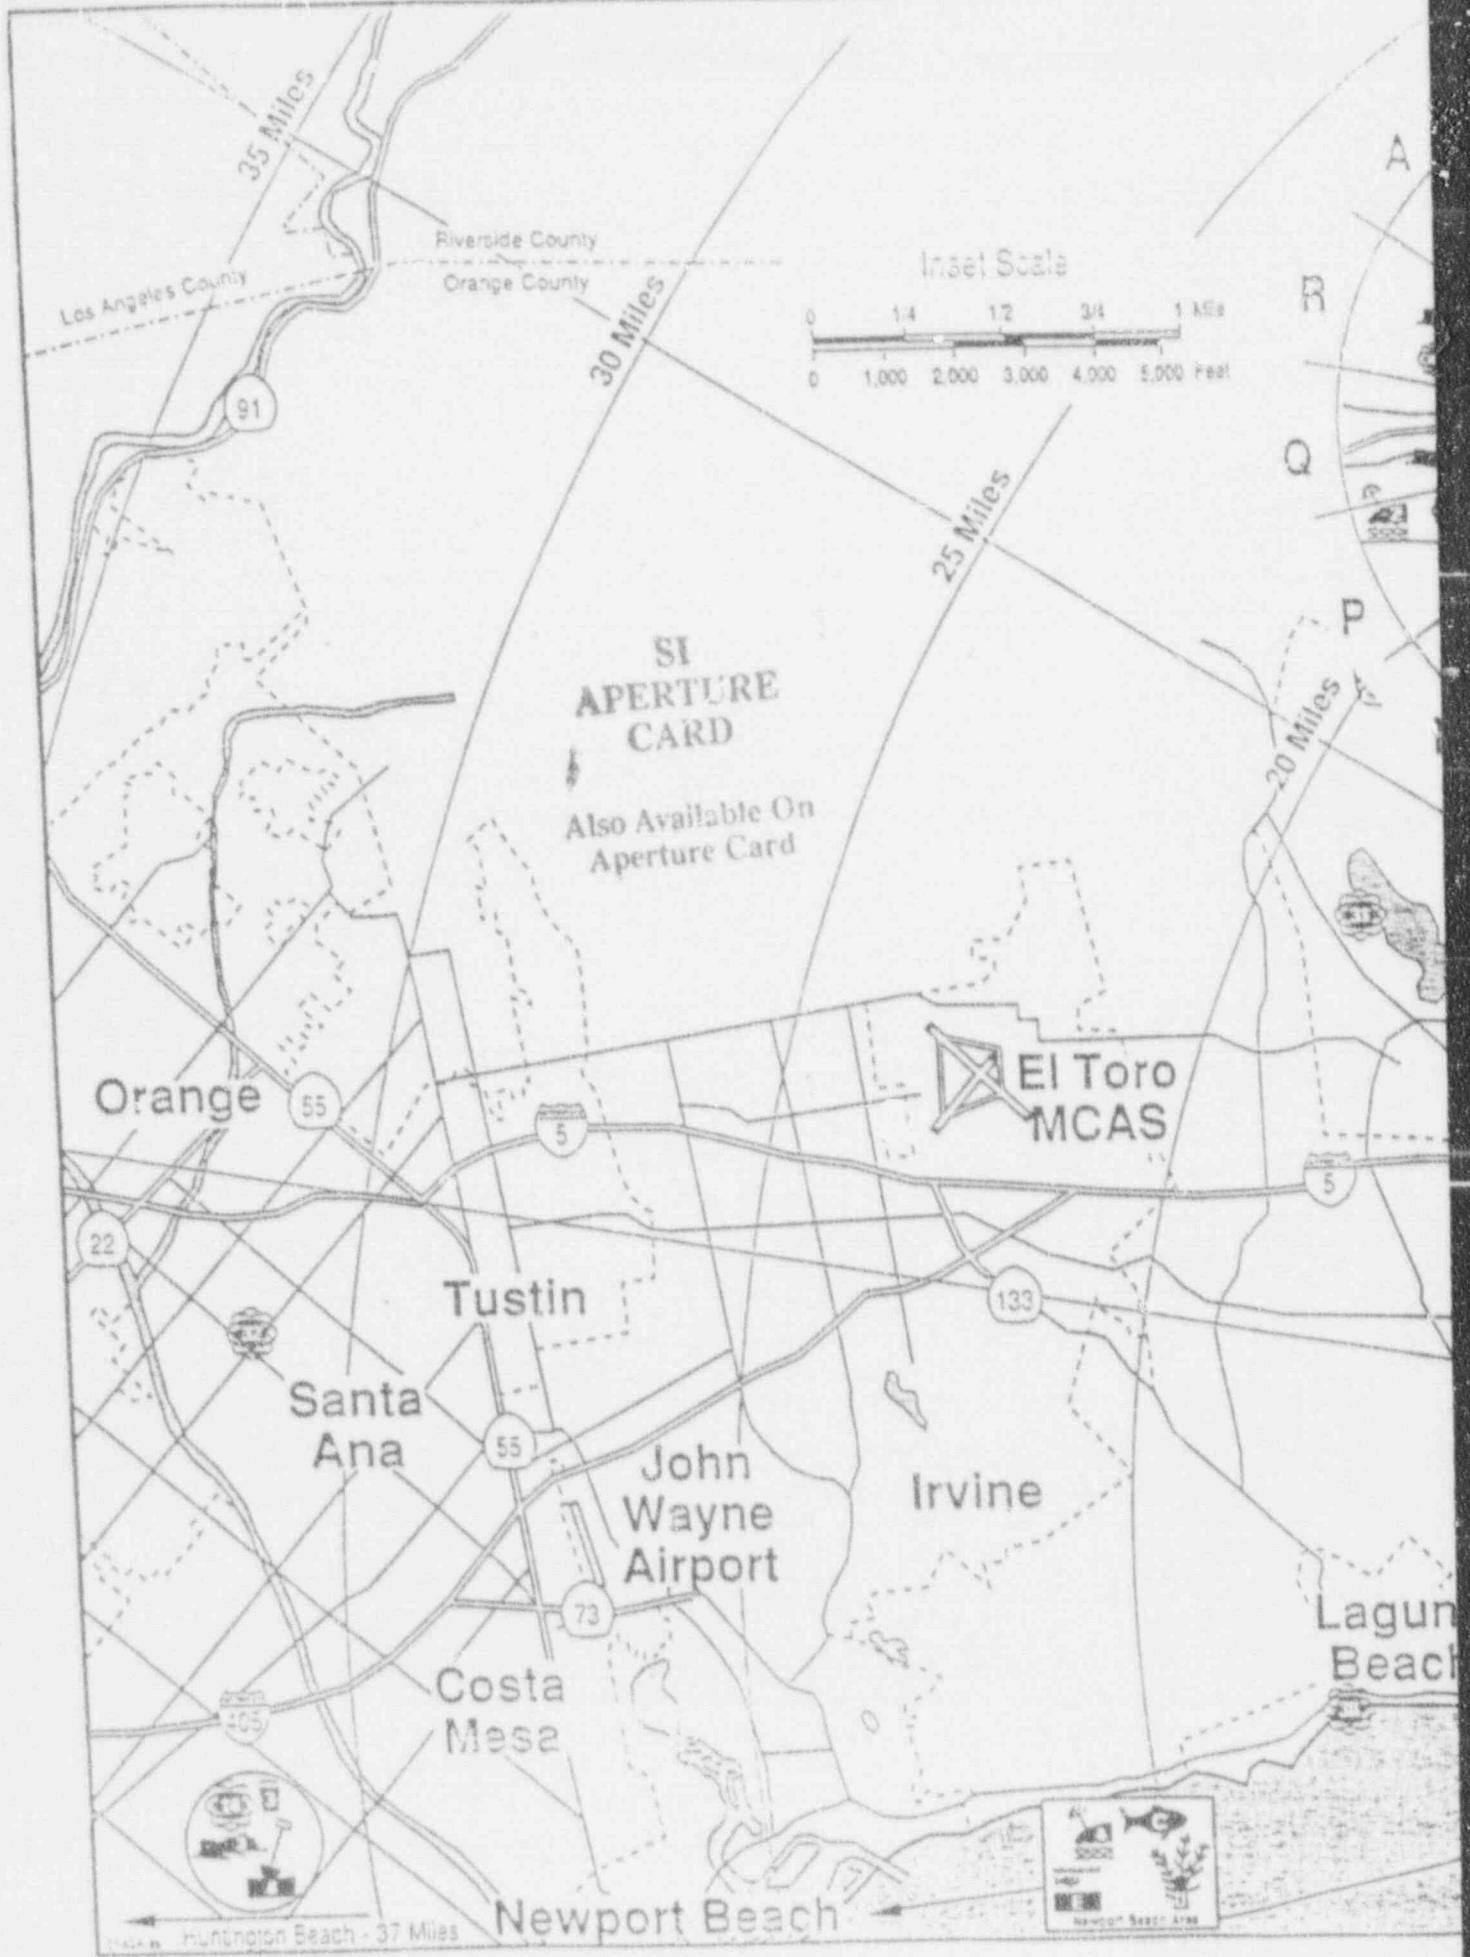


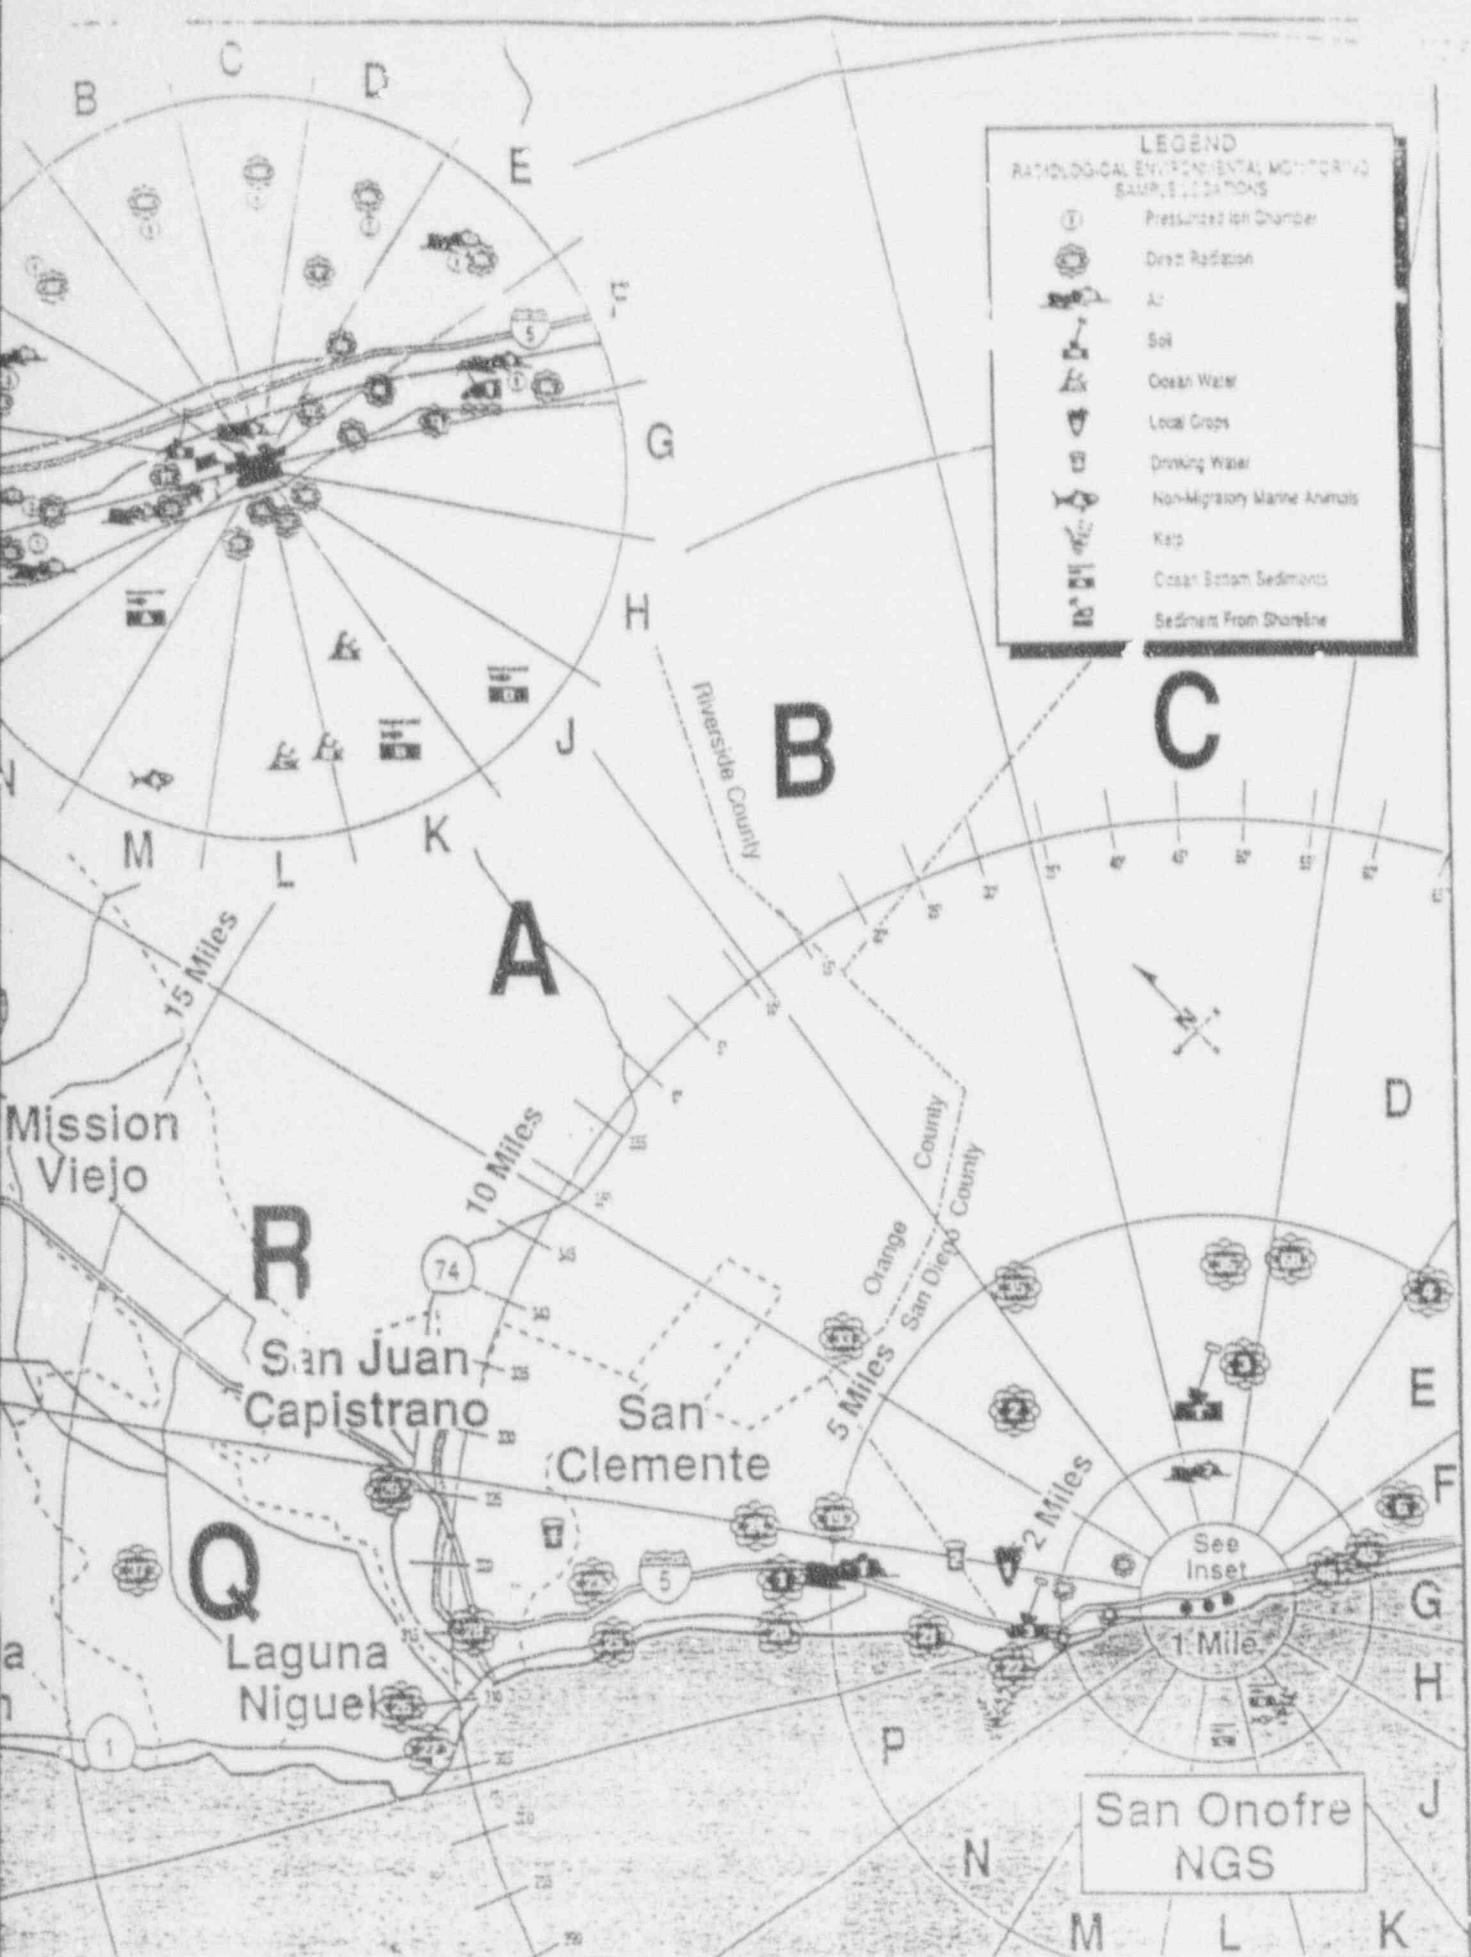


9203240102-02

5-24

SC23-ODCM  
Revision 23  
02-28-91

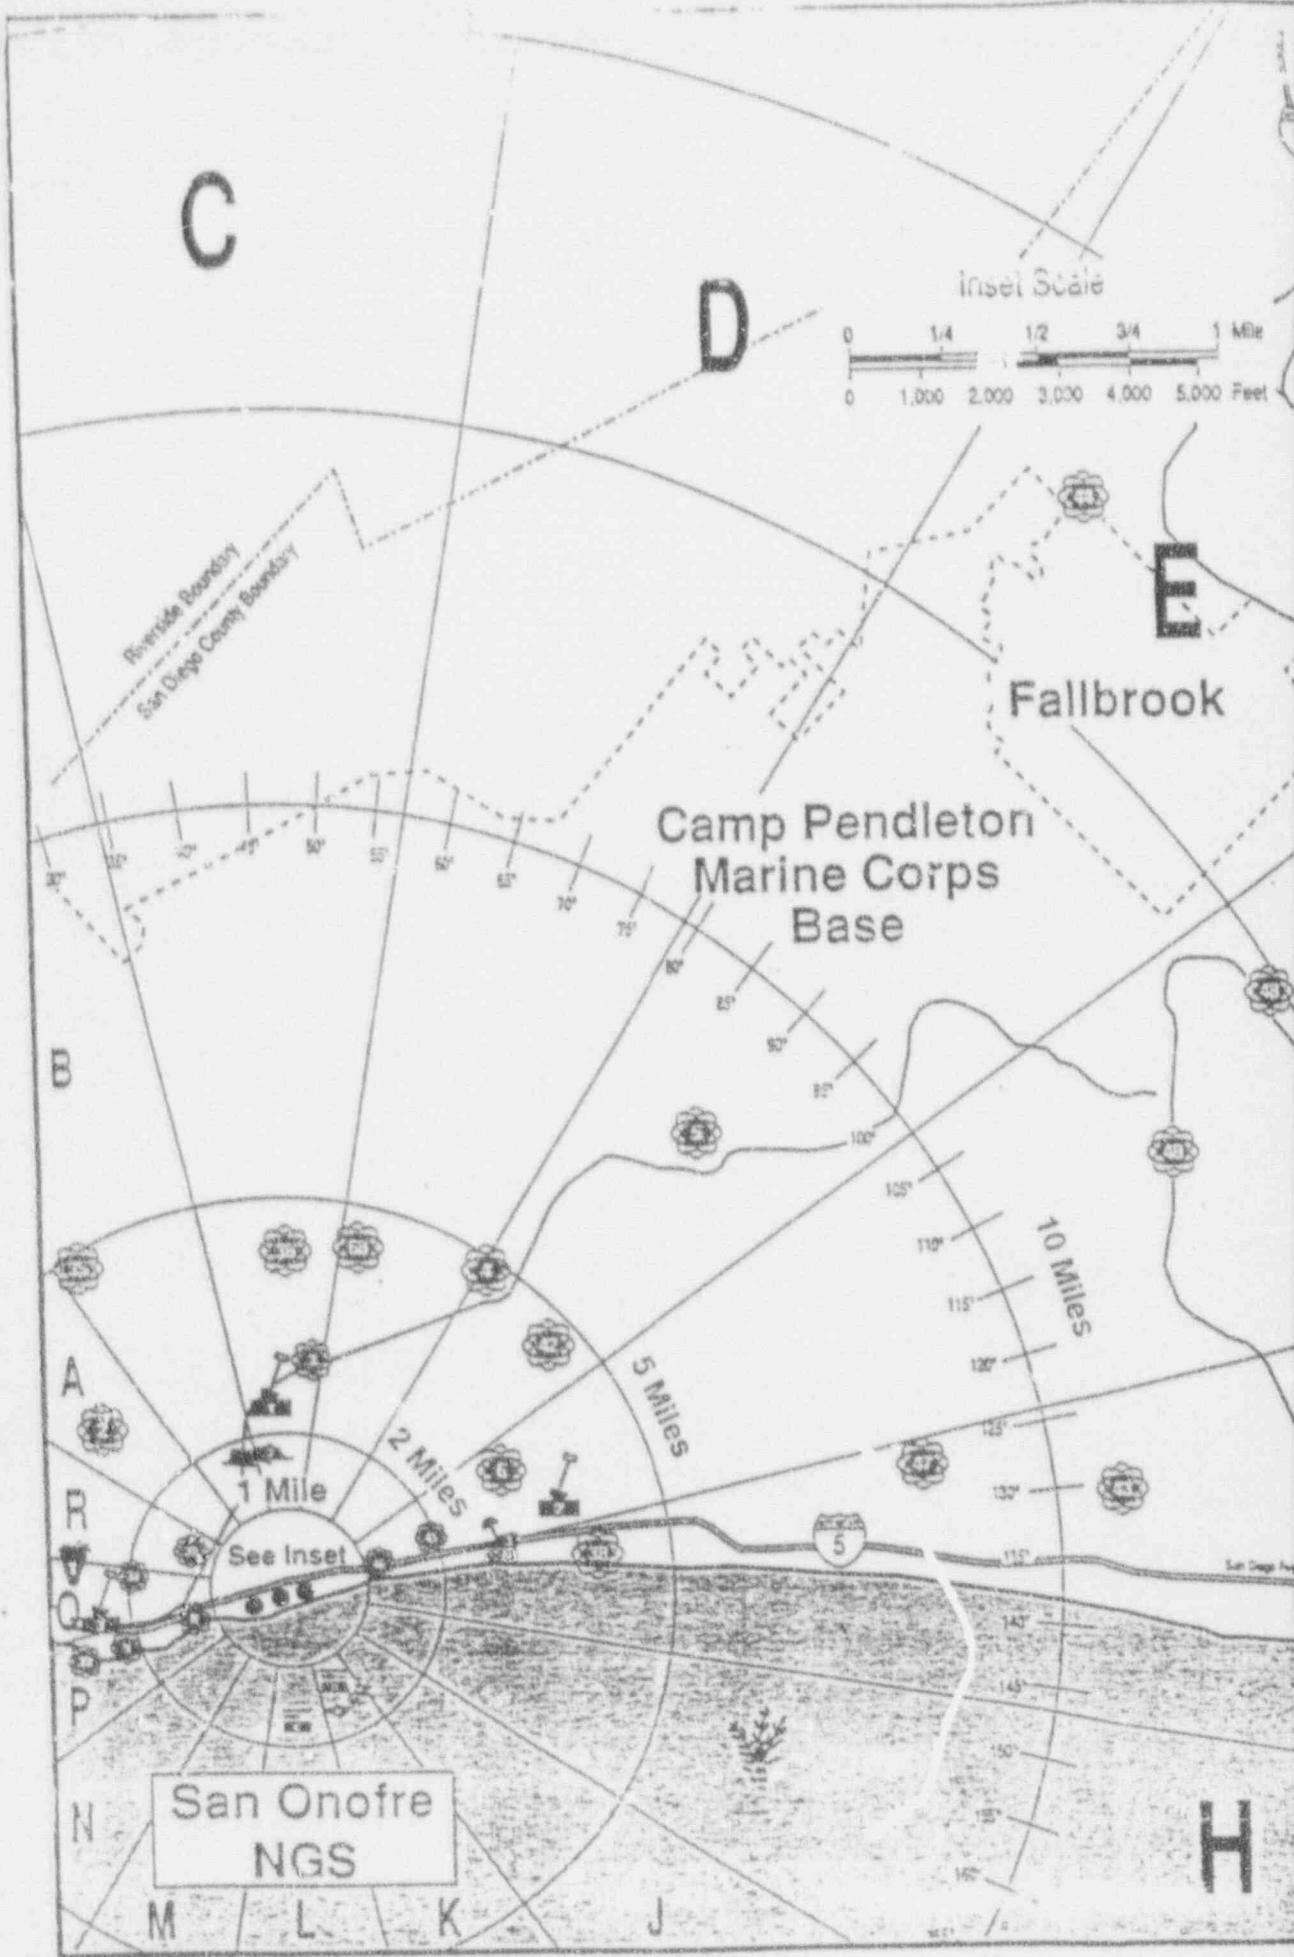

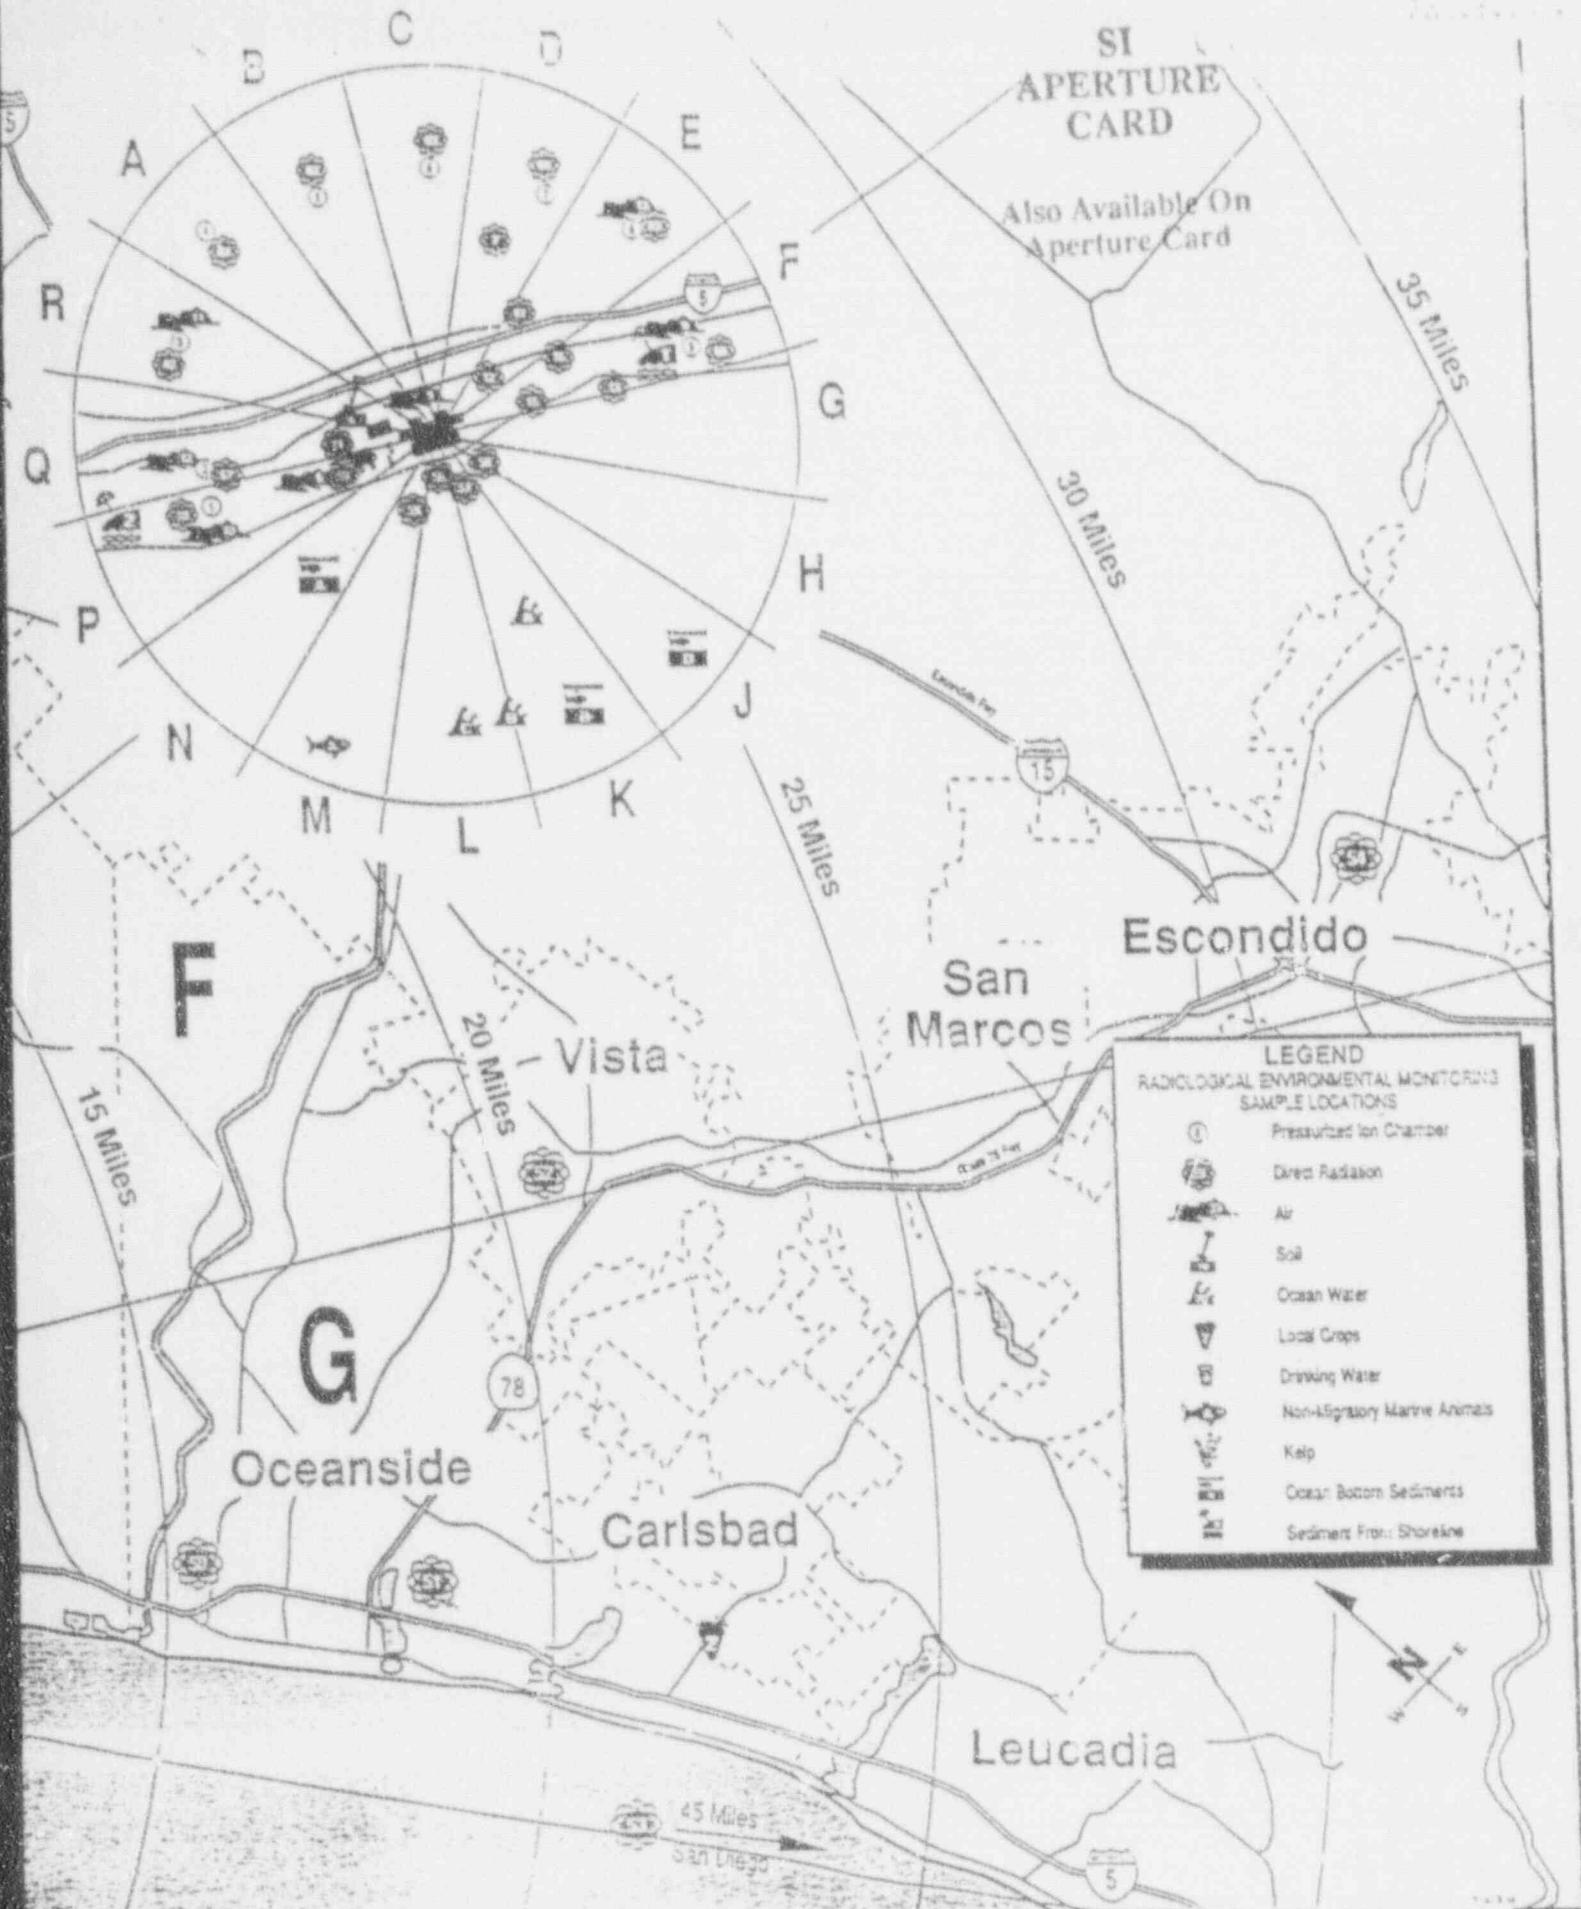

## 6.0 ADMINISTRATIVE

### 6.1 DEFINITIONS

The defined terms of this section appear in capitalized type and are applicable through these Specifications.

#### ACTION

6.1.1 ACTION shall be that part of a specification which prescribes remedial measures required under designated conditions.

#### CHANNEL CALIBRATION

6.1.2 A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds with the necessary range and accuracy to known values of the parameter which the channel monitors. The CHANNEL CALIBRATION shall encompass the entire channel, including the sensor and alarm and/or trip functions, and shall include the CHANNEL FUNCTIONAL TEST. The CHANNEL CALIBRATION may be performed by any series of sequential, overlapping or total channel steps such that the entire channel is calibrated.

#### CHANNEL CHECK

6.1.3 A CHANNEL CHECK shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

#### CHANNEL FUNCTIONAL TEST

6.1.4 A CHANNEL FUNCTIONAL TEST shall be:

- a. Analog channels - the injection of a simulated signal into channel as close to the sensor as practicable to verify OPERABILITY, including alarm and/or trip functions.
- b. Bistable channels - the injection of a simulated signal into the sensor to verify OPERABILITY, including alarm and/or trip functions.
- c. Digital computer channels - the exercising of the digital computer hardware using diagnostic programs and the injection of simulated process data into the channel to verify OPERABILITY.

## 6.0 ADMINISTRATIVE (Continued)

### DOSE EQUIVALENT I-131

- 6.1.5 DOSE EQUIVALENT I-131 shall be that concentration of I-131 (microcuries/gram) which alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table III of TID-14844, "Calculation of Distance Factors for Power and Test Reactor Sites."

### FREQUENCY NOTATION

- 6.1.6 The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 6.2.

### GASEOUS RADWASTE TREATMENT SYSTEM

- 6.1.7 A GASEOUS RADWASTE TREATMENT SYSTEM is any system designed and installed to reduce radioactive gaseous effluents by collecting primary coolant system offgases from the primary system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

### INVESTIGATIVE REPORT

- 6.1.8 The group responsible for the missed ACTION or surveillance shall perform an evaluation which covers the root cause(s), corrective action, and recommendations to preclude recurrence of the event. Copies of the resulting report shall be provided to Effluent Engineering and the Unit Superintendent with the original sent to CDM-SONGS for retention.

### MEMBERS OF THE PUBLIC

- 6.1.9 MEMBER(S) OF THE PUBLIC shall include all individuals who by virtue of their occupational status have no formal association with the plant. This category shall include nonemployees of the licensee who are permitted to use portions of the site for recreational, occupational, or purposes not associated with plant functions. This category shall not include non-employees such as vending machine servicemen or postmen who, as part of their formal job function, occasionally enter an area that is controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials.

6.0 ADMINISTRATIVE (Continued)

OPERABLE - OPERABILITY

6.1.10 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component or device to perform its function(s) are also capable of performing their related support function(s).

PURGE - PURGING

6.1.11 PURGE or PURGING is the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

SITE BOUNDARY

6.1.12 The SITE BOUNDARY shall be that line beyond which the land is not owned, leased, or otherwise controlled by the licensee.

SOLIDIFICATION

6.1.13 SOLIDIFICATION shall be the conversion of radioactive wastes from liquid systems to a homogeneous (uniformly distributed), monolithic, immobilized solid with definite volume and shape, bounded by a stable surface of distinct outline on all sides (free-standing).

SOURCE CHECK

6.1.14 A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a radioactive source.

THERMAL POWER

6.1.15 THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

## 6.0 ADMINISTRATIVE (Continued)

### VENTILATION EXHAUST TREATMENT SYSTEM

6.1.16 A VENTILATION EXHAUST TREATMENT SYSTEM is any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment (such a system is not considered to have any effect on noble gas effluents). Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

### VENTING

6.1.17 VENTING is the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent used in system names does not imply a VENTING process.

TABLE 6-1  
OPERATIONAL MODES

<u>OPERATION MODE</u>	<u>REACTIVITY CONDITION, <math>K_{eff}</math></u>	<u>% OF RATED THERMAL POWER*</u>	<u>AVERAGE COOLANT TEMPERATURE</u>
1. POWER OPERATION	$\geq 0.99$	$> 5\%$	$\geq 350^{\circ}\text{F}$
2. STARTUP	$\geq 0.99$	$\leq 5\%$	$\geq 350^{\circ}\text{F}$
3. HOT STANDBY	$< 0.99$	0	$\geq 350^{\circ}\text{F}$
4. HOT SHUTDOWN	$< 0.99$	0	$350^{\circ}\text{F} > T_{avg} > 200^{\circ}\text{F}$
5. COLD SHUTDOWN	$< 0.99$	0	$\leq 200^{\circ}\text{F}$
6. REFUELING**	$\leq 0.95$	0	$\leq 140^{\circ}\text{F}$

\*Excluding decay heat.

\*\*Fuel in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.

TABLE 6-2  
FREQUENCY NOTATION

<u>NOTATION</u>	<u>FREQUENCY</u>
S	At least once per 12 hours
D	At least once per 24 hours
W	At least once per 7 days
M	At least once per 31 days
Q	At least once per 92 days
SA	At least once per 184 days
R	At least once per 18 months*
S/U	Prior to each reactor startup
P	Completed prior to each release
N.A.	Not applicable
Refueling Interval	Not to exceed 24 months

\*A month is defined as a 31-day period.

## 6.0 ADMINISTRATIVE (Continued)

### 6.2 ADMINISTRATIVE CONTROLS

#### SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT\*

- 6.2.1 Routine radioactive effluent release reports covering the operation of the unit during the previous 6 months of operation shall be submitted within 60 days after January 1 and July 1 of each year. The period of the first report shall begin with the date of initial criticality.
- 6.2.2 The radioactive effluent release reports shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof.

The radioactive effluent release report to be submitted 60 days after January 1 each year shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing of wind speed, wind direction, and atmospheric stability, and precipitation (if measured) on magnetic tape, or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability. This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY (Figure 1-2 and 2-2) during the report period. All assumptions used in making these assessments (i.e., specific activity, exposure time and location) shall be included in these reports. The meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents (as determined by sampling frequency and measurement) shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be performed in accordance with the OFFSITE DOSE CALCULATION MANUAL (ODCM).

## 6.0 ADMINISTRATIVE (Continued)

### 6.2 ADMINISTRATIVE CONTROLS (Continued)

#### 6.2.2 (Continued)

The radioactive effluent release report to be submitted 60 days after January 1 of each year shall also include an assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources (including doses from primary effluent pathways and direct radiation) for the previous 12 consecutive months to show conformance with 40 CFR 190, Environmental Radiation Protection Standards for Nuclear Power Operation. Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in Regulatory Guide 1.109, Rev. 1.

The radioactive effluents release shall include the following information for each type of solid waste shipped offsite during the report period:

- a. Container volume,
- b. Total curie quantity (specify whether determined by measurement or estimate),
- c. Principal radionuclides (specify whether determined by measurement or estimate),
- d. Type of waste (e.g., spent resin, compacted dry waste, evaporator bottoms),
- e. Type of container (e.g., LSA, Type A, Type B, Large Quantity), and
- f. Solidification Agent (e.g., cement, urea formaldehyde).

The radioactive effluent release reports shall include unplanned releases from the site to unrestricted areas of radioactive materials in gaseous and liquid effluents on a quarterly basis.

The radioactive effluent release reports shall include any changes to the PROCESS CONTROL PROGRAM (PCP) made during the reporting period.

\* A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the Station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

## 6.0 ADMINISTRATIVE (Continued)

### 6.3 MAJOR CHANGES TO RADIOACTIVE WASTE TREATMENT SYSTEMS (Liquid, & Gaseous)

Licensee initiated major changes to the radioactive waste systems (liquid & gaseous):

1. Shall be reported to the Commission in the Monthly Operating Report for the period in which the evaluation was performed pursuant to Technical Specification 6.5.2. The discussion of each change shall contain:
  - a. A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59;
  - b. Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
  - c. A detailed description of the equipment, components and processes involved and the interfaces with other plant systems;
  - d. An evaluation of the change which shows the predicted releases of radioactive materials in liquid and gaseous effluents that differ from those previously predicted in the license application and amendments thereto;
  - e. An evaluation of the change which shows the expected maximum exposures to individual in the unrestricted area and to the general population that differ from those previously estimated in the license application and amendments thereto;
  - f. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents to the actual release for the period prior to when the changes are to be made;
  - g. An estimate of the exposure to plant operating personnel as a result of the change; and
  - h. Documentation of the fact that the change was reviewed and found acceptable pursuant to Technical Specification 6.5.2.
2. Shall become effective upon review and acceptance pursuant to Technical Specification 6.5.2.

6.0 ADMINISTRATIVE (Continued)

6.4 RIES

L.1. 2. EFFLUENTS

CONCENTRATION (1.1)

6.4.1 This specification is provided to ensure that the concentration of radioactive materials released in liquid waste effluents from the site will be less than the concentration levels specified in 10 CFR Part 20, Appendix B, Table II, Column 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water outside the site will result in exposures within (1) the Section II.A design objectives of Appendix I, 10 CFR 50, to an individual, and (2) the limits of 10 CFR 20.106(e) to the population. The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its MPC in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

DOSE (1.2)

6.4.2 This specification is provided to implement the requirements of Section II.A, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents will be kept "as low as is reasonably achievable." The dose calculations in the ODCM implement the requirements in Section III.A of Appendix I, that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

This specification applies to the release of liquid effluents from each reactor at the site. For units with shared radwaste treatment systems, the liquid effluents from the shared system are proportioned among the units sharing that system.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### LIQUID WASTE TREATMENT (1.3)

6.4.3 The OPERABILITY of the liquid radwaste treatment system ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the liquid radwaste treatment system were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50, for liquid effluents.

#### GASEOUS EFFLUENTS

##### DOSE RATE (2.1)

6.4.4 This specification is provided to ensure that the dose at any time at the site boundary from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR Part 20 for unrestricted areas. The annual dose limits are the doses associated with the concentrations of 10 CFR Part 20, Appendix B, Table II, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of an individual in an unrestricted area, either within or outside the site boundary, to annual average concentrations exceeding the limits specified in Appendix B, Table II of 10 CFR Part 20 (10 CFR Part 20.106(b)). For individuals who may at times be within the site boundary, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the site boundary. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the site boundary to less than or equal to 500 mrem/year to the total body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.

This specification applies to the release of gaseous effluents from all reactors at the site. For units with shared radwaste treatment systems, the gaseous effluents from the shared system are proportioned among the units sharing that system.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### DOSE - NOBLE GASES (2.2)

6.4.5 This specification is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents will be kept "as low as is reasonably achievable." The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The dose calculations established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1, July 1977. For individuals who may at times be within the site boundary, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. For MEMBERS OF THE PUBLIC who traverse the SITE BOUNDARY via highway I-5, the residency time shall be considered negligible and hence the dose "0". The ODCM equations provided for determining the air doses at the SITE BOUNDARY are based upon the historical average atmospheric conditions.

#### DOSE - RADIOIODINES, RADIOACTIVE MATERIALS IN PARTICULATE FORM AND TRITIUM (2.3)

6.4.6 This specification is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the Surveillance Requirements implement the

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methods for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for radioiodines, radioactive materials in particulate form and tritium are dependent on the existing radionuclide pathways to man, in the unrestricted area. The pathways which were examined in the development of these calculations were:

- 1) individual inhalation of airborne radionuclides,
- 2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, 3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and
- 4) deposition on the ground with subsequent exposure of man.

### GASEOUS RADWASTE TREATMENT (2.4)

#### 6.4.7

The OPERABILITY of the GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### TOTAL DOSE (2.5)

6.4.8 This specification is provided to meet the dose limitations of 40 CFR 190. The specification requires the preparation and submittal of a Special Report whenever the calculated doses from plant radioactive effluents exceed twice the design objective doses of Appendix I. For sites containing up to 4 reactors, it is highly unlikely that the resultant dose to a member of the public will exceed the dose limits of 40 CFR 190 if the individual reactors remain within the reporting requirement level. The Special Report will describe a course of action which should result in the limitation of dose to a member of the public for 12 consecutive months to within the 40 CFR 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the member of the public from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 5 miles must be considered. If the dose to any member of the public is estimated to exceed the requirements of 40 CFR 190, the Special Report with a request for a variance in accordance with the provisions of 40 CFR 190.11, is considered to be a timely request and fulfills the requirements of 40 CFR 190 until NRC staff action is completed provided the release conditions resulting in violation of 40 CFR 190 have not already been corrected. An individual is not considered a member of the public during any period in which he/she is engaged in carrying out any operation which is part of the nuclear fuel cycle.

#### RADIOACTIVE LIQUID EFFLUENT INSTRUMENTATION (4.1)

6.4.9 The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63 and 64 of Appendix A to 10 CFR Part 50.

## 6.0 ADMINISTRATIVE (Continued)

### 6.4 BASES (Continued)

#### RADIOACTIVE GASEOUS EFFLUENT INSTRUMENTATION (4.2)

6.4.10 The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. This instrumentation also includes provisions for monitoring and controlling the concentrations of potentially explosive gas mixtures in the waste gas holdup system. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63 and 64 of Appendix A to 10 CFR Part 50.

#### MONITORING PROGRAM (5.1)

6.4.11 The radiological monitoring program required by this specification provides measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides, which lead to the highest potential radiation exposures of individuals resulting from the station operation. This monitoring program thereby supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways. The initially specified monitoring program will be effective for at least the first three years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The detection capabilities required by Table 5-1 are state-of-the-art for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an *a priori* (before the fact) limit representing the capability of a measurement system and not as an *a posteriori* (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified and described in the Annual Radiological Environmental Operating Report.

6.0 ADMINISTRATIVE (Continued)

6.4 BASES (Continued)

LAND USE CENSUS (5.2)

6.4.12 This specification is provided to ensure that changes in the use of UNRESTRICTED AREAS are identified and that modifications to the monitoring program are made if required by the results of this census. The best survey information from the door-to-door, aerial or consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. Restricting the census to gardens of greater than 500 square feet provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were used, 1) that 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and 2) a vegetation yield of 2 kg/square meter.

INTERLABORATORY COMPARISON PROGRAM (5.3)

6.4.13 The requirement for participation in an Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are reasonably valid.

ATTACHMENT B

Revised Unit 3 January 1992 Unit Shutdowns and Power Reductions  
SONGS Units 2 and 3 Monthly Operating Report

## UNIT SHUTDOWNS AND POWER REDUCTIONS

REPORT MONTH: January 1992

DOCKET NO: 50-362  
 UNIT NAME: SONGS - 3  
 DATE: 3-13-92  
 COMPLETED BY: M. M. F. -T  
 TELEPHONE: (714) 361-9787

No.	Date	Type <sup>1</sup>	Duration (Hours)	Reason <sup>2</sup>	Method of Shutting Down Reactor <sup>3</sup>	LER No.	System Code <sup>4</sup>	Component Code <sup>5</sup>	Cause & Corrective Action to Prevent Recurrence
63	920124	S	* 174.58	* C	5	NA	NA	NA	Cycle 6 refueling outage.

\* Data corrected since previous submittal.

<sup>1</sup>F-Forced  
<sup>1</sup>S-Scheduled

<sup>2</sup>Reason:  
 A-Equipment Failure (Explain)  
 B-Maintenance or Test  
 C-Refueling  
 D-Regulatory Restriction  
 E-Operator Training & License Examination  
 F-Administrative  
 G-Operational Error (Explain)  
 H-Other (Explain)

<sup>3</sup>Method:  
 1-Manual  
 2-Manual Scram.  
 3-Automatic Scram.  
 4-Continuation from  
 Previous Month  
 5-Reduction in the Average  
 Daily Power Level of more  
 than 20% from the previous day  
 6-Other (Explain)

<sup>4</sup>IEEE Std 805-1984<sup>5</sup>IEEE Std 803A-1983

mor.jan/11