

TOLEDO EDISON COMPANY

DAVIS-BESSE UNIT :

CYCLE 8

CORE OPERATING LIMITS REPORT

LIST OF EFFECTIVE PAGES

Page C-1 through C-22

Rev. 0

C-1

Technical Specification/COLR
Cross-Reference

| <u>Technical Specification</u> | <u>COLR Figure/Table</u> |
|--------------------------------|---|
| 3.1.3.6 | Figure 1a Regulating Group Position Limits, 0 to 200 ± 10 EFPD, Four RC Pumps |
| 3.1.3.6 | Figure 1b Regulating Group Position Limits, 200 ± 10 to 400 ± 10 EFPD, Four RC Pumps |
| 3.1.3.6 | Figure 1c Regulating Group Position Limits, after 400 ± 10 EFPD, Four RC Pumps |
| 3.1.3.6 | Figure 2a Regulating Group Position Limits, 0 to 200 ± 10 EFPD, Three RC Pumps |
| 3.1.3.6 | Figure 2b Regulating Group Position Limits, 200 ± 10 to 400 ± 10 EFPD, Three RC Pumps |
| 3.1.3.6 | Figure 2c Regulating Group Position Limits, after 400 ± 10 EFPD, Three RC Pumps |
| 3.1.3.7 | Figure 3 Control Rod Core Locations and Group Assignments |
| 3.1.3.9 | Figure 4a APSR Positions Limits, 0 to 400 ± 10 EFPD, Four RC Pumps |
| 3.1.3.9 | Figure 4b APSR Positions Limits, After 400 ± 10 EFPD, Three or Four RC Pumps, APSRs Withdrawn |
| 3.1.3.9 | Figure 4c APSR Positions Limits, 0 to 400 ± 10 EFPD, Three RC Pumps |

| | | |
|----------|-----------|---|
| 3.2.1 | Figure 5a | AXIAL POWER IMBALANCE Limits, 0 to 200 ± 10 EFPD, Four RC Pumps |
| 3.2.1 | Figure 5b | AXIAL POWER IMBALANCE Limits, 200 ± 10 to 400 ± 10 EFPD, Four RC Pumps |
| 3.2.1 | Figure 5c | AXIAL POWER IMBALANCE Limits, after 400 ± 10 EFPD, Four RC Pumps |
| 3.2.1 | Figure 6a | AXIAL POWER IMBALANCE Limits, 0 to 200 ± 10 EFPD, Three RC Pumps |
| 3.2.1 | Figure 6b | AXIAL POWER IMBALANCE Limits, 200 ± 10 to 400 ± 10 EFPD, Three RC Pumps |
| 3.2.1 | Figure 6c | AXIAL POWER IMBALANCE Limits, after 400 ± 10 EFPD, Three RC Pumps |
| 3.2.4 | Table 1 | QUADRANT POWER TILT Limits |
| 3.1.1.3c | Table 2 | Negative Moderator Temperature Coefficient Limit |

TOLEDO EDISON

DAVIS-BESSE UNIT 1

CYCLE 8

CORE OPERATING LIMITS REPORT

1.0 Core Operating Limits

This CORE OPERATING LIMITS REPORT for DB-1 Cycle 8 has been prepared in accordance with the requirements of Technical Specification 6.9.1.7. The core operating limits have been developed using the methodology provided in the references.

The following cycle-specific core operating limits are included in this report:

- 1) Regulating rod insertion limits
- 2) Rod program group positions
- 3) Axial power shaping rod insertion limits
- 4) AXIAL POWER IMBALANCE operating limits and
- 5) QUADRANT POWER TILT limits
- 6) Negative Moderator Temperature Coefficient limit

2.0 References


- 1) B&W Fuel Company, Topical Report BAW-10122A Rev. 1, "Normal Operating Controls", May 1984
- 2) B&W Fuel Company, Topical Report BAW-10116A, "Assembly Calculations and Fitted Nuclear Data", May 1977
- 3) B&W Fuel Company, Topical Report BAW-10117P-A, "Babcock & Wilcox Version of PDQ User's Manual", January 1977
- 4) B&W Fuel Company, Topical Report BAW-10118A, "Core Computational Techniques and Procedures", December 1979.
- 5) B&W Fuel Company, Topical Report BAW-10124A, "FLAME 3 - A Three-Dimensional Nodal Code for Calculating Core Reactivity and Power Distributions", August 1976

- 6) B&W Fuel Company, Topical Report BAW-10125A, "Verification of the Three-Dimensional FLAME Code", August 1976
- 7) B&W Fuel Company, Topical Report BAW-10152A, "NOODLE - A Multi-Dimensional Two-Group Reactor Simulator", June 1985
- 8) B&W Fuel Company, Topical Report BAW-10119 P-A, "Power Peaking Nuclear Reliability Factors", February 1979
- 9) Log Number 3139, dated January 11, 1990 (T. V. Warbach (NRC) to D. C. Shelton (TE)). (NRC SER for Rod Program)
- 10) Log Number 3441, dated April 10, 1991 (J. R. Hall, Sr. (NRC) to D. C. Shelton (TE)). (NRC's SER for Negative Moderator Temperature Coefficient Limit)
- 11) Log Number 3609, dated October 29, 1991, (J. B. Hopkins (NRC) to D. C. Shelton (TE)). (NRC's SER for change to Technical Specification 5.3.1)

- 6) B&W Fuel Company, Topical Report BAW-10125A, "Verification of the Three-Dimensional FLAME Code", August 1976
- 7) B&W Fuel Company, Topical Report BAW-10152A, "NOODLE - A Multi-Dimensional Two-Group Reactor Simulator", June 1985
- 8) B&W Fuel Company, Topical Report BAW-10119 P-A, "Power Peaking Nuclear Reliability Factors", February 1979
- 9) Log Number 3139, dated January 11, 1990 (T. V. Wambach (NRC) to D. C. Shelton (TE)). (NRC SER for Rod Program)
- 10) Log Number 3441, dated April 10, 1991 (J. R. Hall, Sr. (NRC) to D. C. Shelton (TE)). (NRC's SER for Negative Moderator Temperature Coefficient Limit)
- 11) Log Number 3609, dated October 29, 1991, (J. B. Hopkins (NRC) to D. C. Shelton (TE)). (NRC's SER for change to Technical Specification 5.3.1)

Figure 1a Regulating Group Position Limits,
 0 to 200±10 EFPD, Four RC Pumps --
 Davis-Besse 1, Cycle 8


This Figure is referred
 to by Technical Specification
 1.3.6

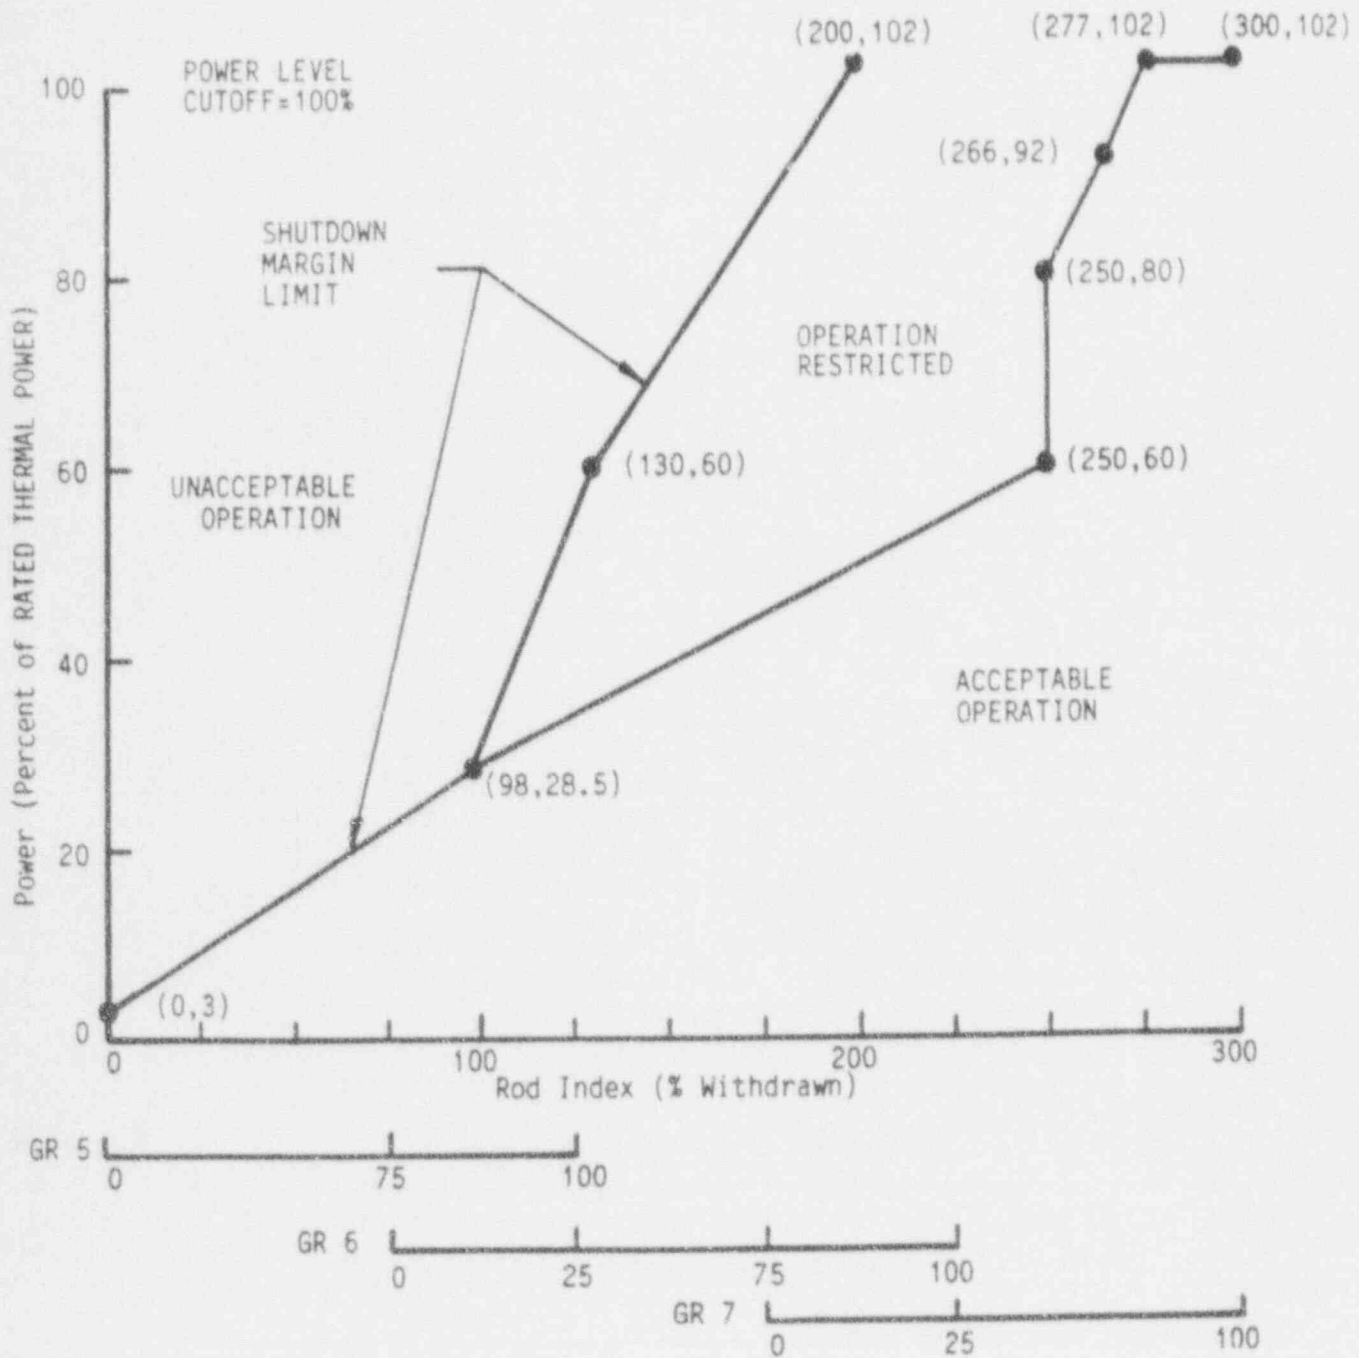

Note 1: A Rod Group overlap of 25±5% between sequential withdrawn groups 5 and 6, and 6 and 7 shall be maintained.

Figure 1b Regulating Group Position Limits,
 200±10 to 400±10 EFPD, Four RC Pumps --
 Davis-Besse 1, Cycle 8


This Figure is referred
 to by Technical Specification
 3.1.3.6

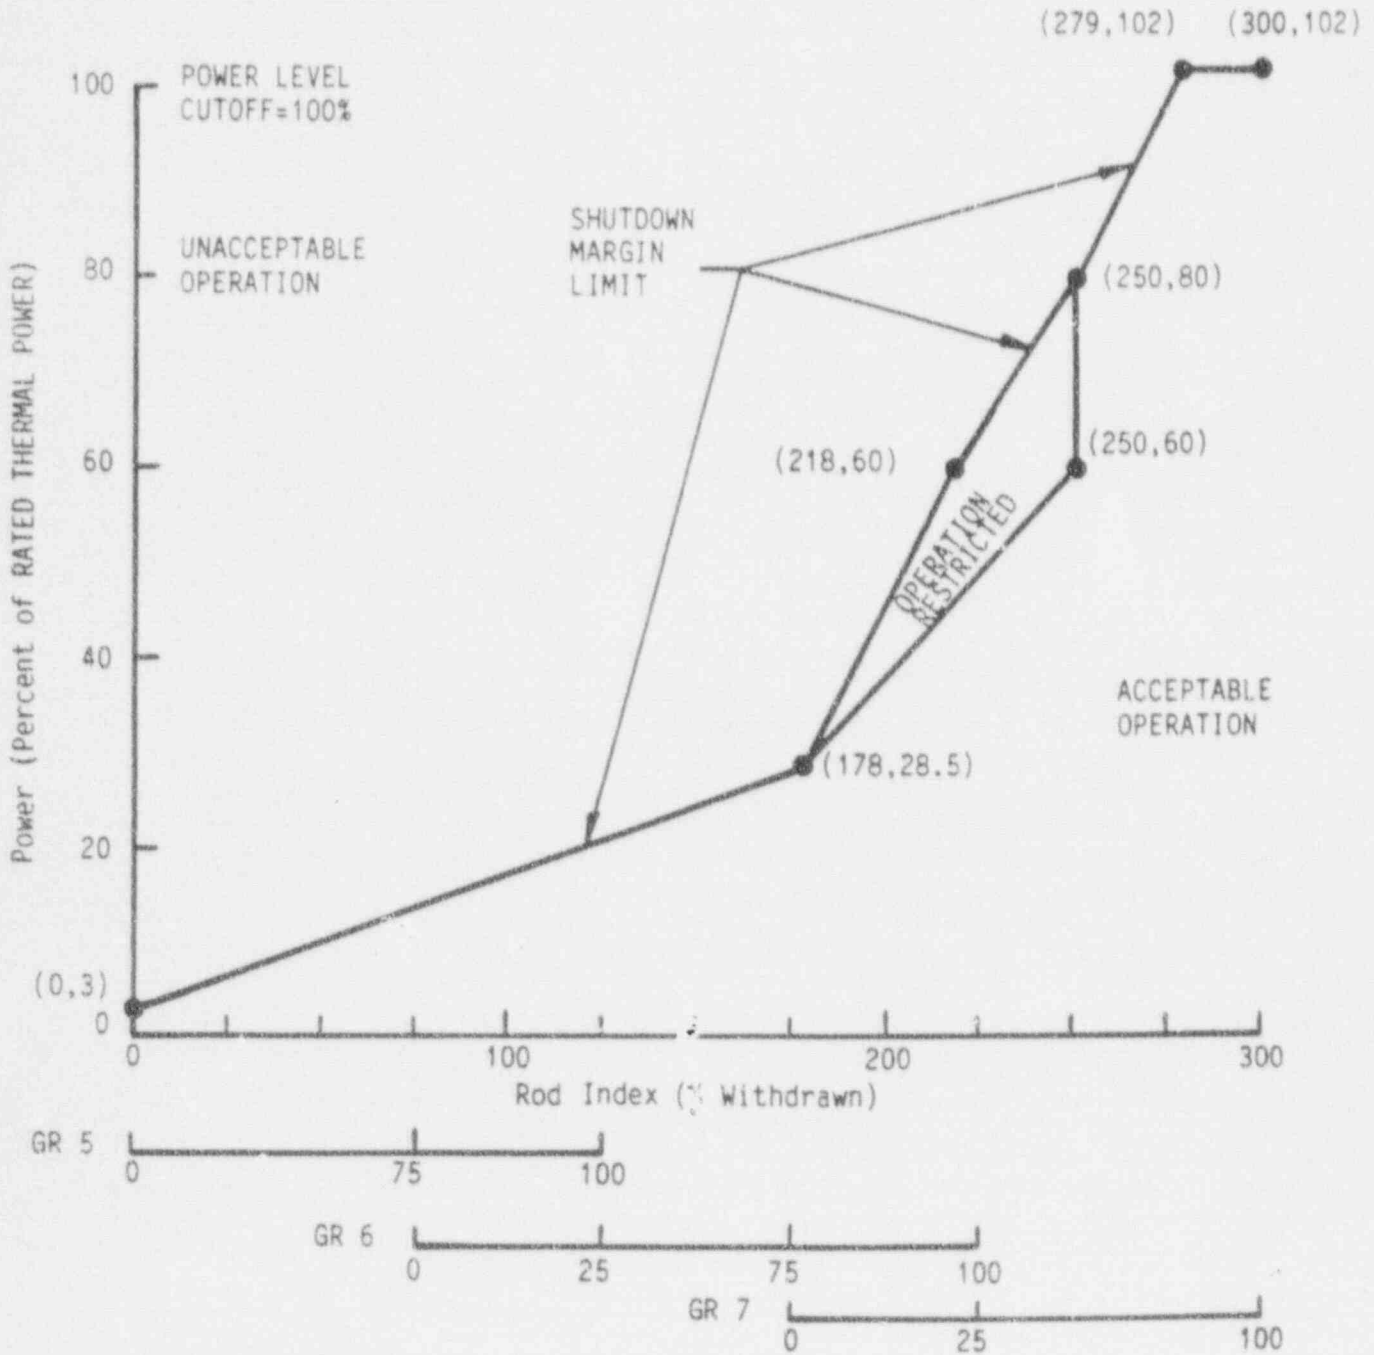

Note 1: A Rod Group overlap of 25±5% between sequential withdrawn groups 5 and 6, and 6 and 7 shall be maintained.

Figure 1c Regulating Group Position Limits,
 After 400±10 EFPD, Four RC Pumps --
 Davis-Besse 1, Cycle 8


This Figure is referred
 to by Technical Specification
 3.1.3.6

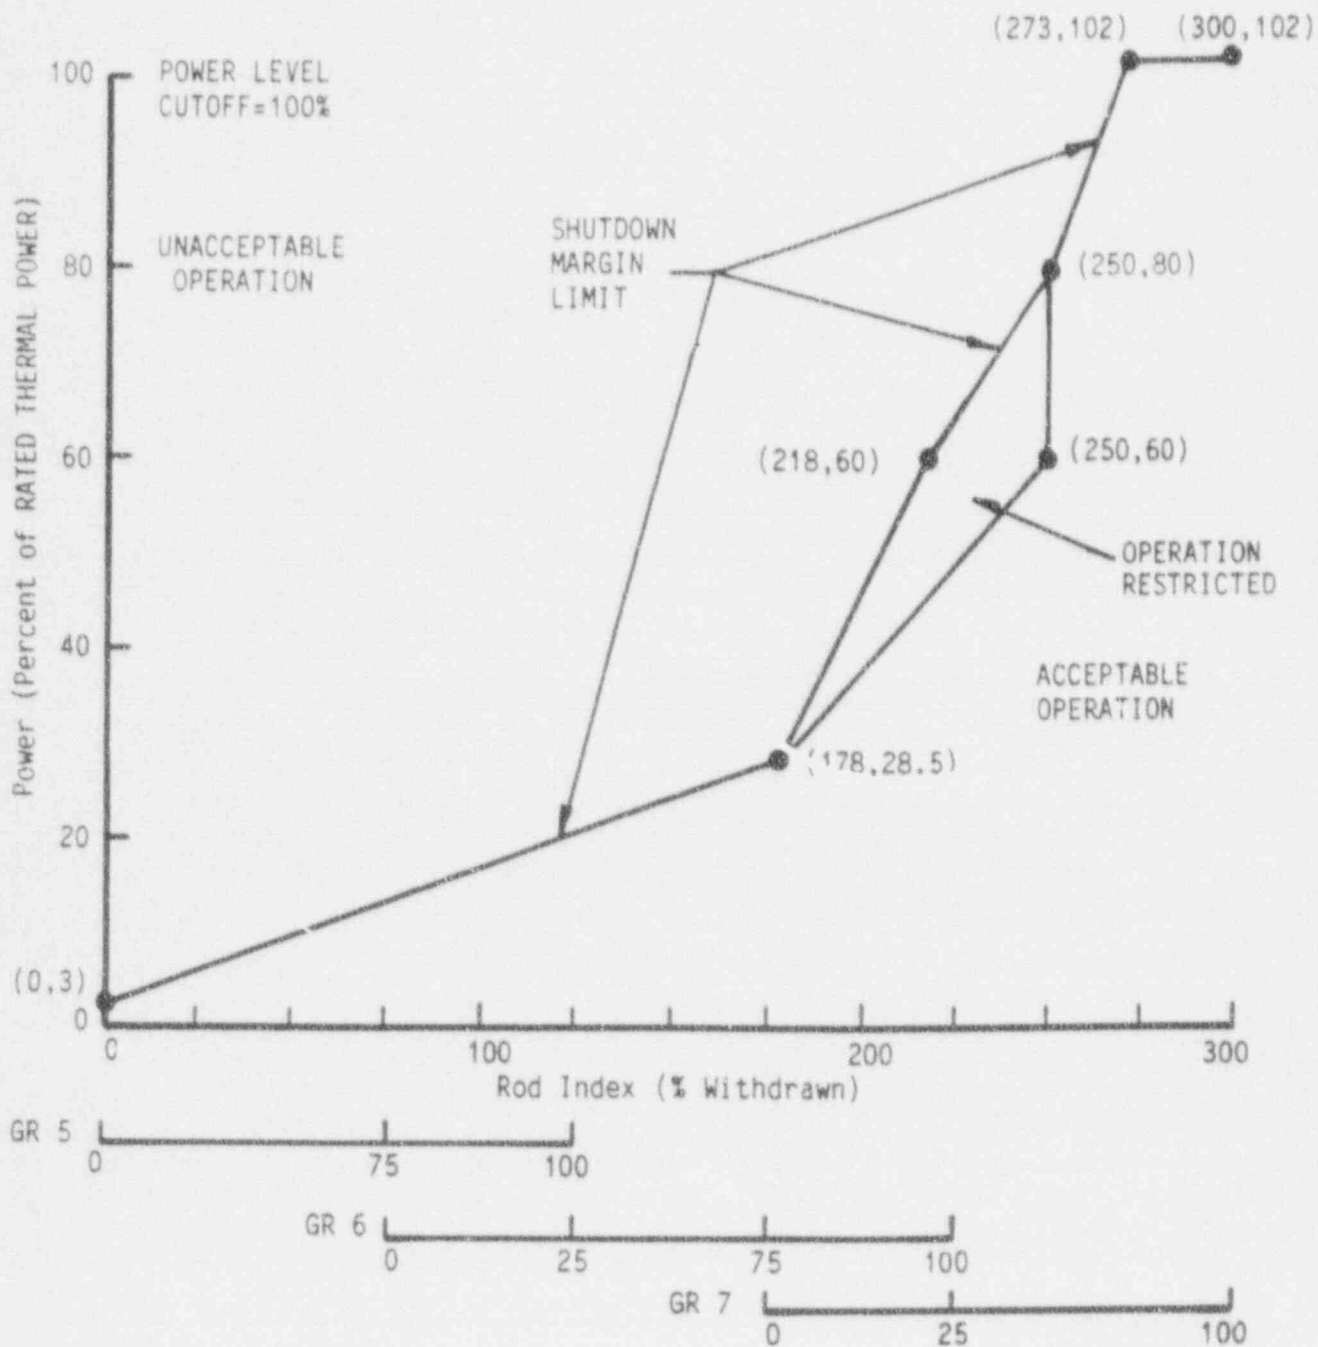

Note 1: A Rod Group overlap of 25±5% between sequential withdrawn groups 5 and 6, and 6 and 7 shall be maintained.

Figure 2a Regulating Group Position Limits,
 0 to 200±10 EFPD, Three RC Pumps --
 Davis-Besse 1, Cycle 8


This Figure is referred
 to by Technical Specification
 3.1.3.6

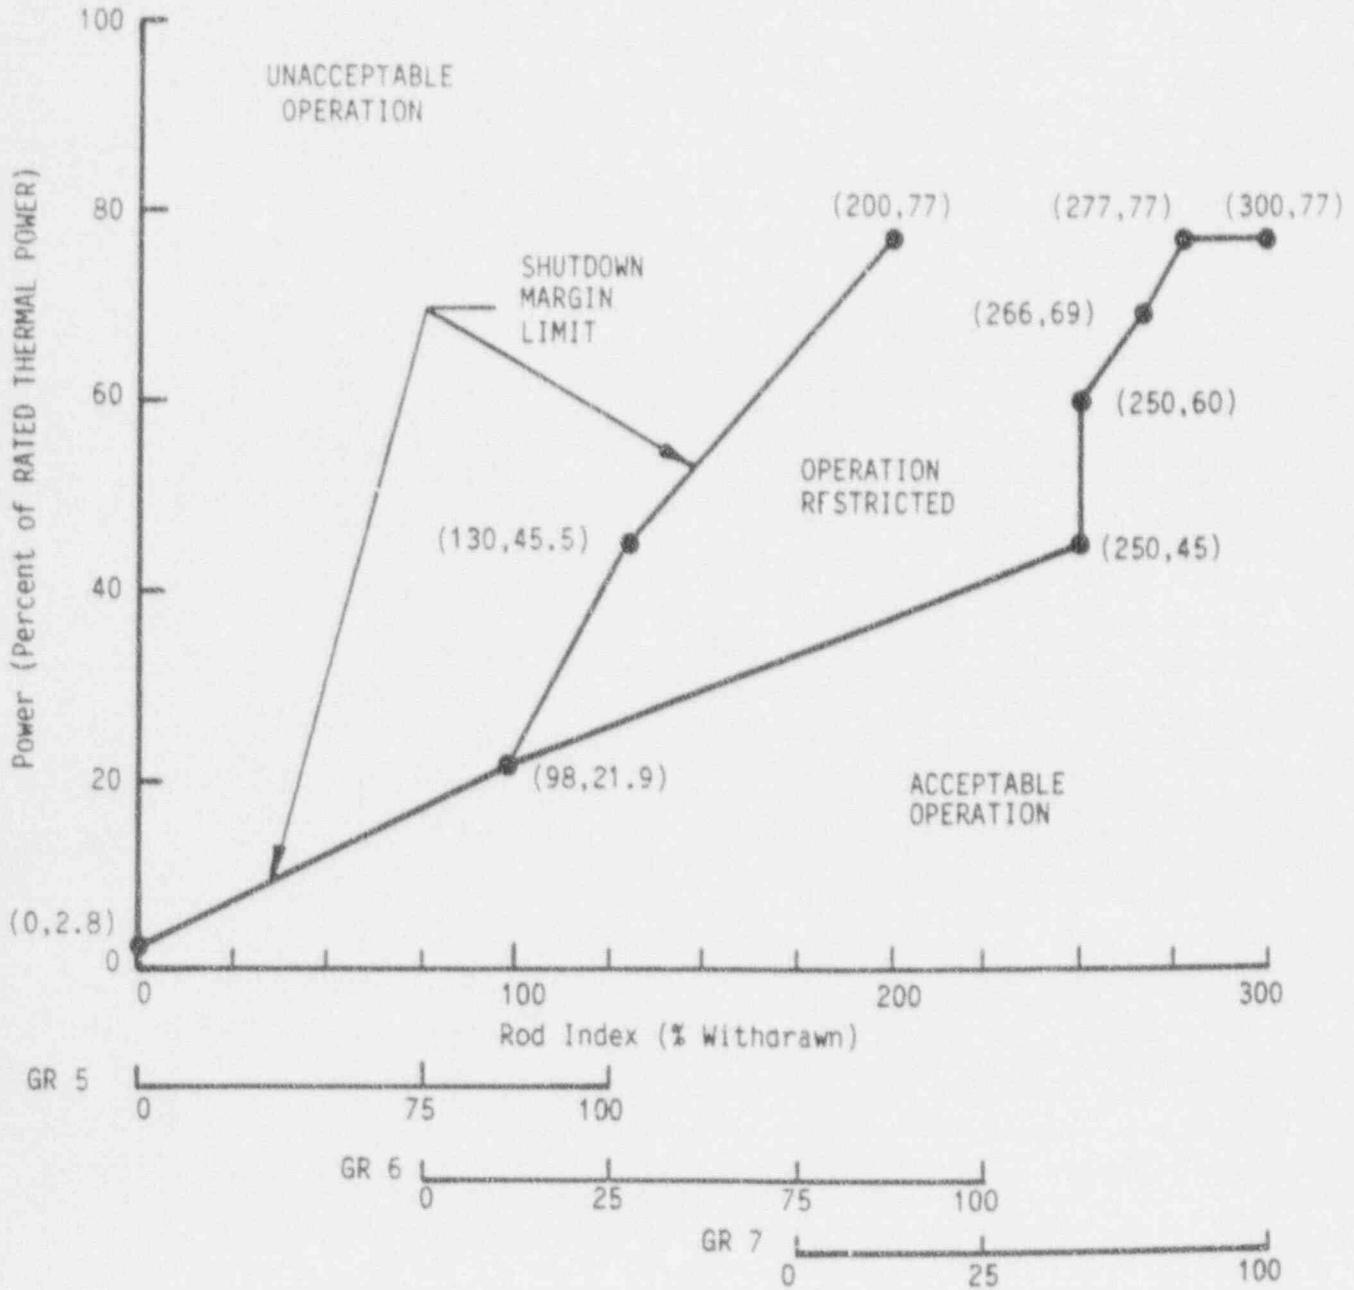

Note 1: A Rod Group overlap of 25±5% between sequential withdrawn groups 5 and 6, and 6 and 7 shall be maintained.

Figure 2b Regulating Group Position Limits,
 200±10 to 400±10 EFPD, Three RC Pumps --
 Davis-Besse 1, Cycle 8


This Figure is referred
 to by Technical Specification
 3.1.3.6

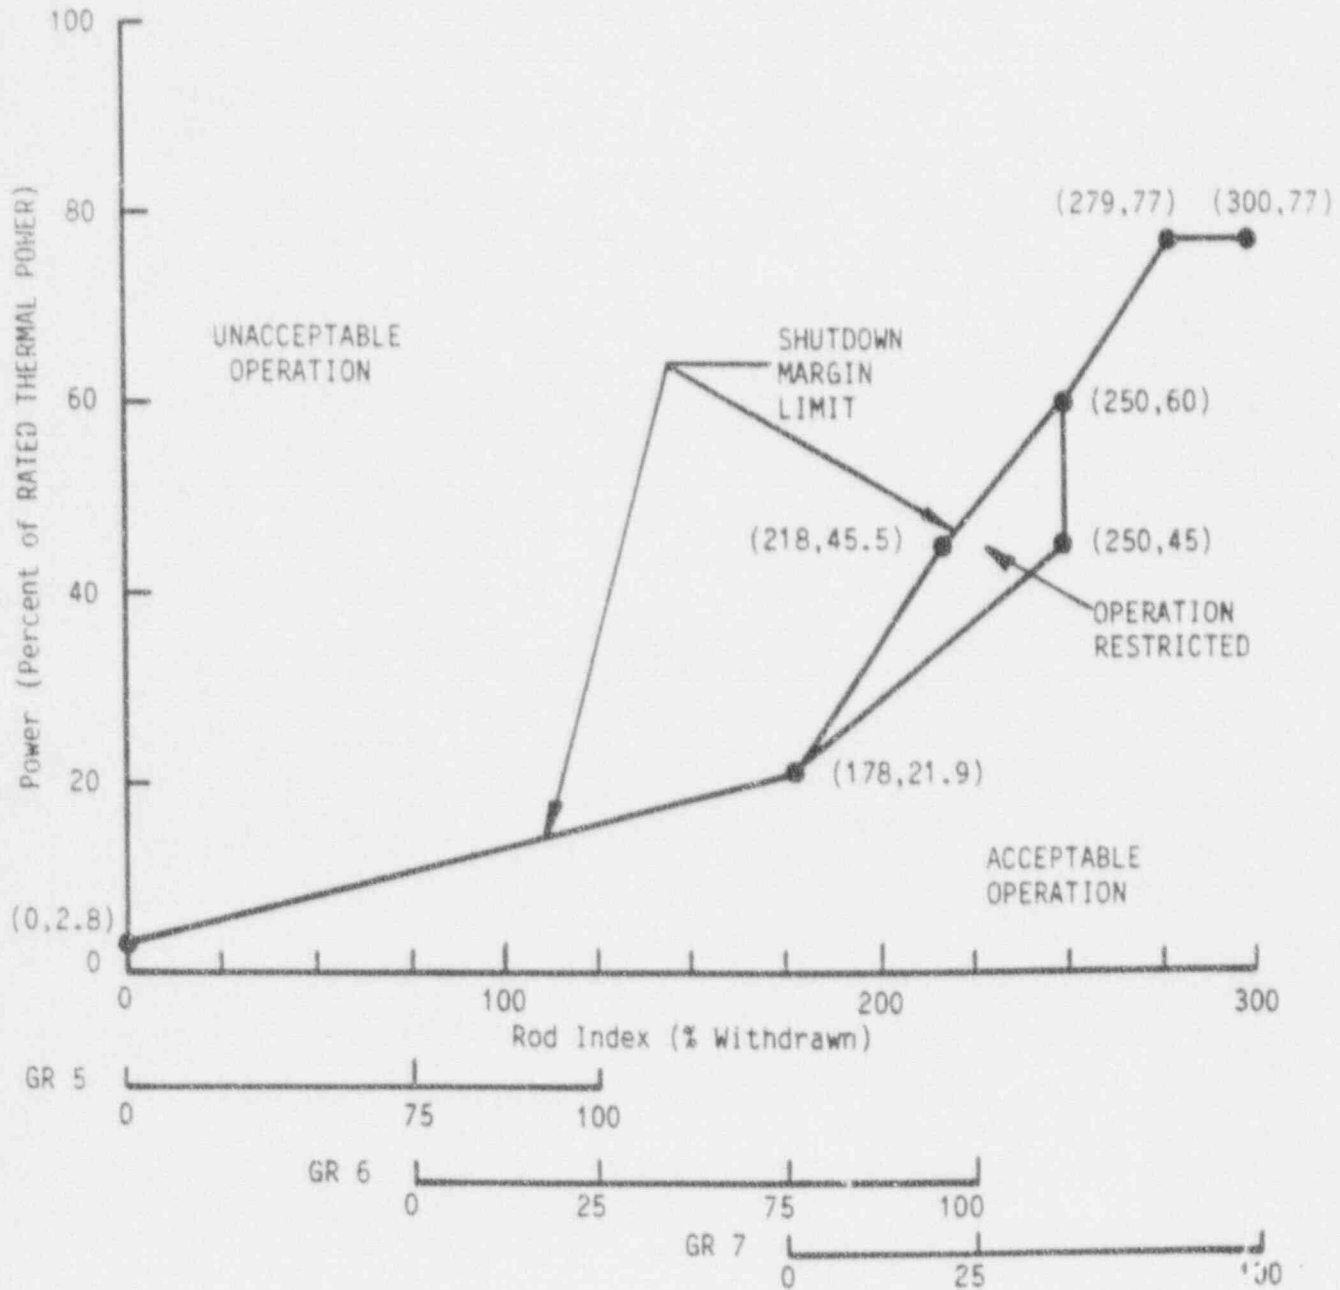

Note 1: A Rod Group overlap of 25±5% between sequential withdrawn groups 5 and 6, and 6 and 7 shall be maintained.

Figure 2c Regulating Group Position Limits,
 After 400+10 EFPD, Three RC Pumps --
 Davis-Besse 1, Cycle 8


This Figure is referred
 to by Technical Specification
 3.1.3.6

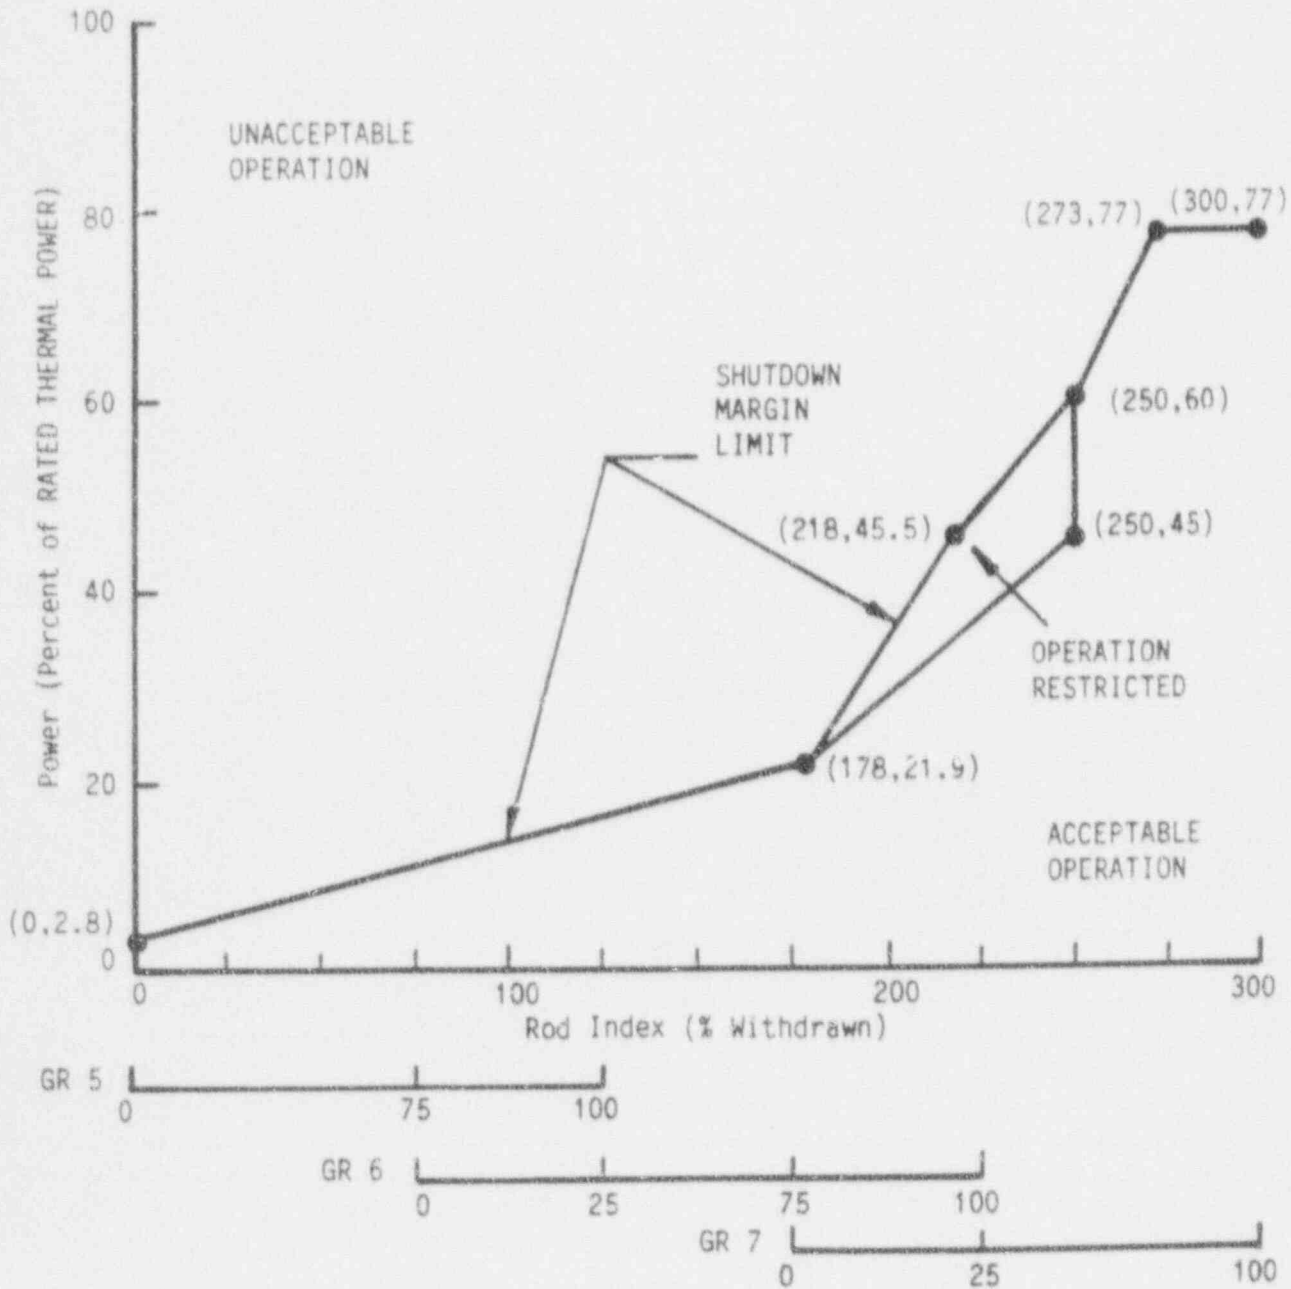

Note 1: A Rod Group overlap of 25+5% between sequential withdrawn groups 5 and 6, and 6 and 7 shall be maintained.

Figure 3 Control Rod Core Locations
 and Group Assignments --
 Davis-Besse 1, Cycle 8

This Figure is referred
 to by Technical Specification
 3.1.3.7

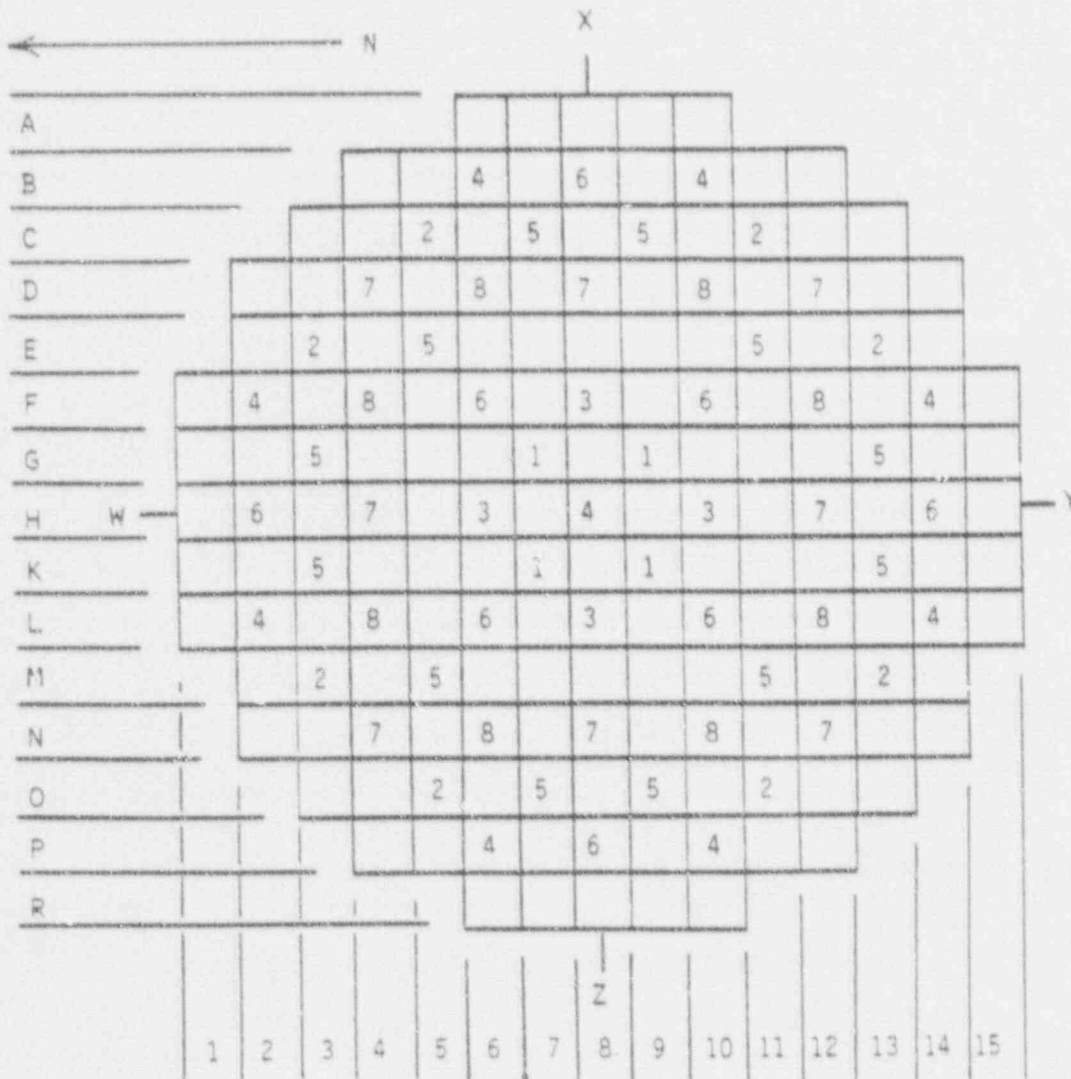

X Group Number

| Group | No. of Rods | Function |
|--------------|-------------|----------|
| 1 | 4 | Safety |
| 2 | 8 | Safety |
| 3 | 4 | Safety |
| 4 | 9 | Safety |
| 5 | 12 | Control |
| 6 | 8 | Control |
| 7 | 8 | Control |
| 8 | 8 | APSRs |
| Total | 61 | |

Figure 4a APSR Positions Limits,
0 to 400±10 EFPD, Four RC Pumps --
Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.1.3.9

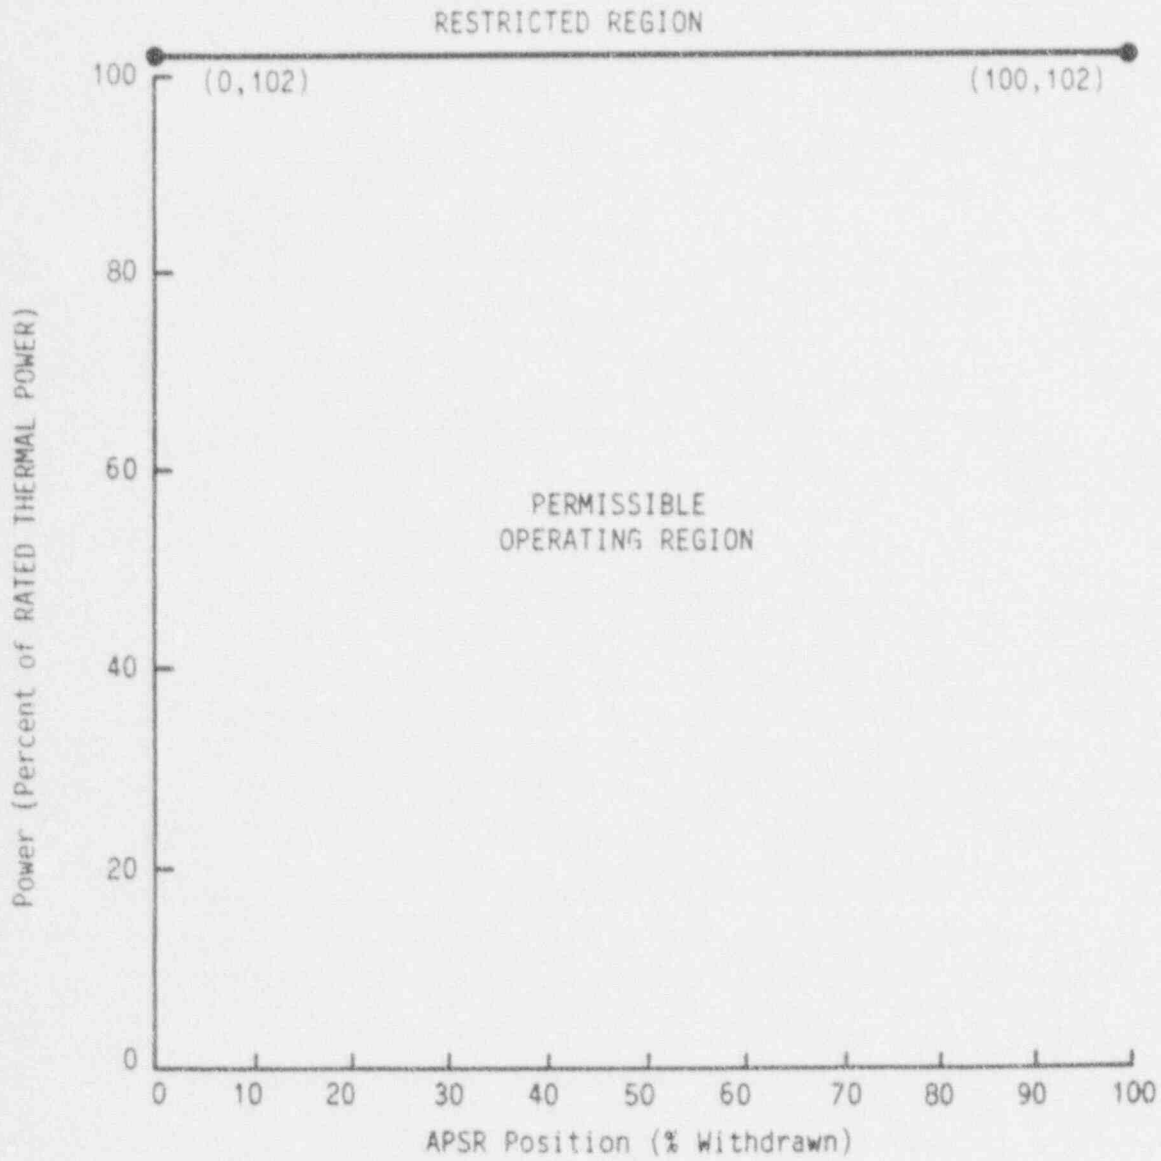


Figure 4b APSR Positions Limits, After
400+10 EFPD, Three or Four RC Pumps,
APSRs Withdrawn -- Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.1.3.9

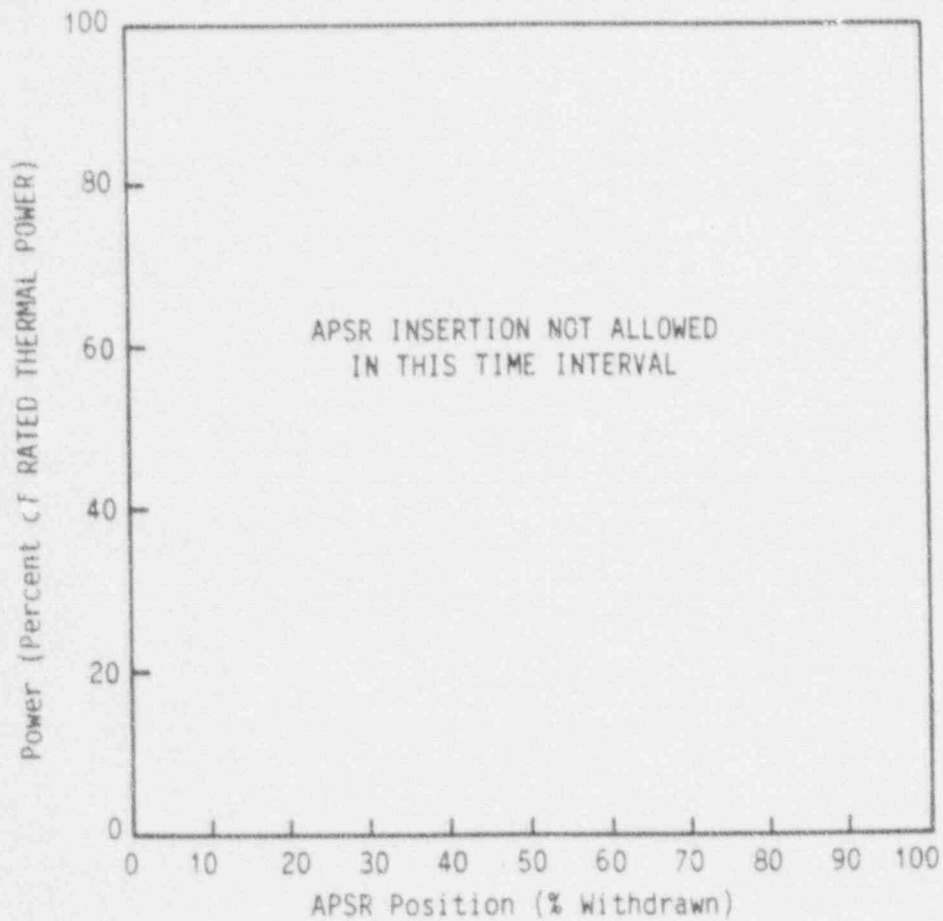


Figure 4c APSR Positions Limits,
0 to 400.10 EFPD, Three RC Pumps --
Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.1.3.9

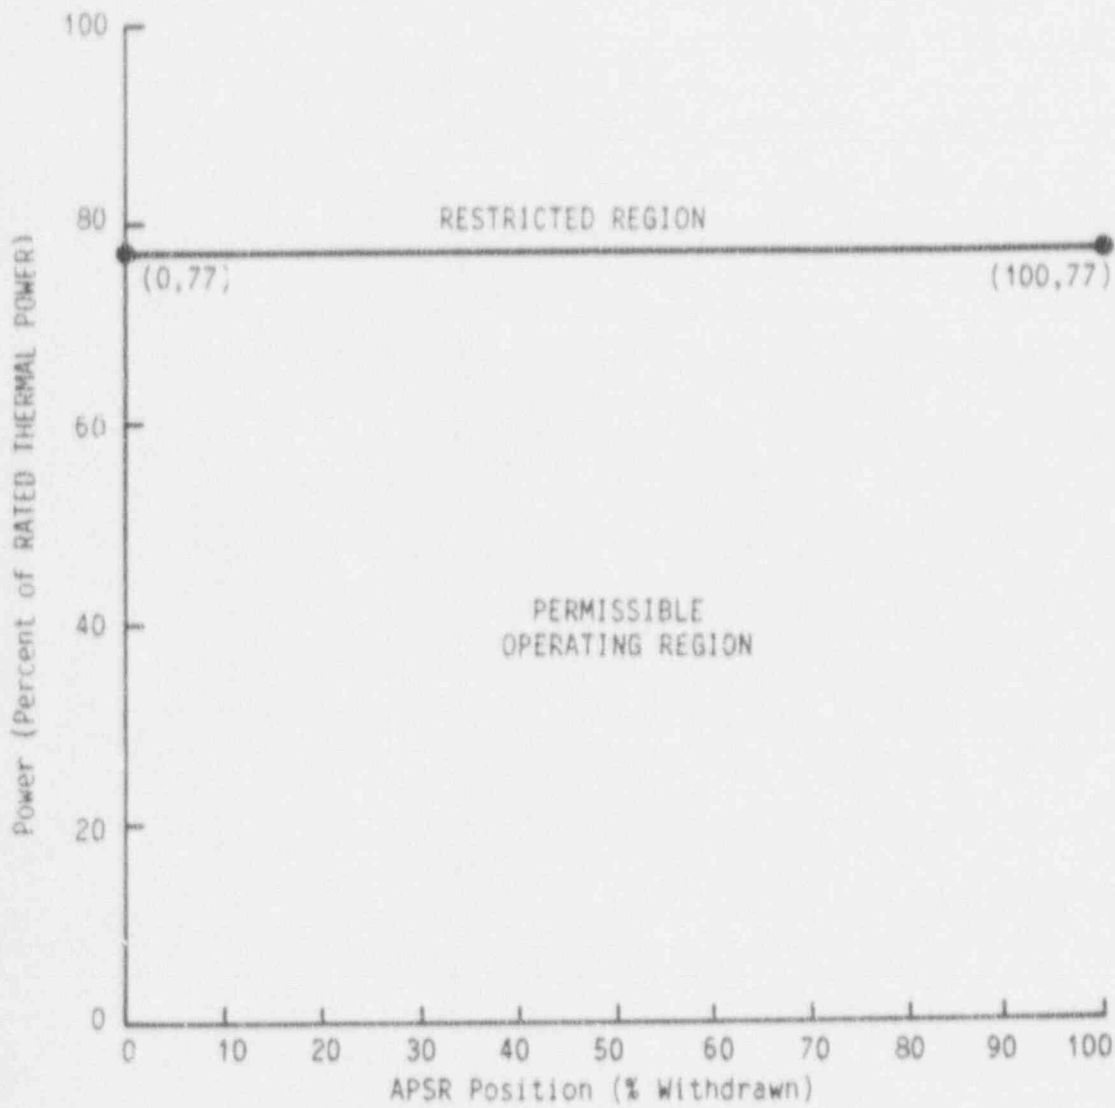


Figure 5a AXIAL POWER IMBALANCE Limits,
0 to 200±10 EFPD, Four RC Pumps --
Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.2.1

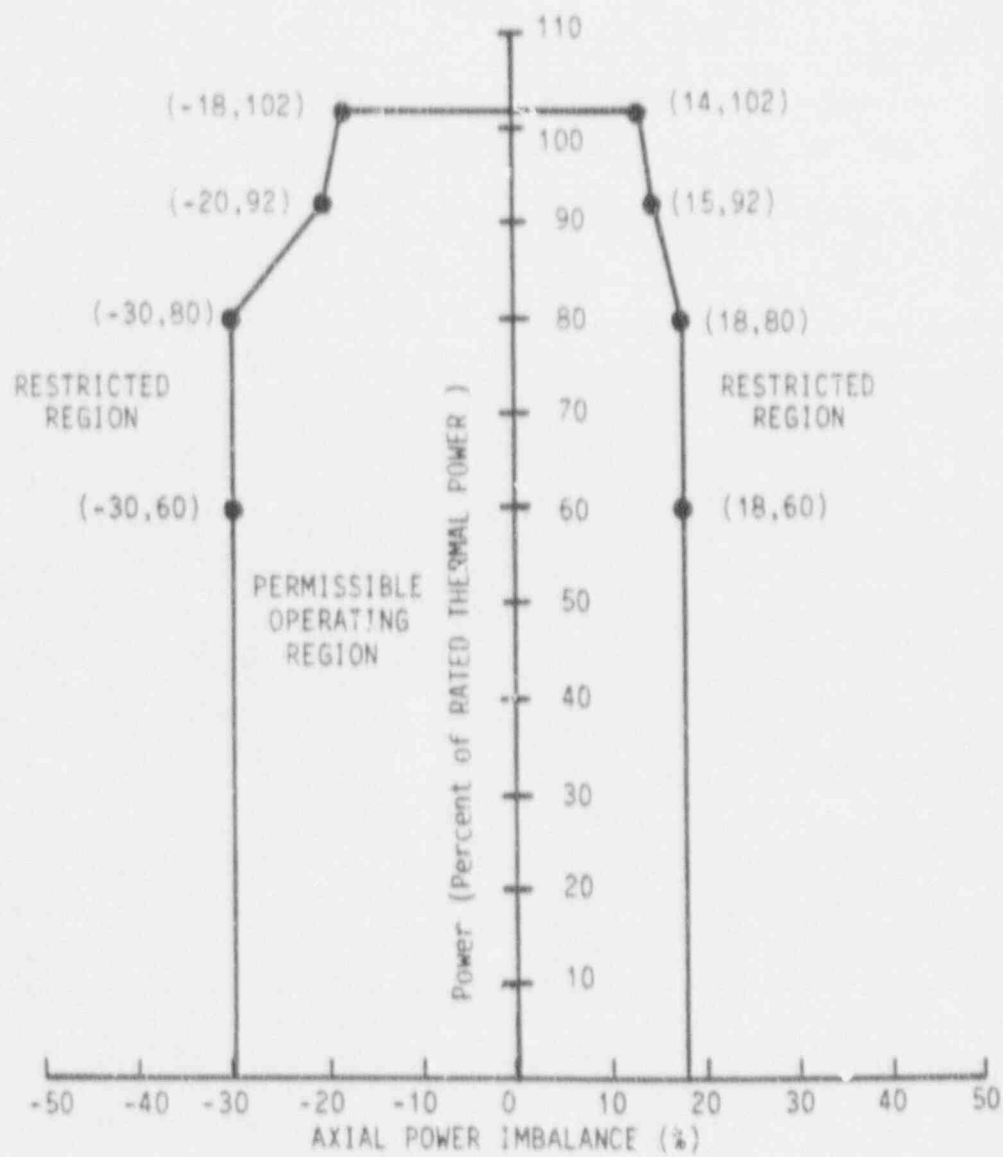


Figure 5b AXIAL POWER IMBALANCE Limits,
200 \pm 10 to 400 \pm 10 EFPD, Four RC Pumps --
Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.2.1

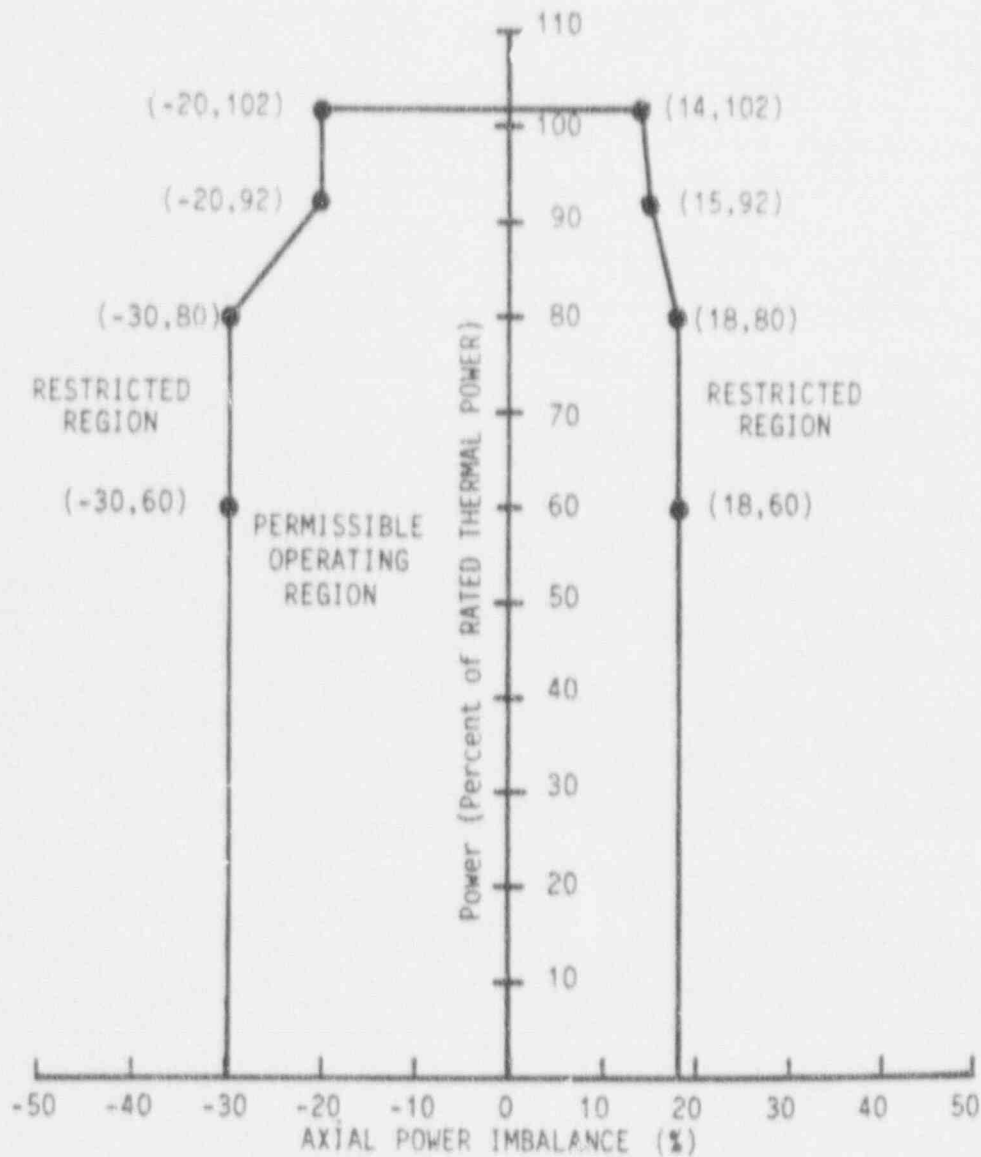


Figure 5c AXIAL POWER IMBALANCE Limits,
After 400±10 EFPD, Four RC Pumps --
Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.2.1

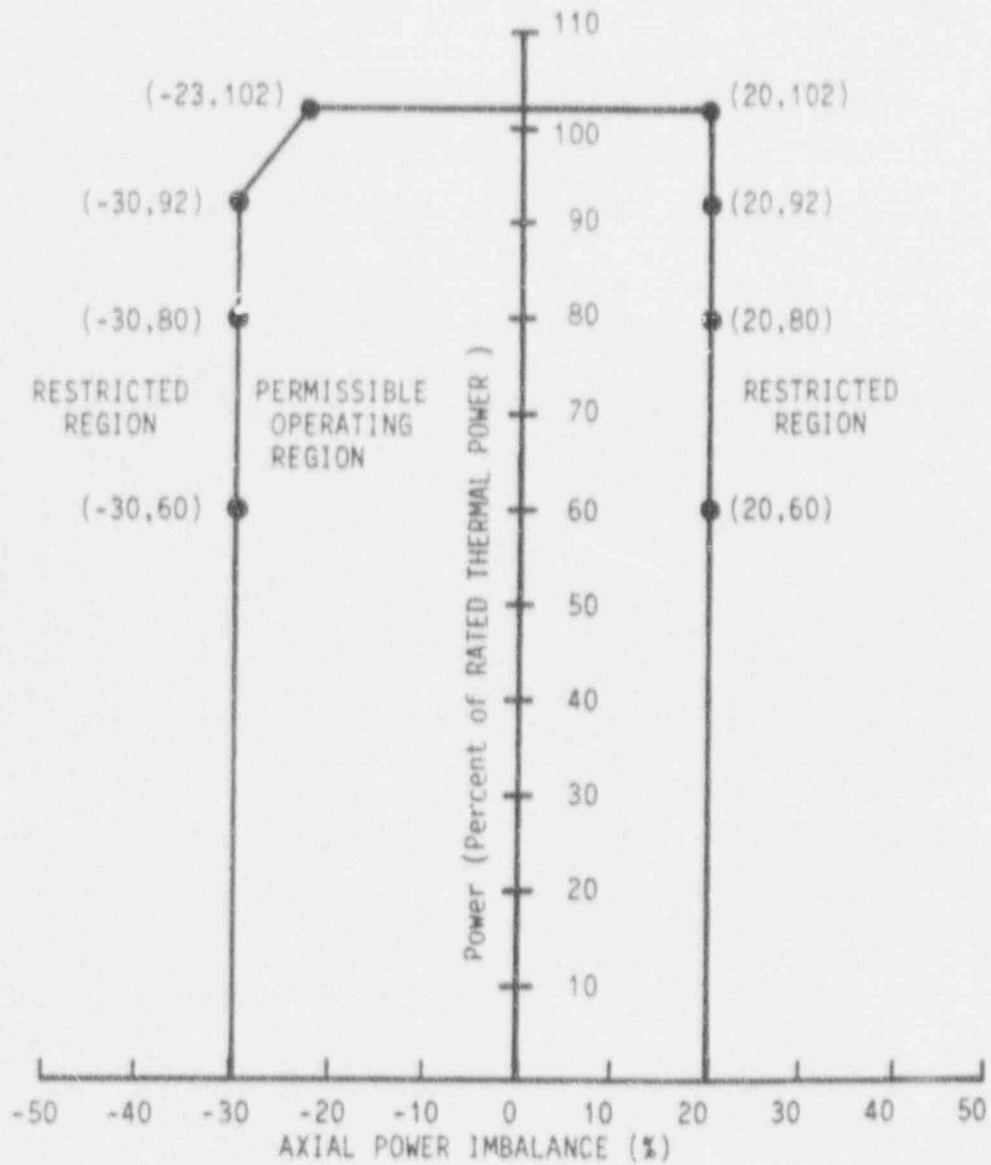


Figure 6a AXIAL POWER IMBALANCE Limits,
0 to 200±10 EFPD, Three RC Pumps --
Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.2.1

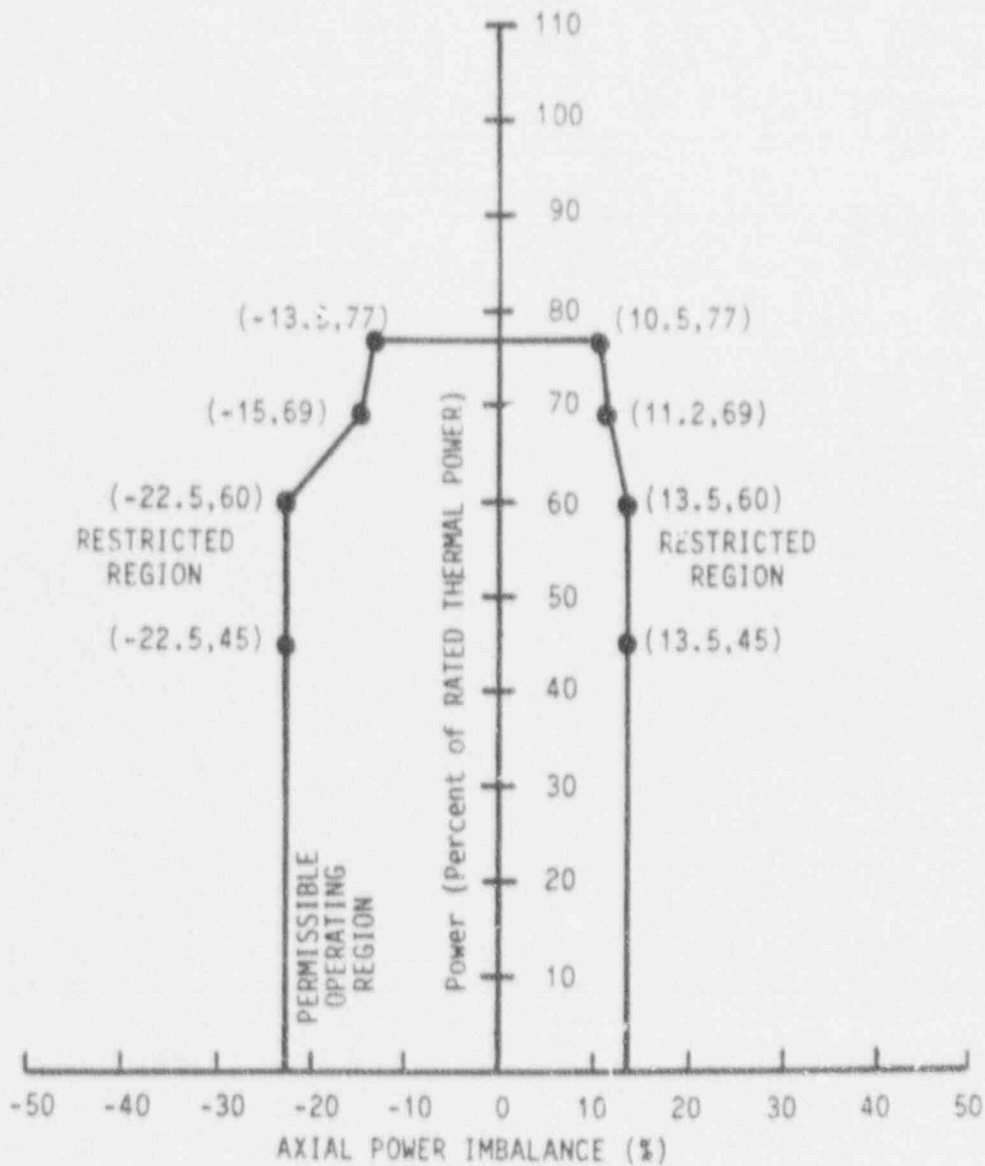


Figure 6b AXIAL POWER IMBALANCE Limits,
200±10 to 400±10 EFPD, Three RC Pumps --
Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.2.1

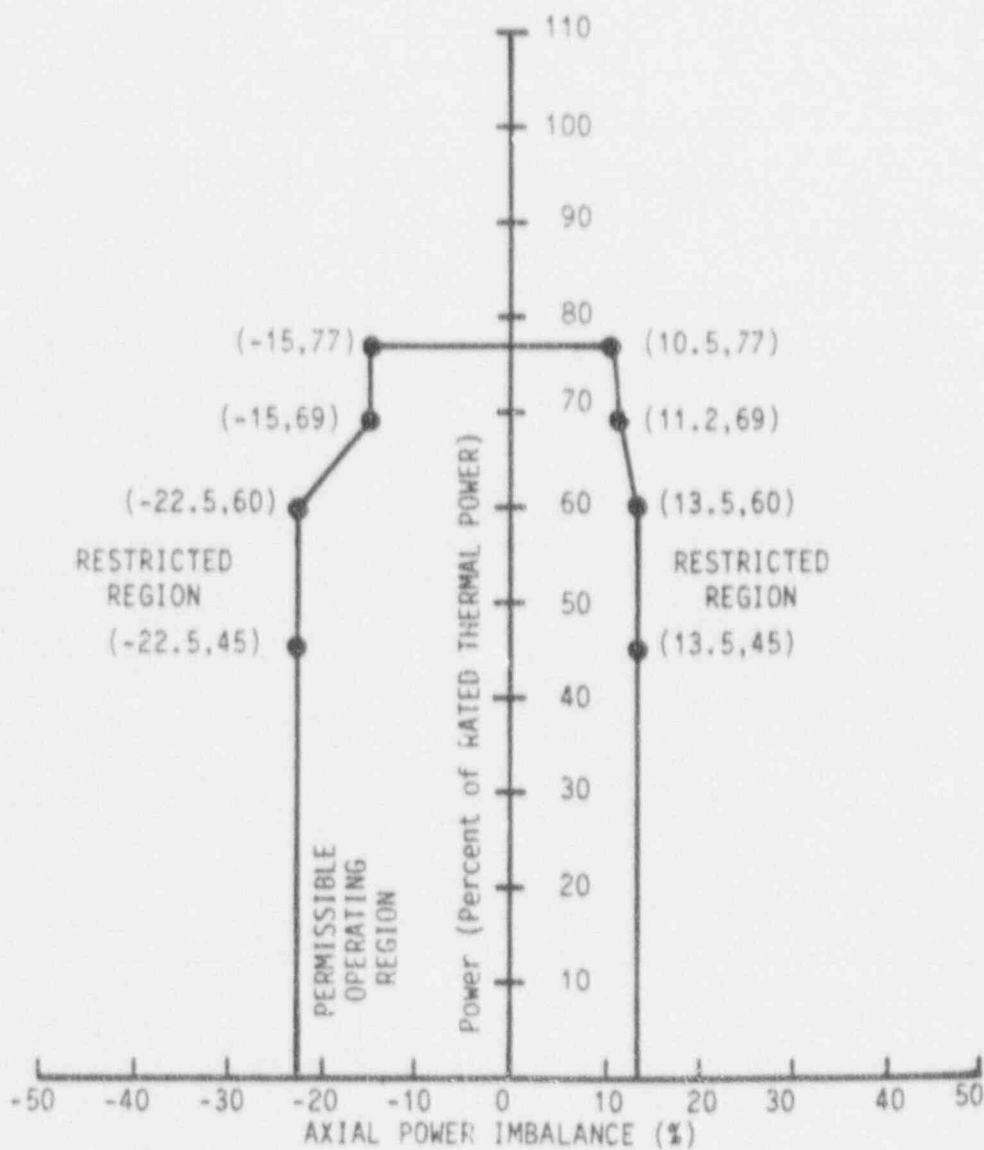


Figure 6c AXIAL POWER IMBALANCE Limits,
After 400±10 EFPD, Three RC Pumps --
Davis-Besse 1, Cycle 8

This Figure is referred
to by Technical Specification
3.2.1

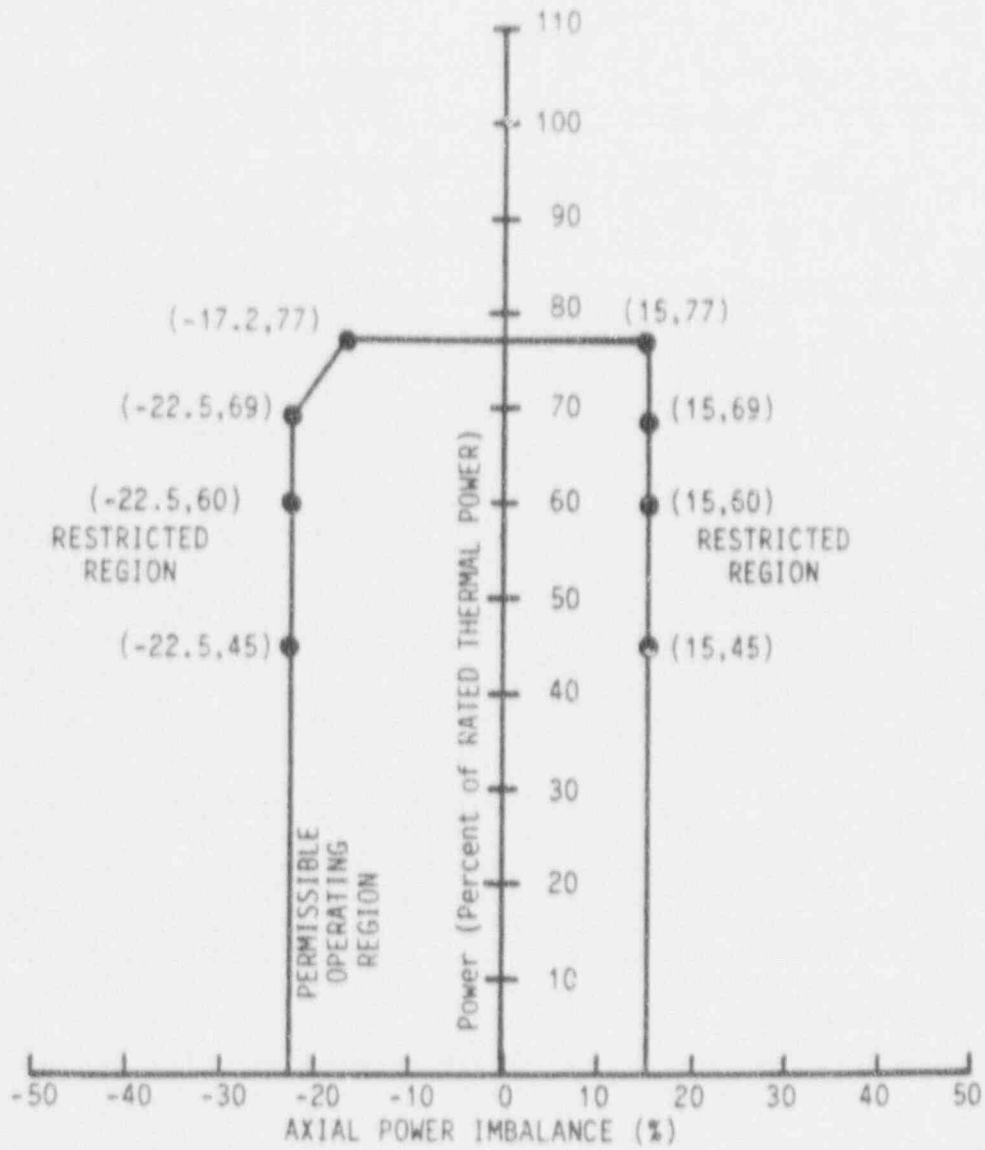


Table 1 QUADRANT POWER TILT Limits

This Table is referred
to by Technical Specification
3.2.4

| Quadrant Power Tilt as measured by: | Steady-state Limit for Thermal Power \leq 60% | Steady-state Limit for Thermal Power \geq 60% | Transient Limit | Maximum Limit |
|--|--|--|--------------------|------------------|
| Symmetrical incore detector system | 6.83 | 4.11 | 10.03 | 20.0 |
| Power Range channels | 4.05 | 1.96 | 6.96 | 20.0 |
| Minimum incore detector system | 2.80* | 1.90* | 4.40* | 20.0* |

*Assumes detector strings with $>60\%$ depletion are excluded from the minimum incore system configuration.

Table 2 Negative Moderator Temperature Coefficient Limit

This Table is referred
to by Technical Specification
s.1.1.3c

Negative Moderator Temperature Coefficient Limit
(at RATED THERMAL POWER)

$$-3.73 \times 10^{-6} \Delta k/k/^{\circ}F$$