



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

IOWA ELECTRIC LIGHT AND POWER COMPANY
CENTRAL IOWA POWER COOPERATIVE
CORN BELT POWER COOPERATIVE

DOCKET NO. 50-331

DUANE ARNOLD ENERGY CENTER

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 98
License No. DPR-49


1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Iowa Electric Light & Power Company, et al, dated March 5, 1984, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 2.C.(2) of Facility Operating License No. DPR-49 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. , are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. The license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Domenic B. Vassallo, Chief
Operating Reactors Branch #2
Division of Licensing

Attachment:
Changes to the
Technical Specifications

Date of Issuance: May 14, 1984

ATTACHMENT TO LICENSE AMENDMENT NO. 98

FACILITY OPERATING LICENSE NO. DPR-49

DOCKET NO. 50-331


Revise the Appendix A Technical Specifications by Removing the Current pages and inserting the revised pages listed below. The revised areas are identified by vertical lines.

LIST OF AFFECTED PAGES

3.12 - 16


3.12 - 17

3.12 - 18

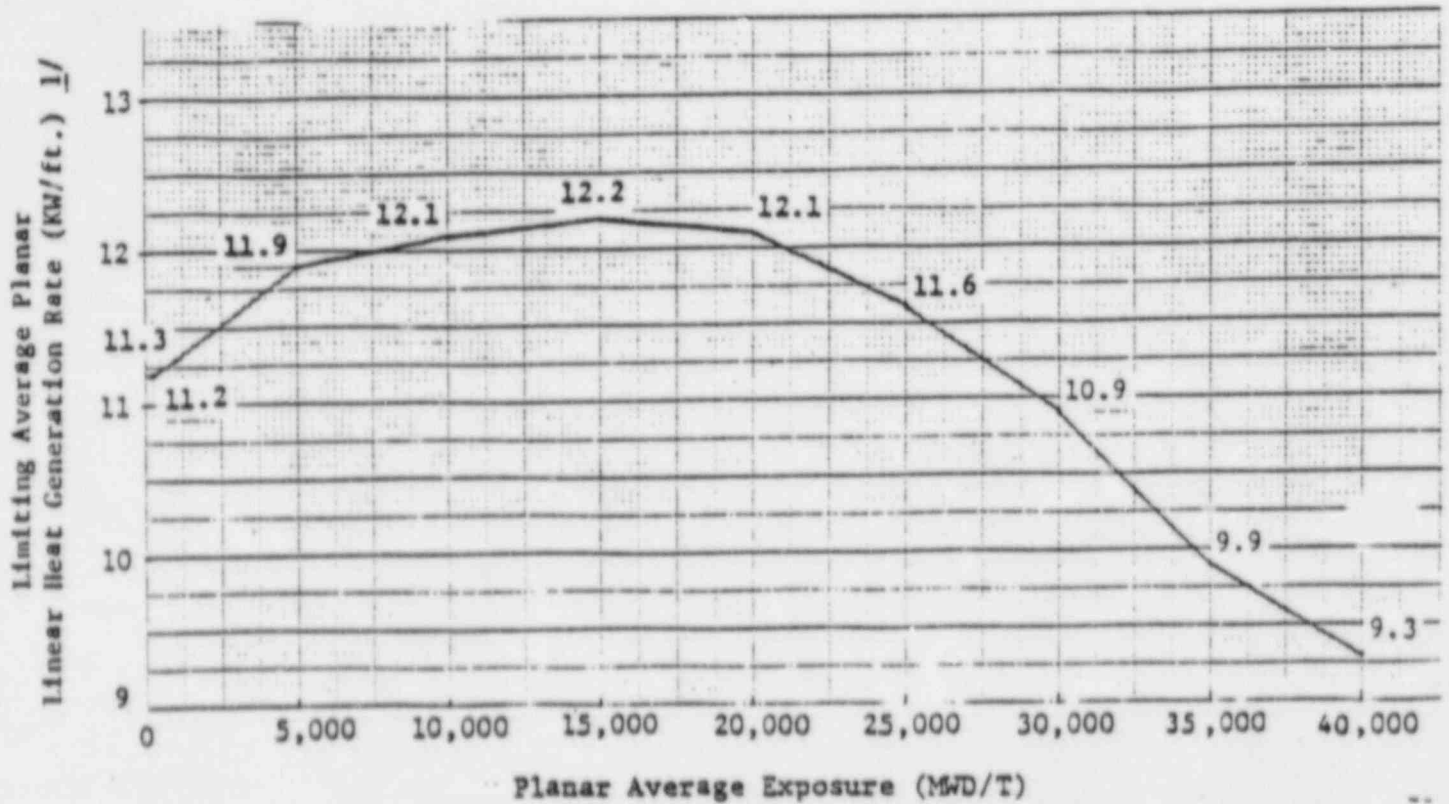

1/ When core flow is equal to or less than 70% of rated, the MAPLHGR shall not exceed 95% of the limiting values shown.


DUANE ARNOLD ENERGY CENTER IOWA ELECTRIC LIGHT AND POWER COMPANY TECHNICAL SPECIFICATIONS
LIMITING AVERAGE PLANAR LINEAR HEAT GENERATION RATE AS A FUNCTION OF PLANAR AVERAGE EXPOSURE FUEL TYPE: 8D274L FIGURE 3.12-5

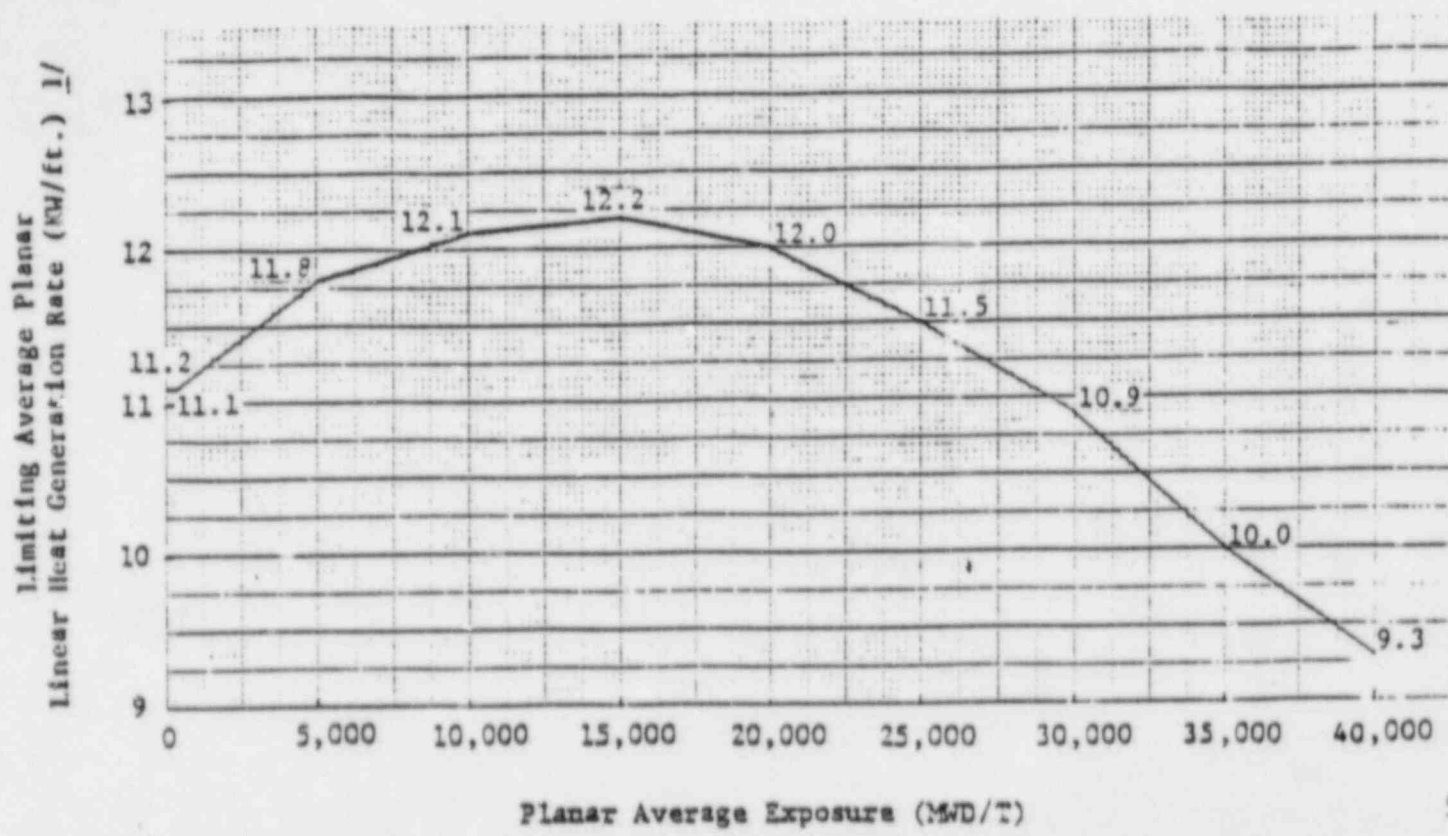

1/ When core flow is equal to or less than 70% of rated, the MAPLGR shall not exceed 95% of the limiting values shown.

DUANE ARNOLD ENERGY CENTER IOWA ELECTRIC LIGHT AND POWER COMPANY TECHNICAL SPECIFICATIONS
LIMITING AVERAGE PLANAR LINEAR HEAT GENERATION RATE AS A FUNCTION OF PLANAR AVERAGE EXPOSURE FUEL TYPE: 8D274H FIGURE 3.12-6

Limiting Average Planar Linear Heat Generation Rate (KW/ft.) ^{1/}

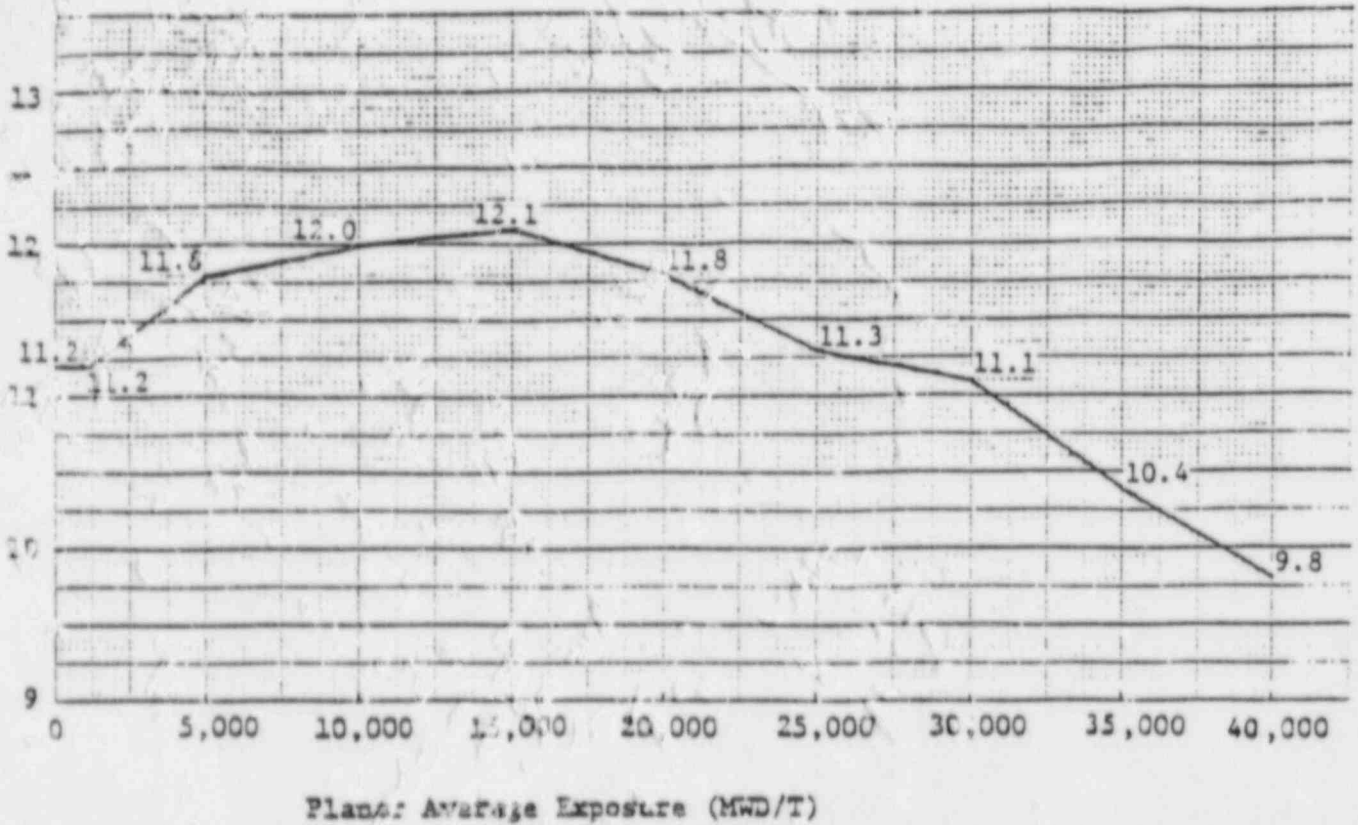

^{1/} When core flow is equal to or less than 70% of rated, the MAPLEGR shall not exceed 95% of the limiting values shown.

<p style="text-align: center;"> JOHNS ARNOLD ENERGY CENTER IOWA ELECTRIC LIGHT AND POWER COMPANY TECHNICAL SPECIFICATIONS </p>
<p style="text-align: center;"> LIMITING AVERAGE PLANAR LINEAR HEAT GENERATION RATE AS A FUNCTION OF PLANAR AVERAGE EXPOSURE </p> <p style="text-align: center;"> FUEL TYPE: PSDP8289 </p> <p style="text-align: center;"> FIGURE 3.12-7 </p>