

Enclosure C  
ULNRC- 941

MARKED TECHNICAL SPECIFICATION PAGES

8410110011 841008  
PDR ADOCK 05000483  
P PDR

## ADMINISTRATIVE CONTROLS

### 6.4 TRAINING

6.4.1 A retraining and replacement training program for the unit staff shall be maintained under the direction of the Superintendent of Training and shall meet or exceed the requirements and recommendations of Section 5 of ANSI/ANS 3.1-1978 and Appendix A of 10 CFR Part 55 and the supplemental requirements specified in Sections A and C of Enclosure 1 of the March 28, 1980 NRC letter to all licensees, and shall include familiarization with relevant industry operational experience identified by the ISEG.

### 6.5 REVIEW AND AUDIT

#### 6.5.1 ON-SITE REVIEW COMMITTEE (ORC)

##### FUNCTION

6.5.1.1 The ORC shall function to advise the Manager, Callaway Plant on all matters related to nuclear safety.

##### COMPOSITION

6.5.1.2 The ORC shall be composed of the:

Chairman:	Manager, Callaway Plant
Member:	Asst Mgr, Oper and Maintenance
Member:	Asst Mgr, Tech Services
Member:	Asst Mgr, Support Services
Member:	Supt, Health Physics
Member:	Supv Eng, Quality Assurance
*Member:	Adv to Mgr, Callaway Plant
Member:	<i>Asst Mgr, Administrative</i>

##### ALTERNATES

6.5.1.3 All alternate members shall be appointed in writing by the ORC Chairman to serve on a temporary basis.\*\*

##### MEETING FREQUENCY

6.5.1.4 The ORC shall meet at least once per calendar month and as convened by the ORC Chairman or his designated alternate.


##### QUORUM

6.5.1.5 The quorum of the ORC necessary for the performance of the ORC responsibility and authority provisions of these Technical Specifications shall consist of the Chairman or his designated alternate and four members of which no more than two shall be alternates.

---

\*This member may be removed when this position is abolished.

\*\*Except for the alternate for the Supv Eng, Quality Assurance (Operations), who is appointed by the Manager, Quality Assurance.

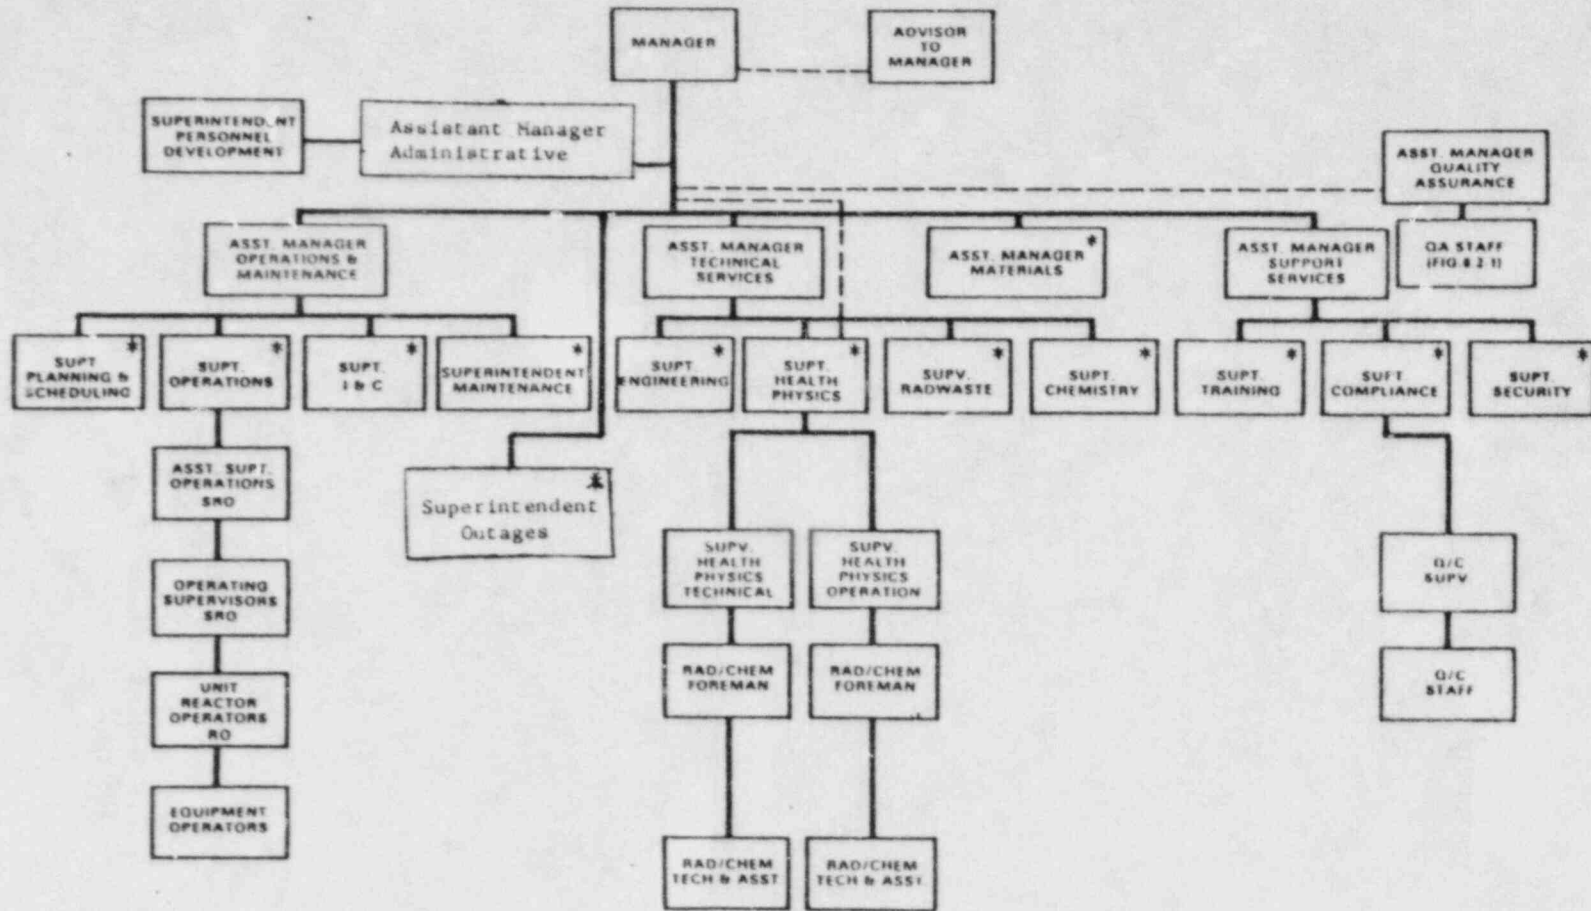

↓ DEPARTMENT HEAD

FIGURE 6.2-2  
UNIT ORGANIZATION

## INSTRUMENTATION

### FIRE DETECTION INSTRUMENTATION

#### LIMITING CONDITION FOR OPERATION

---

3.3.3.7 As a minimum, the fire detection instrumentation for each fire detection zone shown in Table 3.3-11 shall be OPERABLE.

APPLICABILITY: Whenever equipment protected by the fire detection instrument is required to be OPERABLE.

#### ACTION:

- a. With any, but not more than one-half the total in any fire zone, Function A fire detection instruments shown in Table 3.3-11 inoperable, restore the inoperable instrument(s) to OPERABLE status within 14 days or within the next 1 hour establish a fire watch patrol to inspect the zone(s) with the inoperable instrument(s) at least once per hour, unless the instrument(s) is located inside the containment, then inspect that containment zone at least once per 8 hours or monitor the containment air temperature at least once per hour at the locations listed in Specification 4.6.1.<sup>5</sup>
- b. With more than one-half of the Function A fire detection instruments in any fire zone shown in Table 3.3-11 inoperable, or with any Function B fire detection instruments shown in Table 3.3-11 inoperable, or with any two or more adjacent fire detection instruments shown in Table 3.3-11 inoperable, within 1 hour establish a fire watch patrol to inspect the zone(s) with the inoperable instrument(s) at least once per hour, unless the instrument(s) is located inside the containment, then inspect that containment zone at least once per 8 hours or monitor the containment air temperature at least once per hour at the locations listed in Specification 4.6.1.<sup>5</sup>
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.3.3.7.1 Each of the above required fire detection instruments which are accessible during plant operation shall be demonstrated OPERABLE at least once per 6 months by performance of a TRIP ACTUATING DEVICE OPERATIONAL TEST. Fire detectors which are not accessible during plant operation shall be demonstrated OPERABLE by the performance of a TRIP ACTUATING DEVICE OPERATIONAL TEST during each COLD SHUTDOWN exceeding 24 hours unless performed in the previous 6 months.

4.3.3.7.2 The NFPA Standard 72D supervised circuits supervision associated with the detector alarms of each of the above required fire detection instruments shall be demonstrated OPERABLE at least once per 6 months.

cc: Gerald Charnoff, Esq.  
Shaw, Pittman, Potts & Trowbridge  
1800 M. Street, N.W.  
Washington, D.C. 20036

Nicholas A. Petrick  
Executive Director  
SNUPPS  
5 Choke Cherry Road  
Rockville, Maryland 20850

John H. Neisler  
Callaway Resident Office  
U.S. Nuclear Regulatory Commission  
RR#1  
Steedman, Missouri 65077

William Forney  
Division of Projects and  
Resident Programs, Chief, Section 1A  
U.S. Nuclear Regulatory Commission  
Region III  
799 Roosevelt Road  
Glen Ellyn, Illinois 60137

Bruce Little  
Callaway Resident Office  
U.S. Nuclear Regulatory Commission  
RR#1  
Steedman, Missouri 65077

Ron Kucera, Deputy Director  
Missouri Department of Natural Resources  
P.O. Box 176  
Jefferson City, Missouri 65102