



Duane Arnold Energy Center
3277 DAEC Road
Palo, IA 52324
Telephone 319 851 7611
Fax 319 851 7611

October 13, 1995
NG-95-3057

Mr. Hubert J. Miller
Regional Administrator
Region III
U.S. Nuclear Regulatory Commission
801 Warrenville Road
Lisle, IL 60532-4351

Subject: Duane Arnold Energy Center
Docket No: 50-331
Operating License DPR-49
September 1995 Monthly Operating Report

Dear Mr. Miller:

Please find enclosed the Duane Arnold Energy Center Monthly Operating Report for September 1995. The report has been prepared in accordance with the guidelines of NUREG-0020 and distribution has been made in accordance with DAEC Technical Specifications, Section 6.11.1.c.

Very truly yours,

Gary VanMiddlesworth
Plant Superintendent, Nuclear

GDV/RBW
Enclosures
File A-118d
cc:

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Mail Station P1-37
Washington, DC 20555-0001 (Orig.)

Mr. Dennis Murdock
Central Iowa Power Cooperative
Box 2517
Cedar Rapids, IA 52406

Mr. Glenn Kelly
Project Manager
1 Whiteflint North
Mail Stop 13E21
11555 Rockville Pike
Rockville, MD 20852

Dr. William A. Jacobs, Jr.
GDS Associates, Inc.
Suite 720
1850 Parkway Place
Marietta, GA 30068-8237

Document Control Desk
INPO Records Center
700 Galleria Parkway
Atlanta, GA 30339-5957

Mr. Dale Arends
Corn Belt Power Cooperative
1300 13th Street North
Humboldt, IA 50548

Mr. Steve Brown
Iowa State Utilities Board
Lucas State Office Building
Des Moines, IA 50319

DOCU
NRC Resident Inspector

Mr. Fred Yost
Director, Research Services
Utility Data Institute
1700 K St. NW, Suite 400
Washington, DC 20006

100073


9510190190 950930
PDR ADOCK 05000331
R PDR

OPERATING DATA REPORT

DOCKET NO: 50-0331
 DATE: 10/13/95
 Unit: Duane Arnold Energy Center
 COMPLETED BY: Richard Woodward
 TELEPHONE: (319) 851-7318

OPERATING STATUS

1. Unit Name: Duane Arnold Energy Center
2. Reporting Period: September 1995
3. Licensed Thermal Power (MW_{th}): 1658
4. Nameplate Rating (Gross MW_e DER): 565.7 (Turbine)
5. Design Electrical Rating (Net MW_e DER): 538
6. Maximum Dependable Capacity (Gross MW_e MDC): 545
7. Maximum Dependable Capacity (Net MW_e MDC): 515
8. If Changes Occur in Capacity Ratings (Items Number 3 through 7) since the last report, Give Reasons: Not Applicable
9. Power Level to Which Restricted, If Any (Net MW_e): Not Applicable
10. Reasons for Restrictions, If Any: Not Applicable

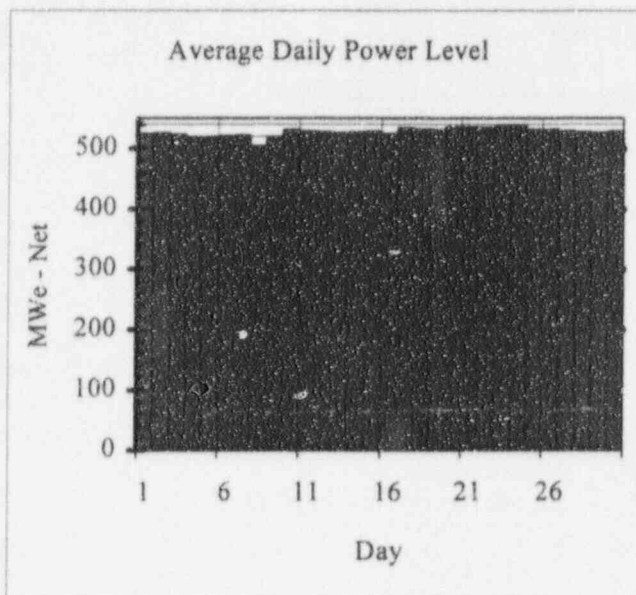

	September-95	1995	Cummulative
11. Hours in Reporting Period	720.0	6,551.0	181,127.0
12. Number of Hours Reactor Was Critical	720.0	5,136.2	136,316.8
13. Reactor Reserve Shutdown Hours	0.0	0.0	192.8
14. Hours Generator On-Line	720.0	5,045.7	132,904.8
15. Unit Reserve Shutdown Hours	0.0	0.0	0.0
16. Gross Thermal Energy Generated (MWH)	1,188,616.4	8,119,984.7	185,648,344.4
17. Gross Electrical Energy Generated (MWH)	401,578.0	2,730,939.0	62,178,825.5
18. Net Electrical Energy Generated (MWH)	379,291.6	2,574,117.8	58,314,162.1
19. Unit Service Factor	100.0%	77.0%	73.4%
20. Unit Availability Factor	100.0%	77.0%	73.4%
21. Unit Capacity Factor (Using MDC Net)	102.3%	76.3%	68.0%
22. Unit Capacity Factor (Using DER Net)	97.9%	73.0%	65.1%
23. Unit Forced Outage Rate	0.0%	1.5%	10.9%

24. Shutdowns Scheduled Over Next 6 Montns (Type, Date, and Duration of each): N/A

25. If Shutdown at End of Report Period, Estimated Date of Startup: N/A

AVERAGE DAILY UNIT POWER LEVEL

DOCKET NO: 50-0331
 DATE: 10/13/95
 Unit: Duane Arnold Energy Center
 COMPLETED BY: Richard Woodward
 TELEPHONE: (319) 851-7318

MONTH September 1995

Day	Average Daily Power Level (MWe-Net)
1	524.1
2	525.0
3	522.7
4	518.9
5	518.9
6	520.2
7	521.2
8	500.5
9	518.8
10	530.8
11	528.0
12	526.5
13	526.1
14	526.9
15	527.5
16	524.3
17	533.2
18	531.5
19	530.4
20	534.8
21	535.3
22	534.5
23	536.9
24	536.4
25	531.0
26	530.2
27	529.1
28	527.0
29	525.7
30	527.5
31	#N/A

REFUELING INFORMATION

DOCKET NO: 50-0331
 DATE: 10/13/95
 Unit: Duane Arnold Energy Center
 COMPLETED BY: Richard Woodward
 TELEPHONE: (319) 851-7318

1. **Name of facility.**
 Duane Arnold Energy Center
2. **Scheduled date for next refueling shutdown.**
 Refuel Outage XIV to begin October 10, 1996.
3. **Actual date for restart following refueling.**
 November 14, 1996
4. **Will refueling or resumption of operation thereafter require a technical specification change or other license amendment?**
 No
5. **Scheduled date(s) for submitting proposed licensing action and supporting information.**
 Not applicable
6. **Important licensing considerations associated with refueling, e.g., new or different fuel design or supplier, unreviewed design or performance analysis methods, significant changes in fuel design, new operating procedures.**
 No
7. **Current and projected fuel assemblies inventory:**

	Number of Fuel Assemblies	Projected date of last refueling that can be discharged
installed in reactor core (following refueling)	368	n/a
previously discharged from core to Spent Fuel Storage Pool (following refueling)	1408	n/a
under present physical capacity of Spent Fuel Storage Pool	2411	2007
under Licensed Capacity of Spent Fuel Storage Pool	3152	2014

DOCKET NO: 50-0331
 DATE: 10/13/95
 Unit: Duane Arnold Energy Center
 COMPLETED BY: Richard Woodward
 TELEPHONE: (319) 851-7318

UNIT SHUTDOWNS AND POWER REDUCTIONS

REPORT MONTH: September 1995

(No shutdowns or power reductions greater than 20%)

No.	Date	Type (1)	Duration (Hours)	Reason (2)	Method of Shutting Down Reactor (3)	Licensee Event Report #	System Code (4)	Comp. Code (5)	Cause

1 - F: Forced
 S: Scheduled

2 - Reason
 A-Equipment Failure (Explain)
 B-Maintenance or Test
 C-Refueling
 D-Regulatory Restriction
 E-Operator Training & License Examination
 F-Administrative
 G-Operational Error (Explain)
 H-Other (Explain)

3 - Method:
 1-Manual
 2-Manual Scram
 3-Automatic Scram
 4-Continued
 5-Reduced Load
 9-Other (Explain)

4 - Exhibit G- Instructions for
 Preparation of Data Entry
 Sheets for Licensee Event
 Report (LER) File (NUREG-
 0161)
 5 - Exhibit 1 (Same Source)

DOCKET NO.: 50-0331
 DATE: 10/13/95
 Unit: Duane Arnold Energy Center
 COMPLETED BY: Richard Woodward
 TELEPHONE: (319) 851-7318

Monthly Operational Overview for September 1995:

The DAEC operated at full thermal power throughout the month of September except:

- to reduce power 30 MWe for three hours early September 4 (Labor Day) for lack of grid demand,
- to make control rod adjustments and perform turbine control valve testing September 7-8,
- to backseat the Reactor Core Injection Cooling System (RCIC) outboard steam isolation valve (during the September 8 turbine valve testing) to stop a packing leak, and
- to repair steam leaks in the heater bay, also during the turbine valve testing.

Allocation of Production & Losses:	Electrical Output MWe	Capacity Factor % of 565.7 MWe (Design Gross Rating)	Full Power Equivalent Hours
Actual Metered Net Electric Output	526.8	93.1%	670.5
Actual Metered Plant Electric Loads	31.0	5.5%	39.4
Load Following Sept. 4	0.1	0.0%	0.2
Off-Line	0.0	0.0%	0.0
Weather losses, ie., condenser pressure > 2.75 In Hg / Circ Water Temp	3.2	0.7%	4.0
Planned Capacity Losses: Turbine Valve Testing September 8	1.1	0.2%	1.4
Control Rod Drive Exercises: September 7-8	0.3	0.0%	0.4
Unplanned Capacity Loss: Backseat MO2401, Leak Repairs September 8	0.3	0.0%	0.3
Normal Capacity Losses (Avg MWth < 1658)	0.6	0.1%	0.6
Metering Losses (Avg indic MWe - Avg MWHe)	1.8	0.3%	2.3
Efficiency Losses (Weather-Norm-Full-Power-MWe < 565.7)	0.7	0.1%	0.9
Design Gross Electric Output	565.7	100.0%	720.0

On September 20, following maintenance on the High Pressure Coolant Injection (HPCI) system, a spurious momentary Primary Containment Isolation System (PCIS) and HPCI isolation signal was received when a PCIS/HPCI isolation valve was being opened to re-pressurize the HPCI steamline. The PCIS/HPCI isolation valve did not close as expected. The isolation signal was likely caused by steam and water's effect on isolation sensors when the valve was opened. The isolation valve failed to close due to small differences in limit switches that control the auto-isolation feature of the valve. After the isolation signal was reset, the valve was closed manually. HPCI was properly removed from service throughout these events and there was no effect on safe operation. LER #95-10 (pending).

Licensing Action Summary:

Plant Availability: 100.0% Unplanned Auto Scrams (while/critical) this month: 0
 Number of reportable events: 1 Unplanned Auto Scrams (while/critical) last 12 months: 1