

Detroit Edison
Fermi 2 Nuclear Power Plant

Turbine Incident Recovery
Radiological Performance Report
12/26/94 - 4/13/94

Radiological Performance Summary

Total Dose for Period	22.364 Rem
Total Personnel Contaminations for Period	18
Dose Related to Turbine Recovery	14.717
Turbine Related Personnel Contaminations	7

Although majority of Turbine Recovery work has been completed,
Turbine Recovery totals may increase due to work after 4/13/94.

Prepared by: Daniel T. Craine

Reviewed by: George E. MacAdam

Approved by: Ed F. Kokosky

	Table of Contents	Page
I.	Executive Summary	2
A.	Description of Event	2
B.	Plant Impacts	3
	1. Chemistry Impacts	
	2. Plant Systems Impacts	
C.	Radiological Summary	5
	1. Contamination Control	
	2. Exposure Summary	
D.	Summary of Lessons Learned	6
II.	Radiological Controls	6
A.	Design/Temporary Modification	8
	1. Temporary Demineralizers	
	- RWCU Letdown	
	- RWCU Side Stream	
	- CST Trailer	
	- CRT-CRD-RPV-CRT	
	2. Alternate Discharge Path	
B.	Engineered Controls	13
	1. Temporary Shielding	
	- Designs/Temporary Modifications	
	- Temporary Demineralizers	
	2. HEPA Ventilation	
C.	Contamination Controls	14
	1. Radwaste Basement Pumpdown/Cleanup	
	2. Installation/Removal of Designs	
	3. Turbine Building Basement Pumpdown/Cleanup	
III.	Personnel Exposure Summary	17
A.	Designs/Temporary Modifications	17
B.	Radwaste Basement Recovery/Cleanup	17
C.	Turbine Building Basement Recovery/Cleanup	18
D.	Exposure Breakdown by RWP/Department/Building	18
IV.	Personnel Contamination Summary	24
V.	Radwaste Summary	29
VI.	Lessons Learned	30
A.	Good Practices	
B.	Lessons Learned	
C.	Summary of Radiological Incidents	
VII	Attachment A: Floor Maps for Water Flow Direction and Contaminated Areas	

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

I. Executive Summary

A. Description of Event

On December 25, 1993 at 1315 Fermi 2 experienced a turbine trip, followed by a reactor scram due to a catastrophic mechanical failure of the turbine and generator. As a result of the turbine failure, large volumes of General Service Water (GSW) (i.e. lake water) and Turbine Building Closed Cooling Water (TBCCW) were released into plant systems and buildings. Additionally, turbine lubricating oils were also released into the Turbine Building when the failure of the turbine severed the oil supply lines. The mixing of these oils and water with the normal radioactive material content of radwaste systems and the turbine building sumps resulted in a large volume of slightly contaminated oily water. Through normal system functions some of this water was automatically pumped over to the Radwaste Building from the turbine building sumps, but most of the water that flooded the radwaste basement came from floor drains in the turbine building basement that drain to sumps in the radwaste basement. Eventually the water reached equilibrium between the two buildings (turbine basement elevation is 564' while the radwaste basement elevation is 557' 6"). The end result of this flooding was normal radwaste system functions were no longer available. With the normal liquid radwaste systems unavailable, temporary systems were installed to process water for reuse and prior to discharge to ensure doses to the public were maintained As Low As Reasonably Achievable (ALARA). The following is a list of the Temporary Modifications (TM) and Safety Evaluations (SE) approved and installed for the processing of water for reuse or release as liquid radwaste:

- TM 94-0007/SE 94-0004 - Alternate Discharge Path Using the Condensate Storage Tank (CST)
- TM 94-0009/SE 94-0016 - Installation of Temporary Power for Radwaste Instrumentation
- TM 94-0010/SE 94-0016 - Operation of Temporary Demins for Processing Liquid Radwaste
- SE 94-0001 - Radiological Aspects of Processing Equipment Outside in a Diked Area
- SE 94-0002 - Pumping Out the Radwaste Basement to the Condenser Hotwell
- SE 94-0003 - ODCM Changes for Alternate Discharge Method using the CST
- SE 94-0005 - Installation/Operation of CST Processing Equipment
- EDP 26303 - Install Hot Taps to Allow Hookup of TM 94-0010

The failure of the turbine also resulted in numerous condenser tubes being severed, allowing Circulating Cooling Water (lake water) to enter the condenser hotwell. This resulted in poor quality water being supplied to plant systems, thus degrading the quality of water in those systems. Also, when the level in the condenser exceeded the high level setpoint, the water in the hotwell was

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

automatically pumped to the CST. The input of lake water from the hotwell into the CST resulted in water with high conductivity and low radioactivity levels.

Due to the large amount of water from the turbine failure event, not all of it was contained within the Radiologically Restricted Area (RRA). TBCCW and GSW cascaded down from the turbine building second floor to the first floor of the turbine building via normal non-contaminated pathways such as stairways, pipe chases, elevator shafts, and floor penetrations. Once the water reached the first floor turbine some of it flowed into the turbine building basement, while other water flowed out of the building into the Office Service Building and out the turbine building truck bay roll-up door. Radiological surveys of spill areas outside the RRA were analyzed for the presence of radioactive isotopes. The results showed that no radioactive material was released by these pathways. See attachment 1 for direction of water flows and areas contaminated as a result of the turbine failure.

An evaluation was performed to determine if radioactive gaseous effluents were released when the Turbine Building Ventilation tripped and the roof vents opened at the time of the event. All potential release pathways were reviewed and no radioactive material in excess of normal operating effluent limits was released to the environment as a result of the turbine failure incident.

B. Plant Impacts

1. Plant Chemistry

The introduction of poor quality water into make-up water systems resulted in high conductivity water in systems throughout the plant. The primary systems of concern were the Reactor Water Cleanup System (RWCU), Reactor Recirc System including the water in the reactor vessel, Condensate Transfer and Storage System (supplies the Control Rod Drives (CRD)), and the Residual Heat Removal System. The primary concern was the impact of poor water chemistry on system components, reactor vessel internals, fuel assemblies, and purification media. To provide water cleanup capabilities, several temporary processing systems were installed on plant systems. These required several temporary modifications and safety evaluations to ensure that each modification would meet the design basis for the systems. They were to provide adequate water cleanup capability and to ensure that the designs incorporated ALARA principles for minimizing the dose required for installation, operation, and removal of the modifications, as well as maintaining dose to the public ALARA. The following is a listing of the Temporary Modifications and Safety Evaluations performed to provide water cleanup capabilities.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

- TM 93-0012/SE 93-0080 - Provide Condensate Return Tank (CRT) Water Supply to CRD's
- TM 93-0013/SE 93-0082 - Provide Demineralized Letdown Path from Rx Vessel to CRT
- TM 93-0015/SE 93-0085 - Install Side stream Demineralizers for RWCU/Rx Vessel Cleanup
- TM 94-0002/SE 94-0006 - Provide Reject Path From the Torus to the CRT
- TM 94-0005/SE 94-0012 - Provide Higher Flow Rate Path From CRT to CRD's to Rx to CRT
- EDP 26281 - Install Hot Taps to Allow Hookup of TM 94-0005

2. Plant Systems

Several plant systems were impacted by the turbine failure event. Some were impacted by the poor water chemistry, while others were affected by the flooding of the Radwaste and Turbine Building Basements. Summarized below (excluding turbine repairs) are the major impacts to plant systems as result of the turbine event.

Radwaste Processing Systems - Unavailable due to flooding

Liquid Discharge Path - Unavailable due to flooding, no normal alternate path

Condensate Storage and Transfer Systems - High conductivity, poor quality water

RWCU System - High conductivity, higher than normal radioactivity, no cleanup capability

CRD System - Unavailable due to poor quality water source to CRD's

Recirc System - High conductivity, poor water quality

RHR System - Degraded water quality, high Torus level

Condensate System - High conductivity, poor water quality, no cleanup capability

How each system was recovered or an alternate temporary system installed is discussed within the body of this report. It should be noted that the excellent overall coordinated team effort by all organizations resulted in restoring most of these systems to normal operation in a relatively short period of time.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

C. Radiological Summary

1. Contamination Control

The overall effort to control the spread of contamination from the turbine failure event was excellent. Contributing to this was the overall cleanliness of the plant prior to the event, as well as the low Source Term of the plant. The initial cleanup response by Radwaste personnel was excellent. Many areas of the turbine building were restored within a few days of the event, with the exception of the turbine deck which was isolated for investigation into the failure and the turbine basement which was flooded. Additionally, plugs were installed (via temporary modification) in selected drains in the turbine basement to prevent the back flow of water from the Radwaste basement. The radwaste basement was flooded when contaminated tanks and sumps overflowed from water that was drained (by design) from the turbine building basement via floor drains. Access to the radwaste basement was restricted until plans were developed, procedures written, equipment and vendor services contracted, and SE's approved for disposition of the water and oil as well as recovery of the radwaste basement. The radwaste basement was decontaminated using a pressure washer utilizing hot water and soap. The radiological controls used for deconning were very effective. Respiratory requirements were relaxed after airborne concentrations remained < 0.3 DAC during the decontamination of the radwaste basement. The basement remains posted as a contaminated area to facilitate the extensive repairs being performed to return systems to service.

The Turbine Building basement was flooded when contaminated sumps overflowed from water that was coming from the turbine failure. The turbine basement was decontaminated using the same method as used for decontaminating the radwaste basement. Radiological Control methods learned from the radwaste basement clean up were effective for the turbine basement cleanup effort as well.

During the time period of this report (12/26/93 - 04/13/94) there were 18 personnel contaminations. None of the personnel contaminations occurred on the day of the event and only 7 are directly related to the recovery effort. Only 1 of the personnel contaminations involved a part of the body, the others were clothing contaminations. The personnel contaminations range from 150 cpm to 10,000 cpm, with half of them < 1000 cpm.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

2. Exposure Summary

Total combined personnel exposure (TLD plus DRD) for the time period for the turbine failure event was 22.364 Rem. This number represents the sum of TLD and DRD dose for the period from 12/26/93 to 04/13/94. Total DRD exposure for all tasks during the turbine failure time period was 22.760 Rem. Of that, 14.717 Rem was related to the turbine failure recovery and 8.043 Rem for all other work. A complete exposure breakdown by RWP/task for turbine failure related exposure and exposures not turbine related can be found in later sections of this report.

The overall effort to minimize personnel exposures by all organizations involved in the recovery of the plant and systems was excellent. Many individuals and work groups, together with RP, worked as a team to incorporate ALARA principles into designs, work plans, and work schedules to ensure that personnel exposures were kept ALARA. As a result of this teamwork, exposure minimization techniques and actions were identified upfront so that equipment, materials, and manpower needs were in place and ready when needed.

D. Summary of Lessons Learned

The turbine failure and subsequent recovery effort provided many challenges to the Fermi 2 organization. Overall, the site organizations responded very well to these challenges. Many of the tasks that were performed by individuals and departments, required close coordination and teamwork to complete. As a result of this coordinated effort several good practices and lessons learned were developed and implemented. The following is a brief summary of the lessons learned from the turbine failure event that enabled Fermi 2 to successfully meet the challenges encountered during the turbine recovery effort. A complete list of good practices and lessons learned can be found at the end of this report.

- The formation of teams for the root cause investigation for the turbine failure, water recovery effort, and system/equipment restoration proved to be the corner stone for successfully meeting many of the challenges faced by the site as a result of the turbine failure. This has proven to be an effective means to respond to unusual circumstances and should be continued in the future.
- The low radioactive Source Term within plant systems which is a direct result of high quality reactor coolant chemistry, replacement of control rod blades and condenser tubes, and the cobalt reduction plan minimized the radiological consequences of the event.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

- The overall cleanliness of the plant prior to the turbine failure contributed significantly to being able to recover many areas of the plant in a short period of time. Additionally, the initial response by Radwaste personnel to the cleanup effort helped minimize the radiological impacts on the recovery effort for many organizations. Maintain this level of cleanliness in the future to reduce the radiological impact that events like the turbine failure can cause.
- The use of consultants with regulatory backgrounds to assist in developing plans for processing water and developing plans for establishing a discharge path worked well. This enabled the water recovery team to develop and implement plans to process and discharge the excess water from the turbine failure event, while keeping the dose to the public ALARA.
- The practice of identifying and evaluating temporary shielding requirements as part of the design package for installation and operation of design. This allowed Plant Engineering to allocate resources for such evaluations at the time the design was being developed instead of after the design was issued when engineering time may not have been available.
- The use of consultants/vendors with expertise in non-nuclear applications helped Fermi 2 meet some of the challenges encountered. Vendors such as Marine Pollution Control which was contracted to assist in the oil recovery effort, proved to a valuable resource even though they had no experience in a nuclear environment.

TURBINE INCIDENT RADILOCICAL PERFORMANCE REPORT

II. Radiological Controls

A. Design/Temporary Modifications

As a result of the turbine failure event many design/temporary modifications were installed to temporarily restore certain system capabilities. These modifications were reviewed for ALARA principles as well as additional radiological controls that may be required for installation, operation, and demobilization/removal. Described below is the purpose for each modification along with a summary of the radiological controls associated with each temporary modification. These controls include those which were incorporated into the design/temporary modifications as well as the controls used for installation, operation, and removal.

1. Temporary Demineralizers

- **TM 93-0012** - Provided CRT water supply to CRD's and reactor through the CRD cooling/charging line. This allowed flushing of CRD's as well as feed and bleed of the reactor coolant (along with TM 93-0013) using the CRT as a clean water source. This modification was removed after TM 94-0^05 was placed in service.

Radiological Controls

No radiological controls required for the temporary modification or field implementation.

- **TM 93-0013** - This temporary modification provided a demineralized letdown path from the RWCU system to the CRT. This was needed for two reasons. The first was to provide a letdown path from the RWCU letdown line to the CRT. The CRD's were being supplied with water from the CRT for flushing purposes, which meant that a letdown path was needed to control vessel level. The second purpose was to demineralize the water before returning it to the CRT because it was the only clean source of water available. This temporary modification was removed when TM 94-0005 was placed in service.

Radiological Controls

1. Hoses routed through low traffic area
2. Demins placed in E. Drains Cooler Room labyrinth to use shielding from walls
3. Lag demin placed in front of lead demin for shielding
4. Door way shielded with 2" thick solid lead shields
5. RP Survey checklist developed

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

6. Plan established for remote monitoring of lead demin dose rate
 7. Forklift was shielded for movement to OSSF
 8. Flush connection installed as part of temp. mod.
 9. Camera installed in Drains Cooler Room to monitor for leakage
 10. Modification leak tested prior to placing in service
 11. Dry run was performed prior to moving demin to OSSF
 12. AMS-3 placed in area to monitor airborne radioactivity level
- TM 93-0015 - Provided a means to cleanup reactor coolant with normal RWCU system flow paths. Due to the poor reactor coolant chemistry (peak conductivity 182 $\mu\text{S}/\text{cm}$, 12.3 ppm chlorides, 16.4 ppm sodium) the normal filter demins would exhaust in approximately 30 minutes. This coupled with only enough space for 14 backwashes left in the RWCU Phase Separators and all liquid radwaste processing lost due to flooding of the Radwaste Basement, a side stream demin system was designed and installed. The side stream demin system was designed so that resin changeouts, storage of used resin, re-use of demin flush water, and recharging of the demins could all be performed independent of the normal radwaste systems.

This system was installed on the refuel floor and was connected to the RWCU system via hard piping installed on chemical cleaning connections in the RWCU valve room on RB-4.

Radiological Controls

1. Hoses routed through low traffic area
2. Demins placed on refuel floor by equipment hatch to easier control access
3. Lag demin placed in front of lead demin for shielding
4. Shielded with 2" thick solid lead shields on all four sides
5. RP Survey checklist developed
6. Plan established for remote monitoring of lead demin dose rate
7. Majority of modification was hard piped from RWCU system to the temp. demins
8. Flush connection installed as part of temp. mod.
9. Camera installed on refuel floor to monitor for leakage at the demin connections
10. Modification leak tested prior to placing in service
11. Sluicing liner placed in shipping cask for shielding
12. Sluicing liner placed between shielded demins and operator for additional shielding
13. Area access restricted while in operation
14. Temporary modification removed from service when crud bursts were expected

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

- 15. Normal RWCU filter demins placed in service to filter crud from crud bursts
 - 16. Shielded piping with temporary shielding to lower general area dose rates
 - 17. AMS-3 placed in area to monitor airborne radioactivity level
 - 18 HEPA ventilation and containment used for removal of temporary modification piping
- **TM 94-0002** - Provided a reject path from the Torus to the CRT to lower water level in the Torus. Additionally, it provided dilution water to improve water quality in the CRT.

Radiological Controls

No radiological controls required for temporary modification or field implementation.

- **TM 94-0005/EDP 26281** - Provided higher flow rate path from CRT to CRDs to Rx to CRT to allow for flushing the CRD's. This modification allowed for stroking of all the CRDs with normal system flow rates and pressures. The CRDs were stroked several times each to ensure that each one worked properly and was flushed with normal system flows and pressures. The EDP associated with the temporary modification allowed for installation of permanent system taps for hooking up the temporary modification to the systems. The flow path for return to the CRT is the same as that for TM 93-0013 with the exception that the demins were put in parallel to allow for the increased flow. This modification allowed for feed and bleed of the reactor coolant for water cleanup as well as demineralizing the water returned to the CRT to also improve water quality of the CRT.

Radiological Controls

1. Hoses routed through low traffic area
2. Demins placed outside E. Drains Cooler Room for ease of movement for changeout
3. Demins double shielded with 2" thick solid lead shields on three sides
4. RP Survey checklist developed
5. Plan established for remote monitoring of demin dose rate
6. Forklift was shielded for movement to OSSF
7. Flush connection installed as part of temp. mod.
8. Shielding installed for installation of hot taps for EDP 26281
9. Modification leak tested prior to placing in service
10. Dry run was performed prior to moving demin to OSSF
11. AMS-3 placed in area to monitor airborne radioactivity level
12. Administrative maximum dose rate established for demins

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

- **SE 94-0005** - Provided for Installation/Operation of CST Processing Equipment using equipment and procedures supplied by Chem Nuclear Systems Inc. (CNSI). This SE was performed on the procedures for processing the CST prior to discharge to the lake. Water that was pumped from the Radwaste Basement to the condenser hotwell was transferred through the Condensate Filter Demins to the CST for processing. The temporary processing system consisted of; a pump installed into the CST through the manway on the top of the tank, a processing trailer containing four demineralizers in parallel for filtration, a steel liner for sluicing of resin from the demineralizers, filters downstream from the demineralizers to prevent resin from entering the tank and to provide mechanical filtration of the water, connection to the temporary discharge path (TM 94-0007) and a temporary dike installed around the trailer. Additional safety evaluations were performed to determine the safety impact of processing outside (SE 94-0001), impact to the ODCM controls and limitations (SE 94-0003), and for the CNSI procedures. All radiological controls were placed in the CNSI procedure prior to approval of the RWP for operating the equipment. This temporary system is still installed, but not operating.

Radiological Controls

1. Hoses double banded to prevent leakage
2. Outside storm drains in the area plugged
3. Dike installed around processing equipment trailer, RRA established around diked area
4. RP Survey checklist developed including areas occupied by members of the public
5. Plan established for remote monitoring of demin dose rate
6. PVC piping to contain hoses between the CST dike and the processing trailer dike
7. Flush connection installed as part of temp. mod.
8. Shielding installed on demins and outside the trailer to lower dose rates at RRA boundary
9. Modification leak tested prior to placing in service
10. One piece hoses for going from the CST dike to inside the CST
11. AMS-3 placed in area to monitor airborne radioactivity level
12. Administrative maximum dose rate established for demins
13. HEPA filter installed on liner to filter air displaced by resin/water during filling operations

- **TM 94-0009/TM 94-0010/EDP 26303** - Provided temporary power for Radwaste Instrumentation and operation of temporary processing equipment for cleanup/reuse and storage/discharge of liquid radwaste using the Waste Sample Tanks and the Waste Surge Tank. The EDP 26303 installed permanent system tie-ins at the tanks and the normal discharge line, so that the temporary processing system could be installed. The system was designed to process the

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

tanks and then tap into the normal plant discharge line upstream of the normal Discharge Radiation Monitor, so the water could either be transferred to the CRT for reuse or discharged to the lake. This system is still installed and in use.

Radiological Controls

1. Hoses double banded to prevent leakage
2. RP Survey checklist developed
3. Plan established for remote monitoring of demin dose rate
4. Flush connection installed as part of temp. mod.
5. Shielding installed on demins
6. Modification leak tested prior to placing in service
7. Administrative maximum dose rate established for demins

2. Temporary Discharge Pathway

- **TM 94-0007** - Provided an alternate discharge pathway for releasing the excess water generated by the turbine failure. This modification was designed to allow for the discharge of liquid radwaste using the CST as a water source. The system tied into the CST processing system, then was hard piped to the discharge line from the Neutralization Tank. This pathway was chosen because it taps in into the Circulating Water Decant Line upstream of the normal liquid radwaste discharge tie-in. This allowed for the use of the normal decant flow for dilution and radiation monitoring using the Decant Line Radiation Monitor. The temporary system consisted of carbon steel piping, dual mechanical filters upstream of a temporary radiation monitor, and a flow meter to determine discharge flow rate. This system is still installed.

Radiological Controls

1. Carbon steel piping to prevent leakage
2. RP Survey checklist developed
3. Continuous monitoring for discharge so the system could be isolated if problems occurred
4. Flush connection installed as part of temp. mod.
5. Additional mechanical filters to further filter the water prior to discharge
6. Modification leak tested prior to placing in service
7. Calibrated temporary radiation monitor for additional monitoring capability
8. Drains in the Auxiliary Boiler House were plugged or sand bagged in area of temp. mod.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

B. Engineered Controls

1. Temporary Shielding

- Shielded vertical run of the side stream hard piping on RB-4 and couplings on RB-4 and RB-5 prior to placing the system in service. Placed additional shielding on all piping after the system was in operation to lower general area dose rates. Contact dose rates were reduced from an average of 35 mRem/hr to 8 mRem/hr, with general area dose rates of 2-5 mRem/hr at 30 cm.
- Shielded RWCU side stream demineralizers on RB-5 with (4) CNSI shield walls. The demineralizer configuration was two trains of demins consisting of (2) demins hooked up in series. Highest contact exposure rate was 23 Rem/hr on the demineralizer, 260 mRem/hr contact dose rate on the shield wall with 120 mRem/hr at 30 cm. The dose rate at the operators station was <0.2 mRem/hr.
- Shielded hotspot on CST demineralizers located in tractor trailer. The configuration consisted of (4) demineralizers hooked up in parallel. The highest contact dose rate on the demineralizers was 190 mRem/hr and 90 mRem/hr @ 30 cm prior to shielding. After shadow shielding was installed contact dose rates on the shielding were 5 mRem/hr and 0.3 mRem/hr at the RRA Boundary.
- Shielded RWCU letdown demineralizers on TB-1 for TM 93-0013 with (2) CNSI shield walls in front of the doorway of the East Drains Cooler Room. The demineralizer configuration was one train of demineralizers consisting of (2) demins hooked up in series, place in the labyrinth of the East Drains Cooler Room. The lag demineralizer was placed in front of the lead demineralizer for additional shielding. Highest contact dose rate was 10 Rem/hr on the lead demineralizer, 2 mRem/hr contact dose rate on the shield wall and 0.2 mRem/hr at 30 cm. The dose rate at the radiation area boundary was <0.2 mRem/hr.
- Shielded RWCU letdown demineralizers on TB-1 for TM 94-0005 with (6) CNSI shield walls. The demineralizer configuration was two demineralizers hooked up in parallel. The shield walls were placed around the demineralizers just outside the East Drains Cooler Room on TB-1. Highest contact exposure rate was 690 mRem/hr on the demineralizer with 1.5 mRem/hr contact dose rate on the shield wall. The dose rate at the radiation area boundary was 0.6 mRem/hr.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

- Shadow shielded RWCU letdown line in the TB-B for installation of hot taps for EDP 26281 with lead blankets. Highest contact dose rate was 280 mRem/hr on the piping prior to shielding and 16-45 mRem/hr general area on the work platform. After shadow shielding was installed general area dose rates on the work platform were reduced to 6-18 mRem/hr.
- Shielded temporary Radwaste Processing demineralizers in the RW-B for TM 94-0010 with (1) CNSI round demineralizer shield made of 1" thick carbon steel for the lead demineralizer and lead blankets for the lag demineralizer. The demineralizer configuration is one train of demineralizers consisting of (2) demins hooked up in series. Highest contact exposure rate when shutdown on 4/8/94 was 1.5 mRem/hr on the demineralizer, 1 mRem/hr contact dose rate on the shield and 0.2 mRem/hr at 30 cm. These demineralizers are still in operation.

2. Temporary HEPA Ventilation

- HEPA ventilation was used during removal of piping installed for the RWCU side stream demineralizers. The piping was removed using a bandsaw to cut the pipe. A containment device was positioned at the location of the cut for horizontal piping with HEPA ventilation hooked up to the containment, no airborne radioactivity >0.3 DAC's was measured. For the vertical sections of piping a catch was installed below the area to be cut with HEPA ventilation directed at the work area, no airborne radioactivity >0.3 DAC's was measured. The combination of ventilation and containment's was very successful in preventing the spread of contamination and airborne radioactivity.

C. Contamination Controls

1. Radwaste Basement Pumpdown/Cleanup

As a result of the turbine failure on December 25, 1993, the radwaste basement was flooded up to a level of 6 foot. Contaminated tanks and sumps overflowed with water that was (by design) drained from the turbine building basement floor drains. The radioactivity levels ranged from 3.0E-04 $\mu\text{Ci}/\text{ml}$ to 8.0E-04 $\mu\text{Ci}/\text{ml}$ for various samples. The nuclides present were Cr-51, Mn-54, Co-58, Co-60, Zn-65, I-131, Cs-134 and Cs-137. An AR-20 probe submerged in the radwaste basement water indicated an exposure rate of 5 mRem/hr. The liquid transfer process from the radwaste basement to the condenser hotwell was governed by controls in Safety Evaluation 94-0002 and associated procedures. The post drain down initial entry radiological surveys for the general access hallways

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

on the walls and floors. There were also several small piles of sludge reading 10-15 mRem/hr.

The Radwaste basement was decontaminated with a 500 - 2000 psi-pressure washer with 180°F water. Radiological Controls have been effective. The respiratory requirements have been relaxed based on airborne concentrations < 0.3 DAC. Deconners are now wearing face shields vs. respirators. The gross decon of the general access hallway floors and walls in the radwaste basement has been successful in reducing contamination levels from 4 - 24 mRad/hr beta to 4000 dpm/100cm².

The initial phase of the Radwaste basement recovery began on February 02, 1994. I&C technicians entered the basement to open electrical equipment boxes on instrument racks. The objective was to drain water out of them and to do an initial damage assessment. RP and deconners continue to work very closely with maintenance to successfully integrate the decon effort with the recovery objectives.

2. Installation/Removal of Designs

The installation of all the temporary modifications and designs went very well from a contamination control stand point. All the system tie-in points were either "hot tapped" or existing tie-in points utilized with no spread of contamination. Each modification was leak tested with demineralized water prior to placing it into service. This ensured that if leakage occurred during the leak test it would not be contaminated and that little or no leakage would occur during operation of the modifications.

There were however several instances of spills while performing different evolution's involving the RWCU letdown demineralizers and the CST processing system. Critiques were performed for each incident and in some cases DERs were written to investigate the causes. A summary of these incidents can be found in the lessons learned section of this report.

- Several of the temporary modifications that were installed to support the turbine recovery effort are still in place with some still in operation (in one form or another). The one modification that has been removed is the RWCU side stream temporary modification (TM 93-0015). The demobilization of that temporary modification went very well with no spread of contamination to unposted areas. The controls utilized for removal were HEPA ventilation for removal of piping and temporary shielding. The piping was removed using a bandsaw to cut the pipe. A containment device was positioned at the location of the cut for horizontal piping with HEPA ventilation hooked up to the containment. No airborne radioactivity >0.3 DACs was measured. As the

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

location of the cut for horizontal piping with HEPA ventilation hooked up to the containment. No airborne radioactivity >0.3 DACs was measured. As the piping was cut the ends were taped over to prevent the spread of contamination. For the vertical sections of piping a catch was installed below the area to be cut with HEPA ventilation directed at the work area. The combination of ventilation and containment's was very successful in preventing the spread of contamination and airborne radioactivity.

3. Turbine Building Basement Pumpdown/Cleanup

As a result of the turbine failure, the Turbine Building basement was flooded when contaminated sumps overflowed from water that was cascading down from the turbine area. The radioactivity level was 1.05E-3 $\mu\text{Ci}/\text{ml}$ for the water pumped to the condenser hotwell. The nuclides present were Cr-51, Mn-54, Co-58, Co-60, Zn-65, I-131, Cs-134 and Cs-137. The liquid transfer process from the turbine basement to the condenser hotwell was governed by controls in Safety Evaluation 94-0002 and associated procedures. The post drain down initial entry radiological surveys for the basement general access hallways indicated <0.2 -0.8 mRem/hr general area and smear results ranging from <500 - 28,000 dpm/100cm² on the walls and floors. There were also several small piles of sludge reading up to 10 mRad/hr.

The turbine basement was decontaminated with a 500 - 2000 psi-pressure wash with 180 F water. Radiological Controls learned from the radwaste basement clean up were effective for the turbine basement cleanup effort as well. The respiratory requirements were relaxed when airborne concentrations were < 0.3 DAC. The gross decon of the general access hallway floors and walls in the turbine basement has been successful in reducing contamination level from 28,000 dpm/100cm² to <500 dpm/100cm² in most areas.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

III. Personnel Exposure Summary

A. Designs/Temporary Modifications

The following temporary modifications and safety evaluations were performed to support the overall turbine failure recovery effort. This included the Water Recovery Plan, recovery of the radwaste and turbine basement, and flushing of CRD mechanisms. The exposure for installation and operation of these temporary modifications is summarized below. The only modification that has been removed is TM 93-0015. The rest of the modifications are still in place with some still service. The dose received for removal of these modifications will be addressed in the RF04 Post Outage ALARA report.

Temp Mod 93-0012 - Provide CRT water supply to vessel via CRD system

Installation Dose - 0 Rem Operation Dose - 0 Rem

TM 93-0013/TM 94-0005 - Provides letdown path from vessel to CRT Via RWCU letdown line.

Installation Dose - .218 Rem Operation Dose - .272 Rem

TM 93-0015 - RWCU Side Stream Demineralizer system to cleanup reactor coolant

Installation Dose - .040 Rem Operation Dose - .253 Rem
Removal Dose .197 Rem

TM 94-0007 - Provide for alternate discharge path from CST to Circulating Water Decant Line

Installation Dose - 0 Rem Operation Dose - 0 Rem

TM 94-0002 - Provides path to reject torus water to CRT

Installation Dose - .005 Rem Operation Dose - 0 Rem

SE 94-0001/SE 94-0005 - Supports CST Processing System

Installation Dose - 0 Rem Operation Dose - .587 Rem

B. Radwaste Basement Recovery/Cleanup

The following tasks were performed to recover the radwaste basement as a result of the turbine failure. The dose received in the radwaste basement for

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

oil skimming, decontamination, initial entry into rooms, and equipment repairs up to 4/14/94 are summarized below. The exposure for installation of EDP 26303 is also summarized below. The dose for removal of these modifications and completion of equipment repairs will be addressed in the RF04 Post Outage ALARA report.

Task	Expended ManRem
Oil Skimming	0.104 Rem
Decontamination	1.121 Rem
Entry into Rooms	0.028 Rem
Equipment Repair	1.026 Rem
EDP 26303 Hot Taps	0.057 Rem

C. Turbine Building Basement Recovery/Cleanup

The majority of the cleanup operations for the turbine basement were performed on the routine specific RWP for decontamination. The dose received for specific evolution's such as cleaning out and removing the sludge from the sumps as well as repairing equipment are listed below. The remainder of the dose received for recovery of the turbine basement from the turbine failure will be summarized in the RF04 Post Outage ALARA Report.

Sump Cleanup/Desludging	0.070 Rem
Equipment Repair	0.016 Rem

D. Exposure Breakdown By RWP/Department/Building

To better identify the breakdown of dose received during the turbine failure event, tasks were divided into 2 categories; tasks which were directly related to the recovery effort and tasks related to already ongoing work or RF04 preparations. Additionally, to determine the impact of the turbine failure on departmental annual dose estimates, the dose is summarized in graphic form for each department as well as their overall contribution to the site dose. The dose breakdown for each building is also graphically depicted so that the impact to different areas of the plant due to the turbine failure can be better understood.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

Turbine Event Related Exposure Summary

RWP Number	Task/Job Description	Actual ManRem
93-1001	Operation Routine RWP	0.085
93-1002	Chemistry Routine RWP	0.028
93-1003	Radiation Protection Routine RWP	0.098
93-1004	Radwaste Laundry Routine RWP	0.045
93-1005	Radwaste Decontamination Routine RWP	0.090
93-1007	Security Routine RWP	0.004
93-1009	Tours and Inspections Routine RWP	0.078
93-1010	Maintenance Routine RWP	0.008
93-1011	I&C Routine RWP	0.003
93-1023	Operations High Radiation Area Rounds	0.023
93-1262	B31F023A&B, B31F031A&B Repair	1.945
93-1263	Install G33 Hot Tap for TM 93-0013	0.040
94-1001	Operation Routine RWP	1.582
94-1002	Chemistry Routine RWP	0.175
94-1003	Radiation Protection Routine RWP	1.634
94-1004	Radwaste Laundry Routine RWP	0.822
94-1005	Radwaste Decontamination Routine RWP	0.431
94-1006	Radwaste OSSF Routine RWP	0.227
94-1007	Security Routine RWP	0.310
94-1008	Fire Protection Routine RWP	0.155
94-1009	Tours and Inspections Routine RWP	0.615
94-1010	Maintenance Routine RWP	1.219
94-1011	I&C Routine RWP	0.204
94-1014	Radwaste Processing Routine RWP	0.190
94-1015	CRD Drive Water Filter Changeout RWP	0.005
94-1023	Operations High Radiation Area Rounds	0.240
94-1025	Scram Discharge Volume Calibrations	0.107
94-1026	HCU Repairs	0.006
94-1031	Setup and Operate TM 94-0005	0.312
94-1032	Recirc/Treatment/Cleanup of CST	0.569
94-1034	Install TM 93-0015	0.040
94-1036	Perform Oil Skimming in the Radwaste Bsmt.	0.104
94-1038	Operate TM 93-0015	0.253
94-1039	Initial RP Survey of the Drywell	0.082
94-1041	N20 System RWP	0.005
94-1042	N21 System RWP	0.021
94-1045	N61 & N62 System RWP	0.015
94-1048	Remove Insulation in the Turbine Building	0.029
94-1049	Rework/Repair Turbine HP&LP Valves	0.088
94-1050	Main Condenser Initial Entry	0.005
94-1051	Condenser Hotwell Initial Entry	0.008

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

94-1056	MSR Inspection/Repair	0.061
94-1096	Install TM-94-0002	0.005
94-1098	Radwaste Basement Equipment Repair	1.026
94-1099	Initial Entry into Radwaste Basement Rooms	0.028
94-1102	Decontamination of Radwaste Basement	1.121
94-1123	Install EDP 26281 Hot Taps	0.178
94-1176	Install EDP 26303 Hot Taps	0.057
94-1178	Clean Turbine Building HVAC Duct Work	0.001
94-1179	Sandblast Turbine Rotors	0.010
94-1180	P4400F615 Dual Indication	0.074
94-1181	Inspect Condenser	0.025
94-1191	CST/CRT Diving Operations	0.010
94-1200	Changeout MPC Oil Coalescer Filters	0.008
94-1202	Repair Turbine Building Equipment from Flood	0.016
94-1208	Remove TM 93-0015	0.197
Total		14.717

Note: Routine RWP's do not have ManRem estimates.

Non Turbine Event Exposure Summary

RWP Number	Task/Job Description	Actual ManRem
93-1240	Torus Room Lighting EDP	1.066
94-1013	Fermi 1 Routine RWP	0.028
94-1028	New Fuel Receipt (RB-1)	0.020
94-1029	New Fuel Receipt (Refuel Floor)	0.355
94-1037	Install and Remove Drywell Baseline Shielding	2.920
94-1057	RP Refuel Floor RWP	0.042
94-1058	Rx Vessel Disassembly/Reassembly (Floor)	0.139
94-1059	Fuel Sipping	0.137
94-1061	Rx Vessel Disassembly (Cavity)	0.097
94-1063	Decontamination of Refuel Floor Equipment	0.074
94-1067	Torus Diving Operations	0.040
94-1070	Torus Hatch Removal/Reinstallation	0.025
94-1072	Reactor Building MOV PM's	0.020
94-1074	Reactor Building Maintenance Routine RWP	0.321
94-1075	Reactor Building I&C Routine RWP	0.020
94-1078	Reactor Building Scaffolding/Temp. Lighting	0.252

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT


94-1090	RCIC System RWP	0.041
94-1094	Operations Drywell Routine RWP	0.217
94-1095	Radiation Protection Drywell Routine RWP	0.327
94-1097	Drywell/RB-1 Steam Tunnel Pre-job Walkdown	0.043
94-1108	Remove/Reinstall Drywell Downcomer Covers	0.122
94-1112	Open/Close Drywell Equipment Hatches	0.050
94-1114	Drywell Snubber ISI	0.166
94-1118	Drywell MOV PM's	0.002
94-1121	I&C Pre-Undervessel Work	0.134
94-1122	Perform Decontamination in the Drywell	0.013
94-1128	MSIV's Repair/Rework/Nose Cone Mod.	0.141
94-1182	Drywell Insulation Removal/Installation	0.045
94-1184	Drywell Scaffolding/Temp. Power and Lighting	0.587
94-1188	E1100F119 Disassemble/Repair/Reassemble	0.010
94-1195	Perform Radiography in OSSF	0.014
94-1198	Install Torus Tubing Protection Platforms	0.015
94-1201	Condenser Waterbox Pumpdown Mod.	0.033
94-1213	CRD Pre-Flush Tank Work	0.055
94-1221	Drywell Sump Piping Modification	0.377
94-1224	Modify Dryer/Separator Drain Line EDP 13714	0.005
94-1225	Install ADHR Block Valves	0.070
94-1226	Westinghouse Undervessel Walkdowns	0.020
Total		8.043
	Total for All Work Performed During Turbine Recovery	22.760

Note:

The above work was performed during the turbine recovery time period, but is not directly related to turbine recovery work.


TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

Exposure By Department

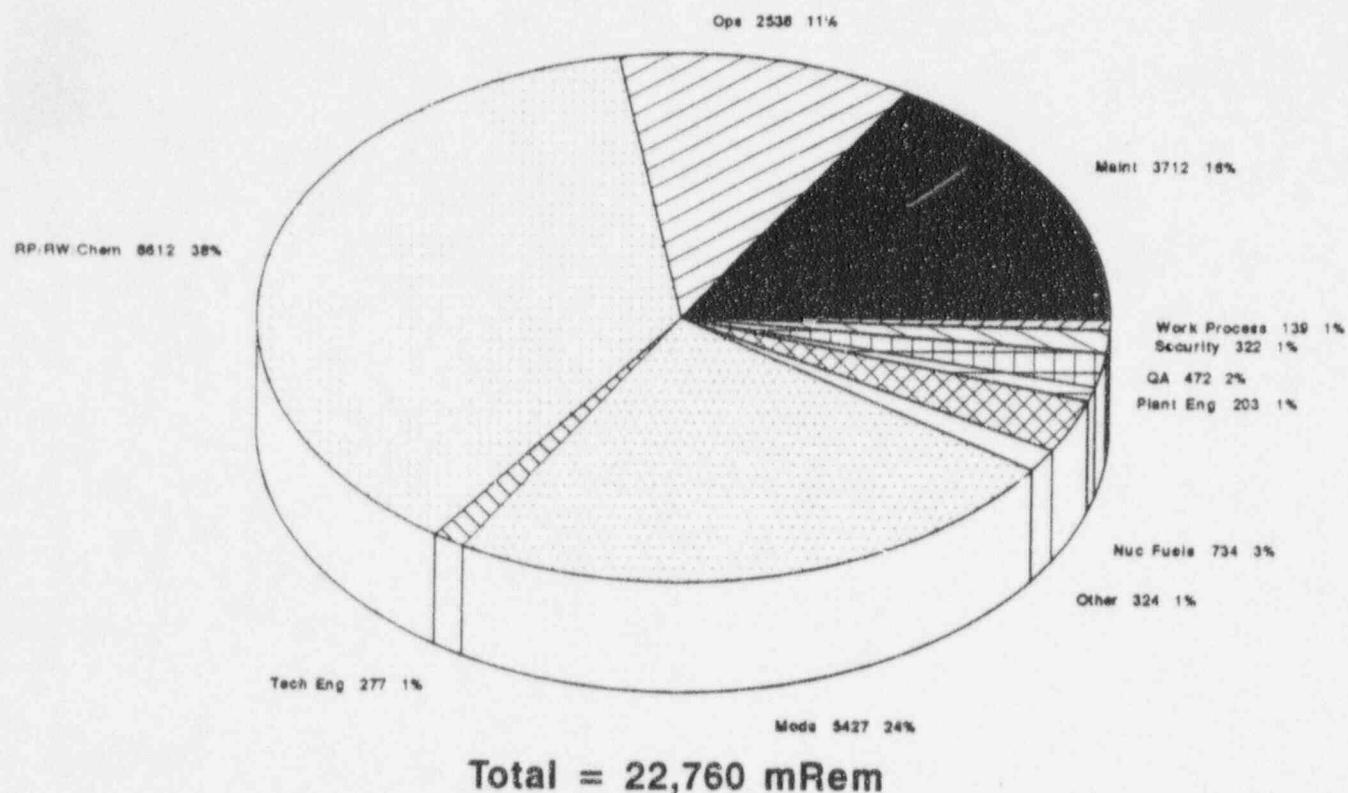

- | | | | |
|---|-----------------------------------|--|------------------------------------|
| <input checked="" type="checkbox"/> Maint | <input type="checkbox"/> Ops | <input type="checkbox"/> RP/RW/Chem | <input type="checkbox"/> Tech Eng |
| <input type="checkbox"/> Mods | <input type="checkbox"/> Other | <input checked="" type="checkbox"/> Nuc Fuels | <input type="checkbox"/> Plant Eng |
| <input type="checkbox"/> QA | <input type="checkbox"/> Security | <input checked="" type="checkbox"/> Work Process | |

Exposure By Building

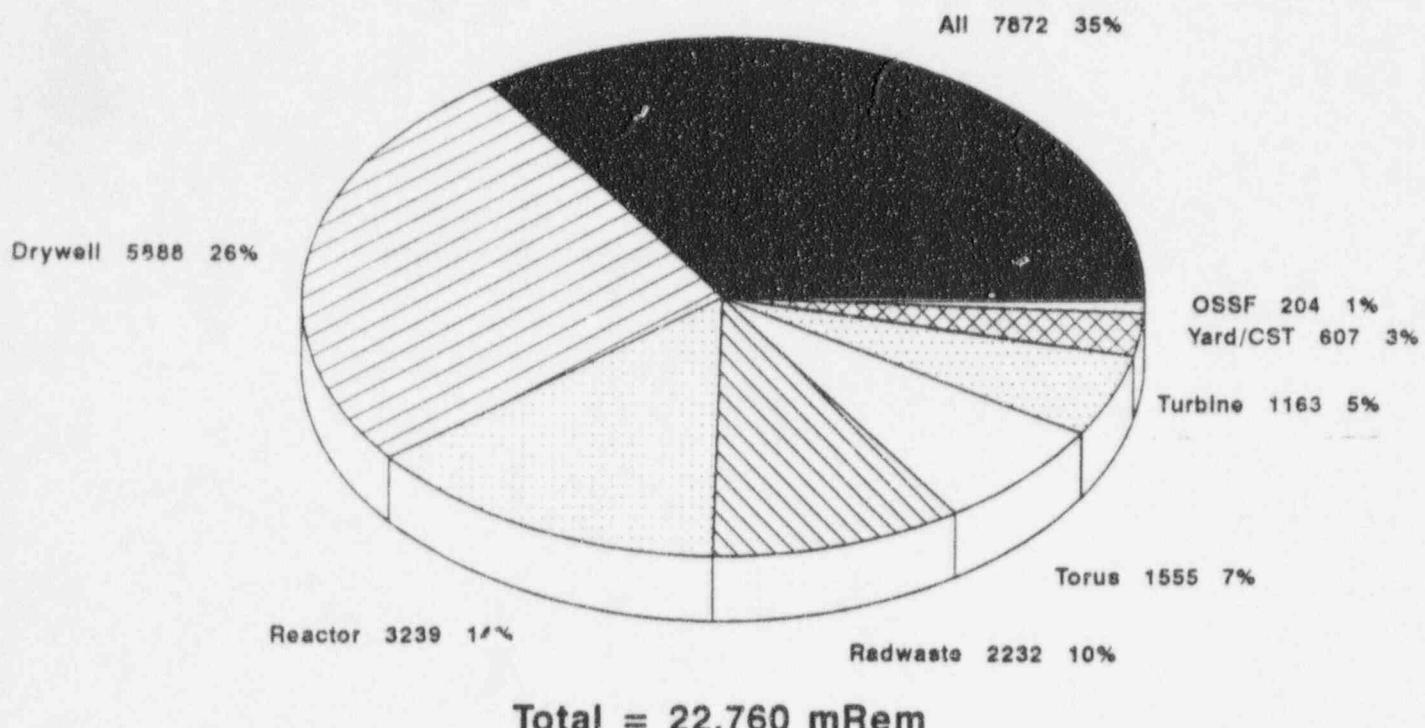

- All Drywell Reactor Radwaste
- Turbine Torus Yard/CST OSSF

TURBINE INCIDENT RADIOPHYSICAL PERFORMANCE REPORT

IV. Personnel Contamination Summary


During the time period for the turbine failure and initial area recovery, there were 18 personnel contaminations. None of the personnel contaminations occurred on the day of the event and only 7 were directly related to the turbine incident recovery. Of the 18 personnel contaminations 17 were from contaminated clothing and shoes. Only 1 personnel contamination involved a part of the body, and that was to the head when a workers hood came off in one of the MSR. The personnel contaminations range from 150 cpm to 10,000 cpm with half less than 1000 cpm. A large percentage (7 out of 18) of the personnel contaminations were from cross contamination of personal clothing while wearing protective clothing (PC's), only 2 of these were directly related to the turbine incident recovery. Only 2 of the personnel contaminations were due to poor worker practices. The following graphical summary of personnel contaminations by location, work group, cause, and building will show that only one factor or trend can be found as the major cause of personnel contaminations. That cause is cross contamination from protective clothing. As a result of this, an investigation was performed to determine the root cause. Several of these percons were apparently caused by contamination transfer from the protective clothing (PCs). As a result, monitoring of the incoming PCs from Interstate Nuclear Services (INS) has been escalated. As well as finding some PCs above the plant acceptance level of 5,000 cpm β/γ per frisker probe area, there were discoveries of alpha contamination and hot particles.

Plants normally initiate increased alpha monitoring programs when field surveys indicate a need. Fermi 2 has not had alpha contamination problems to date and the alpha discovered indicates cross contamination from other sites which contract with INS for laundry services. Palisades is one of the seven sites which sends PCs to the INS facility in Morris, Illinois. It has recently had alpha contamination problems. It is possible that PCs we received were worn at other plants previously or may have picked up contamination from other laundry batches previously washed in the same machines.


Hot particles have also been found on laundered PCs. This presents not only a personnel contamination potential, but a skin dose problem as well. It is also possible for unmonitored skin dose if a particle of sufficient activity were to be against the skin while the PCs were worn but stayed with the PCs when they were removed. Hot particles could also be transferred from other plants as described above.

As a result of the evaluation performed the following steps are being taken. Perform surveys of laundry on some random frequency, including checking for alpha on the PCs and containers. Continue site audits of the vendor and verify that steps to mitigate cross-contamination are implemented.


Personnel Contaminations By Location

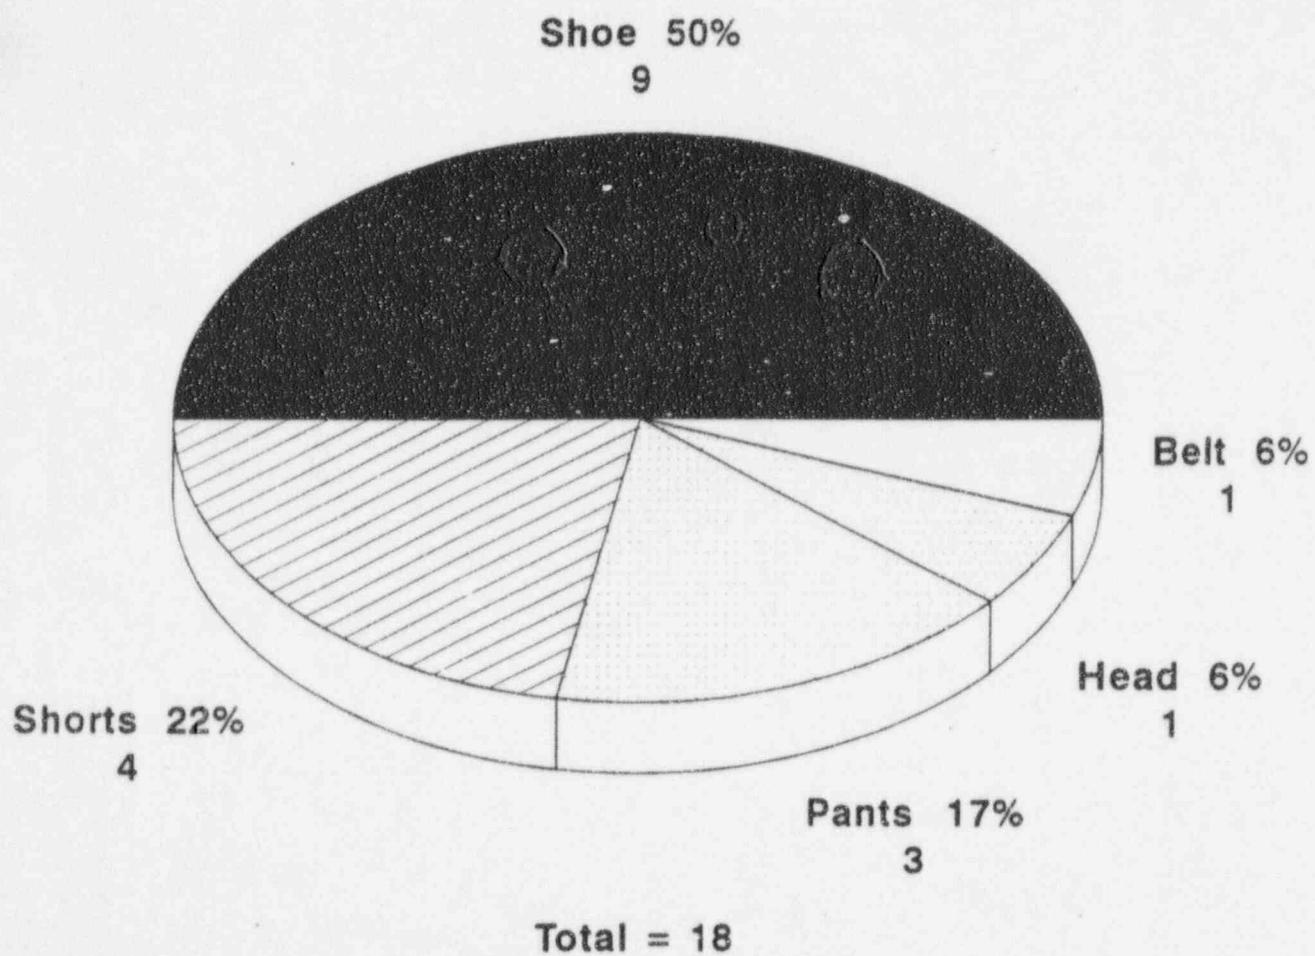


Personnel Contaminations By Workgroup

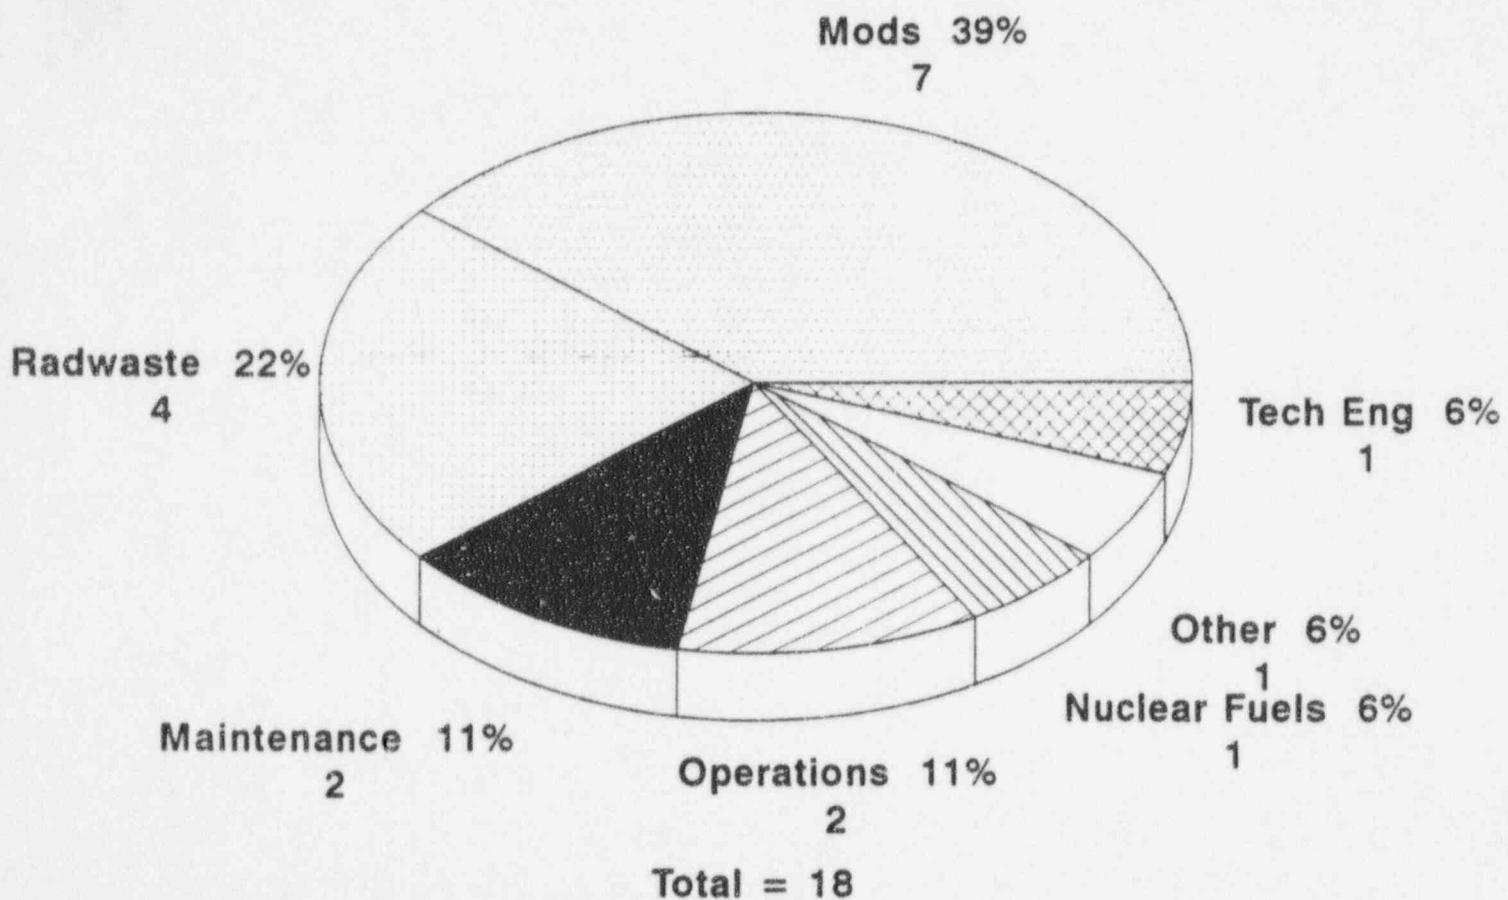

Personnel Contaminations By Cause

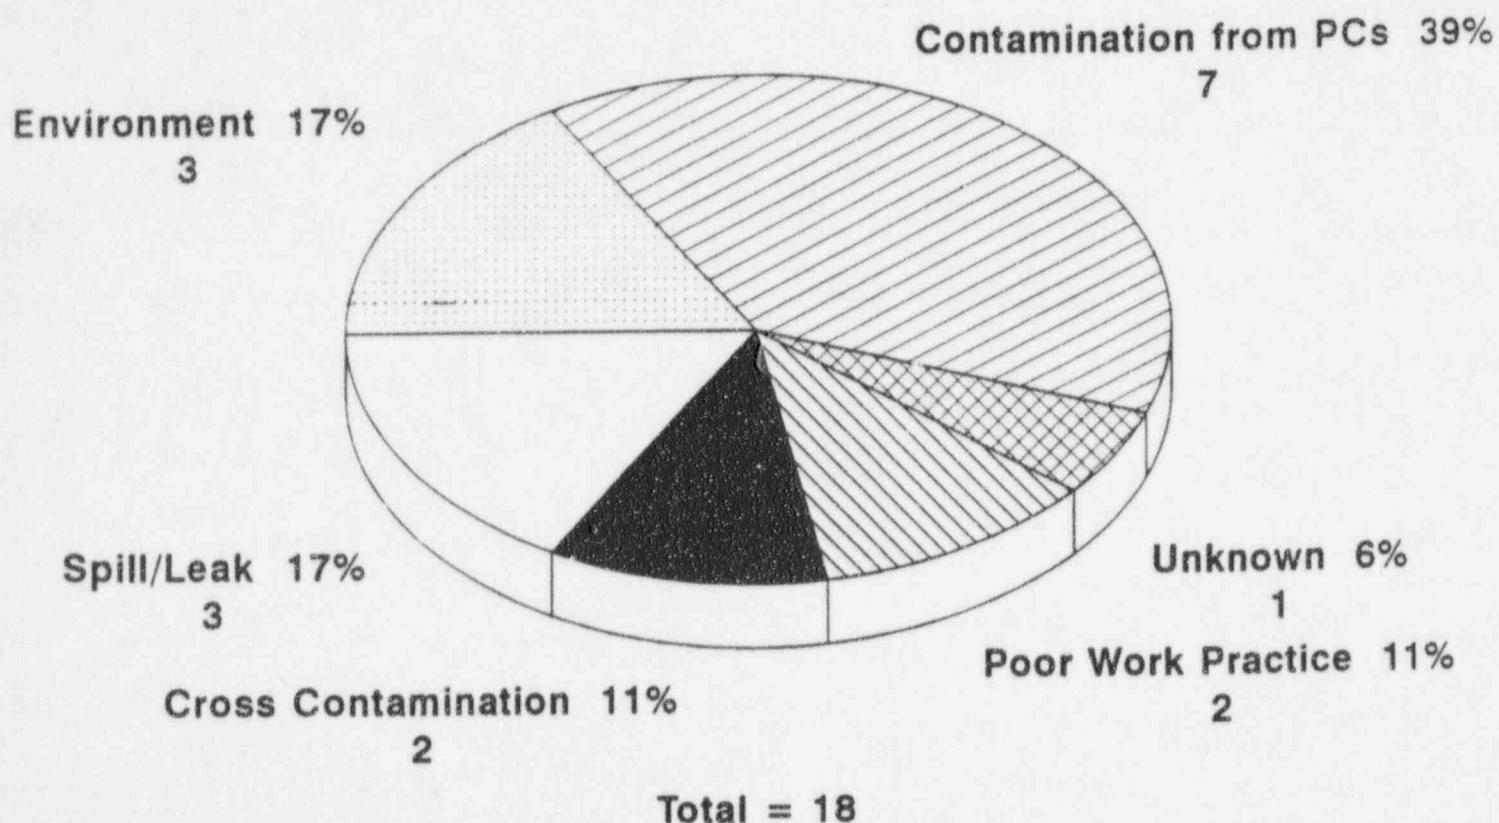

Personnel Contaminations By Building

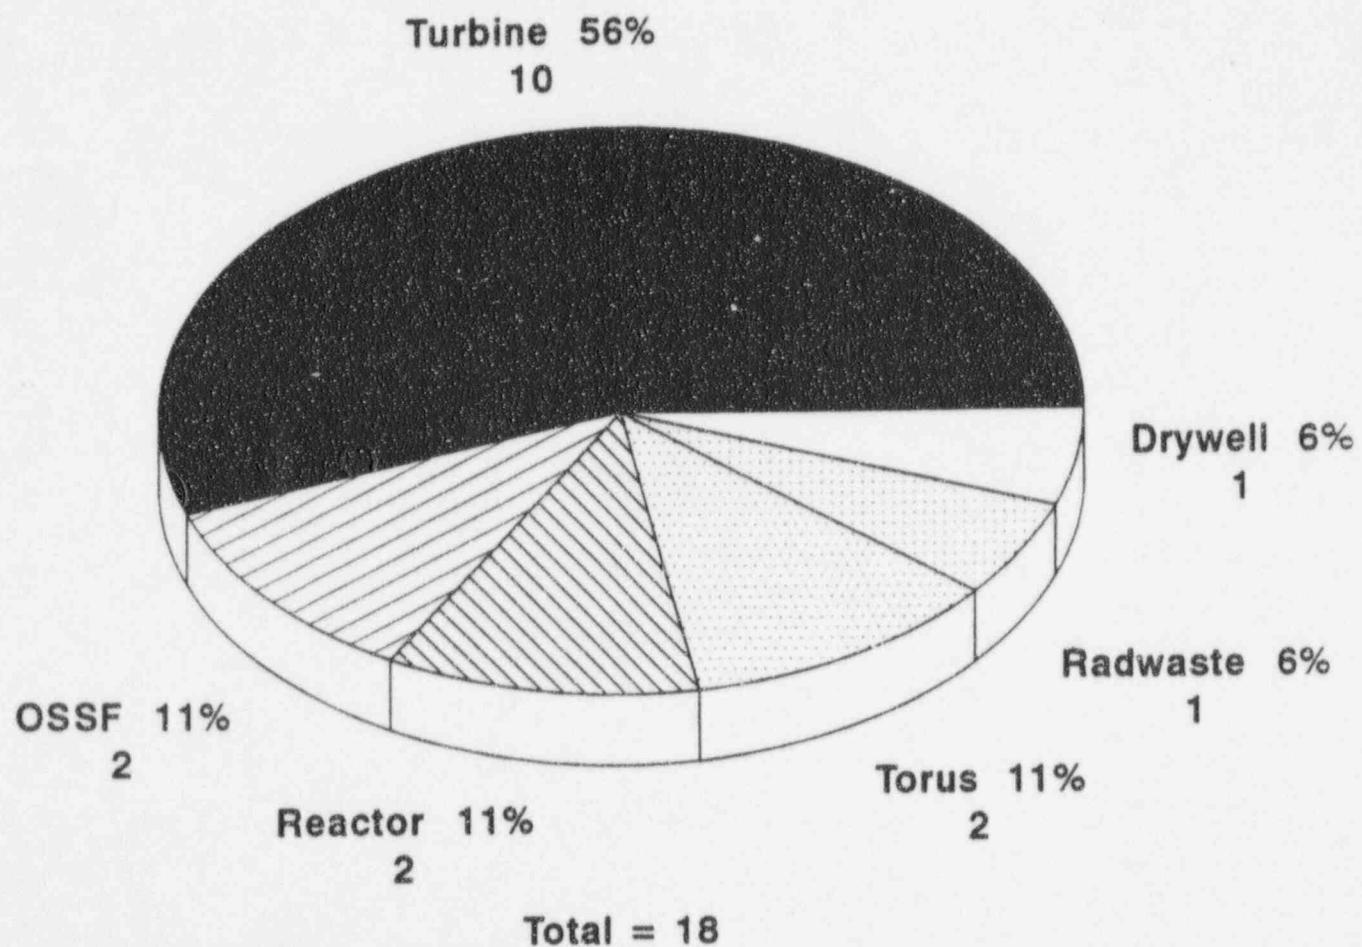

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

V. Radwaste Summary

As a result of the turbine failure and subsequent flooding, large areas of the Turbine and Radwaste building were contaminated that are not normally contaminated areas. Prior to the turbine failure there was 28,959 square feet of the contaminated areas throughout the plant. After the turbine failure there was 102,535 square feet of contaminated area, an increase of 73,576 square feet. The major areas that contributed to the increase are the Turbine Deck, Turbine Building Basement, and the Radwaste Building Basement. Currently there is 61,104 square feet of contaminated areas within the plant (14.8 %), some of which is from work activities related to the current refuel outage.

Another impact from the turbine event is the generation of radioactive waste. The following is a summary of the radwaste generated as a result of the turbine failure.

<u>Type of Waste</u>	<u>Amount</u>
Resin	752 ft cu. ft.
Incinerable Waste	13 LSA Boxes, 1 Alaron Box
Potentially Clean Trash (PCT)	7 LSA Boxes, 1 LSA Box of Metal
Other	3 Alaron Boxes (Compact) 5 Sea Vans (Insulation, PCT, PC's etc.)

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

VI. Lessons Learned

A. Good Practices

- The formation of multi-departmental teams such as the Water Recovery Team to deal with events that are unique or abnormal in nature was successful. This allows for all departments to be informed of plans and manpower needs for such events. Additionally, the resources required to solve difficult problems, perform evaluations, designs, procedure reviews, and emergent problems are available as part of the team. This practice worked very well during the turbine failure event.
- The use of consultants and vendors that have the expertise and equipment to assist in the evaluation, planning, and operation of equipment proved to be invaluable. Additionally, consultants with a regulatory background were used to assist in evaluating sensitive issues such as alternate discharge paths, ODCM evaluations, and supporting safety evaluations. Their experience in these areas proved to be very helpful in formulating plans for developing a alternate discharge path, applicable controls, and methods for monitoring the discharge.
- The practice of performing "dry runs" for difficult high radiation radwaste movements work well. This was especially true for moving temporary demineralizers to the OSSF from TM 93-0013 using a shielded forklift. Total dose for moving these demineralizers was 17 mRem.
- The development of radiation protection checklists for coverage and specific evolution's. Checklists were developed for most temporary modifications that were installed and operated. These checklists let the technician know what was expected of them as well as letting the rest of the organizations know what controls were in place for each modification.
- The practice of incorporating temporary shielding evaluations as part of the temporary modifications and designs should continue. This allows for proper planning for installation and operation of the modification. Additionally, engineering time is identified up front instead of after the design is completed when additional engineering time is required to perform these same evaluations.
- The practice of joint walkdowns by all groups involved in a modification should be continued. This allows for input from all groups into the design so that all impacts are identified prior to completion of the design.

TURBINE INCIDENT RADIOLOGICAL PERFORMANCE REPORT

- The method used to decontaminate the turbine and radwaste basements worked very well. Manhours and dose were saved by using this method, which should be considered for other large decontamination projects in the future.


B. Lessons Learned

- The estimation of dose rate buildup on the temporary demineralizers was very difficult to predict. There are many factors that affect the rate of buildup such as total activity of the water, flow rate of the system, construction of the demineralizer and type of resin used just to name a few. These buildup estimations should only be used for design purposes only, not for establishing control levels for changeout or sluicing of the demineralizers. The actual buildup on the demineralizers should be tracked to verify that the shielding and radiological controls put into place are adequate and changeout should be based on the total estimated dose required to perform the changeout.
- Temporary demineralizers should not be used to cleanup crud bursts. On the RWCU letdown demineralizers dose rates built up at a higher rate than anticipated. An evaluation was performed to determine the cause. It was concluded that a trip of the RWCU system had occurred while the temporary system was in service, which caused a crud burst. When the RWCU system was restarted, only one of RWCU filter demineralizers was placed in service which resulted in less mechanical filtration of the reactor coolant. This reduced the length of time the temporary demineralizer was in service, which impacted the cleanup of the reactor coolant, as well as flushing the CRDs. However, the lessons learned from the evaluation that was performed were applied to other temporary demineralizers that were in service.
- On one occasion a contractor operating a demineralizer side stream system fell asleep. This was discovered by a NRC inspector. Corrective measures were taken to provide more relief's for personnel that operated equipment around the clock. In the future for work of this nature, relief for personnel should be factored into work schedules and manpower needs.
- One very important lesson as a result of the turbine failure event is the value of keeping the plant clean. If not for the cleanliness of the plant at the time of the event, the radiological impact would have been much worse. The cleanliness of the plant coupled with the low source term of the plant, greatly mitigated the consequences of the event. This high standard should be maintained in the future to lessen the impact should any further events of this nature occur.


C. Summary of Radiological Incidents

- A resin spill occurred in the East Drains Cooler Room when changing out temporary demineralizers for TM 94-0005. The cause of this event was a combination of several different factors. The major factors include identifying incorrect procedures in the work request for isolating the temporary modification. This, along with a lack of attention to detail by operators isolating the demineralizers with the wrong procedure, caused the spill to occur. See Operations Critique 94-001.
- CST water was spilled outside of the diked areas during draining of the CST treatment system pre-filter for changeout. During the draining operation 200 gallons was expected in order to drain the pre-filter and associated hoses. This water would be drained to 55 gallon drums. When draining started, the time required to fill one drum was timed a 45 minutes. The operator was making rounds of the draining evolution every 15 minutes. While filling the sixth drum, water overflowed out of the drum and onto a temporary plastic sheet under the drum. It was estimated that one gallon leaked onto the plastic sheet and about a quart spilled onto the ground. It was then discovered that about 15 gallons leaked out of the filter housing vent into the CST diked area. RP surveyed both areas and found no detectable contamination. The primary causes for this event were; draining to barrels outside of diked area, no continuous monitoring of the drums during draining, more water was drained to the drums than anticipated (only 200 gallons was anticipated and when the event occurred they were draining to the sixth barrel), lack of direct Detroit Edison supervision for the evolution, and possibly a valve leaking by. See Operations Critique 94-002.
- During desludging operations for the CST, approximately 30 gallons of water spilled onto the top of the CST. During the desludging operation, the filters installed to remove the sludge plugged. A meeting was held and it was decided not to changeout the filters until the following day. During the night water was discovered to have gotten into the hydraulic lines of the pump. A decision was made to repair the pump and changeout the filters on night shift to allow processing to resume on dayshift. Dayshift decided to first pump the contents of the demineralizer screen backwash liner to the CST. After the valve line-up was performed and the pump was started, it was discovered that the pump discharge had not been put back into the CST. Pumping was stopped immediately. The cause of this spill was the operation's procedure did not cover pumping the liner to the CST but CNSI procedure did. Also no walkdown of the system was performed prior to the start of pumping operations. See Operations Critique 94-003. DER 94-0127 was written to cover evaluating and identifying what actions need to be taken to prevent further occurrences of this nature. Initial response is due 5/2/94.

Turbine building Second Floor

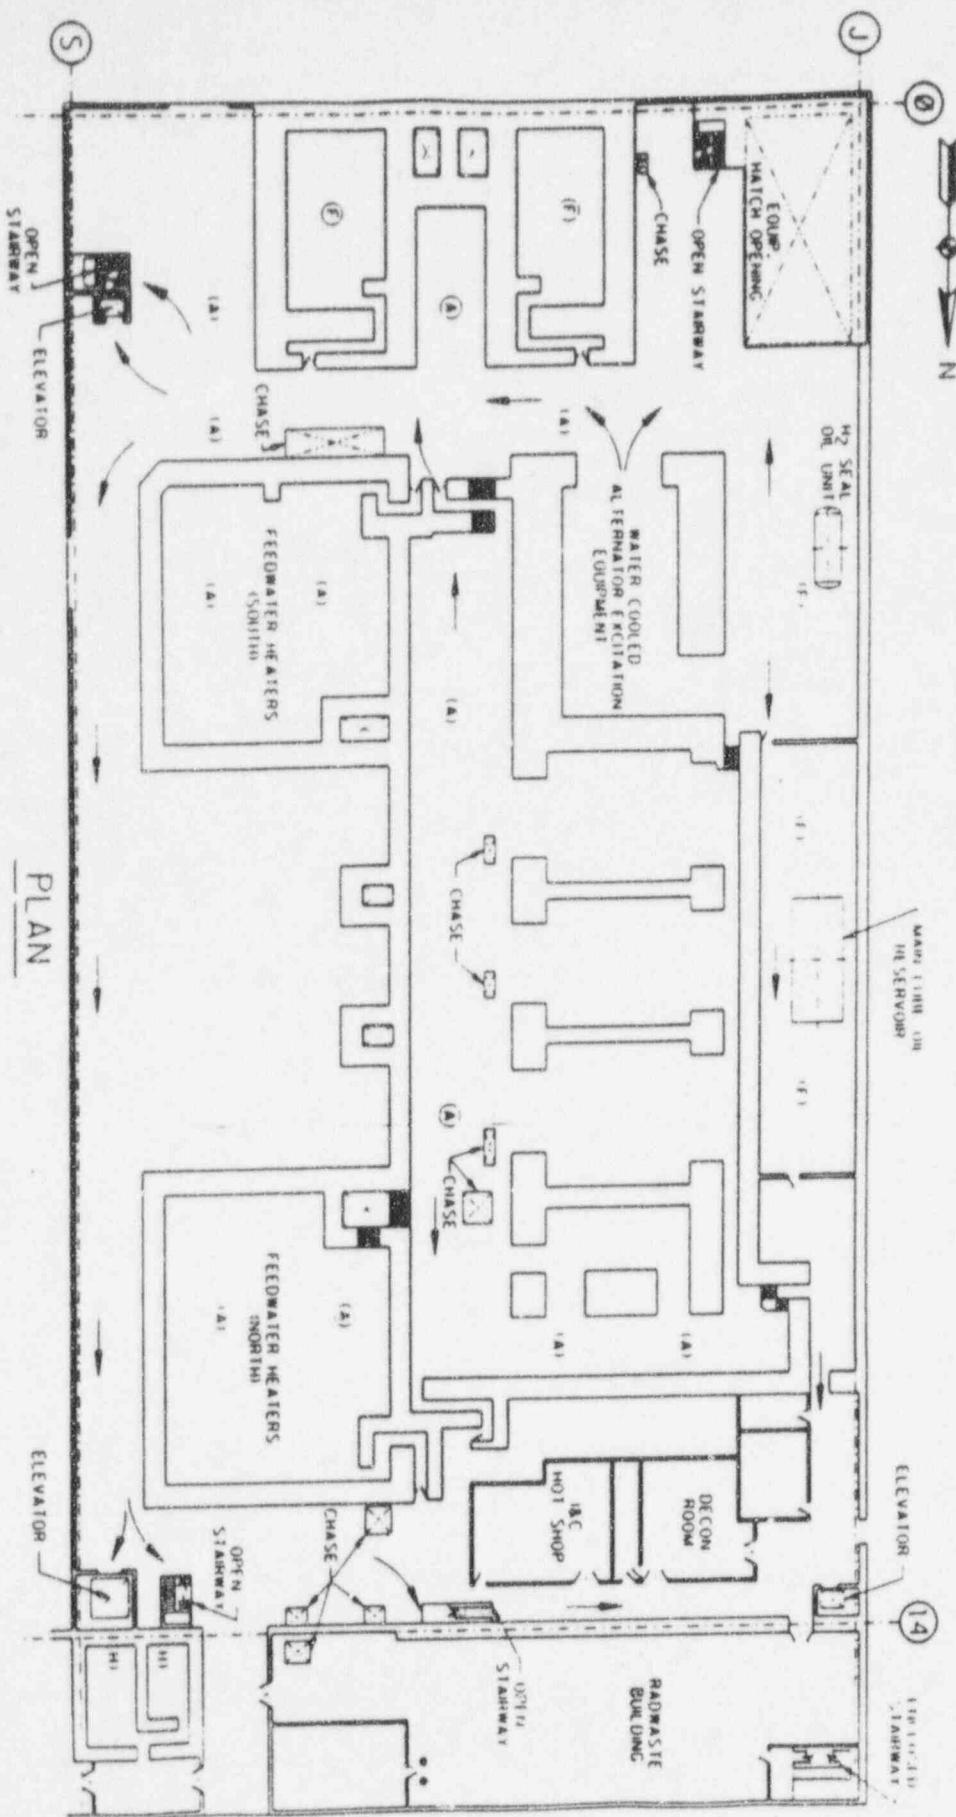


Attachment 1

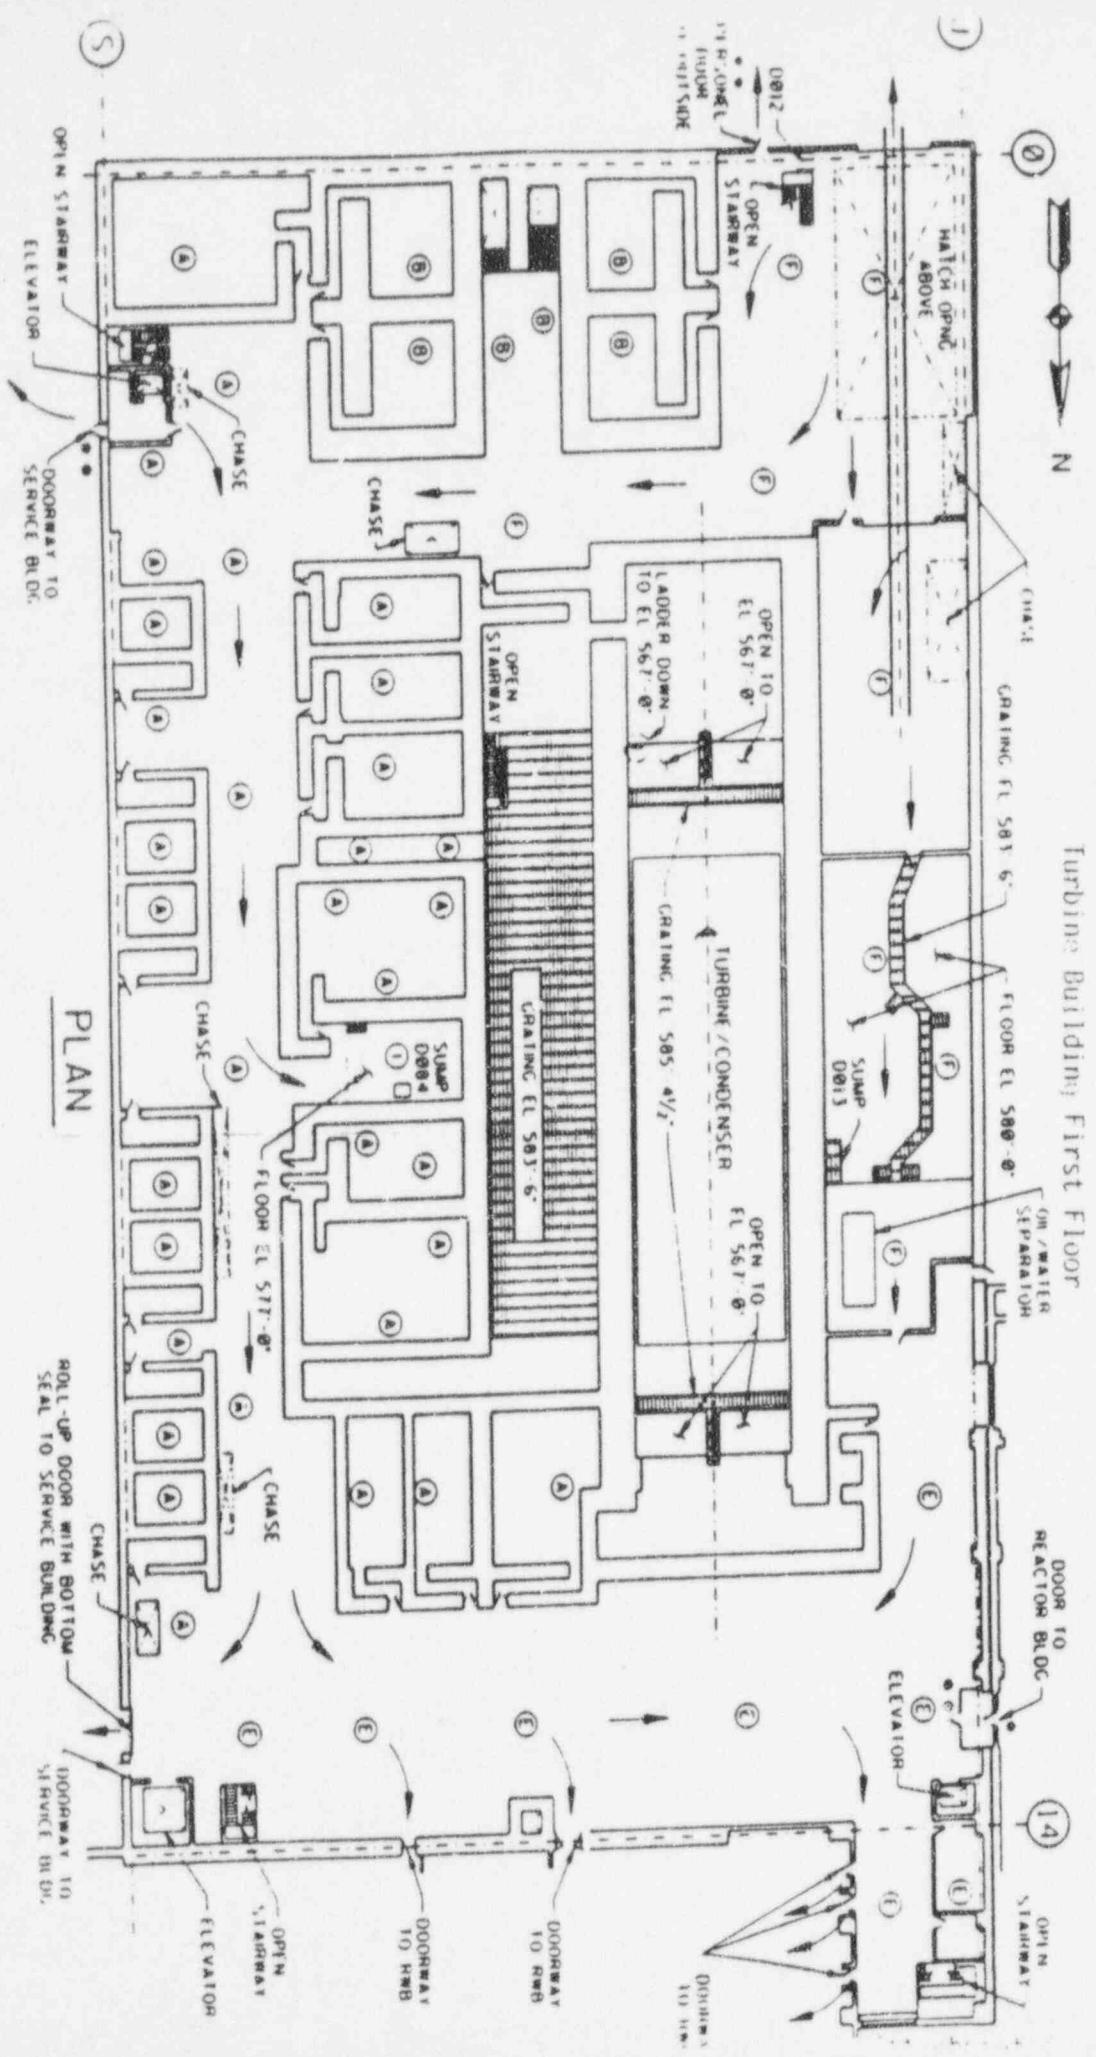

ARROWS SHOW DIRECTION OF WATER FLOW

CROSS HATCHED AREAS ARE AREAS CONTAMINATED FROM TURBINE FAILURE


Turbine Building Basement

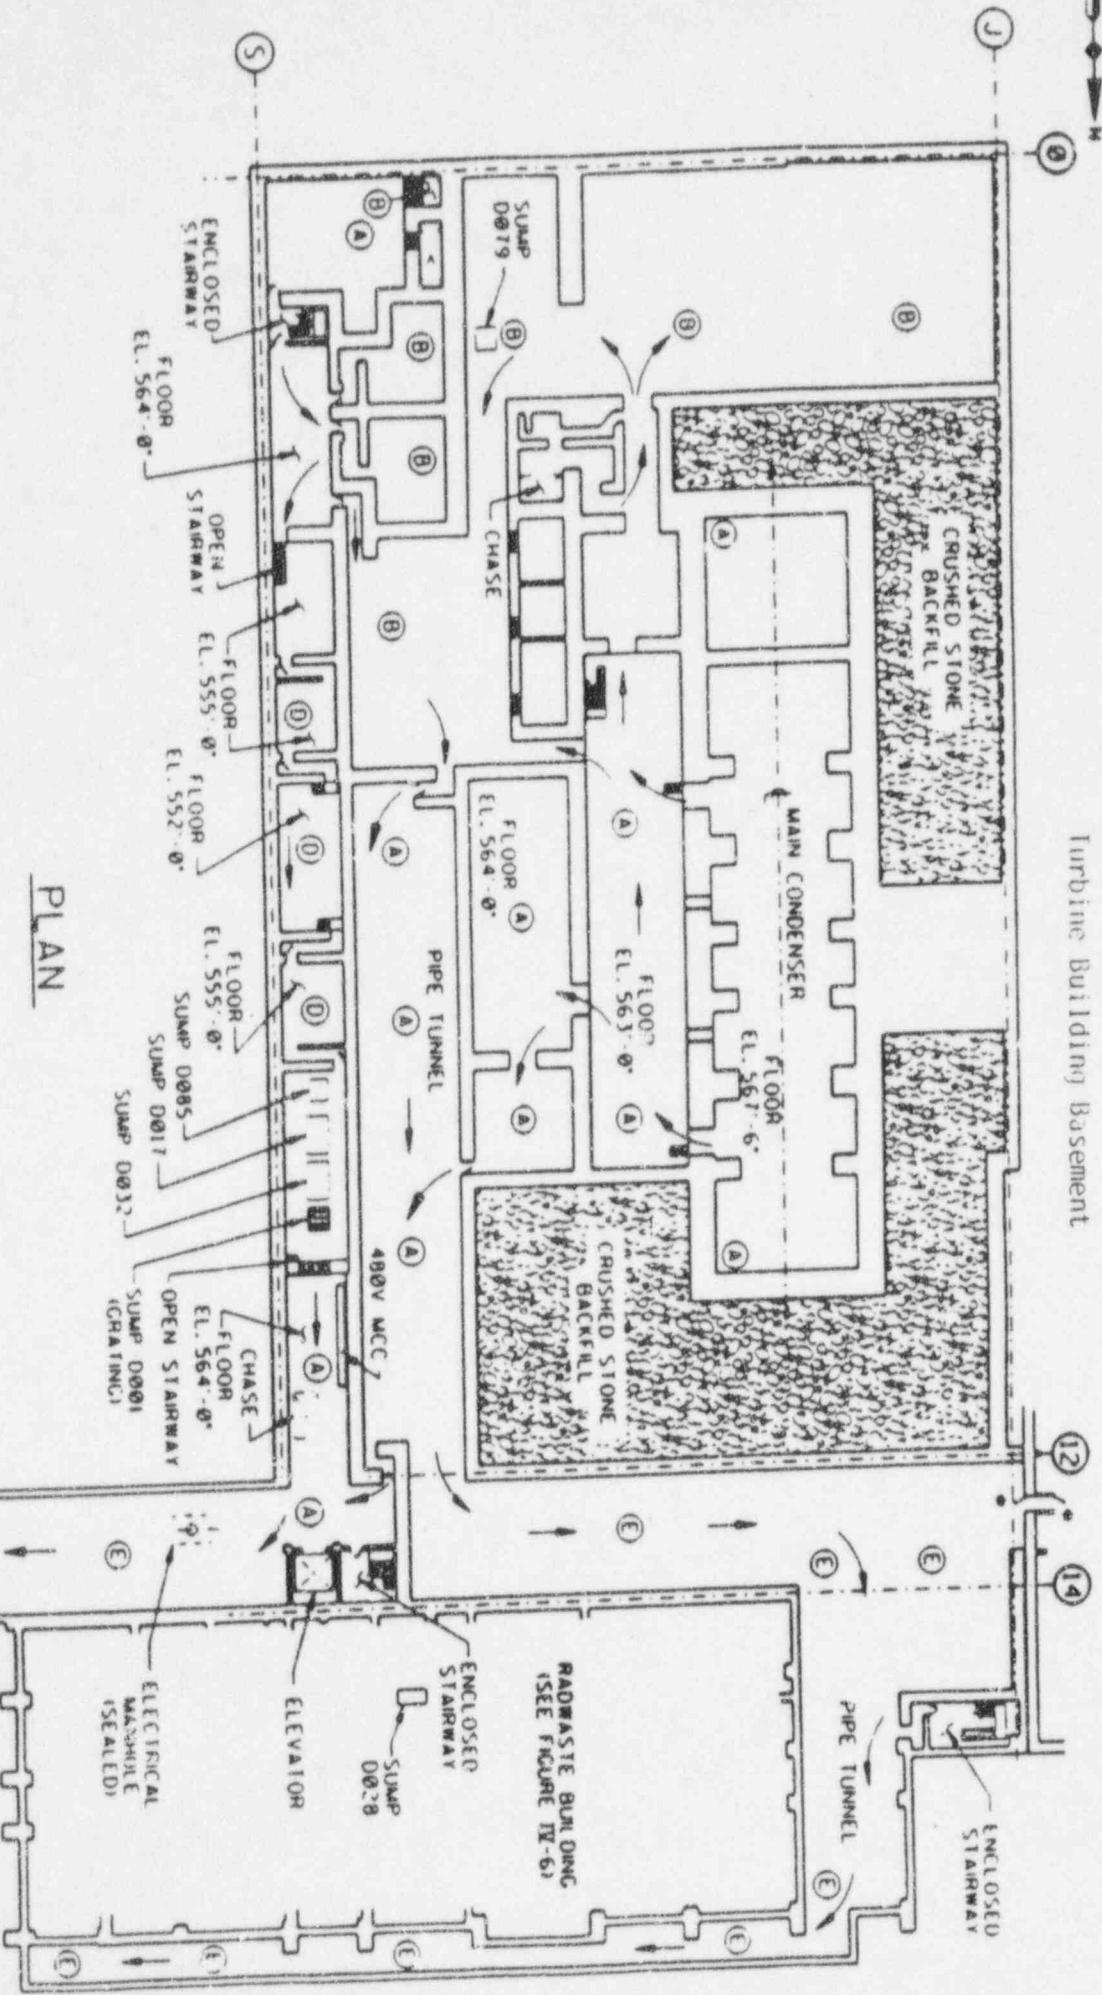

ARROWS show direction of water flow

Cross hatched areas are areas contaminated from turbine failure

Radwaste Building Basement

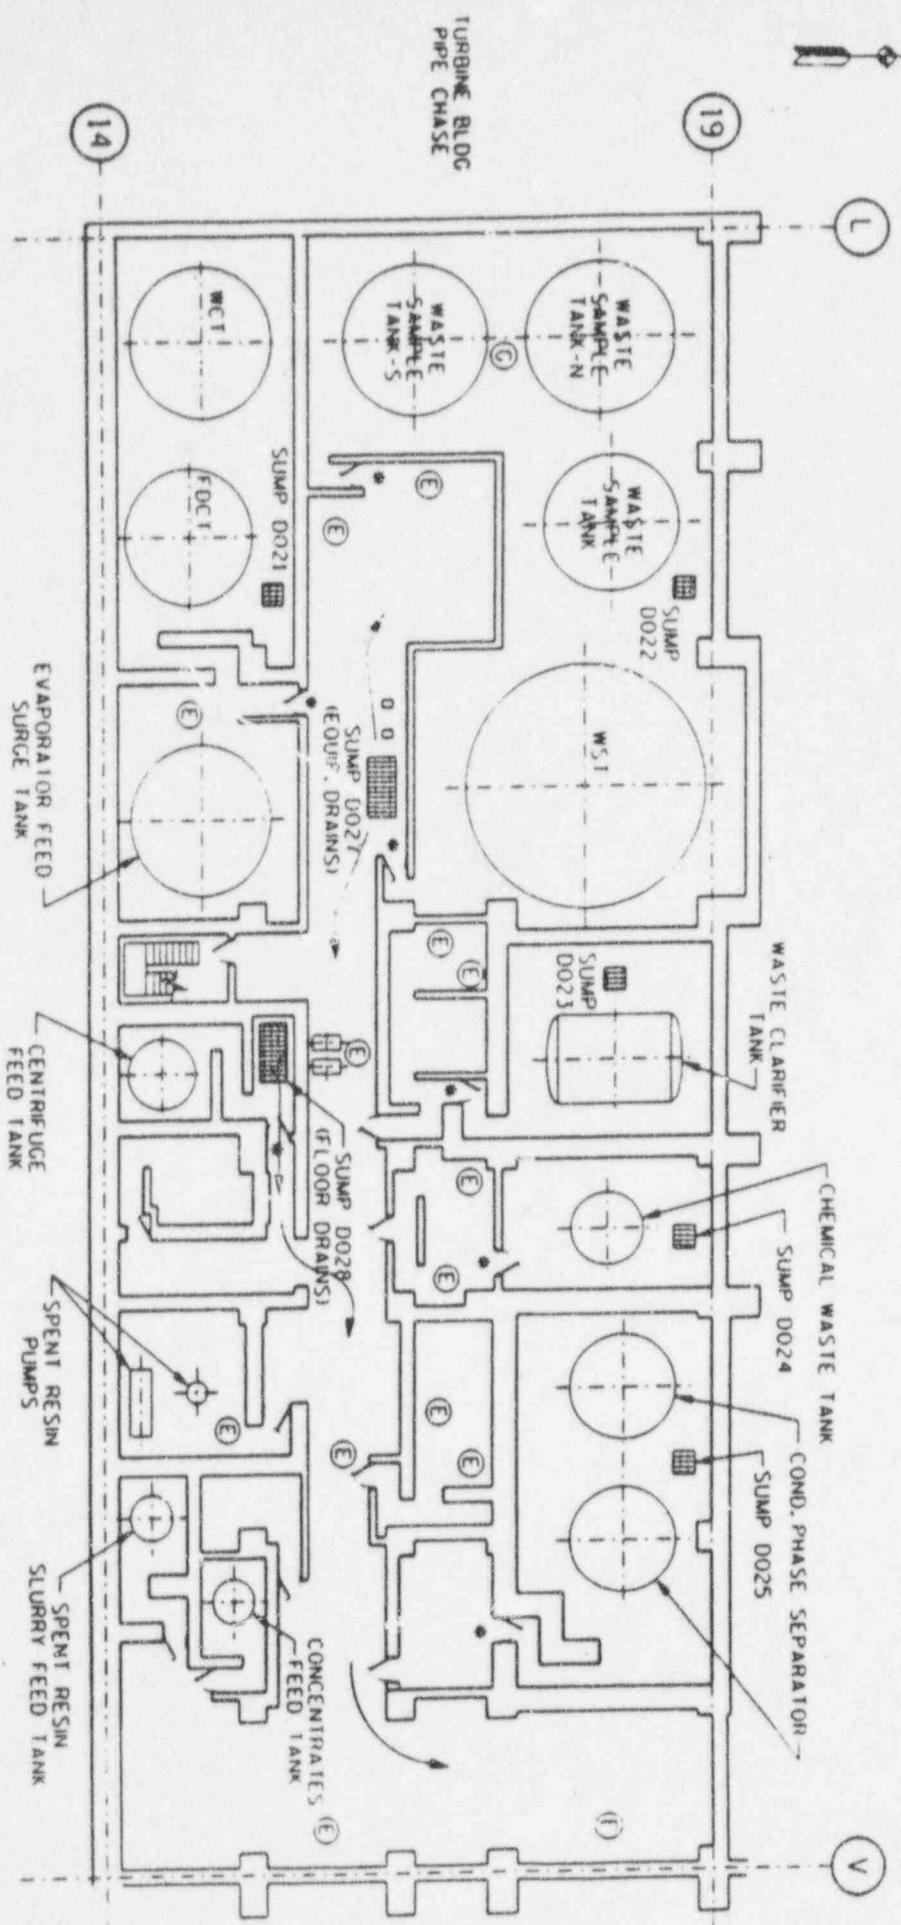

Attachment 1

Arrows show direction of water flow

Cross hatched areas are areas contaminated from the turbine failure

(1)

Fermi 2 Water issues

Date of analysis: FEB 17, 1994

Volume(gal)= 693000
(l)= 2.623E+06

Flow Rates: (gpm)
Dilution= 10000
CST dchg 400

Isotope	Eff Conc uCi/ml	Result uCi/ml	Conc./EC	Activity (mCi)
(10CFR20)				
Cr-51	5.000E-04	3.390E-07	6.780E-04	8.893E-01
Mn-54	3.000E-05	2.060E-07	6.867E-03	5.404E-01
Co-60	3.000E-06	7.520E-07	2.507E-01	1.973E+00
I-131	1.000E-06	7.700E-08	7.700E-02	2.020E-01
Cs-134	9.000E-07	7.080E-07	7.867E-01	1.857E+00
Cs-137	1.000E-06	6.370E-07	6.370E-01	1.671E+00
Sr-89	8.000E-06	5.800E-07	7.250E-02	1.522E+00
H-3	1.000E-03	1.000E-06	1.000E-03	2.623E+00
Totals (w/Dilution)		4.299E-06 1.653E-07	1.832E+00 7.048E-02	1.128E+01 4.338E-01

D\

Fermi 2 Water issues

Date of analysis: FEB 21, 1994

Volume(gal)= 532000
 (l)= 2.014E+06

Flow Rates: (gpm)
 Dilution= 15000
 CST dchg 400

Isotope	Eff Conc uCi/ml	Result uCi/ml	Conc./EC	Activity (mCi)
(10CFR20)				
Cr-51	5.000E-04	3.080E-07	6.160E-04	6.203E-01
Mn-54	3.000E-05	0.000E+00	0.000E+00	0.000E+00
Co-58	2.000E-05	8.740E-08	4.370E-03	1.760E-01
Co-60	3.000E-06	5.060E-07	1.687E-01	1.019E+00
Sb-125	3.000E-05	9.130E-08	3.043E-03	1.839E-01
I-131	1.000E-06	6.650E-08	6.650E-02	1.339E-01
Cs-134	9.000E-07	1.300E-07	1.444E-01	2.618E-01
Cs-137	1.000E-06	1.000E-07	1.000E-01	2.014E-01
Sr-89	8.000E-06	5.800E-07	7.250E-02	1.168E+00
H-3	1.000E-03	4.000E-04	4.000E-01	8.055E+02
Totals (w/Dilution)		4.019E-04 1.044E-05	9.601E-01 2.494E-02	8.093E+02 2.102E+01

Fermi 2 Water issues

cst_224a.wks

Date of analysis: FEB 24, 1994

Volume(gal)= 532000
(l)= 2.014E+06

Flow Rates: (gpm)
Dilution= 20000
CST dchg 400

Isotope	Eff Conc uCi/ml	Result uCi/ml	RESULT/EC	Activity (mCi)
(10CFR20)				
Cr-51	5.000E-04	2.199E-07	4.398E-04	4.428E-01
Mn-54	3.000E-05	0.000E+00	0.000E+00	0.000E+00
Co-58	2.000E-05	9.511E-08	4.756E-03	1.915E-01
Co-60	3.000E-06	4.184E-07	1.395E-01	8.426E-01
Sb-125	3.000E-05	1.096E-07	3.653E-03	2.207E-01
I-131	1.000E-06	2.702E-08	2.702E-02	5.441E-02
Cs-134	9.000E-07	1.415E-07	1.572E-01	2.850E-01
Cs-137	1.000E-06	1.567E-07	1.567E-01	3.156E-01
Sr-89	8.000E-06	5.800E-07	7.250E-02	1.168E+00
H-3	1.000E-03	4.800E-04	4.800E-01	9.666E+02
Totals (w/Dilution)		4.817E-04 9.446E-06	1.042E+00 2.043E-02	9.702E+02

Fermi 2 Water issues

CST_224.WKS

Date of analysis: FEB 24, 1994

Volume(gal)= 532980
(l)= 2.018E+06

Flow Rates: (gpm)
Dilution= 15500
CST dchg 400

Isotope.	Eff Conc uCi/ml	Result uCi/ml	Conc./EC	Activity (mCi)
(10CFR20)				

Fermi 2 Water issues

cst_ave.wks

Date of analysis: Average

Volume(gal)= 480528
(l)= 1.819E+06

Flow Rates: (gpm)
Dilution= 15500
CST dchg 380

Isotope	Eff Conc uCi/ml	Result uCi/ml	Conc./EC	Activity (mCi)
(10CFR20)				
Cr-51	5.000E-04	3.240E-07	1.551E-05	5.894E-01
Co-58	2.000E-05	6.355E-08	7.604E-05	1.156E-01
Co-60	3.000E-06	4.455E-07	3.554E-03	8.104E-01
I-131	1.000E-06	3.630E-08	8.686E-04	6.603E-02
Cs-134	9.000E-07	1.545E-07	4.108E-03	2.810E-01
Cs-137	1.000E-06	1.670E-07	3.996E-03	3.038E-01
Sr-89	8.000E-06	1.200E-06	3.589E-03	2.183E+00
H-3	1.000E-03	4.800E-04	1.149E-02	8.731E+02
Totals (w/Dilution)		4.824E-04 1.154E-05	8.775E+02 2.769E-02	

Fermi 2 Water issues

cst_ave.wks

Date of analysis: Average

Volume(gal)= 480528
(l)= 1.819E+06

Flow Rates: (gpm)
Dilution= 15500
CST dchg 380

Isotope	Eff Conc /ml	Result uCi/ml	Conc./EC	Activity (mCi)
(10CFR20)				
Cr-51	5.000E-04	3.240E-07	6.480E-04	5.894E-01
Co-58	2.000E-05	6.355E-08	3.178E-03	1.156E-01
Co-60	3.000E-06	4.455E-07	1.485E-01	8.104E-01
I-131	1.000E-06	3.630E-08	3.630E-02	6.603E-02
Cs-134	9.000E-07	1.545E-07	1.717E-01	2.810E-01
Cs-137	1.000E-06	1.670E-07	1.670E-01	3.038E-01
Sr-89	8.000E-06	1.200E-06	1.500E-01	2.183E+00
H-3	1.000E-03	4.800E-04	4.800E-01	8.731E+02
Totals (w/Dilution)		4.824E-04 1.154E-05	1.157E+00 2.769E-02	8.775E+02

Fermi 2 Water issues

cst_ave.wks

Date of analysis: Average

Volume(gal)= 480528
(l)= 1.819E+06

Flow Rates: (gpm)
Dilution= 15500
CST dchg 380

Isotope	Eff Conc uCi/ml	Result uCi/ml	Conc./EC	Activity (mCi)
(10CFR26)				
Cr-51	5.000E-04	3.240E-07	1.551E-05	5.894E-01
Co-58	2.000E-05	6.355E-08	7.604E-05	1.156E-01
Co-60	3.000E-06	4.455E-07	3.554E-03	8.104E-01
I-131	1.000E-06	3.630E-08	8.686E-04	6.603E-02
Cs-134	9.000E-07	1.545E-07	4.108E-03	2.810E-01
Cs-137	1.000E-06	1.670E-07	3.996E-03	3.038E-01
Sr-89	8.000E-06	1.200E-06	3.589E-03	2.183E+00
H-3	1.000E-03	4.800E-04	1.149E-02	8.731E+02
Totals (w/Dilution)		4.824E-04 1.154E-05		8.775E+02 2.769E-02

(2)

Comparison of CST Sample Splitting Results Michigan Dept. of Radiological Health and Fermi 2				
Radionuclide	Mich Rad Health	Fermi 2	Ratio (Fermi/Mich)	Agreement (NRC Criteria)
Cr-51	3E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 2\text{E}-07$)	6.1E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 1.8\text{E}-07$)	2.0	yes
Co-58	8E-08 $\mu\text{Ci}/\text{ml}$ ($\pm 3\text{E}-08$)	1.0E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 2.2\text{E}-08$)	1.25	yes
Co-60	4.5E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 0.7\text{E}-07$)	5.2E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 5.0\text{E}-08$)	1.16	yes
I-131	7E-08 $\mu\text{Ci}/\text{ml}$ ($\pm 3\text{E}-08$)	6.0E-08 $\mu\text{Ci}/\text{ml}$ ($\pm 1.4\text{E}-08$)	0.86	yes
Sb-125	1.5E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 0.7\text{E}-07$)	1.2E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 0.47\text{E}-07$)*	0.80	yes
Cs-134	1.1E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 0.4\text{E}-07$)	1.5E-07 $\mu\text{Ci}/\text{ml}$ ($\pm 0.32\text{E}-07$)	1.4	yes
Cs-137	8E-08 $\mu\text{Ci}/\text{ml}$ ($\pm 2\text{E}-08$)	6.7E-08 $\mu\text{Ci}/\text{ml}$ ($\pm 3.2\text{E}-08$)	0.84	yes

- * Sb-125 was not identified as a confirmed peak by the gamma spectral software.
Data review provided this result.

↑ ↑
 Michigan Fermi Sample
 Sample observed by Dr. Fleming

D-2

 ***** 23-FEB-94 08:39:52 *****

CST SAMPLE SPLIT WITH FERMI2 AND STATE OF MICHIGAN

SPECTRAL FILE NAME: L940401.FEV
 SAMPLE DATE: 21-FEB-94 09:27:00
 SAMPLE IDENTIFICATION: 94-040
 TYPE OF SAMPLE: LIQUID
 SAMPLE QUANTITY: 500.7500 UNITS: GM
 SAMPLE GEOMETRY: LMAR500
 EFFICIENCY FILE NAME: LMAR500.EFF

*
 ACQUIRE DATE: 23-FEB-94 08:04:51 * FWHM(1332) 1.886
 PRESET TIME(LIVE): 2000. SEC * SENSITIVITY: 5.000
 ELAPSED REAL TIME: 2000. SEC * SHAPE PARAMETER : 5.0 %
 ELAPSED LIVE TIME: 2000. SEC * NBR ITERATIONS: 10.
 *

 *
 DETECTOR: ORTEC * LIBRARY:MASTER.LIB
 CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV
 KEV/CHNL: .4697016 * HALF LIFE RATIO: 8.00
 OFFSET: 39.8232300 KEV * ABUNDANCE LIMIT: 70.00%
 *

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	185.78	34.	111.	1.19	310.74	306	9	1.70E-02	56.5	
2	0	238.17	18.	112.	.76	422.29	420	10	8.89E-03	****	
3	0	319.96	44.	83.	1.02	596.41	593	9	2.21E-02	41.4	
4	0	364.85	64.	75.	1.95	692.00	686	12	3.18E-02	32.5	
5	0	661.53	77.	63.	1.00	1323.62	1318	12	3.84E-02	23.3	
6	0	795.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1	
7	0	810.32	66.	39.	1.30	1640.39	1634	14	3.31E-02	22.1	
8	0	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2	
9	0	1172.96	291.	23.	1.65	2412.46	2402	18	1.45E-01	7.2	
10	0	1332.44	284.	16.	1.96	2751.99	2743	16	1.42E-01	6.6	
11	0	1460.63	118.	0.	1.79	3024.92	3015	18	5.90E-02	10.7	
12	0	1764.20	35.	7.	.70	3671.21	3664	13	1.73E-02	21.0	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
 UNCORR. LIVE TIME: 2000. CORRECTED LIVE TIME: 2000.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR
1	0	185.78	34.	111.	1.19	310.74	306	9	1.70E-02	56.5
2	0	238.17	18.	112.	.76	422.29	420	10	8.89E-03	****
3	0	319.96	44.	83.	1.02	596.41	593	9	2.21E-02	41.4
4	0	364.85	64.	75.	1.95	692.00	686	12	3.18E-02	32.5
5	0	661.53	77.	63.	1.00	1323.62	1318	12	3.84E-02	23.3
6	0	795.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1
7	0	810.32	66.	39.	1.30	1640.39	1634	14	3.31E-02	22.1
8	0	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2

9	0	1114.70	271.	20.	1.00	2414.40	2404	10	1.23E-01	1.4
10	0	1332.44	284.	16.	1.96	2751.99	2743	16	1.42E-01	6.6
11	0	1460.63	118.	0.	1.79	3024.92	3015	18	5.90E-02	10.7
12	0	1764.20	35.	7.	.70	3671.21	3664	13	1.73E-02	21.0

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 2000. (PILE-UP CORRECTED)

PAGE 1

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GM	1-SIGMA ERROR
CR-51	AP	320.08	44.	83.	9.83*	4.127E+00	3.084E -7	1.278E -7
CO-58	AP	810.76	66.	39.	99.40*	2.099E+00	8.736E -8	1.934E -8
CO-60	AP	1173.22	291.	23.	100.00	1.600E+00	4.909E -7	3.522E -8
		1332.49	284.	16.	100.00*	1.457E+00	5.271E -7	3.458E -8
NI-65	AP	366.27	64.	75.	4.61	3.758E+00	3.971E -1	1.291E -1
		1115.52	0.	0.	14.80	0.000E+00	.000E 0	.000E 0
		1481.84	0.	0.	23.50*	0.000E+00	.000E 0	.000E 0

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GM	1-SIGMA ERROR
I-131	HFP	284.30	0.	0.	6.05	0.000E+00	.000E 0	.000E 0
		364.48	64.	75.	81.20*	3.758E+00	6.654E -8	2.163E -8
		636.97	0.	0.	7.26	0.000E+00	.000E 0	.000E 0
		722.89	0.	0.	1.80	0.000E+00	.000E 0	.000E 0

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GM	1-SIGMA ERROR
RH-105	FP	306.10	0.	0.	5.13	0.000E+00	.000E 0	.000E 0
		318.90	44.	83.	19.20*	4.127E+00	3.772E -7	1.562E -7
CS-134	FP	563.23	0.	0.	8.38	0.000E+00	.000E 0	.000E 0
		569.32	0.	0.	15.43	0.000E+00	.000E 0	.000E 0
		604.70	0.	0.	97.60*	0.000E+00	.000E 0	.000E 0
		795.85	87.	39.	85.40	2.127E+00	1.299E -7	2.486E -8
		801.93	0.	0.	8.73	0.000E+00	.000E 0	.000E 0
CS-137	FP	661.65	77.	63.	85.12*	2.436E+00	9.998E -8	2.328E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GM	1-SIGMA ERROR
K-40	NP	1460.81	118.	0.	10.67*	1.362E+00	2.191E -6	2.338E -7
RA-226	NP	186.21	34.	111.	3.28	5.814E+00	4.803E -7	2.714E -7
		241.98	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		295.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.92	0.	0.	37.20	0.000E+00	.000E 0	.000E 0
		609.31	0.	0.	46.30*	0.000E+00	.000E 0	.000E 0
		1120.29	0.	0.	15.10	0.000E+00	.000E 0	.000E 0
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	35.	7.	15.80	1.186E+00	4.972E -7	1.044E -7
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0
TH-232	NP	238.63	18.	112.	44.60	5.045E+00	2.133E -8	2.576E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	0.	0.	35.86*	0.000E+00	.000E 0	.000E 0

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
NUCLIDE LINE ACTIVITY REPORT
ELAPSED LIVE TIME: 2000. (PILE-UP CORRECTED)

PAGE 2

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI	/	1-SIGMA
							GM		ERROR
U-235	NP	143.76	0.	0.	10.50	0.000E+00	.000E	0	.000E 0
		185.72	34.	111.	54.00*	5.814E+00	2.917E	-8	1.648E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 2000. (PILE-UP CORRECTED)

PAGE 3

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
2	0	238.17	18.	112.	.76	422.29	420	10	8.89E-03	****	5.05E+00
6	0	795.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1	2.13E+00
8	0	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2	1.69E+00
12	0	1764.20	35.	7.	.70	3671.21	3664	13	1.73E-02	21.0	1.19E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI	/GM	ABNDIFF	FAILED
1	RA-226	186.21	1600.00Y	1.000L	0	4.803E -7	12.29%	ABN
2	TH-232	238.63	1.00E+10Y	1.000E	0	2.133E -8	25.03%	ABN
4	NI-65	366.27	2.52H	4.010E	5	3.971E -1	10.74%	DCY, ABN
6	CS-134	795.85	753.10D	1.002E	0	1.299E -7	39.62%	ABN
12	RA-226	1764.49	1600.00Y	1.000E	0	4.972E -7	12.29%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 4

TOTAL LINES IN SPECTRUM	12
UNIDENTIFIED PEAKS	4
IDENTIFIED IN SUMMARY REPORT	8 66.67%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA	ERROR	%ERR
CR-51	AP	27.70D	1.050	3.084E -7	1.278E -7	41.42	
CO-58	AP	70.80D	1.019	8.736E -8	1.934E -8	22.14	
CO-60	AP	1925.00D	1.001	5.271E -7	3.458E -8	6.56	

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA	ERROR	%ERR
I-131	HFP	8.04D	1.184	6.654E -8	2.163E -8	32.50	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA	ERROR	%ERR
RH-105	FP	35.36H	2.508	3.772E -7	1.562E -7	41.42	
CS-137	FP	30.17Y	1.000	9.998E -8	2.328E -8	23.29	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA	ERROR	%ERR
K-40	NP	1.28E+09Y	1.000	2.191E -6	2.338E -7	10.67	
U-235	NP	7.04E+08Y	1.000	2.917E -8	1.648E -8	56.51	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /GM
BE-7	54.	477.59	2.7784E-07
ANIL-511	155.	511.00	HALF LIFE TOO SHORT
NA-22	17.	1274.54	3.6322E-08
NA-24	22.	1368.53	3.8219E-07
CL-38	4.	2167.51	0.0000E+00
AR-41	12.	1293.64	HALF LIFE TOO SHORT
SC-46	52.	1120.51	5.7704E-08
MN-54	51.	834.83	4.4395E-08
MN-56	45.	846.75	HALF LIFE TOO SHORT
FE-59	26.	1099.22	7.2231E-08
CO-57	92.	122.06	2.3093E-08
NI-65	11.	1481.84	HALF LIFE TOO SHORT
CU-64	14.	1345.90	9.1015E-05
ZN-65	37.	1115.52	9.4583E-08
ZN-69M	43.	438.63	2.6463E-07
AS-76	44.	559.10	2.1977E-07
SE-75	73.	264.65	4.0588E-08
BR-82	56.	554.32	1.1392E-07
BR-84	48.	881.50	HALF LIFE TOO SHORT
KR-85	83.	513.99	8.5801E-06
KR-85M	102.	151.18	HALF LIFE TOO SHORT
KR-87	57.	402.58	HALF LIFE TOO SHORT
KR-88	39.	196.32	HALF LIFE TOO SHORT
Rb-88	12.	1836.01	HALF LIFE TOO SHORT
RB-89	39.	1031.88	HALF LIFE TOO SHORT
SR-85	83.	513.99	3.7937E-08
SR-85M	83.	231.69	HALF LIFE TOO SHORT
SR-91	26.	1024.30	3.5406E-05
SR-92	22.	1383.94	HALF LIFE TOO SHORT
Y-88	12.	1836.01	4.0576E-08
Y-91	24.	1204.90	1.3937E-05
Y-91MD	62.	555.57	1.0878E-06
Y-92	39.	934.46	HALF LIFE TOO SHORT
Y-93	81.	266.90	9.2111E-06
ZR-95	35.	756.72	6.1128E-08
ZR-97	36.	743.36	2.4326E-07
NB-94	30.	702.63	2.8314E-08
NB-95	50.	765.79	4.1696E-08
NB-97D	24.	1024.50	2.2875E-05
MO-90	86.	257.34	HALF LIFE TOO SHORT
MO-99	26.	739.58	3.5615E-07
TC-99MD	108.	140.51	3.8950E-08
RU-103	49.	497.08	3.2178E-08
RU-105	34.	724.50	HALF LIFE TOO SHORT
RU-106	50.	621.84	3.3595E-07
AG-110M	41.	657.75	3.3008E-08
CD-109	76.	88.03	6.5519E-07
SN-113	70.	391.39	4.3350E-08
SB-122	42.	563.93	6.5691E-08
SB-124	109.	602.71	4.9544E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /GM
SB-125	88.	427.89	1.1321E-07
TE-123M	79.	158.99	2.2269E-08
TE-132	72.	228.16	3.6189E-08
I-132	36.	667.69	HALF LIFE TOO SHORT
I-133	37.	529.87	1.3927E-07
I-134	43.	847.03	HALF LIFE TOO SHORT
I-135	12.	1260.41	1.4421E-05
XE-131M	113.	163.93	1.2590E-06
XE-133	60.	80.99	8.9260E-08
XE-133M	80.	233.22	4.0799E-07
XE-135	71.	249.79	8.9599E-07
XE-135M	41.	526.56	HALF LIFE TOO SHORT
XE-138	66.	258.31	HALF LIFE TOO SHORT
CS-134	141.	604.70	5.5471E-08
CS-134M	116.	127.42	HALF LIFE TOO SHORT
CS-136	33.	818.50	3.8710E-08
CS-138	11.	1435.86	HALF LIFE TOO SHORT
BA-133	74.	356.00	4.5337E-08
BA-139	88.	165.85	HALF LIFE TOO SHORT
BA-140	39.	537.32	1.1613E-07
BA-141	90.	190.22	HALF LIFE TOO SHORT
LA-140	14.	1596.49	9.1487E-08
CE-139	88.	165.85	2.4389E-08
CE-141	78.	145.44	4.0565E-08
CE-143	67.	293.26	1.5418E-07
CE-144	114.	133.54	2.0995E-07
ND-147	73.	91.11	9.0916E-08
EU-152	57.	344.27	8.8826E-08
EU-154	17.	1274.45	1.0214E-07
HF-181	60.	482.03	3.7349E-08
W-187	48.	479.53	4.4638E-07
HG-203	69.	279.19	3.2009E-08
RA-226	78.	609.31	8.7263E-08
TH-232	32.	2614.66	0.0000E+00
U-238	108.	131.20	1.0686E-07
NP-239	104.	106.13	1.7391E-07
AM-241	70.	59.54	2.0476E-07

***** 23-FEB-94 08:43:48 *****

CST SAMPLE SPLIT WITH FERMIZ AND STATE OF MICHIGAN

SPECTRAL FILE NAME: L940401.FEV
SAMPLE DATE: 21-FEB-94 09:27:00
SAMPLE IDENTIFICATION: 94-040
TYPE OF SAMPLE: LIQUID
SAMPLE QUANTITY: 500.7500 UNITS: GM
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

* ACQUIRE DATE: 23-FEB-94 08:04:51 * FWHM(1332) 1.886
PRESET TIME(LIVE): 2000. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 2000. SEC * SHAPE PARAMETER : 5.0 %
ELAPSED LIVE TIME: 2000. SEC * NBR ITERATIONS: 10.

*
* DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV
KEV/CHNL: .4697016 * HALF LIFE RATIO: 8.00
OFFSET: 39.8232300 KEV * ABUNDANCE LIMIT: 70.00%
*

***** ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	185.78	34.	111.	1.19	310.74	306	9	1.70E-02	56.5	
2	0	238.17	18.	112.	.76	422.29	420	10	8.89E-03	****	
3	0	319.96	44.	83.	1.02	596.41	593	9	2.21E-02	41.4	
4	0	364.85	64.	75.	1.95	692.00	686	12	3.18E-02	32.5	
5	0	661.53	77.	63.	1.00	1323.62	1318	12	3.84E-02	23.3	
6	0	795.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1	
7	0	810.32	66.	39.	1.30	1640.39	1634	14	3.31E-02	22.1	
8	0	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2	
9	0	1172.96	291.	23.	1.65	2412.46	2402	18	1.45E-01	7.2	
10	0	1332.44	284.	16.	1.96	2751.99	2743	16	1.42E-01	6.6	
11	0	1460.63	118.	0.	1.79	3024.92	3015	18	5.90E-02	10.7	
12	0	1764.20	35.	7.	.70	3671.21	3664	13	1.73E-02	21.0	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND
* AFTER ENERGY INDICATES CORRECTED PEAK

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	185.78	34.	111.	1.19	310.74	306	9	1.70E-02	56.5	
		238.17 KEV PEAK DELETED									
3	0	319.96	44.	83.	1.02	596.41	593	9	2.21E-02	41.4	
4	0	364.85	64.	75.	1.95	692.00	686	12	3.18E-02	32.5	
5	0	661.53	77.	63.	1.00	1323.62	1318	12	3.84E-02	23.3	
6	0	795.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1	

7	0	810.32	65.	39.	1.30	1640.59	1034	14	3.31E-04	44.1
8	0	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2
9	0	1172.96	291.	23.	1.65	2412.46	2402	18	1.45E-01	7.2
10	0	1332.44*	273.	16.	1.96	2751.99	2743	16	1.36E-01	7.4
11	0	1460.63*	22.	0.	1.79	3024.92	3015	18	1.10E-02	88.0

1764.20 KEV PEAK DELETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT

PAGE 1

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
6	0	795.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1	2.13E+00
8	0	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2	1.69E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI	/GM	ABNDIFF	FAILED
1	RA-226	186.21	1600.00Y	1.000E 0	4.803E	-7	2.11%	AEN
4	NI-65	366.27	2.52H	4.010E 5	3.971E	-1	10.74%	DCY, ABN
6	CS-134	795.85	753.10D	1.002E 0	1.299E	-7	39.62%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 2

TOTAL LINES IN SPECTRUM	10
UNIDENTIFIED PEAKS	2
IDENTIFIED IN SUMMARY REPORT	8 80.00%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA ERROR	%ERR
CR-51	AP	27.70D	1.050	3.084E -7	1.278E -7	41.42
CO-58	AP	70.80D	1.019	8.736E -8	1.934E -8	22.14
CO-60	AP	1925.00D	1.001	5.060E -7	3.727E -8	7.37

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA ERROR	%ERR
I-131	HFP	8.04D	1.184	6.654E -8	2.163E -8	32.50

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA ERROR	%ERR
RH-105	FP	35.36H	2.508	3.772E -7	1.562E -7	41.42
CS-137	FP	30.17Y	1.000	9.998E -8	2.328E -8	23.29

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA ERROR	%ERR
K-40	NP	1.28E+09Y	1.000	4.083E -7	3.591E -7	87.95
U-235	NP	7.04E+08Y	1.000	2.917E -8	1.648E -8	56.51

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /GM
BE-7	54.	477.59	2.7784E-07
ANIL-511	155.	511.00	HALF LIFE TOO SHORT
NA-22	17.	1274.54	3.6322E-08
NA-24	22.	1368.53	3.8219E-07
CL-38	4.	2167.51	0.0000E+00
AR-41	12.	1293.64	HALF LIFE TOO SHORT
SC-46	52.	1120.51	5.7704E-08
MN-54	51.	834.83	4.4395E-08
MN-56	45.	846.75	HALF LIFE TOO SHORT
FE-59	26.	1099.22	7.2231E-08
CO-57	92.	122.06	2.3093E-08
NI-65	11.	1481.84	HALF LIFE TOO SHORT
CU-64	14.	1345.90	9.1015E-05
ZN-65	37.	1115.52	9.4583E-08
ZN-69M	43.	438.63	2.6463E-07
AS-76	44.	559.10	2.1977E-07
SE-75	73.	264.65	4.0588E-08
BR-82	56.	554.32	1.1392E-07
BR-84	48.	881.50	HALF LIFE TOO SHORT
KR-85	83.	513.99	8.5801E-06
KR-85M	102.	151.18	HALF LIFE TOO SHORT
KR-87	57.	402.58	HALF LIFE TOO SHORT
KR-88	89.	196.32	HALF LIFE TOO SHORT
RB-88	12.	1836.01	HALF LIFE TOO SHORT
RB-89	39.	1031.88	HALF LIFE TOO SHORT
SR-85	83.	513.99	3.7937E-08
SR-85M	83.	231.69	HALF LIFE TOO SHORT
SR-91	26.	1024.30	3.5406E-06
SR-92	22.	1383.94	HALF LIFE TOO SHORT
Y-88	12.	1836.01	4.0576E-08
Y-91	24.	1204.90	1.3937E-05
Y-91MD	62.	555.57	1.0878E-06
Y-92	39.	934.46	HALF LIFE TOO SHORT
Y-93	81.	266.90	9.2111E-06
ZR-95	35.	756.72	6.1128E-08
ZR-97	36.	743.36	2.4326E-07
NB-94	30.	702.63	2.8314E-08
NB-95	50.	765.79	4.1696E-08
NB-97D	24.	1024.50	2.2875E-05
MO-90	86.	257.34	HALF LIFE TOO SHORT
MO-99	26.	739.58	3.5615E-07
TC-99MD	108.	140.51	3.8950E-08
RU-103	49.	497.08	3.2178E-08
RU-105	34.	724.50	HALF LIFE TOO SHORT
RU-106	50.	621.84	3.3595E-07
AG-110M	41.	657.75	3.3008E-08
CD-109	76.	88.03	6.5519E-07
SN-113	70.	391.69	4.3350E-08
SB-122	42.	563.93	6.5691E-08
SB-124	109.	602.71	4.9544E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /GM
SB-125	88.	427.89	1.1321E-07
TE-123M	79.	158.99	2.2269E-08
TE-132	72.	228.16	3.6189E-08
I-132	36.	667.69	HALF LIFE TOO SHORT
I-133	37.	529.87	1.3927E-07
I-134	43.	847.03	HALF LIFE TOO SHORT
I-135	12.	1260.41	1.4421E-05
XE-131M	113.	163.93	1.2590E-06
XE-133	60.	80.99	8.9260E-08
XE-133M	80.	233.22	4.0799E-07
XE-135	71.	249.79	8.9599E-07
XE-135M	41.	526.56	HALF LIFE TOO SHORT
XE-138	66.	258.31	HALF LIFE TOO SHORT
CS-134	141.	604.70	5.5471E-08
CS-134M	116.	127.42	HALF LIFE TOO SHORT
CS-136	33.	818.50	3.8710E-08
CS-138	11.	1435.86	HALF LIFE TOO SHORT
BA-133	74.	356.00	4.5337E-08
BA-139	88.	165.85	HALF LIFE TOO SHORT
BA-140	39.	537.32	1.1613E-07
BA-141	90.	190.22	HALF LIFE TOO SHORT
LA-140	14.	1596.49	9.1487E-08
CE-139	88.	165.85	2.4389E-08
CE-141	78.	145.44	4.0565E-08
CE-143	67.	293.26	1.5418E-07
CE-144	114.	133.54	2.0995E-07
ND-147	73.	91.11	9.0916E-08
EU-152	57.	344.27	8.8826E-08
EU-154	17.	1274.45	1.0214E-07
HF-181	60.	482.03	3.7349E-08
W-187	48.	479.53	4.4638E-07
HG-203	69.	279.19	3.2009E-08
RA-226	78.	609.31	8.7263E-08
TH-232	32.	2614.66	0.0000E+00
U-238	108.	131.20	1.0686E-07
NP-239	104.	106.13	1.7391E-07
AM-241	70.	59.54	2.0476E-07

***** 23-FEB-94 08:47:32 *****

CST SAMPLE SPLIT WITH FERMI2 AND STATE OF MICHIGAN

SPECTRAL FILE NAME: L940401.FEV

SAMPLE DATE: 21-FEB-94 09:27:00

SAMPLE IDENTIFICATION: 94-040

TYPE OF SAMPLE: LIQUID

SAMPLE QUANTITY: 500.7500 UNITS: GM

SAMPLE GEOMETRY: LMAR500

EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 23-FEB-94 08:04:51 * FWHM(1332) 1.836

PRESET TIME(LIVE): 2000. SEC * SENSITIVITY: 5.000

ELAPSED REAL TIME: 2000. SEC * SHAPE PARAMETER: 5.0 %

ELAPSED LIVE TIME: 2000. SEC * NBR ITERATIONS: 10.

DETECTOR: ORTEC * LIBRARY:MASTER.LIB

CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV

KEV/CHNL: .4697016 * HALF LIFE RATIO: 8.00

OFFSET: 39.8232300 KEV * ABUNDANCE LIMIT: 70.00%

PFCS ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	O	185.78	34.	111.	1.19	310.74	306	9	1.70E-02	56.5	
2	O	238.17	18.	112.	.76	422.29	420	10	8.89E-03	****	
3	O	319.96	44.	83.	1.02	596.41	593	9	2.21E-02	41.4	
4	O	364.85	64.	75.	1.95	692.00	686	12	3.18E-02	32.5	
5	O	661.53	77.	63.	1.00	1323.62	1318	12	3.84E-02	23.3	
6	O	795.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1	
7	O	810.32	66.	39.	1.30	1640.39	1634	14	3.31E-02	22.1	
8	O	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2	
9	O	1172.96	201.	23.	1.65	2412.46	2407	18	1.45E-01	7.2	
10	O	1332.44	204.	16.	1.96	2751.92	2742	16	1.42E-01	6.6	
11	O	1460.63	118.	0.	1.79	3024.92	3015	18	5.90E-02	10.7	
12	O	1764.20	35.	7.	.70	3671.21	3664	13	1.73E-02	21.0	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000

UNCORR. LIVE TIME: 2000. CORRECTED LIVE TIME: 2000.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR
1	O	185.78	34.	111.	1.19	310.74	306	9	1.70E-02	56.5
2	O	238.17	18.	112.	.76	422.29	420	10	8.89E-03	****
3	O	319.96	44.	83.	1.02	596.41	593	9	2.21E-02	41.4
4	O	364.85	64.	75.	1.95	692.00	686	12	3.18E-02	32.5
5	O	661.53	77.	63.	1.00	1323.62	1318	12	3.84E-02	23.3
6	O	795.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1
7	O	810.32	66.	39.	1.30	1640.39	1634	14	3.31E-02	22.1
8	O	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2

7	0	1412.70	271.	40.	1.00	2412.46	2402.	10	1.40E-02	1.2
10	0	1332.44	284.	16.	1.96	2751.99	2743	16	1.42E-01	6.6
11	0	1460.63	118.	0.	1.79	3024.92	3015	18	5.90E-02	10.7
12	0	1764.20	35.	7.	.70	3671.21	3664	13	1.73E-02	21.0

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 2000. (PILE-UP CORRECTED)

PAGE 1

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GM	1-SIGMA ERROR
CR-51	AP	320.03	44.	83.	9.83*	4.127E+00	3.084E -7	1.278E -7
CO-58	AP	810.76	66.	39.	99.40*	2.099E+00	8.736E -8	1.934E -8
CO-60	AP	1173.22	291.	23.	100.00	1.600E+00	4.909E -7	3.522E -8
		1332.49	284.	16.	100.00*	1.457E+00	5.271E -7	3.458E -8
NI-65	AP	366.27	64.	75.	4.61	3.758E+00	3.971E -1	1.291E -1
		1115.52	0.	0.	14.80	0.000E+00	.000E 0	.000E 0
		1481.84	0.	0.	23.50*	0.000E+00	.000E 0	.000E 0

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GM	1-SIGMA ERROR
I-131	HFP	284.30	0.	0.	6.05	0.000E+00	.000E 0	.000E 0
		364.48	64.	75.	81.20*	3.758E+00	6.654E -8	2.163E -8
		636.97	0.	0.	7.26	0.000E+00	.000E 0	.000E 0
		722.89	0.	0.	1.80	0.000E+00	.000E 0	.000E 0

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	JCI / GM	1-SIGMA ERROR
RH-105	FP	306.10	0.	0.	5.13	0.000E+00	.000E 0	.000E 0
		318.90	44.	83.	19.20*	4.127E+00	3.772E -7	1.562E -7
CS-134	FP	563.23	0.	0.	8.38	0.000E+00	.000E 0	.000E 0
		569.32	0.	0.	15.43	0.000E+00	.000E 0	.000E 0
		604.70	0.	0.	97.60*	0.000E+00	.000E 0	.000E 0
		795.85	87.	39.	85.40	2.127E+00	1.299E -7	2.486E -8
		801.93	0.	0.	8.73	0.000E+00	.000E 0	.000E 0
CS-137	FP	661.65	77.	63.	85.12*	2.436E+00	5.998E -8	2.321E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GM	1-SIGMA ERROR
K-40	NP	1460.81	118.	0.	10.67*	1.362E+00	2.191E -6	2.633E -6
RA-226	NP	186.21	34.	111.	3.28	5.814E+00	4.803E -7	2.714E -7
		241.98	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		295.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.72	0.	0.	37.20	0.000E+00	.000E 0	.000E 0
		609.31	0.	0.	46.30*	0.000E+00	.000E 0	.000E 0
		1120.29	0.	0.	15.10	0.000E+00	.000E 0	.000E 0
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	35.	7.	15.80	1.186E+00	4.972E -7	1.044E -7
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0
TH-232	NP	238.63	18.	112.	44.60	5.045E+00	2.133E -8	2.576E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	0.	0.	35.86*	0.000E+00	.000E 0	.000E 0

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 08)

NUCLIDE LINE ACTIVITY REPORT

PAGE 2

ELAPSED LIVE TIME: 2000. (PILE-UP CORRECTED)

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	SABN	SEFF	UC1 / GM	1-SIGMA ERROR
U-235	NP	143.76	0.	0.	10.50	0.000E+00	.000E 0	.000E 0
		185.72	34.	111.	54.00*	5.814E+00	2.917E -8	1.648E -8

NUCLEIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)

UNKNOWN LINE REPORT

PAGE 3

ELAPSED LIVE TIME 2000. (PILE-UP CORRECTED)

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
2	0	238.17	18.	112.	.76	422.29	420	10	8.89E-03	****	5.05E+00
6	0	725.82	87.	39.	1.32	1609.52	1604	12	4.36E-02	19.1	2.13E+00
8	0	1091.86	14.	5.	1.20	2239.81	2236	7	6.93E-03	42.2	1.69E+00
12	0	1764.20	35.	7.	.70	3671.21	3664	13	1.73E-02	21.0	1.19E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI	/GM	ABNDIFF	FAILED
1	RA-226	186.21	1600.00Y	1.000E	0	4.803E -7	12.29%	ABN
2	TH-232	238.63	1.00E+10Y	1.000E	0	2.133E -8	25.03%	ABN
4	Ni-65	366.27	2.52H	4.010E	5	3.971E -1	10.74%	DCY, ABN
6	CS-134	725.85	753.10D	1.002E	0	1.299E -7	39.62%	ABN
12	RA-226	1764.49	1600.00Y	1.000E	0	4.972E -7	12.29%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 4

TOTAL LINES IN SPECTRUM	12
UNIDENTIFIED PEAKS	4
IDENTIFIED IN SUMMARY REPORT	8 66.67%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UC1 /GM	1-SIGMA	ERROR	%ERR
CR-51	AP	27.70D	1.050	3.084E -7	1.278E -7	41.42	
CO-58	AP	70.80D	1.019	8.736E -8	1.934E -8	22.14	
CO-60	AP	1925.00D	1.001	5.271E -7	3.458E -8	6.56	

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UC1 /GM	1-SIGMA	ERROR	%ERR
I-131	HFP	8.04D	1.184	6.654E -8	2.163E -8	32.50	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UC1 /GM	1-SIGMA	ERROR	%ERR
RH-105	FP	35.36H	2.508	3.772E -7	1.562E -7	41.42	
CS-137	FP	30.17Y	1.000	9.998E -8	2.328E -8	23.29	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UC1 /GM	1-SIGMA	ERROR	%ERR
K-40	NP	1.28E+09Y	1.000	2.191E -6	2.338E -7	10.67	
U-235	NP	7.04E+08Y	1.000	2.917E -8	1.648E -8	56.51	

23-FEB-94 09:16:50

CST SAMPLE SPLIT WITH FERMIC AND STATE OF MICHIGAN

SPECTRAL FILE NAME: L940402.FEV

SAMPLE DATE: 21-FEB-94 02:27:00

SAMPLE IDENTIFICATION: 94-040

TYPE OF SAMPLE: LIQUID

SAMPLE QUANTITY: 500.7500 UNITS: GM

SAMPLE GEOMETRY: LMAR500

EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 23-FEB-94 08:04:51 * FWHM(1532) 1.886

PRESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000

ELAPSED REAL TIME: 3601. SEC * SHAPE PARAMETER: 5.0 %

ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

DETECTOR: ORTEC * L. ENERGY LIMIT: 1.35E+00

CALIB DATE: 23-FEB-94 07:16:01 * ENERGY TOLERANCE: 1.500 MEV

KEY/CHAN: 1,697,32 * HALF LIFE RATIO: 8.00

OFFSET: -62.000000 MEV * ABUNDANCE LIMIT: 70.00%

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	238.62	68.	112.	.68	423.25	421	7	1.39E-02	29.9	
2	0	319.95	95.	127.	1.03	596.39	594	8	2.65E-02	23.3	
3	0	364.26	133.	118.	1.76	690.74	684	13	3.68E-02	20.9	
4	0	427.64	60.	81.	1.56	825.66	822	8	1.66E-02	31.3	
5	0	510.98	220.	115.	2.93	1003.10	996	15	6.32E-02	13.8	
6	0	604.27	172.	136.	1.31	1201.71	1196	12	4.78E-02	16.4	
7	0	661.73	184.	75.	1.50	1324.05	1319	13	5.10E-02	13.3	
8	0	795.75	185.	61.	1.44	1609.75	1600	16	5.25E-02	12.3	
9	0	810.45	92.	91.	1.60	1640.67	1634	15	2.55E-02	24.6	
10	0	830.24	32.	27.	1.61	1789.25	1787	7	8.98E-03	34.4	
11	0	1173.01	478	63.	1.61	2412.26	2403	18	1.33E-01	6.1	
12	0	1332.32	478	9.	2.02	2751.73	2741	18	1.33E-01	5.0	
13	0	1460.36	194.	12.	1.65	3025.44	3017	16	5.38E-02	8.7	
14	0	1764.07	69.	10.	1.10	3670.93	3663	14	1.92E-02	13.9	
15	0	2203.86	38.	4.	1.36	4607.26	4599	16	1.06E-02	20.0	
16	0	2614.07	48.	3.	3.48	5480.60	5474	16	1.33E-02	19.1	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000

UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR
1	0	238.62	68.	112.	.68	423.25	421	7	1.89E-02	29.9
2	0	319.95	95.	127.	1.03	596.39	594	8	2.65E-02	23.3
3	0	364.26	133.	118.	1.76	690.74	684	13	3.68E-02	20.9
4	0	427.64	60.	81.	1.56	825.66	822	8	1.66E-02	31.3

		CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE	CHARGE
6	0	604.27	172.	136.	1.31	1201.71	1196	12	4.78E-02	16.4						
7	0	661.73	184.	75.	1.50	1324.05	1319	13	5.10E-02	13.3						
8	0	795.75	189.	61.	1.46	1609.38	1600	16	5.25E-02	12.3						
9	0	810.45	92.	91.	1.60	1640.67	1634	13	2.55E-02	24.6						
10	0	880.24	32.	27.	1.61	1789.25	1787	7	8.98E-03	34.4						
11	0	1173.01	478.	63.	1.61	2412.56	2403	18	1.33E-01	6.1						
12	0	1332.32	478.	9.	2.02	2751.73	2741	18	1.33E-01	5.0						
13	0	1460.86	194.	12.	1.65	3025.41	3017	16	5.33E-02	8.7						
14	0	1764.07	69.	10.	1.10	3670.93	3663	14	1.92E-02	13.9						
15	0	2203.86	58.	4.	1.36	4607.26	4599	16	1.06E-02	20.0						
16	0	2614.07	48.	3.	3.48	5480.60	5474	16	1.33E-02	19.1						

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE UP CORRECTED)

PAGE 1

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	ZALIN	%EFF	UCI / GM	1-SIGMA ERROR
ANIL-511	AP	511.00	228.	113.	26.73*	2.943E+00	6.855E -0	9.478E -1
CR-51	AP	320.08	95.	127.	9.83*	4.127E+00	3.704E -7	8.627E -8
CO-58	AP	810.76	92.	91.	99.49*	2.029E+00	6.735E -8	1.655E -8
CO-60	AP	1173.22	478.	63.	100.00	1.600E+00	4.482E -7	2.725E -8
		1332.49	478.	9.	100.00*	1.457E+00	4.922E -7	2.454E -8

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	ZALIN	%EFF	UCI / GM	1-SIGMA ERROR	
BR-84	HFP	802.20	0.	0.	6.10	0.000E+00	.000E 0	.000E 0	
		881.50	32.	27.	42.00*	1.975E+00	3.201E 19	1.100E 19	
		1015.90	0.	0.	6.20	0.000E+00	.000E 0	.000E 0	
		1097.30	0.	0.	14.90	0.000E+00	.000E 0	.000E 0	
		2484.10	0.	0.	6.30	0.000E+00	.000E 0	.000E 0	
		1-131	284.30	0.	0.	6.05	0.000E+00	.000E 0	.000E 0
		364.48	133	113.	81.20*	3.763E+00	7.705E -8	1.611E -8	
		636.97	0.	0.	6.20	0.000E+00	.000E 0	.000E 0	
		722.89	0.	0.	1.30	0.000E+00	.000E 0	.000E 0	

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	ZALIN	%EFF	UCI / GM	1-SIGMA ERROR	
RH-105	FP	306.10	0.	0.	5.13	0.000E+00	.000E 0	.000E 0	
		318.90	95.	127.	19.20*	4.127E+00	4.548E -7	1.059E -7	
		376.33	0.	0.	6.07	0.000E+00	.000E 0	.000E 0	
		427.89	60.	81.	29.33*	3.331E+00	9.127E -8	2.854E -8	
		463.36	0.	0.	10.50	0.000E+00	.000E 0	.000E 0	
		600.56	0.	0.	17.18	0.000E+00	.000E 0	.000E 0	
		635.70	0.	0.	11.22	0.000E+00	.000E 0	.000E 0	
		CS-134	563.23	0.	0.	5.31	0.000E+00	.000E 0	.000E 0
		569.32	0.	0.	15.43	0.000E+00	.000E 0	.000E 0	
		604.70	172.	156.	27.60*	2.603E+00	1.018E -7	1.666E -8	
CS-137	FP	725.85	189.	61.	35.40	2.127E+00	1.561E -7	1.918E -8	
		801.93	0.	0.	5.73	0.000E+00	.000E 0	.000E 0	

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	ZALIN	%EFF	UCI / GM	1-SIGMA ERROR
K-40	NP	1460.81	194.	12.	10.67*	1.362E+00	2.000E -6	1.745E -7

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 2

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GM	1-01GMA	ERROR
RA-226	NP	186.21	0.	0.	3.28	0.000E+00	.000E 0	.000E 0	C
		241.98	0.	0.	7.49	0.000E+00	.000E 0	.000E 0	C
		295.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0	C
		351.92	0.	0.	37.20	0.000E+00	.000E 0	.000E 0	C
		609.31	0.	0.	46.30*	0.000E+00	.000E 0	.000E 0	C
		1120.29	0.	0.	15.10	0.000E+00	.000E 0	.000E 0	C
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0	C
		1764.49	69.	10.	15.80	1.106E+00	5.517E -7	7.645E -8	C
TH-232	NP	2204.22	38.	4.	4.98	1.007E+00	1.130E -6	2.277E -7	C
		238.63	68.	112.	44.60	5.029E+00	4.536E -8	1.355E -8	C
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0	C
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0	C
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0	C
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0	C
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0	C
U-238	NP	2614.66	45.	3.	35.86*	8.883E-01	2.250E -7	4.265E -8	C
		131.20	0.	0.	20.40*	0.000E+00	.000E 0	.000E 0	C
		152.70	0.	0.	6.80	0.000E+00	.000E 0	.000E 0	C
		569.50	0.	0.	11.00	0.000E+00	.000E 0	.000E 0	C
		880.51	32.	27.	12.24	1.975E+00	2.004E -7	6.865E -8	C
		883.24	0.	0.	12.00	0.000E+00	.000E 0	.000E 0	C
		926.00	0.	0.	11.20	0.000E+00	.000E 0	.000E 0	C
		946.00	0.	0.	12.00	0.000E+00	.000E 0	.000E 0	C

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 3

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	SEFF
1	0	238.62	68.	112.	.68	423.25	421	7	1.89E-02	29.9	5.04E+00
4	0	427.64	60.	81.	1.56	825.66	822	8	1.66E-02	31.3	3.35E+00
5	0	510.98	228.	115.	2.98	1003.10	996	15	6.32E-02	13.8	2.94E+00
10	0	880.24	32.	27.	1.61	1789.25	1787	7	8.98E-03	34.4	1.98E+00
14	0	1764.07	69.	10.	1.10	3670.93	3663	14	1.92E-02	13.9	1.19E+00
15	0	2203.86	38.	4.	1.36	4607.26	4599	16	1.06E-02	20.0	1.01E+00
16	0	2614.07	48.	3.	3.48	5480.60	5474	16	1.33E-02	19.1	8.88E-01

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI	/GM	ABNDIFF	FAILED
1	TH-232	238.63	1.000E+10Y	1.000E	0	4.536E -8	45.15%	ABN
4	SB-125	427.89	2.77Y	1.001E	0	9.127E -8	38.75%	ABN
5	ANIL-511	511.00	109.70M	5.720E	7	6.855E 0	100.00%	DCY
10	BR-84	881.50	31.80M	5.482E	26	3.201E 12	55.26%	DCY, ABN
10	U-238	880.51	1.000E+10Y	1.000E	0	2.004E -7	14.29%	ABN
14	RA-226	1764.49	1600.00Y	1.000E	0	5.517E -7	13.35%	ABN
15	RA-226	2204.22	1600.00Y	1.000E	0	1.138E -6	13.35%	ABN
16	TH-232	2614.06	1.000E+10Y	1.000E	0	2.250E -7	45.15%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 SUMMARY OF NUCLIDE ACTIVITY

PAGE 4

TOTAL LINES IN SPECTRUM	16
UNIDENTIFIED PEAKS	7
IDENTIFIED IN SUMMARY REPORT	9 56.25%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA	ERROR	%ERR
CR-51	AP	27.70D	1.050	3.704E -7	8.627E -8	23.27	
CO-58	AP	70.80D	1.019	6.735E -8	1.655E -8	24.56	
CO-60	AP	1925.00D	1.001	4.222E -7	2.454E -8	4.97	

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA	ERROR	%ERR
I-131	HFP	8.04D	1.184	7.705E -8	1.611E -8	20.91	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA	ERROR	%ERR
RH-105	FP	35.36H	2.512	4.548E -7	1.059E -7	23.27	
CS-134	FP	753.10D	1.002	1.018E -7	1.666E -8	16.36	
CS-137	FP	30.17Y	1.000	1.329E -7	1.767E -8	13.56	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GM	1-SIGMA	ERROR	%ERR
K-40	NP	1.28E+09Y	1.000	2.000E -6	1.745E -7	8.73	

²⁴pp

(3)

Fermi 2 Water issues

Date of analysis: FEB 24, 1994

CST_224.WKS

Volume(gal)= 532980
(l)= 2.018E+06

Flow Rates: (gpm)
Dilution= 15500
CST dchg= 400

Isotope	Eff Conc uCi/ml	Result uCi/ml	Conc./EC	Activity (mCi)
(10CFR20)				
Cr-51	5.000E-04	2.755E-07	5.510E-04	5.558E-01
Mn-54	3.000E-05	0.000E+00	0.000E+00	0.000E+00
Co-58	2.000E-05	6.473E-08	3.237E-03	1.306E-01
Co-60	3.000E-06	4.263E-07	1.421E-01	8.601E-01
I-131	1.000E-06	3.023E-08	3.023E-02	6.099E-02
Cs-134	9.000E-07	1.467E-07	1.630E-01	2.960E-01
Cs-137	1.000E-06	1.680E-07	1.680E-01	3.389E-01
Sr-89	8.000E-06	5.800E-07	7.250E-02	1.170E+00
H-3	1.000E-03	4.800E-04	4.800E-01	9.684E+02
Totals (w/Dilution)		4.817E-04 1.212E-05	1.060E+00 2.566E-02	9.718E+02

D 3

** *** **

** *** **

** *** **

CALCULATES THE DOSE DUE TO
NUCLEAR POWER PLANT
LIQUID

RADIOACTIVE EFFLUENTS

** U. S. NUCLEAR REGULATORY COMMISSION **

**

PC DOSE

LIQUID DOSE CALCULATIONS

**

from

**

NUCLEAR POWER PLANT EFFLUENTS

Rev. 35 01/31/92

**

24-Feb-94

**

FILENAME ??????.WK1
24-Feb

PLANT NAME
I N D I V I D U A L M A X I M U M

Feb-94
04:21 PM

Dilution
ENTER PLANT SPECIFIC DATA

FRESH WATER
Flow Rate = 1.55E+04 g/min
Average Flow During Report Period

Individual Average Consumption(kg/y)

Pathways	Adult	Teen	Child
Water	730	510	510
SportFish	21	16	6.9
SportInvt	5	3.8	1.7

Radioactive Release
WHEN COMPLETED ==> Press ALT E

Flow Rate = 4.00E+02 g/min
Flow Time = 2.30E+01 hr
Report Period = 1.20E+01 mth

Transit Times (hrs)
Drinking Water = 0.01
Fish/Invertebrates = 0.01

Comments:

FILENAME ??????.WK1
24-Feb

PLANT NAME

INDIVIDUAL MAXIMUM

Feb-94
04:21 PM

ENTER RADIOACTIVITY RELEASED FOR EACH RADIONUCLIDE

Nuclide uCi/ml

WHEN COMPLETED =====> Press ALT J

Cr-51	2.76E-07
Co-58	6.47E-08
Co-60	4.26E-07
I-131	3.02E-08
Cs-134	1.47E-07
Cs-137	1.68E-07
Sr-89	5.80E-07
H-3	4.80E-04

WHEN COMPLETED =====> Press ALT J

ADDITIONAL DILUTION FACTORS

Food Consumption Products:

1. Potable Water Near Field =====> Dw = 7.70E+01
2. Sport Fish =====> Dsf = 5.00E+00
3. Sport Invert =====> Dsi = 5.00E+00
4. Commercial Fish =====> Dcf = 5.00E+00
5. Commercial Invert =====> Dci = 5.00E+00

FILENAME ??????.WK1
24-Feb

PLANT NAME
I N D I V I D U A L M A X I M U M

Feb-94
04:21 PM

ADULT TOTAL DOSE RECEIVED PER ORGAN
mrem/ 12.00 mth

Nuclide	Bone	Liver	T.Body	Thyroid	Kidney	Lung	Gi-Lli
Cr-51				1.42E-07	8.46E-08	3.12E-08	1.88E-07
Co-58				1.37E-06	3.07E-06		2.78E-05
Co-60				2.59E-05	5.72E-05		4.87E-04
I-131	6.60E-07	9.45E-07	5.41E-07	3.10E-04	1.62E-06		2.49E-07
Cs-134	5.82E-03	1.38E-02	1.13E-02		4.48E-03	1.49E-03	2.42E-04
Cs-137	8.54E-03	1.17E-02	7.65E-03		3.96E-03	1.32E-03	2.26E-04
Sr-89	2.85E-03		8.18E-05				4.57E-04
H-3		4.84E-05	4.84E-05	4.84E-05	4.84E-05	4.84E-05	4.84E-05

TOTALS 1.72E-02 2.56E-02 1.92E-02 3.58E-04 8.50E-03 2.85E-03 1.53E-03
Bone Liver T.Body Thyroid Kidney Lung Gi-Lli

FILENAME ??????.WK1
24-Feb

PLANT NAME
INDIVIDUAL MAXIMUM

Feb-94
04:21 PM

TEEN TOTAL DOSE RECEIVED PER ORGAN
mrem/ 12.00 mth

Nuclide	Bone	Liver	T.Body	Thyroid	Kidney	Lung	Gi-Lli
Cr-51			1.46E-07	8.09E-08	3.19E-08	2.08E-07	2.45E-05
Co-58		1.36E-06	3.13E-06				1.87E-05
Co-60		2.59E-05	5.83E-05				3.37E-04
I-131	7.00E-07	9.80E-07	5.27E-07	2.86E-04	1.69E-06		1.94E-07
Cs-134	5.96E-03	1.40E-02	6.51E-03		4.46E-03	1.70E-03	1.75E-04
Cs-137	9.14E-03	1.22E-02	4.24E-03		4.14E-03	1.61E-03	1.73E-04
Sr-89	3.09E-03		8.85E-05				3.68E-04
H-3		3.51E-05	3.51E-05	3.51E-05	3.51E-05	3.51E-05	3.51E-05

TOTALS 1.82E-02 2.63E-02 1.09E-02 3.21E-04 8.64E-03 3.35E-03 1.13E-03
Bone Liver T.Body Thyroid Kidney Lung Gi-Lli

FILENAME ??????.WK1
24-Feb

PLANT NAME
INDIVIDUAL MAXIMUM

Feb-94
04:21 PM

CHILD TOTAL DOSE RECEIVED PER ORGAN
mrem/ 12.00 mth

Nuclide	Bone	Liver	T.Body	Thyroid	Kidney	Lung	Gi-Lli
Cr-51			1.60E-07	8.88E-08	2.43E-08	1.62E-07	8.48E-06
Co-58		1.13E-06	3.47E-06				6.62E-06
Co-60		2.20E-05	6.47E-05				1.22E-04
I-131	1.02E-06	1.03E-06	5.85E-07	3.40E-04	1.69E-06		9.16E-08
Cs-134	7.23E-03	1.19E-02	2.50E-03		3.68E-03	1.32E-03	6.39E-05
Cs-137	1.16E-02	1.11E-02	1.63E-03		3.61E-03	1.30E-03	6.93E-05
Sr-89	4.26E-03		1.22E-04				1.65E-04
H-3		5.40E-05	5.40E-05	5.40E-05	5.40E-05	5.40E-05	5.40E-05

TOTALS 2.31E-02 2.30E-02 4.38E-03 3.94E-04 7.34E-03 2.67E-03 4.89E-04
Bone Liver T.Body Thyroid Kidney Lung Gi-Lli

FILENAME ??????.WK1
24-Feb

PLANT NAME
I N D I V I D U A L M A X I M U M

Feb-94
04:21 PM

TOTAL DOSE SUMMARY REPORT
mrem/1.20E+01 mth

Group	Organ	Total
Adult	Bone	1.72E-02
Adult	Liver	2.56E-02
Adult	Tot Body	1.92E-02
Adult	Thyroid	3.58E-04
Adult	Kidney	8.50E-03
Adult	Lung	2.85E-03
Adult	Gi-Lli	1.53E-03
Teen	Bone	1.82E-02
Teen	Liver	2.63E-02
Teen	Tot Body	1.09E-02
Teen	Thyroid	3.21E-04
Teen	Kidney	8.64E-03
Teen	Lung	3.35E-03
Teen	Gi-Lli	1.13E-03
Child	Bone	2.31E-02
Child	Liver	2.30E-02
Child	Tot Body	4.38E-03
Child	Thyroid	3.94E-04
Child	Kidney	7.34E-03
Child	Lung	2.67E-03
Child	Gi-Lli	4.89E-04

mrem/1.20E+01 mth

ORGAN WITH MAXIMUM DOSE

Group	Organ	Total
Teen	Liver	2.63E-02

FILENAME ??????.WK1 PLANT NAME Feb-94
24-Feb INDIVIDUAL MAXIMUM 04:21 PM

FILENAME ??????.WK1
24-Feb

PLANT NAME
I N D I V I D U A L M A X I M U M

Feb-94
04:21 PM

Adult Dose Factors (mrem/pCi) Select Position and Press ENTER

Nuclide	Bone	Liver	T.Body	Thyroid	Kidney	Lung	Gi-Lli
Cr-51			2.66E-09	1.59E-09	5.86E-10	3.53E-09	6.69E-07
Co-58		7.45E-07	1.67E-06				1.51E-05
Co-60		2.14E-06	4.72E-06				4.02E-05
I-131	4.16E-06	5.95E-06	3.41E-06	1.95E-03	1.02E-05		1.57E-06
Cs-134	6.22E-05	1.48E-04	1.21E-04		4.79E-05	1.59E-05	2.59E-06
Cs-137	7.97E-05	1.09E-04	7.14E-05		3.70E-05	1.23E-05	2.11E-06
Sr-89	3.08E-04		8.84E-06				4.94E-05
H-3		1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07

FILENAME ??????.WK1
24-Feb

PLANT NAME

Feb-94
04:21 PM

I N D I V I D U A L M A X I M U M

Teen Dose Factors (mrem/pCi)

Nuclide	Bone	Liver	T.Body	Thyroid	Kidney	Lung	Gi-Lli
Cr-51			3.60E-09	2.0CE-09	7.89E-10	5.14E-09	6.05E-07
Co-58	9.72E-07	2.24E-06					1.34E-05
Co-60	2.81E-06	6.33E-06					3.66E-05
I-131	5.85E-06	8.19E-06	4.40E-06	2.39E-03	1.41E-05		1.62E-06
Cs-134	8.37E-05	1.97E-04	9.14E-05		6.26E-05	2.39E-05	2.45E-06
Cs-137	1.12E-04	1.49E-04	5.19E-05		5.07E-05	1.97E-05	2.12E-06
Sr-89	4.40E-04		1.26E-05				5.24E-05
H-3		1.06E-07	1.06E-07	1.06E-07	1.06E-07	1.06E-07	1.06E-07

FILENAME ????????.WK1
24-Feb I N

PLANT NAME

Feb-94

24-Feb

INDIVIDUAL MAXIMUM

04:21 PM

Child Dose Factors (mrem/pCi)

***** 24-FEB-94 15:03:33 *****

FERMI 2 CST PRE DISCHARGE SAMPLE.

STRAL FILE NAME: L940421.FEV
FILE DATE: 24-FEB-94 12:52:00
SAMPLE IDENTIFICATION: L940421.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 584.1000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 24-FEB-94 13:39:12 * FWHM(1732) 1.886
ACQ. TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 3601. SEC * SHAPE PARAMETER: 5.0 2
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
SLAB DATE: 23-FEB-94 07:25:01 * ENERGY TOLERANCE: 1.00 KEY
FCNL: .467716 * HALF LIFE RATIO: 6.00
SUBSET: 59.8222500 KEY * ABUNDANCE LIMIT: 70.000

ENERGY WINDOW 40.29 TC 2253.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	74.66	73.	244.	.72	74.16	70	10	2.02E-02	41.0	
2	0	92.45	70.	210.	.82	112.05	107	10	1.94E-02	41.0	
3	0	288.56	55.	72.	1.29	529.56	527	7	1.53E-02	31.7	
4	0	319.90	67.	177.	1.33	596.45	590	12	2.41E-02	33.5	
5	0	364.68	71.	142.	.96	691.63	687	11	1.99E-02	35.7	
6	0	427.46	123.	150.	1.74	825.28	818	17	3.41E-02	26.1	
7	0	510.92	205.	161.	2.34	1002.98	997	16	5.69E-02	15.6	
8	0	569.56	42.	82.	1.16	1127.83	1124	10	1.16E-02	43.8	
9	0	604.69	290.	149.	1.13	1202.61	1196	14	8.05E-02	11.5	
10	0	661.67	271.	85.	1.47	1323.93	1315	18	7.53E-02	10.0	
11	0	725.95	238.	51.	1.49	1609.31	1602	16	6.60E-02	9.7	
12	0	810.60	105.	77.	1.56	1641.00	1634	14	2.92E-02	20.0	
13	0	1173.43	566.	54.	1.59	2413.45	2404	17	1.57E-01	5.5	
14	0	1332.67	507.	21.	1.95	2752.53	2744	15	1.41E-01	4.8	
15	0	1460.85	236.	18.	1.65	3025.38	3016	17	6.57E-02	8.1	
16	0	1764.87	42.	9.	1.38	3672.64	3666	13	1.18E-02	24.0	
17	0	2615.42	50.	17.	2.56	5483.48	5478	11	1.40E-02	20.3	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR
1	0	74.66	73.	244.	.72	74.16	70	10	2.02E-02	41.0
2	0	92.45	70.	210.	.82	112.05	107	10	1.94E-02	41.0
3	0	288.56	55.	72.	1.29	529.56	527	7	1.53E-02	31.7

		749.98	93.	133.	142.	.96	691.63	687	11	1.99E-02	35.7
5	0	364.68	71.	123.	150.	1.74	825.28	818	17	3.41E-02	26.1
6	0	427.46		205.	161.	2.34	1002.98	997	16	5.69E-02	15.6
7	0	510.92	42.		82.	1.16	1127.83	1124	10	1.16E-02	43.8
8	0	569.56	290.		149.	1.13	1202.61	1196	14	8.05E-02	11.5
9	0	604.69									
10	0	661.67	271.		85.	1.47	1323.93	1315	18	7.53E-02	10.0
11	0	795.95	238.		51.	1.49	1609.81	1602	16	6.60E-02	9.7
12	0	810.60	105.		77.	1.56	1641.00	1634	14	2.92E-02	20.0
13	0	1173.43	566.		54.	1.59	2413.45	2404	17	1.57E-01	5.5
14	0	1332.69	507.		21.	1.95	2752.53	2744	15	1.41E-01	4.8
15	0	1460.85	236.		18.	1.65	3025.38	3016	17	6.57E-02	8.1
16	0	1764.37	42.		9.	1.38	3672.64	3666	13	1.18E-02	24.0
17	0	2615.42		50.	17.	2.56	5483.48	5478	11	1.40E-02	20.3

FILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	205.	161.	96.73*	2.943E+00	1.496E -7	2.337E -8
CR-51	AP	320.08	87.	177.	9.83*	4.127E+00	2.755E -7	9.244E -8
CO-58	AP	810.76	105.	77.	99.40*	2.099E+00	6.473E -8	1.292E -8
CO-60	AP	1173.22	360.	54.	100.00	1.600E+00	4.550E -7	2.494E -8
		1332.49	207.	21.	100.00*	1.457E+00	4.474E -7	2.158E -8

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
Br-81	HFP	234.70	0.	0.	6.05	0.000E+00	.000E 0	.000E 0
		364.48	72.	142.	81.20*	3.760E+00	3.023E -8	1.080E -8
		636.97	0.	0.	7.26	0.000E+00	.000E 0	.000E 0
		722.89	0.	0.	1.80	0.000E+00	.000E 0	.000E 0

ISOTOPIC PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
H-105	FP	306.10	0.	0.	5.13	0.000E+00	.000E 0	.000E 0
		318.90	37.	177.	19.20*	4.127E+00	1.445E -7	4.847E -8
SB-125	FP	176.33	0.	0.	6.89	0.000E+00	.000E 0	.000E 0
		427.89	12.	150.	29.33*	3.352E+00	1.606E -7	4.200E -8
		463.38	0.	0.	10.35	0.000E+00	.000E 0	.000E 0
		600.56	0.	0.	17.80	0.000E+00	.000E 0	.000E 0
		635.90	0.	0.	11.32	0.000E+00	.000E 0	.000E 0
-134	FP	563.23	0.	0.	8.30	0.000E+00	.000E 0	.000E 0
		569.32	42.	82.	13.43	2.718E+00	1.284E -7	5.922E -8
		607.70	0.	142.	97.60*	2.602E+00	1.467E -7	1.682E -8
		795.85	38.	51.	85.10	2.127E+00	1.681E -7	1.628E -8
		801.93	0.	0.	8.73	0.000E+00	.000E 0	.000E 0
SB-137	FP	661.65	37.	85.	85.12*	2.436E+00	1.600E -7	1.687E -8
U-147	FP	91.11	70.	210.	28.00*	4.568E+00	7.055E -8	2.824E -8
		531.02	0.	0.	13.10	0.000E+00	.000E 0	.000E 0

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	236.	18.	10.67*	1.362E+00	2.021E -6	1.684E -7
RA-226	NP	186.21	0.	0.	3.28	0.000E+00	.000E 0	.000E 0
		241.98	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		295.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.92	0.	0.	37.20	0.000E+00	.000E 0	.000E 0
		609.31	0.	0.	46.30*	0.000E+00	.000E 0	.000E 0
		1120.29	0.	0.	15.10	0.000E+00	.000E 0	.000E 0
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.47	42.	9.	15.80	1.185E+00	2.215E -7	6.923E -8
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 2

TURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA
							gram	ERROR
TH-232	NP	238.63	0.	0.	44.60	0.000E+00	.000E 0	.000E 0
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.56	0.	17.	35.86*	8.87E-01	2.037E -7	4.133E -8
U-238	NP	238.20	0.	0.	20.40*	0.000E+00	.000E 0	.000E 0
		152.70	0.	0.	6.80	0.000E+00	.000E 0	.000E 0
		369.50	42.	82.	11.00	2.713E+00	1.800E -7	7.825E -8
		860.71	0.	0.	12.24	0.000E+00	.000E 0	.000E 0
		883.24	0.	0.	12.00	0.000E+00	.000E 0	.000E 0
		726.00	0.	0.	11.20	0.000E+00	.000E 0	.000E 0
		946.00	0.	0.	12.00	0.000E+00	.000E 0	.000E 0

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 3

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF	
1	0	74.66	73.	244.	.72	74.16	70	10	2.02E-02	41.0	2.93E+00
2	0	92.45	70.	210	.82	112.05	107	10	1.94E-02	41.0	4.57E+00
3	0	288.56	55.	72.	1.29	529.56	527	7	1.53E-02	31.7	4.44E+00
6	0	427.46	123.	150.	1.74	825.28	818	17	3.41E-02	26.1	3.35E+00
16	0	1764.87	42.	9.	1.38	3672.64	3666	13	1.18E-02	24.0	1.19E+00
17	0	2615.42	50.	17.	2.56	5483.48	5478	11	1.40E-02	20.5	8.89E-01

INES NOT MEETING SUMMARY CRITERIA

PK	NUCL IDE	ENERGY	HLFE	DECAY	UCI	/gram	ABNDLIF	FATLES
2	ND-147	91.11	10.98D	1.003E	0	7.055E -8	68.13%	ABN
6	SB-125	427.39	2.77Y	0.000E	0	1.606E -7	38.15%	ABN
8	U-238	569.50	1.00E+10Y	1.000E	0	1.800E -7	12.84%	ABN
16	RA-226	1764.49	1600.00Y	0.000E	0	2.715E -7	10.17%	ABN
17	TH-232	2614.66	1.00E+10Y	0.000E	0	2.037E -7	20.12%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 4

TOTAL LINES IN SPECTRUM	17
IDENTIFIED PEAKS	6
ENTIFIED IN SUMMARY REPORT	11
	64.71%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	1.612	1.496E -7	2.337E -8	15.62	
CR-51	AP	27.70D	1.001	2.755E -7	9.244E -8	33.55	
CO-58	AP	70.80D	1.001	6.473E -8	1.222E -8	19.96	
CO-60	AP	1925.00D	1.000	4.474E -7	1.158E -8	4.82	

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
I-131	HFP	8.04D	1.005	3.023E -8	1.030E -8	35.72	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
RH-105	FP	35.35M	1.024	1.445E -7	4.847E -8	33.55	
Zr-134	FP	753.10D	1.000	1.467E -7	1.689E -8	11.51	
OS-137	FP	30.17Y	1.000	1.680E -7	1.687E -8	10.04	

METALLURICAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
K-40	NP	1.28E+02Y	1.000	2.021E -6	1.684E -7	8.05	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BK'	ENERGY	MINIMUM UCI /gram
NA-22	112.	477.59	1.8594E-07
NA-24	35.	1274.54	2.4788E-08
CL-38	33.	1368.53	2.7078E-08
AR-41	8.	2167.51	0.0000E+00
SC-46	24.	1293.64	3.4130E-08
IN-54	61.	1120.51	2.9303E-08
MN-56	53.	846.75	5.1133E-08
FE-59	42.	1029.22	4.2452E-08
CO-57	150.	122.96	1.3976E-08
NI-65	7.	1481.54	1.5363E-08
CU-64	24.	1345.76	4.7074E-06
ZN-65	68.	1115.52	6.0742E-03
ZN-69M	97.	438.53	1.9004E-08
AS-76	87.	559.20	4.4266E-08
SZ-75	123.	264.55	2.4819E-08
MR-82	35.	554.22	2.7292E-08
BP-84	76.	831.50	3.4881E-07
KR-85	144.	513.19	5.3808E-06
KR-85M	167.	151.18	2.1062E-08
KR-87	101.	407.53	6.5961E-08
KR-88	149.	196.32	6.6614E-08
RB-88	16.	1336.01	2.0687E-06
SR-89	55.	1031.88	1.4436E-06
SR-85	144.	513.29	2.3321E-08
SR-85M	158.	231.69	3.9189E-08
SR-91	68.	1024.50	9.7740E-08
SR-92	17.	1383.74	2.8496E-08
Y-88	16.	1836.01	1.2041E-03
Y-91	38.	1204.20	8.1665E-06
Y-91MD	88.	555.57	2.2121E-08
Y-92	81.	934.46	2.7337E-07
Y-93	134.	266.20	2.4645E-07
ZR-95	71.	756.72	4.0621E-08
ZR-97	41.	743.56	1.9035E-08
NB-94	59.	702.63	1.8912E-08
NB-95	74.	765.79	2.3268E-08
NB-97D	69.	1024.50	2.8439E-06
MO-90	131.	257.34	2.2601E-08
MO-99	62.	739.58	1.6225E-07
TC-99MD	130.	140.51	1.4835E-08
RU-103	67.	497.08	1.7331E-08
RU-105	42.	724.50	4.1165E-08
RU-106	84.	621.84	2.0665E-07
AG-110M	65.	657.75	1.9690E-08
CD-109	131.	88.03	4.0853E-07
SN-113	116.	391.69	2.6276E-08
SB-122	84.	563.93	2.7161E-08
SB-124	221.	602.71	3.2872E-08
SB-125	197.	427.89	6.0571E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

CLIDE	BKG	ENERGY	MINIMUM UCI /gram
TE-123M	182.	158.99	1.5922E-08
TE-132	142.	228.16	1.6154E-08
I-132	50.	667.69	2.4667E-08
I-133	105.	529.87	2.4431E-08
I-134	55.	847.03	6.4365E-08
I-135	21.	1260.41	7.5976E-08
XE-131M	166.	163.93	6.5023E-07
XE-133	105.	80.99	4.3748E-08
XE-135M	175.	233.22	1.5747E-07
XE-135	129.	269.79	1.7878E-08
XE-135M	65.	526.56	6.3660E-07
XE-136	134.	258.31	2.1352E-06
CC-134M	160.	127.12	1.3159E-07
CC-136	77.	818.50	2.5480E-08
CC-138	21.	1433.56	1.4538E-07
BE-133	121.	356.00	2.7602E-08
BA-139	177.	165.35	1.4631E-07
BA-140	73.	531.52	6.8261E-08
BA-141	154.	170.22	4.8233E-07
BA-140	21.	1592.45	2.4311E-08
CE-139	177.	165.35	1.6317E-03
CE-141	166.	145.42	2.7005E-08
CE-143	93.	293.26	3.3185E-08
CE-144	162.	133.54	1.1865E-07
CE-147	132.	21.11	5.1645E-08
CE-147	99.	344.27	5.5740E-08
CD-134	35.	1274.45	6.9776E-08
HF-131	88.	482.03	2.0884E-08
Al-26	102.	472.53	3.2211E-08
IC-133	115.	279.19	1.9133E-08
Pa-234	84.	609.31	4.3130E-08
Th-232	73.	2614.66	0.0000E+00
T-235	195.	135.72	2.6024E-08
U-232	151.	131.20	6.0181E-08
NP-239	170.	106.13	6.0522E-08
Am-241	87.	59.54	1.0872E-07

***** 24-FEB-94 15:05:43 *****

FERMI 2 CST PRE DISCHARGE SAMPLE.

CTR AL FILE NAME: L940421.FEV
SAMPLE DATE: 24-FEB-94 12:52:00
SAMPLE IDENTIFICATION: L940421.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 584.1000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 24-FEB-94 11:39:12 * FWHM(1332) 1.886
RESET TIME(LIVE): 3.00. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 36.01. SEC * SHAPE PARAMETER: 5.0 %
ELAPSED LIVE TIME: 36.01. SEC * NBR ITERATIONS: 10.

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 02:26.01 * ENERGY TOLERANCE: 5.000 KEV
KEY/CHNL: .4697016 * HALF LIFE RATIO: 5.00
OFFSET 39.8232300 KEV * ABUNDANCE LIMIT: 0.00%

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTC/SEC	SERR	FIT
1	0	74.66	73.	244.	.72	74.16	70	10	2.02E-02	41.0	
2	0	92.45	70.	210.	.82	112.05	107	10	1.94E-02	41.0	
3	0	288.56	55.	72.	1.29	529.56	527	7	1.53E-02	31.7	
4	0	319.98	87.	177.	1.33	596.45	590	12	2.41E-02	23.5	
5	0	364.68	71.	142.	.96	691.63	637	11	1.29E-02	35.7	
6	0	427.46	123.	150.	1.74	825.28	818	17	3.41E-02	26.1	
7	0	510.92	205.	161.	2.34	1002.98	997	16	5.69E-02	15.6	
8	0	569.56	42.	82.	1.16	1127.83	1124	10	1.16E-02	43.8	
9	0	604.69	290.	149.	1.13	1202.61	1196	14	8.05E-02	11.5	
10	0	661.67	271.	85.	1.47	1323.93	1315	18	7.53E-02	10.0	
11	0	725.95	233.	51.	1.49	1609.31	1602	10	0.60E-02	9.7	
12	0	810.00	105.	77.	1.56	1641.00	1634	14	2.92E-02	20.0	
13	0	1173.43	566.	54.	1.59	2413.45	2404	17	1.57E-01	5.5	
14	0	1332.69	507.	21.	1.95	2752.53	2744	15	1.41E-01	4.8	
15	0	1460.85	236.	18.	1.65	3025.38	3016	17	6.57E-02	8.1	
16	0	1764.87	42.	?	1.38	3672.64	3666	13	1.18E-02	24.0	
17	0	2615.42	50.	17.	2.56	5483.48	5473	11	1.40E-02	20.3	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTC/SEC	SERR	FIT
1	0	74.66*	6.	244.	72	74.16	70	10	1.58E-03	***	

UNIDENTIFIED PEAKS

	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
4	0	74.66	6.	244.	.72	74.16	70	10	1.58E-03	****	2.93E+00
2	0	92.45	70.	210.	.82	112.05	107	10	1.94E-02	41.0	4.57E+00
3	0	288.56	55.	72.	1.29	529.56	527	7	1.53E-02	31.7	4.44E+00
	6	0	427.46	123.	150.	825.28	818	17	3.41E-02	26.1	3.35E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	SLFE	DECAY	UCI	/gram	ABNDIFF	FAILED
2	ND-147	91.11	19.98E	1.003E	0	7.055E	68.13%	ABN
6	SB-145	427.89	2.77Y	1.000E	0	1.600E	38.75%	ABN
8	SB-23	560.50	1.00E+10Y	1.000E	0	1.800E	12.84%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION , DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 2

TOTAL LINES IN SPECTRUM	15
IDENTIFIED PEAKS	4
NTIFIED IN SUMMARY REPORT	11 73.33%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	1.619	8.797E -9	3.328E -8	378.32	
CR-54	AP	27.70D	1.001	2.755E -7	9.244E -8	33.55	
CO-58	AP	70.80D	1.001	6.473E -8	1.292E -8	19.26	
CO-60	AP	1925.00D	1.000	4.263E -7	2.364E -8	5.54	

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
I-131	HFP	8.04D	1.005	3.023E -8	1.080E -8	31.72	

ISOCOPN PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
CS-131	FP	35.36H	1.026	1.445E -7	4.347E -8	31.55	
CS-134	FP	753.10D	1.000	1.467E -7	1.609E -8	11.51	
CS-137	FP	30.17Y	1.000	1.680E -7	1.637E -8	10.04	

ARTIFICAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
R-90	NP	1.28E+02Y	1.000	2.963E -7	2.224E -7	75.07	

19pp

25-FEB-94 01:10:55

FERMI CST AT 4 HOURS INTO DISCHARGE. FIRST DISCHARGE SAMPLE.

CTRAL FILE NAME: L940461.FEV
 PLE DATE: 24-FEB-94 23:27:00
 SAMPLE IDENTIFICATION: L940461.FEV
 TYPE OF SAMPLE: CST DISCHARGE
 SAMPLE QUANTITY: 527.4000 UNITS: gram
 SAMPLE GEOMETRY LMAR500
 EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DT: 25-FEB-94 00:08:24 * FWHM(1332) 1.860
 PRESET TIME/LIVE: 3600 SEC * SENSITIVITY: 1.000
 ELAPSED REAL TIME: 3601 SEC * SHAPE PARAMETER: 5.01
 ELAPSED CPU TIME: 3600 SEC * MBR ITERATIONS: 10

DETECTOR: 107-0 * LIBRARY: MASTER.LIB
 CALIBR. DAT: 23-FEB-94 07:26:02 * ENERGY TOLERANCE: 1.500 KEV
 ENERGY CHNE: 4657016 * HALF-LIFE RATE: 3.00
 DT: SEC: 3600 * ABUNDANCE: 1.00 70.00%

ENERGY WINDOW: 40.29 - 0 2353.05

PK. ID	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTC/SEC	SERR	F1
1 0	320.14	106.	133.	1.03	596.79	592	11	2.95E-02	23.9	
2 0	364.28	46.	102.	1.55	690.76	686	8	1.28E-02	41.5	
3 0	427.31	62.	153.	1.02	826.02	812	13	1.73E-02	43.3	
4 0	441.22	285.	70.	2.51	1003.61	995	20	7.93E-02	11.5	
5 0	562.47	66.	36.	1.93	1127.62	1120	3	1.83E-02	24.1	
6 0	604.54	256.	153.	1.52	1202.29	1196	12	7.11E-02	12.0	
7 0	611.67	268.	72.	1.23	1323.82	1312	10	7.43E-02	13.4	
8 0	725.53	156	81.	1.72	1608.92	1606	11	4.35E-02	14.9	
9 0	810.37	95.	57.	1.37	1641.57	1637	9	2.64E-02	16.8	
10 0	1173.20	532.	42.	1.63	2412.97	2406	15	1.48E-01	5.3	
11 0	1223.61	308.	27.	2.05	2752.46	2743	13	1.41E-01	5.3	
12 0	1460.29	213.	31.	1.51	3025.63	3020	15	5.92E-02	10.0	
13 0	1764.52	57.	9.	2.06	3672.11	3665	13	1.03E-02	23.7	
14 0	2626.74	40	12.	2.46	4832.46	5474	16	1.12E-02	22.8	

PEAK SEARCH COMPLETED (REV 15.2 - ND PC VERSION NOV 80)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
 UNCORR. LIVE TIME: 3600 CORRECTED LIVE TIME: 3600

PK. ID	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTC/SEC	SERR
1 0	320.14	106.	133.	1.03	596.79	592	11	2.95E-02	23.9
2 0	364.28	46.	102.	1.55	690.76	686	8	1.28E-02	41.5
3 0	427.31	62.	153.	1.02	826.02	812	13	1.73E-02	43.3
4 0	441.22	285.	70.	2.51	1003.61	995	20	7.93E-02	11.5
5 0	562.47	66.	36.	1.93	1127.62	1124	3	1.83E-02	24.1
6 0	604.54	256.	153.	1.52	1202.29	1196	12	7.11E-02	12.0

8	0	795.53	156.	81.	1.72	1608.92	1606	11	4.35E-02	14.9
9	0	810.87	95.	37.	1.37	1641.57	1637	9	2.64E-02	16.8
10	0	1173.20	532.	49.	1.63	2412.97	2406	15	1.48E-01	5.3
11	0	1332.61	508.	27.	2.05	2752.36	2743	18	1.41E-01	5.3
12	0	1460.99	213.	31.	1.51	3025.69	3020	15	5.92E-02	10.0
13	0	1764.62	37.	9.	2.06	3672.11	3665	13	1.03E-02	23.7
14	0	2614.94	40.	12.	2.46	5482.46	5474	16	1.12E-02	22.8

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88) •
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

NUCLIDE DIVISION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	285.	98.	96.73*	2.942E+00	2.228E -7	2.569E -8
CR-51	AP	320.08	106.	133.	9.83*	4.126E+00	3.726E -7	8.889E -8
CO-58	AP	810.76	95.	37.	99.40*	2.098E+00	6.478E -8	1.087E -8
CO-60	AP	1173.22	532.	42.	100.00	1.600E+00	4.730E -7	2.504E -8
		1332.42	508.	27.	100.00*	1.457E+00	4.260E -7	2.651E -8

NUCLIDE FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
(+/-)	HFP	284.30	0.	0.	6.05	0.000E+00	0.000E 0	0.000E 0
		364.48	46.	102.	81.20*	3.763E+00	2.150E -8	8.927E -9
		636.97	0.	0.	7.26	0.000E+00	0.000E 0	0.000E 0
		722.89	0.	0.	1.80	0.000E+00	0.000E 0	0.000E 0

NUCLIDE Fission PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
Am-105	FP	306.10	0.	0.	5.13	0.000E+00	0.000E 0	0.000E 0
		318.90	106.	133.	19.20*	4.126E+00	1.950E -7	4.653E -8
Br-125	FP	176.33	0.	0.	6.89	0.000E+00	0.000E 0	0.000E 0
		427.89	62.	153.	29.33*	3.750E+00	2.012E -8	3.250E -8
		463.38	0.	0.	10.35	0.000E+00	0.000E 0	0.000E 0
		600.56	0.	0.	17.80	0.000E+00	0.000E 0	0.000E 0
		635.90	0.	0.	11.32	0.000E+00	0.000E 0	0.000E 0
Eu-151	FP	563.23	0.	0.	8.38	0.000E+00	0.000E 0	0.000E 0
		567.32	0.	36.	15.43	2.712E+00	2.240E -7	5.409E -8
		704.70	256.	153.	27.60*	2.002E+00	1.435E -7	1.718E -8
		725.35	150.	81.	35.40	2.128E+00	1.236E -7	1.832E -8
		801.93	0.	0.	8.73	0.000E+00	0.000E 0	0.000E 0
Cs-137	FP	661.65	268.	72.	85.12*	2.436E+00	1.038E -7	1.549E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	213.	31.	10.67*	1.362E+00	2.067E -6	7.090E -7
Ra-226	NP	186.21	0.	0.	3.28	0.000E+00	0.000E 0	0.000E 0
		241.98	0.	0.	7.42	0.000E+00	0.000E 0	0.000E 0
		295.21	0.	0.	19.20	0.000E+00	0.000E 0	0.000E 0
		351.92	0.	0.	37.20	0.000E+00	0.000E 0	0.000E 0
		609.31	0.	0.	46.30*	0.000E+00	0.000E 0	0.000E 0
		1120.29	0.	0.	15.10	0.000E+00	0.000E 0	0.000E 0
		1238.11	0.	0.	5.94	0.000E+00	0.000E 0	0.000E 0
		1764.49	37.	9.	15.80	1.035E+00	2.831E -7	6.629E -8
		2204.22	0.	0.	4.98	0.000E+00	0.000E 0	0.000E 0

URAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA	ERROR
TH-232	NP	238.63	0.	0.	44.60	0.000E+00	.000E 0	.000E 0	
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0	
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0	
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0	
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0	
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0	
		2614.66	10	12.	75.36*	8.381E-01	1.200E -7	4.097E -8	
	NP	131.20	0.	0.	20.40*	0.000E+00	.000E 0	.000E 0	
		152.70	0.	0.	6.00	0.000E+00	.000E 0	.000E 0	
		569.50	0.	36.	11.00	2.719E+00	3.142E -7	7.586E -8	
		880.31	0.	0.	12.24	0.000E+00	.000E 0	.000E 0	
		883.24	0.	0.	12.00	0.000E+00	.000E 0	.000E 0	
		926.00	0.	0.	11.20	0.000E+00	.000E 0	.000E 0	
		946.00	0.	0.	12.00	0.000E+00	.000E 0	.000E 0	

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88) *
UNKNOWN LINE REPORT PAGE 3
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

IDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF	
3	0	427.81	62.	153.	1.09	826.02	819	13	1.73E-02	43.8	3.35E+00
13	0	1764.62	37.	?	2.06	3672.11	3665	13	1.03E-02	23.7	1.19E+00
14	0	2614.94	40.	12.	2.46	5482.46	5474	16	1.12E-02	22.8	8.88E-01

LINE(S) NOT MEETING SUMMARY CRITERIA

PK NUCLIDE	ENERGY	HLFE	DECAY	UCI /gram	ABNDIFF	FAILED	
U-235	427.89	2.77%	1.000E	0	9.012E -8	38.75%	ABN
U-238	569.50	1.0E+10Y	1.000E	0	5.142E -7	12.34%	ABN
U-226	1764.49	1.0E+10Y	1.000E	0	2.831E -7	10.17%	ABN
Th-232	2614.66	1.0E+10Y	1.000E	0	1.800E -7	20.12%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 4

TOTAL LINES IN SPECTRUM	14
IDENTIFIED PEAKS	3
NTIFIED IN SUMMARY REPORT	11
	78.57%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	2ERR
ANIL-511	AP	102.70M	1.561	2.228E -7	2.562E -8	11.53
CR-51	AP	27.70D	1.001	3.726E -7	3.889E -8	22.86
CO-58	AP	70.70D	1.000	6.478E -8	1.087E -8	16.78
CO-60	AP	1925.00D	1.000	4.960E -7	2.653E -8	5.35

HALOGEN FISSION PRODUCT

NUCLIDE	SDHR	HLIFE	DECAY	UCI /gram	1-SIGMA	2ERR
I-131	HFP	3.04D	1.001	2.150E -8	2.227E -9	41.52

FISSION PRODUCT

NUCLIDE	SDHR	HLIFE	DECAY	UCI /gram	1-3 SIGMA	2ERR
RH-105	FP	35.36D	1.002	1.950E -7	2.653E -8	23.36
CS-134	FP	753.10D	1.000	1.435E -7	2.713E -8	11.98
CS-137	FP	30.17Y	1.000	1.938E -7	1.549E -8	8.43

MATERIAL PRODUCT

NUCLIDE	SDHR	HLIFE	DECAY	UCI /gram	1-3 SIGMA	2ERR
K-40	NP	1.23E+02Y	1.000	2.007E -6	2.070E -7	10.01

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

IDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	75.	477.59	1.6850E-07
NA-22	26.	1274.54	2.3661E-08
NA-24	45.	1368.53	3.4864E-08
CL-38	8.	2167.51	0.0000E+00
AR-41	27.	1293.54	3.8705E-08
SC-46	73.	1120.51	3.5501E-08
MN-54	95.	834.53	3.1826E-08
MN-56	72.	846.55	3.9157E-08
FE-59	43.	1029.52	4.7569E-08
CO-57	171.	122.56	1.6527E-08
NI-65	18.	1481.54	1.3033E-07
CU-64	29.	1341.50	5.7007E-06
ZN-65	57.	1115.52	6.1590E-08
ZN-69M	102.	438.53	2.1477E-08
AS-76	31.	559.50	4.7184E-08
SE-75	133.	264.55	2.8582E-08
BR-82	72.	554.52	2.9085E-08
BR-114	64.	381.50	3.1241E-07
KR-85	126.	513.52	5.5744E-06
KR-85M	154.	151.58	2.2068E-08
KR-87	98.	402.58	6.8266E-08
KR-88	137.	196.52	6.9093E-08
RE-88	20.	1836.01	2.0437E-06
RE-89	58.	1031.58	1.2655E-06
RE-85	126.	513.52	2.4159E-03
SI-85M	133.	231.59	3.7524E-08
SR-91	51.	1024.50	9.3036E-08
SR-92	30.	1383.54	4.0901E-08
Y-93	20.	1836.51	2.7271E-08
Y-91	42.	1204.50	9.5082E-06
Y-91MD	34.	555.57	2.3768E-08
Y-92	73.	934.46	2.8203E-07
Y-93	117.	266.50	2.5336E-07
ZR-95	77.	756.72	4.6849E-08
ZR-97	54.	743.56	2.4098E-08
NB-94	59.	702.53	2.0945E-08
NB-95	75.	765.79	2.5941E-08
NB-97D	49.	1024.50	2.6437E-06
MO-90	135.	257.54	2.5112E-08
MO-99	67.	739.58	1.8661E-07
TC-99HD	148.	140.51	1.4883E-08
RU-103	87.	497.08	2.1870E-08
RU-105	55.	724.50	5.1390E-08
RU-106	67.	621.54	2.0440E-07
AG-110M	75.	657.75	2.3424E-08
CD-109	132.	88.03	4.5417E-07
SN-113	117.	391.69	2.9225E-08
122	103.	563.93	3.3275E-08
124	244.	602.71	3.8252E-08
125	164.	427.89	6.1417E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM
			UCI /gram
123M	149.	158.99	1.5955E-08
132	147.	228.16	1.8188E-08
I-132	73.	667.69	3.2061E-08
I-133	84.	529.87	2.4123E-08
I-134	71.	347.03	7.5033E-08
I-135	36.	1260.41	1.0906E-07
XE-131M	159.	163.93	7.0463E-07
XE-133	116.	80.99	5.0898E-08
XE-135M	134.	233.22	1.5241E-07
XE-135	151.	249.79	2.1265E-08
XE-135M	74.	526.56	5.7703E-07
XE-136	116.	258.31	1.6554E-06
CS-134M	177.	127.42	1.4978E-07
CS-136	65.	818.56	2.5921E-08
CS-138	30.	1435.86	1.6986E-07
BA-133	113.	356.00	2.9542E-08
BA-137	151.	165.35	1.4506E-07
RA-138	78.	537.31	7.8129E-08
RA-141	134.	190.22	3.2237E-07
LA-140	14.	1526.49	2.1947E-08
CE-143	151.	165.35	1.6671E-08
CE-144	152.	145.44	2.8681E-08
CE-145	115.	293.26	4.0786E-07
CE-144	165.	133.54	1.3262E-07
CE-147	110.	91.11	5.2129E-08
CE-148	91.	344.27	5.9186E-08
CO-144	26.	1274.45	6.6605E-08
Hf-183	76.	482.03	2.1493E-08
W-183	71.	479.53	7.5750E-08
Hg-193	118.	279.19	2.1463E-08
RA-196	116.	602.31	5.6133E-08
TH-232	52.	2614.66	0.0000E+00
U-232	189.	185.72	2.8375E-08
U-233	157.	131.20	6.7962E-08
NP-239	169.	106.13	6.6752E-08
AM-241	103.	59.54	1.3101E-07

25-FEB-94 01:13:40 *****

FERMI CST AT 4 HOURS INTO DISCHARGE. FIRST DISCHARGE SAMPLE.

*Background
Subtracted*

SPECTRAL FILE NAME: L940461.FEV
SAMPLE DATE: 24-FEB-94 23:27:00
SAMPLE IDENTIFICATION: L940461.FEV
TYPE OF SAMPLE: CST DISCHARGE
SAMPLE QUANTITY: 527.4000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

* * * * *

ACQUISITION DATE: 25-FEB-94 01:08:24 * FWHM(1332) 1.886
RESET TIME(LIVE): 0.00 SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 36.1. SEC * SHAPE PARAMETER 5.0 %
ELAPSED LIVE TIME: 36.0. SEC * NEIR ITERATIONS: 10.
*

* * * * *

DETECTION: ORTEC * LIBRARY:MASTER.LIB
ACQ. DATE: 25-FEB-94 0 26:01 * ENERGY TOL RANGE 1.000 KEY
LIVETIME: 36.0.469701 * HALF LIFE RATIO 1.00
PFBT: 39.8232300 V * QUADRANCE LIMIT 70.000
*

ENERGY WINDOW 40.29 TO 2858.07

PK IT	ENERGY	AREA	B/GND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	BER%	FIT%
1 0	320.14	106.	133.	1.03	596.79	592	1.	2.25E-02	25.2	
2 0	364.28	46.	102.	1.58	690.76	686	8	1.28E-02	41.5	
3 0	427.31	62.	153.	1.09	826.02	819	13	1.73E-02	43.3	
4 0	511.22	235.	95.	2.51	1003.61	995	20	7.93E-02	11.3	
5 0	569.47	66.	361.	1.98	1127.62	1124	13	1.83E-02	24.1	
6 0	604.54	256.	153.	1.52	1202.29	1196	12	7.11E-02	12.0	
7 0	661.62	268.	72.	1.23	1323.32	1319	10	7.43E-02	8.4	
8 0	725.53	156.	81.	1.72	1608.92	1606	11	4.35E-02	14.9	
9 0	810.87	95.	37.	1.37	1641.57	1637	9	2.64E-02	16.8	
10 0	1173.20	532.	19.	1.63	2412.97	2406	15	1.48E-01	5.5	
11 0	1332.61	508.	27.	2.05	2752.36	2743	18	1.41E-01	5.3	
12 0	1460.99	213.	31.	1.51	3025.69	3020	15	5.92E-02	10.0	
13 0	1764.62	37.	9.	2.06	3672.11	3665	13	1.03E-02	23.7	
14 0	2614.94	40.	12.	2.46	5482.46	5474	16	1.12E-02	22.8	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 1993)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

PK IT	ENERGY	AREA	B/GND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	BER%	FIT%
1 0	320.14	*106.	133.	1.03	596.79	592	1.	2.25E-02	25.2	
2 0	364.28	46.	102.	1.58	690.76	686	8	1.28E-02	41.5	
3 0	427.31	62.	*153.	1.09	826.02	819	13	1.73E-02	43.3	
4 0	511.22	235.	95.	2.51	1003.61	995	20	7.93E-02	11.3	

6	0	604.54	256.	153.	1.52	1202.29	1196	12	7.11E-02	12.0
7	0	661.62	268.	72.	1.23	1323.82	1319	10	7.43E-02	8.4
8	0	795.53	156.	81.	1.72	1608.92	1506	11	4.35E-02	14.9
9	0	810.87	95.	37.	1.37	1641.57	1637	9	2.64E-02	16.8
10	0	1173.20	532.	49.	1.63	2412.97	2406	15	1.48E-01	5.3
1	0	1332.61*	484.	27.	2.05	2752.36	2743	18	1.34E-01	6.1
0	1460.99*		10.	31.	1.51	3025.69	3020	15	2.82E-03	****
1764.62 KEV PEAK DELETED										
2614.94 KEV PEAK DELETED										

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION 1.4 DEC 88)

UNKNOWN LINE REPORT

PAGE 1

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
0	427.81	62.	153.	1.09	1.09	826.02	819	13	1.73E-02	43.8	3.35E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	ILFC	DECAY	UCT /gram	ABNDIFF	FAILED
2	Cr-125	427.89	2.77%	1.000E-0	9.012E-8	38.75%	ABN
2	Co-228	562.50	1.00E+10Y	1.000E-0	3.142E-7	12.24%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88).
SUMMARY OF NUCLIDE ACTIVITY

PAGE 2

TOTAL LINES IN SPECTRUM 12
IDENTIFIED PEAKS 1
NTIFIED IN SUMMARY REPORT 11 91.67%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	2ERR
ANIL-511	AP	102.70H	1.561	7.238E -8	3.607E -8	49.83
CR-51	AP	27.70D	1.001	3.726E -7	8.889E -8	23.86
CO-51	AP	70.30D	1.000	6.478E -8	1.087E -8	16.78
CO-60	AP	1925.00D	1.000	4.726E -7	1.860E -8	5.05

HALOGEN EMISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	2ERR
I-131	HFP	8.04D	1.004	2.150E -8	0.227E -8	41.52

ESSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	2ERR
PH-105	FP	75.36H	1.024	1.950E -7	4.653E -8	23.36
CG-134	FP	753.10D	1.000	1.439E -7	.710E -8	11.98
CS-137	FP	30.17Y	1.000	1.838E -7	1.549E -8	8.43

RAD. PRODUCTS

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	2ERR
Cr-40	NP	1.28E+02Y	1.000	9.257E -8	2.635E -7	264.71

THE DETROIT EDISON COMPANY

ENRICO FERMI II

NRC
SPLIT

~ 4 hrs into
Discharge

CJT Disch

1.24×10^{-6} cur/srnm

Discharge start
Time

1921 on 2-24-94

GAMMA SPECTROSCOPY ANALYSIS REPORT

CHS ATTACHMENT # AUX Ø7

FOR INFORMATION ONLY

PERFORMED BY:

C. Williams 2-25-94

SIGNATURE/DATE

REVIEWED BY:

A. Sonnen 2/25/94

SIGNATURE/DATE

Detroit Edison Fermi-2 Power Plant 25-FEB-1994 00:59:57.26

Chemistry Department Gamma Spectroscopy Report

***** Sample Parameters *****

Title: CST @ 4 Hrs INTO DISCH

Sample collection start date: 24-FEB-1994 23:27:00.00

Sample collection end date : 24-FEB-1994 23:27:00.00

Type of sample : liquid

Sample quantity : 1.00000E+03 grams

Sample geometry : MILL Operator: CWT

***** Acquisition Parameters *****

Detector number : DET1

Acquire date : 25-FEB-1994 00:09:39.95

Preset live time : 0 00:50:00.00

Elapsed live time : 0 00:50:00.00

Elapsed real time : 0 00:50:00.17

Percent dead time : 0.00 %

***** Calibration Parameters *****

Detector number : DET1

Yearly cal date : 14-APR-1993 15:01:38.8

KeV/channel : 4.99974E-01

Zero offset: -3.68064E-01

Daily cal date : 24-FEB-1994 01:20:03.17

***** Peak Search Parameters *****

Start channel : 100

End channel : 4096

Height sensitivity : 5.00000

Shape sensitivity : 10.00000

Maximum number of iterations to resolve multiplets : 5

***** Nuclide Identification Parameters *****

Energy tolerance : 1.25000

Half-life ratio : 10.00000

Aundance limit : 80.00000

Library : HOT_CLNT.nlb

Efficiency file : EFFD1_MILL

Efficiencies at : Peak energy

Post-NID Peak Search Report

It	Energy	Area	Bkgnd	FWHM	Channel	Left	Pw	%Err	Fit	Nuclides
O	320.79	25	40	1.10	642.31	638	10	54.3		CR-51
O	604.52	100	42	1.58	1209.70	1201	15	17.2		CS-134
O	636.07	23	3	3.30	1272.78	1266	13	26.5		I / 3 / 500
O	661.81	75	9	1.86	1324.25	1319	13	14.4		CS-137
O	795.83	46	22	1.55	1592.24	1589	9	23.2		CS-134
O	811.01	30	21	1.56	1622.59	1617	15	38.4		CO-58
O	1173.04	137	4	1.62	2346.42	2338	17	9.2		CO-60
O	1332.58	120	0	1.84	2665.37	2659	15	9.1		CO-60

Rejected Report

Isotope	Half-life	Ratio	1-Sigma				
			Energy	%Abund	Activity	%Error	Rejected by
56	6.10D	0.01	158.38*	98.80	---	Not found	---
			269.50	36.50	---	Not found	---
			480.44	36.50	---	Not found	---
			749.95	49.50	---	Not found	---
			811.85	86.00	9.451E-08	38.43	
			1561.80	14.00	---	Not found	---
			% Abundances Found =		26.77		
SB-125	2.77Y	0.00	176.33	6.89	---	Not found	---
			380.44	1.50	---	Not found	---
			427.89*	29.33	---	Not found	---
			463.38	10.35	---	Not found	---
			600.56	17.80	---	Not found	---
			606.64	5.02	---	Not found	---
			635.90	11.32	4.162E-07	26.49	
			671.41	1.81	---	Not found	---
			% Abundances Found =		13.47	(Abn. Limit = 68.40%)	
I-131	8.04D	0.01	80.18	2.62	---	Not found	---
			284.30	6.05	---	Not found	---
			364.48*	81.20	---	Not found	---
			636.97	7.26	6.515E-07	26.49	
			722.89	1.80	---	Not found	---
			% Abundances Found =		7.34		
32	2.30H	0.49	505.90	5.03	---	Not found	---
			522.65	16.10	---	Not found	---
			535.50	0.52	---	Not found	---
			630.22	13.70	---	Not found	---
			650.60	2.66	---	Not found	---
			667.69*	98.70	---	Not found	---
			669.80	4.90	---	Not found	---
			671.60	5.20	---	Not found	---
			727.00	3.20	---	Not found	---
			772.61	76.20	---	Not found	---
			812.20	5.60	2.023E-06	38.43	
			954.55	18.10	---	Not found	---
			1136.03	2.96	---	Not found	---
			1398.57	7.10	---	Not found	---
			% Abundances Found =		2.15	(Abn. Limit = 67.00%)	

Flag: "*" = Keyline

Interference Report

Sample ID : CST @ 4 Hrs INTO

Page : 2

Acquisition date : 25-FEB-1994 00:09:39

No interference correction performed

Brief Nuclide Activity Report
Sample ID : CST @ 4 Hrs INTO

Page 1 of 3
Acquisition date : 25-FEB-1994 00:09:39

Brief Report

Nuclide	Activity uCi/gram	1-Sigma Error
CR-51	2.630E-07	1.427E-07
CO-58	8.137E-08	3.127E-08
CO-60	5.096E-07	4.652E-08
CS-134	2.021E-07	3.471E-08
CS-137	1.888E-07	2.712E-08

Total Activity :		1.245E-06

Minimum Detectable Activity Report

clide	Bckgnd Sum	Energy (keV)	MDA (uCi/gram)
24	2.	1368.53	4.2577E-08
FE-59	8.	1099.22	9.7864E-08
CU-64	4.	1345.90	1.7651E-05
ZN-65	13.	1115.52	1.3963E-07

***** 25-FEB-94 10:22:32 *****

18pp.

FERMI 2 CST SAMPLE. 12 HOURS INTO DISCHARGE. 2ND CST SAMPLE.

CENTRAL FILE NAME: L940501.FEV
SAMPLE DATE: 25-FEB-94 07:30:00
SAMPLE IDENTIFICATION: L940501.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 501.1000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

* * * * *

ACQUIRE DATE: 25-FEB-94 07:18:52 * FWHM(1332) 1.886
RAZET TIME(LIVE) 3600. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 3602. SEC * SHAPE PARAMETER: 5.0 %
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10

*

* * * * *

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:16:01 * ENERGY TOLERANCE 1.500 KEV
KzV/CHNL: 4697016 * HALF LIFE RATIO: 8.00
OFFSET: 39.8232300 * ABUNDANCE LIMIT: /0.000

* * * * *

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	75.00	53.	133.	.64	74.89	72	6	1.48E-02	38.4	
2	0	238.19	66.	158.	1.34	422.32	418	9	1.82E-02	39.3	
3	0	320.17	89.	115.	1.24	596.86	592	10	2.47E-02	27.2	
4	0	364.91	74.	155.	1.24	692.11	686	13	2.04E-02	38.1	
5	0	427.94	72.	59.	1.32	826.31	823	7	2.00E-02	21.6	
6	0	511.07	215.	189.	2.85	1003.30	995	22	5.98E-02	17.9	
7	0	604.63	290.	123.	1.25	1202.49	1196	12	3.05E-02	10.1	
8	0	661.60	234.	68.	1.45	1323.78	1317	13	6.49E-02	9.9	
9	0	795.74	218.	60.	1.91	1609.35	1603	14	6.06E-02	10.5	
10	0	810.68	91.	53.	.92	1611.16	1636	11	2.54E-02	19.3	
11	0	1173.22	470.	42.	1.59	2413.01	2406	13	1.31E-01	5.3	
12	0	1332.41	478.	16.	1.90	2751.94	2744	16	1.33E-01	5.2	
13	0	1460.90	204.	26.	2.27	3025.48	3019	15	5.67E-02	9.2	
14	0	1509.18	21.	0.	1.82	3128.29	3125	9	5.83E-03	26.6	
15	0	1764.63	48.	0.	1.76	3672.13	3665	15	1.33E-02	21.3	
16	0	2203.74	15.	6.	1.26	4606.99	4599	13	4.18E-03	57.2	
17	10	2613.78	21.	0.	2.44	5479.99	5473	20	5.71E-03	33.7	1.13E+00
18	10	2615.77	37.	0.	2.44	5484.22	5473	20	1.02E-02	19.1	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 82)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR
1	0	75.00	53.	133.	.64	74.89	72	6	1.48E-02	38.4
2	0	238.19	66.	158.	1.34	422.32	418	9	1.82E-02	39.3

4	0	364.91	74.	155.	1.24	692.11	686	13	2.04E-02	38.2	
5	0	427.94	72.	59.	1.32	826.31	823	7	2.00E-02	21.6	
6	0	511.07	215.	189.	2.85	1003.30	995	22	5.98E-02	17.9	
7	0	604.63	290.	123.	1.25	1202.49	1196	12	8.05E-02	10.1	
8	0	661.60	234.	68.	1.45	1323.78	1317	13	6.49E-02	9.9	
9	0	795.74	218.	60.	1.91	1609.35	1603	14	6.06E-02	10.5	
10	0	810.68	91.	53.	.92	1641.16	1636	11	2.54E-02	19.3	
11	0	1173.22	470.	42.	1.59	2413.01	2406	13	1.31E-01	5.3	
12	0	1332.41	478.	16.	1.90	2751.94	2744	16	1.33E-01	5.2	
13	0	160.90	204.	26.	2.27	3025.48	3019	15	5.67E-02	9.2	
14	0	9.18	21.	0.	1.82	3128.29	3125	9	5.83E-03	26.6	
15	0	54.63	48.	0.	1.76	3672.13	3665	15	1.33E-02	21.3	
16		203.74	15.	6.	1.26	4606.99	4599	13	4.18E-03	57.2	
17	10	2613.78	21.	0.	2.44	5472.99	5473	20	5.71E-03	33.7	
18	10	2615.77	37.	0.	2.44	5474.22	5473	20	5.02E-02	19.3	

FILE-JP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM . (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	.215.	189.	96.73*	2.943E+00	2.711E -7	4.862E -8
CR-51	AP	320.08	.89.	115.	9.83*	4.125E+00	3.296E -7	8.959E -8
CO-58	AP	810.76	.21.	53.	92.40*	2.093E+00	6.567E -8	1.267E -8
CO-60	AP	1173.22	.470.	42.	100.00	1.600E+00	4.406E -7	2.347E -8
		1332.49	.478	16.	100.00*	1.457E+00	4.915E -7	2.564E -8
-I-65	AP	366.27	.74.	155.	4.61	3.758E+00	1.198E -6	4.577E -7
		1115.52	.0.	0.	14.30	0.000E+00	.000E 0	.000E 0
		1481.84	.	6.	23.50*	0.000E+00	.000E 0	.000E 0

ALUMINUM FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
-I-131	HFP	284.30	.0.	0.	6.05	0.000E+00	.000E 0	.000E 0
		364.48	.74.	155.	81.20*	3.758E+00	3.641E -8	1.391E -8
		636.97	.0.	0.	7.24	0.000E+00	.000E 0	.000E 0
		772.89	.	0.	1.80	0.000E+00	.000E 0	.000E 0

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
-I-103	FP	306.10	.0.	0.	5.17	0.000E+00	.000E 0	.000E 0
		318.20	.87.	115.	19.20*	4.125E+00	1.762E -7	4.703E -8
-I-125	FP	176.33	.0.	0.	6.82	0.000E+00	.000E 0	.000E 0
		427.89	.72.	52.	29.33*	3.349E+00	1.096E -7	2.369E -8
		463.38	.0.	0.	10.35	0.000E+00	.000E 0	.000E 0
		600.56	.0.	0.	17.80	0.000E+00	.000E 0	.000E 0
		635.90	.0.	0.	11.32	0.000E+00	.000E 0	.000E 0
-I-134	FP	563.23	.0.	0.	8.38	0.000E+00	.000E 0	.000E 0
		569.32	.0.	0.	15.43	0.000E+00	.000E 0	.000E 0
		594.70	.290.	123.	27.60*	2.602E+00	1.710E -7	1.733E -8
		725.85	.218.	60.	35.40	2.127E+00	1.800E -7	1.886E -8
		801.93	.0.	0.	8.73	0.000E+00	.000E 0	.000E 0
CS-137	FP	661.65	.234.	68.	85.12*	2.436E+00	1.690E -7	1.670E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	.204.	26.	10.67*	1.362E+00	2.106E -6	1.947E -7
RA-226	NP	126.21	.0.	0.	3.28	0.000E+00	.000E 0	.000E 0
		241.28	.0.	0.	7.42	0.000E+00	.000E 0	.000E 0
		275.21	.0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.92	.0.	0.	37.20	0.000E+00	.000E 0	.000E 0
		602.31	.0.	0.	46.30*	0.000E+00	.000E 0	.000E 0
		1120.29	.0.	0.	15.10	0.000E+00	.000E 0	.000E 0
		1238.11	.0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	.48.	0.	15.80	1.185E+00	3.839E -7	3.167E -8
		2204.22	.15.	6.	4.98	1.007E+00	4.491E -7	2.567E -7

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)

NUCLIDE LINE ACTIVITY REPORT

ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 2

MATERIAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
TH-232	NP	238.63	66.	158.	44.60	5.045E+00	4.361E -8	1.715E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.30	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	01	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	21.	0.	35.86*	3.384E -01	2.672E -8	3.253E -8

UNKNOWN LINE REPORT

ELAPSED LIVE TIME

3600. (PILE-UP CORRECTED)

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	75.00	53.	133.	.64	74.89	72	6	1.48E-02	38.4 2.96E+00
2	0	238.19	66.	158.	1.34	422.32	418	9	1.82E-02	39.3 5.05E+00
5	0	427.94	72.	59.	1.32	826.31	823	7	2.00E-02	21.6 3.35E+00
14	0	1509.18	21.	0.	1.82	3128.22	3125	9	5.83E-03	26.6 1.33E+00
15	0	1764.63	48.	0.	1.76	3672.13	3665	15	1.53E-02	21.3 1.19E+00
16	0	2203.74	15.	6.	1.26	4606.22	4599	13	4.18E-03	57.2 1.01E+00
17	10	2613.78	21.	0.	2.44	5479.99	5473	20	5.71E-03	33.7 8.88E-01
18	10	2615.77	37	0.	2.44	5484.22	5473	20	1.02E-02	19.3 8.88E-01

NUCLEI IDENTIFIED

PK	NUCLIDE	ENERGY	RPG	DELAY	UCI /gram	AGND OFF	FAILED	
2	TH-232	238.63	1.000E+00Y	1.000E	0	4.361E -8	45.15%	ABN
4	NI-63	366.27	1.000E+00Y	1.000E	0	1.198E -6	10.74%	ABN
5	SB-125	525.62	1.000E+00Y	1.000E	0	1.096E -11	38.75%	ABN
15	RA-226	1764.62	1.000E+00Y	1.000E	0	3.859E -1	13.36%	ABN
16	RA-226	2204.22	1.000E+00Y	1.000E	0	4.491E -7	13.36%	ABN
17	TH-232	2613.66	1.000E+00Y	1.000E	0	9.672E -8	45.15%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 4

TOTAL LINES IN SPECTRUM	18
IDENTIFIED PEAKS	8
NTIFIED IN SUMMARY REPORT	10 55.56%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-911	AP	109.70M	2.391	2.711E -7	4.862E -8	17.03	
CR-54	AP	27.70D	1.002	3.296E -7	8.959E -8	27.18	
CO-58	AP	70.30D	1.001	6.567E -8	1.267E -8	19.29	
CO-60	AP	1925.00D	1.000	4.915E -7	2.564E -8	5.22	

HALOGEN FISSION PRODUCT

NUCLEUS	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
I-133	HP	8.04D	1.000	3.641E -8	1.391E -8	36.19	

I-135 PRODUCT

NUCLEUS	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
I-135	FP	35.36H	1.046	1.762E -7	4.788E -8	27.10	
CS-134	FP	753.10D	1.000	1.710E -7	1.733E -8	10.13	
CS-137	FP	30.17Y	1.000	1.690E -7	1.670E -8	9.89	

URANIUM PRODUCT

NUCLEUS	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
U-234	HP	1.23E+09Y	1.000	2.106E -6	1.247E -7	9.24	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	89.	477.59	1.9331E-07
NA-22	29.	1274.54	2.6301E-08
NA-24	22.	1368.53	2.7025E-08
CL-38	6.	2167.51	0.0000E+00
AR-41	21.	1293.64	5.5045E-08
SC-46	67.	1120.51	3.5809E-08
MN-54	80.	834.33	3.0742E-08
MN-56	59.	846.75	5.0474E-08
FE-59	36.	1099.22	4.5843E-08
CO-57	143	122.06	1.5908E-08
NI-61	13.	1481.84	1.5833E-07
CU-64	15.	1345.90	4.5882E-06
ZN-65	49.	1115.52	6.0110E-08
ZN-C7M	85.	438.63	2.1838E-08
AS-76	21.	559.10	5.4218E-08
SE-77	105.	264.65	2.6735E-08
SR-78	66.	554.32	2.8604E-08
SR-79	60.	881.50	1.3854E-06
KR-85	154.	513.99	6.4362E-06
KR-85M	159.	151.18	2.8084E-08
KR-87	95.	402.53	1.3057E-07
KR-88	146.	196.32	9.8777E-08
BB-88	17.	1836.01	2.7436E-05
BB-89	47.	1031.88	HALF LIFE 100 SHORT
V-95	154.	513.99	2.8124E-08
SR-85M	133.	231.62	7.8830E-08
SR-91	42.	1024.30	2.6510E-08
SR-92	18.	1383.94	4.4456E-08
Y-BL	17.	1856.01	2.6490E-08
Y-91	32.	1204.90	6.7399E-06
Y-91MD	70.	555.57	2.4788E-03
Y-92	48.	934.46	2.9998E-07
Y-93	106.	266.90	2.7417E-07
ZR-95	63.	756.72	4.4623E-08
ZR-97	73.	743.36	3.0881E-08
NB-94	61.	702.63	2.2415E-08
NB-95	65.	765.79	2.5441E-08
NB-97D	42.	1024.50	2.6976E-06
MO-90	133.	257.34	3.0099E-08
MO-99	58.	739.58	1.8491E-07
TC-99MD	186.	140.51	1.7768E-08
RU-103	89.	497.08	2.3300E-08
RU-105	46.	724.50	5.8956E-08
RU-106	72.	621.84	2.2303E-07
AG-110M	68.	657.75	2.3478E-08
CD-109	124.	88.03	4.6333E-07
SN-113	100.	391.69	2.8445E-08
I122	91.	563.93	3.3317E-08
I124	244.	602.71	4.0281E-08
I125	149.	427.89	8.1680E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
I-123M	162.	158.99	1.7514E-08
I-132	143.	228.16	1.9069E-08
I-132	47.	667.69	3.7997E-08
I-133	69.	529.87	2.3890E-08
I-134	60.	847.03	1.7661E-07
I-135	26.	1260.41	1.0975E-07
XE-131M	156.	163.23	7.3660E-07
XE-133	128.	80.99	5.6622E-08
XE-133M	136.	233.22	1.6402E-07
XE-135	98.	249.79	1.9640E-08
XE-135M	31.	526.56	HALF LIFE TOO SHORT
XE-138	129.	258.31	HALF LIFE TOO SHORT
CS-134M	162.	127.42	2.0154E-07
CS-136	52.	818.56	2.4462E-08
CS-138	19.	1435.86	6.0791E-07
BA-133	92.	356.00	2.8055E-08
BA-139	154.	165.85	2.6693E-07
BA-140	76.	537.32	8.1375E-08
BA-141	155.	190.22	5.8529E-06
LA-141	24.	1596.49	3.0836E-08
CE-139	154.	165.85	1.7745E-08
CE-141	151.	145.44	3.0117E-08
CE-143	100.	293.26	4.0986E-08
CE-144	157.	133.54	1.3617E-07
CE-147	143.	91.11	6.2825E-08
CE-152	82.	344.27	5.9132E-08
U-154	29.	1274.45	7.4036E-08
HF-181	91.	482.03	2.4772E-08
W-187	36.	479.53	2.0662E-08
Hg-203	111.	279.19	2.1924E-08
RA-226	36.	609.11	5.0369E-08
RH-232	51.	2614.66	0.0000E+00
U-235	200.	185.72	3.0721E-08
U-238	153.	131.20	7.0612E-08
NP-239	176.	106.13	7.2691E-08
AM-241	111.	59.54	1.4314E-07

***** 25-FEB-94 10:25:38 *****

FERMI 2 CST SAMPLE. 12 HOURS INTO DISCHARGE. 2ND CST SAMPLE.

CONTROL FILE NAME: L940501.FEV
SAMPLE DATE: 25-FEB-94 07:30:00
SAMPLE IDENTIFICATION: L940501.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 501.1000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

*
ACQUIRE DATE: 25-FEB-94 02:18:52 * FWHM(1332) 1.386
PRESENT TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 3601. SEC * SHAPE PARAMETER: 5.0 %
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.
*

*
DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEY
KEY/CHAN: 4697016 * HALF-LIFE RATIO: 8.00
OFFSET: 39.8232300 KEY * ABUNDANCE LIMIT: 0.000
*

ENERGY WINDOW 46.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	75.00	53.	133.	.64	74.89	72	6	1.48E-02	39.4	
2	0	238.19	66.	158.	1.34	422.32	418	9	1.82E-02	39.3	
3	0	320.17	82.	115.	1.24	596.86	592	10	2.47E-02	27.2	
4	0	364.91	74.	155.	1.24	692.11	686	13	2.04E-02	38.2	
5	0	427.24	72.	59.	1.32	826.31	823	7	2.00E-02	21.6	
6	0	511.07	215.	189.	2.85	1003.30	995	22	5.98E-02	17.9	
7	0	604.63	290.	123.	1.25	1202.49	1196	12	8.05E-02	10.1	
8	0	661.60	234.	68.	1.45	1323.78	1317	13	6.49E-02	9.9	
9	0	725.74	213.	60.	1.91	1605.35	1603	14	5.06E-02	10.5	
10	0	810.68	91.	53.	.92	1641.16	1636	11	2.54E-02	19.3	
11	0	1173.22	470.	42.	1.59	2413.01	2406	13	1.31E-01	5.3	
12	0	1332.41	478.	16.	1.90	2751.94	2744	16	1.33E-01	5.2	
13	0	1460.90	204.	26.	2.27	3025.48	3019	15	5.67E-02	9.2	
14	0	1509.18	21.	0.	1.82	3128.29	3125	9	5.83E-03	26.6	
15	0	1764.63	48.	0.	1.76	3672.15	3665	15	1.33E-02	21.3	
16	0	2203.74	15.	6.	1.26	4606.99	4599	13	4.18E-03	57.2	
17	10	2613.78	21.	0.	2.44	5472.99	5473	20	5.71E-03	33.7	1.16E-00
18	10	2615.77	37.	0.	2.44	5484.22	5473	20	1.02E-02	19.3	

PEAK SEARCH COMPLETED (REV 15.3 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

PK IT ENERGY AREA BKGND FWHM CHANNEL LEFT PW CTS/SEC %ERR FIT

238.19 KEV PEAK DELETED																	
3	0	320.17	89.	115.	1.24	596.86	592	10	2.47E-02	27.2							
4	0	364.91	74.	155.	1.24	692.11	686	13	2.04E-02	38.2							
5	0	427.94	72.	59.	1.32	826.31	823	7	2.00E-02	21.6							
6	0	511.07*	18.	189.	2.85	1003.30	995	22	5.03E-03	****							
7	0	604.63	290.	123.	1.25	1202.49	1196	12	8.05E-02	10.1							
8	0	661.60*	178.	68.	1.45	1323.78	1317	13	4.95E-02	15.7							
9	0	795.74	218.	60.	1.91	1609.35	1603	14	6.06E-02	10.5							
10	0	810.68	91.	53.	.92	1641.16	1636	11	2.54E-02	19.3							
11	0	1173.22	470.	42.	1.59	2413.01	2406	13	1.31E-01	5.3							
12	0	1332.41*	431.	16.	1.90	2751.94	2744	16	1.20E-01	6.4							
1460.90 KEV PEAK DELETED																	
14	0	1509.18	21.	0.	1.82	3128.29	3125	9	5.83E-03	26.6							
15	0	1764.63*	1.	0.	1.76	3672.13	3663	15	2.93E-04	****							
16	0	2203.74	15.	6.	1.26	4606.99	4599	13	4.18E-03	57.2							
2613.78 KEV PEAK DELETED																	
2615.77 KEV PEAK DELETED																	

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT

PAGE 1

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF	
0	75.00	53.	133.	.64	74.89	72	6	1.48E-02	38.4	2.96E+00	
5	0	427.94	72.	59.	1.32	826.31	823	7	2.00E-02	21.6	3.35E+00
14	0	1509.18	21.	0.	1.82	3128.22	3125	9	5.83E-03	26.6	1.33E+00
15	0	1764.63	1.	0.	1.76	3672.13	3665	15	3.93E-04	****	1.19E+00
40	0	2203.74	15.	6.	1.26	4606.92	4599	13	4.18E-03	57.2	1.01E+00

LINE NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DCCAY	NCI /gram		ABNDLFF	FAILED
1	I-165	366.27	2.52H	1.084E 0	1.198E -6		10.742	ABN
2	Sr-125	427.89	2.77Y	1.000E 0	1.096E -7		38.773	ABN
2	Ra-226	1764.49	1600.00Y	1.000E 0	1.152E -8		13.303	ABN
6	Ra-226	2204.22	1600.00Y	1.000E 0	4.491E -7		13.303	ABN

TOTAL LINES IN SPECTRUM	14
IDENTIFIED PEAKS	5
NTIFIED IN SUMMARY REPORT	9
	64.29%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	2.391	2.281E -8	5.255E -8	261.10	
CR-51	AP	27.70D	1.002	3.296E -7	8.959E -8	27.18	
CO-58	AP	70.30D	1.001	6.567E -8	1.267E -3	19.22	
CO-60	AP	1925.00D	1.000	4.437E -7	2.835E -3	6.37	

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
I-131	HFP	3.04D	1.008	3.641E -8	1.391E -8	38.12	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
RH-105	FP	35.36H	1.046	1.762E -7	4.788E -8	27.18	
Cs-134	FP	753.10D	1.000	1.710E -7	1.733E -8	10.13	
Cs-137	FP	30.17Y	1.000	1.289E -7	2.019E -8	15.67	

THE DETROIT EDISON COMPANY

ENRICO FERMI II

FOR INFORMATION ONLY


GAMMA SPECTROSCOPY ANALYSIS REPORT

CHS ATTACHMENT # ANX07

CST 12 hr sample NRC split
(0730)

= 1.23×10^{-6}

PERFORMED BY: 2-25-84


2-24-84

SIGNATURE/DATE

REVIEWED BY:


SIGNATURE/DATE

* Detroit Edison Fermi-2 Power Plant 25-FEB-1994 09:06:09.12 *

Chemistry Department Gamma Spectroscopy Report

***** Sample Parameters *****

Title: CST

Sample collection start date: 25-FEB-1994 07:30:00.00

Sample collection end date : 25-FEB-1994 07:30:00.00

Type of sample : liquid

Sample quantity : 9.99900E+02 grams

Sample geometry : MILL Operator: KAS

***** Acquisition Parameters *****

Detector number : DET1 Acquire date : 25-FEB-1994 08:15:47.73

Preset live time : 0 00:50:00.00 Elapsed live time : 0 00:50:00.00

Elapsed real time : 0 00:50:00.17 Percent dead time : 0.00 %

***** Calibration Parameters *****

Detector number : DET1 Yearly cal date : 14-APR-1993 15:01:58.

Kev/channel : 4.99924E-01 Zero offset: -3.52638E-01

Daily cal date : 25-FEB-1994 01:12:21.13

***** Peak Search Parameters *****

Start channel : 100 End channel : 4096

Height sensitivity : 5.00000 Shape sensitivity : 10.00000

Maximum number of iterations to resolve multiplets : 5

***** Nuclide Identification Parameters *****

Energy tolerance : 1.25000 Half-life ratio : 10.00000

Aundance limit : 80.00000 Library : HOT_CLNT.nlb

Efficiency file : EFFD1_MILL Efficiencies at : Peak energy

Post-NID Peak Search Report

It	Energy	Area	Bknd	FWHM	Channel	Left	Pw	Werr	Fit	Nuclides
O	320.54	35	44	0.74	641.84	637	10	39.3		CR-51
O	364.81	25	35	0.78	730.38	726	12	51.4		I-131
O	511.86	40	10	5.21	1024.46	1019	15	24.2		An-20
O	568.94	28	11	3.53	1138.62	1133	11	29.5		CS-134
O	604.98	95	43	1.40	1210.69	1203	16	18.7		Cs-134
O	635.60	13	8	0.90	1271.92	1267	8	46.8		98-25
O	661.90	56	25	1.24	1324.52	1319	13	22.9		CS-137
O	802.14	14	5	1.48	1604.94	1603	8	38.0		CS-137
O	956.57	12	11	1.31	1913.75	1908	11	60.8		
O	1173.12	118	7	2.09	2346.70	2338	16	10.6		CO-60
O	1332.62	116	0	2.14	2665.58	2659	14	9.3		CO-60

Rejected Report

	Half-Life			1-Sigma			
Element	Half-life	Ratio		Energy	%Abund	Activity	%Error
22	2.60Y	0.00		511.00	179.80	3.703E-08	24.18 Abun.
				1274.54*	99.94	---	Not found ---
			% Abundances Found =	64.27			
SB-125	2.77Y	0.00		176.33	6.89	---	Not found --- Abun.
				380.44	1.50	---	Not found ---
				427.69*	29.33	---	Not found ---
				463.38	10.35	---	Not found ---
				600.56	17.80	---	Not found ---
				606.64	5.02	---	Not found ---
				635.90	11.32	2.369E-07	46.79
				671.41	1.81	---	Not found ---
			% Abundances Found =	13.47	(Abn. Limit = 68.40%)		
CS-134	2.06Y	0.00		127.42	12.90	---	Not found --- Abun.
				475.35	1.46	---	Not found ---
				563.23	8.38	---	Not found ---
				569.32	15.43	3.399E-07	29.46
				604.70*	97.60	<u>1.916E-07</u>	<u>18.65</u>
				795.85	85.40	---	Not found ---
				801.93	8.73	4.137E-07	37.97
				1038.57	1.00	---	Not found ---
				1167.94	1.80	---	Not found ---
				1365.15	3.04	---	Not found ---
				1400.00	0.00	---	Not found ---
				1596.00	0.00	---	Not found ---
			% Abundances Found =	51.65	(Abn. Limit = 75.00%)		

Flag: "*" = Keyline

Brief Nuclide Activity Report
Sample ID : CG7

Page :
Acquisition date : 25-FEB-1994 08:15:47

Brief Report

Nuclide	Activity	1-Sigma
	uCi/gram	Error
CR-51	3.767E-07	1.481E-07
CO-60	4.927E-07	4.575E-08
I-131	3.765E-08	1.936E-08
CS-137	1.414E-07	3.244E-08

Total Activity : 1.048E-06

$$\begin{array}{r} + 1.92E-7 \text{ (Cs Br)} \\ \hline 1.23E-6 \end{array}$$

Minimum Detectable Activity Report

clide	Bcknd Sum	Energy (keV)	MDA (uCi/gram)
Cl-35	1.	1368.53	3.0525E-08
CU-58	22.	810.76	6.5592E-08
FE-59	11.	1099.22	1.1207E-07
CU-64	2.	1345.90	1.3686E-05
ZN-65	10.	1115.52	1.2469E-07
CS-134	103.	604.70	1.0045E-07

***** 25-FEB-94 13:22:39 *****

* 1994

EFERMI 2 CST SAMPLE 16 HOURS INTODISCHARGE. 3RD CST SAMPLE

CTRAL FILE NAME: L940511.FEV
 PLE DATE: 25-FEB-94 11:30:00
 SAMPLE IDENTIFICATION: L940511.FEV
 TYPE OF SAMPLE: WATER
 SAMPLE QUANTITY: 500.1000 UNITS: gram
 SAMPLE GEOMETRY: LMAR500
 EFFICIENCY FILE NAME: LMAR500.LEFF

* * * * *

ACQUIRE DATE: 25-FEB-94 12:01:11 * FWHM(1332) 1.886
 RESET TIME(LIVE): 3600 SEC * SENSITIVITY: 5.000
 ELAPSED REAL TIME: 3601. SEC * SHAPE PARAMETER: 5.0 %
 ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: .0

* * * * *

DETECTOR: ORTEC * LIBRARY:MASTER.CLD
 CALIB DATE: 23-FEB-94 07:26:09 * ENERGY TOLERANCE: 1.500 KEV
 CALIB CHNL: 4697016 * HALF LIFE RATIO: 5.00
 OFFSET: 52.8232300 KLV * ABUNDANCE LIMIT: 70.00%

* * * * *

ENERGY WINDOW 40.20 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	74.77	52.	120.	.26	74.41	73	6	1.44E-02	39.6	
2	0	92.71	52.	101.	.61	112.60	111	5	1.45E-02	32.6	
3	0	320.28	85.	151.	1.10	597.10	594	10	2.37E-02	29.5	
4	0	364.02	116.	104.	1.09	620.22	683	13	3.22E-02	21.1	
5	0	428.59	98.	110.	.72	827.69	822	12	2.72E-02	24.4	
6	0	510.98	291.	124.	2.19	1003.11	995	19	8.07E-02	11.9	
7	0	565.35	32.	29.	1.01	1118.85	1117	5	8.98E-03	32.3	
8	0	569.17	88.	64.	1.22	1126.99	1123	10	2.43E-02	20.7	
9	0	604.61	263.	154.	1.31	1202.43	1197	13	7.31E-02	12.3	
10	0	661.71	252.	102.	1.53	1324.00	1316	17	7.19E-02	11.4	
11	0	795.98	236.	46.	1.59	1609.87	1605	13	6.54E-02	9.2	
12	0	811.20	32.	82.	1.29	1642.27	1637	11	2.28E-02	24.8	
13	0	1173.27	482.	43.	1.87	2413.13	2407	17	1.34E-01	5.7	
14	0	1332.49	426.	28.	1.89	2752.10	2742	18	1.18E-01	5.7	
15	0	1460.71	215.	13.	1.74	3025.08	3015	18	5.97E-02	8.9	
16	0	1764.79	50.	3.	2.12	3672.47	3665	18	1.33E-02	19.5	
17	0	2614.92	55.	5.	2.15	5432.41	5473	18	1.54E-02	19.8	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA, CORRECTION = 1.000
 UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR
1	0	74.77	52.	120.	.26	74.41	73	6	1.44E-02	39.6
2	0	92.71	52.	101.	.61	112.60	111	5	1.45E-02	32.6
3	0	320.28	85.	151.	1.10	597.10	594	10	2.37E-02	29.5

5	0	428.59	98.	110.	.72	827.69	822	12	2.72E-02	24.4
6	0	510.98	291.	124.	2.19	1003.11	995	19	8.07E-02	11.9
7	0	565.35	32.	29.	1.01	1118.85	1117	5	8.98E-03	32.8
8	0	569.17	88.	64.	1.22	1126.99	1123	10	2.43E-02	20.7
9	0	604.61	263.	154.	1.31	1202.43	1197	13	7.31E-02	12.3
10	0	661.71	259.	102.	1.53	1324.00	1316	17	7.19E-02	11.4
11	0	795.98	236.	46.	1.59	1609.87	1605	13	6.54E-02	9.2
12	0	811.20	82.	82.	1.29	1642.27	1637	11	2.28E-02	24.8
13	0	1173.27	482.	43.	1.87	2413.13	2407	17	1.34E-01	5.7
14	0	1332.49	426.	28.	1.89	2752.10	2742	18	1.18E-01	5.7
15	0	1460.71	215.	13.	1.74	3025.08	3015	18	5.97E-02	8.9
16	0	1764.79	50.	5.	2.12	3672.47	3665	18	1.38E-02	22.3
17	0	2614.92	55.	5.	2.15	5482.41	5473	18	1.54E-02	19.3

PILE-UP CORRECTION COMPUTED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 86)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

HALOGENATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	291.	124.	96.73*	2.943E+00	2.242E -7	2.677E -8
CR-51	AP	320.08	85.	151.	9.83*	4.124E+00	3.167E -7	9.348E -8
CO-58	AP	810.76	82.	82.	22.40*	2.097E+00	5.200E -8	1.465E -8
CO-60	AP	1173.22	482.	43.	100.00	1.600E+00	4.519E -7	2.595E -8
		1332.49	426.	28.	100.00*	1.457E+00	4.390E -7	2.515E -8

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
-131	HFP	284.30	0.	0.	0.05	0.000E+00	0.000E 0	0.000E 0
		364.48	116.	104.	81.20*	3.764E+00	5.714E -8	1.208E -8
		636.97	0.	0.	7.26	0.000E+00	0.000E 0	0.000E 0
		722.89	0.	0.	1.80	0.000E+00	0.000E 0	0.000E 0

ISOTONIC PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
4H-105	FP	506.10	0.	0.	0.13	0.000E+00	0.000E 0	0.000E 0
		318.90	85.	151.	19.20*	4.124E+00	1.652E -7	4.877E -8
50-122	FP	563.93	32.	29.	70.60*	2.733E+00	2.541E -8	8.345E -9
		692.80	0.	0.	3.70	0.000E+00	0.000E 0	0.000E 0
50-123	FP	176.33	0.	0.	6.32	0.000E+00	0.000E 0	0.000E 0
		427.89	28	110.	29.33*	3.345E+00	1.496E -7	3.647E -8
		463.36	0.	0.	10.35	0.000E+00	0.000E 0	0.000E 0
		600.56	0.	0.	17.80	0.000E+00	0.000E 0	0.000E 0
		635.90	0.	0.	11.32	0.000E+00	0.000E 0	0.000E 0
50-134	FP	563.23	0.	0.	2.58	0.000E+00	0.000E 0	0.000E 0
		569.32	88.	64.	12.43	2.720E+00	3.132E -7	6.469E -8
		604.70	263.	154.	97.00*	2.602E+00	1.556E -7	1.916E -8
		795.85	236.	46.	85.40	2.127E+00	1.947E -7	1.796E -8
		801.93	0.	0.	8.73	0.000E+00	0.000E 0	0.000E 0
50-137	FP	661.65	259.	102.	85.12*	2.436E+00	1.876E -7	2.132E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	215.	13.	10.67*	1.362E+00	2.221E -6	1.936E -7
RA-226	NP	186.21	0.	0.	3.23	0.000E+00	0.000E 0	0.000E 0
		241.98	0.	0.	7.49	0.000E+00	0.000E 0	0.000E 0
		295.21	0.	0.	19.20	0.000E+00	0.000E 0	0.000E 0
		351.92	0.	0.	37.20	0.000E+00	0.000E 0	0.000E 0
		609.31	0.	0.	46.30*	0.000E+00	0.000E 0	0.000E 0
		1120.29	0.	0.	15.10	0.000E+00	0.000E 0	0.000E 0
		1238.11	0.	0.	5.94	0.000E+00	0.000E 0	0.000E 0
		1764.49	50.	3.	15.30	1.185E+00	3.274E -7	7.751E -8
		2204.22	0.	0.	4.98	0.000E+00	0.000E 0	0.000E 0

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
NUCLIDE LINE ACTIVITY REPORT
ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 2

URAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA	ERROR
TH-232	NP	238.63	0.	0.	44.60	0.000E+00	.000E 0	.000E 0	
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0	
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0	
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0	
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0	
		762.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0	
		7614.66	55	5.	35.86*	3.881E-01	2.615E -7	5.180E -8	
J-238	NP	131.20	0.	0.	20.40*	0.000E+00	.000E 0	.000E 0	
		152.70	0.	0.	6.80	0.000E+00	.000E 0	.000E 0	
		569.50	38	64.	11.00	2.720E+00	4.393E -7	2.074E -8	
		830.51	0.	0.	12.24	0.000E+00	.000E 0	.000E 0	
		833.24	0.	0.	12.00	0.000E+00	.000E 0	.000E 0	
		926.00	0.	0.	11.20	0.000E+00	.000E 0	.000E 0	
		946.00	0.	0.	12.00	0.000E+00	.000E 0	.000E 0	

UNKNOWN LINE REPORT

PAGE 3

ELAPSED LIVE TIME

3600. (PILE-UP CORRECTED)

IDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0 74.77	52.	120.	.96	74.41	73	6	1.44E-02	38.6	2.94E+00
2	0 92.71	52.	101.	.61	112.60	111	5	1.45E-02	32.6	4.59E+00
5	0 428.59	98.	110.	.72	827.69	822	12	2.72E-02	24.4	3.35E+00
16	0 1764.79	50.	3.	2.12	3672.47	3665	13	1.38E-02	19.5	1.12E+00
17	0 2614.92	55.	5.	2.15	5482.41	5473	13	1.54E-02	19.8	8.88E-01

LINE NOT MEETING SUMMARY CRITERIA

NUCLIDE	ENERGY	HLFC	DECAY	UOE /gram	ABNDIFF	FAILED
8-125	427.89	2.77Y	1.000E	0 1.492E -7	38.752	ABN
0-238	569.50	1.00E+10Y	1.000E	0 4.393E -7	12.84%	ABN
8A-226	1764.49	1600.00Y	1.000E	0 3.974E -7	10.17%	ABN
H-232	2614.66	1.00E+10Y	1.000E	0 2.615E -7	20.12%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 4

TOTAL LINES IN SPECTRUM	17
IDENTIFIED PEAKS	5
NTIFIED IN SUMMARY REPORT	12 70.59%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	1.463	2.242E -7	2.677E -8	11.24	
CR-51	AP	27.70D	1.001	3.167E -7	9.348E -8	29.51	
CO-58	AP	70.80D	1.000	5.900E -8	1.465E -8	24.83	
CO-60	AP	1925.00D	1.000	4.390E -7	2.515E -8	5.73	

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
I-131	HF12	3.04D	1.004	5.714E -8	1.208E -8	21.13	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
RH-105	FP	35.36H	1.020	1.652E -7	4.377E -8	29.51	
SB-122	FP	2.70D	1.011	2.541E -8	8.345E -9	32.84	
CS-134	FP	753.10D	1.000	1.556E -7	1.916E -8	12.32	
CS-137	FP	30.17Y	1.000	1.876E -7	2.132E -8	11.37	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
U-40	NP	1.28E+09Y	1.000	2.221E -6	1.286E -7	8.24	

MINIMUM DETECTABLE ACTIVITY REPORT (ND RC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

LIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	87.	477.59	1.9137E-07
NA-22	15.	1274.54	1.8953E-08
NA-24	22.	1368.53	2.5506E-08
CL-38	5.	2167.51	0.0000E+00
AR-41	31.	1293.64	4.1001E-08
SC-46	81.	1120.51	3.9434E-08
MN-54	81.	834.83	3.0992E-08
MN-56	65.	846.75	3.7481E-08
FE-57	50.	1099.22	5.4090E-08
CO-57	160.	122.06	1.6859E-08
NI-65	14.	1481.84	1.1567E-07
CU-64	25.	1345.90	5.5303E-06
ZN-65	61.	1115.52	6.7192E-08
ZN-69M	92.	438.63	2.1327E-08
AS-76	86.	559.10	5.1043E-08
SE-75	120.	264.65	2.8630E-08
BR-82	60.	554.32	2.6641E-08
BR-84	70.	881.50	2.7577E-07
KR-85	143.	513.99	6.2627E-06
KR-85M	171.	151.18	2.3885E-08
KR-87	85.	402.58	6.1105E-08
KR-88	137.	196.32	6.9899E-08
BR-88	19.	1836.01	1.4112E-06
89	46.	1031.88	7.5128E-07
85	143.	513.99	2.7140E-08
SR-85M	137.	231.62	3.6172E-08
SR-91	75.	1024.30	1.1758E-07
SR-92	20.	1383.94	3.3718E-08
Y-83	19.	1836.01	2.8051E-08
Y-91	28.	1204.90	8.1865E-06
Y-91MD	73.	555.57	2.3078E-08
Y-92	80.	934.46	3.0115E-07
Y-93	102.	266.90	2.4657E-07
ZR-95	62.	756.72	4.4330E-08
ZR-97	54.	743.36	2.5236E-08
NB-94	65.	702.63	2.3184E-08
NB-95	64.	765.72	2.5268E-08
NB-97D	68.	1024.50	3.2615E-06
MO-90	105.	257.34	2.2874E-08
MO-99	42.	739.58	1.5554E-07
FC-99MD	148.	140.51	1.5667E-08
RU-103	83.	497.08	2.2525E-08
RU-105	45.	724.50	4.7735E-08
RU-106	58.	621.84	2.0055E-07
AG-110M	66.	657.75	2.3173E-08
CD-109	125.	88.03	4.6609E-07
SN-113	109.	391.69	2.9747E-08
124	242.	602.71	4.0171E-08
125	173.	427.89	8.8185E-08
123M	162.	158.99	1.7544E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
132	149.	228.16	1.9282E-08
132	60.	667.69	2.9120E-08
I-133	81.	529.87	2.4840E-08
I-134	56.	847.03	6.1423E-08
I-135	18.	1260.41	7.9887E-08
XE-131M	155.	163.93	7.3338E-07
XE-133	100.	80.99	4.9791E-08
XE-133M	144.	233.22	1.6625E-07
XE-135	137.	249.79	2.1086E-08
XE-135M	70.	526.56	3.7453E-07
XE-138	99.	258.51	2.7704E-07
CS-134M	170.	127.42	1.4863E-07
CS-136	71.	818.30	2.8560E-08
CS-138	23.	1435.84	1.2588E-07
BA-133	126.	356.00	3.2827E-08
BA-139	151.	165.85	1.3857E-07
BA-140	79.	537.52	8.2983E-08
BA-141	176.	190.22	3.2799E-07
LA-140	13.	1593.49	2.2238E-08
CE-139	151.	165.85	1.7602E-08
CE-141	175.	145.44	3.2444E-08
CE-143	119.	293.26	4.3598E-08
CE-144	187.	133.54	1.4889E-07
ND-147	109.	91.11	5.4773E-08
152	91.	344.27	6.2416E-08
154	15.	1274.45	5.3352E-08
W-181	24.	482.03	2.5205E-08
W-187	86.	479.53	8.8497E-08
HG-203	118.	279.17	2.2632E-08
RH-226	113.	609.31	5.8427E-08
TH-232	59.	2614.66	0.0000E+00
U-235	169.	185.72	2.8297E-08
U-238	171.	131.20	7.4729E-08
NP-239	139.	106.13	6.3709E-08
AM-241	90.	59.54	1.2915E-07

***** 25-FEB-94 13:25:53 *****

FERMI 2 CST SAMPLE 16 HOURS INTODISCHARGE. 3RD CST SAMPLE

SAMPLE FILE NAME: L940511.FEV
 SAMPLE DATE: 25-FEB-94 11:30:00
 SAMPLE IDENTIFICATION: L940511.FEV
 TYPE OF SAMPLE: WATER
 SAMPLE QUANTITY: 500.1000 UNITS: gram
 SAMPLE GEOMETRY: LMAR500
 EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 25-FEB-94 12:01:11 * FWHM(1332) 1.386
 PRESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
 ELAPSED REAL TIME: 3601. SEC * SHAPE PARAMETER: 5.0 3
 ELAPSED LIVE TIME: 3600. SEC * NPR ITERATIONS: 10.

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
 CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV
 KEY/CHNL: 4697016 * HALF LIFE RATIO: 3.00
 OFFSET: 39 3232500 KEY * ABUNDANCE LIMIT: 70.00%

ENERGY WINDOW 40.29 TO 2853.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	74.77	52.	120.	.96	74.41	73	6	1.44E-02	38.6	
2	0	92.71	52.	101.	.61	112.60	111	5	1.45E-02	32.6	
3	0	320.20	85.	151.	1.10	597.10	594	10	2.37E-02	29.5	
4	0	364.02	116.	104.	1.09	690.22	683	13	3.22E-02	21.1	
5	0	428.59	98.	110.	.72	827.69	822	12	2.72E-02	24.4	
6	0	510.98	291.	124.	2.19	1003.11	995	19	8.07E-02	11.9	
7	0	565.35	32.	29.	1.01	1118.85	1117	3	3.98E-03	32.8	
8	0	569.17	88.	64.	1.22	1126.99	1123	10	2.43E-02	20.7	
9	0	604.61	263.	154.	1.31	1202.43	1197	13	7.31E-02	12.3	
10	0	661.71	252.	102.	1.53	1324.00	1316	17	7.19E-02	11.4	
11	0	725.98	236.	46.	1.59	1602.87	1605	13	6.54E-02	9.2	
12	0	811.20	82.	82.	1.29	1642.27	1637	11	2.28E-02	24.8	
13	0	1173.27	482.	43.	1.87	2413.13	2407	17	1.34E-01	5.7	
14	0	1332.49	426.	28.	1.89	2752.10	2742	10	1.18E-01	5.7	
15	0	1460.71	215.	13.	1.74	3025.08	3015	18	5.97E-02	8.9	
16	0	1764.79	50.	3.	2.12	3672.47	3665	18	1.38E-02	19.5	
17	0	2614.92	55.	5.	2.15	5482.41	5473	18	1.54E-02	19.8	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND
 * AFTER ENERGY INDICATES CORRECTED PEAK

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	74.77	52.	120.	.96	74.41	73	6	1.44E-02	38.6	

NUCLIDE IDENTIFICATION SYSTEM
UNKNOWN LINE REPORT

(ND PC VERSION DEC 88)

PAGE 1 *

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
0	74.77	52.	120.	.96	74.41	73	6	1.44E-02	38.6	2.94E+00
2	92.71	21.	101.	.61	112.60	111	5	5.81E-03	***	4.59E+00
5	428.59	98.	110.	.72	827.69	822	12	2.72E-02	24.4	3.35E+00
16	1764.72	3.	3.	2.12	3672.47	3665	18	8.33E-04	***	1.12E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI /gram	ABNDIFF	FAILED	
5	UR-125	427.89	2.77Y	1.000E	0	1.496E -7	38.75%	ABN
6	U-238	569.50	1.00E+10Y	1.000E	0	4.393E -7	12.34%	ABN
16	Ru-226	1764.49	1600.00Y	1.000E	0	2.405E -8	10.17%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION * DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM	15
IDENTIFIED PEAKS	4
ENTIFIED IN SUMMARY REPORT	11
	73.33%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	
					ERROR	%ERR
ANIL-511	AP	109.70M	1.463	7.190E -8	3.408E -8	47.39
CR-51	AP	27.70D	1.001	3.167E -7	9.348E -8	29.51
CO-58	AP	70.80D	1.000	5.900E -8	1.465E -8	24.83
DD-60	AP	1925.00D	1.000	3.911E -7	2.791E -8	7.14

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	
					ERROR	%ERR
I-131	HFP	8.04D	1.004	5.714E -8	1.208E -8	21.13

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	
					ERROR	%ERR
RH-105	FP	35.36H	1.020	1.652E -7	4.377E -8	29.51
SB-122	FP	2.70D	1.011	2.541E -8	8.345E -9	32.84
CS-134	FP	753.10D	1.000	1.556E -7	1.916E -8	12.32
CS-137	FP	30.17Y	1.000	1.474E -7	2.416E -8	16.39

THE DETROIT EDISON COMPANY

ENRICO FERMI II

COPY FOR INFORMATION ONLY

GAMMA SPECTROSCOPY ANALYSIS REPORT

CHS ATTACHMENT # Aux C7

CST 16 HR NRC SPLIT

1030

- 1.39 E-6

PERFORMED BY:

2-25-74

SIGNATURE/DATE

REVIEWED BY:

2-25-74

SIGNATURE/DATE

Detroit Edison Fermi-2 Power Plant

25-FEB-1994 12:41:40.45

Chemistry Department Gamma Spectroscopy Report

Sample Parameters *****
Title: C6T
Sample collection start date: 25-FEB-1994 11:30:00.00
Sample collection end date : 25-FEB-1994 11:30:00.00
Type of sample : liquid
Sample quantity : 1.00020E+03 grams
Sample geometry : MILL Operator: kas

Acquisition Parameters *****
Detector number : DET1 Acquire date : 25-FEB-1994 11:51:19.06
Preset live time : 0 00:50:00.00 Elapsed live time : 0 00:50:00.00
Elapsed real time : 0 00:50:00.17 Percent dead time : 0.00 %

Calibration Parameters *****
Detector number : DET1 Yearly cal date : 14-APR-1993 15:01:38.
ray/channel : 4.79924E-01 Zero offset: -3.52838E-01
Daily cal date : 25-FEB-1994 01:12:21.13

Peak Search Parameters *****
Start channel : 100 End channel : 4096
Height sensitivity : 5.00000 Shape sensitivity : 10.00000
Maximum number of iterations to resolve multiplets : 5

Nuclide Identification Parameters *****
Error tolerance : 1.25000 Half-life ratio : 10.00000
Abundance limit : 30.00000 Library : HOT_CLNT.nlb
Efficiency file : EFFD1.MILL Efficiencies at : Peak energy

Post-NID Peak Search Report

#	Energy	Area	Bknd	FWHM	Channel	Left	Pw	%Err	Fit	Nuclides
0	720.31	75	23	1.33	641.78	637	9	27.9		CR-51
0	804.76	94	24	1.31	1210.25	1203	14	15.2		CS-134
0	836.19	27	19	0.92	1272.93	1264	19	43.2		
0	867.36	77	19	1.82	1325.44	1317	18	18.2		CS-137
0	105.85	73	23	1.56	1591.99	1587	14	17.9		CS-134
0	611.02	72	5	1.22	1622.85	1618	9	21.6		CO-58
0	1177.40	122	6	2.11	2347.27	2336	20	10.1		CO-60
0	1312.40	119	11	2.15	2665.14	2656	21	11.5		CO-60

Rejected Report

Isotope	Half-Life			Energy	% Abund	Activity	% Error	Rejected by
	Half-life	Ratio						
Br-86	6.100	0.01		158.38*	98.80	---	Not found	---
				269.50	36.50	---	Not found	---
				480.44	36.50	---	Not found	---
				749.95	49.50	---	Not found	---
				811.85	86.00	9.816E-08	21.56	
				1561.80	14.00	---	Not found	---
			% Abundances Found =		26.77			
Br-128	2.77Y	0.00		176.33	6.89	---	Not found	---
				380.44	1.50	---	Not found	---
				427.89*	29.33	---	Not found	---
				463.38	10.35	---	Not found	---
				600.56	17.80	---	Not found	---
				606.64	5.02	---	Not found	---
				635.90	11.32	4.922E-07	43.23	
				671.41	1.81	---	Not found	---
			% Abundances Found =		13.47	(Abn. Limit =	68.40%)	
I-131	8.04D	0.00		80.18	2.62	---	Not found	---
				284.30	6.05	---	Not found	---
				364.48*	81.20	---	Not found	---
				636.97	7.26	7.695E-07	43.23	
				722.89	1.80	---	Not found	---
			% Abundances Found =		7.34			
Cl-32	2.30H	0.34		505.90	5.03	---	Not found	---
				522.65	16.10	---	Not found	---
				535.50	0.52	---	Not found	---
				630.22	13.70	---	Not found	---
				650.60	2.66	---	Not found	---
				667.69*	98.70	---	Not found	---
				669.80	4.90	---	Not found	---
				671.60	5.20	---	Not found	---
				727.00	3.20	---	Not found	---
				772.61	76.20	---	Not found	---
				812.20	5.60	1.890E-06	21.56	
				954.55	18.10	---	Not found	---
				1136.03	2.76	---	Not found	---
				1398.57	7.10	---	Not found	---
			% Abundances Found =		2.15	(Abn. Limit =	67.00%)	

Flag: "*" = Kevline

Interference Report
Sample ID : cst

Page :
Acquisition date : 25-FEB-1994 11:51:1

interference correction performed

Brief Nuclide Activity Report
Sample ID : cst

Page :
Acquisition date : 25-FEB-1994 11:51:2

ef Report

Nuclide	Activity uCi/gram	1-Sigma Error
CR-51	4.166E-07	1.160E-07
CO-58	8.465E-08	1.825E-08
CO-60	5.036E-07	5.776E-08
CS-134	1.890E-07	2.877E-08
CS-137	1.946E-07	3.543E-08

Total Activity : 1.388E-06

Minimum Detectable Activity Report

clide	Bcknd Sum	Energy (keV)	MDA (uCi/gram)
24	2.	1368.53	4.1874E-08
59	9.	1099.22	1.0614E-07
CU-64	1.	1345.90	1.1215E-05
ZN-65	11.	1115.52	1.2769E-07

PRE-RELEASE INFORMATION

(4)

Release Permit No. 94CST1

CERTIFIED TRUE COPY

INITIAL: CPRDATE: 2-24-94NRC

1. Discharge Monitor reading:

115 cpm2. Circulating Water Decant Monitor reading from Recorder D11-R806 on
Panel H11-P842C540 in Main Control Room:230 cpm

3. Circulating Water Decant (CWD) line % flow from Control Room Recorder N71-R802:

51.5 %

$$\text{Flow in gallons per minute} = \frac{51.5 \% \text{ flow} \times 30,000 \text{ gpm maximum flow} \times 0.01}{1.55E+04 \text{ gpm}} =$$

4. Maximum tank discharge flow rate: 4.00E+02 gpm
(normally 50 gpm for Waste Sample Tank discharge)5. Tank Volume to be released: 532,980 gal
(from 23.718.05, Att 1, Page 1 for Waste Sample Tank)6. Tank Volume to be released in ml: Vol in gal \times 3785 = 2.02E+09 ml

7. Calculation of dose equation multiplication factor (pre-release estimate):

$$\text{Multiplication Factor} = \frac{1.67E-02 \times \text{Tank volume (from part 5 above)}}{\text{CWD flow rate} \times 5}$$

$$\underline{1.15E-01} = \frac{1.67E-2 \times 532,980 \text{ gal}}{1.55E+04 \text{ gpm} \times 5}$$

8. Discharge Monitor Sensitivity:

1.60E+07 / (uCi/cc)

cpm

Performed by:

James Vandervort 2-24-94

Signature / Date

Reviewed by:

Lynne Craine 2-24-94

Signature / Date

Reviewed by:

(CST only) [] NA

Signature / Date

D4

CALCULATION OF MPC FRACTION

CERTIFIED TRUE COPY

Release Permit No. 94CST1

INITIAL: _____

Type of Sample: CST

DATE: _____

Col. 1 Isotope	Col. 2 Conc.(uCi/ml)	Col. 3 MPC	Col. 4 MPC Fraction
1. Cr-51	2.89E-07	5.00E-03	5.78E-05
2. Mn-54	4.31E-08	3.00E-04	1.44E-04
3. Co-60	5.06E-07	3.00E-05	1.69E-02
4. Cs-134	1.64E-07	9.00E-06	1.82E-02
5. Cs-137	1.11E-07	1.00E-05	1.11E-02
6. I-131	7.30E-08	1.00E-05	7.30E-03
7.			
8.			
9.			
10.			
11.			
12.			
13.			
14.			
15.			
16.			
17.			
18.			
19.			
20.			
21.			
22.			
23.			
24.			
25.			
26.			
27.			
28.			
29.			
30.			
31.			
32.			
33.			
34.			
35.			
Total:		1.19E-06 uCi/ml	MPCF: 5.37E-02


Performed by:

 2-24-94

Signature

Date


Reviewed by:

 2-24-94

Signature

Date

Reviewed by:

 NA

Signature

Date

(CST only) [] NA

CIRCULATING WATER DECANt MONITOR SETPOINT COMPARISON

Release Permit No. 94CST1

1. Estimated Circulating Water Decant Monitor alarm (high high) setpoint based on nuclide mix of batch to be released =

$$\frac{(\text{Cr-51 conc (att 2)} \times 0.098 \times 2.7\text{E+8}) + (\text{Total conc except Cr-51} \times 2.7\text{E+8})}{\text{MPCF (Att 2)} \times 2} + \frac{\text{Circ Water}}{\text{Decant Monitor reading (Att 1)}} =$$

$$\frac{(\ 2.89\text{E-07 uCi/cc} \times 0.098 \times 2.70\text{E+08}) + (\ 8.97\text{E-07 uCi/ml} \times 2.70\text{E+08})}{5.37\text{E-02} \times 2} + 230 \text{ cpm}$$

$$= 2.56\text{E+03 cpm}$$

2. Installed Circulating Water Decant Monitor alarm (high high) setpoint

$$= 1700 \text{ cpm}$$

3. Setpoint change required? _____ YES NO

Performed by:

J. L. VanDerveer 2-24-94
Signature / Date

Reviewed by:

J. L. VanDerveer 2-24-94
Signature / Date

Reviewed by:

_____ (CST only) [] NA
Signature / Date

CERTIFIED TRUE COPY

INITIAL: _____

DATE: _____

**CALCULATION OF DISCHARGE MONITOR RELEASE RATE AND SETPOINT -
CIRCULATING WATER NOT CONTAMINATED**

Release Permit No. 94CST1

BF = 0.1
H3MPCF = 0.13
H3F = 0.90

$$1. \text{ Maximum Allowable Release Rate} = \frac{\text{CWD flow rate (Alt 1)} \times 0.5}{[(\text{MPCF(Alt 2)} \times (1 + \text{BF})) + \text{H3MPCF}]} = \frac{1.55E+04 \text{ gpm} \times 0.5}{[(5.37E-02 \times (1 + 0.1)) + 1.3E-1]} = 4.09E+04 \text{ gpm}$$

2. Determination of "Estimated release rate" (for use in Part 3 and 4 below):

- a) If maximum allowable release rate is greater than or equal to maximum release tank discharge flow rate, estimated release rate equals maximum release tank discharge flow rate (from Alt 1, Part 4).
- b) If maximum allowable release rate is less than maximum release tank discharge flow rate, estimated release rate equals maximum allowable release rate.

$$3. \text{ Total MPC fraction at discharge point} = \frac{\text{Estimated release rate} \times [\text{MPCF} \times (1 + \text{BF}) + \text{H3MPCF}]}{\text{CWD flow rate}} \\ = \frac{4.00E+02 \text{ gpm} \times [5.37E-02 \times (1 + 0.1) + 1.3E-1]}{1.55E+04 \text{ gpm}} = 4.89E-03$$

$$4. \text{ Discharge Monitor Setpoint} = \frac{\text{Total conc (Alt 2)} \times \text{Monitor Sensitivity (Alt 1)} \times \text{CWD flow rate (Alt 1 Part 3)} \times \text{H3F}}{\text{MPCF (Alt 2)} \times \text{Estimated release rate (Alt 4 Part 2)} \times (1 + \text{BF})} + \text{Discharge Monitor Background Reading (Alt 1 Part 1)} \\ = \frac{1.19E-06 \text{ uCi/cc} \times 1.60E+07 /(\text{uCi/cc}) \times 1.55E+04 \text{ gpm} \times 0.99}{5.37E-02 \times 4.00E+02 \text{ gpm} \times (1 + 0.1)} + 115 \text{ cpm} \\ = 1.24E+04 \text{ cpm}$$

INITIAL:
DATE:

CERTIFIED TRUE COPY

Performed by J. L. Hause, P.E. Date 2-24-94
 Reviewed by J. L. Hause, P.E. Date 2-24-94
 Reviewed by _____ Date _____

(CST only) NA

PRE-RELEASE LIQUID EFFLUENT DOSE CALCULATION

Release Permit #
Multiplication factor94CST1
1.15E-01

Nuclide	uCi/oo	Bone Factor	Bone Dose	Liver Factor	Liver Dose	T body Factor	T body Dose	Thyroid Factor	Thyroid Dose	Kidney Factor	Kidney Dose	Lung Factor	Lung Dose	QH-LI Factor	QH-LI Dose
Cr-51	2.89E-07					1.29E+00	4.30E-08	7.70E-01	2.50E-08	2.84E-01	9.46E-09	1.71E+00	5.69E-08	3.24E+02	1.08E-05
Mn-54	4.31E-08			4.40E+03	2.19E-05	8.40E+02	4.17E-08			1.31E+03	6.51E-06			1.35E+04	6.70E-05
Co-60	5.06E-07				2.68E+02	1.56E-05	5.90E+02	3.44E-05						5.03E+03	2.03E-04
Ca-134	1.84E-07	2.98E+05	5.63E-03	7.00E+05	1.34E-02	5.80E+05	1.10E-02			2.30E+05	4.35E-03	7.62E+04	1.44E-03	1.24E+04	2.34E-04
Ca-137	1.11E-07	3.82E+05	4.69E-03	5.22E+05	6.68E-03	3.42E+05	4.37E-03			1.77E-05	2.26E-03	5.90E+04	7.55E-04	1.01E+04	1.29E-04
I-131	7.30E-08	1.72E+02	1.45E-06	2.48E+02	2.07E-08	1.41E+02	1.19E-06	8.08E+04	6.78E-04	4.21E+02	3.54E-06			6.49E+01	5.48E-07

CERTIFIED TRUE COPY

INITIAL: _____

DATE: _____

This release	Bone	Liver	T Body	Thyroid	Kidney	Lung	QH-LI
Gamma organ dose (mRem)	1.05E-02	2.01E-02	1.54E-02	6.78E-04	6.62E-03	2.19E-03	7.35E-04
Pure beta organ dose (mRem)	7.04E-04	3.10E-04	1.99E-04	1.19E-04	1.19E-04	2.26E-04	2.84E-04
Total organ dose (mRem)	1.12E-02	2.04E-02	1.56E-02	7.97E-04	6.74E-03	2.42E-03	1.02E-03
Cumulative Qtr prior to release							
Gamma organ dose (mRem)							
Pure beta organ dose (mRem)							
Total organ dose (mRem)							
Cumulative Qtr after release							
			Total body dose limit: 1.5 mRem/Qtr			Max dose to organ: 5.0 mRem/Qtr	
Gamma organ dose (mRem)	1.05E-02	2.01E-02	1.54E-02	6.78E-04	6.62E-03	2.19E-03	7.35E-04
Pure beta organ dose (mRem)	7.04E-04	3.10E-04	1.99E-04	1.19E-04	1.19E-04	2.26E-04	2.84E-04
Total organ dose (mRem)	1.12E-02	2.04E-02	1.56E-02	7.97E-04	6.74E-03	2.42E-03	1.02E-03
Cumulative Year prior to release							
Gamma organ dose (mRem)							
Pure beta organ dose (mRem)							
Total organ dose (mRem)							
Cumulative Year after release							
			Total body dose limit: 3.0 mRem/Year			Max dose to organ: 10 mRem/Year	
Gamma organ dose (mRem)	1.05E-02	2.01E-02	1.54E-02	6.78E-04	6.62E-03	2.19E-03	7.35E-04
Pure beta organ dose (mRem)	7.04E-04	3.10E-04	1.99E-04	1.19E-04	1.19E-04	2.26E-04	2.84E-04
Total organ dose (mRem)	1.12E-02	2.04E-02	1.56E-02	7.97E-04	6.74E-03	2.42E-03	1.02E-03

Performed by Thomas Noland Date 2-24-94Reviewed by V. Linda CraineDate 2-24-94

Reviewed by _____ Date _____ (CST only) [] NA []

LIQUID EFFLUENT RELEASE FROM CONDENSATE STORAGE TANK

PARAMETER	RESULTS	TOLERANCE
Total Activity Concentration Ratio (Sample 1/Sample 2)	0.68	0.6 - 1.67
Time Between Sample 1 and 2	4.7 hour(s)	>= 1 hour
Total MPC Fraction at Decant Line	4.89E-03	<1.0
Sample Composited (YES/NO)		YES
Pre-Release Cumulative Total Body Dose - Quarter (mrem)	1.56E-02 mrem	<= 1.5 mrem T. Body/Qtr
Pre-Release Cumulative Maximum Organ Dose - Quarter (mrem)	2.04E-02 mrem	<= 5.0 mrem Organ/Qtr
Pre-Release Cumulative Total Body Dose - Year (mrem)	1.56E-02 mrem	<= 3.0 mrem T. Body/Yr
Pre-Release Cumulative Maximum Organ Dose - Year (mrem)	2.04E-02 mrem	<= 10 mrem Organ/Yr
Background Reading	115 cpm	N/A
Source Check Reading (2 Minute Average)	cpm	> 2500 + Background
Test 2 Count Rate	cpm	70,000 to 80,000 cpm
High Voltage	Kilovolts	< 1.5 Kilovolts

Comments _____

Setpoint Installed by _____ Date _____

Setpoint Verified by _____ Date _____

ACCEPTANCE CRITERIA

1. The results of information recorded in the above table is within the specified tolerances and required signatures are present

Performed by _____ Date _____

CERTIFIED TRUE COPY
INITIAL _____
DATE: _____

DETROIT EDISON FERMI-2 POWER PLANT

24-FEB-1994 13:58:17.89

RADIATION PROTECTION DEPARTMENT

GAMMA SPECTROSCOPY ANALYSIS REPORT

Sample ID Number: 203-E94

Acquisition Time: 24-FEB-1994 13:24:50.65

Storage file: 203-E94.cnf

REMARKS CSC - 2nd Sample

VERIFIED TRUE COPY

INITIAL:


DATE:

PERFORMED BY:



SIGNATURE

REVIEWED BY:

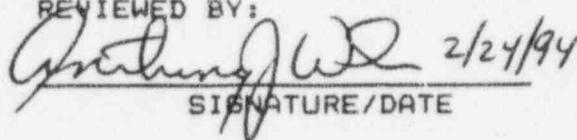

2/24/94

SIGNATURE/DATE

Fermi 2 Radiation Protection Gamma Spectroscopy Report

Sample ID Number: 203-E94

Sample collection start date: 24-FEB-1994 12:52:00.00

Sample collection end date : 24-FEB-1994 12:52:00.00

Type of sample : 1 Liter Marinelli

Sample quantity : 1.00170E+03 ml

Sample geometry : M1LL

Operator: BPP

Detector number : DET1 Acquire date : 24-FEB-1994 13:24:50.65
Preset live time : 0 00:33:20.00 Elapsed live time : 0 00:33:20.00Elapsed real time : 0 00:33:20.35 Percent dead time : 0.00 %

Detector number : DET1 Yearly cal date : 10-MAR-1993 14:54:45.27
Kev/channel : 4.99927E-01 Zero offset: 7.03954E-01Daily cal date : 24-FEB-1994 08:27:39.11

Start channel : 100 End channel : 4096
Height sensitivity : 5.00000 Shape sensitivity : 10.00000Maximum number of iterations to resolve multiplets : 5

Energy tolerance : 1.25000 Half-life ratio : 10.00000
Abundance limit : 75.00000 Library : dacmaster.nlbEfficiency file : EFD1_m1ll Efficiencies at : Peak energy

Pk	It	Energy	Area	Bkgnd	FWHM	Channel	Left	Fw	Cts/Sec	%Err	Fit
1	0	320.29	26	23	0.59	639.29	634	9	1.32E-02	41.4	
2	0	364.98	49	9	1.32	728.67	722	14	2.44E-02	27.5	
3	0	563.63	7	8	1.14	1126.08	1124	5	3.51E-03	68.1	
4	0	604.86	84	46	1.68	1208.56	1202	17	4.20E-02	21.6	
5	0	661.33	46	23	1.56	1321.51	1316	13	2.30E-02	27.0	
6	0	795.51	50	10	1.95	1589.95	1581	17	2.51E-02	19.6	
7	0	834.74	16	7	1.52	1668.44	1666	8	8.22E-03	38.0	
8	0	1172.74	131	10	2.93	2344.65	2333	19	6.57E-02	11.6	
9	0	1331.88	129	0	3.30	2663.06	2649	25	6.45E-02	8.8	

CERTIFIED TRUE COPY

INITIAL: _____

DATE: _____

****dison Fermi 2 Peak Report, Generated 24-FEB-1994 13:58:23.01****
 ****3-E94****
 0 00:32:50.65 Deposition Time = *Re 2124/14*
 17-NOV-1958 00:00:
 Peak Search Report

Energy	Area	Bkgnd	FWHM	Channel	Left	Pw	%Err	Fit	Nuclides
0 320.29	26	23	0.59	639.29	634	9	41.4		
0 364.98	49	9	1.32	728.67	722	14	27.5		CR-51
0 563.63	7	8	1.14	1126.08	1124	5	68.1		I-131
0 604.86	84	46	1.68	1208.56	1202	17	21.6		CS-134
0 661.33	46	23	1.56	1321.51	1316	13	27.0		SB-122 - Attributed to CS
0 795.51	50	10	1.95	1589.95	1581	17	19.6		CS-134
0 834.74	16	7	1.52	1668.44	1666	8	38.0		CS-137 No com peaks to
0 1172.74	131	10	2.93	2344.65	2333	19	11.6		MN-54 SB-122 - 1
0 1331.88	129	0	3.30	2663.06	2649	25	8.8		CO-60 CO-60 error

CERTIFIED TRUE COPY

INITIAL: _____

DATE: _____

Summary of Nuclide Activity
Sample ID : 203-E94

Page : 2

Acquisition date : 24-FEB-1994 13:24:50

Total number of lines in spectrum 9
Number of unidentified lines 0
Number of lines tentatively identified by NID 9 100.00%

Nuclide Type : activation

Nuclide	Hlife	Decay	Uncorrected uCi/ml	Decay Corr uCi/ml	Decay Corr 1-Sigma Error	1-Sigma %Error Flags
CR-51	27.70D	1.001	2.890E-07	2.893E-07	1.197E-07	41.36
IN-54	312.70D	1.000	4.313E-08	4.314E-08	1.639E-08	38.00
CO-60	5.27Y	1.000	5.055E-07	5.055E-07	0.445E-07	8.80 A
9B-122	2.70D	1.009	1.773E-08	1.780E-08	1.218E-08	68.18 CS-134
CS-134	2.06Y	1.000	1.637E-07	1.637E-07	0.353E-07	21.58 7M2-2494
Total Activity :			1.019E-06	1.019E-06		

Nuclide Type : fission

Nuclide	Hlife	Decay	Uncorrected uCi/ml	Decay Corr uCi/ml	Decay Corr 1-Sigma Error	1-Sigma %Error Flags
I-131	8.04D	1.003	7.281E-08	7.302E-08	2.010E-08	27.52
CS-137	30.17Y	1.000	1.111E-07	1.111E-07	0.300E-07	26.99
Total Activity :			1.839E-07	1.841E-07		

Grand Total Activity : 1.203E-06 1.204E-06

Flags: "K" = Keyline not found
"E" = Manually edited

"M" = Manually accepted
"A" = Nuclide specific abn. limit

CERTIFIED TRUE COPY

JATEL

Identified Energy Lines
Sample ID : 203-E94

Page : 3

Acquisition date : 24-FEB-1994 13:24:50

None

Flags: "T" = Tentatively associated

IDENTIFIED TRUE COPY
BY: _____
DATE: _____

Nuclide	Half-life	Ratio	1-Sigma					
			Energy	%Abund	Activity	%Error	Rejected by	
AS-76	26.32H	0.03	559.10*	44.70	---	Not found	---	Abun.
			563.23	1.17	1.093E-06	68.12		
			571.30	0.14	---	Not found	---	
			657.03	6.10	---	Not found	---	
			665.31	0.39	---	Not found	---	
			740.12	0.12	---	Not found	---	
			771.76	0.12	---	Not found	---	
			867.63	0.12	---	Not found	---	
			1129.87	0.14	---	Not found	---	
			1212.72	1.63	---	Not found	---	
			1216.02	3.84	---	Not found	---	
			1228.52	1.39	---	Not found	---	
			1439.13	0.33	---	Not found	---	
			1453.60	0.13	---	Not found	---	
			1787.67	0.33	---	Not found	---	
			% Abundances Found = 1.93					
BR-84	31.80M	1.56	604.80	1.80	2.555E-05	21.58	Abun.	
			736.50	1.31	---	Not found	---	
			802.20	6.10	---	Not found	---	
			881.50*	42.00	---	Not found	---	
			1015.90	6.20	---	Not found	---	
			1213.30	2.60	---	Not found	---	
			1463.80	2.00	---	Not found	---	
			1741.20	1.60	---	Not found	---	
			1877.50	1.14	---	Not found	---	
			1897.30	14.90	---	Not found	---	
			2029.60	2.10	---	Not found	---	
			% Abundances Found = 2.20					
KR-88	2.84H	0.29	165.98	3.10	---	Not found	---	Abun.
			196.32*	26.00	---	Not found	---	
			362.23	2.25	---	Not found	---	
			834.83	13.00	4.054E-07	38.00		
			985.78	1.31	---	Not found	---	
			1141.33	1.28	---	Not found	---	
			1179.51	1.00	---	Not found	---	
			1250.67	1.12	---	Not found	---	
			1369.50	1.48	---	Not found	---	
			1518.39	2.15	---	Not found	---	
			1529.77	10.90	---	Not found	---	
			2029.84	4.53	---	Not found	---	
			2035.41	3.74	---	Not found	---	
			% Abundances Found = 18.09					
ND-147	10.98D	0.00	91.10*	28.00	---	Not found	---	Abun.
			319.41	1.96	1.453E-06	41.36		
			439.90	1.20	---	Not found	---	
			531.02	13.10	---	Not found	---	
			% Abundances Found = 4.43					
AC-228	6.13Y	0.00	129.08	2.80	---	Not found	---	Abun.

Minimum Detectable Activity Report

Radionuclide	Bckgnd Sum	Energy (keV)	MDA (μ Ci/ml)
FE-7	16.	477.59	3.1284E-07
F-18	38.	511.00	3.6151E-08
RA-22	1.	1274.54	2.7701E-08
RA-24	2.	1368.53	3.8342E-08
RG-27	5.	1014.44	4.4143E-06
RL-38	2.	1642.42	3.3323E-07
R-40	3.	1460.81	4.2863E-07
RR-41	2.	1293.64	4.8756E-08
RO-46	12.	889.25	5.3526E-08
RO-56	3.	1238.25	5.7516E-08
RN-56	1.	1810.69	1.7326E-07
RI-56	22.	158.38	1.6495E-08
RO-57	21.	122.06	1.8879E-08
RO-58	31.	810.76	7.3583E-08
RE-59	8.	1099.22	9.3110E-08
RU-64	2.	1345.90	1.2778E-05
RI-65	1.	1481.84	1.6889E-07
RN-65	6.	1115.52	9.0974E-08
RN-69M	16.	438.63	3.3707E-08
RE-75	23.	136.00	2.7801E-08
RS-76	10.	559.10	7.0527E-08
RR-82	8.	776.49	4.7056E-08
RR-83	15.	529.64	3.3916E-06
RR-84	12.	881.50	3.5388E-07
RR-85	0.	802.41	Half-Life too short
RR-85	13.	513.99	7.3340E-06
RR-85M	33.	151.18	2.8925E-08
RR-85	13.	513.99	3.1779E-08
RS-86	10.	1076.63	6.4785E-07
RR-87	20.	402.58	9.7743E-08
RR-87M	17.	388.40	4.1605E-08
RR-88	32.	196.32	1.0096E-07
RS-88	0.	1382.39	9.4902E-06
RR-88	0.	1836.01	1.4154E-08
RR-89	0.	820.90	Half-Life too short
RS-89	7.	1031.88	6.8058E-07
RR-90	0.	1118.69	Half-Life too short
RS-90	0.	831.69	Half-Life too short
RR-90M	11.	824.23	6.6281E-04
RR-90M	30.	202.51	2.6517E-08
RR-91	7.	1024.30	1.5679E-07
-91	3.	1204.90	1.2813E-05
-91M	15.	555.60	7.5677E-08
RR-92	0.	1383.94	1.5021E-08
-92	16.	934.46	5.2541E-07
RR-93	14.	590.28	4.1498E-06
-93	23.	266.90	3.5341E-07



Radionuclide	Bckgnd Sum	Energy (keV)	MDA (uCi/ml)
4B-94	12.	702.63	4.1214E-08
4B-95	5.	765.79	3.1523E-08
4B-95M	29.	235.69	9.5164E-08
4R-95	5.	756.72	5.7876E-08
4B-97	16.	657.90	7.1961E-08
4R-97	8.	743.36	3.8407E-08
4O-99	8.	739.58	2.9006E-07
4C-99M	18.	140.50	1.8171E-08
4C-101	19.	306.81	2.7057E-07
4U-103	13.	497.08	3.5176E-08
4C-104	17.	357.99	1.8082E-07
4H-105	37.	318.90	1.7483E-07
4U-105	8.	724.50	8.3781E-08
4U-106	11.	621.84	3.5460E-07
4D-109	17.	88.03	5.2105E-07
4G-110M	11.	937.48	1.5761E-07
4N-113	18.	391.69	4.4319E-08
4N-117M	24.	158.56	1.9634E-08
4B-124	66.	602.71	7.8254E-08
4B-125	37.	427.89	1.4689E-07
4E-125M	15.	109.28	5.2562E-06
4E-127	18.	417.90	3.2507E-06
4E-127M	22.	57.60	1.9325E-05
4E-127	31.	202.84	3.2101E-08
4E-129	21.	459.60	8.2163E-07
4E-129M	4.	695.88	8.0733E-07
4E-129M	31.	196.56	4.4859E-07
4-130	13.	536.09	3.5656E-08
4A-131	25.	123.80	5.9558E-08
4E-131	25.	149.72	9.3163E-08
4E-131M	7.	773.67	9.7107E-08
4E-131M	22.	163.93	8.4604E-07
4-132	12.	667.69	5.0039E-08
4E-132	26.	228.16	2.5028E-08
4A-133	14.	302.84	1.1350E-07
4A-133M	26.	276.09	1.4004E-07
4-133	15.	529.87	4.2047E-08
4E-133M	15.	912.58	1.2748E-07
4E-133	22.	81.00	6.7296E-08
4E-133M	29.	233.22	2.3073E-07
4-134	9.	884.09	1.3340E-07
4E-134	18.	210.47	1.7995E-07
4A-135M	22.	268.24	1.4503E-07
4-135	3.	1260.41	1.5279E-07
4E-135	20.	249.79	2.4694E-08
4E-135M	11.	526.56	3.1529E-07
4S-136	11.	818.50	4.7225E-08
4-136	0.	1313.02	Half-Life too short
4E-137	9.	455.49	1.8432E-04
4S-138	3.	1435.86	1.6777E-07
4E-138	21.	258.31	7.0713E-07

Minimum Detectable Activity Report (continued)

Page : 3

Sample ID : 203-E94

Acquisition date : 24-FEB-1994 13:24:50

Nuclide	Bckgnd Sum	Energy (keV)	MDA (uCi/ml)
BA-139	1.	1420.50	1.6409E-05
CE-139	27.	165.85	2.2340E-08
CS-139	1.	1283.23	1.2055E-05
BA-140	11.	537.32	1.2221E-07
LA-140	1.	1596.49	3.5918E-08
BA-141	24.	190.22	2.3054E-07
CE-141	22.	145.44	3.2978E-08
LA-141	1.	1354.52	1.2711E-06
BA-142	26.	255.12	2.7219E-06
LA-142	12.	641.17	1.0390E-07
CE-143	21.	293.26	5.7126E-08
CE-144	19.	133.54	1.4089E-07
PR-144	0.	1489.15	2.6382E-05
ND-147	19.	91.10	6.9410E-08
PM-148M	18.	550.27	4.1193E-08
EU-152	14.	344.27	8.6077E-08
EU-154	8.	1004.76	2.7944E-07
EU-156	5.	646.29	3.8300E-07
HF-181	16.	482.03	4.0142E-08
TA-182	0.	1221.42	3.6086E-08
W-187	8.	685.81	1.2121E-07
RE-188	34.	155.03	1.3537E-07
HG-203	19.	279.19	2.8619E-08
BI-207	21.	569.67	4.4438E-08
TL-208	0.	583.14	Half-Life too short
PB-212	35.	238.63	6.1327E-08
BI-214	20.	609.31	5.1130E-07
PB-214	17.	351.92	2.3843E-07
RA-224	26.	240.98	5.8134E-07
RA-226	38.	186.21	6.8539E-07
AC-228	12.	338.32	1.8721E-07
TH-228	17.	84.37	1.6754E-06
PA-234	17.	131.20	7.6506E-08
TH-234	37.	63.29	1.5786E-06
J-235	23.	143.76	1.5568E-07
NP-239	20.	106.13	7.5038E-08
AM-241	28.	59.54	1.9117E-07

COPY

***** 24-FEB-94 16:00:21 *****

MONROE INTAKE/FERMI 2 SAMPLE.

(5)

STRAL FILE NAME: L940431.FEV
AMPLE DATE: 24-FEB-94 06:30:00
SAMPLE IDENTIFICATION: L940431.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 510.2000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

* * * * *

ACQUIRE DATE: 24-FEB-94 15:09:26 * FWHM(1332) 1.886
RELEASE TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 768. SEC * SHAPE PARAMETER: 5.0 %
ELAPSED LIVE TIME: 768. SEC * NBR ITERATIONS: 10.
*

* * * * *

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
ACQ DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV
REV CHNL: 4697016 * HALF LIFE RATIO: 5.00
THRESH: 39.8232300 KEV * ABUNDANCE LIMIT: 10.000
*

* * * * *

ENERGY WINDOW 40.29 TO 2858.03

PK	LT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	1461.01	46.	8.	2.36	3025.72	3017	15	5.229E-02	19.7	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND
* AFTER ENERGY INDICATES CORRECTED PEAK

PK	LT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	1461.01*	3.	8.	2.36	3025.72	3017	15	3.55E-03	*	

D'S

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT

PAGE 1

UNIDENTIFIED PEAKS

NE

LINES NOT MEETING SUMMARY CRITERIA

NONE

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88).
SUMMARY OF NUCLIDE ACTIVITY.

PAGE 2

TOTAL LINES IN SPECTRUM 1
UNIDENTIFIED PEAKS 0
IDENTIFIED IN SUMMARY REPORT 1 100.00%

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
K-40	NP	1.28E+09Y	1.000	1.224E -7		4.613E -7	356.45

***** 24-FEB-94 15:57:43 *****

MONROE INTAKE/FERMI 2 SAMPLE.

CTRAL FILE NAME: L940431.FEV
SAMPLE DATE: 24-FEB-94 06:30:00
SAMPLE IDENTIFICATION: L940431.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 510.2000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUISITION DATE: 24-FEB-94 15:09:26 * FWHM(1032) 1.300
CORRECT TIME(LIVE): 3600. SEC * INTEGRITY: 100
CALIBRED REAL TIME: 68. SEC * SHAPE PARAMETER: 3.00
LIVED LIVE TIME: 68. SEC * NORM. DURATION: 10.

DETECTOR: ORTIC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:26:00 * ENERGY TOLERANCE: 1.00 X10^-4
CHNL: 4697016 * HALF LIFE RATE: 0.000
OFFSET: 39.8232300 KEY * ABUNDANCE LIM: 0.000

ENERGY WINDOW: 1461.01 TO 2858.03

PK	IT	ENERGY	AREA	BKND	FWHM	CHANNEL	LEFT	PW	CTC/SEC	SERR	PIT
1	0	1461.01	46.	8.	2.36	3025.72	3017	15	5.99E-02	19.7	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 93)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 768. CORRECTED LIVE TIME: 768.

PK	IT	ENERGY	AREA	BKND	FWHM	CHANNEL	LEFT	PW	CTC/SEC	SERR	PIT
1	0	1461.01	46.	8.	2.36	3025.72	3017	15	5.99E-02	19.7	

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION. DEC 88)
NUCLIDE LINE ACTIVITY REPORT
ELAPSED LIVE TIME: 768. (PILE-UP CORRECTED)

PAGE 1

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	46.	8.	10.67*	1.362E+00	2.184E -6	4.302E -7

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 768. (PILE-UP CORRECTED)

PAGE " 2

UNIDENTIFIED PEAKS

DONE

LNIES NOT MEETING SUMMARY CRITERIA

NONE

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	1
DENTIFIED PEAKS	0
NTIFIED IN SUMMARY REPORT	1 100.00%

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	SERR
K-40	NP	1.28E+09Y	1.000	2.184E -6		4.302E -7	19.70

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP. 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
Co-7	14.	477.59	3.5421E-07
ANIL-511	50.	511.00	2.0887E-06
NA-22	6.	1274.54	5.5089E-08
NA-24	4.	1368.53	7.1472E-08
CL-38	2.	2167.51	0.0000E+00
AR-41	1.	1293.64	6.3909E-07
SC-46	12.	1120.51	6.9926E-08
CR-51	14.	320.00	2.9823E-07
MN-54	5.	834.83	3.5404E-08
MN-56	9.	846.75	5.1389E-07
TE-97	7.	1099.22	2.3457E-08
CO-57	22.	122.06	3.3005E-08
CO-58	11.	810.76	5.1367E-08
CO-60	12.	1332.49	8.0978E-08
NI-63	2.	1481.84	1.6904E-06
CU-64	10.	1345.90	2.4523E-05
ZN-65	4.	1115.52	7.9129E-08
Zn-65M	18.	433.63	6.4031E-08
AS-75	11.	559.10	1.0285E-07
SE-75	13.	264.65	4.3378E-08
SR-82	16.	554.32	7.3593E-08
BR-84	10.	881.50	HALF LIFE TOO SHORT
KR-85	31.	513.99	1.3399E-05
Y-88M	27.	151.18	1.4452E-07
Y-88	21.	402.53	2.5040E-06
Y-89	21.	196.32	8.3237E-07
RB-88	7.	1836.01	HALF LIFE TOO SHORT
RA-88	7.	1031.88	HALF LIFE TOO SHORT
SR-90	21.	513.97	5.8261E-06
SR-90M	17.	231.69	6.8352E-06
SR-91	6.	1024.30	2.6885E-07
SR-92	5.	1383.94	5.6144E-07
Y-93	7.	1836.01	7.8396E-08
Y-91	7.	1204.90	1.8879E-05
Y-91MD	17.	555.57	2.0034E-08
Y-92	3.	934.46	1.2206E-06
Y-93	17.	266.90	7.8694E-07
ZR-95	17.	756.72	1.0703E-07
ZR-97	3.	743.36	6.1316E-08
NR-94	7.	702.63	3.4958E-08
NB-95	9.	765.79	4.3816E-08
NB-97D	7.	1024.50	6.6055E-06
MO-90	16.	257.34	1.0573E-07
MO-99	6.	739.58	2.9299E-07
TC-99MD	24.	140.51	3.1443E-08
RU-103	13.	497.08	4.1193E-08
RU-105	9.	724.50	3.2859E-07
RU-106	4.	621.84	2.4214E-07
RU-105	10.	318.90	1.5166E-07
RU-110M	10.	657.75	4.1482E-08

PEAK WIDTH ≈ 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM
			UCI /gram
CC-109	22.	88.03	8.9886E-07
SN-113	10.	391.69	4.1479E-08
SB-122	3.	563.93	2.9839E-08
SB-124	23.	602.71	5.7114E-08
SB-125	12.	427.87	1.0674E-07
TE-123M	31.	158.99	3.5328E-08
TE-132	22.	228.16	3.6461E-08
TE-131	24.	364.48	3.0853E-08
TE-132	13.	667.67	3.4253E-07
TE-133	9.	529.87	3.9246E-08
TE-134	9.	347.05	HALF LIFE TOO SHORT
TE-135	8.	1260.41	5.5121E-07
KE-131M	16.	163.93	1.1033E-06
KE-133	21.	80.99	1.0940E-07
KE-133M	17.	233.22	1.2063E-07
KE-135	17.	249.79	6.1518E-08
KE-135M	7.	526.56	HALF LIFE TOO SHORT
KE-138	19.	258.31	HALF LIFE TOO SHORT
CS-134	17.	604.70	4.9158E-08
CS-134M	23.	127.42	1.5990E-08
CS-135	7.	318.50	1.1299E-08
CS-137	25.	661.65	3.3042E-08
CS-138	2.	1435.86	HALF LIFE TOO SHORT
FA-133	19.	356.00	5.8700E-08
FA-139	14.	165.85	9.3463E-06
FA-140	14.	537.32	1.6315E-07
FA-141	20.	190.22	HALF LIFE TOO SHORT
FA-140	2.	1596.49	4.5800E-06
CE-142	14.	165.85	2.4666E-06
CE-141	22.	145.44	5.3222E-06
CE-143	16.	293.26	1.6427E-06
CE-144	32.	133.54	2.8321E-07
ND-147	13.	91.11	2.8701E-08
EU-152	13.	344.27	1.0840E-07
EU-154	6.	1274.45	1.5505E-07
HF-181	16.	482.03	4.8032E-08
W-187	13.	479.53	1.9577E-07
HG-203	10.	279.19	3.0418E-08
RA-226	19.	609.31	1.1000E-07
TH-232	14.	2614.66	0.0000E+00
U-235	24.	185.72	4.3295E-08
U-238	37.	131.20	1.5987E-07
NP-239	19.	106.13	1.1901E-07
AM-241	12.	59.54	2.1662E-07

***** 25-FEB-94 03:07:20 *****

FERMI 2/NRC SPLIT:MONROE WATER INTAKE, SAMPLE #1.

SAMPLE FILE NAME: L940471.FEV
SAMPLE DATE: 25-FEB-94 01:25:00
SAMPLE IDENTIFICATION: L940471.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 492.9000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

REQUIRE DATE: 25-FEB-94 01:42:00 * FWHM(1332) 1.800

RESULT TIME(LIVE): 3600.00 * SENSITIVITY: 5.000

ELAPSED REAL TIME: 3600.00 * SHAPE PARAMETER: 5.0 %

ELAPSED LIVE TIME: 3600.00 SEC * NUR ITERATIONS: 10

* *

ACQ DATE: 25-FEB-94 07:26:01 * LIBRARY:MASTER.LIB

ACQ TIME: 469701.6 * ENERGY TOLERANCE: 1.500 keV

ACQ CHN: 39.8232300 keV * HALF LIFE RATIO: 8.00

ACQ DT: 39.8232300 keV * ABUNDANCE LIMIT: 70.00%

* *

ACQ DATE: 25-FEB-94 07:26:01 * LIBRARY:MASTER.LIB

ACQ TIME: 469701.6 * ENERGY TOLERANCE: 1.500 keV

ACQ CHN: 39.8232300 keV * HALF LIFE RATIO: 8.00

ACQ DT: 39.8232300 keV * ABUNDANCE LIMIT: 70.00%

* *

ENERGY WINDOW: 40.29 TO 2858.02

PK	LT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	DTG/SEC	ZERR	ELT
1	0	238.97	94.	131.	1.10	423.98	420	12	2.61E-02	27.9	
2	0	351.58	58.	70.	1.11	663.74	659	12	1.60E-02	34.7	
3	0	511.00	204.	85.	1.90	1003.15	995	17	5.68E-02	15.0	
4	0	602.12	67.	50.	1.07	1212.19	1207	11	1.87E-02	24.4	
5	0	661.76	38.	54.	.72	1324.12	1318	13	1.06E-02	45.7	
6	0	1120.21	52.	26.	2.00	2300.16	2294	15	1.45E-02	28.2	
7	0	1172.99	36..	17.	2.15	2412.52	2408	11	9.86E-03	27.8	
8	0	1332.76	22.	23.	.72	2752.68	2744	16	5.98E-03	55.2	
9	0	1460.66	182.	25.	2.03	3024.98	3018	14	5.07E-02	9.0	
10	0	1764.61	34.	14.	1.27	3672.10	3666	14	9.35E-03	29.3	
11	0	2614.38	53.	2.	2.32	5482.32	5473	19	1.48E-02	21.3	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	LT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	DTG/SEC	ZERR
1	0	238.97	94.	131.	1.10	423.98	420	12	2.61E-02	27.9
2	0	351.58	58.	70.	1.11	663.74	659	12	1.60E-02	34.7
3	0	511.00	204.	85.	1.90	1003.15	995	17	5.68E-02	15.0
4	0	602.12	67.	50.	1.07	1212.19	1207	11	1.87E-02	24.4
5	0	661.76	38.	54.	.72	1324.12	1318	13	1.06E-02	45.7
6	0	1120.21	52.	26.	2.00	2300.16	2294	15	1.45E-02	28.2
7	0	1172.99	36..	17.	2.15	2412.52	2408	11	9.86E-03	27.8
8	0	1332.76	22.	23.	.72	2752.68	2744	16	5.98E-03	55.2
9	0	1460.66	182.	25.	2.03	3024.98	3018	14	5.07E-02	9.0

11 0 2614.88 53. 9. 2.82 5482.32 5473 19 1.48E-02 21.3

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE*LINE ACTIVITY REPRT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

FISSION GAS

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
XE-135	FG	249.79	0.	0.	89.90*	0.000E+00	.000E 0	.000E 0
		608.18	67.	50.	2.89	2.588E+00	1.449E -6	3.532E -7

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-311	AP	511.00	204	85.	96.73*	2.943E+00	1.518E -7	2.275E -3
	AP	889.25	0.	0.	99.98	0.000E+00	.000E 0	.000E 0
	AP	1120.51	52	26.	99.99*	1.655E+00	4.762E -8	1.545E -3
	AP	1173.72	36	17.	100.00	1.600E+00	5.339E -8	9.281E -3
	AP	1332.49	22	25.	100.00*	1.457E+00	2.227E -8	1.722E -3

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
KU-443	FP	477.92	0.	0.	89.00*	0.000E+00	.000E 0	.000E 0
	FP	610.32	67.	50.	5.60	2.588E+00	6.984E -7	1.702E -7
KU-447	FP	661.55	38.	24.	85.12*	2.435E+00	2.766E -8	1.264E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
~40	NP	1460.81	132.	21.	10.67*	1.362E+00	1.890E -6	1.592E -7
~40	NP	186.21	0.	0.	3.28	0.000E+00	.000E 0	.000E 0
		241.38	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		295.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.92	53	70.	37.20	3.360E+00	6.032E -8	2.091E -8
		609.31	67.	50.	46.30*	2.588E+00	8.442E -8	2.057E -8
		1120.29	52	26	15.10	1.655E+00	3.152E -7	8.903E -8
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	34.	14.	15.80	1.185E+00	2.705E -7	7.913E -8
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0
H-232	NP	238.63	94	131	44.60	5.035E+00	6.287E -8	1.753E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		503.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	53	9.	35.86*	8.881E-01	2.522E -7	5.381E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

PK	IT.	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	*%EFF
1	O	238.97	94.	131.	1.10	423.98	420	12	2.61E-02	27.9	5.03E+00
11	O	2614.88	53.	9.	2.82	5482.32	5473	19	1.48E-02	21.5	8.88E-01

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLL	DECAY	UCI	/g/ am	ABND IFF	FAILED	
1	TH-232	238.63	1.00E+10Y	1.000E	0	6.287E	-8	45.15%	ABN
4	RU-103	610.33	32.34E	1.001E	0	6.984E	-7	5.22%	ABN
4	XE-135	668.18	9.21E	1.072E	0	1.449E	-6	3.11%	ABN
6	CO-46	1120.51	83.90D	1.000E	0	9.762E	-6	50.00%	ABN
11	TH-232	2614.66	1.00E+10Y	1.000E	0	2.522E	-7	45.15%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND,PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	11
UNIDENTIFIED PEAKS	2
IDENTIFIED IN SUMMARY REPORT	9 81.82%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	
					ERROR	SERR
RN71-511	AP	109.70M	1.404	1.518E -7	2.275E -8	14.92
CO-60	AP	1925.00D	1.000	2.222E -8	1.227E -8	55.20

DECAY PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	
					ERROR	SERR
Z-137	FP	30.17Y	1.000	2.760E -3	1.264E -8	45.70

STRUCTURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	
					ERROR	SERR
CO	NP	1.28E+02Y	1.00	1.890E -7	1.624E -7	3.11
Ca-226	NP	1600.00Y	1.000	8.442E -8	1.057E -8	1.97

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SER 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	47.	477.59	1.4099E-07
NA-22	14.	1274.54	1.8354E-08
NA-24	14.	1368.53	2.0294E-08
CL-38	6.	2167.51	0.0000E+00
AR-41	26.	1293.64	3.6125E-08
SC-46	70.	1120.51	3.6746E-08
CR-51	71.	320.08	1.4533E-07
MN-54	64.	834.83	2.7614E-08
MN-56	45.	346.75	3.0365E-08
FE-59	30.	1099.22	4.1996E-08
CO-57	11.	122.06	1.4075E-08
CO-58	57.	810.76	2.0467E-08
NI-65	17.	1481.84	1.2402E-07
CU-66	20.	1345.90	4.9291E-08
ZN-68	35.	1115.52	5.1018E-08
ZN-69M	64.	438.63	1.7734E-08
AS-76	62.	659.10	4.3320E-08
Ge Z	67.	264.65	2.1443E-08
BR-80	52.	554.32	2.4809E-08
BR-84	45.	881.50	1.9240E-07
KR-85	108.	513.92	5.4557E-06
KR-85M	139.	151.18	2.1228E-08
KR-87	70.	402.58	5.2402E-08
Y-88	97.	196.32	5.7421E-08
Y-89	23.	1336.01	1.2087E-06
RB-90	26.	1031.38	4.2505E-07
SR-85	108.	513.92	2.3641E-08
SR-86M	80.	231.69	2.5923E-08
SR-91	43.	1024.50	3.8539E-08
SP-92	17.	1383.94	3.2044E-08
Y-88	23.	1836.01	3.0936E-08
Y-91	53.	1204.90	8.9083E-06
Y-91MD	50.	355.57	1.8995E-08
Y-92	45.	934.46	2.2166E-07
Y-93	64.	266.90	1.9434E-07
ZR-95	57.	756.72	4.2605E-08
ZR-97	47.	743.36	2.3426E-08
NB-94	36.	702.63	1.7295E-08
NB-95	49.	765.72	2.2161E-08
NB-97D	44.	1024.50	2.6182E-06
MO-90	75.	257.34	1.9124E-08
MO-99	24.	739.58	1.1772E-07
TC-92MD	124.	140.51	1.4359E-08
RU-103	58.	497.08	1.8873E-08
RU-105	39.	724.50	4.3800E-08
RU-106	36.	621.84	1.5838E-07
RH-105	66.	318.90	7.2877E-08
110M	57.	657.75	2.1587E-08
110Z	93.	38.03	4.0299E-07
113	63.	391.69	2.2669E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM
			UCI /gram
U-222	50.	563.93	2.4436E-08
U-224	41.	602.71	1.6574E-08
SB-125	69.	427.89	5.5826E-03
TE-123M	127	158.99	1.5571E-08
TE-132	96.	228.16	1.5492E-08
I-131	69.	364.48	1.8288E-08
I-132	42.	667.69	2.3639E-08
I-133	61.	529.87	2.1531E-08
I-134	51.	347.03	5.3940E-03
I-135	18.	1260.41	7.9176E-08
SI-131M	121.	163.93	6.4936E-07
SI-133	90.	80.99	4.7321E-08
SI-135M	83.	233.22	1.3007E-07
SE-135	94.	249.79	1.7364E-08
SE-135M	71.	526.56	2.8209E-07
RE-138	73.	258.31	6.1164E-07
Pr-134	43.	604.70	1.7051E-08
Pr-134M	122.	127.42	1.2229E-07
Pr-136	43.	818.50	2.2274E-08
Pr-138	19.	1435.86	9.9729E-08
SA-133	70.	356.00	2.4579E-08
La-139	129.	165.85	1.2162E-07
La-140	62.	537.32	7.3589E-08
BA-141	113.	190.22	2.0593E-07
La-140	12.	1596.49	2.1377E-08
La-139	129.	165.85	1.6308E-08
La-141	136.	145.44	2.3672E-08
Tl-143	80.	293.26	3.5751E-08
La-140	103.	133.54	1.1342E-07
La-141	78.	91.11	4.6432E-08
Cl-132	56.	344.27	4.9081E-08
Cl-134	14.	1274.45	5.1667E-08
Cl-131	71.	482.03	2.1956E-08
Br-137	56.	479.53	7.0544E-08
Ag-203	82.	279.19	1.8911E-08
TH-232	62.	2614.66	0.0000E+00
U-235	130.	185.72	2.4878E-08
U-238	116.	131.20	6.1755E-08
NP-239	138.	105.13	6.3548E-08
AM-241	68.	59.54	1.1253E-07

***** 25-FEB-94 03:12:20 *****

FERMI 2/NRC SPLIT:MONROE WATER INTAKE,SAMPLE #1.

STRAL FILE NAME: L940471.FEV
AMPLE DATE: 25-FEB-94 01:25:00
SAMPLE IDENTIFICATION: L940471.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 498.0000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMARSC

PRODUCTION DATE: 22-FEB-94 12:42 * FWHM(1332) 1.886

ACQUISITION TIME: 3600. SEC * SENSITIVITY: 5.000

ANALYSIS TIME: 3600. SEC * SHAPE PARAMETER: 5.0

DETECTION TIME: 3600. SEC * NBR ITERATIONS: 10

DETECTOR: ORTEC * LIBRARY:MASTER.LIB

ACQ/B DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.00 KEV

CHNL: 4697016 * HALF LIFE RATIO: 8.00

DET SET: 32.8232300 KEV * ABUNDANCE LIMIT: 70.00%

PEAK SEARCH COMPLETED (REV 15.8 - 4D PC VERSION NOV 89)

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	238.97	70.	131.	1.10	423.98	420	12	2.61E-02	37.2	
2	0	351.58	58.	70.	1.11	663.74	659	12	1.60E-02	34.7	
3	0	511.00	204.	85.	1.90	1003.15	995	17	3.63E-02	19.0	
4	0	609.19	67.	50.	1.07	1212.19	1207	11	1.87E-02	24.4	
5	0	661.76	38.	54.	.72	1324.12	1318	13	1.06E-02	45.7	
6	0	1120.21	52.	26.	2.00	2300.16	2294	15	1.45E-02	28.2	
7	0	1172.99	36.	17.	2.15	2412.52	2408	11	2.86E-03	27.8	
8	0	1332.76	22.	23.	.72	2752.68	2744	16	5.98E-03	55.2	
9	0	1460.66	182.	25.	2.03	324.98	3018	14	5.07E-02	9.0	
10	0	1764.61	34.	14.	2.27	372.10	3666	14	2.35E-03	29.3	
11	0	2614.88	53.	9.	2.82	5482.32	5473	19	1.48E-02	21.3	

PEAK SEARCH COMPLETED (REV 15.8 - 4D PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

PK	IT	ENERGY	AREA	BKGND	FWHM	CHAN	LEFT	PW	CTS/SEC	SERR	FIT
1	0	238.97*	47.	131.	1.10	423.98	420	12	1.31E-02	77.4	
2	0	351.58	58.	70.	1.11	663.74	659	12	1.60E-02	34.7	
3	0	511.00*	12.	85.	1.90	1003.15	995	17	3.28E-03	****	
4	0	609.19*	** 5.	50.	1.07	1212.19	1207	11	1.42E-03	****	
5	0	661.76	38.	54.	.72	1324.12	1318	13	1.06E-02	45.7	
		1120.21 KEV PEAK DELETED									
7	0	1172.99	36.	17.	2.15	2412.52	2408	11	2.86E-03	27.8	

1457.16 KEV PEAK DELETED
1460.66 KEV PEAK DELETED
1764.61 KEV PEAK DELETED
2614.88 KEV PEAK DELETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)

PAGE 1

UNKNOWN LINE REPORT

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
0	0	238.97	47.	131.	1.10	423.98	420	12	1.31E-02	77.4	5.03E+00
2	0	351.58	58.	70.	1.11	663.74	659	12	1.60E-02	34.7	3.86E+00
4	0	609.19	5.	50.	1.07	1212.19	1207	11	1.42E-03	***	2.59E+00
7	0	1172.99	36.	17.	2.15	2412.52	2408	11	9.86E-03	27.8	1.60E+00

LINES NOT MEETING SUMMARY CRITERIA

K	NUCLIDE	ENERGY	SL, S	DECAY	UCI /gram	ABNDIFF	FAILED	
1	TH-232	238.63	1.00E+00	1.000E	0	3.153E-10	25.63%	ABN
2	RA-226	351.92	1600.000	1.000E	0	6.032E-10	53.77%	ABN
3	RU-103	610.33	19.100	1.000E	0	5.326E-10	5.92%	ABN
4	XE-133	608.16	9.120	1.072E	0	1.105E-07	3.11%	ABN
4	RA-226	609.31	1600.000	1.000E	0	6.438E-10	53.77%	ABN
7	CO-60	1173.27	1925.000	1.000E	0	3.339E-10	50.00%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM	6
IDENTIFIED PEAKS	4
NTIFIED IN SUMMARY REPORT	2 33.33%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	1.404	8.770E -9		3.312E -8	377.66

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
CS-137	FP	30.17Y	1.000	2.760E -8		1.264E -8	45.70

***** 25-FEB-94 09:10:34 *****

FERMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #2.

CTRAL FILE NAME: L940491.FEV
SAMPLE DATE: 25-FEB-94 07:10:00
SAMPLE IDENTIFICATION: L940491.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 515.6000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 25-FEB-94 07:10:16 * (AHL,1032) 2.386
ACQ. TIME (SEC): 3600.000 * SENSITIVITY: 2.000
LIVE TIME (SEC): 3600.000 * SHAPE PARAMETER: 3.000
ND COUNTS: 3600.000 * NER ITERATIONS: 10

DIRECTORY: C:\TEC * LIBRARY:MASTER.LIB
MLIB DATE: 25-FEB-94 07:10:01 * ENERGY TOLERANCE: 1.00 KEY
LEV/CHNL: 14697016 * HALF LIFE RATIO: 6.00
OFFSET: 52.6232500 KEY * ABUNDANCE LIMIT: 70.000

ENERGY WINDOW: 20.29 TO 2958.05

PK ID	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	C1S/SEC	%ERR	FILE
1	0	63.24	33.	.30	.93	49.35	47	7	1.06E-02	44.2
2	0	75.01	53.	111.	.96	74.91	72	6	1.47E-02	38.0
3	0	238.42	56.	100.	1.14	422.82	419	8	1.57E-02	34.4
4	0	242.01	70.	114.	1.15	430.47	427	10	1.94E-02	30.6
5	0	294.95	58.	91.	1.31	543.17	539	9	1.62E-02	34.2
6	0	351.78	80.	96.	.93	664.15	660	10	2.24E-02	24.7
7	0	510.74	146.	97	2.10	1002.58	997	12	4.06E-02	16.2
8	0	582.86	45.	27	2.01	1156.12	1153	7	1.25E-02	27.5
9	0	609.37	137.	40	1.50	1212.57	1208	13	3.80E-02	13.6
10	0	777.21	24.	11	1.34	1569.91	1567	7	8.02E-03	32.1
11	0	1331.95	24.	12	1.10	2750.96	2745	15	6.61E-03	52.4
12	0	1460.89	216.	6	1.86	3025.46	3019	14	5.99E-02	7.8
13	0	1763.97	77.	3	2.47	3670.72	3660	21	2.13E-02	13.5
14	0	2614.76	55	0	2.96	5482.07	5475	18	1.53E-02	17.8

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA, CORRECTION = 1.000
UNCORR. LIVE TIME: 3600, CORRECTED LIVE TIME: 3600.

PK ID	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	C1S/SEC	%ERR	
1	0	63.24	33.	.30	.93	49.35	47	7	1.06E-02	44.2
2	0	75.01	53.	111.	.96	74.91	72	6	1.47E-02	38.0
3	0	238.42	56.	100.	1.14	422.82	419	8	1.57E-02	34.4
4	0	242.01	70.	114.	1.15	430.47	427	10	1.94E-02	30.6
5	0	294.95	58.	91.	1.31	543.17	539	9	1.62E-02	34.2
6	0	351.78	80.	96.	.93	664.15	660	10	2.24E-02	24.7

8	0	582.86	45.	23.	2.01	1156.12	1153	7	1.25E-02	27.5	
9	0	609.37	137.	40.	1.50	1212.57	1208	13	3.80E-02	13.6	
10	0	777.21*	29.	11.	1.34	1569.91*	1567	7	8.02E-03	32.1	
11	0	1331.95	24.	19.	1.10	2750.96	2745	15	6.61E-03	52.4	
12	0	1460.89	216.	6.	1.86	3025.46	3019	14	5.99E-02	7.8	
13	0	1763.97	77.	3.	2.47	3670.72	3660	21	2.13E-02	13.5	
14	0	2614.76	55.	0.	2.96	5482.07	5475	18	1.53E-02	17.8	

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

FSSION GAS

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
XE-135	FG	249.79	0.	0.	89.90*	0.000E+00	.000E 0	.000E 0
		608.18	137.	40.	2.89	2.587E+00	2.882E -6	3.918E -7

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	146.	97.	26.73*	2.244E+00	1.100E -7	1.777E -8
DN-60	AP	1173.22	0.	0.	100.00	0.000E+00	.000E 0	.000E 0
		1332.49	14.	19.	100.00*	1.452E+00	2.372E -8	1.246E -8

HALOGEN FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
BR-82	HFP	554.32	0.	0.	70.50*	0.000E+00	.000E 0	.000E 0
		619.07	0.	0.	43.10	0.000E+00	.000E 0	.000E 0
		698.37	0.	0.	23.20	0.000E+00	.000E 0	.000E 0
		776.47	27	11.	33.31	2.164E+00	2.379E -8	7.639E -9
		827.31	0.	0.	24.20	0.000E+00	.000E 0	.000E 0
		1043.97	0.	0.	27.30	0.000E+00	.000E 0	.000E 0
		1317.47	0.	0.	26.90	0.000E+00	.000E 0	.000E 0
		1474.82	0.	0.	16.50	0.000E+00	.000E 0	.000E 0

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
BR-92	FP	241.52	70	114.	3.00	4.794E+00	1.324E -7	2.700E -7
		430.56	0.	0.	3.30	0.000E+00	.000E 0	.000E 0
		953.32	0.	0.	3.60	0.000E+00	.000E 0	.000E 0
		1142.30	0.	0.	2.90	0.000E+00	.000E 0	.000E 0
		1383.94	0.	0.	90.00*	0.000E+00	.000E 0	.000E 0
MO-99	FP	140.51	0.	0.	90.60	0.000E+00	.000E 0	.000E 0
		181.06	0.	0.	6.20	0.000E+00	.000E 0	.000E 0
		366.43	0.	0.	1.37	0.000E+00	.000E 0	.000E 0
		739.58	0.	0.	12.80*	0.000E+00	.000E 0	.000E 0
		778.00	29	11.	4.50	2.164E+00	4.364E -7	1.401E -7
RU-103	FP	497.08	0.	0.	89.00*	0.000E+00	.000E 0	.000E 0
		610.33	137.	40.	5.60	2.587E+00	1.376E -6	1.871E -7

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	216.	6.	10.67*	1.362E+00	2.161E -6	1.636E -7

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
NUCLIDE LINE ACTIVITY REPORT
ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 2

MATERIAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI A	1-SIGMA
							gram	ERROR
RA-226	NP	186.21	0.	0.	3.28	0.000E+00	.000E 0	.000E 0
		241.98	70.	114.	7.49	4.994E+00	2.723E -7	8.340E -8
		295.21	58.	21.	12.20	4.370E+00	1.013E -7	3.458E -8
		351.92	00.	96.	37.20	3.858E+00	8.166E -8	2.016E -8
		609.31	137.	40.	46.30*	2.987E+00	1.663E -7	2.261E -8
		1120.29	0.	0.	15.10	0.000E+00	.000E 0	.000E 0
		1238.11	0.	0.	5.74	0.000E+00	.000E 0	.000E 0
		1644.49	27.	3.	15.80	1.186E+00	5.956E -7	8.060E -8
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0
TH-232	NP	238.63	56.	100.	44.60	5.042E+00	3.654E -8	1.256E -8
		323.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		427.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.14	45.	23.	30.25	2.673E+00	8.115E -8	2.233E -8
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		959.11	0.	0.	16.10	0.000E+00	.000E 0	.000E 0
		1614.66	55	0.	35.86*	8.881E-01	2.515E -7	4.460E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88).
 UNKNOWN LINE REPORT
 ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 3

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	63.24	38.	.80.	.93	49.85	47	7	1.06E-02	44.2
2	0	75.01	53.	111.	.96	74.91	72	6	1.47E-02	38.0
3	0	238.42	56.	100.	1.14	422.82	419	8	1.57E-02	34.4
3	0	582.36	45.	23.	2.01	1156.12	1153	7	1.25E-02	27.5
10	0	777.21	29.	11.	1.34	1569.91	1567	7	8.02E-03	52.1
11	0	1331.95	24.	17.	1.10	2750.96	2745	13	6.51E-03	52.4
14	0	2614.76	55.	0.	2.96	5482.07	5475	13	1.53E-02	17.0

LINEs NOT MEETING SUMMARY CRITERIA

I-K	NUCLIDE	ENERGY	HLF5	DECAY	UCI /gram	END1%	FAILED
3	TH-232	238.63	1.00E+10Y	1.000E	0	3.654E -2	62.12%
4	SR-92	241.52	2.71H	1.299E	0	8.833E -7	2.92%
3	TH-232	583.14	1.00E+10Y	1.000E	0	8.115E -6	62.12%
9	RU-103	610.35	39.35D	1.001E	0	1.576E -6	2.92%
9	XE-135	608.17	9.11H	1.082E	0	2.282E -6	3.11%
10	SR-82	776.49	35.30H	1.021E	0	2.572E -6	76.02%
10	MO-99	778.06	66.02H	1.011E	0	4.364E -7	3.20%
11	CD-60	1332.49	1925.00D	1.000E	0	2.379E -5	50.00%
14	TH-232	2614.66	1.00E+10Y	1.000E	0	2.515E -7	62.12%

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 4

TOTAL LINES IN SPECTRUM	14
IDENTIFIED PEAKS	7
IDENTIFIED IN SUMMARY REPORT	7 50.00%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	102.70M	1.471	1.100E -7	.777E -8	16.16	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
K-40	AP	1.20E+09Y	1,000	2.161E -6	.636E -7	7.80	
Ca-226	IS	1600.00Y	1,000	1.663E -7	2.261E -8	13.59	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

LIDE	BKG	ENERGY	MINIMUM UCI /gram
NA-22	59.	477.59	1.5286E-07
NA-24	21.	1274.54	2.1751E-08
CL-38	22.	1368.53	2.4756E-08
AR-41	6.	2167.51	0.0000E+00
SC-46	24.	1293.64	3.5185E-08
CR-51	56.	1120.51	3.1803E-08
Mn-54	62.	320.08	1.3142E-07
Ni-56	44.	834.83	2.2155E-08
Pt-59	42.	846.75	2.9337E-08
Co-57	51.	1092.22	4.1310E-08
Co-58	122.	122.06	1.4279E-08
Co-60	41.	810.76	2.0862E-08
Cr-65	31.	1352.49	3.1594E-08
Cr-65	20.	1451.84	1.3463E-07
Cr-64	27.	1345.20	5.5789E-06
Cr-65	29.	1115.52	4.4936E-08
Cr-69M	55.	430.63	1.6006E-08
Cr-76	47.	559.10	3.6614E-08
Fe-75	34.	264.65	2.3233E-08
SR-82	53.	554.32	2.4293E-08
SR-84	42.	881.50	2.1118E-07
CR-85	104.	513.99	5.1803E-06
ZR-85M	119.	151.18	1.9370E-08
ZR-87	71.	402.58	5.4600E-08
ZR-88	102.	196.32	5.8708E-08
ZR-88	18.	1836.01	1.3784E-06
ZB-89	37.	1031.38	6.7972E-07
ZR-85	104.	513.99	2.2449E-08
ZR-85M	105.	231.69	3.0991E-08
ZB-91	83.	1024.50	6.3220E-08
ZR-92	18.	1383.74	3.1142E-08
Y-88	18.	1836.01	2.6482E-08
Y-91	29.	1204.20	8.0810E-06
Y-91MD	40.	555.57	1.6587E-08
Y-92	47.	934.46	2.2453E-07
Y-93	78.	266.20	2.0935E-07
ZR-95	40.	756.72	3.4537E-08
ZR-97	42.	743.36	2.1600E-08
NB-94	46.	702.63	1.8917E-08
NB-95	50.	765.79	2.1663E-08
NB-97D	24.	1024.50	1.8805E-06
MO-90	87.	257.34	2.0232E-08
MO-99	26.	739.58	1.1871E-07
TC-99MD	119.	140.51	1.3628E-08
RU-103	52.	497.08	1.7293E-08
RU-105	41.	724.50	4.4295E-08
RU-106	44.	621.84	1.6943E-07
RH-105	70.	318.90	7.2797E-08
110M	50.	657.75	1.9563E-08
109	116.	88.03	4.3550E-07

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

CLIDE	BKG	ENERGY	MINIMUM UCI /gram
113	85.	391.69	2.5479E-08
SB-122	43.	563.93	2.1955E-08
SB-124	48.	602.71	1.7353E-08
SB-125	64.	427.89	5.2024E-08
TE-123M	136.	158.99	1.5591E-08
TE-132	110.	228.16	1.6071E-08
I-131	75.	364.48	1.8457E-08
I-132	52.	667.69	2.6410E-08
I-133	60.	529.87	2.0747E-08
I-134	42.	847.03	5.2193E-08
I-135	19.	1260.41	7.0731E-08
XE-131M	129.	163.93	4.4896E-07
XE-133	70.	30.99	4.0409E-08
XE-133M	102.	233.72	1.3574E-07
XE-135	82.	249.79	1.5840E-08
XE-135M	52.	526.56	3.2571E-07
XE-136	84.	258.31	2.1121E-07
CS-136	51.	604.70	1.7763E-08
CS-138M	121.	127.42	1.2203E-07
CS-139	48.	818.50	2.2777E-08
CS-139	82.	661.65	2.7729E-08
CS-139	25.	1435.86	1.2971E-07
BA-133	80.	356.00	2.5425E-08
BA-139	125.	165.85	1.2318E-07
FA-140	58.	537.32	6.0839E-08
FA-141	127.	190.22	2.5643E-07
LA-140	9.	1596.49	1.7952E-08
CE-139	125.	165.85	1.5533E-08
CE-141	121.	145.44	2.6173E-08
CE-141	86.	293.26	3.5960E-08
CE-142	134.	133.54	1.2222E-07
ND-142	95.	91.11	4.9599E-08
EU-152	64.	344.27	5.0771E-08
EU-154	21.	1274.45	6.1229E-08
HF-181	68.	482.03	2.0722E-08
W-187	58.	479.53	6.9716E-08
HG-205	63.	279.19	1.6040E-08
TH-232	54.	2614.66	0.0000E+00
U-235	128.	185.72	2.3886E-08
U-238	128.	131.20	6.2762E-08
NP-239	124.	106.13	5.8375E-08
AM-241	70.	59.54	1.1048E-07

***** 25-FEB-94 15:51:00 *****

FERMII 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #3.(18 HOUR). *Rpt BKG*

CTRAL FILE NAME: L940521.FEV
SAMPLE DATE: 25-FEB-94 13:25:00
SAMPLE IDENTIFICATION: L940521.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 513.4000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 25-FEB-94 14:29:26 * FWHM(1332) 1.886
RESET TIME(LIVE): 3600. SEC * SENSITIVITY: 1.000
ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 2
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

*

ENERGY WINDOW 40.22 TO 2859.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ZERN	FIT
1	0	238.61	53.	70.	.86	420.21	422	6	1.47E-02	12.7	
2	0	351.92	53.	74.	1.30	664.46	659	11	1.48E-02	36.0	
3	0	511.54	126.	131.	1.56	1004.30	996	21	1.15E-02	13.3	
4	0	610.12	42.	62.	.72	1214.17	1209	13	1.37E-02	38.0	
5	0	661.75	39.	56.	1.28	1324.10	1320	10	1.08E-02	42.9	
6	0	1120.62	33.	41.	.95	2301.03	2297	12	9.26E-03	46.1	
7	0	1331.81	26.	32.	.77	2750.65	2746	12	7.31E-03	51.5	
8	0	1460.84	203.	28.	1.74	3025.36	3018	17	5.64E-02	9.9	
9	0	1764.37	89.	0.	1.67	3671.57	3662	18	2.47E-02	12.8	
10	0	1836.53	33.	3.	2.20	3825.20	3819	14	9.17E-03	25.8	
11	0	2204.61	12.	13.	.56	4608.85	4606	11	3.37E-03	69.1	
12	0	2614.44	38.	15.	1.62	5481.38	5472	17	1.06E-02	24.7	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 1991)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ZERN	FIT
	238.61 KEV PEAK DELETED									
2	0 351.92	53.	74.	1.30	664.46	659	11	1.48E-02	36.0	
	511.54 KEV PEAK DELETED									
4	0 610.12*	8.	32.	.72	1214.17	1209	13	1.09E-03	***	
	661.75 KEV PEAK DELETED									
6	0 1120.62	33.	41.	.95	2301.03	2297	12	9.26E-03	46.1	

1331.84 KEV PEAK DELETED

9 Q 1764.37* 42. 0. 1.67 3671.57 3662 18 1.18E-02 34.2
10 O 1836.53 33. 3. 2.20 3825.20 3819 14 9.17E-03 25.8
11 O 2204.61 12. 13. .56 4608.85 4606 11 3.37E-03 69.1
2614.44 KEV PEAK DELETED

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
)	O	1836.53	33.	3.	2.20	3825.20	3819	14	9.17E-03	25.8	1.15E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLPF	DECAY	UCI /gram	ABNDIFF	FAILED
4	Ru-103	610.33	37.350	1.001E 0	7.609E -8	5.92%	ABN
6	Sc-46	1120.51	83.830	1.001E 0	2.948E -8	50.00%	ABN
10	Rb-88	1836.01	17.80M	3.180E 1	6.234E -6	57.28%	ABN
10	Y-88	1836.01	106.600	1.000E 0	4.223E -3	51.55%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 2

TOTAL LINES IN SPECTRUM	6
IDENTIFIED PEAKS	1
NTIFIED IN SUMMARY REPORT	5 83.33%

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UC1 /gram	1-SIGMA	ERROR	%ERR
RA-226	HP	1600.00Y	1.000	2.192E -2	2.254E -8	321.41	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
7	59.	477.59	1.5356E-07
ANIL-511	231.	511.00	6.2334E-08
NA-22	26.	1274.54	2.4307E-08
NA-24	17.	1368.53	2.2407E-08
CL-38	7.	2167.31	0.0000E+00
AR-41	20.	1293.64	3.9585E-08
K-40	226.	1460.31	7.4548E-07
SC-46	72.	1120.51	3.6223E-08
CR-51	76.	320.08	1.4621E-07
MN-54	41.	834.83	2.1479E-08
MN-56	41.	846.75	3.3653E-08
FE-57	31.	1029.22	4.1502E-08
CO-57	143.	122.06	1.5526E-08
CO-58	53.	810.76	2.3834E-08
CO-60	64.	1332.49	3.9643E-08
TI-60	19.	1481.34	1.5287E-07
U-60	29.	1345.90	5.2801E-06
N-63	37.	1113.52	5.0978E-08
CN-67M	72.	433.03	1.8099E-08
AS-76	68.	559.10	4.4862E-08
SE-73	34.	264.63	2.5336E-08
BR-82	52.	554.32	2.4423E-08
BR-84	45.	881.50	4.4451E-07
BR-85	135.	513.99	5.9274E-06
BR-86	132.	151.18	2.2272E-06
BR-87	68.	462.58	7.2007E-08
CR-88	92.	196.32	6.6260E-08
RE-144	35.	1836.01	6.8079E-06
XB-87	33.	1031.88	2.7567E-06
SR-85	135.	513.99	2.5693E-08
SR-86M	66.	231.62	5.4378E-08
SR-91	33.	1024.30	7.9104E-08
SR-92	28.	1383.94	4.4778E-08
Y-88	35.	1836.01	3.7092E-08
Y-91	37.	1204.20	2.1694E-06
Y-91MD	54.	555.57	2.0132E-08
Y-92	44.	934.46	2.4248E-07
Y-93	95.	266.90	2.4078E-07
ZR-95	74.	756.72	4.7188E-08
ZR-97	46.	743.36	2.3210E-08
NB-24	64.	702.63	2.2409E-08
NB-95	62.	765.79	2.4237E-08
NB-97D	32.	1024.30	2.2229E-06
MO-90	90.	257.34	2.2075E-08
MO-99	25.	732.58	1.1757E-07
TC-99MD	115.	140.51	1.3531E-08
RU-103	43.	497.08	1.5799E-08
RU-105	41.	724.50	4.8394E-08
U-106	59.	621.84	1.9704E-07
U-105	78.	318.90	7.7994E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
110M	49.	657.75	1.9451E-08
CD-109	116.	88.03	4.3738E-07
SN-113	85.	391.69	2.5592E-08
SB-122	55.	563.93	2.5081E-08
SB-124	52.	602.71	1.8144E-08
SB-125	80.	427.89	5.8415E-08
TE-123M	101.	158.29	1.3496E-08
Te-132	122.	228.16	1.7079E-08
Te-131	86.	364.43	1.9883E-08
Te-132	53.	667.67	3.1504E-08
Te-133	60.	529.87	2.1213E-08
Te-134	38.	847.03	7.6378E-08
Te-135	50.	1260.41	1.0647E-07
XE-131M	114.	163.93	6.1348E-07
XE-133	85.	80.99	4.4853E-08
XE-133M	79.	233.22	1.2083E-07
XE-135	103.	249.79	1.8576E-08
XE-135M	65.	526.56	1.5757E-06
XE-138	22.	258.31	4.6258E-06
CS-134	53.	604.76	1.8396E-08
CS-134M	137.	127.42	1.4837E-07
CS-136	42.	818.50	2.1423E-08
CS-137	25.	661.65	3.0186E-08
CS-138	20.	1435.86	2.3387E-07
133	24.	356.00	2.7679E-08
139	105.	165.85	1.4852E-07
Lu-140	56.	537.32	6.8064E-08
La-140	107.	190.22	8.7926E-07
Cl-137	21.	1596.47	2.7796E-08
Cl-137	105.	165.85	1.4299E-08
CE-141	145.	145.44	2.8786E-08
CE-143	79.	293.26	3.5007E-08
CE-144	138.	133.54	1.2459E-07
ND-147	101.	91.11	5.1434E-08
EU-152	68.	344.27	5.2558E-08
EU-154	26.	1274.45	6.8422E-09
HF-181	67.	482.03	2.0736E-08
W-187	66.	479.53	7.5868E-08
HG-203	80.	279.19	1.8158E-08
TH-232	52.	2614.66	0.0000E+00
U-235	134.	185.72	2.4544E-08
U-238	127.	131.20	6.2792E-08
NP-239	124.	106.13	5.9014E-08
AM-241	76.	59.54	1.1561E-07

***** 25-FEB-94 15:38:36 *****

FERMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #3.(18 HOURS).

STRAL FILE NAME: L940521.FEV
PILE DATE: 25-FEB-94 13:25:00
SAMPLE IDENTIFICATION: L940521.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 513.4000 UNIT: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 25-FEB-94 14:27:26 * FWHM(1332) 1.886
PRESET TIME(LIVE): 3600 SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 0
LAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:16:01 * ENERGY TOLERANCE: 1.500 KEY
KEY, CHNL: .469/016 * HALF LIFE RATIO: 8.00
OFFSET: 32.3232300 KEY * ABUNDANCE LIMIT: 70.000

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ZERR	FIT
1	0	238.61	32.	90.	.86	423.21	422	6	1.47E-02	32.7	
2	0	351.92	53.	74.	1.30	664.46	659	11	1.48E-02	36.0	
3	0	511.54	196.	131.	2.36	1004.30	996	21	5.45E-02	18.3	
4	0	610.12	42.	62.	.72	1214.17	1209	13	1.37E-02	38.0	
5	0	661.75	32.	56.	1.28	1324.10	1320	10	1.08E-02	42.9	
6	0	1120.62	33.	41.	.95	2301.03	2297	12	9.26E-03	46.1	
7	0	1331.81	26.	32.	.77	2750.65	2746	12	7.31E-03	51.5	
8	0	1460.84	203.	28.	1.74	3025.36	3018	17	5.64E-02	9.8	
9	0	1764.37	89.	0.	1.67	3571.57	3662	18	2.47E-02	12.8	
10	0	1836.53	33.	3.	2.20	3825.20	3819	14	9.17E-03	25.8	
11	0	2204.61	12.	13.	.56	4608.85	4606	11	3.37E-03	69.1	
12	0	2614.44	38.	15.	1.62	5481.38	5472	17	1.06E-02	24.7	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ZERR
1	0	238.61	33.	90.	.86	423.21	422	6	1.47E-02	32.7
2	0	351.92	53.	74.	1.30	664.46	659	11	1.48E-02	36.0
3	0	511.54	196.	131.	2.36	1004.30	996	21	5.45E-02	18.3
4	0	610.12	42.	62.	.72	1214.17	1209	13	1.37E-02	38.0
5	0	661.75	33.	56.	1.28	1324.10	1320	10	1.08E-02	42.9
6	0	1120.62	33.	41.	.95	2301.03	2297	12	9.26E-03	46.1
7	0	1331.81	26.	32.	.77	2750.65	2746	12	7.31E-03	51.5
8	0	1460.84	203.	28.	1.74	3025.36	3018	17	5.64E-02	9.8

		1764.37	8017.77	9	1.67	7471.57	7460	10	9.47E-03	10	8
10	0	1836.53	33.	3.	2.20	3825.20	3819	14	9.17E-03	25.8	.
11	0	2204.61	12.	13.	.56	4608.85	4606	11	3.37E-03	69.1	.
12	0	2614.44	38.	15.	1.62	5481.38	5472	17	1.06E-02	24.7	.

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

IVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	196.	131.	96.73*	2.941E+00	1.822E -7	3.336E -8
SC-46	AP	889.25	0.	0.	99.98	0.000E+00	.000E 0	.000E 0
		1120.51	33.	41.	99.99*	1.655E+00	2.948E -8	1.359E -8
CU-60	AP	1173.22	0.	0.	100.00	0.000E+00	.000E 0	.000E 0
		1332.49	26.	32.	100.00*	1.458E+00	2.641E -8	1.361E -8

Fission Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
83-80	FP	898.02	0.	0.	14.00	0.000E+00	.000E 0	.000E 0
		1836.01	33.	3.	21.40*	1.151E+00	6.234E -6	1.610E -6
		2677.86	0.	0.	1.96	0.000E+00	.000E 0	.000E 0
Y-88	FP	898.02	0.	0.	93.40	0.000E+00	.000E 0	.000E 0
		1836.01	33.	3.	99.33*	1.151E+00	4.223E -8	1.091E -8
U-103	FP	427.05	0.	0.	39.00*	0.000E+00	.000E 0	.000E 0
		610.33	39.	62.	5.60	2.585E+00	5.092E -7	1.203E -7
Ca-43	FP	661.65	39.	56.	85.12*	2.435E+00	2.732E -8	1.172E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
Co-60	NP	1460.81	203.	28.	10.87*	1.362E+00	2.044E -6	1.226E -7
H-26	NP	186.21	0.	0.	5.28	0.000E+00	.000E 0	.000E 0
		241.28	0.	0.	7.42	0.000E+00	.000E 0	.000E 0
		295.21	0.	0.	12.20	0.000E+00	.000E 0	.000E 0
		351.92	0.	74.	37.20	3.357E+00	5.444E -8	1.258E -8
		609.31	49.	62.	46.30*	2.585E+00	6.043E -8	2.292E -8
		1120.22	33.	41.	15.10	1.655E+00	1.251E -7	3.292E -8
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	82.	0.	15.80	1.186E+00	6.248E -7	8.884E -8
		2204.22	12.	13.	4.98	1.007E+00	3.541E -7	2.447E -7
H-232	NP	238.63	53.	90.	44.60	5.039E+00	3.454E -8	1.128E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		959.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	38.	15.	35.86*	8.832E-01	1.756E -7	4.334E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0 238.61	53.	90.	.86	423.21	422	6	1.47E-02	32.7	5.04E+00
7	0 1331.81	26.	32.	.77	2750.65	2746	12	7.31E-03	51.5	1.46E+00
10	0 1836.53	33.	3.	2.20	3825.20	3819	14	9.17E-03	25.8	1.15E+00
12	0 2614.44	38.	15.	1.62	5481.38	5472	17	1.06E-02	24.7	3.38E-01

INES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI	/gram		ABNDTYPE	FAILED
1	TH-232	238.63	1.00E+10	1.000E	0	3.454E -3		45.15%	ABN
4	Ru-103	610.33	37.00D	1.001E	0	5.007E -3		5.92%	ABN
6	Sc-46	1120.51	82.63D	1.001E	0	2.948E -3		50.00%	ABN
7	Co-60	1332.49	1925.00D	1.000E	0	2.641E -3		50.00%	ABN
10	Rb-88	1836.01	17.80M	3.180E	1	6.234E -6		57.28%	ABN
10	Y-88	1836.01	106.80D	1.000E	0	4.223E -3		51.55%	ABN
12	Th-232	2614.66	1.00E+10	1.000E	0	1.756E -7		45.15%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	12
IDENTIFIED PEAKS	4
NTIFIED IN SUMMARY REPORT	8
	66.67%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	1.805	1.822E -7	3.336E -8	18.31	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
OS-137	FP	30.17Y	1.000	2.732E -8	1.172E -8	42.91	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
K-40	NP	1.28E+09Y	1.000	2.044E -6	1.976E -7	9.76	
RA-226	NP	1600.00Y	1.000	6.043E -8	2.299E -8	38.04	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

IDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	59.	477.59	1.5356E-07
NA-22	26.	1274.54	2.4307E-08
NA-24	17.	1368.53	2.2407E-08
CL-38	7.	2167.51	0.0000E+00
AR-41	20.	1293.64	3.9585E-08
SC-46	72.	1120.51	3.6223E-08
CR-51	76.	320.08	1.4621E-07
MN-54	41.	834.83	2.1479E-08
MN-56	41.	346.75	3.3653E-08
FE-59	31.	1022.22	4.1502E-08
CO-57	143.	122.06	1.5526E-08
CO-58	53.	810.76	2.3834E-08
CO-60	64.	1332.49	3.2643E-08
NI-65	19.	1481.84	1.5287E-07
CU-64	29.	1345.20	5.9801E-06
ZN-65	37.	1115.52	5.0278E-08
ZN-62M	72.	438.63	1.8822E-08
AS-76	58.	559.10	4.4862E-08
SE-75	84.	264.65	2.3336E-08
BR-82	52.	554.32	2.4423E-08
BR-84	45.	881.50	4.4451E-07
KR-85	135.	513.99	5.9274E-06
KR-85M	132.	151.18	2.2272E-08
87	68.	402.58	7.2007E-08
88	29.	176.32	6.6260E-08
RB-88	35.	1874.01	6.8079E-06
RB-89	33.	1031.88	2.7567E-06
SR-85	135.	513.99	2.5693E-08
SR-65M	66.	231.52	3.4378E-08
SR-91	33.	1024.30	7.9104E-08
SR-92	26.	1583.94	4.4778E-08
Y-88	35.	1834.01	3.7092E-08
Y-91	37.	1204.90	2.1694E-06
Y-91MD	54.	555.57	2.0132E-08
Y-92	44.	934.46	2.4248E-07
Y-93	95.	266.90	2.4078E-07
ZR-95	74.	756.72	4.7188E-08
ZR-97	46.	743.36	2.3210E-08
NB-94	64.	702.63	2.2409E-08
NB-95	62.	765.79	2.4237E-08
NB-97D	32.	1024.50	2.2295E-06
MO-90	90.	257.34	2.2075E-08
MO-99	25.	732.58	1.1757E-07
TC-99MD	115.	140.51	1.3531E-08
RU-103	43.	497.08	1.5799E-08
RU-105	41.	724.50	4.8394E-08
RU-106	59.	621.84	1.9704E-07
105	78.	318.90	7.7994E-08
110M	49.	657.75	1.9451E-08
109	116.	88.03	4.3738E-07

PEAK WIDTH = 3.00 FWHM CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM
			UCI /gram
113	85.	391.69	2.5592E-08
122	55.	563.93	2.5081E-08
SB-124	52.	602.71	1.8144E-08
SB-125	80.	427.89	5.8415E-08
TE-123M	101.	158.29	1.3496E-08
TE-132	122.	228.16	1.7079E-08
I-131	86.	364.48	1.9888E-08
I-131	53.	667.69	3.1504E-08
I-133	60.	529.87	2.1213E-08
I-134	38.	847.03	7.6378E-08
I-135	50.	1260.41	1.0647E-07
XE-131M	114.	163.93	6.1348E-07
XE-133	85.	80.29	4.4853E-08
XE-133M	79.	233.22	1.2083E-07
XE-135	103.	249.79	1.8576E-08
XE-135M	65.	526.56	1.5757E-06
XE-138	92.	258.31	4.6858E-06
CS-134	53.	604.70	1.8396E-08
CS-134M	137.	127.42	1.4837E-07
CS-136	42.	818.50	2.1423E-08
CS-138	20.	1435.36	2.3387E-07
BA-133	94.	356.00	2.7679E-08
BA-139	105.	165.85	1.4852E-07
BA-140	56.	537.32	6.8064E-08
141	107.	190.22	8.7926E-07
140	21.	1596.49	2.7779E-08
CE-139	105.	165.85	1.4229E-08
CE-141	145.	145.44	2.8786E-08
CE-143	79.	293.26	3.5007E-08
CE-144	138.	133.54	1.2459E-07
ND-147	101.	91.11	5.1434E-08
EU-152	68.	344.27	5.2558E-08
EU-154	26.	1274.45	6.8422E-08
HF-181	67.	482.03	2.0736E-08
W-187	66.	479.53	7.5868E-08
HG-203	80.	279.19	1.8158E-08
TH-232	52.	2614.66	0.0000E+00
U-235	134.	185.72	2.4544E-08
U-238	127.	131.20	6.2792E-08
NP-239	124.	106.13	5.9014E-08
AM-241	76.	59.54	1.1561E-07

26-FEB-94 04:09:35

FERMI 2 SPLIT SAMPLE; MONROE WATER #4

STRAL FILE NAME: L940541.FEV
SAMPLE DATE: 25-FEB-94 19:30:00
SAMPLE IDENTIFICATION: L940541.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 467.2000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUISITION DATE: 25-FEB-94 19:33:42 * FWHM(1332) 1.886
ACQ. TIME(LIVE): 3600 SEC * SENSITIVITY 5.000
ELAPSED REAL TIME: 3600 SEC * SHAPE PARAMETERS: 5.0 2
LIVE TIME: 3600 SEC * NBR ITERATIONS: 10

MASTER LIBRARY
ONLY DATE: 25-FEB-94 07:22:04 * LIBRARY:MASTER.LIB
LEVEL: 4697300. * ENERGY TOLERANCE: 2.500 KEY
REF ID: 39.8932500 KEY * HALF-LIFE RATIO: 5.00
* ABUNDANCE LIMIT: 10.00%

ENERGY WINDOW 40.29 TO 2658.07

PK	IT	ENERGY	AREA	BKND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	F11
1	0	74.84	28.	139.	1.18	74.54	72	7	7.76E-03	75.3	
2	0	295.36	27.	38.	1.00	544.04	537	8	7.52E-03	65.5	
3	0	352.29	65.	64.	1.15	665.25	662	8	1.80E-02	24.9	
4	0	511.00	175.	134.	1.98	1003.14	995	20	4.85E-02	17.7	
5	0	609.42	50.	40.	1.09	1212.67	1208	9	1.38E-02	30.0	
6	0	662.10	30.	31.	1.41	1324.84	1320	9	8.39E-03	38.7	
7	0	1120.12	49.	16.	1.89	2299.95	2296	9	1.35E-02	23.5	
8	0	1237.03	35.	19.	.96	2548.87	2541	15	9.81E-03	40.9	
9	0	1460.81	194.	16.	1.71	3025.29	3017	15	5.40E-02	8.8	
10	0	1764.65	58.	6.	1.35	3672.17	3665	13	1.62E-02	14.8	
11	0	2615.10	51.	0	2.32	5482.78	5474	19	1.12E-02	14.0	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR
1	0	74.84	28.	139.	1.18	74.54	72	7	7.76E-03	75.3
2	0	295.36	27.	38.	1.00	544.04	537	8	7.52E-03	65.5
3	0	352.29	65.	64.	1.15	665.25	662	8	1.80E-02	24.9
4	0	511.00	175.	134.	1.98	1003.14	995	20	4.85E-02	17.7
5	0	609.42	50.	40.	1.09	1212.67	1208	9	1.38E-02	30.0
6	0	662.10	30.	31.	1.41	1324.84	1320	9	8.39E-03	38.7
7	0	1120.12	49.	16.	1.89	2299.95	2296	9	1.35E-02	23.5
8	0	1237.03	35.	19.	.96	2548.87	2541	15	9.81E-03	40.9
9	0	1460.81	194.	16.	1.71	3025.29	3017	15	5.40E-02	8.8

11 0 2615.10 51. 0. 2.32 5482.78 5474 19 1.42E-02 14.0

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION, DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

Fission Gas

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
XE-135	FG	249.79	0.	0.	89.90*	0.000E+00	.000E 0	.000E 0
		608.18	50.	40.	2.89	2.587E+00	1.141E -6	3.424E -7

Activation Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
U-234	NP	511.00	175.	124.	96.73*	2.243E+00	1.376E -7	2.140E -3
C-14	NP	882.25	0.	0.	99.98	0.000E+00	.000E 0	.000E 0
		1120.51	40.	16.	99.99*	1.655E+00	1.733E -8	1.111E -3

Halogen Fission Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
Xe-135	HEP	529.87	0.	0.	96.30*	0.000E+00	.000E 0	.000E 0
		706.56	0.	1.	1.49	0.000E+00	.000E 0	.000E 0
		856.20	0.	1.	1.23	0.000E+00	.000E 0	.000E 0
		875.53	0.	0.	4.47	0.000E+00	.000E 0	.000E 0
		1236.41	0.	19.	1.42	1.659E+00	2.350E -6	1.043E -6
		1298.22	0.	0.	2.33	0.000E+00	.000E 0	.000E 0

Cl-131 Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	JCI / gram	1-SIGMA ERROR
Cl-131	NP	477.08	0.	0.	39.00*	0.000E+00	.000E 0	.000E 0
		610.23	30.	40.	5.60	2.587E+00	5.507E -7	1.652E -7
		774.47	30.	31.	35.12*	2.434E+00	2.342E -8	9.075E -9

Natural Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	124.	16.	10.67*	1.362E+00	2.150E -6	1.327E -7
RA-226	NP	186.21	0.	0.	3.28	0.000E+00	.000E 0	.000E 0
		241.98	0.	0.	7.42	0.000E+00	.000E 0	.000E 0
		295.21	27.	88.	19.20	4.366E+00	5.191E -8	3.402E -8
		351.92	65.	64.	37.20	3.354E+00	7.270E -9	1.811E -8
		609.31	50.	40.	46.30*	2.587E+00	6.656E -8	1.997E -8
		1120.20	49.	16.	15.10	1.655E+00	3.135E -7	7.354E -8
		1238.11	35.	19.	5.94	1.539E+00	6.209E -7	2.540E -7
		1764.49	58.	6.	15.80	1.185E+00	5.019E -7	7.403E -8
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0
H-232	NP	238.63	0.	0.	44.60	0.000E+00	.000E 0	.000E 0
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.10	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	51.	0.	35.36*	8.380E-01	2.574E -7	3.604E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 13)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0 74.84	28.	139.	1.18	74.54	72	7	7.76E-03	75.3	2.94E+00
11	0 2615.10	51.	0.	2.32	5482.78	5474	12	1.42E-02	14.0	3.88E-01

INES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	REL.	DECAY	UCI /gram	ABNDIFF	FAILED
5	20-103	610.33	39.356	1.001E 0	5.507E -7	5.92%	ABN
5	10-135	602.18	9.111	1.070E 0	1.141E -6	3.17%	ABN
7	30-46	1120.51	33.130	1.000E 0	4.735E -6	50.36%	ABN
3	1-133	1236.41	20.101	1.020E 0	2.550E -6	3.13%	ABN
11	16-232	2614.66	1.00E +2.0V	1.000E 0	2.574E -7	20.12%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	11
UNIDENTIFIED PEAKS	2
IDENTIFIED IN SUMMARY REPORT	9
	81.82%

ACTIVATION PRODUCT

NUCLIDE	SBRP	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-311	AP	102.70M	1.376	1.376E -7	2.440E -8	17.73	

ACTIVATION PRODUCT

NUCLIDE	SBRP	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-311	AP	30.17Y	1.000	2.342E -8	2.021E -9	88.74	

ACTIVATION PRODUCT

NUCLIDE	SBRP	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-311	AP	1.23E 07Y	1.000	2.150E -6	1.897E -7	3.32	
ANIL-311	NP	1600.00Y	1.000	6.656E -8	1.997E -8	30.01	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION) SEP 89

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	63.	477.59	1.7431E-07
NA-22	20.	1274.54	2.3426E-08
NA-24	23.	1368.53	2.7755E-08
CL-38	8.	2167.51	0.0000E+00
AR-41	21.	1293.64	3.4451E-08
SC-46	71.	1120.51	3.9518E-08
CR-51	74.	320.06	1.5843E-07
MN-54	34.	834.83	2.1493E-08
MN-56	41.	846.77	3.0812E-08
PE-59	38.	1099.21	5.0471E-08
CO-57	17.	122.0	1.5863E-08
CD-59	46.	310.76	2.4393E-08
TD-50	43.	1832.49	3.7726E-08
AI-62	6.	1481.84	9.0435E-08
CU-64	19.	1345.90	5.1256E-06
TN-71	56.	1115.57	3.5252E-08
CN-59M	77.	438.63	2.0754E-08
RG-76	66.	559.36	4.7707E-08
DE-78	65.	264.67	2.5791E-08
SR-82	45.	554.31	2.4636E-08
SR-84	24.	891.50	1.4680E-07
KR-85	110.	513.99	5.8796E-06
KR-85M	130.	151.18	2.1866E-08
87	68.	402.58	5.4653E-08
88	114.	196.37	6.6203E-08
8E-88	19.	1836.01	1.1203E-06
88-89	37.	1031.88	5.1525E-07
8H-89	10.	513.99	2.5475E-08
8H-90M	91.	231.60	2.9223E-08
8P-91	79.	1024.30	0.9933E-08
8R-92	12.	1583.94	2.7078E-08
Y-88	19.	1836.01	3.0026E-08
Y-91	21.	1204.90	7.5835E-06
Y-91MD	47.	555.57	1.9642E-08
Y-92	55.	234.46	2.6093E-07
Y-93	81.	266.90	2.3320E-07
ZR-95	59.	756.72	4.6287E-08
ZR-97	40.	743.36	2.3131E-08
NE-94	43.	702.63	2.0185E-08
NB-95	54.	765.79	2.4842E-08
NB-97D	35.	1024.30	2.4919E-06
MO-90	79.	257.34	2.0917E-08
MO-99	32.	739.58	1.4513E-07
TC-99MD	125.	140.51	1.5392E-08
RU-103	56.	497.08	1.9803E-08
RU-105	41.	724.50	4.7832E-08
RU-106	60.	621.84	2.1834E-07
105	69.	318.90	7.9545E-08
110M	40.	657.75	1.9310E-08
109	100.	38.03	4.4623E-07

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
113	62.	391.69	2.4014E-08
122	56.	563.93	2.7610E-08
SB-124	69.	602.71	2.2959E-08
SB-125	57.	427.89	5.4183E-08
TE-123M	125.	158.99	1.6496E-08
TE-132	95.	228.16	1.6462E-08
I-131	62.	364.48	1.8511E-08
I-132	49.	667.69	2.7129E-08
I-133	53.	529.87	2.1419E-08
I-134	42.	847.05	5.1587E-08
I-135	26.	1260.41	1.0144E-07
XE-131M	105.	163.93	6.4592E-07
XE-133	50.	360.99	4.7639E-08
XE-133M	79.	233.22	1.39672E-07
XE-135	35.	242.79	1.7610E-08
XE-135M	58.	526.56	2.6025E-07
XE-138	74.	258.31	6.2612E-07
CS-134	62.	604.70	2.3065E-08
CS-134M	176.	121.47	1.3294E-07
CS-136	57.	815.50	2.2063E-08
CS-138	21.	1435.68	1.0258E-07
BA-133	81.	356.00	2.8234E-08
BA-139	110.	165.85	1.1893E-07
BA-140	53.	537.32	7.2652E-08
I-141	104.	190.22	2.0311E-07
I-140	10.	1596.49	2.0833E-08
TE-139	110.	165.85	1.6081E-08
CE-141	122.	145.44	2.3998E-08
CE-143	75.	295.26	3.6952E-08
CE-144	120.	135.54	1.2225E-07
ND-147	85.	21.11	5.1757E-08
EU-152	66.	344.27	5.6899E-08
EU-154	20.	1274.45	6.5944E-08
HF-181	57.	482.03	2.1007E-08
W-187	62.	479.53	7.9225E-08
HG-203	67.	279.19	1.8253E-08
TH-232	50.	2614.66	0.0000E+00
U-235	124.	185.72	2.5945E-08
U-238	118.	131.20	6.6511E-08
NP-239	108.	106.13	6.0020E-08
AM-241	58.	59.54	1.1093E-07

***** 26-FEB-94 04:12:11 *****
***** RPT-DKG

FERMI 2 SPLIT SAMPLE; MONROE WATER #4

SAMPLE FILE NAME: L940541.FEV
 SAMPLE DATE: 25-FEB-94 19:30:00
 SAMPLE IDENTIFICATION: L940541.FEV
 TYPE OF SAMPLE: WATER
 SAMPLE QUANTITY: 467.2000 UNITS: gram
 SAMPLE GEOMETRY: LMAR500
 EFFICIENCY FILE NAME: LMAR500.EFF

* * * * *

ACQUIRE DATE: 25-FEB-94 19:53:42 * FWHM(1332) 1.886
 PRESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
 ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 %
 ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 50

*

*

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
 CALIB DATE: 23-FEB-94 07:21:01 * ENERGY TOLERANCE: 1.500 KEV
 KEV/CHNL: .4677016 * HALF-LIFE RATIO: 8.90
 EFF CT: 39.8232300 KEV * ABUNDANCE LIMIT: 70.002

*

ENERGY WINDOW 40.29 TO 2858.03

PW	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	PERC	FILE
1	0	74.84	28.	107.	1.18	74.54	72	7	7.76E-03	75.3	
2	0	295.36	27.	88.	1.00	544.04	539	8	7.52E-03	61.5	
3	0	352.29	65.	64.	1.15	665.25	662	3	1.80E-02	24.9	
4	0	511.00	175.	134.	1.98	1003.14	995	20	4.85E-02	17.7	
5	0	609.42	50.	40.	1.09	1212.67	1208	9	1.38E-02	30.0	
6	0	662.10	30.	31.	1.41	1324.84	1320	9	8.39E-03	38.7	
7	0	1120.12	49.	16.	1.89	2299.95	2296	9	1.35E-02	23.5	
8	0	1237.03	35.	19.	.96	2548.87	2541	15	9.81E-03	40.7	
9	0	1460.81	194.	16.	1.71	3025.29	3017	15	5.40E-02	8.8	
10	0	1764.65	58.	6.	1.35	3672.17	3665	13	1.62E-02	14.3	
11	0	2615.10	51.	0.	2.32	5482.78	5474	19	1.42E-02	14.0	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

PW	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	PERC	FILE
1	0	74.84	28.	139.	1.18	74.54	72	7	7.76E-03	75.3	
2	0	295.36	27.	88.	1.00	544.04	539	8	7.52E-03	61.5	
3	0	352.29	65.	64.	1.15	665.25	662	3	1.80E-02	24.9	
		511.00 KEV	PEAK DELETED								
5	0	609.42	3.	40.	1.07	1212.67	1208	2	2.13E-03	91.7	
		662.10 KEV	PEAK DELETED								
7	0	1120.12	49.	16.	1.89	2299.95	2296	9	1.35E-02	23.5	

R D 1237.07 35 19 94 2548.97 2541 16 8 815-03 40 5
1460.81 KEV PEAK DELETED
10 0 1764.65* 12. 6. 1.35 3672.17 3665 13 3.31E-03 ****
2615.10 KEV PEAK DELETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT

*PAGE 1

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
0		74.84	28.	139.	1.18	74.54	72	7	7.76E-03	75.3	2.94E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLP	DECAY	UCI /gram	ABNDIFF	FAILED
5	RU-103	610.33	39.35	1.001E-0	8.518E-8	5.22%	ABN
6	XE-133	608.18	9.12	1.070E-0	1.765E-7	3.11%	ABN
7	SC-46	1120.31	63.38	1.000E-0	4.735E-8	50.00%	ABN
9	I-133	4226.41	26.14	1.050E-0	2.550E-6	1.53%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM	7
IDENTIFIED PEAKS	1
NTIFIED IN SUMMARY REPORT	6
	85.71%

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
RA-226	NP	1600.00Y	1.000	1.030E -6	2.853E +3	277.13	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	63.	477.59	1.7431E-07
ANIL-511	221.	511.00	5.1795E-08
NA-22	20.	1274.54	2.3426E-08
NA-24	23.	1368.53	2.7755E-08
CL-33	8.	2167.51	0.0000E+00
AR-42	21.	1293.64	3.4451E-08
K-40	209.	1460.81	7.3779E-07
SC-41	71.	1120.81	3.9518E-08
CR-51	74.	320.08	1.5843E-07
MN-51	34.	834.83	2.1493E-08
MN-53	41.	846.72	3.0812E-08
Fe-55	38.	1099.22	3.0471E-08
CO-57	119.	122.06	1.5563E-08
CO-60	46.	810.76	2.4393E-08
CO-64	48.	1332.42	3.7726E-08
NI-63	8.	1481.84	9.0435E-08
CU-65	19.	1345.90	5.1236E-08
ZN-65	36.	1115.52	5.5252E-08
ZN-67	77.	433.63	3.0754E-08
Ag-72	66.	559.16	4.7707E-08
Se-75	35.	264.63	2.5791E-08
BR-82	45.	554.32	2.4636E-08
BR-84	24.	881.50	1.4680E-07
BR-85	110.	513.99	5.8796E-08
BR-86	130.	151.10	2.1866E-08
KR-86	65.	402.56	5.1653E-08
KR-89	114.	196.32	5.6203E-08
RB-87	19.	1836.04	1.1263E-06
RB-89	37.	1031.80	5.1525E-07
SR-81	110.	513.99	2.5473E-08
SR-81A	91.	231.67	2.9223E-08
SR-92	39.	1024.30	5.2933E-08
SR-92	12.	1383.94	2.7073E-08
Y-88	19.	1836.01	3.0026E-08
Y-91	21.	1204.90	7.3885E-06
Y-91MD	47.	555.57	1.9642E-08
Y-92	55.	234.46	2.5083E-07
Y-93	81.	266.90	2.33320E-07
ZR-95	59.	756.72	4.6287E-08
ZR-97	40.	743.36	2.3131E-08
NB-94	43.	702.63	2.9185E-08
NB-95	54.	765.79	2.4842E-08
NB-97D	35.	1024.50	2.4919E-06
MO-90	79.	257.34	2.0917E-08
MO-99	32.	739.58	1.4513E-07
TC-99MD	125.	140.51	1.5392E-08
RU-103	56.	497.08	1.9803E-08
105	41.	724.50	4.7832E-08
106	60.	621.84	2.1834E-07
107-108	69.	318.90	7.9545E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
10M	40.	657.75	1.9310E-08
109	100.	88.03	4.4623E-07
3N-113	62.	391.69	2.4014E-08
3B-122	56.	563.93	2.7610E-08
3B-124	62.	602.71	2.2959E-08
3B-125	57.	427.87	5.4183E-08
TE-123M	125.	158.22	1.6496E-08
TE-132	95.	228.16	1.6462E-08
TE-131	62.	364.45	1.3511E-08
TE-132	49.	667.69	2.7129E-08
TE-133	52.	529.37	2.1412E-08
TE-134	42.	847.07	5.1587E-08
TE-135	26.	1260.41	1.0144E-07
KL-131M	105.	163.97	6.4592E-07
KL-133	30.	30.99	4.7638E-08
KL-133M	89.	233.22	1.3967E-07
KE-135	35.	249.77	1.7610E-08
KE-135M	38.	526.56	2.6025E-08
AE-138	74.	253.37	6.2612E-07
TS-134	69.	604.71	2.3065E-08
TS-134M	126.	127.42	1.3224E-07
TS-136	37	810.50	2.2063E-08
TS-137	65.	661.65	2.7438E-08
CS-138	21.	1435.86	1.0958E-07
133	31.	356.00	2.3234E-08
139	110.	165.05	1.1893E-07
141-140	53.	537.32	7.2652E-08
140-141	104.	190.22	2.0311E-07
141-140	10.	1596.49	2.0333E-08
1E-129	110.	165.05	1.6081E-08
1E-141	122.	145.83	2.8923E-08
1E-143	75.	293.26	3.6952E-08
1E-144	127.	133.54	1.2925E-07
ND-147	85.	91.11	5.1757E-08
EU-152	66.	344.27	5.6899E-08
EU-154	20.	1274.45	6.5944E-08
HF-181	57.	482.03	2.1007E-08
H-187	62.	479.53	7.9225E-08
HG-203	67.	279.19	1.8253E-08
H-232	50.	2614.66	0.0000E+00
J-235	124.	185.72	2.5945E-08
J-238	118.	131.20	6.6511E-08
NP-239	108.	106.13	6.0020E-08
AM-241	58	59.54	1.1098E-07

***** 26-FEB-94 10:29:36 *****

FERMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #5.

CTRAL FILE NAME: L940551.FEV
PLE DATE: 26-FEB-94 03:30:00
SAMPLE IDENTIFICATION: L940551.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 511.3000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 26-FEB-94 04:00:46 * FWHM(1332) 1.886
RESE ME(LIVE) 3600 SEC * SENSITIVITY 1.000
ELAPSED REAL TIME: 3600 SEC * SHAPE PARAMETER 5.0 %
LIVE LIVE TIME: 3600 SEC * NEUTRONIC 1.0.

SPEC. ENERGY * LIBRARY:MASTER.LIB
ALIVE DATE: 26-FEB-94 07:00:46 * ENERGY TOLERANCE 10.0 KEV
LIVE TIME: 46070.00 SEC * MAX LIVETIME 1000000.00
LIVE: 37.42320000 KEV * AVERAGE ENERGY 1.000

ENERGY (MEV) 40.29 TC 79738

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTG/SEC	MARK	ST
1	0	74.58	44.	28.	1.76	74.00	72	1	1.23E-02	33.7	
2	0	92.24	59.	137.	2.26	111.60	108	10	1.67E-02	40.5	
3	0	238.38	31.	37.	1.53	422.72	412	9	2.26E-02	24.2	
4	0	511.00	177.	116.	2.29	1003.14	997	19	4.92E-02	17.8	
5	0	582.84	44.	31.	4.46	1156.08	1149	13	1.22E-02	37.3	
6	0	662.09	45.	40.	1.45	1324.82	1320	10	1.25E-02	32.2	
7	0	1356.08	21.	14.	3.63	2802.33	2796	14	5.33E-03	54.9	
8	0	1460.82	179.	16.	1.94	3025.32	3017	15	4.98E-02	9.1	
9	0	1764.56	46.	7.	1.38	3671.97	3664	13	1.27E-02	21.4	
10	0	2614.50	50.	6.	1.64	5481.52	5473	17	1.39E-02	16.5	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 82)

PULSE-FILE-UP CORRECTED DATA, CORRECTION = 1.000
UNCORR. LIVE TIME: 3600 CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTG/SEC	MARK	ST
1	0	74.58	44.	28.	1.76	74.00	72	1	1.23E-02	33.7	
2	0	92.24	59.	137.	2.26	111.60	108	10	1.67E-02	40.5	
3	0	238.38	31.	37.	1.53	422.72	412	9	2.26E-02	24.2	
4	0	511.00	177.	116.	2.29	1003.14	997	19	4.92E-02	17.8	
5	0	582.84	44.	31.	4.46	1156.08	1149	13	1.22E-02	37.3	
6	0	662.09	45.	40.	1.45	1324.82	1320	10	1.25E-02	32.2	
7	0	1356.08	21.	14.	3.63	2802.33	2796	14	5.33E-03	54.9	
8	0	1460.82	179.	16.	1.94	3025.32	3017	15	4.98E-02	9.1	
9	0	1764.56	46.	7.	1.38	3671.97	3664	13	1.27E-02	21.4	
10	0	2614.50	50.	6.	1.64	5481.52	5473	17	1.39E-02	16.5	

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
NUCLIDE LINE ACTIVITY REPORT
ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	177.	116.	96.73*	2.943E+00	1.794E -7	3.189E -8

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
23-127	FP	661.65	45.	40.	35.12*	2.434E+00	3.189E -8	2.027E -8
ND-147	FP	91.11	59.	137.	28.00*	4.551E+00	6.793E -8	2.751E -8
		531.02	3.	0.	15.10	0.000E+00	0.000E 0	0.000E 0

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
40	NP	1460.31	1.2.	16.	10.67*	1.262E+00	1.319E -6	1.646E -7
44-220	NP	186.21	0.	0.	3.28	0.000E+00	0.000E 0	0.000E 0
		241.90	0.	0.	7.49	0.000E+00	0.000E 0	0.000E 0
		295.21	0.	0.	19.20	0.000E+00	0.000E 0	0.000E 0
		351.92	0.	0.	57.20	0.000E+00	0.000E 0	0.000E 0
		609.31	0.	0.	46.30*	0.000E+00	0.000E 0	0.000E 0
		1120.29	0.	0.	15.10	0.000E+00	0.000E 0	0.000E 0
		1238.11	0.	0.	5.94	0.000E+00	0.000E 0	0.000E 0
		1764.49	46.	7.	5.30	1.185E+00	3.573E -7	7.651E -8
		2204.72	0.	0.	4.98	0.000E+00	0.000E 0	0.000E 0
H-220	NP	233.63	31.	30.	44.60	5.042E+00	5.315E -6	1.287E -6
		330.32	0.	0.	11.40	0.000E+00	0.000E 0	0.000E 0
		727.17	0.	0.	1.30	0.000E+00	0.000E 0	0.000E 0
		503.14	44.	31.	30.25	2.673E+00	7.983E -6	3.013E -6
		911.07	0.	0.	27.70	0.000E+00	0.000E 0	0.000E 0
		969.11	0.	0.	16.60	0.000E+00	0.000E 0	0.000E 0
		2614.66	50.	0.	35.86*	8.882E-01	2.305E -7	3.303E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION * DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	74.58	44.	88.	.76	74.00	72	6	1.23E-02	38.9	2.92E+00
2	0	92.24	59.	137.	2.26	111.60	108	10	1.63E-02	40.5	4.55E+00
3	0	238.38	81.	80.	1.53	422.73	419	7	2.26E-02	24.2	5.04E+00
5	0	582.34	41.	5	1.46	1156.08	1149	13	1.22E-02	37.8	2.67E+00
7	0	1356.08	21	2	3.63	2802.33	2796	14	5.83E-03	54.9	1.44E+00
9	0	1764.56	46.	1	1.38	3671.97	3664	17	1.27E-02	21.4	1.12E+00
10	0	2614.56	50.	1	1.64	5481.52	5473	17	1.39E-02	16.5	3.80E-01

LINE NOT PLETTING SUMMARY (40.5 SEC.)

PK	NUCLIDE	ENERGY	HALF	DECAY	ACT /gram	ABUND%	FAILED
2	ND-147	71.1	10.75	1.000E-0	6.795E-8	68.13%	ABN
3	TH-232	238.63	1.000E+07	1.000E-0	5.315E-8	62.12%	ABN
5	TH-232	582.14	1.000E+07	1.000E-0	7.983E-8	62.12%	ABN
7	Th-226	1764.39	1.000	1.000E-0	3.578E-7	10.17%	ABN
10	Th-232	2614.56	1.000	1.000E-0	2.305E-7	62.12%	ABN

NUCLIDE IDENTIFICATION SYSTEM * (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 3*

TOTAL LINES IN SPECTRUM	10
UNIDENTIFIED PEAKS	7
IDENTIFIED IN SUMMARY REPORT	3 30.00%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA
ANIL-911	AP	109.70M	1.9E-3	1.794E-7	ERROR
					7.189E-8
					SERR
					17.78

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-2 SIGMA
3-117	FP	30.17Y	1.000	3.102E-8	ERROR
					1.027E-8
					SERR
					32.20

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-3 SIGMA
40	HP	1.28E+02Y	1.000	1.310E-6	ERROR
					1.337E-7
					SERR
					2.09

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	56.	477.59	1.5024E-07
NA-22	20.	1274.54	2.1406E-08
NA-24	13.	1368.53	1.9876E-08
CL-38	2.	2167.51	0.0000E+00
AR-41	16.	1293.64	3.3654E-08
SC-46	57.	1120.51	3.2364E-08
CR-51	62.	320.08	1.3992E-07
MN-54	47	834.83	2.3092E-08
MN-56	42.	846.75	3.6220E-08
FE-59	51.	1099.22	4.1678E-08
CO-57	126.	122.06	1.4634E-08
CO-58	42.	610.76	2.1306E-08
CO-60	58.	1332.49	3.0672E-08
CI-65	15.	1481.84	1.4491E-07
CU-64	23.	1345.20	5.4122E-06
ZN-65	22.	1115.52	3.9471E-05
ZN-67M	53.	433.65	1.6463E-05
PZ-76	54.	559.10	4.0376E-05
SE-75	31.	264.45	2.3011E-05
SP-81	43.	554.37	2.2399E-08
CR-84	50.	831.50	4.8628E-07
KR-85	97.	513.99	5.0450E-06
KR-85M	106.	151.18	2.0736E-08
87	62.	402.58	8.2136E-08
83	100.	126.32	7.0566E-08
CR-88	16.	1836.01	7.7378E-06
CR-89	30.	1031.88	4.7306E-06
SH-81	92.	517.99	2.1870E-08
CR-85M	92.	231.69	4.8415E-08
SP-91	30.	1024.30	7.6962E-08
CR-92	22.	1383.24	4.2168E-08
Y-88	16.	1836.01	2.5183E-08
Y-91	20.	1204.20	5.7692E-06
Y-91MD	53.	555.57	2.0352E-08
Y-92	43.	934.46	2.5131E-07
Y-93	75.	266.90	2.1810E-07
ZR-95	41.	756.72	3.5272E-08
ZR-97	34.	743.36	2.0218E-07
NB-94	44.	702.63	1.8657E-05
NB-95	50.	705.72	2.1859E-05
NB-97D	29.	1024.50	2.1505E-06
MO-90	91.	257.34	2.2897E-08
MO-92	37.	739.58	1.4395E-07
TC-99MD	116.	140.51	1.3677E-08
RU-103	60.	427.08	1.8742E-02
RU-105	49.	724.50	5.4983E-08
RU-106	48.	621.84	1.7846E-07
105	78.	318.90	7.8654E-08
110M	46.	657.75	1.8924E-08
109	78.	88.03	3.6013E-07

* PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
Li-113	76.	391.69	2.4300E-08
Li-122	36.	563.93	2.0423E-08
SB-124	39.	602.71	1.5779E-08
SB-125	62.	427.89	5.1637E-08
TE-123M	119.	158.99	1.4710E-08
TE-132	91.	228.16	1.4840E-08
T-171	71.	364.48	1.8159E-08
T-172	43.	667.69	3.0452E-08
T-173	50.	529.81	1.7588E-08
T-174	45.	847.03	9.9357E-08
T-175	20.	1260.41	8.9353E-08
XE-131M	103.	163.93	1.8585E-07
XE-132M	72.	30.79	3.3471E-08
XE-133M	81.	233.22	1.2321E-07
XE-134M	78.	249.79	1.6506E-08
XE-135M	50.	526.56	2.5214E-06
TE-133	32.	208.31	3.5016E-06
Te-134	42.	604.71	1.6444E-06
Te-135	110.	127.42	1.6077E-07
Te-136	43.	818.56	2.1776E-06
Te-137	17.	1435.26	2.3796E-07
Te-138	85.	356.06	2.6428E-08
RA-139	103.	165.85	1.6494E-07
RA-140	57.	537.32	6.8986E-08
RA-141	20.	190.22	1.3377E-06
RA-142	9.	1596.49	1.8341E-08
CP-142	103.	165.85	1.4221E-08
CP-143	111.	145.44	2.5205E-08
CP-144	71.	223.26	3.3479E-08
CP-145	125.	173.56	1.1907E-07
ND-157	84.	91.11	4.7126E-08
CU-151	67.	344.27	5.2384E-08
CU-154	20.	1274.45	6.0256E-08
MF-151	67.	432.03	2.0824E-08
N-157	64.	479.53	7.5499E-08
Hg-203	88.	279.19	1.2126E-08
RA-226	39.	609.31	5.0716E-08
TH-232	50.	2614.66	0.0000E+00
U-235	140.	185.72	2.5121E-08
U-238	106.	131.20	5.7601E-08
Am-239	108.	106.13	5.5451E-08
Am-241	57.	59.54	1.0053E-07

***** 26-FEB-94 10:32:33 *****

RMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #5.

SPECTRAL FILE NAME: L940551.FEV
SAMPLE DATE: 26-FEB-94 03:30:00
SAMPLE IDENTIFICATION: L940551.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 511.3000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 26-FEB-94 04:47:40 * FWHM(1332) 1.88
PRESET TIME(LIVE): 3600 SEC * SENSITIVITY: 2.00
ELAPSED REAL TIME: 3600 SEC * SHAPE PARAMETER: 2.0
ELAPSED LIVE TIME: 3600 SEC * NBR ITERATIONS: 20

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 0.1% Kev
REV/CHNL: 4697016 * HALF LIFE RATIO: 0.01
OFFSET: 39.8252300 Kev * ABUNDANCE LIMIT: 0.0001

ENERGY WINDOW 40.22 TO 2858.93

PK	ST	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	FW	GTG/GEC	SLRR	SLR
1	0	74.53	44.	381.	.76	74.00	72	16	1.13E-02	36.9	
2	0	92.10	59.	137.	2.26	111.00	108	10	1.03E-02	20.5	
3	0	238.38	31.	80.	1.53	422.73	412	2	2.26E-02	24.2	
4	0	511.00	177.	116.	2.29	1003.14	997	19	4.92E-02	17.8	
5	0	582.84	44.	31.	4.46	1156.03	1149	13	4.22E-02	37.8	
6	0	662.09	45.	40.	1.45	1324.82	1320	10	1.25E-02	32.2	
7	0	1356.03	21.	14.	3.63	2802.33	2796	14	5.03E-03	54.9	
8	0	1460.82	179.	16.	1.94	3025.32	3017	15	4.98E-02	9.1	
9	0	1764.56	46.	7.	1.38	3671.97	3664	13	1.27E-02	21.4	
10	0	2614.50	50.	0.	1.64	5481.52	5473	17	4.35E-02	16.5	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	RW	CTS/SEC	%ERR	FIT	
1 0	74.58	44.	88.	.76	74.00	72	6	1.23E-02	38.9		
2 0	92.24*	27.	137.	2.26	111.60	108	10	7.61E+03	***		
3 0	238.38*	14.	80.	1.53	422.73	419	9	3.72E-03	***		
	511.00 KEV PEAK DELETED										
5 0	582.84	*44.	31.	4.46	1156.08	1149	13	1.22E-02	37.8		
	662.09 KEV PEAK DELETED										
7 0	1356.08	21.	14.	3.63	2802.33	2796	14	5.83E-03	54.9		
	1460.82 KEV PEAK DELETED										

2614.50 KEY PEAK DELETED
2614.50 KEY PEAK DELETED

(NO PC VERSION DEC 88)

* PAGE 2

NUCLIDE IDENTIFICATION SYSTEM
UNKNOWN LINE REPORT

(NO PC VERSION DEC 88)

UNIDENTIFIED PEAKS

PAGE 1

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%
1	0	74.58	44.	88.	.76	74.00	72	6	1.23E-02	38.9
2	0	92.24	27.	137.	2.26	111.60	108	10	7.61E-03	****
3	0	238.38	14.	80.	1.53	422.73	419	?	3.92E-03	****
5	0	582.84	44.	31.	4.46	1156.78	1149	13	1.22E-02	37.8
7	0	1356.08	21.	14.	3.63	2802.2	2796	14	5.83E-03	54.9
										1.44E

LINES NOT MEETING SUMMARY

PK	NUCLIDE	ENERGY	HL/T	DECAY	UCI /gram	ABND/UF	FAD
2	ND-147	74.1	10.20	1.000E	0 3.172E -2	66.13%	AGI
5	TH-232	238.63	1.00E-10Y	1.000E	0 9.212E -2	42.00%	AGB
6	Th-232	583.14	1.00E-10Y	1.000E	0 7.983E -2	42.00%	ABR

NUCLIDE IDENTIFICATION SYSTEM
UNKNOWN LINE REPORT

(ND PC VERSION DEC 88)

PAGE 1

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF	
0	75.78	74.	168.	3.04	76.56	71	11	2.07E-02	35.8	3.04E+00	
0	238.30	1.	98.	1.03	422.56	417	1C	3.03E-04	***	5.04E+00	
3	0	351.36	30.	64.	1.13	663.27	660	9	8.24E-03	54.5	3.86E+00

LINE'S NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	TYPE	DECAY	UCI /GRAM	ABNDIFF	FAILED	
2	Th-232	238.63	1.00E+10Y	1.000E	0	7.314E-16	25.03%	ABN
3	Ta-226	351.92	1.600 DAY	1.000E	0	3.115E-10	23.96%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88).

PAGE 2

TOTAL LINES IN SPECTRUM	4
IDENTIFIED PEAKS	3
NTIFIED IN SUMMARY REPORT	1 25.00%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAM	1-SIGMA ERROR	%ERR
ANIL-511	AP	109.70M	2.000	1.896E -8	4.040E -8	213.06

***** 26-FEB-94 14:01:16 *****

MARROE WATER INTAKE #6

CTRAL FILE NAME: L940561.FEV
SAMPLE DATE: 26-FEB-94 11:40:00
SAMPLE IDENTIFICATION: L940561.FEV
TYPE OF SAMPLE: LIQUID
SAMPLE QUANTITY: 497.6000 UNITS: GRAM
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 26-FEB-94 13:00:32 * FWHM(1332) 1.885
ACQ. TIME(LIVE): 3600. SEC * SENSITIVITY 1.000
ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER 5.0 %
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS 10.

SPECTROMETER: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:27:01 * ENERGY TOLERANCE 1.000 KEV
CHNL. 4697016 * HALF LIFE RATIO 1.00
SFDET: 32.8232300 KEV * ABUNDANCE LIMIT 70.00%

ENERGY WINDOW 40.29 TO 2858.03

PK IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ZERR	FIT
1 0	75.78	74.	168.	3.04	76.56	71	11	2.07E-02	35.8	
2 0	238.30	68.	98.	1.03	422.56	417	10	1.90E-02	31.4	
3 0	351.36	30.	64.	1.13	663.27	660	9	8.24E-03	54.5	
4 0	510.87	215.	76.	2.09	1002.86	995	17	3.98E-02	12.4	
5 0	609.34	33.	37.	2.09	1212.52	1209	9	9.27E-03	39.2	
6 0	662.80	37.	106.	4.06	1326.33	1314	24	1.03E-02	85.7	
7 0	1460.45	186.	9.	1.82	3024.53	3015	17	5.15E-02	9.9	
8 5	2613.84	32.	8.	2.19	5480.11	5473	17	8.90E-03	24.0	1.03E+00
9 5	2615.76	26.	7.	2.19	5484.20	5473	17	7.19E-03	28.6	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ZERR
1 0	75.78	74.	168.	3.04	76.56	71	11	2.07E-02	35.8
2 0	238.30	68.	98.	1.03	422.56	417	10	1.90E-02	31.4
3 0	351.36	30.	64.	1.13	663.27	660	9	8.24E-03	54.5
4 0	510.87	215.	76.	2.09	1002.86	995	17	3.98E-02	12.4
5 0	609.34	33.	37.	2.09	1212.52	1209	9	9.27E-03	39.2
6 0	662.80	37.	106.	4.06	1326.33	1314	24	1.03E-02	85.7
7 0	1460.45	186.	9.	1.82	3024.53	3015	17	5.15E-02	9.9
8 5	2613.84	32.	8.	2.19	5480.11	5473	17	8.90E-03	24.0
9 5	2615.76	26.	7.	2.19	5484.20	5473	17	7.19E-03	28.6

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

BATION GAS

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
XE-135	FG	249.79	0.	0.	89.90*	0.000E+00	.000E 0	.000E 0
		608.18	33.	37.	2.89	2.587E+00	7.750E -7	3.038E -7

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
ACTIVATION	AP	511.00	212.	76.	96.73*	2.243E+00	2.281E -7	2.817E -8

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
90-103	FP	497.06	0.	0.	89.00*	0.000E+00	.000E 0	.000E 0
		610.21	0.	37.	5.60	2.587E+00	3.481E -7	1.365E -7
90-107	FP	661.00	212.	106.	35.12*	2.433E+00	2.678E -8	3.512E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
40-40	NP	1460.81	186.	9.	10.67*	1.362E+00	1.926E -6	1.910E -7
222-40	NP	186.21	0.	0.	3.28	0.000E+00	.000E 0	.000E 0
		241.98	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		295.91	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.92	30.	64.	37.20	3.861E+00	3.115E -8	1.697E -8
		607.31	0.	57.	46.30*	2.587E+00	4.205E -8	1.648E -8
		1120.27	0.	0.	15.10	0.000E+00	.000E 0	.000E 0
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	0.	0.	15.80	0.000E+00	.000E 0	.000E 0
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0
H-232	NP	238.63	63.	28.	44.60	5.044E+00	4.537E -8	1.438E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	32.	8.	35.86*	8.883E-01	1.517E -7	3.638E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 UNKNOWN LINE REPORT
 ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	75.78	74.	168.	3.04	76.56	71	11	2.07E-02	35.8	3.04E+00
2	0	238.30	68.	98.	1.03	422.56	417	10	1.90E-02	31.4	5.04E+00
3	0	351.36	30.	64.	1.13	663.27	660	9	8.24E-03	54.5	3.86E+00
5	0	609.34	33.	37.	2.09	1212.52	1209	9	9.27E-03	39.2	2.59E+00
8	5	2613.84	32.	8.	2.19	5480.11	5473	17	8.90E-03	24.0	8.88E-01
9	5	2615.76	26.	7.	2.19	5484.20	5473	17	7.19E-03	28.6	8.88E-01

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HALF	DECAY	UCI	/GRAM	AGNDIFF	FAILED
2	TH-232	238.63	1.00E+10Y	1.000E	0	4.587E -8	45.15%	ABN
3	RA-226	351.92	1600.00Y	1.000E	0	3.115E -3	53.77%	ABN
5	RU-103	610.33	39.35D	1.001E	0	3.481E -7	5.92%	ABN
5	XE-135	608.18	9.11H	1.150E	0	7.750E -7	3.11%	ABN
5	RA-226	609.31	1600.00Y	1.000E	0	4.205E -8	53.77%	ABN
3	TH-232	2614.66	1.00E+10Y	1.000E	0	1.517E -7	45.15%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	9
UNIDENTIFIED PEAKS	6
IDENTIFIED IN SUMMARY REPORT	3
	33.33%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAM	1-SIGMA	ERROR	SERR
ANIL-511	AP	109.70M	2.000	2.281E -7	2.817E -8	12.35	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAM	1-SIGMA	ERROR	SERR
U3-137	FP	30.17Y	1.000	2.698E -8	2.312E -11	35.70	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAM	1-SIGMA	ERROR	SERR
K-40	NP	1.286-02Y	1.000	1.926E -6	2.108E -7	2.32	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

LIDE	BKG	ENERGY	MINIMUM UCI /GRAM
BE-7	54.	477.59	1.5160E-07
NA-22	22.	1274.54	2.3069E-08
NA-24	16.	1368.53	2.2710E-08
CL-38	5.	2167.51	0.0000E+00
AR-41	21.	1293.64	4.6370E-08
SC-46	44.	1120.52	2.9219E-08
CR-51	70.	320.03	1.4482E-07
MN-54	28.	834.87	1.8314E-08
MN-55	40.	846.75	3.6881E-08
FE-59	24.	1099.22	3.7683E-08
CO-57	122.	122.02	1.4796E-08
CO-59	41.	810.75	2.1631E-08
CO-62	45.	1332.45	3.4297E-08
NI-65	15.	1481.8	1.5095E-07
SU-64	26.	1345.96	5.9289E-08
ZN-67	29.	1115.52	4.6566E-08
ZN-67M	56.	138.6	1.7432E-08
AS-70	50.	559.10	3.9974E-08
SE-73	60.	264.61	2.0350E-08
BR-82	49.	554.32	2.4591E-08
BR-84	53.	381.50	5.5927E-07
KR-85	95.	513.99	5.1302E-06
KR-85M	113.	151.18	2.2169E-08
87	66.	402.58	8.4810E-08
88	75.	126.32	7.1535E-08
RB-86	18.	1836.01	9.4720E-06
RB-89	26.	1031.89	5.22284E-06
SR-93	95.	513.99	2.22240E-08
SR-85M	66.	231.69	4.7806E-08
SP-91	27.	1024.36	7.5295E-08
SR-92	21.	1383.94	4.2874E-08
Y-88	18.	1836.01	2.7446E-08
Y-91	24.	1204.90	7.6204E-06
Y-91MD	59.	555.57	2.2144E-08
Y-92	32.	934.46	2.2495E-07
Y-93	82.	266.90	2.3513E-07
ZR-95	36.	756.72	3.3962E-08
ZR-97	40.	743.36	2.2580E-08
NB-94	51.	702.63	2.0639E-08
NB-95	52.	765.79	2.2906E-08
NB-97D	31.	1024.50	2.2893E-06
MO-90	73.	257.34	2.1201E-08
MO-99	28.	739.58	1.2874E-07
TC-99MD	116.	140.51	1.4061E-08
RU-103	53.	497.08	1.8101E-08
RU-105	32.	724.50	4.6012E-08
RU-106	48.	621.84	1.8337E-07
105	70.	318.90	7.6637E-08
110M	49.	657.75	2.0069E-08
109	83.	88.03	3.8173E-07

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /GRAM
113	55.	391.69	2.1241E-08
122	50.	563.93	2.4745E-08
SB-124	47.	602.71	1.7799E-08
SB-125	72.	427.89	5.7178E-08
TE-123M	92.	158.99	1.3290E-08
TE-132	69.	228.16	1.3284E-08
I-131	68.	364.48	1.8264E-08
I-132	37.	667.69	2.9463E-08
I-133	42.	529.37	1.9958E-08
I-134	37.	847.03	9.6286E-08
I-135	17.	1260.41	3.5071E-08
XE-131M	116.	163.93	6.3891E-07
XE-133	67.	80.99	4.1147E-08
XE-133M	85.	233.22	1.2977E-07
XE-135	89.	249.79	1.8186E-08
XE-135M	42.	526.56	2.7167E-06
XE-138	65.	258.31	2.0033E-06
CS-134	39.	604.70	1.6282E-08
CS-134M	120.	1271.62	3.5287E-07
CS-136	35.	818.50	2.0159E-08
CS-138	20.	1435.86	3.4210E-07
BA-133	84.	356.00	2.6996E-08
BA-139	116.	165.85	1.8439E-07
BA-140	55.	537.32	6.9638E-08
141	112.	190.22	1.7171E-08
140	10	1596.49	1.9883E-08
CE-139	116.	165.85	1.5508E-08
CE-141	98.	145.44	2.4423E-08
CE-143	77.	293.26	3.5862E-08
CE-144	136.	133.50	1.2762E-07
ND-147	98.	91.11	5.2510E-08
EU-152	52.	344.27	4.7420E-08
EU-154	22.	1274.15	6.4937E-08
HF-181	53.	482.03	1.9032E-08
W-187	47.	479.53	6.6577E-08
HG-203	74.	279.19	1.8022E-08
RA-226	73.	609.31	4.7197E-08
TH-232	61.	2614.66	0.0000E+00
U-235	133.	185.72	2.5229E-08
U-238	121.	131.20	6.3257E-08
NP-239	102.	106.13	5.7276E-08
AM-241	64.	59.54	1.0946E-07

***** 27-FEB-94 02:33:26 *****

FERMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #7.

STRAL FILE NAME: L940581.FEV
AMPLE DATE: 26-FEB-94 19:30:00
SAMPLE IDENTIFICATION: L940581.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 544.8000 UNITS: gram
SAMPLE GEOMETRY: LMAR500

EFFICIENCY FILE NAME: LMAP500.EFF

ACQUISITION TIME (LIVE): 3600 SEC. CORRECTED LIVE TIME: 3600

ACQUIRED REAL TIME: 26-Feb-94 02:33:26 CHANNEL PULSE WIDTH: 0.5
ACQUIRED LIVE TIME: 0.5 CHANNEL PULSE WIDTH: 0.5

ACQUISITION TIME (LIVE): 3600 SEC. CORRECTED LIVE TIME: 3600

FOR OTHER * PRIMARY:MASTER
DATE: 27-FEB-94 17:27:13 * ENERGY TOLERANCE: 0.0 KEV
TIME: 197010 * HALF-LIFE RATIO: 0.0
ID: 0272500 * MULITPLIER: 1.000

ENERGY (KEV) 10.27

#	ENERGY	AREA	SKOND	FWHM	CHANNEL	LFT	PW	CPS/SEC ZERO
1	238.50	85.	17.	1.73	173.00	420	12	2.35E-02 20.5
2	352.04	89.	19.	1.73	664.72	639	13	2.48E-01 25.4
3	511.54	143.	171.	2.10	1004.22	977	16	3.29E-02 17.2
4	609.31	85.	51.	1.31	1212.44	1208	11	2.37E-02 19.1
5	634.98	31.	19.	1.34	1267.09	1262	10	8.62E-03 42.6
6	1120.84	46.	21.	1.35	2301.49	2295	12	1.28E-02 27.1
7	1377.52	24.	4.	1.82	2847.96	2843	11	6.53E-03 30.3
8	1460.97	213.	21.	1.77	3025.64	3018	17	5.72E-02 9.6
9	1764.77	54.	11.	1.90	3672.44	3661	22	1.50E-02 18.1

PEAK SEARCH COMPLETED (REV 15.8 - HD PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA, CORRECTION = 1.000
UNCORR. LIVE TIME: 3600, CORRECTED LIVE TIME: 3600.

#	IT	ENERGY	AREA	SKOND	FWHM	CHANNEL	LFT	PW	CPS/SEC ZERO
1	0	238.50	85.	69.	1.91	422.00	420	7	2.35E-02 20.5
2	0	352.04	89.	79.	1.73	664.72	639	13	2.48E-02 25.4
3	0	511.54	143.	151.	2.10	1004.22	977	16	3.29E-02 17.2
4	0	609.31	85.	51.	1.31	1212.44	1208	11	2.37E-02 19.1
5	0	634.98	31.	19.	1.34	1267.09	1262	10	8.62E-03 42.6
6	0	1120.84	46.	21.	1.35	2301.42	2295	12	1.28E-02 27.1
7	0	1377.52	24.	4.	1.82	2847.96	2843	11	6.53E-03 30.3
8	0	1460.97	213.	21.	1.77	3025.64	3018	17	5.72E-02 9.6
9	0	1764.77	54.	11.	1.90	3672.44	3661	22	1.50E-02 18.1

PILE-UP CORRECTION COMPLETED.

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC. 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

ISION GAS

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
XE-135	FG	249.79	0.	0.	89.90*	0.000E+00	.000E 0	.000E 0
		608.18	85.	51.	2.89	2.587E+00	1.704E -6	3.255E -7

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
AN-140	NP	511.00	1.63	1.51	96.73*	2.941E+00	1.042E -7	2.073E -7
		897.75	0.	0.	99.93	0.000E+00	.000E 0	.000E 0
		1120.51	0.	21.	99.99*	1.654E+00	3.352E -8	1.344E -8

Fission Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
CA-40	FG	497.08	0.	0.	89.00*	0.000E+00	.000E 0	.000E 0
		610.23	0.	51.	5.63	2.587E+00	3.103E -7	1.543E -7
		176.55	0.	0.	6.89	0.000E+00	.000E 0	.000E 0
		423.39	0.	0.	29.33*	0.000E+00	.000E 0	.000E 0
		463.38	0.	0.	10.35	0.000E+00	.000E 0	.000E 0
		600.56	0.	0.	17.80	0.000E+00	.000E 0	.000E 0
		635.90	31.	19.	11.32	2.510E+00	1.505E -7	6.415E -8

NUCLIDE

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
CA-40	NP	1460.31	2.23	22.	10.67*	1.302E+00	7.022E -6	1.731E -7
		186.21	0.	0.	3.28	0.000E+00	.000E 0	.000E 0
		741.98	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		225.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.72	82.	79.	37.20	3.856E+00	8.594E -8	2.134E -8
		609.31	25.	51.	46.30*	2.587E+00	9.798E -8	1.871E -8
		1120.22	46.	21.	15.10	1.654E+00	2.550E -7	6.912E -8
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	54.	11.	15.80	1.185E+00	3.973E -7	7.131E -8
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0
TH-232	NP	238.63	85.	69.	44.60	5.041E+00	5.191E -8	1.067E -8
		538.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	0.	0.	35.86*	0.000E+00	.000E 0	.000E 0

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	238.50	85.	69.	.91	423.00	420	7	2.35E-02	20.5
5	0	634.98	31.	19.	1.34	1267.09	1152	10	8.62E-03	42.6
7	0	1377.52	24.	4.	1.82	2047.96	2843	11	6.53E-03	30.3

LINE NOT MEETING SUMMARY CRITERIA

NUCLEIDE	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	BKGND/CTF	FAILED
137-232	238.50	1.09E-10	1.000E-0	0	5.191E-0	-	-	25.000	ABN	
43-103	610.50	1.71E-10	1.000E-0	0	3.110E-0	-	-	1.000	ABN	
43-125	635.20	2.11E-10	1.000E-0	0	1.704E-0	-	-	1.417	ABN	
53-125	635.20	2.11E-10	1.000E-0	0	1.505E-0	-	-	1.417	ABN	
53-46	1120.50	9.71E-10	1.000E-0	0	3.852E-0	-	-	50.000	ABN	

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	9
UNIDENTIFIED PEAKS	3
IDENTIFIED IN SUMMARY REPORT	6
	66.67%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	1.500	1.042E -7	2.078E -8	12.25	

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
KO	MF	1.231E+2Y	1.000	2.022E -6	1.031E -7	9.55	
Zn	N	1600.00S	1.000	2.779E -8	1.671E -8	12.10	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	42.	477.59	1.3184E-07
NA-22	21.	1274.54	2.0586E-08
NA-24	13.	1368.53	1.8053E-08
CL-38	12.	2167.51	0.0000E+00
AR-41	16.	1225.64	2.7718E-08
SC-46	66.	1120.5	3.2676E-08
CR-51	75.	320.08	1.3681E-07
MN-54	37.	834.8	1.9228E-08
MN-56	33.	846.79	2.4950E-08
FE-59	38.	1099.25	4.3287E-08
CO-57	136.	122.06	1.4263E-08
CO-58	47.	810.76	2.1146E-08
CO-60	45.	1352.47	3.1325E-08
NJ-65	8.	1481.84	8.1721E-08
CU-64	10.	1345.20	3.2221E-06
ZN-65	27.	1113.54	4.1035E-08
ZN-69M	31.	438 ..	1.5924E-08
AS-70	49.	559.10	3.5428E-08
SE-75	75.	264.52	2.0777E-08
BR-82	54.	534.32	2.3230E-08
BR-84	39.	881.50	2.0583E-07
KR-85	116.	513.99	5.1778E-06
KR-85M	102.	151.18	1.7106E-08
87	64.	402.58	5.0438E-08
88	132.	196.52	6.3994E-08
RE-86	18.	1836.01	1.4690E-06
RB-89	27.	1031.88	6.3016E-07
SR-85	116.	513.99	2.2439E-08
SR-85M	72.	231.69	2.5059E-08
SR-91	26.	1024.30	6.3851E-08
SR-92	17.	1383.74	2.9017E-08
Y-88	18.	1836.01	2.5063E-08
Y-91	27.	1204.90	7.3796E-06
Y-91MD	42.	555.57	1.6146E-08
Y-92	37.	934.46	1.9042E-07
Y-93	85.	266.90	2.0755E-07
ZR-95	53.	756.72	3.7625E-08
ZR-97	40.	743.36	1.9991E-08
NB-94	38.	702.63	1.6272E-08
NG-95	43.	765.79	1.9013E-08
NB-97D	26.	1024.50	1.8562E-06
MO-90	93.	257.34	1.9920E-08
MO-92	48.	739.58	1.5274E-07
TC-99MD	110.	140.51	1.2407E-08
RU-103	66.	427.03	1.8439E-08
RU-105	30.	724.50	3.6145E-08
RU-106	47.	621.84	1.6572E-07
105	76.	318.90	7.1859E-08
110M	40.	657.75	1.6560E-08
109	101.	88.03	3.8459E-07

PEAK WIDTH = * 3.00 FWHM. CONFIDENCE LEVEL = 4.66:

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
Li-113	64.	391.69	2.0924E-08
Li-122	50.	563.93	2.2418E-08
Sr-88-124	50.	602.71	1.6762E-08
Sr-88-125	62.	427.89	4.8461E-08
Ts-75-123M	104.	158.22	1.2904E-08
Tl-75-132	75.	228.16	1.2565E-08
I-131	69.	264.48	1.5758E-08
I-132	47.	667.65	2.4129E-08
I-133	47.	522.37	1.7607E-08
I-134	35.	847.02	4.6941E-08
I-135	19.	1240.61	7.5861E-08
I-135M	120.	163.77	5.7244E-07
I-135	35.	80.21	3.7154E-08
I-133M	32.	233.21	1.1526E-07
I-135	33.	249.79	1.0550E-08
I-135M	44.	526.57	3.2540E-07
I-136	38.	258.51	1.0251E-08
I-134	42.	604.70	1.3432E-08
I-134M	123.	127.42	1.1735E-07
I-136	47.	818.56	2.1553E-08
I-137	37.	661.64	2.7222E-08
I-138	28.	1435.86	1.3873E-07
Sr-88-133	71.	356.00	2.2669E-08
Ts-75-132	128.	165.85	1.2101E-07
I-140	43.	557.32	5.5143E-08
I-141	102.	120.22	2.7499E-07
La-140	11.	196.47	1.8722E-08
Pr-149	128.	165.85	1.4876E-08
Pr-141	106.	145.16	1.3134E-08
Pr-143	62.	273.94	3.0516E-08
Pr-144	135.	173.94	1.1526E-07
Pr-143	92.	21.11	4.6200E-08
Cs-132	72.	544.27	5.0264E-08
La-154	21.	1274.45	5.7947E-08
Pr-131	43.	182.03	1.5649E-08
W-187	50.	479.53	6.1351E-08
Hg-203	38.	279.19	1.7942E-08
Ts-232	51.	2614.66	0.0000E+00
Ts-235	144.	165.72	2.3977E-08
Ts-238	140.	131.20	6.7127E-08
Mn-239	113.	106.13	5.3927E-08
Ts-241	71.	59.54	1.0530E-07

***** 27-FEB-94 02:35:01 *****

SMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #7.

CENTRAL FILE NAME:: L940581.FEV
SAMPLE DATE: 26-FEB-94 19:30:00
SAMPLE IDENTIFICATION: L940581.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 544.8000 UNITS: gram
SAMPLE GEOMETRY: LMAR500

EFFECTIVENESS FILE NAME: LMAR500.CPF

ACQUISITION DATE: 26-FEB-94 20:12:07 * FWHM(1332) 1.084

PRESAT. TIME(LIVE): 1609 SEC * SENSITIVITY: 3.000

ELAPSED REAL TIME: 3600 SEC * SHAPE PARAMETER: 0.67

ELAPSED LIVE TIME: 360 SEC * PBR ITERATIONS: 20

JETECTOR ORTEC * LIBRARY:MASTER.LIB

VALID DATE: 23-FEB-94 02:26:01 * ENERGY TOLERANCE: 2.000 KEV

REV. LHN1: 469.010 * HALF-LIFE RATIO: 0.30

OFFSET: 29.8232300 KEV * ABUNDANCE LIMIT: 1.00E-02

ENERGY WINDOW 40.29 TO 2858.05

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	238.50	85.	69.	.91	423.00	420	7	2.35E-02	20.5	
2	0	352.04	89.	79.	1.73	664.72	659	13	2.40E-02	25.4	
3	0	511.54	143.	131.	2.10	1004.22	997	16	3.98E-02	19.2	
4	0	609.31	85.	51.	1.31	1212.44	1208	11	2.37E-02	19.1	
5	0	634.98	31.	19.	1.34	1267.09	1262	10	8.62E-03	42.6	
6	0	1120.84	46.	21.	1.35	2301.49	2295	12	1.20E-02	27.1	
7	0	1377.52	24.	4.	1.82	2847.96	2843	11	6.53E-03	30.3	
8	0	1460.97	213.	21.	1.77	3025.64	3018	17	5.92E-02	9.6	
9	0	1764.77	54.	11.	1.90	3672.44	3661	22	1.50E-02	18.1	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
0	238.50*	17.	69.	.91	423.00	420	7	4.83E-03	***		
0	352.04	89.	79.	1.73	664.72	659	13	2.40E-02	25.4		
511.54 KEV PEAK DELETED											
4	0	609.31*	43.	51.	1.31	1212.44	1208	11	1.20E-02	51.5	
5	0	634.98	31.	19.	1.34	1267.09	1262	10	8.62E-03	42.6	
6	0	1120.84	46.	21.	1.35	2301.49	2295	12	1.20E-02	27.1	
7	0	1377.52	24.	4.	1.82	2847.96	2843	11	6.53E-03	30.3	
1460.97 KEV PEAK DELETED											
9	0	1764.77*	7.*	11.	1.90	3672.44	3661	22	2.00E-03	***	

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF	
1	0	238.50	17.	69.	.91	423.00	420	7	4.83E-03	****	5.04E+00
5	0	634.98	31.	19.	1.34	1267.09	1262	10	8.62E-03	42.6	2.51E+00
7	0	1377.52	24.	4.	1.82	2847.96	2843	11	6.53E-03	30.3	1.42E+00

LINES NOT MEETING SUMMARY CRITERIA

PF	NUCLIDE	ENERGY	FLR	DECAY	UCF /gram		ABNDIFF	FAILED
2	TH-232	238.63	1.00E+10Y	1.000E	0	1.067E -8	25.03%	ABN
4	RU-103	630.33	39.23D	1.001E	0	3.116E -7	5.92%	ABN
4	XE-135	608.18	9.31H	1.005E	0	3.653E -7	3.11%	ABN
2	SB-125	630.90	2.77Y	1.000E	0	1.009E -7	14.26%	ABN
3	SC-46	1120.51	83.83D	1.000E	0	3.852E -8	50.00%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM	7
UNIDENTIFIED PEAKS	3
IDENTIFIED IN SUMMARY REPORT	4
	57.14%

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	ERR
RA-226	NP	1600.00Y	1.000	4.274E -8	2.560E -3	51.47	

***** 27-FEB-94 12:00:48 *****

FORM 2: MONROE WATER INTAKE SAMPLE # 8

CIRAL FILE NAME: L940591.FEV
 PLE DATE: 27-FEB-94 03:25:00
 SAMPLE IDENTIFICATION: L940591.FEV
 TYPE OF SAMPLE: WATER
 SAMPLE QUANTITY: 533.100 UNITS: gram
 SAMPLE GEOMETRY: LMAR500
 EFFICIENCY FILE NAME: LMAR500.LEFF

ACQU. RL DATE: 27-FEB-94 03:45:00 * FWHM(1332) 1.800
 ACQU. RL TIME: 3600. SEC * SENSITIVITY 1.000
 CLASSED RL TIME: 3600. SEC * SHAPE PARAMETER 5.0 %
 CLASSED LIVE TIME: 3600. SEC * NUR ITERAT. ONG. 10.

DETECTOR: GENEQ * LIBRARY:MASTER.LAB
 CAL'D. DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE 1.000 KEV
 ATN. INCL: 46.94026 * HALF LIFE (T1/2) 1.00
 GENEQ: 32.9232300 KU7 * ABUNDANCE (AMT) 70.000 %

ENERGY WINDOW 40.29 TO 2858.00

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	PERC	F1
1	0	62.76	35.	31.	.31	48.83	46	7	2.83E-03	47.4	
2	0	74.55	44.	106.	1.20	73.94	72	6	1.21E-02	43.3	
3	0	92.33	73.	24.	1.27	111.78	108	3	2.02E-02	28.6	
4	0	238.50	48.	102.	.93	422.98	421	8	1.34E-02	41.3	
5	0	510.86	185.	106.	2.60	1002.85	994	20	5.14E-02	16.6	
6	0	608.96	53.	50.	1.30	1211.69	1209	11	1.47E-02	29.8	
7	0	661.79	47.	27.	1.18	1324.18	1320	10	1.30E-02	22.1	
8	0	1332.48	27.	14.	1.76	2752.07	2747	9	7.36E-03	31.7	
9	0	1460.82	207.	23.	1.85	3025.32	3018	18	5.74E-02	8.8	
10	0	1764.01	43.	0	2.41	3670.81	3660	21	1.19E-02	23.0	

PEAK SEARCH COMPLETED (REV 15.8 - NO PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
 INCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	EN ^Y POS	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	PERC
1	0	62.76	35.	31.	.31	48.83	46	7	2.83E-03	47.4
2	0	74.55	44.	106.	1.20	73.94	72	6	1.21E-02	43.3
3	0	92.33	73.	24.	1.27	111.78	108	3	2.02E-02	28.6
4	0	238.50	48.	102.	.93	422.98	421	8	1.34E-02	41.3
5	0	510.86	185.	106.	2.60	1002.85	994	20	5.14E-02	16.6
6	0	608.96	53.	50.	1.30	1211.69	1209	11	1.47E-02	29.8
7	0	661.79	47.	27.	1.18	1324.18	1320	10	1.30E-02	22.1
8	0	1332.48	27.	14.	1.76	2752.07	2747	9	7.36E-03	31.7
9	0	1460.82	207.	23.	1.85	3025.32	3018	18	5.74E-02	8.8
10	0	1764.01	43.	0	2.41	3670.81	3660	21	1.19E-02	23.0

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC. 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

BETA GAS								UCI /		1-SIGMA	
NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF		gram	gram	ERROR	ERROR
XE-135	FG	242.79	0.	0.	89.90*	0.000E+00		.000E 0	.000E 0	.000E 0	.000E 0
		608.18	53.	50.	2.89	2.598E+00	1.058E -6	3.150E -7			
<hr/>											
DETERMINATION PRODUCT											
NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF		UCI /	gram	1-SIGMA	ERROR
ANAL-511-1P	MP	511.00	185.	106.	96.73*	2.945E+00	1.248E -7	2.070E -8			
1173.02			0.	0.	100.00	0.000E+00		.000E 0	.000E 0		
1832.19			27.	14.	100.00*	1.457E+00	2.561E -8	3.108E -9			
<hr/>											
EXTRACTION PRODUCT											
NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF		UCI /	gram	1-SIGMA	ERROR
CH-203	4P	49.08		0.	89.00*	0.000E+00		.000E 0	.000E 0		
		617.33		50.	5.61	2.583E+00	5.127E -7	1.527E -7			
CH-207		661.65	42.	27.	85.12*	2.425E+00	3.185E -8	2.278E -9			
CH-207	PF	9.11	75.	94.	28.00*	4.558E+00	8.054E -8	2.307E -8			
		531.02	0.	0.	13.10	0.000E+00		.000E 0	.000E 0		
<hr/>											
TOTAL PRODUCT											
NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF		UCI /	gram	1-SIGMA	ERROR
K-40	PP	1460.31	207.	23.	10.67*	1.342E+00	2.004E -6	1.764E -7			
Fe-55	4P	186.21	0.	0.	3.28	0.000E+00		.000E 0	.000E 0		
		241.98		0.	7.49	0.000E+00		.000E 0	.000E 0		
		295.21	0.	0.	19.20	0.000E+00		.000E 0	.000E 0		
		351.92	0.	0.	37.20	0.000E+00		.000E 0	.000E 0		
		600.31	53.	50.	46.30*	2.588E+00	6.198E -8	1.846E -8			
		1120.22	0.	0.	15.10	0.000E+00		.000E 0	.000E 0		
		1238.11	0.	0.	5.94	0.000E+00		.000E 0	.000E 0		
		1764.49	42.	0.	15.80	1.186E+00	3.232E -7	7.446E -8			
		2204.22	0.	0.	4.98	0.000E+00		.000E 0	.000E 0		
Th-232	SP	238.63	48.	102.	44.60	5.041E+00	3.026E -8	1.250E -8			
		238.32	0.	0.	11.40	0.000E+00		.000E 0	.000E 0		
		727.17	0.	0.	11.80	0.000E+00		.000E 0	.000E 0		
		583.14	0.	0.	30.25	0.000E+00		.000E 0	.000E 0		
		911.07	0.	0.	27.70	0.000E+00		.000E 0	.000E 0		
		967.11	0.	0.	16.60	0.000E+00		.000E 0	.000E 0		
		2614.66	0.	0.	35.86*	0.000E+00		.000E 0	.000E 0		

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	62.76	35.	.81	48.83	46	7	9.83E-03	47.4	1.82E+00
2	0	74.55	44.	1.20	73.94	72	6	1.21E-02	43.3	2.92E+00
3	0	92.33	73.	1.27	111.78	108	8	2.02E-02	28.6	4.56E+00
4	0	238.50	48.	1.23	422.98	421	8	1.34E-02	41.3	5.04E+00
5	0	608.96	53.	1.30	1211.69	1209	11	1.47E-02	29.8	2.59E+00
6	0	1332.48	27.	1.76	2752.07	2747	9	7.36E-03	31.2	1.46E+00
7	0	1764.01	43.	0.	3670.81	3660	21	1.19E-02	23.0	1.19E+00

INES NOT MEETING SUMMARY CRITERIA

PK NUCLIDE	ENERGY	HLFD	DECAY	UCI /grain	ABND/PP	FAILED
ND-147	91.11	10.28D	1.002E	0	8.054E -6	ABN
TM-232	238.63	1.00E+10Y	1.000E	0	3.026E -3	ABN
RU-103	610.33	39.35D	1.001E	0	5.127E -7	ABN
XE-155	608.18	9.11H	1.065E	0	1.058E -4	ABN
RA-226	607.31	1600.00D	1.000E	0	6.1198E -8	ABN
CO-60	1332.49	1925.00D	1.000E	0	2.561E -3	ABN
RA-226	1764.49	1600.00D	1.000E	0	3.232E -7	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	10
UNIDENTIFIED PEAKS	7
IDENTIFIED IN SUMMARY REPORT	3 30.00%

ACTIVATION PRODUCT

NUCLIDE	SBHM	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	SERR
ANIL-511	AP	107.70M	1.365	1.248E -7	2.070E -8	16.59	

FUSION PRODUCT

NUCLIDE	SBHM	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	SERR
CO-57	FP	8.17Y	1.000	3.185E -8	2.270E -9	29.13	

NATURAL PRODUCT

NUCLIDE	SBHM	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	SERR
K-40	NP	1.26E 00Y	1.000	2.004E -6	1.764E -7	3.60	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

IDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	51.	477.59	1.3774E-07
NA-22	19.	1274.54	2.001CE-08
NA-24	20.	1368.53	2.2620E-08
CL-38	5.	2167.51	0.0000E+00
AR-41	15.	1293.64	2.4948E-08
SC-40	50.	1120.51	2.9063E-08
CR-51	52.	320.03	1.1633E-07
Mn-54	39.	834.62	2.0173E-08
Mn-56	52.	846.75	2.2929E-08
Pd-59	39.	1099.21	4.4202E-08
Co-67	115.	1221.06	1.5403E-08
Tl-58	60.	810.76	2.3415E-08
Cs-60	46.	1552.47	3.2666E-08
Pt-75	10.	1481.84	3.7173E-08
Cd-64	23.	1345.90	4.9263E-08
H-69	37.	1115.51	4.9090E-08
N-69M	68.	458.62	1.7041E-08
Al-74	64.	559.16	4.1107E-08
Fe-75	37.	264.61	2.20347E-08
BR-82	45.	554.32	2.1566E-08
BR-84	35.	381.50	1.4375E-07
KR-85	97.	513.99	4.8287E-06
Kr-85M	96.	151.18	1.6317E-08
Kr-87	77.	402.50	4.0344E-08
Br-83	33.	196.32	4.8723E-08
Rb-83	19.	1836.01	6.2436E-07
Rb-89	35.	1031.88	3.7420E-07
Zr-85	97.	513.97	2.0967E-08
Zr-85M	95.	231.69	2.9230E-08
Cr-93	31.	1024.30	6.9964E-08
Cr-92	13.	1383.24	2.8626E-08
Y-88	10.	1836.01	1.9090E-08
Y-91	22.	1204.90	7.3150E-06
Y-91MD	45.	555.57	1.6771E-08
Y-92	22.	934.46	1.6406E-07
Y-93	74.	266.90	1.9454E-07
Zr-95	50.	756.72	3.7342E-08
Zr-97	38.	743.36	1.9710E-08
Nb-94	52.	702.63	1.9453E-08
Nb-95	51.	765.79	2.0948E-08
Nb-97D	2.	1021.50	1.9830E-06
Mo-90	90.	257.34	1.9424E-08
Mo-99	31.	739.58	1.2511E-07
TC-99MD	111.	140.51	1.2703E-08
RU-103	59.	497.08	1.7813E-08
RU-105	35.	724.50	3.8373E-08
RU-106	42.	621.84	1.6010E-07
Y-105	59.	318.90	6.4387E-08
Y-10M	36.	657.75	1.6055E-08
Y-09	78.	88.03	3.4532E-07

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
Li-7	74.	391.69	2.2992E-08
Li-122	49.	563.93	2.2620E-08
SB-124	46.	602.71	1.6428E-08
SB-125	71.	427.89	5.2997E-08
TE-123M	110.	158.29	1.3561E-08
TE-132	97.	228.16	1.4571E-08
I-131	71.	364.42	1.7357E-08
I-132	44.	667.67	2.2122E-08
I-133	50.	529.37	1.8126E-08
I-134	50.	847.07	4.7063E-08
I-135	15.	1160.41	6.7103E-08
KE-131M	104.	163.77	5.6329E-07
KE-133	76.	30.97	4.0679E-08
KE-133M	95.	233.21	1.2637E-07
KE-135	61.	249.77	1.3015E-08
KE-135M	44.	526.57	1.6912E-07
KE-138	32.	258.32	5.0518E-07
CS-134	57.	604.76	1.8572E-08
CS-134M	113.	127.47	1.0378E-07
CS-136	55.	818.56	2.3571E-08
CG-138	71.	1435.36	3.1346E-08
SA-133	75.	356.90	2.3810E-08
SA-139	121.	165.85	1.0611E-07
SA-140	57.	537.32	6.6021E-08
Ca-41	122.	190.22	1.6840E-07
Ca-40	16.	159.47	2.3071E-08
Ca-132	21.	165.81	1.4731E-08
CE-141	96.	145.44	2.2542E-08
CE-143	71.	206.26	3.2772E-08
CE-144	134.	133.57	1.1623E-07
ND-147	88.	71.11	4.6146E-08
EU-152	67.	344.27	5.0242E-08
EU-154	19.	1274.42	5.6320E-08
HF-181	47.	482.03	1.6717E-08
W-187	56.	479.56	6.5872E-08
HG-203	76.	279.19	1.7037E-08
RA-226	73.	609.31	4.9724E-08
TH-232	58.	2614.66	0.0000E+00
U-235	134.	185.72	2.3637E-08
U-238	131.	131.26	6.1416E-08
NP-239	132.	166.15	5.8110E-08
AM-241	54.	59.54	9.5348E-08

~~W~~MI 2: MONROE WATER INTAKE SAMPLE # 8

RPT B1<G

...CTRAL FILE NAME: L940591.FEV
SAMPLE DATE: 27-FEB-94 03:25:00
SAMPLE IDENTIFICATION: L940591.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 533.1000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMARS00.EFF

ACQUIRE DATE: 27-FEB-94 03:45:08 * FWHM(1332) 1.886
PRESET TIME(LIVE): 3600 SEC * SENSITIVITY: 0.000
ELAPSED REAL TIME: 3600 SEC * SHAPE PARAMETER: 5.0 %
ELAPSED LIVE TIME: 3600 SEC * NGR (ITERATIONS: 10)

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
 CALIB DATE: 23-FEB-94 07:17:01 * ENERGY TOLERANCE: 1.300 KEV
 KEV/CHAN: .4697016 * HALF LIFE RATIO: 2.00
 DIFFUSE: 39.8232300 KELT * ABUNDANCE LIMIT: 70.062

ENERGY WINDOW 40.22 TO 2350.02

PK	N	ENERGY	AREA	SKY-CD	FWHM	CHANNEL	LEFT	PW	GTS/SEC	2E%	FIT
1	0	62.76	35.	.31.	.31	43.83	46	7	2.83E-03	47.4	
2	0	74.55	44.	106.	1.20	73.94	72	6	1.21E-02	43.3	
3	0	92.33	73.	.94.	1.27	111.78	108	3	2.02E-02	28.6	
4	0	238.50	48.	102.	.93	422.98	421	8	1.34E-02	41.3	
5	0	510.86	185.	106.	2.60	1002.85	994	20	5.14E-02	16.6	
6	0	608.96	53.	.50.	1.30	1211.69	1209	11	1.47E-02	29.8	
7	0	661.79	47.	.27.	1.18	1324.18	1320	10	1.30E-02	29.1	
8	0	1332.48	27.	.14.	1.76	2752.07	2747	9	7.36E-03	31.7	
9	0	1460.32	207.	.23.	1.85	3025.32	3018	13	5.74E-02	3.8	
10	0	1764.01	43.	0.	2.41	3670.91	3660	21	1.19E-02	23.0	

PEAK SEARCH COMPLETED (REV 15-8 - ND PC VERSION NOV 82)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT	
0	62.76	35.	81.	.81	48.83	46	7	9.83E-03	47.4		
2	74.55	44.	106.	1.20	73.94	72	6	1.21E-02	43.3		
3	92.35*	42.	24.	1.27	111.78	108	8	1.15E-02	78.1		
	238.50 KEV PEAK DELETED										
	510.86 KEV PEAK DELETED										
6	608.96*	11.	50.	1.30	1211.69	1209	11	3.00E-03	****		
	661.79 KEV PEAK DELETED										
	1332.48 KEV PEAK DELETED										

1460-99-KEN PEAK DELETED

1764.01 KEN PEAK DELETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT

PAGE 1

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF	
1	0	62.76	35.	81.	.81	48.83	46	7	9.83E-03	47.4	1.82E+00
2	0	74.55	44.	106.	1.20	73.94	72	6	1.21E-02	43.3	2.92E+00
3	0	92.33	42.	94.	1.27	111.78	108	8	1.15E-02	78.1	4.56E+00
6	0	608.96	11.	50.	1.30	1211.69	1202	11	3.00E-03	***	2.59E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	H.FE	DECAY	NET /gram	ABND(FP)	ATLED	
3	ND-147	91.11	10.98	2.002E	0	4.595E-48	68.2%	ABN
6	RU-103	610.33	37.250	1.001E	0	1.050E-17	5.2%	ABN
6	XE-133	608.18	9.414	1.005E	0	2.167E-17	3.4%	ABN
6	Ra-226	609.31	1600.007	1.000E	0	1.270E-17	29.3%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM	4
UNIDENTIFIED PEAKS	4
IDENTIFIED IN SUMMARY REPORT	0 .00%

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

IDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	51.	477.59	1.3744E-07
ANIL-511	217.	511.00	4.3977E-08
NA-22	19.	1274.54	2.0010E-08
NA-24	20.	1368.53	2.2620E-08
CL-38	5.	2167.51	0.0000E+00
AR-41	15.	1293.54	2.4948E-08
K-40	219.	1460.51	7.0673E-07
SC-46	50.	1120.51	2.9063E-08
CR-51	52.	319.53	1.1658E-07
MN-54	39.	834.52	2.0173E-08
MN-55	52.	840.51	2.9928E-08
FE-59	39.	1099.52	4.4800E-08
CO-57	115.	1221.56	1.3403E-08
CO-58	60.	810.51	2.4415E-08
CO-60	46.	1332.51	3.2366E-08
Ni-63	10.	1481.51	8.7173E-08
CU-64	23.	1346.51	4.9263E-08
ZN-65	37.	1111.51	4.2090E-08
ZN-67M	63.	430.51	1.7041E-08
As-76	64.	559.51	4.1107E-08
Se-75	37.	764.51	2.2867E-08
BR-82	45.	554.52	2.1566E-08
BR-84	35.	881.50	1.4375E-07
BR-85	27.	513.51	4.8387E-08
BR-85M	25.	151.51	1.6317E-08
KR-87	77.	402.51	4.2344E-08
KR-87	33.	126.51	4.8793E-08
Rb-88	10.	1836.51	6.2436E-07
Rb-89	35.	1061.50	3.7420E-07
SP-89	27.	513.51	2.0967E-08
SR-85M	25.	231.51	2.5230E-08
SR-91	31.	1024.50	6.9964E-08
SR-92	18.	1382.54	2.8626E-08
Y-88	10.	1836.51	1.2020E-08
Y-91	29.	1204.50	7.8150E-08
Y-91MD	45.	555.51	1.6771E-08
Y-92	29.	934.56	1.6406E-07
Y-93	74.	266.50	1.9454E-07
ZR-95	50.	756.52	3.7342E-08
ZR-97	38.	743.56	1.9710E-08
NB-94	52.	702.53	1.9453E-08
NB-95	50.	765.59	2.0943E-08
NB-97D	29.	1024.50	1.9830E-08
MO-90	90.	257.54	1.9424E-08
MO-99	31.	739.50	1.2511E-07
TC-99MD	111.	140.51	1.2703E-08
RU-103	59.	497.08	1.7813E-08
105	35.	724.50	3.8373E-08
106	42.	621.54	1.6010E-07
105	59.	318.50	6.4387E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM
			UCI /gram
TI-110M	36.	657.75	1.6055E-08
TI-109	78.	88.03	3.4539E-07
SN-113	74.	391.62	2.2992E-08
SB-122	49.	563.93	2.2620E-08
SB-124	46.	602.71	1.6428E-08
SB-125	71.	427.82	5.2997E-08
TE-123M	110.	158.22	1.3561E-08
TE-132	97.	228.16	1.4571E-08
TE-131	71.	364.46	1.7357E-08
TE-132	44.	667.62	2.2129E-08
TE-137	50.	429.87	1.8196E-08
TE-136	50.	847.6	4.7063E-08
TE-135	13.	1260.41	6.7103E-08
KE-131M	104.	163.95	5.6329E-07
KE-133	76.	30.22	4.0679E-08
KE-133M	95.	233.82	1.2637E-07
KE-135	61.	249.72	1.3015E-08
KE-135M	44.	526.55	1.6912E-07
KE-138	82.	258.32	5.0519E-07
CS-134	57.	604.76	1.3372E-08
CS-134M	115.	127.42	1.0378E-07
CS-136	55.	318.56	2.3571E-08
CS-137	71.	661.65	2.5131E-08
CS-138	7.	1435.86	5.1346E-08
CS-133	75.	356.00	2.3810E-08
CS-139	121.	165.85	1.0511E-07
CS-140	57.	537.32	6.6021E-08
RA-141	122.	190.22	1.6840E-07
LA-140	16.	1526.47	2.5071E-08
CE-139	121.	165.85	1.4781E-08
CE-141	26.	145.44	2.2542E-08
CE-143	77.	293.26	3.2772E-08
CE-144	134.	133.54	1.1823E-07
ND-147	88.	91.11	4.6146E-08
EU-152	67.	344.27	5.0242E-08
EU-154	19.	1274.45	5.6329E-08
HF-131	47.	482.03	1.6717E-08
W-187	56.	479.53	6.5872E-08
HG-203	76.	279.19	1.7037E-08
RA-226	93.	609.31	4.9724E-08
TH-232	58.	2614.66	0.0000E+00
U-235	134.	185.72	2.3637E-08
U-238	131.	131.20	6.1416E-08
NP-239	132.	106.13	5.8110E-08
AM-241	54.	59.54	9.3848E-08

***** 27-FEB-94 17:44:43 *****

FERMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #9.

STRAL FILE NAME: L940601.FEV
PLE DATE: 27-FEB-94 11:30:00
SAMPLE IDENTIFICATION: L940601.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 511.7000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.ERF

*
ACQUIRE DATE: 27-FEB-94 13:14:16 * FWHM(1332) 1.880
INTEGRATION TIME: 3600. SEC * SENSITIVITY: 3.000
ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 E
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10
*

DETECTOR: OR 10 * LIBRARY:MASTER.LIB
CALIBRATED DATE: 20-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.000 KEV
CALIBRATION: 462701. * HALF LIFE RATIO: 8.00
EGC7: 1.0 3232500 KEV * ABUNDANCE LIMIT: 70.00%

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	ARE	BKND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ZERR	FIT
1	0	74.89	55.	105.	.89	74.65	72	6	1.54E-02	35.4	
2	0	185.72	39.	83.	.84	310.62	308	7	1.08E-02	42.6	
3	0	230.70	69.	150.	.60	423.41	418	12	1.90E-02	37.0	
4	0	510.59	186.	66.	3.18	1002.26	995	14	5.16E-02	12.3	
5	0	609.30	54.	19.	1.40	1212.42	1209	9	1.51E-02	25.1	
6	0	662.54	45.	41.	3.03	1325.78	1320	13	1.25E-02	36.1	
7	0	1120.12	45.	18.	1.77	2299.96	2291	14	1.25E-02	29.3	
8	0	1332.50	26.	24.	1.59	2752.12	2744	16	7.22E-03	51.3	
9	0	1460.39	169.	24.	1.68	3025.46	3017	16	4.69E-02	10.9	
10	0	1766.74	24	10.	1.03	3672.37	3667	12	6.73E-03	34.5	
11	0	2614.62	73.	0.	1.89	5481.77	5472	19	2.03E-02	13.4	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ZERR
1	0	74.89	55.	105.	.89	74.65	72	6	1.54E-02	35.4
2	0	185.72	39.	83.	.84	310.62	308	7	1.08E-02	42.6
3	0	230.70	69.	150.	.60	423.41	418	12	1.90E-02	37.0
4	0	510.59	186.	66.	3.18	1002.26	995	14	5.16E-02	12.3
5	0	609.30	54.	19.	1.40	1212.42	1209	9	1.51E-02	25.1
6	0	662.54	45.	41.	3.03	1325.78	1320	13	1.25E-02	36.1
7	0	1120.12	45.	18.	1.77	2299.96	2291	14	1.25E-02	29.3
8	0	1332.50	26.	24.	1.59	2752.12	2744	16	7.22E-03	51.3
9	0	1460.39	169.	24.	1.68	3025.46	3017	16	4.69E-02	10.9

AM 11 1100 60 70 10 1.05 5672.67 3657 17.6 73E-03 34.5
11 0 2614.62 73. 0. 1.89 5481.77 5472 19 2.03E-02 13.4

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

SSION GAS

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
XE-135	FG	249.79	0.	0.	89.90*	0.000E+00	.000E 0	.000E 0
		608.18	54.	19.	2.89	2.587E+00	1.260E -6	3.158E -7

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	136.	66.	96.73*	2.245E+00	2.222E -7	2.731E -8
30-46	AP	889.25	0.	0.	99.98	0.000E+00	.000E 0	.000E 0
		1120.51	45.	18.	99.99*	1.655E+00	3.988E -8	1.165E -8
30-60	AP	1173.72	0.	0.	100.00	0.000E+00	.000E 0	.000E 0
		1332.49	29.	24.	100.00*	1.457E+00	2.618E -8	1.344E -8

MISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
NU-103	FP	497.08	0.	0.	89.00*	0.000E+00	.000E 0	.000E 0
		610.33	34.	19.	5.60	2.587E+00	5.496E -7	1.377E -7
Co-137	FP	661.65	5.	41.	35.12*	2.433E+00	5.194E -8	1.154E -8

MATERIAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	152.	24.	10.67*	1.362E+00	1.706E -6	1.854E -7
Kr-226	NP	186.21	139.	83.	3.28	5.815E+00	2.993E -7	1.276E -7
		241.98	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		225.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.92	0.	0.	37.20	0.000E+00	.000E 0	.000E 0
		609.31	34.	19.	46.30*	2.587E+00	6.636E -8	1.663E -8
		1120.29	45.	18.	15.10	1.655E+00	2.638E -7	7.727E -8
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	24.	10.	15.80	1.185E+00	1.899E -7	6.554E -8
		2204.22	0.	0.	4.98	0.000E+00	.000E 0	.000E 0
H-232	NP	238.63	69.	150.	44.60	5.033E+00	4.475E -8	1.654E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	73.	0.	35.86*	3.882E-01	3.363E -7	4.503E -8
U-235	NP	143.76	0.	0.	10.50	0.000E+00	.000E 0	.000E 0
		185.72	39.	33.	54.00*	5.815E+00	1.313E -8	7.750E -9

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	74.89	55.	105.	.89	74.65	72	6	1.54E-02	35.4
3	0	238.70	69.	150.	.60	423.41	418	12	1.90E-02	37.0
5	0	609.30	54.	19.	1.40	1212.42	1209	9	1.51E-02	25.1
7	0	1120.12	45.	18.	1.77	2299.96	2291	14	1.25E-02	29.3
8	0	1332.50	26.	24.	1.59	2752.12	2744	16	7.22E-03	51.3
10	0	1764.74	24.	10.	1.03	3672.37	3667	12	6.73E-03	34.5
11		2614.62	73.	0.	1.3	5481.77	5472	19	2.03E-02	13.4

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	MLFL	DECAY	UCI /gram	ABNDIFF	FAILED
2	RA-226	186.21	1600.00Y	1.000E	0	2.993E -7	51.83%
3	TH-232	238.63	1.00E+10Y	1.000E	0	4.475E -8	45.15%
5	Ru-103	610.33	30.350	1.002E	0	5.496E -7	5.92%
5	Sc-135	608.18	2.11E	1.185E	0	1.260E -6	3.11%
5	Co-226	609.31	1600.00Y	1.000E	0	6.636E -8	51.83%
7	Co-46	1120.31	1.3E.02D	1.001E	0	3.983E -6	50.00%
7	RA-226	1120.29	1600.00Y	1.000E	0	2.638E -7	51.83%
8	Cs-60	1332.49	1725.00D	1.000E	0	2.618E -8	50.00%
10	RA-226	1764.42	1600.00Y	1.000E	0	1.899E -7	51.83%
11	TH-232	2614.66	1.00E+10Y	1.000E	0	3.363E -7	45.15%

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION + DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	11
UNIDENTIFIED PEAKS	7
IDENTIFIED IN SUMMARY REPORT	4 36.36%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	102.70M	2.322	2.222E -7	2.731E -8	12.22	

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
Cs-137	FP	30.17Y	1.000	3.194E -8	2.154E -8	56.14	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
K-40	NP	1.23E+02Y	1.000	1.706E -6	1.851E -7	10.87	
U-235	NP	7.04E+03Y	1.000	1.818E -8	1.750E -9	42164	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	53.	477.59	1.4608E-07
NA-22	19.	1274.54	2.0848E-08
NA-24	17.	1368.53	2.3182E-08
CL-38	4.	2167.51	0.0000E+00
AR-41	16.	1293.64	4.5700E-08
SC-46	55.	1120.52	3.1771E-08
CR-51	57.	320.03	1.2713E-07
MN-54	42.	834.62	2.1813E-08
MN-56	41.	846.73	1.0363E-08
FE-59	34.	1029.22	4.3627E-08
CO-57	110.	122.03	1.3663E-08
CO-58	28.	810.76	1.7386E-08
CO-60	46.	1332.41	3.3721E-08
NI-65	11.	1481.8	1.4003E-07
CU-64	24.	1345.70	5.6596E-06
ZN-65	31.	1119.5	4.6820E-08
ZN-67M	56.	438.63	1.7221E-08
AS-70	65.	559.1	4.4783E-08
SE-75	84.	2641.63	2.3417E-08
BR-82	54.	554.52	2.5299E-08
BR-84	44.	881.56	1.0500E-06
KR-85	108.	513.99	5.3193E-06
KR-85M	124.	151.18	2.4001E-08
87	61.	402.58	9.8261E-08
88	101.	196.52	7.0960E-08
RE-88	15.	1836.01	2.1072E-05
RB-89	53.	1031.33	HALF LIFE TOO SHORT
SR-85	103.	513.99	2.3064E-08
SR-85M	37.	231.67	5.9557E-08
SR-91	34.	1024.30	0.4559E-08
SR-92	20.	1383.24	4.4998E-08
Y-88	15.	1836.01	2.4367E-08
Y-91	37.	1204.90	9.2029E-06
Y-91MD	58.	555.57	2.1973E-08
Y-92	30.	934.46	2.2877E-07
Y-93	82.	266.90	2.3491E-07
ZR-95	44.	756.72	3.6518E-08
ZR-97	36.	743.36	2.1170E-08
NB-94	42.	702.63	1.8214E-08
NB-95	45.	765.79	2.0728E-08
NB-97D	35.	1024.30	2.4040E-06
MO-90	70.	257.34	2.1184E-08
MO-99	45.	739.53	1.5937E-07
TC-99MD	98.	140.51	1.2620E-08
RU-103	54.	497.08	1.7772E-08
RU-105	45.	724.50	5.6423E-08
RU-106	46.	621.84	1.7457E-07
105	59.	318.90	6.8950E-08
110M	40.	657.75	1.7634E-08
109	100.	88.03	4.0746E-07

PEAK WIDTH = 3.00 FWHM, CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM
			UCI /gram
Li-7	71.	391.69	2.3471E-08
Li-122	56.	563.93	2.5573E-08
SB-124	35.	602.71	1.4939E-08
SB-125	70.	427.89	5.4825E-08
TE-123M	128.	158.97	1.5246E-08
TE-132	102.	228.16	1.5761E-08
T-121	61.	364.43	1.6345E-08
T-132	29.	667.69	2.8560E-08
T-143	46.	529.87	1.9053E-08
T-124	41.	847.03	1.3455E-07
T-140	19.	1260.42	9.1145E-08
Xe-132M	120.	163.95	6.3254E-07
Xe-133	79.	80.92	4.3543E-08
Xe-133M	90.	233.22	1.3053E-07
Xe-135	102.	249.79	1.2503E-08
Xe-135M	52.	526.56	HALF LIFE TOO SHORT
Xe-136	73.	258.51	HALF LIFE TOO SHORT
Cs-134	46.	604.70	1.7196E-08
Cs-134M	120.	127.42	1.6323E-07
Cs-136	32.	818.56	1.8789E-08
Cs-138	23.	1435.86	5.9314E-07
Br-133	69.	356.00	2.3793E-08
Br-137	113.	165.85	2.1551E-07
Br-140	50.	537.32	6.4625E-08
I-131	105.	120.22	3.9608E-06
I-140	9.	1596.49	1.8468E-08
Te-129	113.	165.82	1.4335E-08
Te-132	114.	145.44	2.5624E-08
Te-133	62.	293.26	3.1553E-08
Te-134	104.	133.54	1.0853E-07
ND-107	83.	91.11	4.6862E-08
Eu-152	59.	344.27	4.9119E-08
Eu-154	19.	1274.45	5.8665E-08
Hf-181	54.	482.03	1.8686E-08
W-187	48.	479.53	6.6181E-08
Hg-203	69.	279.19	1.6927E-08
Ra-226	75.	609.31	4.6521E-08
Th-232	73.	2614.66	0.0000E+00
U-238	124.	131.20	6.2252E-08
NP-239	116.	106.13	5.7737E-08
Am-241	63.	59.54	1.0561E-07

***** 27-FEB-94 17:46:31 *****

RMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #9.

SPECTRAL FILE NAME: L940601.FEV
SAMPLE DATE: 27-FEB-94 11:30:00
SAMPLE IDENTIFICATION: L940601.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 511.7000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 27-FEB-94 15:14:16 * FWHM(1332) 1.880
PRESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER : 5.0
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.
*

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV
KEV/CHNL: 4697016 * HALF LIFE RATIO: 8.00
OFFSET: 19.3232300 KEV * ABUNDANCE LIMIT: 70.00
*

ENERGY WINDOW 40.22 TO 2658.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	O	74.89	55.	105.	.89	74.65	72	6	1.54E-02	35.4	
2	O	185.72	39.	83.	.84	310.62	308	7	1.08E-02	42.6	
3	O	238.70	69.	150.	.60	423.41	418	12	1.20E-02	37.0	
4	O	510.59	186.	66.	3.18	1002.26	995	14	5.16E-02	12.3	
5	O	609.30	54.	19.	1.40	1212.42	1209	9	1.51E-02	25.1	
6	O	662.54	45.	41.	3.03	1325.78	1320	13	1.25E-02	36.1	
7	O	1120.12	45.	18.	1.77	2299.96	2291	14	1.25E-02	29.3	
8	O	1332.50	26.	24.	1.59	2752.12	2744	16	7.22E-03	51.3	
9	O	1460.89	169.	24.	1.68	3025.46	3017	16	4.69E-02	10.9	
10	O	1764.74	24.	10.	1.03	3672.37	3667	12	6.73E-03	34.5	
11	O	2614.62	73.	0.	1.89	5481.77	5472	19	2.03E-02	13.4	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	O	74.89	55.	105.	.89	74.65	72	6	1.54E-02	35.4
2	O	185.72	39.	83.	.84	310.62	308	7	1.08E-02	42.6
3	O	238.70*	1.	150.	.60	423.41	418	12	3.44E-04	***
		510.59 KEV PEAK DELETED								
5	O	609.30*	12.	19.	1.40	1212.42	1209	7	3.40E-03	***
		662.54 KEV PEAK DELETED								
7	O	1120.12	45.	18	1.77	2299.96	2291	14	1.25E-02	29.3

1460.89 KEV PEAK DELETED
1764.74 KEV PEAK DELETED
11 0 2614.62* 14. 0. 1.89 5481.77 5472 19 3.89E-03 ****

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT

PAGE 1

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0 74.89	55.	105.	.89	74.65	72	6	1.54E-02	35.4	2.95E+00
3	0 238.70	1.	150.	.60	423.41	418	12	3.44E-04	****	5.04E+00
5	0 609.30	12.	19.	1.40	1212.42	1209	9	3.40E-03	****	2.59E+00
7	0 1120.12	45.	18.	1.77	2299.26	2291	14	1.25E-02	29.3	1.66E+00
11	0 2614.62	14.	0.	1.89	5481.77	5472	19	3.89E-03	****	8.88E-01

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HALF	DECAY	DC%	/gram	ABNDIFF	FAILED	
2	RA-226	116.21	1600.00Y	1.000E	0	2.973E	-7	41.65%	ABN
3	TH-232	238.63	1.00E+10Y	1.000E	0	3.092E	-10	45.15%	ABN
5	Ru-103	610.33	39.25D	1.002E	0	1.242E	-7	5.92%	ABN
6	Xe-135	608.18	9.11H	1.185E	0	2.349E	-7	7.11%	ABN
6	RA-226	609.31	1600.00Y	1.000E	0	1.500E	-8	41.65%	ABN
7	Sc-46	1120.31	83.13D	1.001E	0	3.983E	-8	50.00%	ABN
7	RA-226	1120.29	1600.00Y	1.000E	0	2.638E	-7	41.65%	ABN
11	Th-232	2614.66	1.00E+10Y	1.000E	0	6.454E	-8	45.15%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY PAGE 2

TOTAL LINES IN SPECTRUM 6
UNIDENTIFIED PEAKS 5
IDENTIFIED IN SUMMARY REPORT 1 16.67%

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
U-235	NP	7.04E+08Y	1.000	1.813E -8	7.750E -2	42.04	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	53.	477.59	1.4608E-07
ANIL-511	215.	511.00	7.7604E-08
NA-22	19.	1274.54	2.0848E-08
NA-24	17.	1368.53	2.3182E-08
CL-38	4.	2167.51	0.0000E+00
AR-41	16.	1293.64	4.5700E-08
K-40	191.	1460.81	6.8761E-07
SC-46	55.	1120.51	3.1771E-08
CR-51	57.	320.08	1.2713E-07
MN-54	42.	834.83	2.1813E-08
MN-56	41.	846.71	4.0362E-08
FE-59	34.	1099.22	4.3627E-08
CO-57	110.	122.06	1.1663E-06
CO-58	28.	810.70	1.7386E-08
CO-60	46.	1332.49	3.3721E-08
NI-65	11.	1481.82	1.4008E-07
CU-69	24.	1745.90	5.6596E-06
Zn-69	31.	1115.52	4.6820E-08
Zn-69M	56.	438.65	1.7291E-08
AS-76	65.	559.10	4.4783E-08
SE-75	34.	264.65	2.3417E-08
BR-82	54.	554.32	2.5299E-08
BR-84	44.	881.50	1.0508E-06
85	108.	513.92	5.3193E-06
85M	124.	151.13	2.4001E-08
KR-87	61.	402.58	9.8261E-08
KR-88	91.	196.32	7.8960E-08
RL-88	15.	1836.01	2.1092E-05
RB-89	33.	1031.53	HALF LIFE TOO SHORT
SR-85	108.	513.97	2.3064E-08
SR-85M	87.	231.62	5.9557E-08
SR-91	34.	1024.30	8.4559E-08
SR-92	20.	1383.94	4.4998E-08
Y-88	15.	1836.01	2.4367E-08
Y-91	37.	1204.90	9.2029E-06
Y-91MD	58.	555.57	2.1973E-08
Y-92	30.	934.46	2.2877E-07
Y-93	82.	266.90	2.3491E-07
ZR-95	44.	756.72	3.6518E-08
ZR-97	36.	743.36	2.1170E-08
NB-94	42.	702.63	1.8214E-08
NB-95	45.	765.79	2.0728E-08
NB-97D	35.	1024.50	2.4040E-06
MO-90	70.	257.34	2.1184E-08
MO-99	45.	739.58	1.5937E-07
TC-99MD	98.	140.51	1.2620E-08
RU-103	54.	497.03	1.7772E-08
105	45.	724.50	5.6423E-08
106	46.	621.84	1.7457E-07
105	59.	318.90	6.8950E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

MINIMUM

NUCLIDE	BKG	ENERGY	UCI /gram
TI-10M	40.	657.75	1.7634E-08
TI-109	100.	88.03	4.0746E-07
SN-113	71.	391.69	2.3471E-08
SB-122	56.	563.93	2.5573E-08
SB-124	35.	602.71	1.4939E-08
SB-125	70.	427.89	5.4825E-08
TE-123M	128.	158.99	1.5246E-08
TE-132	102.	228.16	1.5761E-08
I-131	61.	364.48	1.6845E-08
I-132	29.	667.69	2.8560E-08
I-133	46.	529.87	1.9053E-08
I-134	41.	847.03	1.3455E-07
I-135	19.	1260.41	9.1143E-08
KE-131M	120.	165.93	6.3254E-07
KE-133	79.	80.99	4.3543E-08
Xe-133M	90.	233.22	1.3053E-07
Xe-135	102.	249.79	1.9508E-08
Xe-135M	52.	526.56	HALF LIFE TOO SHORT
Xe-138	73.	258.31	HALF LIFE TOO SHORT
CS-134	46.	604.70	1.7196E-08
CS-134M	120.	127.42	1.6328E-07
CS-136	32.	818.50	1.8789E-08
CS-137	64.	661.65	2.4858E-08
CS-138	23.	1435.86	5.9314E-07
I-133	69.	356.00	2.3793E-08
I-139	113.	165.85	2.1551E-07
Sa-140	50.	537.32	6.4625E-08
BA-141	105.	190.22	3.9608E-06
LA-140	9.	1526.42	1.8468E-08
CE-139	113.	165.85	1.4885E-08
CE-141	114.	145.44	2.5624E-08
CE-143	62.	293.26	3.1553E-08
CE-144	104.	133.54	1.0853E-07
ND-147	83.	91.11	4.6862E-08
EU-152	59.	344.27	4.9119E-08
EU-154	19.	1274.45	5.8685E-08
HF-181	54.	482.03	1.8636E-08
W-187	48.	479.53	6.6181E-08
HG-203	69.	279.19	1.6927E-08
RA-226	75.	609.31	4.6521E-08
TH-232	73.	2614.66	0.0000E+00
U-238	124.	131.20	6.2252E-08
NP-239	116.	106.13	5.7737E-08
AM-241	63.	59.54	1.0561E-07

 ***** 27-FEB-94 20:17:59 *****

FERMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #10.

STRAL FILE NAME: L940611.FEV
 PLE DATE: 27-FEB-94 18:30:00
 SAMPLE IDENTIFICATION: L940611.FEV
 TYPE OF SAMPLE: WATER
 SAMPLE QUANTITY: 455.600G UNITS: gram
 SAMPLE GEOMETRY: LMAP500
 EFFICIENCY FILE NAME: LMAP500.EFF

ACQUISITION DATE: 27-FEB-94 17:17:13 * FWHM(1552) : 1.886
 ACQUISITION TIME(LIVE): 3600. SEC * SENSITIVITY: 9.000
 CALIBRATED TIME: 3600. SEC * SHAPE PARAMETER: 5.0 %
 CALIBRATED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
 DAUL DATE: 23-FEB-94 07:21:01 * ENERGY TOLERANCE: 1.500 KEY
 REV/CHN: 14657026 * HALF LIFE RATE: .00
 OFFSET: 39.3232300 KELV * ABUNDANCE LIMIT: 70.00%

ENERGY WINDOW: 40.29 TO 2953.92

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	74.69	53.	107.	.52	74.24	71	6	1.46E-02	35.3	
2	0	258.88	33.	116.	.96	423.79	420	8	9.06E-03	60.5	
3	0	352.64	75.	90.	1.37	666.00	660	14	2.10E-02	29.5	
4	0	511.45	192.	128.	2.42	1004.10	995	20	5.33E-02	17.6	
5	0	609.71	46.	105.	3.87	1213.30	1207	16	1.28E-02	51.9	
6	0	661.43	28.	38.	.93	1323.41	1319	10	7.81E-03	49.1	
7	0	1119.09	19.	44.	1.95	2297.78	2296	14	5.14E-03	78.3	
8	0	1377.82	19.	10.	1.63	2848.62	2839	17	5.34E-03	56.9	
9	0	1415.76	13.	3.	1.39	2929.38	2925	10	3.50E-03	42.4	
10	0	1460.85	208.	22.	1.76	3025.32	3016	16	5.79E-02	8.0	
11	0	1764.50	46.	11.	1.06	3671.36	3664	15	1.28E-02	21.7	
12	0	1836.62	15.	3.	1.26	3825.40	3823	7	4.24E-03	32.2	
13	0	2204.13	20.	6.	1.34	4607.94	4603	11	5.68E-03	28.3	

PEAK SEARCH COMPLETED (REV 15.8 - NO PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
 UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR
1	0	74.69	53.	107.	.62	74.24	71	6	1.46E-02	35.3
2	0	258.88	33.	116.	.96	423.79	420	8	9.06E-03	60.5
3	0	352.64	75.	90.	1.37	666.00	660	14	2.10E-02	29.5
4	0	511.45	192.	128.	2.42	1004.10	995	20	5.33E-02	17.6
5	0	609.71	46.	105.	3.87	1213.30	1207	16	1.28E-02	51.9
6	0	661.43	28.	38.	.93	1323.41	1319	10	7.81E-03	49.1
7	0	1119.09	19.	44.	1.95	2297.78	2296	14	5.14E-03	78.3

M	D	DATA	19.	10.	1-5500	10000	20000	17.5	5.50E-03	56.9
9	0	1415.76	13.	3.	1.39	2929.38	2925	10	3.50E-03	42.4
10	0	1460.85	208.	22.	1.76	3025.39	3016	16	5.79E-02	8.0
11	0	1764.50	46.	11.	1.06	3671.86	3664	15	1.28E-02	21.7
12	0	1836.62	15.	3.	1.26	3825.40	3823	7	4.24E-03	32.2
13	0	2204.18	20.	6.	1.34	4607.94	4603	11	5.68E-03	28.3

E-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	192.	128.	96.73*	2.941E+00	1.801E -7	3.174E -8
SC-46	AP	889.25	0.	0.	99.98	0.000E+00	.000E 0	.000E 0
		1120.51	19.	44.	99.99*	1.656E+00	1.842E -3	1.443E -8

Fission Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
Ru-188	FP	898.02	0.	0.	14.00	0.000E+00	.000E 0	.000E 0
		1836.01	19.	3.	21.40*	1.151E+00	1.660E -6	5.344E -7
		2677.36	0.	0.	1.96	0.000E+00	.000E 0	.000E 0
Tc-98	FP	898.02	0.	0.	93.10	0.000E+00	.000E 0	.000E 0
		1836.01	19.	3.	99.30*	1.151E+00	2.122E -8	7.077E -9
Ru-103	FP	497.08	0.	0.	39.00*	0.000E+00	.000E 0	.000E 0
		610.33	05.	05.	3.60	2.336E+00	5.222E -7	2.712E -7
Cr-43	FP	661.65	25.	36.	85.10*	2.436E+00	2.235E -8	1.023E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	208.	22.	10.67*	1.362E+00	2.364E -6	1.891E -7
Ca-226	NP	186.21	0.	0.	3.26	0.000E+00	.000E 0	.000E 0
		241.96	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		295.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.92	75.	20.	57.20	3.351E+00	8.677E -8	2.561E -8
		609.32	68.	105.	46.30*	2.586E+00	6.319E -8	3.277E -8
		1120.29	19.	44.	15.10	1.656E+00	1.212E -7	2.543E -8
		1238.11	0.	0.	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	68.	11.	15.30	1.186E+00	4.043E -7	8.761E -8
		2204.22	20.	6.	4.98	1.007E+00	6.725E -7	1.946E -7
Th-232	NP	238.65	33.	116.	44.60	5.036E+00	2.392E -8	1.447E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.30	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	0.	0.	35.86*	0.000E+00	.000E 0	.000E 0

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION , DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	74.69	53.	107.	.62	74.24	71	6	1.46E-02	35.3	2.23E+00
2	0	238.88	33.	116.	.96	423.79	420	8	9.06E-03	50.5	5.04E+00
3	0	1377.82	19.	10.	1.63	2848.62	2839	17	5.34E-03	56.9	1.42E+00
9	0	1415.76	13.	5.	1.39	2929.38	2925	10	3.50E-03	42.4	1.39E+00
12	0	1836.62	15.	5.	1.26	3825.40	3823	7	4.24E-03	32.2	1.15E+00

LINEs NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	TAC	DECAY	UCI	/gram		ABND/F	FATLED
2	TH-232	238.63	1.00E+10Y	1.000E	0	2.392E-3		25.03%	ABN
3	Ru-103	610.33	59.35D	1.001L	0	3.229E-7		5.92%	ABN
7	Sc-46	1120.53	83.83D	1.000E	0	1.842E-3		50.00%	ABN
12	Rb-88	1836.01	17.80M	1.626E	1	1.660E-6		57.28%	ABN
12	V-88	1836.01	106.60D	1.000E	0	2.129E-3		51.55%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	13
UNIDENTIFIED PEAKS	5
IDENTIFIED IN SUMMARY REPORT	8 61.54%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	SERR
ANIL-511	AP	109.70M	1.619	1.301E -7	3.174E -8		17.62

FUSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	SERR
CE-137	FP	50.17Y	1.000	2.255E -8	1.028E -8		19.15

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	SERR
K-40	NF	1.23E+09Y	1.000	2.354E -6	1.391E -7		3.00
RA-226	NF	1600.0UY	1.000	6.319E -6	2.177E -8		51.36

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM, CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	56.	477.59	1.6856E-07
NA-22	24.	1274.54	2.6316E-08
NA-24	14.	1368.53	2.2612E-08
CL-38	5.	2167.51	0.0000E+00
AR-41	20.	1293.64	4.0005E-08
SC-46	56.	1120.51	3.5995E-08
CR-51	65.	320.08	1.5233E-07
MN-54	44.	834.83	2.5073E-08
MN-56	39.	846.75	3.4240E-08
FE-59	23.	1029.22	4.0276E-08
CO-57	115.	122.56	1.5609E-08
CO-58	51.	816.76	2.6343E-08
CO-60	44.	1332.49	3.7040E-08
NL-62	8.	1481.84	1.0329E-07
CU-64	19.	1345.20	5.3698E-06
ZN-65	25.	1115.52	4.7213E-06
ZH-67M	58.	458.52	1.8840E-08
AC-76	60.	559.16	4.7129E-08
Ge-75	93.	264.65	2.7667E-08
BR-82	60.	554.32	2.9397E-08
BR-84	43.	361.50	3.3644E-07
KR-85	137.	513.99	6.7287E-06
KR-85M	106.	151.18	2.1513E-08
87	69.	402.52	6.2902E-08
88	108.	196.32	7.2212E-08
RE-88	25.	1836.01	3.3163E-06
RE-89	30.	1031.83	1.3674E-06
SR-85	137.	513.97	2.9163E-08
SR-85M	84.	231.69	3.6677E-08
SR-91	29.	1024.30	8.1832E-08
SR-92	15.	1583.94	3.4319E-08
Y-88	25.	1836.01	3.5322E-08
Y-91	23.	1204.20	8.1454E-06
Y-91MD	52.	555.57	2.1801E-08
Y-92	40.	934.46	2.4629E-07
Y-93	70.	266.90	2.2837E-07
ZR-95	49.	756.72	4.3264E-08
ZP-97	43.	743.36	2.4992E-08
NB-94	40.	702.63	1.9964E-08
NB-95	46.	765.79	2.3520E-08
NB-97D	23.	1024.50	2.3226E-06
MO-90	76.	257.34	2.2071E-08
MO-99	47.	739.58	1.8111E-07
TC-99MD	121.	140.51	1.5593E-08
RU-103	57.	497.08	2.0494E-08
RU-105	46.	724.50	5.5232E-08
RU-106	41.	621.84	1.8509E-07
105	71.	318.90	8.3382E-08
110M	37.	657.75	1.9046E-08
109	100.	88.03	4.5761E-07

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
γ -13	56.	391.69	2.3406E-08
γ -122	51.	563.93	2.7133E-08
SB-124	44.	602.71	1.8804E-08
SE-125	66.	427.89	5.9789E-08
TE-123M	130.	158.92	1.7252E-08
TE-132	76.	228.16	1.5152E-08
I-131	70.	364.48	2.0193E-08
I-132	48.	667.69	3.0986E-08
I-133	49.	529.87	2.1527E-08
I-134	39.	847.02	6.9495E-08
I-135	13.	1260.41	7.6639E-08
Al-261M	94.	163.92	6.2731E-07
Al-265	72.	30.79	4.3619E-08
Al-273M	72.	233.22	1.2564E-07
KE-215	32.	249.77	1.8274E-08
XE-225M	57.	526.56	7.6457E-07
XU-238	60.	258.51	2.1160E-06
CS-134	49.	604.70	1.9932E-08
Co-134M	112.	127.42	1.4115E-07
Co-136	39.	818.56	2.3243E-08
US-238	21.	1435.86	1.8642E-07
La-133	56.	356.66	2.4074E-08
SA-139	93.	165.85	1.4006E-07
BA-140	47.	537.32	7.0221E-08
γ -131	97.	190.22	4.9092E-07
γ -130	10.	1596.49	2.1503E-08
Ca-139	28.	165.85	1.5566E-08
Cl-36	115.	145.44	2.8881E-08
Ca-135	70.	293.26	5.6210E-08
Ca-137	123.	163.54	1.9255E-07
CD-113	37.	91.11	5.3751E-08
Zn-132	62.	344.27	5.6552E-08
EU-154	24.	1274.45	7.4077E-08
HF-181	66.	482.03	2.3187E-08
W-187	63.	479.53	8.2833E-08
Hg-203	81.	279.19	2.0586E-08
Th-232	50.	2614.66	0.0000E+00
U-233	127.	185.72	2.6926E-08
U-238	119.	131.20	6.8493E-08
NP-239	124.	106.13	6.6268E-08
Pm-241	76.	59.54	1.3027E-07

***** 27-FEB-94 20:20:13 *****

RMI 2/NRC SPLIT: MONROE WATER INTAKE, SAMPLE #10.

SPECTRAL FILE NAME: L940611.FEV
SAMPLE DATE: 27-FEB-94 18:30:00
SAMPLE IDENTIFICATION: L940611.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 455.6000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 27-FEB-94 19:17:13 * FWHM(1332) 1.386
PRESLT TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER 1.0 %
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS 2

DETECTOR: URTEC * LIBRARY:MASTER.LIB
CALIB DATE: 20-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV
KEY/CHNL: 4697016 * HALF LIFE RATIO: 6.00
OFFSET: 39.3232300 KEV * ABUNDANCE LIMIT: 70.000

ENERGY WINDOW 40.22 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	74.69	53.	107.	.62	74.24	71	6	1.46E-02	35.3	
2	0	236.88	33.	116.	.96	423.79	420	3	9.06E-03	60.5	
3	0	352.64	75.	90.	1.37	666.00	660	14	2.10E-02	22.5	
4	0	511.45	192.	128.	2.42	1004.10	995	20	5.33E-02	17.6	
5	0	609.71	46.	105.	3.87	1213.30	1207	16	1.28E-02	51.9	
6	0	661.43	28.	38.	.93	1323.41	1319	10	7.81E-03	49.1	
7	0	1119.09	19.	44.	1.95	2297.78	2296	14	5.14E-03	78.3	
8	0	1373.82	19.	10.	1.63	2848.62	2839	17	5.34E-03	56.9	
9	0	1415.76	13.	3.	1.37	2929.58	2925	10	3.50E-03	42.4	
10	0	1460.85	208.	22.	1.76	3025.39	3016	16	5.79E-02	8.0	
11	0	1764.50	46.	11.	1.06	3671.36	3664	15	1.28E-02	21.7	
12	0	1836.62	15.	3.	1.26	3825.40	3823	7	4.24E-03	32.2	
13	0	2204.18	20.	6.	1.34	4607.94	4603	11	5.68E-03	28.3	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND
* AFTER ENERGY INDICATES CORRECTED PEAK

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	74.69	53.	107.	.62	74.24	71	6	1.46E-02	35.3	
		236.88 KEV PEAK DELETED									
3	0	352.64	75.	90.	1.37	666.00	660	14	2.10E-02	22.5	
		511.45 KEV PEAK DELETED									
5	0	609.71*	4.**	105.	3.87	1213.30	1207	16	1.10E-03	***	

7	0	1119.09	19.	44.	1.95	2297.78	2296	14	5.14E-03	78.3
8	0	1377.82	19.	10.	1.63	2848.62	2839	17	5.34E-03	56.9
9	0	1415.76	13.	3.	1.39	2929.38	2925	10	3.50E-03	42.4
1460.85 KEV PEAK DELETED										
1764.50 KEV PEAK DELETED										
12	0	1836.62	15.	3.	1.26	3825.40	3823	7	4.24E-03	32.2
13	0	2204.18	20.	6.	1.34	4607.94	4603	11	5.68E-03	28.3

NUCLIDE IDENTIFICATION SYSTEM , (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT

PAGE 1

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0	74.69	53.	107.	.62	74.24	71	6 1.46E-02	35.3	2.93E+00
3	0	352.64	75.	90.	1.37	666.00	660	14 2.10E-02	29.5	3.85E+00
5	0	609.71	4.	105.	3.87	1213.30	1207	16 1.10E-03	****	2.59E+00
7	0	1119.09	19.	44.	1.25	2297.78	2296	14 5.14E-03	78.3	1.66E+00
8	0	1377.82	19.	10.	1.63	2848.62	2839	17 5.34E-03	56.9	1.42E+00
9	0	1415.76	13.	5.	1.39	2929.58	2925	10 3.50E-03	42.4	1.32E+00
12	0	1836.01	15.	3.	1.26	3825.40	3823	7 4.24E-03	32.2	1.15E+00
13	0	2204.18	20.	4.	1.34	4607.94	4603	11 5.68E-03	28.3	1.01E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLEUS	ENERGY	REL%	DECAY	UCF /gram		ABNDIFF	FAILED
3	g-226	351.92	1600.00Y	1.000E	0	8.677E -8	66.70%	ABN
5	g-103	610.33	32.350	1.001E	0	4.530E -8	5.92%	ABN
6	6-226	609.31	1600.00Y	1.000E	0	5.473E -9	66.70%	ABN
7	g-46	1120.51	35.350	1.000E	0	1.342E -6	50.00%	ABN
7	6-226	1120.29	1600.00Y	1.000E	0	1.219E -7	66.70%	ABN
12	g-88	1836.01	17.304	1.626E	1	1.660E -6	37.29%	ABN
12	g-88	1836.01	105.601	1.000E	0	2.199E -8	51.55%	ABN
13	g-226	2204.22	1600.00Y	1.000E	0	6.726E -7	66.70%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM	8
UNIDENTIFIED PEAKS	8
IDENTIFIED IN SUMMARY REPORT	0 .00%

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	56.	477.59	1.6856E-07
ANIL-511	227.	511.00	6.2454E-08
NA-22	24.	1274.54	2.6316E-08
N-2	14.	1368.53	2.2612E-08
CL-21	5.	2167.51	0.0000E+00
AI-4	20.	1293.64	4.0005E-08
K-40	225.	1460.31	3.3820E-07
Cl-36	56.	1120.52	3.5995E-08
C-15	65.	320.07	1.5233E-07
C-36	44.	854.37	2.5073E-08
C-36	59.	846.75	3.4240E-08
C-36	23.	1079.21	4.0276E-08
C-36	115.	122.06	1.5637E-03
C-36	5.	310.75	2.6343E-08
C-36	44.	1332.41	3.7040E-08
C-36	5.	1491.84	1.0329E-07
C-36	12.	1345.98	3.3678E-06
C-36	25.	1115.52	4.7218E-08
C-36	58.	405.62	1.8340E-08
C-36	60.	559.10	4.7129E-08
C-36	23.	264.63	2.7667E-03
Cl-32	60.	554.32	2.9397E-08
Cl-34	43.	881.50	3.3644E-07
Cl-34	137.	513.92	6.7287E-06
Cl-34	106.	151.18	2.1513E-08
Cl-34	69.	402.56	6.9902E-08
Cl-34	108.	196.32	7.2712E-03
Cl-34	25.	1836.01	3.3163E-06
Cl-34	50.	1051.57	1.3674E-06
Cl-34	137.	513.97	2.9163E-08
Cl-34	34.	231.62	3.6637E-03
Cl-34	29.	1024.50	3.1832E-08
Cl-34	15.	1383.94	3.4319E-08
Y-33	25.	1836.01	3.5322E-08
Y-31	23.	1204.90	8.1454E-06
Y-31MD	52.	555.57	2.1801E-08
Y-32	40.	934.46	2.4629E-07
Y-33	70.	266.90	2.2837E-07
R-35	49.	756.72	4.3264E-08
T-9	43.	743.36	2.4992E-08
NE-94	40.	702.03	1.9964E-08
NE-95	46.	765.72	2.3520E-08
NE-97D	28.	1024.50	2.3226E-06
MG-90	76.	257.34	2.2071E-08
MG-99	47.	739.55	1.8111E-07
TC-99MD	121.	140.51	1.5593E-08
RU-103	57.	427.03	2.0494E-08
105	46.	724.50	5.5232E-08
106	31.	21.84	1.3509E-07
105	71.	518.90	8.3382E-08

PEAK WIDTH = 0.00 FWHM, CONFIDENCE LEVEL = 9.00.

RELATIVE	BKG	ENERGY	MINIMUM UC1 /gram
1.00	57.	657.75	1.2046E-08
1.00	100.	88.03	4.5761E-07
-1.3	56.	391.62	2.5406E-08
1.7	1.	563.22	2.7153E-07
1.	14.	602.17	1.2804E-08
1.	5.	479.85	5.9742E-07
1.	3.	170.57	1.1712E-07
1.	2.	125.	1.7121E-07
1.	1.	100.	1.1111E-07
1.	1.	667.00	7.4986E-08
1.	1.	223.00	1.1224E-07
1.	1.	146.66	1.7492E-07
1.	1.	100.00	1.1111E-07
1.	1.	570.77	2.9092E-07
1.	1.	433.20	1.0747E-07
1.	1.	365.60	2.1324E-07
1.	1.	308.40	2.3382E-07
1.	1.	240.20	3.6110E-07
1.	1.	182.50	1.3485E-07
1.	1.	144.27	5.3751E-08
1.01	28.	1274.42	1.4977E+02
1.01	1.	452.05	2.3107E+02
1.01	63.	675.82	5.2353E+01
1.203	1.	277.29	2.0136E+01
1.224	11.	603.31	6.9653E+01
1.224	1.	7614.66	0.00000E+00
1.224	17.	115.72	2.0326E+01
1.224	1.	131.20	6.3193E+01
1.224	1.	176.13	6.6763E+01
26.	1.	2.34	1.3027E+02

***** 24-FEB-94 20:55:57 *****

(6)

CIRC WATER PUMP HOUSE (DECANT LINE) SAMPLE, PRE-DISCHARGE.

SAMPLE FILE NAME: L940441.FEV
SAMPLE DATE: 24-FEB-94 13:40:00
SAMPLE IDENTIFICATION: L940441.FEV
TYPE OF SAMPLE: WATER
SAMPLE QUANTITY: 722.6000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 24-FEB-94 17:24:36 * FWHM(1332) 1.036
RESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 3
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

*

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:21:01 * ENERGY TOLERANCE: 1.500 KEE
REV/CHNL 4697016 * HALF LIFE RATIO: 8.00
OFFSET: 39.8252300 KEE * ABUNDANCE LIMIT: 70.00%

*

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	92.74	44.	98.	1.14	112.67	110	7	1.22E-02	43.7	
2	0	238.38	39.	129.	.67	422.72	420	9	1.08E-02	56.1	
3	0	511.62	208.	125.	3.01	1004.47	997	24	5.77E-02	17.6	
4	0	582.68	27.	61.	1.33	1155.75	1152	12	7.37E-03	71.3	
5	0	661.85	47.	33.	2.04	1324.30	1320	10	1.30E-02	22.7	
6	0	1461.00	207.	9.	1.95	3025.70	3019	14	5.75E-02	8.4	
7	0	1765.57	52.	3	1.26	3674.13	3666	16	1.46E-02	19.8	
8	0	2614.83	44.	12.	1.31	5482.21	5474	14	1.23E-02	20.3	

PEAK SEARCH COMPLETED (REV 15.3 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA: CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	92.74	44.	98.	1.14	112.67	110	7	1.22E-02	43.7	
2	0	238.38	39.	129.	.67	422.72	420	9	1.08E-02	56.1	
3	0	511.62	208.	125.	3.01	1004.47	997	24	5.77E-02	17.6	
4	0	582.68	27.	61.	1.33	1155.75	1152	12	7.37E-03	71.3	
5	0	661.85	47.	33.	2.04	1324.30	1320	10	1.30E-02	22.7	
6	0	1461.00	207.	9.	1.95	3025.70	3019	14	5.75E-02	8.4	
7	0	1765.57	52.	3	1.26	3674.13	3666	16	1.46E-02	19.8	
8	0	2614.83	44.	12.	1.31	5482.21	5474	14	1.23E-02	20.3	

PILE-UP CORRECTION COMPLETED

D 6

NUCLIDE IDENTIFICATION SYSTEM . (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 TELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

DIVINATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511 AP		511.00	208.	125.	96.73*	2.940E+00	3.767E -7	6.644E -8

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
CS-137 PP		661.65	47.	33.	85.12*	2.455E+00	2.342E -8	6.295E -9

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40 NP		1460.81	207.	9.	10.67*	1.362E+00	1.480E -6	1.242E -7
RA-226 NP		186.21	0.	0.	3.28	0.000E+00	0.000E 0	0.000E 0
		241.93	0.	0.	7.47	0.000E+00	0.000E 0	0.000E 0
		225.21	0.	0.	19.20	0.000E+00	0.000E 0	0.000E 0
		351.92	0.	0.	37.20	0.000E+00	0.000E 0	0.000E 0
		609.31	0.	0.	46.30*	0.000E+00	0.000E 0	0.000E 0
		1120.22	0.	0.	15.10	0.000E+00	0.000E 0	0.000E 0
		1233.11	0.	0.	5.94	0.000E+00	0.000E 0	0.000E 0
		1764.49	52.	8.	15.80	1.185E+00	2.908E -7	5.767E -8
		2204.22	0.	0.	4.98	0.000E+00	0.000E 0	0.000E 0
		238.63	39.	129.	44.60	5.647E+00	1.707E -3	1.002E -3
		338.32	0.	0.	11.40	0.000E+00	0.000E 0	0.000E 0
		727.17	0.	0.	11.20	0.000E+00	0.000E 0	0.000E 0
		583.14	27.	61.	30.25	2.673E+00	3.410E -8	2.431E -8
		313.07	0.	0.	27.70	0.000E+00	0.000E 0	0.000E 0
		967.11	0.	0.	16.66	0.000E+00	0.000E 0	0.000E 0
		2614.66	44.	12.	35.86*	0.000E 01	1.139E -7	2.227E -3

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1	0 92.74	44.	98.	1.14	112.67	110	7	1.22E-02	43.7	4.59E+00
2	0 238.38	39.	129.	.67	422.72	420	2	1.08E-02	56.1	5.04E+00
4	0 582.68	27.	61.	1.33	1155.75	1152	12	7.37E-03	71.3	2.67E+00
7	0 1765.57	52.	8.	1.26	3674.13	3666	16	1.46E-02	19.3	1.18E+00
8	0 2614.63	44.	12.	1.31	5482.21	5474	14	1.23E-02	20.3	8.88E-01

INES NOT MEETING SUMMARY CRITERIA

PK NUCLIDE	ENERGY	HIFE	DECAY	UCI /gram	ABNDIFF	FAILED
2 TH-232	238.63	1.00E+10Y	1.000E	0 1.797E -8	62.12%	ABN
4 Th-232	583.14	1.00E+10Y	1.000E	0 3.410E -8	62.12%	ABN
7 Ra-226	1764.49	1600.00Y	1.000E	0 2.908E -7	10.17%	ABN
8 Th-232	2614.66	1.00E+10Y	1.000E	0 1.439E -7	62.12%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	8
IDENTIFIED PEAKS	5
IDENTIFIED IN SUMMARY REPORT	3
	37.50%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	4.267	3.767E -7	5.644E -8	17.64	

FUSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
C3-117	FP	30.17Y	1.000	2.542E -8	5.754E -9	22.69	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA	ERROR	%ERR
K-40	NP	1.23E+02Y	1.000	1.180E -6	2.242E -7	1.79	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
	51.	477.59	1.0158E-07
NA-22	19.	1274.54	1.4764E-08
NA-24	21.	1368.53	2.0017E-08
CL-38	8.	2167.51	0.0000E+00
AR-41	20.	1293.64	7.7447E-08
SC-46	60.	1120.51	2.3515E-08
CR-51	64.	320.93	9.5595E-08
MN-54	47.	834.75	1.6343E-08
MN-56	39.	846.75	4.7776E-08
Fe-59	57.	1099.22	3.2270E-08
CO-57	103.	122.92	9.5892E-09
Co-58	51.	810.75	1.6629E-08
CD-60	47.	1332.49	2.4138E-08
NI-55	13.	1481.84	1.8722E-07
CU-64	18.	1345.90	3.8723E-08
ZN-65	32.	1115.51	3.3694E-08
ZN-69M	67.	438.63	1.4817E-08
As-76	67.	589.10	3.3943E-08
Se-75	66.	264.65	1.4706E-08
BR-82	61.	554.32	1.9806E-08
BR-84	48.	381.50	HALF LIFE TOO SHORT
KR-85	121.	513.99	3.9871E-06
KR-85M	120.	151.18	2.2803E-08
	72.	402.58	2.2556E-07
	112.	196.32	2.6062E-08
RE-88	22.	1836.61	HALF LIFE TOO SHORT
RB-89	30.	1031.88	HALF LIFE TOO SHORT
SP-88	121.	513.99	1.7303E-08
SR-85M	38.	231.62	1.4552E-07
SR-91	30.	1024.30	6.5110E-08
SR-92	21.	1383.24	5.4536E-08
Y-88	22.	1836.01	2.0909E-08
Y-91	26.	1204.90	5.4683E-06
Y-91MD	58.	555.57	1.8012E-08
Y-92	36.	934.46	2.6282E-07
Y-93	80.	266.90	1.8855E-07
ZR-95	47.	756.72	2.6751E-08
ZR-97	49.	743.36	1.8989E-08
NB-94	56.	702.63	1.4893E-08
NB-95	49.	765.79	1.5342E-08
NB-97D	32.	1024.50	1.7673E-06
MO-90	96.	257.34	2.2449E-08
MO-99	33.	739.58	9.8701E-08
TC-99MD	131.	140.51	1.0552E-08
RU-103	66.	497.08	1.3934E-08
RU-105	45.	724.50	5.4645E-08
RU-106	43.	621.84	1.1954E-07
RH-105	64.	318.90	5.2892E-08
SC-110M	57.	657.75	1.4910E-08
)109	92.	88.03	2.7679E-07

PEAK WIDTH = *3.00 FWHM. CONFIDENCE LEVEL = 4.66.

ISOTIDE	BKG	ENERGY	MINIMUM
			UCI /gram
Fr-113	75.	391.69	1.7091E-08
SB-122	54.	563.93	1.8169E-08
SB-124	53.	602.71	1.3031E-08
SB-125	72.	427.82	3.9377E-08
TE-123M	98.	158.77	9.4511E-09
TE-132	102.	228.16	1.1361E-08
I-131	75.	564.40	1.3323E-08
I-131	35.	667.69	4.0664E-08
I-133	49.	529.87	1.4885E-08
I-134	38.	847.03	4.4788E-07
I-135	28.	1260.41	2.6620E-08
XE-133M	117.	163.75	4.4446E-07
XE-133	75.	80.72	3.0377E-08
XE-134M	100.	235.22	1.0300E-07
XE-135	78.	249.19	1.4072E-08
XE-135M	41.	526.56	HALF LIFE TOO SHORT
XE-136	104.	258.31	HALF LIFE TOO SHORT
CS-134	45.	604.70	1.2045E-08
CS-134M	127.	127.42	1.9211E-07
CS-135	44.	815.30	1.5670E-08
CS-136	11.	1435.36	3.8732E-06
BA-135	78.	356.06	1.7914E-08
BA-139	105.	165.85	4.0138E-07
BA-140	59.	537.32	4.9938E-08
BA-141	25.	190.22	HALF LIFE TOO SHORT
BA-140	14.	1590.49	1.6884E-08
CE-139	105.	165.85	1.0165E-08
CE-141	122.	145.44	1.8805E-08
CE-142	50.	293.16	2.6473E-08
CE-144	129.	133.54	3.5611E-08
ND-143	76.	91.11	3.1923E-08
EU-152	54.	344.27	3.3277E-08
EU-154	12.	1274.45	4.1558E-03
HF-161	50.	482.02	1.2750E-08
W-167	56.	470.53	5.3661E-08
HG-203	76.	279.19	1.2596E-08
RA-226	67.	609.31	3.1136E-08
TH-232	56.	2614.66	0.0000E+00
U-235	130.	185.72	1.7176E-08
U-238	144.	131.20	4.7505E-08
NP-239	106.	106.13	4.0057E-08
AM-241	58.	59.54	7.1755E-08

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION, DEC 88)
UNKNOWN LINE REPORT

PAGE 1

UNIDENTIFIED PEAKS

IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%EFF
1 0	92.74	44.	98.	1.14	112.67	110	7	1.22E-02	43.7	4.59E+00
4 0	582.68	27.	61.	1.33	1155.75	1152	12	7.37E-03	71.3	2.67E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLLF	DECAY	UC1 /gram	ABNDIFF	FAILED
6	232	583.14	1.00E-10Y	000E 0	3.410E -8	16.97%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM 5
UNIDENTIFIED PEAKS 2
IDENTIFIED IN SUMMARY REPORT 3 60.00%

ACTIVATION PRODUCT

NUCLIDE SBHR HLIFE DECAY UCI /gram 1-SIGMA
ANIL-511 AP 109.70M 4.967 2.714E -8 ERROR %ERR
8.873E -8 326.95

FUSION PRODUCT

NUCLIDE SBHR HLIFE DECAY UCI /gram 1-SIGMA
CO-137 FP 30.17Y 1.000 2.342E -8 ERROR %ERR
6.954E -9 29.62

NATURAL PRODUCT

NUCLIDE SBHR HLIFE DECAY UCI /gram 1-SIGMA
K-40 NP 1.28E+02Y 1.000 2.912E -8 ERROR %ERR
1.710E -7 587.12

***** 24-FEB-94 23:59:20 *****

FERMI 2/NRC SPLIT, DECANT #1, DISCHARGE IN PROGRESS.

STRAL FILE NAME: L940451.FEV
PILE DATE: 24-FEB-94 22:30:00
SAMPLE IDENTIFICATION: L940451.FEV
TYPE OF SAMPLE: CST WATER DILUTE
SAMPLE QUANTITY: 521.0000 UNITS: gram
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAP500.EFF

* ACQUIRE DATE: 24-FEB-94 22:55:07 * FWHM(1332) 1.886

ACQUIRE TIME(LIVE): 3600. SEC * SENSITIVITY: 1.000

ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 %

ELAPSED LIVE TIME: 3600. SEC * NGR ITERATIONS: 10

* DETECTOR: ORTEC * LIBRARY: MASTER.DAT

DATE: 23-FEB-94 07:06:01 * ENERGY TOLERANCE: 1.500 KEV

KEV/CHAN: 4607016 * HALF LIFE RATE: 8.00

OFFSET: 32.0E2500 * ABUNDANCE LIMIT: 70.00%

*

ENERGY WINDOW: 40.29 TO 285.3 E5

PK TT ENERGY AREA BKGND FWHM CHANNEL LEFT PW CTS/SEC SERR FIT

1	O	75.28	58.	170	.72	75.48	72	9	1.62E-02	42.6
2	O	92.35	53.	89.	1.06	111.82	108	7	1.47E-02	34.6
3	O	511.28	259.	68.	3.05	1003.75	993	21	7.19E-02	12.3
4	O	609.20	75.	29.	1.25	1212.22	1208	9	2.08E-02	19.4
5	O	845.15	22.	38.	.84	1714.55	1708	12	6.03E-03	68.7
6	O	1460.96	231.	0.	1.81	3025.61	3017	20	6.42E-02	7.9
7	O	1592.43	11.	6.	.74	3305.51	3299	11	2.97E-03	64.4
8	O	1764.53	55.	12.	2.37	3671.92	3665	16	1.52E-02	19.6
9	O	2614.60	54.	0.	2.85	5481.72	5471	20	1.50E-02	13.6

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	TT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR
1	O	75.28	58.	170	.72	75.48	72	9	1.62E-02	42.6
2	O	92.35	53.	89.	1.06	111.82	108	7	1.47E-02	34.6
3	O	511.28	259.	68.	3.05	1003.75	993	21	7.19E-02	12.3
4	O	609.20	75.	29.	1.25	1212.22	1208	9	2.08E-02	19.4
5	O	845.15	22.	38.	.84	1714.55	1708	12	6.03E-03	68.7
6	O	1460.96	231.	0.	1.81	3025.61	3017	20	6.42E-02	7.9
7	O	1592.43	11.	6.	.74	3305.51	3299	11	2.97E-03	64.4
8	O	1764.53	55.	12.	2.37	3671.92	3665	16	1.52E-02	19.6
9	O	2614.60	54.	0.	2.85	5481.72	5471	20	1.50E-02	13.6

PILE-UP CORRECTION COMPLETED.

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

Fission Gas

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA
KR-87	FG	402.58	0.	0.	49.50*	0.000E+00	.000E 0	.000E 0
		845.43	22.	38.	7.30	2.035E+00	3.430E -7	2.355E -7
		2554.80	0.	0.	9.30	0.000E+00	.000E 0	.000E 0
Xe-135	FG	249.70	0.	0.	89.90*	0.000E+00	.000E 0	.000E 0
		608.18	75.	29.	2.89	2.568E+00	1.543E -6	2.296E -7

Activation Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA
Al-51	AP	511.00	232.	68	26.73*	2.12E+00	1.347E -7	2.273E -8

Fission Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA
Kr-85	NP	173.00	0.	0.	12.60*	0.000E+00	.000E 0	.000E 0
		410.40	2	29	5.46	2.568E+00	7.457E -7	2.443E -7
		921.21	5	89	28.00*	4.359E+00	5.281E -8	2.071E -8
Kr-85	NP	532.61	0	0	13.10	0.000E+00	.000E 0	.000E 0

Natural Product

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA
K-40	NP	1460.81	231.	0	0.50*	1.32E+00	2.291E -6	1.804E -7
		176.00	0	0	1.20	0.000E+00	.000E 0	.000E 0
		311.01	0	0	7.49	0.000E+00	.000E 0	.000E 0
		311.02	0	0	19.20	0.000E+00	.000E 0	.000E 0
		311.02	0	0	37.20	0.000E+00	.000E 0	.000E 0
		609.31	75	29	46.30*	2.568E+00	9.014E -8	1.744E -8
		1120.20	0	0	15.10	0.000E+00	.000E 0	.000E 0
		1238.11	0	0	5.94	0.000E+00	.000E 0	.000E 0
		1764.49	55	12	15.80	1.185E+00	4.202E -7	3.250E -8
		2204.22	0	0	4.98	0.000E+00	.000E 0	.000E 0
Th-232	NP	238.63	0	0	44.60	0.000E+00	.000E 0	.000E 0
		338.32	0	0	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0	0	11.80	0.000E+00	.000E 0	.000E 0
		583.14	0	0	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0	0	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0	0	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	54	0	35.36*	8.882E-01	2.443E -7	3.325E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC.88)
UNKNOWN LINE REPORT PAGE 2
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

NUCLIDE SUMMARY

TOTAL LIN UNIDENTIFI IDENTIFI %EF

ACTIVATI

NUCLIDE ANIL-511

NATURAL F

NUCLIDE K-40

IDENTIFIED PEAKS

K	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR
1	0	75.28	58.	170.	.72	75.48	72	9	1.62E-02	42.6
2	0	92.35	53.	82.	1.06	111.82	108	7	1.47E-02	34.6
4	0	609.20	75.	29.	1.25	1212.22	1202	9	2.08E-02	19.4
5	0	845.15	22.	38.	.84	1714.55	1702	12	6.03E-03	68.7
7	0	1592.43	11.	6.	.74	3305.51	3299	11	2.97E-03	64.4
8	0	1764.53	55.	12.	2.37	3671.92	3665	16	1.52E-02	12.6
9	0	2614.60	54.	6.	2.85	5481.72	5471	20	1.50E-02	13.6

LINED HOT LISTING SUMMARY CRITERIA

PK	NUCL IDE	ENERGY	PERC	DECAY	UCT	/sec	ABNDIF
2	ND-147	91.21	10.98%	1.002E	0	5.981E	68.13
4	RU-103	610.33	59.35%	1.001E	0	7.457E	5.93
4	XE-136	608.18	9.11%	1.072E	0	1.548E	3.11
4	RA-228	609.31	1600.00Y	1.000E	0	9.014E	39.21
5	KK-87	845.43	76.30%	1.630E	0	3.430E	11.04
3	RA-226	1764.49	1600.00Y	1.000E	0	4.202E	79.91
2	TH-232	2614.60	1.00E+10Y	1.000E	0	2.443E	20.12

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	9
UNIDENTIFIED PEAKS	7
IDENTIFIED IN SUMMARY REPORT	2 22.22%

ACTIVATION PRODUCT

NUCLIDE	SDHR	HLIFE	DECAY	UCI /gram	1-SIGMA
ANIL-511	AP	109.70M	1.403	1.647E -7	ERROR

2.273E -8	%ERR
12.31	

NATURAL PRODUCT

NUCLIDE	SDHR	HLIFE	DECAY	UCI /gram	1-SIGMA
K-40	NP	1.28E+02Y	1.000	2.291E -6	ERROR

1.304E -7	%ERR
7.80	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

PEAK WIDTH

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	64.	477.59	1.5755E-07
NA-22	23.	1274.54	2.2528E-08
NA-24	21.	1368.53	2.3809E-08
CL-38	8.	2167.51	0.0000E+00
AR-41	18.	1223.64	2.3859E-08
SC-46	54.	1120.51	3.0905E-08
CR-5	78.	320.08	1.4586E-07
MN-54	56.	834.83	2.4735E-08
MN-55	56.	846.75	3.2497E-08
FE-55	37.	1099.22	4.4660E-08
CO-57	131.	122.06	1.4612E-08
CO-58	44.	810.76	2.1394E-08
CO-60	43.	1332.42	3.2020E-08
NI-63	14.	1481.84	1.0798E-07
CU-65	29.	1345.90	5.6858E-06
ZN-66	29.	1115.52	4.4470E-08
ZN-67	57.	438.63	1.6032E-08
AS-75	48.	559.10	3.4506E-08
SE-75	78.	264.65	2.2155E-08
BR-80	48.	554.32	2.2827E-08
BR-81	18.	681.50	1.7201E-07
KR-85	127.	513.99	5.6652E-06
KR-85M	120.	151.18	1.8908E-08
KR-87	70.	402.58	5.0369E-08
KR-87	100.	196.32	5.5924E-08
RB-88	21.	1836.01	1.1241E-06
RB-89	51.	1031.88	4.5062E-07
SR-89	127.	513.99	2.4549E-08
SR-95	94.	231.69	2.7025E-08
SR-97	38.	1024.30	7.9743E-08
SR-99	28.	1383.94	3.7316E-08
Y-88	21.	1836.01	2.8307E-08
Y-91	21.	1204.90	6.8050E-06
Y-91M	52.	555.57	1.8559E-08
Y-92	48.	934.46	2.1952E-07
Y-93	102.	266.90	2.3504E-07
ZR-95	43.	756.72	3.5435E-08
ZR-97	42.	743.36	2.1275E-08
NB-94	35.	702.63	1.6330E-08
NB-95	54.	765.79	2.2277E-08
NB-97D	42.	1024.50	2.4502E-06
MO-90	68.	257.34	1.7452E-08
MO-90	52.	739.58	1.6595E-07
TC-92MD	132.	140.51	1.4187E-08
RU-103	52.	497.08	1.7112E-08
RU-105	36.	724.50	4.0340E-08
RU-106	56.	621.84	1.8916E-07
RU-105	73.	318.90	7.3403E-08
RU-109M	46.	657.75	1.8570E-08
RU-109	110.	88.03	4.1969E-07

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
113	76.	391.69	2.3842E-08
122	67.	563.93	2.7088E-08
SB-124	48.	602.71	1.7172E-08
SB-125	51.	427.39	4.5960E-08
TE-123M	112.	158.92	1.4002E-08
TE-132	79.	228.16	1.3465E-08
T-131	85.	364.48	1.9438E-08
T-132	49.	667.69	2.4501E-08
T-133	58.	529.37	2.0109E-08
T-134	51.	847.03	5.1936E-08
T-135	29.	1260.41	9.6305E-08
TE-131M	128.	163.93	6.3256E-07
TE-133	73.	80.22	4.0312E-08
KE-133M	82.	233.22	1.2026E-07
KE-135	36.	249.79	1.5913E-08
KE-135M	59.	526.56	2.5092E-07
KE-138	85.	258.31	6.4506E-07
KS-134	53.	604.70	1.8127E-08
KS-134M	133.	127.42	1.2317E-07
KS-136	36.	818.50	1.9516E-08
KS-137	33.	661.65	2.7803E-08
KS-138	19.	1435.86	9.6359E-08
KA-133	75.	356.00	2.4363E-08
KA-139	113.	165.85	1.0938E-07
TA-140	53.	537.32	6.5154E-08
TA-141	116.	190.22	2.0298E-07
TA-140	13.	1596.49	2.1309E-08
CE-139	113.	165.35	1.4616E-08
CE-141	113.	145.44	2.5575E-08
CF-143	71.	293.26	3.2256E-08
CE-144	119.	133.34	1.1400E-07
ND-147	83.	91.11	4.5866E-08
EU-152	63.	344.27	4.9850E-08
EU-154	23.	1274.45	6.3414E-08
HF-181	63.	482.03	1.9805E-08
W-187	59.	479.53	6.9351E-08
HG-203	76.	279.19	1.7433E-08
RA-226	104.	609.31	5.3803E-08
TH-232	54.	2614.66	0.0000E+00
U-235	137.	185.72	2.4455E-08
U-238	112.	131.20	5.8107E-08
NP-239	118.	106.13	5.6275E-08
AM-241	68.	59.54	1.0776E-07

 25-FEB-94 07:28:19 *****

FERMI 2: CPH DECANTE LINE

FINAL FILE NAME: L940481.FEV

PILE DATE: 25-FEB-94 06:10:00

SAMPLE IDENTIFICATION: L940481.FEV

TYPE OF SAMPLE: LIQUID

SAMPLE QUANTITY: 458.3000 UNITS GRAMS

SAMPLE GEOMETRY: LMAR500

EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRED DATE: 25-FEB-94 06:27:42 * FWHM(1332) 1.886

PRESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000

ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 %

ELAPSED LIVE TIME: 3600. SEC * NDR ITERATIONS: 10.

*

DETECTION: ORTEC * LIBRARY:MASTER.LIE

CALIB. DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV

KEV/CHAN: .4697016 * HALF LIFE RATIO: 8.00

OFFSET: 39.8232300 KEV * ABUNDANCE LIMIT: 70.00%

*

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ERRR	FIT
1	0	92.63	42.	69.	.95	112.43	110	5	1.10E-02	34.1	
2	0	238.36	128.	137.	1.27	422.69	416	14	3.56E-02	23.1	
3	0	351.37	27.	69.	.62	663.29	662	8	7.45E-03	62.4	
4	0	510.92	221.	117.	2.54	1002.98	994	21	6.13E-02	13.9	
5	0	609.01	54.	60.	1.37	1211.80	1205	15	1.50E-02	38.7	
6	0	1173.75	54.	8.	1.76	2414.15	2408	16	1.50E-02	22.1	
7	0	1332.96	41.	5.	1.61	2753.10	2748	12	1.14E-02	20.8	
8	0	1460.72	206.	19.	1.93	3025.10	3018	14	5.73E-02	8.0	
9	0	1764.38	45.	7.	1.00	3671.60	3663	16	1.26E-02	20.2	
10	0	2203.62	23.	5.	2.64	4606.75	4601	11	6.41E-03	22.9	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 32)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000

UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	ERRR
1	0	92.63	42.	69.	.95	112.43	110	5	1.18E-02	34.1
2	0	238.36	128.	137.	1.27	422.69	416	14	3.56E-02	23.1
3	0	351.37	27.	69.	.62	663.29	662	8	7.45E-03	62.4
4	0	510.92	221.	117.	2.54	1002.98	994	21	6.13E-02	13.9
5	0	609.01	54.	60.	1.37	1211.80	1205	15	1.50E-02	38.7
6	0	1173.75	54.	8.	1.76	2414.15	2408	16	1.50E-02	22.1
7	0	1332.96	41.	5.	1.61	2753.10	2748	12	1.14E-02	20.8
8	0	1460.72	206.	19.	1.93	3025.10	3018	14	5.73E-02	8.0
9	0	1764.38	45.	7.	1.00	3671.60	3663	16	1.26E-02	20.2
10	0	2203.62	23.	5.	2.64	4606.75	4601	11	6.41E-03	22.9

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

FISSION GAS

NUCLIDE	SBHR	ENERGY	AREA	BKND	%ABN	%EFF	UCI / GRAMS	1-SIGMA ERROR
XE-135	FG	249.79	0.	0.	89.90*	0.000E+00	.000E 0	.000E 0
		608.18	54.	60.	2.89	2.188E+00	1.255E -6	4.859E -7

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKND	%ABN	%EFF	UCI / GRAMS	1-SIGMA ERROR
ANIL-511	AP	511.00	221.	117.	26.73*	2.943E+00	1.705E -7	2.577E -7
CD-60	AP	1173.22	54.	8.	100.00	1.599E+00	5.525E -8	1.219E -8
		1332.49	41.	5.	100.00*	1.457E+00	4.625E -6	2.590E -7

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKND	%ABN	%EFF	UCI / GRAMS	1-SIGMA ERROR
RU-103	FP	497.08	0.	0.	82.00*	0.000E+00	.000E 0	.000E 0
		610.33	54.	60.	5.60	2.588E+00	6.100E -7	2.363E -7

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKND	%ABN	%EFF	UCI / GRAMS	1-SIGMA ERROR
226	NP	1460.81	206.	12.	10.67*	1.362E+00	2.325E -6	1.884E -7
	NP	186.21	0.	0.	3.28	0.000E+00	.000E 0	.000E 0
		241.98	0.	0.	7.49	0.000E+00	.000E 0	.000E 0
		295.21	0.	0.	19.20	0.000E+00	.000E 0	.000E 0
		351.92	27.	69.	37.20	3.861E+00	3.056E -8	1.906E -8
		609.31	54.	60.	46.30*	2.558E+00	7.374E -8	2.856E -7
		1120.29	0.	0.	15.10	0.000E+00	.000E 0	.000E 0
		1238.11	0.	0.	5.24	0.000E+00	.000E 0	.000E 0
		1764.49	45.	7.	15.80	1.176E+00	3.255E -7	8.006E -7
		2204.22	23.	5.	4.98	1.007E+00	7.528E -7	1.727E -7
TH-232	NP	238.63	28.	137.	44.60	5.043E+00	9.316E -8	2.155E -8
		338.32	0.	0.	11.40	0.000E+00	.000E 0	.000E 0
		727.17	0.	0.	11.30	0.000E+00	.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	.000E 0	.000E 0
		969.11	0.	0.	16.60	0.000E+00	.000E 0	.000E 0
		2614.66	0.	0.	35.86*	0.000E+00	.000E 0	.000E 0

UNKNOWN LINE REPORT

ELAPSED LIVE TIME

3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

K	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	%EFF
1	O	92.63	42.	69	.95	111.43	110	5	1.18E-02	34.1	4.58E+00
2	O	238.36	128.	137	1.27	422.69	416	14	3.56E-02	23.1	5.04E+00
3	O	351.37	21.	69	.62	663.29	662	5	7.45E-03	62.4	3.86E+00
5	O	609.01	54.	60	1.37	1211.80	1205	15	1.50E-02	38.7	2.59E+00
9	O	1764.38	45.	7.	1.00	3671.0	3663	16	1.26E-02	20.2	1.19E+00
10	O	2203.62	23.	5.	2.64	4606.75	4601	11	6.41E-03	22.9	1.01E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UC1 /GRAMS	ABNDIFF	FAILED	
2	TH-232	238.63	1.00E+10Y	1.000E	0	9.316E -8	25.03%	ABN
3	RA-226	351.92	1600.00Y	1.000E	0	3.056E -3	67.15%	ABN
5	RU-103	610.33	39.35D	1.001E	0	6.100E -7	5.92%	ABN
5	XE-135	608.18	9.11H	1.062E	0	1.255E -6	3.11%	ABN
5	RA-226	609.52	1600.00Y	1.000E	0	7.374E -8	67.15%	ABN
9	RA-226	1764.49	3600.00Y	1.000E	0	3.255E -7	67.15%	ABN
10	RA-226	2204.22	1600.00Y	1.000E	0	7.528E -7	67.15%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION

DEC 88)

PAGE 3

TOTAL LINES IN SPECTRUM	10
UNIDENTIFIED PEAKS	6
IDENTIFIED IN SUMMARY REPORT	4
	40.00%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAMS	1-SIGMA	ERROR	%ERR
ANIL-511	AP	109.70M	1.344	1.705E -7	2.373E -8	13.92	
CO-60	AP	1925.00D	1.000	4.625E -8	9.598E -9	20.75	

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFF	DECAY	UCI /GRAMS	1-SIGMA	ERROR	%ERR
K-40	NP	1.28E+09Y	1.000	2.325E -6	1.864E -7	3.02	

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

LIDE	BKG	ENERGY	MINIMUM UC1 /GRAMS
BE-7	61.	477.59	1.7465E-07
NA-22	19.	1274.54	2.3251E-08
NA-24	28.	1368.53	3.1041E-08
CL-38	6.	2167.51	0.0000E+00
AR-41	30.	1293.64	4.0369E-08
SC-46	52.	1120.51	3.4438E-08
CR-51	68.	320.08	1.5464E-07
MN-54	47.	834.83	2.5732E-08
MN-56	50.	346.75	3.3730E-08
FE-59	34.	1099.22	4.8612E-08
CO-57	136.	122.06	1.6942E-08
CO-58	47.	810.76	2.5107E-08
NI-65	15.	1481.84	1.2268E-07
CU-64	18.	1345.90	5.0526E-08
ZN-65	36.	1115.52	5.6263E-08
ZN-69M	72.	438.63	2.0334E-08
AS-76	57.	559.10	4.5028E-08
SE-75	87.	264.65	2.6570E-08
CR-82	51.	554.32	2.6655E-08
BR-84	32.	881.50	1.5146E-07
KR-85	128.	313.92	6.4585E-08
KR-85M	104.	151.18	1.9610E-08
KR-87	85.	402.58	5.8225E-08
88	103.	196.32	6.2536E-08
88	14.	1836.01	7.3078E-07
Rb-89	49.	1031.88	4.6122E-07
SR-85	128.	513.99	2.7986E-08
SR-85M	101.	231.69	2.9483E-08
SR-91	21.	1024.30	6.6712E-08
SR-92	28.	1363.94	4.1056E-08
Y-88	14.	1836.01	2.6245E-08
Y-91	30.	1204.70	9.2356E-08
Y-91MD	57.	555.57	2.1867E-08
Y-92	44.	934.40	2.3296E-07
Y-93	73.	266.90	2.2389E-07
ZR-95	47.	756.72	4.2067E-08
ZR-97	36.	143.36	2.2254E-08
NB-94	50.	702.62	2.2164E-08
NB-95	48.	765.79	2.3848E-08
NB-97D	21.	1024.30	1.9575E-08
MO-90	67.	257.54	1.9377E-08
MO-99	30.	739.58	1.4295E-07
TC-99MD	114.	140.51	1.4953E-08
RU-103	66.	497.03	2.1890E-08
RU-105	47.	724.50	5.1342E-08
RU-106	37.	621.34	1.7460E-07
RH-105	65.	318.90	7.3464E-08
-110M	44.	657.75	2.0624E-08
109	81.	88.03	4.0896E-07
113	59.	391.69	2.3854E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 1.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /GRAMS
L-22	51.	563.93	2.6802E-03
I-24	51.	602.71	2.0099E-03
SB-125	63.	427.89	5.8006E-03
TE-123M	108.	158.99	1.5613E-03
TE-132	94.	228.16	1.6660E-03
I-131	71.	364.48	2.0164E-03
I-132	48.	667.69	2.6530E-03
I-133	43.	529.87	1.9581E-03
I-134	45.	847.03	5.0241E-03
I-135	12.	1260.41	6.9442E-03
XE-131M	121.	163.93	7.0591E-03
XE-133	71.	80.99	4.5675E-03
XE-133M	101.	233.22	1.5131E-03
XE-135	81.	249.79	1.7373E-03
XE-135M	46.	526.56	1.8003E-03
XE-138	71.	258.31	4.6529E-03
CS-134	44.	604.70	1.8756E-03
CS-134M	89.	127.42	1.1109E-03
CS-136	42.	818.50	2.3731E-03
CS-137	74.	661.65	2.9812E-03
CS-138	15.	1435.86	8.2878E-03
BA-137	85.	356.00	2.9452E-03
BA-139	114.	165.85	1.1727E-03
BA-140	50.	537.32	7.1842E-03
I-141	72.	190.22	1.3706E-03
I-140	12.	1596.49	2.3199E-03
Li-137	114.	165.85	1.6670E-03
CE-141	129.	145.44	3.0362E-03
CE-143	57.	293.26	3.2735E-03
CF-144	96.	133.54	1.1628E-03
ND-147	75.	91.11	4.9425E-03
FU-152	66.	344.27	5.7241E-03
EU-154	19.	1274.45	6.5451E-03
HF-181	38.	482.03	1.7465E-03
W-187	49.	472.57	7.1512E-03
HG-203	81.	279.19	2.0436E-03
RA-226	91.	609.31	5.7151E-03
TH-232	59.	2614.66	0.0000E+00
U-235	148.	185.72	2.8864E-03
U-236	112.	131.20	6.5984E-03
NP-239	118.	106.15	6.3807E-03
AM-241	74.	59.54	1.2765E-03

25-FEB-94 07:30:01

RMI 2: CPH DECANT LINE

SPECTRAL FILE NAME: L946481.FEV
SAMPLE DATE: 25-FEB-94 06:10:00
SAMPLE IDENTIFICATION: L946481.FEV
TYPE OF SAMPLE: LIQUID
SAMPLE QUANTITY: 458.0000 UNITS: GRAMS
SAMPLE GEOMETRY: LMAR500
EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 25-FEB-94 06:27:42 * FWHM(1332) 1.886
PRESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000
ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER : 5.0 %
ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

DETECTOR: ORTEC * LIBRARY:MASTER.LIB
CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV
KEV/CHNL: 4697016 * HALF LIFE RATIO: 8.00
OFFSET: 39.8232300 KEV * ABUNDANCE LIMITS: 70.00%

ENERGY WINDOW 40.29 TO 2856.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	22.63	42.	60	.95	112.43	110	5	1.18E-02	34.1	
2	0	235.36	125	157	1.27	422.69	416	14	3.56E-02	23.1	
3	0	241.37	27	19	.62	663.29	662	3	7.45E-03	62.4	
4	0	510.92	22	112	2.54	1002.98	994	21	6.13E-02	13.9	
5	0	609.01	54	0	1.37	1211.80	1205	15	1.50E-02	38.7	
6	0	1173.75	54	6	1.76	2414.15	2408	16	1.50E-02	22.1	
7	0	1532.96	41	5	1.61	2753.10	2743	12	1.14E-02	20.8	
8	0	1460.72	206	19	1.97	3025.10	3018	14	5.73E-02	8.0	
9	0	1764.38	45	7	1.00	3671.60	3663	16	1.26E-02	20.2	
10	0	2203.62	27	6	2.64	4606.75	4601	14	6.41E-03	22.9	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOW 391)

PEAK DATA CORRECTION FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

40 0 2203.62 23. 5. 2.64 4606.75 4601 11 6.41E-03 22.9

UNIDENTIFIED PEAKS

	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	%EFF
1	O	92.63	11.	69.	.95	112.43	110	5	3.10E-03	****	4.58E+00
2	O	238.36	61.	137.	1.27	422.69	416	14	1.62E-02	62.2	5.04E+00
3	O	351.37	27.	69.	.62	663.29	662	8	7.45E-03	62.4	3.86E+00
5	O	609.01	12.	60.	1.37	1211.80	1205	15	3.35E-03	****	2.59E+00
6	O	1173.75	54.	8.	1.76	2414.15	2408	16	1.50E-02	22.1	1.60E+00
10	O	2203.62	23.	5.	2.64	4606.75	4601	11	6.41E-03	22.2	1.01E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI	/GRAMS	ABND/PP	FAILED
2	TH-232	238.63	1.00E+10Y	1.000E	0	4.420E -8	25.03%	ABN
3	RA-226	351.92	1600.00Y	1.000E	0	3.056E -8	56.98%	ABN
5	RU-103	610.33	39.35D	1.001E	0	1.363E -7	5.92%	ABN
5	XE-135	608.18	9.11H	1.062E	0	2.803E -7	3.11%	ABN
5	RA-226	609.31	1600.00Y	1.000E	0	1.647E -8	56.98%	ABN
6	CO-60	1173.22	1925.00D	1.000E	0	5.525E -8	50.00%	ABN
10	RA-226	2204.22	1600.00Y	1.000E	0	7.528E -7	56.98%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 2

TOTAL LINES IN SPECTRUM 7
UNIDENTIFIED PEAKS 6
IDENTIFIED IN SUMMARY REPORT 1 14.29%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAMS	1-SIGMA	ERROR	SERR
ANIL-511	AP	109.70M	1.344	1.306E -8	3.176E -8	175.82	

25-FEB-94 17:36:39

FERM 2/NRC SPLIT: DECANT LINE, SAMPLE #3.

DATA FILE NAME: L940531.FEV

FILE DATE: 25-FEB-94 14:00:00

SAMPLE IDENTIFICATION: L940531.FLV

TYPE OF SAMPLE: WATER

SAMPLE MASS, g: 587.3000 UNITS: gram

SAMPLE GEOMETRY: LMAR500

EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 25-FEB-94 15:55:55 * FWHM(1332) 1.886

PRESRT TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000

ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 3

CLAPPED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

DETECTOR: ORTEC * LIBRARY:MASTER.LIB

CALIB DATE: 25-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV

KEV/DIML: .4627016 * HALF LIFE RATIO: 8.00

OFFSET: 39.8232300 KEV * ABUNDANCE LIMIT: 70.00%

ENERGY WINDOW 40.29 TO 2853.03

PK	11	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	92.49	67.	79.	1.63	112.13	109	7	1.86E-02	26.2	
2	0	232.41	61.	152.	1.39	424.92	420	11	1.70E-02	43.0	
3	0	511.43	194.	120.	2.68	1004.06	995	18	5.40E-02	16.1	
4	0	609.19	62.	63.	1.09	1212.18	1205	14	1.72E-02	32.0	
5	0	661.92	25.	37.	.95	1324.45	1321	9	7.06E-03	48.7	
6	0	1120.39	38.	35.	1.58	2300.53	2296	13	1.05E-02	34.2	
7	0	1239.87	49.	28.	1.66	2554.92	2546	18	1.35E-02	40.1	
8	0	1460.88	226.	10.	2.03	3025.44	3019	16	6.29E-02	7.9	
9	0	1764.13	64.	17.	1.67	3671.06	3662	19	1.77E-02	19.2	
10	0	2614.25	47.	5.	1.43	5480.99	5472	17	1.30E-02	17.9	

PEAK SEARCH COMPLETED (REV 15.0 - MD PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA, CORRECTION = 1.000

UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	11	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR
1	0	92.49	67.	79.	1.63	112.13	109	7	1.86E-02	26.2
2	0	232.41	61.	152.	1.39	424.92	420	11	1.70E-02	43.0
3	0	511.43	194.	120.	2.68	1004.06	995	18	5.40E-02	16.1
4	0	609.19	62.	63.	1.09	1212.18	1205	14	1.72E-02	32.0
5	0	661.92	25.	37.	.95	1324.45	1321	9	7.06E-03	48.7
6	0	1120.39	38.	35.	1.58	2300.53	2296	13	1.05E-02	34.2
7	0	1239.87	49.	28.	1.66	2554.92	2546	18	1.35E-02	40.1
8	0	1460.88	226.	10.	2.03	3025.44	3019	16	6.29E-02	7.9
9	0	1764.13	64.	17.	1.67	3671.06	3662	19	1.77E-02	19.2
10	0	2614.25	47.	5.	1.43	5480.99	5472	17	1.30E-02	17.9

PILE-UP CORRECTION COMPLETED

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
 NUCLIDE LINE ACTIVITY REPORT
 ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

ESSION GAS

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
XE-135	FG	249.79	0.	0.	89.90*	0.000E+00	0.000E 0	.000E 0
		608.18	62.	63.	2.89	2.588E+00	1.275E -6	4.084E -7

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
ANIL-511	AP	511.00	194.	120.	96.73*	2.941E+00	2.182E -7	3.320E -8
SC-46	AP	889.25	0.	0.	99.98	0.000E+00	0.000E 0	.000E 0
		1120.51	38.	35.	90.99*	1.655E+00	2.933E -8	1.002E -8

FISSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
RU-106	FP	497.08	0.	0.	89.00*	0.000E+00	0.000E 0	.000E 0
		610.33	62.	63.	5.60	2.588E+00	5.470E -7	1.755E -7
C3-137	FP	661.65	25.	37.	85.12*	2.435E+00	1.567E -8	7.652E -8
ND-147	FP	911.11	67.	79.	28.00*	4.571E+00	6.745E -8	1.765E -8
		131.02	0.	0.	13.10	0.000E+00	0.000E 0	.000E 0

URAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / gram	1-SIGMA ERROR
K-40	NP	1460.81	226.	10.	10.67*	1.362E+00	1.992E -6	1.564E -7
RA-226	NP	186.21	0.	0.	3.28	0.000E+00	0.000E 0	.000E 0
		241.98	0.	0.	7.42	0.000E+00	0.000E 0	.000E 0
		295.21	0.	0.	19.20	0.000E+00	0.000E 0	.000E 0
		351.92	0.	0.	37.20	0.000E+00	0.000E 0	.000E 0
		609.31	62.	63.	46.30*	2.588E+00	6.614E -8	2.119E -8
		1120.22	38.	35.	15.10	1.455E+00	1.941E -7	6.632E -8
		1238.11	0.	0.	5.94	0.000E+00	0.000E 0	.000E 0
		1764.49	64.	17.	15.80	1.186E+00	4.336E -7	8.320E -8
		2204.22	0.	0.	4.98	0.000E+00	0.000E 0	.000E 0
TH-232	NP	238.63	61.	152.	44.60	5.021E 00	3.479E -8	1.497E -8
		338.32	0.	0.	11.40	0.000E+00	0.000E 0	.000E 0
		727.17	0.	0.	11.80	0.000E+00	0.000E 0	.000E 0
		583.14	0.	0.	30.25	0.000E+00	0.000E 0	.000E 0
		911.07	0.	0.	27.70	0.000E+00	0.000E 0	.000E 0
		969.11	6.	0.	16.60	0.000E+00	0.000E 0	.000E 0
		2614.66	47.	5.	35.86*	0.632E -01	1.881E -7	5.339E -8

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

IT	ENERGY	AREA	SKQND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	SEFF
1	0 92.49	67.	79.	1.63	112.13	109	7	1.86E-02	26.2	4.57E+00
2	0 232.41	61.	152.	1.39	424.92	420	11	1.70E-02	43.0	5.03E+00
4	0 609.19	62.	63.	1.09	1212.18	1205	14	1.72E-02	32.0	2.59E+00
6	0 1120.52	38.	35.	1.58	2300.53	2296	12	1.05E-02	34.2	1.65E+00
7	0 1239.87	49.	28.	1.66	2554.92	2546	18	1.35E-02	40.1	1.54E+00
9	0 1764.13	64.	17.	1.57	3671.06	3662	19	1.77E-02	19.2	1.19E+00
10	0 2614.25	47.	5.	1.43	5480.99	5472	17	1.30E-02	17.2	8.68E-01

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFC	DECAY	UCI /gram	ABNDIFF	FAILED
1	ND-147	91.11	10.98D	1.006E	0 6.745E -8	68.13%	ABN
2	TH-232	238.63	1.00E+10Y	1.000E	0 3.479E -3	45.15%	ABN
4	RU-103	610.33	39.35D	1.002E	0 5.478E -7	5.92%	ABN
4	XE-135	603.18	9.11H	1.203E	0 1.275E -6	3.11%	ABN
4	RA-226	609.31	1600.00Y	1.000E	0 6.614E -6	49.71%	ABN
6	SC-46	1120.51	83.33D	1.001E	0 2.933E -3	50.00%	ABN
6	RA-226	1120.29	1600.00Y	1.000E	0 1.941E -7	49.71%	ABN
9	RA-226	1764.49	1600.00Y	1.000E	0 4.536E -3	49.71%	ABN
10	Th-232	2614.66	1.00E+10Y	1.000E	0 1.881E -7	45.15%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 86)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 3

TOTAL LINES IN SPECTRUM	10
UNIDENTIFIED PEAKS	7
IDENTIFIED IN SUMMARY REPORT	3 30.00%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA ERROR	%ERR
ANIL Si1	RP	109.70M	2.492	2.182E -7	3.520E -8	16.13

FISSION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA ERROR	%ERR
CS-137	LP	30.17Y	1.000	1.567E -8	7.632E -9	48.71

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA ERROR	%ERR
K-40	NP	1.20E+09Y	1.000	1.992E -6	1.564E -7	7.83

MINIMUM DETECTABLE ACTIVITY REPORT (ND, PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

SLIDE	BKG	ENERGY	MINIMUM UCI /gram
BE-7	59.	477.59	1.3430E-07
NA-22	26.	1274.54	2.1249E-08
NA-24	25.	1368.53	2.4714E-08
CL-38	9.	2167.51	0.0000E+00
AR-41	26.	1293.64	5.4639E-08
SC-46	70.	1120.51	3.1231E-08
CR-51	66.	320.08	1.1922E-07
MN-54	49.	834.83	2.0528E-08
MN-56	45.	846.75	3.8817E-08
FE-57	26.	1099.22	3.3244E-08
CO-57	145.	122.06	1.3668E-08
CO-58	40.	810.76	1.8106E-08
CO-60	47.	1332.49	2.9698E-08
NI-65	18.	1481.84	1.6469E-07
CU-64	24.	1345.90	4.9836E-06
ZN-65	41.	1115.52	4.6915E-06
ZN-65M	74.	439.63	1.7483E-06
AS-76	88.	559.10	4.5632E-08
SE-75	78.	264.65	1.9662E-08
BR-82	49.	554.32	2.1077E-08
BR-84	53.	881.50	1.2953E-06
KR-85	114.	513.99	4.7616E-06
KR-85M	122.	151.18	2.1375E-08
87	67.	402.58	9.9740E-08
88	112.	196.32	7.5961E-08
RE-88	20.	1836.01	HALF LIFE TOO SHORT
RB-89	33.	1031.88	HALF LIFE TOO SHORT
SR-85	114.	513.99	2.0647E-08
SR-85M	94.	231.69	6.0775E-08
SR-91	41.	1024.30	8.2058E-08
SR-92	24.	1385.94	4.5134E-08
Y-88	20.	1836.01	2.4516E-08
Y-91	30.	1204.90	7.2207E-06
Y-91MD	58.	555.57	1.9417E-08
Y-92	52.	934.46	2.7259E-07
Y-93	96.	266.90	2.2442E-07
ZR-95	53.	756.72	3.4923E-08
ZR-97	40.	743.36	1.9598E-08
NB-94	46.	702.63	1.6608E-08
NB-95	54.	765.79	1.9707E-08
NB-97D	43.	1024.30	2.3402E-06
MO-90	85.	257.34	2.0827E-08
MO-92	36.	739.58	1.2445E-07
TC-99MD	140.	140.51	1.3169E-08
RU-103	64.	497.08	1.6360E-08
RU-105	44.	724.50	5.0107E-08
RU-106	52.	621.84	1.6172E-07
105	65.	318.90	6.3295E-08
110M	50.	657.75	1.7178E-08
109	92.	88.03	3.4052E-07

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /gram
113*	62.	391.69	1.9111E-08
122	69.	563.93	2.4784E-08
SB-124	62.	602.71	1.7326E-08
SB-125	74.	427.89	4.9114E-08
TE-123M	114.	158.29	1.2536E-08
TE-132	109.	228.16	1.4220E-08
I-131	80.	364.48	1.6820E-08
I-132	48.	667.69	3.3943E-08
I-133	66.	522.87	2.0013E-08
I-134	46.	847.03	1.4477E-07
I-135	32.	1260.41	1.0513E-07
KD-131M	114.	163.93	5.3741E-07
KE-133	76.	30.99	3.7250E-08
KE-133M	105.	233.22	1.2316E-07
KE-135	104.	242.79	1.7418E-08
KE-135M	54.	526.56	HALF LIFE TOO SHORT
KE-138	88.	258.31	HALF LIFE TOO SHORT
CS-134	51.	604.70	1.5776E-08
CS-134M	145.	127.42	1.6381E-07
CS-136	62.	818.50	2.2796E-08
CS-138	22.	1435.86	6.4949E-07
BA-133	71.	356.00	2.1028E-08
BA-139	106.	165.85	2.0042E-07
BA-140	58.	537.32	6.0670E-08
**-141	116.	190.22	5.6432E-06
-140	16.	1596.49	2.1526E-08
-139	106.	165.85	1.2562E-08
-141	132.	145.44	2.4028E-08
-143	98.	293.26	3.4704E-08
-144	130.	133.54	1.0572E-07
-147	90.	71.11	4.2539E-08
SU-152	77.	344.27	4.8890E-08
SU-154	26.	1274.45	5.2813E-08
HF-181	71.	482.03	1.8671E-08
N-187	62.	479.53	6.5905E-08
HO-203	92.	279.19	1.7032E-08
RA-226	97.	609.31	4.6095E-08
TH-232	51.	2614.66	0.0000E+00
U-235	152.	185.72	2.2051E-08
J-238	124.	131.20	5.4238E-08
NP-239	103.	106.13	4.7515E-08
AM-241	67.	59.54	9.4889E-08

FERMI 2/NRC SPLIT: DECANT LINE, SAMPLE #3.

CTRAL FILE NAME: L940531.FEV

PLL DATE: 25-FEB-94 14:00:00

SAMPLE IDENTIFICATION: L940531.FEV

TYPE OF SAMPLE: WATER

SAMPLE QUANTITY: 587.3000 UNITS: gram

SAMPLE GEOMETRY: LMAR500

EFFICIENCY FILE NAME: LMAR500.EFF

*

ACQUIRE DATE: 25-FEB-94 15:55:55 * FWHM(1332) 1.380

PRESET TIME(LIVE), 3600. SEC * SENSITIVITY: 5.000

ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER : 5.0 %

ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

*

*

DETECTOR: ORTEC * LIBRARY:MASTER.LIB

CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV

KEV/CHNL: .4697016 * HALF LIFE RATIO: 8.00

OFFSET: 39.3232300 KEV * ABUNDANCE LIMIT: 70.00%

*

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
-	0	92.49	67.	79.	1.63	112.13	109	7	1.86E-02	26.2	
2	0	239.41	61.	1.22	1.39	424.92	420	11	1.70E-02	43.0	
3	0	511.43	194.	20.	2.65	1004.05	995	18	5.40E-02	16.1	
4	0	609.19	52.	63.	1.09	1212.18	1205	14	1.72E-02	32.0	
5	0	661.92	25.	37.	1.25	1324.45	1321	9	7.00E-03	48.7	
6	0	1120.39	38.	35.	1.58	2300.53	2296	13	1.05E-02	34.2	
7	0	1239.87	49.	28.	1.66	2554.92	2546	18	1.35E-02	40.1	
8	0	1460.88	226.	10.	2.03	3025.44	3019	16	6.29E-02	7.5	
9	0	1764.13	64.	17.	1.67	3671.06	3662	19	1.77E-02	19.2	
10	0	2614.25	47.	5.	1.43	5480.99	5472	17	1.30E-02	17.9	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
-	0	92.49*	36.	79.	1.63	112.13	109	7	9.95E-03	85.0	
		239.41 KEV PEAK DELETED									
		511.43 KEV PEAK DELETED									
4	0	609.19*	20.	63.	1.09	1212.18	1205	14	5.57E-03	****	
		661.92 KEV PEAK DELETED									
6	0	1120.39	38.	35.	1.58	2300.53	2296	13	1.05E-02	34.2	
7	0	1239.87	49.	28.	1.66	2554.92	2546	18	1.35E-02	40.1	
8	0	1460.88*	10.	10.	2.03	3025.44	3019	16	2.75E-03	****	

2614.25 KEV PEAK DELETED

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	SEFF
.	0	92.49	36.	79.	1.63	112.13	109	7	9.25E-03	85.0	4.57E+00
4	0	609.19	20.	63.	1.02	1212.18	1205	14	5.57E-03	***	2.50E+00
6	0	1120.39	38.	35.	1.58	2300.53	2296	13	1.05E-02	34.2	1.65E+00
7	0	1239.87	49.	28.	1.66	2554.92	2546	18	1.35E-02	40.1	1.54E+00
9	0	1764.13	17.	17.	1.67	3671.06	3662	19	4.71E-03	89.4	1.19E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI /gram	ABNDIFF	FAILED	
1	ND-147	91.11	10.98D	1.000E	0	3.602E -8	68.13%	ABN
4	RU-103	610.33	59.35D	1.002E	0	1.772E -7	5.92%	ABN
4	XE-135	608.18	9.11H	1.203E	0	4.124E -7	3.11%	ABN
4	RA-226	609.31	1600.00Y	1.000E	0	2.140E -8	49.71%	ABN
6	SC-46	1120.51	83.83D	1.001E	0	2.933E -8	50.00%	ABN
6	RA-226	1120.29	1600.00Y	1.000E	0	1.941E -7	49.71%	ABN
9	RA-226	1764.49	1600.00Y	1.000E	0	1.151E -7	49.71%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM	6
IDENTIFIED PEAKS	5
NTIFIED IN SUMMARY REPORT	1 16.67%

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /gram	1-SIGMA ERROR	SERR
K-40	NP	1.28E+09Y	1.000	8.699E -3	2.171E -7	247.57

***** 26-FEB-94 12:55:25 *****

FERMI 2 CPH DECANT LINE; POST CST DISCHARGE

CTRAL FILE NAME: L940571.FEV

PILE DATE: 26-FEB-94 12:05:00

SAMPLE IDENTIFICATION: L940571.FEV

TYPE OF SAMPLE: LIQUID

SAMPLE QUANTITY: 568.1000 UNITS: GRAM

SAMPLE GEOMETRY: LMAR500

EFFICIENCY FILE NAME: LMAR500.EFF

ACQUIRE DATE: 26-FEB-94 14:04:24 * FWHM(1232) 1.686

PRESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000

ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 %

ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

DETECTOR: ORTEC * LIBRARY:MASTER.LIB

CALIB DATE: 23-FEB-94 07:26:01 * ENERGY TOLERANCE: 1.500 KEV

KEV/CHNL: .4627016 * HALF LIFE RATIO: 8.00

OFFSET: 39.8232300 KEV * ABUNDANCE LIMIT: 70.00%

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR	FIT
1	0	74.84	43.	127.	1.02	74.55	72	7	1.19E-02	49.7	
2	0	230.90	52.	74.	.78	423.83	421	7	1.46E-02	31.7	
3	0	511.06	166.	115.	1.95	1003.27	999	13	4.60E-02	16.1	
4	0	583.15	40.	39.	1.54	1156.75	1152	11	1.11E-02	35.3	
5	0	611.76	76.	103.	4.12	1217.65	1205	28	2.11E-02	49.2	
6	0	660.45	52.	45.	.76	1321.32	1314	13	1.44E-02	33.3	
7	0	1460.72	183.	14.	1.43	3025.11	3017	13	5.09E-02	9.3	
8	0	1764.56	64.	0.	2.68	3671.98	3664	17	1.78E-02	15.6	
9	0	2614.71	51.	5.	3.01	5481.97	5471	19	1.41E-02	17.5	

PEAK SEARCH COMPLETED (REV 15.8 - ND PC VERSION NOV 89)

PULSE-PILE-UP CORRECTED DATA. CORRECTION = 1.000
UNCORR. LIVE TIME: 3600. CORRECTED LIVE TIME: 3600.

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	SERR
1	0	74.84	43.	127.	1.02	74.55	72	7	1.19E-02	49.7
2	0	230.90	52.	74.	.78	423.83	421	7	1.46E-02	31.7
3	0	511.06	166.	115.	1.95	1003.27	999	13	4.60E-02	16.1
4	0	583.15	40.	39.	1.54	1156.75	1152	11	1.11E-02	35.3
5	0	611.76	76.	103.	4.12	1217.65	1205	28	2.11E-02	49.2
6	0	660.45	52.	45.	.76	1321.32	1314	13	1.44E-02	33.3
7	0	1460.72	183.	14.	1.43	3025.11	3017	13	5.09E-02	9.3
8	0	1764.56	64.	0.	2.68	3671.98	3664	17	1.78E-02	15.6
9	0	2614.71	51.	5.	3.01	5481.97	5471	19	1.41E-02	17.5

PILE-UP CORRECTION COMPLETED

*NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
NUCLIDE LINE ACTIVITY REPORT
ELAPSED LIVE TIME: 3600. (PILE-UP CORRECTED)

PAGE 1

ACTIVATION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
ANIL-511 AP	511.00		166.	115.	26.73*	2.943E+00	1.964E -7	3.170E -8

FUSION PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
RU-103 FP	497.08		0.	0.	89.00*	0.000E+00	.000E 0	.000E 0
	610.33		76.	107.	5.60	2.580E+00	6.977E -7	3.434E -7
CS-137 FP	661.65		52.	45.	85.12*	2.439E+00	3.302E -8	1.098E -8

NATURAL PRODUCT

NUCLIDE	SBHR	ENERGY	AREA	BKGND	%ABN	%EFF	UCI / GRAM	1-SIGMA ERROR
K-40 NP	1460.81		187.	14.	10.67*	1.362E+00	1.666E -6	1.554E -7
RA-226 NP	186.21		0.	0.	3.28	0.000E+00	.000E 0	.000E 0
	241.73		0.	0.	7.49	0.000E+00	.000E 0	.000E 0
	295.21		0.	0.	19.20	0.000E+00	.000E 0	.000E 0
	351.92		0.	0.	57.20	0.000E+00	.000E 0	.000E 0
	609.31		0.	0.	46.30*	0.000E+00	.000E 0	.000E 0
	1120.12		0.	0.	15.10	0.000E+00	.000E 0	.000E 0
	1238.11		0.	0.	5.94	0.000E+00	.000E 0	.000E 0
	1764.42		64.	0.	15.80	1.185E+00	4.515E -7	7.066E -8
	2204.22		0.	0.	4.98	0.000E+00	.000E 0	.000E 0
U-232 NP	238.63		52.	74.	44.60	5.035E+00	3.083E -8	9.777E -9
	338.32		0.	0.	11.40	0.000E+00	.000E 0	.000E 0
	727.17		0.	0.	11.80	0.000E+00	.000E 0	.000E 0
	503.14		40.	39.	30.25	2.672E+00	6.544E -8	2.312E -8
	211.07		0.	0.	27.70	0.000E+00	.000E 0	.000E 0
	969.11		0.	0.	16.60	0.000E+00	.000E 0	.000E 0
	2614.66		0.	5.	35.86*	8.881E-01	2.107E -7	3.477E -8

*NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
UNKNOWN LINE REPORT
ELAPSED LIVE TIME 3600. (PILE-UP CORRECTED)

PAGE 2

IDENTIFIED PEAKS

K	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	C13/SEC	%ERR	%EFF
1	O	74.84	43.	127.	1.02	74.55	72	7	1.19E-02	49.7	2.94E+00
2	O	238.90	52.	74.	.78	423.83	421	7	1.46E-02	31.7	5.04E+00
4	O	583.15	40.	39.	1.54	1156.75	1152	11	1.11E-02	35.3	2.67E+00
5	O	611.76	76.	103.	4.12	1217.65	1205	28	2.11E-02	49.2	2.58E+00
6	O	1764.56	64.	0.	2.68	3671.98	3664	17	1.78E-02	15.6	1.19E+00
7	O	2614.71	51.	5.	3.01	5481.97	5471	19	1.41E-02	17.5	8.88E-01

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI /GRAM	ABNDIFF	FAILED	
2	TH-232	238.63	1.00E+10Y	1.000E	0	3.083E -8	62.12%	ABN
4	TH-232	583.14	1.00E+10Y	1.000E	0	6.544E -8	62.12%	ABN
5	RU-103	610.33	39.35D	1.002E	0	6.977E -7	5.92%	ABN
8	RA-226	1764.49	1600.00Y	1.000E	0	4.515E -7	10.17%	ABN
9	TH-232	2614.66	1.00E+10Y	1.000E	0	2.107E -7	62.12%	ABN

NUCLIDE IDENTIFICATION SYSTEM (ND PC VERSION DEC 88)
SUMMARY OF NUCLIDE ACTIVITY

PAGE 3

TOTAL LINES IN SPECTRUM 9
UNIDENTIFIED PEAKS 6
IDENTIFIED IN SUMMARY REPORT 3 33.33%

ACTIVATION PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAM	1-SIGMA ERROR	%ERR
ANIL-511	AP	109.70M	2.555	1.964E -7	3.170E -8	16.14

Fission Product

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAM	1-SIGMA ERROR	%ERR
CS-137	FP	30.17Y	1.000	3.302E -8	1.098E -8	33.27

NATURAL PRODUCT

NUCLIDE	SBHR	HLIFE	DECAY	UCI /GRAM	1-SIGMA ERROR	%ERR
K-40	NP	1.23E+09Y	1.000	1.666E -6	1.554E -7	9.33

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

LIDE	BKG	ENERGY	MINIMUM UCI /GRAM
BE-7	60.	477.57	1.4001E-07
NA-22	23.	1274.54	2.0661E-08
NA-24	16.	1368.53	2.0494E-08
CL-38	11.	2167.51	0.0000E+00
AR-41	20.	1293.64	5.0644E-08
SC-46	51.	1120.51	2.7559E-08
CR-51	72.	320.08	1.2873E-07
MN-54	29.	834.83	1.6326E-08
MN-56	39.	846.75	3.7945E-08
FE-59	27.	1099.22	3.5023E-08
CO-57	115.	122.06	1.2584E-08
CO-58	34.	810.76	1.7250E-08
CO-60	44.	1332.49	2.9705E-08
NI-65	16.	1481.84	1.6310E-07
CU-64	15.	1345.20	4.0860E-06
ZN-65	23.	1115.52	3.6326E-08
ZN-67M	63	438.63	1.6731E-08
AS-76	51.	559.10	3.5968E-08
SC-75	87.	264.65	2.1467E-08
UR-82	55.	554.32	2.3112E-08
UR-84	35	881.51	1.1740E-06
UR-85	115.	513.99	4.9440E-06
KR-85M	108.	151.18	2.0978E-08
87	65.	402.58	1.0483E-07
88	87.	196.82	7.0199E-08
RE-88	20.	1836.01	HALF LIFE TOO SHORT
RB-89	39.	1031.88	HALF LIFE TOO SHORT
SR-85	115.	513.99	2.1439E-08
SR-85M	105	231.57	6.8816E-08
SR-91	29.	1024.70	7.1648E-08
SR-92	16.	1383.94	3.8667E-08
Y-88	20.	1836.01	2.5347E-08
Y-91	28.	1204.90	7.217E-06
Y-91MD	52.	555.57	1.9088E-08
Y-92	45.	934.46	2.6515E-07
Y-93	103.	266.90	2.4128E-07
ZR-95	33.	756.72	2.8489E-08
ZR-97	33.	743.36	1.8446E-08
IR-94	48.	702.63	1.7538E-08
ND-95	39.	765.72	1.7385E-08
NB-97D	30.	1024.50	2.0255E-06
MO-90	89.	257.34	2.2189E-08
MO-99	32.	739.50	1.2137E-07
TC-99MD	127.	140.51	1.2975E-08
RU-103	51.	497.08	1.5560E-08
RU-105	41.	724.50	5.0458E-08
RU-106	43.	621.84	1.5203E-07
-105	70.	318.90	6.7982E-08
110M	43.	657.75	1.6469E-08
-109	81.	88.03	3.3031E-07

PEAK WIDTH 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UC1 /GRAM
113	55.	391.69	1.3608E-08
122	42.	563.93	2.0002E-08
SB-124	50.	602.71	1.6085E-08
SB-125	51.	427.89	4.2151E-08
TE-123M	85.	158.99	1.1191E-08
TE-132	106.	228.16	1.4504E-08
I-131	65.	364.48	1.5677E-08
I-132	42.	667.69	3.3403E-08
I-133	52.	529.87	1.8400E-08
I-134	36.	847.03	1.3862E-07
I-135	21.	1260.41	8.3621E-08
XE-131M	89.	163.93	4.9096E-07
XE-133	66.	80.99	3.5898E-08
XE-133M	103.	233.22	1.2620E-07
XE-135	105.	249.79	1.8173E-08
XE-135M	51.	526.56	HALF LIFE TOO SHORT
XE-136	78.	258.31	HALF LIFE TOO SHORT
CS-134	45.	604.70	1.5319E-08
CS-134M	122.	127.42	1.5751E+07
CS-136	34.	818.50	1.7454E-08
CS-138	14.	435.86	5.7733E-07
BA-132	64.	356.00	2.0640E-08
BA-139	106.	165.85	2.11350E-07
BA-140	47.	537.32	5.6468E-08
141	79.	120.22	HALF LIFE TOO SHORT
140	8.	1596.49	1.5751E-08
CE-139	106.	165.85	1.2986E-08
CE-141	103.	145.44	2.1943E-08
CE-143	69.	293.26	3.0141E-08
CE-144	124	133.54	1.0674E-07
ND-147	31.	21.11	4.1726E-08
EU-152	58.	344.27	4.3366E-08
EU-154	26.	1274.45	5.8158E-08
HF-181	55.	482.07	1.6989E-08
W-187	47.	479.33	5.9421E-08
HG-203	68.	279.19	1.5138E-08
RA-226	79.	607.51	4.3005E-08
TH-232	55.	2614.66	0.0000E+00
U-235	12.	135.72	2.0902E-08
U-238	140.	131.20	5.9579E-08
NP-239	106.	106.13	4.9867E-08
AM-241	71.	59.54	1.0098E-07

26-FEB-94 19:58:17

RPT BKG

TMI 2 CPH DECANT LINE; POST CST DISCHARGE

SPECTRAL FILE NAME: L940571.FEV

SAMPLE DATE: 26-FEB-94 12:05:00

SAMPLE IDENTIFICATION: L940571.FEV

TYPE OF SAMPLE: LIQUID

SAMPLE QUANTITY: 568.1000 UNITS: GRAM

SAMPLE GEOMETRY: LMAR500

EFFICIENCY FILE NAME: LMAR500.EFF

*

ACQUIRE DATE: 26-FEB-94 14:04:24 * FWHM(1332) 1.886

PRESET TIME(LIVE): 3600. SEC * SENSITIVITY: 5.000

ELAPSED REAL TIME: 3600. SEC * SHAPE PARAMETER: 5.0 %

ELAPSED LIVE TIME: 3600. SEC * NBR ITERATIONS: 10.

*

DETECTOR: ORTEC

* LIBRARY:MASTER.LIB

CALIB DATE: 23-FEB-94 07:26:01

* ENERGY TOLERANCE: 1.500 KEV

KEV/CHNL: .4697016

* HALF LIFE RATIO: 8.00

OFFSET: 39.8232300 KEV

* ABUNDANCE LIMIT: 70.002

*

ENERGY WINDOW 40.29 TO 2858.03

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
1	0	74.84	43.	127.	1.02	74.55	72	7	1.19E-02	49.7	
2	0	238.90	52.	74.	.78	423.83	421	7	1.46E-02	31.7	
3	0	511.06	166.	115.	1.95	1003.27	999	13	4.60E-02	16.1	
4	0	583.15	40.	39.	1.54	1156.75	1152	11	1.11E-02	35.3	
5	0	611.76	76.	103.	4.12	1217.65	1215	28	2.11E-02	49.2	
6	0	660.45	52.	45.	.76	1321.32	1314	13	1.44E-02	33.3	
7	0	1460.72	163.	14.	1.43	3025.11	3017	13	5.09E-02	9.3	
8	0	1764.56	64.	0	2.68	3671.98	3664	17	1.78E-02	15.6	
9	0	2614.71	51.	5.	3.01	5481.97	5471	19	1.41E-02	17.	

PEAK SEARCH COMPLETED (REV 15.8 - NO PC VERSION NOV 89)

PEAK DATA CORRECTED FOR ENVIRONMENTAL BACKGROUND

* AFTER ENERGY INDICATES CORRECTED PEAK

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	FIT
0	74.84	43.	127.	1.02	74.55	72	7	1.19E-02	49.7		
	238.90 KEV PEAK DELETED					*					
	511.06 KEV PEAK DELETED										
4	0	583.15	40.	39.	1.54	1156.75	1152	11	1.11E-02	35.3	
5	0	611.76	76.	103.	4.12	1217.65	1205	28	2.11E-02	49.2	
	660.45 KEV PEAK DELETED					*					
	1460.72 KEV PEAK DELETED										
8	0	1764.56*	17.	0	2.68	3671.98	3664	17	4.84E-03	77.3	
	2614.71 KEV PEAK DELETED					*					

UNIDENTIFIED PEAKS

PK	IT	ENERGY	AREA	BKGND	FWHM	CHANNEL	LEFT	PW	CTS/SEC	%ERR	%CFF
1	O	74.84	43.	127.	1.02	74.55	72	7	1.12E-02	49.7	2.94E+00
4	O	583.15	40.	39.	1.54	1156.75	1152	11	1.11E-02	35.3	2.67E+00
5	O	611.76	76.	103.	4.12	1217.65	1205	28	2.11E-02	49.2	2.58E+00
8	O	1764.56	17.	0.	2.68	3671.98	3664	17	4.84E-03	77.3	1.19E+00

LINES NOT MEETING SUMMARY CRITERIA

PK	NUCLIDE	ENERGY	HLFE	DECAY	UCI	/GRAM	ABNDLFF	FAILED
4	TH-232	583.14	1.00E+10Y	1.000E	O	6.544E -8	16.97%	ABN
5	RU-103	610.33	39.35D	1.002E	O	6.977E -7	5.92%	ABN
8	RF-226	1764.49	1600.00Y	1.000E	O	1.229E -7	10.17%	ABN

NUCLIDE IDENTIFICATION SYSTEM
SUMMARY OF NUCLIDE ACTIVITY

(ND PC VERSION DEC 88)

PAGE 2

TOTAL LINES IN SPECTRUM	4
UNIDENTIFIED PEAKS	4
IDENTIFIED IN SUMMARY REPORT	0
	00%

MINIMUM DETECTABLE ACTIVITY REPORT (ND PC VERSION SEP 89)

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

LIDE	BKG	ENERGY	MINIMUM UCI /GRAM
Ge-7	60.	477.59	1.4001E-07
ANTL-511	246.	511.00	8.2272E-08
Na-22	23.	1274.54	2.0661E-08
Na-24	16.	1368.53	2.0494E-08
Cl-38	11.	2167.51	0.0000E+00
Ar-41	20.	1293.64	5.0644E-08
K-40	202.	1460.81	6.3693E-07
Sc-46	51.	1120.51	2.7559E-08
Cr-51	72.	720.08	1.2873E-07
Mn-54	29.	834.83	1.6326E-08
Mn-56	39.	846.75	3.7945E-08
Fe-59	27.	1099.22	3.5023E-08
Co-57	115.	122.06	1.2584E-08
Co-58	34.	310.76	1.7258E-08
Co-60	44.	1332.49	2.9705E-08
Ni-65	16.	1481.84	1.6310E-07
Cu-64	15.	1345.90	1.0860E-06
Zn-65	23.	1115.52	3.6326E-08
Zn-69M	63.	438.63	1.6731E-08
Tl-76	51.	559.10	3.5968E-08
Tl-75	67.	264.65	2.1467E-08
Tl-62	55.	554.32	2.3112E-08
Tl-84	35.	831.50	1.1740E-06
Tl-85	115.	513.99	1.9440E-06
Tl-85M	108.	151.18	1.0978E-08
KR-87	65.	402.58	1.0483E-07
KR-88	87.	196.32	1.0199E-08
RR-88	20.	1836.01	HALF LIFE TOO SHORT
Y-89	39.	1031.88	HALF LIFE TOO SHORT
Li-85	115.	513.99	2.1439E-08
Cr-85M	105.	231.69	6.3816E-08
Sr-71	29.	1024.30	7.1648E-08
Sr-92	16.	1383.94	3.8667E-08
Tl-88	20.	1836.01	2.5345E-08
Y-91	28.	1204.90	7.2118E-06
Y-91MD	52.	555.57	1.9088E-08
Y-92	45.	934.46	2.6515E-07
Y-93	103.	266.90	2.4128E-07
Cr-95	33.	756.72	2.3489E-08
Zr-97	33.	743.36	1.8446E-08
Nb-94	48.	702.63	1.7538E-08
Nb-95	39.	765.79	1.7385E-08
Ng-97D	30.	1024.50	2.0255E-06
Mn-90	89.	257.34	2.2189E-08
Mn-99	32.	739.58	1.2137E-07
Tc-99MD	127.	140.51	1.2975E-08
Ru-103	51.	497.08	1.5560E-08
105	41.	724.50	5.0458E-08
106	43.	621.84	1.5203E-07
105	70.	318.90	6.7982E-08

PEAK WIDTH = 3.00 FWHM. CONFIDENCE LEVEL = 4.66.

NUCLIDE	BKG	ENERGY	MINIMUM UCI /GRAM
110M	43.	657.75	1.6469E-03
109	81.	88.03	3.3031E-07
SN-113	55.	391.69	1.8608E-03
SB-122	42.	563.93	2.0002E-08
SB-124	50.	602.71	1.6085E-08
SB-125	51.	427.89	4.2151E-08
TE-123M	85.	158.99	1.1191E-08
TE-132	106.	228.16	1.4504E-08
I-131	65.	364.48	1.5677E-08
I-132	42.	667.69	3.3403E-08
I-133	52.	529.87	1.8400E-08
I-134	36.	847.03	1.3862E-07
I-135	21.	1260.41	8.8621E-08
XE-131M	89.	163.93	4.9096E-07
XE-133	66.	80.99	3.5898E-08
XE-133M	103.	233.22	1.2620E-07
XE-135	105.	249.79	1.8173E-08
XE-135M	51.	526.56	HALF LIFE TOO SHORT
XE-138	78.	258.31	HALF LIFE TOO SHORT
CS-134	45.	604.70	1.5319E-08
CS-134M	122.	127.42	1.5751E-07
CS-136	34.	818.50	1.7454E-08
CS-137	76.	661.65	2.4399E-08
CS-138	14.	1435.86	5.7733E-07
I-133	64.	356.00	2.0640E-08
I-139	106.	165.85	2.1330E-07
DH-140	47.	537.32	5.6468E-08
BA-141	99.	190.22	HALF LIFE TOO SHORT
LA-140	8.	1596.49	1.5751E-08
CE-139	106.	165.85	1.2986E-08
CE-141	103.	145.44	2.1943E-08
CE-143	69.	293.26	3.0141E-08
CE-144	124.	133.54	1.0674E-07
ND-147	81.	91.11	4.1726E-08
EU-152	58.	344.27	4.3866E-08
EU-154	23.	1274.45	5.8158E-08
HF-181	55.	482.03	1.6989E-08
W-187	47.	479.53	5.9421E-08
HC-203	68.	279.19	1.5138E-08
RA-226	79.	609.31	4.3005E-08
TH-232	55.	2614.66	0.0000E+00
U-235	119.	185.72	2.0902E-08
U-238	140.	131.20	5.2579E-08
NP-239	106.	106.13	4.9867E-08
AM-241	71.	59.54	1.0098E-07

CST Batch #1 Total Activity Removed							
Vol discharged		480528	gals				
		1.82E+09	mls				
Activity start of Batch #1		Activity end of Batch #1		uCl discharged release #1		Total uCl removed	
Isotope	Conc	total ucl	Conc	total ucl			
Co-60	1.62E-06	2948.4	5.06E-07	921	920.92	Co-60	2027.48
Cs-134	2.41E-05	43862	1.64E-07	298	298.48	Cs-134	43563.52
Cs-137	2.12E-05	38584	1.11E-07	202	202.02	Cs-137	38381.98
		Liver		total body			
Estimated dose untreated			2.66		2		
Estimated dose treated			1.73E-02		1.32E-02		
CST Batch #2 Total Activity Removed							
Vol discharged		522850	gals				
		1.98E+09	mls				
Activity start of Batch #2		Activity end of Batch #2		uCl discharged		Total uCl removed	
Isotope	Conc	total ucl	Conc				
Co-60	7.65E-06	15147	8.11E-07	1606	1605.78	Co-60	13541.22
Cs-134	5.63E-05	111474	2.73E-07	541	540.54	Cs-134	110933.5
Cs-137	4.87E-05	96426	2.27E-07	449	449.46	Cs-137	95976.54
		Liver		total body			
Estimated dose untreated			6.71		5.07		
Estimated dose treated			3.16E-02		2.39E-02		
CST Batch #3 Total Activity Removed							
Vol discharged		558360	gals				
		2.21E+09	mls				
Activity start of Batch #3		Activity end of Batch #3		uCl discharged		Total uCl removed	
Isotope	Conc	total ucl	Conc				
Co-60	2.34E-06	4937.4	5.28E-07		1114.08	Co-60	3823.32
Cs-134	2.01E-05	42411	2.62E-07		552.82	Cs-134	41858.18
Cs-137	1.75E-05	36925	2.12E-07		447.32	Cs-137	36477.68
		Liver		total body			
Estimated dose untreated			2.59		1.96		
Estimated dose treated			3.61E-02		2.72E-02		
Dose evaluation summation		Liver	Total body	Total uCl/ discharged		Total uCl removed from 3 tanks	
Untreated water dose			11.96	9.03	3640.78	Co-60	19392.02
Treated water dose			8.50E-02	6.43E-02	1391.84	Cs-134	196355.2
Plant Technical Specification limits		mrem/yr	10	3	1098.8	Cs-137	170836.2
Total dose saved =		1.19E+01	8.97E+00				171935
Total gallons discharged		1.56E+06					
Total mls discharged		5.91E+09					

Guidelines for Evaluating Sampling and Monitoring Data For CST Release

Measurement	Expected Value and Ranges	Action Levels
Sample Gamma Spec Analysis	Expected Total Activity 1.2E-06 $\mu\text{Ci}/\text{ml}$ 1 σ upper value (67% confidence level) 1.5E-06 $\mu\text{Ci}/\text{ml}$ 2 σ upper value (95% confidence level) 1.8E-06 $\mu\text{Ci}/\text{ml}$	If the total gamma activity measured in a sample exceeds the 2 σ value (1.8E-06 $\mu\text{Ci}/\text{ml}$), contact Steve Bartman (pager# 457-1425).
radiation Monitor Response	Expected Response 310 cpm 2 σ upper value (95% confidence level) 480 cpm 2.6 σ upper value (99% confidence level) 530 cpm	If monitor response exceeds the 2.6 σ value (530 cpm), contact Steve Bartman (pager# 457-1425). If response exceeds 10 times the expected response, contact Steve Bartman (pager# 457-1425). Request Chemistry to collect sample. Upon receipt of any alarm, terminate release.
Hot Line Gamma Spec Analysis	No detectable activity is expected. Calculated activity levels are: (Co-60 @ 1E-08 $\mu\text{Ci}/\text{ml}$) (Cs-134@ 4E-09 $\mu\text{Ci}/\text{ml}$) (Cs-137@ 2E-09 $\mu\text{Ci}/\text{ml}$)	Any detectable activity, notify Steve Bartman (pager# 457-1425) and Ed Kokosky (pager# 243-1974).
Water Intake Spec Analysis	No detectable activity is expected. Calculated activity levels are: (Co-60 @ 1E-10 $\mu\text{Ci}/\text{ml}$) (Cs-134@ 4E-11 $\mu\text{Ci}/\text{ml}$) (Cs-137@ 2E-11 $\mu\text{Ci}/\text{ml}$) ~ 1 day transit time	Any detectable activity, notify Steve Bartman (pager# 457-1425) and Ed Kokosky (pager# 243-1974).

(10)

REQUIRED SAMPLE VOLUMES FOR CST SAMPLING DURING
RECIRC & PRE-DISCHARGE

SAMPLE TIME	AMOUNT OF SAMPLE REQUIRED
4-14-94 0319 6 HR. DURING RECIRC	1 LITER FOR CHEM ISOTOPIC
4-14-94 0919 12 HR. DURING RECIRC	1 LITER FOR CHEM ISOTOPIC
4-14-94 2119 *24 HR.DURING RECIRC <i>Actual 2120 EDT</i>	2.5 LITERS FOR NRC/CHEM TO SPLIT** 1 LITER (not acidified) FOR NRC 200ML(not acidified) IN GLASS BOTTLE FOR NRC H-3 REMAINDER FOR CHEM ISOTOPIC AND TRITIUM
<hr/> POST RECIRC AND PRE-DISCHARGE <hr/>	
*1st SAMPLE <i>4/15/94 0730 - 0800</i> <i>Actual 0740 EDT</i>	1.0 GALLON FOR RP/NRC SPLIT** 1 LITER (not acidified) FOR NRC 200ML(not acidified) IN GLASS BOTTLE FOR NRC H-3 1 LITER MARINELLI FOR RP TO COUNT 1 LITER BOTTLE (acidified for RP composite) 100 ML FOR CHEM-H-3 ALSO OBTAIN 2.0 LITERS FOR CHEM O/G. TSS.

2nd SAMPLE 2 HOURS AFTER 1st <i>4/15/94</i>	2 LITERS FOR RP 1 LITER MARINELLI FOR RP TO COUNT 1 LITER BOTTLE (acidified for RP composite)
--	---

* THE NRC WILL OBSERVE THE SAMPLING AND SPLITTING
WHEN THEIR SPLITS ARE DRAWN. CONTACT THEM BEFORE
DRAWING THOSE SAMPLES @ 65380,65381,&BEEPER# 457-
1208

** THE DEFINITION OF A SPLIT SAMPLE IMPLIES THAT BOTH
THE NRC AND CHEM/RP SAMPLES ARE PREPARED FROM THE
SAME SAMPLE BOTTLE.

D-10