



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

TENNESSEE VALLEY AUTHORITY

DOCKET NO. 50-296

BROWNS FERRY NUCLEAR PLANT, UNIT 3

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 70
License No. DPR-68

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Tennessee Valley Authority (the licensee) dated January 23, 1984 complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 2.C(2) of Facility Operating License No. DPR-68 is hereby amended to read as follows:


(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 70, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

8408030125 840711
PDR ADOCK 05000296
P PDR

3. This license amendment is effective as of the date of issuance.

- FOR THE NUCLEAR REGULATORY COMMISSION



Domenic B. Vassallo, Chief
Operating Reactors Branch #2
Division of Licensing

Attachment:
Changes to the Technical
Specifications

Date of Issuance: July 11, 1984

ATTACHMENT TO LICENSE AMENDMENT NO. 70

FACILITY OPERATING LICENSE NO. DPR-68

DOCKET NO. 50-296

Revise Appendix A as follows:

1. Remove the following pages and replace with the identically numbered pages.

vii	165
viii	176
9	178
12	182b
18	
19	
20	
21	
22	
23	
24	
28	
32	
36	

2. The marginal lines on each page indicate the revised area.

3. Add the following new pages:

35A
182c

4.2.E	Minimum Test and Calibration Frequency for Drywell Leak Detection Instrumentation	101
4.2.F	Minimum Test and Calibration Frequency for Surveillance Instrumentation	102
4.2.G	Surveillance Requirements for Control Room Isolation Instrumentation	103
4.2.H	Minimum Test and Calibration Frequency for Flood Protection Instrumentation	104
4.2.J	Seismic Monitoring Instrument Surveillance Requirements	105
4.6.A	Reactor Coolant System Inservice Inspection Schedule	209
3.5.I	MAPLHGR vs. Average Planar Exposure	181, 182 182a, 182b
3.7.A	Primary Containment Isolation Valves	262
3.7.B	Testable Penetrations with Double O-Ring Seals	268
3.7.C	Testable Penetrations with Testable Bellows	269
3.7.D	Primary Containment Testable Isolation Valves	
3.7.E	Suppression Chamber Influent Lines Stop-Check Globe Valve Leakage Rates	279
3.7.F	Check Valves on Suppression Chamber Influent Lines	280
3.7.G	Check Valves on Drywell Influent Lines	281
3.7.H	Testable Electrical Penetrations	283
4.8.A	Radioactive Liquid Waste Sampling and Analysis	310
4.8.B	Radioactive Gaseous Waste Sampling and Analysis	311
6.3.A	Protection Factors for Respirators	373
6.8.A	Minimum Shift Crew Requirements	390

LIST OF ILLUSTRATIONS

<u>Figure</u>	<u>Title</u>	<u>Page</u>
2.1-1	APRM Flow Reference Scram and APRM Rod Block Settings	14
2.1-2	APRM Flow Bias Scram Relationship to Normal Operating Conditions	25
4.1-1	Graphic Aid in the Selection of an Adequate Interval Between Tests	48
4.2-1	System Unavailability	117
3.4-1	Sodium Pentaborate Solution Volume Concentration Requirements	141
3.4-2	Sodium Pentaborate Solution Temperature Requirements	142
3.5.K-1	MCPR Limits	182c
3.5.2	K_{β} Factor vs. Percent Core Flow	183
3.6-1	Temperature-Pressure Limitations	207
3.6-2	Change in Charpy V Temperature vs. Neutron Exposure	208
6.1-1	TVA Office of Power Organization for Operation of Nuclear Power Plants	391
6.1-2	Functional Organization	392
6.2-1	Review and Audit Function	393
6.3-1	In-Plant Fire Program Organization	394

1.1 FUEL CLADDING INTEGRITYApplicability

Applies to the interrelated variables associated with fuel thermal behavior.

Objective

To establish limits which ensure the integrity of the fuel cladding.

Specifications

A. Thermal Power Limits

1. Reactor Pressure > 800 psia and Core Flow > 10% of Rated.

When the reactor pressure is greater than 800 psia, the existence of a minimum critical power ratio (MCPR) less than 1.07 shall constitute violation of the fuel cladding integrity safety limit.

2.1 FUEL CLADDING INTEGRITYApplicability

Applies to trip settings of the instruments and devices which are provided to prevent the reactor system safety limits from being exceeded.

Objective

To define the level of the process variables at which automatic protective action is initiated to prevent the fuel cladding integrity safety limit from being exceeded.

Specification

The limiting safety system settings shall be as specified below:

A. Neutron Flux Trip Settings

1. APRM Flux Scram Trip Setting (Run Mode) — (Flow Biased)
 - a. When the Mode Switch is in the RUN position, the APRM flux scram trip setting shall be:

$$S \leq (0.66W + 54\%)$$

where:

S = Setting in percent of rated thermal power (3293 MWt)

SAFETY LIMIT

LIMITING SAFETY SYSTEM SETTING

2. Reactor Pressure \leq 800 PSIA or Core Flow \leq 10% of Rated

When the reactor pressure is \leq 800 PSIA or core flow is \leq 10% of rated, the core thermal power shall not exceed 823 MWt (~25% of rated thermal power).

2.1 FUEL CLADDING INTEGRITY

- e. Fixed High Neutron Flux Scram Trip Setting - When the mode switch is in the RUN position, the APRM fixed high flux scram trip setting shall be:

$$S \leq 120\% \text{ power}$$

2. APRM and IRM Trip Settings (Startup and Hot Standby Modes).

- a. APRM - When the reactor mode switch is in the STARTUP position, the APRM scram shall be set at less than or equal to 15% of rated power.

- b. IRM - The IRM scram shall be set at less than or equal to 120/125 of full scale.

2.1 BASES: LIMITING SAFETY SYSTEM SETTINGS RELATED TO FUEL CLADDING INTEGRITY

The abnormal operational transients applicable to operation of the Browns Ferry Nuclear Plant have been analyzed throughout the spectrum of planned operating conditions up to the design thermal power condition of 3440 Mwt. The analyses were based upon plant operation in accordance with the operating map given in Figure 3.7-1 of the FSAR. In addition, 3293 Mwt is the licensed maximum power level of Browns Ferry Nuclear Plant, and this represents the maximum steady-state power which shall not knowingly be exceeded.

Conservatism is incorporated in the transient analyses in estimating the controlling factors, such as void reactivity coefficient, control rod scram worth, scram delay time, peaking factors, and axial power shapes. These factors are selected conservatively with respect to their effect on the applicable transient results as determined by the current analysis model. This transient model, evolved over many years, has been substantiated in operation as a conservative tool for evaluating reactor dynamic performance. Results obtained from a General Electric boiling water reactor have been compared with predictions made by the model. The comparisons and results are summarized in Reference 1.

The void reactivity coefficient and the scram worth are described in detail in reference 1.

The scram delay time and rate of rod insertion allowed by the analyses are conservatively set equal to the longest delay and slowest insertion rate acceptable by Technical Specifications as further described in Reference 1. The effect of scram worth, scram delay time and rod insertion rate, all conservatively applied, are of greatest significance in the early portion of the negative reactivity insertion. The rapid insertion of negative reactivity is assured by the time requirements for 5% and 20% insertion. By the time the rods are 60% inserted, approximately four dollars of negative reactivity has been inserted which strongly turns the transient, and accomplishes the desired effect. The times for 50% and 90% insertion are given to assure proper completion of the expected performance in the earlier portion of the transient, and to establish the ultimate fully shutdown steady-state condition.

For analyses of the thermal consequences of the transients a MCPR of *** is conservatively assumed to exist prior to initiation of the transients. This choice of using conservative values of controlling parameters and initiating transients at the design power level, produces more pessimistic answers than would result by using expected values of control parameters and analyzing at higher power levels.

*** See Section 3.5.K.

2.1 BASES

In summary

1. The licensed maximum power level is 3,293 Mwt.
2. Analyses of transients employ adequately conservative values of the controlling reactor parameters.
3. The abnormal operational transients were analyzed to a power level of 3440 Mwt.
4. The analytical procedures now used result in a more logical answer than the alternative method of assuming a higher starting power in conjunction with the expected values for the parameters.

The bases for individual set points are discussed below:

A. Neutron Flux Scram

1. APRM Flow-Biased High Flux Scram Trip Setting (Run Mode)

The average power range monitoring (APRM) system, which is calibrated using heat balance data taken during steady-state conditions, reads in percent of rated power (3293 Mwt). Because fission chambers provide the basic input signals, the APRM system responds directly to core average neutron flux.

During transients, the instantaneous fuel surface heat flux is less than the instantaneous neutron flux by an amount depending upon the duration of the transient and the fuel time constant. For this reason, the flow-biased scram APRM flux signal is passed through a filtering network with a time constant which is representative of the fuel time constant. As a result of this filtering, APRM flow-biased scram will occur only if the neutron flux signal is in excess of the setpoint and of sufficient time duration to overcome the fuel time constant and result in an average fuel surface heat flux which is equivalent to the neutron flux trip setpoint. This setpoint is variable up to 120% of rated power based on recirculation drive flow according to the equations given in section 2.1.A.1 and the graph in figure 2.1.2. For the purpose of licensing transient analysis, neutron flux scram is assumed to occur at 120% of rated power. Therefore, the flow biased provides additional margin to the thermal limits for slow transients such as loss of feedwater heating. No safety credit is taken for flow-biased scrams.

The scram trip setting must be adjusted to ensure that the LHGR transient peak is not increased for any combination of CMFLPD and FRP. The scram setting is adjusted in accordance with the formula in Specification 2.1.A.1, when the CMFLPD exceeds FRP.

Analyses of the limiting transients show that no scram adjustment is required to assure MCPR > 1.07 when the transient is initiated from MCPR > ***.

2. APRM Flux Scram Trip Setting (Refuel or Start & Hot Standby Mode)

For operation in the startup mode while the reactor is at low pressure, the APRM scram setting of 15 percent of rated power provides adequate thermal margin between the setpoint and the safety limit, 25 percent of rated. The margin is adequate to accommodate anticipated maneuvers associated with power plant startup. Effects of increasing pressure at zero or low void content are minor, cold water from sources available during startup is not much colder than that already in the system, temperature coefficients are small, and control rod patterns are constrained to be uniform by operating procedures backed up by the rod worth minimizer and the Rod Sequence Control System. Worth of individual rods is very low in a uniform rod pattern. Thus, all of possible sources of reactivity input, uniform control rod withdrawal is the most probable cause of significant power rise. Because the flux distribution associated with uniform rod withdrawals does not involve high local peaks, and because several rods must be moved to change power by a significant percentage of rated power, the rate of power rise is very slow. Generally, the heat flux is in near equilibrium with the fission rate. In an assumed uniform rod withdrawal approach to the scram level, the rate of power rise is no more than 5 percent of rated power per minute, and the APRM system would be more than adequate to assure a scram before the power could exceed the safety limit. The 15 percent APRM scram remains active until the mode switch is placed in the RUN position. This switch occurs when reactor pressure is greater than 850 psig.

3. IRM-Flux Scram Trip Setting

The IRM system consists of 8 chambers, 4 in each of the reactor protection system logic channels. The IRM is a

*** See Section 3.5.K.

5-decade instrument which covers the range of power level between that covered by the SRM and the APRM. The 5 decades are covered by the IRM by means of a range switch, and the 5 decades are broken down into 10 ranges, each being one-half of a decade in size. The IRM scram setting of 120 divisions is active in each range of the IRM. For example, if the instrument was on range 1, the scram setting would be 120 divisions for that range; likewise, if the instrument was on range 5, the scram setting would be 120 divisions on that range. Thus, as the IRM is ranged up to accommodate the increase in power level, the scram setting is also ranged up. A scram at 120 divisions on the IRM instruments remains in effect as long as the reactor is in the startup mode. The APRM 15-percent scram will prevent higher power operation without being in the run mode. The IRM scram provides protection for changes which occur both locally and over the entire core. The most significant sources of reactivity change during the power increase are due to control rod withdrawal. For insequence control rod withdrawal, the rate of change of power is slow enough, due to the physical limitation of withdrawing control rods, that heat flux is in equilibrium with the neutron flux and an IRM scram would result in a reactor shutdown well before any safety limit is exceeded. For the case of a single control rod withdrawal error, a range of rod withdrawal accidents was analyzed. This analysis included starting the accident at various power levels. The most severe case involves an initial condition in which the reactor is just subcritical and the IRM system is not yet on scale. This condition exists at quarter rod density. Quarter rod density is illustrated in paragraph 7.5.5.4 of the FSAR. Additional conservatism was taken in this analysis by assuming that the IRM channel closest to the withdrawn rod is bypassed. The results of this analysis show that the reactor is scrammed and peak power limited to one percent of rated power, thus maintaining MCPR above 1.07. Based on the above analysis, the IRM provides protection against local control rod withdrawal errors and continuous withdrawal of control rods in sequence.

4. Fixed High Neutron Flux Scram Trip

The average power range monitoring (APRM) system, which is calibrated using heat balance data taken during steady-state conditions, reads in percent of rated power (3293 MWt). The APRM system responds directly to neutron flux. Licensing analyses have demonstrated that with a neutron flux scram of 120% of rated power, none of the abnormal operational transients analyzed violate the fuel safety limit and there is a substantial margin from fuel damage.

B. APRM Control Rod Block

Reactor power level may be varied by moving control rods or by varying the recirculation flow rate. The APRM system provides a control rod block to prevent rod withdrawal beyond

a given point at constant recirculation flow rate, and thus to protect against the condition of a MCPR less than 1.07. This rod block trip setting, which is automatically varied with recirculation loop flow rate, prevents an increase in the reactor power level to excess values due to control rod withdrawal. The flow variable trip setting provides substantial margin from fuel damage, assuming a steady-state operation at the trip setting, over the entire recirculation flow range. The margin to the Safety Limit increases as the flow decreases for the specified trip setting versus flow relationship; therefore, the worst case MCPR which could occur during the steady-state operation is at 108% of rated thermal power because of the APRM rod block trip setting. The actual power distribution in the core is established by specified control rod sequences and is monitored continuously by the in-core LPRM system. As with the APRM scram trip setting, the APRM rod block trip setting is adjusted downward if the CMFLPD exceeds FRP thus preserving the APRM rod block safety margin.

C. Reactor Water Low Level Scram and Isolation
(Except Main Steamlines)

The set point for the low level scram is above the bottom of the separator skirt. This level has been used in transient analyses dealing with coolant inventory decrease. The results reported in FSAR subsection 14.5 show that scram and isolation of all process lines (except main steam) at this level adequately protects the fuel and the pressure barrier, because MCPR is greater than 1.07 in all cases, and system pressure does not reach the safety valve settings. The scram setting is approximately 31 inches below the normal operating range and is thus adequate to avoid spurious scrams.

D. Turbine Stop Valve Closure Scram

The turbine stop valve closure trip anticipates the pressure- neutron flux and heat flux increases that would result from closure of the stop valves. With a trip setting of 10% of valve closure from full open, the resultant increase in heat flux is such that adequate thermal margins are maintained even during the worst case transient that assumes the turbine bypass valves remain closed. (Reference 2).

E. Turbine Control Valve Fast Closure or Turbine Trip Scram

Turbine control valve fast closure or turbine trip scram anticipates the pressure, neutron flux, and heat flux increase that could result from control valve fast closure due to load rejection or control valve closure due to turbine trip; each without bypass valve capability. The reactor protection system initiates a scram in less than 30 milliseconds after the start of control valve fast closure due to load rejection or control valve closure due to turbine trip. This scram is achieved by rapidly reducing hydraulic control

oil pressure at the main turbine control valve actuator disc dump valves. This loss of pressure is sensed by pressure switches whose contacts form the one-out-of-two-twice logic input to the reactor protection system. This trip setting, a nominally 50% greater closure time and a different valve characteristic from that of the turbine stop valve, combine to produce transients very similar to that for the stop valve.

Relevant transient analyses are discussed in References 1 and 2. This scram is bypassed when turbine steam flow is below 30% of rated, as measured by the turbine first stage pressure.

F. Main Condenser Low Vacuum Scram

To protect the main condenser against overpressure, a loss of condenser vacuum initiates automatic closure of the turbine stop valves and turbine bypass valves. To anticipate the transient and automatic scram resulting from the closure of the turbine stop valves, low condenser vacuum initiates a scram. The low vacuum scram set point is selected to initiate a scram before the closure of the turbine stop valves is initiated.

G. & H. Main Steam Line Isolation on Low Pressure and Main Steam Line Isolation Scram

The low pressure isolation of the main steam lines at 850 psig was provided to protect against rapid reactor depressurization and the resulting rapid cooldown of the vessel. Advantage is taken of the scram feature that occurs when the main steam line isolation valves are closed, to provide for reactor shutdown so that high power operation at low reactor pressure does not occur, thus providing protection for the fuel cladding integrity safety limit. Operation of the reactor at pressures lower than 850 psig requires that the reactor mode switch be in the STARTUP

position, where protection of the fuel cladding integrity safety limit is provided by the IRM and APRM high neutron flux scrams. Thus, the combination of main steam line low pressure isolation and isolation valve closure scram assures the availability of neutron flux scram protection over the entire range of applicability of the fuel cladding integrity safety limit. In addition, the isolation valve closure scram anticipates the pressure and flux transients that occur during normal or inadvertent isolation valve closure. With the scrams set at 10 percent of valve closure, neutron flux does not increase.

I. J. & K. Reactor low water level set point for initiation of HPCI and RCIC, closing main steam isolation valves, and starting LPCI and core spray pumps

These systems maintain adequate coolant inventory and provide core cooling with the objective of preventing excessive clad temperatures. The design of these systems to adequately perform the intended function is based on the specified low level scram set point and initiation set points. Transient analyses reported in Section 14 of the FSAR demonstrate that these conditions result in adequate safety margins for both the fuel and the system pressure.

L. References

1. "BWR Transient Analysis Model Utilizing the RETRAN Program," TVA-TR81-01-A.
2. Generic Reload Fuel Application, Licensing Topical Report NEDE 24011-P-A and Addenda.

1.2 BASES

REACTOR COOLANT SYSTEM INTEGRITY

The safety limits for the reactor coolant system pressure have been selected such that they are below pressures at which it can be shown that the integrity of the system is not endangered. However, the pressure safety limits are set high enough such that no foreseeable circumstances can cause the system pressure to rise over these limits. The pressure safety limits are arbitrarily selected to be the lowest transient overpressures allowed by the applicable codes, ASME Boiler and Pressure Vessel Code, Section III, and USAS Piping Code, Section B31.1.

The design pressure (1,250 psig) of the reactor vessel is established such that, when the 10 percent allowance (125 psi) allowed by the ASME Boiler and Pressure Vessel Code Section III for pressure transients is added to the design pressure, a transient pressure limit of 1,375 psig is established.

Correspondingly, the design pressure (1,148 psig for suction and 1,326 psig for discharge) of the reactor recirculation system piping are such that, when the 20 percent allowance (230 and 265 psi) allowed by USAS Piping Code, Section B31.1 for pressure transients are added to the design pressures, transient pressure limits of 1,378 and 1,591 psig are established. Thus, the pressure safety limit applicable to power operation is established at 1,375 psig (the lowest transient overpressure allowed by the pertinent codes), ASME Boiler and Pressure Vessel Code, Section III, and USAS Piping Code, Section B31.1.

The current cycle's safety analysis concerning the most severe abnormal operational transient resulting directly in a reactor coolant system pressure increase is given in the reload licensing
submittal for the current cycle. The reactor vessel
pressure code limit of 1,375 psig given in subsection 4.2 of
the safety analysis report is well above the peak pressure
produced by the overpressure transient described above.
Thus, the pressure safety limit applicable to power operation
is well above the peak pressure that can result due to
reasonably expected overpressure transients.

Higher design pressures have been established for piping within the reactor coolant system than for the reactor vessel. These increased design pressures create a consistent design which assures that, if the pressure within the reactor vessel does not exceed 1,375 psig, the pressures within the piping cannot exceed their respective transient pressure limits due to static and pump heads.

Amendment No. 77, 28, 26, 170

TABLE 3.1.A
 REACTOR PROTECTION SYSTEM (SCRAM) INSTRUMENTATION REQUIREMENT

Min. No. of Operable Inst. Channels Per Trip System	(1) (2) Trip Function	Trip Level Setting	Modes in which Function Must Be Operable			Run	Action(1)
			Shut-down	Refuel (7)	Startup/Hot Standby		
1	Mode Switch in Shutdown		X	X	X	X	1.A
1	Manual Scram		X	X	X	X	1.A
3	IRM (16) High Flux	≤ 120/125 Indicated on scale	X(22)	X(22)	X	(5)	1.A
3	Inoperative APRM (16)(24)(25)			X	X	(5)	1.A
32	High Flux (Fixed Trip)	< 120 percent				X	1.A or 1.B
	High Flux (Flow Biased)	See Spec. 2.1.A.1				X	1.A or 1.B
	High Flux	≤ 15 percent rated power (13)		X(21)	X(17)	(15)	1.A or 1.B
	Inoperative Downscale	≥ 3 indicated on scale		X(21) (11)	X(17) (11)	X (12)	1.A or 1.B
2	High Reactor Pressure	≤ 1055 psig		X(10)	X	X	1.A
2	High Drywell Pressure (14)	≤ 2.5 psig		X(8)	X(8)	X	1.A
2	Reactor Low Water Level (14)	≥ 538" above vessel zero		X	X	X	1.A
2	High Water Level in Scram Discharge Tank	≤ 50 Gallons	X	X(2)	X	X	1.A
4	Main Steam Line Isolation Valve Closure	≤ 10% Valve Closure		X(3) (6)	X(3) (6)	X(6)	1.A or 1.C
2	Turbine Cont. Valve Fast Closure or Turbine Trip	≥ 550 psig				X(4)	1.A or 1.D

24. The Average Power Range Monitor scram function is varied (ref. Figure 2.1-1) as a function of recirculation loop flow (W). The trip setting of this function must be maintained in accordance with 2.1.A.
25. The APRM flow biased neutron flux signal is fed through a time constant circuit of approximately 6 seconds. This time constant may be lowered or equivalently removed (no time delay) without affecting the operability of the flow biased neutron flux trip channels. The APRM fixed high neutron flux signal does not incorporate the time constant but responds directly to instantaneous neutron flux.

TABLE 4.1.A
 REACTOR PROTECTION SYSTEM (SCRAM) INSTRUMENTATION FUNCTIONAL TESTS
 MINIMUM FUNCTIONAL TEST FREQUENCIES FOR SAFETY INSTR. AND CONTROL CIRCUITS

	<u>Group (2)</u>	<u>Functional Test</u>	<u>Minimum Frequency (3)</u>
Mode Switch in Shutdown	A	Place Mode Switch in Shutdown	Each Refueling Outage
Manual Scram	A	Trip Channel and Alarm	Every 3 Months
IRH			
High Flux	C	Trip Channel and Alarm (4)	Once Per Week During Refueling and Before Each Startup
Inoperative	C	Trip Channel and Alarm (4)	Once Per Week During Refueling and Before Each Startup
APRM			
High Flux (15% scram)	C	Trip Output Relays (4)	Before Each Startup and Weekly When Required to be Operable
High Flux (Flow Biased)	B	Trip Output Relays (4)	Once/week
High Flux (Fixed Trip)	B	Trip Output Relays (4)	Once/week
36 Inoperative	B	Trip Output Relays (4)	Once/week
Downscale	B	Trip Output Relays (4)	Once/week
Flow Bias	B	(6)	(6)
High Reactor Pressure	A	Trip Channel and Alarm	Once/Month (1)
High Drywell Pressure	A	Trip Channel and Alarm	Once/Month (1)
Reactor Low Water Level (5)	A	Trip Channel and Alarm	Once/Month (1)
High Water Level in Scram Discharge Tank	A	Trip Channel and Alarm	Once/Month
Turbine Condenser Low Vacuum	A	Trip Channel and Alarm	Once/Month (1)

3.5 CORE AND CONTAINMENT COOLING SYSTEMS

I. Average Planar Linear Heat Generation Rate

During steady state power operation, the Maximum Average Planar Heat Generation Rate (MAPLHGR) for each type of fuel as a function of average planar exposure shall not exceed the limiting value shown in Tables 3.5.1-1 through 3.5.1-7. If at any time during operation, it is determined by normal surveillance that the limiting value for APLHGR is being exceeded, action shall be initiated within 15 minutes to restore operation to within the prescribed limits. If the APLHGR is not returned to within the prescribed limits within two (2) hours, the reactor shall be brought to the Cold Shutdown condition within 36 hours. Surveillance and corresponding action shall continue until reactor operation is within the prescribed limits.

4.5 CORE AND CONTAINMENT COOLING SYSTEMS

I. Maximum Average Planar Linear Heat Generation Rate (MAPLHGR)

The MAPLHGR for each type of fuel as a function of average planar exposure shall be determined daily during reactor operation at $\geq 25\%$ rated thermal power.

3.5 BASES

testing to ensure that the lines are filled. The visual checking will avoid starting the core spray or RHR system with a discharge line not filled. In addition to the visual observation and to ensure a filled discharge line other than prior to testing, a pressure suppression chamber head tank is located approximately 20 feet above the discharge line highpoint to supply makeup water for these systems. The condensate head tank located approximately 100 feet above the discharge high point serves as a backup charging system when the pressure suppression chamber head tank is not in service. System discharge pressure indicators are used to determine the water level above the discharge line high point. The indicators will reflect approximately 30 psig for a water level at the high point and 45 psig for a water level in the pressure suppression chamber head tank and are monitored daily to ensure that the discharge lines are filled.

When in their normal standby condition, the suction for the HPCI and RCIC pumps are aligned to the condensate storage tank, which is physically at a higher elevation than the HPCIS and RCICS piping. This assures that the HPCI and RCIC discharge piping remains filled. Further assurance is provided by observing water flow from these systems high points monthly.

I. Maximum Average Planar Linear Heat Generation Rate (MAPLHGR)

This specification assures that the peak cladding temperature following the postulated design basis loss-of-coolant accident will not exceed the limit specified in the 10 CFR 50, Appendix K.

The peak cladding temperature following a postulated loss-of-coolant accident is primarily a function of the average heat generation rate of all the rods of a fuel assembly at any axial location and is only dependent secondarily on the rod to rod power distribution within an assembly. Since expected local variations in power distribution within a fuel assembly affect the calculated peak clad temperature by less than $\pm 20^\circ\text{F}$ relative to the peak temperature for a typical fuel design, the limit on the average linear heat generation rate is sufficient to assure that calculated temperatures are within the 10 CFR 50 Appendix K limit. The limiting value for MAPLHGR is shown in Tables 3.5.1-1 through 7. The analyses supporting these limiting values is presented in reference 1.

J. Linear Heat Generation Rate (LHGR)

This specification assures that the linear heat generation rate in any rod is less than the design linear heat

1.5 PAGES

reported within 30 days. It must be recognized that there is always an action which would return any of the parameters (MAPLHGR, LHGR, or MCPR) to within prescribed limits, namely power reduction. Under most circumstances, this will not be the only alternative.

H. References

1. Loss-of-Coolant Accident Analysis for Browns Ferry Nuclear Plant Unit 3, NEDO-24194A and Addenda.
2. "BWR Transient Analysis Model Utilizing the RETRAN Program," TVA-TR81-01-A.
3. Generic Reload Fuel Application, Licensing Topical Report, NEDE-24011-P-A and Addenda.

TABLE 3.5.1-7

MAPLHGR VERSUS AVERAGE PLANAR EXPOSURE

Plant: 3F-3

Fuel Type: BP8DRB284L

Average Planar Exposure (MWd/t)	MAPLHGR (kW/ft)
200	11.2
1,000	11.3
5,000	11.8
10,000	12.0
15,000	12.0
20,000	11.9
25,000	11.3
30,000	10.8
35,000	10.1
40,000	9.4
45,000	8.8

Amendment No. ~~61~~, 70

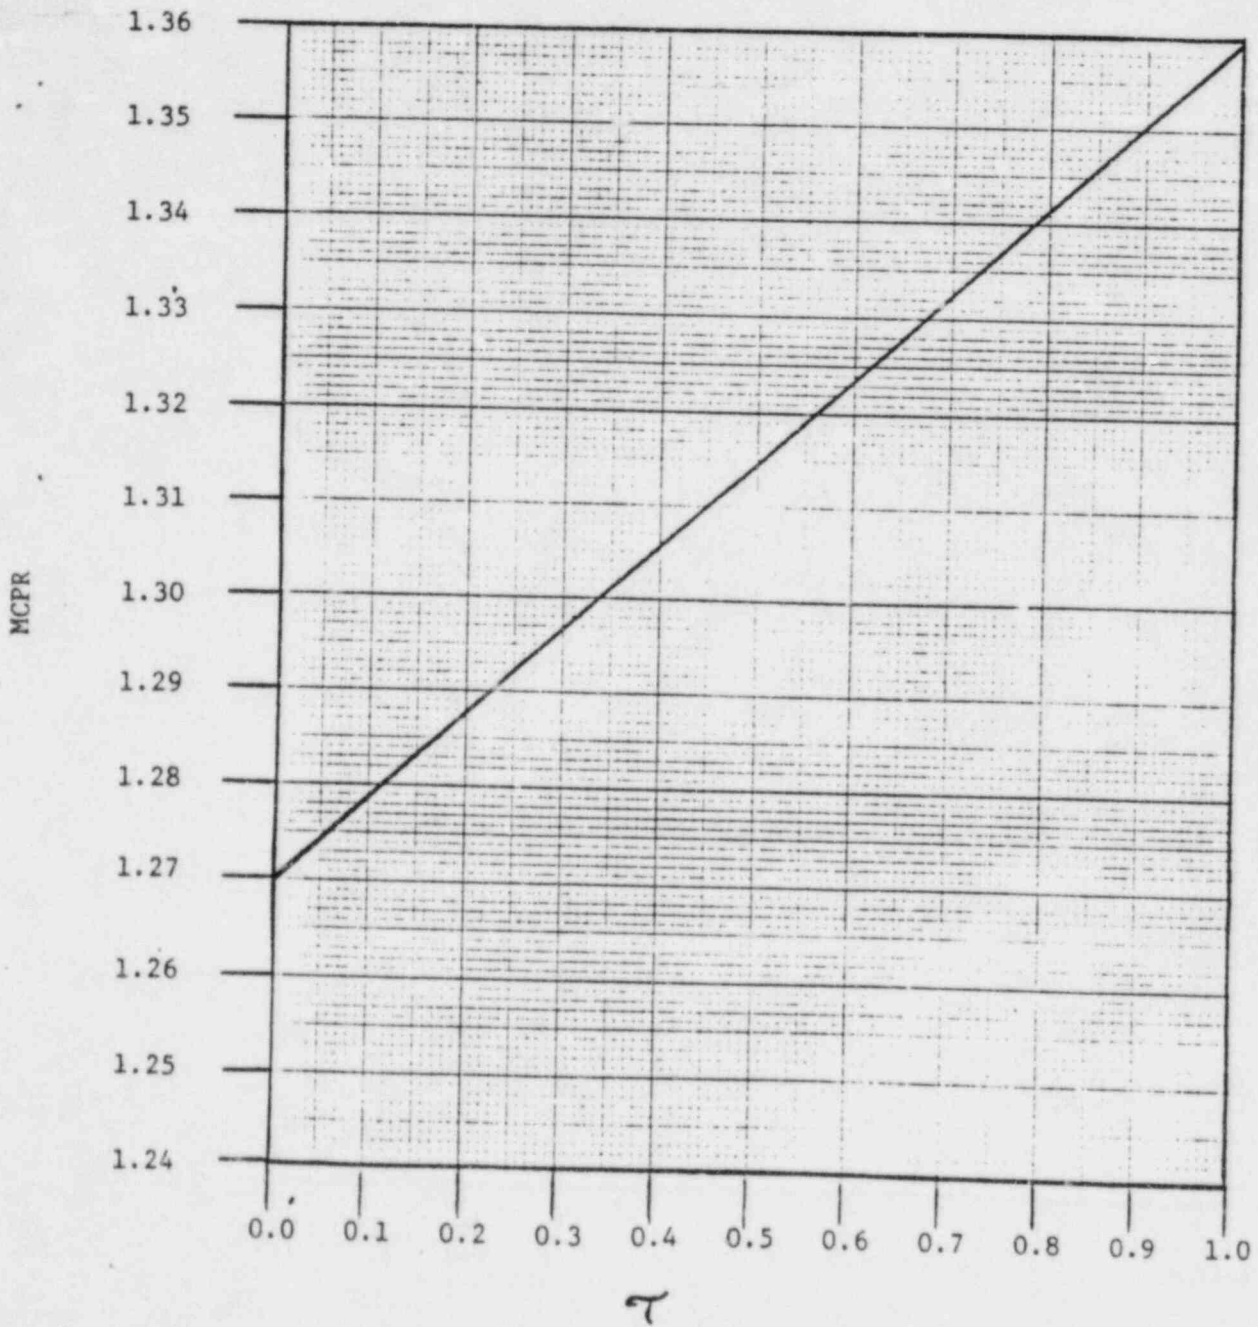


Figure 3.5.K-1
 MCPR Limits for 8x8R, P8x8R and LTAs