




GULF STATES UTILITIES COMPANY

POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704

AREA CODE 713 838-6631

August 3, 1984
RBG- 18423
File Nos. G9.5, G9.25.1.1

Mr. John T. Collins, Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV, Office of Inspection and Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011

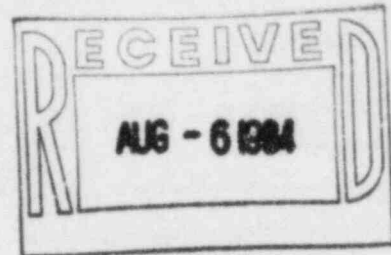

Dear Mr. Collins:

River Bend Station-Unit 1
Docket No. 50-458
Final Report/DR-169

Gulf States Utilities Company (GSU) has completed its evaluation of DR-169 concerning the ground wire discrepancy in Division II, 125-V dc switchgear supplied by Brown-Boveri Electric. Since the dc system is a normally ungrounded system, a single undetected ground would tie one pole to ground. Having one pole tied to ground would not affect the operation of the dc system; therefore, GSU has determined this condition is not reportable under 10CFR50.55(e).

Sincerely,

J. E. Bocker
Manager-Engineering,
Nuclear Fuels & Licensing
River Bend Nuclear Group

JEB/LAE/lp

cc: Director of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

NRC Resident Inspector-Site

INPO

8408150491 840803
PDR ADOCK 05000458
S PDR