

12691 AFCo - Primary p. 123

Board Exhibit 1

Carpenter

Error	Resistance	} by JHC
0.05%	$\sim 10^7$ ohms	
0.5%	$\sim 10^6$ ohms	
5%	$\sim 10^5$ ohms	
50%	$\sim 10^4$ ohms	?


BD-1
50-348/364-CIVP
2/21/92

COLLECTED
USNRC

'92 MAR 13 11:13

OFFICE OF SECRETARY
BUCKETING & SERVICE
BRANCH

**INSULATION
RESISTANCE A
(k Ω)**

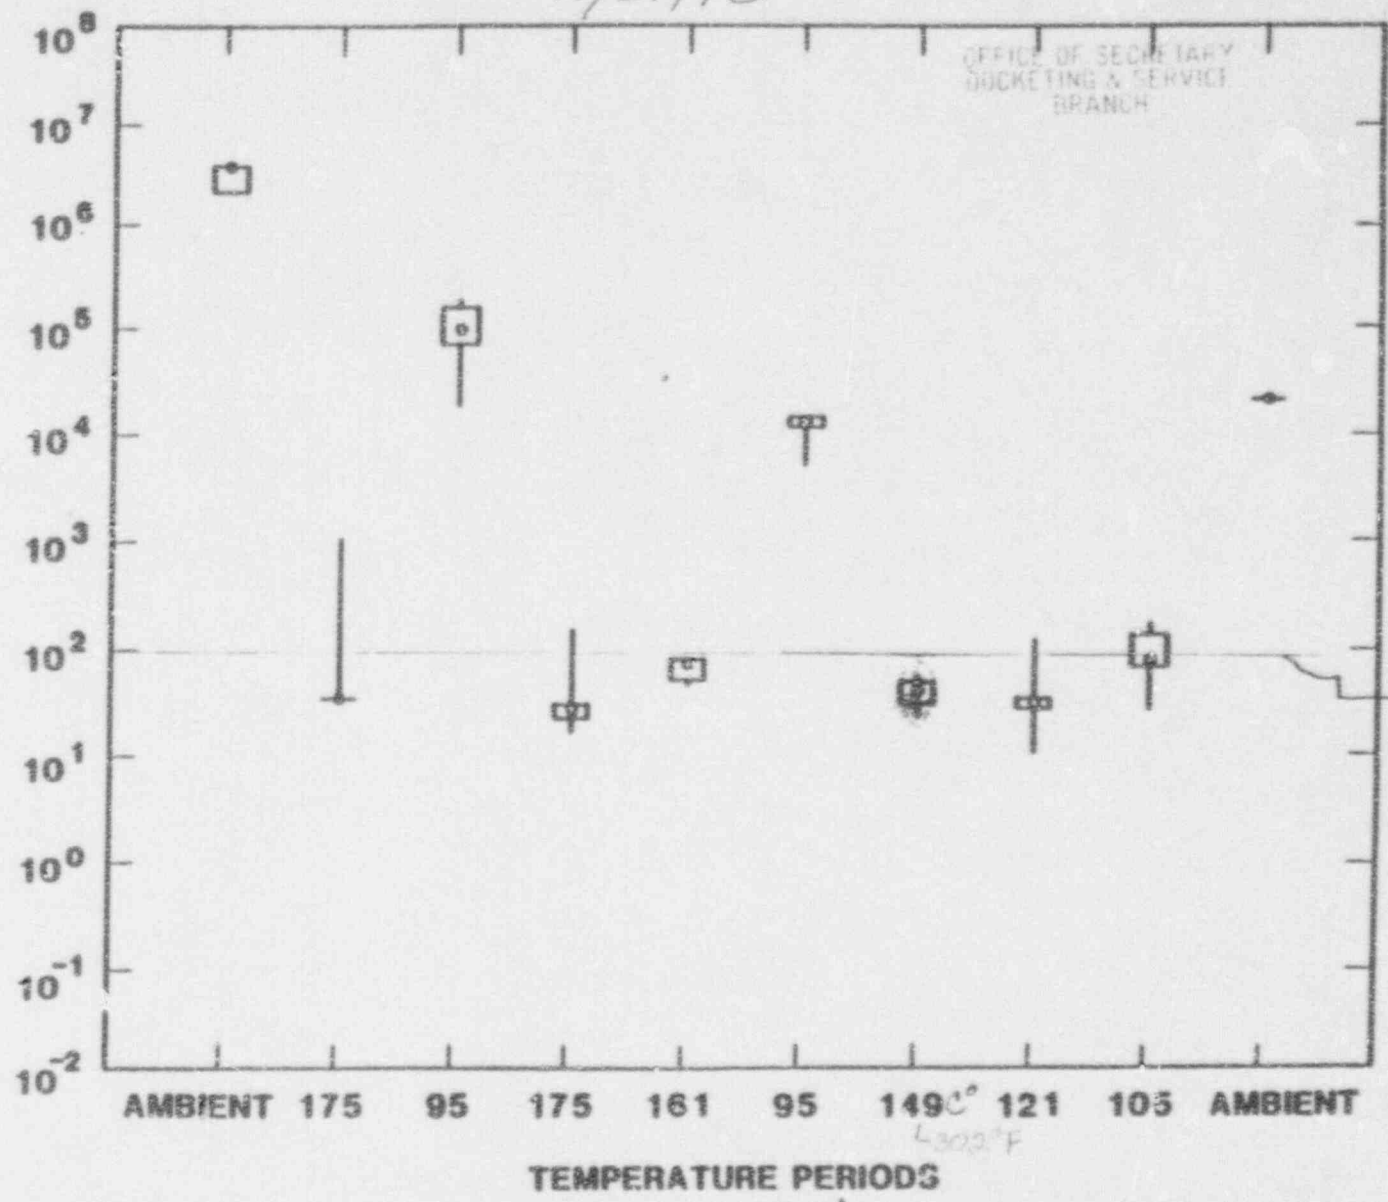

line added
JHC

9204060077 920221
PDR ADDCK 05000348
PDR

-210-

Figure A1-21

Box and Whisker Plot of Insulation Resistance A for TB 9, Phase II

NUCLEAR REGULATORY COMMISSION

DocId No. 50349241 Civil Official Exh. No. 1

In the matter of Alabama Power Company

Board IDENTIFIED 3:27 p.m. 2/20
RECEIVED 7:31 a.m. 2/21/92
REJECTED

DATE 2/21/92

BY L. E. King