


Staff Exh. 51

DULWETED
USNRC

'92 MAR 13 P12:07

OFFICE OF REGULATORY
PROJECTS & SERVICE
BRANCH

Insulation Resistance Vs. Temperature

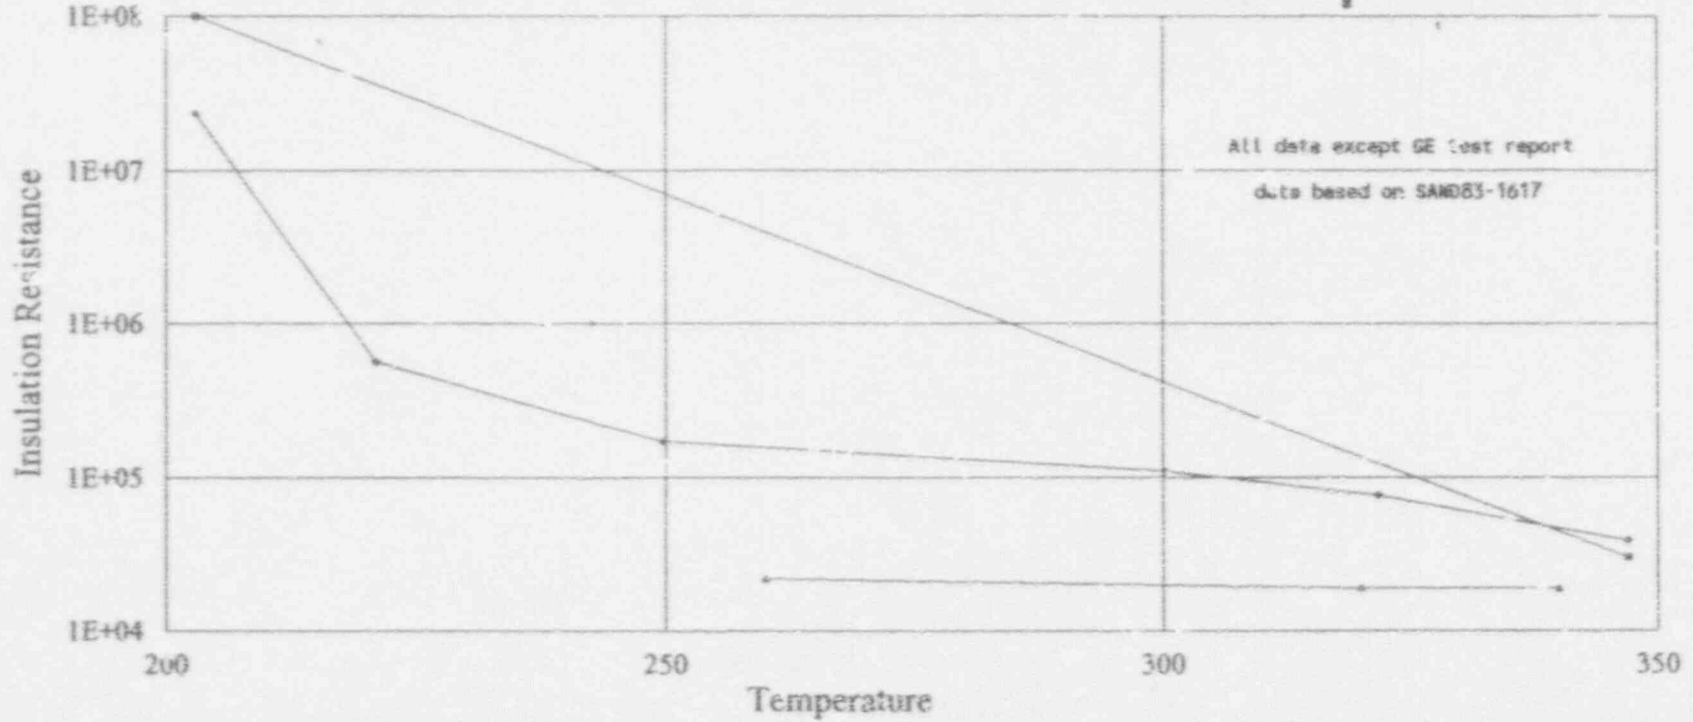

APCo Data-EB25 Endpoints
 States ZWM Complete Plot
 GE Test Report-States TBs

S-51
 50-345/364 - CIVP
 2/16/92

9204070012 920218
 PER ADDCK 05000348
 PDR

NUCLEAR REGULATORY COMMISSION

Docket No. 50-348/92 CIV Atomic Ech. No. 51
in the matter of Alabama Power Company
Staff ✓ IDENTIFIED 10:00 a.m. 2/11/92
Applicant _____ RECEIVED 12:06 p.m. 2/12/92
Intervenor _____ REJECTED _____
Gen'l. Off'r _____ DATE 2/18/92
Contractor _____ C. 1265 _____
Other _____
Reporter L. Estep _____