

Attached are the recent revisions to the ComEd Offsite Dose Calculation Manual (ODCM) Chapters 10, 11, 12 and Appendix F for **Braidwood** Station. Please complete the following manual update:

Remove	Insert
Braidwood Station Chapter 10 Entire Contents	Braidwood Station Chapter 10 Revision 1.8 Entire Contents
Braidwood Station Chapter 11 Entire Contents	Braidwood Station Chapter 11 Revision 1.8 Entire Contents
Braidwood Station Chapter 12 Entire Contents	Braidwood Station Chapter 12 Revision 1.8 Entire Contents
Braidwood Station Appendix F Entire Contents	Braidwood Station Appendix F Revision 1.8 Entire Contents

Please sign and date this control sheet. Return to:

ComEd
c/o Document Control - EP
1400 Opus Place - 5th Floor
Downers Grove, IL 60515

(708)663-7324 or (708)663-7307

Your signature indicates you have verified that your control number is correct and you have updated your manual.

 Signature

X244
 NRC C/O DOC CTRL DSK, C. PATEL
 DIRECTOR OF NUC. REACTOR REGULATION
 U. S. NUC. REGULATORY COMMISSION
 MAIL STATION P1-137

 Date

ADD 9/1

CHAPTER 10***Braidwood Annex Index***

<u>PAGE</u>	<u>REVISION</u>
10-i	1.8
10-ii	1.8
10-iii	1.8
10-iv	1.8
10-v	1.8
10-1	1.8
10-2	1.8
10-3	1.8
10-4	1.8
10-5	1.8
10-6	1.8
10-7	1.8
10-8	1.8
10-9	1.8
10-10	1.8
10-11	1.8
10-12	1.8
10-13	1.8
10-14	1.8
10-15	1.8
10-16	1.8

CHAPTER 10

RADIOACTIVE EFFLUENT TREATMENT AND MONITORING

Table of Contents

<u>SECTION</u>	<u>PAGE</u>
10.1 AIRBORNE RELEASES	1
1. System Description	1
1. Waste Gas Holdup System	1
2. Ventilation Exhaust Treatment System	1
2. Radiation Monitors	1
1. Auxiliary Building Vent Effluent Monitors	1
2. Containment Purge Effluent Monitors	2
3. Waste Gas Decay Tank Monitors	2
4. Gland Steam and Condenser Air Ejector Monitors	2
5. Radwaste Building Ventilation Monitor	2
6. Component Cooling Water Monitor	2
7. Miscellaneous Ventilation Monitors	3
3. Alarm and Trip Setpoints	3
1. Setpoint Calculations	3
1. Auxiliary Building Vent Effluent Monitors	3
2. Containment Purge Effluent Monitors	3
3. Waste Gas Decay Tank Effluent Monitors	3
4. Component Cooling Water Monitors	3
2. Release Limits	3
3. Release Mixture	4
4. Conversion Factors	4
5. HVAC Flow Rates	4
4. Allocation of Effluents from Common Release Points	5
5. Dose Projections for Batch Releases	5

CHAPTER 10

RADIOACTIVE EFFLUENT TREATMENT AND MONITORING

Table of Contents

<u>SECTION</u>	<u>PAGE</u>
10.2 LIQUID RELEASES	5
1. System Description	5
1. Release Tanks	5
2. Radiation Monitors	5
1. Liquid Radwaste Effluent Monitors	6
2. Station Blowdown Monitor	6
3. Reactor Containment Fan Cooler (RCFC) and Essential Service Water (ESSW) Outlet Line Monitors	6
4. Turbine Building Fire and Oil Sump Monitor	6
5. Condensate Polisher Sump Monitor	6
3. Alarm and Trip Setpoints	6
1. Setpoint Calculation	6
1. Liquid Radwaste Effluent Monitor	6
2. Station Blowdown Monitor	6
2. Discharge Flow Rates	7
1. Release Tank Discharge Flow Rate	7
3. Release Limits	8
4. Release Mixture	8
5. Conversion Factors	8
6. Liquid Dilution Flow Rates	8
4. Allocation of Effluents from Common Release Points	8
5. Projected Concentrations for Releases	9
10.3 SOLIDIFICATION OF WASTE/PROCESS CONTROL PROGRAM	9

CHAPTER 10

LIST OF TABLES

	<u>SECTION</u>	<u>PAGE</u>	
	10-1	Assumed Composition of the Braidwood Station Noble Gas Effluent	10-10
	10-2	Assumed Composition of the Braidwod Station Liquid Effluent	10-11

CHAPTER 10**LIST OF FIGURES**

	<u>SECTION</u>	<u>PAGE</u>	
	10-1	Simplified HVAC and Gaseous Effluent Flow Diagram	10-12
	10-2	Simplified Liquid Radwaste Processing Diagram	10-14
	10-3	Simplified Liquid Effluent Flow Diagram	10-15
	10-4	Simplified Solid Radwaste Processing Diagram	10-16

CHAPTER 10**RADIOACTIVE EFFLUENT TREATMENT AND MONITORING****10.1 AIRBORNE RELEASES****10.1.1 System Description**

A simplified HVAC and gaseous effluent flow diagram is provided in Figure 10-1. The principal release points for potentially radioactive airborne effluents are the two auxiliary building vent stacks (designated Unit 1 Vent Stack and Unit 2 Vent Stack in Figure 10-1). In the classification scheme of Section 4.1.4, each is classified as a vent release point (see Table A-1 of Appendix A).

10.1.1.1 Waste Gas Holdup System

The waste gas holdup system is designed and installed to reduce radioactive gaseous effluents by collecting reactor coolant system off-gases from the reactor coolant system and providing for delay or holdup to reduce the total radioactivity by radiodecay prior to release to the environment. The system is described in Section 11.3.2 of the Byron/Braidwood UFSAR.

10.1.1.2 Ventilation Exhaust Treatment System

Ventilation exhaust treatment systems are designed and installed to reduce gaseous radiiodine or radioactive material in particulate form in gaseous effluents by passing ventilation or vent exhaust gases through HEPA filters (and charcoal adsorbers when required to mitigate potential iodine releases) prior to release to the environment. Such a system is not considered to have any effect on noble gas effluents. The ventilation exhaust treatment systems are shown in Figure 10-1.

Engineered safety features atmospheric cleanup systems are not considered to be ventilation exhaust treatment system components.

10.1.2 Radiation Monitors**10.1.2.1 Auxiliary Building Vent Effluent Monitors**

Monitors 1RE-PR028 (Unit 1) and 2RE-PR028 (Unit 2) continuously monitor the final effluent from the auxiliary building vent stacks.

Both vent stack monitors feature automatic isokinetic sampling, grab sampling, and tritium sampling.

In normal operation all three noble gas channels (low, mid-range, high) are on line and active. On a high alarm the low and mid-range noble gas channels are closed and only the high range noble gas channel remains active. The iodine and particulate channels, however, continue to operate under all conditions.

No automatic isolation or control functions are performed by these monitors. Pertinent information on these monitors is provided in Byron/Braidwood UFSAR Table 11.5-1.

10.1.2.2 Containment Purge Effluent Monitors

Monitors 1RE-PR001 (Unit 1) and 2RE-PR001 (Unit 2) continuously monitor the effluent from the Unit 1 and Unit 2 containments, respectively. When airborne radioactivity in the containment purge effluent stream exceeds a specified level, station personnel will follow established procedures to terminate the release by manually activating the containment purge valves. Additionally, the auxiliary building vent effluent monitors provide an independent, redundant means of monitoring the containment purge effluent.

No automatic isolation or control functions are performed by these monitors.

Pertinent information on these monitors is provided in Byron/Braidwood UFSAR Table 11.5-1.

Area Radiation Monitors 1(2) RE-AR011 and 1(2) RE-AR012 monitor the containment atmosphere. On high alarm during a containment purge, these monitors will automatically terminate the purge.

10.1.2.3 Waste Gas Decay Tank Monitors

Monitors 0RE-PR002A/B continuously monitor the noble gas activity released from the gas decay tanks.

On high alarm, the monitors automatically initiate closure of the valve 0GW014 thus terminating the release.

Pertinent information on these monitors and associated control devices is provided in Byron/Braidwood UFSAR Table 11.5-1.

10.1.2.4 Gland Steam and Condenser Air Ejector Monitors

Monitors 1RE-PR027 and 2RE-PR027 continuously monitor the condenser air ejector gas from Units 1 and 2, respectively. On high alarm 1(2)RE-PR027 initiates startup of the offgas treatment system.

Pertinent information on these monitors is provided in Byron/Braidwood UFSAR Table 11.5-1.

10.1.2.5 Radwaste Building Ventilation Monitor

Monitor 0RE-PR026 continuously monitors radioactivity in the radwaste building ventilation system. No control device is initiated by this channel.

Pertinent information on this monitor is provided in Byron/Braidwood UFSAR Table 11.5-1.

10.1.2.6 Component Cooling Water Monitor

Monitors 0RE-PR009 (common), 1RE-PR009 (Unit 1), and 2RE-PR009 (Unit 2) continuously monitor the component cooling water heat exchanger outlets. On high alarm 0RE-PR009 initiates closure of both component cooling water surge tank (CCWST) vents, 1RE-PR009 initiates closure of the Unit 1 CCWST vent, and 2RE-PR009 initiates closure of the Unit 2 CCWST vent.

Pertinent information on this monitor is provided in Byron/Braidwood UFSAR Table 11.5-1.

10.1.2.7 Miscellaneous Ventilation Monitors

Monitor ORE-PR003 continuously monitors radioactivity in the ventilation exhaust from the laboratory fume hoods. No control device is initiated by this channel.

Pertinent information on this monitor and associated devices is provided in Byron/Braidwood UFSAR Table 11.5-1.

10.1.3 Alarm and Trip Setpoints

10.1.3.1 Setpoint Calculations

10.1.3.1.1 Auxiliary Building Vent Effluent Monitors

The setpoints for the low range noble gas channel are conservatively established at 5% of the maximum permissible station release rate for the high alarm and 1/2% of the maximum release rate for the alert alarm.

The setpoints for the high range noble gas channel are conservatively established at 50% of the maximum permissible station release rate for the high alarm and 25% of the maximum release rate for the alert alarm.

10.1.3.1.2 Containment Purge Effluent Monitors

The setpoints are established at 1.50 times the analyzed containment noble gas activity during purge, plus the background reading of the monitor prior to purge.

10.1.3.1.3 Waste Gas Decay Tank Effluent Monitors

The setpoints are established at 1.50 times the analyzed waste gas tank activity during release.

10.1.3.1.4 Component Cooling Water Monitors

The setpoint is based on the radionuclide mix in Table 10-1. The total calculated detector response is divided by 2 to obtain the final setpoint. (See section 10.2.3.5 for the conversion factor).

10.1.3.2 Release Limits

Alarm and trip setpoints of gaseous effluent monitors are established to ensure that the release rate limits of RETS are not exceeded. The release limits are found by solving Equations 10-1 and 10-2 for the total allowed release rate of vent releases, Q_w .

$$(1.11) Q_{tv} \sum (V_i T_i) \leq 500 \text{ mrem/yr} \quad (10-1)$$

$$Q_{tv} \sum \{ (f_i) [L_i(X/Q)_v \exp(-\lambda_i R/3600u_v)^* + 1.11V_i] \} < 3000 \text{ mrem/yr} \quad (10-2)$$

The summations are over noble gas radionuclides i.

f_i Fractional Radionuclide Composition

The release rate of noble gas radionuclide i divided by the total release rate of all noble gas radionuclides.

Q_v Total Allowed Release Rate, Vent Release [$\mu\text{Ci/sec}$]

The total allowed release rate of all noble gas radionuclides released as vent releases.

$\exp(-\lambda_i R/3600U_v)$ is set equal to 1.0 for setpoint calculations.

The remaining parameters in Equation 10-1 have the same definitions as in Equation A-8 of Appendix A. The remaining parameters in Equation 10-2 have the same definition as in Equation A-9 of Appendix A.

Equation 10-1 is based on Equation A-8 of Appendix A and the RETS restriction on whole body dose rate (500 mrem/yr) due to noble gases released in gaseous effluents (see Section A.1.3.1 of Appendix A). Equation 10-2 is based on Equation A-9 of Appendix A and the RETS restriction on skin dose rate (3000 mrem/yr) due to noble gases released in gaseous effluents (see Section A.1.3.2 of Appendix A).

Since the solution to Equation 10-2 is more conservative than the solution to Equation 10-1, the value of Equation 10-2 ($3.09 \times 10^6 \mu\text{Ci/sec}$) is used as the limiting noble gas release rate. During evolutions involving releases from the containment or waste gas decay tanks, the release rate from each release path is procedurally limited to $1 \times 10^6 \mu\text{Ci/sec}$ (less than 1/3 the maximum permissible station release rate).

Calibration methods and surveillance frequency for the monitors will be conducted as specified in the RETS.

10.1.3.3 Release Mixture

In the determination of alarm and trip setpoints, the radioactivity mixture in exhaust air is assumed to have the radionuclide composition of Table 10-1.

10.1.3.4 Conversion Factors

The response curves used to determine the monitor count rates are based on the sensitivity to Xe-133 for conservatism.

10.1.3.5 HVAC Flow Rates

The plant vent stack flow rates are obtained from 1/2 PR28J. However, if the readout indicates "0" flow, the following minimum rated fan flow values are currently used:

Unit 1 -	6.15 x 10 ⁶ cc/sec
Unit 2 -	4.55 x 10 ⁶ cc/sec

10.1.4 Allocation of Effluents from Common Release Points

Radioactive gaseous effluents released from the auxiliary building, miscellaneous ventilation systems and the gas decay tanks are comprised of contributions from both units. Consequently, allocation is made evenly between units.

10.1.5 Dose Projections for Batch Releases

Dose projections are not made prior to release. Doses are calculated after purging the containment or venting the waste gas decay tanks. Per procedure, representative samples are obtained and analyzed, and the doses calculated on a monthly basis to verify compliance with 10CFR50.

10.2 LIQUID RELEASES**10.2.1 System Description**

A simplified liquid effluent flow diagram is provided in Figure 10-3. A simplified liquid waste processing diagram is provided in Figure 10-2.

The liquid radwaste treatment system is designed and installed to reduce radioactive liquid effluents by collecting the liquids, providing for retention or holdup, and providing for treatment by demineralizer or a concentrator for the purpose of reducing the total radioactivity prior to release to the environment. The system is described in Section 11.2.2 of the Byron/Braidwood Updated Final Safety Analysis Report.

10.2.1.1 Release Tanks

There are two radwaste release tanks (0WX01T - 33,100 gallon capacity, and 0WX26T - 33750 gallon capacity) which receive liquid waste before discharge to the Kankakee river.

10.2.2 Radiation Monitors**10.2.2.1 Liquid Radwaste Effluent Monitors**

Monitor 0RE-PR001 is used to monitor all releases from the release tanks. On high alarm, the monitor automatically initiates closure of valves 0WX-353 and 0WX-896 to terminate the release.

Pertinent information on the monitor and associated control devices is provided in Byron/Braidwood UFSAR Table 11.5-2.

10.2.2.2 Station Blowdown Monitor

Monitor 0RE-PR010 continuously monitors the circulating water blowdown. No control device is initiated by this channel.

Pertinent information on this monitor is provided in Byron/Braidwood UFSAR Table 11.5-2.

10.2.2.3 Reactor Containment Fan Cooler (RCFC) and Essential Service Water (ESSW) Outlet Line Monitors

Monitors 1RE-PR02, 2RE-PR002, 1RE-PR003, and 2RE-PR003 continuously monitor the RCFC and ESSW outlet lines.

No control device is initiated by these channels.

Pertinent information on these monitors is provided in Byron/Braidwood UFSAR Table 11.5-2.

10.2.2.4 Turbine Building Fire and Oil Sump Monitor

Monitor 0RE-PR005 continuously monitors the fire and oil sump discharge. On high alarm the monitor automatically initiates an interlock to trip the discharge pumps, close valve 0OD030, and terminate the release. Pertinent information on this monitor is provided in Byron/Braidwood UFSAR Table 11.5-2.

10.2.2.5 Condensate Polisher Sump Monitor

Monitor 0RE-PR041 continuously monitors the condensate polisher sump discharge. On high alarm the monitor automatically initiates an interlock to trip the discharge pumps and terminate the release. Pertinent information on this monitor is provided in Byron/Braidwood UFSAR Table 11.5-2.

10.2.3 Alarm and Trip Setpoints

10.2.3.1 Setpoint Calculations

Alarm and trip setpoints of liquid effluent monitors at the principal release points are established to ensure that the limits of RETS and 10CFR20 are not exceeded in the unrestricted area.

10.2.3.1.1 Liquid Radwaste Effluent Monitor

During release the setpoint is established at 1.5 times the analyzed tank activity plus the background reading.

10.2.3.1.2 Station Blowdown Monitor

The monitor setpoint is found by solving equation 10-3.

$$P \leq C^{CN} + (1.25 \times C^T) \times \left(F_{MAX}^T / (F^{CN} + F_{MAX}^T) \right) \quad (10-3)$$

P	Release Setpoint	[$\mu\text{Ci}/\text{m}^3$]
1.25	Factor to account for minor fluctuations in count rate.	
C^{CW}	Concentration of activity in the circulating water blowdown at the time of discharge. ("Background reading")	[$\mu\text{Ci}/\text{m}^3$]
C^T	Analyzed activity in the release tank	[$\mu\text{Ci}/\text{m}^3$]
F^{CW}	Circulating Water Blowdown Rate	[gpm]
F_{max}^T	Maximum Release Tank Discharge Flow Rate The flow rate from the radwaste discharge tank.	[gpm]

10.2.3.2 Discharge Flow Rates

10.2.3.2.1 Release Tank Discharge Flow Rate

Prior to each batch release, a grab sample is obtained.

The results of the analysis of the waste sample determine the discharge rate of each batch as follows:

$$F_{max}^T = 0.5 (F_{act}^{CW} / \sum (C_i^T / 10 \cdot \text{DWC}_i)) \quad (10-4)$$

The summation is over radionuclides i .

0.5 Factor for conservatism

F_{max}^T	Maximum Permitted Discharge Flow Rate	[gpm]
	The maximum permitted flow rate from the radwaste discharge tank based on radiological limits (not chemistry limits which may be more restrictive)	

F_{act}^{CW}	Circulating Water Blowdown Rate	[gpm]
----------------	---------------------------------	-------

C_i^T	Concentration of Radionuclide i in the Release Tank	[$\mu\text{Ci}/\text{m}^3$]
	The concentration of radioactivity in the radwaste discharge tank based on measurements of a sample drawn from the tank.	

DWC_i Derived Water Concentration of Radionuclide i [$\mu\text{Ci}/\text{m}^3$]

The concentration of radionuclide i given in Appendix B, Table 2, Column 2 to 10CFR20.1001-20.2402.

10 Multiplier

10.2.3.3 Release Limits

Release limits are determined from RETS. Discharge rates and setpoints are adjusted to ensure that 50% of applicable RETS are not exceeded. (See Section 10.2.3.2)

In addition to the limits identified within the RETS, an administrative action level for tritium has been established for the Braidwood cooling pond. This limit, based on drinking water pathways, has been established as a control mechanism to ensure this pathway does not become a significant contributor to public dose. Because the public has access to the Braidwood cooling pond for fishing and/or boating an administrative limit for discharges to the cooling pond is prudent to ensure dose to the public from this path remains well below limits.

The controls for this pathway will be established by limiting the quantity (Curies) discharged to the Braidwood cooling pond. Calculations were performed based on a tritium concentration of 20,000 pCi/liter (40CFR190 public drinking water limit) and 200 pCi/liter which is a typical environmental lower limit of detection (LLD) for tritium. The administrative action level will be established at 4 Ci/year which corresponds to an equilibrium cooling pond level of 200 pCi/liter.

10.2.3.4 Release Mixture

For monitors 0RE-PR001 and 0RE-PR010 the release mixture used for the setpoint determination is the radionuclide mix identified in the grab sample isotopic analysis or the mix in Table 10-2.

For monitors 1RE-PR001, 1RE-PR002, 2RE-PR001, and 2RE-PR002, the release mixture is the radionuclides which are listed in Table 10-2. Each nuclide in the mix is at a concentration which is 10% of the RETS value given in Appendix B, Table 2, Column 2 to 10CFR20.1001 - 20.2402.

10.2.3.5 Conversion Factors

The readouts for the liquid effluent monitors are in $\mu\text{Ci}/\text{m}^3$. The cpm to $\mu\text{Ci}/\text{m}^3$ conversion is based on the detector sensitivity to Cs-137.

10.2.3.6 Liquid Dilution Flow Rates

Dilution flow rates are obtained from circulating water blowdown transmitter loop OFT-CW032.

10.2.4 Allocation of Effluents from Common Release Points

Radioactive liquid effluents released from either release tank (0WX01T or 0WX26T) are comprised of contributions from both units. Under normal operating conditions, it

is difficult to apportion the radioactivity between the units. Consequently, allocation is made evenly between units.

10.2.5 Projected Concentrations for Releases

After determining F'_{max} from Equation 10-4, RETS compliance is verified using Equations 10-5 and 10-6.

$$C_i^e = C_i^T [F'_{max} / (F'_{max} + F_{acr}^e)] \quad (10-5)$$

$$\sum (C_i^e / 10 \cdot DWC_i) \leq 0.5 \quad (10-6)$$

The summation is over radionuclides i .

C_i^e Concentration of Radionuclide i in the Unrestricted Area [μCi/m³]

The calculated concentration of radionuclide i in the unrestricted area as determined by Equation 10-5.

C_i^T Concentration of Radionuclide i in the Release Tank [μCi/m³]

The concentration of radioactivity in the radwaste discharge tank based on measurements of a sample drawn from the tank.

DWC _{i} Derived Water Concentration of Radionuclide i of Radionuclide i [μCi/m³]

The concentration of radionuclide i given in Appendix B, Table 2, Column 2 to 10CFR20.1001-20.2402.

10 Multiplier

F'_{max} Maximum Release Tank Discharge a Flow Rate [gpm]

F_{acr}^e Circulating Water Blowdown Rate [gpm]

0.5 Factor for conservatism

10.3 SOLIDIFICATION OF WASTE/PROCESS CONTROL PROGRAM

The process control program (PCP) contains the sampling, analysis, and formulation determination by which solidification of radioactive wastes from liquid systems is ensured.

Figure 10-4 is a simplified diagram of solid radwaste processing system.

Table 10-1


**Assumed Composition of the Braidwood Station
Noble Gas Effluent**

<u>Isotope</u>	<u>Percent of Total Annual Release</u>
Ar-41	00.89
Kr-85m	00.18
Kr-85	24.90
Kr-87	00.04
Kr-88	00.28
Xe-131m	01.40
Xe-133m	00.57
Xe-133	71.10
Xe-135	00.53
Xe-138	00.04

Table 10-2

Assumed Composition of the Braidwood Station Liquid Effluent


Isotope	Concentration ($\mu\text{Ci/ml}$)	Isotope	Concentration ($\mu\text{Ci/ml}$)
Ru-103	8.00E - 06	Mn-54	1.00E - 05
Ag-110m	3.00E - 06	Fe-59	5.00E - 06
Te-127	2.00E - 05	Co-58	9.00E - 06
Te-129m	2.00E - 06	Co-60	3.00E - 06
Te-131m	4.00E - 06	Rb-86	2.00E - 06
Te-132	2.00E - 06	Zr-95	6.00E - 06
I-130	3.00E - 07	Nb-95	1.00E - 05
I-131	3.00E - 08	Mo-99	4.00E - 06
I-132	8.00E - 07		
I-133	1.00E - 07		
I-135	4.00E - 07		
Cs-134	9.00E - 07		
Cs-136	9.00E - 06		
Cs-137	2.00E - 06		
Ce-144	1.00E - 06		
Np-239	1.00E - 05		

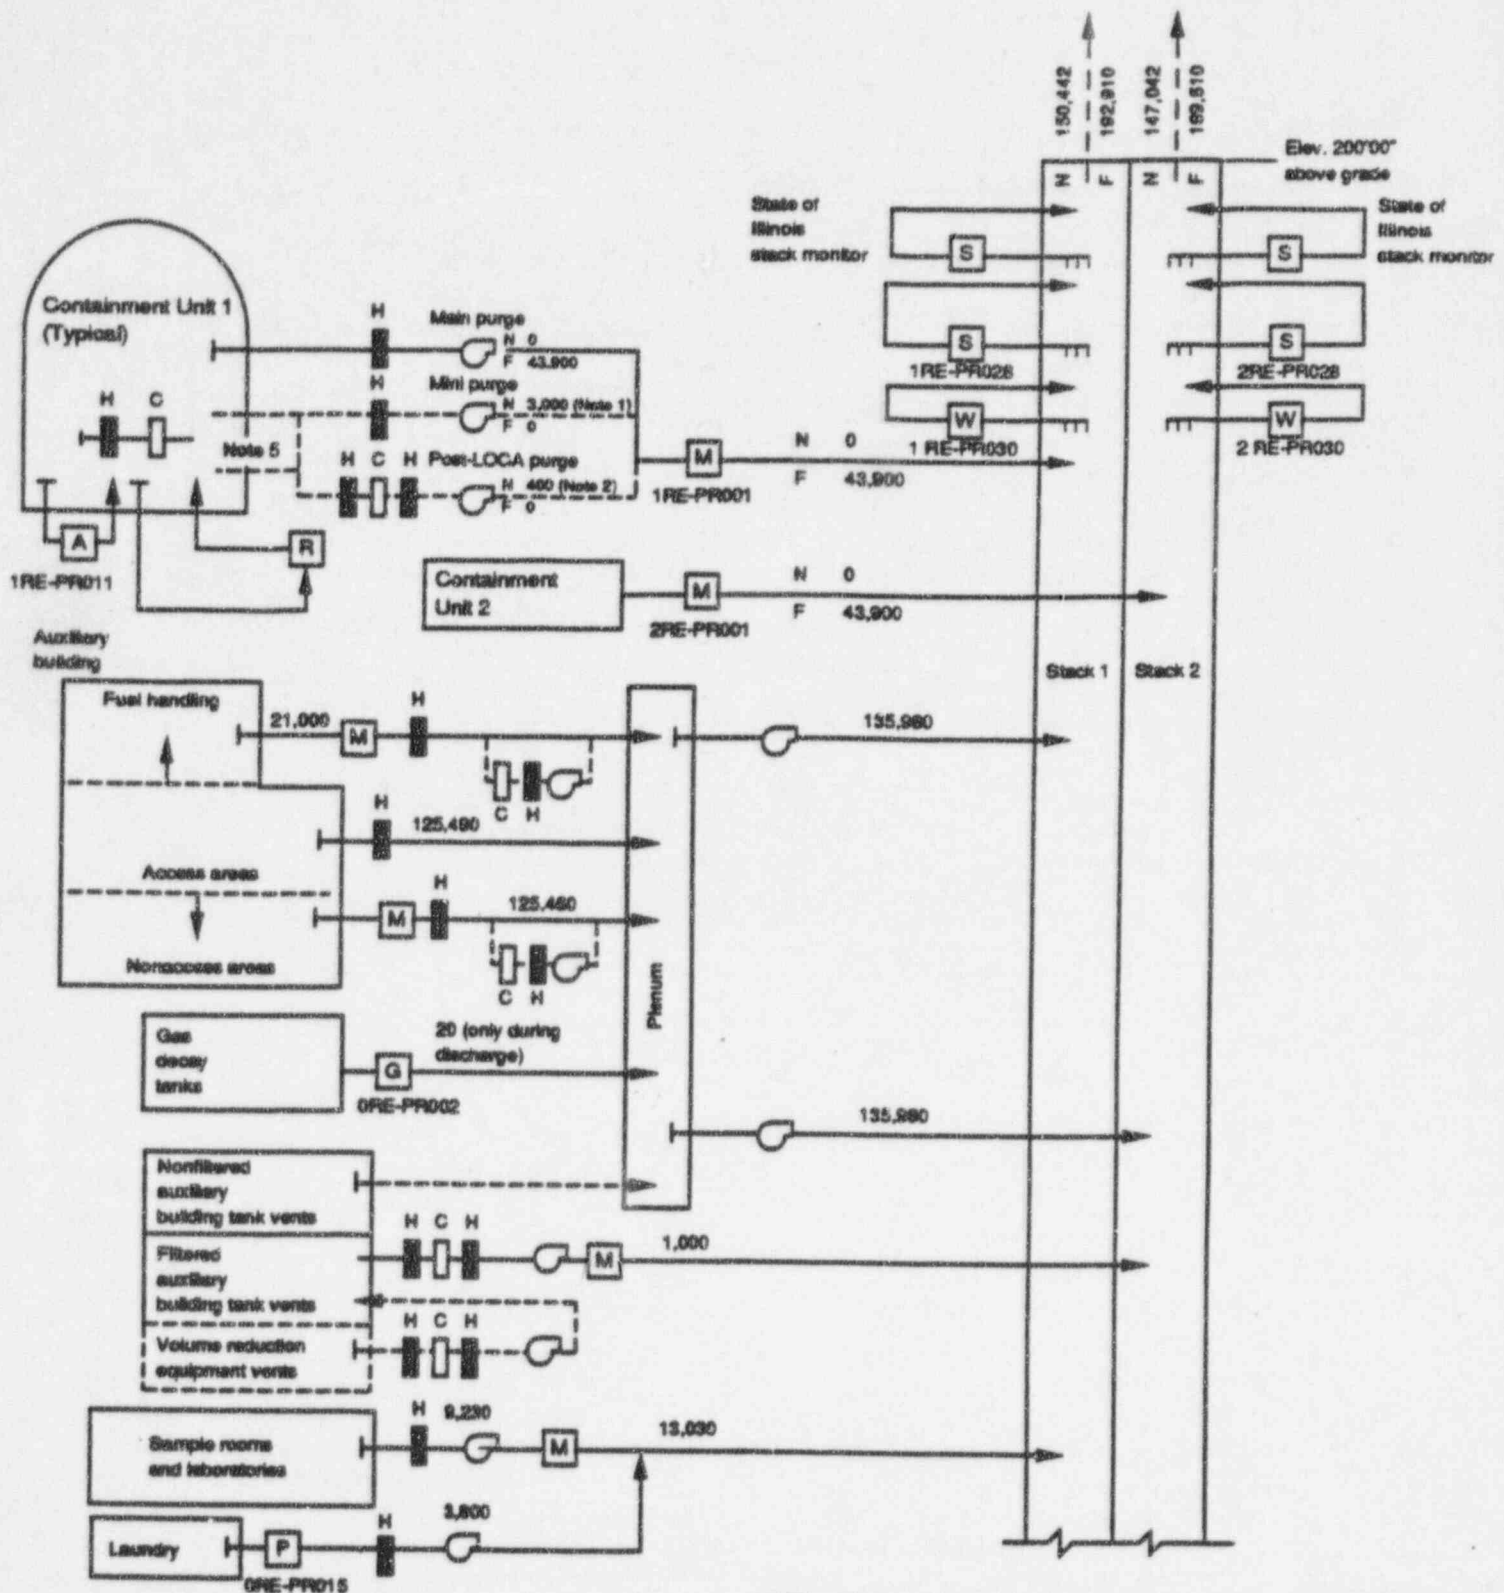

**OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION**

FIGURE 10-1

**SIMPLIFIED HVAC AND GASEOUS
EFFLUENT FLOW DIAGRAM
(SHEET 1 OF 2)**

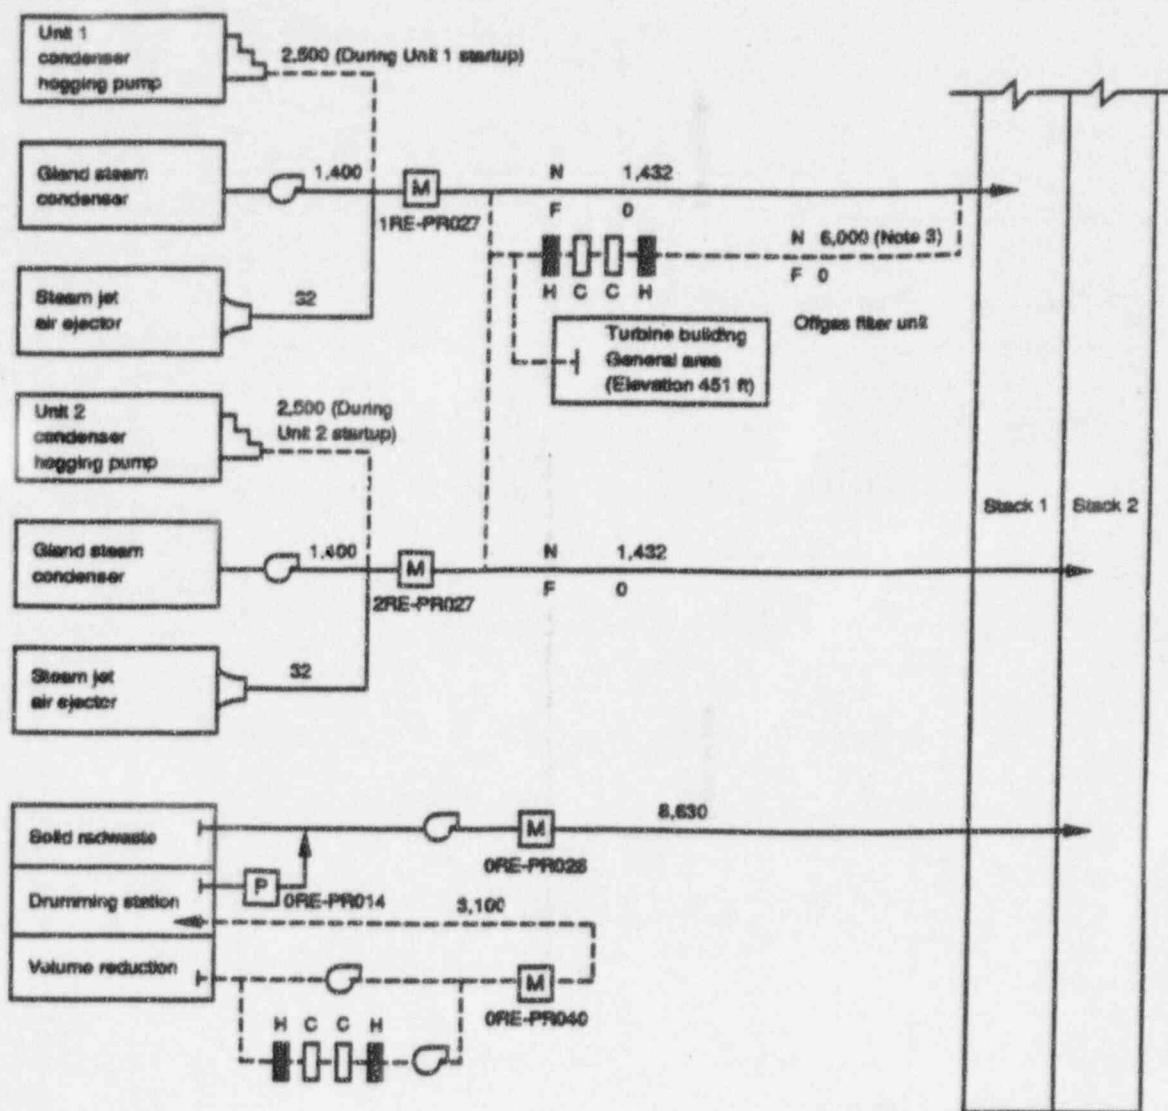

Legend

- Normal or frequent flow path
- - - Occasional flow path
- A Containment atmosphere radiation monitor
- C Charcoal filter
- F Refueling
- G Noble gas radiation monitor (offline)
- H HEPA filter
- M Three-channel radiation monitor for particulate, iodine, and noble gas (offline)
- N Normal operation
- P particulate monitor (offline)
- H Hydrogen recombiner
- S Normal range stack radiation monitor (particulate, iodine, and noble gas)
- W Wide-range stack noble radiation monitor


Notes


1. Used intermittently to vent containment during normal operation.
2. Used only during postaccident operation.
3. Filter unit operates only when high radiation is detected in offgas system effluent.
4. All flow rates are design flow rates in cubic feet per minute.
5. Integrated Leak Rate Test (ILRT) pressure relief point (an alternate release point that is seldom used).

OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION

FIGURE 10-1

SIMPLIFIED HVAC AND GASEOUS
EFFLUENT FLOW DIAGRAM
(SHEET 2 OF 2)

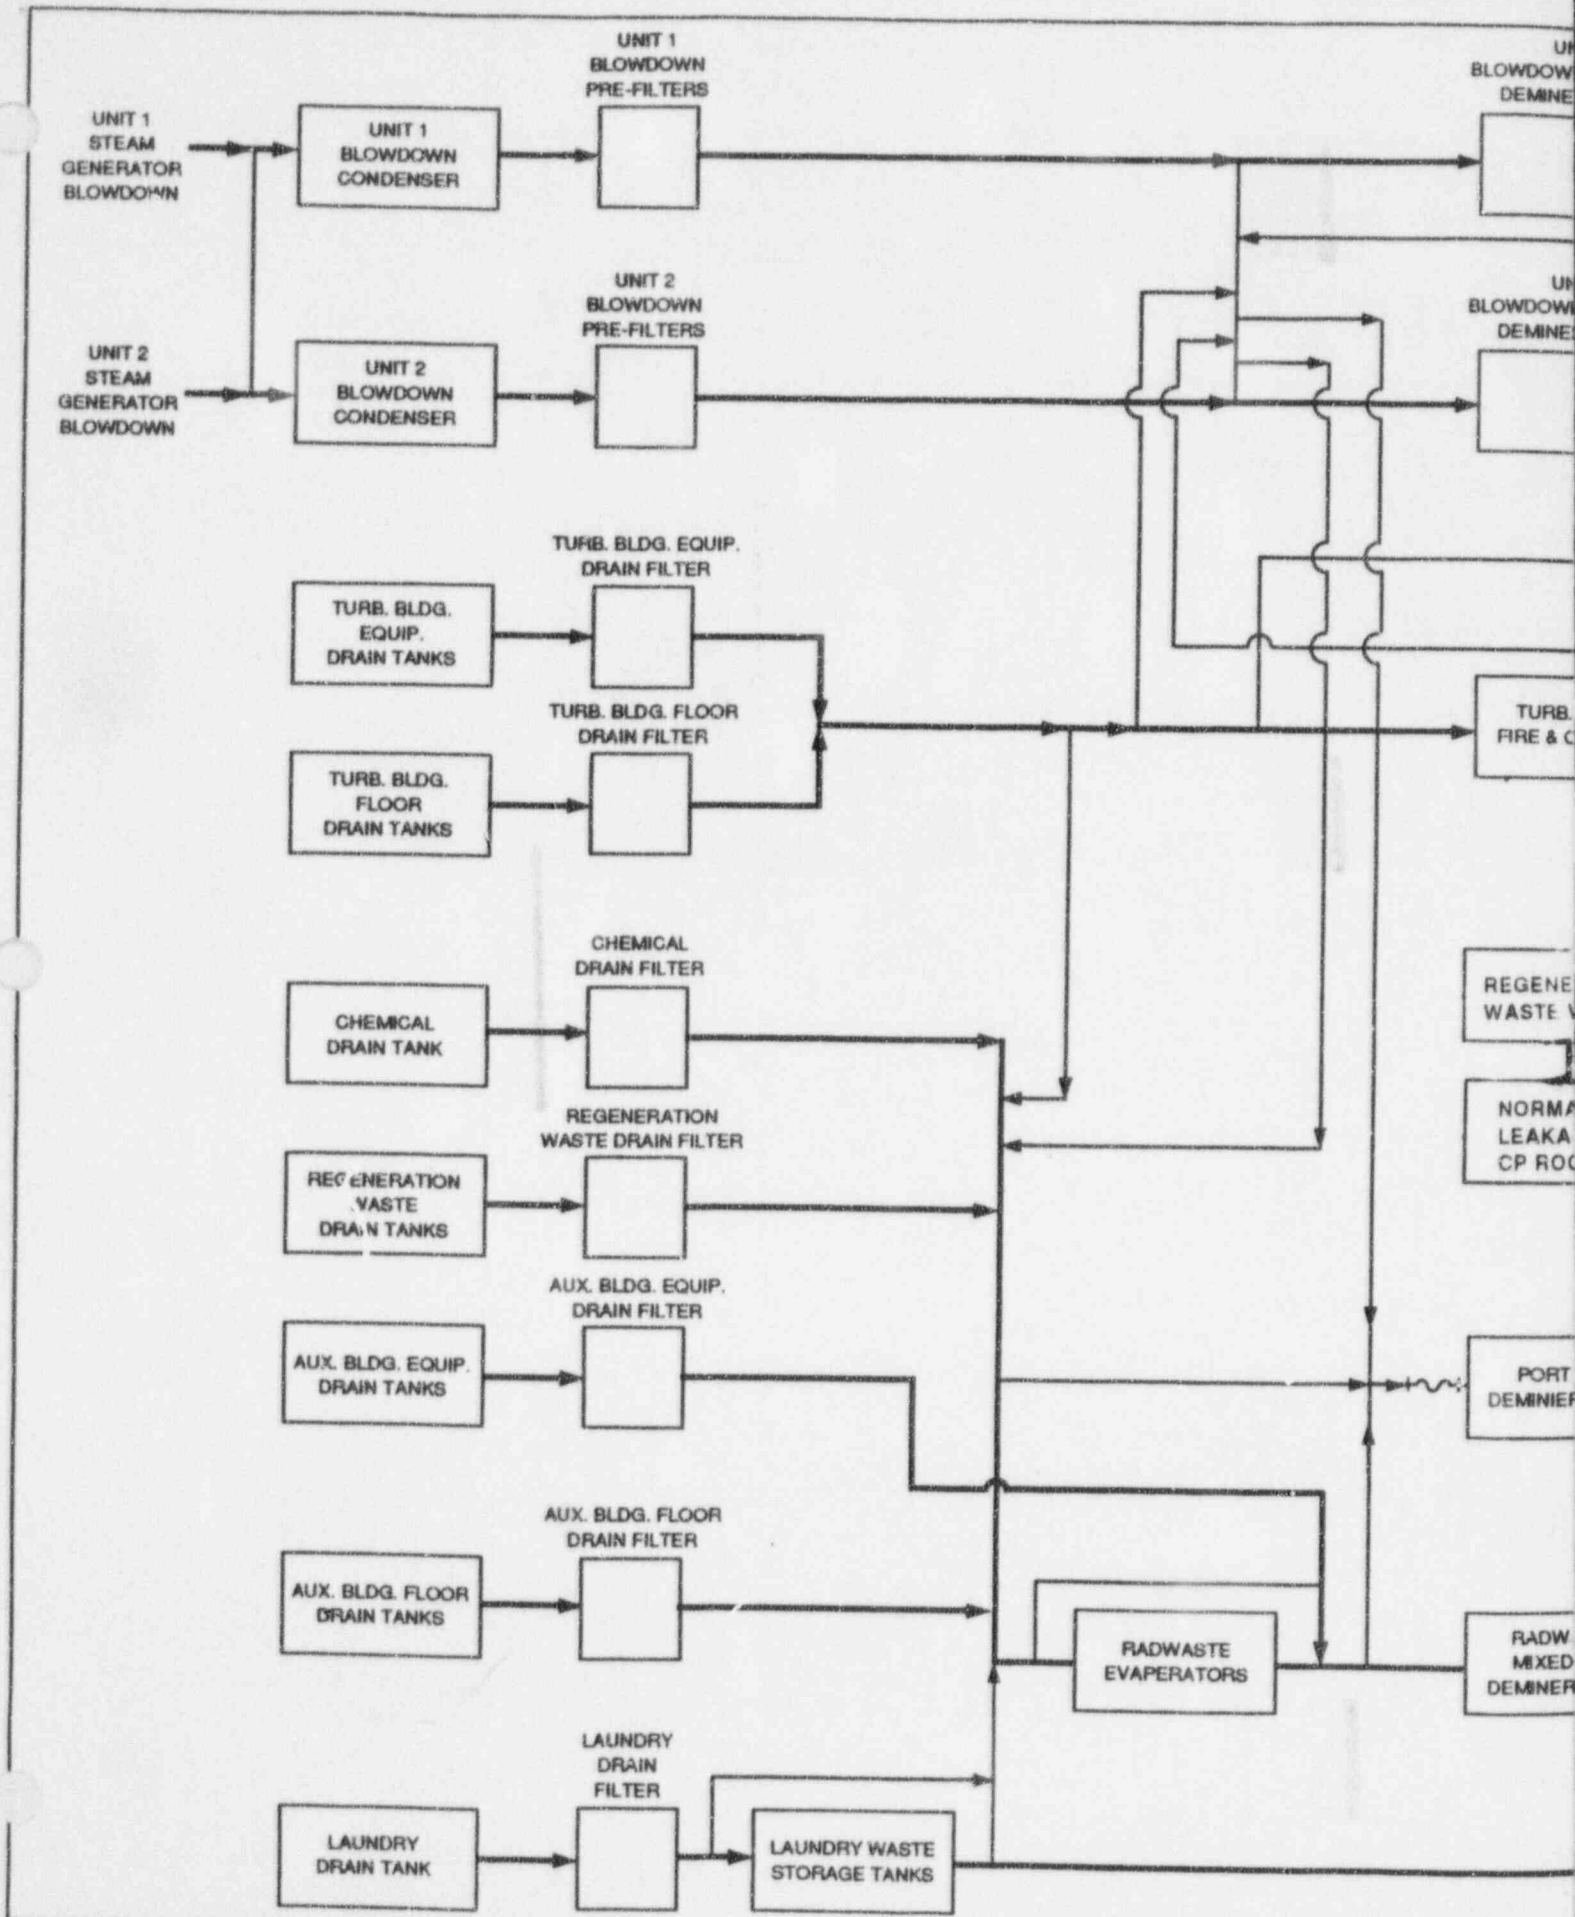

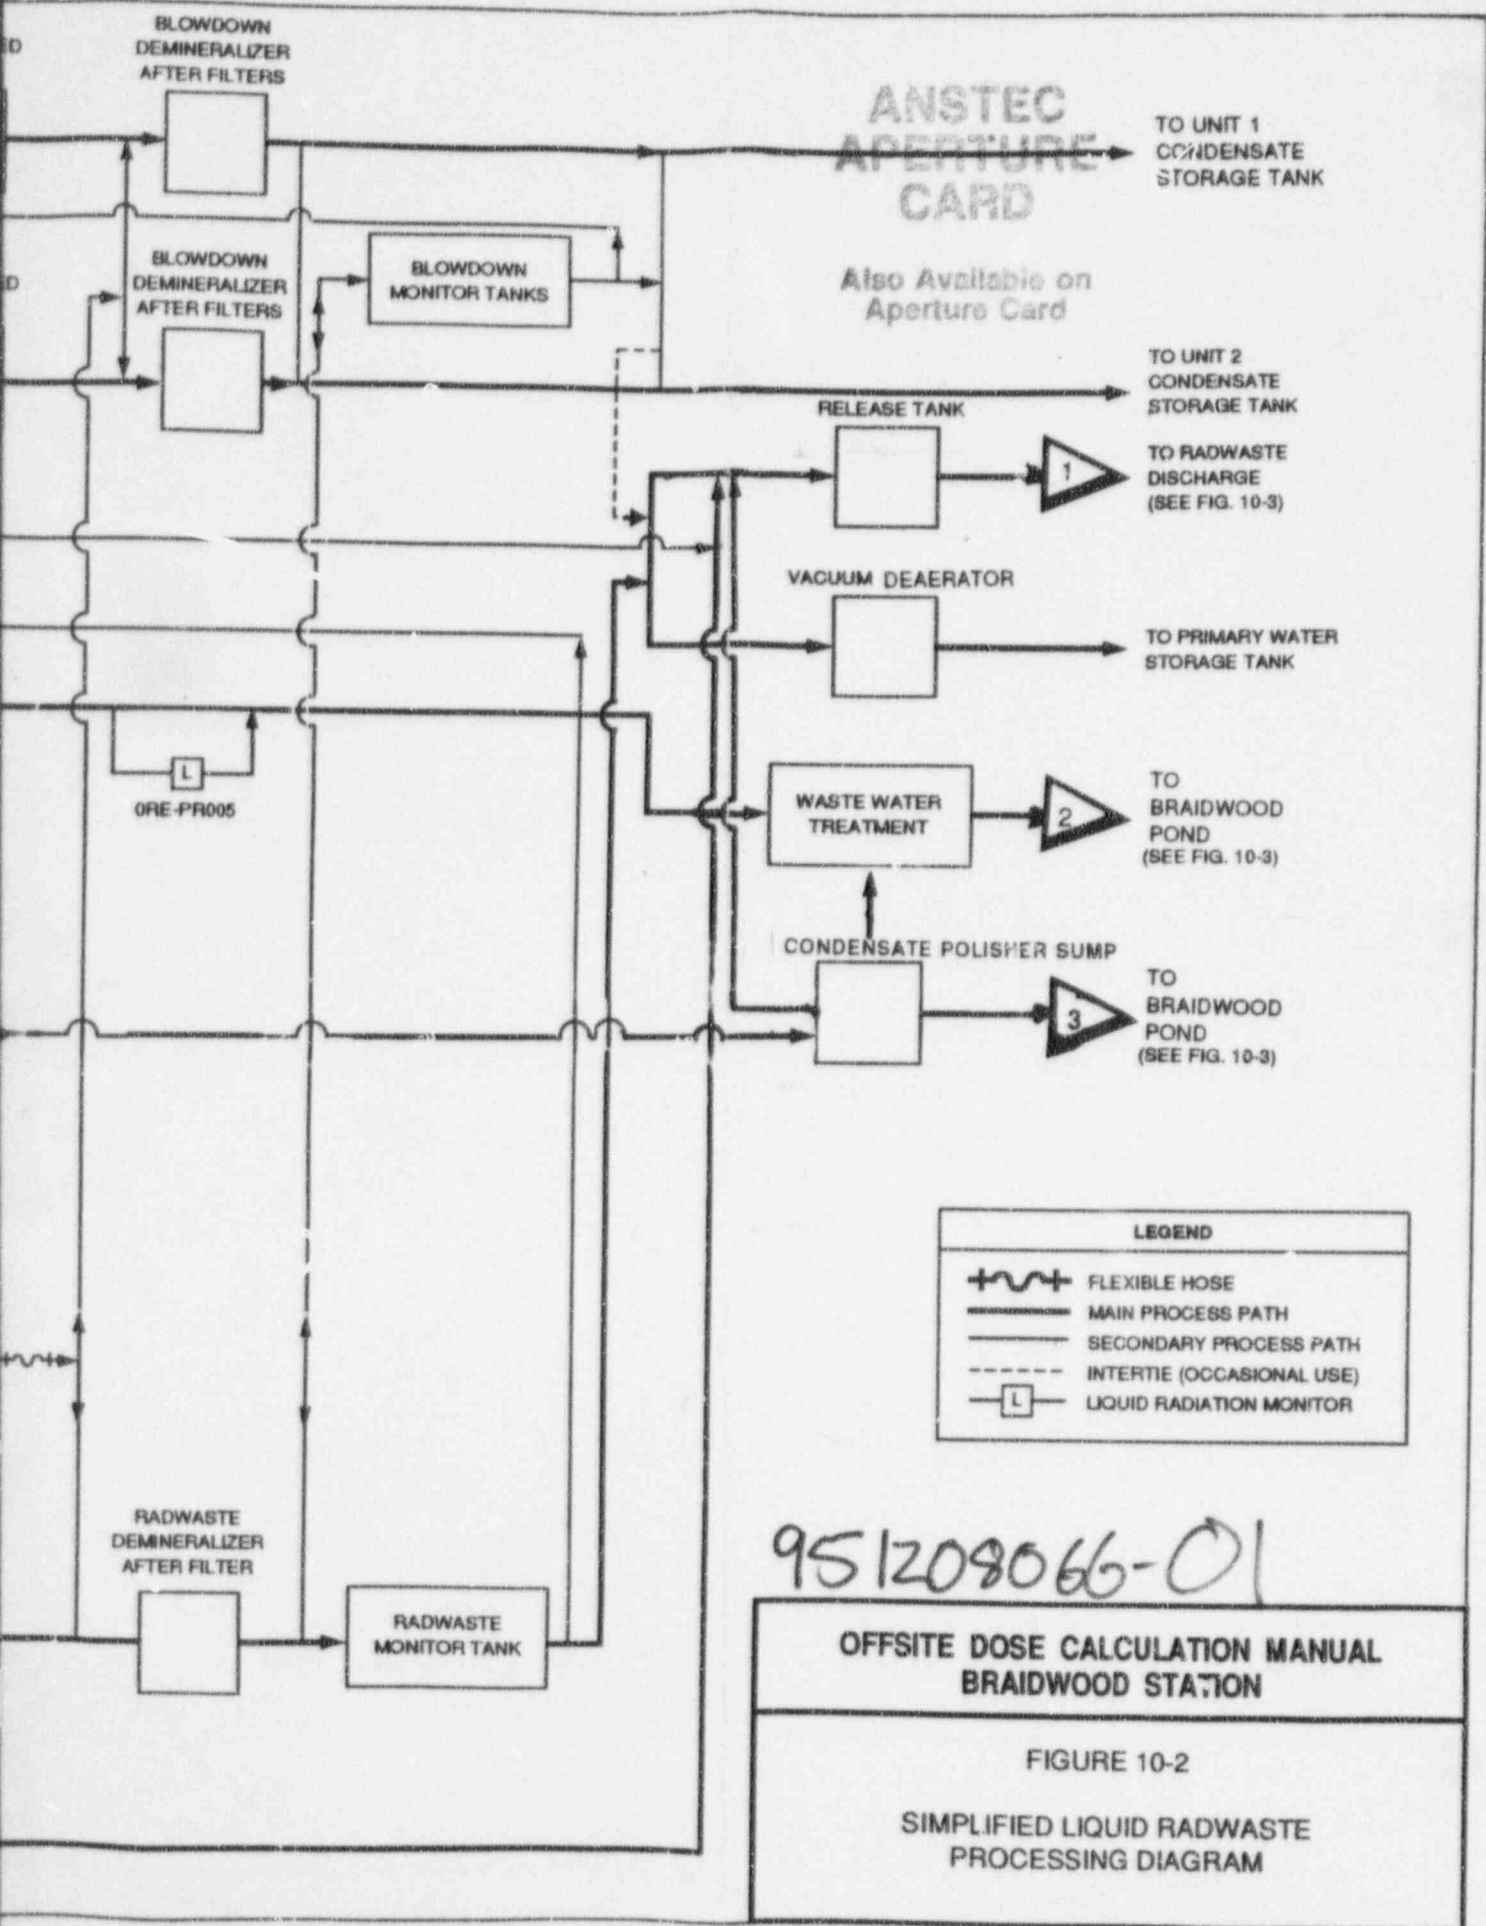


951208066-01

OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION


FIGURE 10-2

SIMPLIFIED LIQUID RADWASTE
PROCESSING DIAGRAM

BRAIDWOOD

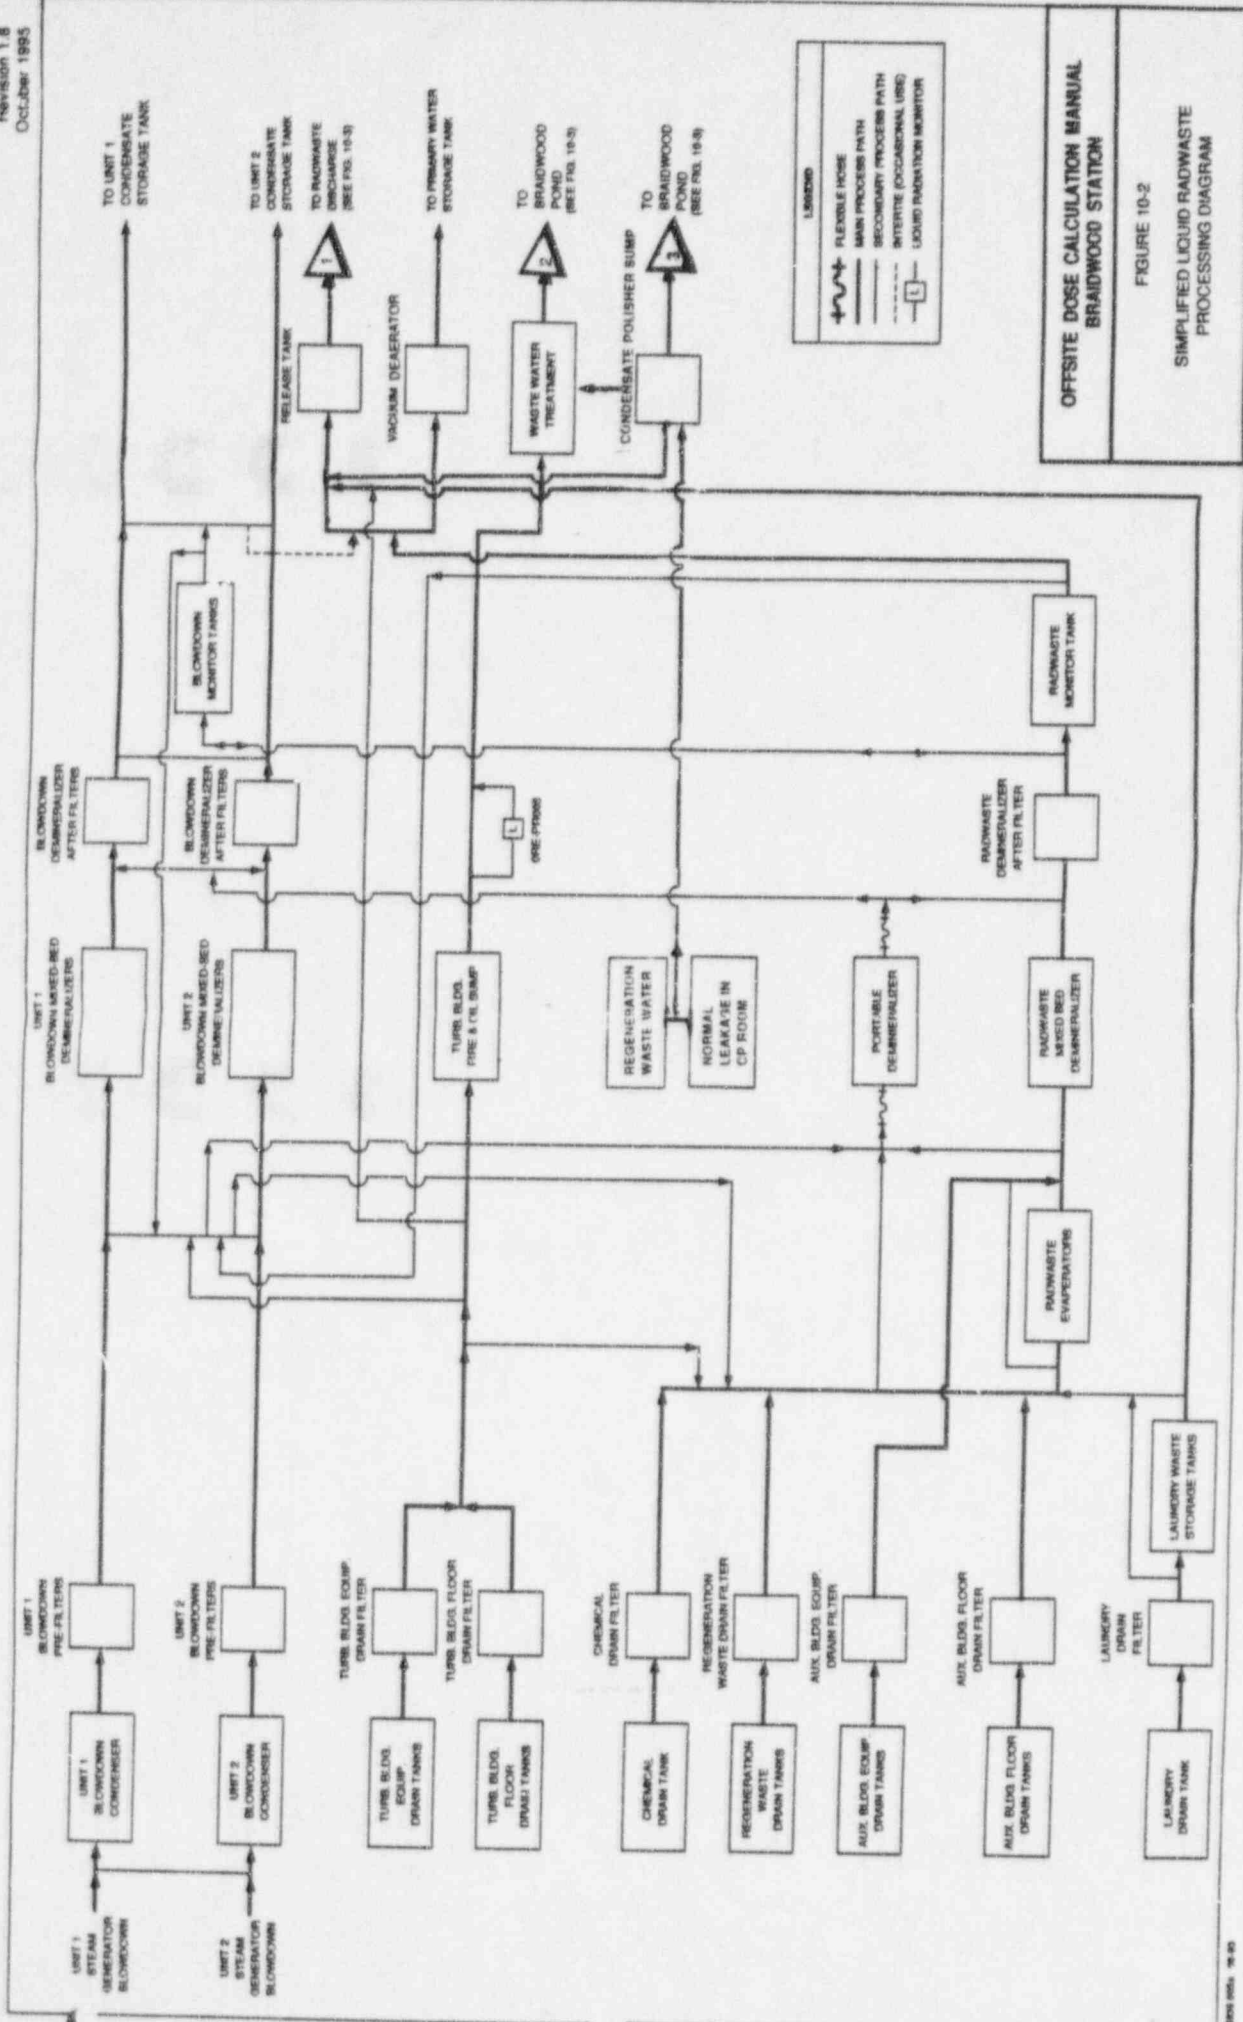

OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION
FIGURE 10-2
SIMPLIFIED LIQUID RADWASTE
PROCESSING DIAGRAM

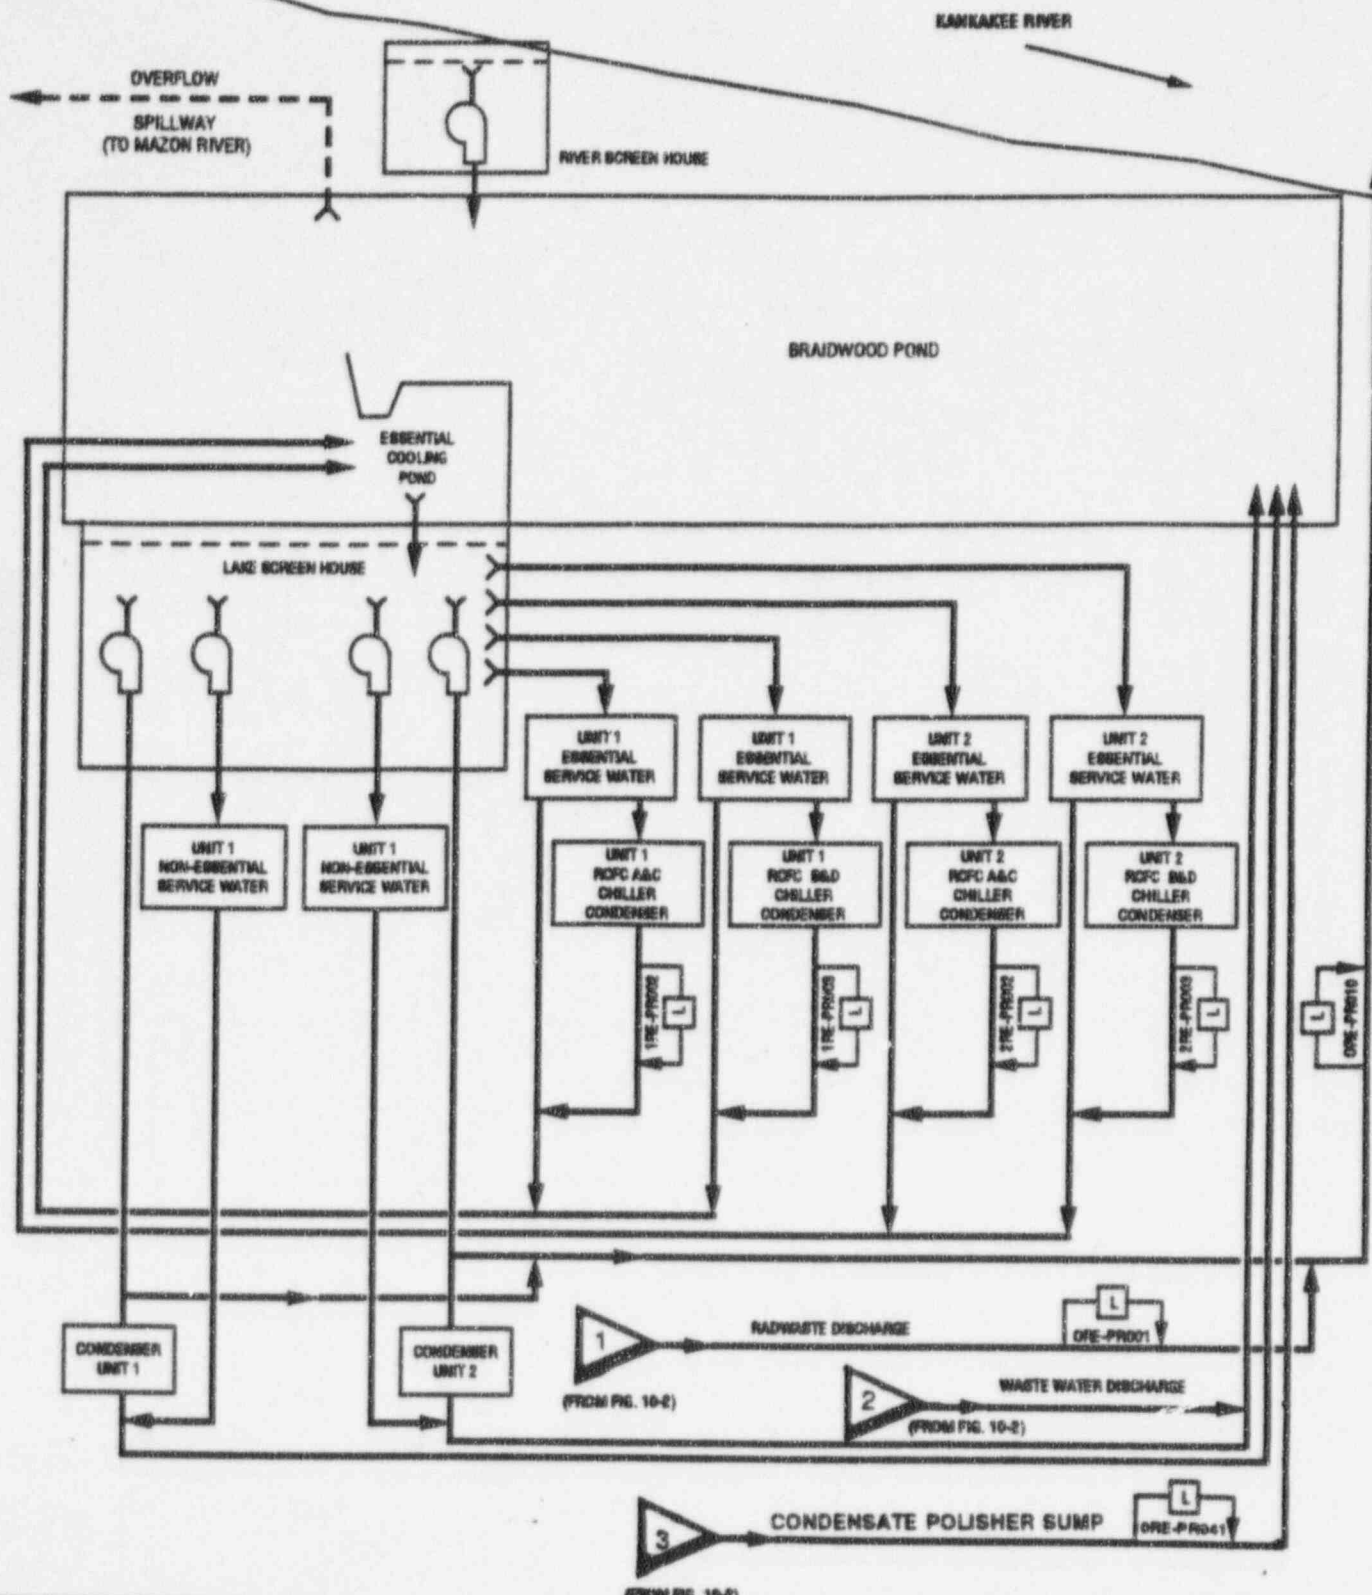

LEGEND AND NOTES


LIQUID RADIATION MONITOR

ROFC=REACTOR CONTAMINANT FAN COOLER IN EACH UNIT. ONLY THE A&C OR B&D CHILLER CONDENSERS ARE OPERATING AT ONE TIME.

**OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION**

FIGURE 10-3

**SIMPLIFIED LIQUID EFFLUENT
FLOW DIAGRAM**

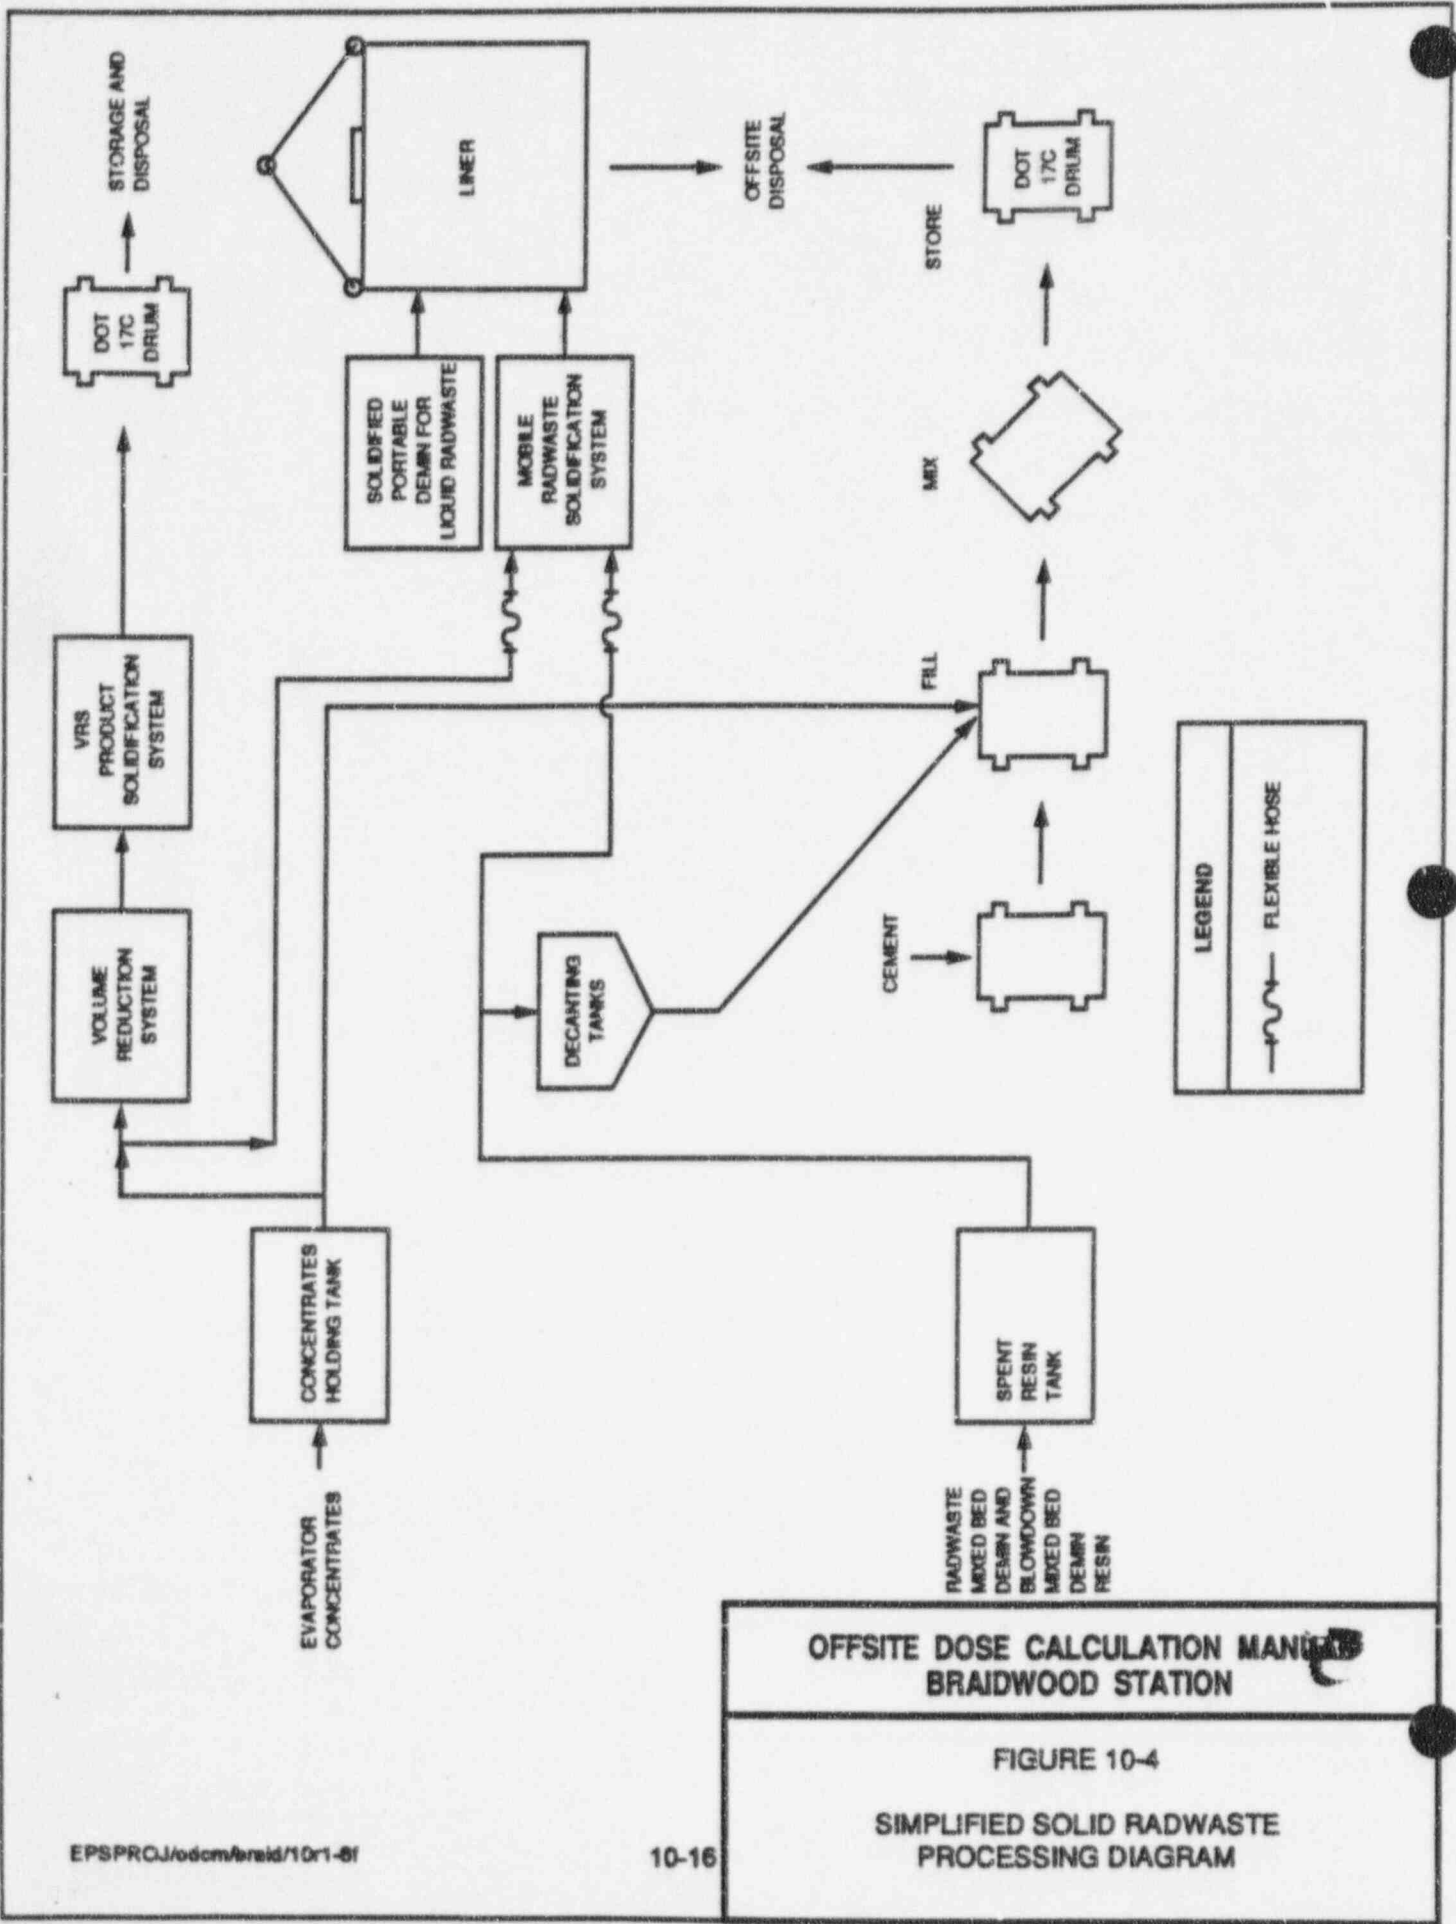

OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION

FIGURE 10-4

SIMPLIFIED SOLID RADWASTE
PROCESSING DIAGRAM

CHAPTER 11

Braidwood Annex Index

<u>Page</u>	<u>Revision</u>
11-i	1.8
11-ii	1.8
11-1	1.8
11-2	1.8
11-3	1.8
11-4	1.8
11-5	1.8
11-6	1.8
11-7	1.8
11-8	1.8
11-9	1.8
11-10	1.8
11-11	1.8

CHAPTER 11
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
Table of Contents

<u>CHAPTER</u>	<u>TITLE</u>	<u>PAGE</u>
11	Radiological Environmental Monitoring Program	11-1

LIST OF TABLES

<u>NUMBER</u>	<u>TITLE</u>	<u>PAGE</u>
11-1	Radiological Environmental Monitoring Program	11-2

LIST OF FIGURES

<u>NUMBER</u>	<u>TITLE</u>	<u>PAGE</u>
11-1	Fixed Air Sampling Sites and Outer Ring TLD Locations	11-9
11-2	Inner Ring TLD Locations	11-10
11-3	Ingestion and Waterborne Exposure Pathway Sample Locations	11-11

CHAPTER 11
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

- | Braidwood Station follows the Uniform Radiological Environmental monitoring Program which is
- | described in Chapter 9. This chapter identifies the site specific REMP for Braidwood Station.
- |
- | Supplemental tables describing reporting levels and LLDs are included within Chapter 9 and figures
- | generally denoting Braidwood Station sample locations are contained herein.

Table 11-1

Radiological Environmental Monitoring Program

Exposure Pathway and/or Sample	Sample or Monitoring Location	Sampling or Collection Frequency	Type and Frequency of Analysis
1. <u>Airborne</u> <u>Radioiodine and Particulates</u>	a. <u>Indicators-Near Field</u> BD-06, Godley, 0.5 mi WSW (0.8 km M) BD-19, Nearsite NW, 0.3 mi NW (0.5 km Q) BD-20, Nearsite N, 0.6 mi N (1.0 km A) BD-21, Nearsite NE, 0.5 mi NE (0.8 km C) b. <u>Indicators-Far Field</u> BD-02, Custer Park, 5.0 mi E (8.0 km E) BD-04, Essex, 4.8 mi SSE (7.7 km H) BD-05, Gardner, 5.5 mi SW (8.8 km L) c. <u>Controls</u> BD-03, County Line Road, 6.2 mi ESE (10.0 km F)	Continuous sampler operation with sample collection weekly, or more frequently if required by dust loading.	<u>Radioiodine Canisters:</u> I-131 analysis weekly on near field and control samples ¹ . <u>Particulate Sampler:</u> Gross beta analysis following weekly filter change ² and gamma isotopic analysis ³ quarterly on composite filters by location on near field and control samples.

Table 11-1 (Cont'd)
Radiological Environmental Monitoring Program

<u>Exposure Pathway and/or Sample</u>	<u>Sample or Monitoring Location</u>	<u>Sampling or Collection Frequency</u>	<u>Type and Frequency of Analysis</u>
2. <u>Direct Radiation</u>	a. <u>Indicators-Inner Ring</u> BD-101-3, 0.5 mi N (0.8 km A) BD-101-4, 0.5 mi N (0.8 km A) BD-102-1, 1.2 mi NNE (1.9 km B) BD-102-2, 1.1 mi NNE (1.8 km B) BD-103-1, 1.0 mi NE (1.6 km C) BD-103-2, 1.0 mi NE (1.6 km C) BD-104-1, 0.7 mi ENE (1.1 km D) BD-104-2, 0.7 mi ENE (1.1 km D) BD-105-1, 2.2 mi E (2.4 km E) BD-105-2, 2.2 mi E (2.4 km E) BD-106-1, 2.5 mi ESE (2.7 km F) BD-106-2, 2.5 mi ESE (2.7 km F) BD-107-1, 3.2 mi SE (3.2 km G) BD-107-2, 3.2 mi SE (3.2 km G) BD-108-1, 3.2 mi SSE (3.2 km H) BD-108-2, 3.2 mi SSE (3.2 km H) BD-109-1, 3.8 mi S (4.0 km J) BD-109-2, 3.8 mi S (4.0 km J) BD-110-1, 2.8 mi SSW (2.9 km K) BD-110-2, 2.8 mi SSW (2.9 km K) BD-111a-1, 1.4 mi SW (2.2 km L) BD-111a-2, 1.4 mi SW (2.2 km L) BD-112-1, 0.7 mi WSW (1.1 km M) BD-112-2, 0.7 mi WSW (1.1 km M) BD-113a-1, 0.5 mi W (0.8 km N) BD-113a-2, 0.5 mi W (0.8 km N) BD-114-1, 0.4 mi WNW (0.6 km P) BD-114-2, 0.4 mi WNW (0.6 km P) BD-115-1, 0.3 mi NW (0.5 km Q) BD-115-2, 0.3 mi NW (0.5 km Q) BD-116-1, 0.4 mi NNW (0.6 km R) BD-116-2, 0.5 mi NNW (0.8 km R)	Quarterly	Gamma dose on each TLD quarterly

Table 11-1 (Cont'd)

Radiological Environmental Monitoring Program

Exposure Pathway and/or Sample	Sample or Monitoring Location	Sampling or Collection Frequency	Type and Frequency of Analysis
2. Direct Radiation (Cont'd)	b. <u>Indicators</u> -Outer Ring BD-201-1, 4.2 mi N (6.8 km A) BD-201-2, 4.2 mi N (6.8 km A) BD-202-1, 4.8 mi NNE (7.7 km B) BD-202-2, 4.8 mi NNE (7.7 km B) BD-203-1, 4.9 mi NE (7.9 km C) BD-203-2, 4.9 mi NE (7.9 km C) BD-204-1, 4.3 mi ENE (6.9 km D) BD-204-2, 4.3 mi ENE (6.9 km D) BD-205-1, 4.0 mi E (6.4 km E) BD-205-2, 4.0 mi E (6.4 km E) BD-206-1, 4.5 mi ESE (7.2 km F) BD-206-2, 4.5 mi ESE (7.2 km F) BD-207-1, 4.5 mi SE (6.6 km G) BD-207-2, 4.5 mi SE (6.6 km G) BD-208-1, 4.5 mi SSE (7.2 km H) BD-208-2, 4.5 mi SSE (7.2 km H) BD-209-1, 4.8 mi S (7.7 km J) BD-209-2, 4.8 mi S (7.7 km J) BD-210-1, 4.9 mi SSW (7.9 km K) BD-210-2, 4.9 mi SSW (7.9 km K) BD-211-1, 4.8 mi SW (7.7 km L) BD-211-2, 4.8 mi SW (7.7 km L) BD-212-3, 5.0 mi WSW (8.0 km M) BD-212-4, 5.0 mi WSW (8.0 km M) BD-213-3, 4.8 mi W (7.7 km N) BD-213-4, 4.8 mi W (7.7 km N) BD-214-1, 4.3 mi WNW (6.9 km P) BD-214-2, 4.3 mi WNW (6.9 km P) BD-215-1, 4.5 mi NW (7.2 km Q) BD-215-2, 4.5 mi NW (7.2 km Q) BD-216-1, 4.0 mi NNW (7.1 km R) BD-216-2, 4.0 mi NNW (7.1 km R)		

Table 11-1 (Cont'd)

Radiological Environmental Monitoring Program

Exposure Pathway and/or Sample	Sample or Monitoring Location	Sampling or Collection Frequency	Type and Frequency of Analysis
<p>2. Direct Radiation (Cont'd)</p>	<p>c. <u>Other</u></p> <p><u>Indicators</u></p> <p>One at each of the airborne location given in part 1.a and 1.b.</p> <p>BD-305-1, Fossil Hunting Area, 0.4 mi E (0.64 km E) BD-305-2, Braidwood Pond Access, 1.0 mi E (1.6 km E) BD-309, Braidwood Pond Access, 2.7 mi S (4.3 km J)</p> <p>d. <u>Controls</u></p> <p>One at each airborne control location given in part 1.c.</p>		

Table 11-1 (Cont'd)

Radiological Environmental Monitoring Program

Exposure Pathway and/or Sample	Sample or Monitoring Location	Sampling or Collection Frequency	Type and Frequency of Analysis
3. <u>Waterborne</u>			
a. <u>Ground/Well</u>	a. <u>Indicators</u> BD-13, Braidwood City Hall Well, 1.7 mi NNE (2.7 km B) BD-34, Gibson Well, 4.7 mi E (7.6 km E) BD-35, Joly Well, 4.7 mi E (7.6 km E) BD-36, Hutton Well, 4.7 mi E (7.6 km E) BD-37, Nurczyk Well, 4.7 mi E (7.6 km E)	Quarterly	Gamma isotopic ³ and tritium analysis quarterly.
b. <u>Drinking Water</u>	a. <u>Indicator</u> BD-22, Wilmington, 5.0 mi NE (8.0 km C)	Weekly grab sample	Gross beta and gamma isotopic analysis ³ on monthly composite; tritium analysis on quarterly composite.
c. <u>Surface Water</u>	a. <u>Indicator</u> BD-10, Kankakee River downstream of discharge, 5.4 mi NE (8.0 km C)	Weekly grab sample	Gross beta and gamma isotopic analysis ³ on monthly composite; tritium and analysis on quarterly composite.
d. <u>Control</u>	a. <u>Control</u> BD-25, Kankakee River upstream of discharge, 9.6 mi E (15.4 km E)	Weekly grab sample	Gross beta and gamma isotopic analysis ³ on monthly composite; tritium and analysis on quarterly composite.
e. <u>Sediments</u>	a. <u>Indicators</u> BD-10, Kankakee River downstream of discharge, 5.4 mi E (8.0 km C)	Semiannually	Gamma isotopic analysis ³ semiannually.


Table 11-1 (Cont'd)
Radiological Environmental Monitoring Program

Exposure Pathway and/or Sample	Sample or Monitoring Location	Sampling or Collection Frequency	Type and Frequency of Analysis
<p>4. <u>Ingestion</u></p> <p>a. <u>Milk</u></p> <p>b. <u>Fish</u></p> <p>c. <u>Food Products</u></p>	<p>a. <u>indicators</u></p> <p>BD-17, Halpin's Dairy, 5.5 mi SSW (8.8 km K)</p> <p>b. <u>Controls</u></p> <p>BD-24, Goodwin Dairy, 7.4 mi E (11.9 km E)</p> <p>a. <u>Indicator</u></p> <p>BD-28, Kankakee River in discharge area, 5.4 mi E (8.7 km E)</p> <p>b. <u>Control</u></p> <p>BD-25, Kankakee River upstream of discharge area, 9.6 mi E (15.4 km E)</p> <p>a. <u>Indicators</u></p> <p>Two sample locations within 6.2 mi.</p> <p>Sample locations for food products may vary based on availability and therefore are not required to be identified here but shall be taken. Samples have been taken previously at the following locations.</p> <p>BD-14, Pinnick Farm, 1.8 mi N (2.9 km A) BD-15, Girot Farm, 1.4 mi NNE (2.2 km B) BD-16, Clark Farm, 3.3 mi ENE (5.5 km D)</p> <p>b. <u>Controls</u></p> <p>Two samples within 9.3 to 13.6 mi.</p>	<p>Biweekly: May through October or monthly: November through April</p> <p>Two times annually</p> <p>Three times annually.</p>	<p>Gamma isotopic³ and I-131 analysis⁴ biweekly May through October, monthly November through April.</p> <p>Gamma isotopic analysis³ on edible portions</p> <p>Gamma isotopic analysis³ on edible portions.</p>

Table 11-1 (Cont'd)

Radiological Environmental Monitoring Program

- ¹ Far field samples are analyzed when near field results are inconsistent with previous measurements and radioactivity is confirmed as having its origin in airborne effluents released from the station, or at the discretion of the Health Physics Support Director.
- ² Airborne particulate sample filters shall be analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples is greater than 10 times the yearly mean of control samples, gamma isotopic analysis shall be performed on the individual samples.
- ³ Gamma isotopic analysis means the identification and quantification of gamma emitting radionuclides that may be attributable to the effluents from the station.
- ⁴ I-131 analysis means the analytical separation and counting procedure are specific for this radionuclide.

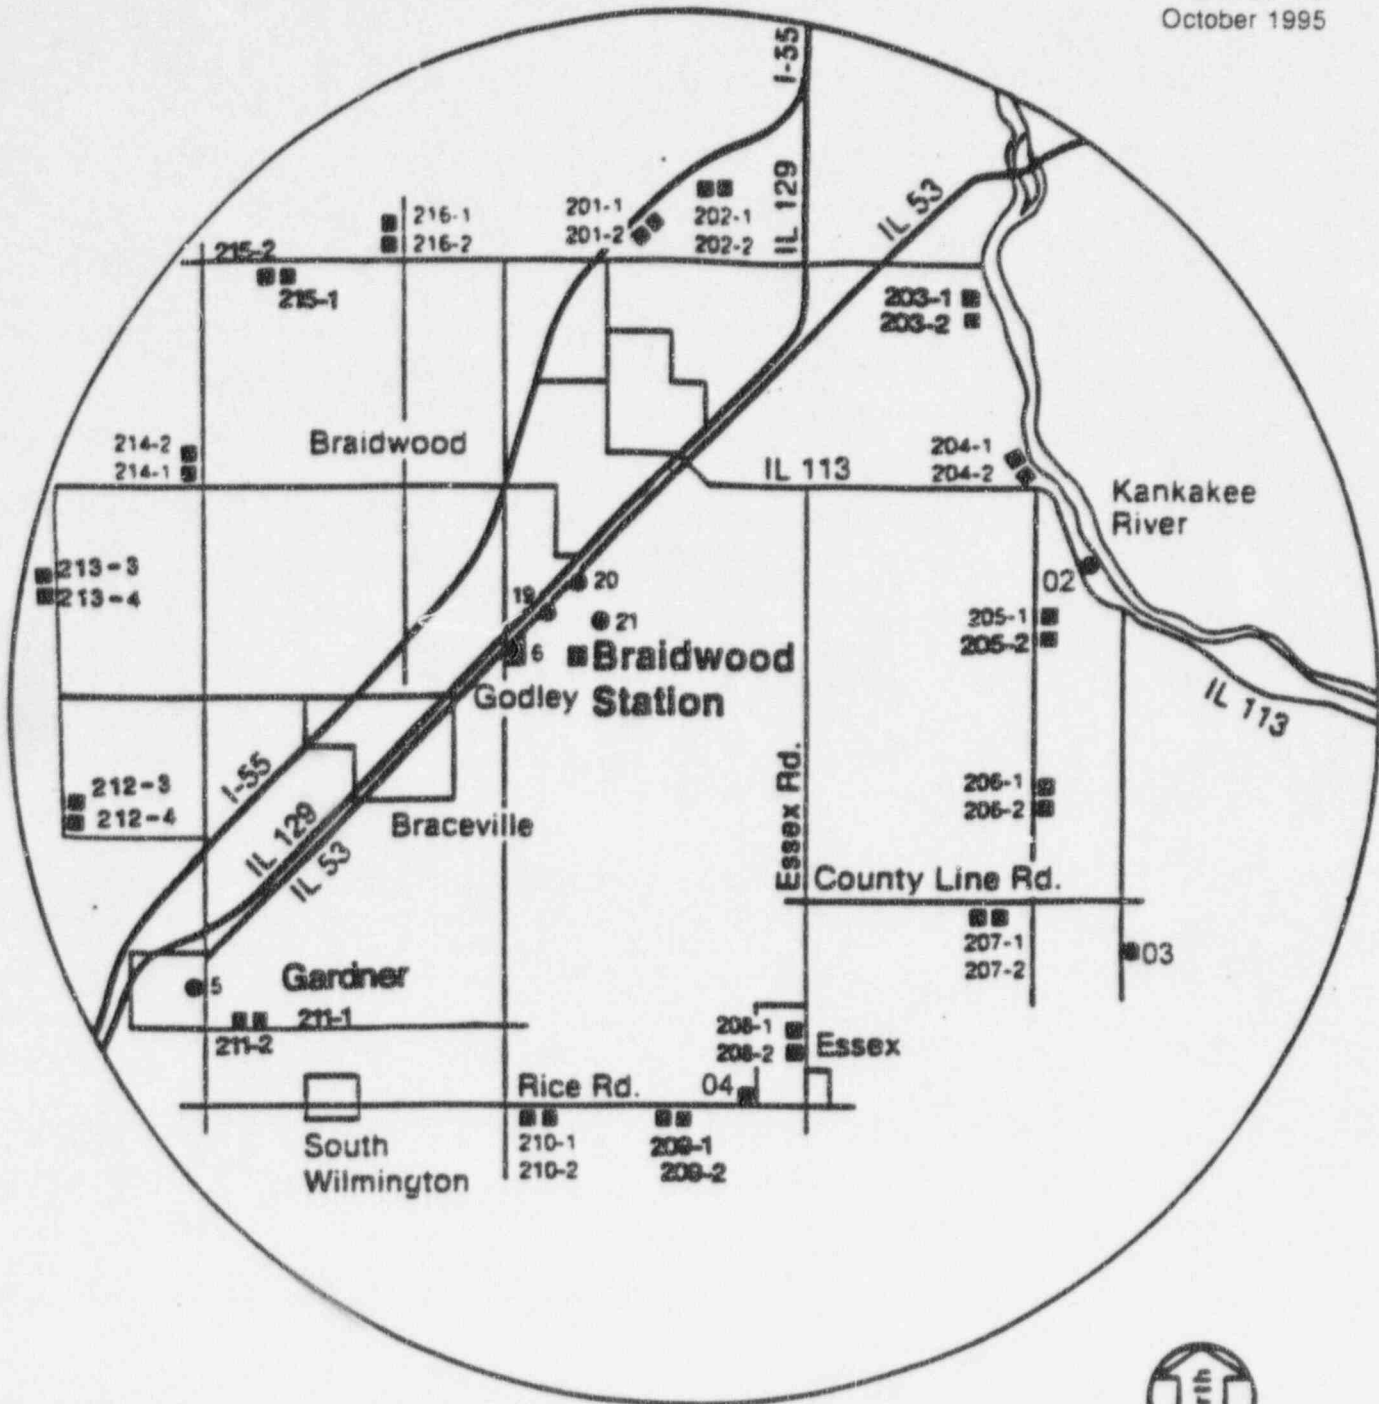

Scale




- Air Sampling Location
- TLD Location
- Braidwood Station

**OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION**

FIGURE 11-1


**FIXED AIR SAMPLING SITES AND
OUTER RING TLD LOCATIONS**

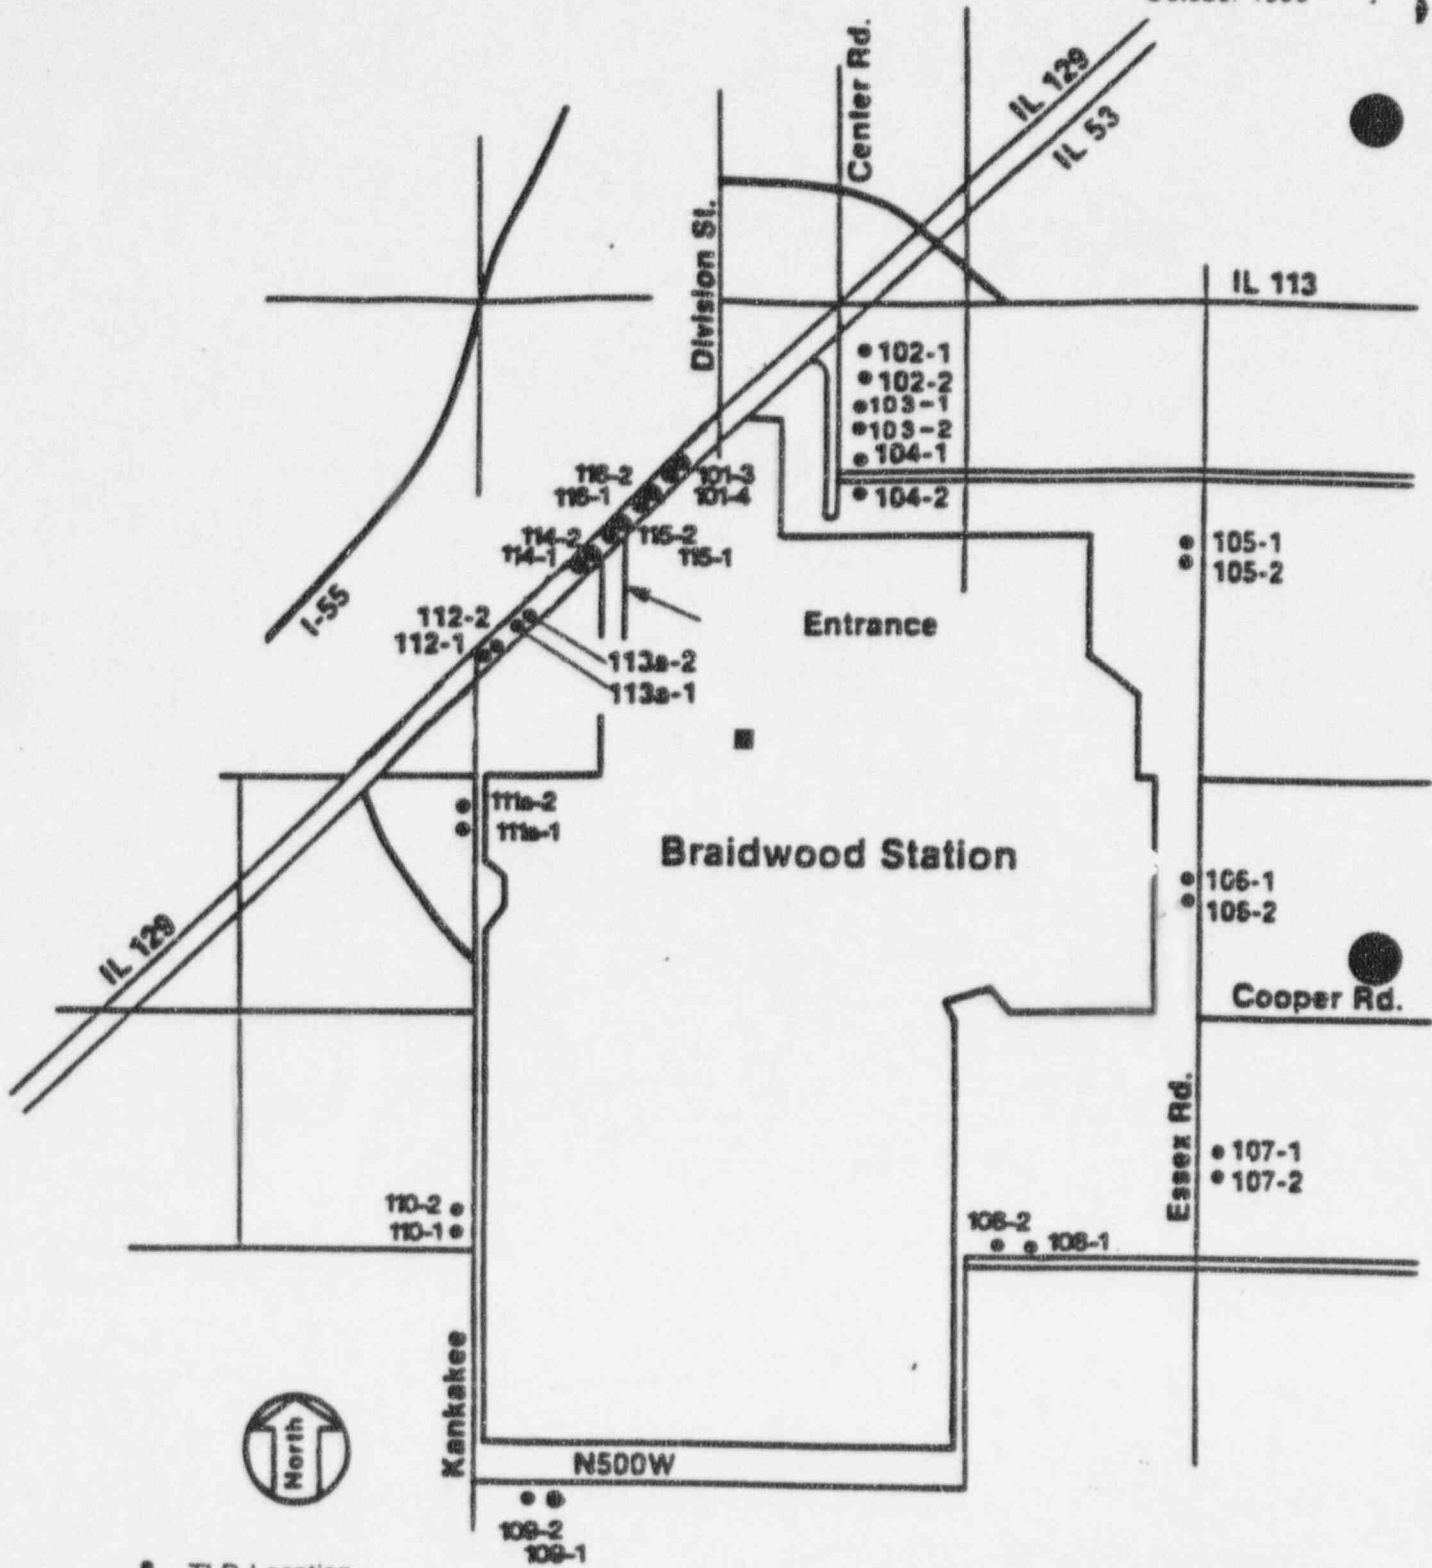

• TLD Location

■ Braidwood Station

Scale




EPSPROJ/odcm/braid/11r1-6f


**OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION**

FIGURE 11-2

INNER RING TLD LOCATIONS

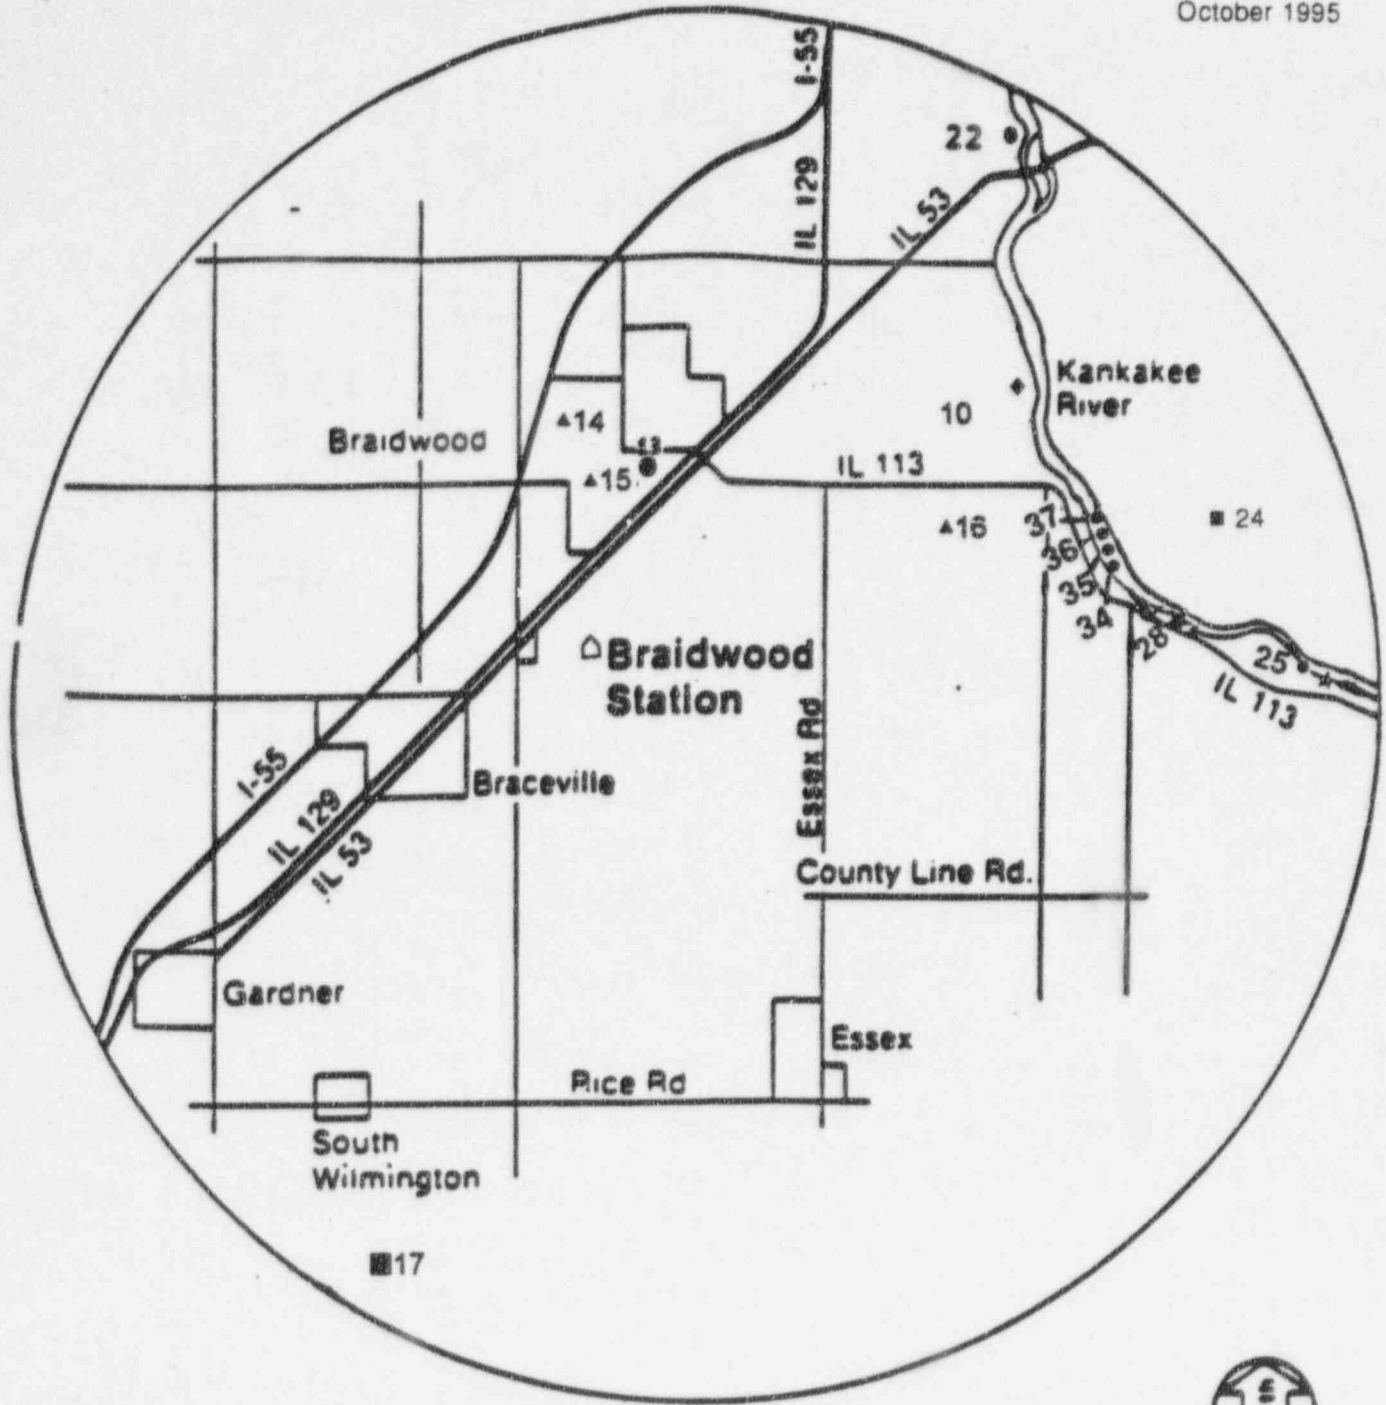

Scale

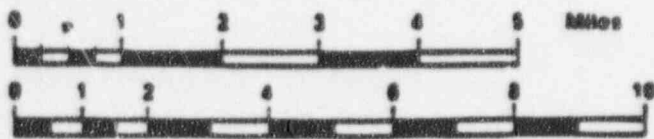

- ★ Fish
- Milk
- ◆ Sediment
- ▲ Vegetables
- Water
- △ Braidwood Station



**OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION**

FIGURE 11-3

**INGESTION AND WATERBORNE EXPOSURE
PATHWAY SAMPLE LOCATIONS**

CHAPTER 12.0

SPECIAL NOTE

The transfer of the Radiological Effluent Technical Specifications to the ODCM by Technical Specification, Amendment 35, dated April 13, 1992, was approved by the Nuclear Regulatory Commission.

CHAPTER 12

ANNEX INDEX

<u>PAGE</u>	<u>REVISION</u>	<u>PAGE</u>	<u>REVISION</u>
12 - i	1.8	12 - 40	1.8
12 - ii	1.8	12 - 41	1.8
12 - iii	1.8	12 - 42	1.8
12 - iv	1.8	12 - 43	1.8
12 - 1	1.8	12 - 44	1.8
12 - 2	1.8	12 - 45	1.8
12 - 3	1.8	12 - 46	1.8
12 - 4	1.8	12 - 47	1.8
12 - 5	1.8	12 - 48	1.8
12 - 6	1.8	12 - 49	1.8
12 - 7	1.8	12 - 50	1.8
12 - 8	1.8	12 - 51	1.8
12 - 9	1.8	12 - 52	1.8
12 - 10	1.8		
12 - 11	1.8		
12 - 12	1.8		
12 - 13	1.8		
12 - 14	1.8		
12 - 15	1.8		
12 - 16	1.8		
12 - 17	1.8		
12 - 18	1.8		
12 - 19	1.8		
12 - 20	1.8		
12 - 21	1.8		
12 - 22	1.8		
12 - 23	1.8		
12 - 24	1.8		
12 - 25	1.8		
12 - 26	1.8		
12 - 27	1.8		
12 - 28	1.8		
12 - 29	1.8		
12 - 30	1.8		
12 - 31	1.8		
12 - 32	1.8		
12 - 33	1.8		
12 - 34	1.8		
12 - 35	1.8		
12 - 36	1.8		
12 - 37	1.8		
12 - 38	1.8		
12 - 39	1.8		

CHAPTER 12**RADIOACTIVE EFFLUENT TECHNICAL STANDARDS
(RETS)
TABLE OF CONTENTS**

	<u>PAGE</u>
12.0 RADIOLOGICAL EFFLUENT TECHNICAL STANDARDS	12-1
12.1 DEFINITIONS	12-4
12.2 INSTRUMENTATION	12-8
1. Radioactive Liquid Effluent Monitoring Instrumentation	12-8
2. Radioactive Gaseous Effluent Monitoring Instrumentation	12-13
12.3 LIQUID EFFLUENTS	12-20
1. Concentration	12-20
2. Dose	12-27
3. Liquid Radwaste Treatment System	12-29
12.4 GASEOUS EFFLUENTS	12-31
1. Dose Rate	12-31
2. Dose - Noble Gases	12-37
3. Dose - Iodine-131 and 133, Tritium, and Radioactive Material in Particulate Form	12-39
4. Gaseous Radwaste Treatment System	12-41
5. Total Dose	12-43
6. Dose Limits for Members of the Public	12-45
12.5 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM	12-46
1. Monitoring Program	12-46
2. Land Use Census	12-47
3. Interlaboratory Comparison Program	12-48
12.6 REPORTING REQUIREMENTS	12-49
1. Annual Radiological Environmental Operating Report	12-49
2. Annual Radioactive Effluent Release Report	12-50
3. Offsite Dose Calculation Manual (ODCM)	12-51
4. Major Changes to Liquid and Gaseous Radwaste Treatment Systems	12-52

CHAPTER 12**RADIOACTIVE EFFLUENT TECHNICAL STANDARDS
(RETS)
LIST OF TABLES**

		<u>PAGE</u>
12.0-1	Effluent Compliance Matrix	12-2
12.0-2	REMP Compliance Matrix	12-3
12.1-1	Frequency Notations	12-7
12.2-1	Radioactive Liquid Effluent Monitoring Instrumentation	12-9
12.2-2	Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements	12-11
12.2-3	Radioactive Gaseous Effluent Monitoring Instrumentation	12-14
12.2-4	Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements	12-15
12.3-1	Radioactive Liquid Waste Sampling and Analysis Program	12-20
12.4-1	Radioactive Gaseous Waste Sampling and Analysis Program	12-31
12.5-1	Radiological Environmental Monitoring Program	12-45
12.5-2	Reporting Levels for Radioactivity Concentrations in Environmental Samples	12-51
12.5-3	Detection Capabilities for Environmental Sample Analysis	12-52

12.0 RADIOLOGICAL EFFLUENT TECHNICAL STANDARDS

Chapter 12 of the Braidwood Station ODCM is a compilation of the various regulatory requirements, surveillance and bases, commitments and/or components of the radiological effluent and environmental monitoring programs for Braidwood Station. To assist in the understanding of the relationship between effluent regulations, ODCM equations, RETS (Chapter 12 section) and related Technical Specification requirements, Table 12.0-1 is a matrix which relates these various components. The Radiological Environmental Monitoring Program fundamental requirements are contained within this chapter and are explained programmatically in Chapter 9 with Braidwood specific information in Chapter 11 and with a supplemental matrix in Table 12.0-2.

Table 12.0-1

EFFLUENT COMPLIANCE MATRIX

Regulation	Dose Component Limit	ODCM Equation	RETS	Technical Specification
10 CFR 50 Appendix I	1. Gamma air dose and beta air dose due to airborne radioactivity in effluent plume.	A-1 A-2	12.4.2	6.8.4.e.8
	a. Whole body and skin dose due to airborne radioactivity in effluent plume are reported only if certain gamma and beta air dose criteria are exceeded.	A-6 A-7	N/A	N/A
	2. CDE for all organs and all four age groups due to iodines and particulates in effluent plume. All pathways are considered.	A-13	12.4.3	6.8.4.e.9
	3. CDE for all organs and all four age groups due to radioactivity in liquid effluents.	A-29	12.3.2	6.8.4.e.4
10 CFR 20	1. TEDE, totaling all deep dose equivalent components (direct, ground and plume shine) and committed effective dose equivalents (all pathways, both airborne and liquid-borne). CDE evaluation is made for adult only using FGR 11 data base.	A-38	12.4.6	6.8.4.e.3
40 CFR 190 (now by reference, also part of 10 CFR 20)	1. Whole body dose (DDE) due to direct dose, ground and plume shine from all sources at a station.	A-35	12.4.5	6.8.4.e.10
	2. Organ doses (CDE) to an adult due to all pathways.	A-13		
Technical Specifications	1. "Instantaneous" whole body (DDE), skin (SDE), and organ (CDE) dose rates to an adult due to radioactivity in airborne effluents. For the organ dose, only inhalation is considered.	A-8 A-9 A-28	12.4.1	6.8.4.e.7
	2. "Instantaneous" concentration limits for liquid effluents.	A-32	12.3.1	6.8.4.e.2
Technical Specifications	1. Radiological Effluent Release Report	NA	12.6.2	6.9.1.7

Table 12.0-2

REMP Compliance Matrix

Regulation	Component	RETS	Technical Specification
10CFR50 Appendix I Section IV.B.2	Implement environmental monitoring program.	12.5.1	6.8.4.f
Technical Specifications	Land Use Census	12.5.2	6.8.4.1.2
Technical Specifications	Interlaboratory Comparison Program	12.5.3	6.8.4.1.3
Technical Specifications	Radiological Environmental Operating Report	12.6.1	6.9.1.6

12.0 RADIOLOGICAL EFFLUENT TECHNICAL STANDARDS12.1 DEFINITIONS

- 12.1.1 Action shall be that which prescribes remedial measures required under designated conditions.
- 12.1.2 Analog Channel Operational Test shall be the injection of a simulated signal into the channel as close to the sensor as practicable to verify OPERABILITY of alarm, interlock and/or trip functions. The ANALOG CHANNEL OPERATIONAL TEST shall include adjustments, as necessary, of the alarm interlock and/or Trip Setpoints such that the Setpoints are within the required range and accuracy.
- 12.1.3 Channel Calibration shall be the adjustment, as necessary, of the channel such that it responds within the required range and accuracy to known values of input. The CHANNEL CALIBRATION shall encompass the entire channel including the sensors and alarm, interlock and/or trip functions and may be performed by any series of sequential, overlapping, or total channel steps such that the entire channel is calibrated.
- 12.1.4 Channel Check shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.
- 12.1.5 Digital Channel Operational Test shall consist of exercising the digital computer hardware using data base manipulation and injecting simulated process data to verify OPERABILITY of alarm and/or trip functions.
- 12.1.6 Dose Equivalent I-131 shall be that connection of I-131 (microCurie/gram) which alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table III of TID-14844, "Calculation of Distance Factors for Power and Test Reactor Sites".
- 12.1.7 Frequency - Table 12.1-1 provides the definitions of various frequencies for which surveillance, sampling, etc. are performed unless defined otherwise. The 25% variance shall not be applied to Operability Action statements. The bases to Technical Specification 4.0.2 provide clarifications to this requirement.
- 12.1.8 Member(s) of the Public means any individual except when that individual is receiving an occupational dose.
- 12.1.9 Occupational Dose means the dose received by an individual in the course of employment in which the individual's assigned duties involve exposure to radiation and/or to radioactive material from licensed and unlicensed sources of radiation, whether in the possession of the licensee or other person. Occupational dose does not include dose from background radiation as a patient from medical practices, from voluntary participation in medical research programs, or as a member of the public.

- 12.1.10 Operable/Operability a system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its function(s) are also capable of performing their related support function(s).
- 12.1.11 Operational Mode (i.e. Mode) shall correspond to any one inclusive combination of core reactivity condition, power level, and average reactor coolant temperature specified in Table 1.2 of the Technical Specifications.
- 12.1.12 Process Control Program (PCP) shall contain the current formulas, sampling, analyses, tests, and determinations to be made to ensure that processing and packaging of solid radioactive wastes based on demonstrated processing of actual or simulated wet solid wastes will be accomplished in such a way as to assure compliance with 10 CFR Parts 20, 61, 71 and State regulations, burial ground requirements, and other requirements governing the disposal of radioactive wastes.
- 12.1.13 Purge/Purging shall be any controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.
- 12.1.14 Rated Thermal Power shall be a total core heat transfer rate to the reactor coolant of 3411 MWt.
- 12.1.15 Site Boundary shall be that line beyond which the land is neither owned, nor leased, nor otherwise controlled by the licensee.
- 12.1.16 Solidification shall be the conversion of wet wastes into a form that meets shipping and burial ground requirements.
- 12.1.17 Source Check shall be the qualitative assessment of channel response when the channel sensor is exposed to a source of increased radioactivity.
- 12.1.18 Thermal Power shall be the total core heat transfer rate to the reactor coolant.
- 12.1.19 Unrestricted Area means an area, access to which is neither limited nor controlled by the licensee.
- 12.1.20 Ventilation Exhaust Treatment System shall be any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment. Such a system is not considered to have any effect on noble gas effluents. Engineered Safety Features Atmospheric Cleanup Systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.
- 12.1.21 Venting shall be any controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent, used in system names, does not imply a VENTING process.

- 12.1.22 Waste Gas Holdup System shall be any system designed and installed to reduce radioactive gaseous effluents by collecting Reactor Coolant System off-gases from the Reactor Coolant System and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.
- 12.1.23 Definitions Peculiar to Estimating Dose to Members of the Public using the ODCM Computer Program.
- a. ACTUAL - ACTUAL refers to using known release data to project the dose to members of the public for the previous time period. This data is stored in the database and used to demonstrate compliance with the reporting requirements of Chapter 12.
 - b. PROJECTED - PROJECTED refers to using known release data from the previous time period or estimated release data to forecast a future dose to members of the public. This data is not incorporated into the database.

TABLE 12.1-1

FREQUENCY NOTATIONS*

<u>NOTATION</u>	<u>FREQUENCY</u>
S - Shiftly	At least once per 12 hours.
D - Daily	At least once per 24 hours.
W - Weekly	At least once per 7 days.
M - Monthly	At least once per 31 days.
Q - Quarterly	At least once per 92 days.
SA - Semiannually	At least once per 184 days.
A - Annually	At least once per 366 days.
R - Refueling cycle	At least once per 18 months (550 days).
S/U - Startup	Prior to each reactor startup.
P - Prior	Prior to each radioactive release.
N.A.	Not applicable.

* Each frequency requirement shall be performed within the specified time interval with the maximum allowable extension not to exceed 25% of the frequency interval. The 25% variance shall not be applied to Operability Action statements. The bases to Technical Specification 4.0.2 provide clarifications to this requirement.

12.2 INSTRUMENTATION

12.2.1 Radioactive Liquid Effluent Monitoring Instrumentation

Operability Requirements

12.2.1.A The radioactive liquid effluent monitoring instrumentation channels shown in Table 12.2-1 shall be OPERABLE with their Alarm/Trip Setpoints set to ensure that the limits of 12.3.1.A are not exceeded. The Alarm/Trip Setpoints of these channels shall be determined and adjusted in accordance with the methodology and parameters in the ODCM.

Applicability: At all times

Action

1. With a radioactive liquid effluent monitoring instrumentation channel Alarm/Trip Setpoint less conservative than required by the above specification, immediately suspend the release of radioactive liquid effluents monitored by the affected channel, or declare the channel inoperable.
2. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 12.2-1. Restore the inoperable instrumentation to OPERABLE status within the time specified in the ACTION, or explain in the next Radioactive Effluent Release Report pursuant to Section 12.6 why this inoperability was not corrected within the time specified.

Surveillance Requirements

12.2.1.B Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and DIGITAL and ANALOG CHANNEL OPERATIONAL TEST at the frequencies shown in Table 12.2-2.

Bases

12.2.1.C The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The Alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of RETS. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50.

TABLE 12.2-1RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
1. Radioactivity Monitors Providing Alarm and Automatic Termination of Release		
a. Liquid Radwaste Effluent Line (0RE-PR001)	1	31
b. Fire and Oil Sump (0RE-PR005)	1	34
c. Condensate Polisher Sump Discharge (0RE-PR041)	1	34
2. Radioactivity Monitors Providing Alarm But Not Providing Automatic Termination of Release		
a. Essential Service Water		
1) Unit 1		
a) RCFC 1A and 1C Outlet (1RE-PR002)	1	32
b) RCFC 1B and 1D Outlet (1RE-PR003)	1	32
2) Unit 2		
a) RCFC 2A and 2C Outlet (2RE-PR002)	1	32
b) RCFC 2B and 2D Outlet (2RE-PR003)	1	32
b. Station Blowdown Line (0RE-PR010)	1	32
3. Flow Rate Measurement Devices		
a. Liquid Radwaste Effluent Line (Loop-WX001)	1	33
b. Liquid Radwaste Effluent Low Flow Line (Loop-WX630)	1	33
c. Station Blowdown Line (Loop-CW032)	1	33

TABLE 12.2-1 (Continued)RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATIONACTION STATEMENTS

- ACTION 31 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 14 days provided that prior to initiating a release:
- a. At least two independent samples are analyzed in accordance with Section 12.3 and
 - b. At least two technically qualified members of the facility staff independently verify the release rate calculations and discharge line valving.
- Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 32 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided that, at least once per 12 hours, grab samples are collected and analyzed for principal gamma emitters and I-131 at a lower limit of detection as specified in Table 12.3-1.
- ACTION 33 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided the flow rate is estimated at least once per 4 hours during actual releases. Pump performance curves generated in place may be used to estimate flow.
- ACTION 34 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided grab samples are analyzed for principal gamma emitters and I-131 at a lower limit of detection as specified in Table 12.3-1:
- a. At least once per 12 hours when the specific activity of the secondary coolant is greater than 0.01 microCurie/gram DOSE EQUIVALENT I-131, or
 - b. At least once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01 microCurie/gram DOSE EQUIVALENT I-131.

TABLE 12.2-2
RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>DIGITAL CHANNEL OPERATIONAL TEST</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>
1. Radioactivity Monitors Providing Alarm and Automatic Termination of Release					
I a. Liquid Radwaste Effluent Line (0RE-PR001)	D	P	R(3)	Q(1)	N.A.
b. Fire and Oil Sump Discharge (0RE-PR005)	D	M	R(3)	Q(1)	N.A.
c. Condensate Polisher Sump Discharge (0RE-PR041)	D	M	R(3)	Q(1)*	N.A.
2. Radioactivity Monitors Providing Alarm But Not Providing Automatic Termination of Release					
a. Essential Service Water					
1) Unit 1					
I a) RCFC 1A and 1C Outlet (1RE-PR002)	D	M	R(3)	Q(2)	N.A.
I b) RCFC 1B and 1D Outlet (1RE-PR003)	D	M	R(3)	Q(2)	N.A.
2) Unit 2					
I a) RCFC 2A and 2C Outlet (2RE-PR002)	D	M	R(3)	Q(2)	N.A.
I b) RCFC 2B and 2D Outlet (2RE-PR003)	D	M	R(3)	Q(2)	N.A.
I b. Station Blowdown Line (0RE-PR010)	D	M	R(3)	Q(2)	N.A.
3. Flow Rate Measurement Devices					
I a. Liquid Radwaste Effluent Line (Loop-WX001)	D(4)	N.A.	R	N.A.	Q
b. Liquid Radwaste Effluent Low Flow Line (Loop-WX630)	D(4)	N.A.	R	N.A.	Q
c. Station Blowdown Line (Loop-CW032)	D(4)	N.A.	R	N.A.	Q

TABLE 12.2-2 (Continued)RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE
REQUIREMENTSTABLE NOTATIONS

- (1) The DIGITAL CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occur if any of the following conditions exists:
 - a. Instrument indicates measured levels above the Alarm/Trip Setpoint, or
 - b. Circuit failure (monitor loss of communications - alarm only, detector loss of counts, or monitor loss of power), or
 - c. Detector check source test failure, or
 - d. Detector channel out-of-service, or
 - e. Monitor loss of sample flow. This is only applicable for ORE-PR001 and ORE-PR005. Monitor ORE-PR041 will not trip on loss of sample flow.
- (2) The DIGITAL CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
 - a. Instrument indicates measured levels above the Alarm Setpoint, or
 - b. Circuit failure (monitor loss of communications - alarm only, detector loss of counts, or monitor loss of power), or
 - c. Detector check source test failure, or
 - d. Detector channel out-of-service, or
 - e. Monitor loss of sample flow.
- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.
- (4) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made.

12.2.2 Radioactive Gaseous Effluent Monitoring InstrumentationOperability Requirements

12.2.2.A The radioactive gaseous effluent monitoring instrumentation channels shown in Table 12.2-3 shall be OPERABLE with their Alarm/Trip Setpoints set to ensure that the limits of Section 12.4 are not exceeded. The Alarm/Trip Setpoints of these channels shall be determined and adjusted in accordance with the methodology and parameters in the ODCM.

Applicability: As shown in Table 12.2-3

Action:

1. With a radioactive gaseous effluent monitoring instrumentation channel Alarm/Trip Setpoint less conservative than required by the above section, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel inoperable.
2. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 12.2-3. Restore the inoperable instrumentation to OPERABLE status within the time specified in the ACTION, or explain in the next Semiannual Radioactive Effluent Release Report pursuant to Section 12.6 why this inoperability was not corrected within the time specified.

Surveillance Requirements

12.2.2.B Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and DIGITAL and CHANNEL OPERATIONAL TEST at the frequencies shown in Table 12.2-4.

Bases

12.2.2.C The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The Alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of RETS. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50. The sensitivity of any noble gas activity monitor used to show compliance with the gaseous effluent release requirements of Section 12.4 shall be such that concentrations as low as 1×10^{-6} uCi/cc are measurable.

TABLE 12.2-3

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
1. Plant Vent Monitoring System - Unit 1			
a. Noble Gas Activity Monitor Providing Alarm			
1) High Range (1RE-PR028D)	1	*	39
2) Low Range (1RE-PR028B)	1	*	39
b. Iodine Sampler (1RE-PR028C)	1	*	40
c. Particulate Sampler (1RE-PR028A)	1	*	40
d. Effluent System Flow Rate Measuring Device (LOOP-VA019)	1	*	36
e. Sampler Flow Rate Measuring Device (1FT-PR165)	1	*	36
2. Plant Vent Monitoring System - Unit 2			
a. Noble Gas Activity Monitor Providing Alarm			
1) High Range (2RE-PR028D)	1	*	39
2) Low Range (2RE-PR028B)	1	*	39
b. Iodine Sampler (2RE-PR028C)	1	*	40
c. Particulate Sampler (2RE-PR028A)	1	*	40
d. Effluent System Flow Rate Measuring Device (LOOP-VA020)	1	*	36
e. Sampler Flow Rate Measuring Device (2FT-PR165)	1	*	36

TABLE 12.2-3 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

	<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
3.	Not Used.			
4.	Gas Decay Tank System			
a.	Noble Gas Activity Monitor- Providing Alarm and Automatic Termination of Release (0RE-PR002A and 2B)	2	*	35
5.	Containment Purge System			
a.	Noble Gas Activity Monitor- Providing Alarm (RE-PR001B)	1	*	37
b.	Iodine Sampler (RE-PR001C)	1	*	40
c.	Particulate Sampler (RE-PR001A)	1	*	40
6.	Radioactivity Monitors Providing Alarm and Automatic Closure of Surge Tank Vent-Component Cooling Water Line (0RE-PR009 and RE-PR009)	2	*	41

TABLE 12.2-3 (Continued)RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATIONTABLE NOTATIONS

*At all times.

- ACTION 35 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment for up to 14 days provided that prior to initiating the release:
- At least two independent samples of the tank's contents are analyzed, and
 - At least two technically qualified members of the facility staff independently verify the release rate calculations and discharge valve lineup.
- Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 36 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided the flow rate is estimated at least once per 4 hours.
- ACTION 37 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend PURGING of radioactive effluents via this pathway. Releases may continue via this pathway for up to 7 days provided real time monitoring of radioactive effluents released via this pathway is established.
- ACTION 38 - Not used.
- ACTION 39 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided grab samples are taken at least once per 12 hours and these samples are analyzed for principle gamma emitters at a LLD as specified in Table 12.4-1.
- ACTION 40 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the affected pathway may continue for up to 30 days provided samples are continuously collected with auxiliary sampling equipment as required in Table 12.4-1.
- ACTION 41 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided that, at least once per 12 hours, liquid grab samples are collected and analyzed for radioactivity at a lower limit of detection as specified in Table 12.3-1.

TABLE 12.2-4

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>DIGITAL CHANNEL OPERATIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
1. Plant Vent Monitoring System - Unit 1					
a. Noble Gas Activity Monitor-Providing Alarm					
1) High Range (1RE-PR028D)	D	M	R(3)	Q(2)	•
2) Low Range (1RE-PR028B)	D	M	R(3)	Q(2)	•
b. Iodine Sampler (1RE-PR028C)	D	M	R(3)	Q(2)	•
c. Particulate Sampler (1RE-PR028A)	D	M	R(3)	Q(2)	•
d. Effluent System Flow Rate Measuring Device (LOOP-VA019)	D	N.A.	R	Q	•
e. Sampler Flow Rate Measuring Device (1FT-PR165)	D	N.A.	R	Q	•
2. Plant Vent Monitoring System - Unit 2					
a. Noble Gas Activity Monitor-Providing Alarm					
1) High Range (2RE-PR028D)	D	M	R(3)	Q(2)	•
2) Low Range (2RE-PR028B)	D	M	R(3)	Q(2)	•
b. Iodine Sampler (2RE-PR028C)	D	M	R(3)	Q(2)	•

TABLE 12.2-4 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>DIGITAL CHANNEL OPERATIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
2. Plant Vent Monitoring System - Unit 2 (Continued)					
c. Particulate Sampler (2RE-PR028C)	D	M	R(3)	Q(2)	*
d. Effluent System Flow Rate Measuring Device (LOOP-VA020)	D	N.A.	R	Q	*
e. Sampler Flow Rate Measuring Device (2FT-PR165)	D	N.A.	R	Q	*
3. Not Used					
4. Gas Decay Tank System					
a. Noble Gas Activity Monitor Providing Alarm and Automatic Termination of Release (0RE-PR002A and 2B)	P	P	R(3)	Q(1)*	*
5. Containment Purge System					
a. Noble Gas Activity Monitor- Providing Alarm (RE-PR001B)	D	P	R(3)	Q(2)	*
b. Iodine Sampler (RE-PR001C)	P	P	R(3)	N.A.	*
c. Particulate Sampler (RE-PR001A)	P	P	R(3)	N.A.	*
6. Radioactivity Monitors Providing Alarm and Automatic Closure of Surge Tank Vent-Component Cooling Water Line (0RE-PR009 and RE-PR009)					
	D	M	R(3)	Q(1)	*

TABLE 12.2-4 (Continued)RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION
SURVEILLANCE REQUIREMENTSTABLE NOTATIONS

- * At all times.
- (1) The DIGITAL CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occur if any of the following conditions exists:
 - a. Instrument indicates measured levels above the Alarm/Trip Setpoint, or
 - b. Circuit failure (monitor loss of communications - alarm only, detector loss of counts, or monitor loss of power), or
 - c. Detector check source test failure, or
 - d. Detector channel out-of-service, or
 - * e. Monitor loss of sample flow. Monitoring ORE-PR002A and 2B will not trip on loss of sample flow. This is only applicable for functional unit 6, ORE-PR009 and RE-009.
 - (2) The DIGITAL CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
 - a. Instrument indicates measured levels above the Alarm Setpoint, or
 - b. Circuit failure (monitor loss of communications - alarm only, detector loss of counts, or monitor loss of power), or
 - c. Detector check source test failure, or
 - d. Detector channel out-of-service, or
 - e. Monitor loss of sample flow.
 - (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.

12.3 LIQUID EFFLUENTS12.3.1 ConcentrationOperability Requirements

12.3.1.A The concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS (see Braidwood Station ODCM Annex, Appendix F, Figure F-1) shall be limited to 10 times the concentration values in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402, for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to 2×10^{-4} microCurie/ml total activity.

Applicability: At all times

Action:

1. With the concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS exceeding the above limits, immediately restore the concentration to within the above limits.

Surveillance Requirements

12.3.1.1.B Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program of Table 12.3-1.

12.3.1.2.B The results of the radioactivity analysis shall be used in accordance with the methodology and parameters in the ODCM to assure that the concentrations at the point of release are maintained within the limits of 12.3.1.A.

Bases

12.3.1.C This section is provided to ensure that the concentration of radioactive materials released in liquid waste effluents to UNRESTRICTED AREAS will be less than 10 times the concentration values in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402. This limitation provides additional assurance that the levels of radioactive materials in bodies of water in UNRESTRICTED AREAS will result in exposures within: (1) the Section II.A design objectives of Appendix I, 10 CFR Part 50, to a MEMBER OF THE PUBLIC, and (2) the limits of 10 CFR Part 20.1301.

This section applies to the release of radioactive materials in liquid effluents from all units at the site.

12.3 LIQUID EFFLUENTS (Continued)Bases

The required detection capabilities for radioactive materials in liquid waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L.A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. **40**, 586-93 (1968), and Hartwell, J.K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

TABLE 12.3-1

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

LIQUID RELEASE TYPE	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) ⁽¹⁾ (μCi/ml)
1. Batch Release Tanks(2)	P Each Batch	P Each Batch	Principal Gamma Emitters(7)	5x10 ⁻⁷
			I-131	1x10 ⁻⁶
	P One Batch/M	M	Dissolved and Entrained Gases (Gamma Emitters)(7)	1x10 ⁻⁵
	P Each Batch	M Composite (3)	H-3	1x10 ⁻⁵
			Gross Alpha	1x10 ⁻⁷
	P Each Batch	Q Composite (3)	Sr-89, Sr-90	5x10 ⁻⁶
Fe-55			1x10 ⁻⁶	
2. Continuous Releases (4)	Continuous(5)	W Composite(5)	Principal Gamma Emitters(7)	5x10 ⁻⁷
			I-131	1x10 ⁻⁶
a. Circulating Water Blowdown	M Grab Sample	M	Dissolved and Entrained Gases (Gamma Emitters)(7)	1x10 ⁻⁵
	Continuous(5)	M Composite(5)	H-3	1x10 ⁻⁵
Gross Alpha			1x10 ⁻⁷	
b. Waste Water Treatment Discharge to Circulating Water Discharge	Continuous(5)	Q Composite(5)	Sr-89, Sr-90	5x10 ⁻⁶
			Fe-55	1x10 ⁻⁶
c. Condensate Polisher Sump Discharge	Continuous(5)	Q Composite(5)	Fe-55	1x10 ⁻⁶

TABLE 12.3-1 (Continued)

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

LIQUID RELEASE TYPE	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) ⁽¹⁾ (μ Ci/ml)
3. Continuous Release(4) Essential Service Water Reactor Containment Fan Cooler (RCFC) Outlet Line	W(6) Grab Sample	W(6)	Principal Gamma Emitters(7)	5×10^{-7}
			I-131	1×10^{-6}
			H-3	1×10^{-5}
		M (6)	Dissolved and Entrained Gases (Gamma Emitters)(7)	1×10^{-5}
4. Continuous Surge Tank Vent-Component Cooling Water Line (8)	None	None	Principal Gamma Emitters(7)	5×10^{-7}
			Dissolved and Entrained Gases (Gamma Emitters)(7)	1×10^{-5}
			I-131	1×10^{-6}

TABLE 12.3-1 (Continued)

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAMTABLE NOTATIONS

- (1) The LLD is defined, for purposes of these sections, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

LLD = the lower limit of detection (microCuries per unit mass or volume),

s_b = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute),

E = the counting efficiency (counts per disintegration),

V = the sample size (units of mass or volume),

2.22×10^6 = the number of disintegrations per minute per microCurie,

Y = the fractional radiochemical yield, when applicable,

λ = the radioactive decay constant for the particular radionuclide (sec^{-1}), and

Δt = the elapsed time between the midpoint of sample collection and the time of counting (sec).

Typical values of E, V, Y, and Δt should be used in the calculation.

Alternative LLD Methodology

An alternative methodology for LLD determination follows and is similar to the above LLD equation:

$$LLD = \frac{[2.71 + 4.65\sqrt{B}] \cdot \text{Decay}}{E \cdot q \cdot b \cdot Y \cdot t \cdot (2.22E06)}$$

TABLE 12.3-1 (Continued)

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAMTABLE NOTATIONS

Where:

B = background sum (counts)

E = counting efficiency, (counts detected/disintegrations)

q = sample quantity, (mass or volume)

b = abundance, (if applicable)

Y = fractional radiochemical yield or collection efficiency, (if applicable)

t = count time (minutes)

2.22E06 = number of disintegrations per minute per microCurie

 $2.71 + 4.65\sqrt{B} \approx k^2 + (2k\sqrt{2}\sqrt{B})$, and $k = 1.645$.

(k=value of the t statistic from the single-tailed t distribution at a significance level of 0.95 and infinite degrees of freedom. This means that the LLD result represents a 95% detection probability with a 5% probability of falsely concluding that the nuclide present when it is not or that the nuclide is not present when it is.)

Decay = $e^{-\lambda\Delta t} [\lambda RT / (1 - e^{-\lambda RT})] [\lambda T_d / (1 - e^{-\lambda T_d})]$, (if applicable) λ = radioactive decay constant, (units consistent with Δt , RT and T_d) Δt = "delta t", or the elapsed time between sample collection or the midpoint of sample collection and the time the count is started, depending on the type of sample, (units consistent with λ)RT = elapsed real time, or the duration of the sample count, (units consistent with λ) T_d = sample deposition time, or the duration of analyte collection onto the sample media, (units consistent with λ)

The LLD may be determined using installed radioanalytical software, if available. In addition to determining the correct number of channels over which to total the background sum, utilizing the software's ability to perform decay corrections (i.e. during sample collection, from sample collection to start of analysis and during counting), this alternate method will result in a more accurate determination of the LLD.

It should be recognized that the LLD is defined as a before the fact limit representing the capability of a measurement system and not as an after the fact limit for a particular measurement.

- (2) A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed by a method described in the ODCM to assure representative sampling.

TABLE 12.3-1 (Continued)RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAMTABLE NOTATIONS

- (3) A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen that is representative of the liquids released.
- (4) A continuous release is the discharge of liquid wastes of a nondiscrete volume, e.g., from a volume of a system that has an input flow during the continuous release.
- (5) To be representative of the quantities and concentrations of radioactive materials in liquid effluents, samples shall be collected continuously whenever the effluent stream is flowing. Prior to analyses, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluent release.
- (6) Not required unless the Essential Service Water RCFC Outlet Radiation Monitors RE-PR002 and RE-PR003 indicates measured levels greater than 1×10^{-6} $\mu\text{Ci/ml}$ above background at any time during the week.
- (7) The principal gamma emitters for which the LLD specification applies include the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for dissolved and entrained gases and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141, and Ce-144 for principal gamma emitters. This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Radioactive Effluent Release Report pursuant to Section 12.6.2, in the format outlines in Regulatory Guide 1.21, Appendix B, Revision 1, June 1974.
- (8) A continuous release is the discharge of dissolved and entrained gaseous waste from a nondiscrete liquid volume.

12.3.2 DoseOperability Requirements

12.3.2.A The dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released, from each unit, to UNRESTRICTED AREAS (see Braidwood Station ODCM Annex, Appendix F, Figure F-1) shall be limited:

1. During any calendar quarter to less than or equal to 1.5 mremS to the whole body and to less than or equal to 5 mremS to any organ, and
2. During any calendar year to less than or equal to 3 mremS to the whole body and to less than or equal to 10 mremS to any organ.

Applicability: At all times.

Action:

1. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.

Surveillance Requirements

12.3.2.B Cumulative dose contributions from liquid effluents for the current calendar quarter and the current calendar year shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

Bases

12.3.2.C This section is provided to implement the requirements of Sections II.A, III.A and IV.A of Appendix I, 10 CFR Part 50. The Operability Requirements implement the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The dose calculation methodology and parameters in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated.

The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man From Routine Releases of Reactor Effluents For the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I" Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

12.3.2 Dose (Continued)Bases

This section applies to the release of radioactive materials in liquid effluents from each reactor at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases may be allocated equally to each of the radioactive waste producing units sharing the Radwaste Treatment System. For determining conformance to Operability Requirements, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total releases per unit.

12.3.3 Liquid Radwaste Treatment System

Operability Requirements

12.3.3.A The Liquid Radwaste Treatment System shall be OPERABLE and appropriate portions of the system shall be used to reduce releases of radioactivity when the projected doses due to the liquid effluent, from each unit, to UNRESTRICTED AREAS (see Braidwood Station ODCM Annex, Appendix F, Figure F-1) would exceed 0.06 mrem to the whole body or 0.2 mrem to any organ in a 31-day period.

Applicability: At all times.

Action:

1. With radioactive liquid waste being discharged without treatment and in excess of the above limits and any portion of the Liquid Radwaste Treatment System not in operation, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report that includes the following information:
 - a. Explanation of why liquid radwaste was being discharged without treatment, identification of any inoperable equipment or subsystems, and the reason for the inoperability,
 - b. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
 - c. Summary description of action(s) taken to prevent a recurrence.

Surveillance Requirements

- 12.3.3.1.B Doses due to liquid releases from each unit to UNRESTRICTED AREAS shall be projected at least once per 31 days in accordance with the methodology and parameters in the ODCM when the Liquid Radwaste Treatment System is not being fully utilized.
- 12.3.3.2.B The installed Liquid Radwaste Treatment System shall be considered OPERABLE by meeting Sections 12.3.1.A and 12.3.2.A.

Bases

- 12.3.3.C The OPERABILITY of the Liquid Radwaste Treatment System ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable". This section implements the requirements of 10 CFR 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.D of Appendix I to 10 CFR Part 50.

12.3.3 Liquid Radwaste Treatment System (Continued)Bases

The specified limits governing the use of appropriate portions of the Liquid Radwaste Treatment System were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50, for liquid effluents.

This section applies to the release of radioactive materials in liquid effluents from each unit at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases may be allocated equally to each of the radioactive waste producing units sharing the Radwaste Treatment System. For determining conformance to Operability Requirements, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total releases per unit.

12.4 GASEOUS EFFLUENTS12.4.1 Dose RateOperability Requirements

12.4.1.A The dose rate due to radioactive materials released in gaseous effluents from the site to areas at and beyond the SITE BOUNDARY (see Braidwood Station ODCM Annex, Appendix F, Figure F-1) shall be limited to the following:

1. For noble gases: less than or equal to a dose rate of 500 mrem/yr to the whole body and less than or equal to a dose rate of 3000 mrem/yr to the skin, and
2. For iodine 131 and 133, for tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

Applicability: At all times.

Action:

1. With the dose rate(s) exceeding the above limits, immediately restore the release rate to within the above limit(s).

Surveillance Requirements

12.4.1.1.B The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in the ODCM.

12.4.1.2.B The dose rate due to iodine 131 and 133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters in the ODCM by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 12.4-1.

Bases

12.4.1.C This section is provided to ensure that the dose at any time at and beyond the SITE BOUNDARY from gaseous effluents from all units on the site will be within the annual dose limits of 10CFR20. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of a MEMBER OF THE PUBLIC, exceeding the limits specified in 10CFR20.1301.

12.4 GASEOUS EFFLUENTS (Continued)Bases

For MEMBERS OF THE PUBLIC who may at times be within the SITE BOUNDARY, the occupancy of that MEMBER OF THE PUBLIC will usually be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. Examples of calculations for such MEMBERS OF THE PUBLIC, with the appropriate occupancy factors, shall be given in the ODCM. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to a MEMBER OF THE PUBLIC at or beyond the SITE BOUNDARY to less than or equal to 500 mrems/year to the whole body or to less than or equal to 3000 mrems/year to the skin. These release rate limits also restrict, at all times the corresponding thyroid dose rate above background via the inhalation pathway to less than or equal to 1500 mrems/year.

This section applies to the release of radioactive materials in gaseous effluents from all units at the site.

The required detection capabilities for radioactive materials in liquid waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually). Currie, L.A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J.K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

TABLE 12.4-1

RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

LIQUID RELEASE TYPE	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF (e) DETECTION (LLD) ⁽¹⁾ (μCi/cc)
1. Waste Gas Decay Tank	P Each Tank Grab Sample	P Each Tank	Principal Gamma Emitters(2)	1x10 ⁻⁴
2. Containment Purge	P Each Purge (3) Grab Sample	P Each Purge (3)	Principal Gamma Emitters (2)	1x10 ⁻⁴
			H-3	1x10 ⁻⁷
3. Auxiliary Bldg. Vent Stack (Unit 1 and 2)	M (4)(5) Grab Sample	M	Principal Gamma Emitters (2)	1x10 ⁻⁴
			H-3	1x10 ⁻⁷
	Continuous (6)	W (7) Charcoal Sample	I-131	1x10 ⁻¹²
			I-133	1x10 ⁻¹⁰
	Continuous (6)	W (7) Particulate Sample	Principal Gamma Emitters(2)	1x10 ⁻¹¹
	Continuous (6)	Q Composite Particulate Sample	Gross Alpha	1x10 ⁻¹¹
	Continuous (6)	Q Composite Particulate Sample	Sr-89, Sr-90	1x10 ⁻¹¹
Continuous	Noble Gas Monitor	Noble Gases, Gross Beta or Gamma	1x10 ⁻⁶	

TABLE 12.4-1 (Continued)

RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAMTABLE NOTATIONS

- (1) The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

LLD = the lower limit of detection (microCuries per unit mass or volume),

s_b = the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (counts per minute),

E = the counting efficiency (counts per disintegration),

V = the sample size (units of mass or volume),

2.22×10^6 = the number of disintegrations per minute per microCurie,

Y = the fractional radiochemical yield, when applicable,

λ = the radioactive decay constant for the particular radionuclide (sec^{-1}), and

Δt = the elapsed time between the midpoint of sample collection and the time of counting (sec).

Typical values of E, V, Y, and Δt should be used in the calculation.

Alternative LLD Methodology

An alternative methodology for LLD determination follows and is similar to the above LLD equation:

$$LLD = \frac{[2.71 + 4.65\sqrt{B}] \cdot \text{Decay}}{E \cdot V \cdot Y \cdot t \cdot (2.22E06)}$$

TABLE 12.4-1 (Continued)RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAMTABLE NOTATIONS

Where:

B = background sum (counts)

E = counting efficiency, (counts detected/disintegrations)

q = sample quantity, (mass or volume)

b = abundance, (if applicable)

Y = fractional radiochemical yield or collection efficiency, (if applicable)

t = count time (minutes)

2.22E06 = number of disintegrations per minute per microCurie

 $2.71 + 4.65\sqrt{B} = k^2 + (2k\sqrt{2}\sqrt{B})$, and $k = 1.645$.

(k=value of the t statistic from the single-tailed t distribution at a significance level of 0.95 and infinite degrees of freedom. This means that the LLD result represents a 95% detection probability with a 5% probability of falsely concluding that the nuclide present when it is not or that the nuclide is not present when it is.)

Decay = $e^{-\lambda \Delta t} [\lambda RT / (1 - e^{-\lambda RT})] [\lambda T_d / (1 - e^{-\lambda T_d})]$, (if applicable) λ = radioactive decay constant, (units consistent with Δt , RT and T_d) Δt = "delta t", or the elapsed time between sample collection or the midpoint of sample collection and the time the count is started, depending on the type of sample, (units consistent with λ)RT = elapsed real time, or the duration of the sample count, (units consistent with λ) T_d = sample deposition time, or the duration of analyte collection onto the sample media, (units consistent with λ)

The LLD may be determined using installed radioanalytical software, if available. In addition to determining the correct number of channels over which to total the background sum, utilizing the software's ability to perform decay corrections (i.e. during sample collection, from sample collection to start of analysis and during counting), this alternate method will result in a more accurate determination of the LLD.

It should be recognized that the LLD is defined as a before the fact limit and not as an after the fact limit for a particular measurement.

TABLE 12.4-1 (Continued)RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAMTABLE NOTATIONS

- (2) The principal gamma emitters for which the LLD specification applies include the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 in noble gas releases and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, I-131, Cs-134, Cs-137, Ce-141, and Ce-144 in particulate releases. This list does not mean that only these nuclides are to be considered.
- Other gamma peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Radioactive Effluent Release Report pursuant to Section 12.6.2, in the format outlined in Regulatory Guide 1.21, Appendix B, Revision 1, June 1974.
- (3) Sampling and analysis shall also be performed following shutdown, startup, or a THERMAL POWER change exceeding 15% of RATED THERMAL POWER within a 1-hour period.
- (4) Tritium grab samples shall be taken at least once per 24 hours when the refueling canal is flooded.
- (5) Tritium grab samples shall be taken at least once per 7 days from the spent fuel pool area, whenever spent fuel is in the spent fuel pool.
- (6) The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Sections 12.4.1.A, 12.4.2.A and 12.4.3.A.
- (7) Samples shall be changed at least once per 7 days and analyses shall be completed within a timeframe necessary to meet the applicable lower limits of detection but not to exceed 48 hours. Sampling shall also be performed at least once per 24 hours for at least 7 days following each shutdown, startup or THERMAL POWER change exceeding 15% of RATED THERMAL POWER within a 1-hour period and analyses shall be completed in a timeframe necessary to meet the applicable lower limits of detection but not to exceed 48 hours of changing. When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10. This requirement does not apply if: (1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the reactor coolant has not increased more than a factor of 3, and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of 3.

12.4.2 Dose - Noble GasesOperability Requirements

12.4.2.A The air dose due to noble gases released in gaseous effluents, from each unit, to areas at and beyond the SITE BOUNDARY (see Braidwood Station ODCM Annex, Appendix F, Figure F-1) shall be limited to the following:

1. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation, and
2. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

Applicability: At all times.

Action:

1. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.

Surveillance Requirements

12.4.2.B Cumulative dose contributions for the current calendar quarter and the current calendar year for noble gases shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

Bases

12.4.2.C This section is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR Part 50. The Operability Requirements implement the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I; to assure that the releases of radioactive material in gaseous effluents to areas at or beyond the SITE BOUNDARY will be kept "as low as is reasonable achievable." The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated.

12.4.2 Dose - Noble Gases (Continued)Bases

The dose calculation methodology and parameters established in the ODCM for calculating the doses due to the actual release rates of radioactive materials in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man From Routine Releases of Reactor Effluents For the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I" Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors, Revision 1," July 1977. The ODCM equations provided for determining the air doses at and beyond the SITE BOUNDARY are based upon the historical average atmospheric conditions.

This section applies to the release of radioactive materials in gaseous effluents from each unit at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases may be allocated equally to each of the radioactive waste producing units sharing the Radwaste Treatment System. For determining conformance to Operability Requirements, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total releases per unit.

12.4.3 Dose - Iodine I-131 and 133, Tritium, and Radioactive Material in Particulate FormOperability Requirements

12.4.3.A The dose to a MEMBER OF THE PUBLIC from Iodine-131 and 133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released, from each unit, to areas at and beyond the SITE BOUNDARY (see Braidwood Station ODCM Annex, Appendix F, Figure F-1) shall be limited to the following:

1. During any calendar quarter: Less than or equal to 7.5 mrems to any organ, and
2. During any calendar year: Less than or equal to 15 mrems to any organ.

Applicability: At all times.

Action:

1. With the calculated dose from the release of Iodine-131 and 133, tritium, and radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.

Surveillance Requirements

12.4.3.B Cumulative dose contributions for the current calendar quarter and the current calendar year for Iodine-131 and 133, tritium, and radionuclides in particulate form with half-lives greater than 8 days shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

Bases

12.4.3.C This section is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Operability Requirements are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents to areas at or beyond the SITE BOUNDARY will be kept "as low as is reasonable achievable." The ODCM calculational methods specified in the Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated.

12.4.3 Dose (Continued)Bases

The ODCM calculational methodology and parameters for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man From Routine Releases of Reactor Effluents For the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I" Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for Iodine-131 and 133, tritium, and radionuclides in particulate form with half-lives greater than 8 days are dependent upon the existing radionuclide pathways to man, in the areas at and beyond the SITE BOUNDARY. The pathways that were examined in the development of these calculations were: (1) individual inhalation of airborne radionuclides, (2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk animals and meat producing animal's graze with consumption of the milk and meat by man, and (4) deposition on the ground with subsequent exposure to man.

This section applies to the release of radioactive materials in gaseous effluents from each unit at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases may be allocated equally to each of the radioactive waste producing units sharing the Radwaste Treatment System. For determining conformance to Operability Requirements, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total releases per unit.

12.4.4 Gaseous Radwaste Treatment System

Operability Requirements

12.4.4.A The VENTILATION EXHAUST TREATMENT SYSTEM and the WASTE GAS HOLDUP SYSTEM shall be OPERABLE and appropriate portions of these systems shall be used to reduce releases of radioactivity when the projected doses in 31 days due to gaseous effluent releases, from each unit, to areas at and beyond the SITE BOUNDARY (see Braidwood Station ODCM Annex, Appendix F, Figure F-1) meet or exceed Technical Specifications and/or Code of Federal Regulation limits.

Applicability: At all times.

Action:

1. With radioactive gaseous waste being discharged without treatment and in excess of limits, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report that includes the following information:
 - a. Identification of any inoperable equipment or subsystems, and the reason for the inoperability,
 - b. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
 - c. Summary description of action(s) taken to prevent a recurrence.

Surveillance Requirements

12.4.4.1.B Doses due to gaseous releases from each unit to areas at and beyond the SITE BOUNDARY shall be projected at least once per 31 days in accordance with the methodology and parameters in the ODCM when Gaseous Radwaste Treatment Systems are not being fully utilized.

12.4.4.2.B The installed VENTILATION EXHAUST TREATMENT SYSTEM and WASTE GAS HOLDUP SYSTEM shall be considered OPERABLE by meeting Section 12.4.1 and 12.4.2 or 12.4.3.

Bases

12.4.4.C The OPERABILITY of the WASTE GAS HOLDUP SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the system will be available for use whenever gaseous effluents require treatment prior to release to the environment.

The requirement that the appropriate portions of this system be used when specified provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable". This section implements the requirements of 10 CFR 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the Gaseous Radwaste Treatment System were specified as a suitable fraction of the dose design objectives set forth in Section II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

12.4.4 Gaseous Radwaste Treatment System (Continued)Bases

This section applies to the release of radioactive materials in gaseous effluents from each unit at the site. When shared Radwaste Treatment Systems are used by more than one unit on a site, the wastes from all units are mixed for shared treatment; by such mixing, the effluent releases cannot accurately be ascribed to a specific unit. An estimate should be made of the contributions from each unit based on input conditions, e.g., flow rates and radioactivity concentrations, or, if not practicable, the treated effluent releases may be allocated equally to each of the radioactive waste producing units sharing the Radwaste Treatment System. For determining conformance to Operability Requirements, these allocations from shared Radwaste Treatment Systems are to be added to the releases specifically attributed to each unit to obtain the total releases per unit.

12.4.5 Total DoseOperability Requirements

- 12.4.5.A The annual (calendar year) dose or dose commitment to any MEMBER OF THE PUBLIC due to releases of radioactivity and to radiation from uranium fuel cycle sources shall be limited to less than or equal to 25 mremS to the whole body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mremS.

Applicability: At all times.

Action:

1. With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Sections 12.3.2, 12.4.2, or 12.4.3, calculations should be made including direct radiation contributions from the units and from outside storage tanks to determine whether the above limits of Section 12.4.5.A have been exceeded. If such is the case, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report that defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the above limits and includes the schedule for achieving conformance with the above limits. This Special Report, as defined in 10 CFR 20.2203, shall include an analysis that estimates the radiation exposure (dose) to a MEMBER OF THE PUBLIC from uranium fuel cycle sources, including all effluent pathways and direct radiation, for the calendar year that includes the release(s) covered by this report. It shall also describe levels of radiation and concentration of radioactive material involved, and the cause of the exposure levels or concentrations. If the estimated dose(s) exceeds the above limits, and if the release condition resulting in violation of 40 CFR Part 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR Part 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.

Surveillance Requirements

- 12.4.5.1.A Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with Sections 12.3.2, 12.4.2, and 12.4.3, and in accordance with the methodology and parameters in the ODCM.
- 12.4.5.2.B Cumulative dose contributions from direct radiation from the units and from radwaste storage tanks shall be determined in accordance with the methodology and parameters in the ODCM. This requirement is applicable only under conditions set forth in ACTION 1 of Section 12.4.5.A.

12.4.5 Total Dose (Continued)Bases

12.4.5.C This section is provided to meet the dose limitations of 40 CFR Part 190 that have been incorporated into 10 CFR Part 20 by 46 FR 18525. The section requires the preparation and submittal of a Special Report whenever the calculated doses due to releases of radioactivity and to radiation from uranium fuel cycle sources exceed 25 mremS to the whole body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mremS. For sites containing up to four reactors, it is highly unlikely that the resultant dose to a MEMBER OF THE PUBLIC will exceed the dose limits of 40 CFR Part 190 if the individual reactors remain within twice the dose design objectives of Appendix I, and if direct radiation doses from the reactor units and outside storage tanks are kept small. The Special Report will describe a course of action that should result in the limitation of the annual dose to a MEMBER OF THE PUBLIC to within the 40 CFR Part 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the MEMBER OF THE PUBLIC from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 8 km must be considered. If the dose to any MEMBER OF THE PUBLIC is estimated to exceed the requirements of 40 CFR Part 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR Part 190 have not already been corrected), in accordance with the provisions of 40 CFR 190.11 and 10 CFR 20.2203, is considered to be a timely request and fulfills the requirements of 40 CFR Part 190 until NRC staff action is completed. The variance only relates to the limits of 40 CFR Part 190, and does not apply in any way to the other requirements for dose limitation of 10 CFR Part 20, as addressed in Sections 12.3.1 and 12.4.1. An individual is not considered a MEMBER OF THE PUBLIC during any period in which he/she is engaged in carrying out any operation that is part of the nuclear fuel cycle.

12.4.6 Dose Limits for Members of the Public12.4.6.A Operability Requirements

The licensee shall conduct operations such that the TEDE to individual MEMBERS OF THE PUBLIC does not exceed 100 mrem in a year. In addition, the dose in any unrestricted area from external sources does not exceed 2 mrem in any one hour. The Effluents Program shall implement monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10CFR20.1302 and with the methodology and parameters in the ODCM.

Applicability: At all times.

Action:

1. If the calculated dose from the release or exposure of radiation meets or exceeds the 100 mrem/year limit for the MEMBER OF THE PUBLIC, prepare and submit a report to the Commission in accordance with 10CFR20.2203.
2. If the dose in any unrestricted area from external sources of radiation meets or exceeds the 2 mrem in any one hour limit for the MEMBER OF THE PUBLIC, prepare and submit a report to the Commission in accordance with 10CFR20.2203.

Surveillance Requirements

- 12.4.6.B Calculate the TEDE to individual MEMBERS OF THE PUBLIC annually to determine compliance with the 100 mrem/year limit in accordance with the ODCM. In addition, evaluate and/or determine if direct radiation exposures exceed 2 mrem in any hour in unrestricted areas.

Bases

- 12.4.6.C This section applies to direct exposure of radioactive materials as well as radioactive materials released in gaseous and liquid effluents. 10CFR20.1301 sets forth the 100 mrem/year dose limit to members of the public; 2 mrem in any one hour limit in the unrestricted area; and reiterates that the licensee is also required to meet the 40CFR190 standards. 10CFR20.1302 provides options to determine compliance to 10CFR20.1301. Compliance to the above operability requirement is based on 10CFR20, 40CFR190 and Braidwood Station Technical Specifications.

12.5 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM12.5.1 Monitoring ProgramOperability Requirements

12.5.1.A The Radiological Environmental Monitoring Program shall be conducted as specified in Table 9.1-1 of Chapter 9 and Chapter 11.

Applicability: At all times.

Action:

1. With the Radiological Environmental Monitoring Program not being conducted as specified in Table 9.1-1 of Chapter 9 and Chapter 11, see Chapter 9 for required actions.

Surveillance Requirements

12.5.1.B The radiological environmental monitoring program samples shall be collected pursuant to Table 9.1-1 of Chapter 9 and Chapter 11. See Chapter 9 for detailed surveillance requirements.

Bases

12.5.1.C The Radiological Environmental Monitoring Program required by this specification provides measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposures of MEMBERS OF THE PUBLIC resulting from the station operation. See Chapter 9 for detailed information. In addition, this requirement is stated in Technical Specification 6.8.4.f.

12.5.2 Land Use Census

Operability Requirements

12.5.2.A. A Land Use Census to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the monitoring program are made if required by the results of the census.

Applicability: At all times.

Action:

1. See Section 9.2 of Chapter 9 for more details.

Surveillance Requirements

12.5.2.B See Section 9.2 of Chapter 9 for more details.

Bases

12.5.2.C See Section 9.2 of Chapter 9 for required surveillances and Technical Specification 6.8.4.1.2 for more bases details.

12.5.3 Interlaboratory Comparison ProgramOperability Requirements

12.5.3.A Participation in an Interlaboratory Comparison Program to ensure that independent checks on the precision and accuracy of the measurement of radioactive materials in the environmental sample matrices are performed as part of the quality assurance program for environmental monitoring.

Applicability: At all times.

Action:

1. See Section 9.2 of Chapter 9 for required actions.

Surveillance Requirements

12.5.3.B See Section 9.2 of Chapter 9 for surveillance requirements.

Bases

12.5.3.C See Section 9.2 of Chapter 9 for more information. In addition, this requirement is stated in Technical Specification 6.8.4.1.3

12.6 REPORTING REQUIREMENTS

12.6.1 Annual Radiological Environmental Operating Report*

Operability Requirements

12.6.1.A Routine Annual Radiological Environmental Operating Report covering the operation of the Units during the previous calendar year shall be submitted prior to May 1 of each year.

Applicability: At all times.

Action:

1. See Section 9.4 of Chapter 9 for information.

Surveillance Requirements

12.6.1.B See Section 9.2 of Chapter 9 for more information.

Bases

12.6.1.C See Section 9.2 of Chapter 9 for more information and Technical Specification 6.9.1.6.

12.6 REPORTING REQUIREMENTS (Continued)12.6.2 Annual Radioactive Effluent Release Report**

Routine Annual Radioactive Effluent Release Reports covering the operation of the unit during the previous calendar year operation shall be submitted prior to May 1 of the following year.

The Annual Radioactive Effluent Release Reports shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof.

For solid wastes, the format for Table 3 in Appendix B shall be supplemented with three additional categories: class of solid wastes (as defined by 10 CFR Part 61), type of container (e.g., LSA, Type A, Type B, Large Quantity), and SOLIDIFICATION agent or absorbent (e.g, cement, urea formaldehyde).

The Annual Radioactive Effluent Release Reports shall include a list and description of unplanned releases from the site to areas beyond the site boundary of radioactive materials in gaseous and liquid effluents made during the reporting period.

The Annual Radioactive Effluent Release Reports shall include any changes made during the reporting period to the PCP, as well as any major changes to Liquid, Gaseous or Solid Radwaste Treatment Systems, pursuant to Section 12.6.3.

The Annual Radioactive Effluent Release Reports shall also include the following: an explanation as to why the inoperability of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified in Section 12.2.1 or 12.2.2, respectively; and description of the events leading to liquid holdup tanks or gas storage tanks exceeding the limits of Technical Specification 3.11.1.4 or 3.11.2.6, respectively.

**A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

12.6 REPORTING REQUIREMENTS (Continued)12.6.3 Offsite Dose Calculation Manual (ODCM)

12.6.3.1 The ODCM shall be approved by the Commission prior to implementation.

12.6.3.2 Licensee-initiated changes to the ODCM:

- a. Shall be documented and records of reviews performed shall be retained as required by Specification 6.10.2. This documentation shall contain:
 1. Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s); and
 2. A determination that the change will maintain the level of radioactive effluent control required by 10 CFR 20, 160, 40 CFR Part 190, 10 CFR 50.36a, and Appendix I to 10 CFR Part 50 and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.
- b. Shall become effective after review and acceptance by the Onsite Review and Investigative Function and the approval of the Plant Manager on the date specified by the Onsite Review and Investigative Function.
- c. Shall be submitted to the Commission in the form of a complete legible copy of the entire ODCM as part of or concurrent with the Annual Radioactive Effluent Release Report for the period of the report in which any change to the ODCM was made effective. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (e.g., month/year) the change was implemented.

12.6 REPORTING REQUIREMENTS (Continued)12.6.4 Major Changes to Liquid and Gaseous Radwaste Treatment Systems*

Licensee-initiated major changes to the Radwaste Treatment Systems (liquid and gaseous):

- a. Shall be reported to the Commission in the Annual Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the Onsite Review and Investigative Function. The discussion of each change shall contain:
 - 1) A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59;
 - 2) Sufficient detailed information to totally support the reason for the change without benefit of additional and supplemental information;
 - 3) A detailed description of the equipment, components, and processes involved and the interfaces with other plant systems.
 - 4) An evaluation of the change which shows the predicted releases of radioactive materials in liquid and gaseous effluents and/or quantity of solid waste that differ from those previously predicted in the License application and amendments thereto;
 - 5) An evaluation of the change, which shows the expected maximum exposures to a MEMBER OF THE PUBLIC and to the general population that differ from those previously estimated in the License application and amendments thereto;
 - 6) A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents and in solid waste, to the actual releases for the period prior to when the changes are to be made;
 - 7) An estimate of the exposure to plant operating personnel as a result of the change; and
 - 8) Documentation of the fact that the change was reviewed and found acceptable by the Onsite Review and Investigative Function.
- b. Shall become effective upon review and acceptance by the Onsite Review and Investigative Function.

*Licensees may choose to submit the information called for in this section as part of the annual FSAR update.

APPENDIX F
STATION-SPECIFIC DATA FOR BRAIDWOOD
UNITS 1 AND 2

TABLE OF CONTENTS

		<u>PAGE</u>
F.1	INTRODUCTION	F-1
F.2	REFERENCES	F-1

APPENDIX F**BRAIDWOOD ANNEX INDEX**

<u>PAGE</u>	<u>REVISION</u>	<u>PAGE</u>	<u>REVISION</u>
F-i	1.8	F-43	1.8
F-ii	1.8	F-44	1.8
F-iii	1.8	F-45	1.8
F-iv	1.8	F-46	1.8
F-1	1.8		
F-2	1.8		
F-3	1.8		
F-4	1.8		
F-5	1.8		
F-6	1.8		
F-7	1.8		
F-8	1.8		
F-9	1.8		
F-10	1.8		
F-11	1.8		
F-12	1.8		
F-13	1.8		
F-14	1.8		
F-15	1.8		
F-16	1.8		
F-17	1.8		
F-18	1.8		
F-19	1.8		
F-20	1.8		
F-21	1.8		
F-22	1.8		
F-23	1.8		
F-24	1.8		
F-25	1.8		
F-26	1.8		
F-27	1.8		
F-28	1.8		
F-29	1.8		
F-30	1.8		
F-31	1.8		
F-32	1.8		
F-33	1.8		
F-34	1.8		
F-35	1.8		
F-36	1.8		
F-37	1.8		
F-38	1.8		
F-39	1.8		
F-40	1.8		
F-41	1.8		
F-42	1.8		

APPENDIX F LIST OF TABLES

<u>NUMBER</u>	<u>TITLE</u>	<u>PAGE</u>
F-1	Aquatic Environmental Dose Parameters	F-2
F-2	Station Characteristics	F-3
F-3	Critical Ranges	F-4
F-4	Average Wind Speeds	F-5
F-5	X/Q and D/Q Maxima At or Beyond the Unrestricted Area Boundary	F-6
F-5a	X/Q and D/Q Maxima At or Beyond the Restricted Area Boundary	F-7
F-6	D/Q at the Nearest Milk Cow and Meat Animal Locations Within 5 Miles	F-8
F-7	Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Selected Nuclides	F-9
F-7a	Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Selected Nuclides	F-24
Supplemental Tables		
A	Mixed Mode Joint Frequency Distribution Table Summaries - 203 and 34 Foot Elevation Data	F-39
	-Summary Table of Percent by Direction and Class	
	-Summary Table of Percent by Direction and Speed	
	-Summary Table of Percent by Speed and Class	
B	Ground Level Joint Frequency Distribution Table Summaries	F-43
	-Summary Table of Percent by Direction and Class	
	-Summary Table of Percent by Direction and Speed	
	-Summary Table of Percent by Speed and Class	

APPENDIX F
LIST OF FIGURES

<u>NUMBER</u>	<u>TITLE</u>	<u>PAGE</u>
F-1	Unrestricted Area Boundary	F-45
F-2	Restricted Area Boundary	F-46

**APPENDIX F
STATION-SPECIFIC DATA FOR BRAIDWOOD
UNITS 1 AND 2**

F.1 INTRODUCTION

This appendix contains data relevant to the Braidwood site. Included is a figure showing the unrestricted area boundary and values of parameters used in offsite dose assessment.

F.2 REFERENCES

1. Sargent & Lundy, Nuclear Analysis and Technology Division Braidwood Calculation No. ATD-0149, Revisions 0, 1, 2 and 3, 3/30/95 for Braidwood.
2. "Assessment of the Impact of Liquid Radioactive Effluents from Braidwood Station on Proposed Public Water Intakes at Wilmington, Illinois", J.C. Golden NSEP, January 1990.
3. "Verification of Environmental Parameters Used for Commonwealth Edison Company's Offsite Dose Calculations," NUS Corporation, 1988.
4. "Verification of Environmental Parameters Used for Commonwealth Edison Company's Offsite Dose Calculations," NUTECH Engineers Group, 1992.

**Table F-1
Aquatic Environment Dose Parameters**

General Information

There is no irrigation occurring on the Kankakee River downstream of the station.

Recreation includes one or more of the following: boating, waterskiing, swimming, and sport fishing.

Downstream dams are within 50 miles of the station. One is located on the Kankakee. The other is the Illinois River at Dresden Island, Marseilles and Starved Rock. The Kankakee River flows into the Illinois River about 12 river miles downstream of the station.

This is based on information in Figure 2.1-13 of the Braidwood Environmental Report and in Section 2.4.1.1 and Figure 2.4-2 of the LaSalle Environmental Report.

Water and Fish Ingestion Parameters

<u>Parameter^a</u>	<u>Value</u>
U ^w , water usage, L/hr	0.042
U ^f , fish consumption, kg/hr	2.4E-3
1/M ^w , 1/M ^f	0.25, 1.0
F ^w , cfs	1.85E4
F ^f , cfs	5.63E3
t ^f , hr ^b	24.0
t ^w , hr ^c	3.0

Limits on Radioactivity in Unprotected Outdoor Tanks^d

Outside Temporary Tank ≤ 10 Ci^e

(per Technical Specification 3.11.1.4)

^a The parameters are defined in Section A.2.1 of Appendix A.

^b t^f (hr) = 24 hr (all stations) for the fish ingestion pathway

^c t^w (hr) = 3 hr (distance nearest potable water intake, to Wilmington, is 4 river miles downstream; a flow rate of 1.4 mph is assumed)

^d See Section A.2.4 of Appendix A.

^e Tritium and dissolved or entrained noble gases are excluded from this limit.

Table F-2
Station Characteristics

STATION: Braidwood
LOCATION: Braceville, Illinois

CHARACTERISTICS OF ELEVATED RELEASE POINT: Not Applicable (NA)

- 1) Release Height = ____m 2) Diameter = ____m
3) Exit Speed = ____ms⁻¹ 4) Heat Content ____Kcal s⁻¹

CHARACTERISTICS OF VENT STACK RELEASE POINT

- 1) Release Height = 60.66 m^a 2) Diameter = 2.80 m
3) Exit Speed = 11.0 ms^{-1a}

CHARACTERISTICS OF GROUND LEVEL RELEASE

- 1) Release Height = 0 m
2) Building Factor (D) = 60.6 m^a

METEOROLOGICAL DATA

A 320 ft Tower is Located 573 m NE of vent stack release point

Tower Data Used in Calculations

Release Point	Wind Speed and Direction	Differential Temperature
<u>Elevated</u>	<u>(NA)</u>	<u>(NA)</u>
<u>Vent</u>	<u>203 ft</u>	<u>199-30 ft</u>
<u>Ground</u>	<u>34 ft</u>	<u>199-30 ft</u>

^aUsed in calculating the meteorological and dose factors in Tables F-5, F-6, and F-7. See Sections B.3 through B.6 of Appendix B.

Table F-3
Critical Ranges

Direction	Unrestricted Area Boundary ^a (m)	Restricted Area Boundary (m)	Nearest Resident ^b (m)	Nearest Dairy Farm within 5 Miles ^c (m)
N	610	305	800	None
NNE	914	265	1100	None
NE	792	299	1000	None
ENE	701	361	1300	None
E	1036	355	1300	None
ESE	2713	425	3500	None
SE	3414	448	4300	None
SSE	3444	540	5300	None
S	4633	530	6800	None
SSW	975	540	2400	None
SW	632	632	800	None
WSW	555	555	700	None
W	518	500	600	None
WNW	503	434	600	None
NW	495	428	600	None
NNW	510	442	600	None

^a See Updated Final Safety Analysis Report Table 2.1-1a and Environmental Report. Used in calculating the meteorological and dose factors in Tables F-5 and F-7. See Sections B.3 through B.6 of Appendix B.

^b 1994 annual survey by Teledyne Isotopes Midwest Laboratories. The distances are rounded to the nearest conservative 100 meters.

^c 1994 annual milk animal census, by Teledyne Isotopes Midwest Laboratories. Used in calculating the D/Q values in Table F-6. The distances are rounded to the nearest conservative 100 meters.

Table F-4
Average Wind Speeds

Downwind Direction	Average Wind Speed (m/sec) ^a		
	Elevated ^b	Mixed Mode	Ground Level ^b
N	7.6	6.0	4.7
NNE	7.5	5.8	4.4
NE	6.1	5.3	3.9
ENE	6.2	5.2	3.7
E	6.6	5.4	4.0
ESE	6.8	5.6	4.3
SE	6.2	5.3	3.9
SSE	5.8	5.2	4.1
S	5.5	4.9	3.6
SSW	5.5	5.0	3.7
SW	5.3	4.8	3.3
WSW	4.7	4.2	2.4
W	5.4	4.4	2.2
WNW	6.0	4.6	2.4
NW	6.0	4.8	3.1
NNW	6.8	5.4	3.9

^a Based on Braidwood site meteorological data, January 1978 through December 1987. Calculated in Reference 1 of Section F.2, using formulas in Section B.1.3 of Appendix B.

^b The elevated and ground level values are provided for reference purposes only. Routine dose calculations are performed using the mixed mode values.

BRAIDWOOD

Revision 1.8
October 1995

Table F-5
X/Q and D/Q Maxima at or Beyond the Unrestricted Area Boundary

Downwind Direction	Mixed Mode(Vent) Release				Ground Level Release		
	Radius (meters)	X/Q (sec/m**3)	Radius (meters)	D/Q (1/m**2)	Radius (meters)	X/Q (sec/m**3)	D/Q (1/m**2)
N	610.	1.161E-06	610.	1.643E-08	610.	4.646E-06	3.355E-08
NNE	914.	5.076E-07	914.	7.023E-09	914.	1.783E-06	1.382E-08
NE	792.	2.990E-07	792.	4.274E-09	792.	1.738E-06	1.092E-08
ENE	701.	4.281E-07	701.	4.903E-09	701.	2.174E-06	1.310E-08
E	1036.	3.104E-07	1036.	3.780E-09	1036.	1.505E-06	8.551E-09
ESE	2713.	1.065E-07	2713.	1.164E-09	2713.	3.990E-07	1.949E-09
SE	3414.	7.575E-08	3414.	7.225E-10	3414.	2.757E-07	1.088E-09
SSE	3444.	6.028E-08	3444.	6.345E-10	3444.	2.165E-07	1.015E-09
S	4633.	4.068E-08	4633.	2.644E-10	4633.	1.749E-07	4.520E-10
SSW	975.	1.925E-07	975.	2.843E-09	975.	1.333E-06	6.781E-09
SW	632.	5.153E-07	632.	5.408E-09	632.	3.485E-06	1.494E-08
WSW	555.	7.821E-07	555.	4.558E-09	555.	5.471E-06	1.853E-08
W	518.	8.901E-07	518.	5.064E-09	518.	5.902E-06	1.830E-08
WNW	503.	1.077E-06	503.	6.100E-09	503.	6.472E-06	1.913E-08
NW	495.	1.081E-06	495.	8.650E-09	495.	5.501E-06	2.537E-08
NNW	510.	1.098E-06	510.	1.185E-08	510.	5.421E-06	3.023E-08

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Note: Based on Reference 1 of Section F.2 and the formulas in Sections B.3 and B.4 of Appendix B.

X/Q is used for beta_{kin}, and inhalation dose pathways. See Sections A.1.2, A.1.3, and A.1.4.2 of Appendix A.

D/Q is used for produce and leafy vegetable pathways. Section A.1.4 of Appendix A.

The ground level release data are provided for reference purposes only. Routine dose calculations are performed using mixed mode data.

Radius is the approximate distance from the midpoint between gaseous effluent release points to the location of highest X/Q or D/Q at or beyond the unrestricted area boundary (UAB).

Table F-5a

X/Q and D/Q Maxima at or Beyond the Restricted Area Boundary

Downwind Direction	Mixed Mode(vent) Release				Ground Level Release		
	Radius (meters)	X/Q (sec/m**3)	Radius (meters)	D/Q (1/m**2)	Radius (meters)	X/Q (sec/m**3)	D/Q (1/m**2)
N	305.	3.766E-06	305.	4.266E-08	305.	1.551E-05	9.627E-08
NNE	265.	3.841E-06	265.	3.855E-08	265.	1.445E-05	9.318E-08
NE	299.	1.412E-06	299.	1.473E-08	299.	8.827E-06	4.892E-08
ENE	361.	1.265E-06	361.	1.138E-08	361.	6.706E-06	3.652E-08
E	355.	1.669E-06	355.	1.590E-08	355.	8.978E-06	4.611E-08
ESE	425.	1.264E-06	425.	1.678E-08	425.	7.012E-06	4.132E-08
SE	448.	1.056E-06	448.	1.266E-08	448.	6.269E-06	3.177E-08
SSE	540.	5.596E-07	540.	8.639E-09	540.	3.673E-06	2.258E-08
S	530.	6.166E-07	530.	5.425E-09	530.	4.576E-06	1.745E-08
SSW	540.	4.441E-07	540.	6.000E-09	540.	3.423E-06	1.748E-08
SW	632.	5.153E-07	632.	5.408E-09	632.	3.485E-06	1.494E-08
WSW	555.	7.821E-07	555.	4.558E-09	555.	5.471E-06	1.853E-08
W	500.	9.431E-07	500.	5.289E-09	500.	6.265E-06	1.932E-08
WNW	434.	1.384E-06	434.	7.394E-09	434.	8.361E-06	2.399E-08
NW	428.	1.381E-06	428.	1.050E-08	428.	7.070E-06	3.170E-08
NNW	442.	1.388E-06	442.	1.444E-08	442.	6.878E-06	3.766E-08

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Note: Based on Reference 1 of Section F.2 and the formulas in Sections B.3 and B.4 of Appendix B.

The ground level release data are provided for reference purposes only. Routine dose calculations are performed using mixed mode data.

Radius is the approximate distance from the midpoint between gaseous effluent release points to the location of highest X/Q or D/Q at or beyond the restricted area boundary (RAB).

BRAIDWOOD

Table F-6

D/Q at the Nearest Milk Cow and Meat Animal Locations within 5 miles

Downwind Direction	Nearest Milk Cow D/Q(1/m**2)		Nearest Meat Animal D/Q(1/m**2)	
	Radius (meters)	Mixed Release	Radius (meters)	Mixed Release
N	8000.	2.694E-10	4500.	7.231E-10
NNE	8000.	2.159E-10	8000.	2.159E-10
NE	8000.	1.333E-10	8000.	3.221E-10
ENE	8000.	1.305E-10	5300.	1.333E-10
E	8000.	1.614E-10	8000.	2.604E-10
ESE	8000.	1.962E-10	3700.	1.614E-10
SE	8000.	1.779E-10	4300.	7.231E-10
SSE	8000.	1.591E-10	8000.	4.998E-10
S	8000.	1.074E-10	8000.	1.591E-10
SSW	8000.	1.172E-10	8000.	1.074E-10
SW	8000.	1.417E-10	5500.	1.172E-10
WSW	8000.	1.143E-10	2700.	1.417E-10
W	8000.	9.700E-11	4500.	1.143E-10
WNN	8000.	9.286E-11	8000.	9.286E-11
WNW	8000.	1.255E-10	8000.	1.255E-10
NW	8000.	1.639E-10	8000.	1.639E-10
NNW	8000.	1.639E-10	8000.	1.639E-10

Braidwood Site Meteorological Data 1/78 - 12/87

Table F-7

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-83m

Downwind Unrestricted Direction Area Bound	Radius (meters)	Mixed Mode(Vent) Release		Ground Level Release			
		V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)	
N	610.	610.	1.455E-04	1.097E-04	610.	5.333E-04	4.021E-04
NNE	914.	914.	6.375E-05	4.807E-05	914.	2.125E-04	1.602E-04
NE	792.	792.	3.828E-05	2.886E-05	792.	2.007E-04	1.513E-04
ENE	701.	701.	5.294E-05	3.992E-05	701.	2.575E-04	1.941E-04
E	1036.	1036.	3.703E-05	2.792E-05	1036.	1.718E-04	1.295E-04
ESE	2713.	2713.	1.129E-05	8.514E-06	2713.	3.792E-05	2.859E-05
SE	3414.	3414.	7.089E-06	5.345E-06	3414.	2.141E-05	1.614E-05
SSE	3444.	3444.	6.047E-06	4.559E-06	3444.	1.798E-05	1.356E-05
S	4633.	4633.	3.224E-06	2.431E-06	4633.	9.268E-06	6.988E-06
SSW	975.	975.	2.363E-05	1.782E-05	975.	1.444E-04	1.088E-04
SW	632.	632.	5.930E-05	4.472E-05	632.	3.694E-04	2.786E-04
WSW	555.	555.	8.469E-05	6.386E-05	555.	5.942E-04	4.480E-04
W	518.	518.	9.909E-05	7.471E-05	518.	6.292E-04	4.744E-04
WNW	503.	503.	1.205E-04	9.082E-05	503.	6.653E-04	5.016E-04
NW	495.	495.	1.242E-04	9.366E-05	495.	6.066E-04	4.574E-04
NNW	510.	510.	1.322E-04	9.969E-05	510.	6.144E-04	4.633E-04

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Note: Based on Reference 1 of Section F.2 and the formulas in Sections B.5 and B.6 of Appendix B.

Routine dose calculations are performed using mixed mode (vent) release data.

BRAIDWOOD

Revision 1.8
October 1995

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-85m

Downwind Unrestricted Direction Area Bound (meters)	Mixed Mode(Vent) Radius (meters)	Release		Ground Level Release			
		V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)	
N	610.	610.	9.989E-04	9.590E-04	610.	2.731E-03	2.614E-03
NNE	914.	914.	4.979E-04	4.785E-04	914.	1.222E-03	1.171E-03
NE	792.	792.	3.618E-04	3.481E-04	792.	1.173E-03	1.124E-03
ENE	701.	701.	4.452E-04	4.280E-04	701.	1.363E-03	1.305E-03
E	1036.	1036.	3.452E-04	3.320E-04	1036.	1.023E-03	9.809E-04
ESE	2713.	2713.	1.220E-04	1.174E-04	2713.	3.051E-04	2.930E-04
SE	3414.	3414.	8.179E-05	7.874E-05	3414.	1.970E-04	1.893E-04
SSE	3444.	3444.	6.958E-05	6.700E-05	3444.	1.634E-04	1.570E-04
S	4633.	4633.	4.000E-05	3.851E-05	4633.	1.051E-04	1.010E-04
SSW	975.	975.	2.413E-04	2.323E-04	975.	9.063E-04	8.688E-04
SW	632.	632.	5.199E-04	4.999E-04	632.	1.989E-03	1.905E-03
WSW	555.	555.	6.707E-04	6.444E-04	555.	3.061E-03	2.929E-03
W	518.	518.	6.908E-04	6.632E-04	518.	3.081E-03	2.947E-03
WNW	503.	503.	7.511E-04	7.204E-04	503.	3.126E-03	2.988E-03
NW	495.	495.	8.396E-04	8.059E-04	495.	2.915E-03	2.788E-03
NNW	510.	510.	9.023E-04	8.662E-04	510.	3.091E-03	2.958E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-85

Downwind Direction	Unrestricted Area Bound	Mixed Mode(Vent) Radius	Release		Ground Level Release		
	(meters)	(meters)	V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	610.	610.	1.125E-05	1.088E-05	610.	2.986E-05	2.888E-05
NNE	914.	914.	5.661E-06	5.474E-06	914.	1.344E-05	1.300E-05
NE	792.	792.	4.192E-06	4.053E-06	792.	1.311E-05	1.268E-05
ENE	701.	701.	5.150E-06	4.980E-06	701.	1.486E-05	1.537E-05
E	1036.	1036.	4.044E-06	3.911E-06	1036.	1.145E-05	1.107E-05
ESE	2713.	2713.	1.468E-06	1.420E-06	2713.	3.702E-06	3.579E-06
SE	3414.	3414.	1.025E-06	9.911E-07	3414.	2.620E-06	2.534E-06
SSE	3444.	3444.	8.593E-07	8.310E-07	3444.	2.101E-06	2.032E-06
S	4633.	4633.	5.432E-07	5.253E-07	4633.	1.699E-06	1.643E-06
SSW	975.	975.	2.853E-06	2.759E-06	975.	1.042E-05	1.008E-05
SW	632.	632.	6.098E-06	5.897E-06	632.	2.227E-05	2.154E-05
WSW	555.	555.	7.358E-06	7.599E-06	555.	3.400E-05	3.288E-05
W	518.	518.	7.924E-06	7.663E-06	518.	3.388E-05	3.276E-05
WNW	503.	503.	8.499E-06	8.219E-06	503.	3.430E-05	3.317E-05
NW	495.	495.	9.567E-06	9.251E-06	495.	3.174E-05	3.069E-05
NNW	510.	510.	1.025E-05	9.909E-06	510.	3.393E-05	3.281E-05

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-87

Direction	Downwind Unrestricted Area Bound		Mixed Mode(Vent) Release		Ground Level Release		
	Radius (meters)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	610.	610.	3.313E-03	3.217E-03	610.	8.088E-03	7.853E-03
NNE	914.	914.	1.650E-03	1.602E-03	914.	3.649E-03	3.543E-03
NE	792.	792.	1.249E-03	1.213E-03	792.	3.373E-03	3.275E-03
ENE	701.	701.	1.516E-03	1.472E-03	701.	4.077E-03	3.958E-03
E	1036.	1036.	1.150E-03	1.117E-03	1036.	2.954E-03	2.868E-03
ESE	2713.	2713.	3.948E-04	3.834E-04	2713.	8.084E-04	7.849E-04
SE	3414.	3414.	2.559E-04	2.486E-04	3414.	4.691E-04	4.555E-04
SSE	3444.	3444.	2.231E-04	2.167E-04	3444.	4.098E-04	3.979E-04
S	4633.	4633.	1.162E-04	1.129E-04	4633.	2.055E-04	1.996E-04
SSW	975.	975.	8.253E-04	8.015E-04	975.	2.477E-03	2.405E-03
SW	632.	632.	1.758E-03	1.707E-03	632.	5.625E-03	5.462E-03
WSW	555.	555.	2.229E-03	2.165E-03	555.	8.703E-03	8.450E-03
W	518.	518.	2.276E-03	2.210E-03	518.	8.931E-03	8.671E-03
WNW	503.	503.	2.431E-03	2.360E-03	503.	9.052E-03	8.789E-03
NW	495.	495.	2.792E-03	2.711E-03	495.	8.646E-03	8.395E-03
NNW	510.	510.	2.982E-03	2.896E-03	510.	9.023E-03	8.761E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-88

Downwind Direction	Unrestricted Area Bound Radius (meters)	Mixed Mode (Vent) Release Radius (meters)	Release V		Ground Level Release		
			(mrad/yr)	(uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR (uCi/sec)
N	610.	610.	7.997E-03	7.772E-03	610.	1.968E-02	1.911E-02
NNE	914.	914.	4.019E-03	3.906E-03	914.	8.899E-03	8.644E-03
NE	792.	792.	3.059E-03	2.974E-03	792.	8.441E-03	8.199E-03
ENE	701.	701.	3.725E-03	3.621E-03	701.	9.870E-03	9.586E-03
E	1036.	1036.	2.878E-03	2.798E-03	1036.	7.394E-03	7.182E-03
ESE	2713.	2713.	1.022E-03	9.941E-04	2713.	2.215E-03	2.152E-03
SE	3414.	3414.	6.859E-04	6.670E-04	3414.	1.396E-03	1.357E-03
SSE	3444.	3444.	5.929E-04	5.766E-04	3444.	1.185E-03	1.151E-03
S	4633.	4633.	3.301E-04	3.210E-04	4633.	6.987E-04	6.792E-04
SSW	975.	975.	2.066E-03	2.009E-03	975.	6.466E-03	6.281E-03
SW	632.	632.	4.389E-03	4.267E-03	632.	1.422E-02	1.381E-02
WSW	555.	555.	5.589E-03	5.433E-03	555.	2.182E-02	2.119E-02
W	518.	518.	5.607E-03	5.449E-03	518.	2.205E-02	2.141E-02
WNW	503.	503.	5.947E-03	5.779E-03	503.	2.232E-02	2.167E-02
NW	495.	495.	6.814E-03	6.622E-03	495.	2.097E-02	2.036E-02
NHW	510.	510.	7.265E-03	7.060E-03	510.	2.215E-02	2.151E-02

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-89

Downwind Unrestricted Direction Area Bound	Radius (meters)	Mixed Mode(Vent) Release		Ground Level Release			
		Radius (meters)	V (mrad/yr)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR (uCi/sec)
N	610.	610.	4.323E-03	4.199E-03	610.	7.655E-03	7.435E-03
NNE	914.	914.	1.692E-03	1.643E-03	914.	2.645E-03	2.569E-03
NE	792.	792.	1.305E-03	1.268E-03	792.	2.219E-03	2.155E-03
ENE	701.	701.	1.577E-03	1.532E-03	701.	3.016E-03	2.929E-03
E	1036.	1036.	9.092E-04	8.833E-04	1036.	1.387E-03	1.347E-03
ESE	2713.	2713.	1.140E-04	1.108E-04	2713.	9.720E-05	9.442E-05
SE	3414.	3414.	4.392E-05	4.266E-05	3414.	2.983E-05	2.897E-05
SSE	3444.	3444.	3.822E-05	3.712E-05	3444.	3.079E-05	2.990E-05
S	4633.	4633.	9.027E-06	8.769E-06	4633.	6.198E-06	6.021E-06
SSW	975.	975.	6.764E-04	6.571E-04	975.	1.066E-03	1.036E-03
SW	632.	632.	1.750E-03	1.700E-03	632.	3.181E-03	3.089E-03
WSW	555.	555.	2.009E-03	1.951E-03	555.	4.608E-03	4.475E-03
W	518.	518.	2.170E-03	2.108E-03	518.	4.949E-03	4.807E-03
WNW	503.	503.	2.410E-03	2.341E-03	503.	5.589E-03	5.428E-03
NW	495.	495.	3.227E-03	3.134E-03	495.	7.228E-03	7.020E-03
NNW	510.	510.	3.714E-03	3.608E-03	510.	7.735E-03	7.512E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-90

Downwind Unrestricted Direction	Unrestricted Area Bound Radius (meters)	Mixed Mode(Vent) Release		Ground Level Release			
		Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	610.	610.	8.576E-04	8.317E-04	610.	9.142E-04	8.863E-04
NNE	914.	914.	1.453E-04	1.409E-04	914.	1.212E-04	1.175E-04
NE	792.	792.	1.302E-04	1.263E-04	792.	1.132E-04	1.098E-04
ENE	701.	701.	1.874E-04	1.817E-04	701.	1.634E-04	1.584E-04
E	1036.	1036.	5.480E-05	5.316E-05	1036.	3.996E-05	3.875E-05
ESE	2713.	2713.	2.691E-07	2.610E-07	2713.	1.795E-07	1.741E-07
SE	3414.	3414.	1.862E-08	1.612E-08	3414.	6.748E-09	6.546E-09
SSE	3444.	3444.	2.647E-08	2.568E-08	3444.	2.033E-08	1.972E-08
S	4633.	4633.	5.354E-10	5.193E-10	4633.	3.704E-10	3.592E-10
SSW	975.	975.	4.411E-05	4.278E-05	975.	3.803E-05	3.688E-05
SW	632.	632.	2.254E-04	2.186E-04	632.	1.980E-04	1.920E-04
WSW	555.	555.	2.280E-04	2.212E-04	555.	1.855E-04	1.799E-04
W	518.	518.	2.822E-04	2.738E-04	518.	1.673E-04	1.622E-04
WNW	503.	503.	3.444E-04	3.341E-04	503.	2.412E-04	2.339E-04
NW	495.	495.	5.611E-04	5.442E-04	495.	5.535E-04	5.366E-04
NNW	510.	510.	8.014E-04	7.772E-04	510.	9.221E-04	8.940E-04

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-131m

Downwind Unrestricted Direction Area Bound (meters)	Mixed Mode(Vent) Radius (meters)	Release		Ground Level Release			
		V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)	
N	610.	610.	1.355E-04	1.065E-04	610.	4.922E-04	3.831E-04
NNE	914.	914.	6.125E-05	4.839E-05	914.	1.988E-04	1.553E-04
NE	792.	792.	3.806E-05	3.031E-05	792.	1.946E-04	1.520E-04
ENE	701.	701.	5.153E-05	4.083E-05	701.	2.358E-04	1.838E-04
E	1036.	1036.	3.805E-05	3.024E-05	1036.	1.677E-04	1.310E-04
ESE	2713.	2713.	1.232E-05	9.849E-06	2713.	4.412E-05	3.474E-05
SE	3414.	3414.	8.612E-06	6.883E-06	3414.	3.046E-05	2.401E-05
SSE	3444.	3444.	6.862E-06	5.499E-06	3444.	2.387E-05	1.883E-05
S	4633.	4633.	4.603E-06	3.676E-06	4633.	1.914E-05	1.510E-05
SSW	975.	975.	2.441E-05	1.949E-05	975.	1.504E-04	1.176E-04
SW	632.	632.	6.073E-05	4.813E-05	632.	3.620E-04	2.819E-04
WSW	555.	555.	8.569E-05	6.762E-05	555.	5.701E-04	4.435E-04
W	518.	518.	9.576E-05	7.527E-05	518.	5.874E-04	4.565E-04
WNW	503.	503.	1.132E-04	8.870E-05	503.	6.171E-04	4.790E-04
NW	495.	495.	1.167E-04	9.171E-05	495.	5.515E-04	4.285E-04
NNW	510.	510.	1.244E-04	9.777E-05	510.	5.698E-04	4.432E-04

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-133m

Downwind Unrestricted Direction Area Bound	Radius (meters)	Mixed Mode(Vent) Release		Ground Level Release			
		Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	610.	610.	2.561E-04	2.223E-04	610.	8.256E-04	7.023E-04
NNE	914.	914.	1.214E-04	1.063E-04	914.	3.481E-04	2.984E-04
NE	792.	792.	8.185E-05	7.244E-05	792.	3.399E-04	2.912E-04
ENE	701.	701.	1.055E-04	9.274E-05	701.	4.017E-04	3.426E-04
E	1036.	1036.	8.032E-05	7.091E-05	1036.	2.943E-04	2.524E-04
ESE	2713.	2713.	2.749E-05	2.446E-05	2713.	8.394E-05	7.303E-05
SE	3414.	3414.	1.908E-05	1.697E-05	3414.	5.806E-05	5.060E-05
SSE	3444.	3444.	1.562E-05	1.394E-05	3444.	4.609E-05	4.022E-05
S	4633.	4633.	1.005E-05	8.929E-06	4633.	3.632E-05	3.171E-05
SSW	975.	975.	5.399E-05	4.788E-05	975.	2.651E-04	2.276E-04
SW	632.	632.	1.243E-04	1.092E-04	632.	6.091E-04	5.186E-04
WSW	555.	555.	1.679E-04	1.466E-04	555.	9.488E-04	8.060E-04
W	518.	518.	1.799E-04	1.560E-04	518.	9.658E-04	8.185E-04
WNW	503.	503.	2.046E-04	1.763E-04	503.	1.001E-03	8.459E-04
NW	495.	495.	2.185E-04	1.894E-04	495.	9.067E-04	7.683E-04
NNW	510.	510.	2.337E-04	2.027E-04	510.	9.487E-04	8.059E-04

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-133

Downwind Unrestricted Direction	Unrestricted Area Bound Radius (meters)	Mixed Mode(Vent) Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	610.	610.	2.824E-04	2.536E-04	610.	9.100E-04	8.050E-04
NNE	914.	914.	1.355E-04	1.224E-04	914.	3.891E-04	3.466E-04
NE	792.	792.	9.079E-05	8.273E-05	792.	3.804E-04	3.389E-04
ENE	701.	701.	1.161E-04	1.052E-04	701.	4.450E-04	3.946E-04
E	1036.	1036.	8.914E-05	8.108E-05	1036.	3.295E-04	2.937E-04
ESE	2713.	2713.	3.072E-05	2.812E-05	2713.	9.583E-05	8.640E-05
SE	3414.	3414.	2.135E-05	1.953E-05	3414.	6.660E-05	6.011E-05
SSE	3444.	3444.	1.740E-05	1.596E-05	3444.	5.275E-05	4.767E-05
S	4633.	4633.	1.130E-05	1.033E-05	4633.	4.215E-05	3.809E-05
SSW	975.	975.	5.975E-05	5.460E-05	975.	2.978E-04	2.657E-04
SW	632.	632.	1.367E-04	1.238E-04	632.	6.726E-04	5.954E-04
WSW	555.	555.	1.830E-04	1.649E-04	555.	1.044E-03	9.224E-04
W	518.	518.	1.965E-04	1.762E-04	518.	1.056E-03	9.311E-04
WNW	503.	503.	2.231E-04	1.990E-04	503.	1.088E-03	9.570E-04
NW	495.	495.	2.387E-04	2.135E-04	495.	9.911E-04	8.736E-04
NNW	510.	510.	2.563E-04	2.299E-04	510.	1.044E-03	9.221E-04

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-135m

Downwind Direction	Unrestricted Area Bound		Mixed Mode(Vent) Release		Ground Level Release		
	Radius (meters)	Radius (meters)	V (mrad/yr)	vBAR ((uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR ((uCi/sec)
N	610.	610.	1.924E-03	1.856E-03	610.	4.403E-03	4.240E-03
NNE	914.	914.	9.071E-04	8.750E-04	914.	1.913E-03	1.843E-03
NE	792.	792.	6.745E-04	6.509E-04	792.	1.628E-03	1.568E-03
ENE	701.	701.	8.149E-04	7.862E-04	701.	2.191E-03	2.110E-03
E	1036.	1036.	5.710E-04	5.510E-04	1036.	1.368E-03	1.319E-03
ESE	2713.	2713.	1.557E-04	1.503E-04	2713.	2.479E-04	2.391E-04
SE	3414.	3414.	8.843E-05	8.536E-05	3414.	1.163E-04	1.122E-04
SSE	3444.	3444.	7.741E-05	7.472E-05	3444.	1.062E-04	1.025E-04
S	4633.	4633.	3.277E-05	3.163E-05	4633.	4.020E-05	3.879E-05
SSW	975.	975.	4.100E-04	3.957E-04	975.	1.011E-03	9.747E-04
SW	632.	632.	8.898E-04	8.587E-04	632.	2.532E-03	2.439E-03
WSW	555.	555.	1.092E-03	1.054E-03	555.	3.989E-03	3.842E-03
W	518.	518.	1.187E-03	1.145E-03	518.	4.362E-03	4.200E-03
WNW	503.	503.	1.304E-03	1.258E-03	503.	4.495E-03	4.327E-03
NW	495.	495.	1.546E-03	1.490E-03	495.	4.695E-03	4.521E-03
NNW	510.	510.	1.673E-03	1.613E-03	510.	4.688E-03	4.514E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-135

Downwind Unrestricted Direction Area Bound (meters)	Mixed Mode(Vent) Radius (meters)	Release		Ground Level Release			
		V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)	
N	610.	610.	1.353E-03	1.307E-03	610.	3.674E-03	3.548E-03
NNE	914.	914.	6.781E-04	6.554E-04	914.	1.652E-03	1.596E-03
NE	792.	792.	4.952E-04	4.788E-04	792.	1.599E-03	1.545E-03
ENE	701.	701.	6.084E-04	5.890E-04	701.	1.833E-03	1.770E-03
E	1036.	1036.	7.753E-04	4.595E-04	1036.	1.395E-03	1.348E-03
ESE	2713.	2713.	1.700E-04	1.644E-04	2713.	4.326E-04	4.181E-04
SE	3414.	3414.	1.160E-04	1.121E-04	3414.	2.914E-04	2.816E-04
SSE	3444.	3444.	9.782E-05	9.459E-05	3444.	2.377E-04	2.297E-04
S	4633.	4633.	5.868E-05	5.674E-05	4633.	1.698E-04	1.641E-04
SSW	975.	975.	3.328E-04	3.217E-04	975.	1.253E-03	1.211E-03
SW	632.	632.	7.144E-04	6.906E-04	632.	2.708E-03	2.615E-03
WSW	555.	555.	9.205E-04	8.896E-04	555.	4.150E-03	4.007E-03
W	518.	518.	9.408E-04	9.091E-04	518.	4.151E-03	4.008E-03
WNW	503.	503.	1.018E-03	9.833E-04	503.	4.203E-03	4.058E-03
NW	495.	495.	1.139E-03	1.101E-03	495.	3.908E-03	3.773E-03
NNW	510.	510.	1.225E-03	1.183E-03	510.	4.166E-03	4.022E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-137

Direction	Downwind Unrestricted Area Bound		Mixed Mode(Vent) Release		Ground Level Release		
	Radius (meters)	Radius (meters)	V (mrad/yr)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR (uCi/sec)
N	610.	610.	6.360E-04	6.154E-04	610.	1.202E-03	1.164E-03
NNE	914.	914.	2.578E-04	2.494E-04	914.	4.345E-04	4.205E-04
NE	792.	792.	1.950E-04	1.887E-04	792.	3.640E-04	3.522E-04
ENE	701.	701.	2.355E-04	2.279E-04	701.	4.977E-04	4.816E-04
E	1036.	1036.	1.407E-04	1.361E-04	1036.	2.400E-04	2.322E-04
ESE	2713.	2713.	2.042E-05	1.976E-05	2713.	1.931E-05	1.868E-05
SE	3414.	3414.	8.468E-06	8.195E-06	3414.	6.393E-06	6.186E-06
SSE	3444.	3444.	7.384E-06	7.146E-06	3444.	6.474E-06	6.265E-06
S	4633.	4633.	1.951E-06	1.888E-06	4633.	1.457E-06	1.410E-06
SSW	975.	975.	1.038E-04	1.006E-04	975.	1.812E-04	1.753E-04
SW	632.	632.	2.577E-04	2.493E-04	632.	5.246E-04	5.076E-04
WSW	555.	555.	2.977E-04	2.881E-04	555.	7.771E-04	7.519E-04
W	518.	518.	3.247E-04	3.143E-04	518.	8.444E-04	8.170E-04
WNW	503.	503.	3.635E-04	3.517E-04	503.	9.371E-04	9.067E-04
NW	495.	495.	4.769E-04	4.615E-04	495.	1.167E-03	1.129E-03
NNW	510.	510.	5.441E-04	5.265E-04	510.	1.222E-03	1.182E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.0
October 1995

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-138

Downwind Unrestricted Direction Area Bound (meters)	Mixed Mode(Vent) Radius (meters)	Release		Ground Level Release			
		V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GSAR (uCi/sec)	
N	610.	610.	4.201E-03	4.079E-03	610.	9.169E-03	8.898E-03
NNE	914.	914.	1.982E-03	1.925E-03	914.	3.986E-03	3.869E-03
NE	792.	792.	1.504E-03	1.460E-03	792.	3.379E-03	3.280E-03
ENE	701.	701.	1.805E-03	1.753E-03	701.	4.549E-03	4.415E-03
E	1036.	1036.	1.262E-03	1.225E-03	1036.	2.830E-03	2.747E-03
ESE	2713.	2713.	3.395E-04	3.297E-04	2713.	5.079E-04	4.931E-04
SE	3414.	3414.	1.926E-04	1.871E-04	3414.	2.381E-04	2.312E-04
SSE	3444.	3444.	1.685E-04	1.636E-04	3444.	2.185E-04	2.121E-04
S	4633.	4633.	7.045E-05	6.842E-05	4633.	8.174E-05	7.937E-05
SSW	975.	975.	9.144E-04	8.880E-04	975.	2.091E-03	2.030E-03
SW	632.	632.	1.991E-03	1.934E-03	632.	5.226E-03	5.072E-03
WSW	555.	555.	2.429E-03	2.359E-03	555.	8.199E-03	7.957E-03
W	518.	518.	2.609E-03	2.534E-03	518.	8.973E-03	8.708E-03
WNW	503.	503.	2.834E-03	2.751E-03	503.	9.247E-03	8.973E-03
NW	495.	495.	3.387E-03	3.288E-03	495.	9.733E-03	9.445E-03
NNW	510.	510.	3.657E-03	3.551E-03	510.	9.712E-03	9.425E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Ar-41

Downwind Direction	Unrestricted Area Bound Radius (meters)	Mixed Mode(Vent) Release Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	610.	610.	5.141E-03	4.977E-03	610.	1.283E-02	1.242E-02
NNE	914.	914.	2.568E-03	2.485E-03	914.	5.780E-03	5.595E-03
NE	792.	792.	1.935E-03	1.873E-03	792.	5.421E-03	5.248E-03
ENE	701.	701.	2.357E-03	2.282E-03	701.	6.445E-03	6.239E-03
E	1036.	1036.	1.803E-03	1.746E-03	1036.	4.745E-03	4.593E-03
ESE	2713.	2713.	6.281E-04	6.080E-04	2713.	1.352E-03	1.309E-03
SE	3414.	3414.	4.128E-04	3.996E-04	3414.	8.140E-04	7.880E-04
SSE	3444.	3444.	3.580E-04	3.466E-04	3444.	7.007E-04	6.783E-04
S	4633.	4633.	1.924E-04	1.862E-04	4633.	3.770E-04	3.650E-04
SSW	975.	975.	1.289E-03	1.247E-03	975.	4.067E-03	3.937E-03
SW	632.	632.	2.748E-03	2.660E-03	632.	9.104E-03	8.813E-03
WSW	555.	555.	3.504E-03	3.392E-03	555.	1.404E-02	1.359E-02
W	518.	518.	3.562E-03	3.448E-03	518.	1.430E-02	1.384E-02
WNW	503.	503.	3.806E-03	3.685E-03	503.	1.449E-02	1.403E-02
WW	495.	495.	4.350E-03	4.211E-03	495.	1.371E-02	1.327E-02
WNW	510.	510.	4.647E-03	4.498E-03	510.	1.439E-02	1.393E-02

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7a

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-83m

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode(Vent) Release Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR (uCi/sec)
N	305.	305.	3.994E-04	3.012E-04	305.	1.521E-03	1.147E-03
NNE	265.	265.	3.883E-04	2.928E-04	265.	1.406E-03	1.060E-03
NE	299.	299.	1.555E-04	1.173E-04	299.	9.211E-04	6.945E-04
ENE	361.	361.	1.372E-04	1.034E-04	361.	7.062E-04	5.325E-04
E	355.	355.	1.785E-04	1.346E-04	355.	9.139E-04	6.891E-04
ESE	425.	425.	1.505E-04	1.135E-04	425.	7.634E-04	5.756E-04
SE	448.	448.	1.196E-04	9.017E-05	448.	6.583E-04	4.964E-04
SSE	540.	540.	6.996E-05	5.275E-05	540.	4.053E-04	3.056E-04
S	530.	530.	6.499E-05	4.900E-05	530.	4.639E-04	3.498E-04
SSW	540.	540.	5.532E-05	4.171E-05	540.	3.829E-04	2.887E-04
SW	632.	632.	5.930E-05	4.472E-05	632.	3.694E-04	2.786E-04
WSW	555.	555.	8.469E-05	6.386E-05	555.	5.942E-04	4.480E-04
W	500.	500.	1.045E-04	7.876E-05	500.	6.646E-04	5.011E-04
WNW	434.	434.	1.497E-04	1.129E-04	434.	8.320E-04	6.273E-04
NW	428.	428.	1.537E-04	1.159E-04	428.	7.562E-04	5.702E-04
NNW	442.	442.	1.633E-04	1.231E-04	442.	7.667E-04	5.781E-04

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Note: Based on Reference 1 of Section F.2 and the formulas in Sections B.5 and B.6 of Appendix B.

Routine dose calculations are performed using mixed mode release data.

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-85m

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode Radius (meters)	Release (Vent)		Ground Level Release		
			V (mrad/yr)	VBAR ((uCi/sec))	Radius (meters)	G (mrad/yr)	GBAR ((uCi/sec))
N	305.	305.	2.263E-03	2.169E-03	305.	6.552E-03	6.259E-03
NNE	265.	265.	2.146E-03	2.056E-03	265.	5.928E-03	5.662E-03
NE	299.	299.	1.094E-03	1.050E-03	299.	4.111E-03	3.928E-03
ENE	361.	361.	9.475E-04	9.097E-04	361.	3.165E-03	3.025E-03
E	355.	355.	1.197E-03	1.149E-03	355.	4.072E-03	3.891E-03
ESE	425.	425.	1.073E-03	1.031E-03	425.	3.584E-03	3.427E-03
SE	448.	448.	9.074E-04	8.718E-04	448.	3.167E-03	3.029E-03
SSE	540.	540.	6.068E-04	5.836E-04	540.	2.086E-03	1.997E-03
S	530.	530.	5.227E-04	5.023E-04	530.	2.351E-03	2.249E-03
SSW	540.	540.	4.797E-04	4.613E-04	540.	1.999E-03	1.913E-03
SW	632.	632.	5.199E-04	4.999E-04	632.	1.989E-03	1.905E-03
WSW	555.	555.	6.707E-04	6.444E-04	555.	3.061E-03	2.929E-03
W	500.	500.	7.204E-04	6.915E-04	500.	3.224E-03	3.083E-03
WNW	434.	434.	8.947E-04	8.578E-04	434.	3.764E-03	3.597E-03
NW	428.	428.	9.954E-04	9.552E-04	428.	3.505E-03	3.351E-03
NNW	442.	442.	1.068E-03	1.025E-03	442.	3.712E-03	3.551E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-85

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode(Vent) Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)	VBAR ((uCi/sec))	Radius (meters)	G (mrad/yr)	GBAR ((uCi/sec))
N	305.	305.	2.521E-05	2.437E-05	305.	7.053E-05	6.820E-05
NNE	265.	265.	2.389E-05	2.310E-05	265.	6.351E-05	6.141E-05
NE	299.	299.	1.248E-05	1.207E-05	299.	4.443E-05	4.296E-05
ENE	361.	361.	1.083E-05	1.047E-05	361.	3.404E-05	3.292E-05
E	355.	355.	1.366E-05	1.320E-05	355.	4.396E-05	4.251E-05
ESE	425.	425.	1.220E-05	1.180E-05	425.	3.889E-05	3.760E-05
SE	448.	448.	1.042E-05	1.008E-05	448.	3.470E-05	3.355E-05
SSE	540.	540.	7.029E-06	6.797E-06	540.	2.290E-05	2.215E-05
S	530.	530.	6.111E-06	5.909E-06	530.	2.632E-05	2.545E-05
SSW	540.	540.	5.594E-06	5.409E-06	540.	2.217E-05	2.144E-05
SW	632.	632.	6.098E-06	5.897E-06	632.	2.227E-05	2.154E-05
WSW	555.	555.	7.858E-06	7.599E-06	555.	3.400E-05	3.288E-05
W	500.	500.	8.255E-06	7.983E-06	500.	3.541E-05	3.424E-05
WNW	434.	434.	1.009E-05	9.757E-06	434.	4.111E-05	3.976E-05
NW	428.	428.	1.131E-05	1.093E-05	428.	3.802E-05	3.677E-05
NNW	442.	442.	1.209E-05	1.169E-05	442.	4.056E-05	3.922E-05

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-87

Downwind Direction	Restricted Area Bound Radius (meters)	Mixed Mode (Vent) Release Radius (meters)	Release		Ground Level Release	
			V	VBAR	G	GBAR
			(mrad/yr)	((uCi/sec)	(mrad/yr)	((uCi/sec)
N	305.	305.	7.480E-03	7.264E-03	305.	1.972E-02 1.915E-02
NNE	265.	265.	7.100E-03	6.895E-03	265.	1.802E-02 1.749E-02
NE	299.	299.	3.780E-03	3.671E-03	299.	1.225E-02 1.189E-02
ENE	361.	361.	3.246E-03	3.152E-03	361.	9.572E-03 9.294E-03
E	355.	355.	4.060E-03	3.943E-03	355.	1.220E-02 1.185E-02
ESE	425.	425.	3.644E-03	3.539E-03	425.	1.068E-02 1.037E-02
SE	448.	448.	3.081E-03	2.992E-03	448.	9.262E-03 8.992E-03
SSE	540.	540.	2.111E-03	2.050E-03	540.	6.149E-03 5.971E-03
S	530.	530.	1.762E-03	1.711E-03	530.	6.549E-03 6.359E-03
SSW	540.	540.	1.664E-03	1.616E-03	540.	5.727E-03 5.561E-03
SW	632.	632.	1.758E-03	1.707E-03	632.	5.625E-03 5.462E-03
WSW	555.	555.	2.229E-03	2.165E-03	555.	8.703E-03 8.450E-03
W	500.	500.	2.375E-03	2.306E-03	500.	9.363E-03 9.090E-03
WNW	434.	434.	2.903E-03	2.818E-03	434.	1.098E-02 1.066E-02
HW	428.	428.	3.315E-03	3.219E-03	428.	1.044E-02 1.014E-02
NNW	442.	442.	3.533E-03	3.431E-03	442.	1.090E-02 1.058E-02

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-88

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode(Vent) Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)	VBAR ((uCi/sec))	Radius (meters)	G (mrad/yr)	GBAR ((uCi/sec))
N	305.	305.	1.790E-02	1.739E-02	305.	4.712E-02	4.574E-02
NNE	265.	265.	1.698E-02	1.650E-02	265.	4.272E-02	4.146E-02
NE	299.	299.	9.121E-03	8.865E-03	299.	2.947E-02	2.861E-02
ENE	361.	361.	7.868E-03	7.647E-03	361.	2.281E-02	2.214E-02
E	355.	355.	9.873E-03	9.595E-03	355.	2.928E-02	2.842E-02
ESE	425.	425.	8.818E-03	8.571E-03	425.	2.578E-02	2.503E-02
SE	448.	448.	7.516E-03	7.306E-03	448.	2.271E-02	2.205E-02
SSE	540.	540.	5.155E-03	5.012E-03	540.	1.505E-02	1.462E-02
S	530.	530.	4.382E-03	4.260E-03	530.	1.666E-02	1.618E-02
SSW	540.	540.	4.092E-03	3.978E-03	540.	1.429E-02	1.388E-02
SW	632.	632.	4.389E-03	4.267E-03	632.	1.422E-02	1.381E-02
WSW	555.	555.	5.589E-03	5.433E-03	555.	2.182E-02	2.119E-02
W	500.	500.	5.844E-03	5.680E-03	500.	2.308E-02	2.241E-02
WNW	434.	434.	7.074E-03	6.873E-03	434.	2.690E-02	2.612E-02
NW	428.	428.	8.064E-03	7.837E-03	428.	2.520E-02	2.447E-02
NNW	442.	442.	8.580E-03	8.338E-03	442.	2.660E-02	2.583E-02

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-89

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode (Vent) Release Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR (uCi/sec)
N	305.	305.	1.243E-02	1.208E-02	305.	2.613E-02	2.538E-02
NNE	265.	265.	1.213E-02	1.178E-02	265.	2.655E-02	2.579E-02
NE	299.	299.	6.070E-03	5.896E-03	299.	1.438E-02	1.397E-02
ENE	361.	361.	4.638E-03	4.506E-03	361.	1.132E-02	1.099E-02
E	355.	355.	5.715E-03	5.551E-03	355.	1.360E-02	1.321E-02
ESE	425.	425.	5.133E-03	4.986E-03	425.	1.084E-02	1.053E-02
SE	448.	448.	4.043E-03	3.927E-03	448.	8.014E-03	7.784E-03
SSE	540.	540.	2.636E-03	2.561E-03	540.	5.137E-03	4.990E-03
S	530.	530.	1.936E-03	1.880E-03	530.	4.055E-03	3.938E-03
SSW	540.	540.	1.970E-03	1.914E-03	540.	4.039E-03	3.922E-03
SW	632.	632.	1.750E-03	1.700E-03	632.	3.181E-03	3.089E-03
WSW	555.	555.	2.009E-03	1.951E-03	555.	4.608E-03	4.475E-03
W	500.	500.	2.313E-03	2.247E-03	500.	5.385E-03	5.230E-03
WNW	434.	434.	3.129E-03	3.040E-03	434.	7.749E-03	7.526E-03
NW	428.	428.	4.110E-03	3.993E-03	428.	9.703E-03	9.424E-03
NNW	442.	442.	4.671E-03	4.537E-03	442.	1.017E-02	9.878E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-90

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode (Vent) Release Radius (meters)	Release V (mrad/yr)/(uCi/sec)		Ground Level Release G (mrad/yr)/(uCi/sec)	
			VBAR	GBAR	Radius (meters)	GBAR
N	305.	305.	5.688E-03	5.515E-03	305.	8.218E-03 7.966E-03
NNE	265.	265.	6.051E-03	5.868E-03	265.	9.375E-03 9.087E-03
NE	299.	299.	2.447E-03	2.374E-03	299.	3.836E-03 3.719E-03
ENE	361.	361.	1.410E-03	1.367E-03	361.	1.941E-03 1.882E-03
E	355.	355.	1.896E-03	1.839E-03	355.	2.575E-03 2.496E-03
ESE	425.	425.	1.516E-03	1.470E-03	425.	1.818E-03 1.762E-03
SE	448.	448.	1.032E-03	1.001E-03	448.	1.147E-03 1.112E-03
SSE	540.	540.	5.186E-04	5.030E-04	540.	6.013E-04 5.830E-04
S	530.	530.	3.564E-04	3.457E-04	530.	4.307E-04 4.176E-04
SSW	540.	540.	3.743E-04	3.630E-04	540.	4.345E-04 4.213E-04
SW	632.	632.	2.254E-04	2.186E-04	632.	1.980E-04 1.920E-04
WSW	555.	555.	2.280E-04	2.212E-04	555.	1.855E-04 1.799E-04
W	500.	500.	3.175E-04	3.080E-04	500.	1.971E-04 1.911E-04
WNW	434.	434.	5.483E-04	5.319E-04	434.	4.559E-04 4.420E-04
NW	428.	428.	8.796E-04	8.532E-04	428.	9.766E-04 9.468E-04
NNW	442.	442.	1.222E-03	1.185E-03	442.	1.523E-03 1.477E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-131m

Downwind Direction	Restricted Area Bound Radius (meters)	Mixed Mode (Vent) Release Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)	VBAR ((uCi/sec))	Radius (meters)	G (mrad/yr)	GBAR ((uCi/sec))
N	305.	305.	3.585E-04	2.801E-04	305.	1.342E-03	1.040E-03
NNE	265.	265.	3.471E-04	2.710E-04	265.	1.225E-03	9.489E-04
NE	299.	299.	1.442E-04	1.135E-04	299.	8.221E-04	6.377E-04
ENE	361.	361.	1.274E-04	1.002E-04	361.	6.227E-04	4.832E-04
E	355.	355.	1.664E-04	1.307E-04	355.	8.136E-04	6.311E-04
ESE	425.	425.	1.406E-04	1.108E-04	425.	6.887E-04	5.349E-04
SE	448.	448.	1.152E-04	9.088E-05	448.	6.093E-04	4.733E-04
SSE	540.	540.	6.798E-05	5.395E-05	540.	3.772E-04	2.936E-04
S	530.	530.	6.550E-05	5.172E-05	530.	4.533E-04	3.523E-04
SSW	540.	540.	5.419E-05	4.299E-05	540.	3.656E-04	2.846E-04
SW	632.	632.	6.073E-05	4.813E-05	632.	3.620E-04	2.819E-04
WSW	555.	555.	8.569E-05	6.762E-05	555.	5.701E-04	4.435E-04
W	500.	500.	1.006E-04	7.904E-05	500.	6.184E-04	4.805E-04
WNW	434.	434.	1.391E-04	1.088E-04	434.	7.616E-04	5.907E-04
NW	428.	428.	1.429E-04	1.121E-04	428.	6.807E-04	5.285E-04
NNW	442.	442.	1.521E-04	1.194E-04	442.	7.027E-04	5.461E-04

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-133m

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode Radius (meters)	Release (Vent)		Ground Level Release		
			V (mrad/yr)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR (uCi/sec)
N	305.	305.	6.300E-04	5.411E-04	305.	2.135E-03	1.798E-03
NNE	265.	265.	6.053E-04	5.184E-04	265.	1.940E-03	1.632E-03
NE	299.	299.	2.759E-04	2.399E-04	299.	1.321E-03	1.115E-03
ENE	361.	361.	2.417E-04	2.099E-04	361.	1.005E-03	8.488E-04
E	355.	355.	3.110E-04	2.695E-04	355.	1.307E-03	1.103E-03
ESE	425.	425.	2.701E-04	2.350E-04	425.	1.125E-03	9.516E-04
SE	448.	448.	2.251E-04	1.964E-04	448.	9.971E-04	8.442E-04
SSE	540.	540.	1.413E-04	1.245E-04	540.	6.325E-04	5.379E-04
S	530.	530.	1.293E-04	1.131E-04	530.	7.461E-04	6.326E-04
SSW	540.	540.	1.123E-04	9.889E-05	540.	6.124E-04	5.209E-04
SW	632.	632.	1.243E-04	1.092E-04	632.	6.091E-04	5.186E-04
WSW	555.	555.	1.679E-04	1.466E-04	555.	9.488E-04	8.060E-04
W	500.	500.	1.883E-04	1.632E-04	500.	1.014E-03	8.589E-04
WNW	434.	434.	2.477E-04	2.129E-04	434.	1.222E-03	1.031E-03
NW	428.	428.	2.634E-04	2.277E-04	428.	1.107E-03	9.360E-04
NNW	442.	442.	2.813E-04	2.434E-04	442.	1.157E-03	9.803E-04

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-133

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode(Vent) Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR (uCi/sec)
N	305.	305.	6.810E-04	6.050E-04	305.	2.299E-03	2.013E-03
NNE	265.	265.	6.509E-04	5.774E-04	265.	2.084E-03	1.823E-03
NE	299.	299.	2.984E-04	2.679E-04	299.	1.431E-03	1.256E-03
ENE	361.	361.	2.612E-04	2.343E-04	361.	1.090E-03	9.571E-04
E	355.	355.	3.363E-04	3.011E-04	355.	1.414E-03	1.241E-03
ESE	425.	425.	2.954E-04	2.656E-04	425.	1.226E-03	1.079E-03
SE	448.	448.	2.460E-04	2.216E-04	448.	1.088E-03	9.581E-04
SSE	540.	540.	1.555E-04	1.411E-04	540.	6.963E-04	6.158E-04
S	530.	530.	1.408E-04	1.270E-04	530.	8.174E-04	7.209E-04
SSW	540.	540.	1.231E-04	1.117E-04	540.	6.754E-04	5.974E-04
SW	632.	632.	1.367E-04	1.238E-04	632.	6.726E-04	5.954E-04
WSW	555.	555.	1.830E-04	1.649E-04	555.	1.044E-03	9.224E-04
W	500.	500.	2.055E-04	1.842E-04	500.	1.108E-03	9.759E-04
WNW	434.	434.	2.689E-04	2.394E-04	434.	1.323E-03	1.160E-03
NW	428.	428.	2.860E-04	2.557E-04	428.	1.204E-03	1.059E-03
NNW	442.	442.	3.071E-04	2.749E-04	442.	1.266E-03	1.116E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-135m

Downwind Direction	Restricted Area Bound Radius (meters)	Mixed Mode(Vent) Release Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	305.	305.	4.596E-03	4.429E-03	305.	1.180E-02	1.135E-02
NNE	265.	265.	4.387E-03	4.227E-03	265.	1.125E-02	1.082E-02
NE	299.	299.	2.254E-03	2.174E-03	299.	7.028E-03	6.764E-03
ENE	361.	361.	1.883E-03	1.816E-03	361.	5.738E-03	5.523E-03
E	355.	355.	2.326E-03	2.242E-03	355.	7.076E-03	6.811E-03
ESE	425.	425.	2.121E-03	2.046E-03	425.	6.001E-03	5.778E-03
SE	448.	448.	1.723E-03	1.662E-03	448.	4.819E-03	4.640E-03
SSE	540.	540.	1.178E-03	1.137E-03	540.	3.220E-03	3.101E-03
S	530.	530.	9.052E-04	8.734E-04	530.	2.852E-03	2.747E-03
SSW	540.	540.	9.038E-04	8.720E-04	540.	2.739E-03	2.638E-03
SW	632.	632.	8.898E-04	8.587E-04	632.	2.532E-03	2.439E-03
WSW	555.	555.	1.092E-03	1.054E-03	555.	3.989E-03	3.842E-03
W	500.	500.	1.246E-03	1.202E-03	500.	4.617E-03	4.446E-03
WNW	434.	434.	1.593E-03	1.536E-03	434.	5.652E-03	5.441E-03
NW	428.	428.	1.869E-03	1.802E-03	428.	5.820E-03	5.603E-03
NNW	442.	442.	2.013E-03	1.940E-03	442.	5.812E-03	5.596E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-135

Downwind Direction	Restricted Area Bound Radius (meters)	Mixed Mode(Vent) Release Radius (meters)	Release		Ground Level Release		
			V	VBAR	Radius (meters)	G	GBAR
			(mrad/yr)	((uCi/sec)		(mrad/yr)	((uCi/sec)
N	305.	305.	3.039E-03	2.936E-03	305.	0.709E-03	3.406E-03
NNE	265.	265.	2.880E-03	2.781E-03	265.	7.856E-03	7.583E-03
NE	299.	299.	1.481E-03	1.431E-03	299.	5.482E-03	5.292E-03
ENE	361.	361.	1.284E-03	1.241E-03	361.	4.211E-03	4.065E-03
E	355.	355.	1.621E-03	1.567E-03	355.	5.425E-03	5.237E-03
ESE	425.	425.	1.455E-03	1.406E-03	425.	4.794E-03	4.629E-03
SE	448.	448.	1.235E-03	1.194E-03	448.	4.257E-03	4.110E-03
SSE	540.	540.	8.285E-04	8.008E-04	540.	2.811E-03	2.714E-03
S	530.	530.	7.163E-04	6.923E-04	530.	3.197E-03	3.087E-03
SSW	540.	540.	6.561E-04	6.342E-04	540.	2.709E-03	2.615E-03
SW	632.	632.	7.144E-04	6.906E-04	632.	2.708E-03	2.615E-03
WSW	555.	555.	9.205E-04	8.896E-04	555.	4.150E-03	4.007E-03
W	500.	500.	9.804E-04	9.473E-04	500.	4.340E-03	4.190E-03
WNW	434.	434.	1.210E-03	1.168E-03	434.	5.044E-03	4.869E-03
NW	428.	428.	1.348E-03	1.302E-03	428.	4.686E-03	4.524E-03
NNW	442.	442.	1.446E-03	1.397E-03	442.	4.987E-03	4.815E-03

BRAIDWOOD SITE METEOROLOGICAL DATA: 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-137

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode(Vent) Release Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	305.	305.	1.764E-03	1.707E-03	305.	3.915E-03	3.788E-03
NNE	265.	265.	1.712E-03	1.657E-03	265.	3.949E-03	3.821E-03
NE	299.	299.	8.519E-04	8.244E-04	299.	2.178E-03	2.108E-03
ENE	361.	361.	6.624E-04	6.410E-04	361.	1.748E-03	1.692E-03
E	355.	355.	8.157E-04	7.893E-04	355.	2.100E-03	2.032E-03
ESE	425.	425.	7.381E-04	7.142E-04	425.	1.690E-03	1.636E-03
SE	448.	448.	5.802E-04	5.615E-04	448.	1.259E-03	1.219E-03
SSE	540.	540.	3.822E-04	3.699E-04	540.	8.154E-04	7.890E-04
S	530.	530.	2.803E-04	2.713E-04	530.	6.471E-04	6.261E-04
SSW	540.	540.	2.864E-04	2.772E-04	540.	6.459E-04	6.250E-04
SW	632.	632.	2.577E-04	2.493E-04	632.	5.246E-04	5.076E-04
WSW	555.	555.	2.977E-04	2.881E-04	555.	7.771E-04	7.519E-04
W	500.	500.	3.453E-04	3.341E-04	500.	9.141E-04	8.844E-04
WNW	434.	434.	4.671E-04	4.520E-04	434.	1.275E-03	1.234E-03
NW	428.	428.	6.017E-04	5.823E-04	428.	1.543E-03	1.493E-03
NNW	442.	442.	6.784E-04	6.565E-04	442.	1.588E-03	1.537E-03

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-138

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode Radius (meters)	Mode(Vent) Release		Ground Level Release		
			V (mrad/yr)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)	GBAR (uCi/sec)
N	305.	305.	1.001E-02	9.714E-03	305.	2.457E-02	2.384E-02
NNE	265.	265.	9.553E-03	9.273E-03	265.	2.347E-02	2.278E-02
NE	299.	299.	5.016E-03	4.870E-03	299.	1.459E-02	1.416E-02
ENE	361.	361.	4.169E-03	4.048E-03	361.	1.195E-02	1.160E-02
E	355.	355.	5.137E-03	4.988E-03	355.	1.471E-02	1.427E-02
ESE	425.	425.	4.679E-03	4.543E-03	425.	1.247E-02	1.210E-02
SE	448.	448.	3.827E-03	3.716E-03	448.	9.982E-03	9.687E-03
SSE	540.	540.	2.630E-03	2.554E-03	540.	6.694E-03	6.497E-03
S	530.	530.	2.223E-03	1.964E-03	530.	5.857E-03	5.684E-03
SSW	540.	540.	2.021E-03	1.962E-03	540.	5.661E-03	5.495E-03
SW	632.	632.	1.991E-03	1.934E-03	632.	5.226E-03	5.072E-03
WSW	555.	555.	2.429E-03	2.359E-03	555.	8.199E-03	7.957E-03
W	500.	500.	2.739E-03	2.659E-03	500.	9.502E-03	9.221E-03
WNW	434.	434.	3.459E-03	3.358E-03	434.	1.164E-02	1.130E-02
NW	428.	428.	4.093E-03	3.974E-03	428.	1.207E-02	1.172E-02
NNW	442.	442.	4.399E-03	4.271E-03	442.	1.204E-02	1.169E-02

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Revision 1.8
October 1995

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on: 1 cm Depth at the Restricted Area Boundary for Ar-41

Downwind Direction	Restricted Area Bound (meters)	Mixed Mode(Vent) Release Radius (meters)	Release		Ground Level Release		
			V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	305.	305.	1.160E-02	1.122E-02	305.	3.106E-02	3.006E-02
NNE	265.	265.	1.101E-02	1.065E-02	265.	2.826E-02	2.736E-02
NE	299.	299.	5.833E-03	5.646E-03	299.	1.936E-02	1.874E-02
ENE	361.	361.	5.023E-03	4.863E-03	361.	1.505E-02	1.456E-02
E	355.	355.	6.295E-03	6.094E-03	355.	1.925E-02	1.864E-02
ESE	425.	425.	5.640E-03	5.459E-03	425.	1.689E-02	1.635E-02
SE	448.	448.	4.783E-03	4.630E-03	448.	1.477E-02	1.430E-02
SSE	540.	540.	3.262E-03	3.157E-03	540.	9.781E-03	9.468E-03
S	530.	530.	2.756E-03	2.667E-03	530.	1.066E-02	1.032E-02
SSW	540.	540.	2.580E-03	2.497E-03	540.	9.211E-03	8.917E-03
SW	632.	632.	2.748E-03	2.660E-03	632.	9.104E-03	8.813E-03
WSW	555.	555.	3.504E-03	3.392E-03	555.	1.404E-02	1.359E-02
W	500.	500.	3.715E-03	3.596E-03	500.	1.498E-02	1.450E-02
WNW	434.	434.	4.539E-03	4.393E-03	434.	1.753E-02	1.697E-02
NW	428.	428.	5.159E-03	4.994E-03	428.	1.652E-02	1.599E-02
NNW	442.	442.	5.499E-03	5.323E-03	442.	1.734E-02	1.679E-02

BRAIDWOOD SITE METEOROLOGICAL DATA 1/78 - 12/87

BRAIDWOOD

Supplemental Table A
Mixed Mode Joint Frequency Distribution Table Summaries
203 Foot Elevation Data

Summary Table of Percent by Direction and Class

Class	N	ENE	E	ESE	S	SSE	SW	WSW	W	WNW	NW	NNW	Total				
A	290	291	301	215	202	288	282	388	474	280	187	483	481	5 978			
B	157	241	240	208	157	188	239	252	186	192	151	227	228	3 572			
C	221	292	271	252	205	277	312	457	404	282	242	457	468	3 822			
D	1 523	1 880	2 168	1 874	1 272	1 916	2 831	1 800	1 688	2 108	2 248	2 181	2 912	18 512			
E	879	615	758	878	558	870	1 128	1 039	1 021	1 506	1 208	1 022	1 290	7 168			
F	246	271	289	208	207	459	520	428	328	397	588	417	588	2 888			
G	188	188	208	178	158	270	212	188	188	288	210	188	188	2 078			
Total	3 520	3 428	4 418	4 182	3 511	3 188	4 628	4 418	5 118	5 187	4 222	4 104	4 714	5 231	5 100	4 885	70 978

Summary Table of Percent by Direction and Speed

Speed	0	1-5	6-10	11-15	16-20	21-25	26-30	31-35	36-40	41-45	46-50	51-55	56-60	61-65	66-70	71-75	76-80	81-85	86-90	91-95	96-100	Total	
0	88	112	122	137	174	158	127	104	84	68	52	41	31	24	18	14	11	8	6	5	4	3	2
1-5	108	137	152	178	234	208	162	128	104	84	68	52	41	31	24	18	14	11	8	6	5	4	3
6-10	128	157	172	208	288	252	192	148	112	88	72	56	44	36	28	22	18	14	11	8	6	5	4
11-15	148	178	192	238	338	292	212	168	128	104	84	68	52	41	31	24	18	14	11	8	6	5	4
16-20	168	198	212	268	398	342	242	188	148	128	104	84	68	52	41	31	24	18	14	11	8	6	5
21-25	188	218	232	298	448	382	262	208	168	148	128	104	84	68	52	41	31	24	18	14	11	8	6
26-30	208	238	252	328	498	422	282	228	188	168	148	128	104	84	68	52	41	31	24	18	14	11	8
31-35	228	258	272	358	548	462	302	248	208	188	168	148	128	104	84	68	52	41	31	24	18	14	8
36-40	248	278	292	388	608	502	322	268	228	208	188	168	148	128	104	84	68	52	41	31	24	18	8
41-45	268	298	312	418	678	552	342	288	248	228	208	188	168	148	128	104	84	68	52	41	31	24	8
46-50	288	318	332	448	758	602	362	308	268	248	228	208	188	168	148	128	104	84	68	52	41	31	8
51-55	308	338	352	488	848	652	382	328	288	268	248	228	208	188	168	148	128	104	84	68	52	41	8
56-60	328	358	372	528	948	702	402	348	308	288	268	248	228	208	188	168	148	128	104	84	68	52	8
61-65	348	378	392	568	1 048	752	422	368	328	308	288	268	248	228	208	188	168	148	128	104	84	68	8
66-70	368	398	412	608	1 148	802	442	388	348	328	308	288	268	248	228	208	188	168	148	128	104	84	8
71-75	388	418	432	648	1 248	852	462	408	368	348	328	308	288	268	248	228	208	188	168	148	128	104	8
76-80	408	438	452	688	1 348	902	482	428	388	368	348	328	308	288	268	248	228	208	188	168	148	128	8
81-85	428	458	472	728	1 448	952	502	448	408	388	368	348	328	308	288	268	248	228	208	188	168	148	8
86-90	448	478	492	768	1 548	1 002	522	468	428	408	388	368	348	328	308	288	268	248	228	208	188	168	8
91-95	468	498	512	808	1 648	1 052	542	488	448	428	408	388	368	348	328	308	288	268	248	228	208	188	8
96-100	488	518	532	848	1 748	1 102	562	508	468	448	428	408	388	368	348	328	308	288	268	248	228	208	8
Total	2 520	2 520	2 428	2 418	2 511	2 188	2 628	2 418	3 118	3 187	2 222	2 104	2 714	2 231	2 100	1 885	1 978	1 885	1 790	1 695	1 600	1 505	70 978

NOTE:

Wind directions in tables are presented as "wind from" and not "wind to" direction.

In order to determine the final mixed mode values, 70.076% of the elevated value (presented in the 250 FT Mixed Mode table) and 29.924% of the ground level value (presented in the 30 FT Mixed Mode table) are used to calculate the final values.

Supplemental Table A - Continued
Mixed Mode Joint Frequency Distribution Table Summaries
203 Foot Elevation Data

Summary Table of Percent by Speed and Class

Class Speed	A	B	C	D	E	F	G
1.00	.002	.002	.003	.072	.002	.048	.020
2.00	.014	.032	.037	.200	.108	.071	.086
3.00	.178	.197	.272	1.785	.839	.373	.282
4.00	.800	.742	1.828	2.100	1.208	.662	.282
5.00	.802	.872	1.092	4.441	2.228	1.002	.075
6.00	.800	.808	.221	2.358	2.068	1.230	.088
7.00	.388	.822	1.286	1.280	2.207	1.017	.088
8.00	.328	.190	1.320	1.231	0.000	1.075	.091
9.00	.018	.011	.016	2.155	1.222	.255	.075
10.00	.000	.000	.000	.000	.081	.008	.062
11.00	.000	.000	.000	.000	.000	.000	.000
12.00	.000	.000	.000	.000	.000	.000	.000
13.00	.000	.000	.000	.000	.000	.000	.000
14.00	.000	.000	.000	.000	.000	.000	.000
15.00	.000	.000	.000	.000	.000	.000	.000
16.00	.000	.000	.000	.000	.000	.000	.000
17.00	.000	.000	.000	.000	.000	.000	.000
18.00	.000	.000	.000	.000	.000	.000	.000
19.00	.000	.000	.000	.000	.000	.000	.000
20.00	.000	.000	.000	.000	.000	.000	.000

Supplemental Table A - Continued
Mixed Mode Joint Frequency Distribution Table Summaries
34 Foot Elevation Data

Summary Table of Percent by Direction and Class

Class	N	ENE	NE	ESE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	WW	WNW	W	WNW	W	WNW	W	WNW	W	WNW	Total
A	.022	.071	.077	.084	.100	.076	.110	.136	.078	.218	.082	.080	.137	.270	.178	.257	.257	.178	.257	.257	.178	.257	.257	.178	2.155
B	.047	.044	.055	.031	.023	.048	.051	.053	.172	.123	.052	.052	.157	.270	.178	.257	.257	.178	.257	.257	.178	.257	.257	.178	1.287
C	.037	.059	.059	.044	.049	.059	.051	.154	.113	.123	.052	.052	.157	.270	.178	.257	.257	.178	.257	.257	.178	.257	.257	.178	3.008
D	.042	.051	.053	.043	.040	.042	.041	.120	.087	.120	.057	.057	.157	.270	.178	.257	.257	.178	.257	.257	.178	.257	.257	.178	3.008
E	.044	.047	.047	.040	.030	.038	.030	.100	.061	.100	.058	.058	.157	.270	.178	.257	.257	.178	.257	.257	.178	.257	.257	.178	3.008
F	.044	.047	.047	.040	.030	.038	.030	.100	.061	.100	.058	.058	.157	.270	.178	.257	.257	.178	.257	.257	.178	.257	.257	.178	3.008
G	.022	.059	.059	.044	.049	.059	.051	.154	.113	.123	.052	.052	.157	.270	.178	.257	.257	.178	.257	.257	.178	.257	.257	.178	3.008
Total	1.012	1.177	1.188	.860	.860	1.161	1.702	2.636	4.850	3.387	1.478	1.430	2.027	2.728	1.887	1.887	1.887	1.708	1.887	1.887	1.708	1.887	1.887	1.708	28.924

Summary Table of Percent by Direction and Speed

Speed	N	ENE	NE	ESE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	WW	WNW	W	WNW	W	WNW	W	WNW	W	WNW	Total
48	.014	.002	.014	.018	.010	.008	.004	.008	.001	.001	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000
1.00	.016	.018	.027	.048	.058	.051	.030	.038	.013	.010	.010	.018	.018	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000
2.00	.051	.052	.052	.031	.028	.050	.050	.058	.032	.032	.051	.047	.047	.018	.018	.018	.018	.018	.018	.018	.018	.018	.018	.018	.018
4.00	.121	.143	.173	.202	.188	.201	.208	.246	.288	.222	.188	.200	.222	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192
6.00	.158	.158	.157	.150	.173	.173	.173	.218	.288	.222	.188	.200	.222	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192
8.00	.120	.124	.158	.123	.152	.191	.208	.288	.222	.188	.200	.222	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192	.192
10.00	.143	.152	.166	.088	.088	.128	.110	.038	.118	.032	.030	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032
12.00	.119	.128	.158	.038	.011	.008	.028	.087	.160	.032	.030	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032	.032
14.00	.073	.078	.088	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000
16.00	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000
18.00	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000
Total	1.012	1.177	1.188	.860	.860	1.161	1.702	2.636	4.850	3.387	1.478	1.430	2.027	2.728	1.887	1.887	1.887	1.708	1.887	1.887	1.708	1.887	1.887	1.708	28.924

NOTE: Wind directions in tables are presented in "wind from" and not "wind to" direction.

BRAIDWOOD

Revision 1.8
October 1995

Supplemental Table A - Continued
Mixed Mode Joint Frequency Distribution Table Summaries
34 Foot Elevation Data

Summary Table of Percent by Speed and Class

Class Speed	A	B	C	D	E	F	G
1 08	.000	.001	.000	.000	.018	.021	.044
2 08	.001	.001	.003	.000	.128	.181	.076
3 08	.017	.020	.023	.028	.080	.021	.028
4 08	.127	.102	.127	1.18	1.170	.481	.188
5 08	.377	.182	.291	1.08	1.211	.323	.028
6 08	.332	.208	.274	1.870	1.178	.178	.028
7 08	.281	.218	.258	2.228	1.223	.078	.001
8 08	.738	.448	.332	3.892	1.848	.000	.001
10 08	.218	.128	.211	1.358	.527	.000	.000
13 08	.038	.040	.044	.438	.220	.024	.000
18 08	.001	.002	.004	.028	.000	.000	.000
23 08	.000	.000	.000	.000	.000	.000	.000

BRAIDWOOD

Supplemental Table B

Ground Level Joint Frequency Distribution Table Summaries

Summary Table of Percent by Direction and Class

Class	N	NNE	NE	ESE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	WW	WNW	Total
A	378	.418	.470	.384	.420	.381	.617	.418	.720	.627	.348	.228	.288	.872	.668	.608	7,320
B	360	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	8,208
C	360	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	8,208
D	2,028	2,232	2,436	2,640	2,844	3,048	3,252	3,456	3,660	3,864	4,068	4,272	4,476	4,680	4,884	5,088	7,500
E	360	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	.288	8,208
F	324	.324	.324	.324	.324	.324	.324	.324	.324	.324	.324	.324	.324	.324	.324	.324	7,872
G	144	.144	.144	.144	.144	.144	.144	.144	.144	.144	.144	.144	.144	.144	.144	.144	3,264
Total	6,888	5,760	5,184	4,608	4,032	3,456	2,880	2,304	1,728	1,152	584	132	8,600	7,752	6,900	6,152	100,000

Summary Table of Percent by Direction and Speed

Speed	N	NNE	NE	ESE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	WW	WNW	Total
1-50	184	.111	.128	.150	.170	.187	.211	.229	.256	.281	.307	.332	.357	.382	.407	.432	1,228
2-60	216	.263	.304	.345	.386	.427	.468	.509	.550	.591	.632	.673	.714	.755	.796	.837	1,872
3-70	252	.324	.375	.426	.477	.528	.579	.630	.681	.732	.783	.834	.885	.936	.987	1,038	2,328
4-80	288	.365	.426	.487	.548	.609	.670	.731	.792	.853	.914	.975	1,036	1,097	1,158	1,219	2,772
5-90	324	.406	.467	.528	.589	.650	.711	.772	.833	.894	.955	1,016	1,077	1,138	1,199	1,260	3,168
10-100	360	.447	.508	.569	.630	.691	.752	.813	.874	.935	.996	1,057	1,118	1,179	1,240	1,301	3,672
12-110	396	.488	.549	.610	.671	.732	.793	.854	.915	.976	1,037	1,098	1,159	1,220	1,281	1,342	4,176
14-120	432	.529	.590	.651	.712	.773	.834	.895	.956	1,017	1,078	1,139	1,200	1,261	1,322	1,383	4,680
16-130	468	.570	.631	.692	.753	.814	.875	.936	.997	1,058	1,119	1,180	1,241	1,302	1,363	1,424	5,184
18-140	504	.611	.672	.733	.794	.855	.916	.977	1,038	1,099	1,160	1,221	1,282	1,343	1,404	1,465	5,688
20-150	540	.652	.713	.774	.835	.896	.957	1,018	1,079	1,140	1,201	1,262	1,323	1,384	1,445	1,506	6,192
22-160	576	.693	.754	.815	.876	.937	.998	1,059	1,120	1,181	1,242	1,303	1,364	1,425	1,486	1,547	6,696
24-170	612	.734	.795	.856	.917	.978	1,039	1,100	1,161	1,222	1,283	1,344	1,405	1,466	1,527	1,588	7,200
26-180	648	.775	.836	.897	.958	1,019	1,080	1,141	1,202	1,263	1,324	1,385	1,446	1,507	1,568	1,629	7,704
28-190	684	.816	.877	.938	.999	1,060	1,121	1,182	1,243	1,304	1,365	1,426	1,487	1,548	1,609	1,670	8,208
30-200	720	.857	.918	.979	1,040	1,101	1,162	1,223	1,284	1,345	1,406	1,467	1,528	1,589	1,650	1,711	8,712
Total	6,888	5,760	5,184	4,608	4,032	3,456	2,880	2,304	1,728	1,152	584	132	8,600	7,752	6,900	6,152	100,000

NOTE: Wind directions in tables are presented in "wind from" and not "wind to" direction.

BRAIDWOOD

Supplemental Table B -Continued
Ground Level Joint Frequency Distribution Table Summaries

Summary Table of Percent by Sees and Class

Class Spaced	A	B	C	D	2	P	E
1 02	027	015	021	107	320	388	215
2 02	102	023	145	1 022	1 483	1 370	815
3 02	028	088	788	4 850	6 150	2 350	440
4 02	1 197	1 009	1 002	8 298	6 220	2 542	872
5 02	1 518	1 100	1 888	8 878	4 892	1 027	244
6 02	1 428	089	1 213	8 808	2 880	264	08
8 02	1 185	831	1 007	6 833	1 793	1 18	618
10 02	1 054	529	879	6 084	3 088	107	002
12 02	210	128	212	1 200	538	853	800
14 02	028	040	040	425	230	024	000
16 00	001	002	004	048	080	000	000
25 00	000	000	000	000	000	000	000

Kankakee River

Liquid Effluent Release Point

BRAIDWOOD

Revision 1.8
October 1995

Mishawic Blowdown
Corridor

Drainage Ditch

Unrestricted Area Boundary

Meteorological Tower

Freshwater
Holding Pond

Gaseous Effluent Release Point

Main Plant Structures

Pond Screen

Circulating
Water
Discharge

Essential Cooling Pond

Pond Elevation
895 FT @ W

Gateway

Exterior Ditch
@ 830 FT @ W

Spillway

Illinois Central Gulf Railroad


Interstate 55

Unrestricted Area Boundary

Scale 1000 0 1000 2000 Feet




300 0 600 Meters




OFFSITE DOSE CALCULATION MANUAL BRAIDWOOD STATION

FIGURE F-1

UNRESTRICTED AREA BOUNDARY

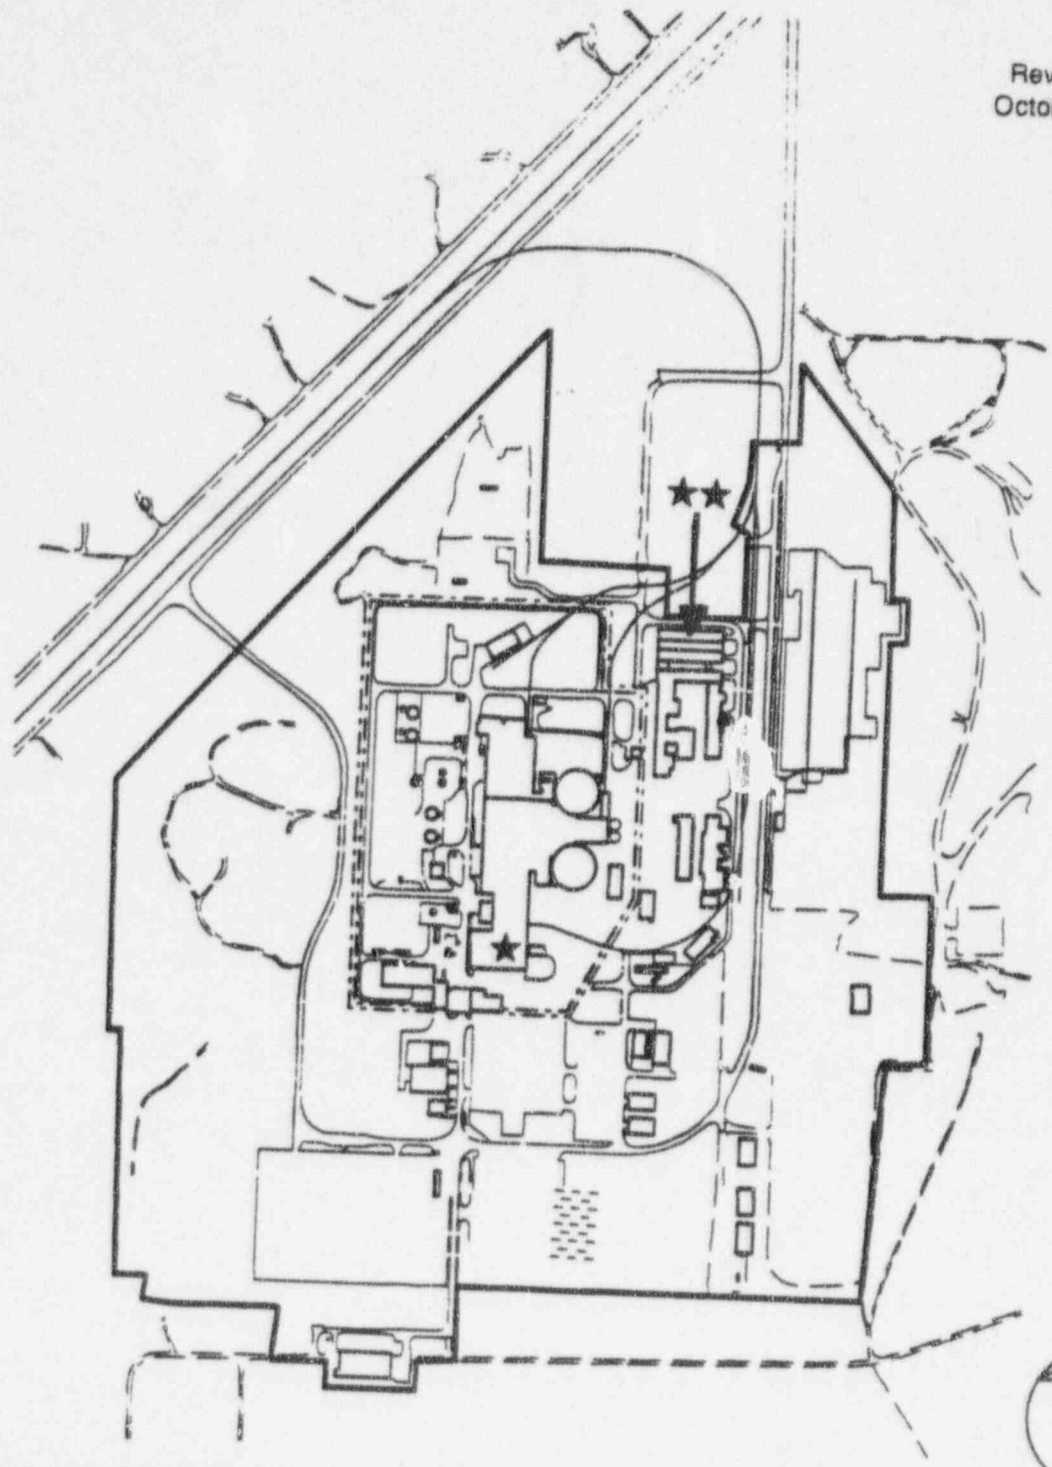

- ★ Low Level Radwaste Storage Building
(in Service Building Truck Bay)
- ★★ DAW Storage
- Restricted Area Boundary
- ▨ Radwaste Storage Area (When Operational, this area may include 8-packs, DAW, and other types of storage)

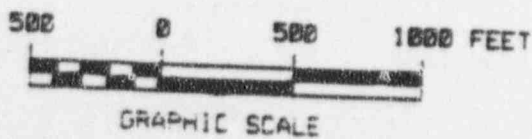

OFFSITE DOSE CALCULATION MANUAL
BRAIDWOOD STATION

FIGURE F-2
RESTRICTED AREA BOUNDARY