

Georgia Power Company  
Route 2, Box 299A  
Waynesboro, Georgia 30830  
Telephone 404 554-9961, Ext. 3360  
404 724-8114, Ext. 3360

D. O. Foster  
Vice President and Project  
General Manager  
Vogtle Project

JUL 20 9:46



July 11, 1984

United States Nuclear Regulatory Commission  
Office of Inspection and Enforcement  
Region II - Suite 3100  
101 Marietta Street  
Atlanta, Georgia 30303

File: X7BG10  
Log: GN-387

Reference: 50-424/84-11, 50-425/84-11

Attention: Mr. R. C. Lewis

The Georgia Power Company wishes to submit the following information concerning the violations discussed in your inspection report 50-424/84-11 and 50-425/84-11:

**Violation 50-424, 425/84-11-01, "Failure to Protect Electrical Equipment During Installation" - Severity Level IV.**

- (1) Georgia Power Company acknowledges the discrepancies identified in the violation.
- (2) Vogtle field procedure GD-T-09 provides adequate controls for the protection of electrical equipment during installation; however, precautions for maintaining the storage requirements for safety-related electrical cabinets in the Unit 1 Control Room were not adequately implemented during a time when multiple work activities were in progress in the area.
- (3) Due to the amount of cable termination and other work to be completed in the Unit 1 Control Room, additional controls have been implemented in this area to assure that the cleanliness of stored equipment is maintained. Contractors are required to report their work schedules for the Control Room area to the Georgia Power Company Area Manager a day in advance. The Area Manager will compare the schedules and make any adjustments necessary to ensure that equipment in storage in the area will not be exposed to detrimental contamination resulting from nearby activities. Cable termination work will usually be given priority over other work activities. The Area Manager will also designate personnel to continuously monitor work activities in the Control Room to ensure that adequate precautions

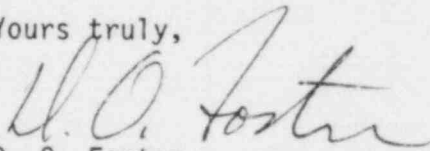
8408240367 840724  
PDR ADOCK 05000424  
G PDR

are taken to protect stored equipment. Georgia Power Company has an on-going program for cleaning stored equipment and all equipment stored in the Unit 1 Control Room area has been thoroughly cleaned.

- (4) To prevent further violation of equipment protection requirements, a system is being developed for all areas of the plant which will provide controls similar to those implemented in the Control Room area. A roster is being developed which will assign specific responsibilities to designated personnel to monitor work activities and conduct surveillance as necessary in each area of the plant to ensure that stored equipment is adequately protected from damage and/or contamination resulting from nearby construction activities. The training program for electrical termination crews will be upgraded to include instruction on how to handle situations where other work activities in the area of open equipment could adversely affect the equipment.
- (5) All corrective actions will be completed and full compliance with applicable regulatory requirements will be achieved by August 22, 1984.

This response contains no proprietary information and may be placed in the NRC Public Document Room.

Yours truly,

  
D. O. Foster

REF/DOF/t dm

xc: U. S. Nuclear Regulatory Commission  
Attn: Victor J. Stello, Jr., Director  
Office of Inspection and Enforcement  
Washington, D. C. 20555

R. J. Kelly  
R. E. Conway  
G. F. Head  
J. T. Beckham  
D. N. MacLemore  
D. E. Dutton  
W. F. Sanders  
R. H. Pinson  
B. M. Guthrie  
R. A. Thomas  
W. T. Nickerson

J. A. Bailey  
O. Batum  
H. H. Gregory  
C. W. Hayes  
E. D. Groover  
L. T. Gucwa  
M. Malcom  
G. Bockhold  
P. D. Rice  
J. L. Vota