NUCLEAR ENERGY BUSINESS OPERATIONS • GENERAL ELECTRIC COMPANY
SAN JOSE, CALIFORNIA 95125

GENERAL ELECTRIC

APPLICABLE TO:

PUBLICATION NO. NEDO-24229-1

T. I. E. NO. 80NED270

TITLE Peach Bottom Atomic Power Station Units 2 and 3 Single-Loop Operation

ISSUE DATE May 1980

ERRATA And ADDENDA SHEET

NO. 2

DATE June 1984

NOTE: Correct all copies of the applicable publication as specified below.

ITEM	REFERENCES (SECTION, PAGE PARAGRAPH, LINE)	INSTRUCTIONS (CORRECTIONS AND ADDITIONS)
1.	Page 5-5	Replace with new page 5-5. (Change bars in right-hand margin indicate where report has been revised.)

8409110262 840907
PDR ADOCK 05000277
P PDR

Table 5-1

MAPLHGR MULTIPLIER CASES

Unit	Fuel Type	Cases Calculated
2	7x7, 8x8,	100% DBA Suction Break
	8x8R, P8x8R, BP8x8R,	100% DBA Discharge Break
	and LTA	66% DBA Discharge Break*
3	7x7, 8x8,	100% DBA Suction Break
	8x8R, and P8x8R,	100% DBA Discharge Break
	and PTA	66% DBA Discharge Break*

*Most limiting break.

Table 5-2

LIMITING MAPLHGR REDUCTION FACTORS

Unit	Fuel Type	Reduction Factor
2	7x7	0.71
	8x8	0.82
	8x8R, P8x8R and BP8x8R	0.79
	LTA	0.79
3	7x7	0.71
	8x8	0.83
	8x8R and P8x8R	0.81
	PTA	0.81

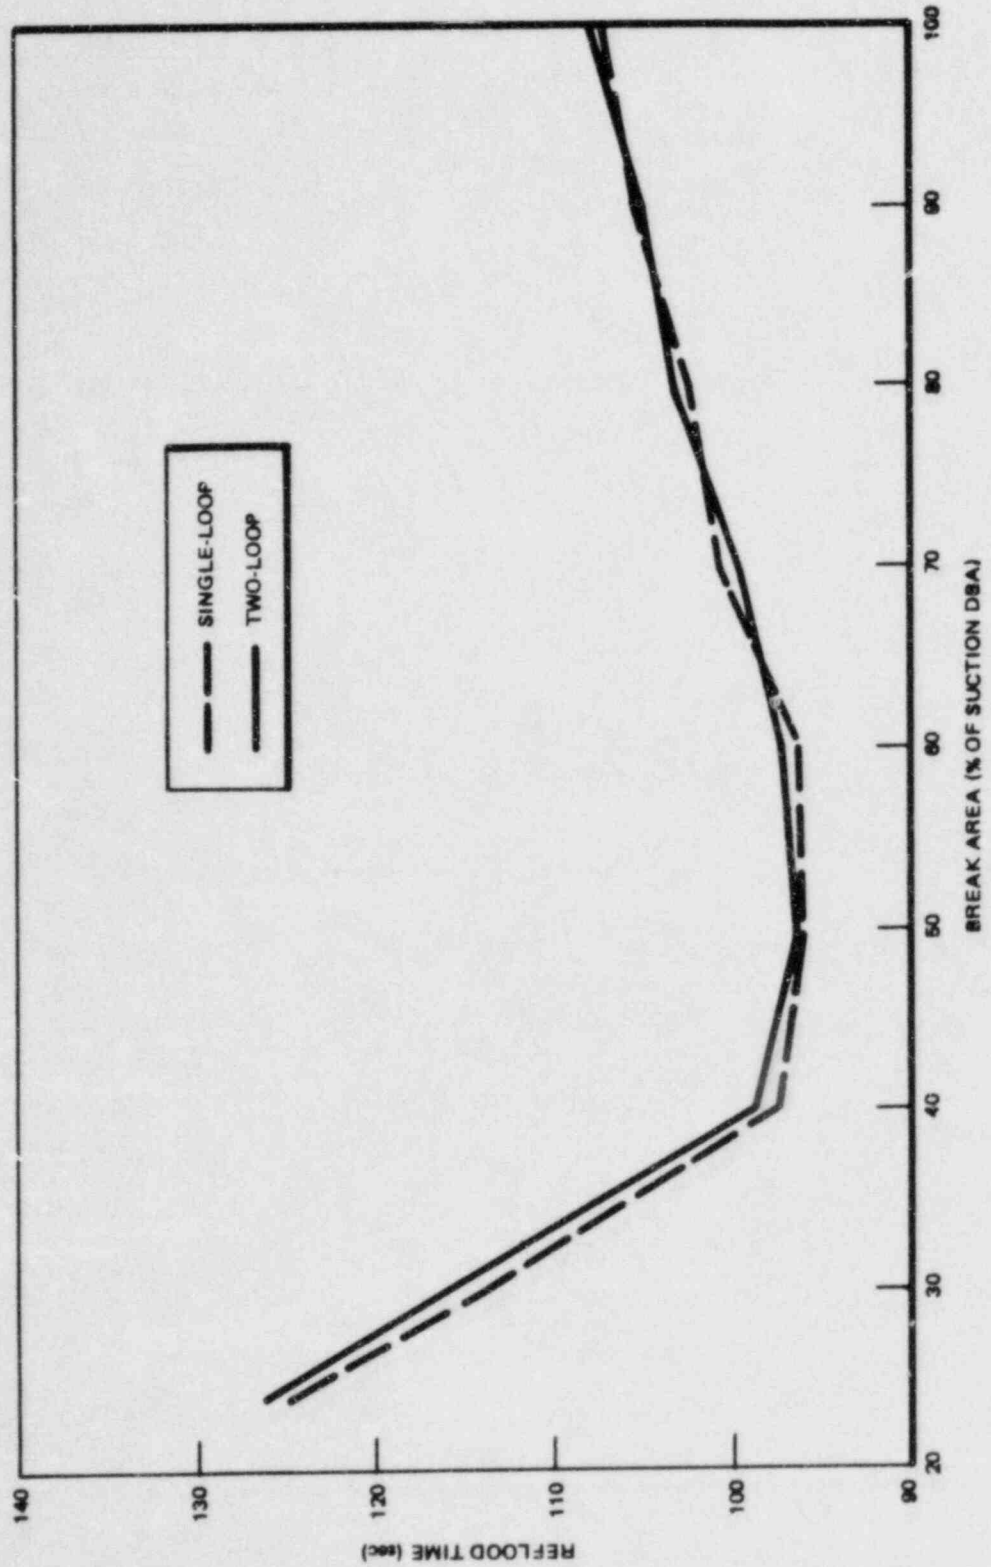

Figure 5-1. Peach Bottom 2 Suction Break Spectrum Reflood Times