

12945

DOCKET NUMBER  
PROD. & UTIL. FAC. 50-348/364 CIVP  
WINSTON & STRAWN

FREDERICK H. WINSTON (1853-1886)  
SILAS H. STRAWN (1821-1948)

1400 L STREET, N.W.  
WASHINGTON, D.C. 20005-3502

(202) 371-5700

FACSIMILE (202) 371-5950

DOCKETED  
USNRC  
CHICAGO OFFICE  
25 WEST WACKER DRIVE  
CHICAGO, ILLINOIS 60601

'92 APR 30 P1:58

NEW YORK OFFICE  
75 WATER STREET  
OFFICE OF GENERAL COUNSEL 10038-4981  
DOCKETING & RECORDS 10129 600-2500  
NY, NY

WRITER'S DIRECT DIAL NUMBER  
(202) 371-5726

April 29, 1992

G. Paul Bollwerk, III  
Administrative Judge  
Atomic Safety and Licensing Board  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

James H. Carpenter  
Administrative Judge  
Atomic Safety and Licensing Board  
Washington, D. C. 20555

Peter A. Morris  
Administrative Judge  
10825 South Glen Road  
Potomac, Maryland 20854

Dear Administrative Judges:

In preparing for the upcoming hearing, one oversight in the Surrebuttal Testimony of Alabama Power Company has come to our attention. Rather than awaiting introduction of the testimony, we are calling this to the attention of the Board and parties at this time to avoid any confusion.

Specifically, in the testimony of Mr. Love on Terminal Blocks (Volume II of the Surrebuttal Testimony), at page 146, Mr. Love states that he has marked Figures 1 and 2 (the figures appear on pages 147 and 148, respectively) "to indicate each simulated DBA on the profiles." However, the Figures as they appear in the bound volume were not so marked. Attached are copies of the figures as they should have appeared, marked by Mr. Love.

Other errata in the Surrebuttal Testimony on Terminal Blocks are noted in an attached errata sheet. Any additional errata, including any on other issues, will be provided at the hearing consistent with customary practice.

Respectfully submitted,

*David A. Repka*

David A. Repka  
Counsel for  
Alabama Power Company

Attachment:


cc: Service List

9206080057 920429  
PDR ADOCK 05000348  
PDR

D503

MARKED BY: Jesse E. Love

4/27/92

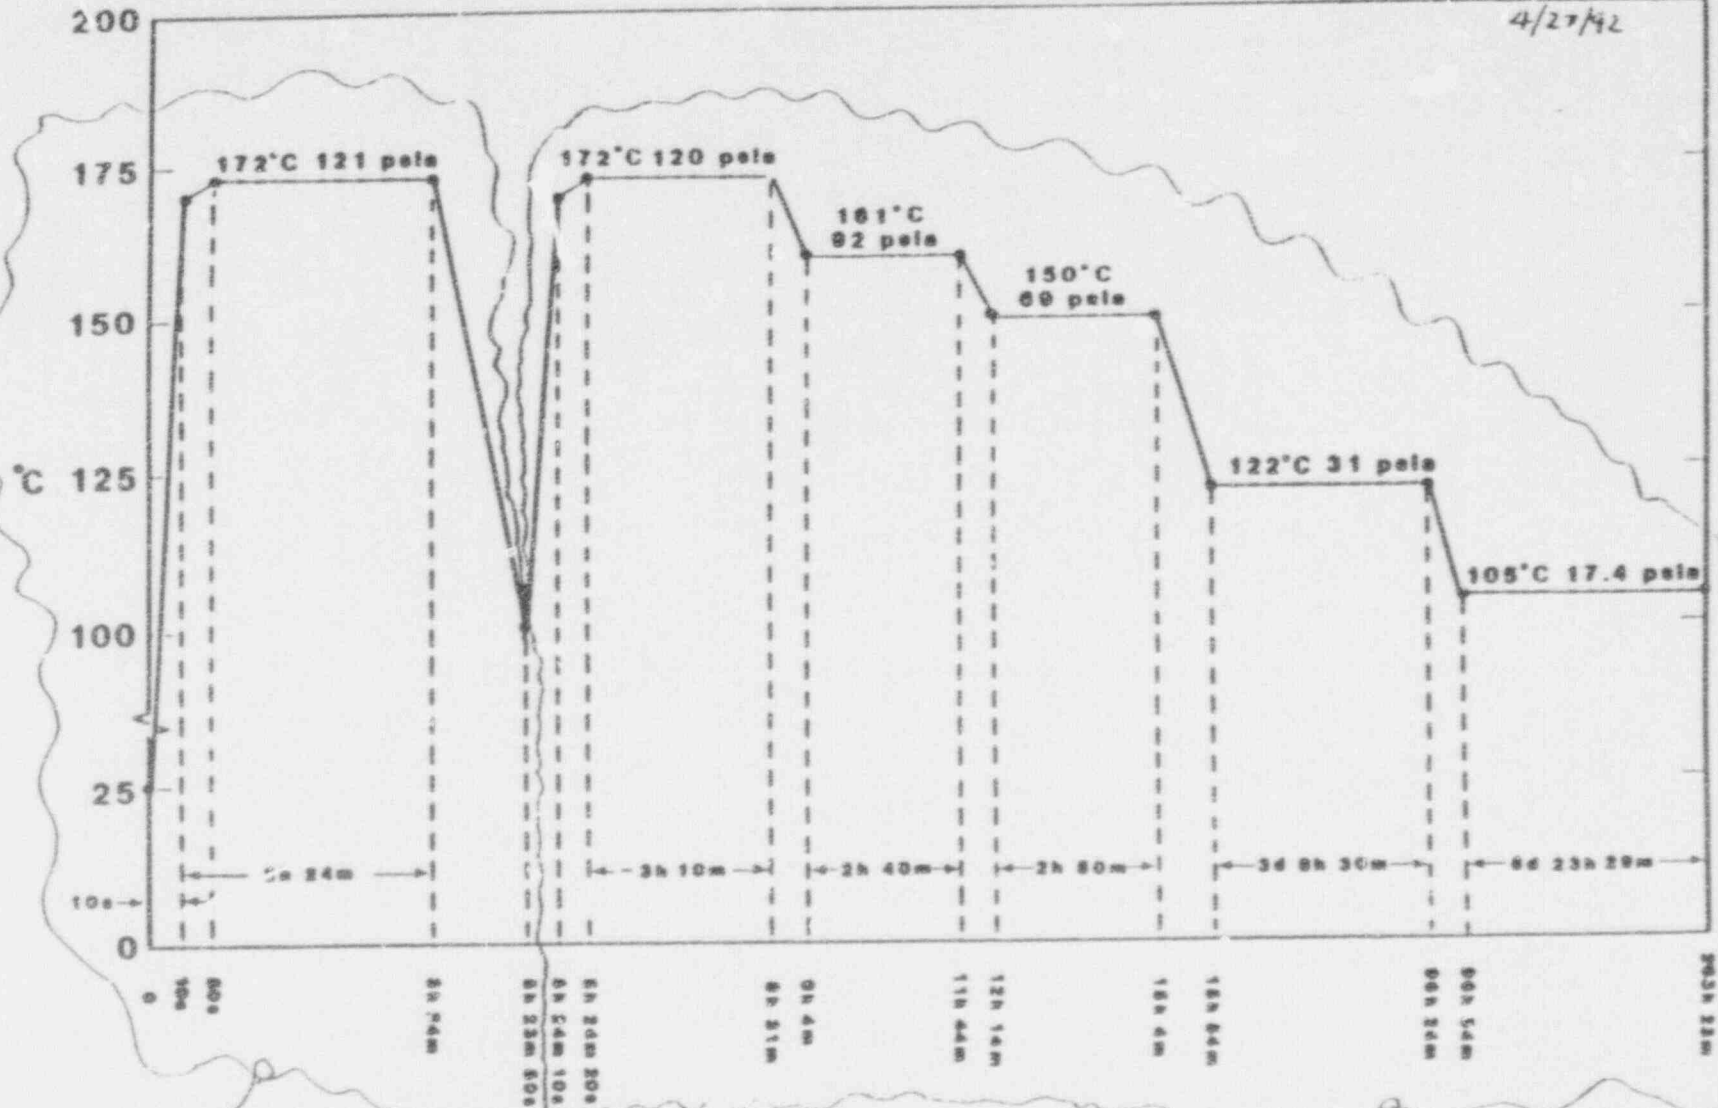


FIRST DBA Test

TOTAL ELAPSED TIME

SECOND DBA Test

Figure 1

Phase I Environmental Temperature Profile

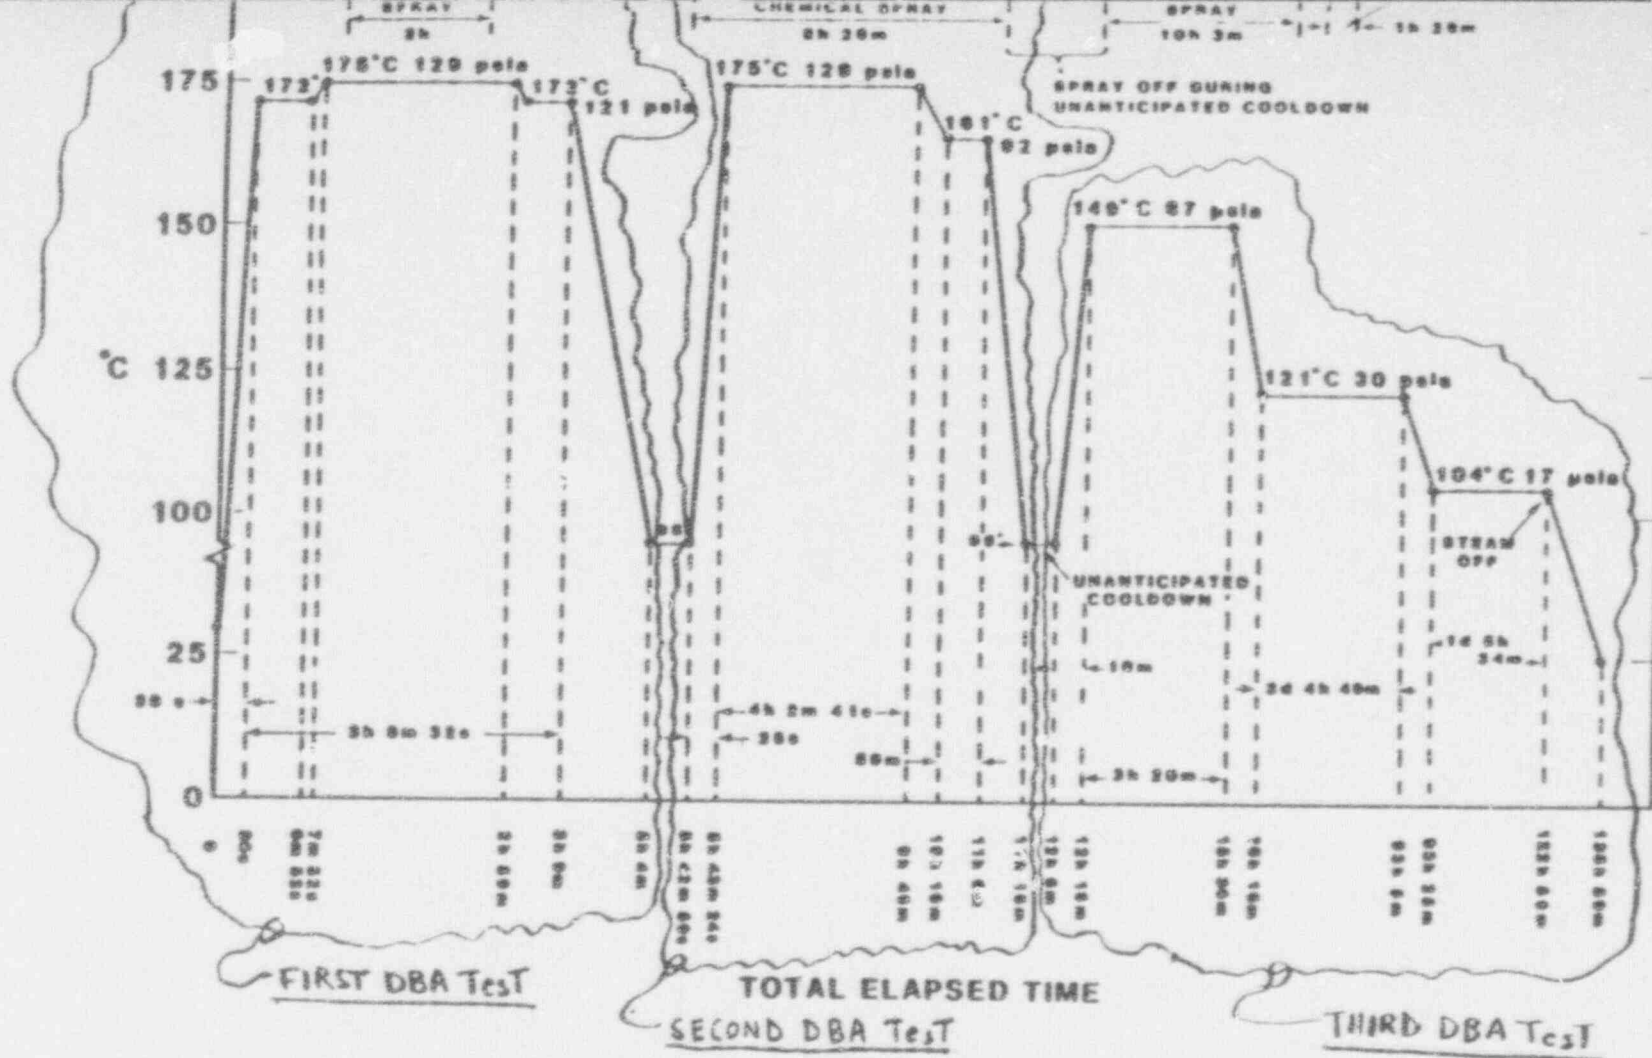

FIRST DBA Test  
TOTAL ELAPSED TIME  
SECOND DBA Test  
THIRD DBA Test

Figure 2

Phase II Environmental Temperature Profile

Section 11