


Reactor Internals GAP Analysis  
NUREG-2192 FER 3.1.2.2.9

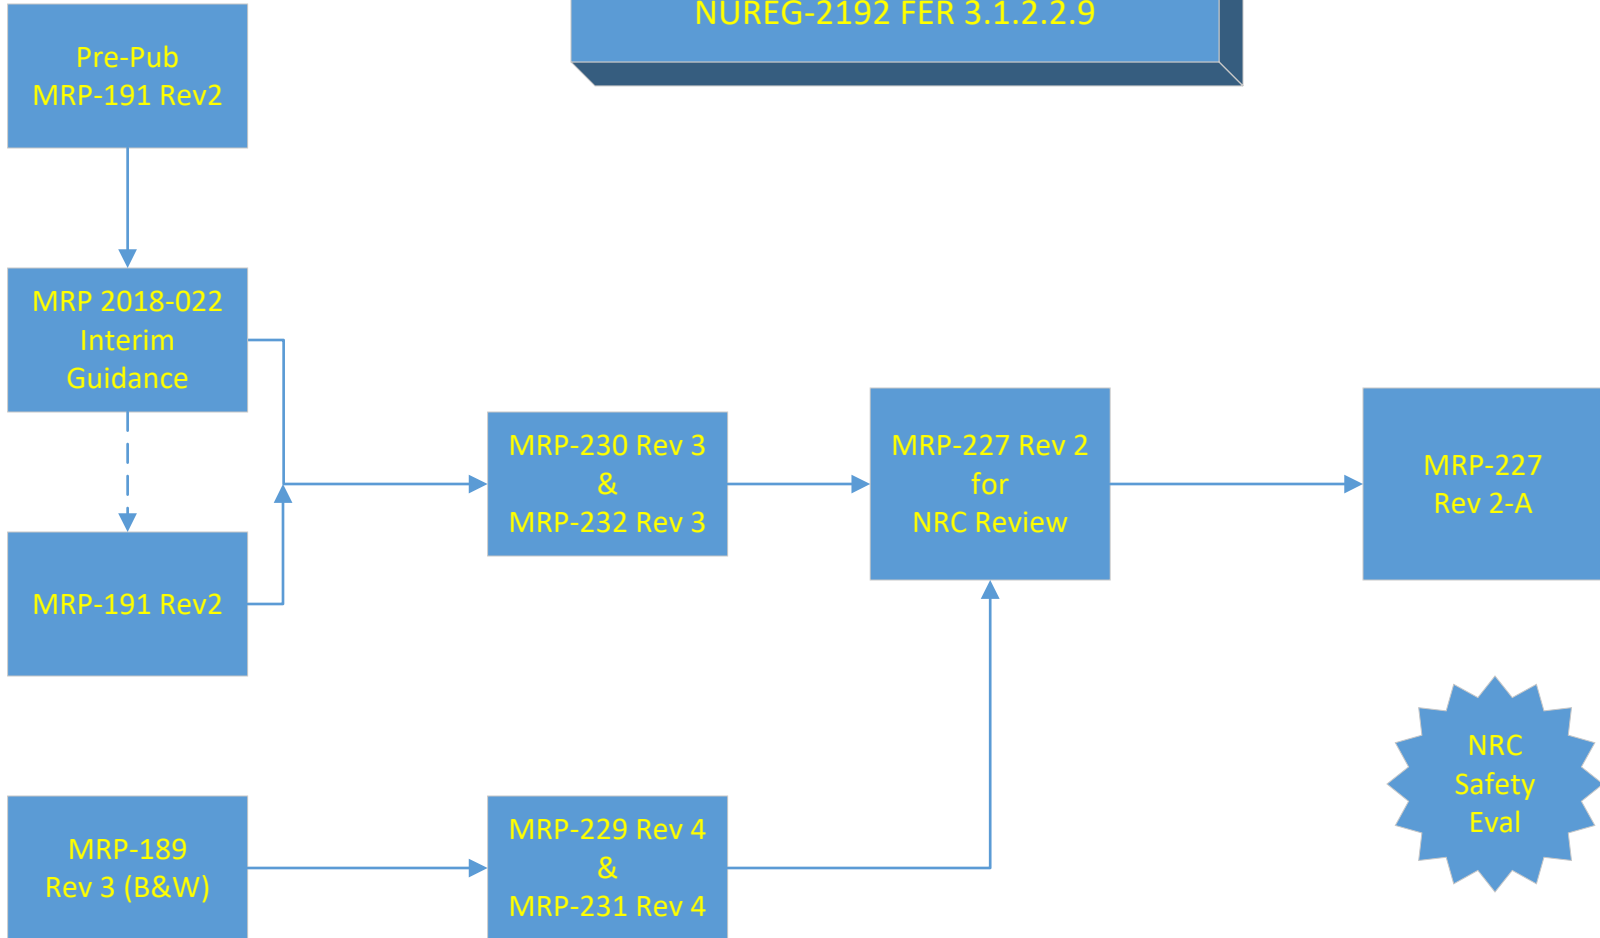

GAP Analysis Basis  
Prior to MRP-227 Rev 2

GAP Analysis Basis  
with MRP-227 Rev 2

No GAP Analysis  
Required