

Omaha Public Power District
1623 Harney Omaha, Nebraska 68102
402/536-4000

September 14, 1984
LIC-84-316

Mr. H. R. Denton, Director
U.S. Nuclear Regulatory Commission
Office of Nuclear Reactor Regulation
Division of Licensing
Washington, DC 20555


Reference: Docket No. 50-285

Dear Mr. Denton:

Fort Calhoun Station Unit No. 1
Updated Safety Analysis Report

The Omaha Public Power District's submittal dated July 20, 1984 contained among other things, revised text to Section 14.22 of the Fort Calhoun Station Updated Safety Analysis Report. Figures which accompany this text were omitted due to a clerical error. Please find attached 13 controlled copies of these figures.

Sincerely,



R. L. Andrews
Division Manager
Nuclear Production

RLA/DJM/rjb

Attch.

cc: LeBoeuf, Lamb, Leiby & MacRae - w/o attch.
1333 New Hampshire Avenue, N.W.
Washington, DC 20036

Mr. E. G. Tourigny - w/o attch.
Mr. L. A. Yandell - w/o attch.

8409250204 840914
PDR ADOCK 0500C285
P PDR

ATTACHMENT 5

Page 1 of 1


Updated Safety Analysis Report (USAR) Revision Transmittal Sheet

| | |
|--------|--------------------|
| #1 | September 13, 1984 |
| (Name) | (Date) |

The following page(s), figure(s) and/or table(s) to the USAR have been revised since the last revision to this document. You are requested to insert these replacement page(s) into your copy(s) and to discard the outdated page(s).

New or Revised
Page, Figure and/or Table Number(s)

Figure 14.22-1 to 14.22-4 were inadvertently omitted from July 20, 1984 package. Please insert attached pages and remove old pages, if not already done.

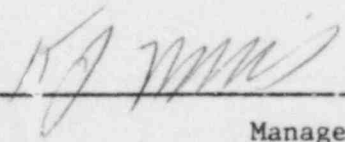

Manager - Administrative Services

I hereby acknowledge receipt of the page(s) identified above. The additional or revised page(s) have been included in my assigned copy of the USAR and the superceded page(s) have been removed and discarded.


Please sign and return this form within five (5) days to the:

Supervisor - Nuclear Regulatory and Industry Affairs
Omaha Public Power District
1623 Harney Street
Omaha, NE 68102

| | |
|-------------|------|
| | |
| USAR Holder | Date |

Note: If your copy of the USAR has been transferred to another person or address, please fill out the spaces below and return this form to the address identified above.


| | | |
|----------------|------------|---------|
| | | |
| Name of Holder | Department | |
| | | |
| | | Address |

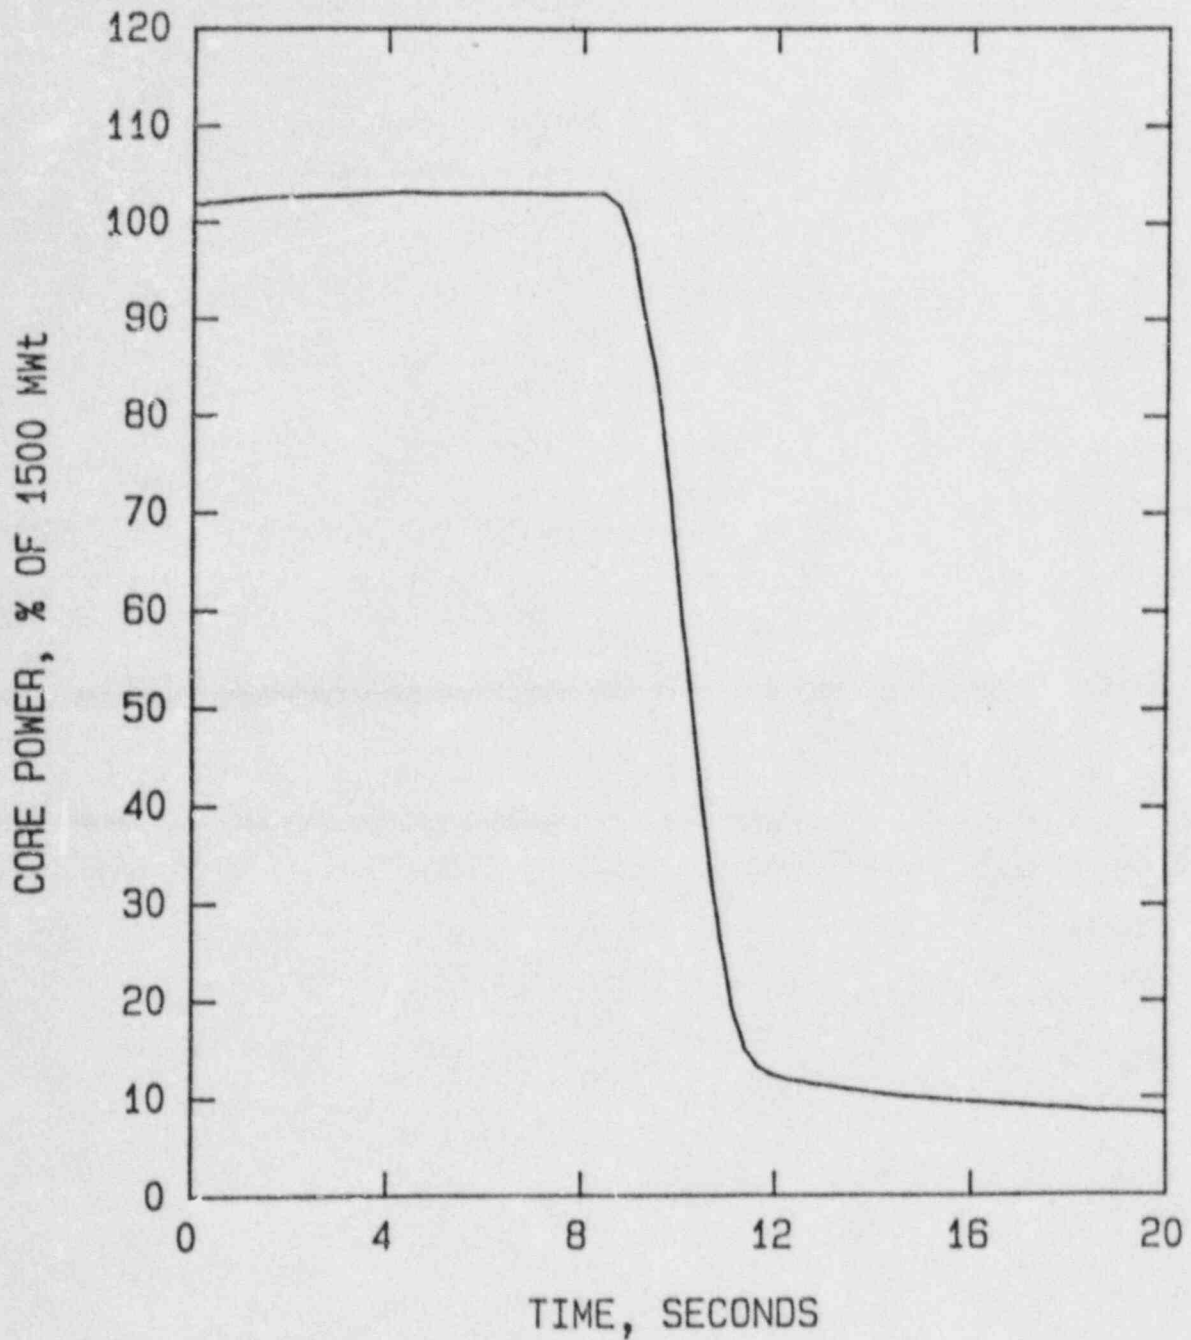

RCS Depressurization Incident
Core Power vs Time

Omaha Public Power District
Fort Calhoun Station-Unit No. 1


Figure
14.22-1

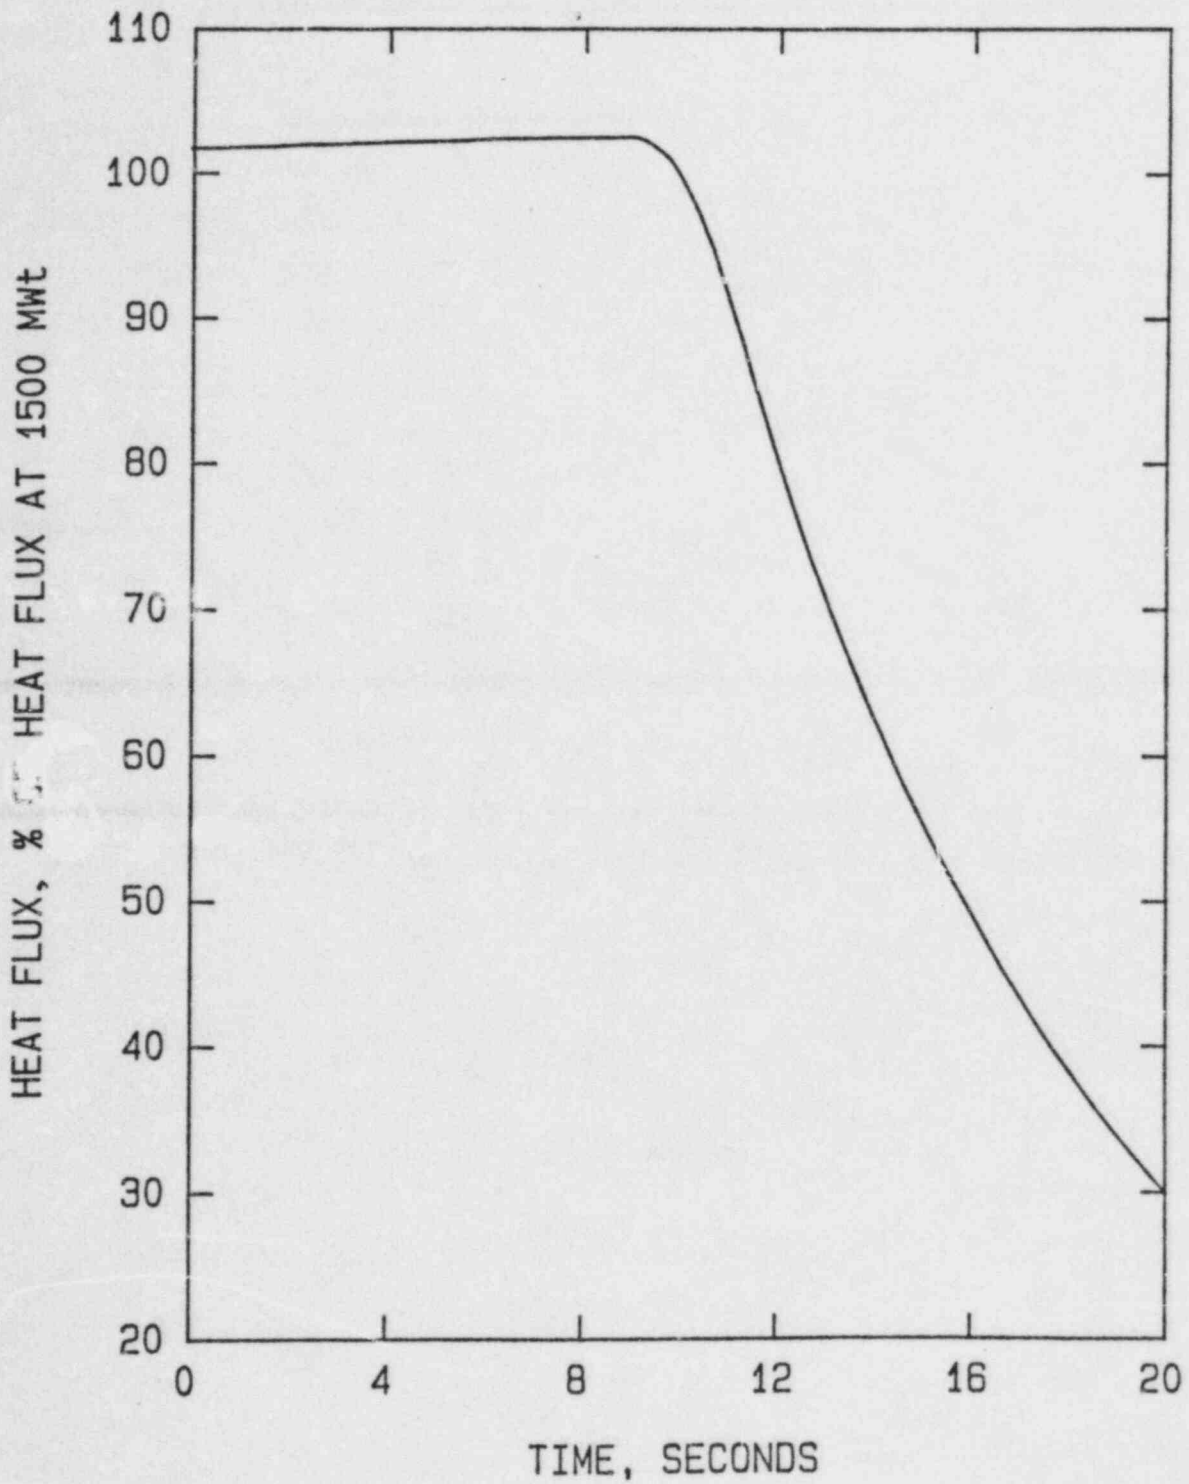

RCS Depressurization Incident
Core Average Heat Flux vs Time

Omaha Public Power District
Fort Calhoun Station-Unit No. 1


Figure
14.22-2

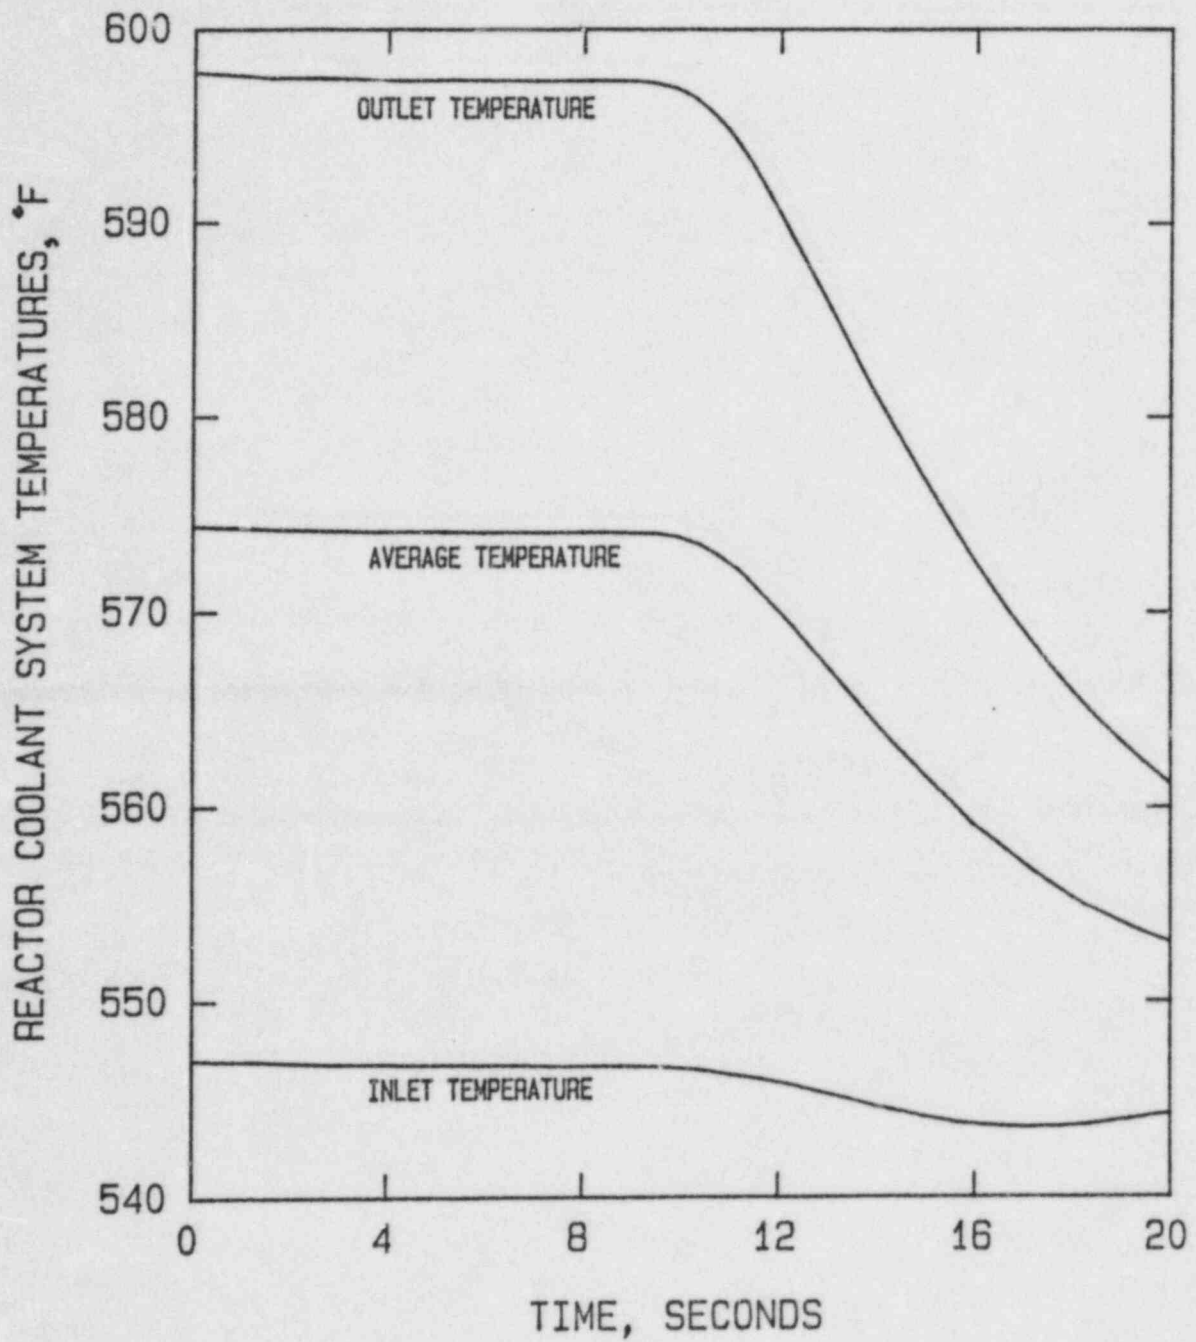

RCS Depressurization Incident
Coolant Temperatures vs Time

Omaha Public Power District
Fort Calhoun Station-Unit No. 1

Figure
14.22-3

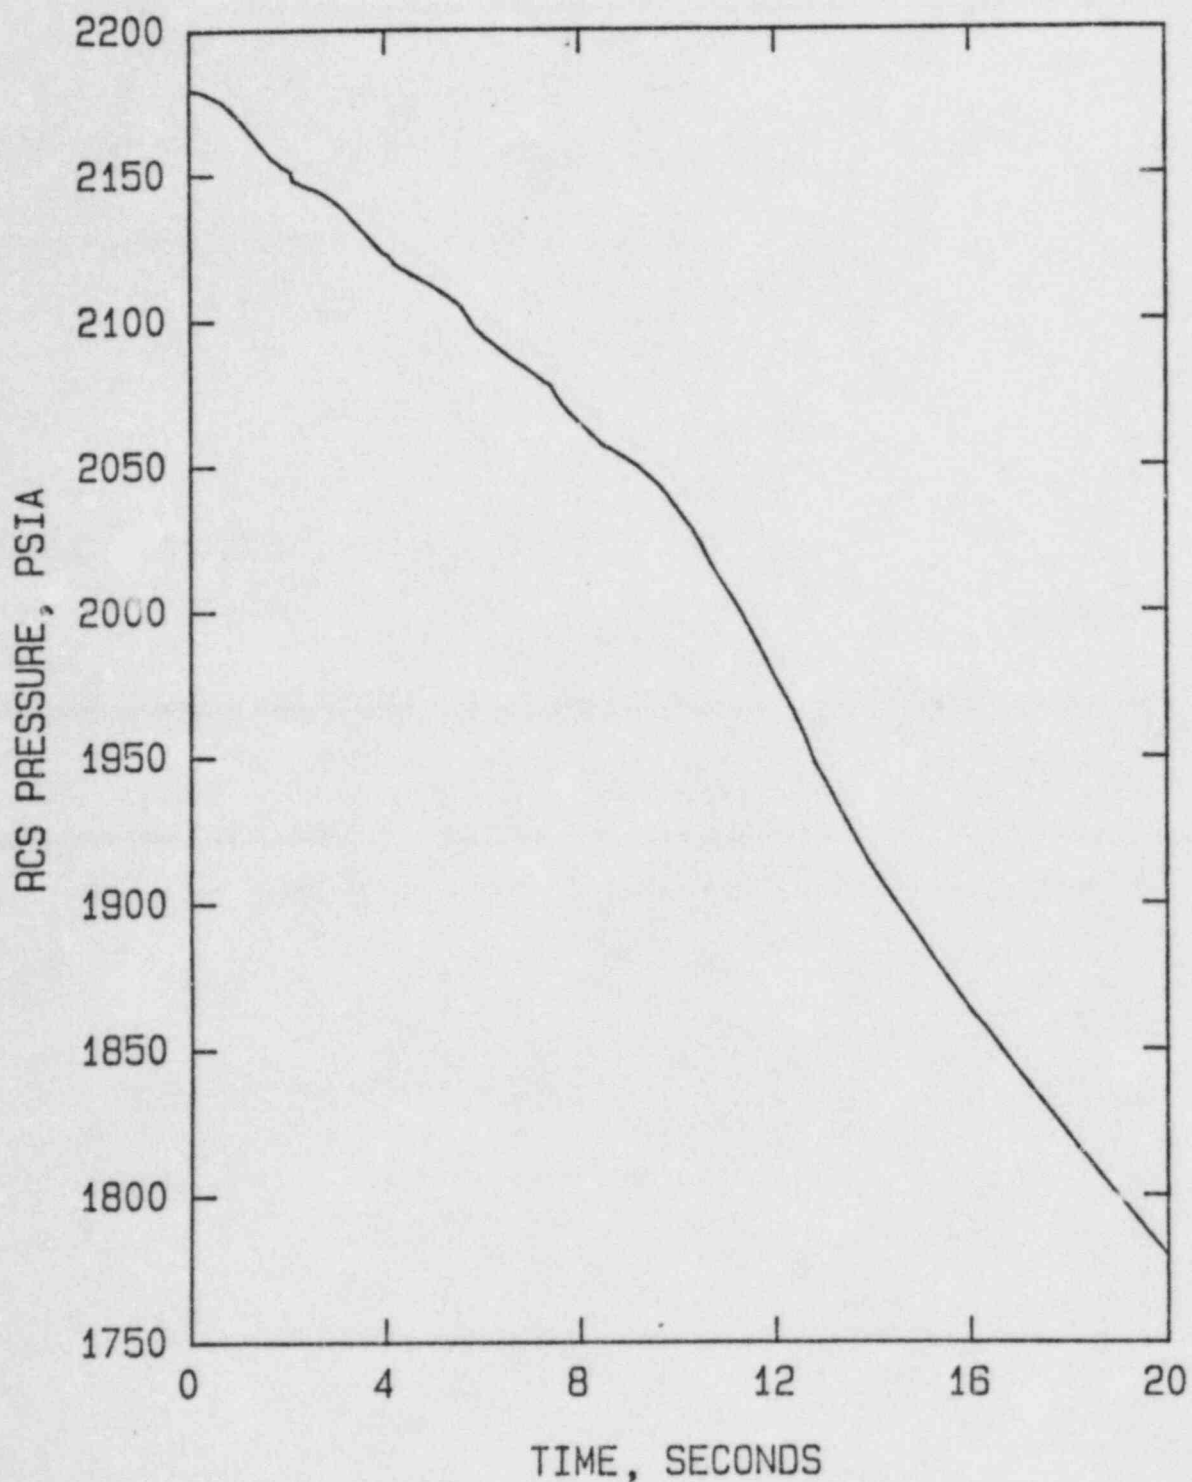

RCS Depressurization Incident
RCS Pressure vs Time

Omaha Public Power District
Fort Calhoun Station-Unit No. 1

Figure
14.22-4