

UNITED STATES OF AMERICA '84 OCT-1 A9:33  
NUCLEAR REGULATORY COMMISSION

BEFORE THE ATOMIC SAFETY AND LICENSING BOARD SERVICE  
BRANCH

In the Matter of )  
TEXAS UTILITIES ELECTRIC ) Docket Nos. 50-445 and  
COMPANY, ET AL. ) 50-446  
(Comanche Peak Steam Electric ) (Application for  
Station, Units 1 and 2) ) Operating Licenses)

AFFIDAVIT OF JOHN C. FINNERAN, JR. IN SUPPORT  
OF APPLICANTS' REPLY TO CASE'S ANSWER TO  
APPLICANTS' MOTION FOR SUMMARY DISPOSITION  
REGARDING LOCAL DISPLACEMENTS AND STRESSES

I, John C. Finneran, Jr., being first duly sworn hereby depose and state, as follows: I am the Project Pipe Support Engineer for the Comanche Peak Steam Electric Station. In this position I oversee the design work of all pipe support design organizations for Comanche Peak. A statement of my educational and professional qualifications was received into evidence as Applicants' Exhibit 142B.

Q. What is the purpose of this affidavit?

A. This affidavit provides information in support of Applicants' Reply to CASE's Answer to Applicants' Motion for Summary Disposition Regarding Consideration of Local Displacements and Stresses. I address below the arguments CASE presents in the affidavit of Mr. Doyle ("Affidavit"). CASE takes issue only with respect to Applicants first statement of material fact.

- Q. What is your response to CASE's first argument regarding Applicants' motion?
- A. CASE disputes Applicants' statement in Attachment A to my original affidavit regarding the effect of neglecting air film insulation in the calculation of the temperature of the tube steel (Affidavit at 3-4). It appears CASE misunderstands Applicants' statement and the principles of air film insulation. CASE seems to believe that the "air film" which Applicants mentioned is located at the interface, or point of contact, between the tube steel and the pipe. There is no air film at the point of contact of the pipe and box frame. This phenomenon occurs over the remainder of the surface area of the box frame. Its insulating effect serves to reduce the rate of heat transfer from the frame to the surrounding atmosphere, thereby causing the frame to expand further and reduce the stress between the pipe and frame. Thus, neglecting this effect as Applicants have done is conservative.
- Further, for the situation CASE apparently envisions to exist regarding air film, a gap between the frame and the pipe would have to be present. However, were such a gap to exist, which it does not, the pipe would be able to expand through that gap before contacting the frame thereby reducing the ultimate stress between the pipe and the frame. CASE apparently does not recognize this consideration.

Finally, I note that we have recently performed, at the request of the NRC Staff, a finite difference analysis of the temperature distribution within the box frame of this support. This analysis was provided to CASE with Applicants' letter to the NRC Staff, dated September 24, 1984. A copy of the results of that analysis is attached hereto as Attachment A. As demonstrated therein, Applicants' initial assumption for the temperature distribution in the box frame was very conservative. Applicants originally assumed an average temperature within the frame of 203° F. The finite difference analysis found that the minimum temperature within the frame is actually 206° F. The average temperature in the frame is greater than 220° F. At this higher temperature the frame will expand more than originally assumed and, thus, the stresses in the pipe and the frame will decrease. Accordingly, Applicants' original simplifying assumption was conservative, as we indicated at that time.

- Q. What is your reply to CASE's second point?
- A. CASE contends that the temperature gradient in the tube steel will vary along the tube from that existing through the tube at the point of contact of the frame and the pipe (Affidavit at 4). However, CASE does not point to any particular effect it believes this varying temperature gradient will have on Applicants' analysis. Consequently, it is not possible to respond directly to CASE's argument. It should be noted, nonetheless, that Applicants' finite

difference analysis mentioned above demonstrated that the temperature gradients along the tube are, in fact (as originally assumed) nearly linear across the frame and along the length of the tube away from the point of contact between the frame and the pipe (Attachment A; sh. 11 of 11). Thus, although the gradients do vary, Applicants' assumption of linearity for taking an average temperature of the tube was reasonable and, in fact, conservative given the conclusion from the finite element analysis that the lowest temperature in the frame ( $206^{\circ}\text{F}$ ) is actually higher than the average temperature ( $203^{\circ}\text{F}$ ) originally assumed. Thus, the expansion of the frame will actually be greater than initially estimated.

Q. What is your response to CASE's third assertion?

A. CASE asserts that the expansion of the frame calculated by Applicants will actually be "far less" because of the thermal gradients (Affidavit at 4). As I have already noted, Applicants' original assessment was appropriate and very conservative, actually underestimating the expansion of the frame. CASE's assertion to the contrary is simply wrong.

CASE also claims that the thermal gradients within the box frame will give rise to differential expansion of the frame, creating internal thermal stresses (Affidavit at 4-5). The Board has already ruled that such internal thermal

stresses need not be considered under the ASME Code  
(Memorandum and Order (Thermal Stress in Pipe Supports),  
July 6, 1983).

Q. What is your response to CASE's fourth argument?

A. CASE again asserts that the thermal gradients within the box frame are not linear (relying on CASE Exhibits 669B, Items 13E-13J) and, thus, stresses will be higher due to "direct bending . . . only as a result of thermal constraint" (Affidavit at 5). In the first instance, it is not possible to draw any meaningful conclusion by comparing CASE's exhibits with the support at issue here. Heat flow calculations involve many parameters and are highly dependent on configuration, proximity to the pipe, number of and extent of contact points with the pipe, etc. None of the configurations in CASE's exhibits are similar to the support involved here. Finally, to the extent CASE again argues that stresses resulting from "thermal constraint" need be considered, as I already noted the Board previously ruled that such stresses need not be considered.

Q. What is your reply to CASE's final argument?

A. CASE's final assertion is that Applicants' employed an incorrect value for Young's Modulus in calculating the expansion of the frame (Affidavit at 5). CASE apparently assumed Applicants employed an AISC formula for calculating the coefficient of thermal expansion. However, because this support is an ASME support, Applicants utilized the value

for the coefficient of thermal expansion set forth in Appendix I to Section III of the ASME Code. Applicants used the value set forth in Table I-50 (Attachment B) for the coefficient at 200° F ( $6.38 \times 10^{-6}$ ) adjusted for the 203° F temperature assumed for the frame ( $6.387 \times 10^{-6}$ ). Finally, it should be noted that although CASE apparently contends Applicants should have used the coefficient CASE derived, CASE does not acknowledge that to do so would be less conservative in that the expansion of the frame would be greater and, thus, lower stresses would be created in the frame and the pipe.

- Q. Do you have any further comments regarding CASE's assertions?
- A. To summarize my previous comments, I note that none of CASE's arguments raised valid concerns. CASE has failed to point to any significant effect that should have been, but was not, considered in Applicants' analysis.

John C. Finneran Jr.  
John C. Finneran, Jr.

STATE OF TEXAS  
COUNTY OF SAN SABA

Subscribed and sworn to before me this 28<sup>th</sup> day of September, 1984.

Bee J. Hodges  
Notary Public  
My Commission Expires MARCH 28, 1988

BY J. SHIN DATE 9/19/84

CHKD. BY Attieh DATE 9/19/84

CLIENT TUGC

PROJECT COMANCHE PEAK S.E.S

SUBJECT 3-D OPEN END BOX BEAM

SHEET 1 OF 1  
OFS NO 2970.002 DEPT NO 462

### Assumptions

- 1) Pipe surface temperature 350°F
- 2) Hollow box beams are located vertically.
- 3) Passing connecting air inside hollow box beam is 104°F.

To find Temperature distribution, a model for computer code HEATING 5 is utilized.

Proper natural heat convection inside gap between pipe and box beam, and inside hollow box beam is included. Radiation between pipe and box beams, and conduction thru direct contact are calculated with the proper input data by HEATING 5 in 3-D model. Also natural convection at the surface of box beams are accounted in the model.

The results are shown in the next page. II  
of calculation


## EBASCO SERVICES INCORPORATED

BY J. SHIN DATE 9/18/84CHKD. BY Beth DATE 9/19/84CLIENT TUGCPROJECT COMANCHE PEAK S.E.S.SUBJECT 3-D OPEN END BOX BEAMSHEET 1 OF 11OFS NO. 2970.002 DEPT. NO. 4462Reference)

1) FLOW OF FLUIDS - THROUGH VALVES, FITTINGS  
AND PIPE BY CRANE

2) Heat Transfer by A. J. Chapman  
Macmillan Co.

## EBASCO SERVICES INCORPORATED

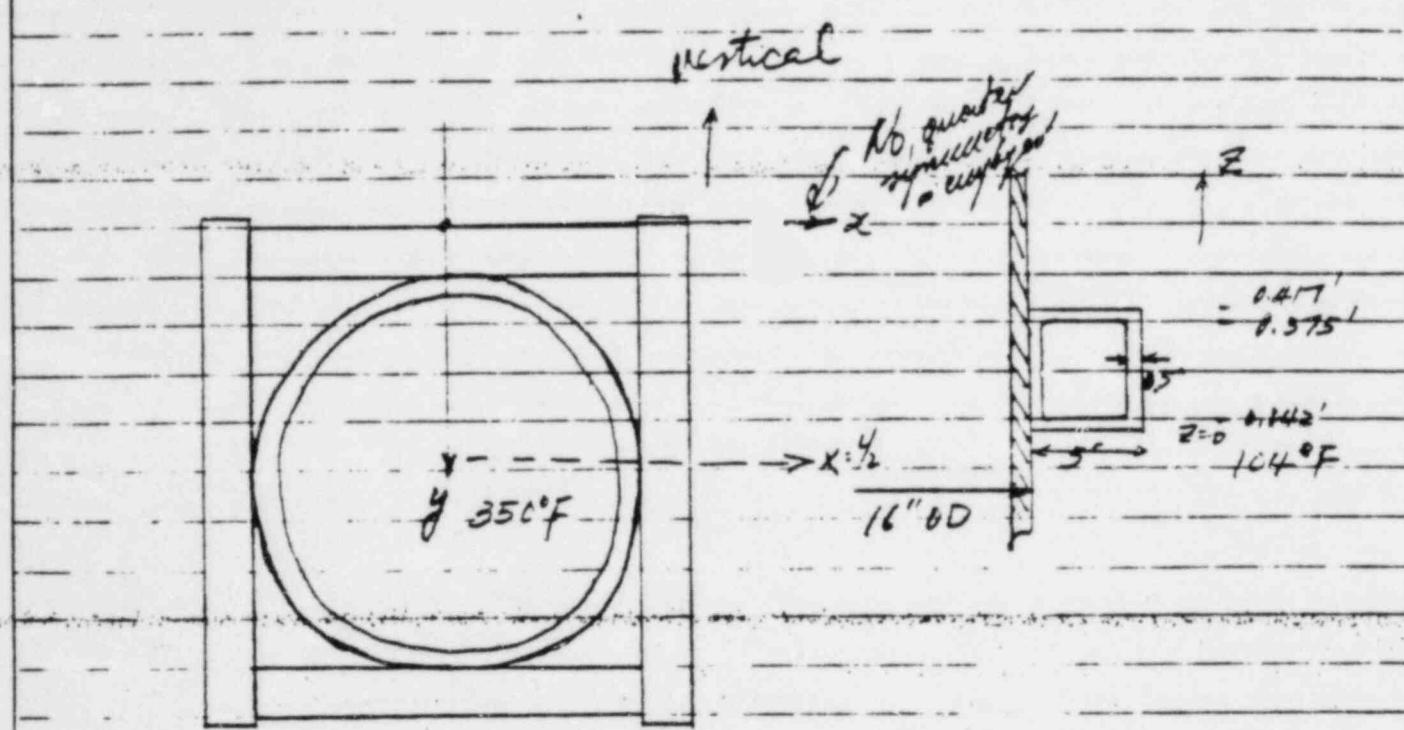BY J SHIN DATE 9/18/84CHKD. BY R. Scott DATE 9/10/84CLIENT TUGCPROJECT COMANCHE PEAK SESSUBJECT 3-D OPEN END BOX BEAMSSHEET 2 OF 11OFS NO 2970.002 DEPT. NO 462

Purpose: To find out temperature distribution  
of the box beam

### Major assumptions

- 1) Pipe surface temperature 350°F ✓
- 2) Hollow box beams are located vertically as shown in the figure. ✓
- 3) No significant grease is applied between pipe and box beam (or line contact)
- 4) Symmetry with respect to  $Z = \frac{X}{2}$  assumed and heat will transfer readily

BY J. SHIN DATE 9/15/84  
 CHKD. BY W.Lob DATE 9/19/84  
 CLIENT TUGC  
 PROJECT COMANCHE PEAK SES  
 SUBJECT 3-D OPEN END BOX BEAMS

SHEET 3 OF 11  
 OFS NO 2970.002 DEPT. NO 462

- 5) Passing connecting air inside hollow box  
 beam is  $104^{\circ}\text{F}$ , this is conservative since air will be  
 hotter
- 6) Air temperature of the gap between pipe  
 and box beam is  $104^{\circ}\text{F}$  for conservatism ok

To find Temperature distribution a model  
 for computer code HEATING 5 is considered  
 as depicted in the next page. (one quadrant considered)


Since height of roughness of commercial  
 stainless steel is  $0.00015\text{ inches}$ ,  $2 + 0.00015 = 2.00015$   
 is assumed as direct contact area. (Ref 1)

How to find radiation shape factor.

for gray body emissivity -  $\epsilon_1 = 0.95$  and  $\epsilon_2 = 0.95$   
 (Ref 2 Pg 426)

$$q_{12} = \frac{A_1 F_{1-2} \sigma (T_1^4 - T_2^4)}{\frac{T_1}{\epsilon_1} + \frac{1}{\epsilon_2} - 1}$$

$$0.1549857 \times 10^{-8} \quad \sigma: 0.1713 \times 10^{-8}$$

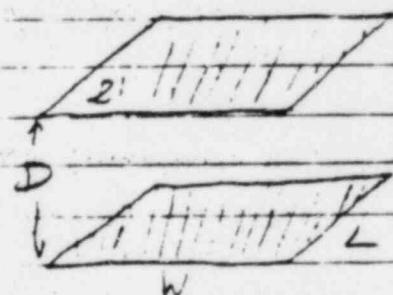

E#79 pg 5

## EDADIS SERVICES INCORPORATED

BY J. SHIN DATE 9/18/84

CHECKED BY PC DATE 9/19/84

CLIENT TUGC

PROJECT COMANCHE PEAK S.E.S.

SUBJECT 3-D OPEN END BOX BEAMS

SHEET 4 OF 11  
OPS NO 2970 012 DEPT NO 462

80' 0.042'	0.25'	0.417'	0.583' 0.667'	1.083' 1.042'
------------	-------	--------	---------------	---------------

(6)

Z

0.0	14
-----	----

0.042	
-------	--

16 AIR

Z=0.5" TO 4.5"

19 STEEL Z=0 TO 0.5"

20 STEEL Z=4.5" TO 5"

14

17 STEEL

Z=0 TO 0.5"

18 STEEL

Z=4.5" TO 5" 12



10	9	8	7	6
(8) 28	29 (9)	30 (9) 31 (13) 5		
13	15	23	24 32	

0.667

0.833

1.042'

1.083'

CIRCLED #: BOUNDARY CONDITIONS  
NON-CIRCLED #: REG OMS

## EBASCO SERVICES INCORPORATED

BY J. SHIN DATE 9/18/84CHKD. BY R.C.H. DATE 9/19/84CLIENT TUGCPROJECT CIMANCHE PEAK S.G.SSUBJECT 3-D OPEN END BOX BEAMSSHEET 5 OF 11  
OFS NO. 2970.002 DEPT. NO. 462

Where regions 13, 15, 23, 24, 25, 26 and 27 signify the pipe surface for this model and regions 28, 29, 30, 31, 32, 33, 34 and 35 are for gap.

FROM PAGE 3

Two parallel plates in the subdivided region

For gaps 35 and 28 (ref 2 page 320)

$$25'' \text{ long } 0.5'' \text{ gap} \quad f_{12} = A \cdot f_1 f_2 T_1 T_2$$

$$R_1 = \frac{L}{D} = \frac{5}{0.5} = 10 \quad f_{12} = 0.75 \rightarrow 1.1624 \times 10^{-9}$$

$$R_2 = \frac{W}{D} = \frac{2.5}{0.5} = 5$$

2" long 1" gap for gaps 30 and 29

$$R_1 = \frac{2}{1} = 2 \quad f_{12} = 0.53 \rightarrow 8.244 \times 10^{-10}$$

$$R_2 = \frac{2}{1} = 2$$

2" long 3" gap for gaps 33 and 30

$$R_1 = 1.667 \quad f_{12} = 0.2 \rightarrow 3.6997 \times 10^{-10}$$

$$R_2 = 0.667$$

0.5" long 6.5" gap

$$f_{12} = 0.0075 \rightarrow 1.1624 \times 10^{-11}$$

The foregoing radiation is between the pipe and box beams.

## EBASCO SERVICES INCORPORATED

BY J SHIN DATE 9/18/84

CHKD. BY John DATE 9/19/84

CLIENT TUGC

PROJECT CEMANCHE PEAK S.E.S.

SUBJECT 3-D OPEN END ED BEAMS

SHEET 6 OF 11

OFS NO. 2970.002 DEPT. NO. 462

To calculate natural convection in the gap between  
the pipe and the turbulent.

Chapman (Ref 2) pg 277, 275 and 418

Heat transfer coefficient for air  
for B.C ③ horizontal plates

$$h = 0.12 \left( \frac{st}{L} \right)^{1/4} = \frac{0.12}{\left( \frac{5}{12} \right)^{1/4}} (st)^{1/4} = 0.15 (st)^{1/4}$$

for E.C ④ vertical plates

$$h = 0.29 \left( \frac{st}{L} \right)^{1/4} = \frac{0.29}{\left( \frac{8}{12} \right)^{1/4}} (st)^{1/4} = 0.32 (st)^{1/4}$$

Heat transfer coeff. for E.C ①, ② and ⑧

Grashoff number should be calculated.

$$N_{Gr} = (\rho st) \left( \frac{L^3 g}{\nu^2} \right)$$

$$\text{Total set } \left( \frac{260 + 340}{2} + 104 \right) / 2 = 202 \rightarrow 200^\circ F$$

$$N_{Pr} = 0.694, \nu = 0.8636 \text{ ft}^2/\text{hr}$$

$$L = \frac{26}{12} = 2.17 \text{ ft}$$

$$\Delta t = \frac{260 - 340}{2} - 104 = 196^\circ F$$

J. SHIN DATE 9/18/84

SHEET 7 OF 11  
OFS NO. 2970.002 DEPT. NO. 462

CHKD. BY \_\_\_\_\_ DATE \_\_\_\_\_

CLIENT TUGC

PROJECT COMANCHE PEAK S.E.S

SUBJECT 3-D OPEN END BOX BEAMS

$$\beta = \frac{1}{T} = \frac{1}{460+200} = \frac{1}{660} \text{ : expansion coeff for air}$$

$$N_{Gr} P_n = \frac{196}{160} \left(\frac{26}{12}\right)^3 \frac{32.2 + 3600^2}{0.8636^2} * 0.692 \\ = 1.17 * 10^9 > 10^9$$

turbulent flow!

$$h = 0.19 (\delta t)^{4/3} \text{ for vertical plates}$$

$$h = 0.22 (\delta t)^{1/3} \text{ for horizontal plates}$$

This is ok for heat transfer from plate up, but overestimates heat transfer from plate down, which is bad since it will lead to cooler frame under surface

## EBASCO SERVICES INCORPORATED

BY W.H. Hart DATE 9/12/84  
 CHKD. BY DR. Lab DATE 9/19/84  
 CLIENT TUSI  
 PROJECT Circus Park  
 SUBJECT Heat Transfer f. tip =: Box


SHEET 8 OF 11  
 OFS NO. 5970,002 DEPT. NO. 462

Assuming conduction through an air space, an effective  
 distance  $d$  ft. from insulation can be calculated  
 assuming that the heat transfer time through the air  
 space is equal to that of insulation. This is a first approximation.

$$d = \frac{L}{k} = \frac{0.22}{\frac{8.5}{165 - d^2}} \quad L = \sqrt{165 - d^2}$$

in      ft       $\frac{8.5}{165 - d^2}$       in

direct contact	0	0	$\infty$	0
	1000.5	111.65	176.0	
	3.5	1.75	0.69	
	1.1	0.55	0.16	
	1.2		0.179	
gap conduction	0.4			
	1.8			
	0.6			0.506
	3.0			0.715
	4.4		4.165	1.00
	41.8	0.06667	2.3685	1.43

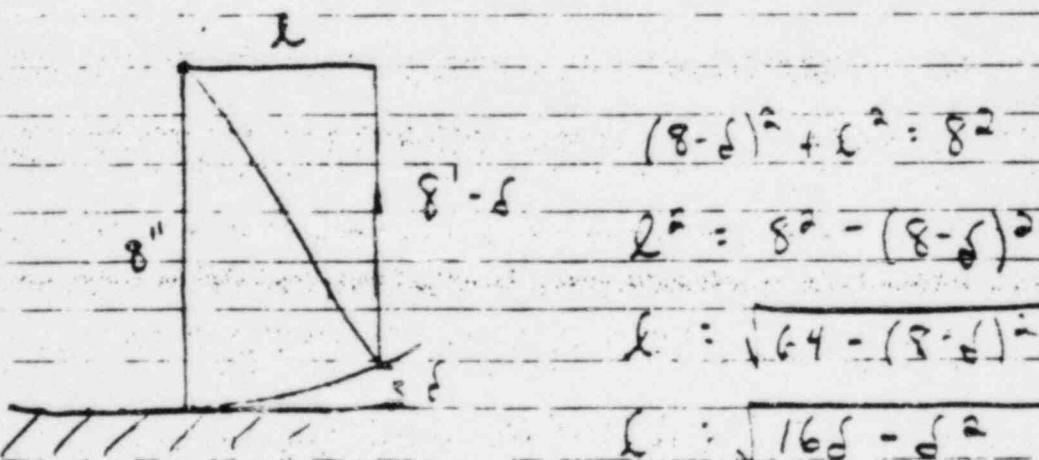

Height of ring areas of commercial stainless steel  
 0.00015 inches. Assuming direct contact as  
 2E or 0.003 inches.

## EBASCC SERVICES INCORPORATED

BY M ZURORSKI DATE 9/14/84

CHKD. BY PEL DATE 9/19/84

CLIENT TUGC

PROJECT CEMANCHE PEAK SES

SUBJECT 3-D OPEN END BOX BEAMS

SHEET 9 OF 11

OFS NO 2970 072 DEPT. NO 462

Update 1

Add 2 regions in contact and change  
 the BC for regions ① and ⑩ to include  
 heat conduction through air.  $h_{\text{air}} = 53$

corresponding to equivalent gap of .008"  
 length of contact .0053"

Regions 21 and 22 will have BC |  
 (ie contact temp. of 350°)

Region 1 and 10 will have new BC  
 ⑩, with  $h=53$  and radiation factor  
 factor 1.0 ie  $15.5 \times 10^{-10}$

$\frac{21}{24} 10$   
 0.25E-5 0.2

1.082975  
 1.083  
 0.702

EBASCO SERVICES INCORPORATED

BY J SHIN DATE 9/18/84  
CHKD BY RATI DATE 9/19/84  
CLIENT TUGC  
PROJECT COMANCHE PEAK S.E.S  
SUBJECT 3-D OPEN END BOX BEAMS

SHEET 10 OF 11  
OFF NO. 2970.012 DEPT. NO. 462

HEATING5 computer code was run with  
the foregoing model and input data.

The results are shown in the next page.

COPYBF, STAFF, HTR.

REWIND, HTR.

COPY, HTR, PHEAT5.

REWIND, HTR, PHEAT5.

BEGIN, HEAT5, HTR, 0, 0, 0, 0, 0, 0.

ATTACH, MPPROC, ID=GC3, PW=ITEL.

MPPROC, OUTPUT.

MEADDRS. M ZUZOVSKY EBASCO SERVICES INC. TOWER WORLD TRADE CENTER

MEADDRS. 99TH FLOOR NEW YORK, N.Y. 10048

MEINFOR. SEND BY FIRST CLASS MAIL-MAKE TWO COPIES

MEPRINT. TUSG - TEMPERATURE IN BOX BEAM AROUND PIPE 2

EXIT(U)

TUSG - TEMPERATURE IN TUBE STEEL FRAME 2

	3000	6	35	2	5	0	4	13
--	------	---	----	---	---	---	---	----

11	11	4						
----	----	---	--	--	--	--	--	--

1	750	5.7-6						
1	1	.667	.708	1.042	1.042975	0.0	.417	
1		10				8	8	
2	1	.667	.708	.863	1.042	0.0	.417	
1		13				8	8	
3	1	.667	.708	.667	.833	0.0	.417	
1		13				8	8	
4	1	.667	.708	.500	.667	0.0	.417	
1		13				8	8	
5	1	.667	.708	.417	.500	0.0	.417	
1		13				0	0	
6	1	.583	.667	.375	.417	0.0	.417	
1		1	.417	.583	.375	0.0	.417	
7						8	8	
8	1	.250	.417	.375	.417	0.0	.417	
1						8	8	
9	1	.042	.250	.375	.417	0.0	.417	
1						8	8	
10	1	2.57-5	0.242	.375	.417	0.0	.417	
1						8	8	
11	1	0.0	.708	0.1	0.042	0.0	.417	
1						8	8	
12	1	1.042	1.043	0.0	1.043	0.	.417	
13	1	.042	.250	.417	.500	0.0	.417	
1						8	8	
14	1	.667	.708	.042	.417	0.0	.417	
2						8	8	
15	1	.250	.417	.42	.5	0	.417	
1						8	8	
16	2	0.0	.667	.042	.375	.042	.375	
2						8	8	
17	1	.708	1.042	0.0	1.043	0.0	.042	
2						8	8	
18	1	.708	1.042	0.0	1.043	.375	.417	
2						8	8	
19	1	0.0	.667	.042	.375	0.0	.042	
2						8	8	
20	1	0.0	.667	.042	.375	.375	.417	
2						8	8	
21	1	.667	.708	1.042975	1.043	0.0	.417	
1		1				8	8	
22	1	0.0	2.57-5	.375	.417	0.0	.417	
1						8	8	
23	1	.417	.583	.417	.500	0.0	.417	
1						8	8	

26	1	.553	.66	.617	.673	.0	.417
27	1	.553	.66	.617	1.042	.0	.417
28	1	.042	.25	.417	.420	.0	.417
29		.250	.417	.417	.420	.0	.417
30		.417	.583	.417	.420	.0	.417
31		.583	.66	.417	.420	.0	.417
32		.660	.667	.617	.500	.0	.417
33		.660	.667	.510	.667	.0	.417
34		.660	.567	.667	.633	.0	.417
35		.660	.667	.673	1.042	.0	.417

2	AIR	.0170
1	CSTEEL	25.70
1	350.	
2	250.	
2	200.	
4	150.	
1	2	350.

11.65-10	3						
8.21E-10	3						
3.100E-10	3						
.1155E-10	3						
1	104.0						
	.220	.333					
1	104.0						
	.190	.333					
1	104.0						
	.190	.333					
=	1	104.0					
	.150	.25					
1	1	350.0					
53.	15.55-10						
11	3						
12	2	.239	.25				
13	1	104.					
	.320	.25					
0.0	2.55-5	.042	.250	.417	.583	.660	.667
.750	1.042	1.042					
1	1	2	2	2	1	1	1
1	1						
0.0	.042	.375	.417	.427	.500	.667	.833
1.042	1.042-75	1.042					
1	2	1	1	1	2	2	2
1	1						
0.0	.042	.375	.417				
1	3	1	1				

BY S. SHIN DATE 9/18/84


CHKD BY \_\_\_\_\_ DATE \_\_\_\_\_

CLIENT TUSC

PROJECT COMANCHE PEAK S.E.S.

SUBJECT Z-D OPEN END BOX BEAMS

Sheet 11 of 11  
OPN NO 2970 012 DEPT NO 462

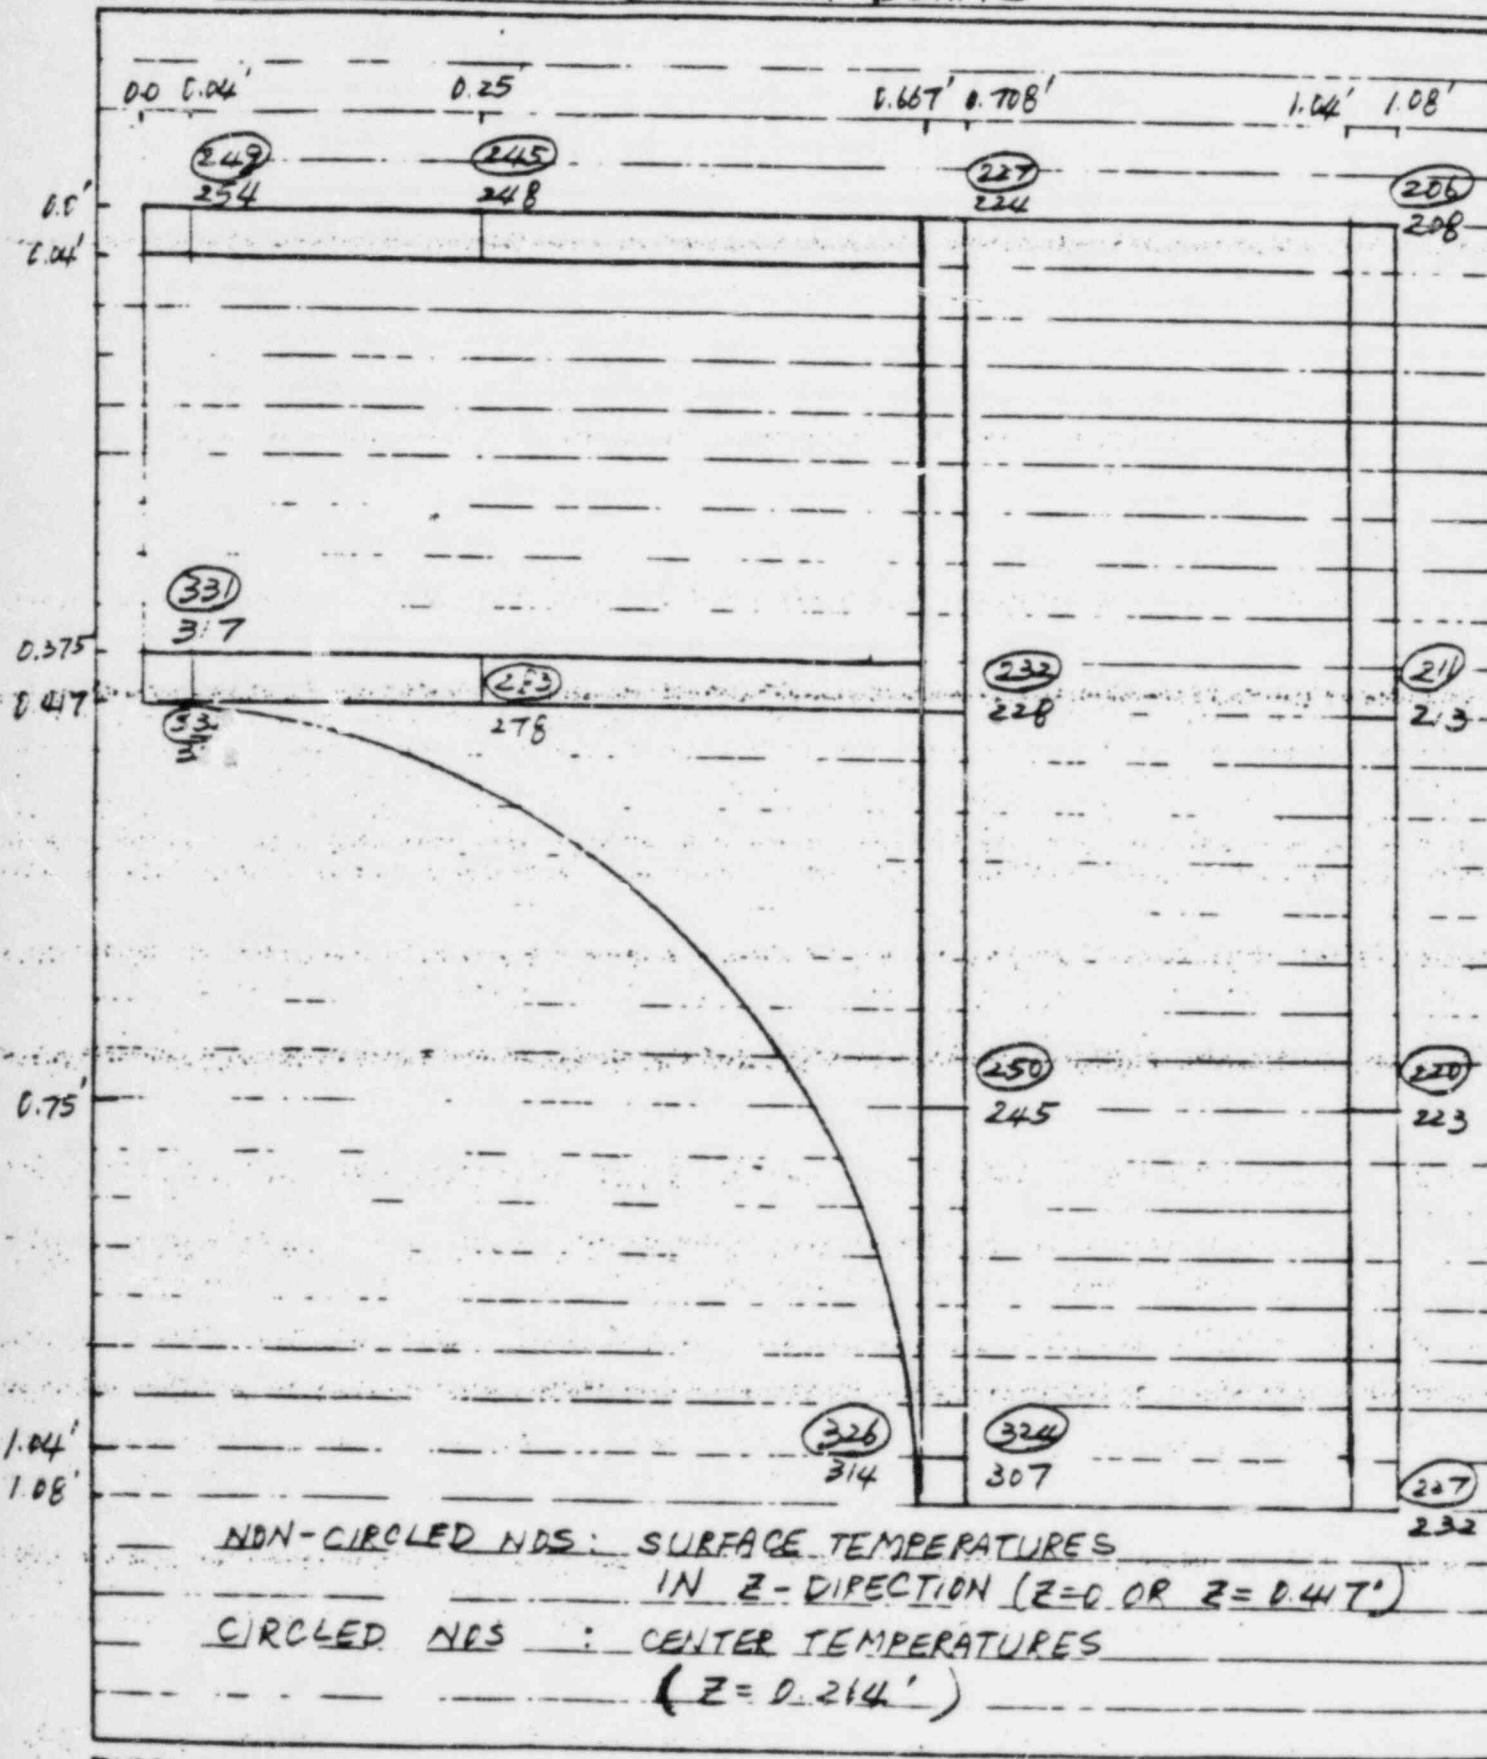

**TABLE I-5-0**  
**COEFFICIENTS OF THERMAL EXPANSION**

Materials	Coef-ficient <sup>1</sup>	Temperature (F)															
		70	100	150	200	250	300	350	400	450	500	550	600	650	700	750	800
Carbon steel; Carbon-moly steel; low chrome steels (through 3 Cr)	A	6.07	6.20	6.44	6.67	6.89	7.10	7.33	7.54	7.76	7.96	8.16	8.35	8.54	8.76	8.94	9.16
	B	6.07	6.13	6.25	6.38	6.49	6.60	6.71	6.82	6.92	7.02	7.12	7.23	7.33	7.44	7.54	7.65
	C	0	.0023	.0061	.0099	.0140	.0182	.0226	.0270	.0316	.0362	.0411	.0460	.0511	.0563	.0616	.0670
Intermediate chrome steels (5 Cr through 9 Cr)	A	5.73	5.90	6.13	6.30	6.42	6.54	6.71	6.85	7.03	7.16	7.35	7.47	7.60	7.75	7.90	8.02
	B	5.73	5.79	5.92	6.04	6.12	6.19	6.27	6.34	6.42	6.50	6.58	6.66	6.73	6.80	6.88	6.96
	C	0	.0022	.0058	.0094	.0133	.0171	.0210	.0250	.0293	.0335	.0380	.0424	.0469	.0514	.0562	.0610
High-chrome steels (112 Cr through 17 Cr)	A	5.24	5.34	5.53	5.72	5.87	6.05	6.21	6.36	6.50	6.66	6.80	6.94	7.01	7.08	7.21	7.36
	B	5.24	5.29	5.40	5.50	5.58	5.66	5.74	5.81	5.89	5.96	6.05	6.13	6.20	6.26	6.33	6.39
	C	0	.0020	.0053	.0086	.0121	.0156	.0193	.0230	.0269	.0308	.0349	.0390	.0431	.0473	.0516	.0560
Austenitic stainless steel (18 Cr 8 Ni)	A	9.11	9.21	9.39	9.50	9.66	9.73	9.87	9.96	10.09	10.20	10.34	10.43	10.54	10.66	10.81	10.90
	B	9.11	9.16	9.25	9.34	9.41	9.47	9.53	9.59	9.65	9.70	9.76	9.82	9.87	9.93	9.99	10.05
	C	0	.0034	.0090	.0146	.0203	.0261	.0320	.0380	.0441	.0501	.0562	.0624	.0687	.0751	.0815	.0880
25 Cr-20 Ni	A	7.48	7.60	7.78	7.98	8.13	8.27	8.45	8.57	8.74	8.88	9.02	9.16	9.30	9.42	9.56	9.70
	B	7.48	7.54	7.65	7.76	7.84	7.92	8.00	8.08	8.15	8.22	8.30	8.38	8.45	8.52	8.60	8.68
	C	0	.0028	.0074	.0121	.0170	.0218	.0269	.0320	.0372	.0424	.0479	.0533	.0588	.0644	.0702	.0760
Nickel-Chrome Iron	A	7.13	7.26	7.46	7.63	7.77	7.91	8.02	8.10	8.16	8.23	8.33	8.43	8.53	8.63	8.73	8.98
	B	7.13	7.20	7.30	7.40	7.48	7.56	7.63	7.70	7.75	7.80	7.85	7.90	7.95	8.00	8.05	8.10
	C	0	.0026	.0070	.0115	.0161	.0209	.0256	.0305	.0353	.0402	.0452	.0502	.0553	.0605	.0657	.0710
Aluminum	A	12.25	12.62	13.12	13.52	13.80	14.06	14.34	14.67	14.95	15.24	15.49	15.79	...	...	...	...
	B	12.25	12.39	12.67	12.90	13.12	13.28	13.44	13.60	13.75	13.90	14.05	14.20	...	...	...	...
	C	0	.0046	.0123	.0200	.0283	.0366	.0453	.0539	.0628	.0717	.0810	.0903	...	...	...	...

## NOTE:

1. Coefficient A is the instantaneous coefficient of thermal expansion X 10<sup>6</sup> (in./in./F). Coefficient B is the mean coefficient of thermal expansion X 10<sup>6</sup> (in./in./F) in going from 70 F to indicated temperature. Coefficient C is the linear thermal expansion (in./ft.) in going from 70 F to indicated temperature.

DOCKETED  
USNRC

'84 OCT -1 A9:33

UNITED STATES OF AMERICA  
NUCLEAR REGULATORY COMMISSION  
BEFORE THE ATOMIC SAFETY AND LICENSING BOARD

SECRETARIAL & SERVICE  
BRANCH

In the Matter of )  
 )  
TEXAS UTILITIES ELECTRIC ) Docket Nos. 50-445 and  
COMPANY, et al. ) 50-446  
 )  
(Comanche Peak Steam Electric ) (Application for  
Station, Units 1 and 2) ) Operating Licenses)

CERTIFICATE OF SERVICE

I hereby certify that copies of "Applicants' Reply to CASE's Answer to Applicants' Motion for Summary Disposition Regarding Local Displacement and Stresses," in the above-captioned matter was served upon the following persons by express delivery (\*), or deposit in the United States mail, first class, postage prepaid, this 28th day of September, 1984, or by hand delivery (\*\*) on the 1st day of October, 1984.

\*\*Peter B. Bloch, Esq.  
Chairman, Atomic Safety and  
Licensing Board  
U.S. Nuclear Regulatory  
Commission  
Washington, D.C. 20555

\*Dr. Walter H. Jordan  
881 West Outer Drive  
Oak Ridge, Tennessee 37830

\*Dr. Kenneth A. McCollom  
Dean, Division of Engineering  
Architecture and Technology  
Oklahoma State University  
Stillwater, Oklahoma 74074

Mr. John Collins  
Regional Administrator,  
Region IV  
U.S. Nuclear Regulatory  
Commission  
611 Ryan Plaza Drive  
Suite 1000  
Arlington, Texas 76011

Chairman, Atomic Safety and  
Licensing Appeal Panel  
U.S. Nuclear Regulatory  
Commission  
Washington, D.C. 20555

Mr. William L. Clements  
Docketing & Service Branch  
U.S. Nuclear Regulatory  
Commission  
Washington, D.C. 20555

\*\*Stuart A. Treby, Esq.  
Office of the Executive  
Legal Director  
U.S. Nuclear Regulatory  
Commission  
Washington, D.C. 20555

Chairman, Atomic Safety and  
Licensing Board Panel  
U.S. Nuclear Regulatory  
Commission  
Washington, D.C. 20555

Renea Hicks, Esq.  
Assistant Attorney General  
Environmental Protection  
Division  
P.O. Box 12548  
Capitol Station  
Austin, Texas 78711

Lanny A. Sinkin  
114 W. 7th Street  
Suite 220  
Austin, Texas 78701

\*Mrs. Juanita Ellis  
President, CASE  
1426 South Polk Street  
Dallas, Texas 75224

Ellen Ginsberg, Esquire  
Atomic Safety and Licensing  
Board Panel  
U.S. Nuclear Regulatory  
Commission  
Washington, D.C. 20555

William A. Horin  
William A. Horin

cc: John W. Beck  
Robert Wooldridge, Esq.