


EQUIPMENT QUALIFICATION DATA PACKAGE

This document contains information, relative to the qualification of the equipment identified below in accordance with the methodology of WCAP-8587. The Specification section (Part 1) defines the assumed limits for the equipment qualification and constitute interface requirements to the user.

Tobar Differential Pressure Transmitters (Group A)

APPROVED:

8-

  
\_\_\_\_\_  
E. P. Rahe, Manager  
Nuclear Safety Department

WESTINGHOUSE ELECTRIC CORPORATION  
NUCLEAR ENERGY SYSTEMS  
PITTSBURGH, PENNSYLVANIA 15230

8410050241 841002  
PDR ADOCK 05000482  
A PDR

WESTINGHOUSE CLASS 3

SECTION 1 - SPECIFICATIONS

1.0 PERFORMANCE SPECIFICATIONS

1.1 Electrical Requirements

1.1.1 Voltage: 20 - 45 VDC  $\pm$  1V

1.1.2 Frequency: N/A

1.1.3 Load: 4 - 20 MA

1.1.4 Electromagnetic Interference: None

1.1.5 Other: None

1.2 Installation Requirements: Wall mounted per Westinghouse Drawing 8765D69

1.3 Auxiliary Devices: None

1.4 Preventive Maintenance Schedule: Per the Westinghouse Equipment Qualification test program, the maintenance required to maintain the qualified life stated in Section 1.9 is that the cover O-ring must be replaced each time the cover is removed. This does not preclude development of preventive maintenance program designed to enhance equipment performance and identify unanticipated equipment degradation as long as this program does not compromise the qualification status of the equipment. Surveillance activities may also be considered to support the basis for, and a possible extension of, the qualified life.

1.5 Design Life: 40 years

1.6 Operating Cycles (Expected number of cycles during design life, including test): Continuous duty.

1.7 Performance Requirements for Function (b): Pressurizer Level

77920

Parameter	Normal Conditions	Abnormal Conditions	Containment Test Conditions	DBE Conditions <sup>(a)</sup>			Post DBE Conditions <sup>(a)</sup>		
				FLB/SLB	LOCA	Seismic	FLB/SLB	LOCA	Seismic
1.7.1 Time requirement	Continuous	Included under normal	Test Duration	Event Duration	Event Durat.	Event Duration	4 months	4 months	Continuous
1.7.2 Performance (c) requirement (d)	± 1% 0.4 Sec	Included under normal	No damage	± 16% 10 secs.	± 16% 10 secs.	± 11% 0.4 secs.	± 16% 10 secs	± 16% 10 secs	± 1% 0.4 secs

1.8 Environmental Conditions for Same Function<sup>(b)</sup>

1.8.1 Temperature (°F)	50 - 120	Included under normal	Ambient	Figure 2	Figure 3	Ambient	Figure 2	Figure 3	Ambient
1.8.2 Pressure (psig)	-0.1/+0.3	Included under normal	70	Figure 2	Figure 3	0	Figure 2	Figure 3	0
1.8.3 Humidity (% RH)	0 - 95	Included under normal	Ambient	100	100	Ambient	100	100	Ambient
1.8.4 Radiation (R)	< 10 <sup>4</sup>	Included under normal	None	Included Under Post DBE	Included Under Post DBE	None	3.9x10 <sup>4</sup> Y 6.4x10 <sup>5</sup> B	4.1x10 <sup>7</sup> Y 9x10 <sup>8</sup> B	None
1.8.5 Chemicals	None	Included under normal	None	Figure 2	Figure 3	None	Figure 2	Figure 3	None
1.8.6 Vibration	None	Included under normal	None	None	None	None	None	None	None
1.8.7 Acceleration (g)	None	Included under normal	None	None	None	Figures 1A,1B,1C	None	None	None

- Notes:
- (a) DBE is the Design Basis Event.
  - (b) Margin is not included in the parameters of this section.
  - (c) Reference accuracy specified. Values shown for accuracy under DBE and Post DBE conditions include ± 1% for normal conditions which is not part of the DBE induced effects.
  - (d) Time Response
  - (e) Continued operation required, no specified accuracy or time response.

1.7 Performance Requirements for Function <sup>(b)</sup>: Steam Generator Water Level (NR)

Parameter	Normal Conditions	Abnormal Conditions	Containment Test Conditions	DBE Conditions <sup>(a)</sup>			Post DBE Conditions <sup>(a)</sup>		
				FLB	LOCA/SLB	Seismic	FLB/SLB	LOCA	Seismic
1.7.1 Time requirement	Continuous	Included under normal	Test Duration	< 5 min	Event Duration	Event Duration	4 months	4 months	Continuous
1.7.2 Performance (c) requirement (d)	± 1% 0.4 sec	Included under normal	No damage	± 1% 0.4 secs.	± 16% 10 secs.	± 11% 0.4 secs.	± 16% 10 secs	± 16% 10 secs	± 1% 0.4 secs

1.8 Environmental Conditions for Same Function <sup>(b)</sup>

1.8.1 Temperature (°F)	50 - 120	Included under normal	Ambient	Figure 2	Figure 2/3	Ambient	Figure 2	Figure 3	Ambient
1.8.2 Pressure (psig)	-0.1/-0.3	Included under normal	70	Figure 2	Figure 2/3	0	Figure 2	Figure 3	0
1.8.3 Humidity (% RH)	0 - 95	Included under normal	Ambient	100	100	Ambient	100	100	Ambient
1.8.4 Radiation (R)	< 10 <sup>4</sup>	Included under normal	None	Included Under Post DBE	Included Under Post DBE	None	3.9x10 <sup>4</sup> Y 6.4x10 <sup>5</sup> B	4.1x10 <sup>7</sup> Y 9x10 <sup>8</sup> B	None
1.8.5 Chemicals	None	Included under normal	None	Figure 2	Figure 2/3	None	Figure 2	Figure 3	None
1.8.6 Vibration	None	Included under normal	None	None	None	None	None	None	None
1.8.7 Acceleration (g)	None	Included under normal	None	None	None	Figures 1A,1B,1C	None	None	None

- Notes:
- (a) DBE is the Design Basis Event
  - (b) Margin is not included in the parameters of this section.
  - (c) Reference accuracy specified. Values shown for accuracy under DBE and Post DBE conditions include ± 1% for normal conditions which is not part of the DBE induced effect.
  - (d) Time Response

77920

3

WESTINGHOUSE CLASS 3

WESTINGHOUSE CLASS 3

1.9 Qualified Life: The currently demonstrated qualified life is ten years (10 yrs.) based on an average ambient temperature of 40°C (104°F). The demonstrated qualified life based on an average ambient temperature of 120°F is six years (6 yrs.).

1.10 Remarks: Beta dose only applicable to transmitter seals

SECTION 2 - EQUIPMENT QUALIFICATION DATA

2.1 QUALIFICATION PLAN

The qualification of the Tobar Model 32DP1 Differential Pressure Transmitter (Group A) is based on a combination of analysis and testing. The testing was performed on a Veritrak Model 76DP2 Differential Pressure Transmitter and is described in Reference 2. The analysis is described in Section 4 of this report and in Reference 1.

Complete qualification testing was performed on the Veritrak Model 76DP2 to simulate the following conditions:

- Thermal Aging
- Radiation Environment
- Containment Pressure
- Seismic Environment
- High Energy Line Break (HELB)
- Loss of Coolant Accident (LOCA)

A similarity analysis, described in Section 4, was performed in an effort to extend qualification to the Tobar Model 32DP1.

WESTINGHOUSE CLASS 3

SECTION 3 QUALIFICATION BY EXPERIENCE

Westinghouse does not employ operating experience in support of the qualification program for the Tobar Group A Differential Pressure Transmitter.



SECTION 4 QUALIFICATION BY ANALYSIS

4.1 COMBINED ANALYSIS AND TEST APPROACH

Westinghouse does not employ methods which rely solely upon analysis in their qualification programs. In the qualification program for the Tobar Model 32DP1 Differential Pressure Transmitter a combined test and analysis approach was taken.

Testing was performed on the Veritrak Model 76DP2 Differential Pressure Transmitter and documented in Reference 2.

4.2 ANALYSIS

A similarity analysis was performed to establish qualification for the following conditions:

- Thermal Aging
- Radiation Environment
- Containment Pressure
- Seismic Environment
- High Energy Line Break (HELB)
- Loss of Coolant Accident (LOCA)

The two-phase analysis consisted of:

1. A rigorous review of drawings for both the Tobar model and the Veritrak qualification unit. Any differences found between the Tobar Model 32DP1 and the Veritrak Model 76DP2 qualification unit were noted and investigated.
2. A review of design changes which may have been implemented on the Tobar Model 32DP1 but not on the Veritrak Model 76DP2 qualification unit.



### WESTINGHOUSE CLASS 3

The similarity analysis results showed no differences between the Tobar model and the Veritrak qualification unit which would result in performance outside of the specifications given in Section 1.7 for the conditions given above.

#### 4.3 CONCLUSION

Based on the results of the similarity analysis (Reference 1) comparing the Tobar Model 32DP1 with the Veritrak Model 76DP2 which was tested and qualified (Reference 2), it is concluded that the Tobar model will perform its required safety functions in an equivalent manner to the Veritrak Model under the conditions described in Section 1.7.

<u>Description</u>	<u>Model</u>	<u>W Drawing Number</u>
Differential Pressure Transmitter	32DP1	8765D69/6

#### 4.4 REFERENCES

1. Shubert, J. J., "Equipment Qualification Analysis Report, Tobar Differential Pressure Transmitters - Group A", WCAP-8687, Supp. 2-E03C.
2. Skeers, D. M., Drost, P. S., Black, J. P., Rygg, D. E., "Equipment Qualification Test Report, Veritrak Differential Pressure Transmitters - Group A", WCAP-8687, Supp. 2-E03B.

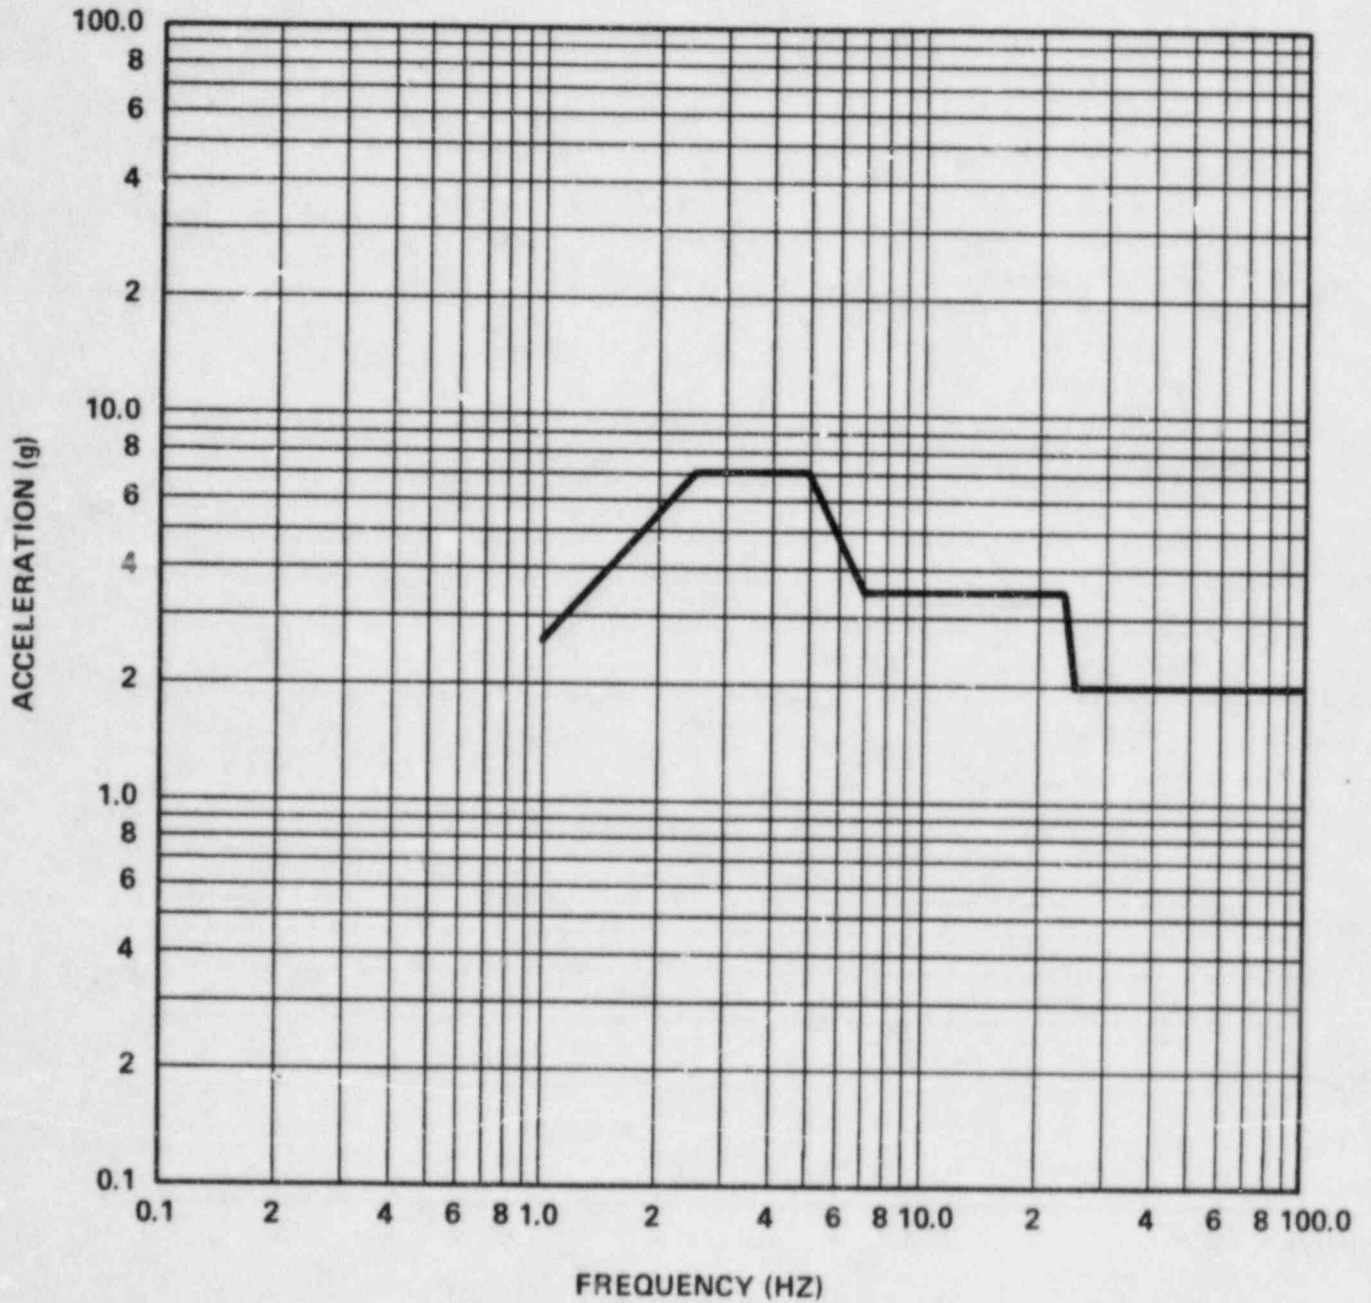


Figure 1A. Required Response Spectrum (RRS) for Safe Shutdown Earthquake (SSE) (Input A) Along the Principal Axis

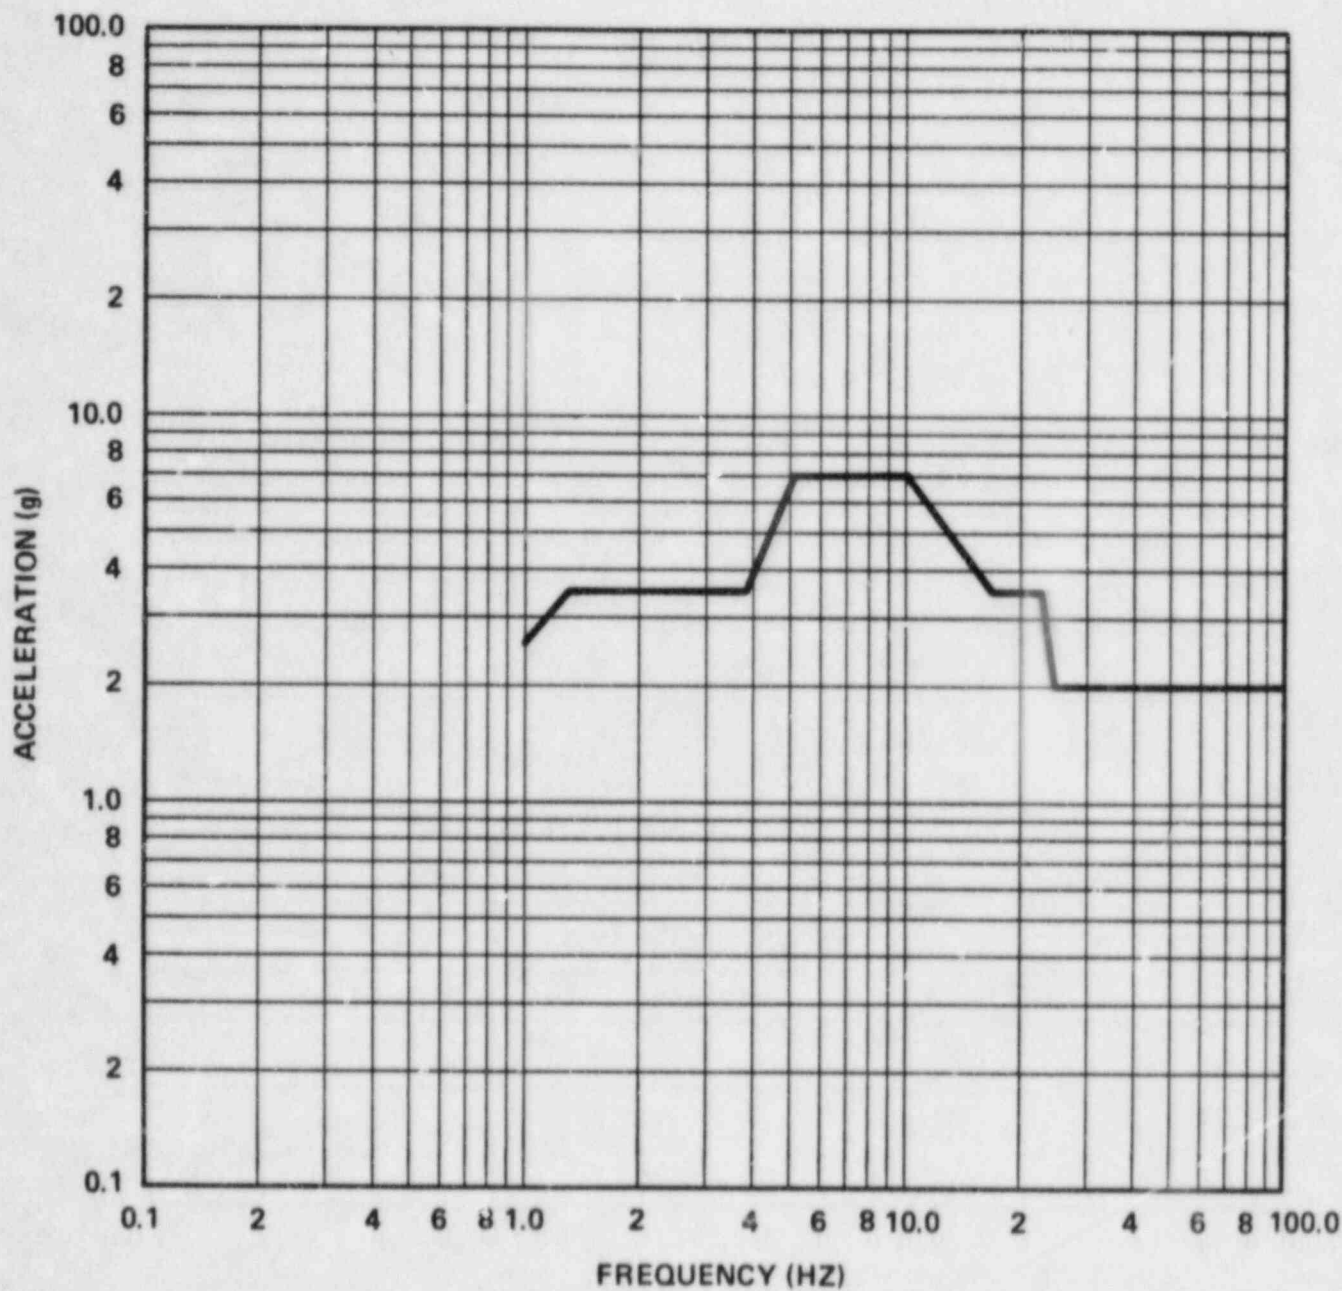


Figure 1B. Required Response Spectrum (RRS) for Safe Shutdown Earthquake (SSE) (Input B) Along the Principal Axis

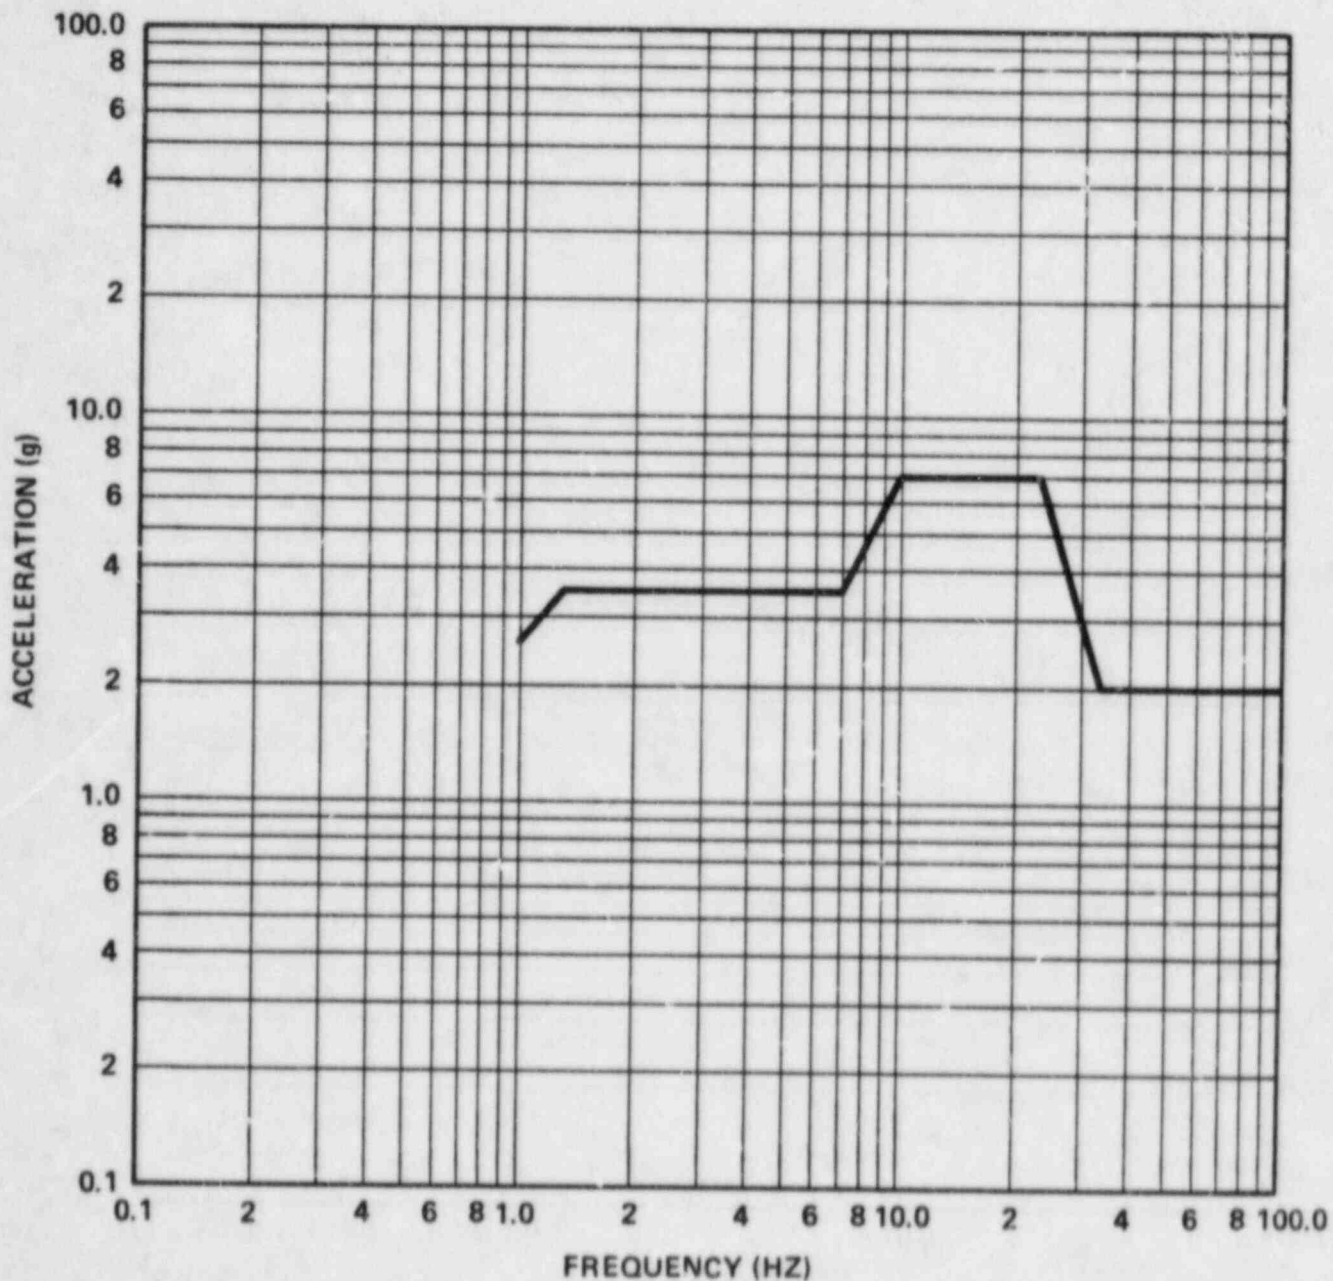


Figure 1C. Required Response Spectrum (RRS) for Safe Shutdown Earthquake (SSE) (Input C) Along the Principal Axis


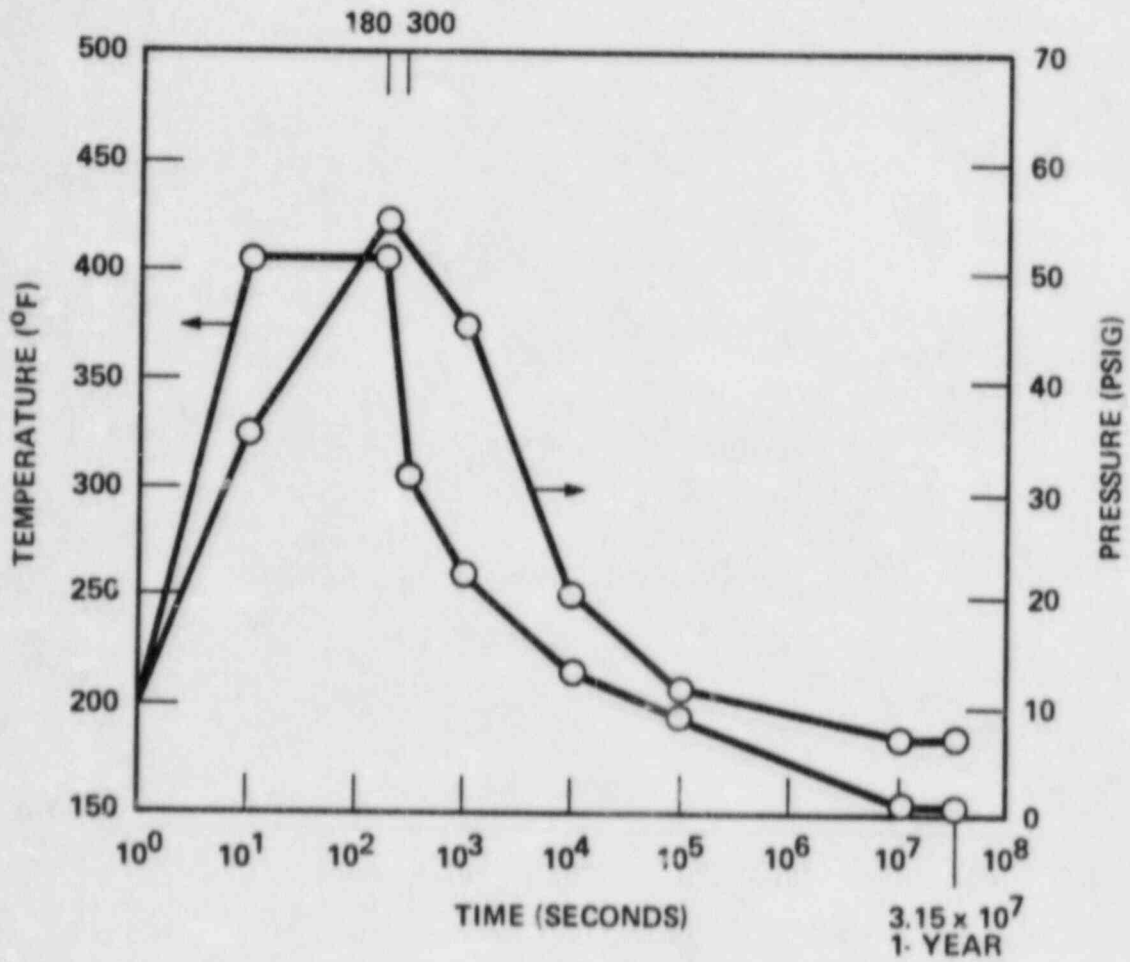


Figure 2: Required HELB Profile

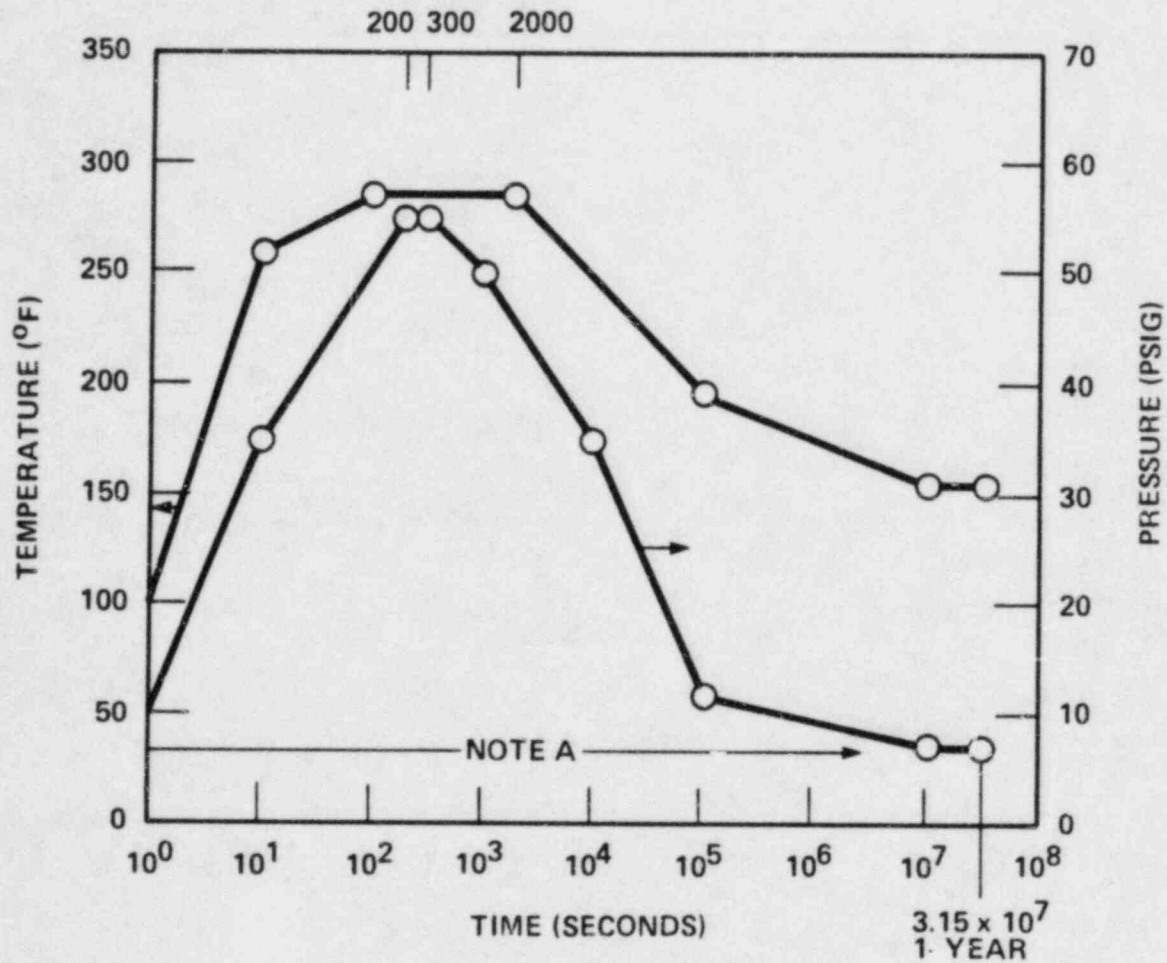

NOTE A: INITIAL 24 HOUR CONTAINMENT SPRAY SOLUTION OF 2500 ppm BORON WITH 0.24% NaOH

Figure 3: Required LOCA Profile