

# How Water in **PHILADELPHIA** is Treated and Distributed



1982

8411270462 840619  
PDR ADDCK 05000352  
G PDR

**FACTS AND CHARTS**

NUCLEAR REGULATORY COMMISSION

Docket No. 50-352/353 Official Ex. No. 166  
In the matter of PECO - Shinerick ✓

IDENTIFIED \_\_\_\_\_  
RECEIVED \_\_\_\_\_  
REJECTED \_\_\_\_\_  
Staff \_\_\_\_\_  
Applicant  \_\_\_\_\_  
Intervenor \_\_\_\_\_  
Cont'g Off'r \_\_\_\_\_ DATE 6/19/84  
Contractor \_\_\_\_\_ witness \_\_\_\_\_  
Other \_\_\_\_\_  
Reporter Mary Stewart



# Abundant Water From Local Streams...

## SOURCES AND DISTRIBUTION

Where does Philadelphia get its water?

The city pumps one-half of its water from the Delaware River, just above the outlet of Pennypack Creek. The other half is pumped from the Schuylkill River at two different locations: the Belmont Pumping Station on the west side, just below Columbia Avenue Bridge, and the Queen Lane Pumping Station on the east side, just below City Line Bridge. The Belmont Station pumps from the pool formed by the Fairmount Dam, while the Queen Lane Station draws water from the head of the same pool.

All sources are located within the city and, with minor exceptions, all service is within the city limits.

After treatment and filtration, the major part of the effluent (or output) of the Belmont and Queen Lane Plants is delivered through the distribution system by gravity. This is possible because these plants have filtered water basins with water level elevations of 239 and 216 feet respectively.

The other effluents from Belmont and Queen Lane—and all the effluent from the Torresdale Plant—are pumped by stations located at, or near the plants, and some effluents are repumped at six booster stations. Pumping helps to maintain the gradients required for satisfactory pressures and good service at all points in the distribution system.


Normally about one-third of plant output is delivered by gravity and two-thirds is pumped. Of the latter, about 15% is repumped at the booster stations.

Because of differences in elevation among city neighborhoods (a difference of 450 feet, for example, between homes in Roxborough and those in South Philadelphia), the city is divided into ten pressure districts. The fact that Philadelphia takes its water from three different river sources also makes some of these districts necessary.

## AREAS WHERE DELIVERED

Delaware water is delivered generally to those areas of the city east of Broad Street, while Schuylkill water reaches consumers west of Broad Street. There are some exceptions, however, to this pattern of distribution.

Thus Delaware water flows west of Broad Street to some neighborhoods south of Erie Avenue. It is also delivered to West Oak Lane and Chestnut Hill, and it may mix with Schuylkill water in the vicinity of East Park Reservoir before the latter water enters central city. Schuylkill water may also cross the Broad Street boundary: it serves the area bounded by Lehigh, Wyoming, and Kensington Avenue, and Roosevelt Boulevard.

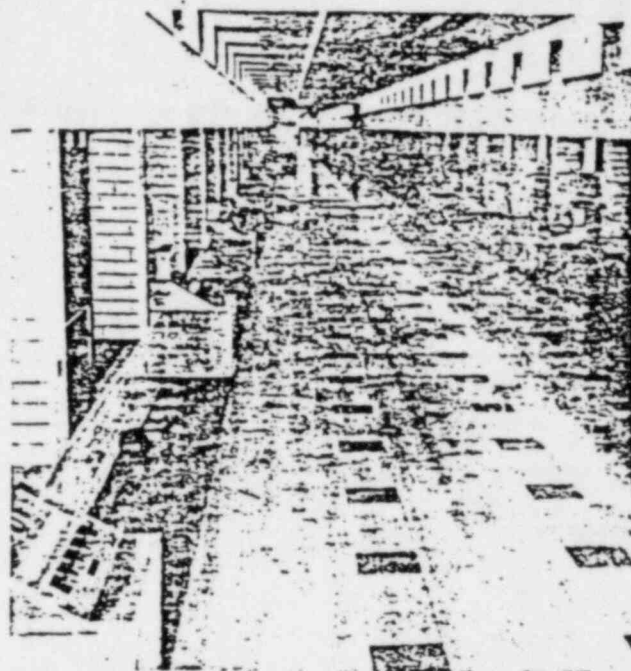

Electronic consoles line the filter gallery at the Queen Lane Water Plant. Consoles regulate the flow of water through rapid-sand filter beds located behind the columns.

Because of changes in consumer demands, and the need for occasional changes in plant operations, it is uncertain which of the river waters, or what combination of them, will be received in some areas along the north-south mid-axis of the city represented by Broad Street. West Philadelphia, however, receives only Schuylkill water.

The preceding is of particular interest to those who may be affected by changes in the mineral content of the water, since the Schuylkill water contains in solution about twice the amount present in Delaware water. In the 10-year period 1971-1980, the annual hardness of water delivered to distribution from the Torresdale Plant on the Delaware averaged 96 parts per million; annual hardness of water from the plants on the Schuylkill averaged 145 parts per million.

The total population served is 1.69 million. To these customers the Water Department distributes an average of 345 million gallons daily.

In addition, the department delivers 11 million gallons of water daily to the Bucks County Water and Sewer Authority for distribution in lower Bucks County.

The distribution system contains 3,200 miles of pipes of various sizes, from three inches to seven feet nine inches in diameter. About 142 miles of this pipe are three feet or wider in diameter. There are 78,000 valves and over 25,000 fire hydrants.

Besides the regular distribution system, there is a high pressure fire system covering center city and that part of north central Philadelphia lying east of Broad Street and south of Lehigh Avenue. This is composed of 63 miles of mains, 1,900 valves, and 1,050 hydrants, together with two pumping stations that deliver water at pressures up to 300 lbs. per sq. in. One station is located at Delaware Avenue and Race Street; the other at 7th Street and Lehigh Avenue.

#### MODE OF TREATMENT

Philadelphia's three water treatment plants are modern. The Torresdale Plant was completed in 1959; the Belmont Plant in 1965; and the principal facilities of the Queen Lane Plant in stages — 1954, 1960, 1971. The plants are of the rapid-sand filter type, with automatic and semi-automatic controls. It is planned to bring all the plant treatment processes under computer control within the next few years.

Daily output of the water treatment plants, in millions of gallons daily, averaged as follows in fiscal 1980:

Belmont .....	63.8
Queen Lane .....	98.0
Torresdale .....	214.6

Although there is some variation at the plants, the treatment process comprises of natural sedimentation, pre-chlorination, chemical treatment, flocculation, sedimentation, filtration, and post chemical treatment.

Natural sedimentation takes place in a large raw-water reservoir, where some suspended matter settles out as the water moves slowly through.


The second step in treatment is chlorination. The chlorine is added to the water to destroy taste and odor-producing materials which are chiefly organic matter. This may include the wastes of industries as well as those of natural origin.

The third step is injection of other chemicals into the raw water as it passes under a chemical or pre-treatment building. At this point, alum or ferric chloride may be added to promote the later formation of "floc," and chemicals such as carbon or sodium chlorite may be used to control taste and odor.

The fourth step is for the chemical-laden water to pass through small basins, where the chemicals and water are mixed for more than a half-hour by giant revolving paddles. The mixing causes the formation of "floc," tiny red or brown granules. The floc will enmesh suspended impurities in the water.

When necessary, lime is added to the water to neutralize acidity and create optimum conditions for the formation of floc.

Enmeshment of suspended particles by the floc takes place in large sedimentation basins to which the water next flows. In these basins the water remains quiescent for two to four hours, and the floc settles to the bottom, taking with it more than 90% of the suspended impurities. This prepares the water for filtration.

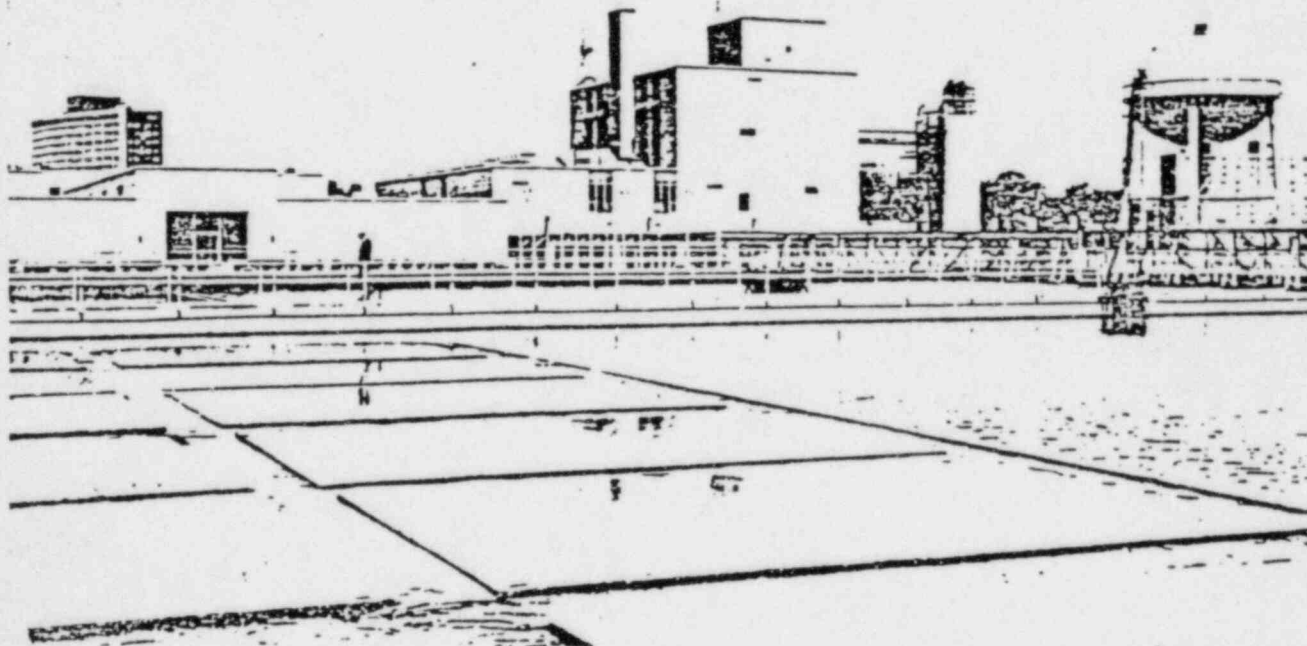

Water sparkles as it flows off the sedimentation basins at the Belmont Water Plant to enter the filter building (left background). The basins settle out 90% of the impurities in the water.

**.....Treated In Modern Plants**

## One Of America's Purest Waters

The water is then filtered through beds of sand and gravel, which remove all particles that remain after the settling period.

As the final step in treatment, the chlorine content of the water is adjusted to ensure safety, and ammonia may be added to counteract chlorinous tastes and odors. At various steps in the treatment process, additional chemicals may be used, or the usual chemicals replaced by others. This is governed by the changes in the condition of the raw water supply.

To help prevent tooth decay in children, fluoride is also added to the water.

Because treatment steps differ slightly at the plants, the successive steps are summarized below:

**BELMONT:** (1) Settling by natural sedimentation for 22 hours, (2) pre-chlorination, (3) application of chemicals—alum with lime for pH adjustment, (4) rapid mixing of chemicals with water, (5) slow mixing of chemicals to form "floc," (6) settling, (7) chlorination, (8) rapid sand filtration, (9) post treatment, including chlorination, zinc phosphate, fluoridation, and ammonia.


**QUEEN LANE:** (1) Settling for 20 hours, (2) pre-chlorination and fluoridation, (3) application of chemicals — ferric chloride, with lime for pH adjustment, and carbon, (4) rapid mixing of chemicals with water, (5) slow mixing of chemicals with water to form "floc," (6) settling, (7) chlorination, (8) rapid sand filtration, (9) post treatment, including zinc phosphate and ammonia.

**TORRESDALE:** (1) Settling by natural sedimentation, (2) chlorination, (3) application of chemicals — ferric chloride with lime for pH adjustment, chlorine, dioxide, and carbon, (4) rapid mixing of chemicals with water, (5) slow mixing of chemicals with water to form "floc," (6) settling, (7) chlorination to free chlorine residual, (8) rapid sand filtration, (9) post treatment, including chlorination, fluoridation and ammonia.

Water withdrawn from the East Park and Oak Lane Reservoirs is rechlorinated before entering the distribution system. East Park water is treated with chlorine dioxide through the spring, summer and autumn to control algae.

**QUALITY CONTROL:** The Water Department guards the quality of its water from the river to the home faucet. Along the rivers, raw water samples are collected by boat. In the plants, laboratory personnel check the water at every treatment stage, and this is followed by regular sampling of 85 points in the distribution system. Laboratories make 170,000 wet chemical tests on water each year, and the equivalent of hundreds of thousands of other tests by electronic testing devices.

The city's drinking water, in its finished form, meets or surpasses all of the quality standards of the U. S. Environmental Protection Agency under the Safe Drinking Water Act.

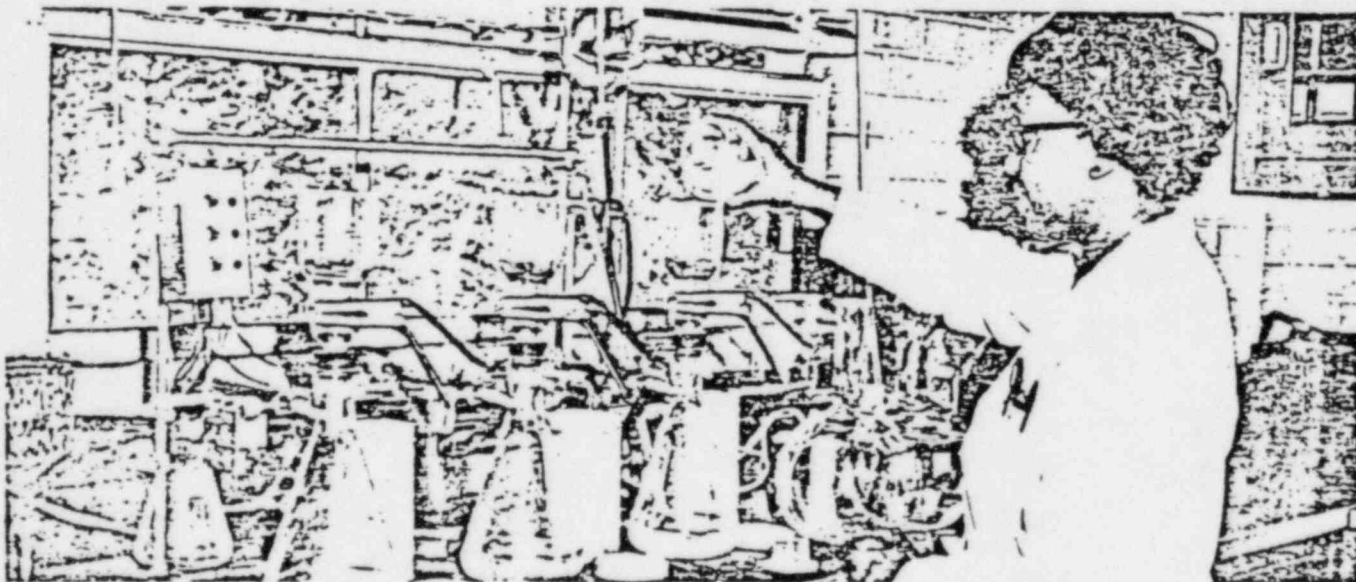

Modern laboratories ensure pure, safe, and palatable drinking water. They make 170,000 "wet chemical" tests and hundreds of thousands of instrumental tests on water samples yearly.

## 1801: Steam Pumps Supplied Water

Philadelphia's water system began with a bold experiment.

At a time when steam power was finding its first uses in America, the City Fathers opened two steam pumping stations in January, 1801. These water works represented the first large scale application of steam pumping to water service in this country.

The new system was the brain child of Benjamin Henry Latrobe, an immigrant British engineer, who later designed the Capitol in Washington.

One of Latrobe's stations was located just north of Chestnut Street near the Schuylkill River. The water flowed into a pit under the station, and a steam engine raised it about 40 feet into a brick conduit, which ran down Chestnut Street to Broad Street and then turned north to Centre (now Penn.) Square.

The other station, situated in the middle of Centre Square where City Hall now stands, received the water and raised it by steam power to two wooden tanks that were 40 feet above the ground. These tanks, which held 17,660 gallons, were the city's only reservoir.

Latrobe's stations operated until 1815. The Centre Square buildings were taken down in 1820.

### OLD FAIRMOUNT WATER WORKS

By 1812 the City Fathers had grown disgusted with the expense of keeping the wooden pumps running at Centre Square. Water service too was frequently interrupted by insufficient storage.

As a result, the City built new water works at "Fair Mount," which went into service on September 7, 1815. Water was raised to an earthen reservoir on the hill now occupied by the Museum of Art, from which it flowed by gravity to city houses.


At first, two steam engines were used to lift the water. Unfortunately, the boiler of one of the high pressure engines burst in 1818, and the City Fathers turned to much cheaper water-wheel power.

A dam was thrown across the Schuylkill River to form a fresh water pool, and new paddle wheels and pumps were built just below the pool level. River water was conducted into a forebay on the back and east side of the mill buildings, and it was then led through flumes to turn the wheels.

The new water-driven works — the first of its type built for public water service in any large American city — went into operation July 1, 1822.

From the beginning of the Fairmount Station and through much of its subsequent evolution, Frederick Graff, eminent engineer, was the guiding spirit. His son, Frederick, Jr., carried on his work after his death in 1847.

As the city grew, additional paddle wheels were installed at Fairmount, and additional basins were created on the neighboring hill. By 1842, there were eight paddle wheels supplying water to four basins

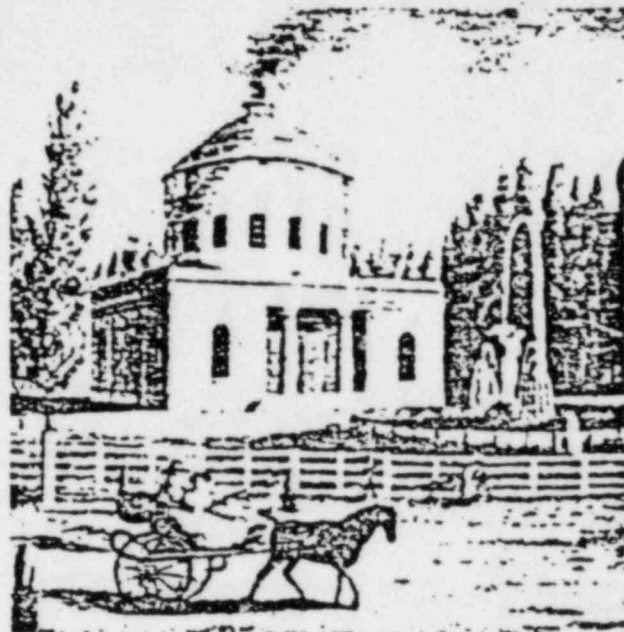

The Centre Square Works was one of two steam-powered pumping stations opened by Philadelphia in 1801 to supply water.

through double-acting force pumps which had been designed by Frederick Graff.

The first water turbine (a French invention by Fourneyron) was installed at Fairmount in 1851, and by 1871 all of the paddle wheels had been replaced by turbines. Fairmount Dam was rebuilt in 1842-43.

The Fairmount Station continued to supply portions of the city until March, 1911, when new filtration plants took over all water service.

### 19TH CENTURY PIPING

When the Centre Square Station went into service in 1801, water flowed from it through wooden logs to reach center city homes. These logs were bored through the center, and joined end to end by iron bands and caulking.

The wooden mains, however, leaked badly and constantly, and by 1832, the city discontinued laying them. Up to that time it had laid 241,604 feet.

Cast iron mains gradually replaced the old logs. The first 400 feet of cast iron pipe was imported from England in 1817, and by 1852 the city proper had 440,403 feet of cast iron mains in service. By the 1850's wooden mains were no longer in use, although many of them were not actually removed from the ground.

Philadelphia's water system today has 3,200 miles of mains, most of them cast iron but with an increasing proportion of ductile iron and steel pipe. A few old mains laid in the 1830's and 1840's are still in service.

# From Water Wheels And Wooden Mains

## EARLY 20TH CENTURY FILTRATION

The chief method of purifying water in 19th century Philadelphia was to provide for quiet periods in the reservoirs. This allowed suspended materials to settle to the bottom.

As the century wore on, however, the water from the Delaware and Schuylkill Rivers became increasingly polluted. Tastes and odors appeared, and the typhoid fever rate rose in the city.

Between 1858 and 1899, seven special studies were made of water sources and treatment. As a result of the 1899 report, the City Council authorized the construction of filtration plants.

Five new filtration plants — the biggest and finest "slow sand" plants in the world — went into service between 1902 and 1911. The new plants included extensive acreages of sand beds, where the river water was filtered. This filtration was preceded by cleansing in pre-filters of the coke or sponge type, and/or, later by settling in raw water basins.

Filtration of Philadelphia's water caused a marked drop in typhoid deaths. These quickly fell from an annual average of 60 per 100,000 residents to only one-fourth that number. With the introduction of chlorine treatment in 1913, typhoid was rapidly wiped out.

## THE REBIRTH OF THE 1950'S

As the years went by, the lack of public funds handicapped the city's water system. Its proud slow sand plants gradually deteriorated. Though a few rapid sand filters were introduced at the Queen Lane and Belmont Plants in the 1920's and other modifications were made, the plants were unable to keep up with growing water demands. This was also true of the old steam pumping stations.

The city's drinking water had become safe, but tastes and odors persisted. To correct this, activated carbon, ozone, chlorine dioxide, and other treatment chemicals were adopted in the late 1940's and early 1950's. There was an immediate improvement in water quality.

With the creation of a self-supporting Water Department in 1952, the long needed funds became available. The department began a \$217 million construction program (1952-1976).

To provide better water and meet rising demand, the department built a network of modern treatment plants, pumping stations, covered reservoirs, and hundreds of miles of new mains.

Notable were the treatment plants. Equipped with semi-automatic controls, the new Torresdale Plant was the largest "push-button" rapid-sand plant in America when it was opened in 1959. Similar plants were completed in the 1960's at Queen Lane and Belmont.

During the 1950's, the last steam pumps were removed from pumping stations, and new electric pumps were installed.

## LOAD CONTROL CENTER

Keeping watch over the distribution of water to Philadelphians is a modern system of electronic controls. The multi-million dollar system, known as the Load Control Center, was one of the first in this country when it was inaugurated in 1960.


The high speed intelligence system constantly monitors water pressure, rates of flow, levels, etc. in water mains, reservoirs, and pumping stations throughout the City. Data is picked up by electronic sensing devices at 120 points in the water distribution grid and is relayed by a ring of seven microwave towers to the control center. Complex equipment then deciphers the incoming signals, translating them automatically into meaningful information on typewritten sheets and digital displays.

There are no operating personnel in any of the 16 pumping stations. By simply pushing a button, the operator at the control center can start or stop pumps, and open and close valves in the remotely located stations.


## PROTECTING WATER QUALITY

In 1976, Philadelphia became the first American city to build a pilot plant to determine the best methods for removing trace organics, and tastes and odors from water. Located in the Torresdale plant, the pilot facility used both regular treatment and non-conventional treatment such as carbon filters, ozone, polyelectrolytes, and macroreticular resins. A Trace Organics Laboratory was also built at Torresdale to monitor the results of the tests.

To protect drinking water from taste and odor causing algae, the department began to cover its open reservoirs. In 1975-76, it placed floating covers on the north and south basins of the Oak Lane Reservoirs, and in 1981, the department's contractor began installing 4 million square feet of synthetic rubber to line and cover the north basins of the East Park Reservoirs. When completed, this will be one of the largest municipal lining/cover sites in the world.

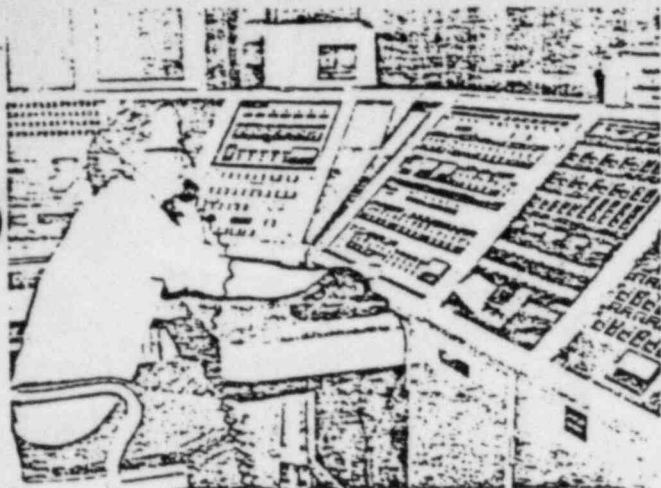

The operator at the console of the Load Control Center can control 16 remote pumping stations and monitor water pressure, rates of flow, and levels of reservoirs throughout the city.

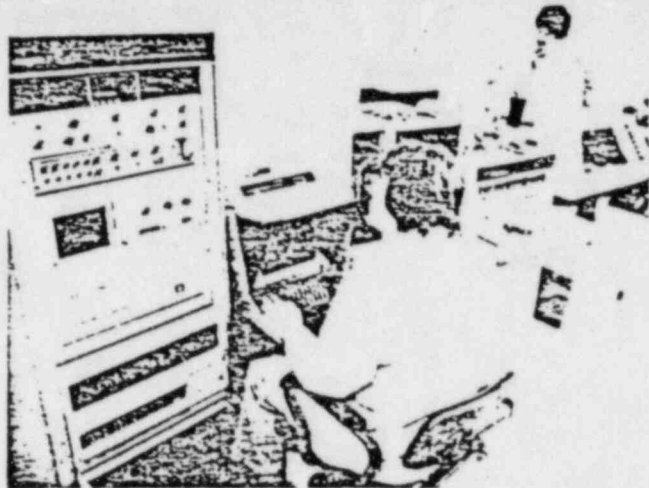

Samples of treated water, periodically analyzed for trace organics on an automated gas chromatograph/mass spectrometer system, are found to meet all federal standards.

## WATER SYSTEM CAPACITIES — 1982

### PLANT TREATMENT CAPACITIES

(in millions of gallons daily)

	RATED	PEAK RATE
BELMONT PLANT	78	108
QUEEN LANE PLANT	120	150
TORRESDALE PLANT	282	423

### PLANT RETENTION CAPACITIES (in millions of gallons)

		TOTAL
BELMONT PLANT:	Two 36-MG pre-sedimentation basins	72
	Four sedimentation basins	14.2
	Three filtered water basins	38.2
	Filtered water clear well	1.8
QUEEN LANE PLANT:	Pre-sedimentation basin	177
	Four 3-MG upper settling basins	12
	Four 3-MG lower settling basins	12
	Four filtered water basins	90
TORRESDALE PLANT:	Pre-sedimentation basin	176
	Four 10-MG sedimentation basins	40
	Five filtered water basins	193

### OTHER RETENTION CAPACITIES (in millions of gallons)

		TOTAL
UPPER ROXBOROUGH:	Filtered water basins	25.6
LOWER ROXBOROUGH:	Filtered water basins	3
OPEN RESERVOIRS:	East Park (filtered water)	677
	Oak Lane (filtered water)	70
STANDPIPES:	Two 5-MG Somerton tanks	10
	Two 5.5-MG Roxborough tanks	11
	Fox Chase tank	1.5


### PUMPING STATION CAPACITIES (in millions of gallons daily)

		TOTAL	
RAW WATER:	Belmont Station (Schuylkill)	140	
	Queen Lane Station (Schuylkill)	200	
	Torresdale Station (Delaware)	480	
FILTERED WATER:	1. Treated Schuylkill Water		
	Belmont High Service Station	42	
	Chestnut Hill Booster Station	8.5	
	East Park Booster Station	75	
	Queen Lane High Service Station	77.5	
	Roxborough High Service Station	45	
	2. Treated Delaware Water		
	Fox Chase Booster Station	25.3	
	Lardner's Point Station	240	
	Oak Lane High Service Station	50	
	Torresdale High and Low Service Station (200 MGD low, 80 MGD high)	263	
	West Oak Lane Booster Station	27.5	
	HIGH PRESSURE:	Fairhill Station	21.6
	Race Street Station	21.6	
(Each high pressure station can pump 15,000 gallons per minute)			

*NOTE: At each stage, the combined capacities of the water system facilities (whether treatment plants, reservoirs, or pumping stations) are much greater than average daily demand by consumers. This enables the Water Department to meet emergencies, to supply peak needs at certain hours or seasons, and to continue operation when some facilities have to be taken out of service.*

**To An Automated Water System**



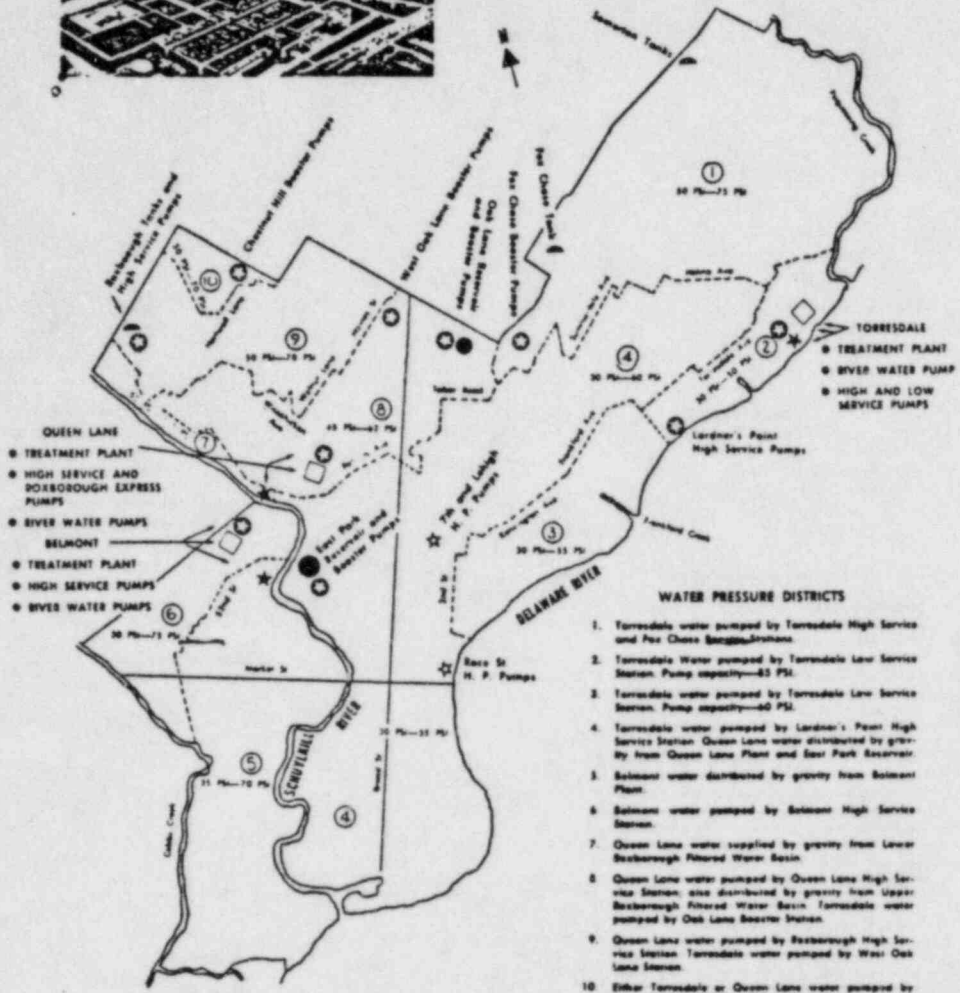

- QUEEN LANE
- TREATMENT PLANT
- HIGH SERVICE AND DOXBOROUGH EXPRESS PUMPS
- RIVER WATER PUMPS
- BELMONT
- TREATMENT PLANT
- HIGH SERVICE PUMPS
- RIVER WATER PUMPS

**WATER PRESSURE DISTRICTS**

1. Torresdale water pumped by Torresdale High Service and Per Chese Barrow Stations.
2. Torresdale water pumped by Torresdale Low Service Station. Pump capacity—85 PSI.
3. Torresdale water pumped by Torresdale Low Service Station. Pump capacity—60 PSI.
4. Torresdale water pumped by Lardner's Point High Service Station. Queen Lane water distributed by gravity from Queen Lane Plant and East Park Reservoir.
5. Belmont water distributed by gravity from Belmont Plant.
6. Belmont water pumped by Belmont High Service Station.
7. Queen Lane water supplied by gravity from Lower Roxborough Filtered Water Basin.
8. Queen Lane water pumped by Queen Lane High Service Station; also distributed by gravity from Upper Roxborough Filtered Water Basin. Torresdale water pumped by Oak Lane Booster Station.
9. Queen Lane water pumped by Roxborough High Service Station. Torresdale water pumped by West Oak Lane Station.
10. Either Torresdale or Queen Lane water pumped by Chestnut Hill Booster Station from April through November. At other times, the district is supplied directly by the Roxborough and West Oak Lane Stations.

**KEY**

- Treatment Plants
- ★ River Water Pumping Stations
- Filtered Water Pumping Stations
- ☆ High Pressure Pumping Stations (for fire protection only)
- ⊕ Tanks for Filtered Water
- Open Reservoirs for Filtered Water


Note: There are also underground basins for stored water at each treatment plant and in Upper Roxborough.

*Note on Water Pressure:* The normal range of water pressure, as indicated by 75-100 PSI, is shown on the map for each district. (The 50 PSI, 75 PSI [for District 11] denotes a pressure range of 50 to 75 pounds per square inch.)




**Philadelphia Water Facilities & Water Pressure Districts**

# Chief Water Supply Lines


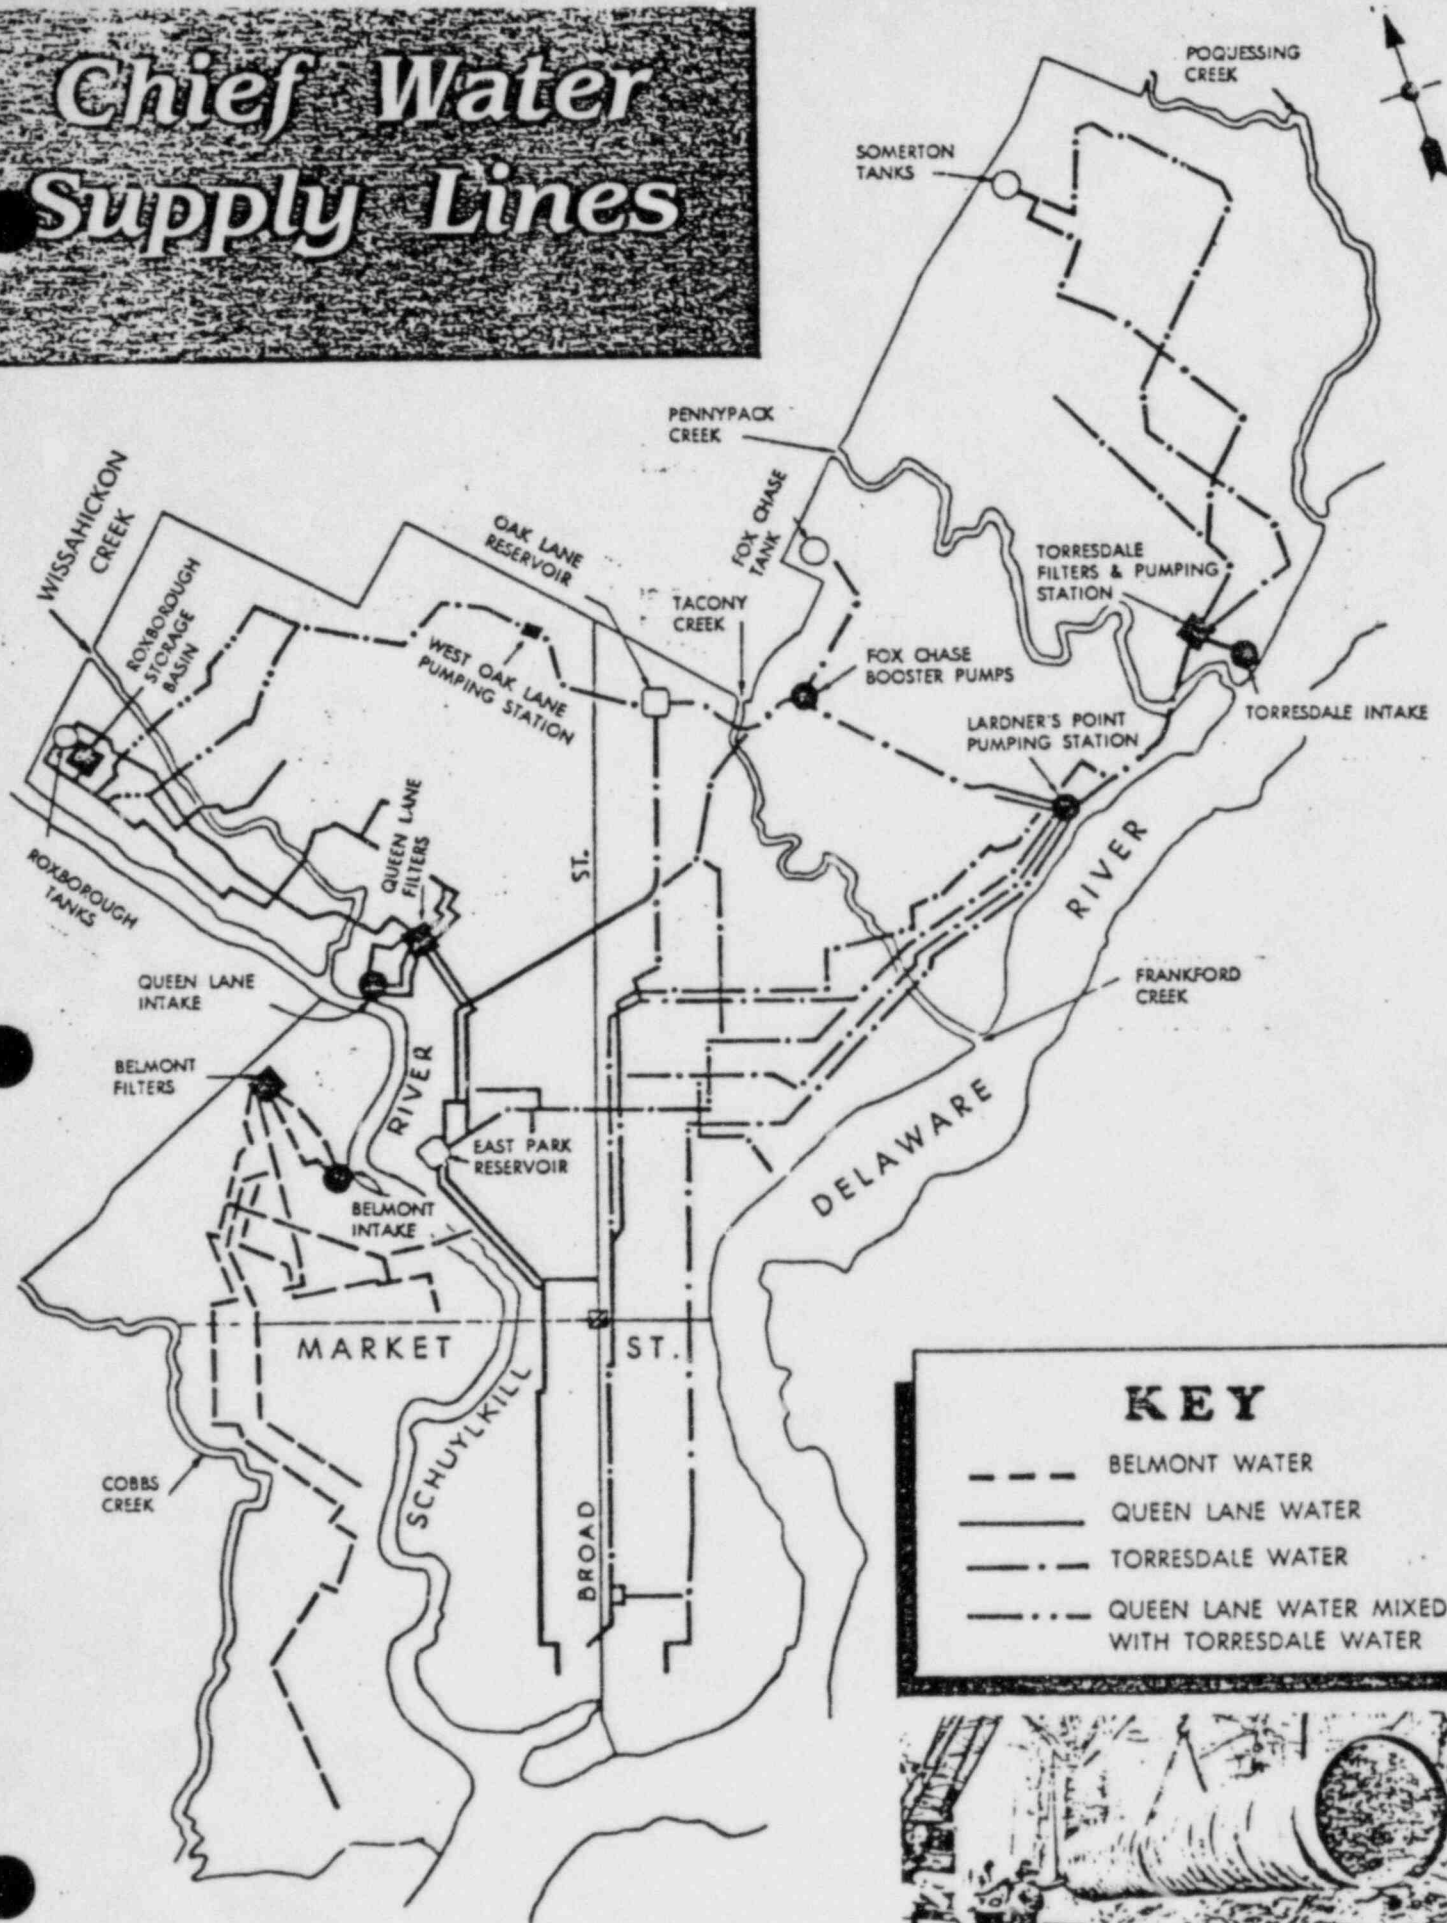


**KEY**

- BELMONT WATER
- QUEEN LANE WATER
- - - TORRESDALE WATER
- · - · QUEEN LANE WATER MIXED WITH TORRESDALE WATER

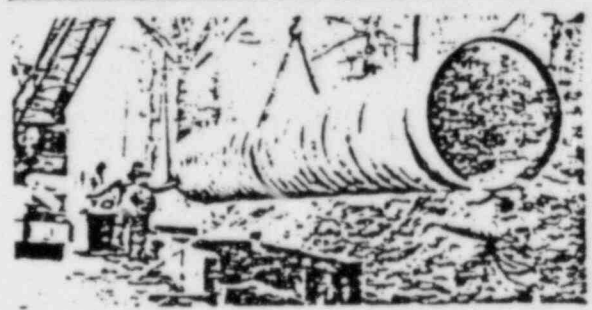

# Torresdale Water Treatment Plant

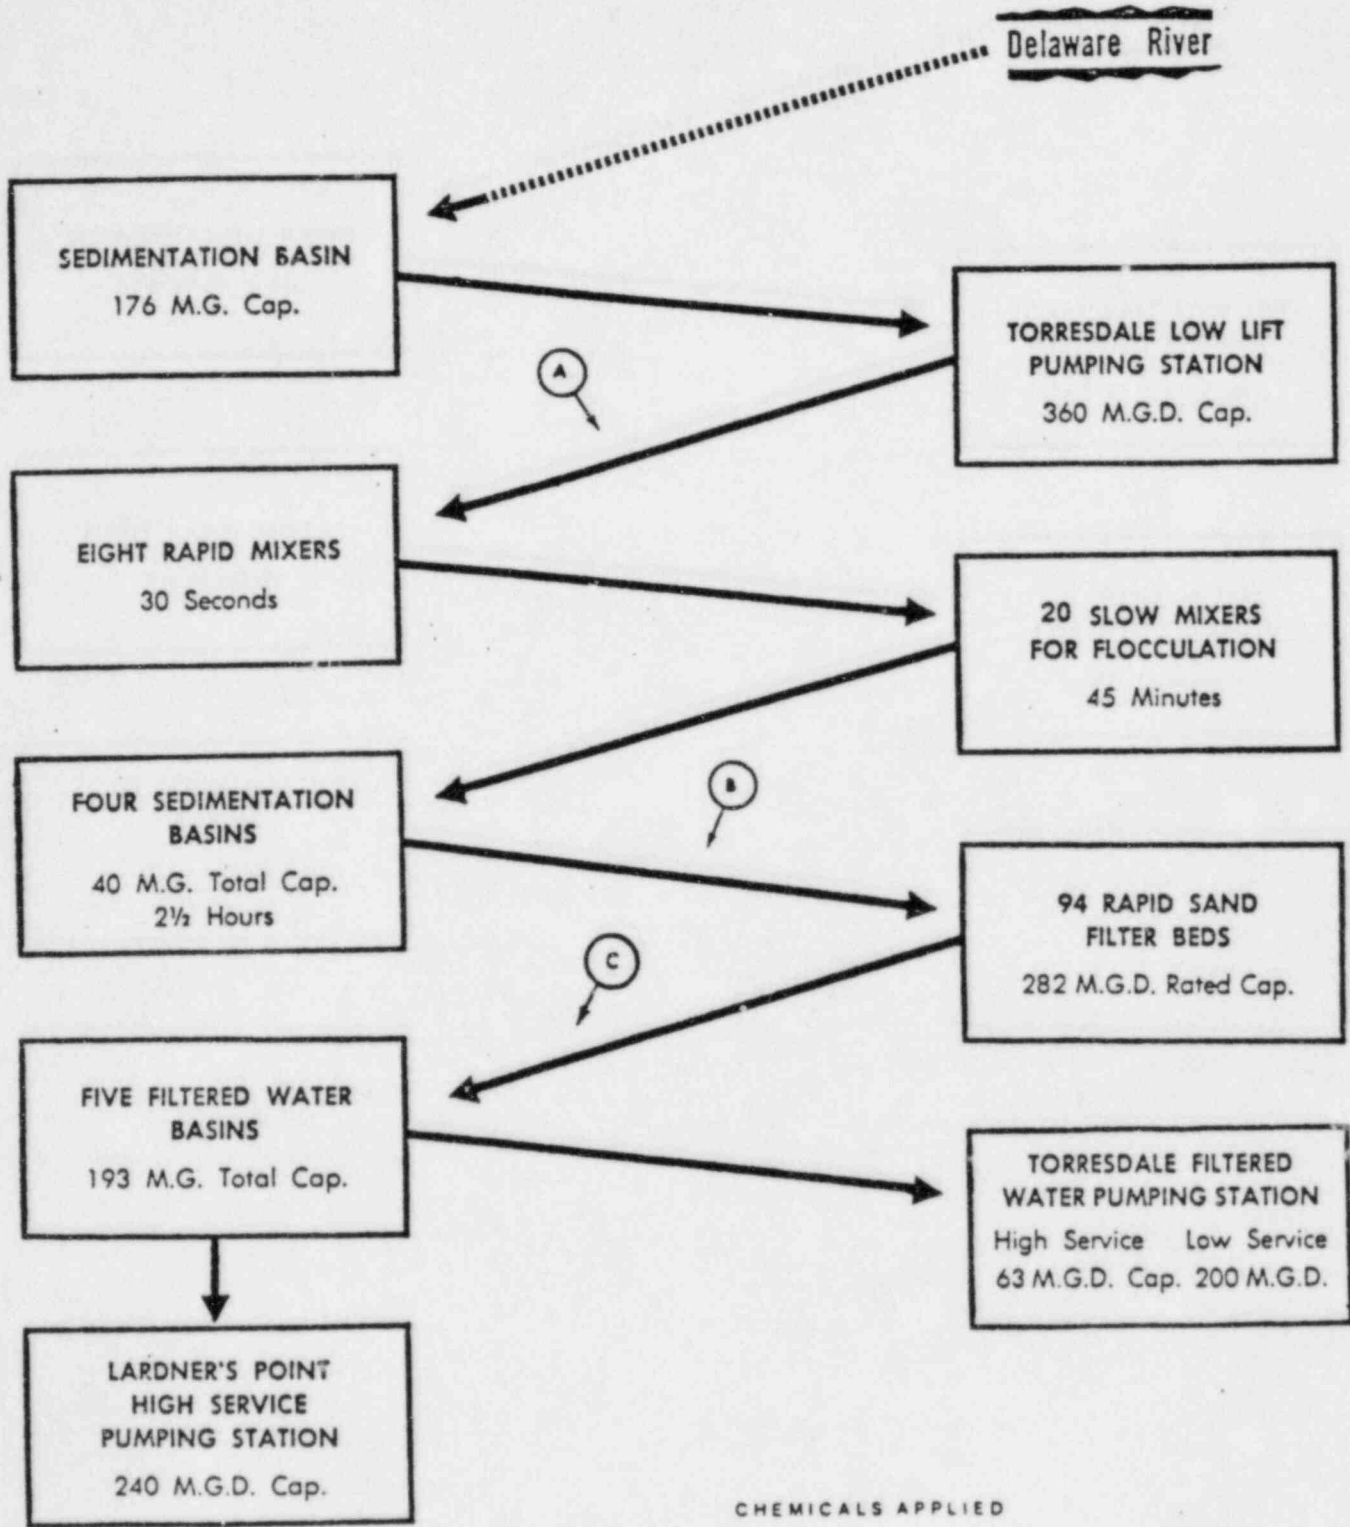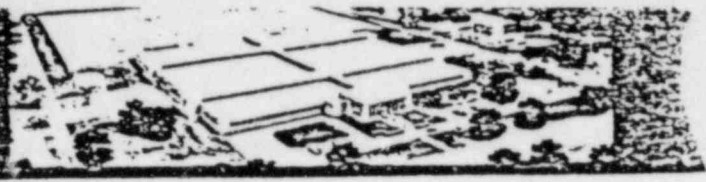

### CHEMICALS APPLIED

- A—Ferric chloride, lime, carbon, chlorine, chlorine dioxide
- B—Chlorine or chlorine dioxide
- C—Fluoride, chlorine, chlorine dioxide, ammonia

# Torresdale



**TORRESDALE FILTERED WATER PUMPING STATION**  
 High Service    Low Service  
 80 M.G.D. Cap.    200 M.G.D.

**DISTRIBUTION**  
 High service pumps supply Pressure District 1 with average of 21 M.G.D. annually. Also supply 11 M.G.D. to Bucks County

**LARDNER'S POINT HIGH SERVICE PUMPING STATION**  
 240 M.G.D. Cap.

**DISTRIBUTION**  
 Low service pumps supply Pressure Districts 2, 3, and 4 with average of 35 to 40 M.G.D. annually.

**DISTRIBUTION**  
 Supplies Pressure Districts 2, 3, and 4, and Fox Chase and Oak Lane Stations, with combined average of 145 M.G.D. annually.

**FOX CHASE BOOSTER PUMPING STATION**  
 25.3 M.G.D. Cap.

**DISTRIBUTION**  
 Supplies Pressure District 1 with average of 11 M.G.D. annually.

**OAK LANE RESERVOIR**  
 North Basin    South Basin  
 70 M.G. Total Cap.

**OAK LANE BOOSTER PUMPING STATION**  
 50 M.G.D. Cap.

**DISTRIBUTION**  
 Supplies Pressure District 8 and West Oak Lane Station with Combined average of 17 to 19 M.G.D. annually. Pressure District 8 is also supplied by Queen Lane H.S. Pumps and Upper Roxborough gravity.

**WEST OAK LANE BOOSTER PUMPING STATION**  
 27.5 M.G.D. Cap.

**DISTRIBUTION**  
 Supplies Pressure District 9, 10, with 8 to 9 M.G.D. annually.




**CHEMICALS APPLIED**  
 A— Sodium hypochlorite ammonia


# Treatment Plant




Schuylkill River

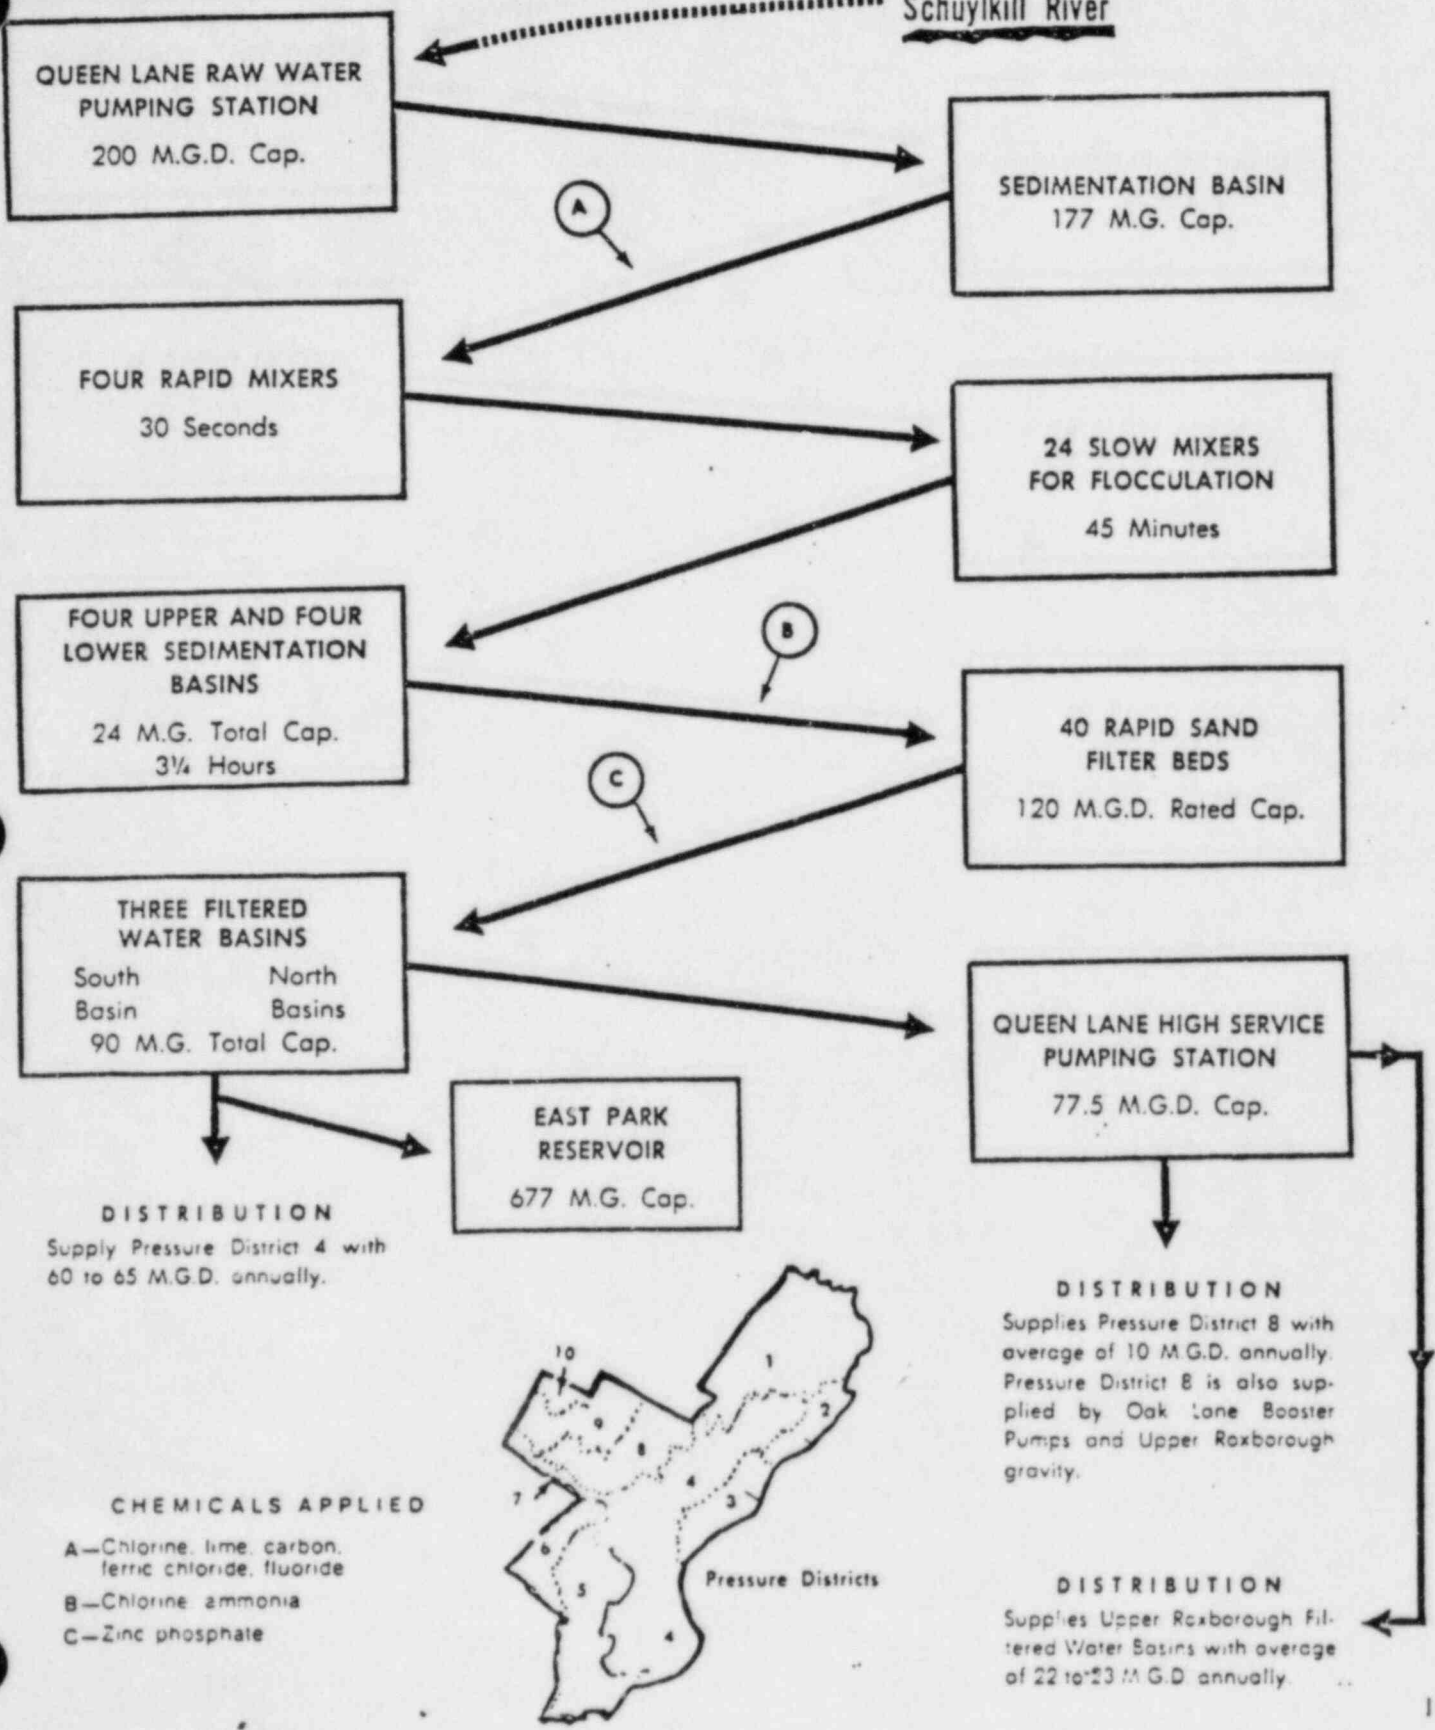

# DISTRIBUTION FROM Roxborough

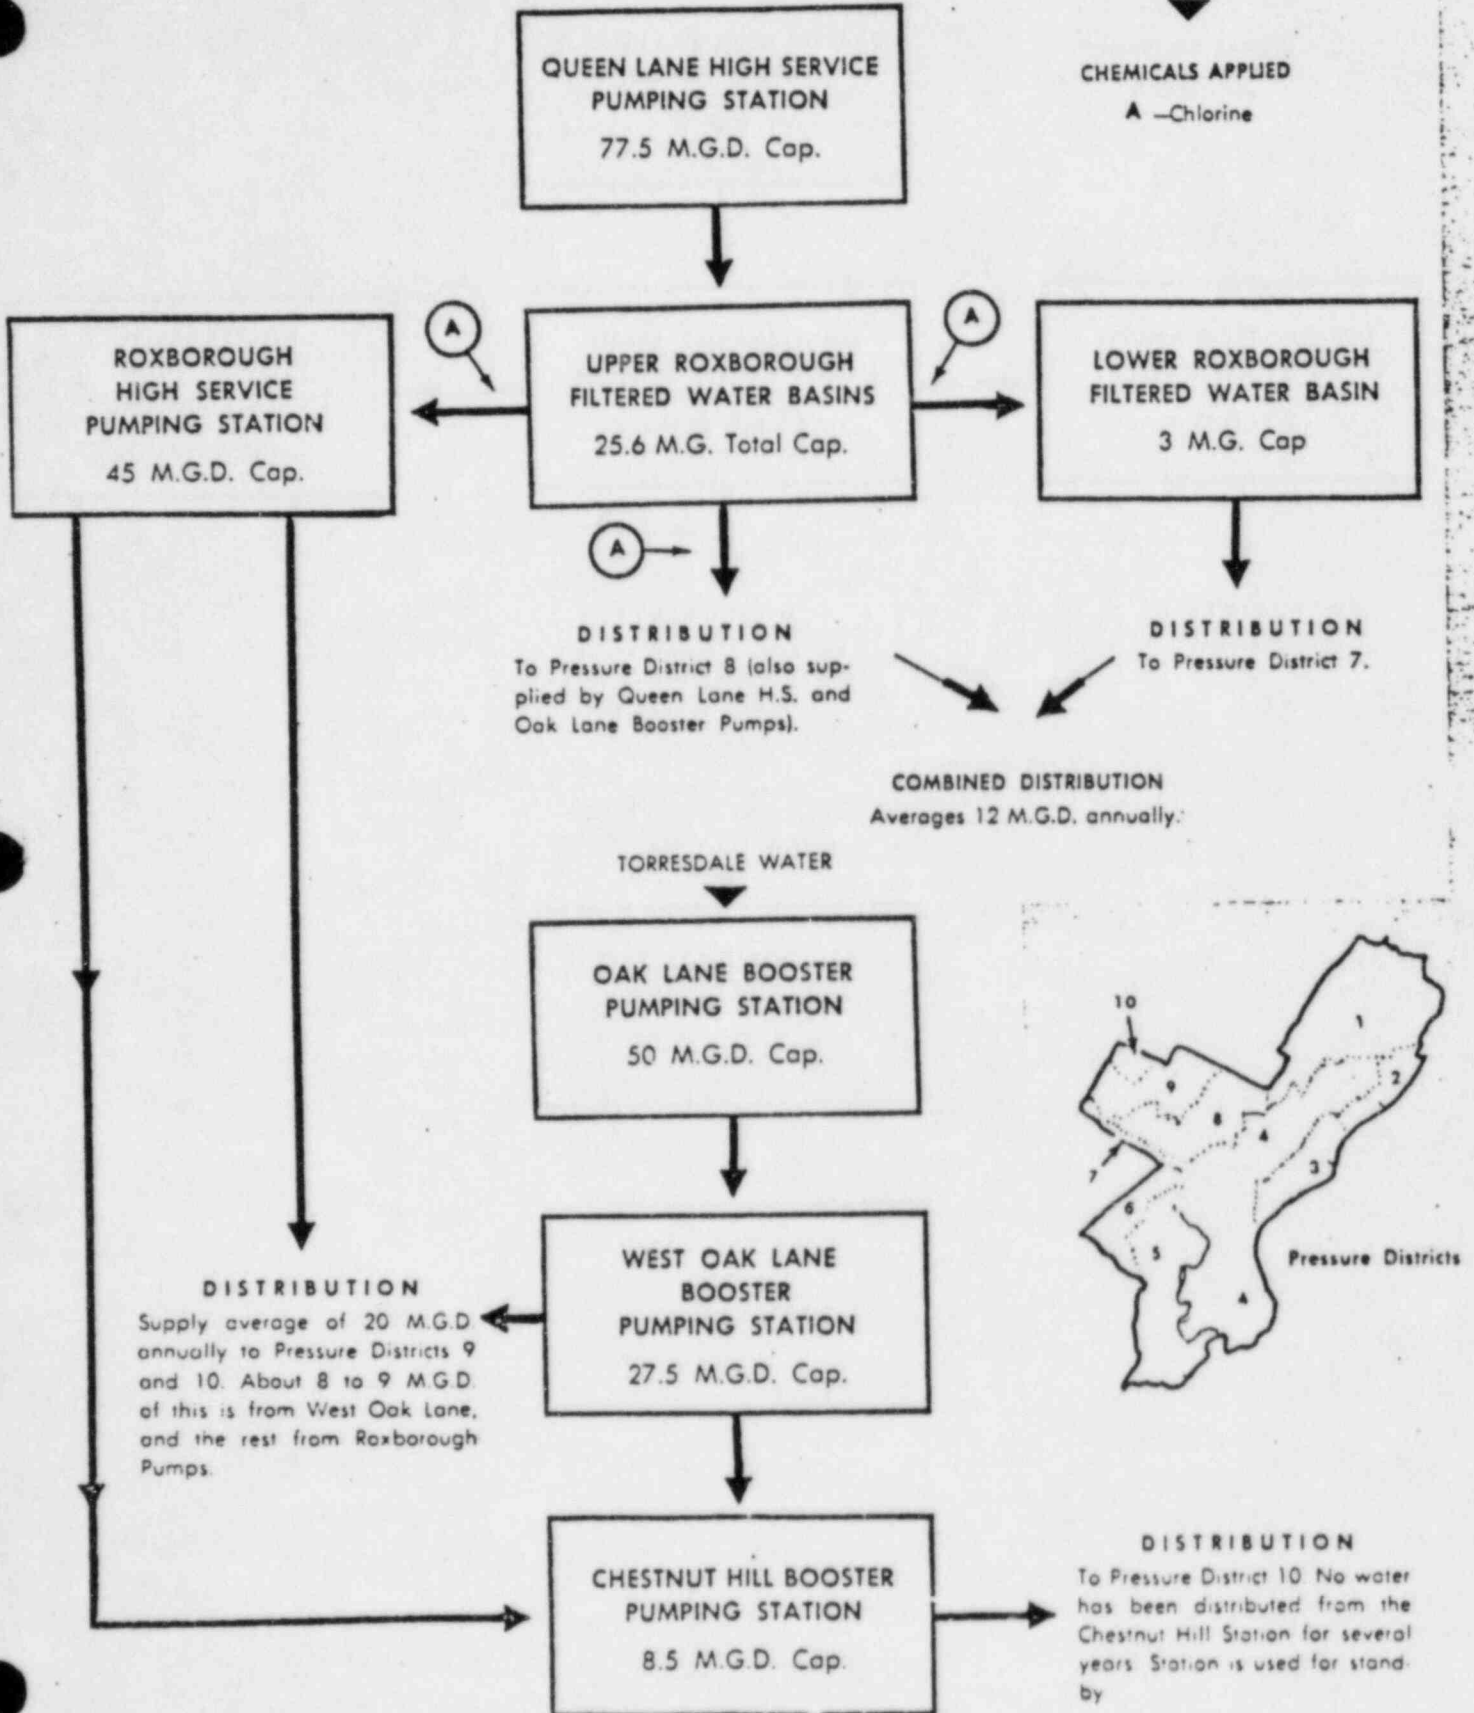

# Belmont Water Treatment Plant

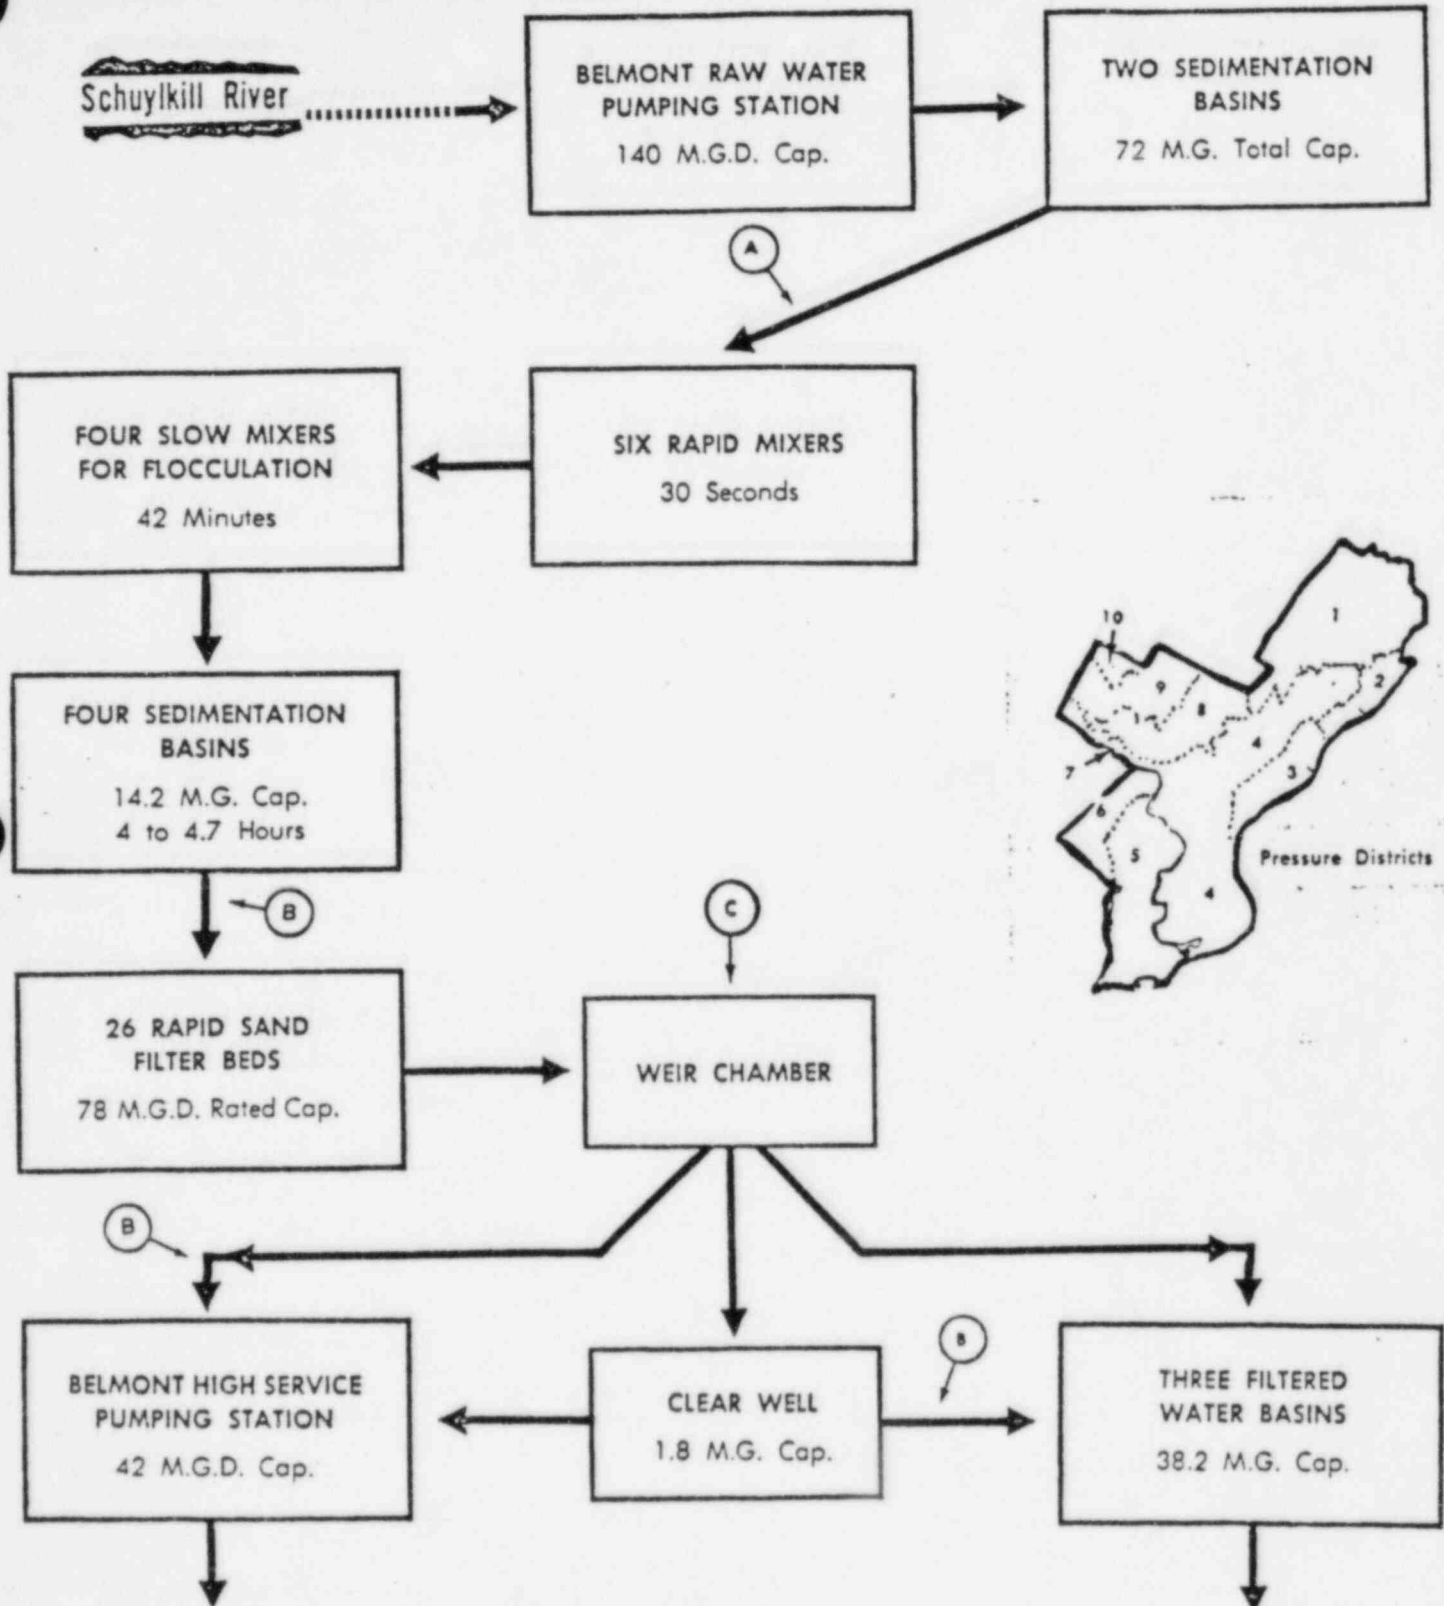

**DISTRIBUTION**  
Supplies average of 13 to 14 M.G.D. to Pressure District 6 annually.

**CHEMICALS APPLIED**  
 A—Alum lime carbon chlorine chlorine dioxide  
 B—Chlorine  
 C—Zinc phosphate lime fluoride ammonia chlorine chlorine dioxide

**DISTRIBUTION**  
Supplies average of 50 M.G.D. to Pressure District 5 annually.



**Water  
is the lifeline  
of the  
Delaware Valley—**

**Don't Waste It!**

City of Philadelphia



WILLIAM J. GREEN Mayor

WILLIAM J. MARRAZZO Water Commissioner