


DMB




LOUISIANA
POWER & LIGHT / 142 DELARONDE STREET
P O. BOX 6008 • NEW ORLEANS, LOUISIANA 70174 • (504) 366-2345

April 4, 1984

W3P84-0927
0-3-A20.03.17

Mr. John T. Collins
Regional Administrator, Region IV
U.S. Nuclear Regulatory Commission
611 Ryan Plaza Drive
Suite 1000
Arlington, Texas 76011

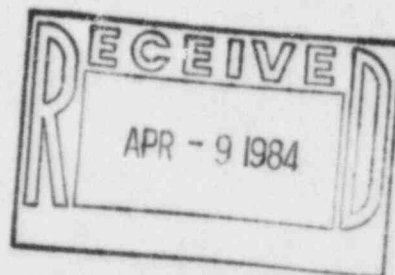

SUBJECT: Waterford 3 SES
Docket No. 50-382
IE Bulletin 83-08
Electrical Circuit Breakers With An Undervoltage Trip Feature In
Use In Safety-Related Applications Other Than The Reactor Trip
System

Dear Mr. Collins:

As required by IE Bulletin 83-08, a review has been performed of circuit breakers in safety-related applications at Waterford 3, other than as reactor trip breakers. This review concluded that none of the subject circuit breakers (supplied exclusively by General Electric) incorporate the use of an undervoltage trip feature as discussed in IE Bulletin 83-04.

Based on the above information, LP&L considers all required action complete for IE Bulletin 83-08. If you have any questions or require additional information, please advise.

Very truly yours,

K.W. Cook
Nuclear Support and Licensing Manager

KWC/DWH/mlm

cc: W.M. Stevenson, E.L. Blake, G.L. Constable, J. Wilson,
D.M. Crutchfield

8501070053 840404
PDR ADDCK 05000382
PDR
Q

1611

Before the
UNITED STATES NUCLEAR REGULATORY COMMISSION

Docket No. 50-382

In the Matter of
LOUISIANA POWER & LIGHT COMPANY

Response to IE Bulletin 83-08

Louisiana Power & Light Company, Applicant in the above captioned proceeding, hereby files a response to IE Bulletin 83-08, for Waterford SES Unit No. 3.

Respectfully submitted,
LOUISIANA POWER & LIGHT COMPANY

By: 

R.M. Nelson
Nuclear Support & Licensing
Manager (acting)

DATE: April 4, 1984

