

Wayne H. Jens
Vice President
Nuclear Operations

**Detroit
Edison**

Fermi-2
6400 North Dixie Highway
Newport, Michigan 48166
(313) 586-4150

January 25, 1985
EF2-70238

Mr. James G. Keppler
Regional Administrator
Region III
U. S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, Illinois 60137

Dear Mr. Keppler:

- Reference: (1) Fermi 2
NRC Docket No. 50-341
- (2) Letter, W. H. Jens to J. G. Keppler
December 18, 1984, EF2-70221


Subject: Detroit Edison Amended Response
Inspection Report 50-341/84-37

Reference 2 provided Detroit Edison's response to the items of noncompliance identified in your Inspection Report No. 50-341/84-37. During a subsequent telephone discussion between Messrs. S. DuPont, D. Hills, and M. Ring of your office and Detroit Edison's Messrs. F. Abramson and J. Conen, Detroit Edison agreed to take additional steps to address your inspectors' concerns regarding Item 84-37-01. The enclosed response describes additional corrective actions to prevent recurrence and the date when these actions will be fully implemented.

We trust this letter satisfactorily responds to the concerns identified by your inspectors.

If you have questions regarding this matter, please contact Mr. Lewis Bregni, (313) 586-5083.

Sincerely,

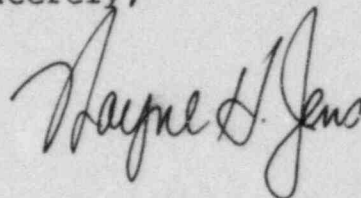

8502080486 850125
PDR ADOCK 05000341
G PDR

cc: P. M. Byron
R. C. Knop
USNRC, Document Control Desk
Washington, D.C. 20555

FEB 1 1985

JEOL 11

AMENDED RESPONSE TO NRC INSPECTION REPORT
ITEM NO. 50-341/84-37-01

Corrective Action Taken to Avoid Further Noncompliance

During the investigations related to this item of non-compliance, Detroit Edison concluded that more explicit guidance on the use of the Abnormal Lineup Sheet (ALS) was appropriate. A change has been issued to POM 21.000.01, "Shift Operations and Control Room" to clarify when the use of an ALS is required. This procedure is included in the operators' required reading.

In addition, Plant Order EFP-1081, "Authorization for Equipment Operation," has been issued. This order specifies that all operation of devices under the jurisdiction of the plant Operating Authority shall be performed by operating personnel unless specifically authorized by the shift supervisor or his designee. This order is included as required reading for appropriate maintenance and technical (I&C) personnel by revision of the Technical Section Indoctrination Card in POM Procedure 41.000.04 and by addition to the required reading specified by the Maintenance Engineer, general Foreman, and group supervisors under POM Procedure 31.000.07.

Date When Full Compliance Will Be Achieved

The required reading lists and Technical Section Indoctrination Card have been revised. Training of the affected maintenance and I&C personnel will be completed by January 30, 1985.