



GPU Nuclear Corporation
Post Office Box 388
Route 9 South
Forked River, New Jersey 08731-0388
609 971-4000
Writer's Direct Dial Number:

September 10, 1992
C321-92-2253

U.S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, D.C. 20555


Gentlemen:

Subject: Oyster Creek Nuclear Generating Station
Docket No. 50-219
Special Report No. 92-06

Enclosed is Special Report No. 92-06 which is submitted in accordance with technical specification 3.12.B.2.

If there are any questions, please call Mr. Michael Heller, Licensing Engineer, at (609) 971-4680.

Sincerely,

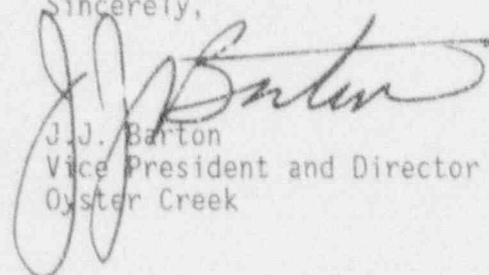

J.J. Barton
Vice President and Director
Oyster Creek

Enclosure

cc: NRC Region 1 Administrator
NRC Resident Inspector
Oyster Creek NRC Project Manager

150016

9209170047 920910
PDR ADOCK 05000217
S PDR

Oyster Creek Nuclear Generating Station
Special Report 92-06

Report Date: September 10, 1992

Occurrence Date: August 7, 1992

Identification of Occurrence:

The #1 fire diesel pump was inoperable for greater than 7 days which requires a special report per technical specification 3.12.B.2.

Description of Occurrence:

The #1 fire diesel pump was removed from service on August 7, 1992 to perform routine quarterly preventive maintenance tasks. When the pump was being returned to service on August 11, 1992, the diesel engine overheated during the operability surveillance. Corrective action was taken to replace the cooling water solenoid valve (V-9-52) and install new cooling water strainers. The #1 fire diesel pump again tested and declared operable on August 15, 1992. During this entire period, the #2 fire diesel pump and the backup suppression water system were operable.