



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

BOSTON EDISON COMPANY

DOCKET NO. 50-293

PILGRIM NUCLEAR POWER STATION

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 82  
License No. DPR-35

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment by Boston Edison Company (the licensee) dated July 30, 1984 complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 3.B of Facility Operating License No. DPR-35 is hereby amended to read as follows:


8410230592 841010  
PDR ADOCK 05000293  
P PDR

B. Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 82, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

  
Domenic B. Vassallo, Chief  
Operating Reactors Branch #2  
Division of Licensing

Attachment:  
Changes to the  
Technical Specifications

Date of Issuance: October 10, 1984

ATTACHMENT TO LICENSE AMENDMENT NO. 82

FACILITY OPERATING LICENSE NO. DPR-35

DOCKET NO. 50-293

Remove

Insert

123

123

124

124

---

124A

128

128

128A

128A

139

139

---

139A

3.6 PRIMARY SYSTEM BOUNDARYApplicability:

Applies to the operating status of the reactor coolant system.

Objective:

To assure the integrity and safe operation of the reactor coolant system.

Specification:A. Thermal and Pressurization Limitations

1. The average rate of reactor coolant temperature change during normal heatup or cooldown shall not exceed 100°F/hr when averaged over a one-hour period except when the vessel temperatures are above 450°F. The shell flange to shell temperature differential shall not exceed 145°F.
2. The reactor vessel shall not be pressurized for hydrostatic and/or leakage tests, and critical core operation shall not be conducted unless the reactor vessel temperature is above that defined by the appropriate curves on Figures 3.6.1 and 3.6.2. In the event this requirement is not met, achieve stable reactor conditions with reactor vessel temperature above that defined by the appropriate curve and obtain an engineering evaluation to determine the appropriate course of action to take.

4.6 PRIMARY SYSTEM BOUNDARYApplicability:

Applies to the periodic examination and testing requirements for the reactor cooling system.

Objective:

To determine the condition of the reactor coolant system and the operation of the safety devices related to it.

Specification:A. Thermal and Pressurization Limitations

1. During heatups and cooldowns, the following temperatures shall be permanently logged at least every 15 minutes until the difference between any two readings taken over a 45 minute period is less than 5°F.
  - a. Reactor vessel shell adjacent to shell flange
  - b. Reactor vessel shell flange
  - c. Recirculation loops A and B
2. Reactor vessel shell temperature and reactor coolant pressure shall be permanently logged at least every 15 minutes whenever the shell temperature is below 220°F and the reactor vessel is not vented.

Test specimens of the reactor vessel base, weld and heat affected zone metal subjected to the highest fluence of greater than 1 Mev neutrons shall be installed in the reactor vessel adjacent to the vessel wall at the core midplane level. The specimens and sample program shall conform to the requirements of ASTM E 185-66. Selected

LIMITING CONDITION FOR OPERATION

SURVEILLANCE REQUIREMENTS

3.6.A Thermal and Pressurization Limitations (Cont'd)

4.6.A Thermal and Pressurization Limitations (Cont'd)

- 3. The reactor vessel head bolting studs shall not be under tension unless the temperature of the vessel head flange and the head is greater than 55°F.
- 4. The pump in an idle recirculation loop shall not be started unless the temperatures of the coolant within the idle and operating recirculation loops are within 50°F of each other.
- 5. The reactor recirculation pumps shall not be started unless the coolant temperatures between the dome and the bottom head drain are within 145°F.

- 3. When the reactor vessel head bolting studs are tensioned and the reactor is in a Cold Condition, the reactor vessel shell temperature immediately below the head flange shall be permanently recorded.
- 4. Prior to and during startup of an idle recirculation loop, the temperature of the reactor coolant in the operating and idle loops shall be permanently logged.
- 5. Prior to starting a recirculation pump, the reactor coolant temperatures in the dome and in the bottom head drain shall be compared and permanently logged.

6. Thermal-Hydraulic Stability

Core thermal power shall not exceed 25% of rated thermal power without forced recirculation.

B. Coolant Chemistry

- 1. The reactor coolant system radioactivity concentration in water shall not exceed 20 microcuries total iodine per ml of water.
- 2. The reactor coolant water shall not exceed the following limits with steaming rates less than 100,000 pounds per hour, except as specified in 3.6.B.3:

- 1. a. A reactor coolant sample shall be taken at least every 96 hours and analyzed for radioactivity content.
- b. Isotopic analysis of a reactor coolant sample shall be made at least once per month.
- 2. During startups and at steaming rates less than 100,000 pounds per hour, a sample of reactor coolant shall be taken every four hours and analyzed for chlorine content.


Conductivity ... 2 μmho/cm

Chloride ion ... 0.1 ppm

TABLE 4.6.3  
 REACTOR VESSEL MATERIAL  
 SURVEILLANCE PROGRAM WITHDRAWAL SCHEDULE

<u>Capsule Number</u>	<u>Effective Full Power Years (EFPY)</u>	<u>Fluence (n/cm<sup>2</sup>) (1/4 T)</u>	<u>RT<sub>NDT</sub> (weld metal) (°F)</u>
1	4.17	$1.8 \times 10^{17}$	55
2	15 (approx.)	$6.3 \times 10^{17}$ (approx.)	91
3	End of Life	$1.4 \times 10^{18}$ (approx.)	136


**FIGURE 3.6.1**  
**PILGRIM REACTOR VESSEL**  
**PRESSURE - TEMPERATURE LIMITS**  
**HYDROSTATIC AND LEAK TESTS**

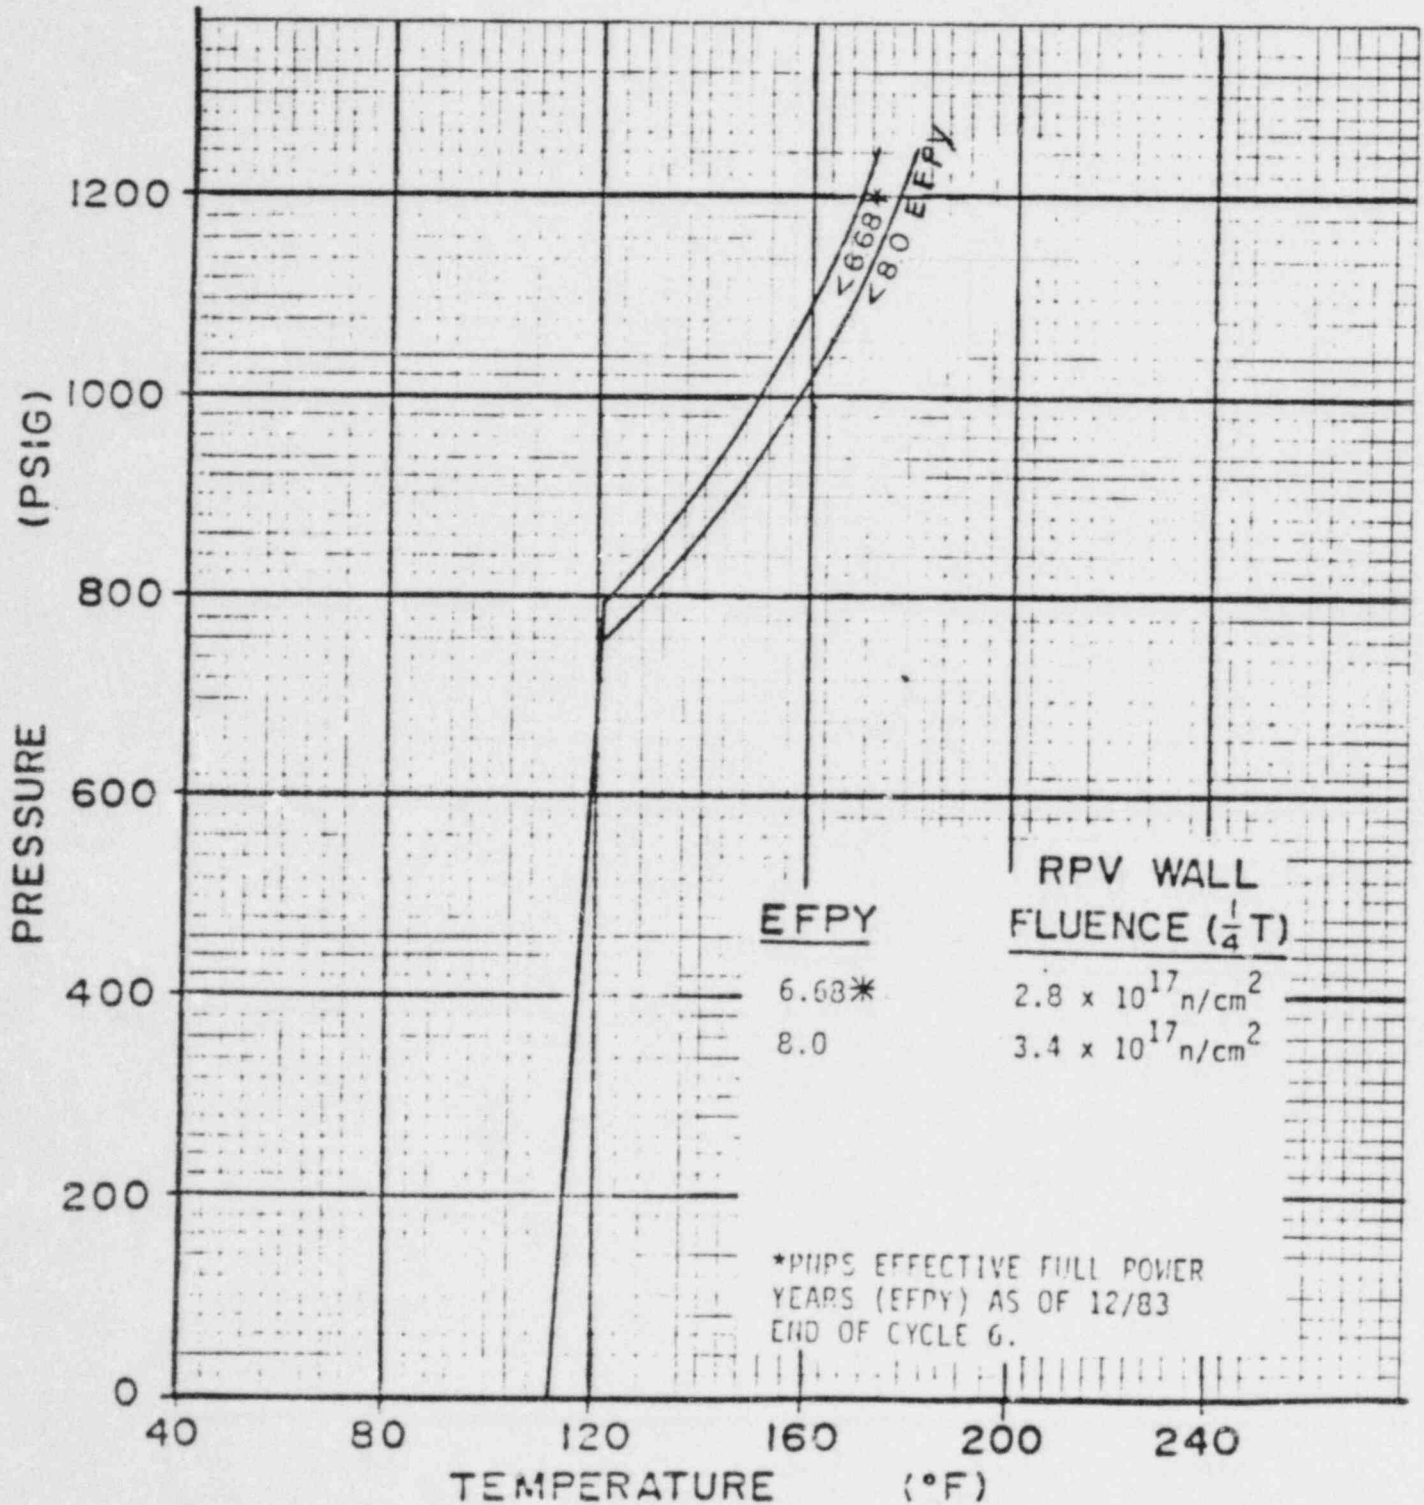

**FIGURE 3.6.2**

**PILGRIM REACTOR VESSEL  
PRESSURE - TEMPERATURE LIMITS**

**SUBCRITICAL / CRITICAL HEAT UP & COOL DOWN**

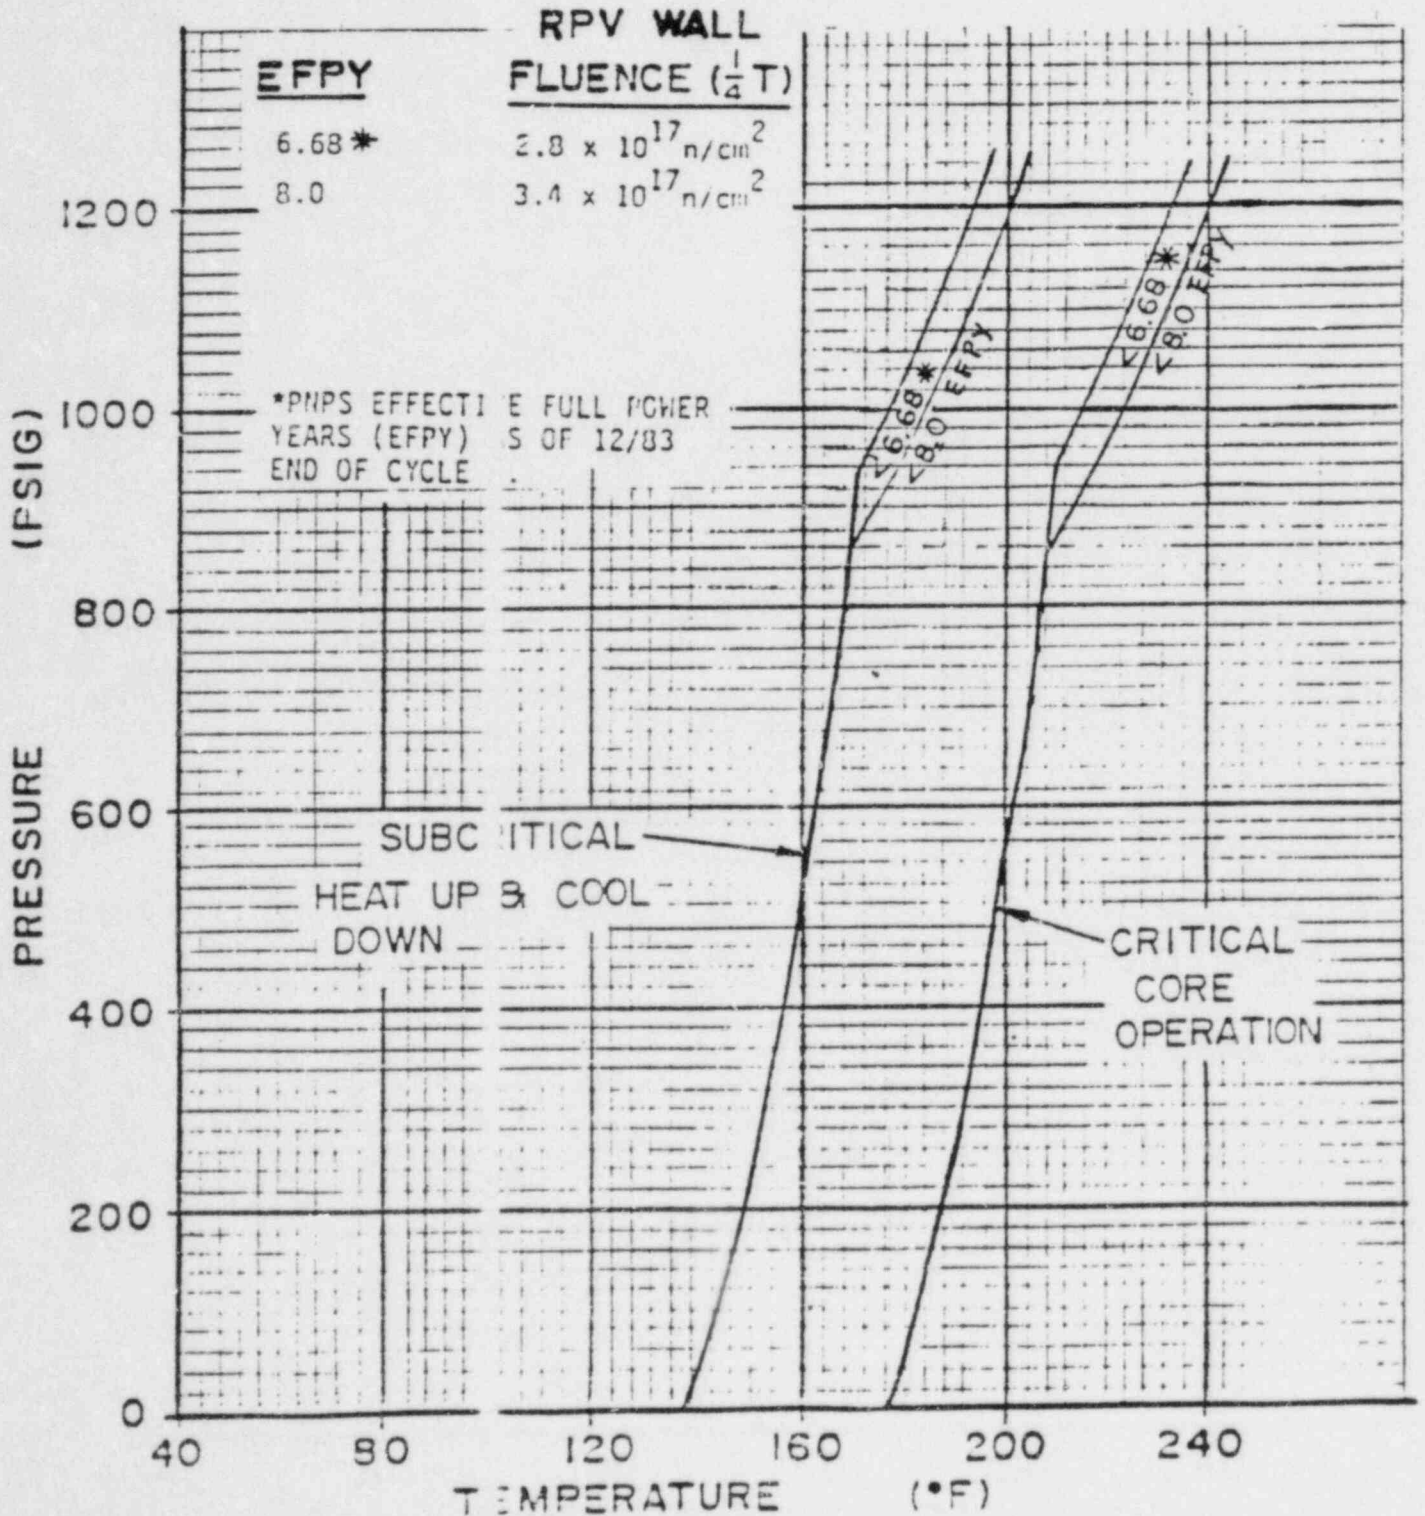



Bases:

3.6.A and 4.6.A

Thermal and Pressurization Limitations (Cont'd)

The reactor coolant system is a primary barrier against the release of fission products to the environs. In order to provide assurance that this barrier is maintained at a high degree of integrity, restrictions have been placed on the operating conditions to which it can be subjected.

Appendix G to 10CFR50 defines the temperature-pressurization restrictions for hydrostatic and leak tests, pressurization, and critical operation. These limits have been calculated for Pilgrim and are contained in Figures 3.6.1 and 3.6.2.

For Pilgrim pressure-temperature restrictions, two locations in the reactor vessel are limiting. The closure region controls at lower pressures and the beltline controls at higher pressures.

The nil-ductility transition (NDT) temperature is defined as the temperature below which ferritic steel breaks in a brittle rather than ductile manner. Radiation exposure from fast neutrons (>1 mev) above about  $10^{17}$  nvt may shift the NDT temperature of the vessel metal above the initial value. Impact tests from the first material surveillance capsule removed from the reactor vessel have established the magnitude of the  $RT_{NDT}$  shift for the beltline. The shift, which is greatest for the weld metal, is tabulated below for various fluence levels and EFPY of operation:

<u>EFPY</u>	<u>RPV Wall Fluence (1/4T)</u>	<u><math>RT_{NDT}</math></u>
6.68*	$2.8 \times 10^{17}$ n/cm <sup>2</sup>	61°F
8.0	$3.4 \times 10^{17}$ n/cm <sup>2</sup>	68°F

\*PNPS Effective Full Power Years (EFPY) as of end of Cycle 6 (12/83)

Neutron flux wires and samples of vessel material are installed in the reactor vessel adjacent to the vessel wall at the core midplane level. The wires and samples will be periodically removed and tested to experimentally verify the values used for Figures 3.6.1 and 3.6.2. The withdrawal schedule of Table 4.6.2 has been established as required by 10CFR50, Appendix H.

The pressure-temperature limitations of Figures 3.6.1 and 3.6.2 applicable to the beltline reflect an initial  $RT_{NDT}$  of 0°F. This initial value is based

Bases:

3.6.A and 4.6.A

Thermal and Pressurization Limitations (Cont'd)

on unirradiated test data adjusted for specimen orientation in accordance with USNRC Branch Technical Position MTEB 5-2.

The pressure-temperature limitations of Figures 3.6.1 and 3.6.2 applicable to the closure region reflect an  $RT_{NDT}$  of  $-5^{\circ}F$ , also based on test data adjusted for specimen orientation. The curves apply to 100% bolt preload condition, but are conservative for lesser bolt preload conditions.

For critical core operation when the water level is within the normal range for power operation and the pressure is less than 20% of the preservice system hydrostatic test pressure (313 psi), the minimum permissible temperature of the highly stressed regions of the closure flange is  $RT_{NDT} + 60 = 55^{\circ}F$ .

The closure region is more limiting than the feedwater nozzle with regards to both stress intensity and  $RT_{NDT}$ . Therefore the pressure-temperature limits of the closure are controlling.