

TEXAS UTILITIES GENERATING COMPANY
SKYWAY TOWER • 400 NORTH OLIVE STREET, L.B. 81 • DALLAS, TEXAS 75201


BILLY R. CLEMENTS
VICE PRESIDENT, NUCLEAR OPERATIONS

February 7, 1985
TXX-4410

Mr. D.R. Hunter, Chief
Reactor Project Branch 2
U.S. Nuclear Regulatory Commission
Office of Inspection & Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76012

Docket No.: 50-445

COMANCHE PEAK STEAM ELECTRIC STATION
CABLE SPREAD ROOM: FIRE PROTECTION
QA FILE: CP-85-02, SDAR-162
FILE NO.: 10110

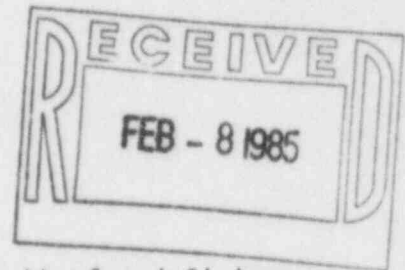

Dear Mr. Hunter:

On January 11, 1985 we verbally notified your Mr. D. Hunnicutt of a deficiency identified during an engineering review of fire protection construction/installation activities. The slab at Elevation 821'-8" in the Turbine Building was identified to be four (4) inches in thickness which is not adequate to provide a three-hour fire barrier.

We have completed our investigation and concluded that the matter is not reportable under 10CFR50.55(e). Records supporting this determination are available for your inspector's review at the CPSES site.

Very truly yours,

A handwritten signature in cursive script that reads "Billy R. Clements".

BRC:tlg

cc: NRC Region IV (0 + 1 copy)

Director, Inspection & Enforcement (15 copies)
U.S. Nuclear Regulatory Commission
Washington, DC 20555

8502150433 850207
PDR ADOCK 05000445
S PDR