




GULF STATES UTILITIES COMPANY

POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704

AREA CODE 713 838-6631

October 26, 1984
RBG-19264
File Nos. G9.5, G9.25.1.1

Mr. Robert D. Martin, Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV, Office of Inspection and Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011

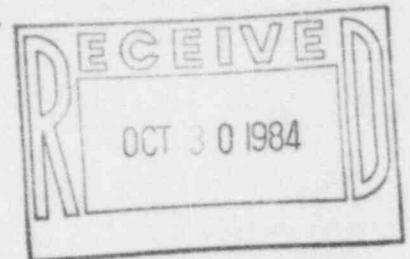

Dear Mr. Martin:

River Bend Station Unit 1
Docket No. 50-458
Final Report/DR-140

Gulf States Utilities Company (GSU) has completed its evaluation of DR-140 concerning the engine-mounted fuel oil line in the standby diesel generators supplied by Transamerica Delaval, Incorporated (TDI). The Field Quality Control inspection results show that for standby diesel generators 1EGS*EG1A and 1EGS*EG1B, the fuel oil piping and header assembly were installed in accordance with TDI Drawing No. 03-450-08. Because no hardware deficiency exists, GSU has determined that this condition does not meet the reporting criteria of 10CFR50.55(e).

Sincerely,

William J. Booker
for J. E. Booker
Manager-Engineering,
Nuclear Fuels & Licensing
River Bend Nuclear Group

WJ
WJ/JP/lp

Attachment

cc: Director of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

NRC Resident Inspector-Site

8411120458 841026
PDR ADOCK 05000458
S PDR

IE-27
10