

ATTACHMENT I

OFFSITE DOSE CALCULATION MANUAL

REVISION 19

JANUARY 1995

9604300067 960424
PDR ADCK 05000395
R PDR

ODCM Revision 19

ODCM (Revision 19) Changes	Comment
List of effective pages i and ii; revised consistent with changes made in this revision.	
Specification 1.1.1.1, Radioactive Liquid Effluent Monitoring Instrumentation, p. 1.0-1; Action (b) changed from "... the next semiannual effluent report" to "... the next Annual Radioactive Effluent Release Report".	Change required for consistency with Technical Specifications Amendment No. 117 which changed the reporting frequency for the radioactive effluent release report from semiannual to annual.
Specification 1.2.1.1, Radioactive Gaseous Effluent Monitoring Instrumentation, p. 1.0-17; Action (b) changed from "... the next semiannual effluent report" to "... the next Annual Radioactive Effluent Release Report".	See Specification 1.1.1.1.
Specification 1.2.2.1, Gaseous Effluents: Dose Rate, p. 1.0-23; Condition (c) added - : "Less Than 0.1% of the limits 1.2.2.1(a) and (b) as a result of oil incineration".	Specific oil incineration offsite dose rate limits are added consistent with those stated in the application for Approval to Incinerate Oil Contaminated with Very Low Levels of Licensed Radioactive Material (Oil Incineration Application), submitted to the Bureau of Radiological Health, South Carolina Department of Health and Environmental Control (SCDHEC). The specific oil incineration dose rate limits represent a small fraction of the station offsite gaseous dose rate limits.
Specification 1.2.4.1, Gaseous Effluents: Dose- Radioiodines, Tritium and Radioactive Materials in Particulate Form, p. 1.0-27; Condition (c) added - : "Less Than 0.1% of the limits 1.2.4.1(a) and (b) as a result of oil incineration".	Specific oil incineration offsite dose rate limits are added consistent with those submitted to SCDHEC in the Oil Incineration Application. The specific oil incineration dose limit represents a small fraction of the station total gaseous effluent dose limit.

ODCM Revision 19 (continued)

ODCM (Revision 19) Changes	Comment
<p>Specification 1.6.2, Semiannual Radioactive Effluent Release Report, p. 1.0-51; Section title changed from "Semiannual Radioactive Effluent Release Report" to "Annual Radioactive Effluent Release Report". Section 1.6.2.1 changed from "Routine radioactive effluent release reports covering the operation of the unit during the previous 6 months of operation shall be submitted within 60 days after January 1 and July 1 of each year" to "A radioactive effluent release report covering the operation of the unit during the previous year of operation shall be submitted within 60 days after January 1 of each year".</p> <p>Section 1.6.2.2, para. 1, was changed from "... reports ..." to "... report ...".</p> <p>Section 1.6.2.2, para. 2, sentence 1, was changed from "... release report to be submitted within 60 days after January 1 of each year ..." to "... release report ...".</p> <p>Section 1.6.2.2, para. 3, sentence 1, was changed from "... release report to be submitted within 60 days after January 1 of each year ..." to "... release report ...".</p> <p>Section 1.6.2.2, para. 5, was added to include the reporting requirements of Specification 1.1.1.1 and 1.2.1.1 as follows: "The Radioactive Effluent Release Report shall also include the following: an explanation as to why the inoperability of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified in ODCM Specification 1.1.1.1 and 1.2.1.1, respectively".</p>	<p>Change required for consistency with Technical Specification Amendment No. 117 which changed the reporting frequency for the radioactive effluent release report from semi-annual to annual.</p>
<p>Section 3.1.5, Oil Incineration, p. 3.0-10; Equation (60) limit changed from "1500 mrem/yr" to "1.5 mrem/yr".</p>	<p>Equation (60) is used to calculate a maximum burn rate for waste oil. The equation was revised to limit the burn rate such that offsite dose rate will not exceed 1.5 mrem/yr. This change is made for consistency with the revised Specification 1.2.2.1.</p>

Control Copy No. _____

OFFSITE DOSE CALCULATION MANUAL
FOR
SOUTH CAROLINA ELECTRIC AND GAS COMPANY
VIRGIL C. SUMMER NUCLEAR STATION

Approval BC Williams 1/16/95
General Manager, Nuclear Plant Operations Date

PS&C Approval BC Williams 1/16/95
Date

Revision 19
January 1995

Reviewed by: J. A. Riley 1/16/95
Date

Approved by: G. A. Blue 1-6-95
Date

LIST OF EFFECTIVE PAGES

<u>Page</u>	<u>Revision</u>	<u>Page</u>	<u>Revision</u>
i	19	1.0-34	15
ii	19	1.0-35	18
iii	17	1.0-36	18
iv	17	1.0-37	18
v	17	1.0-38	15
vi	17	1.0-39	17
vii	17	1.0-40	15
viii	17	1.0-41	15
ix	17	1.0-42	16
x	17	1.0-43	16
xi	17	1.0-44	15
		1.0-45	15
		1.0-46	17
		1.0-47	17
		1.0-48	17
1.0-1	19	1.0-49	15
1.0-2	13	1.0-50	15
1.0-3	13	1.0-51	19
1.0-4	13	1.0-52	19
1.0-5	13	1.0-53	16
1.0-6	13	1.0-54	16
1.0-7	18	1.0-55	16
1.0-8	13	1.0-56	16
1.0-9	13		
1.0-10	18		
1.0-11	13	2.0-1	13
1.0-12	13	2.0-2	16
1.0-13	13	2.0-3	16
1.0-14	13	2.0-4	16
1.0-15	13	2.0-5	16
1.0-16	13	2.0-6	13
1.0-17	19	2.0-7	13
1.0-18	15	2.0-8	13
1.0-19	15	2.0-9	13
1.0-20	15	2.0-10	13
1.0-21	15	2.0-11	13
1.0-22	15	2.0-12	13
1.0-23	19	2.0-13	13
1.0-24	17	2.0-14	13
1.0-25	17	2.0-15	13
1.0-26	15	2.0-16	17
1.0-27	19	2.0-17	17
1.0-28	18	2.0-18	16
1.0-29	18	2.0-19	16
1.0-30	15	2.0-20	16
1.0-31	15	2.0-21	16
1.0-32	15	2.0-22	16
1.0-33	15		

LIST OF EFFECTIVE PAGES (continued)

<u>Page</u>	<u>Revision</u>	<u>Page</u>	<u>Revision</u>
2.0-23	16	3.0-28	13
2.0-24	16	3.0-29	13
2.0-25	16	3.0-30	13
2.0-26	16	3.0-31	13
2.0-27	16	3.0-32	13
2.0-28	17	3.0-33	13
2.0-29	17	3.0-34	13
2.0-29a	18	3.0-35	13
2.0-30	17	3.0-36	13
2.0-31	17	3.0-37	16
2.0-32	17	3.0-38	17
2.0-33	17	3.0-39	17
2.0-34	17	3.0-40	13
2.0-35	17	3.0-41	13
2.0-36	17	3.0-42	13
2.0-37	17	3.0-43	14
2.0-38	17	3.0-44	13
2.0-39	17	3.0-45	16
2.0-40	17	3.0-46	16
		3.0-47	16
3.0-1	13	3.0-48	13
3.0-2	13	3.0-49	13
3.0-3	17	3.0-50	13
3.0-4	13	3.0-51	13
3.0-5	13	3.0-52	13
3.0-6	17		
3.0-7	13	4.0-1	13
3.0-8	18	4.0-2	18
3.0-9	13	4.0-3	18
3.0-10	19	4.0-4	13
3.0-10A	16	4.0-5	13
3.0-11	13	4.0-6	13
3.0-12	15	4.0-7	18
3.0-13	14	4.0-8	17
3.0-14	13	4.0-9	13
3.0-15	16	4.0-10	13
3.0-16	17	4.0-11	18
3.0-17	16	4.0-12	18
3.0-18	13	4.0-13	18
3.0-19	13		
3.0-20	13		
3.0-21	13		
3.0-22	13		
3.0-23	13		
3.0-24	13		
3.0-25	13		
3.0-26	13		
3.0-27	13		

Table of Contents

	<u>PAGE</u>
List of Effective Pages	i
Table of Contents	iii
List of Tables	v
List of Figures	vi
References	vii
Introduction	viii
Responsibilities	ix
1.0 <u>SPECIFICATION OF LIMITING CONDITIONS FOR OPERATION</u>	
1.1 <u>Liquid Effluents</u>	1.0-1
1.1.1 Radioactive Liquid Effluent Monitoring Instrumentation	1.0-1
1.1.2 Liquid Effluents: Concentration	1.0-8
1.1.3 Liquid Effluents: Dose	1.0-14
1.1.4 Liquid Waste Treatment	1.0-15
1.2 <u>Gaseous Effluents</u>	1.0-17
1.2.1 Radioactive Gaseous Effluent Monitoring Instrumentation	1.0-17
1.2.2 Gaseous Effluents: Dose Rate	1.0-23
1.2.3 Gaseous Effluents: Dose - Noble Gas	1.0-26
1.2.4 Gaseous Effluents: Dose - Radioiodines, Tritium and Radioactive Materials in Particulate Form ..	1.0-27
1.2.5 Gaseous Radwaste Treatment	1.0-28
1.3 <u>Radioactive Effluents: Total Dose</u>	1.0-30
1.4 <u>Radiological Environmental Monitoring</u>	1.0-32
1.4.1 Monitoring Program	1.0-32
1.4.2 Land Use Census	1.0-42
1.4.3 Interlaboratory Comparison Program	1.0-44
1.5 <u>Bases</u>	1.0-45
1.6 <u>Reporting Requirements</u>	1.0-50
1.6.1 Annual Radiological Environmental Operating Report	1.0-50
1.6.2 Semiannual Radioactive Effluent Release Report	1.0-51
1.6.3 Major Changes to Radioactive Waste Treatment System (Liquid and Gaseous)	1.0-53
1.7 Definitions	1.0-55

2.0	<u>LIQUID EFFLUENT</u>	
2.1	<u>Liquid Effluent Monitor Setpoint Calculation</u>	2.0-1
2.1.1	Liquid Effluent Monitor Setpoint Calculation Parameters	2.0-2
2.1.2	Liquid Radwaste Effluent Line Monitors	2.0-6
2.1.3	Liquid Radwaste Discharge Via Industrial and Sanitary Waste System	2.0-14
2.1.4	Steam Generator Blowdown, Turbine Building Sump, and Condensate Demineralizer Backwash Effluent Lines	2.0-15
2.2	<u>Dose Calculation for Liquid Effluents</u>	2.0-32
2.2.1	Liquid Effluent Dose Calculation Parameters	2.0-32
2.2.2	Methodology	2.0-33
3.0	<u>GASEOUS EFFLUENT</u>	3.0-1
3.1	<u>Gaseous Effluent Monitor Setpoints</u>	3.0-1
3.1.1	Gaseous Effluent Monitor Setpoint Calculation Parameters	3.0-1
3.1.2	Station Vent Noble Gas Monitors	3.0-5
3.1.3	Waste Gas Decay System Monitor	3.0-7
3.1.4	Alternative Methodology for Establishing Conservative Setpoints	3.0-8
3.1.5	Oil Incineration	3.0-10
3.1.6	Meteorological Release Criteria for Batch Releases	3.0-10
3.2	<u>Dose Calculation for Gaseous Effluent</u>	3.0-12
3.2.1	Gaseous Effluent Dose Calculation Parameters	3.0-12
3.2.2	Unrestricted Area Boundary Dose	3.0-14
3.2.3	Unrestricted Area Dose to Individual	3.0-15
3.3	<u>Meteorological Model for Dose Calculations</u>	3.0-45
3.3.1	Meteorological Model Parameters	3.0-45
3.3.2	Meteorological Model	3.0-46
4.0	<u>RADIOLOGICAL ENVIRONMENTAL MONITORING</u>	4.0-1

LIST OF TABLES

<u>Table No.</u>		<u>Page No.</u>
1.1-1	Radioactive Liquid Effluent Monitoring Instrumentation ..	1.0-2
1.1-2	Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements	1.0-5
1.1-3	Frequency Notation	1.0-7
1.1-4	Radioactive Liquid Waste Sampling and Analysis Program ..	1.0-10
1.2-1	Radioactive Gaseous Effluent Monitoring Instrumentation	1.0-18
1.2-2	Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements	1.0-21
1.2-3	Radioactive Gaseous Waste Sampling and Analysis Program	1.0-25
1.4-1	Radiological Environmental Monitoring Program	1.0-35
1.4-2	Reporting Levels for Radioactivity Concentrations in Environ- mental Samples Reporting Levels	1.0-40
1.4-3	Maximum Values for the Lower Limits of Detection (LLD) ^{a,c} Reporting Levels	1.0-41
2.2-1	Bioaccumulation Factors	2.0-35
2.2-2	Adult Ingestion Dose Factors	2.0-36
2.2-3	Site Related Ingestion Dose Commitment Factor (A_{it})	2.0-38
3.1-1	Dose Factors for Exposure to a Semi-Infinite Cloud of Noble Gases	3.0-4
3.1-2	Favorable Meteorology	3.0-10A
3.2-1	Pathway Dose Factors for Section 3.2.2.2. (P_i)	3.0-18
3.2-2	Pathway Dose Factors for Section 3.2.3.2. (R_i)	3.0-21
3.2-3	Pathway Dose Factors for Section 3.2.3.3. (R_i) (Infant)	3.0-24
3.2-4	Pathway Dose Factors for Section 3.2.3.3. (R_i) (Child)	3.0-27
3.2-5	Pathway Dose Factors for Section 3.2.3.3. (R_i) (Teenager) ..	3.0-30
3.2-6	Pathway Dose Factors for Section 3.2.3.3. (R_i) (Adult)	3.0-33
3.2-7	Controlling Receptors, Locations, and Pathways	3.0-37
3.2-8	Atmospheric Dispersion Parameters for Controlling Receptor Locations	3.0-39
3.2-9	Parameters Used in Dose Factor Calculations	3.0-40
4.0-1	Radiological Environmental Monitoring Program	4.0-2

LIST OF FIGURES

<u>Figure No.</u>		<u>Page No.</u>
2.1-1	Example Liquid Monitor Calibration Curve	2.0-30
2.2-1	Liquid Radwaste Treatment System	2.0-40
3.1-1	Example Noble Gas Monitor Calibration Curve	3.0-11
3.2-1	Gaseous Radwaste Treatment System	3.0-44
3.3-1	Plume Depletion Effect for Ground Level Releases (δ)	3.0-49
3.3-2	Vertical Standard Deviation of Material in a Plume (σ_z)	3.0-50
3.3-3	Relative Deposition for Ground Level Releases (D_g)	3.0-51
3.3-4	Open Terrain Recirculation Factor	3.0-52
4.0-1	Radiological Environmental Sampling Locations (Local) ...	4.0-12
4.0-2	Radiological Environmental Sampling Locations (Remote) .	4.0-13

REFERENCES

1. Boegli, T.S., R.R. Bellamy, W.L. Britz, and R.L. Waterfield, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants" NUREG-0133 (October 1978).
2. "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR 50, Appendix I", U.S. NRC Regulatory Guide 1.109 (March 1976).
3. "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR 50, Appendix I", U.S. NRC Regulatory Guide 1.109, Rev. 1 (October 1977).
4. "Final Safety Analysis Report", South Carolina Electric and Gas Company, Virgil C. Summer Nuclear Station.
5. "Operating License Environmental Report", South Carolina Electric and Gas Company, Virgil C. Summer Nuclear Station.
6. Wahlig, B.G., "Estimation of the Radioactivity Release Rate/Equilibrium Concentration Relationship for the Parr Pumped Storage System", Applied Physical Technology, Inc., February 1981.
7. "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light - Water - Cooled Reactors", U.S. NRC Regulatory Guide 1.111 (March 1976).
8. "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light - Water - Cooled Reactors", U.S. NRC Regulatory Guide 1.111, Rev. 1 (July 1977).
9. Slade, D.H., (editor), "Meteorology and Atomic Energy"; U.S. Atomic Energy Commission, AEC TID-24190, 1968.
10. "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants", U.S. NRC Regulatory Guide 1.21, Rev. 1 (June 1974).
11. "Standard Radiological Effluent Technical Specifications for Pressurized Water Reactors", NUREG-0472, Revision 3 (January 1983).
12. "Quality Assurance for Radiological Monitoring Programs (Normal Operations) - Effluent Streams and the Environment", USNRC Regulatory Guide 4.15, Revision 1 (February 1979).
13. "Age-Specific Radiation Dose Commitment Factors for a One-Year Chronic Intake", NUREG-0172 (November 1977).

INTRODUCTION

CO2→

The OFFSITE DOSE CALCULATION MANUAL (ODCM) is an implementing and supporting document of the RADIOLOGICAL EFFLUENT TECHNICAL SPECIFICATIONS (RETS). In accordance with USNRC Generic Letter 89-01, entitled "Implementation of Programmatic Controls for Radiological Effluent Technical Specifications in the Administrative Controls Section of the Technical Specifications and the Relocation of Procedural Details of RETS to the Offsite Dose Calculation Manual or to the Process Control Program", the procedural details for implementing the Radiological Limiting Conditions for Operation have been incorporated into the ODCM. The ODCM describes the methodology and parameters to be used in the calculation of offsite doses due to radioactive liquid and gaseous effluents and in the calculation of liquid and gaseous effluent monitoring instrumentation alarm/trip setpoints. The ODCM contains a list and graphical description of the specific sample locations for the radiological environmental monitoring program. Configurations of the liquid and gaseous radwaste treatment systems are also included.

The ODCM will be maintained at the Station as the reference which details the Radiological Effluent Limiting Conditions for Operation of the V. C. Summer Nuclear Station. Additionally the ODCM will be maintained as the guide for accepted calculational methodologies. Changes in calculation methods or parameters will be incorporated into the ODCM in order to ensure that the ODCM represents the current methodology in all applicable areas. Computer software to perform described calculations will be maintained current with this ODCM.

RESPONSIBILITIES

The ODCM contains the radiological effluent limiting conditions for operation, their applicability, remedial actions, surveillance requirements, and their bases. Plant procedures implement responsibilities for compliance with the ODCM that include:

The Operations group is responsible for:

- Declaring radioactive liquid and gaseous effluent monitor channels operable or inoperable.
- Ensuring the minimum number of operable channels for radioactive liquid and gaseous effluent monitors.
- Notifying the responsible group to implement appropriate action, if less than the minimum number of radioactive liquid and gaseous effluent monitor channels are operable.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when less than the minimum number of channels operable condition prevails for more than 30 days.
- Restoring to within limits, the concentration of liquid radioactive material exceeding ODCM limits released from the site.
- Ensuring radioactive liquid and gaseous effluent monitor setpoints are set as prescribed in the effluent release permit.
- Suspending release if radioactive liquid and gaseous effluent monitor setpoints are less conservative than ODCM requirements.
- Declaring liquid and gaseous radwaste treatment systems operable or inoperable.
- Ensuring operability of gaseous and liquid radwaste treatment systems and ventilation exhaust treatment system.
- Ensuring appropriate portions of the gaseous and liquid radwaste treatment systems are used to reduce the radioactive materials in liquid and gaseous waste prior to their discharge when the projected doses exceed limits specified by the ODCM.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when liquid or gaseous radwaste system is inoperable for more than 31 days.
- Performing channel check and source check at the frequencies shown in Tables 1.1-2 and 1.2-2 for each radioactive liquid and gaseous effluent monitoring instrumentation channel.

Instrumentation and Controls group is responsible for:

- Performing channel calibration and analog channel operational test at the frequencies shown in Tables 1.1-2 and 1.2-2 for each radioactive liquid and gaseous effluent monitoring instrumentation channel.
- Informing the Operations group of surveillance test results.

The Health Physics group is responsible for:

- Establishing setpoints for radioactive liquid and gaseous effluent monitors, consistent with ODCM methodology, and providing setpoint information to Operations.
- Implementing remedial actions as requested by Operations. These actions include grab sampling and analysis and providing the results to Operations.
- Performing periodic radioactive effluent monitor checks to determine backgrounds, normal indications and verifying monitor correlation graphs, and providing this information as necessary to Operations.
- Implementing radioactive gaseous and liquid waste sampling and analysis program in accordance with ODCM Tables 1.1-4 and 1.2-3.
- Informing Operations when at least one Circulating Water Pump or the Circulating Water Jockey Pump is required to provide dilution to the discharge structure.
- Calculating cumulative dose contributions and performing dose projections from liquid and gaseous effluents in accordance with the ODCM and providing the information to Operations.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when calculated dose from the discharge of radioactive materials in liquid or gaseous effluents are in excess of the limits specified by ODCM sections 1.1.3.1 or 1.2.3.1.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when liquid or gaseous waste is discharged without treatment and is in excess of the limits specified by ODCM sections 1.1.4.1 or 1.2.3.1.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when the dose or dose commitment to any member of the public due to releases of radioactivity and radiation is in excess of 25 mrem to the total body or any organ (except the thyroid, which shall be limited to less than or equal to 75 mrem) over 12 consecutive months.

- Implementing the Radiological Environmental Monitoring Program as specified in Section 1.4 of the ODCM.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when the Radiological Environmental Monitoring Program limiting conditions for operation are exceeded.
- Preparation of the Semiannual Radioactive Effluent Release Report and the Annual Environmental Report.

1.0 SPECIFICATION OF CONTROLS

1.1 LIQUID EFFLUENTS

1.1.1 Radioactive Liquid Effluent Monitoring Instrumentation

LIMITING CONDITION FOR OPERATION

1.1.1.1 The radioactive liquid effluent monitoring instrumentation channels shown in Table 1.1-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of ODCM Specification 1.1.2.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with ODCM, Section 2.1.

APPLICABLE: At all times.

ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/ trip setpoint less conservative than required by the above specification, immediately suspend the release of radioactive liquid effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 1.1-1. Additionally if this condition prevails for more than 30 days, in the next Annual Radioactive Effluent Release Report explain why this condition was not corrected in a timely manner.
- c. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.1.1.2 Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and ANALOG CHANNEL OPERATIONAL TEST operations at the frequencies shown in Table 1.1-2.

TABLE 1.1-1

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

	<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
1.	GROSS RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE		
a.	Liquid Radwaste Effluent Line - RM-L5 or RM-L9	1	1
b.	Nuclear (Processed Steam Generator) Blowdown Effluent Line RM-L7 or RM-L9	1	1
c.	Steam Generator Blowdown Effluent Line		
1.	Unprocessed during Power Operation - RM-L10 or RM-L3	1	2
2.	Unprocessed during Startup - RM-L3	1	2
d.	Turbine Building Sump Effluent Line - RM-L8	1	3
e.	Condensate Demineralizer Backwash Effluent Line RM-L11	1	6
2.	FLOW RATE MEASUREMENT DEVICES*		
a.	Liquid Radwaste Effluent Line - Tanks 1 and 2	1/tank	4
b.	Penstock Minimum Flow Interlock**	1	4
c.	Nuclear Blowdown Effluent Line	1	4
d.	Steam Generator (Unprocessed) Blowdown Effluent Line	1	4
3.	TANK LEVEL INDICATING DEVICES		
a.	Condensate Storage Tank	1	5

* In the event that simultaneous releases from both WMT and NBMT are required (which normally will be prevented by procedure) the flow rate for monitor RM-L9 will be determined by adding flow rates for monitors RM-L5 and RM-L7.

** Minimum dilution flow is assured by an interlock that terminates liquid waste releases if the minimum dilution flow is not available.

TABLE 1.1-1 (Continued)

TABLE NOTATION

ACTION 1 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases may continue for up to 14 days provided that prior to initiating a release:

- a. At least two independent samples are analyzed in accordance with ODCM Specification 1.1.2.4 and
- b. At least two technically qualified members of the Facility Staff independently verify the release rate calculations and discharge line valving;

Otherwise, suspend release of radioactive effluents via this pathway.

ACTION 2 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided grab samples are analyzed for gross radioactivity (beta and gamma) at a limit of detection of at least 1E-7 microcuries/gram:

- a. At least once per 8 hours when the specific activity of the secondary coolant is greater than 0.01 microcuries/gram DOSE EQUIVALENT I-131.
- b. At least once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01 microcuries/gram DOSE EQUIVALENT I-131.

TABLE 1.1-1 (Continued)

TABLE NOTATION

- ACTION 3 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided that, at least once per 8 hours, grab samples are collected and analyzed for gross radioactivity (beta and gamma) at a limit of detection of at least $1E-7$ microcuries/gram.
- ACTION 4 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided the flow rate is estimated at least once per 4 hours during actual releases. Pump curves may be used to estimate flow.
- ACTION 5 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, liquid additions to this tank may continue for up to 30 days provided the tank liquid level is estimated during all liquid additions to the tank to prevent overflow.
- ACTION 6 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases may continue for up to 30 days provided that samples are analyzed in accordance with ODCM Specification 1.1.2.2 and Technical Specification 4.11.1.5.

TABLE 1.1-2
 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION
 SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>
1. GROSS RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE				
a. Liquid Radwaste Effluent Line - RM-L5 or RM-L9	D	P	R(2)	Q(1)
b. Nuclear Blowdown Effluent Line RM-L7	D	P	R(2)	Q(1)
c. Steam Generator Blowdown Effluent Line - RM-L3, RM-L10	D	M	R(2)	Q(1)
d. Turbine Building Sump Effluent Line - RM-L8	D	M	R(2)	Q(1)
e. Condensate Demineralizer Backwash Effluent Line RM-L11	D	M	R(2)	Q(4)
2. FLOW RATE MEASUREMENT DEVICES				
a. Liquid Radwaste Effluent Line	D(3)	N.A.	R	Q
b. Penstocks Minimum Flow Interlock	D(3)	N.A.	R	Q
c. Nuclear Blowdown Effluent Line	D(3)	N.A.	R	Q
d. Steam Generator Blowdown Effluent Line	D(3)	N.A.	R	Q
3. TANK LEVEL INDICATING DEVICES				
a. Condensate Storage Tank	D	N.A.	R	Q

See Table 1.1-3 for explanation of frequency notation.

TABLE 1.1-2 (Continued)

TABLE NOTATION

- (1) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occurs if any of the following conditions exists:
 1. Instrument indicates measured levels above the alarm/trip setpoint.
 2. Loss of Power (alarm only).
 3. Low flow (alarm only).
 4. Instrument indicates a downscale failure (alarm only).
 5. Normal/Bypass switch set in Bypass (alarm only).
 6. Other instrument controls not set in operate mode.

- (2) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.

- (3) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made.

- (4) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and local panel alarm annunciation occurs if any of the following conditions exists:
 1. Instrument indicates measured levels above the alarm/trip setpoint.
 2. Loss of Power (alarm only).
 3. Low flow (alarm only).
 4. Instrument indicates a downscale failure (alarm only).
 5. Normal/Bypass switch set in Bypass (alarm only).
 6. Other instrument controls not set in operate mode.

Table 1.1-3

FREQUENCY NOTATION

Notation	Frequency
D	At least once per 24 hours.
W	At least once per 7 days.
M	At least once per 31 days.
Q	At least once per 92 days.
SA	At least once per 184 days.
R	At least once per 18 months.
P	Completed prior to each release.
N.A.	Not applicable.

Note: Each surveillance requirement shall be performed within the specified surveillance interval with a maximum allowable extension of 25% of the specified surveillance interval.

1.1.2 Liquid Effluents: Concentration

LIMITING CONDITION FOR OPERATION

1.1.2.1 The concentration of radioactive material released from the site (see Technical Specification Figure 5.1-4) shall be limited to the concentrations specified in 10 CFR Part 20, Appendix B, Table II, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to 2E-4 microcuries/ml total activity.

APPLICABLE: At all Times.

ACTION:

With the concentration of radioactive material released from the site exceeding the above limits, immediately restore the concentration to within the above limits.

SURVEILLANCE REQUIREMENTS

1.1.2.2 The radioactivity content of each batch of radioactive liquid waste shall be determined prior to release by sampling and analysis in accordance with Table 1.1-4. The results or pre-release analyses shall be used with the calculational methods in ODCM Section 2.1 to assure that the concentration at the point of release is maintained within the limits of ODCM Specification 1.1.2.1.

1.1.2.3 Post-release analyses of samples composited from batch releases shall be performed in accordance with Table 1.1-4. The results of the previous post-release analyses shall be used with the calculational methods in ODCM Section 2.1 to assure that the concentrations at the point of release were maintained within the limits of ODCM Specification 1.1.2.1.

1.1.2.4 The radioactivity concentration of liquids discharged from continuous release points shall be determined by collection and analysis of samples in

accordance with Table 1.1-4. The results of the analyses shall be used with the calculational methods in ODCM Section 2.1 to assure that the concentrations at the point of release are maintained within the limits of ODCM Specification 1.1.2.1.

1.1.2.5 At least one Circulating Water Pump or the Circulating Water Jockey Pump shall be determined to be in operation and providing dilution to the discharge structure at least once per 4 hours whenever dilution is required to meet the site radioactive effluent concentration limits of ODCM Specification 1.1.2.1.

Table 1.1-4

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

	Liquid Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) ($\mu\text{Ci/ml}$) ^a
A.	Batch Waste Release ^d Tanks	P Each Batch	P Each Batch	Principal Gamma Emitters ^f	5×10^{-7}
				I-131	1×10^{-6}
1.	Waste Monitor Tanks	P Once Batch/M	M	Dissolved and Entrained Gases (Gamma Emitters)	1×10^{-5}
2.	Condensate Demineralizer Backwash Receiving Tank	P Each Batch	M Composite ^b	H-3	1×10^{-5}
				Gross Alpha	1×10^{-7}
3.	Nuclear Blowdown Monitor Tank	P Each Batch	Q Composite ^b	Sr-89, Sr-90	5×10^{-8}
				Fe-55	1×10^{-6}
B.	Continuous Release ^e	D Grab Sample	W Composite ^c	Principal Gamma Emitters ^f	5×10^{-7}
				I-131	1×10^{-6}
1.	Steam Generator Blowdown	M Grab Sample	M	Dissolved and Entrained Gases (Gamma Emitters)	1×10^{-5}
2.	Turbine Building Sump	D Grab Sample	M Composite ^c	H-3	1×10^{-5}
				Gross Alpha	1×10^{-7}
3.	Service Water	D Grab Sample	Q Composite ^c	Sr-89, Sr-90	5×10^{-8}
				Fe-55	1×10^{-6}

See Table 1.1-3 for explanation of frequency notation.

TABLE 1.1-4 (Continued)

TABLE NOTATION

- a. The Lower Limit of Detection (LLD) is the smallest concentration of radioactive material in a sample that will yield a net count above background that will be detected with a 95% probability. LLD also yields a 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{(E)(V)(2.22)(Y)(\exp)(-\lambda \Delta t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above (as pCi per unit mass or volume). Current literature defines the LLD as the detection capability for the instrumentation only and the MDC, the minimum detectable concentration, as the detection capability for a given instrument procedure and type of sample.

4.66 is a factor which corrects for the smallest activity that has a probability, p, of being detected, and a probability, 1-p, of falsely concluding its presence.

$$4.66 = 2k \sqrt{1 + (t_b/t_s)}$$

k = a constant whose value depends on the chosen confidence level (NRC recommends a confidence level of 95%)

= 1.6545 at 95% confidence level

t_b = background time

t_s = sample time

s_b is the standard deviation of the background counting rate or the counting rate of blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

TABLE 1.1-4 (Continued)

TABLE NOTATION

V is the sample size (in units of mass or volume),

2.22 is the number of transformations per minute per picocurie,

Y is the fractional radiochemical yield (when applicable),

λ is the radioactive decay constant for the particular radionuclide,

and

Δt is the elapsed time between midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of s_b used in the calculation of the LLD for a detection system shall be used on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry the background should include the typical contributions of other radionuclides normally present in the samples. Typical values of E, V, Y, and Δt shall be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as a a posteriori (after the fact) limit for particular measurement.*

*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem. 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotopic Counting Techniques," Atlantic Richfield Handford Company Report ARH-2537 (June 22, 1972).

TABLE 1.1-4 (Continued)

TABLE NOTATION

- b. A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen which is representative of the liquids released.
- c. To be representative of the quantities and concentrations of radioactive materials in liquid effluents, samples shall be composited in proportion to the rate of flow of the effluent stream. Prior to analyses, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluent release.
- d. A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed, by a method described in ODCM Section 2.0, to assure representative sampling.
- e. A continuous release is the discharge of liquid wastes of a nondiscrete volume; e.g., from a volume of system that has an input flow during the continuous release.
- f. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141, and Ce-144. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported.

1.1.3 Liquid Effluents: Dose

LIMITING CONDITION FOR OPERATION

1.1.3.1 The dose or dose commitment to an individual from radioactive materials in liquid effluents released from the site (see Technical Specification Figure 5.1-4) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABLE: At all Times.

ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause (s) for exceeding the limit (s) and defines the corrective actions to be taken to the releases and the proposed actions to be taken to assure that subsequent releases will be in compliance with ODCM Specification 1.1.3.1.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.1.3.2 Dose Calculations. Cumulative dose contributions from liquid effluents shall be determined in accordance with ODCM Section 2.2 at least once per 31 days.

1.1.4 Liquid Waste Treatment

LIMITING CONDITION FOR OPERATION

1.1.4.1 The liquid radwaste treatment system shall be OPERABLE. The appropriate portions of the system shall be used to reduce the radioactive materials in liquid wastes prior to their discharge when the projected doses due to the liquid effluent from the site (See Technical Specification Figure 5.1-4) when averaged over 31 days, would exceed 0.06 mrem to the total body or 0.2 mrem to any organ.

APPLICABLE: At all Times.

ACTION:

- a. With the liquid radwaste treatment system inoperable for more than 31 days or with radioactive liquid waste being discharged without treatment and in excess of the above limits, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which includes the following information:
 1. Identification of the inoperable equipment or subsystems and the reason for inoperability,
 2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
 3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.1.4.2 Doses due to liquid releases shall be projected at least once per 31 days, in accordance with ODCM Section 2.2.

1.1.4.3 The liquid radwaste treatment system shall be demonstrated OPERABLE by operating the liquid radwaste treatment system equipment for at least 30 minutes at least once per 92 days unless the liquid radwaste system has been utilized to process radioactive liquid effluents during the previous 92 days.

1.2 GASEOUS EFFLUENTS

1.2.1 Radioactive Gaseous Effluent Monitoring Instrumentation

LIMITING CONDITION FOR OPERATION

1.2.1.1 The radioactive gaseous effluent monitoring instrumentation channels shown in Table 1.2-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of ODCM Specification 1.2.2.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with ODCM Section 3.1.

APPLICABLE: As shown in Table 1.2-1

ACTION:

- a. With a radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above ODCM Specification, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 1.2-1. Additionally if this condition prevails for more than 30 days, in the next Annual Radioactive Effluent Release Report, explain why this condition was not corrected in a timely manner.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.2.1.2 Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and ANALOG CHANNEL OPERATIONAL TEST operations at the frequencies shown in Table 1.2-2.

TABLE 1.2-1

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION		MINIMUM CHANNELS OPERABLE	APPLICA- BILITY	ACTION
	<u>INSTRUMENT</u>			
1.	WASTE GAS HOLDUP SYSTEM			
a.	Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release (RM-A10 or RM-A3)	1	*	7
2.	MAIN PLANT VENT EXHAUST SYSTEM			
a.	Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release from Waste Gas Holdup System (RM- A3)	1	*	9
b.	Iodine Sampler	1	*	11
c.	Particulate Sample	1	*	11
d.	Flow Rate Measuring Device	1	*	8
e.	Sampler Flow Rate Measuring Device	1	*	8
3.	REACTOR BUILDING PURGE SYSTEM			
a.	Noble Gas Activity Monitor Providing Alarm and Automatic Termination of Release (RM-A4)	1	*	10
b.	Iodine Sampler	1	*	11
c.	Particulate Sample	1	*	11
d.	Flow Rate Measuring Device	1	*	8
e.	Sampler Flow Rate Measuring Device	1	*	8

TABLE 1.2-1 (Continued)

TABLE NOTATION

* At all times during releases via this pathway.

ACTION 7 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment for up to 14 days provided that prior to initiating the release:

- a. At least two independent samples of the tank's contents are analyzed, and
- b. At least two technically qualified members of the Facility Staff independently verify the release rate calculations and discharge valve lineup;

Otherwise, suspend release of radioactive effluents via this pathway.

ACTION 8 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided the flow rate is estimated at least once per 4 hours.

ACTION 9 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided grab samples are taken at least once per 8 hours and these samples are analyzed for gross activity within 24 hours.

TABLE 1.2-1 (Continued)

TABLE NOTATION

- ACTION 10 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend PURGING of radioactive effluents via this pathway.
- ACTION 11 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the affected pathway may continue for up to 30 days provided samples are continuously collected with auxiliary sampling equipment as required in Table 1.2-3.

TABLE 1.2-2

RADIOACTIVE GASEOUS EFFLUENT
MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

	INSTRUMENT	CHANNEL CHECK	SOURCE CHECK	CHANNEL CALIBRATION	ANALOG CHANNEL OPERATIONAL TEST	MODES IN WHICH SURVEILLANCE REQUIRED
1.	WASTE GAS HOLDUP SYSTEM					
a.	Noble Gas Activity Monitor - RM-A10 or RM-A3	P	P	R(3)	Q(1)	*
2.	MAIN PLANT VENT EXHAUST SYSTEM					
a.	Noble Gas Activity Monitor - RM-A3	D	M	R(3)	Q(2)	*
b.	Iodine Sampler	W	N.A.	N.A.	N.A.	*
c.	Particulate Sampler	W	N.A.	N.A.	N.A.	*
d.	Flow Rate Measuring Device	D	N.A.	R	Q	*
e.	Sampler Flow Rate Monitor	D	N.A.	R	Q	*
3.	REACTOR BUILDING PURGE SYSTEM					
a.	Noble Gas Activity Monitor - RM-A4	D	P,M	R(3)	Q(1)	*
b.	Iodine Sampler	W	N.A.	N.A.	N.A.	*
c.	Particulate Sampler	W	N.A.	N.A.	N.A.	*
d.	Flow Rate Measuring Device	D	N.A.	R	Q	*
e.	Sampler Flow Rate Monitor	D	N.A.	R	Q	*

See Table 1.1-3 for explanation of frequency notation.

TABLE 1.2-2 (Continued)

TABLE NOTATION

* At all times.

- (1) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occurs if any of the following conditions exists:
 1. Instrument indicates measured levels above the alarm/trip setpoint.
 2. Loss of Power (alarm only).
 3. Low flow (alarm only).
 4. Instrument indicates a downscale failure (alarm only).
 5. Normal/Bypass switch set in Bypass (alarm only).
 6. Other instrument controls not set in operate mode.

- (2) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
 1. Instrument indicates measured levels above the alarm setpoint.
 2. Loss of Power.
 3. Low flow.
 4. Instrument indicates a downscale failure.
 5. Instrument controls not set in operate mode.

- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.

1.2.2 Gaseous Effluents: Dose Rate

LIMITING CONDITIONS FOR OPERATION

1.2.2.1 The dose rate in unrestricted areas due to radioactive materials released in gaseous effluents from the site including effluents from oil incineration (see Technical Specification Figure 5.1-3) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin.
- b. For all radioiodines and for all radioactive materials in particulate form and tritium with half lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.
- c. Less than 0.1% of the limits in 1.2.2.1 (a) and (b) as a result of oil incineration.

APPLICABLE: At all times.

ACTION:

With the dose rate(s) exceeding the above limits, immediately decrease the release rate to within the above limit(s).

SURVEILLANCE REQUIREMENTS

1.2.2.2 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methods and procedures of the ODCM.

1.2.2.3 The dose rate due to radioiodines, tritium and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methods and procedures of ODCM Section 3.2.2 by obtaining representative samples and performing analysis in accordance with the sampling and analysis program specified in Table 1.2.2.3.

TABLE 1.2-3
RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

Gaseous Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) ($\mu\text{Ci/ml}$) ^a
A Waste Gas Storage Tank	P Each Tank Grab Sample	P Each Tank	Principal Gamma Emitters ^g	1X10 ⁻⁴
B1 Reactor Building -36" Purge Line	P Each Purge ^{b,c}	P Each Purge ^b	Principal Gamma Emitters ^g	1X10 ⁻⁴
-6" Purge Line			H-3	1X10 ⁻⁶
B2 Reactor Building -6" Purge Line (if continuous)	M ^b Grab Sample	M ^b	Principal Gamma Emitters ^g	1X10 ⁻⁴
			H-3	1X10 ⁻⁶
C Main Plant Vent	M ^{b,e} Grab Sample	M ^b	Principal Gamma Emitters ^g	1X10 ⁻⁴
			H-3	1X10 ⁻⁶
D1. Reactor Building Purge	Continuous Sampler ^f	W ^d Charcoal Sample	I-131 I-133	1X10 ⁻¹² 1X10 ⁻¹⁰
2. Main Plant Vent	Continuous Sampler ^f	W ^d Particulate Sample	Principal Gamma Emitters ^g I-131, others	1X10 ⁻¹¹
	Continuous Sampler ^f	M Composite Particulate Sample	Gross Alpha	1X10 ⁻¹¹
	Continuous Sampler ^f	Q Composite Particulate Sample	Sr-89, Sr-90	1X10 ⁻¹¹
	Continuous Monitor	Noble Gas Monitor	Noble Gases Gross Beta	2X10 ⁻⁶
E Oil Incinerator	P Each Batch ^h Grab Sample	P Each Batch	Principal Gamma Emitters ^g Noble Gases I-131 H-3 Sr-89, Sr-90 Fe-55	5 X 10 ⁻⁷ ⁱ 1E-5 ⁱ 1E-6 ⁱ 3E-5 ⁱ 3E-7 ⁱ 1E-6 ⁱ

See Table 1.1-3 for explanation of frequency notation.

TABLE 1.2-3 (Continued)

TABLE NOTATION

- a. See Table 1.1-4 notation (a) for definition of LLD.
- b. Analyses shall be also be performed within 24 hours² following shutdown, startup, or a THERMAL POWER change exceeding 15 percent of the RATED THERMAL POWER within a one hour period.
- c. Tritium grab samples shall be taken at least once per 24 hours when the refueling canal is flooded.
- d. Samples shall be changed at least once per 7 days and analyses shall be completed within 48 hours after changing (or after removal from sampler). Sampling shall also be performed at least once per 24 hours for a least 7 days following each shutdown, startup or THERMAL POWER change exceeding 15 percent of RATED THERMAL POWER in one hour and analyses shall be completed within 48 hours of changing. When samples collected for 24 hours are analyzed, the corresponding LLD's may be increased by a factor of 10.
- e. Tritium grab samples shall be taken at least once per 7 days from the ventilation exhaust from the spent fuel pool area, whenever spent fuel is in the spent fuel pool.
- f. The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with ODCM Specifications 1.2.2.1, 1.2.3.1 and 1.2.4.1.
- g. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emissions and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141 and Ce-144 for particulate emissions. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported.
- h. Prior to sampling for analysis, each batch of oil shall be isolated and representative samples obtained by methods described in ASTM D 4057-81, Volume 05.03, "Standard Practice for Manual Sampling of Petroleum and Petroleum Products".
- i. This LLD refer to the liquid sample.

1.2.3 Gaseous Effluents: Dose - Noble Gas

LIMITING CONDITION FOR OPERATION

1.2.3.1 The air dose due to noble gases released in gaseous effluents from the site (see Technical Specification Figure 5.1-3) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation and,
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABLE: At all Times.

ACTION:

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, in lieu of any other report required by ODCM section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with ODCM Specification 1.2.3.1.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.2.3.2 Dose Calculations Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with ODCM Section 3.2.3 at least once per 31 days.

1.2.4 Gaseous Effluents: Dose - Radioiodines, Tritium, and Radioactive Materials in Particulate Form.

LIMITING CONDITIONS FOR OPERATION

1.2.4.1 The dose to an individual from radioiodines, tritium, and radioactive materials in particulate form, and radionuclides (other than noble gases) with half-lives greater than 8 days in gaseous effluents including effluents from oil incineration (see Technical Specification Figure 5.1-3) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ.
- b. During any calendar year: Less than or equal to 15 mrem to any organ.
- c. Less than 0.1% of the limits in 1.2.4.1 (a) and (b) as a result of oil incineration.

APPLICABLE: At all times.

ACTION:

- a. With the calculated dose from the release of tritium, radioiodines, and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents exceeding any of the above limits, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause(s) for exceeding the limit and defines the corrective actions to be taken to releases and the proposed actions to be taken to assure that subsequent release will be in compliance with ODCM Specification 1.2.4.1.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.2.4.2 Dose Calculations Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with ODCM Section 3.2.3 at least once per 31 days.

1.2.5 Gaseous Effluents: Gaseous Radwaste Treatment

CONTROLS

1.2.5.1 The GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM shall be OPERABLE. The appropriate portions of the GASEOUS RADWASTE TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected gaseous effluent air doses due to gaseous effluent releases from the site (See Technical Specification Figure 5.1-3), when averaged over 31 days, would exceed 0.2 mrad for gamma radiation and 0.4 mrad for beta radiation. The appropriate portions of the VENTILATION EXHAUST TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected doses due to gaseous effluent releases from the site when averaged over 31 days would exceed 0.3 mrem to any organ.

APPLICABLE: At all times*.

ACTION:

- a. With the GASEOUS RADWASTE TREATMENT SYSTEM and/or the VENTILATION EXHAUST TREATMENT SYSTEM inoperable for more than 31 days or with gaseous waste being discharged without treatment and in excess of the above limits, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which includes the following information:
1. Identification of the inoperable equipment or subsystems and the reason for inoperability.
 2. Action(s) taken to restore the inoperable equipment to OPERABLE status.

*The Waste Gas System may be secured during refueling and defueled operations since there is no gas in the system to be removed and processed. The system is considered "inoperable" during these conditions due to the instrumentation being out of calibration when flow is stopped through the recombiner. This "inoperable" state is the normal system condition during refueling and defueled modes.

3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.2.5.2 Doses due to gaseous releases from the reactor shall be projected at least once per 31 days, in accordance with ODCM Section 3.2.2 for air doses and ODCM Section 3.2.3 for organ doses.

1.2.5.3 The GASEOUS RADWASTE TREATMENT SYSTEM and VENTILATION EXHAUST TREATMENT SYSTEM shall be demonstrated OPERABLE by operating the GASEOUS RADWASTE TREATMENT SYSTEM equipment and VENTILATION EXHAUST TREATMENT SYSTEM equipment for at least 30 minutes, at least once per 92 days unless the appropriate system has been utilized to process radioactive gaseous effluents during the previous 92 days.

1.3 RADIOACTIVE EFFLUENTS: TOTAL DOSE

LIMITING CONDITION FOR OPERATION

1.3.1 The dose or dose commitment to any member of the public, due to releases of radioactivity and radiation, from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the total body or any organ (except the thyroid, which shall be limited to less than or equal to 75 mrem) over 12 consecutive months.

APPLICABLE: At all Times.

ACTION:

- a. With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of ODCM Specification 1.1.3.1.a, 1.1.3.1.b, 1.2.3.1.a, 1.2.3.1.b, 1.2.4.1.a, or 1.2.4.1.b, in lieu of any other report required and ODCM Section 1.6, prepare and submit to the Commission, within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the limits of ODCM Specification 1.3.1. This Special Report shall include an analysis which estimates the radiation exposure (dose) to a member of the public from uranium fuel cycle sources (including all effluent pathways and direct radiation) for a 12 consecutive month period that includes the release(s) covered by this report. If the estimated dose(s) exceeds the limits of ODCM Specification 1.3.1, and if the release condition resulting in violation of 40 CFR 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190 and including information of § 190.11 (b). Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete. The variance only relates to the limits of 40 CFR 190, and does not apply in any way to the requirements for dose

limitation of 10 CFR Part 20, as addressed in ODCM Specifications 1.1.2 and 1.2.2.

- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.3.2 Dose Calculations Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with ODCM Specifications 1.1.3.2, 1.2.3.2 and 1.2.4.2.

1.4 RADIOLOGICAL ENVIRONMENTAL MONITORING

1.4.1 Monitoring Program

LIMITING CONDITION FOR OPERATION

- 1.4.1.1 The radiological environmental monitoring program shall be conducted as specified in Table 1.4-1.

APPLICABILITY: At all times.

ACTION:

- a. With the radiological environmental monitoring program not being conducted as specified in Table 1.4-1 in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission, in the Annual Radiological Operating Report, a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.
- b. With the level of radioactivity in an environmental sampling medium exceeding the reporting levels of Table 1.4-2 when averaged over any calendar quarter, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days from the end of the affected calendar quarter a Special Report. When more than one of the radionuclides in Table 1.4-2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{limit level (1)}} + \frac{\text{concentration (2)}}{\text{limit level (2)}} + \dots \geq 1.0$$

When radionuclides other than those in Table 1.4-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose to an individual is equal to or greater than the calendar year limits of ODCM Specifications 1.1.3.1, 1.2.3.1

and 1.2.4.1. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report.

- c. With milk or fresh leafy vegetable samples unavailable from one or more of the sample locations required by Table 1.4-1, in lieu of any other report required by ODCM Section 1.6 prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause of the unavailability of samples and identifies locations for obtaining replacement samples. The locations from which samples were unavailable may then be deleted from those required by Table 1.4-1, provided the locations from which the replacement samples were obtained are added to the environmental monitoring program as replacement locations.
- d. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.4.1.2 The radiological environmental monitoring samples shall be collected pursuant to Table 1.4-1 and shall be analyzed pursuant to the requirements of Tables 1.4-1 and 1.4-3.

Table 1.4-1 Radiological Environmental Monitoring Program
Virgil C. Summer Nuclear Station

Exposure Pathway and/or Sample	Minimum Number of Sample Locations and Criteria for Selection	Sampling and Collection Frequency	Type & Frequency of Analysis
AIRBORNE: I. Particulates	A) 3 Indicator samples to be taken at locations (in different sectors) beyond but as close to the exclusion boundary as practicable where the highest offsite sectorial ground level concentrations are anticipated. (1) B) 1 Indicator sample to be taken in the sector beyond but as close to the exclusion boundary as practicable corresponding to the residence having the highest anticipated offsite ground level concentration or dose. (1) C) 1 Indicator sample to be taken at the location of one of the dairies most likely to be affected. (1) (2) D) 1 Control sample to be taken at a location at least 10 air miles from the site and not in the most prevalent wind directions. (1)	Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection.	Gross beta following filter change; quarterly composite (by location) for gamma isotopic. Gross beta following filter change; quarterly composite (by location) for gamma isotopic. Gross beta following filter change; quarterly composite (by location) for gamma isotopic. Gross beta following filter change; quarterly composite (by location) for gamma isotopic.
II. Radioiodine	A) 3 Indicator samples to be taken at two locations as given in I.A. above. B) 1 Indicator sample to be taken at the location as given in I.B. above. C) 1 Indicator sample to be taken at the location as given in I.C. above. D) 1 Control sample to be taken at a location as given in I.D. above.	Continuous sampler operation with weekly canister collection. Continuous sampler operation with weekly canister collection. Continuous sampler operation with weekly canister collection. Continuous sampler operation with weekly canister collection.	Gamma Isotopic for I-131 weekly. Gamma Isotopic for I-131 weekly. Gamma Isotopic for I-131 weekly. Gamma Isotopic for I-131 weekly.
III. Direct	A) 13 Indicator stations with two or more dosimeters to form an inner ring of stations in the 13 accessible sectors within 1 to 2 miles of the plant. B) 16 Indicator stations with two or more dosimeters to form an outer ring of stations in the 16 accessible sectors within 3 to 5 miles of the plant. C) 8 Stations with two or more dosimeters to be placed in special interest areas such as population centers, nearby residences, schools and in 2 or 3 areas to serve as control stations.	Monthly or quarterly.(3,5) Monthly or quarterly.(3,5) Monthly or quarterly.(3,5)	Gamma dose monthly or quarterly. Gamma dose monthly or quarterly. Gamma dose monthly or quarterly.

Table 1.4-1 Radiological Environmental Monitoring Program
Virgil C. Summer Nuclear Station

Exposure Pathway and/or Sample	Minimum Number of Sample Locations and Criteria for Selection	Sampling and Collection Frequency	Type & Frequency of Analysis
<p>WATERBORNE: IV. Surface Water</p>	<p>A) 1 indicator sample downstream to be taken at a location which allows for mixing and dilution in the ultimate receiving river.</p> <p>B) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.</p> <p>C) 1 Indicator sample from a location immediately upstream of the nearest downstream municipal water supply.</p> <p>D) 1 Indicator sample to be taken in the upper reservoir of the pumped storage facility in the plant discharge canal.</p> <p>E) 1 Indicator sample to be taken in the upper reservoir's non-fluctuating recreational area.</p> <p>F) 1 Control sample to be taken at a location on a separate unaffected watershed reservoir.</p> <p>G) 1 indicator sample to be taken in the upper reservoir at the intake of the pumped storage facility.</p>	<p>Time composite samples with collection every month (corresponds to USGS continuous sampling site). (3)</p> <p>Time composite samples with collection every month (corresponds to USGS continuous sampling site). (3)</p> <p>Time composite samples with collection every month (corresponds to USGS continuous sampling site). (3)</p> <p>Time composite samples with collection every month (corresponds to USGS continuous sampling site). (3)</p> <p>Grab sampling monthly.(3)</p> <p>Grab sampling monthly.(3)</p> <p>Time composite samples with collection every month (corresponds to USGS continuous sampling site). (3)</p>	<p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium.(5)</p> <p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium.(5)</p> <p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium.(5)</p> <p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium.(5)</p> <p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium.(5)</p> <p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium.(5)</p> <p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium.(5)</p>
<p>V. Ground Water</p>	<p>A) 2 Indicator samples to be taken within the exclusion boundary and in the direction of potentially affected ground water supplies.</p> <p>B) 1 Control sample from unaffected location.</p>	<p>Quarterly grab sampling. (5)</p> <p>Quarterly grab sampling. (5)</p>	<p>Gamma isotopic and tritium analyses quarterly.(5)</p> <p>Gamma isotopic and tritium analyses quarterly.(5)</p>

Table 1.4-1 Radiological Environmental Monitoring Program
Virgil C. Summer Nuclear Station

Exposure Pathway and/or Sample	Minimum Number of Sample Locations and Criteria for Selection	Sampling and Collection Frequency	Type & Frequency of Analysis
VI. Drinking Water	<p>A) 1 Indicator sample from a nearby public ground water supply source.</p> <p>B) 1 Indicator (finished water) sample from the nearest downstream water supply.</p> <p>C) 1 Control (finished water) sample from the nearest unaffected public water supply.</p>	<p>Monthly grab sampling. (3)</p> <p>Monthly composite sampling.</p> <p>Monthly composite sampling.</p>	<p>Monthly (3) gamma isotopic and gross beta analyses and quarterly (5) composite for tritium analyses.</p> <p>Monthly (3) gamma isotopic and gross beta analyses and quarterly (5) composite for tritium analyses.</p> <p>Monthly (3) gamma isotopic and gross beta analyses and quarterly (5) composite for tritium analyses.</p>
<p>INGESTION:</p> <p>VII. Milk(2)</p>	<p>A) Samples from milking animals in 3 locations within 5 km distance having the highest dose potential. If there are none then 1 sample from milking animals in each of 3 areas between 5 to 8 km distance where doses are calculated to be greater than 1 mrem per year.</p> <p>B) 1 Control sample to be taken at the location of a dairy greater than 20 miles distance and not in the most prevalent wind direction.(1)</p> <p>C) 1 Indicator grass (forage) sample to be taken at one of the locations beyond but as close to the exclusion boundary as practicable where the highest offsite sectorial ground level concentrations are anticipated.(1)</p> <p>D) 1 Indicator grass (forage) sample to be taken at the location of VII(A) above when animals are on pasture.</p> <p>E) 1 Control grass (forage) sample to be taken at the location of VII(B) above.</p>	<p>Semi-monthly when animals are on pasture, (6) monthly other times.(3)</p> <p>Semi-monthly when animals are on pasture, (6) monthly other times.(3)</p> <p>Monthly when available (3)</p> <p>Monthly when available (3)</p> <p>Monthly when available (3)</p>	<p>Gamma isotopic and I-131 analysis semi-monthly (6) when animals are on pasture; monthly (3) at other times.</p> <p>Gamma isotopic and I-131 analysis semi-monthly (6) when animals are on pasture; monthly (3) at other times.</p> <p>Gamma isotopic.</p> <p>Gamma isotopic.</p> <p>Gamma isotopic.</p>
VIII. Food Products	<p>A) 2 samples of broadleaf vegetation grown in the 2 nearest offsite location of highest calculated annual average ground level D/Q if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5-10 km where the doses are calculated to be greater than 1 mrem/yr.</p> <p>B) 1 Control sample for the same foods taken at a location at least 10 miles distance and not in the most prevalent wind direction if milk sampling is not performed within 3 km or if milk sampling is not at a location within 5 to 8 km where doses are calculated to be greater than 1 mrem/yr.</p>	<p>Monthly when available. (3)</p> <p>Monthly when available. (3)</p>	<p>Gamma isotopic on edible portion.</p> <p>Gamma isotopic on edible portion.</p>

Table 1.4-1 Radiological Environmental Monitoring Program
Virgil C. Summer Nuclear Station

Exposure Pathway and/or Sample	Minimum Number of Sample Locations and Criteria for Selection	Sampling and Collection Frequency	Type & Frequency of Analysis
IX. Fish	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual (7) collection of the following species types if available: bass; bream, crappie; catfish, carp; forage fish (shad).	Gamma isotopic on edible portions semiannually.
	B) 1 Indicator sample to be taken at a location in the lower reservoir.	Semiannual (7) collection of the following species types if available: bass; bream, crappie; catfish, carp; forage fish (shad).	Gamma isotopic on edible portions semiannually.
	C) 1 Indicator sample to be taken at a location in the upper reservoir's non-fluctuating recreational area.	Semiannual (7) collection of the following species types if available: bass; bream, crappie; catfish, carp; forage fish (shad).	Gamma isotopic on edible portions semiannually.
IX. Fish (continued)	D) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual(7) collection of the following species types if available: bass; bream, crappie; catfish, carp; forage fish (shad).	Gamma isotopic on edible portions semiannually.
AQUATIC: X. Sediment	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual grab sample. (7)	Gamma isotopic.
	B) 1 Indicator sample to be taken at a location in the upper reservoir's non-fluctuating recreational area.	Semiannual grab sample. (7)	Gamma isotopic.
	C) 1 Indicator sample to be taken on the shoreline of the lower reservoir.	Semiannual grab sample. (7)	Gamma isotopic.
	D) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual grab sample. (7)	Gamma isotopic.

NOTES

1. Sample site locations are based on the meteorological analysis for the period of record as presented in Chapters 5 and 6 of the OLER.
2. Milking animal and garden survey results will be analyzed annually. Should the survey indicate new dairying activity, the owners shall be contacted with regard to a contract for supplying sufficient samples. If contractual arrangements can be made, site(s) will be added for additional milk sampling up to a total of 3 Indicator locations.
3. Not to exceed 35 days.
4. Time composite samples are samples which are collected with equipment capable of collecting an aliquot at time intervals which are short (e.g., hourly) relative to the compositing period.
5. At least once per 100 days.
6. At least once per 18 days.
7. At least once per 200 days.

NOTE: Deviations from this sampling schedule may occasionally be necessary if sample media are unobtainable due to hazardous conditions, seasonal unavailability, insufficient sample size, malfunctions of automatic sampling or analysis equipment and other legitimate reasons. If specimens are unobtainable due to sampling equipment malfunction, every effort shall be made to complete corrective action prior to the end of the next sampling period. Deviations from sampling-analysis schedules will be described in the annual report.

TABLE 1.4-2

Reporting Levels for Radioactivity Concentrations in Environmental Samples
Reporting Levels

Analysis	Water (pCi/l)	Airborne Particulate or Gases(pCi/m ³)	Fish (pCi/kg, wet)	Milk (pCi/l)	Food Products (pCi/Kg, wet)
H-3	20,000(a)	N.A.	N.A.	N.A.	N.A.
Mn-54	1,000	N.A.	30,000	N.A.	N.A.
Fe-59	400	N.A.	10,000	N.A.	N.A.
Co-58	1,000	N.A.	30,000	N.A.	N.A.
Co-60	300	N.A.	10,000	N.A.	N.A.
Zn-65	300	N.A.	10,000	N.A.	N.A.
Zr-95	400	N.A.	20,000	N.A.	N.A.
Nb-95	400	N.A.	20,000	N.A.	N.A.
I-131	2	0.9	N.A.	3	100
Cs-134	30	10	1,000	60	1,000
Cs-137	50	20	2,000	70	2,000
Ba-140	200	N.A.	N.A.	300	N.A.
La-140	200	N.A.	N.A.	300	N.A.

(a) For drinking water samples. This is the 40 CFR Part 141 value.

TABLE 1.4-3

Maximum Values for the Lower Limits of Detection (LLD)^{a,c}
Reporting Levels

Analysis	Water (pCi/l)	Airborne Particulate or Gases(pCi/m ³)	Fish (pCi/kg, wet)	Milk (pCi/l)	Food Products (pCi/Kg, wet)	Sediment (pCi/Kg, dry)
Gross Beta	4	1 X 10 ⁻²	N.A.	N.A.	N.A.	N.A.
H-3	2000(b)	N.A.	N.A.	N.A.	N.A.	N.A.
Mn-54	15	N.A.	130	N.A.	N.A.	N.A.
Fe-59	30	N.A.	260	N.A.	N.A.	N.A.
Co-58	15	N.A.	130	N.A.	N.A.	N.A.
Co-60	15	N.A.	130	N.A.	N.A.	N.A.
Zn-65	30	N.A.	260	N.A.	N.A.	N.A.
Zr-95	30	N.A.	N.A.	N.A.	N.A.	N.A.
Nb-95	15	N.A.	N.A.	N.A.	N.A.	N.A.
I-131	1b	7 X 10 ⁻²	N.A.	1	60	N.A.
Cs-134	15	5 X 10 ⁻²	130	15	60	150
Cs-137	18	6 X 10 ⁻²	150	18	80	180
Ba-140	60	N.A.	N.A.	60	N.A.	N.A.
La-140	15	N.A.	N.A.	15	N.A.	N.A.

TABLE 1.4-3 (Continued)

TABLE NOTATION

- a. Table 1.4-3 lists detection capabilities for radioactive materials in environmental samples. These detection capabilities are tabulated in terms of the lower limits of detection (LLDs). See Table 1.1-4 notation (a) for definition of LLD.
- b. LLD for drinking water samples.
- c. Other peaks potentially due to reactor operations (fission and activation products) which are measurable and identifiable, together with the radio-nuclides in Table 1.4-3, shall be identified and reported.

1.4.2 Land Use Census

LIMITING CONDITION FOR OPERATION

1.4.2.1 A land use census shall be conducted and shall identify the location of the nearest milk animal, the nearest residence and the nearest garden* of greater than 500 square feet producing fresh leafy vegetables in each of the 16 meteorological sectors within a distance of five miles.

APPLICABILITY: At all times.

ACTION:

- a. With a land use census identifying a location(s) which yields a calculated dose or dose commitment greater than the values currently being calculated in ODCM Specification 1.2.4.2, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the new location(s).
- b. With a land use census identifying a location(s) which yields a calculated dose or dose commitment (via the same exposure pathway) 20 percent greater than at a location from which samples are currently being obtained in accordance with ODCM Specification 1.4.1.1, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the new location. The new location shall be added to the radiological environmental monitoring program within 30 days. The sampling location, excluding the control station location, having the lowest calculated dose or dose commitment (via the same exposure pathway) may be deleted from this monitoring program after October 31 of the year in which this land use census was conducted.

*Broad leaf vegetation sampling may be performed at the site boundary in the direction sector with the highest D/Q in lieu of the garden census.

- c. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.4.2.2 The land use census shall be conducted at least once per 12 months between the dates of June 1 and October 1 using that information which will provide the best results, such as by a door-to-door survey, aerial survey, or by consulting local agriculture authorities.

1.4.3 Interlaboratory Comparison Program

LIMITING CONDITION FOR OPERATION

1.4.3.1 Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program which has been approved by the Commission.

APPLICABILITY: At all times.

ACTION:

- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.4.3.2 A summary of the results obtained as part of the above required Interlaboratory Comparison Program shall be included in the Annual Radiological Environmental Operating Report (participants in the EPA crosscheck program shall provide the EPA program code designation for the unit).

1.5 BASES

B/1.1 LIQUID EFFLUENTS

B/1.1.1 Radioactive Liquid Effluent Monitoring Instrumentation

The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63 and 64 of Appendix A to 10CFR Part 50.

B/1.1.2 Concentration

This specification is provided to ensure that concentration of radioactive materials released in liquid waste effluents from the site will be less than the concentration levels specified in 10 CFR Part 20, Appendix B, Table II, Column 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water outside the site will result in exposures within:

- (1) the Section II.A design objectives of Appendix I, 10 CFR 50, to an individual, and
- (2) the limits of 10 CFR 20. 106 (e) to the population.

The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 the controlling radioisotope and its MPC in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

B/1.1.3 Dose

This specification is provided to implement the requirements of Sections II.A, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.A. of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents will be kept "as low as is reasonably achievable." Also, for fresh water sites with drinking water supplies which can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR 141. The dose calculations in the ODCM implement the requirements in Section III.A of Appendix I that conformance with guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants", section 4.3. NUREG-0133 implements Regulatory Guide 1.109, Revision 1, October 1977 (section C.1 and Appendix A) and Regulatory Guide 1.113, April 1977. Regulatory Guide 1.109, October

Bases (continued)

1977, is titled "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I". Regulatory Guide 1.113, April 1977, is titled "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I".

B/1.1.4 Liquid Waste Treatment

The OPERABILITY of the liquid radwaste treatment system ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design of active given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the liquid radwaste treatment system were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50, for liquid effluents.

B/1.2 GASEOUS EFFLUENTS

B/1.2.1 Radioactive Gaseous Effluent Monitoring Instrumentation

The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63 and 64 of Appendix A to 10 CFR Part 50.

B/1.2.2 Dose Rate

This specification is provided to ensure that the dose at any time at the site boundary from gaseous effluents from all units as well as the oil incinerator on the site will be within the annual dose limits of 10 CFR Part 20 for unrestricted areas. The annual dose limits are the doses associated with the concentration of 10 CFR Part 20, Appendix B, Table II, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of an individual in an unrestricted area, either within or outside the site boundary, to annual average concentrations exceeding the limits specified in Appendix B, Table II of 10 CFR Part 20 (10 CFR Part 20. 106 (b)). For individuals who may at times be within the site boundary, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the site boundary. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the site boundary to less than or equal to 500 mrem/year to the total body or to less than or equal 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.

B/1.2.3 Dose - Noble Gases

This specification is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents will be kept "as low as is reasonably achievable". The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The dose calculations established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants", section 5.3. NUREG-0133 implements Regulatory Guide 1.109, Revision 1, October 1977 and Regulatory Guide 1.111, Revision 1, July 1977. Regulatory Guide 1.109 is entitled "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, "Revision 1, October 1977 and Regulatory Guide 1.111 is entitled "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors, "Revision 1, July 1977. The ODCM equations provided for determining the air doses at the site boundary are based upon the historical average atmospheric conditions.

This specification applies to the release of gaseous effluents from all reactors at the site and from the incineration of oil.

B/1.2.4 Dose-Radioiodines, Tritium and Radioactive Materials in Particulate Form

This specification is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A Appendix I to assure that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methods for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants", section 5.3. NUREG-0133 implements Regulatory Guide 1.109, Revision 1, October 1977 and Regulatory Guide 1.111, Revision 1, July 1977. Regulatory Guide 1.109 is entitled "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, "Revision 1, October 1977 and Regulatory Guide 1.111 is entitled "Methods for Estimating Atmospheric Transport and Dispersion of of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors, "Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for radioiodines,

Bases (continued)

tritium, and radioactive materials in particulate form are dependent on the existing radionuclide pathways to man, in the unrestricted area. The pathways which were examined in the development of these calculations were: 1) individual inhalation of airborne radionuclides, 2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, 3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and 4) deposition on the ground with subsequent exposure of man.

This specification applies to the release of gaseous effluents from all reactors at the site and from the incineration of oil.

B/1.2.5 Gaseous Radwaste Treatment

The OPERABILITY of the GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable". This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

B/1.3 RADIOACTIVE EFFLUENTS: TOTAL DOSE

The specification is provided to meet the dose limitations of 40 CFR 190. The specification requires the preparation and submittal of a Special Report whenever the calculated doses from plant radioactive effluents exceed twice the design objective doses of Appendix I. For sites containing up to 4 reactors, it is highly unlikely that the resultant dose to a member of the public will exceed the dose limits of 40 CFR 190 if the individual reactors remain within the reporting requirement level. The Special Report will describe a course of action which should result in the limitation of dose to a member of the public for 12 consecutive months to within the 40 CFR 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the member of the public from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 5 miles must be considered. If the dose to any member of the public is estimated to exceed the requirements of 40 CFR 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR 190 have not already been corrected), in accordance with the provisions of 40 CFR 190.11, is considered to be a timely request and fulfills the requirements of 40 CFR 190 until NRC staff action is completed. An individual is not considered a member of the public during any period in which he/she is engaged in carrying out any operation which is part of the nuclear fuel cycle.

B/1.4.1 Monitoring Program

The radiological monitoring program required by this specification provides measurements of radiation of radioactive materials in those exposure pathways and for those radionuclides, which lead to the highest potential radiation exposures of individuals resulting from the station operation. This monitoring program thereby supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways. The initially specified monitoring program will be effective for at least the first three years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The detection capabilities required by Table 1.4-3 are state-of-the-art for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as a a posteriori (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified and described in the Annual Radiological Environmental Operating Report.

B/1.4.2 Land Use Census

This specification is provided to ensure that changes in the use of unrestricted areas are identified and that modifications to the monitoring program are made if required by the results of this census. The best survey information from the door-to-door, aerial or consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. Restricting the census to gardens of greater than 500 square feet provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were used, 1) that 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and 2) a vegetation yield of 2 kg/square meter.

B/1.4.3 Interlaboratory Comparison Program

The requirement for participation in an Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are reasonably valid.

1.6 REPORTING REQUIREMENTS

1.6.1 Annual Radiological Environmental Operating Report

1.6.1.1 Routine radiological environmental operating reports covering the operation of the unit during the previous calendar year shall be submitted prior to May 1 of each year. The initial report shall be submitted prior to May 1 of the year following initial criticality.

1.6.1.2 The annual radiological environmental operating reports shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison with preoperational studies, operational controls (as appropriate), and previous environmental surveillance reports and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of land use censuses required by ODCM Specification 1.4.2.1. If harmful effects or evidence of irreversible damage are detected by the monitoring, the report shall provide an analysis of the problem and a planned course of action to alleviate the problem.

The annual radiological environmental operating reports shall include summarized and tabulated results in the format of Regulatory Guide 4.8, December 1975 of all radiological environmental samples taken during the report period. In the event that some results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for missing results. The missing data shall be submitted as soon as possible in a supplementary report.

The report shall also include the following: a summary description of the radiological environmental monitoring program; a map of all sampling locations keyed to a table giving distances and directions from one reactor; and the results of licensee participation in the Interlaboratory Comparison Program, required by ODCM Specification 1.4.3.1.

1.6.2 Annual Radioactive Effluent Release Report

1.6.2.1 A radioactive effluent release report covering the operation of the unit during the previous year of operation shall be submitted within 60 days after January 1 of each year. The period of the first report shall begin with the date of initial criticality.

1.6.2.2 The Radioactive Effluent Release Report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants", Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof. The summary will also include quantities of radioactive gaseous effluent and solid waste (ash) released as a result of on-site oil incineration.

The Radioactive Effluent Release Report shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing of wind speed, wind direction, and atmospheric stability, and precipitation (if measured) on magnetic tape, or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability. This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station and oil incinerator during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to members of the public due to their activities inside the site boundary (Figures 5.1-3 and 5.1-4 of the VCSNS Technical Specifications) during the year. All assumptions used in making these assessments (i.e., specific activity, exposure time and location) shall be included in these reports. Historical annual average meteorology or meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents (as determined by sampling frequency and measurement) shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be

performed in accordance with the OFFSITE DOSE CALCULATION MANUAL (ODCM).

The Radioactive Effluent Release Report shall also include an assessment of radiation doses to the likely most exposed member of the public from reactor releases and other nearby uranium fuel cycle sources (including doses from primary effluent pathways and direct radiation) for the previous 12 consecutive months to show conformance with 40 CFR 190, Environmental Radiation Protection Standards for Nuclear Power Operation. Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in Regulatory Guide 1.109, Rev. 1.

The Radioactive Effluent Release Report shall include unplanned releases from site to unrestricted areas of radioactive materials in gaseous and liquid effluents on a quarterly basis.

The Radioactive Effluent Release Report shall also include the following: an explanation as to why the inoperability of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified in ODCM Specifications 1.1.1.1 and 1.2.1.1, respectively.

1.6.3 Major Changes To Radioactive Waste Treatment Systems (Liquid and Gaseous)

1.6.3.1 Licensee initiated major changes to the radioactive waste systems (liquid and gaseous):

1. Shall be reported to the Commission in the Monthly Operating Report for the period in which the evaluation was reviewed by the Plant Safety Review Committee. The discussion of each change shall contain:
 - a. A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59;
 - b. Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
 - c. A detailed description of the equipment, components and processes involved and the interfaces with other plant systems;
 - d. An evaluation of the change which shows the predicted releases or radioactive materials in liquid and gaseous effluents that differs from those previously predicted in the license application and amendments thereto;
 - e. An evaluation of the change which shows the expected maximum exposures to individual in the unrestricted area and to the general population that differ from those previously estimated in the license application and amendments thereto;
 - f. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents, to the actual releases for the period prior to when the changes are to be made;
 - g. An estimate of the exposure to plant operating personnel as a result of the change; and

- h. Documentation of the fact that the change was reviewed and found acceptable by the PSRC.
- 2. Shall become effective upon review and acceptance as set forth in Technical Specification 6.5.

1.7 Definitions

ACTION

- 1.7.1 ACTION shall be that part of a specification which prescribes measures required under designated conditions.

ANALOG CHANNEL OPERATIONAL TEST

- 1.7.2 An ANALOG CHANNEL OPERATIONAL TEST shall be the injection of a simulated signal into the channel as close to the sensor as practicable to verify OPERABILITY of alarm, interlock and/or trip functions. The ANALOG CHANNEL OPERATIONAL TEST shall include adjustments, as necessary, of the alarm, interlock and/or trip setpoints such that the setpoints are within the required range and accuracy.

CHANNEL CALIBRATION

- 1.7.3 A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel such that it responds within the required range and accuracy to known values of input. The CHANNEL CALIBRATION shall encompass the entire channel including the sensors and alarm, interlock and/or trip functions, and may be performed by any series of sequential, overlapping or total channel steps such that the entire channel is calibrated.

CHANNEL CHECK

- 1.7.4 A CHANNEL CHECKS shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

GASEOUS RADWASTE TREATMENT SYSTEM

- 1.7.5 A GASEOUS RADWASTE TREATMENT SYSTEM is any system designed and installed to reduce radioactive gaseous effluents by collecting primary coolant system off gases from the primary system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

OPERABLE - OPERABILITY

- 1.7.6 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component or device to perform its function(s) are also capable of performing their related support function(s).

SOURCE CHECK

- 1.7.7 A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a radioactive source.

VENTILATION EXHAUST TREATMENT SYSTEM

- 1.7.8 A VENTILATION EXHAUST TREATMENT SYSTEM is any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal absorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment (such a system is not considered to have any effect on noble gas effluents). Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

2.0 LIQUID EFFLUENT

2.1 Liquid Effluent Monitor Setpoint Calculation

The Virgil C. Summer Nuclear Station is located on the Monticello Reservoir which provides supply and discharge for the plant circulating water. This reservoir also provides supply and discharge capacity for the Fairfield Pumped Storage Facility. The Parr Reservoir located below the pumped storage facility is formed by the Parr Dam.

There are two analyzed release pathways and sources of dilution for liquid effluents: the circulating water discharge canal and the liquid effluent line to the penstocks of the pumped storage facility. All liquid effluent pathways discharge to one of these release points. Generally speaking, very low concentrations of radioactive waste are discharged to the circulating water discharge while higher concentrations of radioactive waste are released to the penstocks of the pumped storage facility during the generation cycle.

The calculated setpoint values will be regarded as upper bounds for the actual setpoint adjustments. That is, setpoint adjustments are not required to be performed if the existing setpoint level corresponds to a lower count rate than the calculated value. Setpoints may be established at values lower than the calculated values, if desired.

Calculated monitor setpoints may be added to the ambient background count rate.

GENERAL NOTE: If no discharge is planned for a specific pathway or if the sum of the effluent concentrations of gamma emitting nuclides equals zero, the monitor setpoint should be established as close to background as practical to prevent spurious alarms and yet alarm should an inadvertent release occur.

2.1.1 Liquid Effluent Monitor Setpoint Calculation Parameters

<u>Term</u>	<u>Definition*</u>	<u>Section of Initial Use</u>
A	= Penstock discharge adjustment factor which will allow the set point to be established in a convenient manner and to prevent spurious alarms. = f_t/f_{dx}	2.1.2
A_{it}	= The site related ingestion dose commitment factor to the total body or organ τ , for each identified principal gamma and beta emitter listed in Table 2.2-3 (mrem-ml per hr-uCi). For calculation see section 2.2.2.	2.1.4.4.1
\bar{A}_τ	= average A_{it} using maximum organ for each nuclide and weighted by concentration. = $\frac{\sum (A_{it} * C_i)}{\sum C_i}$	2.1.4.4.1
B	= Steam Generator Blowdown adjustment factor which will allow the set point to be established in a convenient manner and to prevent spurious alarms. = f_d/f_{ds}	2.1.4.1
C	= the effluent concentration limit (Specification 1.1.2) implementing 10CFR 20 for the site, in uCi/ml.	2.1.2
C_α	= the effluent concentration of alpha emitting nuclides observed by gross alpha analysis of the monthly composite sample, in uCi/ml.	2.1.2
C_f	= the measured concentration of Fe-55 in liquid waste as determined by analysis of the most recent available quarterly composite sample, in uCi/ml.	2.1.2
C_g	= the effluent concentration of a gamma emitting nuclide, g, observed by gamma-ray spectroscopy on the waste sample, in uCi/ml.	2.1.2
C_i	= the concentration of nuclide i, in uCi/ml, as determined by the analysis of the waste sample.	2.1.2
C_{ir}	= the concentration of radionuclide i, in uCi/ml, in the Monticello Reservoir. Inclusion of this term will correct for possible long-term buildup of radioactivity due to recirculation and for the presence of activity recently released to the Monticello Reservoir by plant activities.	2.1.2
C_s	= the concentration of Sr-89 or Sr-90 in liquid wastes as determined by analysis of the quarterly composite sample, in uCi/ml.	2.1.2
C_t	= the measured concentration of H-3 in liquid waste as determined by analysis of the monthly composite, in uCi/ml.	2.1.2
c	= the setpoint, in uCi/ml, of the radioactivity monitor measuring the radioactivity concentration in the effluent line prior to dilution and subsequent release. This setpoint which is proportional to the volumetric flow to the effluent line and inversely proportional to the volumetric flow of the dilution stream plus the effluent	2.1.2

*All concentrations are in units of uCi/ml unless otherwise noted.

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
	stream, represents a value which, if exceeded, would result in concentrations exceeding the limits of 10CFR 20 in the unrestricted area.	
C_B	= the monitor setpoint concentration for RM-L7, the Nuclear Blowdown Monitor Tank discharge line monitor, in uCi/ml.	2.1.2.2
C_C	= the monitor setpoint concentration for RM-L9, the combined Liquid Waste Processing System and Nuclear Blowdown System effluent discharge line monitor, in μ Ci/ml.	2.1.2.3
C_D	= the monitor setpoint concentration for RM-L11, the Condensate Demineralizer Backwash discharge line monitor, in uCi/ml.	2.1.4.2.2
C_M	= the monitor setpoint concentration for RM-L5, the Waste Monitor Tank discharge line monitor, in uCi/ml.	2.1.2.1
C_{Sa}	= the monitor setpoint concentration for RM-L3, the initial Steam Generator Blowdown Effluent line monitor, in μ Ci/ml.	2.1.4.1.1
C_{Sb}	= the monitor setpoint concentration for RM-L10, the final Steam Generator Blowdown Effluent line monitor, in uCi/ml.	2.1.4.1.1
C_T	= the monitor setpoint concentration for RM-L8, the Turbine Building Sump Effluent line monitor, in uCi/ml.	2.1.4.2.1
CF_D	= the Condensate Demineralize Backwash Effluent Concentration Factor.	2.1.4.2
CF_S	= the Steam Generator Blowdown Effluent Concentration Factor.	2.1.4.3
CF_T	= the Turbine Building Sump Effluent Concentration Factor.	2.1.4.2
DF	= the dilution factor, which is the ratio of the total dilution flow rate to the effluent stream flow rate(s).	2.1.2
D_m	= daily dose projection margin (mrem) for most limiting dose (total body or organ).	2.1.4.4.1
F	= the dilution water flow setpoint as determined prior to the release, in volume per unit time.	2.1.2
F_d	= the flow rate of the Circulating Water System during the time of release of the Turbine Building Sump and/or the Steam Generator Blowdown, in volume per unit time.	2.1.4.1
F_{dc}	= the dilution flow rate of the Circulating Water System used for effluent monitor setpoint calculations, based on 90 percent of expected Circulating Water System flow rate during the time of release and corrected for recirculated Monticello Reservoir activity, in volume per unit time.	2.1.4.1
F_{dp}	= the dilution flow rate through the penstock(s) receiving the radioactive liquid release upon which the effluent monitor setpoint is based, as corrected for any recirculated radioactivity, in volume per unit time.	2.1.2

* (Conservatively this value will be either zero, if no release is to be conducted from this system, or the maximum measured capacity of the discharge pump if a release is to be conducted.)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
F_t	= the flow rate of water through the Fairfield Pumped Storage Station penstock(s) to which radioactive liquids are being discharged during the period of effluent release. This flow rate is dependent upon operational status of Fairfield Pumped Storage Station, in volume per unit time.	2.1.2
f	= the effluent line flow setpoint as determined for the radiation monitor location, in volume per unit time.	2.1.2
f_d	= the maximum permissible discharge flow rate for releases to the Circulating Water, in volume per unit time.	2.1.4.1
f_{db}^*	= the flow rate of the Nuclear Blowdown Monitor Tank discharge, in volume per unit time.	2.1.2
f_{dm}^*	= the flow rate of a Waste Monitor Tank discharge, in volume per unit time.	2.1.2
f_{ds}^*	= the flow rate of the Steam Generator Blowdown discharge, in volume per unit time.	2.1.4.1
f_{dx}	= the flow rate of the tank discharge, either f_{dm} or f_{db} , in volume per unit time.	2.1.2
F_k	= The near field dilution factor for C_i during release from Turbine Building sump.	2.1.4.4.1
f_r	= the recirculation flow rate used to mix the contents of a tank, in volume per unit time.	2.1.2
f_t	= the maximum permissible discharge flow rate for batch releases to the penstocks, in volume per unit time.	2.1.2
MPC_i	= MPC_g , MPC_a , MPC_s , MPC_l , and MPC_t = the limiting concentrations of the appropriate gamma emitting, alpha emitting, and strontium radionuclides, Fe-55, and tritium, respectively, from 10CFR, Part 20, Appendix B, Table II, Column 2. For gamma emitting noble gas radionuclides, $MPC_i = 2 \times 10^{-4}$ uCi/ml.	2.1.2
SF	= the safety factor, a conservative factor used to compensate for engineering and measurement uncertainties. SF = 0.5, corresponding to a 100 percent variation.	2.1.2
$[C_i]_{LLD}$	= the Lower Limit of Detection (LLD) for radionuclide i in liquid waste in the Waste Monitor Tank, as determined by the analysis required in ODCM Table 1.1-4, in uCi/ml.	2.1.3
$[C_i]_M$	= the concentration of radionuclide i in the waste contained within the Waste Monitor Tank serving as the holding facility for sampling and analysis prior to discharge, in uCi/ml.	2.1.3

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
$\sum_g C_g$	= the sum of the concentrations C_g of each measured gamma emitting nuclide observed by gamma-ray spectroscopy of the waste sample, in $\mu\text{Ci/ml}$.	2.1.2
$[\sum C_g]_B$	= the gamma isotopic concentrations of the Nuclear Blowdown Monitor Tank as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.2
$[\sum C_g]_D$	= the gamma isotopic concentrations of the Condensate Demineralizer Backwash effluent (including solids) as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.4.2.2
$[\sum C_g]_M$	= the gamma isotopic concentrations of the Waste Monitor Tank as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.2
$[\sum C_g]_S$	= the gamma isotopic concentrations of the Steam Generator Blowdown as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.4.1.1
$[\sum C_g]_T$	= the gamma isotopic concentrations of the Turbine Building Sump as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.4.2.1
$[\sum (C_i/\text{MPC}_i)]_D$	= the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Condensate Demineralizer Backwash.	2.1.4.2
$[\sum (C_i/\text{MPC}_i)]_S$	= the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Steam Generator Blow-down Effluent.	2.1.4.1
$[\sum (C_i/\text{MPC}_i)]_T$	= the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Turbine Building Sump Effluent.	2.1.4.2
$[\sum (C_i/\text{MPC}_i)]_X$	= the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC for the tank whose contents are being considered for release. For a WMT, $X = M$. For the NBMT, $X = B$.	2.1.2
t_r	= the minimum time for recirculating the contents of a tank prior to sampling, in minutes.	2.1.2
V	= the volume of liquid in a tank to be sampled, in gallons.	2.1.2
V_j	= release volume for Turbine Building sump release permit j , in gallons.	2.1.4.4.1
Δt_k	= the length of time (in hours) during which concentrations and flow rates are averaged. For purpose of setpoint calculation, $\Delta t_k = 24$ hours.	2.1.4.4.1

2.1.2 Liquid Radwaste Effluent Line Monitors

(RM-L5, RM-L7, RM-L9)

Liquid Radwaste Effluent Line Monitors provide alarm and automatic termination of release functions prior to exceeding the concentration limits specified in 10CFR 20, Appendix B, Table II, Column 2 at the release point to the unrestricted area. To meet this specification, the alarm/trip setpoints for liquid effluent monitors and flow measurement devices are set to assure that the following equation is satisfied:

$$C \geq \frac{cf}{F+f} \quad (1)$$

where:

- C = the effluent concentration limit (Specification 1.1.2) implementing 10CFR 20 for the site in uCi/ml.
- c = the setpoint, in uCi/ml, of the radioactivity monitor measuring the radioactivity concentration in the effluent line prior to dilution and subsequent release; the setpoint, which is inversely proportional to the volumetric flow of the effluent line and proportional to the volumetric flow of the dilution stream plus the effluent stream, represents a value which, if exceeded, would result in concentrations exceeding the limits of 10CFR 20 in the unrestricted area.
- F = the dilution water flow setpoint as determined prior to the release point, in volume per unit time.
- f = the effluent line flow setpoint as determined at the radiation monitor location, in volume per unit time.

At the Virgil C. Summer Nuclear Station the Liquid Waste Processing System (LWPS) and the Nuclear Blowdown System (NBS) both discharge to the penstocks of the Fairfield Pumped Storage (FPS) Facility through a

common line. The available dilution water flow (F_{dp}) is assumed to be 90 percent of the flow through the FPS penstock(s) to which liquid effluent is being discharged and is dependent upon operational status of the FPS Facility. The waste tank flow rates (f_{dm} and f_{db}) and the monitor setpoints (c_M , c_B and c_C) are set to meet the condition of equation (1) for a given effluent concentration, C . The three monitor setpoints are determined in accordance with the monitor system configuration for this discharge pathway. The LWPS discharges through RM-L5, which has setpoint c_M for alarm/control functions over releases from either Waste Monitor Tanks 1 or 2. The Nuclear Blowdown discharges through RM-L7, which has setpoint c_B for alarm/ control functions over releases from the Nuclear Blowdown Monitor Tank. These two release pathways merge into a common line monitored by RM-L9, which has setpoint c_C for control functions over the common effluent line. Although the piping is arranged so that simultaneous batch releases from the two systems could be practiced, operational releases shall be from only one of the two batch systems at any given time. The method by which their setpoints are determined is as follows:

- 1) The isotopic concentration for a waste tank to be released is obtained from the sum of the measured concentrations as determined by the analysis required in Table 1.1-4:

$$\sum_i C_i = \sum_g C_g + C_a + C_s + C_t + C_f \quad (2)$$

where:

C_i = the concentration of nuclide i , in uCi/ml, as determined by the analysis of the waste sample.

* Values for C_a , C_s , C_t and C_f will be based on most recent available composite sample analyses as required by Table 1.1-4.

- $\sum C_g$ = the sum of the concentrations C_g of each measured gamma emitting nuclide observed by gamma-ray spectroscopy of the waste sample, in uCi/ml.
- C_a^* = the effluent concentration of alpha emitting nuclides observed by gross alpha analysis of the monthly composite sample, in uCi/ml.
- C_s^* = the concentration of Sr-89 and Sr-90 in liquid waste as determined by analysis of the quarterly composite sample, in uCi/ml.
- C_t^* = the measured concentration of H-3 in liquid waste as determined by analysis of the monthly composite sample, in uCi/ml.
- C_i^* = the measured concentration of Fe-55 in liquid waste as determined by analysis of the quarterly composite sample, in uCi/ml.

The C_g term will be included in the analysis of each batch; terms for alpha, strontium, Fe-55, and tritium shall be included as appropriate*. Isotopic concentrations for both the Waste Monitor Tanks (WMT) and the Nuclear Blowdown Monitor Tank (NBMT) may be calculated using equation (2).

Prior to being sampled for analysis, the contents of a tank shall be isolated and recirculated. The minimum recirculation time shall be:

$$t_r = 2V/f_r \quad (3)$$

- t_r = the minimum time for recirculating the contents of a tank prior to sampling.
- V = the volume of liquid in the tank to be sampled.
- f_r = the recirculation flow rate used to mix the contents of a tank.

This is done to ensure that a representative sample will be obtained. Mechanical mixers shall ensure a similar minimum turnover.

- 2) Once isotopic concentrations for either Waste Monitor Tank or the Nuclear Blowdown Monitor Tank have been determined, these values are used to calculate a Dilution Factor, DF, which is the ratio of dilution flow rate to tank flow rate(s) required to assure that the limiting concentration of 10CFR, Part 20, Appendix B, Table II, Column 2 are met at the point of discharge for whichever tank is having its contents discharged.

$$DF = \left| \sum_i \frac{C_i}{MPC_i} \right|_x + SF \quad (4)$$

$$DF = \left| \sum_g \frac{C_g}{MPC_g} + \frac{C_a}{MPC_a} + \frac{C_s}{MPC_s} + \frac{C_t}{MPC_t} + \frac{C_i}{MPC_i} \right|_x + SF \quad (5)$$

where:

$\left| \sum_i \frac{C_i}{MPC_i} \right|_x$ = the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC for the tank whose contents are being considered for release. For a WMT, $X = M$. For the NBMT, $X = B$.

MPC_i = $MPC_g, MPC_a, MPC_s, MPC_t,$ and MPC_i = limiting concentrations of the appropriate gamma emitting, alpha emitting, and strontium radionuclides, Fe-55, and tritium, respectively, given in 10CFR, Part 20, Appendix B, Table II, Column 2. For gamma-emitting noble gas radionuclides MPC_i is to be set equal to $2 \times 10^{-4} \mu\text{Ci/ml}$, according to the Radiological Effluent Technical Specifications.

SF = the safety factor; a conservative factor used to compensate for engineering and measurement uncertainties.

= 0.5, Corresponding to a 100 percent variation.

- 3) The maximum permissible discharge flow rate, f_t , may be calculated for the release of either the WMT or NBMT. First the appropriate Dilution Factor is calculated by applying equation (4), using the appropriate concentration ratio term (i.e. M or B).

then,

$$f_t = \frac{F_{dp} + f_{dx}}{DF} \approx \frac{F_{dp}}{DF} \quad \text{for } F_{dp} \gg f_{dx} \quad (6)$$

where:

F_{dp} = dilution flow rate to be used in effluent monitor setpoint calculations, based on 90 percent FPS Station expected flow rate, as corrected for any recirculated radioactivity:

$$F_{dp} = (0.9) F_t \left(1 - \sum_i \frac{C_{ir}}{MPC_i} \right) \quad (7)$$

where:

F_t = the flow rate through the Fairfield Pumped Storage Station penstock(s) to which radioactive liquids are being discharged. F_t should normally fall between 2500 and 44800 cfs.

C_{ir} = the concentration of radionuclide i , in uCi/ml, in the intake of Fairfield Pumped Storage Station (that is, in the Monticello Reservoir). Inclusion of this term will correct for possible long-term buildup of radioactivity due to recirculation and for the presence of activity recently released to the Monticello Reservoir by plant activities. For expected discharges of liquid wastes, the summation will be much less than 1.0 and can be ignored (Reference 6).

- f_{dx} = the flow rate of the tank discharge, either f_{dm} or f_{db} .
- f_{db} = flow rate of Nuclear Blowdown Monitor Tank discharge. (Conservatively this value will be either zero, if no release is to be conducted from this system, or the maximum measured capacity of the discharge pump if a release is to be conducted.)
- f_{dm} = flow rate of Waste Monitor Tank discharge. (Conservatively this value will either be zero, if no release is to be conducted from this system, or the maximum measured capacity of the discharge pump if a release is to be conducted.)
- DF = the Dilution Factor from Step 2.

If $f_t \leq f_{dx}$, the release may be made as planned and the flow rate monitor setpoints should be established as in Step 4 (below). Because F_{dp} is normally very large compared to the maximum discharge pump capacities for the Waste Monitor Tank and the Nuclear Blowdown Monitor Tank, it is extremely unlikely that $f_t < f_{dx}$. However, if a situation should arise such that $f_t < f_{dx}$, steps must be taken to assure that equation (1) is satisfied prior to making the release. These steps may include decreasing f_{dx} by decreasing the flow rate of f_{dm} or f_{db} , and/or increasing F_{dp} .

When new candidate flow rates are chosen, the calculations above should be repeated to verify that they combine to form an acceptable release. If they do, the establishment of flow rate monitor setpoints may proceed as follows in Step 4. If they do not, the choice of candidate flow rates must be repeated until an acceptable set is identified.

Note that if $DF \geq 1$, the waste tank concentration for which the calculation is being performed includes safety factors in Step 2 and meets the limits of 10CFR 20 without further dilution. Even though

no dilution would be required, there will be no discharge if minimum dilution flow is not available, since the penstock minimum flow interlock will prevent discharge.

- 4) The dilution flow rate setpoint*, F , is established at 90 percent of the expected available dilution flow rate:

$$F = (0.9) F_t \quad (8)$$

The flow rate monitor setpoint* for the effluent stream shall be set at the selected discharge pump rate (normally the maximum discharge pump rate or zero) f_{dm} or f_{db} chosen in Step 3 above.

- 5) The radiation monitor setpoints may now be determined based on the values of ΣC_i , F , and f which were specified to provide compliance with the limits of 10CFR 20, Appendix B, Table II, Column 2. The monitor response is primarily to gamma radiation, therefore, the actual setpoint is based on ΣC_g .

The setpoint concentration, c , is determined as follows:

$$c \leq \sum_g C_g \times A \quad (9)$$

$A =$ Adjustment factor which will allow the setpoint to be established in a practical manner for convenience and to prevent spurious alarms.

$$A = f_t / f_{dx} \quad 10$$

If $A \geq 1$, Calculate c and determine the maximum value for the actual monitor setpoint (cpm) from the monitor calibration graph.

* Set points for flow rates are administrative limits.

If $A < 1$, No release may be made. Reevaluate the alternatives presented in Step 3.

NOTE: If calculated setpoint values are near actual concentrations planned for release, it may be impractical to set the monitor alarm at this value. In this case a new setpoint may be calculated following the remedial methodology presented in Step 3 for the case of $f_t < f_{dx}$.

Within the limits of the conditions stated above, the specific monitor setpoint concentrations for the three liquid radiation monitors RM-L5, RM-L7, and RM-L9 are determined as follows:

2.1.2.1 RM-L5, Waste Monitor Tank Discharge Line Monitor:

$$C_M \leq \left[\sum_g C_g \right]_M (A) \quad (11)$$

C_M is in uCi/ml

*See GENERAL NOTE under 2.1.

2.1.2.2 RM-L7, Nuclear Blowdown Monitor Tank Discharge Line Monitor:

$$C_B \leq \left[\sum_g C_g \right]_B (A) \quad (12)$$

C_B is in uCi/ml

NOTE: In no case should discharge be made directly from the Nuclear Blowdown Holdup Tank to the penstocks.

*See GENERAL NOTE under 2.1.

2.1.2.3 RM-L9, Combined Liquid Waste Processing System and Nuclear Blowdown Waste Effluent Discharge Line Monitor

The monitor setpoint concentration on the common line, c_C , should be the same as the setpoint concentration for the monitor on the active individual discharge line (i.e., c_M or c_B as determined above):

$$C_C \leq \text{MAX} (C_M, C_B) \quad (13)$$

*See GENERAL NOTE under 2.1.

NOTE: In all cases, c_M , c_B , and c_C are the setpoint concentration values in uCi/ml. The actual monitor setpoints (cpm) for RM-L5, RM-L7, and RM-L9 are determined from the calibration graph for the particular monitor. Initially, the calibration curves were determined conservatively from families of response curves supplied by the monitor manufacturers. A sample is shown in Figure 2.1-1. As releases occur, a historical correlation will be prepared and placed in service when sufficient data are accumulated.

2.1.3 Liquid Radwaste Discharge Via Industrial and Sanitary Waste System (RM-L5)

In the Virgil C. Summer Nuclear Station liquid waste effluent system design, there exists a mechanism for discharging liquid wastes via the Industrial Sanitary Waste System. The sample point prior to discharge is one of the Waste Monitor Tanks. The analysis requirements are the requirements listed in Table 1.1-4.

This effluent pathway shall only be used when the following condition is met for all radionuclides, i :

$$\left| C_i \right|_M \leq \left| C_i \right|_{LLD} \quad (14)$$

$\left| C_i \right|_M$ = the concentration of radionuclide i in the waste contained within the Waste Monitor Tank serving as the holding facility for sampling and analysis prior to discharge, in uCi/ml.

$\left| C_i \right|_{LLD}$ = the Lower Limit of Detection, (LLD) for radionuclide i in the liquid waste in the Waste Monitor Tank as determined by the analysis required in Table 1.1-4, in uCi/ml.

When the conditions of equation (14) are met, liquid waste may be released via the Industrial and Sanitary Waste System pathway. The RM-L5 setpoint should be established as close to background as practical to prevent spurious alarms and yet alarm should an inadvertent high concentration release occur.

2.1.4 Steam Generator Blowdown, Turbine Building Sump, and Condensate Demineralizer Backwash Effluent Lines

(RM-L3, RM-L10, RM-L8, RM-L11)

Concentrations of radionuclides in the liquid effluent discharges made via the Turbine Building Sump, Steam Generator Blowdown, and Condensate Demineralizer Backwash are expected to be very low or nondetectable. The first two releases are expected to be continuous in nature and the last a batch release. All will be sampled in an appropriate manner as specified in Table 1.1-4 of the ODCM. The Steam Generator Blowdown Monitors, the Turbine Building Sump Monitor, and the Condensate Demineralizer Backwash Monitor provide alarm and automatic termination of release prior to exceeding the concentration limits specified in 10CFR 20, Appendix B, Table II, Column 2 at the release point to the unrestricted area.

In reality, all of these effluent pathways utilize the circulating water as dilution to the effluent stream, with the circulating water discharge canal being the point of release into an unrestricted area. Steam Generator Blowdown Effluent may be released to the Circulating Water either directly in the Condenser outflow (the normal flow path) or in the first hours following startup via the Industrial and Sanitary Waste System (ISWS) for chemical reasons. The Turbine Building Sump and Condensate Demineralizer Backwash Effluents enter Circulating Water via the sumps and ponds of the Industrial and Sanitary Waste System.

- CO3+ To ensure compliance with ODCM specification 1.1.2.1, normally no dilution is assumed for discharges to the Industrial and Sanitary Waste System. The assumption of no dilution limits discharges to < 0.5 MPC and therefore ODCM specification 1.1.2.1 would not be compromised in the event circulating water dilution is lost. To add operational flexibility for abnormal conditions (radionuclide concentration in Turbine Building sump > 0.5 MPC), discharges from the Turbine Building sump and concentrations in the ISWS may exceed the operational objective, 0.5 MPC, provided circulating water dilution is sufficient to ensure compliance with ODCM specification 1.1.2.1 and liquid effluents are being discharged in compliance with ODCM specification 1.1.4.1. Two separate setpoint calculations are given for Turbine Building sump discharges (RM-L8). Section 2.1.4.2.1 describes the setpoint calculation normally used, limiting discharges to 0.5 MPC. Section 2.1.4.2.2 provides an alternate setpoint methodology which may be used during abnormal conditions. RM-L8 set-points are considered in compliance with ODCM specification 1.1.1.1 provided the setpoints are adequate to prevent releases in excess of ODCM specification 1.1.2.1.
- CO3+

Two mutually exclusive setpoint calculation processes are outlined below for steam generator blowdown. Section 2.1.4.1 is to be used whenever Steam Generator Blowdown is being released directly to the Circulating Water in the Condenser outflow, which is the normal mode. Section 2.1.4.2 is to be used whenever Steam Generator Blowdown is being released to the Industrial and Sanitary Waste System, or diverted to the Nuclear Blowdown Processing System, both of which are alternate modes.

Normally, water collected by the Nuclear Blowdown Processing System has very low specific activity. This water may be processed to the Turbine Building sump.

NOTE: When Circulating Water is unavailable for effluent dilution, releases containing activity above LLD (excluding tritium) should be discouraged via pathways

which lead to it. Steam Generator Blowdown should be diverted to the Nuclear Blowdown Processing System. Condensate Demineralizer Backwash may be diverted to the Turbine Building sump or not released. Turbine Building sump effluent should be processed through temporary demineralizers or diverted to the Excess Liquid Waste Processing System. (These steps are to keep the calculated dose to individuals as low as reasonably achievable.)

2.1.4.1 Steam Generator Blowdown Effluent Direct to Circulating Water (Normal Mode)

Equation (1) is again used to assure that effluents are in compliance with the aforementioned specification:

$$C \geq \frac{cf}{(F+f)}$$

The available dilution water flow (F_{dc}) is dependent upon the mode of operation of the Circulating Water System. Any change in this value will be accounted for in a recalculation of equation (1). The Steam Generator Blowdown flow rate (f_{db}) and the Steam Generator Blowdown monitor setpoints (c_{sa} and c_{sb}) are set to meet the condition of equation (1).

RM-L3, the first monitor in the Steam Generator Blowdown discharge pathway, alarms and terminates release of the stream. The discharge is then automatically diverted to the Nuclear Blowdown Processing System. RM-L10, the last monitor in the Steam Generator Blowdown discharge pathway, alarms and terminates the release. Thus, RM-L10 is redundant to RM-L3 and the setpoint (c_{sb}) will be determined in the same manner as RM-L3 (c_{sa}).

The method by which the monitor setpoints are determined is as follows:

- 1) The isotopic concentrations for any release source to be or being released are obtained from the sum of the measured concentrations as determined in Table 1.1-4. Equation (2) is again employed for this calculation:

$$\sum_i C_i = \sum_g C_g + C_a + C_s + C_t + C_f$$

where:

- $\sum_i C_i$ = the sum of the measured concentrations as determined by the analysis of the waste sample, in uCi/ml.
- $\sum_g C_g$ = the sum of the concentrations C_g of each measured gamma emitting nuclide observed by gamma-ray spectroscopy of the waste sample, in uCi/ml.
- C_a = the measured concentration C_a of alpha emitting composite sample, in uCi/ml.
- C_s = the measured concentrations of Sr-89 and Sr-90 in liquid waste as determined by analysis of the most recent available quarterly composite sample, in uCi/ml.
- C_t = the measured concentration of H-3 in liquid waste determined by analysis of the monthly composite sample, in uCi/ml.
- C_f = the measured concentration of Fe-55 in liquid waste as determined by analysis of the most recent available quarterly composite sample, in uCi/ml.

Isotopic concentrations for the Steam Generator Blowdown System effluent, the Turbine Building Sump Effluent, and the Condensate Demineralizer Backwash effluent may be calculated using equation (2).

- 2) Once isotopic concentrations for the Steam Generator Blowdown have been determined, these values are used to calculate a Dilution Factor, DF, which is the ratio of the total dilution flow rate to effluent stream flow rate required to assure that the limiting concentrations of 10CFR, Part 20, Appendix B, Table II, Column 2 are met at the point of discharge.

$$DF = \left[\sum_i \frac{C_i}{MPC_i} \right]_S \cdot SF \quad (15)$$

$$DF = \left[\sum_g \frac{C_g}{MPC_g} + \frac{C_a}{MPC_a} + \frac{C_s}{MPC_s} + \frac{C_f}{MPC_f} + \frac{C_t}{MPC_t} \right]_S \cdot SF \quad (16)$$

where:

C_i = $C_g, C_a, C_s, C_f,$ and C_t ; measured concentrations as defined in Step 1. Terms $C_a, C_s, C_f,$ and C_t will be included in the calculation as appropriate.

$\left[\sum_i \frac{C_i}{MPC_i} \right]_S$ = the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Steam Generator Blowdown effluent.

MPC_i = $MPC_g, MPC_a, MPC_s, MPC_f,$ and MPC_t are limiting concentrations of the appropriate radionuclide from 10CFR, Part 20, Appendix B, Table II, Column 2 limits. For gamma-emitting noble gas radionuclides, MPC_i is to be set equal to 2×10^{-4} uCi/ml.

SF = the same generic term as used in Section 2.1.2, Step 2.

= 0.5

- 3) The maximum permissible effluent discharge flow rate, f_d , may now be calculated for a release from the Steam Generator Blowdown.

$$f_d = \frac{F_{dc} + f_{ds}}{DF} = \frac{F_{dc}}{DF} \text{ for } F_{dc} \gg f_{ds} \quad (17)$$

where:

F_{dc} = Dilution flow rate for use in effluent monitor setpoint calculations, based on 90 percent of the expected flow rate of the Circulating Water System during the time of release and corrected for any recirculated activity:

$$F_{dc} = (0.9) F_d \left(1 - \sum_i \frac{C_{ir}}{MPC_i} \right) \quad (18)$$

where:

F_d = the flow rate of the Circulating Water System during the time of the release. F_d should normally fall between 1.78×10^5 and 5.34×10^5 gpm when the plant is operating and should be 5000 gpm when the plant is shutdown and the Circulating Water Jockey pump is operating.

C_{ir} = the concentration of radionuclide i , in uCi/ml, in the Circulating Water System intake, (that is, in the Monticello Reservoir). Inclusion of this term will correct for possible long-term buildup of radioactivity due to recirculation and for the presence of activity recently released to the Monticello Reservoir by plant activities. For expected discharges of liquid wastes, the summation will be much less than 1.0 and can be ignored (Reference 6).

f_{ds} = Flow rate of Steam Generator Blowdown discharge. (This value normally will be either zero, if no release is

to be conducted, or the maximum rated capacity of the discharge pump (250 gpm), if a release is to be conducted.)

Note that the equation is valid only for $DF > 1$; for $DF \leq 1$, the effluent concentration meets the limits of 10CFR 20 without dilution as well as being in compliance with the conservatism imposed by the Safety Factor in Step 2.

If $f_d \geq f_{ds}$, releases may be made as planned. Because F_{dc} is normally very large compared to the maximum discharge pump capacity of the Steam Generator Blowdown System, it is extremely unlikely that $f_d < f_{ds}$. However, if a situation should arise such that $f_d < f_{ds}$, steps must be taken to assure that equation (1) is satisfied prior to making the release. These steps may include diverting Steam Generator Blowdown to the Nuclear Blowdown Processing System or decreasing the effluent flow rate.

When new candidate flow rates are chosen, the calculations above should be repeated to verify that they combine to form an acceptable release. If they do, the establishment of flow rate monitor setpoints should proceed as follows in Step 4. If they do not provide an acceptable release, the choice of candidate flow rates must be repeated until an acceptable set is identified.

- 4) The dilution flow rate setpoint for minimum flow rate, F , is established at 90 percent of the expected available dilution flow rate:

$$F = (0.9) (F_d) \quad (19)$$

Flow rate monitor setpoints for the Steam Generator Blowdown effluent stream shall be set at the selected

discharge pump rate (normally the maximum discharge pump rate) f_{ds} , chosen in Step 3 above.

- 5) The Steam Generator Monitor setpoints may be specified based on the values of $\sum C_i$, F , and f which were specified to provide compliance with the limits of 10CFR 20, Appendix B, Table II, Column 2. The monitor response is primarily to gamma radiation, therefore, the actual setpoint is based on $\sum C_g$. The monitor setpoint in cpm which corresponds to the calculated value c is taken from the monitor calibration graph. (See NOTE, page 2.0-14.) The setpoint concentration, c , is determined as follows:

$$c \leq \sum_g C_g \times B \quad (20)$$

$$B = f_d / f_{ds} \quad (21)$$

If $B \geq 1$, Calculate c and determine the maximum value for the actual monitor setpoint (cpm) from the monitor calibration graph.

If $B < 1$, No release may be made. Reevaluate the alternatives presented in step 3.

NOTE: If the calculated setpoint value is near actual concentrations being released or planned for release, it may be impractical to set the monitor alarm at this value. In this case a new setpoint may be calculated following the remedial methodology presented in steps 3 and 4 for the case $f_d < f_{ds}$.

Within the conditions stated above, the specific monitor setpoint concentrations for the two steam generator blowdown monitors RM-L3 and RM-L10 are calculated as shown below. Since the monitors are sensitive primarily to

gamma radiation, their setpoints will be based on the concentrations of gamma emitting radionuclides.

2.1.4.1.1 For RM-L3, Steam Generator Blowdown Discharge initial monitor, and for RM-L10, Steam Generator Blowdown Discharge final monitor:

$$c_{Sa} \text{ or } c_{Sb} \leq \left[\sum_g C_g \right]_S (B) \quad (22)$$

$\left[\sum_g C_g \right]_S =$ the isotopic concentration of the Steam Generator Blowdown effluent as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in uCi/ml.

*See GENERAL NOTE under 2.1.

2.1.4.2 Turbine Building Sump and Condensate Demineralizer Backwash (Normal Mode)

For conservatism, the Turbine Building Sump and Condensate Demineralizer Backwash monitor setpoints (c_T and c_D) will claim no dilution from the Circulating Water, and will be set at the applicable concentration limit. That is:

$$c \leq C \quad (23)$$

The Turbine Building sump monitor, RM-L8, alarms and terminates release upon exceeding the monitor setpoint (c_T). The discharge can then be manually diverted to the Excess Waste Processing System. RM-L11, the Condensate Demineralizer Backwash monitor, alarms and terminates release upon exceeding the monitor setpoint (c_D). The discharge may then be manually diverted to the Turbine Building sump or simply delayed.

The Turbine Building Sump and Condensate Demineralizer Backwash monitor setpoints are to be established indepen-

dently of each other and without crediting dilution. They are to be based on the measured radionuclide concentrations of the effluent stream and are to ensure compliance with the limits of 10CFR 20, Appendix B, Table II, Column 2 prior to discharge.

For each effluent stream, a concentration factor CF must be calculated, measuring the nearness of approach of the undiluted waste stream to the specified limiting condition of the Maximum Permissible Concentration. That is,

$$CF = \left[\sum_i \frac{C_i}{MPC_i} \right] + SF \quad (24)$$

$$CF_T = \left[\sum_i \frac{C_i}{MPC_i} \right]_T + SF \quad (25)$$

$$CF_D = \left[\sum_i \frac{C_i}{MPC_i} \right]_D + SF \quad (26)$$

where:

$$\left[\sum_i \frac{C_i}{MPC_i} \right]_T = \text{the sum of the ratios of the measured concentration of nuclide } i \text{ to its limiting value } MPC_i \text{ for the Turbine Building sump effluent.}$$

$$\left[\sum_i \frac{C_i}{MPC_i} \right]_D = \text{the sum of the measured concentration of nuclide } i \text{ (in liquid only) to its limiting value } MPC_i \text{ for the Condensate Demineralizer Backwash effluent.}$$

CF_T = the concentration factor for the Turbine Building Sump Effluent.

CF_D = the concentration factor for the Condensate Demineralizer Backwash Effluent.

SF = the generic engineering safety factor used in Section 2.1.2, Step 2.
= 0.5

If $CF \leq 1$, calculate c and determine the actual monitor setpoint (cpm) from the calibration curve.

If $CF > 1$, no release may be made via this path. The release must either be delayed or diverted for additional processing. Because of spurious alarms, these remedial steps may be required if the monitor setpoints are only near the actual concentrations being released.

Within the limits of the conditions stated above, the specific monitor setpoint concentrations for RM-L8 and RM-L11 may now be calculated. Because they are primarily sensitive to gamma radiation, their setpoints will be based on the concentrations of gamma emitting radionuclides as follows:

2.1.4.2.1 For RM-L8, Turbine Building Sump Discharge Monitor:

$$c_T \leq \left[\sum_g C_g \right]_T + CF_T \quad (27)$$

Where:

$\left[\sum_g C_g \right]_T$ = The gamma isotopic concentration of the Turbine Building sump effluent as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in uCi/ml.

CF_T = The Turbine Building sump Effluent Concentration Factor from equation (25).

*See GENERAL NOTE under 2.1.

2.1.4.2.2 For RM-L11, Condensate Demineralizer Backwash Discharge Monitor:

$$c_D \leq \left| \sum_g C_g \right|_D + CF_D \quad (28)$$

where:

$\left| \sum_g C_g \right|_D =$ The gamma isotopic concentration of the Condensate Demineralizer Backwash effluent (including solids) as obtained from the sum of the measured concentrations determined by the analysis required ODCM Table 1.1-4, in uCi/ml.

$CF_D =$ The Condensate Demineralizer Backwash Effluent Concentration Factor from equation (26).

*See GENERAL NOTE under 2.1.

2.1.4.3 Steam Generator Blowdown Effluent Not Directly to Circulating Water (Alternate Mode)

Equation (23) is again used to assure that effluents are in compliance with the aforementioned specification before dilution in the receiving water:

$$c \leq C$$

Because dilution is not considered in the setpoint calculation, it is not necessary to calculate maximum permissible discharge flow rates or anticipated available dilution flow rate.

The functions of the two monitors whose setpoints are to be established are described in Section 2.1.4.1 above. The method for the determination is as follows:

- 1) If a release is found to be permissible, flow rate monitors for the active effluent streams (Steam Generator Blowdown - f_{ds} , Turbine Building sump - f_{dt} , and Condensate Demineralizer - f_{dd}) may have their setpoints established at any operationally convenient value. Since 10CFR 20 is to be

complied with before dilution, the flow rate of discharges is irrelevant.

- 2) The Concentration Factor of equation (24) is again used to ensure the permissibility of the release:

$$CF = \left| \sum_i \frac{C_i}{MPC_i} \right| + SF$$

$$CF_S = \left| \sum_i \frac{C_i}{MPC_i} \right|_S + SF \quad (29)$$

in which all terms are defined in subsection 1.1.3.1 and subscript S refers to the Steam Generator Blowdown Effluent.

If $CF \cong 1$, calculate c and determine the actual monitor setpoint (cpm) from the calibration curve.

If $CF > 1$, no release may be made via this path. The release must either be delayed or diverted for additional processing. Because of spurious alarms, these remedial steps may be required if the monitor setpoints are only near the actual concentrations being released.

Within the above limitation, setpoint concentrations may now be calculated for the two effluent monitors. Because they are primarily sensitive to gamma radiation, their setpoints will be based on the concentrations of gamma emitting radionuclides as follows:

2.1.4.3.1 For RM-L3, Steam Generator Blowdown Discharge initial monitor, and RML-10, Steam Generator Blowdown Discharge final monitor:

$$c_{Sa} \text{ or } c_{Sb} \leq \left| \sum_g C_g \right|_S + CF_S \quad (30)$$

Where:

$\left[\sum_g C_g \right]_S$ = The isotopic concentration of the Steam Generator Blowdown effluent as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in uCi/ml.

CF_S = The Steam Generator Blowdown Effluent Concentration Factor from equation (29).

*See GENERAL NOTE under 2.1.

CO3→ 2.1.4.4 Turbine Building Sump (Abnormal Conditions)

Provided circulating water is available, 1 to 3 circulating water pumps, effluent exceeding 0.5 MPC may be released from the Turbine Building sump to the industrial and sanitary waste system, using the setpoint in this section, provided the following conditions are met:

- 1) Instantaneous release rate limits of ODCM Specification 1.1.2.1 are not exceeded in the circulating water discharge canal.
- 2) The average radionuclide concentration in the industrial and sanitary waste system (Pond 6B or 008) will not exceed 1.0 MPC when averaged over one year.
- 3) The limits of ODCM specification 1.1.4.1 will not be exceeded with actual liquid effluent releases over a 31 day period.
- 4) Average discharge flow does not exceed values used in setpoint determination.

In addition, the source of radioactivity should be identified and isolated. Radionuclide concentration in Turbine Building sump effluent should be restored to <0.5 MPC as soon as possible and normal setpoint reestablished. Radionuclide concentration in Pond 6B and 008 should be restored to < LLD (excluding tritium) using dilution as necessary (normal flow from the TBS would normally be adequate). Turbine Building sump samples should be obtained and analyzed every eight hours while the alternate setpoint is being used to ensure that the setpoint remains conservative with respect to the isotopic mixture and to ensure offsite doses are within ODCM limits.

Alternate setpoint methodology for Turbine Building sump (RM-L8) is available to ensure operational flexibility in the event radioactivity is detected in the Turbine Building sump > 0.5 MPC and release would result in minimal offsite dose. The alternate setpoint methodology is not intended to be used continuously. To remove restrictions on operation of circulating water, pond concentrations should be restored to < LTD as soon as possible. The setpoint methodology follows:

2.1.4.4.1 For RM-L8, Turbine Building Sump (alternate methodology)

$$C_T \leq \frac{\sum C_B}{CF_T} \times \frac{1}{F_k} \quad (57)$$

where,

F_k = The near field dilution factor for C_i during release from Turbine Building sump.
 = $\frac{\text{(average undiluted waste flow)}}{\text{(average flow from discharge structure)}}$

For purpose of implementing section 2.1.4.4 release condition 2, the following must be satisfied.

$$\frac{\sum_{j=1}^n \left\{ \left[\sum_{i=1}^x (C_i / MPC_i) \right]_{T_j} * V_j \right\}}{\sum_{j=1}^n V_j} < 1.0 \quad (58)$$

where $[\sum(C_i / MPC_i)]_{T_j}$ = the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Turbine Building sump effluent for release permit j , including proposed permit,

V_j = Release volume for Turbine Building sump release permit j (gal), and

j = index for batch release permits during the calendar year.

2.1.4.5 Turbine Building Sump - Special Considerations During Station Shutdowns


During periods in which circulating water (CW) is not available for diluting Turbine Building Sump (TBS) discharges, effluent from the TBS may be directed to a non-releasing pond and offsite dose calculations required by Specification 1.1.3.1 deferred until CW is restored. RM-L8 setpoint requirement specified by Specification 1.1.1.1 is not applicable when directing water from the TBS to a non-releasing ISWTS pond provided the following conditions are met.

- 1) Sufficient freeboard is available in the non-releasing pond to ensure that pond contents will not be released to the CW discharge canal prior to reestablishing CW flow.
- 2) Release of ISWTS contents will be in compliance with Specifications 1.1.2.1, 1.1.3.1 and 1.1.4.1 once CW flow has been reestablished.
- 3) ISWTS pond radioactivity will not exceed 1 MPC.
- 4) TBS samples are obtained and analyzed every 8 hours while water is being directed to a non-releasing pond.

Once samples have been obtained and release acceptability determined, RM-L8 setpoint may be increased to 2 times indication to allow release of sump contents to a non-releasing pond.

Demonstrating compliance with item 3 can be performed by calculations using TBS samples and discharge volumes or by sampling ISWTS ponds.

Figure 2.1-1
Example Liquid Effluent Monitor
Calibration Curve

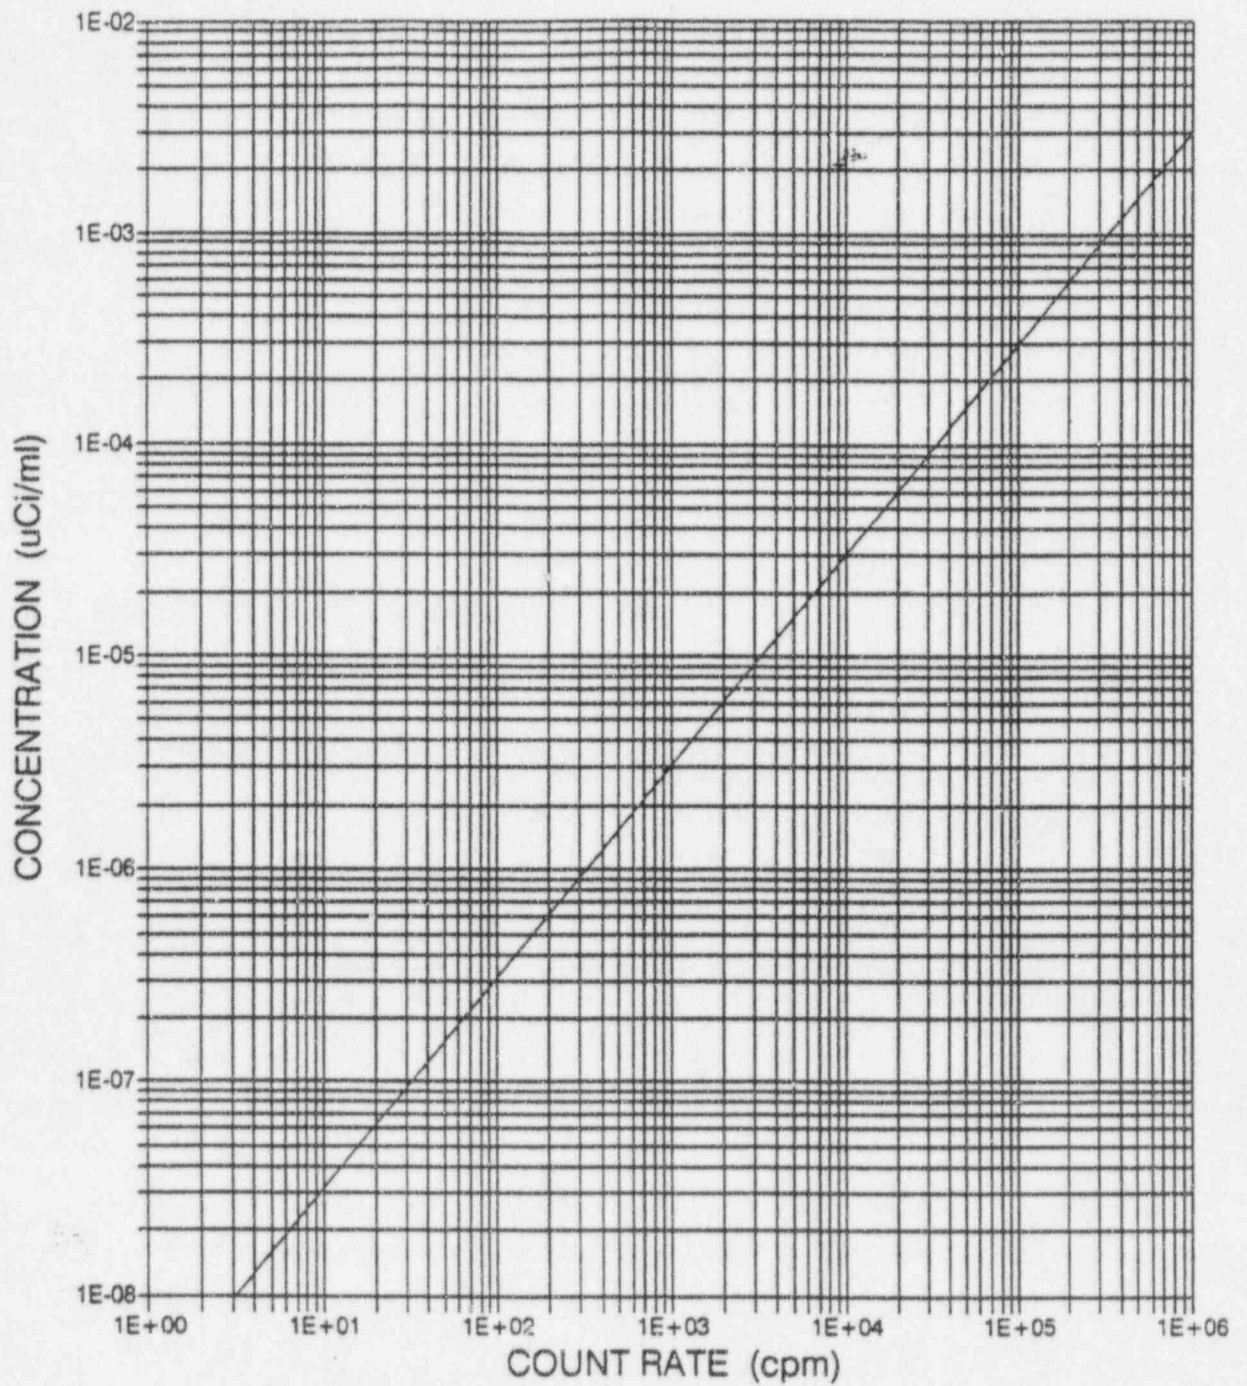

2.2 Dose Calculation For Liquid Effluents

The method of this section is to be used in all cases for calculating doses to individuals from routine liquid effluents. Four notes at the end of the section confirm the values which certain parameters are to be assigned in some special cases.

2.2.1 Liquid Effluent Dose Calculation Parameters

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
$A_{i\tau}$	= the site related ingestion dose commitment factor to the total body or any organ τ , for each identified principal gamma and beta emitter listed in Table 2.2-3 in mrem-ml per hr- μ Ci.	2.2.2
BF_i	= Bioaccumulation Factor for nuclide i , in fish, pCi/Kg per pCi/l, from Table 2.2-1.	2.2.2
C_{ik}	= the average concentration of radionuclide, i , in undiluted liquid effluent during time period Δt_k from any liquid released, in μ Ci/ml.	2.2.2
$DF_{i\tau}$	= a dose conversion factor for nuclide, i , for adults in preselected organ, τ , in mrem/pCi found in Table 2.2-2.	2.2.2
D_τ	= the cumulative dose commitment to the total body or any organ, τ , from the liquid effluents for the total time period, $\sum \Delta t_k$ in mrem (Ref. 1).	2.2.2
D_w	= Dilution Factor from the near field area within one-quarter mile of the release points to the potable water intake for adult water consumption; for V. C. Summer, $D_w = 1$.	2.2.2
F_k	= the near field average dilution factor for C_{ik} during any liquid effluent release.	2.2.2
K_o	= 1.14×10^5 , units conversion factor = $(10^6 \text{ pCi}/\mu\text{Ci}) (10^3 \text{ ml/l}) \div 8760 \text{ hr/yr}$	2.2.2

Liquid Effluent Dose Calculation Parameters (continued)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
Δt_k	= the length (in hours) of a time period over which concentrations and flow rates are averaged for dose calculations.	2.2.2
U_f	= 21 kg/yr, fish consumption (adult) (Reference 3).	2.2.2
U_w	= 730 kg/yr, water consumption (adult) (Reference 3).	2.2.2
Z	= applicable near-field dilution factor when no additional dilution is to be considered; $Z = 1$.	2.2.2

2.2.2 Methodology

The dose contribution from all radionuclides identified in liquid effluents released to unrestricted areas is calculated using the following expression:

$$D_{\tau} = \sum_i \left[A_{it} \sum_{k=1} \Delta t_k C_{ik} F_k \right] \quad (31)$$

$$A_{it} = K_o ((U_w/D_w) + U_f B F_i) D F_{it} \quad (32)$$

$$F_k = \frac{\text{(average undiluted liquid waste flow)}}{\text{(average flow from the discharge structure) } (Z)} \quad (33)$$

NOTE 1: If radioactivity in the Monticello Reservoir (C_{ir}) becomes > the LLD specified in ODCM, Table 1.1-4, that concentration must be included in the Dose determination. For this part of the dose calculation, $F_k = 1$ and $\Delta t_k =$ the entire time period for which the dose is being calculated.

NOTE 2: Prior to termination of Circulating Water Pumps, an assessment of the dose resulting from pond radioactivity concentrations and discharge flow rates from the Industrial And Sanitary Waste System (ISWS) will be performed as follows. Sampling of the liquid in the ISWS will be initiated,

and the measured concentrations of radionuclides will be used in the dose calculations with $F_k = 1$ and $\Delta t_k =$ the entire time period for which the dose is being calculated.

NOTE 3: For releases through the ISWS pathway when circulating water is not available, dose projections for ²²⁶assessment of release acceptability should be based on the most representative samples obtained from in plant sumps. Normally sump samples are also used to assess actual release. However, due to the ultraconservative assumptions when circulating water is not available, i.e. dose calculations are based on radioactive material concentration in the discharge stream regardless of release volume, representative samples from the ISWS may be used to evaluate impact of releases.

NOTE 4: During periods when the Circulating Water Pumps are in operation, any releases to the ISWS are to be credited with dilution in Circulating Water for dose calculation purposes, even though such dilution is normally not claimed in the setpoint calculation. When taken in union with the note above, this procedure results in some overestimation of dose to the population because discharges made to the ISWS just before loss of Circulating Water will be counted twice in the dose calculation process.

NOTE 5: If radioactivity in the Service Water becomes $>$ LLD as determined by the analysis required by ODCM, Table 1.1-4, that concentration must be included in the Dose determination. For this part of the dose calculation, $F_k = 1$ and $\Delta t_k =$ the entire time since the last Service Water sample was taken.

TABLE 2.2-1
 BIOACCUMULATION FACTORS*
 (pCi/kg per pCi/liter)

<u>ELEMENT</u>	<u>FRESHWATER FISH</u>
H	9.0E-01
C	4.6E 03
F	1.0E 01
Na	1.0E 02
P	1.0E 05
Cr	2.0E 02
Mn	4.0E 02
Fe	1.0E 02
Co	5.0E 01
Ni	1.0E 02
Cu	5.0E 01
Zn	2.0E 03
Br	4.2E 02
Rb	2.0E 03
Sr	3.0E 01
Y	2.5E 01
Zr	3.3E 00
Nb	3.0E 04
Mo	1.0E 01
Tc	1.5E 01
Ru	1.0E 01
Rh	1.0E 01
Sb	1.0E 00
Te	4.0E 02
I	1.5E 01
Cs	2.0E 03
Ba	4.0E 00
La	2.5E 01
Ce	1.0E 00
Pr	2.5E 01
Nd	2.5E 01
W	1.2E 03
Np	1.0E 01

*Values in Table 2.2-1 are taken from Reference 3, Table A-1.

TABLE 2.2-2

Page 1 of 2

ADULT INGESTION DOSE FACTORS*
(mrem/pCi ingested)

NUCLIDE	BONE	LIVER	T.BODY	THYROID	KIDNEY	LUNG	GI-LLI
H-3	NO DATA	1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07
C-14	2.84E-06	5.68E-07	5.68E-07	5.68E-07	5.68E-07	5.68E-07	5.68E-07
†F-18	6.24E-07	NO DATA	6.92E-08	NO DATA	NO DATA	NO DATA	1.85E-08
NA-24	1.70E-06	1.70E-06	1.70E-06	1.70E-06	1.70E-06	1.07E-06	1.70E-06
P-32	1.93E-04	1.20E-05	7.45E-06	NO DATA	NO DATA	NO DATA	2.17E-05
CR-51	NO DATA	NO DATA	2.66E-09	1.59E-09	5.86E-10	3.53E-09	6.69E-07
MN-54	NO DATA	4.57E-06	8.72E-07	NO DATA	1.36E-06	NO DATA	1.40E-05
MN-56	NO DATA	1.15E-07	2.04E-08	NO DATA	1.46E-07	NO DATA	3.67E-06
FE-55	2.75E-06	1.90E-06	4.43E-07	NO DATA	NO DATA	1.06E-06	1.09E-06
FE-59	4.34E-06	1.02E-05	3.91E-06	NO DATA	NO DATA	2.85E-06	3.40E-05
†CO-57	NO DATA	1.75E-07	2.91E-07	NO DATA	NO DATA	NO DATA	4.44E-06
CO-58	NO DATA	7.45E-07	1.67E-06	NO DATA	NO DATA	NO DATA	1.51E-05
CO-60	NO DATA	2.14E-06	4.72E-06	NO DATA	NO DATA	NO DATA	4.02E-05
NI-63	1.30E-04	9.01E-06	4.36E-06	NO DATA	NO DATA	NO DATA	1.88E-06
NI-65	5.28E-07	6.86E-08	3.13E-08	NO DATA	NO DATA	NO DATA	1.74E-06
CU-64	NO DATA	8.33E-08	3.91E-08	NO DATA	2.10E-07	NO DATA	7.10E-06
ZN-65	4.84E-06	1.54E-05	6.76E-06	NO DATA	1.03E-05	NO DATA	9.70E-06
ZN-69	1.03E-08	1.97E-08	1.37E-09	NO DATA	1.28E-08	NO DATA	2.96E-09
†Zn-69m‡	1.70E-07	4.08E-07	3.37E-08	NO DATA	2.47E-07	NO DATA	2.49E-05
†BR-82	NO DATA	NO DATA	2.26E-06	NO DATA	NO DATA	NO DATA	2.59E-06
BR-83‡	NO DATA	NO DATA	4.02E-08	NO DATA	NO DATA	NO DATA	5.79E-08
BR-84	NO DATA	NO DATA	5.21E-08	NO DATA	NO DATA	NO DATA	4.09E-13
BR-85	NO DATA	NO DATA	2.14E-09	NO DATA	NO DATA	NO DATA	LT E-24**
RB-86	NO DATA	2.11E-05	9.83E-06	NO DATA	NO DATA	NO DATA	4.16E-06
RB-88	NO DATA	6.05E-08	3.21E-08	NO DATA	NO DATA	NO DATA	8.36E-19
RB-89‡	NO DATA	4.01E-08	2.82E-08	NO DATA	NO DATA	NO DATA	2.33E-21
SR-89‡	3.08E-04	NO DATA	8.84E-06	NO DATA	NO DATA	NO DATA	4.94E-05
SR-90‡	7.58E-03	NO DATA	1.86E-03	NO DATA	NO DATA	NO DATA	2.19E-04
SR-91‡	5.67E-06	NO DATA	2.29E-07	NO DATA	NO DATA	NO DATA	2.70E-05
SR-92‡	2.15E-06	NO DATA	9.30E-08	NO DATA	NO DATA	NO DATA	4.26E-05
Y-90	9.62E-09	NO DATA	2.58E-10	NO DATA	NO DATA	NO DATA	1.02E-04
Y-91M‡	9.09E-11	NO DATA	3.52E-12	NO DATA	NO DATA	NO DATA	2.67E-10
Y-91	1.41E-07	NO DATA	3.77E-09	NO DATA	NO DATA	NO DATA	7.76E-05
Y-92	8.45E-10	NO DATA	2.47E-11	NO DATA	NO DATA	NO DATA	1.48E-05
Y-93	2.68E-09	NO DATA	7.40E-11	NO DATA	NO DATA	NO DATA	8.50E-05
ZR-95‡	3.04E-08	9.75E-09	6.60E-09	NO DATA	1.53E-08	NO DATA	3.09E-05
ZR-97‡	1.68E-09	3.39E-10	1.55E-10	NO DATA	5.12E-10	NO DATA	1.05E-04
NB-95	6.22E-09	3.46E-09	1.86E-09	NO DATA	3.42E-09	NO DATA	2.10E-05
†NB-97	5.22E-11	1.32E-11	4.82E-12	NO DATA	1.54E-11	NO DATA	4.87E-08
MO-99‡	NO DATA	4.31E-06	8.20E-07	NO DATA	9.76E-06	NO DATA	9.99E-06

‡Daughter contributions are included (see Reference 13).

†Values taken from Reference 13, Table 4.

*Values other than those footnoted in Table 2.2-2 are taken from Reference 3, Table E-11.

**Less than E-24.

TABLE 2.2-2 (continued)

Page 2 of 2

NUCLIDE	BONE	LIVER	T.BODY	THYROID	KIDNEY	LUNG	GI-LLI
TC-99M	2.47E-10	6.98E-10	8.89E-09	NO DATA	1.06E-08	3.42E-10	4.13E-07
TC-101	2.54E-10	3.66E-10	3.59E-09	NO DATA	6.59E-09	1.87E-10	1.10E-21
RU-103‡	1.85E-07	NO DATA	7.97E-08	NO DATA	7.06E-07	NO DATA	2.16E-05
RU-105‡	1.54E-08	NO DATA	6.08E-07	NO DATA	1.99E-07	NO DATA	9.42E-06
RU-106‡	2.75E-06	NO DATA	3.48E-07	NO DATA	5.31E-06	NO DATA	1.78E-04
AG-110M‡	1.60E-07	1.48E-07	8.79E-08	NO DATA	2.91E-07	NO DATA	6.04E-05
†SB-124	2.80E-06	5.29E-08	1.11E-06	6.79E-09	NO DATA	2.18E-06	7.95E-05
†SB-125	1.79E-06	2.00E-08	4.26E-07	1.82E-09	NO DATA	1.38E-06	1.97E-05
†SB-126	1.15E-06	2.34E-08	4.15E-07	7.04E-09	NO DATA	7.05E-07	9.40E-05
†SB-127	2.58E-07	5.65E-09	9.90E-08	3.10E-09	NO DATA	1.53E-07	5.90E-05
TE-125M	2.68E-06	9.71E-07	3.59E-07	8.06E-07	1.09E-05	NO DATA	1.07E-05
TE-127M‡	6.77E-06	2.42E-06	8.25E-07	1.73E-06	2.75E-05	NO DATA	2.27E-05
TE-127	1.10E-07	3.95E-08	2.38E-08	8.15E-08	4.48E-07	NO DATA	8.68E-06
TE-129M‡	1.15E-05	4.29E-06	1.82E-06	3.95E-06	4.80E-05	NO DATA	5.79E-05
TE-129	3.14E-08	1.18E-08	7.65E-09	2.41E-08	1.32E-07	NO DATA	2.37E-08
TE-131M‡	1.73E-06	8.46E-07	7.05E-07	1.34E-06	8.57E-06	NO DATA	8.40E-05
TE-131‡	1.97E-08	8.23E-09	6.22E-09	1.62E-08	8.63E-08	NO DATA	2.79E-09
TE-132‡	2.52E-06	1.63E-06	1.53E-06	1.80E-06	1.57E-05	NO DATA	7.71E-05
I-130	7.56E-06	2.23E-06	8.80E-07	1.89E-04	3.48E-06	NO DATA	1.92E-06
I-131‡	4.16E-06	5.95E-06	3.41E-06	1.95E-03	1.02E-05	NO DATA	1.57E-06
I-132	2.03E-07	5.43E-07	1.90E-07	1.90E-05	8.65E-07	NO DATA	1.02E-07
I-133‡	1.42E-06	2.47E-06	7.53E-07	3.63E-04	4.31E-06	NO DATA	2.22E-06
I-134	1.06E-07	2.88E-07	1.03E-07	4.99E-06	4.58E-07	NO DATA	2.51E-10
I-135‡	4.43E-07	1.16E-06	4.28E-07	7.65E-05	1.86E-06	NO DATA	1.31E-06
CS-134	6.22E-05	1.48E-04	1.21E-04	NO DATA	4.79E-05	1.59E-05	2.59E-06
CS-136	6.51E-06	2.57E-05	1.85E-05	NO DATA	1.43E-05	1.96E-06	2.92E-06
CS-137‡	7.97E-05	1.09E-04	7.14E-05	NO DATA	3.70E-05	1.23E-05	2.11E-06
CS-138	5.52E-08	1.09E-07	5.40E-08	NO DATA	8.01E-08	7.91E-09	4.65E-13
BA-139	9.70E-08	6.91E-11	2.84E-09	NO DATA	6.46E-11	3.92E-11	1.72E-07
BA-140‡	2.03E-05	2.55E-08	1.33E-06	NO DATA	8.67E-09	1.46E-08	4.18E-05
BA-141‡	4.71E-08	3.56E-11	1.59E-09	NO DATA	3.31E-11	2.02E-11	2.22E-17
BA-142‡	2.13E-08	2.19E-11	1.34E-09	NO DATA	1.85E-11	1.24E-11	3.00E-26
LA-140	2.50E-09	1.26E-09	3.33E-10	NO DATA	NO DATA	NO DATA	9.25E-05
LA-142	1.28E-10	5.82E-11	1.45E-11	NO DATA	NO DATA	NO DATA	4.25E-07
CE-141	9.36E-09	6.33E-09	7.18E-10	NO DATA	2.94E-09	NO DATA	2.42E-05
CE-143‡	1.65E-09	1.22E-06	1.35E-10	NO DATA	5.37E-10	NO DATA	4.56E-05
CE-144‡	4.88E-07	2.04E-07	2.62E-08	NO DATA	1.21E-07	NO DATA	1.65E-04
PR-143	9.20E-09	3.69E-09	4.56E-10	NO DATA	2.13E-09	NO DATA	4.03E-05
PR-144	3.01E-11	1.25E-11	1.53E-12	NO DATA	7.05E-12	NO DATA	4.33E-18
ND-147‡	6.29E-09	7.27E-09	4.35E-10	NO DATA	4.25E-09	NO DATA	3.49E-05
W-187	1.03E-07	8.61E-08	3.01E-08	NO DATA	NO DATA	NO DATA	2.82E-05
NP-239	1.19E-09	1.17E-10	6.45E-11	NO DATA	3.65E-10	NO DATA	2.40E-05

TABLE 2.2-3
 SITE RELATED INGESTION
 DOSE COMMITMENT FACTOR, A_{it}^*
 (mrem/hr per $\mu\text{Ci/ml}$)
 Page 1 of 2

NUCLIDE	BONE	LIVER	T.BODY	THYROID	KIDNEY	LUNG	GI-LLI
H-3	NO DATA	8.96E+00	8.96E+00	8.96E+00	8.96E+00	8.96E+00	8.96E+00
C-14	3.15E+04	6.30E+03	6.30E+03	6.30E+03	6.30E+03	6.30E+03	6.30E+03
F-18	6.69E+01	NO DATA	7.42E+00	NO DATA	NO DATA	NO DATA	1.98E+00
NA-24	5.48E+02	5.48E+02	5.48E+02	5.48E+02	5.48E+02	5.48E+02	5.48E+02
P-32	4.62E+07	2.87E+06	1.79E+06	NO DATA	NO DATA	NO DATA	5.20E+06
CR-51	NO DATA	NO DATA	1.49E+00	8.94E-01	3.29E-01	1.98E+00	3.76E+02
MN-54	NO DATA	4.76E+03	9.08E+02	NO DATA	1.42E+03	NO DATA	1.46E+04
MN-56	NO DATA	1.20E+02	2.12E+01	NO DATA	1.52E+02	NO DATA	3.82E+03
FE-55	8.87E+02	6.13E+02	1.43E+02	NO DATA	NO DATA	3.42E+02	3.52E+02
FE-59	1.40E+03	3.29E+03	1.26E+03	NO DATA	NO DATA	9.19E+02	1.10E+04
CO-57	NO DATA	3.55E+01	5.91E+01	NO DATA	NO DATA	NO DATA	9.01E+02
CO-58	NO DATA	1.51E+02	3.39E+02	NO DATA	NO DATA	NO DATA	3.06E+03
CO-60	NO DATA	4.34E+02	9.58E+02	NO DATA	NO DATA	NO DATA	8.16E+03
NI-63	4.19E+04	2.91E+03	1.41E+03	NO DATA	NO DATA	NO DATA	6.07E+02
NI-65	1.70E+02	2.21E+01	1.01E+01	NO DATA	NO DATA	NO DATA	5.61E+02
CU-64	NO DATA	1.69E+01	7.93E+00	NO DATA	4.26E+01	NO DATA	1.44E+03
ZN-65	2.36E+04	7.50E+04	3.39E+04	NO DATA	5.02E+04	NO DATA	4.73E+04
ZN-69	5.02E+01	9.60E+01	6.67E+00	NO DATA	6.24E+01	NO DATA	1.44E+01
ZN-69m‡	8.28E+02	1.99E+03	1.82E+02	NO DATA	1.20E+03	NO DATA	1.21E+05
BR-82	NO DATA	NO DATA	2.46E+03	NO DATA	NO DATA	NO DATA	2.82E+03
BR-83‡	NO DATA	NO DATA	4.38E+01	NO DATA	NO DATA	NO DATA	6.30E+01
BR-84	NO DATA	NO DATA	5.67E+01	NO DATA	NO DATA	NO DATA	4.45E-04
BR-85	NO DATA	NO DATA	2.33E+00	NO DATA	NO DATA	NO DATA	1.09E-15
RB-86	NO DATA	1.03E+05	4.79E+04	NO DATA	NO DATA	NO DATA	2.03E+04
RB-88	NO DATA	2.95E+02	1.56E+02	NO DATA	NO DATA	NO DATA	4.07E-09
RB-89‡	NO DATA	1.95E+02	1.37E+02	NO DATA	NO DATA	NO DATA	1.13E-11
SR-89‡	4.78E+04	NO DATA	1.37E+03	NO DATA	NO DATA	NO DATA	7.66E+03
SR-90‡	1.18E+06	NO DATA	2.88E+05	NO DATA	NO DATA	NO DATA	3.48E+04
SR-91‡	8.79E+02	NO DATA	3.55E+01	NO DATA	NO DATA	NO DATA	4.19E+03
SR-92‡	3.33E+02	NO DATA	1.44E+01	NO DATA	NO DATA	NO DATA	6.60E+03
Y-90	1.38E+00	NO DATA	3.69E-02	NO DATA	NO DATA	NO DATA	1.46E+04
Y-91M‡	1.30E-02	NO DATA	5.04E-04	NO DATA	NO DATA	NO DATA	3.82E-02
Y-91	2.02E+01	NO DATA	5.39E-01	NO DATA	NO DATA	NO DATA	1.11E+04
Y-92	1.21E-01	NO DATA	3.53E-03	NO DATA	NO DATA	NO DATA	2.12E+03
Y-93	3.83E-01	NO DATA	1.06E-02	NO DATA	NO DATA	NO DATA	1.22E+04
ZR-95‡	2.77E+00	8.88E-01	6.01E-01	NO DATA	1.39E+00	NO DATA	2.82E+03
ZR-97‡	1.53E-01	3.09E-02	1.41E-02	NO DATA	4.67E-02	NO DATA	9.57E+03
NB-95	4.47E+02	2.49E+02	1.34E+02	NO DATA	2.46E+02	NO DATA	1.51E+06
NB-97	3.75E+00	9.49E-01	3.47E-01	NO DATA	1.11E+00	NO DATA	3.50E+03

‡ Daughter contributions are included (see Reference 13).

* Calculated using equation (32) and Tables 2.2-1 and 2.2-2.

TABLE 2.2-3
 SITE RELATED INGESTION
 DOSE COMMITMENT FACTOR, A_{it}^*
 (mrem/h: per μ Ci/ml)
 Page 2 of 2

NUCLIDE	BONE	LIVER	T.BODY	THYROID	KIDNEY	LUNG	GI-LLI
MO-99‡	NO DATA	4.62E+02	8.79E+01	NO DATA	1.05E+03	NO DATA	1.07E+03
TC-99M	2.94E-02	8.32E-02	1.06E+00	NO DATA	1.26E+00	4.07E-02	4.92E+01
TC-101	3.03E-02	4.36E-02	4.28E-01	NO DATA	7.85E-01	2.23E-02	1.31E-13
RU-103‡	1.98E+01	NO DATA	8.54E-01	NO DATA	7.57E+01	NO DATA	2.31E+03
RU-105‡	1.65E+00	NO DATA	6.52E-01	NO DATA	2.13E+01	NO DATA	1.01E+03
RU-106‡	2.95E+02	NO DATA	3.73E+01	NO DATA	5.69E+02	NO DATA	1.91E+04
AG-110M‡	1.42E+01	1.31E+01	7.80E+00	NO DATA	2.58E+01	NO DATA	5.36E+03
SB-124	2.40E+02	4.53E+00	9.50E+01	5.81E-01	NO DATA	1.87E+02	6.81E+03
SB-125‡	1.53E+02	1.71E+00	3.65E+01	1.56E-01	NO DATA	1.18E+02	1.69E+03
SB-126	9.85E+01	2.00E+00	3.55E+01	6.03E-01	NO DATA	6.04E+01	8.05E+03
SB-127	2.21E+01	4.84E-01	8.47E+00	2.65E-01	NO DATA	1.31E+01	5.05E+03
TE-125M	2.79E+03	1.01E+03	3.74E+02	8.39E+02	1.13E+04	NO DATA	1.11E+04
TE-127M‡	7.05E+03	2.52E+03	8.59E+02	1.80E+03	2.86E+04	NO DATA	2.36E+04
TE-127	1.14E+02	4.11E+01	2.48E+01	8.48E+01	4.66E+02	NO DATA	9.03E+03
TE-129M‡	1.20E+04	4.47E+03	1.89E+03	4.11E+03	5.00E+04	NO DATA	6.03E+04
TE-129	3.27E+01	1.23E+01	7.96E+00	2.51E+01	1.37E+02	NO DATA	2.47E+01
TE-131M‡	1.88E+03	8.81E+02	7.34E+02	1.39E+01	8.92E+03	NO DATA	8.74E+04
TE-131‡	2.05E+01	8.57E+00	6.47E+00	1.69E+01	8.98E+01	NO DATA	2.90E+00
TE-132‡	2.62E+03	1.70E+03	1.59E+03	1.87E+03	1.63E+04	NO DATA	8.02E+04
I-130	9.01E+01	2.66E+02	1.05E+02	2.25E+04	4.15E+02	NO DATA	2.29E+02
I-131‡	4.96E+02	7.09E+02	4.06E+02	2.32E+05	1.22E+03	NO DATA	1.87E+02
I-132	2.42E+01	6.47E+01	2.26E+01	2.26E+03	1.03E+02	NO DATA	1.22E+01
I-133‡	1.69E+02	2.94E+02	8.97E+01	4.32E+04	5.13E+02	NO DATA	2.64E+02
I-134	1.26E+01	3.43E+01	1.23E+01	5.94E+02	5.46E+01	NO DATA	2.99E-02
I-135‡	5.28E+01	1.38E+02	5.10E+01	9.11E+03	2.22E+02	NO DATA	1.56E+02
CS-134	3.03E+05	7.21E+05	5.89E+05	NO DATA	2.33E+05	7.75E+04	1.26E+04
CS-136	3.17E+04	1.25E+05	9.01E+04	NO DATA	6.97E+04	9.55E+03	1.42E+04
CS-137‡	3.88E+05	5.31E+05	3.48E+05	NO DATA	1.88E+05	5.99E+04	1.03E+04
CS-138	2.69E+02	5.31E+02	2.63E+02	NO DATA	3.90E+02	3.85E+01	2.27E-03
BA-139	9.00E+00	6.41E-03	2.64E-01	NO DATA	5.99E-03	3.64E-03	1.60E+01
BA-140‡	1.88E+03	2.37E+00	1.23E+02	NO DATA	8.05E-01	1.35E+00	3.88E+03
BA-141‡	4.27E+00	3.30E-03	1.48E-01	NO DATA	3.07E-03	1.87E-03	2.06E-09
BA-142‡	1.98E+00	2.03E-03	1.24E-01	NO DATA	1.72E-03	1.15E-03	2.78E-18
LA-140	3.58E-01	1.80E-01	4.76E-02	NO DATA	NO DATA	NO DATA	1.32E+04
LA-142	1.83E-02	8.33E-03	2.07E-03	NO DATA	NO DATA	NO DATA	6.08E+01
CE-141	8.01E-01	5.42E-01	6.15E-02	NO DATA	2.52E-01	NO DATA	2.07E+03
CE-143‡	1.41E-01	1.04E+02	1.16E-02	NO DATA	4.60E-02	NO DATA	3.90E+03
CE-144‡	4.18E+01	1.77E+01	2.24E+00	NO DATA	1.04E+01	NO DATA	1.41E+04
PR-143	1.32E+00	5.28E-01	6.52E-02	NO DATA	3.05E-01	NO DATA	5.77E+03
PR-144	4.31E-03	1.79E-03	2.19E-04	NO DATA	1.01E-03	NO DATA	6.19E-10
ND-147‡	9.00E-01	1.04E+00	6.22E-02	NO DATA	6.08E-01	NO DATA	4.99E+03
W-187	3.04E+02	2.55E+02	8.90E+01	NO DATA	NO DATA	NO DATA	8.34E+04
NP-239	1.28E-01	1.25E-02	6.91E-03	NO DATA	3.91E-02	NO DATA	2.57E+03

Figure 2.2-1
LIQUID RADWASTE TREATMENT SYSTEM

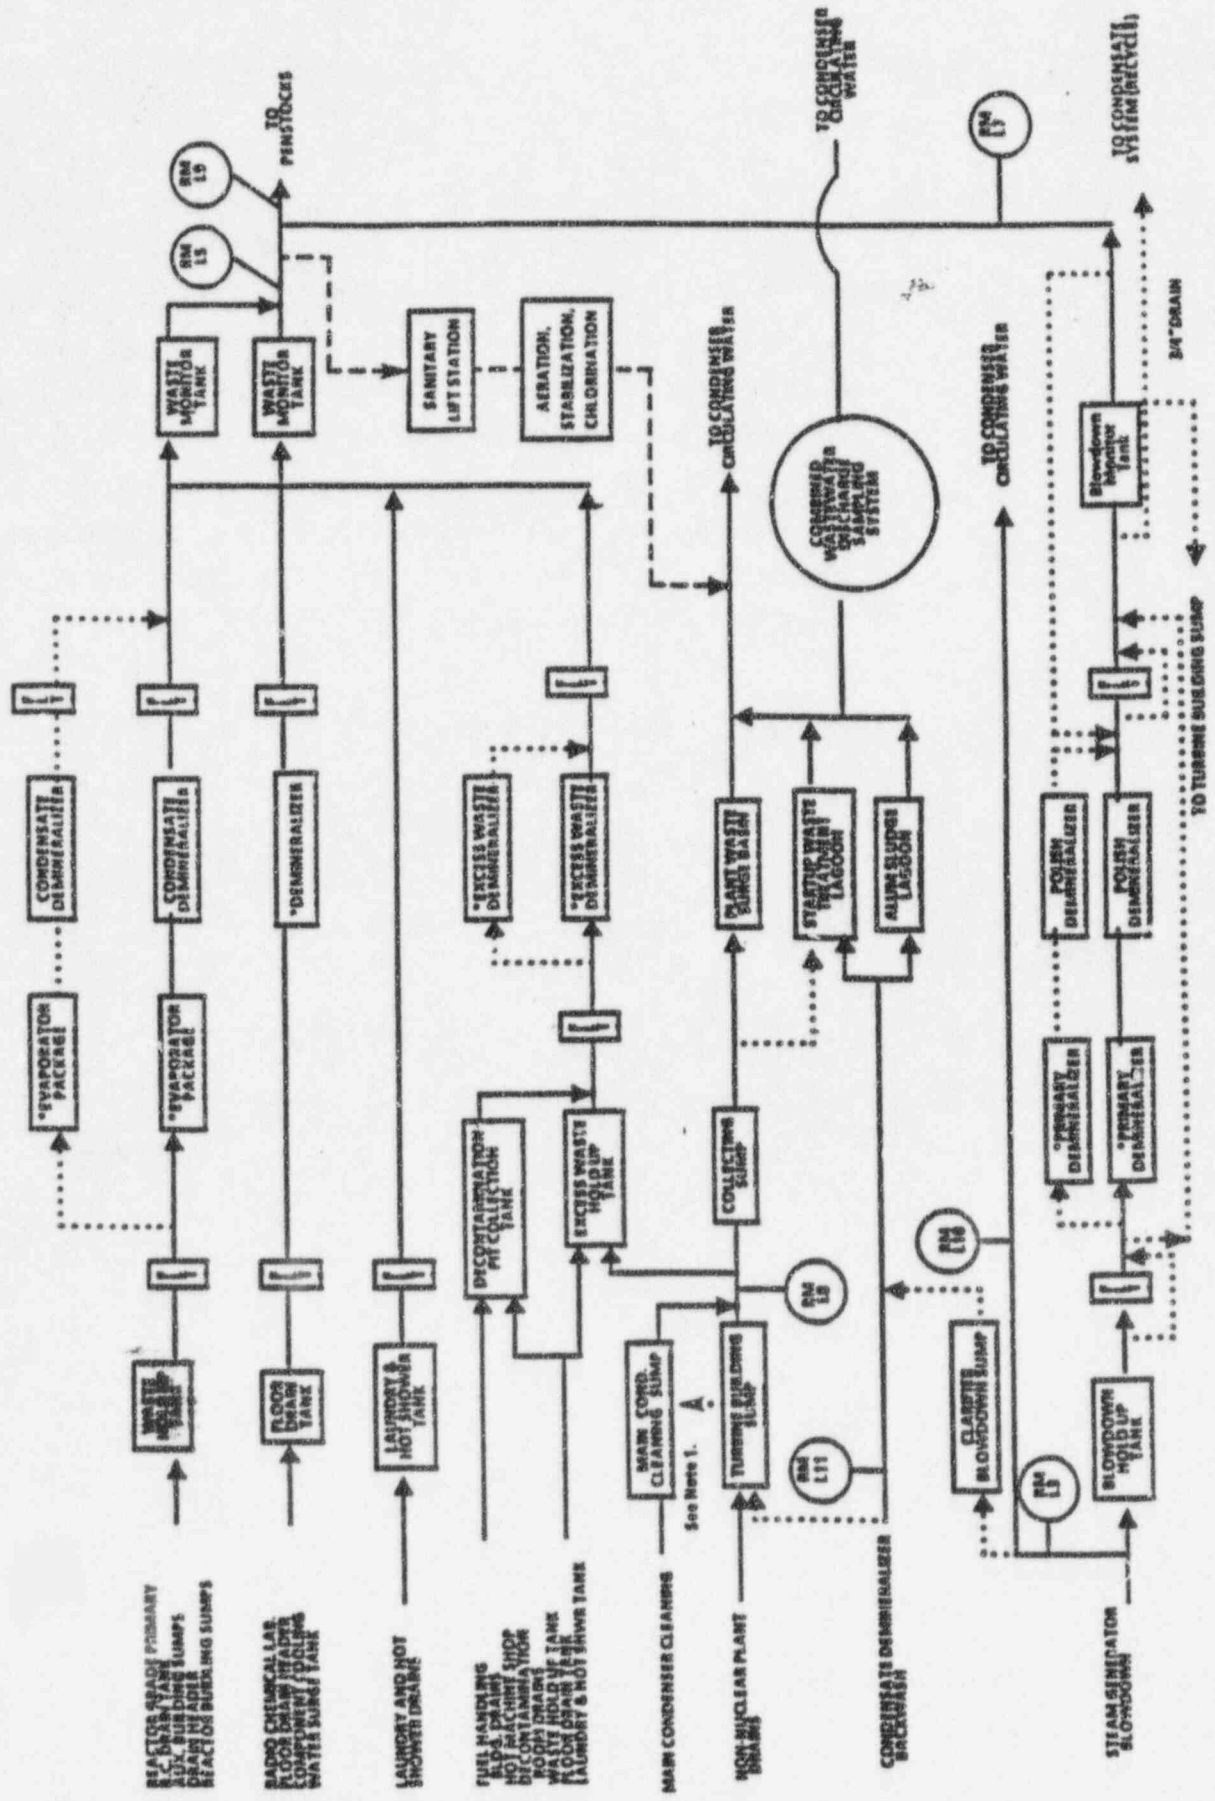


FIGURE 2.2-1

- NOTES: 1. Turbine Building Sump contents may be processed to the main condenser cleaning sump through a portable demineralizer. This is an optional treatment pathway which provides processing flexibility in the event processing through excess liquid waste is not desirable. Since a temporary demineralizer is used for this optional treatment pathway, operability tests specified in ODCM specification 1.1.4.1 are not required. To ensure adequacy of the RM-L8 setpoint while using the alternate process pathway, samples must be obtained from the discharge side of the demineralizers or condenser cleaning sump and analyzed every eight hours.

3.0 GASEOUS EFFLUENT

3.1 Gaseous Effluent Monitor Setpoints

The calculated setpoint values will be regarded as upper bounds for the actual setpoint adjustments. That is, setpoint adjustments are not required to be performed if the existing setpoint level corresponds to a lower count rate than the calculated value. Setpoints may be established at values lower than the calculated values, if desired.

Calculated monitor setpoints may be added to the ambient background count rate.

3.1.1 Gaseous Effluent Monitor Setpoint Calculation Parameters

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
C_v =	count rate of a station vent monitor corresponding to grab sample radionuclide concentrations, X_{iv} , as determined from the monitor's calibration curve, in cpm.	(3.1.2)
C'_v =	the count rate of the monitor on vent v corresponding to X'_v uCi/cc of Xe-133, in cpm.	(3.1.4)
c =	count rate of the gas decay system monitor for measured radionuclide concentrations corrected to discharge pressure, in cpm.	(3.1.3)
c' =	the count rate of the waste gas decay system monitor corresponding to the total noble gas concentration in cpm.	(3.1.4)
D_{SS} =	limiting dose rate to the skin (3000 mrem/year).	(3.1.2)
D_{TB} =	limiting dose rate to the total body (500 mrem/year).	(3.1.2)
F_v =	the flow rate in vent v (cc/sec) (1 cc/sec = 0.002119 cfm).	(3.1.2)
f_s =	the maximum permissible waste gas discharge rate, based on the actual radionuclide mix and skin dose rate (cc/sec).	(3.1.3)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
f_t =	the maximum permissible waste gas discharge rate, based on the actual radionuclide mix and total body dose rate (cc/sec).	(3.1.3)
f_w =	the maximum permissible waste gas discharge rate, the lesser of f_s and f_t (cc/sec).	(3.1.3)
f'_s =	the conservative maximum permissible waste gas discharge rate based on Kr-89 skin dose rate (cc/sec).	(3.1.4)
f'_t =	the conservative maximum permissible waste gas discharge rate based on Kr-89 total body dose rate (cc/sec).	(3.1.4)
K_i =	total body dose factor due to gamma emissions from isotope i (mrem/year per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.1.2)
$K_{\text{Kr-89}}$ =	total body dose factor for Kr-89, the most restrictive isotope from Table 3.1-1 (mrem/yr per $\mu\text{Ci}/\text{m}^3$).	(3.1.3)
L_i =	Skin dose factor due to beta emissions from isotope i (mrem/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.1.2)
$L_{\text{Kr-89}}$ =	Skin dose factor for Kr-89, the most restrictive isotope, from Table 3.1-1 (mrem/yr per $\mu\text{Ci}/\text{m}^3$).	(3.1.3)
M_i =	air dose factor due to gamma emissions from isotope i (mrad/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.1.2)
$M_{\text{Kr-89}}$ =	air dose factor for Kr-89, the most restrictive isotope, from Table 3.1-1 (mrad/yr per $\mu\text{Ci}/\text{m}^3$).	(3.1.3)
R_s =	count rate per mrem/yr to the skin.	(3.1.2)
R_t =	count rate per mrem/yr to the total body.	(3.1.2)
R'_s =	conservative count rate per mrem to the skin (Xe-133 detection, Kr-89 dose).	(3.1.4)
R'_t =	conservative count rate per mrem to the total body (Xe-133 detection, Kr-89 dose).	(3.1.4)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
S_d =	count rate of the waste gas decay system noble gas monitor at the alarm setpoint, in cpm.	(3.1.3)
S_v =	count rate of a station vent noble gas monitor at the alarm setpoint, in cpm.	(3.1.2)
S_{vc} =	count rate of the containment purge noble gas monitor at the alarm setpoint, in cpm.	(3.1.2)
S_{vp} =	count rate of the plant vent noble gas monitor at the alarm setpoint, in cpm.	(3.1.2)
X_{id} =	the concentration of noble gas radionuclide i in a waste gas decay tank, as corrected to the pressure of the discharge stream at the point of its flow measurement in uCi/cc.	(3.1.3)
X_{iv} =	the measured concentration of noble gas radionuclide i in the last grab sample analyzed for vent v in uCi/cc.	(3.1.2)
X_d' =	the total noble gas concentration in a waste gas decay tank, as corrected to the pressure of the discharge stream at the point of its flow measurement in uCi/cc.	(3.1.4)
X_v' =	a concentration of Xe-133 chosen to be in the operating range of the monitor on vent v in uCi/cc.	(3.1.4)
\overline{X}/Q =	the highest annual average relative concentration in any sector, at the site boundary in sec/m ³ .	(3.1.2)
1.1 =	mrem skin dose per mrad air dose	(3.1.2)
0.25 =	the safety factor applied to each of the two vent noble gas monitors (plant vent and containment purge) to assure that the sum of the releases has a combined safety factor of 0.5 which allows a 100 percent margin for cumulative uncertainties of measurements.	(3.1.2)

TABLE 3.1-1

DOSE FACTORS FOR EXPOSURE TO A SEMI-INFINITE CLOUD OF NOBLE GASES, *

Nuclide	γ -Body*** (K _i)	β -Skin*** (L _i)	γ -Air** (M _i)	β -Air** (N _i)
Kr-85m	1.17E + 03****	1.46E + 03	1.23E + 03	1.97E + 03
Kr-85	1.61E + 01	1.34E + 03	1.72E + 01	1.95E + 03
Kr-87	5.92E + 03	9.73E + 03	6.17E + 03	1.03E + 04
Kr-88	1.47E + 04	2.37E + 03	1.52E + 04	2.93E + 03
Kr-89	1.66E + 04	1.01E + 04	1.73E + 04	1.06E + 04
Kr-90	1.56E + 04	7.29E + 03	1.63E + 04	7.83E + 03
Xe-131m	9.15E + 01	4.76E + 02	1.56E + 02	1.11E + 03
Xe-133m	2.51E + 02	9.94E + 02	3.27E + 02	1.48E + 03
Xe-133	2.94E + 02	3.06E + 02	3.53E + 02	1.05E + 03
Xe-135m	3.12E + 03	7.11E + 02	3.36E + 03	7.39E + 02
Xe-135	1.81E + 03	1.86E + 03	1.92E + 03	2.46E + 03
Xe-137	1.42E + 03	1.22E + 04	1.51E + 03	1.27E + 04
Xe-138	8.83E + 03	4.13E + 03	9.21E + 03	4.75E + 03
Ar-41	8.84E + 03	2.69E + 03	9.30E + 03	3.28E + 03

*Values taken from Reference 3, Table B-1

** $\frac{\text{mrad-m}^3}{\mu\text{Ci-yr}}$

*** $\frac{\text{mrem-m}^3}{\mu\text{Ci-yr}}$

**** $1.17E + 03 = 1.17 \times 10^3$

CO1+ 3.1.2 Station Vent Noble Gas Monitors (RM-A3 and RM-A4)

For the purpose of implementation of section 1.2.1 of the ODCM, the alarm setpoint level for the station vent noble gas monitors will be calculated as follows:

S_v = count rate of the plant vent noble gas monitor (= S_{vp} for RM-A3) or the containment purge noble gas monitor (= S_{vc} for RM-A4) at the alarm setpoint level.

$$0.25 \times R_t \times D_{TB} \quad (34)$$

≡ the lesser of or

$$0.25 \times R_s \times D_{SS} \quad (35)$$

0.25 = the safety factor applied to each of the two vent noble gas monitors (plant vent and containment purge) to assure that the sum of the releases has a combined safety factor of 0.5 which allows a 100 percent margin for cumulative uncertainties of measurements.

D_{TB} = Dose rate limit to the total body of an individual
= 500 mrem/yr

R_t = count rate per mrem/yr to the total body
= $C_v / ((\overline{X/Q}) \times F_v \times \sum_i K_i X_{iv})$ (36)

D_{SS} = Dose rate limit to the skin of the body of an individual in an unrestricted area.
= 3000 mrem/year.

R_s = count rate per mrem/yr to the skin.
= $C_v \div [\overline{X/Q} \times F_v \times \sum_i (L_i + 1.1 M_i) X_{iv}]$ (37)

X_{iv} = the measured concentration of noble gas radionuclide i in the last grab sample analyzed for vent v , $\mu\text{Ci/ml}$. (For the plant vent, grab samples are taken at least

monthly. For the 6" and 36" containment purge lines, the sample is taken just prior to the release and also monthly, if the release is continuous.)

F_v = the flow rate in vent v, cc/sec. (1 cc/sec = 0.002119 cfm)
 C_v = count rate, (cpm) of the monitor on station vent v corresponding to grab sample noble gas concentrations, X_{iv} , as determined from the monitor's calibration curve. i.e. product of the monitor response curve slope ($^{cpm}/\mu Ci/ml$) and the sum of the noble gas concentrations in the grab sample ($\mu Ci/ml$). (Initial calibration curves of the type shown in Figure 2.1-1 have been determined conservatively from families of response curves supplied by the monitor manufacturers. As releases occur, a historical correlation will be prepared and placed in service when sufficient data are accumulated.)

$\overline{X/Q}$ = the highest annual average relative concentration in any sector, at the site boundary (seven year average).

= $6.3E-6$ sec/ m^3 in the ENE sector.

K_i = total body dose factor due to gamma emissions from isotope i (mrem/yr per $\mu Ci/m^3$) from Table 3.1-1.

L_i = skin dose factor due to beta emissions from isotope i (mrem/yr per $\mu Ci/m^3$) from Table 3.1-1.

1.1 = mrem skin dose per mrad air dose.

M_i = air dose factor due to gamma emissions from isotope i (mrad/yr per $\mu Ci/m^3$) from Table 3.1-1.

NOTE: At plant startups when no grab sample analysis is available for the continuous releases, the Alternate Methodology of Section 3.1.4 must be used.

3.1.3 Waste Gas Decay System Monitor (RM-A10)

The permissible conditions for discharge through the waste gas decay system monitor (RM-A10) will be calculated in a manner similar to that for the plant vent noble gas monitor. In the case of the waste gas system, however, the discharge flow rate is continuously controllable by valve HCV-014 and permissible release conditions are therefore defined in terms of both flow rate and concentration. Therefore, RM-A10 is used only to insure that a representative sample was obtained.

For operational convenience, (to prevent spurious alarms due to fluctuations in background) the setpoint level will be established at 1.5 times the measured waste concentration.

The maximum permissible flow rate will be set on the same basis but include the engineering safety factor of 0.5. The RM-A10 setpoint level S_d is defined as:

$$S_d \leq 1.5c \quad (38)$$

where:

c = count rate in CPM of the waste gas decay system monitor corresponding to the measured concentration (taken from the monitor calibration curves).

The maximum permissible waste gas flow rate f_w (cc/sec) is calculated from the maximum permissible dose rates at the site boundary according to:

$$f_w \cong \text{the lesser of } f_t \text{ or } f_s \quad (39)$$

f_t = the maximum permissible discharge rate based on total body dose rate.

$$= 0.25 \times D_{TB} / [\overline{X/Q} \times 1.5 \sum_i X_{id} K_i] \quad (40)$$

f_s = the maximum permissible discharge rate based on skin dose rate.

$$= 0.25 \times D_{SS} / [\overline{X/Q} \times 1.5 \sum_i X_{id} (L_i + 1.1M_i)] \quad (41)$$

X_{id} = the concentration of noble gas radionuclide i in the waste gas decay tank whose contents are to be discharged, as corrected to the pressure of the discharge stream at the point of the flow rate measurement. The maximum discharge pressure as governed by the diaphragm valve, 7896, is 30 psia.

NOTE: The factor of 1.5 in the denominators of equations (40) and (41) places f_w on the same basis as S_d .

When a discharge is to be conducted, valve HCV-014 is to be opened until (a) the waste gas discharge flow rate reaches $0.9 \times f_w$ or (b) the count rate of the plant vent noble gas monitor RM-A3 approaches its setpoint, whichever of the above conditions is reached first.

When no discharges are being made from the Waste Gas Decay System, the RM-A10 setpoint should be established as near background as practical to prevent spurious alarms and yet alarm in the event of an inadvertent release.

3.1.4 Alternative Methodology for Establishing Conservative Setpoints

As an alternate to the methodology of section 3.1.2, to minimize necessity for frequent adjustment of setpoint, a conservative setpoint may be calculated as follows:

For a plant vent:

R_c' = conservative count rate per mrem/yr to the total body (Xe-133 detection, Kr-89 dose).

$$= C_v' + [\overline{X/Q} \times K_{Kr-89} \times X_v' \times F_v], \quad (42)$$

where:

X_v' = a concentration of Xe-133 chosen to be in the operating range of the monitor on vent v, $\mu\text{Ci/cc}$.

C_v' = the count rate in CPM of the monitor on vent v corresponding to X_v' $\mu\text{Ci/cc}$ of Xe-133.

K_{Kr-89} = total body dose factor for Kr-89, the most restrictive isotope from Table 3.1-1.

R_s' = count rate per mrem/yr to the skin.

$$= C_v' + [\overline{X/Q} \times (L_{Kr-89} + 1.1M_{Kr-89}) \times X_v' \times F_v] \quad (43)$$

where:

L_{Kr-89} = skin dose factor for Kr-89, the most restrictive isotope from Table 3.1-1.

M_{Kr-89} = air dose factor for Kr-89, the most restrictive isotope, from Table 3.1-1.

For the waste gas decay system:

f_t' = the conservative maximum permissible discharge rate based on Kr-89 total body dose rate.

$$= 0.25 \times D_{TB} + [\overline{X/Q} \times 1.5 \times X_d' \times K_{Kr-89}] \quad (44)$$

f_s' = the conservative maximum permissible discharge rate based on Kr-89 skin dose rate.

$$= 0.25 \times D_{SS} + [\overline{X/Q} \times 1.5 \times X_d' \times (L_{Kr-89} + 1.1M_{Kr-89})] \quad (45)$$

X_d' = the total concentration of noble gas radionuclides in the waste gas decay tank whose contents are to be discharged, as corrected to the pressure of the discharge stream at the point of the flow measurement.

c' = count rate in cpm of the waste gas decay system monitor corresponding to X_d' $\mu\text{Ci/cc}$ of Kr-85.

3.1.5

Oil Incineration

3.1.5.1 Releases from the oil incinerator will be limited such that

$$\overline{X/Q}_{(oil)} \sum P_i Q_{(oil)} < 1.5 \text{ mrem/yr.}$$

Eq. (60)

where:

$\overline{X/Q}_{(oil)}$ = highest annual average dispersion coefficient (sec/m^3) at the site boundary

$$= 3.3\text{E-}5 \text{ sec/m}^3$$

P_i = dose parameter for radionuclide i for inhalation, from Table 3.2-1 (mrem / yr per uCi/m^3),

$$Q_{(oil)} = C_{i(oil)} \times R$$

where:

$C_{i(oil)}$ = concentration of radionuclide i in oil (uCi/ml), and

R = burn rate (ml/s).

3.1.5.2 Incinerator operation will be administratively controlled such that the combination of gaseous releases from the station and oil incineration will be less than Specifications 1.2.2.1(b) and 1.2.5.1. If noble gases are detected in waste oil, an assessment of release acceptability should be performed using the general methodology described in sections 3.2.2.1 and 3.2.3.1.

3.1.6

Meteorological Release Criteria for Batch Releases

Planned gaseous batch releases (WGDT) and oil incineration will be performed during favorable meteorology. Limiting releases to favorable meteorology provides assurance that release conditions will be conservative with respect to annual average dispersion values ($\overline{X/Q}$, $\overline{X/Q}'$). Favorable meteorology is defined in Table 3.1-2.

Table 3.1-2


Favorable Meteorology

Differential Temperature (ΔT) ¹ °F		Stability Class	Wind Speed ² (mph)	
61m - 10m	40m - 10m		10m	61m
$\Delta T \leq -1.74$	$\Delta T \leq -1.03$	A	*	*
$-1.74 < \Delta T \leq -1.56$	$-1.03 < \Delta T \leq -0.92$	B	*	*
$-1.55 < \Delta T \leq -1.38$	$-0.92 < \Delta T \leq -0.81$	C	1.3	1.6
$-1.38 < \Delta T \leq -0.46$	$-0.81 < \Delta T \leq -0.27$	D	3.1	4.1
$-0.46 < \Delta T \leq 1.38$	$-0.27 < \Delta T \leq 0.81$	E	3.5	6.6
$1.38 < \Delta T \leq 3.67$	$0.81 < \Delta T \leq 2.16$	F	5.2	14.0
$3.67 < \Delta T$	$2.16 < \Delta T$	G	7.0	18.9

Notes:

- 1 The ΔT values for 61m - 10m are considered as primary indicators for determination of stability class. The 40m - 10m ΔT values are used only when 61m - 10m values are not available. All ΔT values are listed in °F and are based on values in USNRC Regulatory Guide 1.23.
 - 2 The 10m wind speed is considered the primary indication for windspeed. The 61m wind speed indication should only be used if 10m is not available.
- * No wind is required for planned releases.

Figure 3.1-1
Example Noble Gas Monitor
Calibration Curve

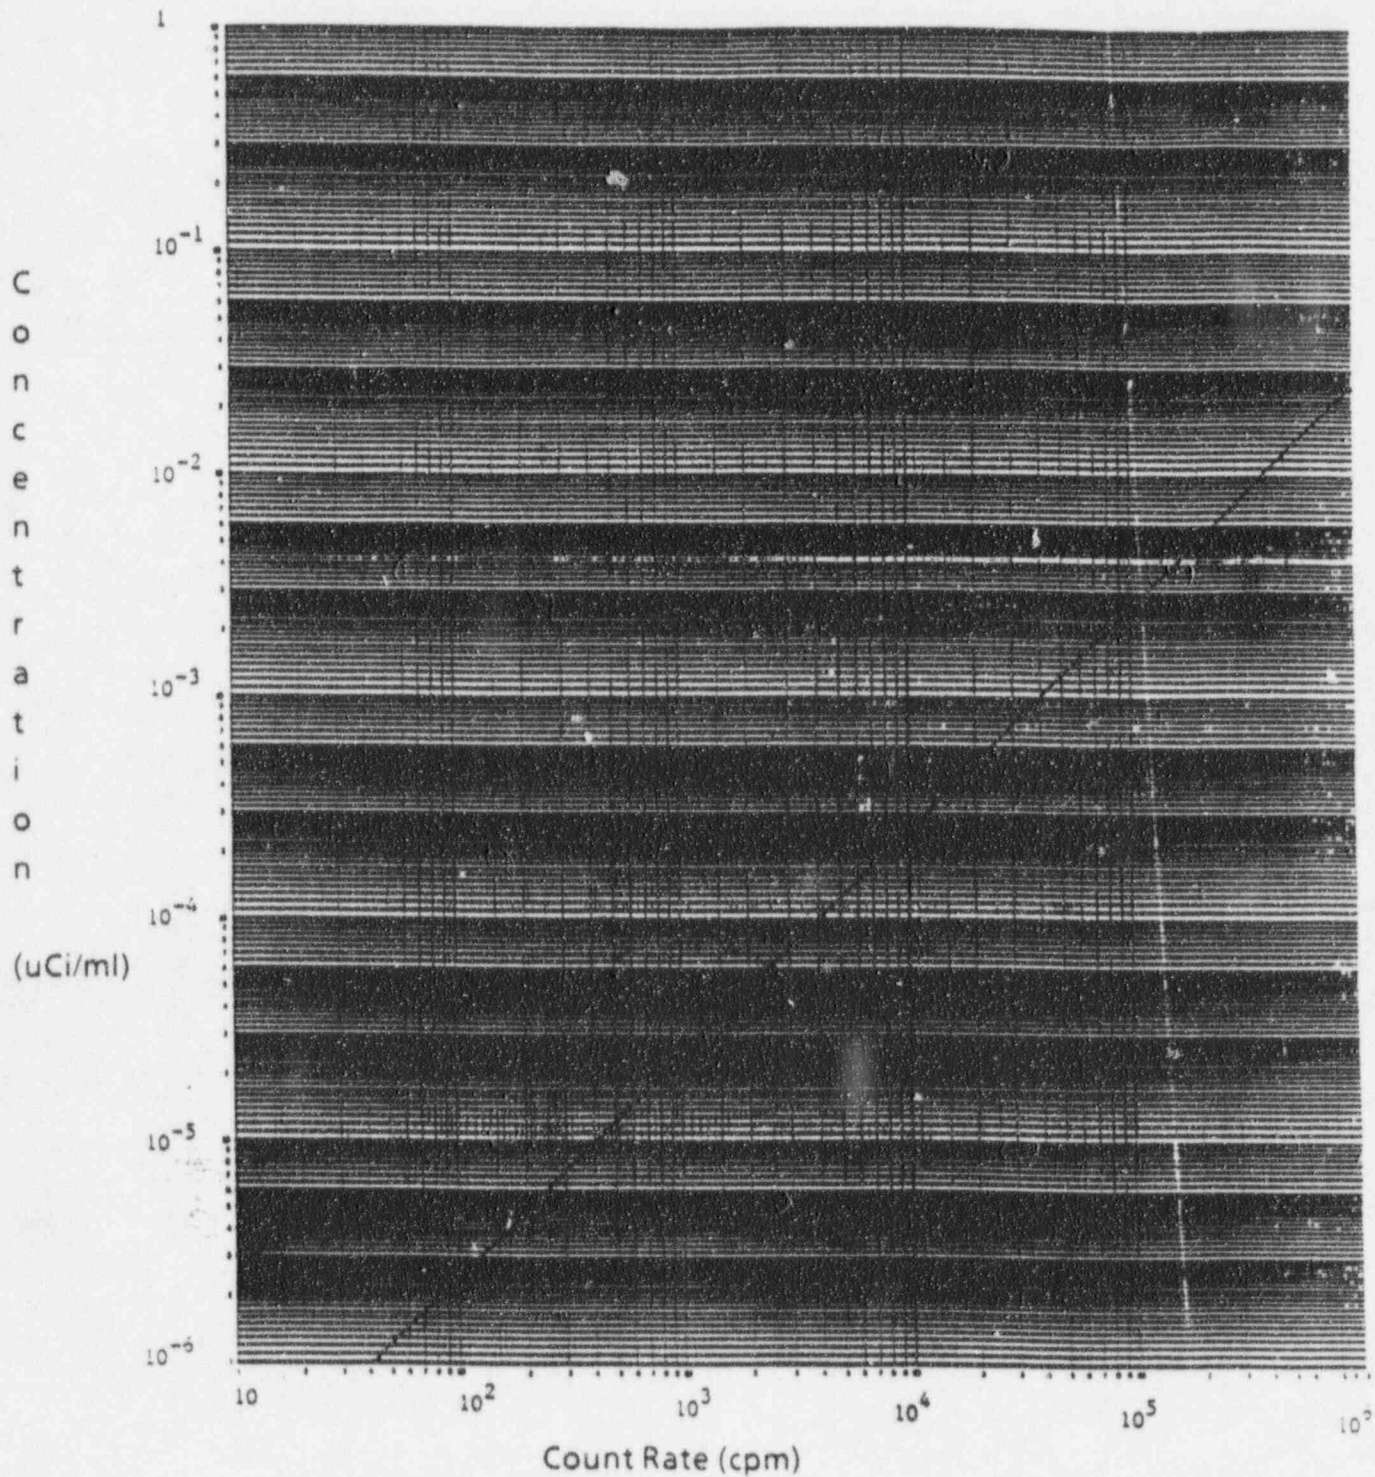

3.2 Dose Calculation for Gaseous Effluent

3.2.1 Gaseous Effluent Dose Calculation Parameters

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
D_o =	average organ dose rate in the current year (mrem/yr).	(3.2.2.2)
D_p =	dose to an individual from radioiodine and radionuclides in particulate form and radionuclides (other than noble gases), with half-lives greater than eight days (mrem).	(3.2.3.2)
D_s =	average skin dose rate in current year (mrem/year).	(3.2.2.1)
D_t =	current total body dose rate (mrem/yr)	(3.2.2.1)
D_β =	air dose due to beta emissions from noble gas radionuclides (mrad).	(3.2.3.1)
D_γ =	air dose due to gamma emissions from noble gas radionuclides (mrad).	(3.2.3.1)
K_i =	total body dose factor due to gamma emissions from isotope i (mrem/year per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.2.2.1)
L_i =	skin dose factor due to beta emissions from noble gas radionuclide i (mrad/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.2.2.1)
M_i =	air dose factor due to gamma emissions from noble gas radionuclide i (mrad/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.2.2.1)
N_i =	air dose factor due to beta emissions from noble gas radionuclide i (mrad per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.2.3.1)
P_i =	dose parameter for radionuclide i , (mrem/yr per $\mu\text{Ci}/\text{m}^3$) for inhalation, from Table 3.2-1.	(3.2.2.2)
\bar{Q}_i =	the release rate of noble gas radionuclide i as determined from the concentrations measured in the analysis of the appropriate sample required by Table 1.2-3 ($\mu\text{Ci}/\text{sec}$).	(3.2.2.1)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
\bar{Q}'_i =	the release rate of non-noble gas radionuclide i as determined from the concentrations measured in the analysis of the appropriate sample required by Table 1.2-3 ($\mu\text{Ci}/\text{sec}$).	(3.2.2.2)
\tilde{Q}_i =	cumulative release of noble gas radionuclide i over the period of interest (μCi).	(3.2.3.1)
\tilde{Q}'_i =	cumulative release of non-noble gas radionuclide i (required by ODCM Specification 1.2.4.1) over the period of interest (μCi).	(3.2.3.2)
R_{ij} =	dose factor for radionuclide i and pathway j, (mrem/yr per $\mu\text{Ci}/\text{m}^3$) or ($\text{m}^2\text{-mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$) from Tables 3.2-2 through 3.2-6.	(3.2.3.2)
W'_{ij} =	relative dispersion parameter for the maximum exposed individual, as appropriate for his exposure pathway j and radionuclide i.	(3.2.3.2)
=	$\bar{X}Q'$ for inhalation and all tritium pathways	
=	\bar{D}/Q' for other pathways and non-tritium radionuclides	
$\bar{X}Q$ =	the highest annual average relative concentration in any sector, at the site boundary in sec/m^3 .	(3.2.2.1)
3.17×10^{-8} =	the fraction of one year per one second	(3.2.3.1)
$\bar{X}Q'$ =	Annual average relative concentration for the location of the maximum exposed individual for the site (sec/m^3).	(3.2.3.2)
\bar{D}/Q' =	Annual average relative deposition for the location of the maximum exposed individual for the site (m^{-2}).	(3.2.3.2)

3.2.2 Unrestricted Area Boundary Dose

3.2.2.1 For the purpose of implementation of section 1.2.2.1a, (≤ 500 mrem/year - total body, ≤ 3000 mrem/year - skin) the dose at the unrestricted area boundary due to noble gases shall be calculated as follows:

$$\begin{aligned} D_t &= \text{current total body dose rate (mrem/yr)} \\ &= \overline{X/Q} \sum_i K_i \overline{Q}_i \end{aligned} \quad (46)$$

$$\begin{aligned} D_s &= \text{current skin dose rate (mrem/yr)} \\ &= \overline{X/Q} \sum_i (L_i + 1.1M_i) \overline{Q}_i \end{aligned} \quad (47)$$

where:

\overline{Q}_i = the release rate of noble gas radionuclide i as determined from the concentration measured in the analysis of the appropriate sample required by Table 1.2-3 ($\mu\text{Ci/sec.}$).

$\overline{X/Q}$ = the highest annual average relative concentration in any sector, at the site boundary (for value, see Section 3.1.2).

K_i , L_i , and M_i will be selected for the appropriate radionuclide from Table 3.1-1.

3.2.2.2 For the purpose of implementation of section 1.2.2.1.b (≤ 1500 mrem/yr - any organ) organ doses due to radioiodines and all radioactive materials in particulate form and radionuclides (other than noble gases) with half-lives greater than eight days, will be calculated as follows:

$$\begin{aligned} D_o &= \text{current organ dose rate (mrem/yr)} \\ &= \sum_i \overline{X/Q} P_i \overline{Q}_i' \end{aligned} \quad (48)$$

where:

$\overline{X/Q}$ = the highest annual average relative concentration in any sector, at the site boundary (for value, see Section 3.1.2)

P_i = dose parameter for radionuclide i , (mrem/yr per $\mu\text{Ci}/\text{m}^3$) for inhalation, from Table 3.2-1.

\overline{Q}_i = the release rate of non-noble gas radionuclide i as determined from the concentrations measured in the analysis of the appropriate sample required by Table 1.2-3 ($\mu\text{Ci}/\text{sec}$).

3.2.3 Unrestricted Area Dose (Air Dose and Dose to Individual)

3.2.3.1 For the purpose of implementation of section 1.2.3.1 (Calendar quarter: ≤ 5 mrad - γ and ≤ 10 mrad - β , Calendar year: ≤ 10 mrad - γ and ≤ 20 mrad - β) and section 1.2.5.1 (air dose averaged over 31 days: ≤ 0.2 mrad - γ and ≤ 0.4 mrad - β), the air dose in unrestricted areas shall be determined as follows:

$$\begin{aligned}
 D\gamma &= \text{air dose due to gamma emissions from noble gas radionuclide } i \text{ (mrad)} \\
 &= 3.17 \times 10^{-8} \sum_i M_i \overline{X/Q} \tilde{Q}_i \quad (49)
 \end{aligned}$$

where:

3.17×10^{-8} = the fraction of one year per one second

\tilde{Q}_i = cumulative release of noble gas radionuclide i over the period of interest (μCi).

$$\begin{aligned}
D_{\beta} &= \text{air dose due to beta emissions from noble gas radionuclide } i \text{ (mrad).} \\
&= 3.17 \times 10^{-8} \sum_i N_i \overline{X/Q} \tilde{Q}_i
\end{aligned}
\tag{50}$$

where, N_i = air dose factor due to beta emission from noble gas radionuclide i (mrad/yr per uCi/m³) from Table 3.1-1.

3.2.3.2 For all gaseous effluents including oil incineration, dose to an individual from radioiodines and radioactive materials in particulate form and radionuclides (other than noble gases), with half-lives greater than eight (8) days (Calendar quarter: ≤ 7.5 mrem any organ, Calendar year: ≤ 15 mrem any organ) will be calculated for the purpose of implementation of section 1.2.4.1 as follows:

$$\begin{aligned}
D_p &= \text{dose to an individual from radioiodines and radionuclides in particulate form, with half-lives greater than eight days (mrem)} \\
&= 3.17 \times 10^{-8} \sum_{ij} R_{ij} W'_{ij} \tilde{Q}'_i
\end{aligned}
\tag{51}$$

where:

W'_{ij} = relative concentration or relative deposition for the maximum exposed individual, as appropriate for exposure pathway j and radionuclide i .

$\overline{X/Q}'$ for inhalation and all tritium pathways
= $3.5 \times 10^{-6} \text{ sec/m}^3$

$\overline{D/Q}'$ for other pathways and non-tritium radionuclides
= $1.1 \times 10^{-8} \text{ m}^{-2}$

(See the notes to Table 3.2-7 and 3.2-8 for the origin of these factors.)

R_{ij} = dose factor for radionuclide i and pathway j , (mrem/yr per $\mu\text{Ci}/\text{m}^3$) or (m^2 - mrem/yr per $\mu\text{Ci}/\text{sec}$) from Table 3.2-2.

\widetilde{Q}_i = Cumulative release of non-noble gas radionuclide i (required by ODCM Specification 1.2.4.1) over the period of interest (μCi).

3.2.4 For the purpose of initial assessments of the impact of unplanned gaseous releases, dose calculations for the critical receptor in each affected sector may be performed using section 3.2.3.1 and section 3.2.3.2 equations as follows:

- (1) For each affected sector, X/Q and D/Q will be calculated for one mile and critical receptor locations using actual meteorological conditions occurring during the unplanned release. Actual X/Q and D/Q values will be compared to annual average dispersion coefficients ($\overline{X/Q}$, $\overline{X/Q}'$, and $\overline{D/Q}'$). The more limiting dispersion coefficients will be used along with methodology in sections 3.2.3.1 and 3.2.3.2 for the initial assessment.
- (2) The location of the critical receptors and the pathways j which should be analyzed are shown in Table 3.2-7. (For very rough calculations, the annual average dispersion coefficients ($\overline{X/Q}$ and $\overline{D/Q}$) for each receptor are shown in Table 3.2-8.)
- (3) The R_{ij} for the appropriate exposure pathways and age groups will be selected from Tables 3.2-3 through 3.2-6.

TABLE 3.2-1
 PATHWAY DOSE FACTORS FOR SECTION 3.2.2.2 (P_i)*

Page 1 of 3

AGE GROUP	(CHILD)
ISOTOPE	INHALATION
H-3	1.125E + 03
C-14	3.589E + 04
NA-24	1.610E + 04
P-32	2.605E + 06
CR-51	1.698E + 04
MN-54	1.576E + 06
MN-56	1.232E + 05
FE-55	1.110E + 05
FE-59	1.269E + 06
CO-58	1.106E + 06
CO-60	7.067E + 06
NI-63	8.214E + 05
NI-65	8.399E + 04
CU-64	3.670E + 04
ZN-65	9.953E + 05
ZN-69	1.018E + 04
BR-83	4.736E + 02
BR-84	5.476E + 02
BR-85	2.531E + 01
RB-86	1.983E + 05
RB-88	5.624E + 02
RB-89	3.452E + 02
SR-89	2.157E + 06
SR-90	1.010E + 08
SR-91	1.739E + 05

*See note, page 3.0-20

Units - mrem/yr per $\mu\text{Ci}/\text{m}^3$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-1
 PATHWAY DOSE FACTORS FOR SECTION 3.2.2.2 (P₁)

Page 2 of 3

AGE GROUP	(CHILD)
ISOTOPE	INHALATION
SR-92	2.424E + 05
Y-90	2.679E + 05
Y-91M	2.812E + 03
Y-91	2.627E + 06
Y-92	2.390E + 05
Y-93	3.885E + 05
ZR-95	2.231E + 06
ZR-97	3.511E + 05
NB-95	6.142E + 05
MO-99	1.354E + 05
TC-99M	4.810E + 03
TC-101	5.846E + 02
RU-103	6.623E + 05
RU-105	9.953E + 04
RU-106	1.476E + 07
AG-110M	5.476E + 06
TE-125M	4.773E + 05
TE-127M	1.480E + 06
TE-127	5.624E + 04
TE-129M	1.761E + 06
TE-129	2.549E + 04
TE-131M	3.078E + 05
TE-131	2.054E + 03
TE-132	3.774E + 05
I-130	1.846E + 06

* See note, page 3.0-20

Units - mrem/yr per $\mu\text{Ci}/\text{m}^3$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-1
 PATHWAY DOSE FACTORS FOR SECTION 3.2.2.2 (P_i)

Page 3 of 3

AGE GROUP	(CHILD)
ISOTOPE	INHALATION
I-131	1.624E + 07
I-132	1.935E + 05
I-133	3.848E + 06
I-134	5.069E + 04
I-135	7.918E + 05
CS-134	1.014E + 06
CS-136	1.709E + 05
CS-137	9.065E + 05
CS-138	8.399E + 02
BA-139	5.772E + 04
BA-140	1.743E + 06
BA-141	2.919E + 03
BA-142	1.643E + 03
LA-140	2.257E + 05
LA-142	7.585E + 04
CE-141	5.439E + 05
CE-143	1.273E + 05
CE-144	1.195E + 07
PR-143	4.329E + 05
PR-144	1.565E + 03
ND-147	3.282E + 05
W-187	9.102E + 04
NP-239	6.401E + 04

NOTE: The P_i values of Table 3.2-1 were calculated according to the methods of Reference 1, Section 5.2.1, for children. The values used for the various parameters and the origins of those values are given in Table 3.2-9 and its notes.

Units - mrem/yr per $\mu\text{Ci}/\text{m}^3$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-2

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.2 (R_i)*

Page 1 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	VEGETATION
H-3	1.125E + 03 (Total Body)	0.000E + 00 (Skin)	3.627E + 03 (Total Body)
C-14	3.589E + 04 (Bone)	0.000E + 00 (Skin)	8.894E + 08 (Bone)
NA-24	1.610E + 04 (Total Body)	3.33E + 08 (Skin)	3.729E + 05 (Total Body)
P-32	2.605E + 06 (Bone)	0.000E + 00 (Skin)	3.366E + 09 (Bone)
CR-51	1.698E + 04 (Lung)	5.506E + 06 (Skin)	6.213E + 06 (GI-LLI)
MN-54	1.576E + 06 (Lung)	1.625E + 09 (Skin)	6.648E + 08 (Liver)
MN-56	1.232E + 05 (GI-LLI)	1.068E + 06 (Skin)	2.723E + 03 (GI-LLI)
FE-55	1.110E + 05 (Lung)	0.000E + 00 (Skin)	8.012E + 08 (Bone)
FE-59	1.269E + 06 (Lung)	3.204E + 08 (Skin)	6.693E + 08 (GI-LLI)
CO-58	1.106E + 06 (Lung)	4.464E + 08 (Skin)	3.771E + 08 (GI-LLI)
CO-60	7.067E + 06 (Lung)	2.532E + 10 (Skin)	2.095E + 09 (GI-LLI)
NI-63	8.214E + 05 (Bone)	0.000E + 00 (Skin)	3.949E + 10 (Bone)
NI-65	8.399E + 04 (GI-LLI)	3.451E + 05 (Skin)	1.211E + 03 (GI-LLI)
CU-64	3.670E + 04 (GI-LLI)	6.876E + 05 (Skin)	5.159E + 05 (GI-LLI)
ZN-65	9.953E + 05 (Lung)	8.583E + 08 (Skin)	2.164E + 09 (Liver)
ZN-69	1.018E + 04 (GI-LLI)	0.000E + 00 (Skin)	9.893E-04 (GI-LLI)
BR-83	4.736E + 02 (Total Body)	7.079E + 03 (Skin)	5.369E + 00 (Total Body)
BR-84	5.476E + 02 (Total Body)	2.363E + 05 (Skin)	3.822E - 11 (Total Body)
BR-85	2.531E + 01 (Total Body)	0.000E + 00 (Skin)	0.000E + 00 (Total Body)
RB-86	1.983E + 05 (Liver)	1.035E + 07 (Skin)	4.584E + 08 (Liver)
RB-88	5.624E + 02 (Liver)	3.779E + 04 (Skin)	4.374E - 22 (Liver)
RB-89	3.452E + 02 (Liver)	1.452E + 05 (Skin)	1.642E - 26 (Liver)
SR-89	2.157E + 06 (Lung)	2.509E + 04 (Skin)	3.593E + 10 (Bone)
SR-90	1.010E + 08 (Bone)	0.000E + 00 (Skin)	1.243E + 12 (Bone)
SR-91	1.739E + 05 (GI-LLI)	2.511E + 06 (Skin)	1.157E + 06 (GI-LLI)

* See note, page 3.0-36

** Reference 1, section 5.3.1, page 30, paragraph 1 explains the logic used in selecting these specific pathways.

*** Critical organs for each pathway by nuclide in parentheses.

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

TABLE 3.2-2 (continued)

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.2 (R_i)

Page 2 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	VEGETATION
SR - 92	2.424E + 05 (GI-LLI)	8.631E + 05 (Skin)	1.378E + 04 (GI-LLI)
Y - 90	2.679E + 05 (GI-LLI)	5.308E + 03 (Skin)	6.569E + 07 (GI-LLI)
Y - 91M	2.812E + 03 (Lung)	1.161E + 05 (Skin)	1.737E - 05 (GI-LLI)
Y - 91	2.627E + 06 (Lung)	1.207E + 06 (Skin)	2.484E + 09 (GI-LLI)
Y - 92	2.390E + 05 (GI-LLI)	2.142E + 05 (Skin)	4.576E + 04 (GI-LLI)
Y - 93	3.885E + 05 (GI-LLI)	2.534E + 05 (Skin)	4.482E + 06 (GI-LLI)
ZR - 95	2.231E + 06 (Lung)	2.837E + 08 (Skin)	8.843E + 08 (GI-LLI)
ZR - 97	3.511E + 05 (GI-LLI)	3.445E + 06 (Skin)	1.248E + 07 (GI-LLI)
NB - 95	6.142E + 05 (Lung)	1.605E + 08 (Skin)	2.949E + 08 (GI-LLI)
MO - 99	1.354E + 05 (Lung)	4.626E + 06 (Skin)	1.647E + 07 (Kidney)
TC - 99M	4.810E + 03 (GI-LLI)	2.109E + 05 (Skin)	5.255E + 03 (GI-LLI)
TC - 101	5.846E + 02 (Lung)	2.277E + 04 (Skin)	4.123E - 29 (Kidney)
RU - 103	6.623E + 05 (Lung)	1.265E + 08 (Skin)	3.971E + 08 (GI-LLI)
RU - 105	9.953E + 04 (GI-LLI)	7.212E + 05 (Skin)	5.981E + 04 (GI-LLI)
RU - 106	1.476E + 07 (Lung)	5.049E + 08 (Skin)	1.159E + 10 (GI-LLI)
AG - 110M	5.476E + 06 (Lung)	4.019E + 09 (Skin)	2.581E + 09 (GI-LLI)
TE - 125M	4.773E + 05 (Lung)	2.128E + 06 (Skin)	3.506E + 08 (Bone)
TE - 127M	1.480E + 06 (Lung)	1.083E + 05 (Skin)	3.769E + 09 (Kidney)
TE - 127	5.624E + 04 (GI-LLI)	3.293E + 03 (Skin)	3.903E + 05 (GI-LLI)
TE - 129M	1.761E + 06 (Lung)	2.312E + 07 (Skin)	2.430E + 09 (GI-LLI)
TE - 129	2.549E + 04 (GI-LLI)	3.076E + 04 (Skin)	7.200E - 02 (GI-LLI)
TE - 131M	3.078E + 05 (GI-LLI)	9.459E + 06 (Skin)	2.163E + 07 (GI-LLI)
TE - 131	2.054E + 03 (Lung)	3.450E + 07 (Skin)	1.349E - 14 (GI-LLI)
TE - 132	3.774E + 05 (Lung)	4.968E + 06 (Skin)	3.111E + 07 (GI-LLI)
I - 130	1.846E + 06 (Thyroid)	6.692E + 06 (Skin)	1.371E + 08 (Thyroid)

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE& G: Revision 13 (June 1990)

3.0-22

TABLE 3.2-2 (continue)

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.2 (R₁)

Page 3 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	VEGETATION
I-131	1.624E + 07 (Thyroid)	2.089E + 07 (Skin)	4.754E + 10 (Thyroid)
I-132	1.935E + 05 (Thyroid)	1.452E + 06 (Skin)	7.314E + 03 (Thyroid)
I-133	3.848E + 06 (Thyroid)	2.981E + 06 (Skin)	8.113E + 08 (Thyroid)
I-134	5.069E + 04 (Thyroid)	5.305E + 05 (Skin)	6.622E - 03 (Thyroid)
I-135	7.918E + 05 (Thyroid)	2.947E + 06 (Skin)	9.973E + 06 (Thyroid)
CS-134	1.014E + 06 (Liver)	8.007E + 09 (Skin)	2.631E + 10 (Liver)
CS-136	1.709E + 05 (Liver)	1.710E + 08 (Skin)	2.247E + 08 (Liver)
CS-137	9.065E + 05 (Bone)	1.201E + 10 (Skin)	2.392E + 10 (Bone)
CS-138	8.399E + 02 (Liver)	4.102E + 05 (Skin)	9.133E - 11 (Liver)
BA-139	5.772E + 04 (GI-LLI)	1.194E + 05 (Skin)	2.950E + 00 (GI-LLI)
BA-140	1.743E + 06 (Lung)	2.346E + 07 (Skin)	2.767E + 08 (Bone)
BA-141	2.919E + 03 (Lung)	4.734E + 04 (Skin)	1.605E - 21 (Bone)
BA-142	1.643E + 03 (Lung)	5.064E + 04 (Skin)	4.105E - 39 (Bone)
LA-140	2.257E + 05 (GI-LLI)	2.180E + 07 (Skin)	3.166E + 07 (GI-LLI)
LA-142	7.585E + 04 (Lung)	9.117E + 05 (Skin)	2.141E + 01 (GI-LLI)
CE-141	5.439E + 05 (Lung)	1.540E + 07 (Skin)	4.082E + 08 (GI-LLI)
CE-143	1.273E + 05 (GI-LLI)	2.627E + 06 (Skin)	1.364E + 07 (GI-LLI)
CE-144	1.195E + 07 (Lung)	8.042E + 07 (Skin)	1.039E + 10 (GI-LLI)
PR-143	4.329E + 05 (Lung)	0.000E + 00 (Skin)	1.575E + 08 (GI-LLI)
PR-144	1.565E + 03 (Lung)	2.112E + 03 (Skin)	3.829E - 23 (GI-LLI)
ND-147	3.282E + 05 (Lung)	1.009E + 07 (Skin)	9.197E + 07 (GI-LLI)
W-187	9.102E + 04 (GI-LLI)	2.740E + 06 (Skin)	5.380E + 06 (GI-LLI)
NP-239	6.401E + 04 (GI-LLI)	1.976E + 06 (Skin)	1.357E + 07 (GI-LLI)

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-3
PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)*

Page 1 of 3

AGE GROUP	(INFANT)	(N.A.)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS-COW MEAT	GRS-COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
H-3	6.468E+02	0.000E+00	2.157E+03	0.000E+00	2.157E+03	0.000E+00	4.398E+03	0.000E+00
C-14	2.646E+04	0.000E+00	2.340E+09	0.000E+00	8.189E+08	0.000E+00	2.340E+09	0.000E+00
NA-24	1.056E+04	1.385E+07	1.542E+07	0.000E+00	2.300E-37	0.000E+00	1.851E+06	0.000E+00
P-32	2.030E+06	0.000E+00	1.602E+11	0.000E+00	7.088E+08	0.000E+00	1.924E+11	0.000E+00
CR-51	1.284E+04	5.506E+06	4.700E+06	0.000E+00	1.729E+05	0.000E+00	5.641E+05	0.000E+00
MN-54	9.996E+05	1.625E+09	3.900E+07	0.000E+00	1.118E+07	0.000E+00	4.680E+06	0.000E+00
MN-56	7.168E+04	1.068E+06	2.862E+00	0.000E+00	0.000E+00	0.000E+00	3.436E-01	0.000E+00
FE-55	8.694E+04	0.000E+00	1.351E+08	0.000E+00	4.439E+07	0.000E+00	1.757E+06	0.000E+00
FE-59	1.015E+06	3.204E+08	3.919E+08	0.000E+00	3.384E+07	0.000E+00	5.096E+06	0.000E+00
CO-58	7.770E+05	4.464E+08	6.055E+07	0.000E+00	8.824E+06	0.000E+00	7.251E+06	0.000E+00
CO-60	4.508E+06	2.532E+10	2.098E+08	0.000E+00	7.107E+07	0.000E+00	2.517E+07	0.000E+00
NI-63	3.388E+05	0.000E+00	3.493E+10	0.000E+00	1.221E+10	0.000E+00	4.192E+09	0.000E+00
NI-65	5.012E+04	3.451E+05	3.020E+01	0.000E+00	0.000E+00	0.000E+00	3.635E+00	0.000E+00
CU-64	1.498E+04	6.876E+05	3.807E+06	0.000E+00	7.934E-46	0.000E+00	4.246E+05	0.000E+00
ZN-65	6.468E+05	8.583E+08	1.904E+10	0.000E+00	5.160E+09	0.000E+00	2.285E+09	0.000E+00
ZN-69	1.322E+04	0.000E+00	3.855E-09	0.000E+00	0.000E+00	0.000E+00	3.581E-10	0.000E+00
BR-83	3.808E+02	7.079E+03	9.339E-01	0.000E+00	0.000E+00	0.000E+00	1.124E-01	0.000E+00
BR-84	4.004E+02	2.363E+05	1.256E-22	0.000E+00	0.000E+00	0.000E+00	1.527E-23	0.000E+00
BR-85	2.044E+01	0.000E+00	0.00E+00	0.000E+00	0.000E+00	0.000E+00	0.000E00	0.000E+00
RB-86	1.904E+05	1.035E+07	2.234E+10	0.000E+00	2.827E+08	0.000E+00	2.671E+09	0.000E+00
RB-88	5.572E+02	3.779E+04	1.874E-44	0.000E+00	0.000E+00	0.000E+00	2.304E-45	0.000E+00
RB-89	3.206E+02	1.452E+05	3.414E-52	0.000E+00	0.000E+00	0.000E+00	4.056E-53	0.000E+00
SR-89	2.030E+06	2.509E+04	1.258E+10	0.000E+00	1.280E+09	0.000E+00	2.643E+10	0.000E+00
SR-90	4.088E+07	0.000E+00	1.216E+11	0.000E+00	4.230E+10	0.000E+00	2.553E+11	0.000E+00
SR-91	7.336E+04	2.511E+06	3.215E+05	0.000E+00	0.000E+00	0.000E+00	6.758E+05	0.000E+00
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

*See note, page 3.0-36

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

TABLE 3.2-3 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 2 of 3

AGE GROUP	(INFANT)	(N.A.)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)
ISOTOPE	INHALATION	GROUND PLANE	GRS-COW MILK	GRS COW MEAT	GRS COW MILK	GRS-GOT MEAT	GRS-GOT MILK	VEGETATION
SR-92	1.400E+05	8.631E+05	5.005E+01	0.000E+00	0.000E+00	0.000E+00	1.054E+02	0.000E+00
Y-90	2.688E+05	5.308E+03	9.406E+05	0.000E+00	2.335E-05	0.000E+00	1.129E+05	0.000E+00
Y-91M	2.786E+03	1.161E+05	1.876E-15	0.000E+00	0.000E+00	0.000E+00	2.290E-16	0.000E+00
Y-91	2.450E+06	1.207E+06	5.251E+06	0.000E+00	6.324E+05	0.000E+00	6.302E+05	0.000E+00
Y-92	1.266E+05	2.142E+05	1.026E+01	0.000E+00	0.000E+00	0.000E+00	1.234E+00	0.000E+00
Y-93	1.666E+05	2.534E+05	1.776E+04	0.000E+00	2.386E-61	0.000E+00	2.046E+03	0.000E+00
ZR-95	1.750E+06	2.837E+08	8.257E+05	0.000E+00	1.090E+05	0.000E+00	9.910E+04	0.000E+00
ZR-97	1.400E+05	3.445E+06	4.446E+04	0.000E+00	4.980E-35	0.000E+00	5.339E+03	0.000E+00
NB-95	4.788E+05	1.605E+08	2.062E+08	0.000E+00	1.213E+07	0.000E+00	2.475E+07	0.000E+00
MO-99	1.348E+05	4.626E+06	3.108E+08	0.000E+00	1.523E-02	0.000E+00	3.731E+07	0.000E+00
TC-99M	2.030E+03	2.109E+05	1.646E+04	0.000E+00	0.000E+00	0.000E+00	1.978E+03	0.000E+00
TC-101	8.442E+02	2.277E+04	1.423E-56	0.000E+00	0.000E+00	0.000E+00	6.530E-58	0.000E+00
RU-103	5.516E+05	1.265E+08	1.055E+05	0.000E+00	7.573E+03	0.000E+00	1.265E+04	0.000E+00
RU-105	4.844E+04	7.212E+05	3.204E+00	0.000E+00	0.000E+00	0.000E+00	3.851E-01	0.000E+00
RU-106	1.156E+07	5.049E+08	1.445E+06	0.000E+00	4.266E+05	0.000E+00	1.734E+05	0.000E+00
AG-110M	3.668E+06	4.019E+09	1.461E+10	0.000E+00	3.984E+09	0.000E+00	1.752E+09	0.000E+00
TE-125M	4.466E+05	2.128E+06	1.508E+08	0.000E+00	1.799E+07	0.000E+00	1.809E+07	0.000E+00
TE-127M	1.312E+06	1.083E+05	1.037E+09	0.000E+00	2.046E+08	0.000E+00	1.244E+08	0.000E+00
TE-127	2.436E+04	3.293E+03	1.359E+05	0.000E+00	1.269E-65	0.000E+00	1.594E+04	0.000E+00
TE-129M	1.680E+06	2.312E+07	1.392E+09	0.000E+00	7.559E+07	0.000E+00	1.672E+08	0.000E+00
TE-129	2.632E+04	3.076E+04	2.187E-07	0.000E+00	0.000E+00	0.000E+00	2.624E-08	0.000E+00
TE-131M	1.988E+05	9.459E+06	2.288E+07	0.000E+00	1.653E-15	0.000E+00	2.747E+06	0.000E+00
TE-131	8.218E+03	3.450E+07	1.384E-30	0.000E+00	0.000E+00	0.000E+00	1.688E-31	0.000E+00
TE-132	3.402E+05	4.968E+06	6.513E-07	0.000E+00	1.041E-01	0.000E+00	7.842E+06	0.000E+00
I-130	1.596E+06	6.692E+06	8.754E+08	0.000E+00	7.115E-45	0.000E+00	1.051E+09	0.000E+00
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-3 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 3 of 3

AGE GROUP	(INFANT)	(N.A.)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS COW MEAT	GRS COW MILK	VEGETATION
I-131	1.484E+07	2.089E+07	1.053E+12	0.000E+00	1.567E+08	0.000E+00	1.264E+12	0.000E+00
I-132	1.694E+05	1.452E+06	1.188E+02	0.000E+00	0.000E+00	0.000E+00	1.638E+02	0.000E+00
I-133	3.556E+06	2.981E+06	9.601E+09	0.000E+00	1.776E-22	0.000E+00	1.153E+10	0.000E+00
I-134	4.452E+04	5.305E+05	8.402E-10	0.000E+00	0.000E+00	0.000E+00	1.017E-09	0.000E+00
I-135	6.958E+05	2.947E+06	2.002E+07	0.000E+00	0.000E+00	0.000E+00	2.406E+07	0.000E+00
CS-134	7.028E+05	8.007E+09	6.801E+10	0.000E+00	2.191E+10	0.000E+00	2.040E+11	0.000E+00
CS-136	1.345E+05	1.710E+08	5.795E+09	0.000E+00	1.729E+07	0.000E+00	1.744E+10	0.000E+00
CS-137	6.118E+05	1.201E+10	6.024E+10	0.000E+00	2.096E+10	0.000E+00	1.087E+12	0.000E+00
CS-138	8.764E+02	4.102E+05	2.180E-22	0.000E+00	0.000E+00	0.000E+00	6.628E-22	0.000E+00
BA-139	5.096E+04	1.194E+05	2.874E-05	0.000E+00	0.000E+00	0.000E+00	3.265E-06	0.000E+00
BA-140	1.596E+06	2.346E+07	2.410E+08	0.000E+00	6.409E+05	0.000E+00	2.893E+07	0.000E+00
BA-141	4.746E+03	4.734E+04	4.916E-44	0.000E+00	0.000E+00	0.000E+00	5.899E-45	0.000E+00
BA-142	1.554E+03	5.064E+04	1.049E-78	0.000E+00	0.000E+00	0.000E+00	1.259E-79	0.000E+00
LA-140	1.680E+05	2.180E+07	1.880E+05	0.000E+00	4.563E-12	0.000E+00	2.253E+04	0.000E+00
LA-142	5.950E+04	9.117E+05	1.078E-05	0.000E+00	0.000E+00	0.000E+00	1.278E-06	0.000E+00
CE-141	5.166E+05	1.540E+07	1.366E+07	0.000E+00	7.008E+05	0.000E+00	1.640E+06	0.000E+00
CE-143	1.162E+05	2.627E+06	1.536E+06	0.000E+00	1.039E-14	0.000E+00	1.844E+05	0.000E+00
CE-144	9.842E+06	8.042E+07	1.334E+08	0.000E+00	3.749E+07	0.000E+00	1.601E+07	0.000E+00
PR-143	4.326E+05	0.000E+00	7.845E+05	0.000E+00	2.771E+03	0.000E+00	9.407E+04	0.000E+00
PR-144	4.284E+03	2.112E+03	1.171E-48	0.000E+00	0.000E+00	0.000E+00	1.259E-49	0.000E+00
ND-147	3.220E+05	1.009E+07	5.743E+05	0.000E+00	6.902E+02	0.000E+00	6.885E+04	0.000E+00
W-187	3.962E+04	2.740E+06	2.501E+06	0.000E+00	5.275E-22	0.000E+00	2.983E+05	0.000E+00
NP-239	5.950E+04	1.976E+06	9.400E+04	0.000E+00	1.025E-07	0.000E+00	1.132E+04	0.000E+00
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

3.0-26

TABLE 3.2-4
PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)*

Page 1 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
H-3	1.125E+03	0.000E+00	1.421E+03	2.118E+02	1.421E+03	2.543E+01	2.899E+03	3.627E+03
C-14	3.589E+04	0.000E+00	1.195E+09	3.834E+08	4.181E+08	4.601E+07	1.195E+09	9.894E+08
NA-24	1.610E+04	1.385E+07	8.853E+06	1.725E-03	1.321E-37	2.070E-04	1.063E+06	3.729E+05
P-32	2.605E+06	0.000E+00	7.775E+10	7.411E+09	3.440E+08	8.893E+08	9.335E+10	3.366E+09
CF-51	1.698E+04	5.506E+06	5.398E+06	4.661E+05	1.985E+05	5.593E+04	6.478E+05	6.213E+06
MN-54	1.576E+06	1.625E+09	2.097E+07	8.011E+06	6.012E+06	9.613E+05	2.517E+06	6.648E+08
MN-56	1.232E+05	1.068E+06	1.865E+00	2.437E-51	0.000E+00	2.924E-52	2.238E-01	2.723E+03
FE-55	1.110E+05	0.000E+00	1.118E+08	4.571E+08	3.673E+07	5.486E+07	1.453E+06	8.012E+08
FE-59	1.269E+06	3.204E+08	2.025E+08	6.338E+08	1.749E+07	7.605E+07	2.633E+06	6.693E+08
CO-58	1.106E+06	4.464E+08	7.080E+07	9.596E+07	1.032E+07	1.152E+07	8.487E+06	3.771E+08
CO-60	7.067E+06	2.532E+10	2.391E+08	3.838E+08	8.103E+07	4.605E+07	2.870E+07	2.095E+09
NI-63	8.214E+05	0.000E+00	2.964E+10	2.912E+10	1.036E+10	3.495E+09	3.557E+09	3.949E+10
NI-65	8.399E+04	3.451E+05	1.909E+01	4.061E-51	0.000E+00	4.873E-52	2.298E+00	1.211E+03
CU-64	3.670E+04	6.876E+05	3.502E+06	1.393E-05	7.299E-46	1.672E-06	3.907E+05	5.159E+05
ZN-65	9.953E+05	8.583E+08	1.101E+10	1.000E+09	2.985E+09	1.200E+08	1.322E+09	2.164E+09
ZN-69	1.018E+04	0.000E+00	1.123E-09	0.000E+00	0.000E+00	0.000E+00	1.043E-10	9.893E-04
BR-83	4.736E+02	7.079E+03	4.399E-01	9.519E-57	0.000E+00	1.142E-57	5.190E-02	5.369E+00
BR-84	5.476E+02	2.363E+05	6.508E-23	0.000E+00	0.000E+00	0.000E+00	7.758E-24	3.822E-11
BR-85	2.531E+01	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00
RB-86	1.983E+05	1.035E+07	8.804E+09	5.816E+08	1.114E+08	6.979E+07	1.053E+09	4.584E+08
RB-88	5.624E+02	3.779E+04	7.150E-45	0.000E+00	0.000E+00	0.000E+00	8.789E-46	4.374E-22
RB-89	3.452E+02	1.452E+05	1.397E-52	0.000E+00	0.000E+00	0.000E+00	1.659E-53	1.642E-26
SR-89	2.157E+06	2.509E+04	6.618E+09	4.815E+08	6.730E+08	5.778E+07	1.390E+10	3.593E+10
SR-90	1.010E+08	0.000E+00	1.117E+11	1.040E+10	3.887E+10	1.248E+09	2.346E+11	1.243E+12
SR-91	1.739E+05	2.511E+06	2.878E+05	55.292E-10	0.000E+00	6.351E-11	6.050E+05	1.157E+06
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

*See note, page 3.0-36

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

TABLE 3.2-4 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R₁)

AGE GROUP	(CHILD)	(N.A.)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
SR-92	2.424E+05	8.631E+05	4.134E+01	3.492E-48	0.000E+00	4.191E-49	8.706E+01	1.378E+4
Y-90	2.679E+05	5.308E+03	9.171E+05	4.879E+05	2.277E-05	5.855E+04	1.101E+05	6.569E+7
Y-91M	2.812E+03	1.161E+05	5.622E-16	0.000E+00	0.000E+00	0.000E+00	6.344E-17	1.737E-5
Y-91	2.627E+06	1.207E+06	5.199E+06	2.400E+08	6.261E+05	2.880E+07	6.240E+05	2.484E+9
Y-92	2.390E+05	2.142E+05	7.310E+00	6.959E-35	0.000E+00	8.350E-36	8.791E-01	4.576E+4
Y-93	3.885E+05	2.534E+05	1.573E+04	1.547E-07	9.134E-61	1.857E-08	1.888E+03	4.482E+6
ZR-95	2.231E+06	2.837E+08	8.786E+05	6.106E+08	1.160E+05	7.328E+07	1.054E+05	8.843E+8
ZR-97	3.511E+05	3.445E+06	4.199E+04	7.015E-01	4.703E-35	8.418E-02	5.042E+03	1.248E+7
NB-95	6.142E+05	1.605E+08	2.287E+08	2.288E+09	1.346E-17	2.673E+08	2.747E+07	2.949E+8
MO-99	1.354E+05	4.626E+06	1.738E+08	2.456E+05	8.512E-03	2.947E+04	2.086E+07	1.647E+7
TC-99M	4.810E+03	2.109E+05	1.474E+04	6.915E-18	0.000E+00	8.298E-19	1.771E+03	5.255E+3
TC-101	5.846E+02	2.277E+04	5.593E-58	0.000E+00	0.000E+00	0.000E+00	2.566E-59	4.123E-29
RU-103	6.623E+05	1.265E+08	1.108E+05	4.009E+09	7.952E+03	4.811E+08	1.329E+04	3.971E+8
RU-105	9.953E+04	7.212E+05	2.493E+00	5.885E-25	0.000E+00	7.061E-26	2.997E-01	5.981E+4
RU-106	1.476E+07	5.049E+08	1.437E+06	6.902E+10	4.243E+05	8.282E+09	1.725E+05	1.159E+10
AG-110M	5.476E+06	4.019E+09	1.678E+10	6.742E+08	4.576E+09	8.090E+07	2.013E+09	2.581E+9
TE-125M	4.773E+05	2.128E+06	7.377E+07	5.690E+08	8.802E+06	6.828E+07	8.853E+06	3.506E+8
TE-127M	1.480E+06	1.083E+05	5.932E+08	5.060E+09	1.171E+08	6.072E+08	7.118E+07	3.769E+9
TE-127	5.624E+04	3.293E+03	1.191E+05	1.607E-08	0.000E+00	1.929-09	1.396E+04	3.903E+5
TE-129M	1.761E+06	2.312E+07	7.961E+08	5.245E+09	4.324E+07	6.294E+08	9.563E+07	2.46E+9
TE-129	2.549E+04	3.076E+04	7.96E-08	0.000E+00	0.000E+00	0.000E+00	9.641E-09	7.204E-2
TE-131M	3.078E+05	9.459E+06	2.244E+07	9.815E+03	1.621E-15	1.178E+03	2.094E+06	2.163E+7
TE-131	2.054E+03	3.450E+07	8.489E-32	0.000E+00	0.000E+00	0.000E+00	1.036E-32	1.349E-14
TE-132	3.774E+05	4.968E+06	4.551E+07	9.325E+06	7.272E-02	1.119E+06	5.480E+06	3.111E+7
I-130	1.846E+06	6.692E+06	3.845E+08	6.758E-04	3.125E-45	8.109E-05	4.617E+08	1.371E+8
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

TABLE 3.2-4 (continue)

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 3 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
I-131	1.624E + 07	2.089E + 07	4.333E + 11	5.503E + 09	6.448E + 07	6.604E + 08	5.201E + 11	4.754E + 10
I-132	1.935E + 05	1.452E + 06	5.129E + 01	2.429E - 57	0.000E + 00	2.915E - 58	7.072E + 01	7.314E + 03
I-133	3.848E + 06	2.981E + 06	3.945E + 09	1.304E + 02	7.299E - 23	1.564E + 01	4.737E + 09	8.113E + 08
I-134	5.069E + 04	5.305E + 05	3.624E - 10	0.000E + 00	0.000E + 00	0.000E + 00	4.386E - 10	6.622E - 03
I-135	7.918E + 05	2.947E + 06	8.607E + 06	1.039E - 14	0.000E + 00	1.247E - 15	1.034E + 07	9.973E + 06
CS-134	1.014E + 06	8.007E + 09	3.715E + 10	1.513E + 09	1.197E + 10	1.816E + 08	1.115E + 11	2.631E + 10
CS-136	1.709E + 05	1.710E + 08	2.773E + 09	4.426E + 07	8.276E + 06	5.311E + 06	8.344E + 09	2.247E + 08
CS-137	9.065E + 05	1.201E + 10	3.224E + 10	1.334E + 09	1.122E + 10	1.600E + 08	9.672E + 10	2.392E + 10
CS-138	8.399E + 02	4.102E + 05	5.528E - 23	0.000E + 00	0.000E + 00	0.000E + 00	1.681E - 22	9.133E - 11
BA-139	5.772E + 04	1.194E + 05	1.231E - 05	0.000E + 00	0.000E + 00	0.000E + 00	1.398E - 06	2.950E + 00
BA-140	1.743E + 06	2.346E + 07	1.171E + 08	4.384E + 07	3.114E + 05	5.201E + 06	1.406E + 07	2.767E + 08
BA-141	2.919 + 03	4.734E + 04	1.894E - 45	0.000E + 00	0.000E + 00	0.000E + 00	2.273E - 46	1.605E - 21
BA-142	1.643E + 03	5.064E + 04	1.208E - 79	0.000E + 00	0.000E + 00	0.000E + 00	1.450E - 80	4.105E - 39
LA-140	2.257E + 05	2.180E + 07	1.894E + 05	5.492E + 02	4.596E - 12	6.590E + 01	2.269E + 04	3.166E + 07
LA-142	7.585E + 04	9.117E + 05	5.203E - 06	0.000E + 00	0.000E + 00	0.000E + 00	6.166E - 07	2.141E + 01
CE-141	5.439E + 05	1.540E + 07	1.361E + 07	1.382E + 07	6.980 + 05	1.658E + 06	1.633E + 06	4.082E + 08
CE-143	1.273E + 05	2.627E + 06	1.488E + 06	2.516E + 02	1.006E - 14	3.020E + 01	1.787E + 05	1.364E + 07
CE-144	1.195E + 07	8.042E + 07	1.326E + 08	1.893E + 08	3.727E + 07	2.271E + 07	1.592E + 07	1.039E + 10
PR-143	4.329E + 05	0.000E + 00	7.754E + 05	3.609E + 07	2.738E + 03	4.331E + 06	9.297E + 04	1.575E + 08
PR-144	1.565E + 03	2.112E + 03	2.040E - 50	0.000E + 00	0.000E + 00	0.000E + 00	2.353E - 51	3.829E - 23
ND-147	3.282E + 05	1.009E + 07	5.712E + 05	1.505E + 07	6.864E + 02	1.805E + 06	6.846E + 04	9.197E + 07
W-187	9.102E + 04	2.740E + 06	2.420E + 06	2.790E + 00	5.103E - 22	3.348E - 01	2.886E + 05	5.380E + 06
NP-239	6.401E + 04	1.976E + 06	9.138E + 04	2.232E + 03	9.336E - 08	2.679E + 02	1.100E + 04	1.357E + 07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-5

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)*

Page 1 of 3

AGE GROUP	(TEENAGER)	(N.A.)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
H-3	1.272E + 03	0.000E + 00	8.993E + 02	1.754E + 02	8.993E + 02	2.104E + 01	1.835E + 03	2.342E + 03
C-14	2.600E + 04	0.000E + 08	4.859E + 08	2.040E + 08	1.700E + 08	2.448E + 07	4.859E + 08	3.690E + 08
NA-24	1.376E + 04	1.385E + 07	4.255E + 05	1.084E - 03	6.347E - 38	1.301E - 04	5.110E + 05	2.389E + 05
P-32	1.888E + 06	0.000E + 00	3.153E + 10	3.931E + 09	1.395E + 08	4.717E + 08	3.785E + 10	1.608E + 09
CR-51	2.096E + 04	5.506E + 06	8.387E + 06	9.471E + 05	3.085E + 05	1.137E + 05	1.006E + 06	1.037E + 07
MN-54	1.984E + 06	1.625E + 09	2.875E + 07	1.436E + 07	8.240E + 06	1.723E + 06	3.450E + 06	9.320E + 08
MN-56	5.744E + 04	1.068E + 06	4.856E - 01	8.302E - 52	0.000E + 00	9.962E - 53	5.829E - 02	9.451E + 02
FE-55	1.240E + 05	0.000E + 00	4.454E + 07	2.382E + 08	1.463E + 07	2.859E + 07	5.790E + 05	3.259E + 08
FE-59	1.528E + 06	3.204E + 08	2.861E + 08	1.171E + 09	2.470E + 07	1.405E + 08	3.720E + 06	9.895E + 08
CO-58	1.344E + 06	4.464E + 08	1.095E + 08	1.942E + 08	1.596E + 07	2.330E + 07	1.313E + 07	6.034E + 08
CO-60	8.720E + 06	2.532E + 10	3.621E + 08	7.600E + 08	1.227E + 08	9.120E + 07	4.345E + 07	3.238E + 09
NI-63	5.800E + 05	0.000E + 00	1.182E + 10	1.519E + 10	4.130E + 09	1.823E + 09	1.419E + 09	1.606E + 10
NI-65	3.672E + 04	3.451E + 05	4.692E + 00	1.305E - 51	0.000E + 00	1.566E - 52	5.647E - 01	3.966E + 02
CU-64	6.144E + 04	6.876E + 05	3.293E + 06	1.713E - 05	6.863E - 46	2.072E - 06	3.673E + 05	6.465E + 05
ZN-65	1.240E + 06	8.583E + 08	7.315E + 09	8.688E + 08	1.983E + 09	1.043E + 08	8.779E + 08	1.471E + 09
ZN-69	1.584E + 03	0.000E + 00	1.760E - 11	0.000E + 00	0.000E + 00	0.000E + 00	1.635E - 12	2.067E - 05
BR-83	3.440E + 02	7.079E + 03	1.790E - 01	5.066E - 57	0.000E + 00	6.079E - 58	2.112E - 02	2.911E + 00
BR-84	4.328E + 02	2.363E + 05	2.877E - 23	0.000E + 00	0.000E + 00	0.000E + 00	3.429E - 24	2.251E - 11
BR-85	1.832E + 01	0.000E + 00	0.000E + 00	0.000E + 00	0.000E + 00	0.000E + 00	0.000E + 00	0.000E + 00
RB-86	1.904E + 05	1.035E + 07	4.746E + 09	4.101E + 08	6.006E + 07	4.921E + 07	5.675E + 08	2.772E + 08
RB-88	5.456E + 02	3.779E + 04	3.886E - 45	0.000E + 00	0.000E + 00	0.000E + 00	4.777E - 46	3.168E - 22
RB-89	3.520E + 02	1.452E + 05	7.957E - 53	0.000E + 00	0.000E + 00	0.000E + 00	9.454E - 54	1.247E - 26
SR-89	2.416E + 06	2.509E + 04	2.674E + 09	2.545E + 08	2.719E + 08	3.054E + 07	5.617E + 09	1.513E + 10
SR-90	1.080E + 08	0.000E + 00	6.612E + 10	8.049E + 09	2.301E + 10	9.659E + 08	1.389E + 11	7.507E + 11
SR-91	2.592E + 05	2.511E + 06	2.409E + 05	5.794E - 10	0.000E + 00	6.953E - 11	5.064E + 05	1.291E + 06
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

*See note, page 3.0-36

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-5 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 2 of 3

AGE GROUP	(TEENAGER)	(N.A.)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
SR - 92	1.192E + 05	8.631E + 05	2.277E + 01	2.516E - 48	0.000E + 00	3.019E - 49	4.795E + 01	1.012E + 04
Y - 90	5.592E + 05	5.308E + 03	1.074E + 06	7.470E + 05	2.666E - 05	8.965E + 04	1.289E + 05	1.025E + 08
Y - 91M	3.200E + 03	1.161E + 05	5.129E - 18	0.000E + 00	0.000E + 00	0.000E + 00	6.260E - 19	2.285E - 07
Y - 91	2.936E + 06	1.207E + 06	6.147E + 06	3.910E + 08	7.797E + 05	4.691E + 07	7.780E + 05	3.212E + 09
Y - 92	1.648E + 05	2.142E + 05	2.828E + 00	3.522E - 35	0.000E + 00	4.226E - 36	3.402E - 01	2.360E + 04
Y - 93	5.792E + 05	2.534E + 05	1.312E + 04	1.688E - 07	7.620E - 61	2.026E - 08	1.511E + 03	4.983E + 06
ZR - 95	2.688E + 06	2.837E + 08	1.201E + 06	1.092E + 09	1.585E + 05	1.310E + 08	1.441E + 05	1.253E + 09
ZR - 97	6.304E + 05	3.44E + 06	4.225E + 04	9.231E - 01	4.732E - 35	1.108E - 01	5.073E + 03	1.673E + 07
NB - 95	7.512E + 05	1.605E + 08	3.338E + 08	4.251E + 09	1.963E + 07	5.101E + 08	4.008E + 07	4.551E + 08
MO - 99	2.688E + 05	4.626E + 06	1.023E + 08	1.892E + 05	5.013E - 03	2.270E + 04	1.228E + 07	1.293E + 07
TC - 99M	6.128E + 03	2.109E + 05	1.055E + 04	6.471E - 18	0.000E + 00	7.766E - 19	1.267E + 03	5.011E + 03
TC - 101	6.672E + 02	2.277E + 04	1.343E - 58	0.000E + 00	0.000E + 00	0.000E + 00	1.508E - 59	3.229E - 23
RU - 103	7.832E + 05	1.265E + 08	1.513E + 05	7.162E + 09	1.086E + 04	8.595E + 08	1.815E + 04	5.706E + 08
RU - 105	9.040E + 04	7.212E + 05	1.263E + 00	3.900E - 25	0.000E + 00	4.680E - 26	1.519E - 01	4.039E + 04
RU - 106	1.608E + 07	5.049E + 08	1.799E + 06	1.130E + 11	5.312E + 05	1.356E + 10	2.159E + 05	1.484E + 10
AG - 110M	6.752E + 06	4.019E + 09	2.559E + 10	1.345E + 09	6.982E + 09	1.614E + 08	3.071E + 09	4.031E + 09
TE - 125M	5.360 + 05	2.128E + 06	8.863E + 07	8.941E + 08	1.058E + 07	1.073E + 08	1.064E + 07	4.375E + 08
TE - 127M	1.656E + 06	1.083E + 05	3.420E + 08	3.810E + 09	6.753E + 07	4.580E + 08	4.105E + 07	2.236E + 09
TE - 127	8.080E + 04	3.293E + 03	9.572E + 04	1.589E - 08	0.000E + 00	2.027E - 09	1.122E + 04	4.180E + 05
TE - 129M	1.976E + 06	2.312E + 07	4.602E + 08	3.966E + 09	2.500E + 07	4.759E + 08	5.528E + 07	1.514E + 09
TE - 129	3.296E + 03	3.076E + 04	2.834E - 09	0.000E + 00	0.000E + 00	0.000E + 00	3.433E - 10	3.916E - 03
TE - 131M	6.208E + 05	9.459E + 06	2.529E + 07	1.447E + 04	1.827E - 15	1.736E + 03	3.036E + 06	3.248E + 07
TE - 131	2.336E + 03	3.450E + 07	2.879E - 32	0.000E + 00	0.000E + 00	0.000E + 00	3.515E - 33	6.099E - 15
TE - 132	4.632E + 05	4.968E + 06	8.581E + 07	2.300E + 07	1.371E - 01	2.760E + 06	1.033E + 07	7.818E + 07
I - 130	1.488E + 06	6.692E + 06	1.742E + 08	4.005E - 04	1.416E - 45	4.806E - 05	2.092E + 08	8.276E + 07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

TABLE 3.2-5 (continued)

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 3 of 3

AGE GROUP	(TEENAGER)	(N.A.)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
I-131	1.464E+07	2.089E+07	2.195E+11	3.645E+09	3.266E+07	4.375E+08	2.634E+11	3.140E+10
I-132	1.512E+05	1.452E+06	2.242E+01	1.389E-57	0.000E+00	1.667E-58	3.092E+01	4.262E+03
I-133	2.920E+06	2.981E+06	1.674E+09	7.234E+01	3.096E-23	8.680E+00	2.009E+09	4.587E+08
I-134	3.952E+04	5.305E+05	1.583E-10	0.000E+00	0.000E+00	0.000E+00	1.915E-10	3.854E-03
I-135	6.208E+05	2.947E+06	3.777E+06	5.963E-15	0.000E+00	7.156E-16	4.538E+06	5.832E+06
CS-134	1.128E+06	8.007E+09	2.310E+10	1.231E+09	7.443E+09	1.477E+08	6.931E+10	1.671E+10
CS-136	1.936E+05	1.710E+08	1.759E+09	3.671E+07	5.249E+06	4.405E+06	5.292E+09	1.708E+08
CS-137	8.480E+05	1.201E+10	1.781E+10	9.634E+08	6.197E+09	1.156E+08	5.342E+10	1.348E+10
CS-138	8.560E+02	4.102E+05	3.149E-23	0.000E+00	0.000E+00	0.000E+10	9.576E-23	6.935E-11
BA-139	6.464E+03	1.194E+05	7.741E-07	0.000E+00	0.000E+00	0.000E+00	8.794E-08	2.403E-01
BA-140	2.032E+06	2.346E+07	7.483E+07	3.663E+07	1.990E+05	4.396E+06	8.981E+06	2.130E+08
BA-141	3.288E+03	4.734E+04	7.703E-46	0.000E+00	0.000E+00	0.000E+00	9.244E-47	8.699E-22
BA-142	1.912E+03	5.064E+04	5.010E-80	0.000E+00	0.000E+00	0.000E+00	6.012E-81	5.613E-39
LA-140	4.872E+05	2.180E+07	2.291E+05	8.689E+02	5.560E-12	1.043E+02	2.745E+04	5.104E+07
LA-142	1.200E+04	9.117E+05	4.611E-07	0.000E+00	0.000E+00	0.000E+00	5.465E-08	2.529E+00
CE-141	6.136E+05	1.540E+07	1.696E+07	2.252E+07	8.700E+05	2.703E+06	2.036E+06	5.404E+08
CE-143	2.552E+05	2.627E+06	1.671E+06	3.695E+02	1.130E-14	4.434E+01	2.006E+05	2.040E+07
CE-144	1.336E+07	8.042E+07	1.655E+08	3.089E+08	4.650E+07	3.706E+07	1.986E+07	1.326E+10
PR-143	4.832E+05	0.000E+00	9.553E+05	5.817E+07	3.374E+03	6.980E+06	1.146E+05	2.310E+08
PR-144	1.752E+03	2.112E+03	1.238E-53	0.000E+00	0.000E+00	0.000E+00	1.331E-54	3.097E-26
ND-147	3.720E+05	1.009E+07	7.116E+05	2.453E+07	8.552E+02	2.942E+06	8.530E+04	1.424E+08
W-187	1.768E+05	2.740E+06	2.646E+06	3.989E+00	5.579E-22	4.787E-01	3.155E+05	7.839E+06
NP-239	1.320E+05	1.976E+06	1.060E+05	3.387E+03	1.083E-07	4.064E+02	1.276E+04	2.097E+07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-6
PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)*

Page 1 of 3

AGE GROUP	(ADULT)	(N.A.)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)
ISOTOPE	INHALATION	GROUND PLANE	GRS-COW MILK	GRS-COW MEAT	GRS-COW MILK	GRS-GOT MEAT	GRS-GOT MILK	VEGETATION
H-3	1.264E+03	0.000E+00	6.904E+02	2.940E+02	6.904E+02	3.528E+01	1.408E+03	2.845E+03
C-14	1.816E+04	0.000E+00	2.634E+08	2.414E+08	9.219E+07	2.897E+07	2.634E+08	2.276E+08
NA-24	1.024E+04	1.385E+07	2.438E+06	1.356E-03	3.636E-38	1.628E-04	2.926E+05	2.690E+05
P-32	1.320E+06	0.000E+00	1.709E+10	4.651E+09	7.559E+07	5.582E+08	2.052E+10	1.403E+09
CR-51	1.440E+04	5.506E+06	7.187E+06	1.772E+06	2.644E+05	2.127E+05	8.624E+05	1.168E+07
MN-54	1.400E+06	1.525E+09	2.578E+07	2.812E+07	7.389E+06	3.375E+06	3.091E+06	9.585E+08
MN-56	2.024E+04	1.068E+06	1.328E-01	4.958E-52	0.000E+00	5.949E-53	1.594E-02	5.082E+02
FE-55	7.208E+04	0.000E+00	2.511E+07	2.933E+08	8.250E+06	3.519E+07	3.265E+05	2.096E+08
FE-59	1.016E+06	3.204E+08	2.327E+08	2.080E+09	2.009E+07	2.495E+08	3.024E+06	9.875E+08
CO-58	9.280E+05	4.464E+08	9.565E+07	3.703E+08	1.394E+07	4.443E+07	1.147E+07	6.252E+08
CO-60	5.968E+06	2.532E+10	3.082E+08	1.413E+09	1.044E+08	1.695E+08	3.7E+06	3.139E+09
NI-63	4.320E+05	0.000E+00	6.729E+09	1.888E+10	2.351E+09	2.266E+09	8.075E+08	1.040E+10
NI-65	1.232E+04	3.451E+05	1.219E+00	7.405E-52	0.000E+00	8.886E-53	1.464E-01	2.026E+02
CU-64	4.896E+04	6.876E+05	2.031E+06	2.307E-05	4.233E-46	2.769E-06	2.415E+05	7.841E+05
ZN-65	8.640E+05	8.583E+08	3.798E+09	1.122E+09	1.183E+09	1.358E+08	4.588E+08	1.009E+09
ZN-69	9.200E+02	0.000E+00	4.031E-12	0.000E+00	0.000E+00	0.000E+00	4.837E-13	1.202E-05
BR-83	2.408E+02	7.079E+03	1.399E-01	8.648E-57	0.000E+00	1.038E-57	1.698E-02	4.475E+00
BR-84	3.128E+02	2.363E+05	1.69E-23	0.000E+00	0.000E+00	0.000E+00	2.029E-24	2.475E-11
BR-85	1.280E+01	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00
RB-86	1.352E+05	1.027E+07	2.595E+09	4.870E+00	3.201E+07	5.845E+07	3.113E+08	2.194E+08
RB-88	3.872E+02	3.779E+04	2.139E-45	0.000E+00	0.000E+00	0.000E+00	2.573E-46	3.428E-22
RB-89	2.560E+02	1.476E+05	4.496E-53	0.000E+00	0.000E+00	0.000E+00	5.396E-54	3.961E-26
SR-89	1.400E+06	2.509E+04	1.451E+09	3.014E+08	1.475E+08	3.617E+07	3.046E+09	9.961E+09
SR-90	9.920E+07	0.000E+00	4.680E+10	1.244E+10	1.628E+10	1.493E+09	9.828E+10	6.846E+11
SR-91	1.912E+05	2.511E+06	1.377E+05	7.233E-10	0.000E+00	8.680E-11	2.872E+05	1.451E+06
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

*See note, page 3.0-36

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

TABLE 3.2-6 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 2 of 3

AGE GROUP	(ADULT)	(N.A.)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
SR-92	4.304E+04	8.631E+05	9.675E+00	2.334E-48	0.000E+00	2.801E-49	2.05E+01	8.452E+03
Y-90	5.056E+05	5.308E+03	7.511E+05	1.141E+06	1.865E-05	1.369E+05	9.028E+04	1.410E+08
Y-91M	1.920E+03	1.161E+05	1.883E-19	0.000E+00	0.000E+00	0.000E+00	2.262E-20	1.527E-08
Y-91	1.704E+06	1.207E+06	4.726E+06	6.231E+08	5.691E+05	7.477E+07	5.672E+05	2.814E+09
Y-92	7.352E+04	2.142E+05	9.772E-01	2.657E-35	0.000E+00	3.188E-36	1.17E-01	1.603E+04
Y-93	4.216E+05	2.534E+05	7.091E+03	2.075E-07	4.290E-61	2.490E-08	8.43E+02	5.517E+06
ZR-95	1.768E+06	2.837E+08	9.587E+05	1.903E+09	1.265E+05	2.284E+08	1.151E+05	1.194E+09
ZR-97	5.232E+05	3.445E+06	2.707E+04	1.292E+00	3.032E-35	1.550E-01	3.24E+03	2.108E+07
NB-95	5.048E+05	1.605E+08	2.787E+08	7.748E+09	1.639E+07	9.297+08	3.344E+07	4.798+08
MO-99	2.480E+05	4.626E+06	5.741E+07	2.318E+05	2.813E-03	2.781E+04	6.878E+06	1.426E+07
TC-99M	4.160E+03	2.109E+05	5.553E+03	7.439E-18	0.000E+00	8.927E-19	6.641E+02	5.187E+03
TC-101	3.192E+02	2.277E+04	7.406E-59	0.000E+00	0.000E+00	0.000E+00	8.888E-60	3.502E-29
RU-103	5.048E+05	1.265E+08	1.189E+05	1.229E+10	8.537E+03	1.475E+09	1.426E+04	5.577E+08
RU-105	4.816E+04	7.212E+05	5.240E-01	3.533E-25	0.000E+00	4.239E-26	6.245E-02	3.294E+04
RU-106	9.360E+06	5.049E+08	1.320E+06	1.811E+11	3.898E+05	2.173E+10	1.584E+05	1.247E+10
AG-110M	4.632E+06	4.019E+09	2.198E+10	2.523E+09	5.996E+09	3.028E+08	2.638E+09	3.979E+09
TE-125M	3.136E+05	2.128E+06	6.626E+07	1.460E+09	7.906E+06	1.751E+08	7.955E+06	3.927E+08
TE-127M	9.600E+05	1.083E+05	1.860E+08	4.531E+09	3.671E+07	5.437E+08	2.223E+07	1.418E+09
TE-127	5.736E+04	3.293E+03	5.278E+04	2.034E-08	0.000E+00	2.441E-09	6.172E+03	4.532E+09
TE-129M	1.160E+06	2.312E+07	3.028E+08	5.698E+09	1.645E+07	6.838E+08	3.636E+07	1.261E+09
TE-129	1.936E+03	3.076E+04	1.183E-09	0.000E+00	0.000E+00	0.000E+00	1.42E-10	2.80E-03
TE-131M	5.560E+05	9.459E+06	1.753E+07	2.190E+04	1.266E-15	2.628E+03	2.102E+06	4.428E+07
TE-131	1.392E+03	3.450E+07	1.578E-32	0.000E+00	0.000E+00	0.000E+00	1.927E-33	6.575E-15
TE-132	5.096E+05	4.968E+06	7.356E+07	4.287E+07	1.170E-01	5.144E+06	8.827E+06	1.312E+08
I-130	1.136E+06	6.692E+06	1.050E+08	5.272E-04	8.535E-46	6.326E-05	1.254E+08	9.809+07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

TABLE 3.2-6 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 3 of 3

AGE GROUP	(ADULT)	(N.A.)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)
ISOTOPE	INHALATION	GROUND PLANE	GRS-COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
I-131	1.192E+07	2.089E+07	1.388E+11	5.034E+09	2.065E+07	6.040E+08	1.665E+11	3.785E+10
I-132	1.144E+05	1.452E+06	1.541E+01	1.816E-57	0.000E+00	2.179E-58	1.849E+01	5.016E+03
I-133	2.152E+06	2.981E+06	9.891E+08	9.336E+01	1.830E-23	1.120E+01	1.189E+09	5.331E+08
I-134	2.984E+04	5.305E+05	8.886E-11	0.000E+00	0.000E+00	0.000E+00	1.066E-10	4.563E-03
I-135	4.480E+05	2.947E+06	2.217E+06	7.644E-15	0.000E+00	9.172E-16	2.676E+06	6.731E+06
CS-134	8.480E+05	8.007E+09	1.345E+10	1.565E+09	4.333E+09	1.878E+08	4.035E+10	1.110E+10
CS-136	1.464E+05	1.710E+08	1.039E+09	4.724E+07	3.093E+06	5.669E+06	3.117E+09	1.675E+08
CS-137	6.208E+05	1.201E+10	1.010E+10	1.193E+09	3.513E+09	1.431E+08	3.03E+10	8.696E+09
CS-138	6.208E+02	4.102E+05	1.786E-23	0.000E+00	0.000E+00	0.000E+00	5.146E-23	7.730E-11
BA-139	3.760E+03	1.194E+05	7.863E-08	0.000E+00	0.000E+00	0.000E+00	9.435E-09	5.225E-02
BA-140	1.272E+06	2.346E+07	5.535E+07	5.917E+07	1.472E+05	7.100E+06	6.643E+06	2.646E+08
BA-141	1.936E+03	4.734E+04	4.327E-46	0.000E+00	0.000E+00	0.000E+00	5.193E-47	9.463E-22
BA-142	1.192E+03	5.064E+04	2.509E-80	0.000E+00	0.000E+00	0.000E+00	3.011E-81	2.463E-39
LA-140	4.584E+05	2.180E+07	1.672E+05	1.385E+03	4.059E-12	1.662E+02	2.006E+04	7.319E+07
LA-142	6.328E+03	9.117E+05	6.273E-08	0.000E+00	0.000E+00	0.000E+00	7.531E-09	6.768E-01
CE-141	3.616E+05	1.540E+07	1.25E+07	3.632E+07	6.424E+05	4.358E+06	1.503E+06	5.097E+08
CE-143	2.264E+05	2.627E+06	1.15E+06	5.547E+02	7.768E-15	6.656E+01	1.38E+05	2.758E+07
CE-144	7.776E+06	8.042E+07	1.21E+08	4.928E+08	3.398E+07	5.914E+07	1.451E+07	1.112E+10
PR-143	2.808E+05	0.000E+00	6.918E+05	9.204E+07	2.445E+03	1.104E+07	8.297E+04	2.748E+08
PR-144	1.016E+03	2.112E+03	6.716E-54	0.000E+00	0.000E+00	0.000E+00	7.745E-55	3.303E-26
ND-147	2.208E+05	1.009E+07	5.231E+05	3.935E+07	6.286E+02	4.722E+06	6.273E+04	1.853E+08
W-187	1.552E+05	2.740E+06	1.796E+06	5.912E+00	3.787E-22	7.094E-01	2.14E+05	1.046E+07
NP-239	1.192E+05	1.976E+06	7.409E+04	5.152E+03	7.545E-08	6.182E+02	8.876E+03	2.872E+07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

NOTE: The R_i values of Table 3.2-2 through 3.2-6 were calculated in accordance with the methods of Section 5.3.1 of Reference 1. Columns in those tables marked "Pasture" are for freely-grazing animals ($f_p = f_s = 1$). Columns marked "Feed" are for animals fed solely locally-grown stored feed ($f_p = f_s = 0$). The values used for each parameter and the origins of the values are given in Table 3.2-9 and its notes.

Table 3.2-7

CONTROLLING RECEPTORS, LOCATIONS, AND PATHWAYS*

<u>SECTOR</u>	<u>DISTANCE (METERS)</u>	<u>PATHWAY</u>	<u>AGE GROUP</u>	<u>ORIGIN (FOR INFORMATION ONLY)</u>
N**	6,100	Vegetation	Child	-Vegetable Garden
NNE**	5,300	Vegetation	Child	-Vegetable Garden
NE	4,500	Vegetation	Child	-Vegetable Garden
	4,500	Grass/Cow/Meat	Child	Grazing Beef Cattle
ENE	2,600	Vegetation	Child	-Vegetable Garden
	2,600	Grass/Cow/Meat	Child	Grazing Beef Cattle
E	1,800	Vegetation	Child	-Vegetable Garden
ESE	1,800	Vegetation	Child	-Vegetable Garden
SE	2,400	Vegetation	Child	-Vegetable Garden
SSE	4,300	Vegetation	Child	-Vegetable Garden
S**	6,300	Vegetation	Child	-Vegetable Garden
SSW**	5,500	Vegetation	Child	-Vegetable Garden
SW**	5,300	Vegetation	Child	-Vegetable Garden
WSW	3,100	Grass/Cow/Meat	Child	-Grazing Beef Cattle
W	4,300	Vegetation	Child	-Vegetable Garden
	3,500	Grass/Cow/Meat	Child	Grazing Beef Cattle
WNW**	7,700	Vegetation	Child	-Vegetable Garden
NW**	6,600	Vegetation	Child	-Vegetable Garden
	6,600	Grass/Cow/Meat	Child	Grazing Beef Cattle
NNW	4,800	Vegetation	Child	-Vegetable Garden
	4,800	Grass/Cow/Meat	Child	Grazing Beef Cattle

* See note on the following page for the method used to identify these controlling receptors.

** If a cow were located at 5.0 miles (8,000 meters) in this sector, an infant consuming only its milk would receive a greater total radiation dose than would the real receptor listed. However, such an infant would not be the Maximum Exposed Individual for the site.

NOTE: The controlling receptor in each sector was identified in the following way. Receptor locations and associated pathways were obtained from the August 1991 field survey. A child was assumed at each location, except that where a milk cow was listed, an infant was assumed. X/Q' and D/Q' for each candidate receptor was calculated using five year average meteorological data. XOQDOQ-82 software was used to analyze the meteorological data. Expected annual releases of each nuclide were taken from Table 5.2-2 of Reference 5. The specific dispersion values for each candidate are used with the methodology of ODCM section 3.2.3.2 to calculate a hypothetical dose. The controlling receptor for each sector was then chosen as the candidate receptor with the highest total annual dose of any candidate receptor in the given sector. All listed pathways are in addition to inhalation and ground plane exposure.

Table 3.2-8

ATMOSPHERIC DISPERSION PARAMETERS
FOR CONTROLLING RECEPTOR LOCATIONS*

<u>SECTOR</u>	<u>X/Q'</u>	<u>D/Q'</u>	<u>DISTANCE - (MILES/METERS)</u>
N	2.3 E-7	6.3 E-10	3.8 / 6,100
NNE	2.9 E-7	8.5 E-10	3.3 / 5,300
NE	5.4 E-7	1.5 E-9	2.8 / 4,500
ENE	1.8 E-6	5.4 E-9	1.6 / 2,600
E	3.5 E-6	1.1 E-8	1.1 / 1,800
ESE	2.1 E-6	6.8 E-9	1.1 / 1,800
SE	6.5 E-7	2.4 E-9	1.5 / 2,400
SSE	1.2 E-7	5.3 E-10	2.7 / 4,300
S	7.6 E-8	3.5 E-10	3.9 / 6,300
SSW	1.2 E-7	7.0 E-10	3.4 / 5,500
SW	1.3 E-7	9.6 E-10	3.3 / 5,300
WSW	3.6 E-7	2.5 E-9	1.9 / 3,100
W	1.8 E-7	7.7 E-10	2.7 / 4,300
W	2.8 E-7	1.3 E-9	2.2 / 3,500
WNW	3.8 E-8	1.3 E-10	4.8 / 7,700
NW	9.8 E-8	2.8 E-10	4.1 / 6,600
NNW	3.3 E-7	9.0 E-10	3.0 / 4,800

* Annual average relative dispersion and deposition values for the receptor locations in Table 3.2-7. Values were calculated from 5 year averaged meteorological data using the XOQDOQ-82 software. Dispersion values were calculated assuming ground-level release, open terrain recirculation, dry depletion, and using decay with a half-life of 8.0 days. As a result of the analysis described in the note to Table 3.2-7, the location of the maximum exposed individual for the site is assumed to be the vegetable garden at 1.1 miles in the E sector. Therefore, the site X/Q' and D/Q' (Section 3.2.3.2 and following) are those from this table for that location.

Table 3.2-9
Page 1 of 4
PARAMETERS USED IN DOSE FACTOR CALCULATIONS

Parameter	Value	Origin of Value		
		Table in R.G. 1.109	Section of NUREG- 0133	Site- Specific
	For P_i			
DFA _i	Each radionuclide	E-9		Note 2
BR	3700 m ³ /yr	E-5		
	For Ri (Vegetation)			
r	Each element type	E-1		
Y _v	2.0 kg/m ²	E-15		
λ _w	5.83 E-7 sec ⁻¹		5.3.1.3	
DFL _i	Each age group and radio- nuclide	E-11 thru E-14		Note 2
U _a ^L	Each age group	E-5		
f _L	1.0		5.3.1.5	
t _L	8.6 E + 4 seconds	E-15		
U _a ^S	Each age group	E-5		
f _g	0.76		5.3.1.5	
t _h	5.18 E + 6 seconds	E-15		
H	8.84 gm/m ³			Note 1
	For Ri (Inhalation)			
BR	Each age group	E-5		
DFA _i	Each age group and nuclide	E-7 thru E-10		Note 2

Table 3.2-9

Page 2 of 4

PARAMETERS USED IN DOSE FACTOR CALCULATIONS

<u>Parameter</u>	<u>Value</u>	<u>Origin of Value</u>		
		<u>Table in R.G. 1.109</u>	<u>Section of NUREG- 0133</u>	<u>Site- Specific</u>
	For R_i (Ground Plane)			
SF	0.7	E-15		
DFG _i	Each radionuclide	E-6		
t	4.73 E + 8 sec		5.3.1.2	
	For R_i (Grass/Animal/Meat)			
Q _f (Cow)	50 kg/day	E-3		
Q _f (Goat)	6 kg/day	E-3		
U _{ap}	Each age group	E-5		
λw	5.73 E-7 sec ⁻¹		5.3.1.3	
F _i (Both)	Each element	E-1		
r	Each element type	E-15		
DFL _i	Each age group and nuclide	E-11 thru E-14		Note 2
f _p	1.0			Note 3
f _s	1.0			Note 3
Y _p	0.7 kg/m ³	E-15		
t _h	7.78 E + 6 sec	E-15		
Y _s	2.0 kg/m ²	E-15		
t _f	1.73 E + 6 sec	E-15		
H	8.84 gm/m ³			Note 1

PARAMETERS USED IN DOSE FACTOR CALCULATIONS

<u>Parameter</u>	<u>Value</u>	<u>Origin of Value</u>		
		<u>Table in R.G. 1.109</u>	<u>Section of NUREG-0133</u>	<u>Site-Specific</u>
	For R _i (Grass/Animal/Milk)			Note 4
Q _F (Cow)	50 kg/day	E-3		
Q _F (Goat)	6 kg/day	E-3		
U _{ap}	Each age group	E-5		
λ _w	5.73 E-7 sec ⁻¹		5.3.1.3	
F _m	Each element	E-1 & E-2		
r	Each element type	E-15		
DFL _i	Each age group and nuclide	E-11 thru E-14		Note 2
Y _p	0.7 kg/m ²	E-15		
t _h	7.78 E + 6 sec	E-15		
Y _s	2.0 kg/m ²	E-15		
t _f	1.73 E + 5 sec	E-15		
f _p	1.0			Note 5
f _s	1.0			Note 5
f _p	0.0			Note 5
f _s	0.0			Note 5
H	8.84 gm/m ³			Note 1

Table 3.2-9 (Continued)

Page 4 of 4

NOTES

1. Site-specific annual average absolute humidity. For each month, an average absolute humidity was calculated from the 7 years of monthly average temperatures in Table 2.3-49 of Reference 4 and the 5 years of monthly average dew points in Table 2.3-64 of Reference 4. The 12 monthly values were averaged to obtain the annual average of 8.84 gm/m³. (Section 5.2.1.3 of Reference 1 gives a default value of 8 gm/m³.)
2. Inhalation and ingestion dose factors were taken from the indicated source. For each age group, for each nuclide, the organ dose factor used was the highest dose factor for that nuclide and age group in the referenced table.
3. Typically beef cattle are raised all year on pasture. Annual land surveys have indicated that the small number of goats raised within 5 miles typically are used for grass control and not food or milk. Nevertheless, the goats were treated as full meat and milk sources where present, despite the fact that their numbers cannot sustain the meat consumption rates of Table E-5 of Reference 3.
4. According to the August 1990 land use census, dairy cattle possibly graze at 4.9 miles in the West sector. If dairy cattle graze at this location, the dose to an infant consuming milk from these animals would be less than the dose received by the critical receptor identified for the sector. No other milking activity within five miles of the plant was identified. These values are included for reference only.
5. Two columns of R_i's were calculated - one for cows kept exclusively on local pasture (f_p = f_s = 1), and one for cows kept exclusively on locally grown stored feed (f_p = f_s = 0). See the note on page 2.0-37.

3.3 Meteorological Model for Dose Calculations

3.3.1 Meteorological Model Parameters

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
b =	height of the containment building.	(3.3.2.1)
D _g =	deposition rate for ground-level releases relative to the distance from the containment building (from Figure 3.3-3).	(3.3.2.2)
D/Q =	the sector averaged relative deposition for any distance in a given sector (m ⁻²).	(3.3.2.2)
i =	wind speed class. The wind speed classes are given in Table 4A of Reference 10 as 1-3, 4-7, 8-12, 13-18, 19-24, and > 24 miles per hour.	(3.3.2.1)
N =	total hours of valid meteorological data.	(3.3.2.1)
n _{ij} =	number of hours meteorological conditions are observed to be in a given wind direction, wind speed class i, and atmospheric stability class j.	(3.3.3.1)
n =	number of hours wind is in given direction.	(3.3.2.1)
r =	distance from the containment building to the location of interest for dispersion calculations (m).	(3.3.2.1)
ΔT/ΔZ =	temperature differential with vertical separation (°K/100m).	(3.3.2.1)
T =	terrain recirculation factor, Figure 3.3-4.	(3.3.2.1)
u _i =	wind speed (midpoint of wind speed class i) at ground level (m/sec).	(3.3.2.1)
X/Q =	the sector average relative concentration at any distance in a given sector. (sec/m ³).	(3.3.2.1)
δ =	plume depletion factor at distance r from Figure 3.3-1.	(3.3.3.1)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
σ_z	= vertical standard deviation of the plume (in meters), at distance r for ground level releases under the stability category indicated by $\Delta T / \Delta Z$, from Figure 3.3-2.	(3.3.2.1)
2.032	= $(2/\pi)^{1/2}$ divided by the width in radians of a 22.5° sector (0.3927 radians).	(3.3.2.1)
2.55	= the inverse of the number of radians in a 22.5° sector $\frac{1}{(22.5^\circ)(0.0175 \text{ Radians}/^\circ)}$	(3.3.2.2)

3.3.2 Meteorological Model

3.3.2.1 Atmospheric dispersion for routine venting or other routine gaseous effluent releases is calculated using a ground-level, wake-corrected form of the straight line flow model.

$$\begin{aligned}
 X/Q &= \text{the sector-averaged relative concentration at any distance in the given sector (sec/m}^3\text{)} \\
 &= 2.032 \delta T \sum_{ij} \frac{n_{ij}}{N r u_i \sum_{aj}} \quad (52)
 \end{aligned}$$

where:

2.032 = $(2/\pi)^{1/2}$ divided by the width in radians of a 22.5° sector (0.3927 radians).

δ = plume depletion factor at distance r for the appropriate stability class from Figure 3.3-1.

i = wind speed class. The wind speed classes are given in Table 4A of Reference 10 as 1-3, 4-7, 8-12, 13-18, 19-24, and > 24 miles per hour.

$n_{i,j}$ = number of hours meteorological conditions are observed to be in a given wind direction, wind speed class i, and atmospheric stability class j.

- N = total hours of valid meteorological data.
- r = distance from the containment building to location of interest (m)
- u_i = wind speed (midpoint of wind speed class i) at ground level (m/sec).
- \sum_z = the lesser of $(\sigma_z^2 + b^2/2\pi)^{1/2}$ or $(\sqrt{3} \sigma_z)$ (53)

where:

- σ_z = vertical standard deviation of the plume (in meters) at distance r for ground level releases under the stability category indicated by $\Delta T/\Delta Z$, from Figure 3.3-2.
- T = terrain recirculation factor, from Figure 3.3-4
- π = 3.1416
- b = height of the containment building (50.9m)
- $\Delta T/\Delta Z$ = temperature differential with vertical separation ($^{\circ}\text{K}/100\text{m}$).

Note: For calculation of X/Q using actual meteorological data for a particular release, u_i = the average wind speed for hour i and n_{ij} = number of hours with wind speed i and stability class j .

3.3.2.2 Relative deposition per unit area for all releases is calculated for a ground-level release.

- D/Q = the sector-averaged relative deposition at any distance in a given sector (m^{-2}).
- = $\frac{2.55 D_g^n}{r N}$ (54)

where,

- D_g = deposition rate for ground-level releases relative to distance (r) from the containment building (from Figure 3.3-3).

2.55 = the inverse of the number of radians in a 22.5° sector

$$\frac{1}{(22.5^\circ)(0.0175 \text{ Radians}^\circ)}$$


n = number of hours wind is in given direction (sector).

N = total hours of valid meteorological data.

FIGURE 3.3-1

Plume Depletion Effect for Ground Level Releases (8)
(All Atmospheric Stability Classes)

Graph taken from Reference 8, Figure 2

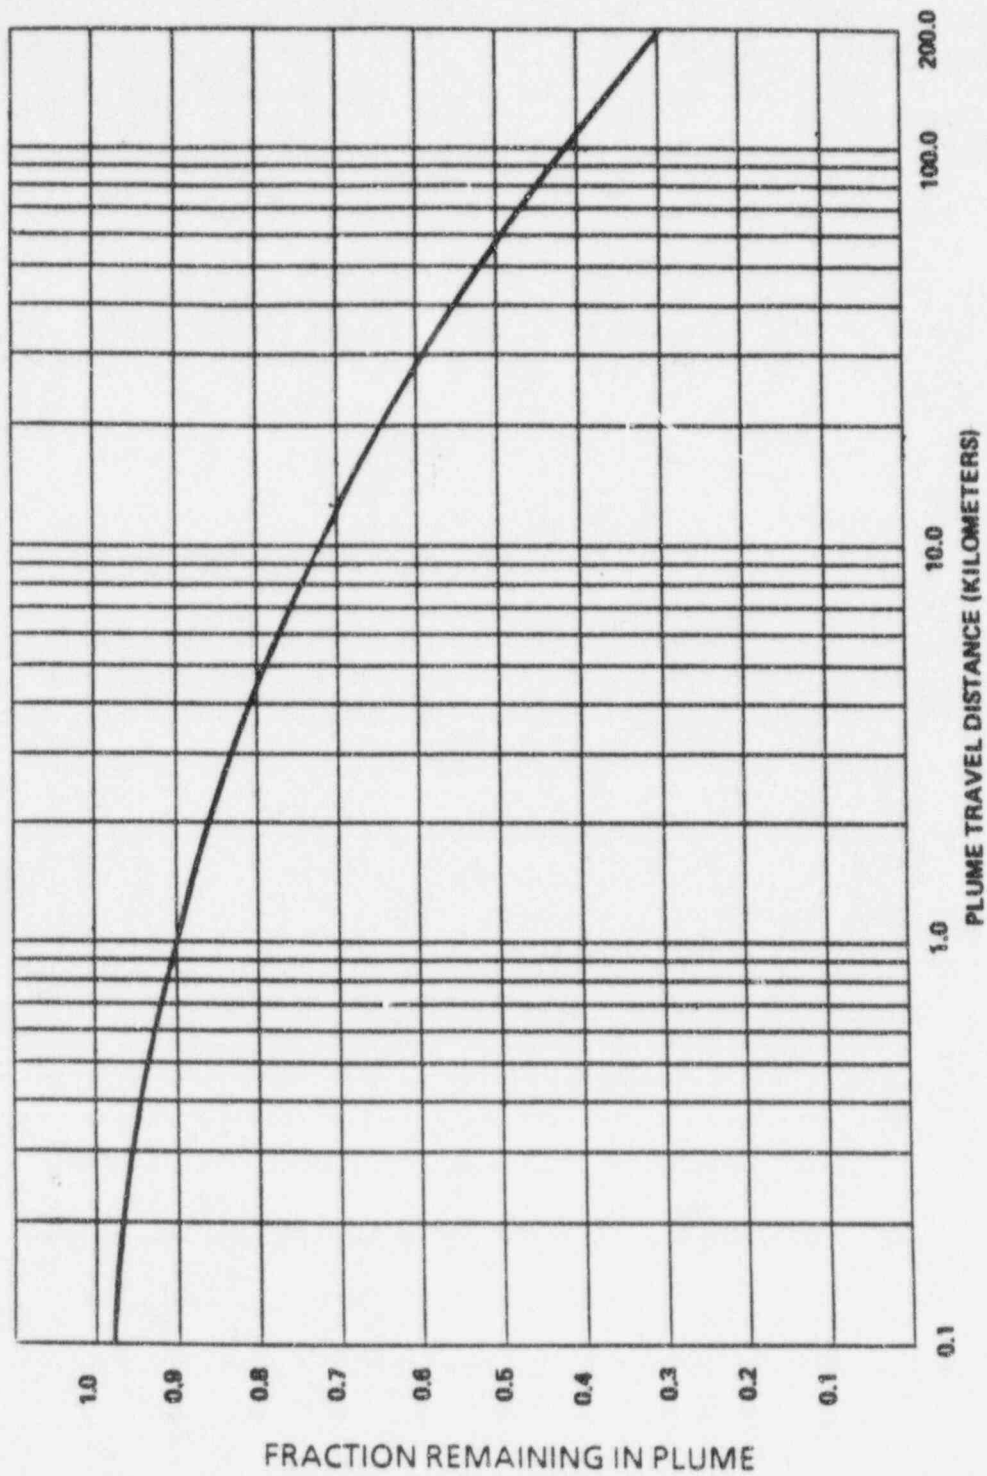


ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

FIGURE 3.3-2

Vertical Standard Deviation of Material in a Plume (δ_z)
 (Letters denote Pasquill Stability Classes)

Graph taken from Reference 8, Figure 1

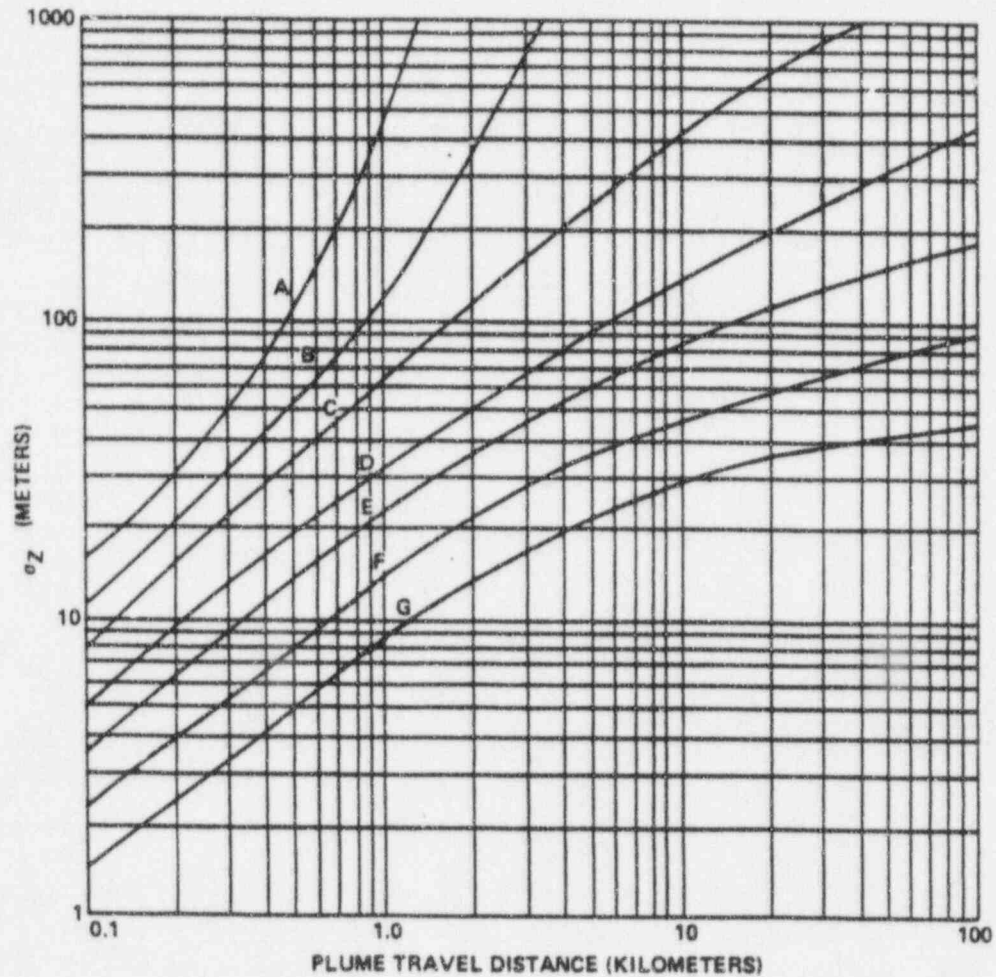

Temperature Change
 with Height $\Delta T/\Delta Z$ ($^{\circ}\text{K}/100\text{m}$)

Pasquill
 Categories

Stability
 Classification

< -1.9

A

Extremely Unstable

-1.9 to -1.7

B

Moderately Unstable

-1.7 to -1.5

C

Slightly Unstable

-1.5 to -0.5

D

Neutral

-0.5 to 1.5

E

Slightly Stable

1.5 to 4.0

F

Moderately Stable

> 4.0


G

Extremely Stable

FIGURE 3.3-3

Relative Deposition for Ground Level Releases (D_g)
(All Atmospheric Stability Classes)

Graph taken from Reference 8, Figure 6

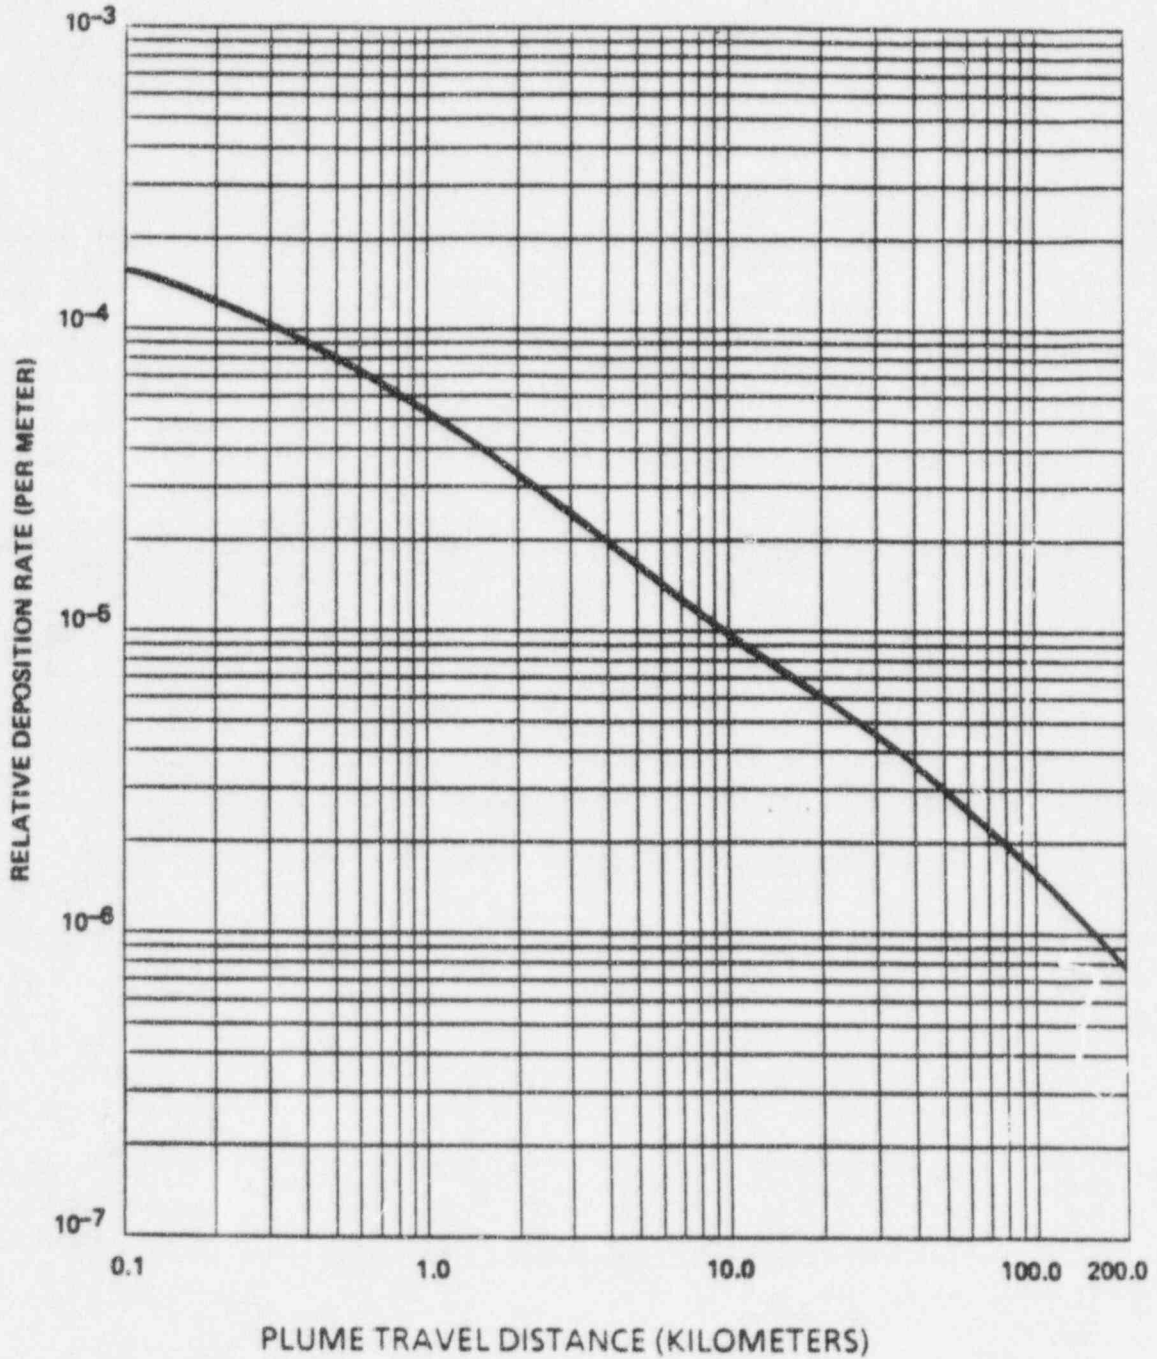


ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

FIGURE 3.3-4

Open Terrain Recirculation Factor

Graph taken from Reference 7, Figure 2

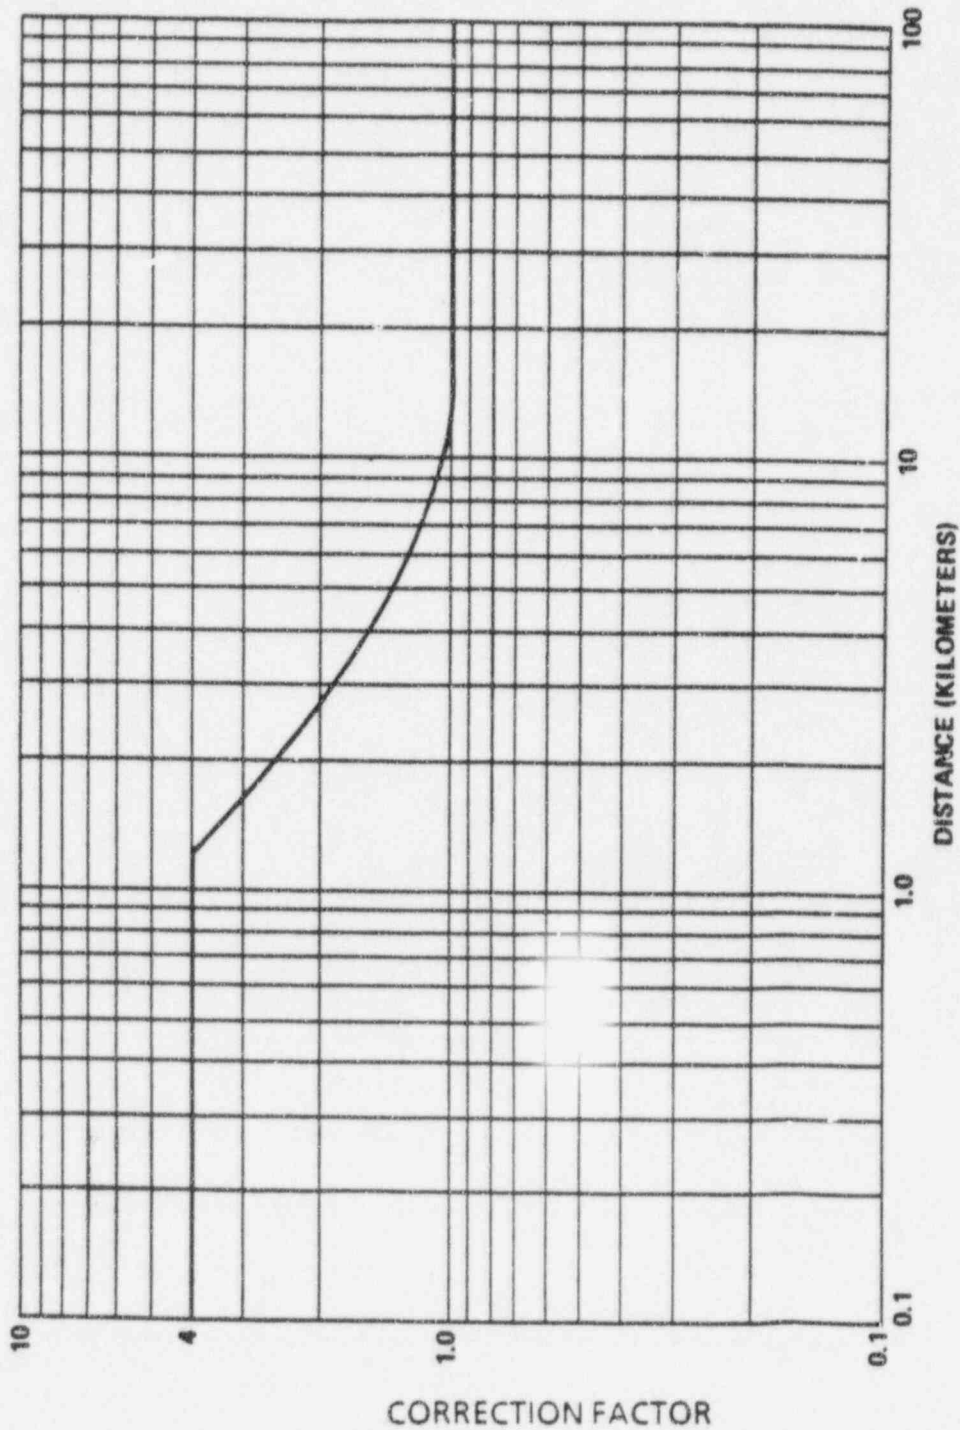

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

4.0 RADIOLOGICAL ENVIRONMENTAL MONITORING

Sampling locations as required in section 1.4.1 of the ODCM Specifications are described in Table 4.0-1 and shown on Figures 4.0-1 and 4.0-2. As indicated by the ditto ("") marks in the table, entries in the sampling frequency and analysis frequency columns apply to all samples below the entry until a new entry appears.

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
AIRBORNE: I. Particulate	A) 3 Indicator samples to be taken at locations (in different sectors) beyond but as close to the exclusion boundary as practicable where the highest offsite sectorial ground level concentrations are anticipated. ² B) 1 Indicator sample to be taken in the sector beyond but as close to the exclusion boundary as practicable corresponding to the residence having the highest anticipated offsite ground level concentration or dose. ² C) 1 Indicator sample to be taken at the location of one of the dairies most likely to be affected. ^{2,4} D) 1 Control sample to be taken at a location at least 10 air miles from the site and not in the most prevalent wind direction. ²	Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection.	5 6 7 7 144 17	0.9 SE 1.0ESE 1.0E 1.0 E 6.3 W 24.7 SE	Gross beta following filter change; Quarterly Composite (by location) for gamma isotopic. Gross beta following filter change; Quarterly Composite (by location) for gamma isotopic. Gross beta following filter change; Quarterly Composite (by location) for gamma isotopic. Gross beta following filter change; Quarterly Composite (by location) for gamma isotopic.

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
II. Radioiodine	<p>A) 3 Indicator samples to be taken at two locations as given in I(A) above.</p> <p>B) 1 Indicator sample to be taken at the location as given in I(B) above.</p> <p>C) 1 Indicator sample to be taken at the location as given in I(C) above.</p> <p>D) 1 Control sample to be taken at a location similar in nature to I(D) above.</p>	<p>Continuous sampler operation with weekly canister collection.</p> <p>Continuous sampler operation with weekly canister collection.</p> <p>Continuous sampler operation with weekly canister collection.</p> <p>Continuous sampler operation with weekly canister collection.</p>	<p>5 6 7</p> <p>7</p> <p>14</p> <p>17</p>	<p>0.9 SE 1.0ESE 1.0E</p> <p>1.0E</p> <p>6.3 W</p> <p>24.7 SE</p>	<p>Gamma Isotopic for I-131 weekly</p> <p>Gamma Isotopic for I-131 weekly</p> <p>Gamma Isotopic for I-131 weekly</p> <p>Gamma Isotopic for I-131 weekly</p>
III. Direct	<p>A) 13 Indicator stations to form an inner ring of stations in the 13 accessible sectors within 1 to 2 miles of the plant.</p>	<p>Monthly or quarterly exchange ^{5,7}; two or more dosimeters at each location.</p>	<p>1,2 3,4 5,6 7,8 9,10 29 30 47</p>	<p>1.2 S, 1.2 SW 1.2W, 1.2 WNW 0.9 S E, 1.0 ESE 1.0 E, 1.5 ENE 2.2 NE, 2.5 NNE 0.9 WSW, 1.0 SSW 1.0 NW</p>	<p>Gamma dose monthly or quarterly.</p>

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
	<p>B) 16 Indicator stations to form an inner ring of stations in the 16 accessible sectors within 3 to 5 miles of the plant.</p> <p>C) 8 Stations to be placed in special interest areas such as population centers, nearby residences, schools and in 2 or 3 areas to serve as controls.</p>	<p>Monthly or quarterly exchange^{5,7}; two or more dosimeters at each location.</p> <p>Monthly or quarterly exchange^{5,7}; two or more dosimeters at each location.</p>	<p>12,14 32,33 34,35 36,37 41,42 43 45 46 49 53,55</p> <p>11,13 15,16 17,18 31,54</p>	<p>4.2 N, 6.3 W 4.5 NNE, 4.2 ENE 4.8 ESE, 4.8 SE 3.1 SSE, 4.9 NW 3.9 S, 3.9 SSW 5.2 SW 5.9 WSW 3.7 WNW 4.0 NNW 3.0 NE, 2.8 E</p> <p>3.3 N, 2.9 NNW 2.5 SSW, 28.0 W 24.7 SE, 16.5 S 5.8 NNE, 1.7 ENE</p>	<p>Gamma dose monthly or quarterly.</p> <p>Gamma dose monthly or quarterly.</p>
<p>WATERBORNE: IV. Surface Water</p>	<p>A) 1 Indicator sample downstream to be taken at a location which allows for mixing and dilution in the ultimate receiving river.</p> <p>B) 1 Control sample to be taken at a location on the receiving river, sufficiently far upstream such that no effects of pumped storage operation are anticipated.</p>	<p>Time composite samples with collection every month.⁵</p> <p>Time composite samples with collection every month.⁵</p>	<p>21^{3,6}</p> <p>22³</p>	<p>2.7 SSW</p> <p>30.0 NNW</p>	<p>Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium.⁷</p> <p>Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium.⁷</p>

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
	C) 1 Indicator sample from a location immediately upstream of the nearest downstream municipal water supply.	Time composite samples with collection every month. ⁵	17	24.7 SE	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷
	D) 1 Indicator sample to be taken in the upper reservoir of the pumped storage facility at the plant discharge canal.	Time composite samples with collection every month. ⁵	23 ³	0.5 ESE	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷
	E) 1 Indicator sample to be taken in the upper reservoir's non-fluctuating recreational area.	Grab sampling monthly ⁵	24 ³	5.5 N	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷
	F) 1 Control sample to be taken at a location on a separated unaffected watershed reservoir.	Grab sampling monthly ⁵	18 ³	16.5 S	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷
	G) 1 Indicator sample to be taken in the upper reservoir at the intake of the pumped storage facility.	Time composite samples with collection every month. ⁵	25 ³	0.8 WNW	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
V. Ground Water	<p>A) 2 Indicator samples to be taken within the exclusion boundary and in the direction of potentially affected ground water supplies.</p> <p>B) 1 Control sample from unaffected location.</p>	<p>Quarterly grab sampling ⁷</p> <p>Quarterly grab sampling ⁷</p>	<p>26 27</p> <p>16</p>	<p>Onsite Onsite</p> <p>20 1 W</p>	<p>Gamma isotopic and tritium analyses quarterly.⁷</p> <p>Gamma isotopic and tritium analyses quarterly.⁷</p>
VI. Drinking Water	<p>A) 1 Indicator sample from a nearby public ground water supply source.</p> <p>B) 1 Indicator (finished water) sample from the nearest downstream water supply</p> <p>C) 1 Control (finished water) sample from an unaffected water supply.</p>	<p>Monthly grab sampling ⁵</p> <p>Monthly composite sampling</p> <p>Monthly composite sampling.</p>	<p>28</p> <p>17</p> <p>39</p>	<p>2.4 SSE</p> <p>24.7 S</p> <p>14.0 SSE</p>	<p>Monthly⁵ gamma isotopic and gross beta analyses and quarterly⁷ composite for tritium analyses.</p> <p>Monthly⁵ gamma isotopic and gross beta analyses and quarterly⁷ composite for tritium analyses.</p> <p>Monthly⁵ gamma isotopic and gross beta analyses and quarterly⁷ composite for tritium analyses.</p>

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
INGESTION: VII. Milk ⁴	A) Samples from milking animals in 3 locations within 5 km having the highest dose potential. If there are none then 1 sample from milking animals in each of 3 areas between 5 to 8 km distance where doses are calculated to be greater than 1 mrem per year. ¹⁰	Semimonthly when animals are on pasture ⁸ , monthly other times. ⁵	To be supplied when milk animals are found in accordance with criteria VII.A.		Gamma isotopic and I-131 analysis semimonthly ⁸ when animals are on pasture, monthly other times ⁵ .
	B) 1 Control sample to be taken at the location of a dairy > 20 miles distance and not in the most prevalent wind direction. ²	Semimonthly when animals are on pasture ⁸ , monthly other times. ⁵	16	20.1 W	Gamma isotopic and I-131 analysis semimonthly ⁸ when animals are on pasture, monthly other times ⁵ .
	C) 1 Indicator grass (forage) sample to be taken at one of the locations beyond but as close to the exclusion boundary as practicable where the highest offsite sectorial ground level concentrations are anticipated. ²	Monthly when available ⁵	7	1.0 E	Gamma isotopic.
	D) 1 Indicator grass (forage) sample to be taken at the location of VII(A) above when animals are on pasture.	Monthly when available ⁵	To be supplied when milk animals are found in accordance with criteria VII.A.		Gamma isotopic.

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
	E) 1 Control grass (forage) sample to be taken at the location of VII(B) above.	Monthly when available ⁵	16	20.1 W	Gamma isotopic.
VIII. Food Products	A) 2 samples of broadleaf vegetation grown in the 2 nearest offsite locations of highest calculated annual average ground level D/Q if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5-10 km where the doses are calculated to be greater than 1 mrem/yr. ¹⁰ B) 1 Control sample for the same foods taken at a location at least 10 miles distance and not in the most prevalent wind direction if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5-8 km where the doses are calculated to be greater than 1 mrem/yr. ¹⁰	Monthly when available. ⁵ Monthly when available. ⁵	6 7 18	1.0 ESE 1.0 E 16.5 S	Gamma isotopic on edible portion. Gamma isotopic on edible portion.
IX. Fish	A) 1 indicator sample to be taken at a location in the upper reservoir.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp; forage fish (shad).	23 ³	0.3-5	Gamma isotopic on edible portions semiannually. ⁹

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
	B) 1 Indicator sample to be taken at a location in the lower reservoir.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp; forage fish (shad).	21 ³	1-3	Gamma isotopic on edible portions semiannually ⁹ .
	C) 1 Indicator sample to be taken at a location in the upper reservoir's non-fluctuating recreational area.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp; forage fish (shad).	24 ³	5.5-6.5	Gamma isotopic on edible portions semiannually ⁹ .
	D) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp; forage fish (shad).	22 ³	30.0 NNW	Gamma isotopic on edible portions semiannually ⁹ .
AQUATIC: X. Sediment	A) 1 Indicator sample to be taken at a location in the upper reservoir	Semiannual grab sample. ⁹	23 ³	0.5 ESE	Gamma isotopic.
	B) 1 Indicator sample to be taken at a location in the upper reservoir's non-fluctuating recreational area.	Semiannual grab sample. ⁹	24 ³	5.5 N	Gamma isotopic.

ODCM, V.C. Summer, SCEandG: Revision 13 (June 1990)

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
 VIRGIL C. SUMMER NUCLEAR STATION
 TABLE 4.0-1**

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Locations Mi/Dir	Type & Frequency of Analysis
	C) 1 Indicator sample to be taken on the shoreline of the lower reservoir. D) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual grab sample ⁹ Semiannual grab sample ⁹	21 ³ 22 ³	2.7 SSW 30.0 NNW	Gamma isotopic. Gamma isotopic.

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1**

NOTES

- (1) Location numbers refer to Figures 4.0-1 and 4.0-2.
- (2) Sample site locations are based on 5 year average meteorological analysis.
- (3) Though generalized areas are noted for simplicity of sample site enumeration, airborne, water and sediment sampling is done at the same location whereas biological sampling sites are generalized areas in order to reasonably assure availability of samples.
- (4) Milking animal and garden survey results will be analyzed annually. Should the survey indicate new dairying activity the owners shall be contacted with regard to a contract for supplying sufficient samples. If contractual arrangements can be made, site(s) will be added for additional milk sampling up to a total of 3 Indicator Locations.
- (5) Not to exceed 35 days.
- (6) Time composite samples are samples which are collected with equipment capable of collecting an aliquot at time intervals which are short (e.g. hourly) relative to the compositing period.
- (7) At least once per 100 days.
- (8) At least once per 18 days.
- (9) At least once per 200 days.
- (10) The dose shall be calculated for the maximum organ and age group, using the guidance/methodology contained in Regulatory Guide 1.109, Rev. 1 and the parameters particular to the Site.

ODCM, V.C. Summer/SCEandG: Revision 18 (September 1994)

FIGURE 4.0-1
Radiological Environmental Sampling Locations (Local)


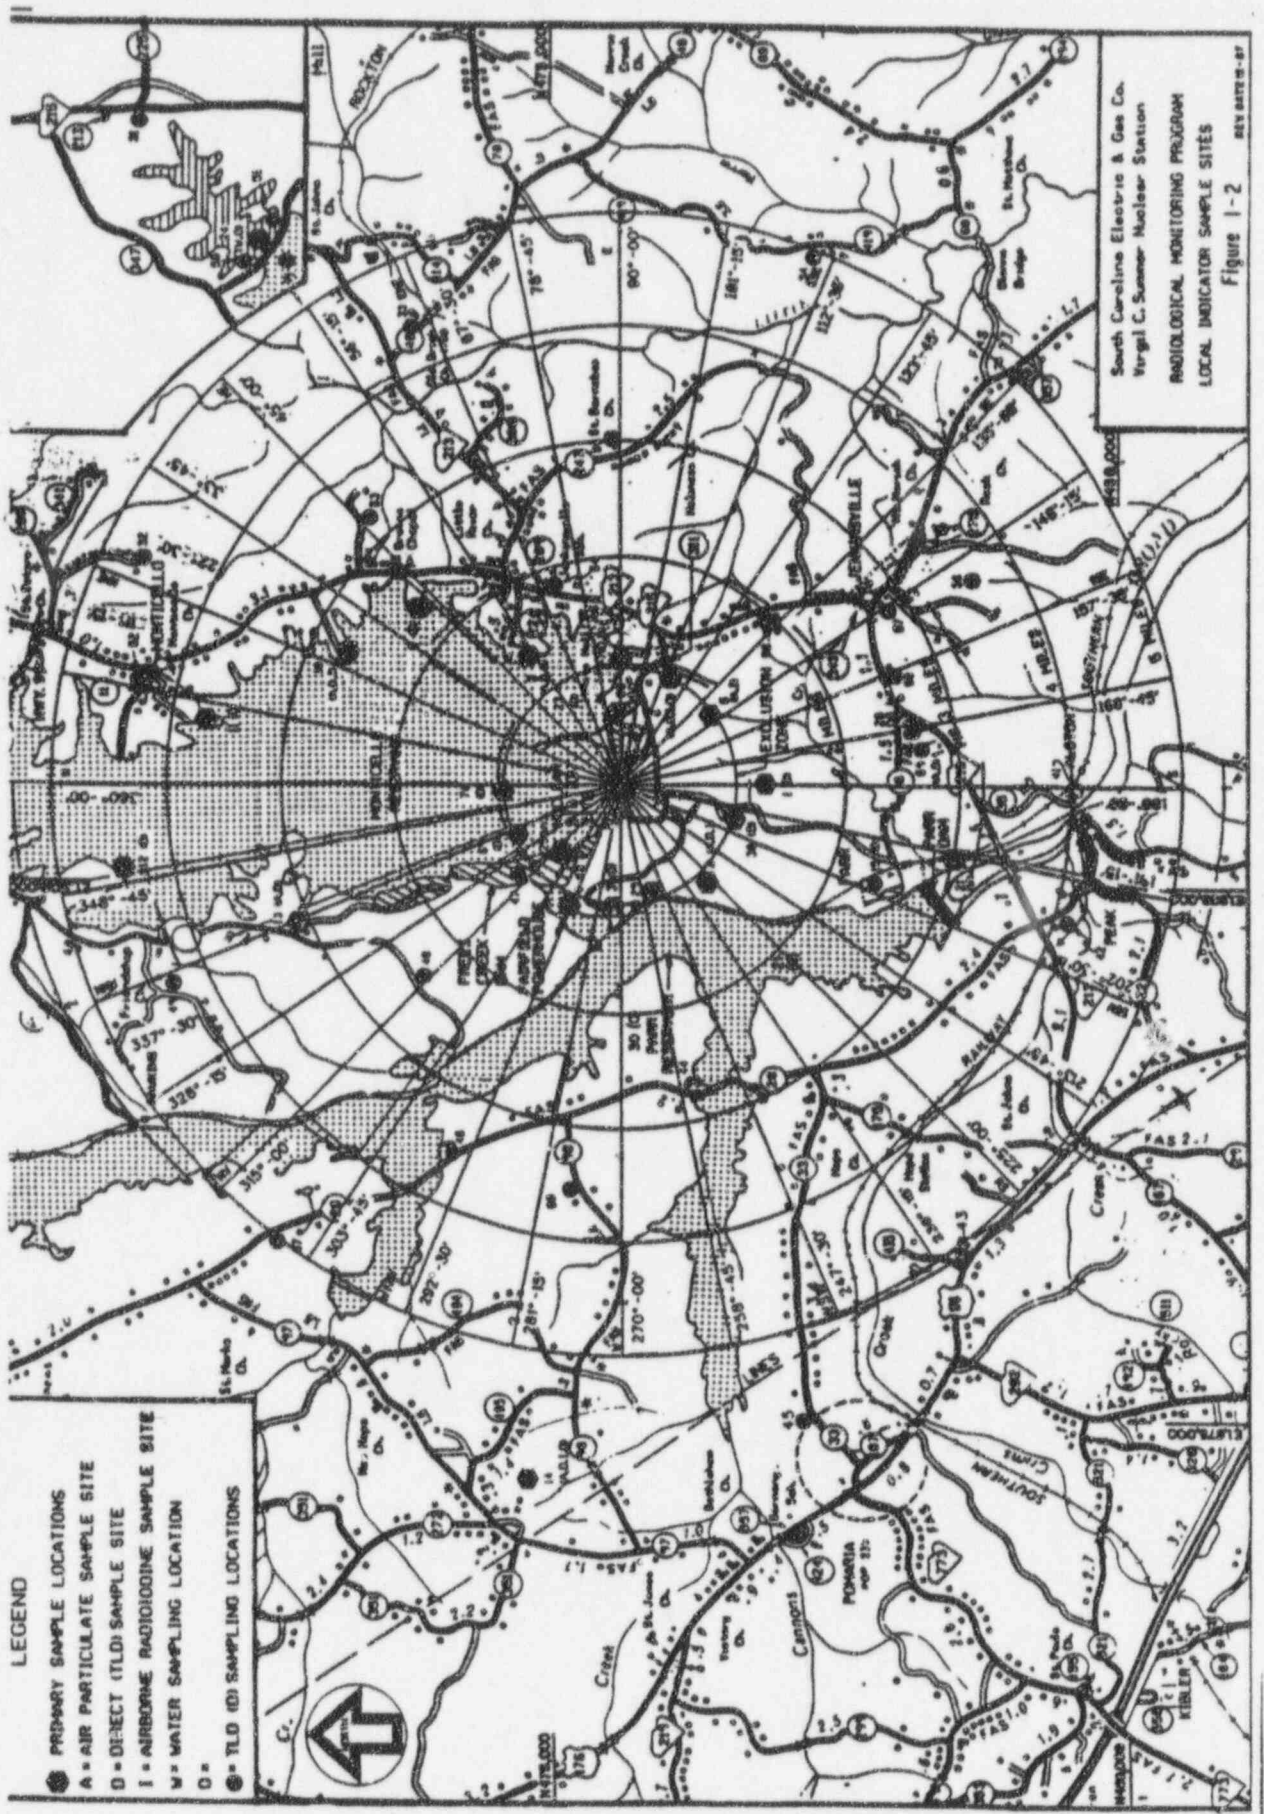


FIGURE 4.0-2

Radiological Environmental Sampling Locations
(Remote)

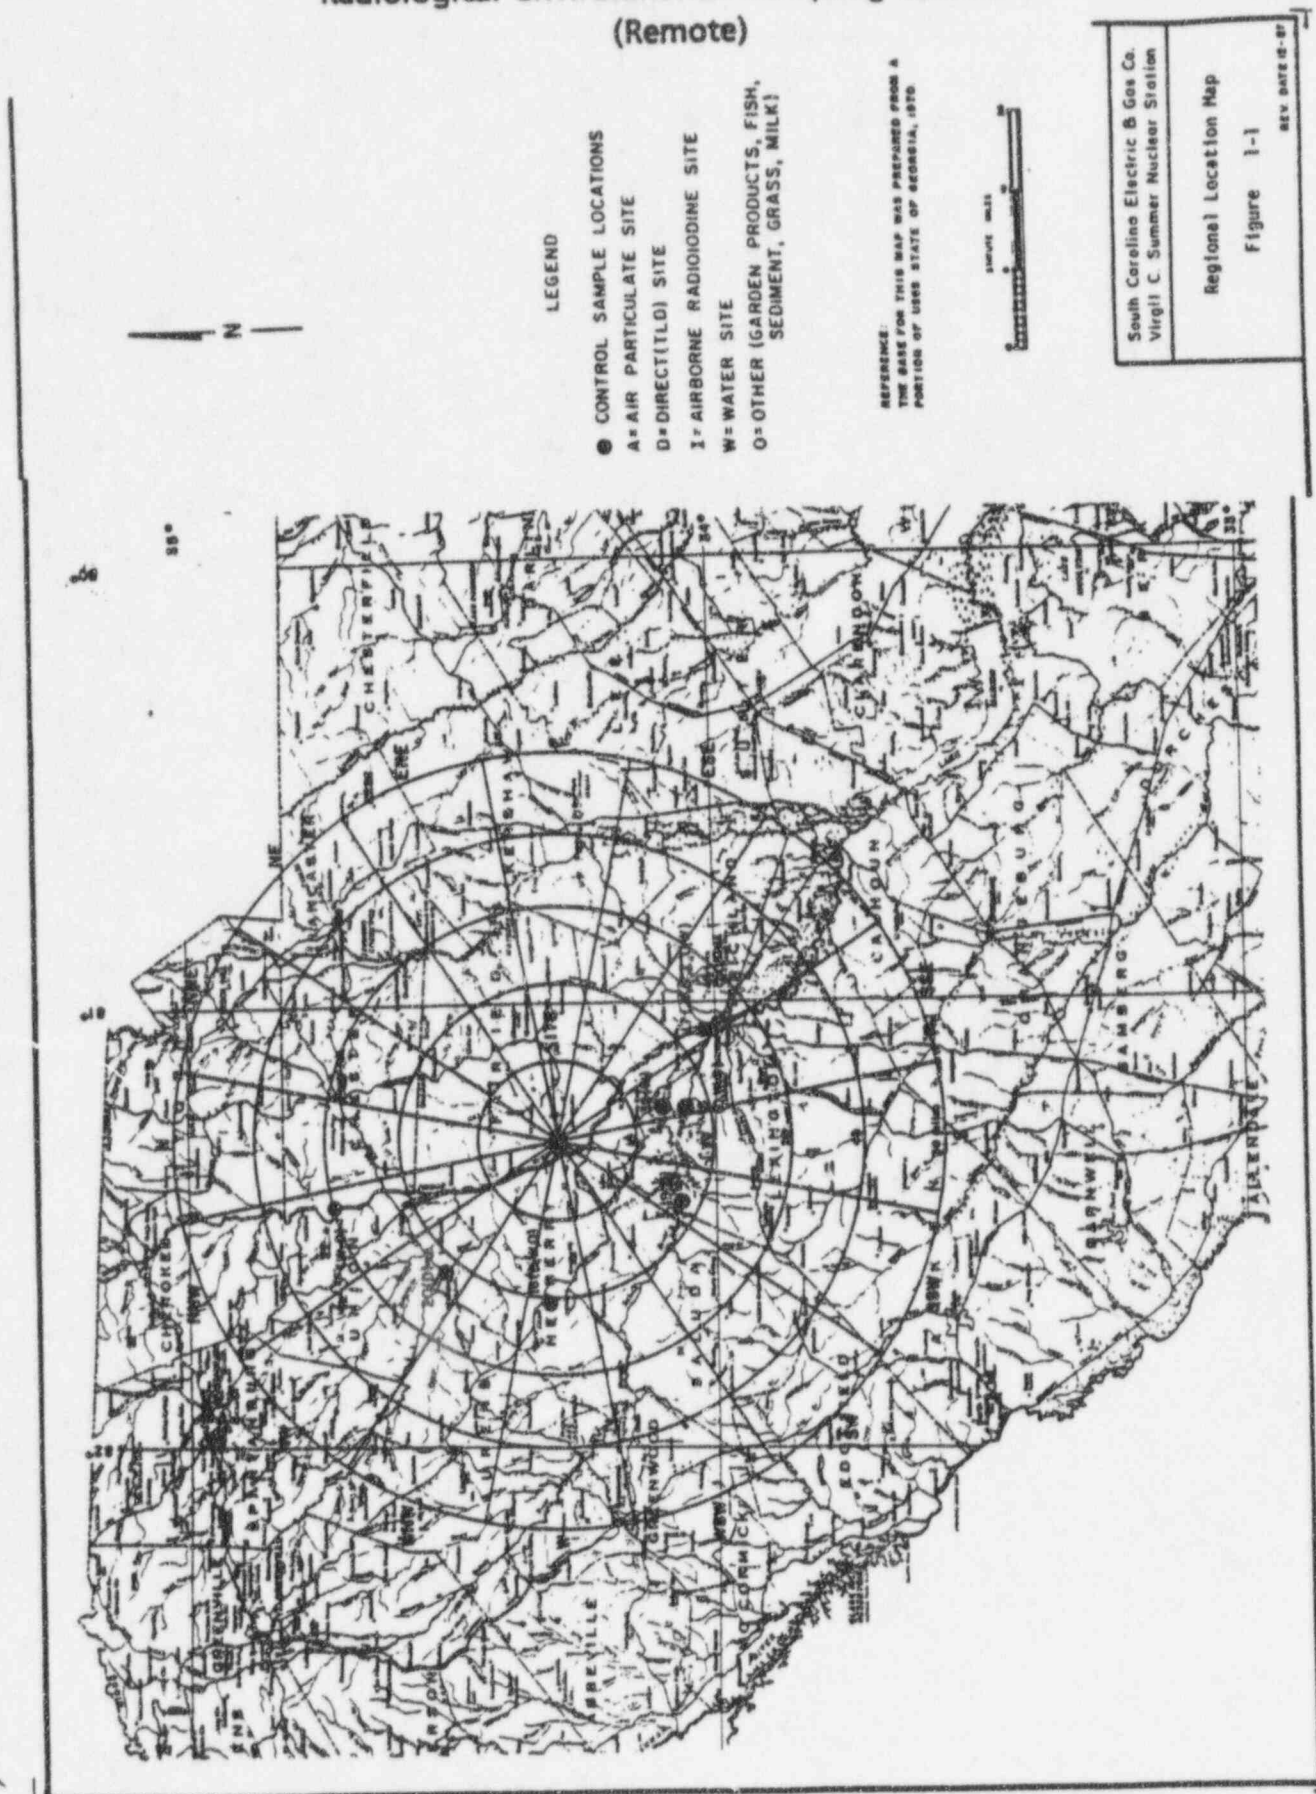

ATTACHMENT II

OFFSITE DOSE CALCULATION MANUAL

REVISION 20

DECEMBER 1995

ODCM (Revision 20) Changes	Comment
List of effective pages i and ii revised consistent with changes made in this revision.	none
Table 1.4-1, Radiological Environmental Monitoring Program, Airborne Particulate Item I (A) and (B), page 1.0-34; Footnote I deleted from criteria.	Note I states that sample locations are based on meteorological analysis for the period of record presented in the OLER. OLER meteorological analysis is based on pre-reservoir conditions (1975) and is not representative of present dispersion conditions. The criteria used for selection of sampling locations is specified in Footnote 1 to Table 4.0-1 which states that locations are based on 5 year average meteorological analysis.
Table 1.4-1, Radiological Environmental Monitoring Program, Airborne Particulate Item I (C), page 1.0-34; Criteria changed from "indicator sample to be taken at the location of one of the dairies most likely to be affected" to "1 indicator sample to be taken at the location of one of the dairies most likely to be affected as defined in VII (A)".	Sampling criteria for particulate sampling at the location of one of the dairies most likely to be affected was revised to limit the sampling criteria for air particulate to that required for monitoring dairy activity.
Table 1.4-1, Radiological Environmental Monitoring Program, Item I (D), page 1.0-34; Footnote I deleted from criteria.	See Table 1.4-1, item I (A) and (B) above.
Table 1.4-1, Radiological Environmental Monitoring Program, Item III Direct (C), page 1.0-34; Criteria revised increasing number of direct monitoring stations for special interest areas and control locations from 8 to 11. Additionally, the number of control locations is increased from "2 or 3" to "4 or 5".	This change makes the total number of environmental TLD locations consistent with NRC guidance and ensures an adequate level of monitoring.
Table 1.4-1, Radiological Environmental Monitoring Program, Item IV Surface Water (A) and (B), page 1.0-35; Reference to sample collection at the USGS continuous sampling site was deleted.	Including the criteria for sampling at a USGS monitoring point goes beyond regulatory requirements. Actual sample locations used for environmental monitoring, meeting specific monitoring point selection criteria, are described in ODCM Table 4.0-1.
Table 1.4-1, Radiological Environmental Monitoring Program, Item IV Surface Water (C), page 1.0-35; Criteria for 1 Indicator sample from a location immediately upstream of the nearest downstream municipal water supply was deleted.	Site 21 (Parr Reservoir- ODCM Criteria IV A) and site 23 (Monticello Reservoir) monitor the 2 liquid discharge pathways at VCSNS. These two locations are conservative indicators for other surface water locations. Sampling surface water at locations downstream of Parr Reservoir goes beyond regulatory requirements. Adequate monitoring of the City of Columbia drinking water is ensured through monitoring Columbia "finished water" (ODCM Criteria VI, Drinking Water Item B).

ODCM (Revision 20) Changes	Comment
Table 1.4-1, Radiological Environmental Monitoring Program, Item IV Surface Water (D), page 1.0-35; Item renumbered from (D) to (C). Additionally, reference to sample collection at the USGS continuous sampling site was deleted.	Including the criteria for sampling at a USGS monitoring point goes beyond regulatory requirements. Actual sample locations used for environmental monitoring, meeting specific monitoring point selection criteria, are described in ODCM Table 4.0-1.
Table 1.4-1, Radiological Environmental Monitoring Program, Item IV Surface Water (E), page 1.0-35; Criteria for 1 indicator sample to be taken in the upper reservoir's non fluctuating recreational area was deleted.	Site 21 (Parr Reservoir) and site 23 (Monticello Reservoir) monitor the 2 liquid discharge pathways at VCSNS and are conservative indicators for other surface water locations.
Table 1.4-1, Radiological Environmental Monitoring Program, Item IV Surface Water (F), page 1.0-35; Criteria for 1 control sample to be taken on a separate unaffected watershed reservoir was deleted.	This criteria for an additional control location in this sampling category goes beyond regulatory requirements and provides little benefit in quantification of public dose.
Table 1.4-1, Radiological Environmental Monitoring Program, Item IV Surface Water (G), page 1.0-35; Criteria for 1 indicator sample to be taken in the upper reservoir at the intake of the pumped storage facility.	Site 21 (Parr Reservoir) and site 23 (Monticello Reservoir) monitor the 2 liquid discharge pathways at VCSNS and are conservative indicators for other surface water locations.
Table 1.4-1, Radiological Environmental Monitoring Program, Item VII Milk (B), page 1.0-36; Footnote (1) notation deleted. Footnote (8) added to sampling and collection frequency.	<p>Note 1 states that sample locations are based on meteorological analysis for the period of record presented in the OLER. OLER meteorological analysis is based on pre-reservoir conditions (1975) and is not representative of present dispersion conditions. The criteria used for selection of sampling locations is specified in Footnote 1 to Table 4.0-1 which states that locations are based on 5 year average meteorological analysis.</p> <p>Note (8) states that milk and forage sampling at the control location is only required when milk is being sampled from indicator locations meeting the criteria of VII (A). Criteria VII (A) requires sampling from dairies within 5 miles distant from VCSNS where projected doses exceed 1 mrem. There are no locations in the vicinity of VCSNS that meet this criteria and therefore a milk indicator location is not identified. Sampling at a control location when indicator samples are not being obtained provides no useful data for quantification of offsite dose.</p>
Table 1.4-1, Radiological Environmental Monitoring Program, Item VII Milk (C), page 1.0-36; Criteria for 1 indicator forage sample from the nearest offsite location with the highest anticipated ground level concentration was deleted.	This monitoring criteria goes beyond regulatory requirements. Monitoring of forage in the vicinity of VCSNS will continue as part of the supplemental environmental monitoring program.

ODCM (Revision 20) Changes	Comment
Table 1.4-1, Radiological Environmental Monitoring Program, Items VII Milk (D and E), page 1.0-36; Footnote reference (8) added to criteria (E). Items renumbered to (C) and (D).	See Table 1.4-1, Item VII Milk (B), above.
Table 1.4-1, Radiological Environmental Monitoring Program, Items VIII Food Products (A), page 1.0-36; Monitoring criteria revised from "5-10 km" to "5-8 km".	Typographical correction.
Table 1.4-1, Radiological Environmental Monitoring Program, Items IX Fish (A,B,and D), page 1.0-37; Fish sampling and collection frequency revised deleting requirement for sampling forage fish (shad).	Thread Fin and Gizzard Shad present in the vicinity of VCSNS are not preferred as food. These fish are not considered a significant component of the of the ingestion exposure pathway.
Table 1.4-1, Radiological Environmental Monitoring Program, Items IX Fish (C), page 1.0-37; Criteria for 1 indicator sample to be taken at a location in the upper reservoir's non-fluctuating recreational area was deleted.	Site 21 (Parr Reservoir- ODCM Criteria IV A) and site 23 (Monticello Reservoir) monitor the 2 liquid discharge pathways at VCSNS. These two locations are conservative indicators for other locations.
Table 1.4-1, Radiological Environmental Monitoring Program, Items IX Fish (D), page 1.0-37; Item renumbered from (D) to (C).	none
Table 1.4-1, Radiological Environmental Monitoring Program, Items X Sediment (B), page 1.0-37; Criteria for 1 indicator sample to be taken at a location in the upper reservoir's non-fluctuating recreational area was deleted.	Site 21 (Parr Reservoir) and site 23 (Monticello Reservoir) monitor the 2 liquid discharge pathways at VCSNS. These two locations are conservative indicators for the recreational area (site 24).
Table 1.4-1, Radiological Environmental Monitoring Program, Item X Sediment (C), page 1.0-37; Criteria changed from "1 indicator sample to be taken <u>on</u> the shoreline of the lower reservoir" to "1 indicator sample to be taken <u>on or near</u> the shoreline of the lower reservoir". Item renumbered from (C) to (B).	Sample criteria changed to ensure that sediment samples are taken from areas flooded where there is interaction between water and sediment.
Table 1.4-1, Radiological Environmental Monitoring Program, Item X Sediment (C), page 1.0-37; Item (D) renumbered as (C).	none
Table 1.4-1, Radiological Environmental Monitoring Program, Notes, page 1.0-38; Note (1) deleted and replaced with "Reserved".	Note 1 stated that sample locations are based on meteorological analysis for the period of record presented in the OLER. OLER meteorological analysis is based on pre-reservoir conditions (1975) and is not representative of present dispersion conditions. The criteria used for selection of sampling locations is specified in Footnote (1) to Table 4.0-1 which states that locations are based on 5 year average meteorological analysis.
Table 1.4-1, Radiological Environmental Monitoring Program, Notes, page 1.0-38; Note (8) added as follows "Milk and forage sampling at the control location is only required when locations meeting the criteria of VII (A) are being sampled".	Criteria VII (A) requires sampling from dairies within 5 miles distant from VCSNS where projected doses exceed 1 mrem. There are no locations in the vicinity of VCSNS that meet this criteria and therefore a milk indicator location is not identified. Sampling at a control location

ODCM (Revision 20) Changes	Comment
	when indicator samples are not being obtained provides no useful data for quantification of offsite dose.
Pages 2.0-34 through 2.0-40 renumbered to 2.0-36 through 2.0-42.	Change made to incorporate new section 2.3. See below.
Section 2.3, "Liquid Effluent Releases through Unmonitored Pathways, Pages 2.0-34 and 35 added; See attached entire section.	Section added to allow operational flexibility in dealing with radiologically contaminated water in the RWST sump ("rainwater tank") and the NaOH tank while maintaining effluent releases well within Summer Station release limits. The low level radioactive material releases are maintained as a small fraction of the offsite liquid limits through a dual sample and batch release program
Table 4.0-1, Radiological Environmental Monitoring Program, Airborne Particulate, Item I (A), page 4.0-2; Sample locations changed from "5,6, and 7" to "2,7, and 30".	Changes based on review of meteorological data with consideration of reservoir effect (ref. TWR HP-5.4.3-95-019).
Table 4.0-1, Radiological Environmental Monitoring Program, Airborne Particulate, Item I (B), page 4.0-2; Sample location changed from 7 to 6.	Changes based on review of meteorological data with consideration of reservoir effect and census data (ref. TWR HP-5.4.3-95-019).
Table 4.0-1, Radiological Environmental Monitoring Program, Airborne Particulate, Item I (C), page 4.0-2; Criteria changed from "1 indicator sample to be taken at the location of one of the dairies most likely to be affected" to 1 indicator sample to be taken at the location of one of the dairies most likely to be affected as defined in VII (A)". Sample location changed from 14 to "N/A".	See Table 1.4-1, Item I (C) above.
Table 4.0-1, Radiological Environmental Monitoring Program, Airborne Particulate, Item I (D), page 4.0-2; Distance for sample location 17 changed from 24.7 to 25.0 miles.	Change based on best available distance measurement.
Table 4.0-1, Radiological Environmental Monitoring Program, Airborne Radioiodine, Item II (A), page 4.0-3; Sample locations changed from "5,6, and 7" to "2,7, and 30".	See Table 1.4-1, Item II (A), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Airborne Radioiodine, Item II (B), page 4.0-3; Sample location changed from "7" to "6".	See Table 4.0-1, Item I (B), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Airborne Radioiodine, Item II (C), page 4.0-3; Sample location changed from 14 to "N/A".	See Table 1.4-1, Item I (C), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Airborne Radioiodine, Item I(D), page 4.0-3; Distance for sample location 17 changed from 24.7 to 25.0 miles.	Change based on best available distance measurement.

ODCM (Revision 20) Changes	Comment
Table 4.0-1, Radiological Environmental Monitoring Program, Direct, Item III(B), page 4.0-3; Sample locations "14, 45, and 49" deleted and replaced with "13, 44, and 60".	This change made to maintain an adequate number of NRC/ VCSNS co-located TLDs.
Table 4.0-1, Radiological Environmental Monitoring Program, Direct, Item III(C), page 4.0-4; Criteria changed from "8 stations to be placed in special interest areas such as population centers, nearby residences, schools and in 2 or 3 areas to serve as controls" to "11 stations to be placed in special interest areas such as population centers, nearby residences, schools and in 4 or 5 areas to serve as controls" Sample locations "11, 13, and 15" were deleted and replaced with "19, 20, 45, 52, 56, and 58".	This change made to ensure an appropriate level of monitoring and maintain an adequate number of NRC/ VCSNS co-located TLDs.
Table 4.0-1, Radiological Environmental Monitoring Program, Surface Water, Item IV(B), page 4.0-4; Distance for sampling location 22 changed from 30.0 to 26.0 miles.	Change based on best available distance measurement.
Table 4.0-1, Radiological Environmental Monitoring Program, Surface Water, Item IV(C), page 4.0-5; Sampling criteria for sampling surface water from the nearest downstream municipal water supply was deleted.	See Table 1.4-1, Item IV (C), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Surface Water, Item IV(D), page 4.0-5; Item renumbered from (D) to (C).	none
Table 4.0-1, Radiological Environmental Monitoring Program, Surface Water, Item IV(E), page 4.0-5; Sampling criteria for sampling surface water from the upper reservoir's non-fluctuating recreational area was deleted.	See Table 1.4-1, Item IV (E), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Surface Water, Item IV(F), page 4.0-5; Sampling criteria for sampling surface water from the nearest unaffected watershed reservoir was deleted.	See Table 1.4-1, Item IV (F), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Surface Water, Item IV(G), page 4.0-5; Sampling criteria for sampling surface water at the intake of the pumped storage facility was deleted.	See Table 1.4-1, Item IV (G), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Ground Water, Item V(B), page 4.0-6; Sample location changed from 16 to 59.	The monitoring well at the Nuclear Training Center (2.6 miles SSE) is sufficiently distant from VCSNS to serve as a ground water control.
Table 4.0-1, Radiological Environmental Monitoring Program, Drinking Water, Item VI(B), page 4.0-6; Distance for sampling location 17 changed from 24.7 to 25.0 miles.	Change based on best available distance measurement.

ODCM (Revision 20) Changes	Comment
Table 4.0-1, Radiological Environmental Monitoring Program, Milk, Item VII(B), page 4.0-7; Footnote reference (11) added to the control milk sampling and collection frequency indicating that sampling from the control location is only required when samples from the indicator location are being collected.	Note (11) states that milk and forage sampling at the control location is only required when milk is being sampled from indicator locations meeting the criteria of VII (A). Criteria VII (A) requires sampling from dairies within 5 miles distant from VCSNS where projected doses exceed 1 mrem. There are no locations in the vicinity of VCSNS that meet this criteria and therefore a milk indicator location is not identified. Sampling at a control location when indicator samples are not being obtained provides no useful data for quantification of offsite dose.
Table 4.0-1, Radiological Environmental Monitoring Program, Item VII Milk (C), page 4.0-7; Criteria for 1 indicator forage sample from the nearest offsite location with the highest anticipated ground level concentration was deleted.	This monitoring criteria goes beyond regulatory requirements. Monitoring of forage in the vicinity of VCSNS will continue as part of the supplemental environmental monitoring program.
Table 4.0-1, Radiological Environmental Monitoring Program, Items VII Milk (D and E), page 4.0-7,8; Footnote reference (11) added to criteria (E). Items renumbered to (C) and (D).	See Table 4.0-1, Item VII (B), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Items VIII Food Products (A), page 4.0-8; Monitoring criteria revised from "5-10 km" to "5-8 km".	Typographical correction.
Table 4.0-1, Radiological Environmental Monitoring Program, Items IX Fish (A,B,and D), pages 4.0-8,9; Fish sampling and collection frequency revised deleting requirement for sampling forage fish (shad). Item (D) sampling location distance changed from 30.0 to 26.0 miles and renumbered to Item (C).	See Table 1.4-1, Items IX (A, B, and D), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Items IX Fish (C), page 4.0-9; Criteria for 1 indicator sample to be taken at a location in the upper reservoir's non-fluctuating recreational area was deleted.	See Table 1.4-1, Item IX (C), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Items X Sediment (B), page 4.0-9; Criteria for 1 indicator sample to be taken at a location in the upper reservoir's non-fluctuating recreational area was deleted.	See Table 1.4-1, Item X (B), above.
Table 4.0-1, Radiological Environmental Monitoring Program, Items X Sediment (C andD), page 4.0-9; Criteria for item (C) changed from "1 indicator sample to be taken on the shore line of the lower reservoir" to "1 indicator sample to be taken on or near the shoreline of the lower reservoir". Items (C and D) renumbered to (B and C).	See Table 1.4-1, item X (C), above.

ODCM (Revision 20) Changes	Comment
Table 4.0-1, Radiological Environmental Monitoring Program, Notes, page 4.0-11; Note (11) added as follows "Milk and forage sampling at the control location is only required when locations meeting the criteria of VII (A) are being sampled".	See Table 1.4-1, Note (8), above.

Control Copy No. _____

OFFSITE DOSE CALCULATION MANUAL
FOR
SOUTH CAROLINA ELECTRIC AND GAS COMPANY
VIRGIL C. SUMMER NUCLEAR STATION

Approval *S.H.A. Blue* | *11/28/95*
General Manager, Nuclear Plant Operations Date

PSRC Approval *BC Williams* | *(95-45) 11/28/95*
Date

Revision 20
November 1995

Reviewed by: *[Signature]* | *11/28/95*
Date

Approved by: *S.A. Blue* | *11-28-95*
Date

LIST OF EFFECTIVE PAGES

<u>Page</u>	<u>Revision</u>	<u>Page</u>	<u>Revision</u>
i	20	1.0-34	20
ii	20	1.0-35	20
iii	17	1.0-36	20
iv	20	1.0-37	20
v	20	1.0-38	20
vi	20	1.0-39	17
vii	17	1.0-40	15
viii	17	1.0-41	15
ix	17	1.0-42	16
x	17	1.0-43	16
xi	17	1.0-44	15
		1.0-45	15
		1.0-46	17
		1.0-47	17
		1.0-48	17
		1.0-49	15
1.0-1	19	1.0-50	15
1.0-2	13	1.0-51	19
1.0-3	13	1.0-52	19
1.0-4	13	1.0-53	16
1.0-5	13	1.0-54	16
1.0-6	13	1.0-55	16
1.0-7	18	1.0-56	16
1.0-8	13		
1.0-9	13		
1.0-10	18		
1.0-11	13	2.0-1	13
1.0-12	13	2.0-2	16
1.0-13	13	2.0-3	16
1.0-14	13	2.0-4	16
1.0-15	13	2.0-5	16
1.0-16	13	2.0-6	13
1.0-17	19	2.0-7	13
1.0-18	15	2.0-8	13
1.0-19	15	2.0-9	13
1.0-20	15	2.0-10	13
1.0-21	15	2.0-11	13
1.0-22	15	2.0-12	13
1.0-23	19	2.0-13	13
1.0-24	17	2.0-14	13
1.0-25	17	2.0-15	13
1.0-26	15	2.0-16	17
1.0-27	19	2.0-17	17
1.0-28	18	2.0-18	16
1.0-29	18	2.0-19	16
1.0-30	15	2.0-20	16
1.0-31	15	2.0-21	16
1.0-32	15	2.0-22	16
1.0-33	15		

LIST OF EFFECTIVE PAGES (continued)

<u>Page</u>	<u>Revision</u>	<u>Page</u>	<u>Revision</u>
2.0-23	16	3.0-26	13
2.0-24	16	3.0-27	13
2.0-25	16	3.0-28	13
2.0-26	16	3.0-29	13
2.0-27	16	3.0-30	13
2.0-28	17	3.0-31	13
2.0-29	17	3.0-32	13
2.0-29a	18	3.0-33	13
2.0-30	17	3.0-34	13
2.0-31	17	3.0-35	13
2.0-32	17	3.0-36	13
2.0-33	17	3.0-37	16
2.0-34	20	3.0-38	17
2.0-35	20	3.0-39	17
2.0-36	20	3.0-40	13
2.0-37	20	3.0-41	13
2.0-38	20	3.0-42	13
2.0-39	20	3.0-43	14
2.0-40	20	3.0-44	13
2.0-41	20	3.0-45	16
2.0-42	20	3.0-46	16
		3.0-47	16
3.0-1	13	3.0-48	13
3.0-2	13	3.0-49	13
3.0-3	17	3.0-50	13
3.0-4	13	3.0-51	13
3.0-5	13	3.0-52	13
3.0-6	17		
3.0-7	13	4.0-1	13
3.0-8	18	4.0-2	20
3.0-9	13	4.0-3	20
3.0-10	19	4.0-4	20
3.0-10A	16	4.0-5	20
3.0-11	13	4.0-6	20
3.0-12	15	4.0-7	20
3.0-13	14	4.0-8	20
3.0-14	13	4.0-9	20
3.0-15	16	4.0-10	13
3.0-16	17	4.0-11	18
3.0-17	16	4.0-12	18
3.0-18	13	4.0-13	18
3.0-19	13		
3.0-20	13		
3.0-21	13		
3.0-22	13		
3.0-23	13		
3.0-24	13		
3.0-25	13		

Table of Contents

	<u>PAGE</u>
List of Effective Pages	i
Table of Contents	iii
List of Tables	v
List of Figures	vi
References	vii
Introduction	viii
Responsibilities	ix
1.0 <u>SPECIFICATION OF LIMITING CONDITIONS FOR OPERATION</u>	
1.1 <u>Liquid Effluents</u>	1.0-1
1.1.1 Radioactive Liquid Effluent Monitoring Instrumentation	1.0-1
1.1.2 Liquid Effluents: Concentration	1.0-8
1.1.3 Liquid Effluents: Dose	1.0-14
1.1.4 Liquid Waste Treatment	1.0-15
1.2 <u>Gaseous Effluents</u>	1.0-17
1.2.1 Radioactive Gaseous Effluent Monitoring Instrumentation	1.0-17
1.2.2 Gaseous Effluents: Dose Rate	1.0-23
1.2.3 Gaseous Effluents: Dose - Noble Gas	1.0-26
1.2.4 Gaseous Effluents: Dose - Radioiodines, Tritium and Radioactive Materials in Particulate Form ..	1.0-27
1.2.5 Gaseous Radwaste Treatment	1.0-28
1.3 <u>Radioactive Effluents: Total Dose</u>	1.0-30
1.4 <u>Radiological Environmental Monitoring</u>	1.0-32
1.4.1 Monitoring Program	1.0-32
1.4.2 Land Use Census	1.0-42
1.4.3 Interlaboratory Comparison Program	1.0-44
1.5 <u>Bases</u>	1.0-45
1.6 <u>Reporting Requirements</u>	1.0-50
1.6.1 Annual Radiological Environmental Operating Report	1.0-50
1.6.2 Semiannual Radioactive Effluent Release Report	1.0-51
1.6.3 Major Changes to Radioactive Waste Treatment System (Liquid and Gaseous)	1.0-53
1.7 Definitions	1.0-55

Table of Contents

	<u>PAGE</u>
List of Effective Pages	i
Table of Contents	iii
List of Tables	v
List of Figures	vi
References	vii
Introduction	viii
Responsibilities	ix
1.0 <u>SPECIFICATION OF LIMITING CONDITIONS FOR OPERATION</u>	
1.1 <u>Liquid Effluents</u>	1.0-1
1.1.1 Radioactive Liquid Effluent Monitoring Instrumentation	1.0-1
1.1.2 Liquid Effluents: Concentration	1.0-8
1.1.3 Liquid Effluents: Dose	1.0-14
1.1.4 Liquid Waste Treatment	1.0-15
1.2 <u>Gaseous Effluents</u>	1.0-17
1.2.1 Radioactive Gaseous Effluent Monitoring Instrumentation	1.0-17
1.2.2 Gaseous Effluents: Dose Rate	1.0-23
1.2.3 Gaseous Effluents: Dose - Noble Gas	1.0-26
1.2.4 Gaseous Effluents: Dose - Radioiodines, Tritium and Radioactive Materials in Particulate Form ..	1.0-27
1.2.5 Gaseous Radwaste Treatment	1.0-28
1.3 <u>Radioactive Effluents: Total Dose</u>	1.0-30
1.4 <u>Radiological Environmental Monitoring</u>	1.0-32
1.4.1 Monitoring Program	1.0-32
1.4.2 Land Use Census	1.0-42
1.4.3 Interlaboratory Comparison Program	1.0-44
1.5 <u>Bases</u>	1.0-45
1.6 <u>Reporting Requirements</u>	1.0-50
1.6.1 Annual Radiological Environmental Operating Report	1.0-50
1.6.2 Semiannual Radioactive Effluent Release Report	1.0-51
1.6.3 Major Changes to Radioactive Waste Treatment System (Liquid and Gaseous)	1.0-53
1.7 Definitions	1.0-55

2.0	<u>LIQUID EFFLUENT</u>	
2.1	<u>Liquid Effluent Monitor Setpoint Calculation</u>	2.0-1
2.1.1	Liquid Effluent Monitor Setpoint Calculation Parameters	2.0-2
2.1.2	Liquid Radwaste Effluent Line Monitors	2.0-6
2.1.3	Liquid Radwaste Discharge Via Industrial and Sanitary Waste System	2.0-14
2.1.4	Steam Generator Blowdown, Turbine Building Sump, and Condensate Demineralizer Backwash Effluent Lines	2.0-15
2.2	<u>Dose Calculation for Liquid Effluents</u>	2.0-32
2.2.1	Liquid Effluent Dose Calculation Parameters	2.0-32
2.2.2	Methodology	2.0-33
2.3	<u>Liquid Effluent Releases through the Neutralization Basin</u>	2.0-34
2.3.1	Rainwater Tank	2.0-34
2.3.2	NaOH Spray Tank and Stored NaOH	2.0-35
3.0	<u>GASEOUS EFFLUENT</u>	3.0-1
3.1	<u>Gaseous Effluent Monitor Setpoints</u>	3.0-1
3.1.1	Gaseous Effluent Monitor Setpoint Calculation Parameters	3.0-1
3.1.2	Station Vent Noble Gas Monitors	3.0-5
3.1.3	Waste Gas Decay System Monitor	3.0-7
3.1.4	Alternative Methodology for Establishing Conservative Setpoints	3.0-8
3.1.5	Oil Incineration	3.0-10
3.1.6	Meteorological Release Criteria for Batch Releases	3.0-10
3.2	<u>Dose Calculation for Gaseous Effluent</u>	3.0-12
3.2.1	Gaseous Effluent Dose Calculation Parameters	3.0-12
3.2.2	Unrestricted Area Boundary Dose	3.0-14
3.2.3	Unrestricted Area Dose to Individual	3.0-15
3.3	<u>Meteorological Model for Dose Calculations</u>	3.0-45
3.3.1	Meteorological Model Parameters	3.0-45
3.3.2	Meteorological Model	3.0-46
4.0	<u>RADIOLOGICAL ENVIRONMENTAL MONITORING</u>	4.0-1

LIST OF FIGURES

<u>Figure No.</u>		<u>Page No.</u>
2.1-1	Example Liquid Monitor Calibration Curve	2.0-31
2.2-1	Liquid Radwaste Treatment System	2.0-41
3.1-1	Example Noble Gas Monitor Calibration Curve	3.0-11
3.2-1	Gaseous Radwaste Treatment System	3.0-44
3.3-1	Plume Depletion Effect for Ground Level Releases (δ)	3.0-49
3.3-2	Vertical Standard Deviation of Material in a Plume (σ_z)	3.0-50
3.3-3	Relative Deposition for Ground Level Releases (D_g)	3.0-51
3.3-4	Open Terrain Recirculation Factor	3.0-52
4.0-1	Radiological Environmental Sampling Locations (Local)	4.0-12
4.0-2	Radiological Environmental Sampling Locations (Remote)	4.0-13

LIST OF TABLES

<u>Table No.</u>		<u>Page No.</u>
1.1-1	Radioactive Liquid Effluent Monitoring Instrumentation ..	1.0-2
1.1-2	Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements	1.0-5
1.1-3	Frequency Notation	1.0-7
1.1-4	Radioactive Liquid Waste Sampling and Analysis Program .	1.0-10
1.2-1	Radioactive Gaseous Effluent Monitoring Instrumentation	1.0-18
1.2-2	Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements	1.0-20
1.2-3	Radioactive Gaseous Waste Sampling and Analysis Program	1.0-23
1.4-1	Radiological Environmental Monitoring Program	1.0-34
1.4-2	Reporting Levels for Radioactivity Concentrations in Environ- mental Samples Reporting Levels	1.0-38
1.4-3	Maximum Values for the Lower Limits of Detection (LLD) a,c Reporting Levels	1.0-39
2.2-1	Bioaccumulation Factors	2.0-36
2.2-2	Adult Ingestion Dose Factors	2.0-37
2.2-3	Site Related Ingestion Dose Commitment Factor (A_{IT})	2.0-39
3.1-1	Dose Factors for Exposure to a Semi-Infinite Cloud of Noble Gases	3.0-4
3.1-2	Favorable Meteorology	3.0-10A
3.2-1	Pathway Dose Factors for Section 3.2.2.2. (P_i)	3.0-18
3.2-2	Pathway Dose Factors for Section 3.2.3.2. (R_i)	3.0-21
3.2-3	Pathway Dose Factors for Section 3.2.3.3. (R_i) (Infant)	3.0-24
3.2-4	Pathway Dose Factors for Section 3.2.3.3. (R_i) (Child)	3.0-27
3.2-5	Pathway Dose Factors for Section 3.2.3.3. (R_i) (Teenager) ..	3.0-30
3.2-6	Pathway Dose Factors for Section 3.2.3.3. (R_i) (Adult)	3.0-33
3.2-7	Controlling Receptors, Locations, and Pathways	3.0-37
3.2-8	Atmospheric Dispersion Parameters for Controlling Receptor Locations	3.0-39
3.2-9	Parameters Used in Dose Factor Calculations	3.0-40
4.0-1	Radiological Environmental Monitoring Program	4.0-2

REFERENCES

1. Boegli, T.S., R.R. Bellamy, W.L. Britz, and R.L. Waterfield, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants" NUREG-0133 (October 1978).
2. "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR 50, Appendix I", U.S. NRC Regulatory Guide 1.109 (March 1976).
3. "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR 50, Appendix I", U.S. NRC Regulatory Guide 1.109, Rev. 1 (October 1977).
4. "Final Safety Analysis Report", South Carolina Electric and Gas Company, Virgil C. Summer Nuclear Station.
5. "Operating License Environmental Report", South Carolina Electric and Gas Company, Virgil C. Summer Nuclear Station.
6. Wahlig, B.G., "Estimation of the Radioactivity Release Rate/Equilibrium Concentration Relationship for the Parr Pumped Storage System", Applied Physical Technology, Inc., February 1981.
7. "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light - Water - Cooled Reactors", U.S. NRC Regulatory Guide 1.111 (March 1976).
8. "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light - Water - Cooled Reactors", U.S. NRC Regulatory Guide 1.111, Rev. 1 (July 1977).
9. Slade, D.H., (editor), "Meteorology and Atomic Energy"; U.S. Atomic Energy Commission, AEC TID-24190, 1968.
10. "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants", U.S. NRC Regulatory Guide 1.21, Rev. 1 (June 1974).
11. "Standard Radiological Effluent Technical Specifications for Pressurized Water Reactors", NUREG-0472, Revision 3 (January 1983).
12. "Quality Assurance for Radiological Monitoring Programs (Normal Operations) - Effluent Streams and the Environment", USNRC Regulatory Guide 4.15, Revision 1 (February 1979).
13. "Age-Specific Radiation Dose Commitment Factors for a One-Year Chronic Intake", NUREG-0172 (November 1977).

INTRODUCTION

CO2→

The OFFSITE DOSE CALCULATION MANUAL (ODCM) is an implementing and supporting document of the RADIOLOGICAL EFFLUENT TECHNICAL SPECIFICATIONS (RETS). In accordance with USNRC Generic Letter 89-01, entitled "Implementation of Programmatic Controls for Radiological Effluent Technical Specifications in the Administrative Controls Section of the Technical Specifications and the Relocation of Procedural Details of RETS to the Offsite Dose Calculation Manual or to the Process Control Program", the procedural details for implementing the Radiological Limiting Conditions for Operation have been incorporated into the ODCM. The ODCM describes the methodology and parameters to be used in the calculation of offsite doses due to radioactive liquid and gaseous effluents and in the calculation of liquid and gaseous effluent monitoring instrumentation alarm/trip setpoints. The ODCM contains a list and graphical description of the specific sample locations for the radiological environmental monitoring program. Configurations of the liquid and gaseous radwaste treatment systems are also included.

The ODCM will be maintained at the Station as the reference which details the Radiological Effluent Limiting Conditions for Operation of the V. C. Summer Nuclear Station. Additionally the ODCM will be maintained as the guide for accepted calculational methodologies. Changes in calculation methods or parameters will be incorporated into the ODCM in order to ensure that the ODCM represents the current methodology in all applicable areas. Computer software to perform described calculations will be maintained current with this ODCM.

RESPONSIBILITIES

The ODCM contains the radiological effluent limiting conditions for operation, their applicability, remedial actions, surveillance requirements, and their bases. Plant procedures implement responsibilities for compliance with the ODCM that include:

The Operations group is responsible for:

- Declaring radioactive liquid and gaseous effluent monitor channels operable or inoperable.
- Ensuring the minimum number of operable channels for radioactive liquid and gaseous effluent monitors.
- Notifying the responsible group to implement appropriate action if less than the minimum number of radioactive liquid and gaseous effluent monitor channels are operable.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when less than the minimum number of channels operable condition prevails for more than 30 days.
- Restoring to within limits, the concentration of liquid radioactive material exceeding ODCM limits released from the site.
- Ensuring radioactive liquid and gaseous effluent monitor setpoints are set as prescribed in the effluent release permit.
- Suspending release if radioactive liquid and gaseous effluent monitor setpoints are less conservative than ODCM requirements.
- Declaring liquid and gaseous radwaste treatment systems operable or inoperable.
- Ensuring operability of gaseous and liquid radwaste treatment systems and ventilation exhaust treatment system.
- Ensuring appropriate portions of the gaseous and liquid radwaste treatment systems are used to reduce the radioactive materials in liquid and gaseous waste prior to their discharge when the projected doses exceed limits specified by the ODCM.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when liquid or gaseous radwaste system is inoperable for more than 31 days.
- Performing channel check and source check at the frequencies shown in Tables 1.1-2 and 1.2-2 for each radioactive liquid and gaseous effluent monitoring instrumentation channel.

Instrumentation and Controls group is responsible for:

- Performing channel calibration and analog channel operational test at the frequencies shown in Tables 1.1-2 and 1.2-2 for each radioactive liquid and gaseous effluent monitoring instrumentation channel.
- Informing the Operations group of surveillance test results.

The Health Physics group is responsible for:

- Establishing setpoints for radioactive liquid and gaseous effluent monitors, consistent with ODCM methodology, and providing setpoint information to Operations.
- Implementing remedial actions as requested by Operations. These actions include grab sampling and analysis and providing the results to Operations.
- Performing periodic radioactive effluent monitor checks to determine backgrounds, normal indications and verifying monitor correlation graphs, and providing this information as necessary to Operations.
- Implementing radioactive gaseous and liquid waste sampling and analysis program in accordance with ODCM Tables 1.1-4 and 1.2-3.
- Informing Operations when at least one Circulating Water Pump or the Circulating Water Jockey Pump is required to provide dilution to the discharge structure.
- Calculating cumulative dose contributions and performing dose projections from liquid and gaseous effluents in accordance with the ODCM and providing the information to Operations.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when calculated dose from the discharge of radioactive materials in liquid or gaseous effluents are in excess of the limits specified by ODCM sections 1.1.3.1 or 1.2.3.1.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when liquid or gaseous waste is discharged without treatment and is in excess of the limits specified by ODCM sections 1.1.4.1 or 1.2.3.1.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when the dose or dose commitment to any member of the public due to releases of radioactivity and radiation is in excess of 25 mrem to the total body or any organ (except the thyroid, which shall be limited to less than or equal to 75 mrem) over 12 consecutive months.

- Implementing the Radiological Environmental Monitoring Program as specified in Section 1.4 of the ODCM.
- Initiating an Off Normal Occurrence Report in accordance with SAP-132, when the Radiological Environmental Monitoring Program limiting conditions for operation are exceeded.
- Preparation of the Semiannual Radioactive Effluent Release Report and the Annual Environmental Report.

1.0 SPECIFICATION OF CONTROLS

1.1 LIQUID EFFLUENTS

1.1.1 Radioactive Liquid Effluent Monitoring Instrumentation

LIMITING CONDITION FOR OPERATION

1.1.1.1 The radioactive liquid effluent monitoring instrumentation channels shown in Table 1.1-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of ODCM Specification 1.1.2.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with ODCM, Section 2.1.

APPLICABLE: At all times.

ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/ trip setpoint less conservative than required by the above specification, immediately suspend the release of radioactive liquid effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 1.1-1. Additionally if this condition prevails for more than 30 days, in the next Annual Radioactive Effluent Release Report explain why this condition was not corrected in a timely manner.
- c. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.1.1.2 Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and ANALOG CHANNEL OPERATIONAL TEST operations at the frequencies shown in Table 1.1-2.

TABLE 1.1-1

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

	<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
1.	GROSS RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE		
a.	Liquid Radwaste Effluent Line - RM-L5 or RM-L9	1	1
b.	Nuclear (Processed Steam Generator) Blowdown Effluent Line RM-L7 or RM-L9	1	1
c.	Steam Generator Blowdown Effluent Line		
1.	Unprocessed during Power Operation - RM-L10 or RM-L3	1	2
2.	Unprocessed during Startup - RM-L3	1	2
d.	Turbine Building Sump Effluent Line - RM-L8	1	3
e.	Condensate Demineralizer Backwash Effluent Line RM-L11	1	6
2.	FLOW RATE MEASUREMENT DEVICES*		
a.	Liquid Radwaste Effluent Line - Tanks 1 and 2	1/tank	4
b.	Penstock Minimum Flow Interlock**	1	4
c.	Nuclear Blowdown Effluent Line	1	4
d.	Steam Generator (Unprocessed) Blowdown Effluent Line	1	4
3.	TANK LEVEL INDICATING DEVICES		
a.	Condensate Storage Tank	1	5

* In the event that simultaneous releases from both WMT and NBMT are required (which normally will be prevented by procedure) the flow rate for monitor RM-L9 will be determined by adding flow rates for monitors RM-L5 and RM-L7.

** Minimum dilution flow is assured by an interlock that terminates liquid waste releases if the minimum dilution flow is not available.

TABLE 1.1-1 (Continued)

TABLE NOTATION

- ACTION 1 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases may continue for up to 14 days provided that prior to initiating a release:
- a. At least two independent samples are analyzed in accordance with ODCM Specification 1.1.2.4 and
 - b. At least two technically qualified members of the Facility Staff independently verify the release rate calculations and discharge line valving;
- Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 2 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided grab samples are analyzed for gross radioactivity (beta and gamma) at a limit of detection of at least $1E-7$ microcuries/gram:
- a. At least once per 8 hours when the specific activity of the secondary coolant is greater than 0.01 microcuries/gram DOSE EQUIVALENT I-131.
 - b. At least once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01 microcuries/gram DOSE EQUIVALENT I-131.

TABLE 1.1-1 (Continued)

TABLE NOTATION

- ACTION 3 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided that, at least once per 8 hours, grab samples are collected and analyzed for gross radioactivity (beta and gamma) at a limit of detection of at least 1E-7 microcuries/gram.
- ACTION 4 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided the flow rate is estimated at least once per 4 hours during actual releases. Pump curves may be used to estimate flow.
- ACTION 5 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, liquid additions to this tank may continue for up to 30 days provided the tank liquid level is estimated during all liquid additions to the tank to prevent overflow.
- ACTION 6 With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases may continue for up to 30 days provided that samples are analyzed in accordance with ODCM Specification 1.1.2.2 and Technical Specification 4.11.1.5.

TABLE 1.1-2
 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION
 SURVEILLANCE REQUIREMENTS

	<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>
1.	GROSS RADIOACTIVITY MONITORS PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE				
a.	Liquid Radwaste Effluent Line - RM-L5 or RM-L9	D	P	R(2)	Q(1)
b.	Nuclear Blowdown Effluent Line RM-L7	D	P	R(2)	Q(1)
c.	Steam Generator Blowdown Effluent Line - RM-L3, RM-L10	D	M	R(2)	Q(1)
d.	Turbine Building Sump Effluent Line - RM-L8	D	M	R(2)	Q(1)
e.	Condensate Demineralizer Backwash Effluent Line RM-L11	D	M	R(2)	Q(4)
2.	FLOW RATE MEASUREMENT DEVICES				
a.	Liquid Radwaste Effluent Line	D(3)	N.A.	R	Q
b.	Penstocks Minimum Flow Interlock	D(3)	N.A.	R	Q
c.	Nuclear Blowdown Effluent Line	D(3)	N.A.	R	Q
d.	Steam Generator Blowdown Effluent Line	D(3)	N.A.	R	Q
3.	TANK LEVEL INDICATING DEVICES				
a.	Condensate Storage Tank	D	N.A.	R	Q

See Table 1.1-3 for explanation of frequency notation.

TABLE 1.1-2 (Continued)

TABLE NOTATION

- (1) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occurs if any of the following conditions exists:
 1. Instrument indicates measured levels above the alarm/trip setpoint.
 2. Loss of Power (alarm only).
 3. Low flow (alarm only).
 4. Instrument indicates a downscale failure (alarm only).
 5. Normal/Bypass switch set in Bypass (alarm only).
 6. Other instrument controls not set in operate mode.

- (2) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.

- (3) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made.

- (4) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and local panel alarm annunciation occurs if any of the following conditions exists:
 1. Instrument indicates measured levels above the alarm/trip setpoint.
 2. Loss of Power (alarm only).
 3. Low flow (alarm only).
 4. Instrument indicates a downscale failure (alarm only).
 5. Normal/Bypass switch set in Bypass (alarm only).
 6. Other instrument controls not set in operate mode.

Table 1.1-3

FREQUENCY NOTATION

Notation	Frequency
D	At least once per 24 hours.
W	At least once per 7 days.
M	At least once per 31 days.
Q	At least once per 92 days.
SA	At least once per 184 days.
R	At least once per 18 months.
P	Completed prior to each release.
N.A.	Not applicable.

Note: Each surveillance requirement shall be performed within the specified surveillance interval with a maximum allowable extension of 25% of the specified surveillance interval.

1.1.2 Liquid Effluents: Concentration

LIMITING CONDITION FOR OPERATION

1.1.2.1 The concentration of radioactive material released from the site (see Technical Specification Figure 5.1-4) shall be limited to the concentrations specified in 10 CFR Part 20, Appendix B, Table II, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to $2E-4$ microcuries/ml total activity.

APPLICABLE: At all Times.

ACTION:

With the concentration of radioactive material released from the site exceeding the above limits, immediately restore the concentration to within the above limits.

SURVEILLANCE REQUIREMENTS

1.1.2.2 The radioactivity content of each batch of radioactive liquid waste shall be determined prior to release by sampling and analysis in accordance with Table 1.1-4. The results or pre-release analyses shall be used with the calculational methods in ODCM Section 2.1 to assure that the concentration at the point of release is maintained within the limits of ODCM Specification 1.1.2.1.

1.1.2.3 Post-release analyses of samples composited from batch releases shall be performed in accordance with Table 1.1-4. The results of the previous post-release analyses shall be used with the calculational methods in ODCM Section 2.1 to assure that the concentrations at the point of release were maintained within the limits of ODCM Specification 1.1.2.1.

1.1.2.4 The radioactivity concentration of liquids discharged from continuous release points shall be determined by collection and analysis of samples in

accordance with Table 1.1-4. The results of the analyses shall be used with the calculational methods in ODCM Section 2.1 to assure that the concentrations at the point of release are maintained within the limits of ODCM Specification 1.1.2.1.

1.1.2.5 At least one Circulating Water Pump or the Circulating Water Jockey Pump shall be determined to be in operation and providing dilution to the discharge structure at least once per 4 hours whenever dilution is required to meet the site radioactive effluent concentration limits of ODCM Specification 1.1.2.1.

Table 1.1-4

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

	Liquid Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) ($\mu\text{Ci/ml}$) ^a
A.	Batch Waste Release ^d Tanks	P Each Batch	P Each Batch	Principal Gamma Emitters ^f	5×10^{-7}
				I-131	1×10^{-6}
1.	Waste Monitor Tanks	P One Batch/M	M	Dissolved and Entrained Gases (Gamma Emitters)	1×10^{-5}
2.	Condensate Demineralizer Backwash Receiving Tank	P Each Batch	M Composite ^b	H-3	1×10^{-5}
				Gross Alpha	1×10^{-7}
3.	Nuclear Blowdown Monitor Tank	P Each Batch	Q Composite ^b	Sr-89, Sr-90	5×10^{-8}
				Fe-55	1×10^{-6}
B.	Continuous Release ^e	D Grab Sample	W Composite ^c	Principal Gamma Emitters ^f	5×10^{-7}
				I-131	1×10^{-6}
1.	Steam Generator Blowdown	M Grab Sample	M	Dissolved and Entrained Gases (Gamma Emitters)	1×10^{-5}
2.	Turbine Building Sump	D Grab Sample	M Composite ^c	H-3	1×10^{-5}
				Gross Alpha	1×10^{-7}
3.	Service Water	D Grab Sample	Q Composite ^c	Sr-89, Sr-90	5×10^{-8}
				Fe-55	1×10^{-6}

See Table 1.1-3 for explanation of frequency notation.

TABLE 1.1-4 (Continued)

TABLE NOTATION

- a. The Lower Limit of Detection (LLD) is the smallest concentration of radioactive material in a sample that will yield a net count above background that will be detected with a 95% probability. LLD also yields a 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{(E)(V)(2.22)(Y)(\exp)(-\lambda \Delta t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above (as pCi per unit mass or volume). Current literature defines the LLD as the detection capability for the instrumentation only and the MDC, the minimum detectable concentration, as the detection capability for a given instrument procedure and type of sample.

4.66 is a factor which corrects for the smallest activity that has a probability, p, of being detected, and a probability, 1-p, of falsely concluding its presence.

$$4.66 = 2k \sqrt{1 + (t_b/t_s)}$$

k = a constant whose value depends on the chosen confidence level (NRC recommends a confidence level of 95%)

= 1.6545 at 95% confidence level

t_b = background time

t_s = sample time

s_b is the standard deviation of the background counting rate or the counting rate of blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

TABLE 1.1-4 (Continued)

TABLE NOTATION

V is the sample size (in units of mass or volume),

2.22 is the number of transformations per minute per picocurie,

Y is the fractional radiochemical yield (when applicable),

λ is the radioactive decay constant for the particular radionuclide,

and

Δt is the elapsed time between midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of s_b used in the calculation of the LLD for a detection system shall be used on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry the background should include the typical contributions of other radionuclides normally present in the samples. Typical values of E , V , Y , and Δt shall be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as a a posteriori (after the fact) limit for particular measurement.*

*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem. 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotopic Counting Techniques," Atlantic Richfield Handford Company Report ARH-2537 (June 22, 1972).

TABLE 1.1-4 (Continued)

TABLE NOTATION

- b. A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen which is representative of the liquids released.
- c. To be representative of the quantities and concentrations of radioactive materials in liquid effluents, samples shall be composited in proportion to the rate of flow of the effluent stream. Prior to analyses, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluent release.
- d. A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed, by a method described in ODCM Section 2.0, to assure representative sampling.
- e. A continuous release is the discharge of liquid wastes of a nondiscrete volume; e.g., from a volume of system that has an input flow during the continuous release.
- f. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141, and Ce-144. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported.

1.1.3 Liquid Effluents: Dose

LIMITING CONDITION FOR OPERATION

1.1.3.1 The dose or dose commitment to an individual from radioactive materials in liquid effluents released from the site (see Technical Specification Figure 5.1-4) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABLE: At all Times.

ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause (s) for exceeding the limit (s) and defines the corrective actions to be taken to the releases and the proposed actions to be taken to assure that subsequent releases will be in compliance with ODCM Specification 1.1.3.1.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.1.3.2 Dose Calculations. Cumulative dose contributions from liquid effluents shall be determined in accordance with ODCM Section 2.2 at least once per 31 days.

1.1.4 Liquid Waste Treatment

LIMITING CONDITION FOR OPERATION

1.1.4.1 The liquid radwaste treatment system shall be OPERABLE. The appropriate portions of the system shall be used to reduce the radioactive materials in liquid wastes prior to their discharge when the projected doses due to the liquid effluent from the site (See Technical Specification Figure 5.1-4) when averaged over 31 days, would exceed 0.06 mrem to the total body or 0.2 mrem to any organ.

APPLICABLE: At all Times.

ACTION:

- a. With the liquid radwaste treatment system inoperable for more than 31 days or with radioactive liquid waste being discharged without treatment and in excess of the above limits, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which includes the following information:
 1. Identification of the inoperable equipment or subsystems and the reason for inoperability,
 2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
 3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.1.4.2 Doses due to liquid releases shall be projected at least once per 31 days, in accordance with ODCM Section 2.2.

1.1.4.3 The liquid radwaste treatment system shall be demonstrated OPERABLE by operating the liquid radwaste treatment system equipment for at least 30 minutes at least once per 92 days unless the liquid radwaste system has been utilized to process radioactive liquid effluents during the previous 92 days.

1.2 GASEOUS EFFLUENTS

1.2.1 Radioactive Gaseous Effluent Monitoring Instrumentation

LIMITING CONDITION FOR OPERATION

1.2.1.1 The radioactive gaseous effluent monitoring instrumentation channels shown in Table 1.2.-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of ODCM Specification 1.2.2.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with ODCM Section 3.1.

APPLICABLE: As shown in Table 1.2-1

ACTION:

- a. With a radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above ODCM Specification, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 1.2-1. Additionally if this condition prevails for more than 30 days, in the next Annual Radioactive Effluent Release Report, explain why this condition was not corrected in a timely manner.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.2.1.2 Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION and and ANALOG CHANNEL OPERATIONAL TEST operations at the frequencies shown in Table 1.2-2.

TABLE 1.2-1

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION		MINIMUM CHANNELS <u>OPERABLE</u>	APPLICA- BILITY	<u>ACTION</u>
	<u>INSTRUMENT</u>			
1.	WASTE GAS HOLDUP SYSTEM			
a.	Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release (RM-A10 or RM-A3)	1	*	7
2.	MAIN PLANT VENT EXHAUST SYSTEM			
a.	Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release from Waste Gas Holdup System (RM- A3)	1	*	9
b.	Iodine Sampler	1	*	11
c.	Particulate Sample	1	*	11
d.	Flow Rate Measuring Device	1	*	8
e.	Sampler Flow Rate Measuring Device	1	*	8
3.	REACTOR BUILDING PURGE SYSTEM			
a.	Noble Gas Activity Monitor Providing Alarm and Automatic Termination of Release (RM-A4)	1	*	10
b.	Iodine Sampler	1	*	11
c.	Particulate Sample	1	*	11
d.	Flow Rate Measuring Device	1	*	8
e.	Sampler Flow Rate Measuring Device	1	*	8

TABLE 1.2-1 (Continued)

TABLE NOTATION

* At all times during releases via this pathway.

ACTION 7 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment for up to 14 days provided that prior to initiating the release:

- a. At least two independent samples of the tank's contents are analyzed, and
- b. At least two technically qualified members of the Facility Staff independently verify the release rate calculations and discharge valve lineup;

Otherwise, suspend release of radioactive effluents via this pathway.

ACTION 8 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided the flow rate is estimated at least once per 4 hours.

ACTION 9 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided grab samples are taken at least once per 8 hours and these samples are analyzed for gross activity within 24 hours.

TABLE 1.2-1 (Continued)

TABLE NOTATION

- ACTION 10 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend PURGING of radioactive effluents via this pathway.
- ACTION 11 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the affected pathway may continue for up to 30 days provided samples are continuously collected with auxiliary sampling equipment as required in Table 1.2-3.

TABLE 1.2-2

RADIOACTIVE GASEOUS EFFLUENT
MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

INSTRUMENT	CHANNEL CHECK	SOURCE CHECK	CHANNEL CALIBRA- TION	ANALOG CHANNEL OPERA- TIONAL TEST	MODES IN WHICH SURVEILL ANCE RE- QUIRED
1. WASTE GAS HOLDUP SYSTEM					
a. Noble Gas Activity Monitor - RM-A10 or RM-A3	P	P	R(3)	Q(1)	*
2. MAIN PLANT VENT EXHAUST SYSTEM					
a. Noble Gas Activity Monitor - RM-A3	D	M	R(3)	Q(2)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Flow Rate Measuring Device	D	N.A.	R	Q	*
e. Sampler Flow Rate Monitor	D	N.A.	R	Q	*
3. REACTOR BUILDING PURGE SYSTEM					
a. Noble Gas Activity Monitor - RM-A4	D	P,M	R(3)	Q(1)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Flow Rate Measuring Device	D	N.A.	R	Q	*
e. Sampler Flow Rate Monitor	D	N.A.	R	Q	*

See Table 1.1-3 for explanation of frequency notation.

TABLE 1.2-2 (Continued)

TABLE NOTATION

- * At all times.
- (1) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occurs if any of the following conditions exists:
 1. Instrument indicates measured levels above the alarm/trip setpoint.
 2. Loss of Power (alarm only).
 3. Low flow (alarm only).
 4. Instrument indicates a downscale failure (alarm only).
 5. Normal/Bypass switch set in Bypass (alarm only).
 6. Other instrument controls not set in operate mode.

 - (2) The ANALOG CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
 1. Instrument indicates measured levels above the alarm setpoint.
 2. Loss of Power.
 3. Low flow.
 4. Instrument indicates a downscale failure.
 5. Instrument controls not set in operate mode.

 - (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.

1.2.2 Gaseous Effluents: Dose Rate

LIMITING CONDITIONS FOR OPERATION

1.2.2.1 The dose rate in unrestricted areas due to radioactive materials released in gaseous effluents from the site including effluents from oil incineration (see Technical Specification Figure 5.1-3) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin.
- b. For all radioiodines and for all radioactive materials in particulate form and tritium with half lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.
- c. Less than 0.1% of the limits in 1.2.2.1 (a) and (b) as a result of oil incineration.

APPLICABLE: At all times.

ACTION:

With the dose rate(s) exceeding the above limits, immediately decrease the release rate to within the above limit(s).

SURVEILLANCE REQUIREMENTS

1.2.2.2 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methods and procedures of the ODCM.

1.2.2.3 The dose rate due to radioiodines, tritium and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methods and procedures of ODCM Section 3.2.2 by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 1.2-3.

TABLE 1.2-3
RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

Gaseous Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) ($\mu\text{Ci/ml}$) ^a
A Waste Gas Storage Tank	P Each Tank Grab Sample	P Each Tank	Principal Gamma Emitters ^g	1X10 ⁻⁴
B1 Reactor Building -36" Purge Line	P Each Purge ^{b,c}	P Each Purge ^b	Principal Gamma Emitters ^g	1X10 ⁻⁴
-6" Purge Line			H-3	1X10 ⁻⁶
B2 Reactor Building -6" Purge Line (if continuous)	M ^b Grab Sample	M ^b	Principal Gamma Emitters ^g	1X10 ⁻⁴
			H-3	1X10 ⁻⁶
C Main Plant Vent	M ^{b,e} Grab Sample	M ^b	Principal Gamma Emitters ^g	1X10 ⁻⁴
			H-3	1X10 ⁻⁶
D1. Reactor Building Purge	Continuous Sampler ^f	W ^d Charcoal Sample	I-131 I-133	1X10 ⁻¹² 1X10 ⁻¹⁰
2. Main Plant Vent	Continuous Sampler ^f	W ^d Particulate Sample	Principal Gamma Emitters ^g I-131, others	1X10 ⁻¹¹
	Continuous Sampler ^f	M Composite Particulate Sample	Gross Alpha	1X10 ⁻¹¹
	Continuous Sampler ^f	Q Composite Particulate Sample	Sr-89, Sr-90	1X10 ⁻¹¹
	Continuous Monitor	Noble Gas Monitor	Noble Gases Gross Beta	2X10 ⁻⁶
E Oil Incinerator	P Each Batch ^h Grab Sample	P Each Batch	Principal Gamma Emitters ^g Noble Gases I-131 H-3 Sr-89, Sr-90 Fe-55	5 X 10 ⁻⁷ ⁱ 1E-5 ⁱ 1E-6 ⁱ 3E-5 ⁱ 3E-7 ⁱ 1E-6 ⁱ

See Table 1.1-3 for explanation of frequency notation.

TABLE 1.2-3 (Continued)

TABLE NOTATION

- a. See Table 1.1-4 notation (a) for definition of LLD.
- b. Analyses shall be also be performed within 24 hours following shutdown, startup, or a THERMAL POWER change exceeding 15 percent of the RATED THERMAL POWER within a one hour period.
- c. Tritium grab samples shall be taken at least once per 24 hours when the refueling canal is flooded.
- d. Samples shall be changed at least once per 7 days and analyses shall be completed within 48 hours after changing (or after removal from sampler). Sampling shall also be performed at least once per 24 hours for a least 7 days following each shutdown, startup or THERMAL POWER change exceeding 15 percent of RATED THERMAL POWER in one hour and analyses shall be completed within 48 hours of changing. When samples collected for 24 hours are analyzed, the corresponding LLD's may be increased by a factor of 10.
- e. Tritium grab samples shall be taken at least once per 7 days from the ventilation exhaust from the spent fuel pool area, whenever spent fuel is in the spent fuel pool.
- f. The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with ODCM Specifications 1.2.2.1, 1.2.3.1 and 1.2.4.1.
- g. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emissions and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141 and Ce-144 for particulate emissions. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported.
- h. Prior to sampling for analysis, each batch of oil shall be isolated and representative samples obtained by methods described in ASTM D 4057-81, Volume 05.03, "Standard Practice for Manual Sampling of Petroleum and Petroieum Products".
- i. This LLD refer to the liquid sample.

1.2.3 Gaseous Effluents: Dose - Noble Gas

LIMITING CONDITION FOR OPERATION

1.2.3.1 The air dose due to noble gases released in gaseous effluents from the site (see Technical Specification Figure 5.1-3) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation and,
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABLE: At all Times.

ACTION:

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, in lieu of any other report required by ODCM section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with ODCM Specification 1.2.3.1.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.2.3.2 Dose Calculations Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with ODCM Section 3.2.3 at least once per 31 days.

1.2.4 Gaseous Effluents: Dose - Radioiodines, Tritium, and Radioactive Materials in Particulate Form.

LIMITING CONDITIONS FOR OPERATION

1.2.4.1 The dose to an individual from radioiodines, tritium, and radioactive materials in particulate form, and radionuclides (other than noble gases) with half-lives greater than 8 days in gaseous effluents including effluents from oil incineration (see Technical Specification Figure 5.1-3) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ.
- b. During any calendar year: Less than or equal to 15 mrem to any organ.
- c. Less than 0.1% of the limits in 1.2.4.1 (a) and (b) as a result of oil incineration.

APPLICABLE: At all times.

ACTION:

- a. With the calculated dose from the release of tritium, radioiodines, and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents exceeding any of the above limits, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause(s) for exceeding the limit and defines the corrective actions to be taken to releases and the proposed actions to be taken to assure that subsequent release will be in compliance with ODCM Specification 1.2.4.1.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.2.4.2 Dose Calculations Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with ODCM Section 3.2.3 at least once per 31 days.

1.2.5 Gaseous Effluents: Gaseous Radwaste Treatment

CONTROLS

1.2.5.1 The GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM shall be OPERABLE. The appropriate portions of the GASEOUS RADWASTE TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected gaseous effluent air doses due to gaseous effluent releases from the site (See Technical Specification Figure 5.1-3), when averaged over 31 days, would exceed 0.2 mrad for gamma radiation and 0.4 mrad for beta radiation. The appropriate portions of the VENTILATION EXHAUST TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected doses due to gaseous effluent releases from the site when averaged over 31 days would exceed 0.3 mrem to any organ.

APPLICABLE: At all times*.

ACTION:

- a. With the GASEOUS RADWASTE TREATMENT SYSTEM and/or the VENTILATION EXHAUST TREATMENT SYSTEM inoperable for more than 31 days or with gaseous waste being discharged without treatment and in excess of the above limits, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which includes the following information:
1. Identification of the inoperable equipment or subsystems and the reason for inoperability.
 2. Action(s) taken to restore the inoperable equipment to OPERABLE status.

*The Waste Gas System may be secured during refueling and defueled operations since there is no gas in the system to be removed and processed. The system is considered "inoperable" during these conditions due to the instrumentation being out of calibration when flow is stopped through the recombiner. This "inoperable" state is the normal system condition during refueling and defueled modes.

3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.2.5.2 Doses due to gaseous releases from the reactor shall be projected at least once per 31 days, in accordance with ODCM Section 3.2.2 for air doses and ODCM Section 3.2.3 for organ doses.

1.2.5.3 The GASEOUS RADWASTE TREATMENT SYSTEM and VENTILATION EXHAUST TREATMENT SYSTEM shall be demonstrated OPERABLE by operating the GASEOUS RADWASTE TREATMENT SYSTEM equipment and VENTILATION EXHAUST TREATMENT SYSTEM equipment for at least 30 minutes, at least once per 92 days unless the appropriate system has been utilized to process radioactive gaseous effluents during the previous 92 days.

1.3 RADIOACTIVE EFFLUENTS: TOTAL DOSE

LIMITING CONDITION FOR OPERATION

1.3.1 The dose or dose commitment to any member of the public, due to releases of radioactivity and radiation, from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the total body or any organ (except the thyroid, which shall be limited to less than or equal to 75 mrem) over 12 consecutive months.

APPLICABLE: At all Times.

ACTION:

- a. With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of ODCM Specification 1.1.3.1.a, 1.1.3.1.b, 1.2.3.1.a, 1.2.3.1.b, 1.2.4.1.a, or 1.2.4.1.b, in lieu of any other report required and ODCM Section 1.6, prepare and submit to the Commission, within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the limits of ODCM Specification 1.3.1. This Special Report shall include an analysis which estimates the radiation exposure (dose) to a member of the public from uranium fuel cycle sources (including all effluent pathways and direct radiation) for a 12 consecutive month period that includes the release(s) covered by this report. If the estimated dose(s) exceeds the limits of ODCM Specification 1.3.1, and if the release condition resulting in violation of 40 CFR 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190 and including information of § 190.11 (b). Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete. The variance only relates to the limits of 40 CFR 190, and does not apply in any way to the requirements for dose

limitation of 10 CFR Part 20, as addressed in ODCM Specifications 1.1.2 and 1.2.2.

- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.3.2 Dose Calculations Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with ODCM Specifications 1.1.3.2, 1.2.3.2 and 1.2.4.2.

1.4 RADIOLOGICAL ENVIRONMENTAL MONITORING

1.4.1 Monitoring Program

LIMITING CONDITION FOR OPERATION

- 1.4.1.1 The radiological environmental monitoring program shall be conducted as specified in Table 1.4-1.

APPLICABILITY: At all times.

ACTION:

- a. With the radiological environmental monitoring program not being conducted as specified in Table 1.4-1 in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission, in the Annual Radiological Operating Report, a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.
- b. With the level of radioactivity in an environmental sampling medium exceeding the reporting levels of Table 1.4-2 when averaged over any calendar quarter, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days from the end of the affected calendar quarter a Special Report. When more than one of the radionuclides in Table 1.4-2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{limit level (1)}} + \frac{\text{concentration (2)}}{\text{limit level (2)}} + \dots \geq 1.0$$

When radionuclides other than those in Table 1.4-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose to an individual is equal to or greater than the calendar year limits of ODCM Specifications 1.1.3.1, 1.2.3.1

and 1.2.4.1. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report.

- c. With milk or fresh leafy vegetable samples unavailable from one or more of the sample locations required by Table 1.4-1, in lieu of any other report required by ODCM Section 1.6 prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the cause of the unavailability of samples and identifies locations for obtaining replacement samples. The locations from which samples were unavailable may then be deleted from those required by Table 1.4-1, provided the locations from which the replacement samples were obtained are added to the environmental monitoring program as replacement locations.
- d. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.4.1.2 The radiological environmental monitoring samples shall be collected pursuant to Table 1.4-1 and shall be analyzed pursuant to the requirements of Tables 1.4-1 and 1.4-3.

Table 1.4-1 Radiological Environmental Monitoring Program
Virgil C. Summer Nuclear Station

Exposure Pathway and/or Sample	Minimum Number of Sample Locations and Criteria for Selection	Sampling and Collection Frequency	Type & Frequency of Analysis
AIRBORNE: I. Particulates	A) 3 Indicator samples to be taken at locations (in different sectors) beyond but as close to the exclusion boundary as practicable where the highest offsite sectorial ground level concentrations are anticipated.	Continuous sampler operation with weekly collection.	Gross beta following filter change; quarterly composite (by location) for gamma isotopic.
	B) 1 Indicator sample to be taken in the sector beyond but as close to the exclusion boundary as practicable corresponding to the residence having the highest anticipated offsite ground level concentration or dose.	Continuous sampler operation with weekly collection.	Gross beta following filter change; quarterly composite (by location) for gamma isotopic.
	C) 1 Indicator sample to be taken at the location of one of the dairies being sampled meeting the criteria of VII(A). ⁽²⁾	Continuous sampler operation with weekly collection.	Gross beta following filter change; quarterly composite (by location) for gamma isotopic.
	D) 1 Control sample to be taken at a location at least 10 air miles from the site and not in the most prevalent wind directions.	Continuous sampler operation with weekly collection.	Gross beta following filter change; quarterly composite (by location) for gamma isotopic.
II. Radioiodine	A) 3 Indicator samples to be taken at two locations as given in I(A) above.	Continuous sampler operation with weekly canister collection.	Gamma isotopic for I-131 weekly.
	B) 1 Indicator sample to be taken at the location as given in I(B) above.	Continuous sampler operation with weekly canister collection.	Gamma isotopic for I-131 weekly.
	C) 1 Indicator sample to be taken at the location as given in I(C) above.	Continuous sampler operation with weekly canister collection.	Gamma isotopic for I-131 weekly.
	D) 1 Control sample to be taken at a location as given in I(D) above.	Continuous sampler operation with weekly canister collection.	Gamma isotopic for I-131 weekly.
III. Direct	A) 13 Indicator stations with two or more dosimeters to form an inner ring of stations in the 13 accessible sectors within 1 to 2 miles of the plant.	Monthly or quarterly. ^(3,5)	Gamma dose monthly or quarterly.
	B) 16 Indicator stations with two or more dosimeters to form an outer ring of stations in the 16 accessible sectors within 3 to 5 miles of the plant.	Monthly or quarterly. ^(3,5)	Gamma dose monthly or quarterly.
	C) 11 Stations with two or more dosimeters to be placed in special interest areas such as population centers, nearby residences, schools and in 4 or 5 areas to serve as control stations.	Monthly or quarterly. ^(3,5)	Gamma dose monthly or quarterly.

Table 1.4-1 Radiological Environmental Monitoring Program
Virgil C. Summer Nuclear Station

Exposure Pathway and/or Sample	Minimum Number of Sample Locations and Criteria for Selection	Sampling and Collection Frequency	Type & Frequency of Analysis
<p>WATERBORNE: IV. Surface Water</p>	<p>A) 1 Indicator sample downstream to be taken at a location which allows for mixing and dilution in the ultimate receiving river.</p> <p>B) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.</p> <p>C) 1 Indicator sample to be taken in the upper reservoir of the pumped storage facility in the plant discharge canal.</p>	<p>Time composite samples with collection every month. ⁽³⁾</p> <p>Time composite samples with collection every month. ⁽³⁾</p> <p>Time composite samples with collection every month. ⁽³⁾</p>	<p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium. ⁽⁵⁾</p> <p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium. ⁽⁵⁾</p> <p>Gamma isotopic monthly with quarterly composite (by location) or monthly sample to be analyzed for tritium. ⁽⁵⁾</p>
<p>V. Ground Water</p>	<p>A) 2 Indicator samples to be taken within the exclusion boundary and in the direction of potentially affected ground water supplies.</p> <p>B) 1 Control sample from unaffected location.</p>	<p>Quarterly grab sampling. ⁽⁵⁾</p> <p>Quarterly grab sampling. ⁽⁵⁾</p>	<p>Gamma isotopic and tritium analyses quarterly. ⁽⁵⁾</p> <p>Gamma isotopic and tritium analyses quarterly. ⁽⁵⁾</p>
<p>VI. Drinking Water</p>	<p>A) 1 Indicator sample from a nearby public ground water supply source.</p> <p>B) 1 Indicator (finished water) sample from the nearest downstream water supply.</p> <p>C) 1 Control (finished water) sample from the nearest unaffected public water supply.</p>	<p>Monthly grab sampling. ⁽³⁾</p> <p>Monthly composite sampling.</p> <p>Monthly composite sampling.</p>	<p>Monthly ⁽³⁾ gamma isotopic and gross beta analyses and quarterly ⁽⁵⁾ composite for tritium analyses.</p> <p>Monthly ⁽³⁾ gamma isotopic and gross beta analyses and quarterly ⁽⁵⁾ composite for tritium analyses.</p> <p>Monthly ⁽³⁾ gamma isotopic and gross beta analyses and quarterly ⁽⁵⁾ composite for tritium analyses.</p>

Table 1.4-1 Radiological Environmental Monitoring Program
Virgil C. Summer Nuclear Station

Exposure Pathway and/or Sample	Minimum Number of Sample Locations and Criteria for Selection	Sampling and Collection Frequency	Type & Frequency of Analysis
INGESTION: VII. Milk(2)	A) Samples from milking animals in 3 locations within 5 km distance having the highest dose potential. If there are none then 1 sample from milking animals in each of 3 areas between 5 to 8 km distance where doses are calculated to be greater than 1 mrem per year.	Semimonthly when animals are on pasture, ⁽⁶⁾ monthly other times. ⁽³⁾	Gamma isotopic and I-131 analysis semimonthly ⁽⁶⁾ when animals are on pasture; monthly ⁽³⁾ at other times.
	B) 1 Control sample to be taken at the location of a dairy greater than 20 miles distance and not in the most prevalent wind direction.	Semimonthly when animals are on pasture, ⁽⁶⁾ monthly other times. ^(3,8)	Gamma isotopic and I-131 analysis semimonthly ⁽⁶⁾ when animals are on pasture; monthly ⁽³⁾ at other times.
	C) 1 Indicator grass (forage) sample to be taken at the location of one of the dairies being sampled meeting the criteria of VII(A), above, when animals are on pasture.	Monthly when available ⁽³⁾	Gamma isotopic.
	D) 1 Control grass (forage) sample to be taken at the location of VII(B) above.	Monthly when available ^(3,8)	Gamma isotopic.
VIII. Food Products	A) 2 samples of broadleaf vegetation grown in the 2 nearest offsite locations of highest calculated annual average ground level D/Q if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5 to 8 km where the doses are calculated to be greater than 1 mrem/yr.	Monthly when available. ⁽³⁾	Gamma isotopic on edible portion.
	B) 1 Control sample for the same foods taken at a location at least 10 miles distance and not in the most prevalent wind direction if milk sampling is not performed within 3 km or if milk sampling is not at a location within 5 to 8 km where doses are calculated to be greater than 1 mrem/yr.	Monthly when available. ⁽³⁾	Gamma isotopic on edible portion.
IX. Fish	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual ⁽⁷⁾ collection of the following specie types if available: bass; bream, crappie; catfish, carp.	Gamma isotopic on edible portions semiannually
	B) 1 Indicator sample to be taken at a location in the lower reservoir.	Semiannual ⁽⁷⁾ collection of the following specie types if available: bass; bream, crappie; catfish, carp.	Gamma isotopic on edible portions semiannually
	C) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual ⁽⁷⁾ collection of the following specie types if available: bass; bream, crappie; catfish, carp.	Gamma isotopic on edible portions semiannually

Table 1.4-1 Radiological Environmental Monitoring Program
Virgil C. Summer Nuclear Station

Exposure Pathway and/or Sample	Minimum Number of Sample Locations and Criteria for Selection	Sampling and Collection Frequency	Type & Frequency of Analysis
AQUATIC: X. Sediment	A) 1 Indicator sample to be taken at a location in the upper reservoir. B) 1 Indicator sample to be taken on or near the shoreline of the lower reservoir. C) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual grab sample. ⁽⁷⁾ Semiannual grab sample. ⁽⁷⁾ Semiannual grab sample. ⁽⁷⁾	Gamma isotopic. Gamma isotopic. Gamma isotopic.

Table 1.4-1 (Continued)

TABLE NOTATION

1. (Reserved)
2. Milking animal and garden survey results will be analyzed annually. Should the survey indicate new dairying activity, the owners shall be contacted with regard to a contract for supplying sufficient samples. If contractual arrangements can be made, site(s) will be added for additional milk sampling up to a total of 3 Indicator locations.
3. Not to exceed 35 days.
4. Time composite samples are samples which are collected with equipment capable of collecting an aliquot at time intervals which are short (e.g., hourly) relative to the compositing period.
5. At least once per 100 days.
6. At least once per 18 days.
7. At least once per 200 days.
8. Milk and grass (forage) sampling at the control location is only required when locations meeting the criteria of VII(A) are being sampled.

NOTE: Deviations from this sampling schedule may occasionally be necessary if sample media are unobtainable due to hazardous conditions, seasonal unavailability, insufficient sample size, malfunctions of automatic sampling or analysis equipment and other legitimate reasons. If specimens are unobtainable due to sampling equipment malfunction, every effort shall be made to complete corrective action prior to the end of the next sampling period. Deviations from sampling-analysis schedules will be described in the annual report.

TABLE 1.4-2

Reporting Levels for Radioactivity Concentrations in Environmental Samples
Reporting Levels

Analysis	Water (pCi/l)	Airborne Particulate or Gases (pCi/m ³)	Fish (pCi/kg, wet)	Milk (pCi/l)	Food Products (pCi/Kg, wet)
H-3	20,000(a)	N.A.	N.A.	N.A.	N.A.
Mn-54	1,000	N.A.	30,000	N.A.	N.A.
Fe-59	400	N.A.	10,000	N.A.	N.A.
Co-58	1,000	N.A.	30,000	N.A.	N.A.
Co-60	300	N.A.	10,000	N.A.	N.A.
Zn-65	300	N.A.	10,000	N.A.	N.A.
Zr-95	400	N.A.	20,000	N.A.	N.A.
Nb-95	400	N.A.	20,000	N.A.	N.A.
I-131	2	0.9	N.A.	3	100
Cs-134	30	10	1,000	60	1,000
Cs-137	50	20	2,000	70	2,000
Ba-140	200	N.A.	N.A.	300	N.A.
La-140	200	N.A.	N.A.	300	N.A.

(a) For drinking water samples. This is the 40 CFR Part 141 value.

TABLE 1.4-3

Maximum Values for the Lower Limits of Detection (LLD)^{a,c}
Reporting Levels

Analysis	Water (pCi/l)	Airborne Par- ticulate or Gases(pCi/m ³)	Fish (pCi/kg, wet)	Milk (pCi/l)	Food Products (pCi/Kg, wet)	Sediment (pCi/Kg, dry)
Gross Beta	4	1 X 10 ⁻²	N.A.	N.A.	N.A.	N.A.
H-3	2000(b)	N.A.	N.A.	N.A.	N.A.	N.A.
Mn-54	15	N.A.	130	N.A.	N.A.	N.A.
Fe-59	30	N.A.	260	N.A.	N.A.	N.A.
Co-58	15	N.A.	130	N.A.	N.A.	N.A.
Co-60	15	N.A.	130	N.A.	N.A.	N.A.
Zn-65	30	N.A.	260	N.A.	N.A.	N.A.
Zr-95	30	N.A.	N.A.	N.A.	N.A.	N.A.
Nb-95	15	N.A.	N.A.	N.A.	N.A.	N.A.
I-131	1b	7 X 10 ⁻²	N.A.	1	60	N.A.
Cs-134	15	5 X 10 ⁻²	130	15	60	150
Cs-137	18	6 X 10 ⁻²	150	18	80	180
Ba-140	60	N.A.	N.A.	60	N.A.	N.A.
La-140	15	N.A.	N.A.	15	N.A.	N.A.

TABLE 1.4-3 (Continued)

TABLE NOTATION

- a. Table 1.4-3 lists detection capabilities for radioactive materials in environmental samples. These detection capabilities are tabulated in terms of the lower limits of detection (LLDs). See Table 1.1-4 notation (a) for definition of LLD.
- b. LLD for drinking water samples.
- c. Other peaks potentially due to reactor operations (fission and activation products) which are measurable and identifiable, together with the radio-nuclides in Table 1.4-3, shall be identified and reported.

1.4.2 Land Use Census

LIMITING CONDITION FOR OPERATION

1.4.2.1 A land use census shall be conducted and shall identify the location of the nearest milk animal, the nearest residence and the nearest garden* of greater than 500 square feet producing fresh leafy vegetables in each of the 16 meteorological sectors within a distance of five miles.

APPLICABILITY: At all times.

ACTION:

- a. With a land use census identifying a location(s) which yields a calculated dose or dose commitment greater than the values currently being calculated in ODCM Specification 1.2.4.2, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the new location(s).
- b. With a land use census identifying a location(s) which yields a calculated dose or dose commitment (via the same exposure pathway) 20 percent greater than at a location from which samples are currently being obtained in accordance with ODCM Specification 1.4.1.1, in lieu of any other report required by ODCM Section 1.6, prepare and submit to the Commission within 30 days, pursuant to Technical Specification 6.9.2, a Special Report which identifies the new location. The new location shall be added to the radiological environmental monitoring program within 30 days. The sampling location, excluding the control station location, having the lowest calculated dose or dose commitment (via the same exposure pathway) may be deleted from this monitoring program after October 31 of the year in which this land use census was conducted.

*Broad leaf vegetation sampling may be performed at the site boundary in the direction sector with the highest D/Q in lieu of the garden census.

- c. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.4.2.2 The land use census shall be conducted at least once per 12 months between the dates of June 1 and October 1 using that information which will provide the best results, such as by a door-to-door survey, aerial survey, or by consulting local agriculture authorities.

1.4.3 Interlaboratory Comparison Program

LIMITING CONDITION FOR OPERATION

1.4.3.1 Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program which has been approved by the Commission.

APPLICABILITY: At all times.

ACTION:

- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report.
- b. The provisions of Technical Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

1.4.3.2 A summary of the results obtained as part of the above required Interlaboratory Comparison Program shall be included in the Annual Radiological Environmental Operating Report (participants in the EPA crosscheck program shall provide the EPA program code designation for the unit).

1.5 BASES

B/1.1 LIQUID EFFLUENTS

B/1.1.1 Radioactive Liquid Effluent Monitoring Instrumentation

The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63 and 64 of Appendix A to 10CFR Part 50.

B/1.1.2 Concentration

This specification is provided to ensure that concentration of radioactive materials released in liquid waste effluents from the site will be less than the concentration levels specified in 10 CFR Part 20, Appendix B, Table II, Column 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water outside the site will result in exposures within:

- (1) the Section II.A design objectives of Appendix I, 10 CFR 50, to an individual, and
- (2) the limits of 10 CFR 20.106 (e) to the population.

The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 the controlling radioisotope and its MPC in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

B/1.1.3 Dose

This specification is provided to implement the requirements of Sections II.A, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.A. of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents will be kept "as low as is reasonably achievable." Also, for fresh water sites with drinking water supplies which can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR 141. The dose calculations in the ODCM implement the requirements in Section III.A of Appendix I that conformance with guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants", section 4.3. NUREG-0133 implements Regulatory Guide 1.109, Revision 1, October 1977 (section C.1 and Appendix A) and Regulatory Guide 1.113, April 1977. Regulatory Guide 1.109, October

Bases (continued)

1977, is titled "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I". Regulatory Guide 1.113, April 1977, is titled "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I".

B/1.1.4 Liquid Waste Treatment

The OPERABILITY of the liquid radwaste treatment system ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the liquid radwaste treatment system were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50, for liquid effluents.

B/1.2 GASEOUS EFFLUENTS

B/1.2.1 Radioactive Gaseous Effluent Monitoring Instrumentation

The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63 and 64 of Appendix A to 10 CFR Part 50.

B/1.2.2 Dose Rate

This specification is provided to ensure that the dose at any time at the site boundary from gaseous effluents from all units as well as the oil incinerator on the site will be within the annual dose limits of 10 CFR Part 20 for unrestricted areas. The annual dose limits are the doses associated with the concentration of 10 CFR Part 20, Appendix B, Table II, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of an individual in an unrestricted area, either within or outside the site boundary, to annual average concentrations exceeding the limits specified in Appendix B, Table II of 10 CFR Part 20 (10 CFR Part 20. 106 (b)). For individuals who may at times be within the site boundary, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the site boundary. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the site boundary to less than or equal to 500 mrem/year to the total body or to less than or equal 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.

Bases (continued)

B/1.2.3 Dose - Noble Gases

This specification is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents will be kept "as low as is reasonably achievable". The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The dose calculations established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants", section 5.3. NUREG-0133 implements Regulatory Guide 1.109, Revision 1, October 1977 and Regulatory Guide 1.111, Revision 1, July 1977. Regulatory Guide 1.109 is entitled "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, "Revision 1, October 1977 and Regulatory Guide 1.111 is entitled "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors, "Revision 1, July 1977. The ODCM equations provided for determining the air doses at the site boundary are based upon the historical average atmospheric conditions.

This specification applies to the release of gaseous effluents from all reactors at the site and from the incineration of oil.

B/1.2.4 Dose-Radioiodines, Tritium and Radioactive Materials in Particulate Form

This specification is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A Appendix I to assure that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methods for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in NUREG-0133, "Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants", section 5.3. NUREG-0133 implements Regulatory Guide 1.109, Revision 1, October 1977 and Regulatory Guide 1.111, Revision 1, July 1977. Regulatory Guide 1.109 is entitled "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, "Revision 1, October 1977 and Regulatory Guide 1.111 is entitled "Methods for Estimating Atmospheric Transport and Dispersion of of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors, "Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for radioiodines,

Bases (continued)

tritium, and radioactive materials in particulate form are dependent on the existing radionuclide pathways to man, in the unrestricted area. The pathways which were examined in the development of these calculations were: 1) individual inhalation of airborne radionuclides, 2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, 3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and 4) deposition on the ground with subsequent exposure of man.

This specification applies to the release of gaseous effluents from all reactors at the site and from the incineration of oil.

B/1.2.5 Gaseous Radwaste Treatment

The OPERABILITY of the GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable". This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

B/1.3 RADIOACTIVE EFFLUENTS: TOTAL DOSE

The specification is provided to meet the dose limitations of 40 CFR 190. The specification requires the preparation and submittal of a Special Report whenever the calculated doses from plant radioactive effluents exceed twice the design objective doses of Appendix I. For sites containing up to 4 reactors, it is highly unlikely that the resultant dose to a member of the public will exceed the dose limits of 40 CFR 190 if the individual reactors remain within the reporting requirement level. The Special Report will describe a course of action which should result in the limitation of dose to a member of the public for 12 consecutive months to within the 40 CFR 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the member of the public from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 5 miles must be considered. If the dose to any member of the public is estimated to exceed the requirements of 40 CFR 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR 190 have not already been corrected), in accordance with the provisions of 40 CFR 190.11, is considered to be a timely request and fulfills the requirements of 40 CFR 190 until NRC staff action is completed. An individual is not considered a member of the public during any period in which he/she is engaged in carrying out any operation which is part of the nuclear fuel cycle.

Bases (continued)

B/1.4.1 Monitoring Program

The radiological monitoring program required by this specification provides measurements of radiation of radioactive materials in those exposure pathways and for those radionuclides, which lead to the highest potential radiation exposures of individuals resulting from the station operation. This monitoring program thereby supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways. The initially specified monitoring program will be effective for at least the first three years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The detection capabilities required by Table 1.4-3 are state-of-the-art for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as a posteriori (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified and described in the Annual Radiological Environmental Operating Report.

B/1.4.2 Land Use Census

This specification is provided to ensure that changes in the use of unrestricted areas are identified and that modifications to the monitoring program are made if required by the results of this census. The best survey information from the door-to-door, aerial or consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. Restricting the census to gardens of greater than 500 square feet provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were used, 1) that 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and 2) a vegetation yield of 2 kg/square meter.

B/1.4.3 Interlaboratory Comparison Program

The requirement for participation in an Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are reasonably valid.

1.6 REPORTING REQUIREMENTS

1.6.1 Annual Radiological Environmental Operating Report

1.6.1.1 Routine radiological environmental operating reports covering the operation of the unit during the previous calendar year shall be submitted prior to May 1 of each year. The initial report shall be submitted prior to May 1 of the year following initial criticality.

1.6.1.2 The annual radiological environmental operating reports shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison with preoperational studies, operational controls (as appropriate), and previous environmental surveillance reports and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of land use censuses required by ODCM Specification 1.4.2.1. If harmful effects or evidence of irreversible damage are detected by the monitoring, the report shall provide an analysis of the problem and a planned course of action to alleviate the problem.

The annual radiological environmental operating reports shall include summarized and tabulated results in the format of Regulatory Guide 4.8, December 1975 of all radiological environmental samples taken during the report period. In the event that some results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for missing results. The missing data shall be submitted as soon as possible in a supplementary report.

The report shall also include the following: a summary description of the radiological environmental monitoring program; a map of all sampling locations keyed to a table giving distances and directions from one reactor; and the results of licensee participation in the Interlaboratory Comparison Program, required by ODCM Specification 1.4.3.1.

1.6.2 Annual Radioactive Effluent Release Report

1.6.2.1 A radioactive effluent release report covering the operation of the unit during the previous year of operation shall be submitted within 60 days after January 1 of each year. The period of the first report shall begin with the date of initial criticality.

1.6.2.2 The Radioactive Effluent Release Report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants", Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof. The summary will also include quantities of radioactive gaseous effluent and solid waste (ash) released as a result of on-site oil incineration.

The Radioactive Effluent Release Report shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing of wind speed, wind direction, and atmospheric stability, and precipitation (if measured) on magnetic tape, or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability. This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station and oil incinerator during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to members of the public due to their activities inside the site boundary (Figures 5.1-3 and 5.1-4 of the VCSNS Technical Specifications) during the year. All assumptions used in making these assessments (i.e., specific activity, exposure time and location) shall be included in these reports. Historical annual average meteorology or meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents (as determined by sampling frequency and measurement) shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be

performed in accordance with the OFFSITE DOSE CALCULATION MANUAL (ODCM).

The Radioactive Effluent Release Report shall also include an assessment of radiation doses to the likely most exposed member of the public from reactor releases and other nearby uranium fuel cycle sources (including doses from primary effluent pathways and direct radiation) for the previous 12 consecutive months to show conformance with 40 CFR 190, Environmental Radiation Protection Standards for Nuclear Power Operation. Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in Regulatory Guide 1.109, Rev. 1.

The Radioactive Effluent Release Report shall include unplanned releases from site to unrestricted areas of radioactive materials in gaseous and liquid effluents on a quarterly basis.

The Radioactive Effluent Release Report shall also include the following: an explanation as to why the inoperability of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified in ODCM Specifications 1.1.1.1 and 1.2.1.1, respectively.

1.6.3 Major Changes To Radioactive Waste Treatment Systems (Liquid and Gaseous)

1.6.3.1 Licensee initiated major changes to the radioactive waste systems (liquid and gaseous):

1. Shall be reported to the Commission in the Monthly Operating Report for the period in which the evaluation was reviewed by the Plant Safety Review Committee. The discussion of each change shall contain:
 - a. A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59;
 - b. Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
 - c. A detailed description of the equipment, components and processes involved and the interfaces with other plant systems;
 - d. An evaluation of the change which shows the predicted releases or radioactive materials in liquid and gaseous effluents that differs from those previously predicted in the license application and amendments thereto;
 - e. An evaluation of the change which shows the expected maximum exposures to individual in the unrestricted area and to the general population that differ from those previously estimated in the license application and amendments thereto;
 - f. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents, to the actual releases for the period prior to when the changes are to be made;
 - g. An estimate of the exposure to plant operating personnel as a result of the change; and

- h. Documentation of the fact that the change was reviewed and found acceptable by the PSRC.
- 2. Shall become effective upon review and acceptance as set forth in Technical Specification 6.5.

1.7 Definitions

ACTION

- 1.7.1 ACTION shall be that part of a specification which prescribes measures required under designated conditions.

ANALOG CHANNEL OPERATIONAL TEST

- 1.7.2 An ANALOG CHANNEL OPERATIONAL TEST shall be the injection of a simulated signal into the channel as close to the sensor as practicable to verify OPERABILITY of alarm, interlock and/or trip functions. The ANALOG CHANNEL OPERATIONAL TEST shall include adjustments, as necessary, of the alarm, interlock and/or trip setpoints such that the setpoints are within the required range and accuracy.

CHANNEL CALIBRATION

- 1.7.3 A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel such that it responds within the required range and accuracy to known values of input. The CHANNEL CALIBRATION shall encompass the entire channel including the sensors and alarm, interlock and/or trip functions, and may be performed by any series of sequential, overlapping or total channel steps such that the entire channel is calibrated.

CHANNEL CHECK

- 1.7.4 A CHANNEL CHECKS shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

GASEOUS RADWASTE TREATMENT SYSTEM

- 1.7.5 A GASEOUS RADWASTE TREATMENT SYSTEM is any system designed and installed to reduce radioactive gaseous effluents by collecting primary coolant system off gases from the primary system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

OPERABLE - OPERABILITY

- 1.7.6 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component or device to perform its function(s) are also capable of performing their related support function(s).

SOURCE CHECK

- 1.7.7 A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a radioactive source.

VENTILATION EXHAUST TREATMENT SYSTEM

- 1.7.8 A VENTILATION EXHAUST TREATMENT SYSTEM is any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal absorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment (such a system is not considered to have any effect on noble gas effluents). Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

2.0 LIQUID EFFLUENT

2.1 Liquid Effluent Monitor Setpoint Calculation

The Virgil C. Summer Nuclear Station is located on the Monticello Reservoir which provides supply and discharge for the plant circulating water. This reservoir also provides supply and discharge capacity for the Fairfield Pumped Storage Facility. The Parr Reservoir located below the pumped storage facility is formed by the Parr Dam.

There are two analyzed release pathways and sources of dilution for liquid effluents: the circulating water discharge canal and the liquid effluent line to the penstocks of the pumped storage facility. All liquid effluent pathways discharge to one of these release points. Generally speaking, very low concentrations of radioactive waste are discharged to the circulating water discharge while higher concentrations of radioactive waste are released to the penstocks of the pumped storage facility during the generation cycle.

The calculated setpoint values will be regarded as upper bounds for the actual setpoint adjustments. That is, setpoint adjustments are not required to be performed if the existing setpoint level corresponds to a lower count rate than the calculated value. Setpoints may be established at values lower than the calculated values, if desired.

Calculated monitor setpoints may be added to the ambient background count rate.

GENERAL NOTE: If no discharge is planned for a specific pathway or if the sum of the effluent concentrations of gamma emitting nuclides equals zero, the monitor setpoint should be established as close to background as practical to prevent spurious alarms and yet alarm should an inadvertent release occur.

2.1.1 Liquid Effluent Monitor Setpoint Calculation Parameters

<u>Term:</u>	<u>Definition*</u>	<u>Section of Initial Use</u>
A	= Penstock discharge adjustment factor which will allow the set point to be established in a convenient manner and to prevent spurious alarms. = f_t/f_{dx}	2.1.2
A_{it}	= The site related ingestion dose commitment factor to the total body or organ t , for each identified principal gamma and beta emitter listed in Table 2.2-3 (mrem-ml per hr-uCi). For calculation see section 2.2.2.	2.1.4.4.1
\bar{A}_t	= average A_{it} using maximum organ for each nuclide and weighted by concentration. = $\frac{\sum (A_{it} * C_i)}{\sum C_i}$	2.1.4.4.1
B	= Steam Generator Blowdown adjustment factor which will allow the set point to be established in a convenient manner and to prevent spurious alarms. = f_d/f_{ds}	2.1.4.1
C	= the effluent concentration limit (Specification 1.1.2) implementing 10CFR 20 for the site, in uCi/ml.	2.1.2
C_a	= the effluent concentration of alpha emitting nuclides observed by gross alpha analysis of the monthly composite sample, in uCi/ml.	2.1.2
C_f	= the measured concentration of Fe-55 in liquid waste as determined by analysis of the most recent available quarterly composite sample, in uCi/ml.	2.1.2
C_g	= the effluent concentration of a gamma emitting nuclide, g , observed by gamma-ray spectroscopy of the waste sample, in uCi/ml.	2.1.2
C_i	= the concentration of nuclide i , in uCi/ml, as determined by the analysis of the waste sample.	2.1.2
C_{ir}	= the concentration of radionuclide i , in uCi/ml, in the Monticello Reservoir. Inclusion of this term will correct for possible long-term buildup of radioactivity due to recirculation and for the presence of activity recently released to the Monticello Reservoir by plant activities.	2.1.2
C_s	= the concentration of Sr-89 or Sr-90 in liquid wastes as determined by analysis of the quarterly composite sample, in uCi/ml.	2.1.2
C_t	= the measured concentration of H-3 in liquid waste as determined by analysis of the monthly composite, in uCi/ml.	2.1.2
c	= the setpoint, in uCi/ml, of the radioactivity monitor measuring the radioactivity concentration in the effluent line prior to dilution and subsequent release. This setpoint which is proportional to the volumetric flow to the effluent line and inversely proportional to the volumetric flow of the dilution stream plus the effluent	2.1.2

*All concentrations are in units of uCi/ml unless otherwise noted.

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
	stream, represents a value which, if exceeded, would result in concentrations exceeding the limits of 10CFR 20 in the unrestricted area.	
C_B	= the monitor setpoint concentration for RM-L7, the Nuclear Blowdown Monitor Tank discharge line monitor, in uCi/ml.	2.1.2.2
C_C	= the monitor setpoint concentration for RM-L9, the combined Liquid Waste Processing System and Nuclear Blowdown System effluent discharge line monitor, in μ Ci/ml.	2.1.2.3
C_D	= the monitor setpoint concentration for RM-L11, the Condensate Demineralizer Backwash discharge line monitor, in uCi/ml.	2.1.4.2.2
C_M	= the monitor setpoint concentration for RM-L5, the Waste Monitor Tank discharge line monitor, in uCi/ml.	2.1.2.1
C_{Sa}	= the monitor setpoint concentration for RM-L3, the initial Steam Generator Blowdown Effluent line monitor, in μ Ci/ml.	2.1.4.1.1
C_{Sb}	= the monitor setpoint concentration for RM-L10, the final Steam Generator Blowdown Effluent line monitor, in uCi/ml.	2.1.4.1.1
C_T	= the monitor setpoint concentration for RM-L8, the Turbine Building Sump Effluent line monitor, in uCi/ml.	2.1.4.2.1
CF_D	= the Condensate Demineralize Backwash Effluent Concentration Factor.	2.1.4.2
CF_S	= the Steam Generator Blowdown Effluent Concentration Factor.	2.1.4.3
CF_T	= the Turbine Building Sump Effluent Concentration Factor.	2.1.4.2
DF	= the dilution factor, which is the ratio of the total dilution flow rate to the effluent stream flow rate(s).	2.1.2
D_m	= daily dose projection margin (mrem) for most limiting dose (total body or organ).	2.1.4.4.1
F	= the dilution water flow setpoint as determined prior to the release, in volume per unit time.	2.1.2
F_d	= the flow rate of the Circulating Water System during the time of release of the Turbine Building Sump and/or the Steam Generator Blowdown, in volume per unit time.	2.1.4.1
F_{dc}	= the dilution flow rate of the Circulating Water System used for effluent monitor setpoint calculations, based on 90 percent of expected Circulating Water System flow rate during the time of release and corrected for recirculated Monticello Reservoir activity, in volume per unit time.	2.1.4.1
F_{dp}	= the dilution flow rate through the penstock(s) receiving the radioactive liquid release upon which the effluent monitor setpoint is based, as corrected for any recirculated radioactivity, in volume per unit time.	2.1.2

* (Conservatively this value will be either zero, if no release is to be conducted from this system, or the maximum measured capacity of the discharge pump if a release is to be conducted.)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
F_t	= the flow rate of water through the Fairfield Pumped Storage Station penstock(s) to which radioactive liquids are being discharged during the period of effluent release. This flow rate is dependent upon operational status of Fairfield Pumped Storage Station, in volume per unit time.	2.1.2
f	= the effluent line flow setpoint as determined for the radiation monitor location, in volume per unit time.	2.1.2
f_d	= the maximum permissible discharge flow rate for releases to the Circulating Water, in volume per unit time.	2.1.4.1
f_{db}^*	= the flow rate of the Nuclear Blowdown Monitor Tank discharge, in volume per unit time.	2.1.2
f_{dm}^*	= the flow rate of a Waste Monitor Tank discharge, in volume per unit time.	2.1.2
f_{ds}^*	= the flow rate of the Steam Generator Blowdown discharge, in volume per unit time.	2.1.4.1
f_{dx}	= the flow rate of the tank discharge, either f_{dm} or f_{db} , in volume per unit time.	2.1.2
F_k	= The near field dilution factor for C_i during release from Turbine Building sump.	2.1.4.4.1
f_r	= the recirculation flow rate used to mix the contents of a tank, in volume per unit time.	2.1.2
f_t	= the maximum permissible discharge flow rate for batch releases to the penstocks, in volume per unit time.	2.1.2
MPC_i	= $MPC_g, MPC_a, MPC_s, MPC_r,$ and MPC_t = the limiting concentrations of the appropriate gamma emitting, alpha emitting, and strontium radionuclides, Fe-55, and tritium, respectively, from 10CFR, Part 20, Appendix B, Table II, Column 2. For gamma emitting noble gas radionuclides, $MPC_i = 2 \times 10^{-4}$ uCi/ml.	2.1.2
SF	= the safety factor, a conservative factor used to compensate for engineering and measurement uncertainties. SF = 0.5, corresponding to a 100 percent variation.	2.1.2
$[C_i]_{LLD}$	= the Lower Limit of Detection (LLD) for radionuclide i in liquid waste in the Waste Monitor Tank, as determined by the analysis required in ODCM Table 1.1-4, in uCi/ml.	2.1.3
$[C_i]_M$	= the concentration of radionuclide i in the waste contained within the Waste Monitor Tank serving as the holding facility for sampling and analysis prior to discharge, in uCi/ml.	2.1.3

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
$\sum C_g$	= the sum of the concentrations C_g of each measured gamma emitting nuclide observed by gamma-ray spectroscopy of the waste sample, in $\mu\text{Ci/ml}$.	2.1.2
$[\sum C_g]_B$	= the gamma isotopic concentrations of the Nuclear Blowdown Monitor Tank as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.2
$[\sum C_g]_D$	= the gamma isotopic concentrations of the Condensate Demineralizer Backwash effluent (including solids) as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.4.2.2
$[\sum C_g]_M$	= the gamma isotopic concentrations of the Waste Monitor Tank as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.2
$[\sum C_g]_S$	= the gamma isotopic concentrations of the Steam Generator Blowdown as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.4.1.1
$[\sum C_g]_T$	= the gamma isotopic concentrations of the Turbine Building Sump as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in $\mu\text{Ci/ml}$.	2.1.4.2.1
$[\sum (C_i/\text{MPC}_i)]_D$	= the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Condensate Demineralizer Backwash.	2.1.4.2
$[\sum (C_i/\text{MPC}_i)]_S$	= the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Steam Generator Blow-down Effluent.	2.1.4.1
$[\sum (C_i/\text{MPC}_i)]_T$	= the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Turbine Building Sump Effluent.	2.1.4.2
$[\sum (C_i/\text{MPC}_i)]_X$	= the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC for the tank whose contents are being considered for release. For a WMT, $X = M$. For the NBMT, $X = B$.	2.1.2
t_r	= the minimum time for recirculating the contents of a tank prior to sampling, in minutes.	2.1.2
V	= the volume of liquid in a tank to be sampled, in gallons.	2.1.2
V_j	= release volume for Turbine Building sump release permit j , in gallons.	2.1.4.4.1
Δt_k	= the length of time (in hours) during which concentrations and flow rates are averaged. For purpose of setpoint calculation, $\Delta t_k = 24$ hours.	2.1.4.4.1

2.1.2 Liquid Radwaste Effluent Line Monitors

(RM-L5, RM-L7, RM-L9)

Liquid Radwaste Effluent Line Monitors provide alarm and automatic termination of release functions prior to exceeding the concentration limits specified in 10CFR 20, Appendix B, Table II, Column 2 at the release point to the unrestricted area. To meet this specification, the alarm/trip setpoints for liquid effluent monitors and flow measurement devices are set to assure that the following equation is satisfied:

$$C \geq \frac{cf}{F+f} \quad (1)$$

where:

- C = the effluent concentration limit (Specification 1.1.2) implementing 10CFR 20 for the site in uCi/ml.
- c = the setpoint, in uCi/ml, of the radioactivity monitor measuring the radioactivity concentration in the effluent line prior to dilution and subsequent release; the setpoint, which is inversely proportional to the volumetric flow of the effluent line and proportional to the volumetric flow of the dilution stream plus the effluent stream, represents a value which, if exceeded, would result in concentrations exceeding the limits of 10CFR 20 in the unrestricted area.
- F = the dilution water flow setpoint as determined prior to the release point, in volume per unit time.
- f = the effluent line flow setpoint as determined at the radiation monitor location, in volume per unit time.

At the Virgil C. Summer Nuclear Station the Liquid Waste Processing System (LWPS) and the Nuclear Blowdown System (NBS) both discharge to the penstocks of the Fairfield Pumped Storage (FPS) Facility through a

common line. The available dilution water flow (F_{dp}) is assumed to be 90 percent of the flow through the FPS penstock(s) to which liquid effluent is being discharged and is dependent upon operational status of the FPS Facility. The waste tank flow rates (f_{dm} and f_{db}) and the monitor setpoints (c_M , c_B and c_C) are set to meet the condition of equation (1) for a given effluent concentration, C . The three monitor setpoints are determined in accordance with the monitor system configuration for this discharge pathway. The LWPS discharges through RM-L5, which has setpoint c_M for alarm/control functions over releases from either Waste Monitor Tanks 1 or 2. The Nuclear Blowdown discharges through RM-L7, which has setpoint c_B for alarm/control functions over releases from the Nuclear Blowdown Monitor Tank. These two release pathways merge into a common line monitored by RM-L9, which has setpoint c_C for control functions over the common effluent line. Although the piping is arranged so that simultaneous batch releases from the two systems could be practiced, operational releases shall be from only one of the two batch systems at any given time. The method by which their setpoints are determined is as follows:

- 1) The isotopic concentration for a waste tank to be released is obtained from the sum of the measured concentrations as determined by the analysis required in Table 1.1-4:

$$\sum_i C_i = \sum_g C_g + C_a + C_s + C_t + C_f \quad (2)$$

where:

C_i = the concentration of nuclide i , in uCi/ml, as determined by the analysis of the waste sample.

* Values for C_a , C_s , C_t and C_f will be based on most recent available composite sample analyses as required by Table 1.1-4.

- ΣC_g = the sum of the concentrations C_g of each measured gamma emitting nuclide observed by gamma-ray spectroscopy of the waste sample, in uCi/ml.
- C_a^* = the effluent concentration of alpha emitting nuclides observed by gross alpha analysis of the monthly composite sample, in uCi/ml.
- C_s^* = the concentration of Sr-89 and Sr-90 in liquid waste as determined by analysis of the quarterly composite sample, in uCi/ml.
- C_t^* = the measured concentration of H-3 in liquid waste as determined by analysis of the monthly composite sample, in uCi/ml.
- C_i^* = the measured concentration of Fe-55 in liquid waste as determined by analysis of the quarterly composite sample, in uCi/ml.

The C_g term will be included in the analysis of each batch; terms for alpha, strontium, Fe-55, and tritium shall be included as appropriate*. Isotopic concentrations for both the Waste Monitor Tanks (WMT) and the Nuclear Blowdown Monitor Tank (NBMT) may be calculated using equation (2).

Prior to being sampled for analysis, the contents of a tank shall be isolated and recirculated. The minimum recirculation time shall be:

$$t_r = 2V/f, \quad (3)$$

- t_r = the minimum time for recirculating the contents of a tank prior to sampling.
- V = the volume of liquid in the tank to be sampled.
- f_r = the recirculation flow rate used to mix the contents of a tank.

This is done to ensure that a representative sample will be obtained. Mechanical mixers shall ensure a similar minimum turnover.

- 2) Once isotopic concentrations for either Waste Monitor Tank or the Nuclear Blowdown Monitor Tank have been determined, these values are used to calculate a Dilution Factor, DF, which is the ratio of dilution flow rate to tank flow rate(s) required to assure that the limiting concentration of 10CFR, Part 20, Appendix B, Table II, Column 2 are met at the point of discharge for whichever tank is having its contents discharged.

$$DF = \left| \sum_i \frac{C_i}{MPC_i} \right|_x + SF \quad (4)$$

$$DF = \left| \sum_g \frac{C_g}{MPC_g} + \frac{C_a}{MPC_a} + \frac{C_s}{MPC_s} + \frac{C_f}{MPC_f} + \frac{C_t}{MPC_t} \right|_x + SF \quad (5)$$

where:

$\left| \sum_i \frac{C_i}{MPC_i} \right|_x$ = the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC for the tank whose contents are being considered for release. For a WMT, $X = M$. For the NBMT, $X = B$.

MPC_i = MPC_g , MPC_a , MPC_s , MPC_f , and MPC_t = limiting concentrations of the appropriate gamma emitting, alpha emitting, and strontium radionuclides, Fe-55, and tritium, respectively, given in 10CFR, Part 20, Appendix B, Table II, Column 2. For gamma-emitting noble gas radionuclides MPC_i is to be set equal to 2×10^{-4} $\mu\text{Ci/ml}$, according to the Radiological Effluent Technical Specifications.

SF = the safety factor; a conservative factor used to compensate for engineering and measurement uncertainties.

= 0.5, Corresponding to a 100 percent variation.

- 3) The maximum permissible discharge flow rate, f_t , may be calculated for the release of either the WMT or NBMT. First the appropriate Dilution Factor is calculated by applying equation (4), using the appropriate concentration ratio term (i.e. M or B).

then,

$$f_t = \frac{F_{dp} + f_{dx}}{DF} \approx \frac{F_{dp}}{DF} \quad \text{for } F_{dp} \gg f_{dx} \quad (6)$$

where:

F_{dp} = dilution flow rate to be used in effluent monitor setpoint calculations, based on 90 percent FPS Station expected flow rate, as corrected for any recirculated radioactivity:

$$F_{dp} = (0.9) F_t \left(1 - \sum_i \frac{C_{ir}}{MPC_i} \right) \quad (7)$$

where:

F_t = the flow rate through the Fairfield Pumped Storage Station penstock(s) to which radioactive liquids are being discharged. F_t should normally fall between 2500 and 44800 cfs.

C_{ir} = the concentration of radionuclide i , in uCi/ml, in the intake of Fairfield Pumped Storage Station (that is, in the Monticello Reservoir). Inclusion of this term will correct for possible long-term buildup of radioactivity due to recirculation and for the presence of activity recently released to the Monticello Reservoir by plant activities. For expected discharges of liquid wastes, the summation will be much less than 1.0 and can be ignored (Reference 6).

- f_{dx} = the flow rate of the tank discharge, either f_{dm} or f_{db} .
- f_{db} = flow rate of Nuclear Blowdown Monitor Tank discharge. (Conservatively this value will be either zero, if no release is to be conducted from this system, or the maximum measured capacity of the discharge pump if a release is to be conducted.)
- f_{dm} = flow rate of Waste Monitor Tank discharge. (Conservatively this value will either be zero, if no release is to be conducted from this system, or the maximum measured capacity of the discharge pump if a release is to be conducted.)
- DF = the Dilution Factor from Step 2.

If $f_t = f_{dx}$, the release may be made as planned and the flow rate monitor setpoints should be established as in Step 4 (below). Because F_{dp} is normally very large compared to the maximum discharge pump capacities for the Waste Monitor Tank and the Nuclear Blowdown Monitor Tank, it is extremely unlikely that $f_t < f_{dx}$. However, if a situation should arise such that $f_t < f_{dx}$, steps must be taken to assure that equation (1) is satisfied prior to making the release. These steps may include decreasing f_{dx} by decreasing the flow rate of f_{dm} or f_{db} , and/or increasing F_{dp} .

When new candidate flow rates are chosen, the calculations above should be repeated to verify that they combine to form an acceptable release. If they do, the establishment of flow rate monitor setpoints may proceed as follows in Step 4. If they do not, the choice of candidate flow rates must be repeated until an acceptable set is identified.

Note that if $DF = 1$, the waste tank concentration for which the calculation is being performed includes safety factors in Step 2 and meets the limits of 10CFR 20 without further dilution. Even though

no dilution would be required, there will be no discharge if minimum dilution flow is not available, since the penstock minimum flow interlock will prevent discharge.

- 4) The dilution flow rate setpoint*, F , is established at 90 percent of the expected available dilution flow rate:

$$F = (0.9) F_t \quad (8)$$

The flow rate monitor setpoint* for the effluent stream shall be set at the selected discharge pump rate (normally the maximum discharge pump rate or zero) f_{dm} or f_{db} chosen in Step 3 above.

- 5) The radiation monitor setpoints may now be determined based on the values of ΣC_i , F , and f which were specified to provide compliance with the limits of 10CFR 20, Appendix B, Table II, Column 2. The monitor response is primarily to gamma radiation, therefore, the actual setpoint is based on ΣC_g .

The setpoint concentration, c , is determined as follows:

$$c \leq \frac{\sum C_g \times A}{B} \quad (9)$$

$A =$ Adjustment factor which will allow the setpoint to be established in a practical manner for convenience and to prevent spurious alarms.

$$A = f_t / f_{dx} \quad 10$$

If $A \geq 1$, Calculate c and determine the maximum value for the actual monitor setpoint (cpm) from the monitor calibration graph.

* Set points for flow rates are administrative limits.

If $A < 1$, No release may be made. Reevaluate the alternatives presented in Step 3.

NOTE: If calculated setpoint values are near actual concentrations planned for release, it may be impractical to set the monitor alarm at this value. In this case a new setpoint may be calculated following the remedial methodology presented in Step 3 for the case of $f_t < f_{dx}$.

Within the limits of the conditions stated above, the specific monitor setpoint concentrations for the three liquid radiation monitors RM-L5, RM-L7, and RM-L9 are determined as follows:

2.1.2.1 RM-L5, Waste Monitor Tank Discharge Line Monitor:

$$C_M \leq \left[\sum_g C_g \right]_M (A) \quad (11)$$

C_M is in uCi/ml

*See GENERAL NOTE under 2.1.

2.1.2.2 RM-L7, Nuclear Blowdown Monitor Tank Discharge Line Monitor:

$$C_B \leq \left[\sum_g C_g \right]_B (A) \quad (12)$$

C_B is in uCi/ml

NOTE: In no case should discharge be made directly from the Nuclear Blowdown Holdup Tank to the penstocks.

*See GENERAL NOTE under 2.1.

2.1.2.3 RM-L9, Combined Liquid Waste Processing System and Nuclear Blowdown Waste Effluent Discharge Line Monitor

The monitor setpoint concentration on the common line, c_C , should be the same as the setpoint concentration for the monitor on the active individual discharge line (i.e., c_M , or c_B as determined above):

$$C_C \leq \text{MAX} (C_M, C_B) \quad (13)$$

*See GENERAL NOTE under 2.1.

NOTE: In all cases, c_M , c_B , and c_C are the setpoint concentration values in uCi/ml. The actual monitor setpoints (cpm) for RM-L5, RM-L7, and RM-L9 are determined from the calibration graph for the particular monitor. Initially, the calibration curves were determined conservatively from families of response curves supplied by the monitor manufacturers. A sample is shown in Figure 2.1-1. As releases occur, a historical correlation will be prepared and placed in service when sufficient data are accumulated.

2.1.3 Liquid Radwaste Discharge Via Industrial and Sanitary Waste System (RM-L5)

In the Virgil C. Summer Nuclear Station liquid waste effluent system design, there exists a mechanism for discharging liquid wastes via the Industrial Sanitary Waste System. The sample point prior to discharge is one of the Waste Monitor Tanks. The analysis requirements are the requirements listed in Table 1.1-4.

This effluent pathway shall only be used when the following condition is met for all radionuclides, i:

$$\left| C_i \right|_M \leq \left| C_i \right|_{LLD} \quad (14)$$

$\left| C_i \right|_M$ = the concentration of radionuclide i in the waste contained within the Waste Monitor Tank serving as the holding facility for sampling and analysis prior to discharge, in uCi/ml.

$\left| C_i \right|_{LLD}$ = the Lower Limit of Detection, (LLD) for radionuclide i in the liquid waste in the Waste Monitor Tank as determined by the analysis required in Table 1.1-4, in uCi/ml.

When the conditions of equation (14) are met, liquid waste may be released via the Industrial and Sanitary Waste System pathway. The RM-L5 setpoint should be established as close to background as practical to prevent spurious alarms and yet alarm should an inadvertent high concentration release occur.

2.1.4 Steam Generator Blowdown, Turbine Building Sump, and Condensate Demineralizer Backwash Effluent Lines

(RM-L3, RM-L10, RM-L8, RM-L11)

Concentrations of radionuclides in the liquid effluent discharges made via the Turbine Building Sump, Steam Generator Blowdown, and Condensate Demineralizer Backwash are expected to be very low or nondetectable. The first two releases are expected to be continuous in nature and the last a batch release. All will be sampled in an appropriate manner as specified in Table 1.1-4 of the ODCM. The Steam Generator Blowdown Monitors, the Turbine Building Sump Monitor, and the Condensate Demineralizer Backwash Monitor provide alarm and automatic termination of release prior to exceeding the concentration limits specified in 10CFR 20, Appendix B, Table II, Column 2 at the release point to the unrestricted area.

In reality, all of these effluent pathways utilize the circulating water as dilution to the effluent stream, with the circulating water discharge canal being the point of release into an unrestricted area. Steam Generator Blowdown Effluent may be released to the Circulating Water either directly in the Condenser outflow (the normal flow path) or in the first hours following startup via the Industrial and Sanitary Waste System (ISWS) for chemical reasons. The Turbine Building Sump and Condensate Demineralizer Backwash Effluents enter Circulating Water via the sumps and ponds of the Industrial and Sanitary Waste System.

- CO3+ To ensure compliance with ODCM specification 1.1.2.1, normally no dilution is assumed for discharges to the Industrial and Sanitary Waste System. The assumption of no dilution limits discharges to < 0.5 MPC and therefore ODCM specification 1.1.2.1 would not be compromised in the event circulating water dilution is lost. To add operational flexibility for abnormal conditions (radionuclide concentration in Turbine Building sump > 0.5 MPC), discharges from the Turbine Building sump and concentrations in the ISWS may exceed the operational objective, 0.5 MPC, provided circulating water dilution is sufficient to ensure compliance with ODCM specification 1.1.2.1 and liquid effluents are being discharged in compliance with ODCM specification 1.1.4.1. Two separate setpoint calculations are given for Turbine Building sump discharges (RM-L8). Section 2.1.4.2.1 describes the setpoint calculation normally used, limiting discharges to 0.5 MPC. Section 2.1.4.2.2 provides an alternate setpoint methodology which may be used during abnormal conditions. RM-L8 set-points are considered in compliance with ODCM specification 1.1.1.1 provided the setpoints are
- CO3+ adequate to prevent releases in excess of ODCM specification 1.1.2.1.

Two mutually exclusive setpoint calculation processes are outlined below for steam generator blowdown. Section 2.1.4.1 is to be used whenever Steam Generator Blowdown is being released directly to the Circulating Water in the Condenser outflow, which is the normal mode. Section 2.1.4.2 is to be used whenever Steam Generator Blowdown is being released to the Industrial and Sanitary Waste System, or diverted to the Nuclear Blowdown Processing System, both of which are alternate modes.

Normally, water collected by the Nuclear Blowdown Processing System has very low specific activity. This water may be processed to the Turbine Building sump.

NOTE: When Circulating Water is unavailable for effluent dilution, releases containing activity above LLD (excluding tritium) should be discouraged via pathways

which lead to it. Steam Generator Blowdown should be diverted to the Nuclear Blowdown Processing System. Condensate Demineralizer Backwash may be diverted to the Turbine Building sump or not released. Turbine Building sump effluent should be processed through temporary demineralizers or diverted to the Excess Liquid Waste Processing System. (These steps are to keep the calculated dose to individuals as low as reasonably achievable.)

2.1.4.1 Steam Generator Blowdown Effluent Direct to Circulating Water (Normal Mode)

Equation (1) is again used to assure that effluents are in compliance with the aforementioned specification:

$$C \geq \frac{cf}{(F+f)}$$

The available dilution water flow (F_{dc}) is dependent upon the mode of operation of the Circulating Water System. Any change in this value will be accounted for in a recalculation of equation (1). The Steam Generator Blowdown flow rate (f_{ds}) and the Steam Generator Blowdown monitor setpoints (c_{sa} and c_{sb}) are set to meet the condition of equation (1).

RM-L3, the first monitor in the Steam Generator Blowdown discharge pathway, alarms and terminates release of the stream. The discharge is then automatically diverted to the Nuclear Blowdown Processing System. RM-L10, the last monitor in the Steam Generator Blowdown discharge pathway, alarms and terminates the release. Thus, RM-L10 is redundant to RM-L3 and the setpoint (c_{sb}) will be determined in the same manner as RM-L3 (c_{sa}).

The method by which the monitor setpoints are determined is as follows:

- 1) The isotopic concentrations for any release source to be or being released are obtained from the sum of the measured concentrations as determined in Table 1.1-4. Equation (2) is again employed for this calculation:

$$\sum_i C_i = \sum_g C_g + C_a + C_s + C_t + C_f$$

where:

- $\sum_i C_i$ = the sum of the measured concentrations as determined by the analysis of the waste sample, in uCi/ml.
- $\sum_g C_g$ = the sum of the concentrations C_g of each measured gamma emitting nuclide observed by gamma-ray spectroscopy of the waste sample, in uCi/ml.
- C_a = the measured concentration C_a of alpha emitting composite sample, in uCi/ml.
- C_s = the measured concentrations of Sr-89 and Sr-90 in liquid waste as determined by analysis of the most recent available quarterly composite sample, in uCi/ml.
- C_t = the measured concentration of H-3 in liquid waste determined by analysis of the monthly composite sample, in uCi/ml.
- C_f = the measured concentration of Fe-55 in liquid waste as determined by analysis of the most recent available quarterly composite sample, in uCi/ml.

Isotopic concentrations for the Steam Generator Blowdown System effluent, the Turbine Building Sump Effluent, and the Condensate Demineralizer Backwash effluent may be calculated using equation (2).

- 2) Once isotopic concentrations for the Steam Generator Blowdown have been determined, these values are used to calculate a Dilution Factor, DF, which is the ratio of the total dilution flow rate to effluent stream flow rate required to assure that the limiting concentrations of 10CFR, Part 20, Appendix B, Table II, Column 2 are met at the point of discharge.

$$DF = \left[\sum_i \frac{C_i}{MPC_i} \right]_S + SF \quad (15)$$

$$DF = \left[\sum_g \frac{C_g}{MPC_g} + \frac{C_a}{MPC_a} + \frac{C_s}{MPC_s} + \frac{C_f}{MPC_f} + \frac{C_t}{MPC_t} \right]_S + SF \quad (16)$$

where:

C_i = $C_g, C_a, C_s, C_f,$ and C_t ; measured concentrations as defined in Step 1. Terms $C_a, C_s, C_f,$ and C_t will be included in the calculation as appropriate.

$\left[\sum_i \frac{C_i}{MPC_i} \right]_S$ = the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Steam Generator Blowdown effluent.

MPC_i = $MPC_g, MPC_a, MPC_s, MPC_f,$ and MPC_t are limiting concentrations of the appropriate radionuclide from 10CFR, Part 20, Appendix B, Table II, Column 2 limits. For gamma-emitting noble gas radionuclides, MPC_i is to be set equal to 2×10^{-4} uCi/ml.

SF = the same generic term as used in Section 2.1.2, Step 2.

= 0.5

- 3) The maximum permissible effluent discharge flow rate, f_d , may now be calculated for a release from the Steam Generator Blowdown.

$$f_d = \frac{F_{dc} + f_{ds}}{DF} = \frac{F_{dc}}{DF} \text{ for } F_{dc} \gg f_{ds} \quad (17)$$

where:

F_{dc} = Dilution flow rate for use in effluent monitor setpoint calculations, based on 90 percent of the expected flow rate of the Circulating Water System during the time of release and corrected for any recirculated activity:

$$F_{dc} = (0.9) F_d \left[1 - \sum_i \frac{C_{ir}}{MPC_i} \right] \quad (18)$$

where:

F_d = the flow rate of the Circulating Water System during the time of the release. F_d should normally fall between 1.78×10^5 and 5.34×10^5 gpm when the plant is operating and should be 5000 gpm when the plant is shutdown and the Circulating Water Jockey pump is operating.

C_{ir} = the concentration of radionuclide i , in uCi/ml, in the Circulating Water System intake, (that is, in the Monticello Reservoir). Inclusion of this term will correct for possible long-term buildup of radioactivity due to recirculation and for the presence of activity recently released to the Monticello Reservoir by plant activities. For expected discharges of liquid wastes, the summation will be much less than 1.0 and can be ignored (Reference 6).

f_{ds} = Flow rate of Steam Generator Blowdown discharge. (This value normally will be either zero, if no release is

to be conducted, or the maximum rated capacity of the discharge pump (250 gpm), if a release is to be conducted.)

Note that the equation is valid only for $DF > 1$; for $DF \leq 1$, the effluent concentration meets the limits of 10CFR 20 without dilution as well as being in compliance with the conservatism imposed by the Safety Factor in Step 2.

If $f_d \geq f_{ds}$, releases may be made as planned. Because F_{dc} is normally large compared to the maximum discharge pump capacity of the Steam Generator Blowdown System, it is extremely unlikely that $f_d < f_{ds}$. However, if a situation should arise such that $f_d < f_{ds}$, steps must be taken to assure that equation (1) is satisfied prior to making the release. These steps may include diverting Steam Generator Blowdown to the Nuclear Blowdown Processing System or decreasing the effluent flow rate.

When new candidate flow rates are chosen, the calculations above should be repeated to verify that they combine to form an acceptable release. If they do, the establishment of flow rate monitor setpoints should proceed as follows in Step 4. If they do not provide an acceptable release, the choice of candidate flow rates must be repeated until an acceptable set is identified.

- 4) The dilution flow rate setpoint for minimum flow rate, F , is established at 90 percent of the expected available dilution flow rate:

$$F = (0.9) (F_d) \quad (19)$$

Flow rate monitor setpoints for the Steam Generator Blowdown effluent stream shall be set at the selected

discharge pump rate (normally the maximum discharge pump rate) f_{ds} , chosen in Step 3 above.

- 5) The Steam Generator Monitor setpoints may be specified based on the values of $\sum C_i$, F , and f which were specified to provide compliance with the limits of 10CFR 20, Appendix B, Table II, Column 2. The monitor response is primarily to gamma radiation, therefore, the actual setpoint is based on $\sum C_g$. The monitor setpoint in cpm which corresponds to the calculated value c is taken from the monitor calibration graph. (See NOTE, page 2.0-14.) The setpoint concentration, c , is determined as follows:

$$c \leq \sum_g C_g \times B \quad (20)$$

$$B = f_d / f_{ds} \quad (21)$$

If $B \geq 1$, Calculate c and determine the maximum value for the actual monitor setpoint (cpm) from the monitor calibration graph.

If $B < 1$, No release may be made. Reevaluate the alternatives presented in step 3.

NOTE: If the calculated setpoint value is near actual concentrations being released or planned for release, it may be impractical to set the monitor alarm at this value. In this case a new setpoint may be calculated following the remedial methodology presented in steps 3 and 4 for the case $f_d < f_{ds}$.

Within the conditions stated above, the specific monitor setpoint concentrations for the two steam generator blowdown monitors RM-L3 and RM-L10 are calculated as shown below. Since the monitors are sensitive primarily to

gamma radiation, their setpoints will be based on the concentrations of gamma emitting radionuclides.

2.1.4.1.1 For RM-L3, Steam Generator Blowdown Discharge initial monitor, and for RM-L10, Steam Generator Blowdown Discharge final monitor:

$$c_{S_a} \text{ or } c_{S_b} \leq \left[\sum_g c_g \right]_S (B) \quad (22)$$

$\left[\sum_g c_g \right]_S =$ the isotopic concentration of the Steam Generator Blowdown effluent as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in uCi/ml.

*See GENERAL NOTE under 2.1.

2.1.4.2 Turbine Building Sump and Condensate Demineralizer Backwash (Normal Mode)

For conservatism, the Turbine Building Sump and Condensate Demineralizer Backwash monitor setpoints (c_T and c_D) will claim no dilution from the Circulating Water, and will be set at the applicable concentration limit. That is:

$$c \leq C \quad (23)$$

The Turbine Building sump monitor, RM-L8, alarms and terminates release upon exceeding the monitor setpoint (c_T). The discharge can then be manually diverted to the Excess Waste Processing System. RM-L11, the Condensate Demineralizer Backwash monitor, alarms and terminates release upon exceeding the monitor setpoint (c_D). The discharge may then be manually diverted to the Turbine Building sump or simply delayed.

The Turbine Building Sump and Condensate Demineralizer Backwash monitor setpoints are to be established indepen-

SF = the generic engineering safety factor used in Section 2.1.2, Step 2.
= 0.5

If $CF \leq 1$, calculate c and determine the actual monitor setpoint (cpm) from the calibration curve.

If $CF > 1$, no release may be made via this path. The release must either be delayed or diverted for additional processing. Because of spurious alarms, these remedial steps may be required if the monitor setpoints are only near the actual concentrations being released.

Within the limits of the conditions stated above, the specific monitor setpoint concentrations for RM-L8 and RM-L11 may now be calculated. Because they are primarily sensitive to gamma radiation, their setpoints will be based on the concentrations of gamma emitting radionuclides as follows:

2.1.4.2.1 For RM-L8, Turbine Building Sump Discharge Monitor:

$$c_T \leq \left[\sum_g C_g \right]_T + CF_T \quad (27)$$

Where:

$\left[\sum_g C_g \right]_T$ = The gamma isotopic concentration of the Turbine Building sump effluent as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in uCi/ml.

CF_T = The Turbine Building sump Effluent Concentration Factor from equation (25).

*See GENERAL NOTE under 2.1.

2.1.4.2.2 For RM-L11, Condensate Demineralizer Backwash Discharge Monitor:

$$c_D \leq \left[\sum_g C_g \right]_D + CF_D \quad (28)$$

where:

$\left[\sum_g C_g \right]_D =$ The gamma isotopic concentration of the Condensate Demineralizer Backwash effluent (including solids) as obtained from the sum of the measured concentrations determined by the analysis required ODCM Table 1.1-4, in uCi/ml.

$CF_D =$ The Condensate Demineralizer Backwash Effluent Concentration Factor from equation (26).

*See GENERAL NOTE under 2.1.

2.1.4.3 Steam Generator Blowdown Effluent Not Directly to Circulating Water (Alternate Mode)

Equation (23) is again used to assure that effluents are in compliance with the aforementioned specification before dilution in the receiving water:

$$c \leq C$$

Because dilution is not considered in the setpoint calculation, it is not necessary to calculate maximum permissible discharge flow rates or anticipated available dilution flow rate.

The functions of the two monitors whose setpoints are to be established are described in Section 2.1.4.1 above. The method for the determination is as follows:

- 1) If a release is found to be permissible, flow rate monitors for the active effluent streams (Steam Generator Blowdown - f_{ds} , Turbine Building sump - f_{dt} , and Condensate Demineralizer - f_{dd}) may have their setpoints established at any operationally convenient value. Since 10CFR 20 is to be

complied with before dilution, the flow rate of discharges is irrelevant.

- 2) The Concentration Factor of equation (24) is again used to ensure the permissibility of the release:

$$CF = \left| \sum_i \frac{C_i}{MPC_i} \right| + SF$$

$$CF_S = \left| \sum_i \frac{C_i}{MPC_i} \right|_S + SF \quad (29)$$

in which all terms are defined in subsection 1.1.3.1 and subscript S refers to the Steam Generator Blowdown Effluent.

If $CF \leq 1$, calculate c and determine the actual monitor setpoint (cpm) from the calibration curve.

If $CF > 1$, no release may be made via this path. The release must either be delayed or diverted for additional processing. Because of spurious alarms, these remedial steps may be required if the monitor setpoints are only near the actual concentrations being released.

Within the above limitation, setpoint concentrations may now be calculated for the two effluent monitors. Because they are primarily sensitive to gamma radiation, their setpoints will be based on the concentrations of gamma emitting radionuclides as follows:

2.1.4.3.1 For RM-L3, Steam Generator Blowdown Discharge initial monitor, and RML-10, Steam Generator Blowdown Discharge final monitor:

$$c_{Sa} \text{ or } c_{Sb} \leq \left| \sum_g C_g \right|_S + CF_S \quad (30)$$

Where:

$\left[\sum_g C_g \right]_s$ = The isotopic concentration of the Steam Generator Blowdown effluent as obtained from the sum of the measured concentrations determined by the analysis required in ODCM Table 1.1-4, in uCi/ml.

CF_s = The Steam Generator Blowdown Effluent Concentration Factor from equation (29).

*See GENERAL NOTE under 2.1.

CO3+ 2.1.4.4 Turbine Building Sump (Abnormal Conditions)

Provided circulating water is available, 1 to 3 circulating water pumps, effluent exceeding 0.5 MPC may be released from the Turbine Building sump to the industrial and sanitary waste system, using the setpoint in this section, provided the following conditions are met:

- 1) Instantaneous release rate limits of ODCM Specification 1.1.2.1 are not exceeded in the circulating water discharge canal.
- 2) The average radionuclide concentration in the industrial and sanitary waste system (Pond 6B or 008) will not exceed 1.0 MPC when averaged over one year.
- 3) The limits of ODCM specification 1.1.4.1 will not be exceeded with actual liquid effluent releases over a 31 day period.
- 4) Average discharge flow does not exceed values used in setpoint determination.

In addition, the source of radioactivity should be identified and isolated. Radionuclide concentration in Turbine Building sump effluent should be restored to <0.5 MPC as soon as possible and normal setpoint reestablished. Radionuclide concentration in Pond 6B and 008 should be restored to < LLD (excluding tritium) using dilution as necessary (normal flow from the TBS would normally be adequate). Turbine Building sump samples should be obtained and analyzed every eight hours while the alternate setpoint is being used to ensure that the setpoint remains conservative with respect to the isotopic mixture and to ensure offsite doses are within ODCM limits.

Alternate setpoint methodology for Turbine Building sump (RM-L8) is available to ensure operational flexibility in the event radioactivity is detected in the Turbine Building sump > 0.5 MPC and release would result in minimal offsite dose. The alternate setpoint methodology is not intended to be used continuously. To remove restrictions on operation of circulating water, pond concentrations should be restored to < LED^{25} as soon as possible. The setpoint methodology follows:

2.1.4.4.1 For RM-L8, Turbine Building Sump (alternate methodology)

(57)

$$C_T \leq \frac{\sum C_i}{CF_T} \times \frac{1}{F_k}$$

where,

$$F_k = \begin{aligned} &= \text{The near field dilution factor for } C_i \text{ during release} \\ &\quad \text{from Turbine Building sump.} \\ &= \frac{\text{(average undiluted waste flow)}}{\text{(average flow from discharge structure)}} \end{aligned}$$

For purpose of implementing section 2.1.4.4 release condition 2, the following must be satisfied.

$$\frac{\sum_{j=1}^n \left\{ \left[\sum_{i=1}^x \left(C_i / MPC_i \right) \right]_{Tj} * V_j \right\}}{\sum_{j=1}^n V_j} < 1.0 \quad (58)$$

where $[\sum(C_i / MPC_i)]_{Tj}$ = the sum of the ratios of the measured concentration of nuclide i to its limiting value MPC_i for the Turbine Building sump effluent for release permit j , including proposed permit,

V_j = Release volume for Turbine Building sump release permit j (gal), and

j = index for batch release permits during the calendar year.

2.1.4.5 Turbine Building Sump - Special Considerations During Station Shutdowns


During periods in which circulating water (CW) is not available for diluting Turbine Building Sump (TBS) discharges, effluent from the TBS may be directed to a non-releasing pond and offsite dose calculations required by Specification 1.1.3.1 deferred until CW is restored. RM-L8 setpoint requirement specified by Specification 1.1.1.1 is not applicable when directing water from the TBS to a non-releasing ISWTS pond provided the following conditions are met.

- 1) Sufficient freeboard is available in the non-releasing pond to ensure that pond contents will not be released to the CW discharge canal prior to reestablishing CW flow.
- 2) Release of ISWTS contents will be in compliance with Specifications 1.1.2.1, 1.1.3.1 and 1.1.4.1 once CW flow has been reestablished.
- 3) ISWTS pond radioactivity will not exceed 1 MPC.
- 4) TBS samples are obtained and analyzed every 8 hours while water is being directed to a non-releasing pond.

Once samples have been obtained and release acceptability determined, RM-L8 setpoint may be increased to 2 times indication to allow release of sump contents to a non-releasing pond.

Demonstrating compliance with item 3 can be performed by calculations using TBS samples and discharge volumes or by sampling ISWTS ponds.

Figure 2.1-1
Example Liquid Effluent Monitor
Calibration Curve

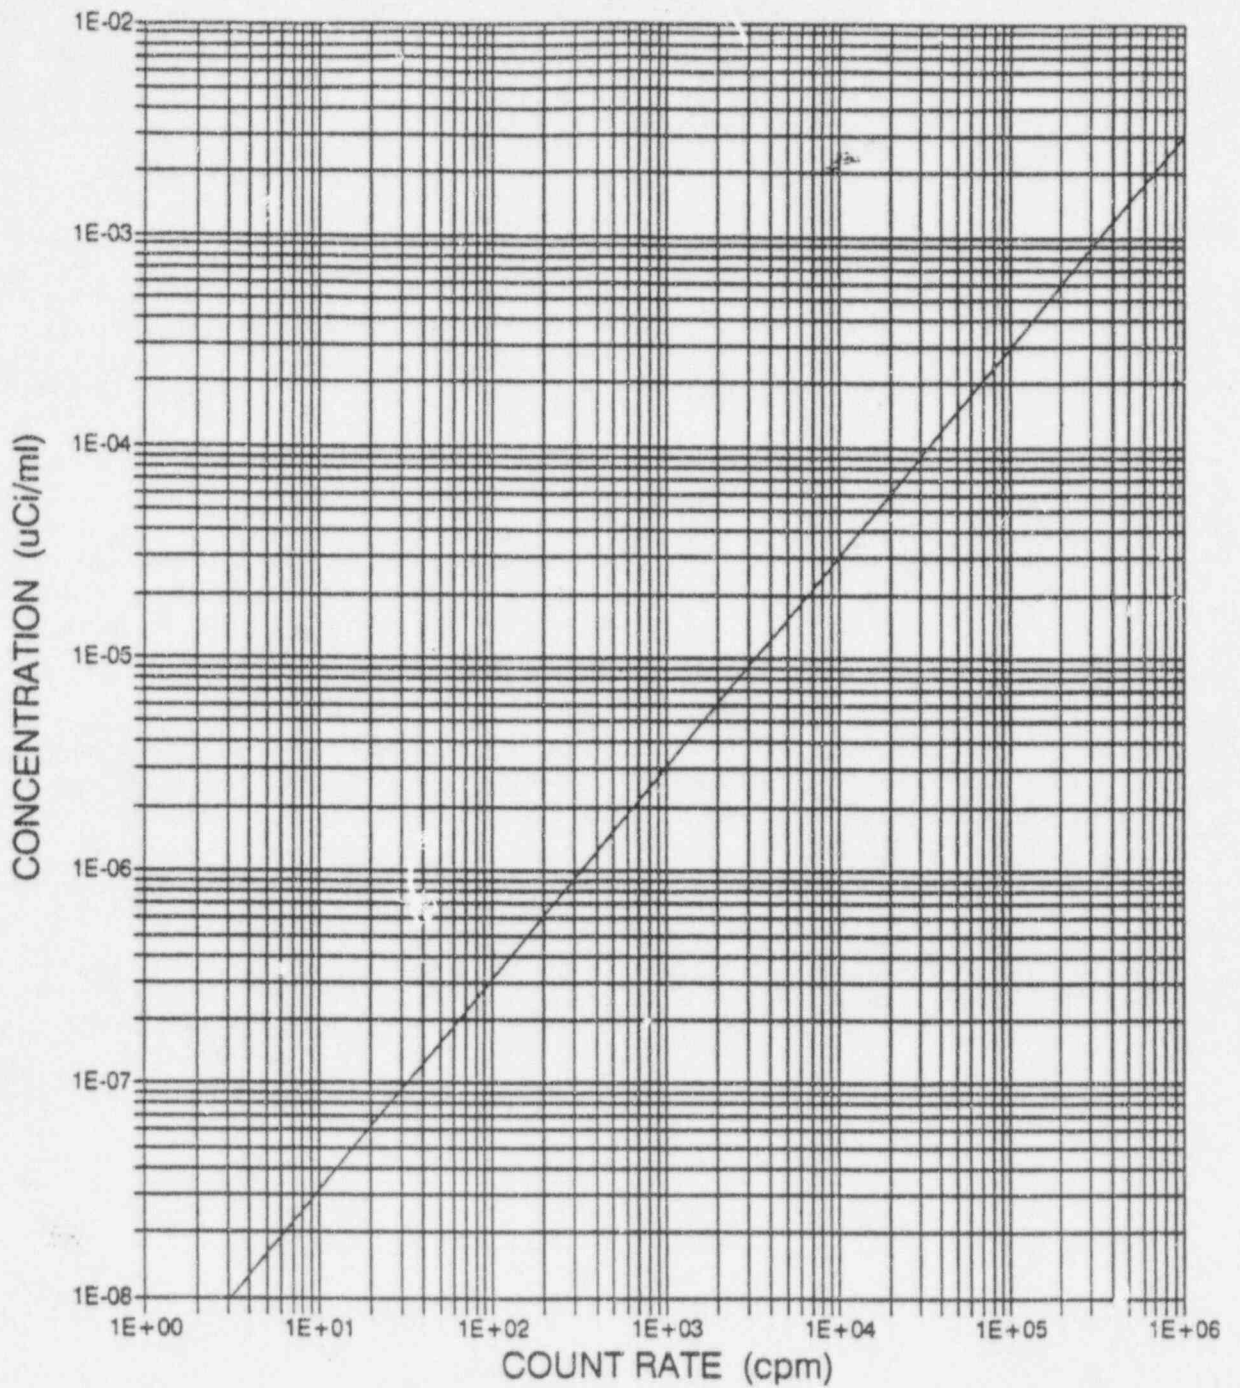

2.2 Dose Calculation For Liquid Effluents

The method of this section is to be used in all cases for calculating doses to individuals from routine liquid effluents. Four notes at the end of the section confirm the values which certain parameters are to be assigned in some special cases.

2.2.1 Liquid Effluent Dose Calculation Parameters

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
$A_{i\tau}$	= the site related ingestion dose commitment factor to the total body or any organ τ , for each identified principal gamma and beta emitter listed in Table 2.2-3 in mrem-ml per hr- μ Ci.	2.2.2
BF_i	= Bioaccumulation Factor for nuclide i , in fish, pCi/Kg per pCi/l, from Table 2.2-1.	2.2.2
C_{ik}	= the average concentration of radionuclide, i , in undiluted liquid effluent during time period Δt_k from any liquid released, in uCi/ml.	2.2.2
$DF_{i\tau}$	= a dose conversion factor for nuclide, i , for adults in preselected organ, τ , in mrem/pCi found in Table 2.2-2.	2.2.2
D_τ	= the cumulative dose commitment to the total body or any organ, τ , from the liquid effluents for the total time period, $\Sigma \Delta t_k$ in mrem (Ref. 1).	2.2.2
D_w	= Dilution Factor from the near field area within one-quarter mile of the release points to the potable water intake for adult water consumption; for V. C. Summer, $D_w = 1$.	2.2.2
F_k	= the near field average dilution factor for C_{ik} during any liquid effluent release.	2.2.2
K_o	= 1.14×10^5 , units conversion factor = $(10^6 \text{ pCi/uCi}) (10^3 \text{ ml/l}) \div 8760 \text{ hr/yr}$	2.2.2

Liquid Effluent Dose Calculation Parameters (continued)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
Δt_k	= the length (in hours) of a time period over which concentrations and flow rates are averaged for dose calculations.	2.2.2
U_f	= 21 kg/yr, fish consumption (adult) (Reference 3).	2.2.2
U_w	= 730 kg/yr, water consumption (adult) (Reference 3).	2.2.2
Z	= applicable near-field dilution factor when no additional dilution is to be considered; Z = 1.	2.2.2

2.2.2 Methodology

The dose contribution from all radionuclides identified in liquid effluents released to unrestricted areas is calculated using the following expression:

$$D_{\tau} = \sum_i \left[A_{i\tau} \sum_{k=1} \Delta t_k C_{ik} F_k \right] \quad (31)$$

$$A_{i\tau} = K_o \left((U_w/D_w) + U_f B F_i \right) D F_{i\tau} \quad (32)$$

$$F_k = \frac{\text{(average undiluted liquid waste flow)}}{\text{(average flow from the discharge structure) (Z)}} \quad (33)$$

NOTE 1: If radioactivity in the Monticello Reservoir (C_{ir}) becomes > the LLD specified in ODCM, Table 1.1-4, that concentration must be included in the Dose determination. For this part of the dose calculation, $F_k = 1$ and $\Delta t_k =$ the entire time period for which the dose is being calculated.

NOTE 2: Prior to termination of Circulating Water Pumps, an assessment of the dose resulting from pond radioactivity concentrations and discharge flow rates from the Industrial And Sanitary Waste System (ISWS) will be performed as follows. Sampling of the liquid in the ISWS will be initiated,

and the measured concentrations of radionuclides will be used in the dose calculations with $F_k = 1$ and $\Delta t_k =$ the entire time period for which the dose is being calculated.

NOTE 3: For releases through the ISWS pathway when circulating water is not available, dose projections for ²²⁶assessment of release acceptability should be based on the most representative samples obtained from in plant sumps. Normally sump samples are also used to assess actual release. However, due to the ultraconservative assumptions when circulating water is not available, i.e. dose calculations are based on radioactive material concentration in the discharge stream regardless of release volume, representative samples from the ISWS may be used to evaluate impact of releases.

NOTE 4: During periods when the Circulating Water Pumps are in operation, any releases to the ISWS are to be credited with dilution in Circulating Water for dose calculation purposes, even though such dilution is normally not claimed in the setpoint calculation. When taken in union with the note above, this procedure results in some overestimation of dose to the population because discharges made to the ISWS just before loss of Circulating Water will be counted twice in the dose calculation process.

NOTE 5: If radioactivity in the Service Water becomes $>$ LLD as determined by the analysis required by ODCM, Table 1.1-4, that concentration must be included in the Dose determination. For this part of the dose calculation, $F_k = 1$ and $\Delta t_k =$ the entire time since the last Service Water sample was taken.

2.3 Liquid Effluent Releases through the Neutralization Basin

Releases of slightly contaminated liquids from pathways feeding the Neutralization Basin (Pond 007) through Circulating Water (CW) may be made under strictly controlled conditions. Releases from these pathways (e.g., NaOH sump, RWST sump) will be allowed if the following conditions are adhered to in controlling the radioactive materials released.

2.3.1 Rainwater Tank

Rainwater collected in the RWST sump is pumped to the RWST Pit Drain Tank (Rainwater Tank) for analysis and subsequent release. Normally the rainwater is sampled, found to contain no detectable radioactivity, and is released to the environment via the storm drain system. If measurable amounts of radioactive materials are found in Rainwater Tank samples, the tank may be pumped to a Waste Monitor Tank and released without processing. In order to allow for operational flexibility, the Rainwater Tank containing radioactive materials may be drained to the NaOH sump and discharged to the circulating water (CW) system via the Neutralization basin (007). The following constraints are to be applied for releases through this pathway:

- (1) At least one CW pump must be used for dilution to release through this pathway.
- (2) Chemistry Services must be notified to verify that conditions in the Neutralization Basin are such that additions to the basin can be made.
- (3) Using the Rainwater Tank analysis and available circulating water, a release calculation must be performed that shows that releases be less than $6.0E-4$ mrem (whole body) and $2.0E-3$ mrem (any organ). These limits represent 1% of unprocessed effluent 31-day dose limits (ODCM Section 1.1.4.1).

- (4) If these limits are met, the Rainwater Tank may be drained through the NaOH sump to the Neutralization Basin. Chemistry will then release the Neutralization Basin contents through circulating water as soon as possible once their procedural and NPDES release criteria are met.

2.3.2 NaOH Spray Tank and Stored NaOH

- (1) The same limits and conditions as 2.3.1 (1-4) apply for releases from the NaOH sump.
- (2) Samples should be obtained and analyzed during performance of NaOH Spray Tank surveillances and after additions are made to the tank.
- (3) If the samples show concentrations of radionuclides that would exceed the dose limits above and the tank must have liquid removed from it, the contaminated NaOH may be drained to appropriate holding containers for temporary storage. Once the conditions for release become favorable (e.g. return of CW), the containers used for temporary storage may be sampled and analyzed for release. If the dose limitations in 2.3.1 (3) are met and Chemistry approval is obtained, a release permit is generated and the containers can be drained through the NaOH sump to the Neutralization Basin for release through CW.

TABLE 2.2-1
 BIOACCUMULATION FACTORS*
 (pCi/kg per pCi/liter)

<u>ELEMENT</u>	<u>FRESHWATER FISH</u>
H	9.0E-01
C	4.6E 03
F	1.0E 01
Na	1.0E 02
P	1.0E 05
Cr	2.0E 02
Mn	4.0E 02
Fe	1.0E 02
Co	5.0E 01
Ni	1.0E 02
Cu	5.0E 01
Zn	2.0E 03
Br	4.2E 02
Rb	2.0E 03
Sr	3.0E 01
Y	2.5E 01
Zr	3.3E 00
Nb	3.0E 04
Mo	1.0E 01
Tc	1.5E 01
Ru	1.0E 01
Rh	1.0E 01
Sb	1.0E 00
Te	4.0E 02
I	1.5E 01
Cs	2.0E 03
Ba	4.0E 00
La	2.5E 01
Ce	1.0E 00
Pr	2.5E 01
Nd	2.5E 01
W	1.2E 03
Np	1.0E 01

*Values in Table 2.2-1 are taken from Reference 3, Table A-1.

ADULT INGESTION DOSE FACTORS*
 (mrem/pCi ingested)

NUCLIDE	BONE	LIVER	T.BODY	THYROID	KIDNEY	LUNG	GI-LLI
H-3	NO DATA	1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07	1.05E-07
C-14	2.84E-06	5.68E-07	5.68E-07	5.68E-07	5.68E-07	5.68E-07	5.68E-07
†F-18	6.24E-07	NO DATA	6.92E-08	NO DATA	NO DATA	NO DATA	1.85E-08
NA-24	1.70E-06	1.70E-06	1.70E-06	1.70E-06	1.70E-06	1.07E-06	1.70E-06
P-32	1.93E-04	1.20E-05	7.46E-06	NO DATA	NO DATA	NO DATA	2.17E-05
CR-51	NO DATA	NO DATA	2.66E-09	1.59E-09	5.86E-10	3.53E-09	6.69E-07
MN-54	NO DATA	4.57E-06	8.72E-07	NO DATA	1.36E-06	NO DATA	1.40E-05
MN-56	NO DATA	1.15E-07	2.04E-08	NO DATA	1.46E-07	NO DATA	3.67E-06
FE-55	2.75E-06	1.90E-06	4.43E-07	NO DATA	NO DATA	1.06E-06	1.09E-06
FE-59	4.34E-06	1.02E-05	3.91E-06	NO DATA	NO DATA	2.85E-06	3.40E-05
†CO-57	NO DATA	1.75E-07	2.91E-07	NO DATA	NO DATA	NO DATA	4.44E-06
CO-58	NO DATA	7.45E-07	1.67E-06	NO DATA	NO DATA	NO DATA	1.51E-05
CO-60	NO DATA	2.14E-06	4.72E-06	NO DATA	NO DATA	NO DATA	4.02E-05
NI-63	1.30E-04	9.01E-06	4.36E-06	NO DATA	NO DATA	NO DATA	1.88E-06
NI-65	5.28E-07	6.86E-08	3.13E-08	NO DATA	NO DATA	NO DATA	1.74E-06
CU-64	NO DATA	8.33E-08	3.91E-08	NO DATA	2.10E-07	NO DATA	7.10E-06
ZN-65	4.84E-06	1.54E-05	6.76E-06	NO DATA	1.03E-05	NO DATA	9.70E-06
ZN-69	1.03E-08	1.97E-08	1.37E-09	NO DATA	1.28E-08	NO DATA	2.96E-09
†Zn-69m‡	1.70E-07	4.08E-07	3.37E-08	NO DATA	2.47E-07	NO DATA	2.49E-05
†BR-82‡	NO DATA	NO DATA	2.26E-06	NO DATA	NO DATA	NO DATA	2.59E-06
BR-83‡	NO DATA	NO DATA	4.02E-08	NO DATA	NO DATA	NO DATA	5.79E-08
BR-84	NO DATA	NO DATA	5.21E-08	NO DATA	NO DATA	NO DATA	4.09E-13
BR-85	NO DATA	NO DATA	2.14E-09	NO DATA	NO DATA	NO DATA	LT E-24**
RB-86	NO DATA	2.11E-05	9.83E-06	NO DATA	NO DATA	NO DATA	4.16E-06
RB-88	NO DATA	6.05E-08	3.21E-08	NO DATA	NO DATA	NO DATA	8.36E-19
RB-89‡	NO DATA	4.01E-08	2.82E-08	NO DATA	NO DATA	NO DATA	2.33E-21
SR-89‡	3.08E-04	NO DATA	8.84E-06	NO DATA	NO DATA	NO DATA	4.94E-05
SR-90‡	7.58E-03	NO DATA	1.86E-03	NO DATA	NO DATA	NO DATA	2.19E-04
SR-91‡	5.67E-06	NO DATA	2.29E-07	NO DATA	NO DATA	NO DATA	2.70E-05
SR-92‡	2.15E-06	NO DATA	9.30E-08	NO DATA	NO DATA	NO DATA	4.26E-05
Y-90	9.62E-09	NO DATA	2.58E-10	NO DATA	NO DATA	NO DATA	1.02E-04
Y-91M‡	9.09E-11	NO DATA	3.52E-12	NO DATA	NO DATA	NO DATA	2.67E-10
Y-91	1.41E-07	NO DATA	3.77E-09	NO DATA	NO DATA	NO DATA	7.76E-05
Y-92	8.45E-10	NO DATA	2.47E-11	NO DATA	NO DATA	NO DATA	1.48E-05
Y-93	2.68E-09	NO DATA	7.40E-11	NO DATA	NO DATA	NO DATA	8.50E-05
ZR-95‡	3.04E-08	9.75E-09	6.60E-09	NO DATA	1.53E-08	NO DATA	3.09E-05
ZR-97‡	1.68E-09	3.39E-10	1.55E-10	NO DATA	5.12E-10	NO DATA	1.05E-04
NB-95	6.22E-09	3.46E-09	1.86E-09	NO DATA	3.42E-09	NO DATA	2.10E-05
†NB-97	5.22E-11	1.32E-11	4.82E-12	NO DATA	1.54E-11	NO DATA	4.87E-08
MO-99‡	NO DATA	4.31E-06	8.20E-07	NO DATA	9.76E-06	NO DATA	9.99E-06

‡Daughter contributions are included (see Reference 13).

†Values taken from Reference 13, Table 4.

*Values other than those footnoted in Table 2.2-2 are taken from Reference 3, Table 1.

**Less than E-24.

TABLE 2.2-2 (continued)

Page 2 of 2

NUCLIDE	BONE	LIVER	T.BODY	THYROID	KIDNEY	LUNG	GI-LLI
TC-99M	2.47E-10	6.98E-10	8.89E-09	NO DATA	1.06E-08	3.42E-10	4.13E-07
TC-101	2.54E-10	3.66E-10	3.59E-09	NO DATA	6.59E-09	1.87E-10	1.10E-21
RU-103‡	1.85E-07	NO DATA	7.97E-08	NO DATA	7.06E-07	NO DATA	2.16E-05
RU-105‡	1.54E-08	NO DATA	6.08E-07	NO DATA	1.99E-07	NO DATA	9.42E-06
RU-106‡	2.75E-06	NO DATA	3.48E-07	NO DATA	5.31E-06	NO DATA	1.78E-04
AG-110M‡	1.60E-07	1.48E-07	8.79E-08	NO DATA	2.91E-07	NO DATA	6.04E-05
†SB-124	2.80E-06	5.29E-08	1.11E-06	6.79E-09	NO DATA	2.18E-06	7.95E-05
†SB-125	1.79E-06	2.00E-08	4.26E-07	1.82E-09	NO DATA	1.38E-06	1.97E-05
†SB-126	1.15E-06	2.34E-08	4.15E-07	7.04E-09	NO DATA	7.05E-07	9.40E-05
†SB-127	2.58E-07	5.65E-09	9.90E-08	3.10E-09	NO DATA	1.53E-07	5.90E-05
TE-125M	2.68E-06	9.71E-07	3.59E-07	8.06E-07	1.09E-05	NO DATA	1.07E-05
TE-127M‡	6.77E-06	2.42E-06	8.25E-07	1.73E-06	2.75E-05	NO DATA	2.27E-05
TE-127	1.10E-07	3.95E-08	2.38E-08	8.15E-08	4.48E-07	NO DATA	8.68E-06
TE-129M‡	1.15E-05	4.29E-06	1.82E-06	3.95E-06	4.80E-05	NO DATA	5.79E-05
TE-129	3.14E-08	1.18E-08	7.65E-09	2.41E-08	1.32E-07	NO DATA	2.37E-08
TE-131M‡	1.73E-06	8.46E-07	7.05E-07	1.34E-06	8.57E-06	NO DATA	8.40E-05
TE-131‡	1.97E-08	8.23E-09	6.22E-09	1.62E-08	8.63E-08	NO DATA	2.79E-09
TE-132‡	2.52E-06	1.63E-06	1.53E-06	1.80E-06	1.57E-05	NO DATA	7.71E-05
I-130	7.56E-06	2.23E-06	8.80E-07	1.89E-04	3.48E-06	NO DATA	1.92E-06
I-131‡	4.16E-06	5.95E-06	3.41E-06	1.95E-03	1.02E-05	NO DATA	1.57E-06
I-132	2.03E-07	5.43E-07	1.90E-07	1.90E-05	8.65E-07	NO DATA	1.02E-07
I-133‡	1.42E-06	2.47E-06	7.53E-07	3.63E-04	4.31E-06	NO DATA	2.22E-06
I-134	1.06E-07	2.88E-07	1.03E-07	4.99E-06	4.58E-07	NO DATA	2.51E-10
I-135‡	4.43E-07	1.16E-06	4.28E-07	7.65E-05	1.86E-06	NO DATA	1.31E-06
CS-134	6.22E-05	1.48E-04	1.21E-04	NO DATA	4.79E-05	1.59E-05	2.59E-06
CS-136	6.51E-06	2.57E-05	1.85E-05	NO DATA	1.43E-05	1.96E-06	2.92E-06
CS-137‡	7.97E-05	1.09E-04	7.14E-05	NO DATA	3.70E-05	1.23E-05	2.11E-06
CS-138	5.52E-08	1.09E-07	5.40E-08	NO DATA	8.01E-08	7.91E-09	4.65E-13
BA-139	9.70E-08	6.91E-11	2.84E-09	NO DATA	6.46E-11	3.92E-11	1.72E-07
BA-140‡	2.03E-05	2.55E-08	1.33E-06	NO DATA	8.67E-09	1.46E-08	4.18E-05
BA-141‡	4.71E-08	3.56E-11	1.59E-09	NO DATA	3.31E-11	2.02E-11	2.22E-17
BA-142‡	2.13E-08	2.19E-11	1.34E-09	NO DATA	1.85E-11	1.24E-11	3.00E-26
LA-140	2.50E-09	1.26E-09	3.33E-10	NO DATA	NO DATA	NO DATA	9.25E-05
LA-142	1.28E-10	5.82E-11	1.45E-11	NO DATA	NO DATA	NO DATA	4.25E-07
CE-141	9.36E-09	6.33E-09	7.18E-10	NO DATA	2.94E-09	NO DATA	2.42E-05
CE-143‡	1.65E-09	1.22E-06	1.35E-10	NO DATA	5.37E-10	NO DATA	4.56E-05
C-144‡	4.88E-07	2.04E-07	2.62E-08	NO DATA	1.21E-07	NO DATA	1.65E-04
PR-143	9.20E-09	3.69E-09	4.56E-10	NO DATA	2.13E-09	NO DATA	4.03E-05
PR-144	3.01E-11	1.25E-11	1.53E-12	NO DATA	7.05E-12	NO DATA	4.33E-13
ND-147‡	6.29E-09	7.27E-09	4.35E-10	NO DATA	4.25E-09	NO DATA	3.49E-05
W-187	1.03E-07	8.61E-08	3.01E-08	NO DATA	NO DATA	NO DATA	2.82E-05
NP-239	1.19E-09	1.17E-10	6.45E-11	NO DATA	3.65E-10	NO DATA	2.40E-05

TABLE 2.2-3
 SITE RELATED INGESTION
 DOSE COMMITMENT FACTOR, A_{it}^*
 (mrem/hr per $\mu\text{Ci/ml}$)
 Page 1 of 2

NUCLIDE	BONE	LIVER	T.BODY	THYROID	KIDNEY	LUNG	GI-LLI
H-3	NO DATA	8.96E+00	8.96E+00	8.96E+00	8.96E+00	8.96E+00	8.96E+00
C-14	3.15E+04	6.30E+03	6.30E+03	6.30E+03	6.30E+03	6.30E+03	6.30E+03
F-18	6.69E+01	NO DATA	7.42E+00	NO DATA	NO DATA	NO DATA	1.98E+00
NA-24	5.48E+02	5.48E+02	5.48E+02	5.48E+02	5.48E+02	5.48E+02	5.48E+02
P-32	4.62E+07	2.87E+06	1.79E+06	NO DATA	NO DATA	NO DATA	5.20E+06
CR-51	NO DATA	NO DATA	1.49E+00	8.94E-01	3.29E-01	1.98E+00	3.76E+02
MN-54	NO DATA	4.76E+03	9.08E+02	NO DATA	1.42E+03	NO DATA	1.46E+04
MN-56	NO DATA	1.20E+02	2.12E+01	NO DATA	1.52E+02	NO DATA	3.82E+03
FE-55	8.87E+02	6.13E+02	1.43E+02	NO DATA	NO DATA	3.42E+02	3.52E+02
FE-59	1.40E+03	3.29E+03	1.26E+03	NO DATA	NO DATA	9.19E+02	1.10E+04
CO-57	NO DATA	3.55E+01	5.91E+01	NO DATA	NO DATA	NO DATA	9.01E+02
CO-58	NO DATA	1.51E+02	3.39E+02	NO DATA	NO DATA	NO DATA	3.06E+03
CO-60	NO DATA	4.34E+02	9.58E+02	NO DATA	NO DATA	NO DATA	8.16E+03
NI-63	4.19E+04	2.91E+03	1.41E+03	NO DATA	NO DATA	NO DATA	6.07E+02
NI-65	1.70E+02	2.21E+01	1.01E+01	NO DATA	NO DATA	NO DATA	5.61E+02
CU-64	NO DATA	1.69E+01	7.93E+00	NO DATA	4.26E+01	NO DATA	1.44E+03
ZN-65	2.36E+04	7.50E+04	3.39E+04	NO DATA	5.02E+04	NO DATA	4.73E+04
ZN-69	5.02E+01	9.60E+01	6.67E+00	NO DATA	6.24E+01	NO DATA	1.44E+01
ZN-69m \ddagger	8.28E+02	1.99E+03	1.82E+02	NO DATA	1.20E+03	NO DATA	1.21E+05
BR-82	NO DATA	NO DATA	2.46E+03	NO DATA	NO DATA	NO DATA	2.82E+03
BR-83 \ddagger	NO DATA	NO DATA	4.38E+01	NO DATA	NO DATA	NO DATA	6.30E+01
BR-84	NO DATA	NO DATA	5.67E+01	NO DATA	NO DATA	NO DATA	4.45E-04
BR-85	NO DATA	NO DATA	2.33E+00	NO DATA	NO DATA	NO DATA	1.09E-15
RB-86	NO DATA	1.03E+05	4.79E+04	NO DATA	NO DATA	NO DATA	2.03E+04
RB-88	NO DATA	2.95E+02	1.56E+02	NO DATA	NO DATA	NO DATA	4.07E-09
RB-89 \ddagger	NO DATA	1.95E+02	1.37E+02	NO DATA	NO DATA	NO DATA	1.13E-11
SR-89 \ddagger	4.78E+04	NO DATA	1.37E+03	NO DATA	NO DATA	NO DATA	7.66E+03
SR-90 \ddagger	1.18E+06	NO DATA	2.88E+05	NO DATA	NO DATA	NO DATA	3.48E+04
SR-91 \ddagger	8.79E+02	NO DATA	3.55E+01	NO DATA	NO DATA	NO DATA	4.19E+03
SR-92 \ddagger	3.33E+02	NO DATA	1.44E+01	NO DATA	NO DATA	NO DATA	6.60E+03
Y-90	1.38E+00	NO DATA	3.69E-02	NO DATA	NO DATA	NO DATA	1.46E+04
Y-91M \ddagger	1.30E-02	NO DATA	5.04E-04	NO DATA	NO DATA	NO DATA	3.82E-02
Y-91	2.02E+01	NO DATA	5.39E-01	NO DATA	NO DATA	NO DATA	1.11E+04
Y-92	1.21E-01	NO DATA	3.53E-03	NO DATA	NO DATA	NO DATA	2.12E+03
Y-93	3.83E-01	NO DATA	1.06E-02	NO DATA	NO DATA	NO DATA	1.22E+04
ZR-95 \ddagger	2.77E+00	8.88E-01	6.01E-01	NO DATA	1.39E+00	NO DATA	2.82E+03
ZR-97 \ddagger	1.53E-01	3.09E-02	1.41E-02	NO DATA	4.67E-02	NO DATA	9.57E+03
NB-95	4.47E+02	2.49E+02	1.34E+02	NO DATA	2.46E+02	NO DATA	1.51E+06
NB-97	3.75E+00	9.49E-01	3.47E-01	NO DATA	1.11E+00	NO DATA	3.50E+03


\ddagger Daughter contributions are included (see Reference 13).

* Calculated using equation (32) and Tables 2.2-1 and 2.2-2.

TABLE 2.2-3
 SITE RELATED INGESTION
 DOSE COMMITMENT FACTOR, A_{it}^*
 (mrem/hr per $\mu\text{Ci/ml}$)
 Page 2 of 2

NUCLIDE	BONE	LIVER	T.BODY	THYROID	KIDNEY	LUNG	GI-LLI
MO-99‡	NO DATA	4.62E+02	8.79E+01	NO DATA	1.05E+03	NO DATA	1.07E+03
TC-99M	2.94E-02	8.32E-02	1.06E+00	NO DATA	1.26E+00	4.07E-02	4.92E+01
TC-101	3.03E-02	4.36E-02	4.28E-01	NO DATA	7.85E-01	2.23E-02	1.31E-13
RU-103‡	1.98E+01	NO DATA	8.54E-01	NO DATA	7.57E+01	NO DATA	2.31E+03
RU-105‡	1.65E+00	NO DATA	6.52E-01	NO DATA	2.13E+01	NO DATA	1.01E+03
RU-106‡	2.95E+02	NO DATA	3.73E+01	NO DATA	5.69E+02	NO DATA	1.91E+04
AG-110M‡	1.42E+01	1.31E+01	7.80E+00	NO DATA	2.58E+01	NO DATA	5.36E+03
SB-124	2.40E+02	4.53E+00	9.50E+01	5.81E-01	NO DATA	1.87E+02	6.81E+03
SB-125‡	1.53E+02	1.71E+00	3.65E+01	1.56E-01	NO DATA	1.18E+02	1.69E+03
SB-126	9.85E+01	2.00E+00	3.55E+01	6.03E-01	NO DATA	6.04E+01	8.05E+03
SB-127	2.21E+01	4.84E-01	8.47E+00	2.65E-01	NO DATA	1.31E+01	5.05E+03
TE-125M	2.79E+03	1.01E+03	3.74E+02	8.39E+02	1.13E+04	NO DATA	1.11E+04
TE-127M‡	7.05E+03	2.52E+03	8.59E+02	1.80E+03	2.86E+04	NO DATA	2.36E+04
TE-127	1.14E+02	4.11E+01	2.48E+01	8.48E+01	4.66E+02	NO DATA	9.03E+03
TE-129M‡	1.20E+04	4.47E+03	1.89E+03	4.11E+03	5.00E+04	NO DATA	6.03E+04
TE-129	3.27E+01	1.23E+01	7.96E+00	2.51E+01	1.37E+02	NO DATA	2.47E+01
TE-131M‡	1.88E+03	8.81E+02	7.34E+02	1.39E+01	8.92E+03	NO DATA	8.74E+04
TE-131‡	2.05E+01	8.57E+00	6.47E+00	1.69E+01	8.98E+01	NO DATA	2.90E+00
TE-132‡	2.62E+03	1.70E+03	1.59E+03	1.87E+03	1.63E+04	NO DATA	8.02E+04
I-130	9.01E+01	2.66E+02	1.05E+02	2.25E+04	4.15E+02	NO DATA	2.29E+02
I-131‡	4.96E+02	7.09E+02	4.06E+02	2.32E+05	1.22E+03	NO DATA	1.87E+02
I-132	2.42E+01	6.47E+01	2.26E+01	2.26E+03	1.03E+02	NO DATA	1.22E+01
I-133‡	1.69E+02	2.94E+02	8.97E+01	4.32E+04	5.13E+02	NO DATA	2.64E+02
I-134	1.26E+01	3.43E+01	1.23E+01	5.94E+02	5.46E+01	NO DATA	2.99E-02
I-135‡	5.28E+01	1.38E+02	5.10E+01	9.11E+03	2.22E+02	NO DATA	1.56E+02
CS-134	3.03E+05	7.21E+05	5.89E+05	NO DATA	2.33E+05	7.75E+04	1.26E+04
CS-136	3.17E+04	1.25E+05	9.01E+04	NO DATA	6.97E+04	9.55E+03	1.42E+04
CS-137‡	3.88E+05	5.31E+05	3.48E+05	NO DATA	1.88E+05	5.99E+04	1.03E+04
CS-138	2.69E+02	5.31E+02	2.63E+02	NO DATA	3.90E+02	3.85E+01	2.27E-03
BA-139	9.00E+00	6.41E-03	2.64E-01	NO DATA	5.99E-03	3.64E-03	1.60E+01
BA-140‡	1.88E+03	2.37E+00	1.23E+02	NO DATA	8.05E-01	1.35E+00	3.88E+03
BA-141‡	4.27E+00	3.30E-03	1.48E-01	NO DATA	3.07E-03	1.87E-03	2.06E-09
BA-142‡	1.98E+00	2.03E-03	1.24E-01	NO DATA	1.72E-03	1.15E-03	2.78E-18
LA-140	3.58E-01	1.80E-01	4.76E-02	NO DATA	NO DATA	NO DATA	1.32E+04
LA-142	1.83E-02	8.33E-03	2.07E-03	NO DATA	NO DATA	NO DATA	6.08E+01
CE-141	8.01E-01	5.42E-01	6.15E-02	NO DATA	2.52E-01	NO DATA	2.07E+03
CE-143‡	1.41E-01	1.04E+02	1.16E-02	NO DATA	4.60E-02	NO DATA	3.90E+03
CE-144‡	4.18E+01	1.77E+01	2.24E+00	NO DATA	1.04E+01	NO DATA	1.41E+04
PR-143	1.32E+00	5.28E-01	6.52E-02	NO DATA	3.05E-01	NO DATA	5.77E+03
PR-144	4.31E-03	1.79E-03	2.19E-04	NO DATA	1.01E-03	NO DATA	6.19E-10
ND-147‡	9.00E-01	1.04E+00	6.22E-02	NO DATA	6.08E-01	NO DATA	4.99E+03
W-187	3.04E+02	2.55E+02	8.90E+01	NO DATA	NO DATA	NO DATA	8.34E+04
NP-239	1.28E-01	1.25E-02	6.91E-03	NO DATA	3.91E-02	NO DATA	2.57E+03

FIGURE 2.2-1

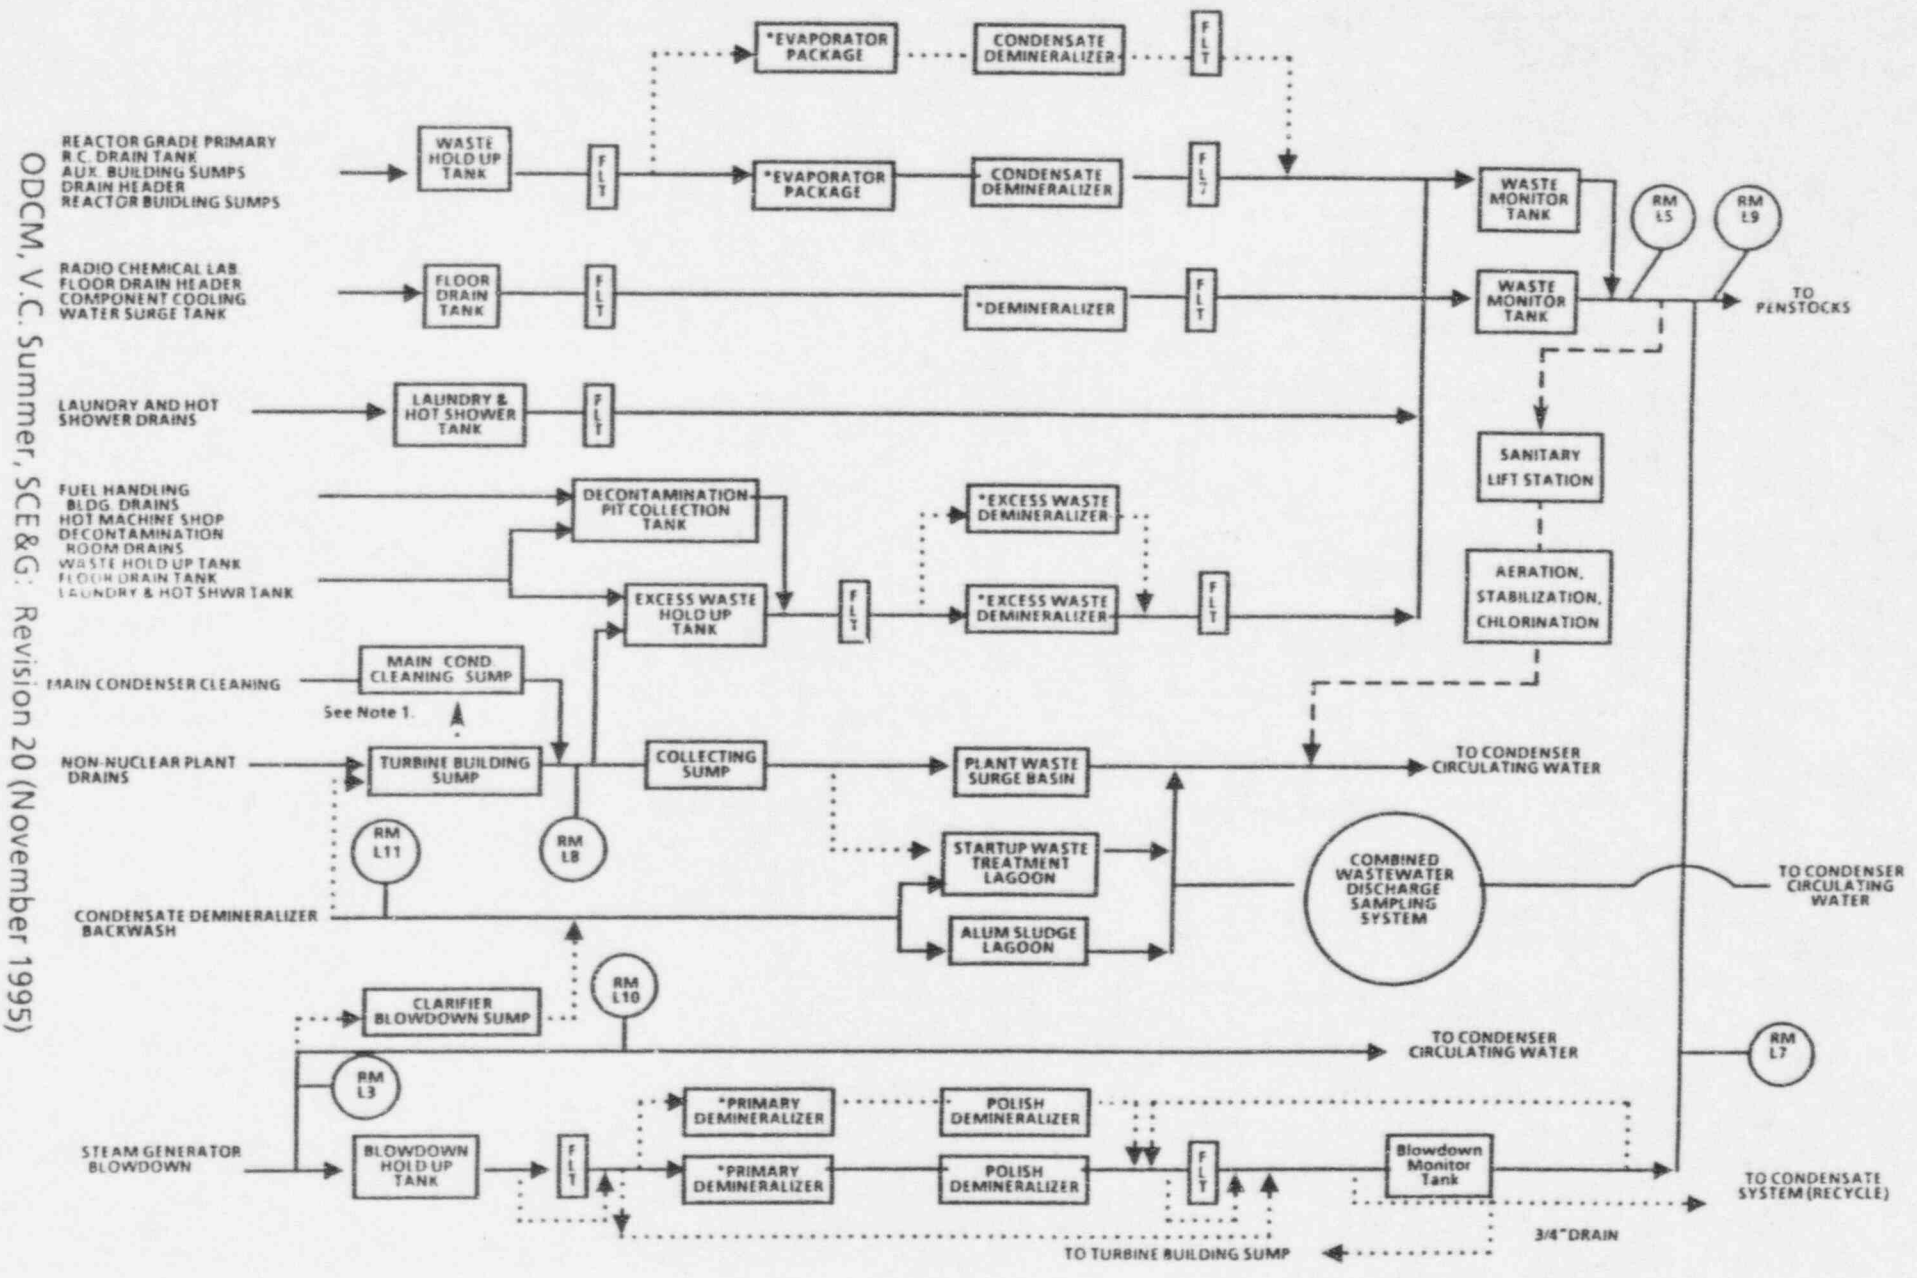

ODCM, V.C. Summer, SCE&G: Revision 20 (November 1995)

2.0-41

FIGURE 2.2-1

- NOTES:
1. Turbine Building Sump contents may be processed to the main condenser cleaning sump through a portable demineralizer. This is an optional treatment pathway which provides processing flexibility in the event processing through excess liquid waste is not desirable. Since a temporary demineralizer is used for this optional treatment pathway, operability tests specified in ODCM specification 1.1.4.1 are not required. To ensure adequacy of the RM-L8 setpoint while using the alternate process pathway, samples must be obtained from the discharge side of the demineralizers or condenser cleaning sump and analyzed every eight hours.

3.0 GASEOUS EFFLUENT

3.1 Gaseous Effluent Monitor Setpoints

The calculated setpoint values will be regarded as upper bounds for the actual setpoint adjustments. That is, setpoint adjustments are not required to be performed if the existing setpoint level corresponds to a lower count rate than the calculated value. Setpoints may be established at values lower than the calculated values, if desired.

Calculated monitor setpoints may be added to the ambient background count rate.

3.1.1 Gaseous Effluent Monitor Setpoint Calculation Parameters

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
C_v =	count rate of a station vent monitor corresponding to grab sample radionuclide concentrations, X_{iv} , as determined from the monitor's calibration curve, in cprn.	(3.1.2)
C'_v =	the count rate of the monitor on vent v corresponding to X'_v uCi/cc of Xe-133, in cpm.	(3.1.4)
c =	count rate of the gas decay system monitor for measured radionuclide concentrations corrected to discharge pressure, in cpm.	(3.1.3)
c' =	the count rate of the waste gas decay system monitor corresponding to the total noble gas concentration in cpm.	(3.1.4)
D_{SS} =	limiting dose rate to the skin (3000 mrem/year).	(3.1.2)
D_{TB} =	limiting dose rate to the total body (500 mrem/year).	(3.1.2)
F_v =	the flow rate in vent v (cc/sec) (1 cc/sec = 0.002119 cfm).	(3.1.2)
f_s =	the maximum permissible waste gas discharge rate, based on the actual radionuclide mix and skin dose rate (cc/sec).	(3.1.3)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
f_t =	the maximum permissible waste gas discharge rate, based on the actual radionuclide mix and total body dose rate (cc/sec).	(3.1.3)
f_w =	the maximum permissible waste gas discharge rate, the lesser of f_s and f_t (cc/sec).	(3.1.3)
f'_s =	the conservative maximum permissible waste gas discharge rate based on Kr-89 skin dose rate (cc/sec).	(3.1.4)
f'_t =	the conservative maximum permissible waste gas discharge rate based on Kr-89 total body dose rate (cc/sec).	(3.1.4)
K_i =	total body dose factor due to gamma emissions from isotope i (mrem/year per uCi/m ³) from Table 3.1-1.	(3.1.2)
K_{Kr-89} =	total body dose factor for Kr-89, the most restrictive isotope from Table 3.1-1 (mrem/yr per uCi/m ³).	(3.1.3)
L_i =	Skin dose factor due to beta emissions from isotope i (mrem/yr per uCi/m ³) from Table 3.1-1.	(3.1.2)
L_{Kr-89} =	Skin dose factor for Kr-89, the most restrictive isotope, from Table 3.1-1 (mrem/yr per uCi/m ³).	(3.1.3)
M_i =	air dose factor due to gamma emissions from isotope i (mrad/yr per uCi/m ³) from Table 3.1-1.	(3.1.2)
M_{Kr-89} =	air dose factor for Kr-89, the most restrictive isotope, from Table 3.1-1 (mrad/yr per uCi/m ³).	(3.1.3)
R_s =	count rate per mrem/yr to the skin.	(3.1.2)
R_t =	count rate per mrem/yr to the total body.	(3.1.2)
R'_s =	conservative count rate per mrem to the skin (Xe-133 detection, Kr-89 dose).	(3.1.4)
R'_t =	conservative count rate per mrem to the total body (Xe-133 detection, Kr-89 dose).	(3.1.4)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
S_d =	count rate of the waste gas decay system noble gas monitor at the alarm setpoint, in cpm.	(3.1.3)
S_v =	count rate of a station vent noble gas monitor at the alarm setpoint, in cpm.	(3.1.2)
S_{vc} =	count rate of the containment purge noble gas monitor at the alarm setpoint, in cpm.	(3.1.2)
S_{vp} =	count rate of the plant vent noble gas monitor at the alarm setpoint, in cpm.	(3.1.2)
X_{id} =	the concentration of noble gas radionuclide i in a waste gas decay tank, as corrected to the pressure of the discharge stream at the point of its flow measurement in $\mu\text{Ci/cc}$.	(3.1.3)
X_{iv} =	the measured concentration of noble gas radionuclide i in the last grab sample analyzed for vent v in $\mu\text{Ci/cc}$.	(3.1.2)
X'_d =	the total noble gas concentration in a waste gas decay tank, as corrected to the pressure of the discharge stream at the point of its flow measurement in $\mu\text{Ci/cc}$.	(3.1.4)
X'_v =	a concentration of Xe-133 chosen to be in the operating range of the monitor on vent v in $\mu\text{Ci/cc}$.	(3.1.4)
$\overline{X/Q}$ =	the highest annual average relative concentration in any sector, at the site boundary in sec/m^3 .	(3.1.2)
1.1 =	mrem skin dose per mrad air dose	(3.1.2)
0.25 =	the safety factor applied to each of the two vent noble gas monitors (plant vent and containment purge) to assure that the sum of the releases has a combined safety factor of 0.5 which allows a 100 percent margin for cumulative uncertainties of measurements.	(3.1.2)

TABLE 3.1-1

DOSE FACTORS FOR EXPOSURE TO A SEMI-INFINITE CLOUD OF NOBLE GASES,*

<u>Nuclide</u>	<u>γ-Body*** (K_i)</u>	<u>β-Skin*** (L_i)</u>	<u>γ-Air** (M_i)</u>	<u>β-Air** (N_i)</u>
Kr-85m	1.17E + 03****	1.46E + 03	1.23E + 03	1.97E + 03
Kr-85	1.61E + 01	1.34E + 03	1.72E + 01	1.95E + 03
Kr-87	5.92E + 03	9.73E + 03	6.17E + 03	1.03E + 04
Kr-88	1.47E + 04	2.37E + 03	1.52E + 04	2.93E + 03
Kr-89	1.66E + 04	1.01E + 04	1.73E + 04	1.06E + 04
Kr-90	1.56E + 04	7.29E + 03	1.63E + 04	7.83E + 03
Xe-131m	9.15E + 01	4.76E + 02	1.56E + 02	1.11E + 03
Xe-133m	2.51E + 02	9.94E + 02	3.27E + 02	1.48E + 03
Xe-133	2.94E + 02	3.06E + 02	3.53E + 02	1.05E + 03
Xe-135m	3.12E + 03	7.11E + 02	3.36E + 03	7.39E + 02
Xe-135	1.81E + 03	1.86E + 03	1.92E + 03	2.46E + 03
Xe-137	1.42E + 03	1.22E + 04	1.51E + 03	1.27E + 04
Xe-138	8.83E + 03	4.13E + 03	9.21E + 03	4.75E + 03
Ar-41	8.84E + 03	2.69E + 03	9.30E + 03	3.28E + 03

*Values taken from Reference 3, Table B-1

** $\frac{\text{mrad-m}^3}{\mu\text{Ci-yr}}$

*** $\frac{\text{mrem-m}^3}{\mu\text{Ci-yr}}$

**** $1.17\text{E} + 03 = 1.17 \times 10^3$

CO1→ 3.1.2 Station Vent Noble Gas Monitors (RM-A3 and RM-A4)

For the purpose of implementation of section 1.2.1 of the ODCM, the alarm setpoint level for the station vent noble gas monitors will be calculated as follows:

S_v = count rate of the plant vent noble gas monitor (= S_{vp} for RM-A3) or the containment purge noble gas monitor (= S_{vc} for RM-A4) at the alarm setpoint level.

$$0.25 \times R_t \times D_{TB} \quad (34)$$

≤ the lesser of or

$$0.25 \times R_s \times D_{SS} \quad (35)$$

0.25 = the safety factor applied to each of the two vent noble gas monitors (plant vent and containment purge) to assure that the sum of the releases has a combined safety factor of 0.5 which allows a 100 percent margin for cumulative uncertainties of measurements.

D_{TB} = Dose rate limit to the total body of an individual
= 500 mrem/yr

R_t = count rate per mrem/yr to the total body
= $C_v / ((\overline{X/Q}) \times F_v \times \sum_i K_i X_{iv})$ (36)

D_{SS} = Dose rate limit to the skin of the body of an individual in an unrestricted area.
= 3000 mrem/year.

R_s = count rate per mrem/yr to the skin.
= $C_v \div [\overline{X/Q} \times F_v \times \sum_i (L_i + 1.1 M_i) X_{iv}]$ (37)

X_{iv} = the measured concentration of noble gas radionuclide i in the last grab sample analyzed for vent v , $\mu\text{Ci/ml}$. (For the plant vent, grab samples are taken at least

monthly. For the 6" and 36" containment purge lines, the sample is taken just prior to the release and also monthly, if the release is continuous.)

F_v = the flow rate in vent v, cc/sec. (1 cc/sec = 0.002119 cfm)
 C_v = count rate, (cpm) of the monitor on station vent v corresponding to grab sample noble gas concentrations, X_{iv} , as determined from the monitor's calibration curve. i.e. product of the monitor response curve slope ($\text{cpm}/\mu\text{Ci}/\text{ml}$) and the sum of the noble gas concentrations in the grab sample ($\mu\text{Ci}/\text{ml}$). (Initial calibration curves of the type shown in Figure 2.1-1 have been determined conservatively from families of response curves supplied by the monitor manufacturers. As releases occur, a historical correlation will be prepared and placed in service when sufficient data are accumulated.)

$\overline{X/Q}$ = the highest annual average relative concentration in any sector, at the site boundary (seven year average).

= $6.3\text{E-}6$ sec/ m^3 in the ENE sector.

K_i = total body dose factor due to gamma emissions from isotope i (mrem/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.

L_i = skin dose factor due to beta emissions from isotope i (mrem/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.

1.1 = mrem skin dose per mrad air dose.

M_i = air dose factor due to gamma emissions from isotope i (mrad/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.

NOTE: At plant startups when no grab sample analysis is available for the continuous releases, the Alternate Methodology of Section 3.1.4 must be used.

3.1.3 Waste Gas Decay System Monitor (RM-A10)

The permissible conditions for discharge through the waste gas decay system monitor (RM-A10) will be calculated in a manner similar to that for the plant vent noble gas monitor. In the case of the waste gas system, however, the discharge flow rate is continuously controllable by valve HCV-014 and permissible release conditions are therefore defined in terms of both flow rate and concentration. Therefore, RM-A10 is used only to insure that a representative sample was obtained.

For operational convenience, (to prevent spurious alarms due to fluctuations in background) the setpoint level will be established at 1.5 times the measured waste concentration.

The maximum permissible flow rate will be set on the same basis but include the engineering safety factor of 0.5. The RM-A10 setpoint level S_d is defined as:

$$S_d \leq 1.5c \quad (38)$$

where:

c = count rate in CPM of the waste gas decay system monitor corresponding to the measured concentration (taken from the monitor calibration curves).

The maximum permissible waste gas flow rate f_w (cc/sec) is calculated from the maximum permissible dose rates at the site boundary according to:

$$f_w \cong \text{the lesser of } f_t \text{ or } f_s \quad (39)$$

f_t = the maximum permissible discharge rate based on total body dose rate.

$$= 0.25 \times D_{TB} / [\overline{X/Q} \times 1.5 \sum_i X_{id} K_i] \quad (40)$$

f_s = the maximum permissible discharge rate based on skin dose rate.

$$= 0.25 \times D_{SS} / [\overline{X/Q} \times 1.5 \sum_i X_{id} (L_i + 1.1M_i)] \quad (41)$$

X_{id} = the concentration of noble gas radionuclide i in the waste gas decay tank whose contents are to be discharged, as corrected to the pressure of the discharge stream at the point of the flow rate measurement. The maximum discharge pressure as governed by the diaphragm valve, 7896, is 30 psia.

NOTE: The factor of 1.5 in the denominators of equations (40) and (41) places f_w on the same basis as S_d .

When a discharge is to be conducted, valve HCV-014 is to be opened until (a) the waste gas discharge flow rate reaches $0.9 \times f_w$ or (b) the count rate of the plant vent noble gas monitor RM-A3 approaches its setpoint, whichever of the above conditions is reached first.

When no discharges are being made from the Waste Gas Decay System, the RM-A10 setpoint should be established as near background as practical to prevent spurious alarms and yet alarm in the event of an inadvertent release.

3.1.4 Alternative Methodology for Establishing Conservative Setpoints

As an alternate to the methodology of section 3.1.2, to minimize necessity for frequent adjustment of setpoint, a conservative setpoint may be calculated as follows:

For a plant vent:

R_t' = conservative count rate per mrem/yr to the total body (Xe-133 detection, Kr-89 dose).

$$= C_v' + [\overline{X/Q} \times K_{Kr-89} \times X_v' \times F_v], \quad (42)$$

where:

X_v' = a concentration of Xe-133 chosen to be in the operating range of the monitor on vent v, $\mu\text{Ci/cc}$.

C_v' = the count rate in CPM of the monitor on vent v corresponding to X_v' $\mu\text{Ci/cc}$ of Xe-133.

K_{Kr-89} = total body dose factor for Kr-89, the most restrictive isotope from Table 3.1-1.

R_s' = count rate per mrem/yr to the skin.

$$= C_v' + [\overline{X/Q} \times (L_{Kr-89} + 1.1M_{Kr-89}) \times X_v' \times F_v] \quad (43)$$

where:

L_{Kr-89} = skin dose factor for Kr-89, the most restrictive isotope from Table 3.1-1.

M_{Kr-89} = air dose factor for Kr-89, the most restrictive isotope, from Table 3.1-1.

For the waste gas decay system:

f_t' = the conservative maximum permissible discharge rate based on Kr-89 total body dose rate.

$$= 0.25 \times D_{TB} + [\overline{X/Q} \times 1.5 \times X_d' \times K_{Kr-89}] \quad (44)$$

f_s' = the conservative maximum permissible discharge rate based on Kr-89 skin dose rate.

$$= 0.25 \times D_{SS} + [\overline{X/Q} \times 1.5 \times X_d' \times (L_{Kr-89} + 1.1M_{Kr-89})] \quad (45)$$

X_d' = the total concentration of noble gas radionuclides in the waste gas decay tank whose contents are to be discharged, as corrected to the pressure of the discharge stream at the point of the flow measurement.

c' = count rate in cpm of the waste gas decay system monitor corresponding to X_d' $\mu\text{Ci/cc}$ of Kr-85.

3.1.5 Oil Incineration

3.1.5.1 Releases from the oil incinerator will be limited such that

$$\overline{X/Q}_{(oil)} \sum P_i Q_{(oil)} < 1.5 \text{ mrem/yr.} \quad \text{Eq. (60)}$$

where:

$\overline{X/Q}_{(oil)}$ = highest annual average dispersion coefficient (sec/m³) at the site boundary
= 3.3E-5 sec/m³

P_i = dose parameter for radionuclide i , for inhalation, from Table 3.2-1 (mrem / yr per $\mu\text{Ci/m}^3$),

$Q_{(oil)}$ = $C_{i(oil)} \times R$

where:

$C_{i(oil)}$ = concentration of radionuclide i in oil ($\mu\text{Ci/ml}$), and

R = burn rate (mi/s).

3.1.5.2 Incinerator operation will be administratively controlled such that the combination of gaseous releases from the station and oil incineration will be less than Specifications 1.2.2.1(b) and 1.2.5.1. If noble gases are detected in waste oil, an assessment of release acceptability should be performed using the general methodology described in sections 3.2.2.1 and 3.2.3.1.

~~3.1.6~~ Meteorological Release Criteria for Batch Releases

Planned gaseous batch releases (WGDT) and oil incineration will be performed during favorable meteorology. Limiting releases to favorable meteorology provides assurance that release conditions will be conservative with respect to annual average dispersion values ($\overline{X/Q}$, $\overline{X/Q}'$). Favorable meteorology is defined in Table 3.1-2.

Table 3.1-2

Favorable Meteorology


Differential Temperature (ΔT) ¹ °F		Stability Class	Wind Speed ² (mph)	
61m - 10m	40m - 10m		10m	61m
$\Delta T \leq -1.74$	$\Delta T \leq -1.03$	A	*	*
$-1.74 < \Delta T \leq -1.56$	$-1.03 < \Delta T \leq -0.92$	B	*	*
$-1.55 < \Delta T \leq -1.38$	$-0.92 < \Delta T \leq -0.81$	C	1.3	1.6
$-1.38 < \Delta T \leq -0.46$	$-0.81 < \Delta T \leq -0.27$	D	3.1	4.1
$-0.46 < \Delta T \leq 1.38$	$-0.27 < \Delta T \leq 0.81$	E	3.5	6.6
$1.38 < \Delta T \leq 3.67$	$0.81 < \Delta T \leq 2.16$	F	5.2	14.0
$3.67 < \Delta T$	$2.16 < \Delta T$	G	7.0	18.9

Notes:

- 1 The ΔT values for 61m - 10m are considered as primary indicators for determination of stability class. The 40m - 10m ΔT values are used only when 61m - 10m values are not available. All ΔT values are listed in °F and are based on values in USNRC Regulatory Guide 1.23.
 - 2 The 10m wind speed is considered the primary indication for windspeed. The 61m wind speed indication should only be used if 10m is not available.
- * No wind is required for planned releases.

Figure 3.1-1

Example Noble Gas Monitor
Calibration Curve

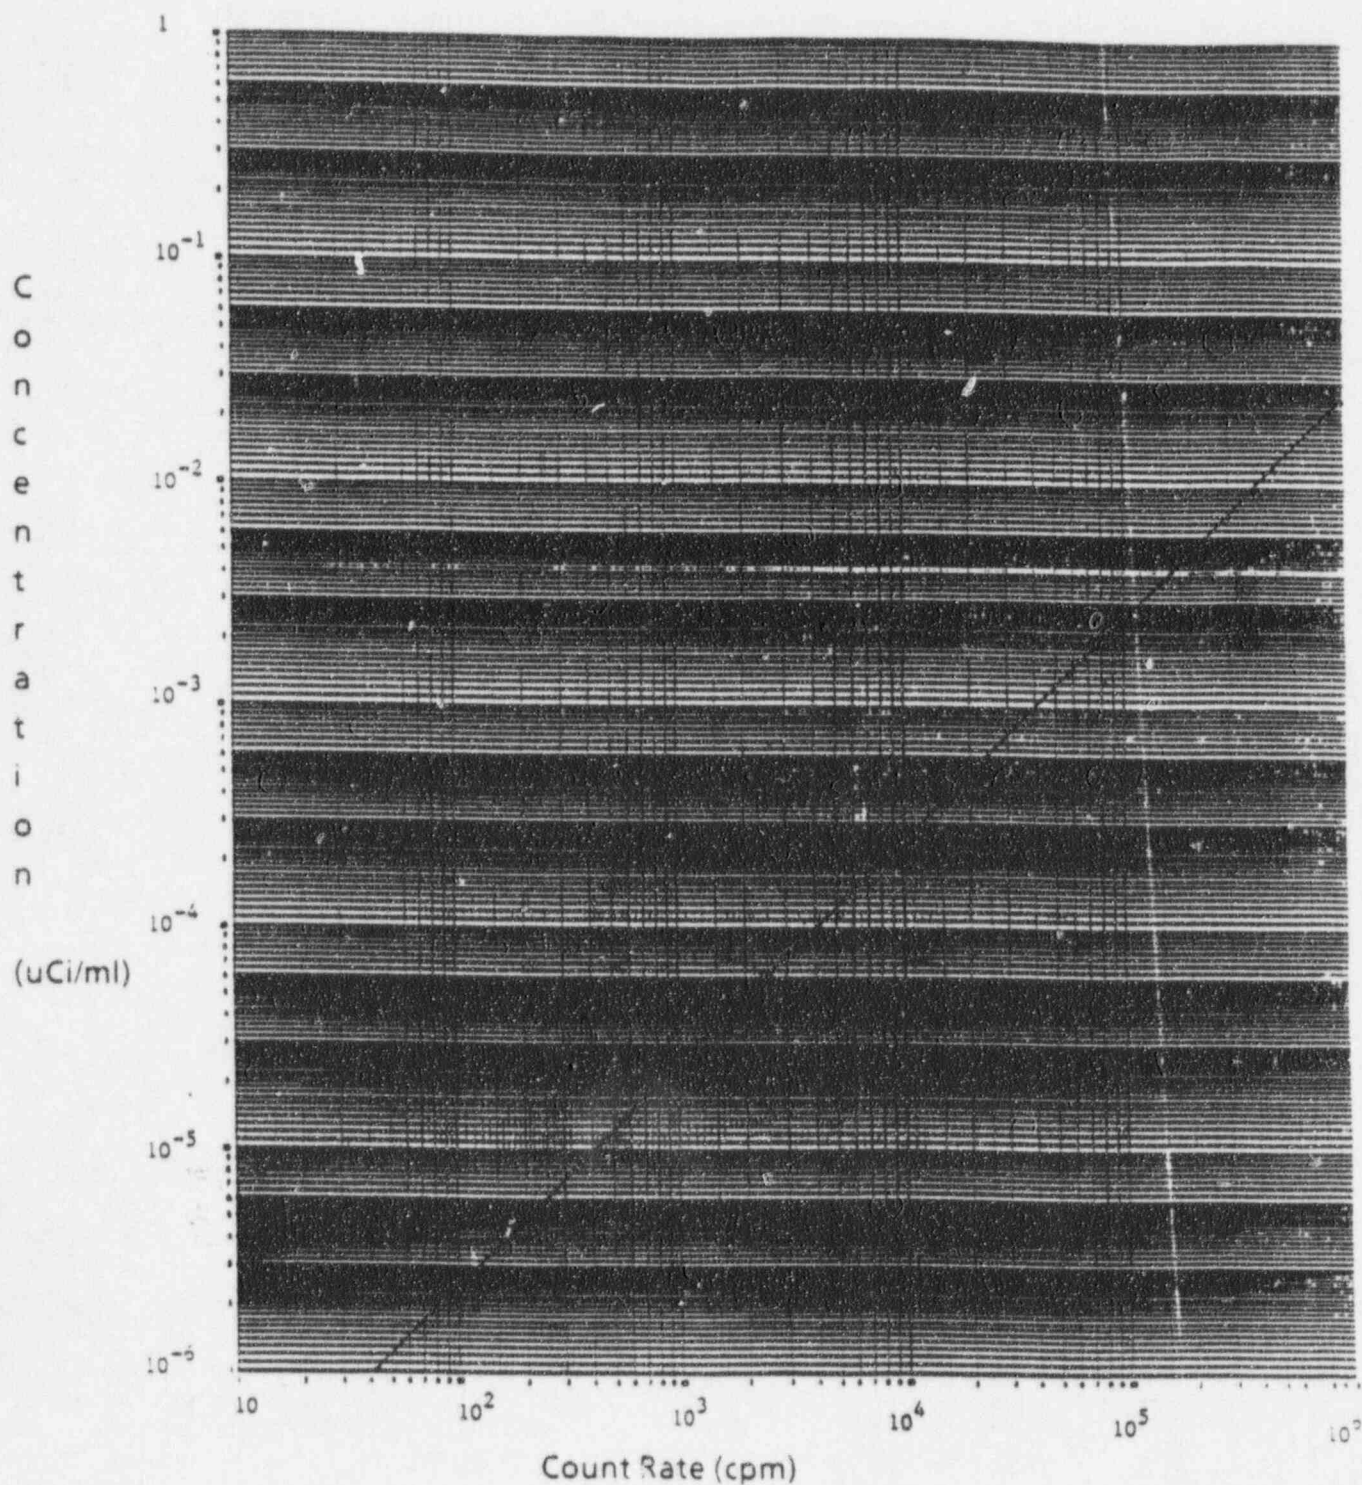

3.2 Dose Calculation for Gaseous Effluent

3.2.1 Gaseous Effluent Dose Calculation Parameters

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
D_o =	average organ dose rate in the current year (mrem/yr).	(3.2.2.2)
D_p =	dose to an individual from radioiodine and radionuclides in particulate form and radionuclides (other than noble gases), with half-lives greater than eight days (mrem).	(3.2.3.2)
D_s =	average skin dose rate in current year (mrem/year).	(3.2.2.1)
D_t =	current total body dose rate (mrem/yr)	(3.2.21)
D_β =	air dose due to beta emissions from noble gas radionuclides (mrad).	(3.2.3.1)
D_γ =	air dose due to gamma emissions from noble gas radionuclides (mrad).	(3.2.3.1)
K_i =	total body dose factor due to gamma emissions from isotope i (mrem/year per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.2.2.1)
L_i =	skin dose factor due to beta emissions from noble gas radionuclide i (mrad/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.2.2.1)
M_i =	air dose factor due to gamma emissions from noble gas radionuclide i (mrad/yr per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.2.2.1)
N_i =	air dose factor due to beta emissions from noble gas radionuclide i (mrad per $\mu\text{Ci}/\text{m}^3$) from Table 3.1-1.	(3.2.3.1)
P_i =	dose parameter for radionuclide i , (mrem/yr per $\mu\text{Ci}/\text{m}^3$) for inhalation, from Table 3.2-1.	(3.2.2.2)
\bar{Q}_i =	the release rate of noble gas radionuclide i as determined from the concentrations measured in the analysis of the appropriate sample required by Table 1.2-3 ($\mu\text{Ci}/\text{sec}$).	(3.2.2.1)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
\bar{Q}'_i =	the release rate of non-noble gas radionuclide i as determined from the concentrations measured in the analysis of the appropriate sample required by Table 1.2-3 ($\mu\text{Ci}/\text{sec}$).	(3.2.2.2)
\tilde{Q}_i =	cumulative release of noble gas radionuclide i over the period of interest (μCi).	(3.2.3.1)
\tilde{Q}'_i =	cumulative release of non-noble gas radionuclide i (required by ODCM Specification 1.2.4.1) over the period of interest (μCi).	(3.2.3.2)
R_{ij} =	dose factor for radionuclide i and pathway j, (mrem/yr per uCi/m^3) or ($\text{m}^2\text{-mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$) from Tables 3.2-2 through 3.2-6.	(3.2.3.2)
W_{ij}' =	relative dispersion parameter for the maximum exposed individual, as appropriate for his exposure pathway j and radionuclide i.	(3.2.3.2)
=	$\bar{X}Q'$ for inhalation and all tritium pathways	
=	$\bar{D}Q'$ for other pathways and non-tritium radionuclides	
$\bar{X}Q$ =	the highest annual average relative concentration in any sector, at the site boundary in sec/m^3 .	(3.2.2.1)
3.17×10^{-8} =	the fraction of one year per one second	(3.2.3.1)
$\bar{X}Q'$ =	Annual average relative concentration for the location of the maximum exposed individual for the site (sec/m^3).	(3.2.3.2)
$\bar{D}Q'$ =	Annual average relative deposition for the location of the maximum exposed individual for the site (m^{-2}).	(3.2.3.2)

3.2.2 Unrestricted Area Boundary Dose

3.2.2.1 For the purpose of implementation of section 1.2.2.1a, ($\cong 500$ mrem/year - total body, $\cong 3000$ mrem/year - skin) the dose at the unrestricted area boundary due to noble gases shall be calculated as follows:

$$\begin{aligned} D_t &= \text{current total body dose rate (mrem/yr)} \\ &= \overline{X/Q} \sum_i K_i \overline{Q}_i \end{aligned} \quad (46)$$

$$\begin{aligned} D_s &= \text{current skin dose rate (mrem/yr)} \\ &= \overline{X/Q} \sum_i (L_i + 1.1M_i) \overline{Q}_i \end{aligned} \quad (47)$$

where:

\overline{Q}_i = the release rate of noble gas radionuclide i as determined from the concentration measured in the analysis of the appropriate sample required by Table 1.2-3 ($\mu\text{Ci/sec.}$).

$\overline{X/Q}$ = the highest annual average relative concentration in any sector, at the site boundary (for value, see Section 3.1.2).

K_i , L_i , and M_i will be selected for the appropriate radionuclide from Table 3.1-1.

3.2.2.2 For the purpose of implementation of section 1.2.2.1.b ($\cong 1500$ mrem/yr - any organ) organ doses due to radioiodines and all radioactive materials in particulate form and radionuclides (other than noble gases) with half-lives greater than eight days, will be calculated as follows:

$$\begin{aligned} D_o &= \text{current organ dose rate (mrem/yr)} \\ &= \sum_i \overline{X/Q} P_i \overline{Q}_i' \end{aligned} \quad (48)$$

where:

$\overline{X/Q}$ = the highest annual average relative concentration in any sector, at the site boundary (for value, see Section 3.1.2)

P_i = dose parameter for radionuclide i , (mrem/yr per $\mu\text{Ci}/\text{m}^3$) for inhalation, from Table 3.2-1.

\overline{Q}_i = the release rate of non-noble gas radionuclide i as determined from the concentrations measured in the analysis of the appropriate sample required by Table 1.2-3 ($\mu\text{Ci}/\text{sec}$).

3.2.3 Unrestricted Area Dose (Air Dose and Dose to Individual)

3.2.3.1 For the purpose of implementation of section 1.2.3.1 (Calendar quarter: $\cong 5$ mrad - γ and $\cong 10$ mrad - β , Calendar year: $\cong 10$ mrad - γ and $\cong 20$ mrad - β) and section 1.2.5.1 (air dose averaged over 31 days: $\cong 0.2$ mrad - γ and $\cong 0.4$ mrad - β), the air dose in unrestricted areas shall be determined as follows:

$$D_\gamma = \text{air dose due to gamma emissions from noble gas radionuclide } i \text{ (mrad)}$$

$$= 3.17 \times 10^{-8} \sum_i M_i \overline{X/Q} \tilde{Q}_i \quad (49)$$

where:

3.17×10^{-8} = the fraction of one year per one second

\tilde{Q}_i = cumulative release of noble gas radionuclide i over the period of interest (μCi).

$$\begin{aligned}
D_{\beta} &= \text{air dose due to beta emissions from noble gas radionuclide } i \text{ (mrad).} \\
&= 3.17 \times 10^{-8} \sum_i N_i \overline{X/Q} \tilde{Q}_i
\end{aligned} \tag{50}$$

where, N_i = air dose factor due to beta emission from noble gas radionuclide i (mrad/yr per uCi/m³) from Table 3.1-1.

3.2.3.2 For all gaseous effluents including oil incineration, dose to an individual from radioiodines and radioactive materials in particulate form and radionuclides (other than noble gases), with half-lives greater than eight (8) days (Calendar quarter: ≤ 7.5 mrem any organ, Calendar year: ≤ 15 mrem any organ) will be calculated for the purpose of implementation of section 1.2.4.1 as follows:

$$\begin{aligned}
D_p &= \text{dose to an individual from radioiodines and radionuclides in particulate form, with half-lives greater than eight days (mrem)} \\
&= 3.17 \times 10^{-8} \sum_{ij} R_{ij} W'_{ij} \tilde{Q}'_i
\end{aligned} \tag{51}$$

where:

W'_{ij} = relative concentration or relative deposition for the maximum exposed individual, as appropriate for exposure pathway j and radionuclide i .

$\overline{X/Q}'$ for inhalation and all tritium pathways

$$= 3.5 \times 10^{-6} \text{ sec/m}^3$$

$\overline{D/Q}'$ for other pathways and non-tritium radionuclides

$$= 1.1 \times 10^{-8} \text{ m}^{-2}$$

(See the notes to Table 3.2-7 and 3.2-8 for the origin of these factors.)

R_{ij} = dose factor for radionuclide i and pathway j ,
(mrem/yr per $\mu\text{Ci}/\text{m}^3$) or (m^2 - mrem/yr per $\mu\text{Ci}/\text{sec}$)
from Table 3.2-2.

\widetilde{Q}_i = Cumulative release of non-noble gas radionuclide
 i (required by ODCM Specification 1.2.4.1) over
the period of interest (μCi).

3.2.4 For the purpose of initial assessments of the impact of unplanned gaseous releases, dose calculations for the critical receptor in each affected sector may be performed using section 3.2.3.1 and section 3.2.3.2 equations as follows:

- (1) For each affected sector, X/Q and D/Q will be calculated for one mile and critical receptor locations using actual meteorological conditions occurring during the unplanned release. Actual X/Q and D/Q values will be compared to annual average dispersion coefficients ($\overline{X/Q}$, $\overline{X/Q}'$, and $\overline{D/Q}'$). The more limiting dispersion coefficients will be used along with methodology in sections 3.2.3.1 and 3.2.3.2 for the initial assessment.
- (2) The location of the critical receptors and the pathways j which should be analyzed are shown in Table 3.2-7. (For very rough calculations, the annual average dispersion coefficients ($\overline{X/Q}$ and $\overline{D/Q}$) for each receptor are shown in Table 3.2-8.)
- (3) The R_{ij} for the appropriate exposure pathways and age groups will be selected from Tables 3.2-3 through 3.2-6.

TABLE 3.2-1
 PATHWAY DOSE FACTORS FOR SECTION 3.2.2.2 (P_i)*

Page 1 of 3

AGE GROUP	(CHILD)
ISOTOPE	INHALATION
H-3	1.125E + 03
C-14	3.589E + 04
NA-24	1.610E + 04
P-32	2.605E + 06
CR-51	1.698E + 04
MN-54	1.576E + 06
NI-56	1.232E + 05
FE-55	1.110E + 05
FE-59	1.269E + 06
CO-58	1.106E + 06
CO-60	7.067E + 06
NI-63	8.214E + 05
NI-65	8.399E + 04
CU-64	3.670E + 04
ZN-65	9.953E + 05
ZN-69	1.018E + 04
BR-83	4.736E + 02
BR-84	5.476E + 02
BR-85	2.531E + 01
RB-86	1.983E + 05
RB-88	5.624E + 02
RB-89	3.452E + 02
SR-89	2.157E + 06
SR-90	1.010E + 08
SR-91	1.739E + 05

*See note, page 3.0-20

Units - mrem/yr per $\mu\text{Ci}/\text{m}^3$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-1
 PATHWAY DOSE FACTORS FOR SECTION 3.2.2.2 (P₁)

Page 2 of 3

AGE GROUP	(CHILD)
ISOTOPE	INHALATION
SR-92	2.424E + 05
Y-90	2.679E + 05
Y-91M	2.812E + 03
Y-91	2.627E + 06
Y-92	2.390E + 05
Y-93	3.885E + 05
ZR-95	2.231E + 06
ZR-97	3.511E + 05
NB-95	6.142E + 05
MO-99	1.354E + 05
TC-99M	4.810E + 03
TC-101	5.846E + 02
RU-103	6.623E + 05
RU-105	9.953E + 04
RU-106	1.476E + 07
AG-110M	5.476E + 06
TE-125M	4.773E + 05
TE-127M	1.480E + 06
TE-127	5.624E + 04
TE-129M	1.761E + 06
TE-129	2.549E + 04
TE-131M	3.078E + 05
TE-131	2.054E + 03
TE-132	3.774E + 05
I-130	1.846E + 06

*See note, page 3.0-20

Units - mrem/yr per $\mu\text{Ci}/\text{m}^3$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-1
 PATHWAY DOSE FACTORS FOR SECTION 3.2.2.2 (P_i)

Page 3 of 3

AGE GROUP	(CHILD)
ISOTOPE	INHALATION
I-131	1.624E + 07
I-132	1.935E + 05
I-133	3.848E + 06
I-134	5.069E + 04
I-135	7.918E + 05
CS-134	1.014E + 06
CS-136	1.709E + 05
CS-137	9.065E + 05
CS-138	8.399E + 02
BA-139	5.772E + 04
BA-140	1.743E + 06
BA-141	2.919E + 03
BA-142	1.643E + 03
LA-140	2.257E + 05
LA-142	7.585E + 04
CE-141	5.439E + 05
CE-143	1.273E + 05
CE-144	1.195E + 07
PR-143	4.329E + 05
PR-144	1.565E + 03
ND-147	3.282E + 05
W-187	9.102E + 04
NP-239	6.401E + 04

NOTE: The P_i values of Table 3.2-1 were calculated according to the methods of Reference 1, Section 5.2.1, for children. The values used for the various parameters and the origins of those values are given in Table 3.2-9 and its notes.

Units - mrem/yr per $\mu\text{Ci}/\text{m}^3$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-2

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.2 (R_i)*

Page 1 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	VEGETATION
H-3	1.125E + 03 (Total Body)	0.000E + 00 (Skin)	3.627E + 03 (Total Body)
C-14	3.589E + 04 (Bone)	0.000E + 00 (Skin)	8.894E + 08 (Bone)
NA-24	1.610E + 04 (Total Body)	3.33E + 08 (Skin)	3.729E + 05 (Total Body)
P-32	2.605E + 06 (Bone)	0.000E + 00 (Skin)	3.366E + 09 (Bone)
CR-51	1.698E + 04 (Lung)	5.506E + 06 (Skin)	6.213E + 06 (GI-LLI)
MN-54	1.576E + 06 (Lung)	1.625E + 09 (Skin)	6.648E + 08 (Liver)
MN-56	1.232E + 05 (GI-LLI)	1.068E + 06 (Skin)	2.723E + 03 (GI-LLI)
FE-55	1.110E + 05 (Lung)	0.000E + 00 (Skin)	8.012E + 08 (Bone)
FE-59	1.269E + 06 (Lung)	3.204E + 08 (Skin)	6.693E + 08 (GI-LLI)
CO-58	1.106E + 06 (Lung)	4.464E + 08 (Skin)	3.771E + 08 (GI-LLI)
CO-60	7.067E + 06 (Lung)	2.532E + 10 (Skin)	2.095E + 09 (GI-LLI)
NI-63	8.214E + 05 (Bone)	0.000E + 00 (Skin)	3.949E + 10 (Bone)
NI-65	8.399E + 04 (GI-LLI)	3.451E + 05 (Skin)	1.211E + 03 (GI-LLI)
CU-64	3.670E + 04 (GI-LLI)	6.876E + 05 (Skin)	5.159E + 05 (GI-LLI)
ZN-65	9.953E + 05 (Lung)	8.583E + 08 (Skin)	2.164E + 09 (Liver)
ZN-69	1.018E + 04 (GI-LLI)	0.000E + 00 (Skin)	9.893E-04 (GI-LLI)
BR-83	4.736E + 02 (Total Body)	7.079E + 03 (Skin)	5.369E + 00 (Total Body)
BR-84	5.476E + 02 (Total Body)	2.363E + 05 (Skin)	3.822E - 11 (Total Body)
BR-85	2.531E + 01 (Total Body)	0.000E + 00 (Skin)	0.000E + 00 (Total Body)
RB-86	1.983E + 05 (Liver)	1.035E + 07 (Skin)	4.584E + 08 (Liver)
RB-88	5.624E + 02 (Liver)	3.779E + 04 (Skin)	4.374E - 22 (Liver)
RB-89	3.452E + 02 (Liver)	1.452E + 05 (Skin)	1.642E - 26 (Liver)
SR-89	2.157E + 06 (Lung)	2.509E + 04 (Skin)	3.593E + 10 (Bone)
SR-90	1.010E + 08 (Bone)	0.000E + 00 (Skin)	1.243E + 12 (Bone)
SR-91	1.739E + 05 (GI-LLI)	2.511E + 06 (Skin)	1.157E + 06 (GI-LLI)

* See note, page 3.0-36

** Reference 1, section 5.3.1, page 30, paragraph 1 explains the logic used in selecting these specific pathways.

*** Critical organs for each pathway by nuclide in parentheses.

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

TABLE 3.2-2 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.2 (R_i)

Page 2 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	VEGETATION
SR - 92	2.424E + 05 (GI-LLI)	8.631E + 05 (Skin)	1.378E + 04 (GI-LLI)
Y - 90	2.679E + 05 (GI-LLI)	5.308E + 03 (Skin)	6.569E + 07 (GI-LLI)
Y - 91M	2.812E + 03 (Lung)	1.161E + 05 (Skin)	1.737E - 05 (GI-LLI)
Y - 91	2.627E + 06 (Lung)	1.207E + 06 (Skin)	2.484E + 09 (GI-LLI)
Y - 92	2.390E + 05 (GI-LLI)	2.142E + 05 (Skin)	4.576E + 04 (GI-LLI)
Y - 93	3.885E + 05 (GI-LLI)	2.534E + 05 (Skin)	4.482E + 06 (GI-LLI)
ZR - 95	2.231E + 06 (Lung)	2.837E + 08 (Skin)	8.843E + 08 (GI-LLI)
ZR - 97	3.511E + 05 (GI-LLI)	3.445E + 06 (Skin)	1.248E + 07 (GI-LLI)
NB - 95	6.142E + 05 (Lung)	1.605E + 08 (Skin)	2.949E + 08 (GI-LLI)
MO - 99	1.354E + 05 (Lung)	4.626E + 06 (Skin)	1.647E + 07 (Kidney)
TC - 99M	4.810E + 03 (GI-LLI)	2.109E + 05 (Skin)	5.255E + 03 (GI-LLI)
TC - 101	5.846E + 02 (Lung)	2.277E + 04 (Skin)	4.123E - 29 (Kidney)
RU - 103	6.623E + 05 (Lung)	1.265E + 08 (Skin)	3.971E + 08 (GI-LLI)
RU - 105	9.953E + 04 (GI-LLI)	7.212E + 05 (Skin)	5.981E + 04 (GI-LLI)
RU - 106	1.476E + 07 (Lung)	5.049E + 08 (Skin)	1.159E + 10 (GI-LLI)
AG - 110M	5.476E + 06 (Lung)	4.019E + 09 (Skin)	2.581E + 09 (GI-LLI)
TE - 125M	4.773E + 05 (Lung)	2.128E + 06 (Skin)	3.506E + 08 (Bone)
TE - 127M	1.480E + 06 (Lung)	1.083E + 05 (Skin)	3.769E + 09 (Kidney)
TE - 127	5.624E + 04 (GI-LLI)	3.293E + 03 (Skin)	3.903E + 05 (GI-LLI)
TE - 129M	1.761E + 06 (Lung)	2.312E + 07 (Skin)	2.430E + 09 (GI-LLI)
TE - 129	2.549E + 04 (GI-LLI)	3.076E + 04 (Skin)	7.200E - 02 (GI-LLI)
TE - 131M	3.078E + 05 (GI-LLI)	9.459E + 06 (Skin)	2.163E + 07 (GI-LLI)
TE - 131	2.054E + 03 (Lung)	3.450E + 07 (Skin)	1.349E - 14 (GI-LLI)
TE - 132	3.774E + 05 (Lung)	4.968E + 06 (Skin)	3.111E + 07 (GI-LLI)
I - 130	1.846E + 06 (Thyroid)	6.692E + 06 (Skin)	1.371E + 08 (Thyroid)

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-2 (continue)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.2 (R_i)

Page 3 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	VEGETATION
I-131	1.624E + 07 (Thyroid)	2.089E + 07 (Skin)	4.754E + 10 (Thyroid)
I-132	1.935E + 05 (Thyroid)	1.452E + 06 (Skin)	7.314E + 03 (Thyroid)
I-133	3.848E + 06 (Thyroid)	2.981E + 06 (Skin)	8.113E + 08 (Thyroid)
I-134	5.069E + 04 (Thyroid)	5.305E + 05 (Skin)	6.622E - 03 (Thyroid)
I-135	7.918E + 05 (Thyroid)	2.947E + 06 (Skin)	9.973E + 06 (Thyroid)
CS-134	1.014E + 06 (Liver)	8.007E + 09 (Skin)	2.631E + 10 (Liver)
CS-136	1.709E + 05 (Liver)	1.710E + 08 (Skin)	2.247E + 08 (Liver)
CS-137	9.065E + 05 (Bone)	1.201E + 10 (Skin)	2.392E + 10 (Bone)
CS-138	8.399E + 02 (Liver)	4.102E + 05 (Skin)	9.133E - 11 (Liver)
BA-139	5.772E + 04 (GI-LLI)	1.194E + 05 (Skin)	2.950E + 00 (GI-LLI)
BA-140	1.743E + 06 (Lung)	2.346E + 07 (Skin)	2.767E + 08 (Bone)
BA-141	2.919E + 03 (Lung)	4.734E + 04 (Skin)	1.605E - 21 (Bone)
BA-142	1.643E + 03 (Lung)	5.064E + 04 (Skin)	4.105E - 39 (Bone)
LA-140	2.257E + 05 (GI-LLI)	2.180E + 07 (Skin)	3.166E + 07 (GI-LLI)
LA-142	7.585E + 04 (Lung)	9.117E + 05 (Skin)	2.141E + 01 (GI-LLI)
CE-141	5.439E + 05 (Lung)	1.540E + 07 (Skin)	4.082E + 08 (GI-LLI)
CE-143	1.273E + 05 (GI-LLI)	2.627E + 06 (Skin)	1.364E + 07 (GI-LLI)
CE-144	1.195E + 07 (Lung)	8.042E + 07 (Skin)	1.039E + 10 (GI-LLI)
PR-143	4.329E + 05 (Lung)	0.000E + 00 (Skin)	1.575E + 08 (GI-LLI)
PR-144	1.565E + 03 (Lung)	2.112E + 03 (Skin)	3.829E - 23 (GI-LLI)
ND-147	3.282E + 05 (Lung)	1.009E + 07 (Skin)	9.197E + 07 (GI-LLI)
W-187	9.102E + 04 (GI-LLI)	2.740E + 06 (Skin)	5.380E + 06 (GI-LLI)
NP-239	6.401E + 04 (GI-LLI)	1.976E + 06 (Skin)	1.357E + 07 (GI-LLI)

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-3
PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)*

Page 1 of 3

AGE GROUP	(INFANT)	(N.A.)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS-COW MEAT	GRS-COW MILK	GRS GOT MEAT	GRS-GOT-MILK	VEGETATION
H-3	6.468E+02	0.000E+00	2.157E+03	0.000E+00	2.157E+03	0.000E+00	4.398E+03	0.000E+00
C-14	2.646E+04	0.000E+00	2.340E+09	0.000E+00	8.189E+08	0.000E+00	2.340E+09	0.000E+00
NA-24	1.056E+04	1.385E+07	1.542E+07	0.000E+00	2.300E-37	0.000E+00	1.851E+06	0.000E+00
P-32	2.030E+06	0.000E+00	1.602E+11	0.000E+00	7.088E+08	0.000E+00	1.924E+11	0.000E+00
CR-51	1.284E+04	5.506E+06	4.700E+06	0.000E+00	1.729E+05	0.000E+00	5.641E+05	0.000E+00
MN-54	9.996E+05	1.625E+09	3.900E+07	0.000E+00	1.118E+07	0.000E+00	4.680E+06	0.000E+00
MN-56	7.168E+04	1.068E+06	2.862E+00	0.000E+00	0.000E+00	0.000E+00	3.436E-01	0.000E+00
FE-55	8.694E+04	0.000E+00	1.351E+08	0.000E+00	4.439E+07	0.000E+00	1.757E+06	0.000E+00
FE-59	1.015E+06	3.204E+08	3.919E+08	0.000E+00	3.384E+07	0.000E+00	5.096E+06	0.000E+00
CO-58	7.770E+05	4.464E+08	6.055E+07	0.000E+00	8.824E+06	0.000E+00	7.251E+06	0.000E+00
CO-60	4.508E+06	2.532E+10	2.098E+08	0.000E+00	7.107E+07	0.000E+00	2.517E+07	0.000E+00
NI-63	3.388E+05	0.000E+00	3.493E+10	0.000E+00	1.221E+10	0.000E+00	4.192E+09	0.000E+00
NI-65	5.012E+04	3.451E+05	3.020E+01	0.000E+00	0.000E+00	0.000E+00	3.635E+00	0.000E+00
CU-64	1.498E+04	6.876E+05	3.807E+06	0.000E+00	7.934E-46	0.000E+00	4.246E+05	0.000E+00
ZN-65	6.468E+05	8.583E+08	1.904E+10	0.000E+00	5.160E+09	0.000E+00	2.285E+09	0.000E+00
ZN-69	1.322E+04	0.000E+00	3.855E-09	0.000E+00	0.000E+00	0.000E+00	3.581E-10	0.000E+00
BR-83	3.808E+02	7.079E+03	9.339E-01	0.000E+00	0.000E+00	0.000E+00	1.124E-01	0.000E+00
BR-84	4.004E+02	2.363E+05	1.256E-22	0.000E+00	0.000E+00	0.000E+00	1.527E-23	0.000E+00
BR-85	2.044E+01	0.000E+00	0.00E+00	0.000E+00	0.000E+00	0.000E+00	0.000E00	0.000E+00
RB-86	1.904E+05	1.035E+07	2.234E+10	0.000E+00	2.827E+08	0.000E+00	2.671E+09	0.000E+00
RB-88	5.572E+02	3.779E+04	1.874E-44	0.000E+00	0.000E+00	0.000E+00	2.304E-45	0.000E+00
RB-89	3.206E+02	1.452E+05	3.414E-52	0.000E+00	0.000E+00	0.000E+00	4.056E-53	0.000E+00
SR-89	2.030E+06	2.509E+04	1.258E+10	0.000E+00	1.280E+09	0.000E+00	2.643E+10	0.000E+00
SR-90	4.088E+07	0.000E+00	1.216E+11	0.000E+00	4.230E+10	0.000E+00	2.553E+11	0.000E+00
SR-91	7.336E+04	2.511E+06	3.215E+05	0.000E+00	0.000E+00	0.000E+00	6.758E+05	0.000E+00
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

*See note, page 3.0-36

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

TABLE 3.2-3 (continued)

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 2 of 3

AGE GROUP	(INFANT)	(N.A.)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)
ISOTOPE	INHALATION	GROUND PLANE	GRS-COW MILK	GRS-COW MEAT	GRS-COW MILK	GRS-COW MEAT	GRS-COW MILK	VEGETATION
SR-92	1.400E+05	8.631E+05	5.005E+01	0.000E+00	0.000E+00	0.000E+00	1.054E+02	0.000E+00
Y-90	2.688E+05	5.308E+03	9.406E+05	0.000E+00	2.335E-05	0.000E+00	1.129E+05	0.000E+00
Y-91M	2.786E+03	1.161E+05	1.876E-15	0.000E+00	0.000E+00	0.000E+00	2.290E-16	0.000E+00
Y-91	2.450E+06	1.207E+06	5.251E+06	0.000E+00	6.324E+05	0.000E+00	6.302E+05	0.000E+00
Y-92	1.266E+05	2.142E+05	1.026E+01	0.000E+00	0.000E+00	0.000E+00	1.234E+00	0.000E+00
Y-93	1.666E+05	2.534E+05	1.776E+04	0.000E+00	2.386E-61	0.000E+00	2.046E+03	0.000E+00
ZR-95	1.750E+06	2.837E+08	8.257E+05	0.000E+00	1.090E+05	0.000E+00	9.910E+04	0.000E+00
ZR-97	1.400E+05	3.445E+06	4.446E+04	0.000E+00	4.980E-35	0.000E+00	5.339E+03	0.000E+00
NB-95	4.788E+05	1.605E+08	2.062E+08	0.000E+00	1.213E+07	0.000E+00	2.475E+07	0.000E+00
MO-99	1.348E+05	4.626E+06	3.108E+08	0.000E+00	1.523E-02	0.000E+00	3.731E+07	0.000E+00
TC-99M	2.030E+03	2.109E+05	1.646E+04	0.000E+00	0.000E+00	0.000E+00	1.978E+03	0.000E+00
TC-101	8.442E+02	2.277E+04	1.423E-56	0.000E+00	0.000E+00	0.000E+00	6.530E-58	0.000E+00
RU-103	5.516E+05	1.265E+08	1.055E+05	0.000E+00	7.573E+03	0.000E+00	1.265E+04	0.000E+00
RU-105	4.844E+04	7.212E+05	3.204E+00	0.000E+00	0.000E+00	0.000E+00	3.851E-01	0.000E+00
RU-106	1.156E+07	5.049E+08	1.445E+06	0.000E+00	4.266E+05	0.000E+00	1.734E+05	0.000E+00
AG-110M	3.668E+06	4.019E+09	1.461E+10	0.000E+00	3.984E+09	0.000E+00	1.752E+09	0.000E+00
TE-125M	4.466E+05	2.128E+06	1.508E+08	0.000E+00	1.799E+07	0.000E+00	1.809E+07	0.000E+00
TE-127M	1.312E+06	1.083E+05	1.037E+09	0.000E+00	2.046E+08	0.000E+00	1.244E+08	0.000E+00
TE-127	2.436E+04	3.293E+03	1.359E+05	0.000E+00	1.269E-65	0.000E+00	1.594E+04	0.000E+00
TE-129M	1.680E+06	2.312E+07	1.352E+09	0.000E+00	7.559E+07	0.000E+00	1.672E+08	0.000E+00
TE-129	2.632E+04	3.076E+04	2.187E-07	0.000E+00	0.000E+00	0.000E+00	2.624E-08	0.000E+00
TE-131M	1.988E+05	9.459E+06	2.288E+07	0.000E+00	1.653E-15	0.000E+00	2.747E+06	0.000E+00
TE-131	8.218E+03	3.450E+07	1.384E-30	0.000E+00	0.000E+00	0.000E+00	1.688E-31	0.000E+00
TE-132	3.402E+05	4.968E+06	6.513E+07	0.000E+00	1.041E-01	0.000E+00	7.842E+06	0.000E+00
I-130	1.596E+06	6.692E+06	8.754E+08	0.000E+00	7.115E-45	0.000E+00	1.051E+09	0.000E+00
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-3 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R₁)

Page 3 of 3

AGE GROUP	(INFANT)	(N.A.)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)	(INFANT)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
I-131	1.484E+07	2.089E+07	1.053E+12	0.000E+00	1.567E+08	0.000E+00	1.264E+12	0.000E+00
I-132	1.694E+05	1.452E+06	1.188E+02	0.000E+00	0.000E+00	0.000E+00	1.638E+02	0.000E+00
I-133	3.556E+06	2.981E+06	9.601E+09	0.000E+00	1.776E-22	0.000E+00	1.153E+10	0.000E+00
I-134	4.452E+04	5.305E+05	8.402E-10	0.000E+00	0.000E+00	0.000E+00	1.017E-09	0.000E+00
I-135	6.958E+05	2.947E+06	2.002E+07	0.000E+00	0.000E+00	0.000E+00	2.406E+07	0.000E+00
CS-134	7.028E+05	8.007E+09	4.801E+10	0.000E+00	2.191E+10	0.000E+00	2.040E+11	0.000E+00
CS-136	1.345E+05	1.710E+10	5.795E+09	0.000E+00	1.729E+07	0.000E+00	1.744E+10	0.000E+00
CS-137	6.118E+05	1.201E+10	6.024E+10	0.000E+00	2.096E+10	0.000E+00	1.087E+12	0.000E+00
CS-138	8.764E+02	4.102E+05	2.180E-22	0.000E+00	0.000E+00	0.000E+00	6.628E-22	0.000E+00
BA-139	5.096E+04	1.194E+05	2.874E-05	0.000E+00	0.000E+00	0.000E+00	3.265E-06	0.000E+00
BA-140	1.596E+06	2.346E+07	2.410E+08	0.000E+00	6.409E+05	0.000E+00	2.893E+07	0.000E+00
BA-141	4.746E+03	4.734E+04	4.916E-44	0.000E+00	0.000E+00	0.000E+00	5.899E-45	0.000E+00
BA-142	1.554E+03	5.064E+04	1.049E-78	0.000E+00	0.000E+00	0.000E+00	1.259E-79	0.000E+00
LA-140	1.680E+05	2.180E+07	1.880E+05	0.000E+00	4.563E-12	0.000E+00	2.253E+04	0.000E+00
LA-142	5.950E+04	9.117E+05	1.078E-05	0.000E+00	0.000E+00	0.000E+00	1.278E-06	0.000E+00
CE-141	5.166E+05	1.540E+07	1.366E+07	0.000E+00	7.008E+05	0.000E+00	1.640E+06	0.000E+00
CE-143	1.162E+05	2.627E+06	1.536E+06	0.000E+00	1.039E-14	0.000E+00	1.844E+05	0.000E+00
CE-144	9.842E+06	8.042E+07	1.334E+08	0.000E+00	3.749E+07	0.000E+00	1.601E+07	0.000E+00
PR-143	4.326E+05	0.000E+00	7.845E+05	0.000E+00	2.771E+03	0.000E+00	9.407E+04	0.000E+00
PR-144	4.284E+03	2.112E+03	1.171E-48	0.000E+00	0.000E+00	0.000E+00	1.259E-49	0.000E+00
ND-147	3.220E+05	1.009E+07	5.743E+05	0.000E+00	6.902E+02	0.000E+00	6.885E+04	0.000E+00
W-187	3.962E+04	2.740E+06	2.501E+06	0.000E+00	5.275E-22	0.000E+00	2.983E+05	0.000E+00
NP-239	5.950E+04	1.976E+06	9.400E+04	0.000E+00	1.025E-07	0.000E+00	1.132E+04	0.000E+00
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

3.0-26

TABLE 3.2-4
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)*

Page 1 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
H-3	1.125E+03	0.000E+00	1.421E+03	2.118E+02	1.421E+03	2.543E+01	2.899E+03	3.627E+03
C-14	3.589E+04	0.000E+00	1.195E+09	3.834E+08	4.181E+08	4.601E+07	1.195E+09	8.894E+08
NA-24	1.610E+04	1.385E+07	8.853E+06	1.725E-03	1.321E-37	2.070E-04	1.063E+06	3.729E+05
P-32	2.605E+06	0.000E+00	7.775E+10	7.411E+09	3.440E+08	8.893E+08	9.335E+10	3.366E+09
CF-51	1.698E+04	5.506E+06	5.398E+06	4.661E+05	1.985E+05	5.593E+04	6.478E+05	6.213E+06
MN-54	1.576E+06	1.625E+09	2.097E+07	8.011E+06	6.012E+06	9.613E+05	2.517E+06	6.648E+08
MN-56	1.232E+05	1.068E+06	1.865E+00	2.437E-51	0.000E+00	2.924E-52	2.238E-01	2.723E+03
FE-55	1.110E+05	0.000E+00	1.118E+08	4.571E+08	3.673E+07	5.486E+07	1.453E+06	8.012E+08
FE-59	1.269E+06	3.204E+08	2.025E+08	6.338E+08	1.749E+07	7.605E+07	2.633E+06	6.693E+08
CO-58	1.106E+06	4.464E+08	7.080E+07	9.596E+07	1.032E+07	1.152E+07	8.487E+06	3.771E+08
CO-60	7.067E+06	2.532E+10	2.391E+08	3.838E+08	8.103E+07	4.605E+07	2.870E+07	2.095E+09
NI-63	8.214E+05	0.000E+00	2.964E+10	2.912E+10	1.036E+10	3.495E+09	3.557E+09	3.949E+10
NI-65	8.399E+04	3.451E+05	1.909E+01	4.061E-51	0.000E+00	4.873E-52	2.298E+00	* 211E+03
CJ-64	3.670E+04	6.876E+05	3.502E+06	1.393E-05	7.299E-46	1.672E-06	3.907E+05	5.159E+05
ZN-65	9.953E+05	8.583E+08	1.101E+10	1.000E+09	2.985E+09	1.200E+08	1.322E+09	2.164E+09
ZN-69	1.018E+04	0.000E+00	1.123E-09	0.000E+00	0.000E+00	0.000E+00	1.043E-10	9.893E-04
BR-83	4.736E+02	7.079E+03	4.399E-01	9.519E-57	0.000E+00	1.142E-57	5.190E-02	5.369E+00
BR-84	5.476E+02	2.363E+05	6.508E-23	0.000E+00	0.000E+00	0.000E+00	7.758E-24	3.822E-11
BR-85	2.531E+01	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00
RB-86	1.983E+05	1.035E+07	8.804E+09	5.816E+08	1.114E+08	6.979E+07	1.053E+09	4.584E+08
RB-88	5.624E+02	3.779E+04	7.150E-45	0.000E+00	0.000E+00	0.000E+00	8.789E-46	4.374E-22
RB-89	3.452E+02	1.452E+05	1.397E-52	0.000E+00	0.000E+00	0.000E+00	1.659E-53	1.642E-26
SR-89	2.157E+06	2.509E+04	6.618E+09	4.815E+08	6.730E+08	5.778E+07	1.390E+10	3.593E+10
SR-90	1.010E+08	0.000E+00	1.117E+11	1.040E+10	3.887E+10	1.248E+09	2.346E+11	1.243E+12
SR-91	1.739E+05	2.511E+06	2.878E+05	55.292E-10	0.000E+00	6.351E-11	6.050E+05	1.157E+06
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

*See note, page 3.0-36

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

TABLE 3.2-4 (continued)

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 2 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
SR-92	2.424E+05	8.631E+05	4.134E+01	3.492E-48	0.000E+00	4.191E-49	8.706E+01	1.378E+4
Y-90	2.679E+05	5.308E+03	9.171E+05	4.879E+05	2.277E-05	5.855E+04	1.101E+05	6.569E+7
Y-91M	2.812E+03	1.161E+05	5.622E-16	0.000E+00	0.000E+00	0.000E+00	6.344E-17	1.737E-5
Y-91	2.627E+06	1.207E+06	5.199E+06	2.400E+08	6.261E+05	2.880E+07	6.240E+05	2.484E+9
Y-92	2.390E+05	2.142E+05	7.310E+00	6.959E-35	0.000E+00	8.350E-36	8.791E-01	4.576E+4
Y-93	3.885E+05	2.534E+05	1.573E+04	1.547E-07	9.134E-61	1.857E-08	1.888E+03	4.482E+6
ZR-95	2.231E+06	2.837E+08	8.786E+05	6.106E+08	1.160E+05	7.328E+07	1.054E+05	8.843E+8
ZR-97	3.511E+05	3.445E+06	4.199E+04	7.015E-01	4.703E-35	8.418E-02	5.042E+03	1.248E+7
NB-95	6.142E+05	1.605E+08	2.287E+08	2.288E+09	1.346E+07	2.673E+08	2.747E+07	2.949E+8
MO-99	1.354E+05	4.626E+06	1.738E+08	2.456E+05	8.512E-03	2.947E+04	2.086E+07	1.647E+7
TC-99M	4.810E+03	2.109E+05	1.474E+04	6.915E-18	0.000E+00	8.298E-19	1.771E+03	5.255E+3
TC-101	5.846E+02	2.277E+04	5.593E-58	0.000E+00	0.000E+00	0.000E+00	2.566E-59	4.123E-29
RU-103	6.623E+05	1.265E+08	1.108E+05	4.009E+09	7.952E+03	4.811E+08	1.329E+04	3.971E+8
RU-105	9.953E+04	7.212E+05	2.493E+00	5.885E-25	0.000E+00	7.061E-26	2.997E-01	5.981E+4
RU-106	1.476E+07	5.049E+08	1.437E+06	6.902E+10	4.243E+05	8.282E+09	1.725E+05	1.159E+10
AG-110M	5.476E+06	4.019E+09	1.678E+10	6.742E+08	4.576E+09	8.090E+07	2.013E+09	2.581E+9
TE-125M	4.773E+05	2.128E+06	7.377E+07	5.690E+08	8.802E+06	6.828E+07	8.853E+06	3.506E+8
TE-127M	1.480E+06	1.083E+05	5.932E+08	5.060E+09	1.171E+08	6.072E+08	7.118E+07	3.769E+9
TE-127	5.624E+04	3.293E+03	1.191E+05	1.607E-08	0.000E+00	1.929-09	1.396E+04	3.903E+5
TE-129M	1.761E+06	2.312E+07	7.961E+08	5.245E+09	4.324E+07	6.294E+08	9.563E+07	2.46E+9
TE-129	2.549E+04	3.076E+04	7.96E-08	0.000E+00	0.000E+00	0.000E+00	9.641E-09	7.204E-2
TE-131M	3.078E+05	9.459E+06	2.244E+07	9.815E+03	1.621E-15	1.178E+03	2.094E+06	2.163E+7
TE-131	2.054E+03	3.450E+07	8.489E-32	0.000E+00	0.000E+00	0.000E+00	1.036E-32	1.349E-14
TE-132	3.774E+05	4.968E+06	4.551E+07	9.325E+06	7.272E-02	1.119E+06	5.480E+06	3.111E+7
I-130	1.846E+06	6.692E+06	3.845E+08	6.758E-04	3.125E-45	8.109E-05	4.617E+08	1.371E+8
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

TABLE 3.2-4 (continue)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 3 of 3

AGE GROUP	(CHILD)	(N.A.)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)	(CHILD)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
I-131	1.624E+07	2.089E+07	4.333E+11	5.503E+09	6.448E+07	6.604E+08	5.201E+11	4.754E+10
I-132	1.935E+05	1.452E+06	5.129E+01	2.429E-57	0.000E+00	2.915E-58	7.072E+01	7.314E+03
I-133	3.848E+06	2.981E+06	3.945E+09	1.304E+02	7.299E-23	1.564E+01	4.737E+09	8.113E+08
I-134	5.069E+04	5.305E+05	3.624E-10	0.000E+00	0.000E+00	0.000E+00	4.386E-10	6.622E-03
I-135	7.918E+05	2.947E+06	8.607E+06	1.039E-14	0.000E+00	1.247E-15	1.034E+07	9.973E+06
CS-134	1.014E+06	8.007E+09	3.715E+10	1.513E+09	1.197E+10	1.816E+08	1.115E+11	2.631E+10
CS-136	1.709E+05	1.710E+08	2.773E+09	4.426E+07	8.276E+06	5.311E+06	8.344E+09	2.247E+08
CS-137	9.065E+05	1.201E+10	3.224E+10	1.334E+09	1.122E+10	1.600E+08	9.672E+10	2.392E+10
CS-138	8.399E+02	4.102E+05	5.528E-23	0.000E+00	0.000E+00	0.000E+00	1.681E-22	9.133E-11
BA-139	5.772E+04	1.194E+05	1.231E-05	0.000E+00	0.000E+00	0.000E+00	1.398E-06	2.950E+00
BA-140	1.743E+06	2.346E+07	1.171E+08	4.384E+07	3.114E+05	5.261E+06	1.406E+07	2.767E+08
BA-141	2.919+03	4.734E+04	1.894E-45	0.000E+00	0.000E+00	0.000E+00	2.273E-46	1.605E-21
BA-142	1.643E+03	5.064E+04	1.208E-79	0.000E+00	0.000E+00	0.000E+00	1.450E-80	4.105E-39
LA-140	2.257E+05	2.180E+07	1.894E+05	5.492E+02	4.596E-12	6.590E+01	2.269E+04	3.166E+07
LA-142	7.585E+04	9.117E+05	5.203E-06	0.000E+00	0.000E+00	0.000E+00	6.166E-07	2.141E+01
CE-141	5.439E+05	1.540E+07	1.361E+07	1.382E+07	6.980+05	1.658E+06	1.633E+06	4.082E+08
CE-143	1.273E+05	2.627E+06	1.488E+06	2.516E+02	1.006E-14	3.020E+01	1.787E+05	1.364E+07
CE-144	1.195E+07	8.042E+07	1.326E+08	1.893E+08	3.727E+07	2.271E+07	1.592E+07	1.039E+10
PR-143	4.329E+05	0.000E+00	7.754E+05	3.609E+07	2.738E+03	4.331E+06	9.297E+04	1.575E+08
PR-144	1.565E+03	2.112E+03	2.040E-50	0.000E+00	0.000E+00	0.000E+00	2.353E-51	3.829E-23
ND-147	3.282E+05	1.009E+07	5.712E+05	1.505E+07	6.864E+02	1.805E+06	6.846E+04	9.197E+07
W-187	9.102E+04	2.740E+06	2.420E+06	2.790E+00	5.103E-22	3.348E-01	2.886E+05	5.380E+06
NP-239	6.401E+04	1.976E+06	9.138E+04	2.232E+03	9.336E-08	2.679E+02	1.100E+04	1.357E+07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-5
PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)*

Page 1 of 3

AGE GROUP	(TEENAGER)	(N.A.)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
H-3	1.272E + 03	0.000E + 00	8.993E + 02	1.754E + 02	8.993E + 02	2.104E + 01	1.835E + 03	2.342E + 03
C-14	2.600E + 04	0.000E + 08	4.859E + 08	2.040E + 08	1.700E + 08	2.448E + 07	4.859E + 08	3.690E + 08
NA-24	1.376E + 04	1.385E + 07	4.255E + 06	1.084E - 03	6.347E - 38	1.301E - 04	5.110E + 05	2.389E + 05
P-32	1.888E + 06	0.000E + 00	3.153E + 10	3.931E + 09	1.395E + 08	4.717E + 08	3.785E + 10	1.608E + 09
CR-51	2.096E + 04	5.506E + 06	8.387E + 06	9.471E + 05	3.085E + 05	1.137E + 05	1.006E + 06	1.037E + 07
MN-54	1.984E + 06	1.625E + 09	2.875E + 07	1.436E + 07	8.240E + 06	1.723E + 06	3.450E + 06	9.320E + 08
MN-56	5.744E + 04	1.068E + 06	4.856E - 01	8.302E - 52	0.000E + 00	9.962E - 53	5.829E - 02	9.451E + 02
FE-55	1.240E + 05	0.000E + 00	4.454E + 07	2.362E + 08	1.463E + 07	2.859E + 07	5.790E + 05	3.259E + 08
FE-59	1.528E + 06	3.204E + 08	2.861E + 08	1.171E + 09	2.470E + 07	1.405E + 08	3.720E + 06	9.895E + 08
CO-58	1.344E + 06	4.464E + 08	1.095E + 08	1.942E + 08	1.596E + 07	2.330E + 07	1.313E + 07	6.034E + 08
CO-60	8.770E + 06	2.532E + 10	3.621E + 08	7.600E + 08	1.227E + 08	9.120E + 07	4.345E + 07	3.238E + 09
NI-63	5.800E + 05	0.000E + 00	1.182E + 10	1.519E + 10	4.130E + 09	1.823E + 09	1.419E + 09	1.606E + 10
NI-65	3.672E + 04	3.451E + 05	4.692E + 00	1.305E - 51	0.000E + 00	1.566E - 52	5.647E - 01	3.966E + 02
CU-64	6.144E + 04	6.876E + 05	3.293E + 06	1.713E - 05	6.863E - 46	2.072E - 06	3.673E + 05	6.465E + 05
ZN-65	1.240E + 06	8.583E + 08	7.315E + 09	8.686E + 08	1.983E + 09	1.043E + 08	8.779E + 08	1.471E + 09
ZN-69	1.584E + 03	0.000E + 00	1.760E - 11	0.000E + 00	0.000E + 00	0.000E + 00	1.635E - 12	2.067E - 05
BR-83	3.440E + 02	7.079E + 03	1.790E - 01	5.066E - 57	0.000E + 00	6.079E - 58	2.112E - 02	2.911E + 00
BR-84	4.328E + 02	2.363E + 05	2.877E - 23	0.000E + 00	0.000E + 00	0.000E + 00	3.429E - 24	2.251E - 11
BR-85	1.832E + 01	0.000E + 00	0.000E + 00	0.000E + 00	0.000E + 00	0.000E + 00	0.000E + 00	0.000E + 00
RB-86	1.904E + 05	1.035E + 07	4.746E + 09	4.101E + 08	6.006E + 07	4.921E + 07	5.675E + 08	2.772E + 08
RB-88	5.456E + 02	3.779E + 04	3.886E - 45	0.000E + 00	0.000E + 00	0.000E + 00	4.777E - 46	3.168E - 22
RB-89	3.520E + 02	1.452E + 05	7.957E - 53	0.000E + 00	0.000E + 00	0.000E + 00	9.454E - 54	1.247E - 26
SR-89	2.416E + 06	2.509E + 04	2.674E + 09	2.545E + 08	2.719E + 08	3.054E + 07	5.617E + 09	1.513E + 10
SR-90	1.080E + 08	0.000E + 00	6.612E + 10	8.049E + 09	2.301E + 10	9.659E + 08	1.389E + 11	7.507E + 11
SR-91	2.592E + 08	2.511E + 06	2.409E + 05	5.794E - 10	0.000E + 00	6.953E - 11	5.064E + 05	1.291E + 06
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

*See note, page 3.0-36

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-5 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 2 of 3

AGE GROUP	(TEENAGER)	(N.A.)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
SR - 92	1.192E + 05	8.631E + 05	2.277E + 01	2.516E - 48	0.000E + 00	3.019E - 49	4.795E + 01	1.012E + 04
Y - 90	5.592E + 05	5.308E + 03	1.074E + 06	7.470E + 05	2.666E - 05	8.965E + 04	1.289E + 05	1.025E + 08
Y - 91M	3.200E + 03	1.161E + 05	5.129E - 18	0.000E + 00	0.000E + 00	0.000E + 00	6.260E - 19	2.285E - 07
Y - 91	2.936E + 06	1.207E + 06	6.147E + 06	3.910E + 08	7.797E + 05	4.691E + 07	7.780E + 05	3.212E + 09
Y - 92	1.648E + 05	2.142E + 05	2.828E + 00	3.522E - 35	0.000E + 00	4.226E - 36	3.402E - 01	2.360E + 04
Y - 93	5.792E + 05	2.534E + 05	1.312E + 04	1.688E - 07	7.620E - 61	2.026E - 08	1.511E + 03	4.983E + 06
ZR - 95	2.688E + 06	2.837E + 08	1.201E + 06	1.092E + 09	1.585E + 05	1.310E + 08	1.441E + 05	1.253E + 09
ZR - 97	6.304E + 05	3.44E + 06	4.225E + 04	9.231E - 01	4.732E - 35	1.108E - 01	5.073E + 03	1.673E + 07
NB - 95	7.512E + 05	1.605E + 08	3.338E + 08	4.251E + 09	1.963E + 07	5.101E + 08	4.008E + 07	4.551E + 08
MO - 99	2.688E + 05	4.626E + 06	1.023E + 08	1.892E + 05	5.013E - 03	2.270E + 04	1.228E + 07	1.293E + 07
TC - 99M	6.128E + 03	2.109E + 05	1.055E + 04	6.471E - 18	0.000E + 00	7.766E - 19	1.267E + 03	5.011E + 03
TC - 101	6.672E + 02	2.277E + 04	1.343E - 58	0.000E + 00	0.000E + 00	0.000E + 00	1.508E - 59	3.229E - 29
RU - 103	7.832E + 05	1.265E + 08	1.513E + 05	7.162E + 09	1.086E + 04	8.595E + 08	1.815E + 04	5.706E + 08
RU - 105	9.040E + 04	7.212E + 05	1.263E + 00	3.900E - 25	0.000E + 00	4.580E - 26	1.519E - 01	4.039E + 04
RU - 106	1.608E + 07	5.049E + 08	1.799E + 06	1.130E + 11	5.312E + 05	1.356E + 10	2.159E + 05	1.484E + 10
AG - 110M	6.752E + 06	4.019E + 09	2.559E + 10	1.345E + 09	6.982E + 09	1.614E + 08	3.071E + 09	4.031E + 09
TE - 125M	5.360 + 05	2.128E + 06	8.863E + 07	8.941E + 08	1.058E + 07	1.073E + 08	1.064E + 07	4.375E + 08
TE - 127M	1.656E + 06	1.083E + 05	3.420E + 08	3.816E + 09	6.753E + 07	4.580E + 08	4.105E + 07	2.236E + 09
TE - 127	8.080E + 04	3.293E + 03	9.572E + 04	1.689E - 08	0.000E + 00	2.027E - 09	1.122E + 04	4.180E + 05
TE - 129M	1.976E + 06	2.312E + 07	4.602E + 08	3.966E + 09	2.500E + 07	4.759E + 08	5.528E + 07	1.514E + 09
TE - 129	3.296E + 03	3.076E + 04	2.834E - 09	0.000E + 00	0.000E + 00	0.000E + 00	3.433E - 10	3.916E - 03
TE - 131M	6.208E + 05	9.459E + 06	2.529E + 07	1.447E + 04	1.827E - 15	1.736E + 03	3.036E + 06	3.248E + 07
TE - 131	2.336E + 03	3.450E + 07	2.879E - 32	0.000E + 00	0.000E + 00	0.000E + 00	3.515E - 33	6.099E - 15
TE - 132	4.632E + 05	4.968E + 06	8.581E + 07	2.300E + 07	1.371E - 01	2.760E + 06	1.033E + 07	7.818E + 07
I - 130	1.488E + 05	6.692E + 06	1.742E + 08	4.005E - 04	1.416E - 45	4.806E - 05	2.092E + 08	8.276E + 07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

TABLE 3.2-5 (continued)

PATHWAY DOSE FACTORS FOR SECTION 3.2 3.3 (R_i)

Page 3 of 3

AGE GROUP	(TEENAGER)	(N.A.)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)	(TEENAGER)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
I-131	1.464E+07	2.089E+07	2.195E+11	3.645E+09	3.266E+07	4.375E+08	2.634E+11	3.140E+10
I-132	1.512E+05	1.452E+06	2.242E+01	1.389E-57	0.000E+00	1.667E-58	3.092E+01	4.262E+03
I-133	2.920E+06	2.981E+06	1.674E+09	7.234E+01	3.096E-23	8.680E+00	2.009E+09	4.587E+08
I-134	3.952E+04	5.305E+05	1.583E-10	0.000E+00	0.000E+00	0.000E+00	1.915E-10	3.854E-03
I-135	6.208E+05	2.947E+06	3.777E+06	5.963E-15	0.000E+00	7.156E-16	4.538E+06	5.832E+06
CS-134	1.128E+06	8.007E+09	2.310E+10	1.231E+09	7.443E+09	1.477E+08	6.931E+10	1.671E+10
CS-136	1.936E+05	1.710E+08	1.759E+09	3.671E+07	5.249E+06	4.405E+06	5.292E+09	1.708E+08
CS-137	8.480E+05	1.201E+10	1.781E+10	9.634E+08	6.197E+09	1.156E+08	5.342E+10	1.348E+10
CS-138	8.560E+02	4.102E+05	3.149E-23	0.000E+00	0.000E+00	0.000E+10	9.576E-23	6.935E-11
BA-139	6.464E+03	1.194E+05	7.741E-07	0.000E+00	0.000E+00	0.000E+00	8.794E-08	2.403E-01
BA-140	2.032E+06	2.346E+07	7.483E+07	3.663E+07	1.990E+05	4.396E+06	8.981E+06	2.130E+08
BA-141	3.288E+03	4.734E+04	7.703E-46	0.000E+00	0.000E+00	0.000E+00	9.244E-47	8.699E-22
BA-142	1.912E+03	5.064E+04	5.010E-80	0.000E+00	0.000E+00	0.000E+00	6.012E-81	5.613E-39
LA-140	4.872E+05	2.180E+07	2.291E+05	8.689E+02	5.560E-12	1.043E+02	2.745E+04	5.104E+07
LA-142	1.200E+04	9.117E+05	4.611E-07	0.000E+00	0.000E+00	0.000E+00	5.465E-08	2.529E+00
CE-141	6.136E+05	1.540E+07	1.696E+07	2.252E+07	8.700E+05	2.703E+06	2.036E+06	5.404E+08
CE-143	2.552E+05	2.627E+06	1.671E+06	3.695E+02	1.130E-14	4.434E+01	2.006E+05	2.040E+07
CE-144	1.336E+07	8.042E+07	1.655E+08	3.089E+08	4.650E+07	3.706E+07	1.986E+07	1.326E+10
PR-143	4.832E+05	0.000E+00	9.553E+05	5.817E+07	3.374E+03	6.980E+06	1.146E+05	2.310E+08
PR-144	1.752E+03	2.112E+03	1.238E-53	0.000E+00	0.000E+00	0.000E+00	1.331E-54	3.097E-26
ND-147	3.720E+05	1.009E+07	7.116E+05	2.453E+07	8.552E+02	2.942E+06	8.530E+04	1.424E+08
W-187	1.768E+05	2.740E+06	2.646E+06	3.989E+00	5.579E-22	4.787E-01	3.155E+05	7.839E+06
NP-239	1.320E+05	1.976E+06	1.060E+05	3.387E+03	1.083E-07	4.064E+02	1.276E+04	2.097E+07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

3.0-32

TABLE 3.2-6

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)*

Page 1 of 3

AGE GROUP	(ADULT)	(N.A.)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)
ISOTOPE	INHALATION	GROUND PLANE	GRS-COW MILK	GRS-COW MEAT	GRS-COW MILK	GRS-GOT MEAT	GRS-GOT MILK	VEGETATION
H-3	1.264E+03	0.000E+00	6.904E+02	2.940E+02	6.904E+02	3.528E+01	1.408E+03	2.845E+03
C-14	1.816E+04	0.000E+00	2.624E+08	2.414E+08	9.219E+07	2.897E+07	2.634E+08	2.276E+08
NA-24	1.024E+04	1.385E+07	2.438E+06	1.356E-03	3.636E-38	1.628E-04	2.926E+05	2.690E+05
P-32	1.320E+06	0.000E+00	1.709E+10	4.651E+09	7.559E+07	5.582E+08	2.052E+10	1.403E+09
CR-51	1.440E+04	5.506E+06	7.187E+06	1.772E+06	2.644E+05	2.127E+05	8.624E+05	1.168E+07
MN-54	1.400E+06	1.625E+09	2.578E+07	2.812E+07	7.389E+06	3.375E+06	3.091E+06	9.585E+08
MN-56	2.024E+04	1.068E+06	1.328E-01	4.958E-52	0.000E+00	5.949E-53	1.594E-02	5.082E+02
FE-55	7.208E+04	0.000E+00	2.511E+07	2.933E+08	8.250E+06	3.519E+07	3.265E+05	2.096E+08
FE-59	1.016E+06	3.204E+08	2.327E+08	2.080E+09	2.009E+07	2.495E+08	3.024E+06	9.875E+08
CO-58	9.280E+05	4.464E+08	9.565E+07	3.703E+08	1.394E+07	4.443E+07	1.147E+07	6.252E+08
CO-60	5.968E+06	2.532E+10	3.082E+08	1.413E+09	1.044E+08	1.695E+08	3.7E+06	3.139E+09
NI-63	4.320E+05	0.000E+00	6.729E+09	1.888E+10	2.351E+09	2.266E+09	8.075E+08	1.040E+10
NI-65	1.232E+04	3.451E+05	1.219E+00	7.405E-52	0.000E+00	8.886E-53	1.464E-01	2.026E+02
CU-64	4.896E+04	6.876E+05	2.031E+06	2.307E-05	4.233E-46	2.769E-06	2.415E+05	7.841E+05
ZN-65	8.640E+05	8.583E+08	3.798E+09	1.132E+09	1.183E+09	1.358E+08	4.588E+08	1.009E+09
ZN-69	9.203E+02	0.000E+00	4.031E-12	0.000E+00	0.000E+00	0.000E+00	4.837E-13	1.202E-05
BR-83	2.408E+02	7.079E+03	1.399E-01	8.648E-57	0.000E+00	1.038E-57	1.698E-02	4.475E+00
BR-84	3.128E+02	2.363E+05	1.69E-23	0.000E+00	0.000E+00	0.000E+00	2.029E-24	2.475E-11
BR-85	1.280E+01	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00	0.000E+00
RB-86	1.352E+05	1.027E+07	2.595E+09	4.870E+00	3.201E+07	5.845E+07	3.113E+08	2.194E+08
RB-88	3.872E+02	3.779E+04	2.139E-45	0.000E+00	0.000E+00	0.000E+00	2.573E-46	3.428E-22
RB-89	2.560E+02	1.476E+05	4.496E-53	0.000E+00	0.000E+00	0.000E+00	5.396E-54	3.961E-26
SR-89	1.400E+06	2.509E+04	1.451E+09	3.014E+08	1.475E+08	3.617E+07	3.046E+09	9.961E+09
SR-90	9.920E+07	0.000E+00	4.680E+10	1.244E+10	1.628E+10	1.493E+09	9.828E+10	6.846E+11
SR-91	1.912E+05	2.511E+06	1.377E+05	7.233E-10	0.000E+00	8.680E-11	2.872E+05	1.451E+06
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

*See note, page 3.0-36

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

TABLE 3.2-6 (continued)
 PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 2 of 3

AGE GROUP	(ADULT)	(N.A.)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)
ISOTOPE	INHALATION	GROUND PLANE	GRS COW MILK	GRS COW MEAT	GRS COW MILK	GRS-GOT MEAT	GRS-GOT MILK	VEGETATION
SR-92	4.304E+04	8.631E+05	9.675E+00	2.334E-48	0.000E+00	2.801E-49	2.05E+01	8.452E+03
Y-90	5.056E+05	5.308E+03	7.511E+05	1.141E+06	1.865E-05	1.369E+05	9.028E+04	1.410E+08
Y-91M	1.920E+03	1.161E+05	1.883E-19	0.000E+00	0.000E+00	0.000E+00	2.262E-20	1.527E-08
Y-91	1.704E+06	1.207E+06	4.726E+06	6.231E+08	5.691E+05	7.477E+07	5.672E+05	2.814E+09
Y-92	7.352E+04	2.142E+05	9.772E-01	2.657E-35	0.000E+00	3.188E-36	1.17E-01	1.603E+04
Y-93	4.216E+05	2.534E+05	7.091E+03	2.075E-07	4.290E-61	2.490E-08	8.43E+02	5.517E+06
ZR-95	1.768E+06	2.837E+08	9.587E+05	1.903E+09	1.265E+05	2.284E+08	1.151E+05	1.194E+09
ZR-97	5.232E+05	3.445E+06	2.707E+04	1.292E+00	3.032E-35	1.550E-01	3.24E+03	2.108E+07
NB-95	5.048E+05	1.605E+08	2.787E+08	7.748E+09	1.639E+07	9.297+08	3.344E+07	4.798+08
MO-99	2.480E+05	4.626E+06	5.741E+07	2.318E+05	2.813E-03	2.781E+04	6.878E+06	1.426E+07
TC-99M	4.160E+03	2.109E+05	5.553E+03	7.439E-18	0.000E+00	8.927E-19	6.641E+02	5.187E+03
TC-101	3.992E+02	2.277E+04	7.406E-59	0.000E+00	0.000E+00	0.000E+00	8.888E-60	3.502E-29
RU-103	5.048E+05	1.265E+08	1.189E+05	1.229E+10	8.537E+03	1.475E+09	1.426E+04	5.577E+08
RU-105	4.816E+04	7.212E+05	5.240E-01	3.533E-25	0.000E+00	4.239E-26	6.245E-02	3.294E+04
RU-106	9.360E+06	5.049E+08	1.320E+06	1.811E+11	3.898E+05	2.173E+10	1.584E+05	1.247E+10
AG-110M	4.632E+06	4.019E+09	2.198E+10	2.523E+09	5.996E+09	3.028E+08	2.638E+09	3.979E+09
TE-125M	3.136E+05	2.128E+06	6.626E+07	1.460E+09	7.906E+06	1.751E+08	7.955E+06	3.927E+08
TE-127M	9.600E+05	1.083E+05	1.860E+08	4.531E+09	3.671E+07	5.437E+08	2.223E+07	1.418E+09
TE-127	5.736E+04	3.293E+03	5.278E+04	2.034E-08	0.000E+00	2.441E-09	6.172E+03	4.532E+09
TE-129M	1.160E+06	2.312E+07	3.028E+08	5.698E+09	1.645E+07	6.838E+08	3.636E+07	1.261E+09
TE-129	1.936E+03	3.076E+04	1.183E-09	0.000E+00	0.000E+00	0.000E+00	1.42E-10	2.80E-03
TE-131M	5.560E+05	9.459E+06	1.753E+07	2.190E+04	1.266E-15	2.628E+03	2.102E+06	4.426E+07
TE-131	1.392E+03	3.450E+07	1.578E-32	0.000E+00	0.000E+00	0.000E+00	1.927E-33	6.575E-15
TE-132	5.096E+05	4.968E+06	7.356E+07	4.287E+07	1.170E-01	5.144E-06	8.827E+06	1.312E+08
I-130	1.136E+06	6.692E+06	1.050E+08	5.272E-04	8.535E-46	6.326E-05	1.254E+08	9.809+07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$

Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

TABLE 3.2-6 (continued)

PATHWAY DOSE FACTORS FOR SECTION 3.2.3.3 (R_i)

Page 3 of 3

AGE GROUP	(ADULT)	(N.A.)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)	(ADULT)
ISOTOPE	INHALATION	GROUND PLANE	GRS-COW MILK	GRS COW MEAT	GRS COW MILK	GRS GOT MEAT	GRS GOT MILK	VEGETATION
I-131	1.192E+07	2.089E+07	1.388E+11	5.034E+09	2.065E+07	6.040E+08	1.665E+11	3.785E+10
I-132	1.144E+05	1.452E+06	1.541E+01	1.816E-57	0.000E+00	2.179E-58	1.849E+01	5.016E+03
I-133	2.152E+06	2.981E+06	9.891E+08	9.336E+01	1.830E-23	1.120E+01	1.189E+09	5.331E+08
I-134	2.984E+04	5.305E+05	8.886E-11	0.000E+00	0.000E+00	0.000E+00	1.066E-10	4.563E-03
I-135	4.480E+05	2.947E+06	2.217E+06	7.644E-15	0.000E+00	9.172E-16	2.676E+06	6.731E+06
CS-134	8.480E+05	8.007E+09	1.345E+10	1.565E+09	4.333E+09	1.878E+08	4.035E+10	1.110E+10
CS-136	1.464E+05	1.710E+08	1.039E+09	4.724E+07	3.093E+06	5.669E+06	3.117E+09	1.675E+08
CS-137	6.208E+05	1.201E+10	1.010E+10	1.193E+09	3.513E+09	1.431E+08	3.03E+10	8.696E+09
CS-138	6.208E+02	4.102E+05	1.786E-23	0.000E+00	0.000E+00	0.000E+00	5.146E-23	7.730E-11
BA-139	3.760E+03	1.194E+05	7.863E-08	0.000E+00	0.000E+00	0.000E+00	9.435E-09	5.225E-02
BA-140	1.272E+06	2.346E+07	5.535E+07	5.917E+07	1.472E+05	7.100E+06	6.643E+06	2.646E+08
BA-141	1.936E+03	4.734E+04	4.327E-46	0.000E+00	0.000E+00	0.000E+00	5.193E-47	9.463E-22
BA-142	1.192E+03	5.064E+04	2.509E-80	0.000E+00	0.000E+00	0.000E+00	3.011E-81	2.463E-39
LA-140	4.584E+05	2.180E+07	1.672E+05	1.385E+03	4.059E-12	1.662E+02	2.006E+04	7.319E+07
LA-142	6.328E+03	9.117E+05	6.273E-08	0.000E+00	0.000E+00	0.000E+00	7.531E-09	6.768E-01
CE-141	3.616E+05	1.540E+07	1.25E+07	3.632E+07	6.424E+05	4.358E+06	1.503E+06	5.097E+08
CE-143	2.264E+05	2.627E+06	1.15E+06	5.547E+02	7.768E-15	6.656E+01	1.38E+05	2.758E+07
CE-144	7.776E+06	8.042E+07	1.21E+08	4.928E+08	3.398E+07	5.914E+07	1.451E+07	1.112E+10
PR-143	2.808E+05	0.000E+00	6.918E+05	9.204E+07	2.445E+03	1.104E+07	8.297E+04	2.748E+08
PR-144	1.016E+03	2.112E+03	6.716E-54	0.000E+00	0.000E+00	0.000E+00	7.745E-55	3.303E-26
ND-147	2.208E+05	1.009E+07	5.231E+05	3.935E+07	6.286E+02	4.722E+06	6.273E+04	1.853E+08
W-187	1.552E+05	2.740E+06	1.796E+06	5.912E+00	3.787E-22	7.094E-01	2.14E+05	1.046E+07
NP-239	1.192E+05	1.976E+06	7.409E+04	5.152E+03	7.545E-08	6.182E+02	8.876E+03	2.872E+07
			(PASTURE)	(PASTURE)	(FEED)	(PASTURE)	(PASTURE)	

Units -

Inhalation and all tritium - mrem/yr per $\mu\text{Ci}/\text{m}^3$ Other pathways for all other radionuclides - $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$

ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

3.0-35

NOTE: The R_i values of Table 3.2-2 through 3.2-6 were calculated in accordance with the methods of Section 5.3.1 of Reference 1. Columns in those tables marked "Pasture" are for freely-grazing animals ($f_p = f_s = 1$). Columns marked "Feed" are for animals fed solely locally-grown stored feed ($f_p = f_s = 0$). The values used for each parameter and the origins of the values are given in Table 3.2-9 and its notes.

Table 3.2-7

CONTROLLING RECEPTORS, LOCATIONS, AND PATHWAYS*

<u>SECTOR</u>	<u>DISTANCE (METERS)</u>	<u>PATHWAY</u>	<u>AGE GROUP</u>	<u>ORIGIN (FOR INFORMATION ONLY)</u>
N**	6,100	Vegetation	Child	-Vegetable Garden
NNE**	5,300	Vegetation	Child	-Vegetable Garden
NE	4,500	Vegetation	Child	-Vegetable Garden
	4,500	Grass/Cow/Meat	Child	Grazing Beef Cattle
ENE	2,600	Vegetation	Child	-Vegetable Garden
	2,600	Grass/Cow/Meat	Child	Grazing Beef Cattle
E	1,800	Vegetation	Child	-Vegetable Garden
ESE	1,800	Vegetation	Child	-Vegetable Garden
SE	2,400	Vegetation	Child	-Vegetable Garden
SSE	4,300	Vegetation	Child	-Vegetable Garden
S**	6,300	Vegetation	Child	-Vegetable Garden
SSW**	5,500	Vegetation	Child	-Vegetable Garden
SW**	5,300	Vegetation	Child	-Vegetable Garden
WSW	3,100	Grass/Cow/Meat	Child	-Grazing Beef Cattle
W	4,300	Vegetation	Child	-Vegetable Garden
	3,500	Grass/Cow/Meat	Child	Grazing Beef Cattle
WNW**	7,700	Vegetation	Child	-Vegetable Garden
NW**	6,600	Vegetation	Child	-Vegetable Garden
	6,600	Grass/Cow/Meat	Child	Grazing Beef Cattle
NNW	4,800	Vegetation	Child	-Vegetable Garden
	4,800	Grass/Cow/Meat	Child	Grazing Beef Cattle

* See note on the following page for the method used to identify these controlling receptors.

** If a cow were located at 5.0 miles (8,000 meters) in this sector, an infant consuming only its milk would receive a greater total radiation dose than would the real receptor listed. However, such an infant would not be the Maximum Exposed Individual for the site.

NOTE: The controlling receptor in each sector was identified in the following way. Receptor locations and associated pathways were obtained from the August 1991 field survey. A child was assumed at each location, except that where a milk cow was listed, an infant was assumed. X/Q' and D/Q' for each candidate receptor was calculated using five year average meteorological data. XOQDOQ-82 software was used to analyze the meteorological data. Expected annual releases of each nuclide were taken from Table 5.2-2 of Reference 5. The specific dispersion values for each candidate are used with the methodology of ODCM section 3.2.3.2 to calculate a hypothetical dose. The controlling receptor for each sector was then chosen as the candidate receptor with the highest total annual dose of any candidate receptor in the given sector. All listed pathways are in addition to inhalation and ground plane exposure.

Table 3.2-8

ATMOSPHERIC DISPERSION PARAMETERS
FOR CONTROLLING RECEPTOR LOCATIONS*

<u>SECTOR</u>	<u>X/Q'</u>	<u>D/Q'</u>	<u>DISTANCE (MILES/METERS)</u>
N	2.3 E-7	6.3 E-10	3.8 / 6,100
NNE	2.9 E-7	8.5 E-10	3.3 / 5,300
NE	5.4 E-7	1.5 E-9	2.8 / 4,500
ENE	1.8 E-6	5.4 E-9	1.6 / 2,600
E	3.5 E-6	1.1 E-8	1.1 / 1,800
ESE	2.1 E-6	6.8 E-9	1.1 / 1,800
SE	6.5 E-7	2.4 E-9	1.5 / 2,400
SSE	1.2 E-7	5.3 E-10	2.7 / 4,300
S	7.6 E-8	3.5 E-10	3.9 / 6,300
SSW	1.2 E-7	7.0 E-10	3.4 / 5,500
SW	1.3 E-7	9.6 E-10	3.3 / 5,300
WSW	3.6 E-7	2.5 E-9	1.9 / 3,100
W	1.8 E-7	7.7 E-10	2.7 / 4,300
W	2.8 E-7	1.3 E-9	2.2 / 3,500
WNW	3.8 E-8	1.3 E-10	4.8 / 7,700
NW	9.8 E-8	2.8 E-10	4.1 / 6,600
NNW	3.3 E-7	9.0 E-10	3.0 / 4,800

* Annual average relative dispersion and deposition values for the receptor locations in Table 3.2-7. Values were calculated from 5 year averaged meteorological data using the XOQDOQ-82 software. Dispersion values were calculated assuming ground-level release, open terrain recirculation, dry depletion, and using decay with a half-life of 8.0 days. As a result of the analysis described in the note to Table 3.2-7, the location of the maximum exposed individual for the site is assumed to be the vegetable garden at 1.1 miles in the E sector. Therefore, the site X/Q' and D/Q' (Section 3.2.3.2 and following) are those from this table for that location.

Table 3.2-9
Page 1 of 4
PARAMETERS USED IN DOSE FACTOR CALCULATIONS

<u>Parameter</u>	<u>Value</u>	<u>Origin of Value</u>		
		<u>Table in R.G. 1.109</u>	<u>Section of NUREG-0133</u>	<u>Site-Specific</u>
	For P_i			
DFA _i	Each radionuclide	E-9		Note 2
BR	3700 m ³ /yr	E-5		
	For Ri (Vegetation)			
r	Each element type	E-1		
Y _v	2.0 kg/m ²	E-15		
λw	5.83 E-7 sec ⁻¹		5.3.1.3	
DFL _i	Each age group and radionuclide	E-11 thru E-14		Note 2
U _a ⁴	Each age group	E-5		
f _L	1.0		5.3.1.5	
t _L	8.6 E + 4 seconds	E-15		
U _a ⁵	Each age group	E-5		
f _g	0.76		5.3.1.5	
t _h	5.18 E + 6 seconds	E-15		
H	8.84 gm/m ³			Note 1
	For Ri (Inhalation)			
BR	Each age group	E-5		
DFA _i	Each age group and nuclide	E-7 thru E-10		Note 2

PARAMETERS USED IN DOSE FACTOR CALCULATIONS

Parameter	Value	Origin of Value		
		Table in R.G. 1.109	Section of NUREG- 0133	Site- Specific
	For R_i (Ground Plane)			
SF	0.7	E-15		
DFG _i	Each radionuclide	E-6		
t	4.73 E + 8 sec		5.3.1.2	
	For R_i (Grass/Animal/Meat)			
Q_f (Cow)	50 kg/day	E-3		
Q_f (Goat)	6 kg/day	E-3		
U_{ap}	Each age group	E-5		
λ_w	5.73 E-7 sec ⁻¹		5.3.1.3	
F_i (Both)	Each element	E-1		
r	Each element type	E-15		
DFL _i	Each age group and nuclide	E-11 thru E-14		Note 2
f_p	1.0			Note 3
f_s	1.0			Note 3
Y_p	0.7 kg/m ³	E-15		
t_h	7.78 E + 6 sec	E-15		
Y_s	2.0 kg/m ²	E-15		
t_f	1.73 E + 6 sec	E-15		
H	8.84 gm/l.			Note 1

Table 3.2-9

Page 3 of 4

PARAMETERS USED IN DOSE FACTOR CALCULATIONS

<u>Parameter</u>	<u>Value</u>	<u>Origin of Value</u>		
		<u>Table in R.G. 1.109</u>	<u>Section of NUREG- 0133</u>	<u>Site- Specific</u>
	For R _i (Grass/Animal/Milk)			Note 4
Q _F (Cow)	50 kg/day	E-3		
Q _F (Goat)	6 kg/day	E-3		
U _{ap}	Each age group	E-5		
λ _w	5.73 E-7 sec ⁻¹		5.3.1.3	
F _m	Each element	E-1 & E-2		
r	Each element type	E-15		
DFL _i	Each age group and nuclide	E-11 thru E-14		Note 2
Y _p	0.7 kg/m ²	E-15		
t _h	7.78 E + 6 sec	E-15		
Y _s	2.0 kg/m ²	E-15		
t _f	1.73 E + 5 sec	E-15		
f _p	1.0			Note 5
f _s	1.0			Note 5
f _p	0.0			Note 5
f _s	0.0			Note 5
H	8.84 gm/m ³			Note 1

Table 3.2-9 (Continued)


Page 4 of 4

NOTES

1. Site-specific annual average absolute humidity. For each month, an average absolute humidity was calculated from the 7 years of monthly average temperatures in Table 2.3-49 of Reference 4 and the 5 years of monthly average dew points in Table 2.3-64 of Reference 4. The 12 monthly values were averaged to obtain the annual average of 8.84 gm/m³. (Section 5.2.1.3 of Reference 1 gives a default value of 8 gm/m³.)
2. Inhalation and ingestion dose factors were taken from the indicated source. For each age group, for each nuclide, the organ dose factor used was the highest dose factor for that nuclide and age group in the referenced table.
3. Typically beef cattle are raised all year on pasture. Annual land surveys have indicated that the small number of goats raised within 5 miles typically are used for grass control and not food or milk. Nevertheless, the goats were treated as full meat and milk sources where present, despite the fact that their numbers cannot sustain the meat consumption rates of Table E-5 of Reference 3.
4. According to the August 1990 land use census, dairy cattle possibly graze at 4.9 miles in the West sector. If dairy cattle graze at this location, the dose to an infant consuming milk from these animals would be less than the dose received by the critical receptor identified for the sector. No other milking activity within five miles of the plant was identified. These values are included for reference only.
5. Two columns of R_i's were calculated - one for cows kept exclusively on local pasture ($f_p = f_s = 1$), and one for cows kept exclusively on locally grown stored feed ($f_p = f_s = 0$). See the note on page 2.0-37.

GASEOUS RADWASTE TREATMENT SYSTEM

FIGURE 3.2-1

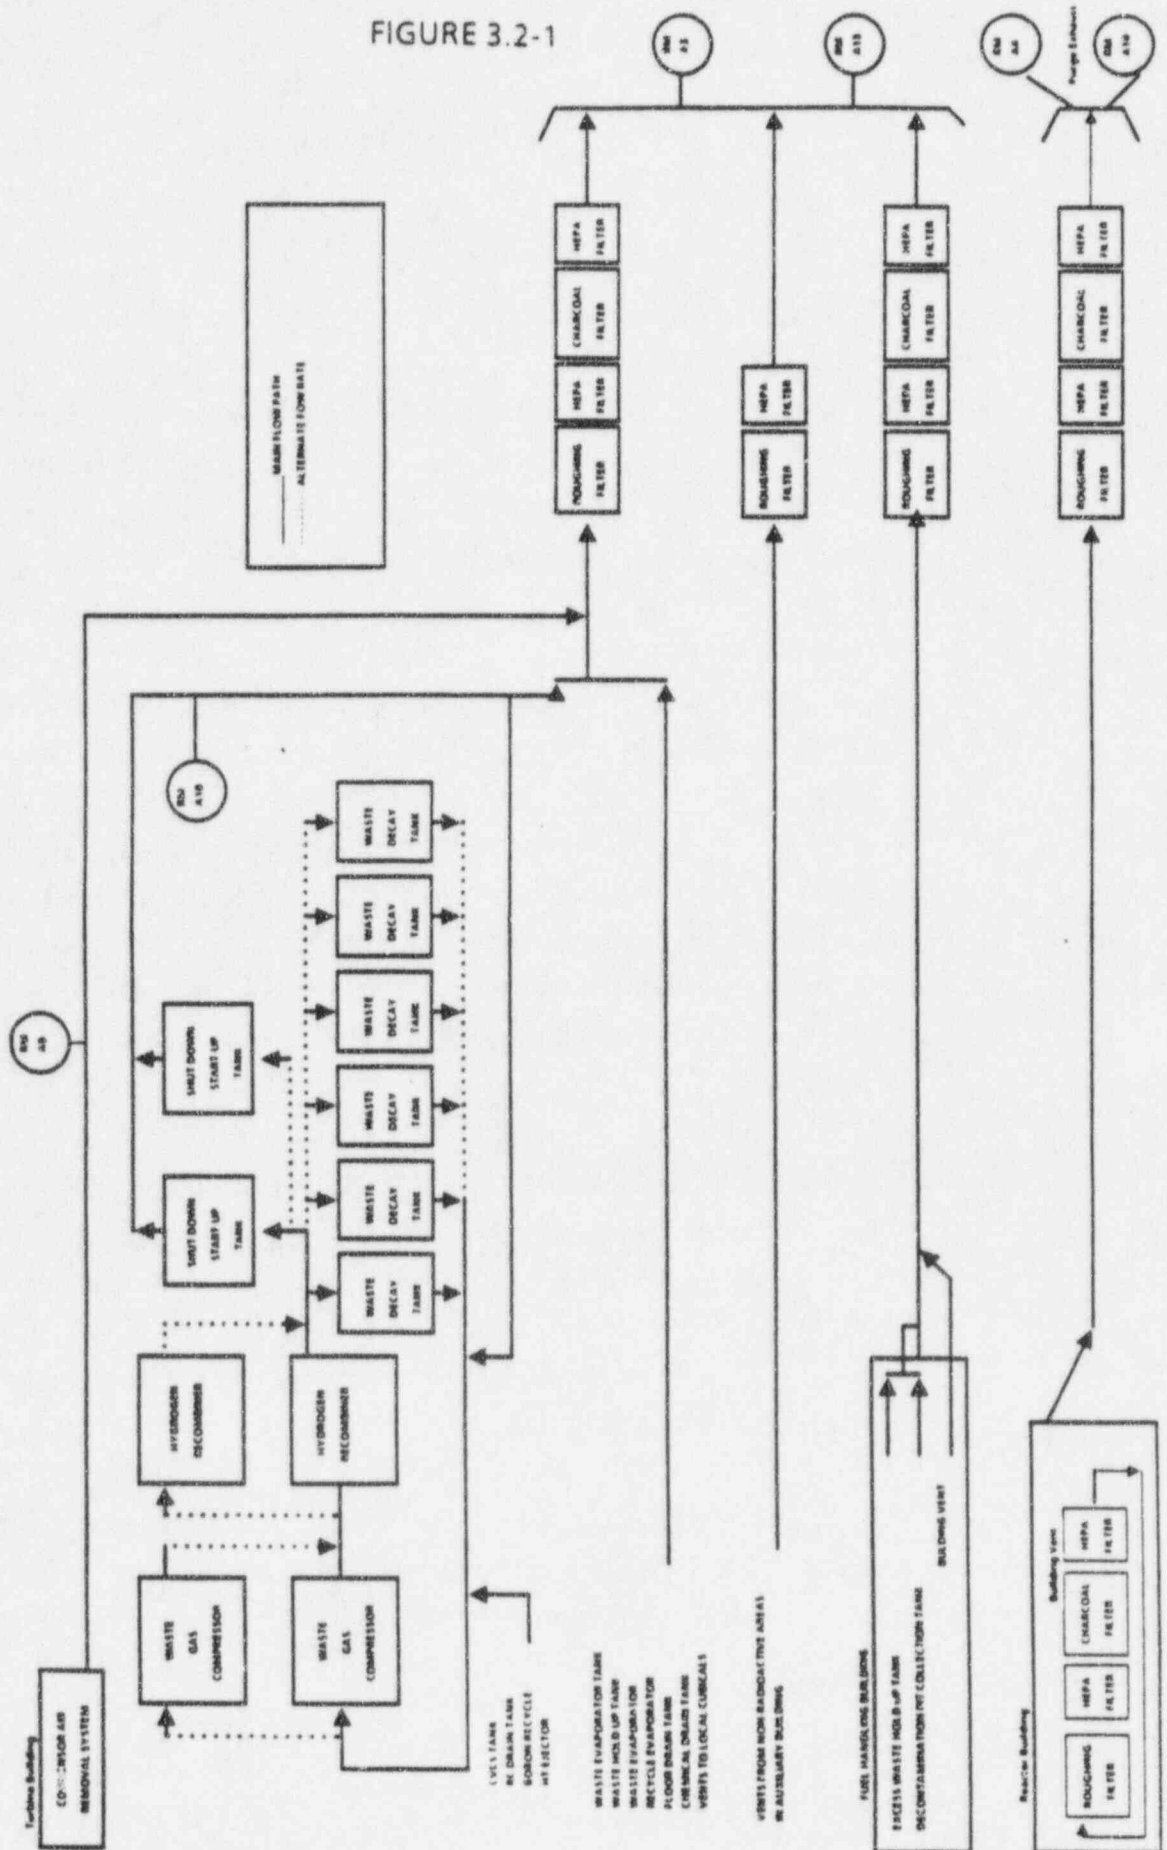

ODCM, V.C. Summer, SCE&G Revision 13 (June 1990)

3.3 Meteorological Model for Dose Calculations

3.3.1 Meteorological Model Parameters

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
b =	height of the containment building.	(3.3.2.1)
D_g =	deposition rate for ground-level releases relative to the distance from the containment building (from Figure 3.3-3).	(3.3.2.2)
D/Q =	the sector averaged relative deposition for any distance in a given sector (m^{-2}).	(3.3.2.2)
i =	wind speed class. The wind speed classes are given in Table 4A of Reference 10 as 1-3, 4-7, 8-12, 13-18, 19-24, and > 24 miles per hour.	(3.3.2.1)
N =	total hours of valid meteorological data.	(3.3.2.1)
n_{ij} =	number of hours meteorological conditions are observed to be in a given wind direction, wind speed class i, and atmospheric stability class j.	(3.3.3.1)
n =	number of hours wind is in given direction.	(3.3.2.1)
r =	distance from the containment building to the location of interest for dispersion calculations (m).	(3.3.2.1)
$\Delta T/\Delta Z$ =	temperature differential with vertical separation ($^{\circ}K/100m$).	(3.3.2.1)
T =	terrain recirculation factor, Figure 3.3-4.	(3.3.2.1)
u_i =	wind speed (midpoint of wind speed class i) at ground level (m/sec).	(3.3.2.1)
X/Q =	the sector average relative concentration at any distance in a given sector. (sec/m^3).	(3.3.2.1)
δ =	plume depletion factor at distance r from Figure 3.3-1.	(3.3.3.1)

<u>Term</u>	<u>Definition</u>	<u>Section of Initial Use</u>
σ_z	= vertical standard deviation of the plume (in meters), at distance r for ground level releases under the stability category indicated by $\Delta T/ \Delta Z$, from Figure 3.3-2.	(3.3.2.1)
2.032	= $(2/\pi)^{1/2}$ divided by the width in radians of a 22.5° sector (0.3927 radians).	(3.3.2.1)
2.55	= the inverse of the number of radians in a 22.5° sector $\frac{1}{(22.5^\circ)(0.0175 \text{ Radians}^\circ)}$	(3.3.2.2)

3.3.2 Meteorological Model

3.3.2.1 Atmospheric dispersion for routine venting or other routine gaseous effluent releases is calculated using a ground-level, wake-corrected form of the straight line flow model.

$$\begin{aligned}
 X/Q &= \text{the sector-averaged relative concentration at any distance in the given sector (sec/m}^3\text{)} \\
 &= 2.032 \delta T \sum_{ij} \frac{n_{ij}}{N r u_i \sum_{zj}} \quad (52)
 \end{aligned}$$

where:

2.032 = $(2/\pi)^{1/2}$ divided by the width in radians of a 22.5° sector (0.3927 radians).

δ = plume depletion factor at distance r for the appropriate stability class from Figure 3.3-1.

i = wind speed class. The wind speed classes are given in Table 4A of Reference 10 as 1-3, 4-7, 8-12, 13-18, 19-24, and > 24 miles per hour.

$n_{i,j}$ = number of hours meteorological conditions are observed to be in a given wind direction, wind speed class i, and atmospheric stability class j.

- N = total hours of valid meteorological data.
- r = distance from the containment building to location of interest (m)
- u_i = wind speed (midpoint of wind speed class i) at ground level (m/sec).
- \sum_z = the lesser of $(\sigma_z^2 + b^2/2\pi)^{\frac{1}{2}}$ or $(\sqrt{3} \sigma_z)$ (53)

where:

- σ_z = vertical standard deviation of the plume (in meters) at distance r for ground level releases under the stability category indicated by $\Delta T/\Delta Z$, from Figure 3.3-2.
- T = terrain recirculation factor, from Figure 3.3-4
- π = 3.1416
- b = height of the containment building (50.9m)
- $\Delta T/\Delta Z$ = temperature differential with vertical separation ($^{\circ}\text{K}/100\text{m}$).

Note: For calculation of X/Q using actual meteorological data for a particular release, u_i = the average wind speed for hour i and n_{ij} = number of hours with wind speed i and stability class j .

3.3.2.2 Relative deposition per unit area for all releases is calculated for a ground-level release.

D/Q = the sector-averaged relative deposition at any distance in a given sector (m^{-2}).

$$= \frac{2.55 D_g^n}{r N} \quad (54)$$

where,

- D_g = deposition rate for ground-level releases relative to distance (r) from the containment building (from Figure 3.3-3).

2.55 = the inverse of the number of radians in a 22.5° sector

$$\frac{1}{(22.5^\circ)(0.0175 \text{ Radians}^\circ)}$$

n = number of hours wind is in given direction (sector).

N = total hours of valid meteorological data.

FIGURE 3.3-1

Plume Depletion Effect for Ground Level Releases (δ)
(All Atmospheric Stability Classes)

Graph taken from Reference 8, Figure 2


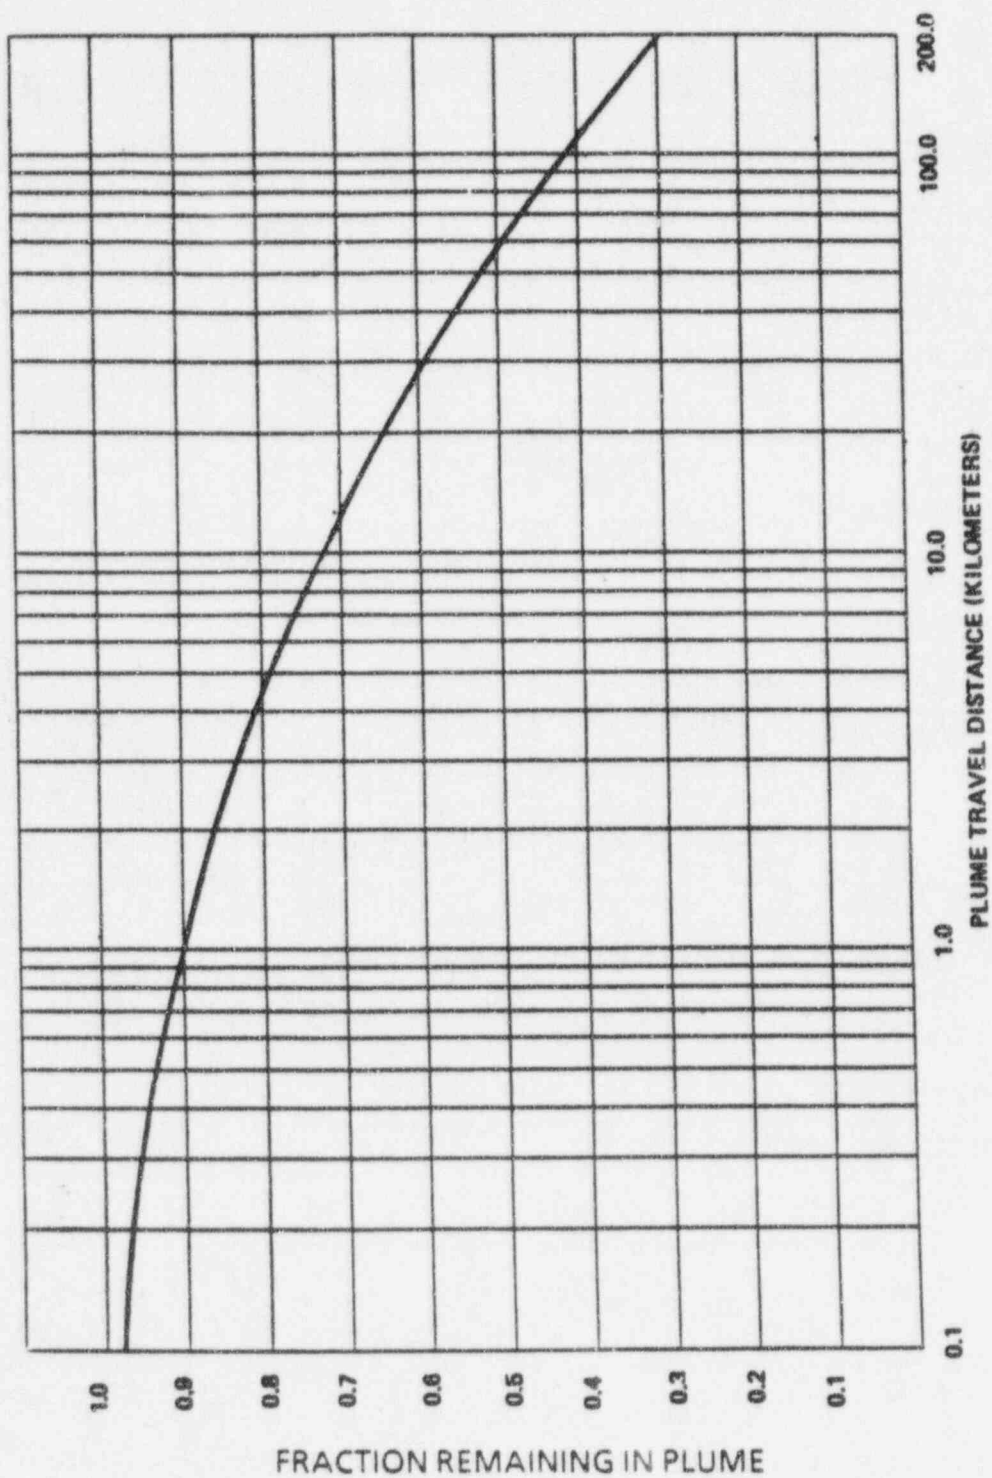


FIGURE 3.3-2

Vertical Standard Deviation of Material in a Plume (δ_z)
(Letters denote Pasquill Stability Classes)

Graph taken from Reference 8, Figure 1

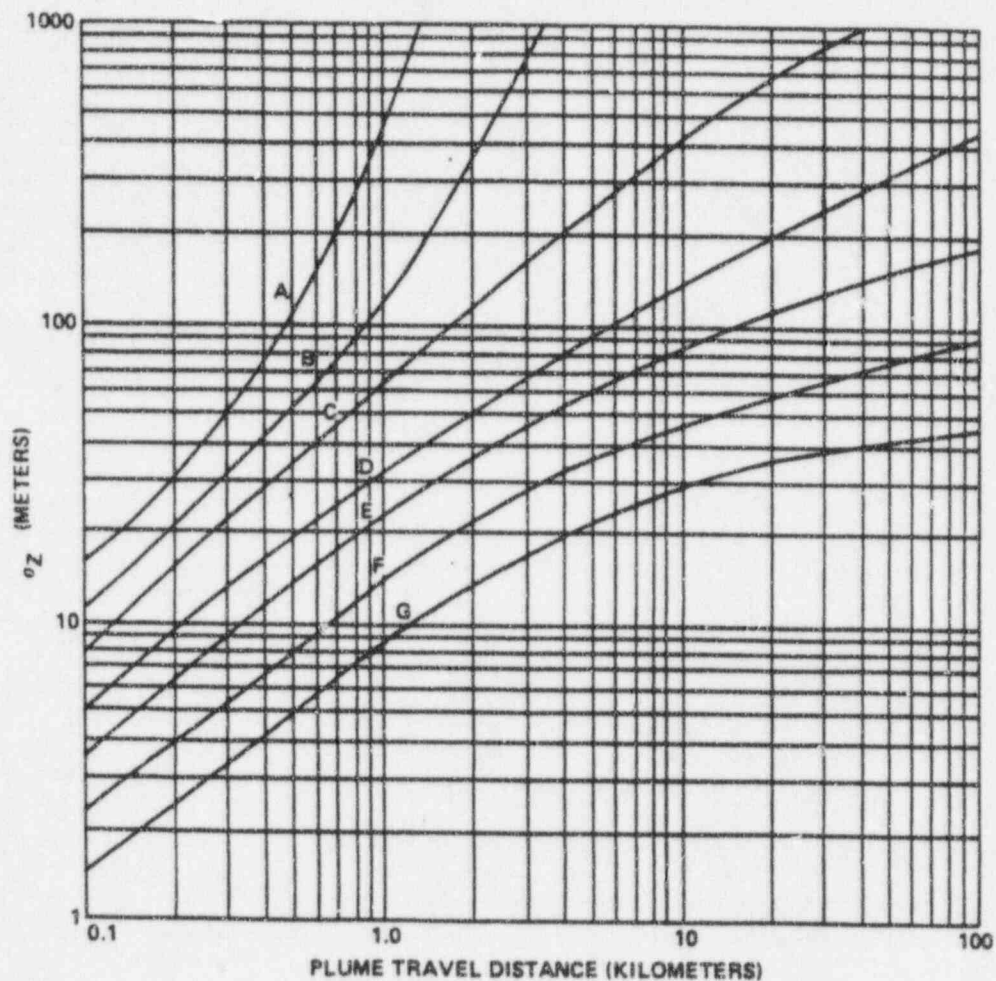

Temperature Change
with Height $\Delta T/\Delta Z$ ($^{\circ}\text{K}/100\text{m}$)

Pasquill
Categories

Stability
Classification

< -1.9

A

Extremely Unstable

-1.9 to -1.7

B

Moderately Unstable

-1.7 to -1.5

C

Slightly Unstable

-1.5 to -0.5

D

Neutral

-0.5 to 1.5

E

Slightly Stable

1.5 to 4.0

F

Moderately Stable

> 4.0


G

Extremely Stable

FIGURE 3.3-3

Relative Deposition for Ground Level Releases (D_g)
(All Atmospheric Stability Classes)

Graph taken from Reference 8, Figure 6

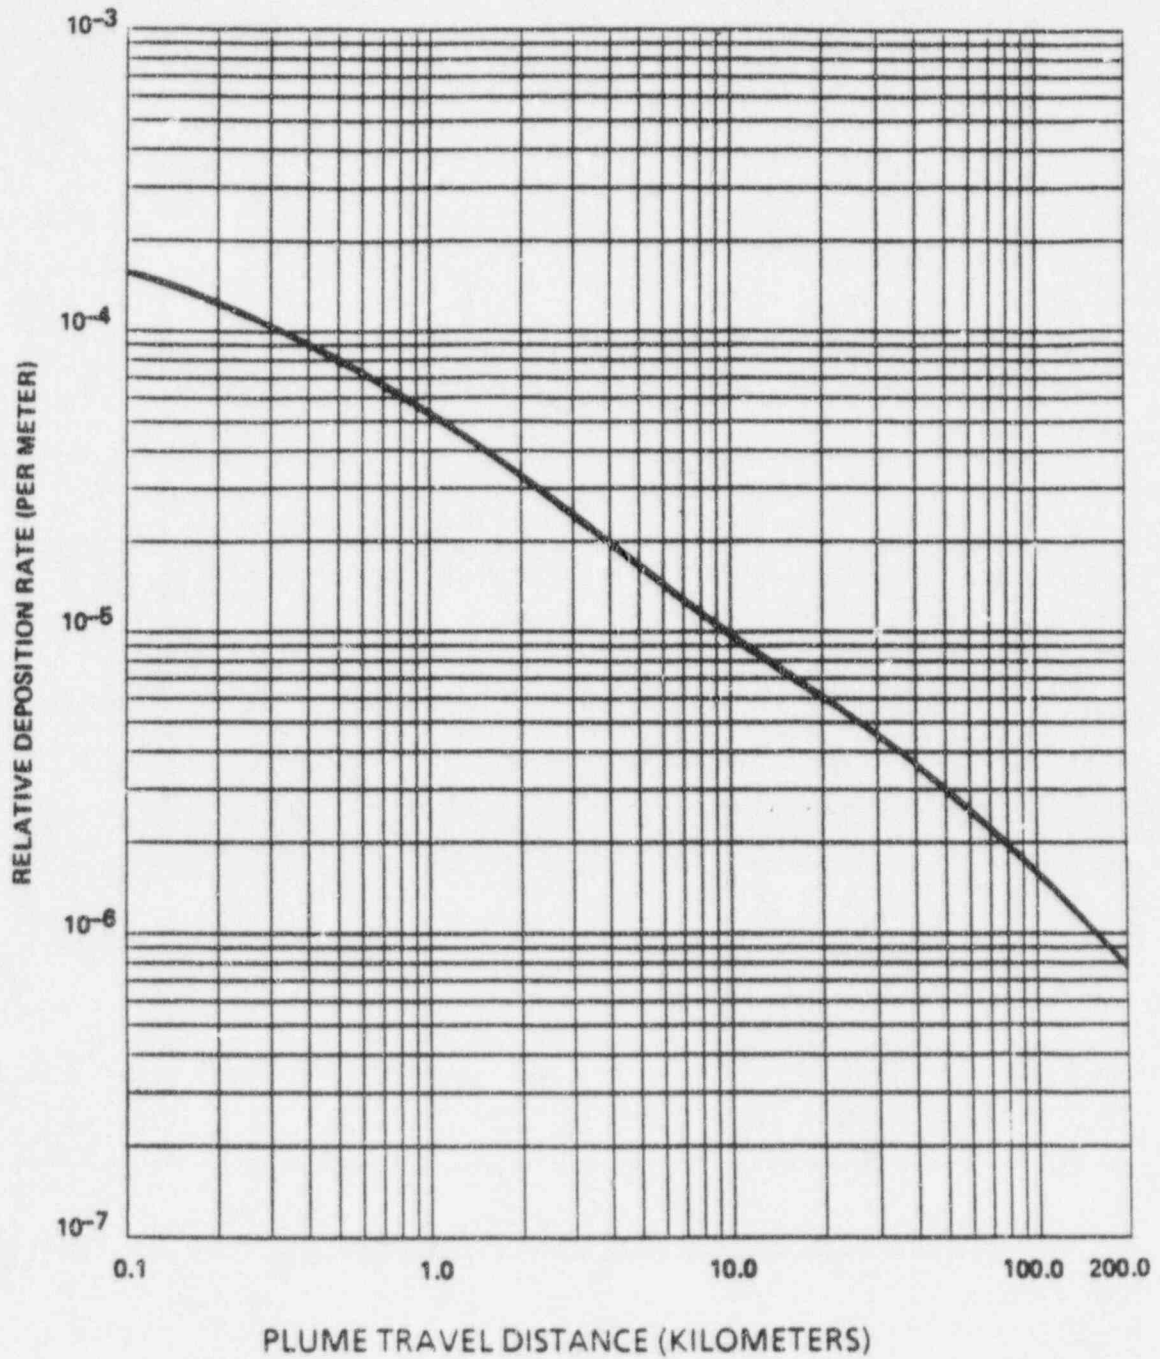


ODCM, V.C. Summer, SCE&G: Revision 13 (June 1990)

FIGURE 3.3-4

Open Terrain Recirculation Factor

Graph taken from Reference 7, Figure 2

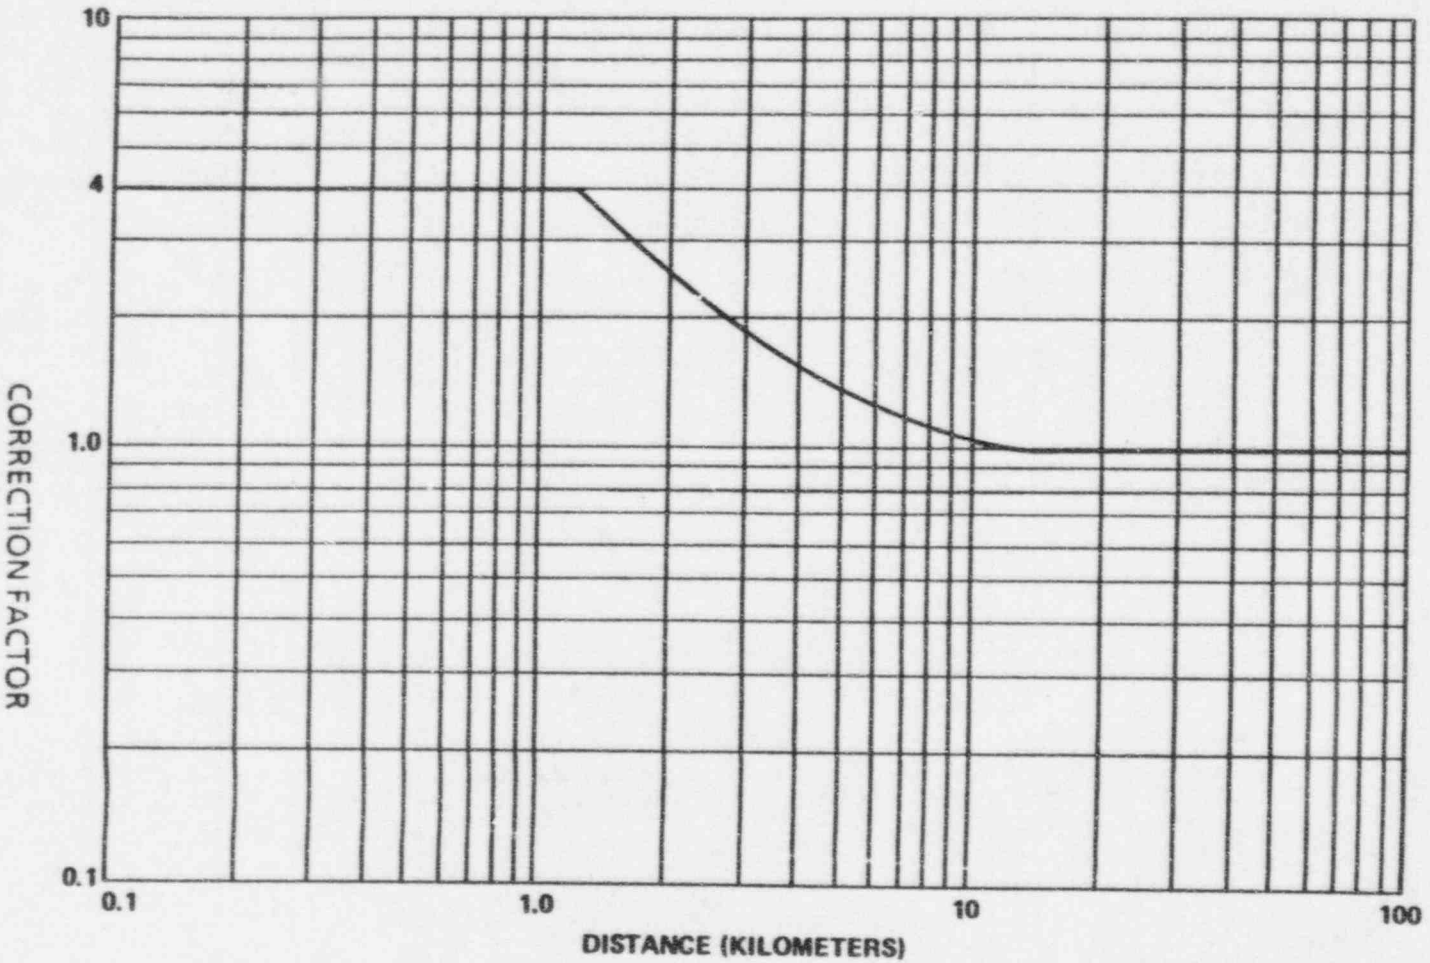

4.0 RADIOLOGICAL ENVIRONMENTAL MONITORING

Sampling locations as required in section 1.4.1 of the ODCM Specifications are described in Table 4.0-1 and shown on Figures 4.0-1 and 4.0-2. As indicated by the ditto (") marks in the table, entries in the sampling frequency and analysis frequency columns apply to all samples below the entry until a new entry appears.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
 VIRGIL C. SUMMER NUCLEAR STATION
 TABLE 4.0-1

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
AIRBORNE: I. Particulate	A) 3 Indicator samples to be taken at locations (in different sectors) beyond but as close to the exclusion boundary as practicable where the highest offsite sectorial ground level concentrations are anticipated. ² B) 1 Indicator sample to be taken in the sector beyond but as close to the exclusion boundary as practicable corresponding to the residence having the highest anticipated offsite ground level concentration or dose. ² C) 1 Indicator sample to be taken at the location of one of the dairies being sampled meeting the criteria of VII(A). ^{2,4} D) 1 Control sample to be taken at a location at least 10 air miles from the site and not in the most prevalent wind direction. ²	Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection. Continuous sampler operation with weekly collection.	2 7 30 6 N/A 17	1.1 SW 1.0E 1.0SSW 1.0 ESE N/A 25.0 SE	Gross beta following filter change; Quarterly Composite (by location) for gamma isotopic. Gross beta following filter change; Quarterly Composite (by location) for gamma isotopic Gross beta following filter change; Quarterly Composite (by location) for gamma isotopic. Gross beta following filter change; Quarterly Composite (by location) for gamma isotopic.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
 VIRGIL C. SUMMER NUCLEAR STATION
 TABLE 4.0-1

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
II. Radioiodine	A) 3 Indicator samples to be taken at two locations as given in I(A) above. B) 1 Indicator sample to be taken at the location as given in I(B) above. C) 1 Indicator sample to be taken at the location as given in I(C) above. D) 1 Control sample to be taken at a location similar in nature to I(D) above.	Continuous sampler operation with weekly canister collection. Continuous sampler operation with weekly canister collection. Continuous sampler operation with weekly canister collection. Continuous sampler operation with weekly canister collection.	2 7 30 6 N/A 17	1.1 SW 1.0E 1.0SSW 1.0ESE N/A 25.0 SE	Gamma Isotopic for I-131 weekly Gamma Isotopic for I-131 weekly Gamma Isotopic for I-131 weekly Gamma Isotopic for I-131 weekly
III. Direct	A) 13 Indicator stations to form an inner ring of stations in the 13 accessible sectors within 1 to 2 miles of the plant.	Monthly or quarterly exchange ^{5,7} ; two or more dosimeters at each location.	1,2 3,4 5,6 7,8 9,10 29 30 47	1.2 S, 1.2 SW 1.2W, 1.2 WNW 0.9 SE, 1.0 ESE 1.0 E, 1.5 ENE 2.2 NE, 2.5 NNE 1.0 WSW, 1.0 SSW 1.0 NW	Gamma dose monthly or quarterly.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
 VIRGIL C. SUMMER NUCLEAR STATION
 TABLE 4.0-1

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
	<p>B) 16 Indicator stations to form an inner ring of stations in the 16 accessible sectors within 3 to 5 miles of the plant.</p> <p>C) 11 Stations to be placed in special interest areas such as population centers, nearby residences, schools and in 4 or 5 areas to serve as controls.</p>	<p>Monthly or quarterly exchange^{5,7}; two or more dosimeters at each location.</p> <p>Monthly or quarterly exchange^{5,7}; two or more dosimeters at each location.</p>	<p>12,13 32,33 34,35 36,37 41,42 43,44 46,60 53,55</p> <p>16,17 18,19 20,31 45,52 54,56 58</p>	<p>4.2 N, 2.9 NNW 4.5 NNE, 4.2 ENE 4.8 ESE, 4.8 SE 3.1 SSE, 4.9 NW 3.9 S, 3.9 SSW 5.2 SW, 2.8 WSW 3.7 WNW, 3.5 W 3.0 NE, 2.8 E</p> <p>28.0 W, 25.0 SE 16.5 S, 21.0 SSW 22.0 NW, 6.6 NNE 5.8 WSW, 3.8 NNE 1.7 ENE, 2.0 SE 2.5 SSE</p>	<p>Gamma dose monthly or quarterly.</p> <p>Gamma dose monthly or quarterly.</p>
<p>WATERBORNE: IV. Surface Water</p>	<p>A) 1 Indicator sample downstream to be taken at a location which allows for mixing and dilution in the ultimate receiving river.</p> <p>B) 1 Control sample to be taken at a location on the receiving river, sufficiently far upstream such that no effects of pumped storage operation are anticipated.</p>	<p>Time composite samples with collection every month.⁵</p> <p>Time composite samples with collection every month.⁵</p>	<p>21³, 6</p> <p>22³</p>	<p>2.7 SSW</p> <p>26.0 NNW</p>	<p>Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium.⁷</p> <p>Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium.⁷</p>

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
 VIRGIL C. SUMMER NUCLEAR STATION
 TABLE 4.0-1

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
	C) 1 Indicator sample to be taken in the upper reservoir of the pumped storage facility at the plant discharge canal.	Time composite samples with collection every month. ⁵	23 ³	0.5 ESE	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷
V. Ground Water	A) 2 Indicator samples to be taken within the exclusion boundary and in the direction of potentially affected ground water supplies.	Quarterly grab sampling ⁷	26 27	Onsite Onsite	Gamma isotopic and tritium analyses quarterly. ⁷
	B) 1 Control sample from unaffected location.	Quarterly grab sampling ⁷	59	2.6 SSE	Gamma isotopic and tritium analyses quarterly. ⁷
VI. Drinking Water	A) 1 Indicator sample from a nearby public ground water supply source.	Monthly grab sampling. ⁵	28	2.6 SSE	Monthly ⁵ gamma isotopic and gross beta analyses and quarterly ⁷ composite for tritium analyses.
	B) 1 Indicator (finished water) sample from the nearest downstream water supply.	Monthly composite sampling.	17	25.0 SE	Monthly ⁵ gamma isotopic and gross beta analyses and quarterly ⁷ composite for tritium analyses.
	C) 1 Control (finish water) sample from an unaffected water supply.	Monthly composite sampling.	39	14.0 SSE	Monthly ⁵ gamma isotopic and gross beta analyses and quarterly ⁷ composite for tritium analyses.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
 VIRGIL C. SUMMER NUCLEAR STATION
 TABLE 4.0-1

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
INGESTION: VII. Milk ⁴	A) Samples from milking animals in 3 locations within 5 km having the highest dose potential. If there are none then 1 sample from milking animals in each of 3 areas between 5 to 8 km distance where doses are calculated to be greater than 1 mrem per year. ¹⁰	Semimonthly when animals are on pasture ⁸ , monthly other times. ⁵	To be supplied when milk animals are found in accordance with criteria VII(A)		Gamma isotopic and I-131 analysis semimonthly ⁸ when animals are on pasture, monthly other times ⁵ .
	B) 1 Control sample to be taken at the location of a dairy > 20 miles distance and not in the most prevalent wind direction. ²	Semimonthly when animals are on pasture ⁸ , monthly other times. ^{5,11}	16	20.0 W	Gamma isotopic and I-131 analysis semimonthly ⁸ when animals are on pasture, monthly other times ⁵ .
	C) 1 Indicator grass (forage) sample to be taken at the location of one of the dairies being sampled meeting the criteria of VII(A), above, when animals are on pasture.	Monthly when available ⁵	To be supplied when milk animals are found in accordance with criteria VII(A)		Gamma isotopic.
	D) 1 Control grass (forage) sample to be taken at the location of VII(B) above.	Monthly when available ^{5,11}	16	20.0 W	Gamma isotopic.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
 VIRGIL C. SUMMER NUCLEAR STATION
 TABLE 4.0-1

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
VIII. Food Products	A) 2 samples of broadleaf vegetation grown in the 2 nearest offsite locations of highest calculated annual average ground level D/Q if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5 to 8 km where the doses are calculated to be greater than 1 mrem/yr. ¹⁰	Monthly when available. ⁵	6 7	1.0 ESE 1.0 E	Gamma Isotopic on edible portion.
	B) 1 Control sample for the same foods taken at a location at least 10 miles distance and not in the most prevalent wind direction if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5 to 8 km where the doses are calculated to be greater than 1 mrem/yr. ¹⁰	Monthly when available. ⁵	18	16.5 S	Gamma Isotopic on edible portion.
IX. Fish	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp.	23 ³	0.3-5	Gamma isotopic on edible portions semiannually. ⁹
	B) 1 Indicator sample to be taken at a location in the lower reservoir.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp).	21 ³	1-3	Gamma isotopic on edible portions semiannually. ⁹

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
 VIRGIL C. SUMMER NUCLEAR STATION
 TABLE 4.0-1

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample ¹ Location	Locations Mi/Dir	Type & Frequency of Analysis
	C) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp.	22 ³	26.0 NNW	Gamma isotopic on edible portions semiannually ⁹ .
AQUATIC: X. Sediment	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual grab sample. ⁹	23 ³	0.5 ESE	Gamma isotopic.
	B) 1 Indicator sample to be taken on or near the shoreline of the lower reservoir.	Semiannual grab sample. ⁹	21 ³	2.7 SSW	Gamma isotopic.
	C) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual grab sample. ⁹	22 ³	26.0 NNW	Gamma isotopic.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
VIRGIL C. SUMMER NUCLEAR STATION
TABLE 4.0-1

NOTES

- (1) Location numbers refer to Figures 4.0-1 and 4.0-2.
- (2) Sample site locations are based on 5 year average meteorological analysis.
- (3) Though generalized areas are noted for simplicity of sample site enumeration, airborne, water and sediment sampling is done at the same location whereas biological sampling sites are generalized areas in order to reasonably assure availability of samples.
- (4) Milking animal and garden survey results will be analyzed annually. Should the survey indicate new dairying activity the owners shall be contacted with regard to a contract for supplying sufficient samples. If contractual arrangements can be made, site(s) will be added for additional milk sampling up to a total of 3 Indicator Locations.
- (5) Not to exceed 35 days.
- (6) Time composite samples are samples which are collected with equipment capable of collecting an aliquot at time intervals which are short (e.g. hourly) relative to the compositing period.
- (7) At least once per 100 days.
- (8) At least once per 18 days.
- (9) At least once per 200 days.
- (10) The dose shall be calculated for the maximum organ and age group, using the guidance/methodology contained in Regulatory Guide 1.109, Rev. 1 and the parameters particular to the Site.
- (11) Milk and forage sampling at the control location is only required when locations meeting the criteria of VII(A) are being sampled.

FIGURE 4.0-1
 Radiological Environmental Sampling Locations (Local)

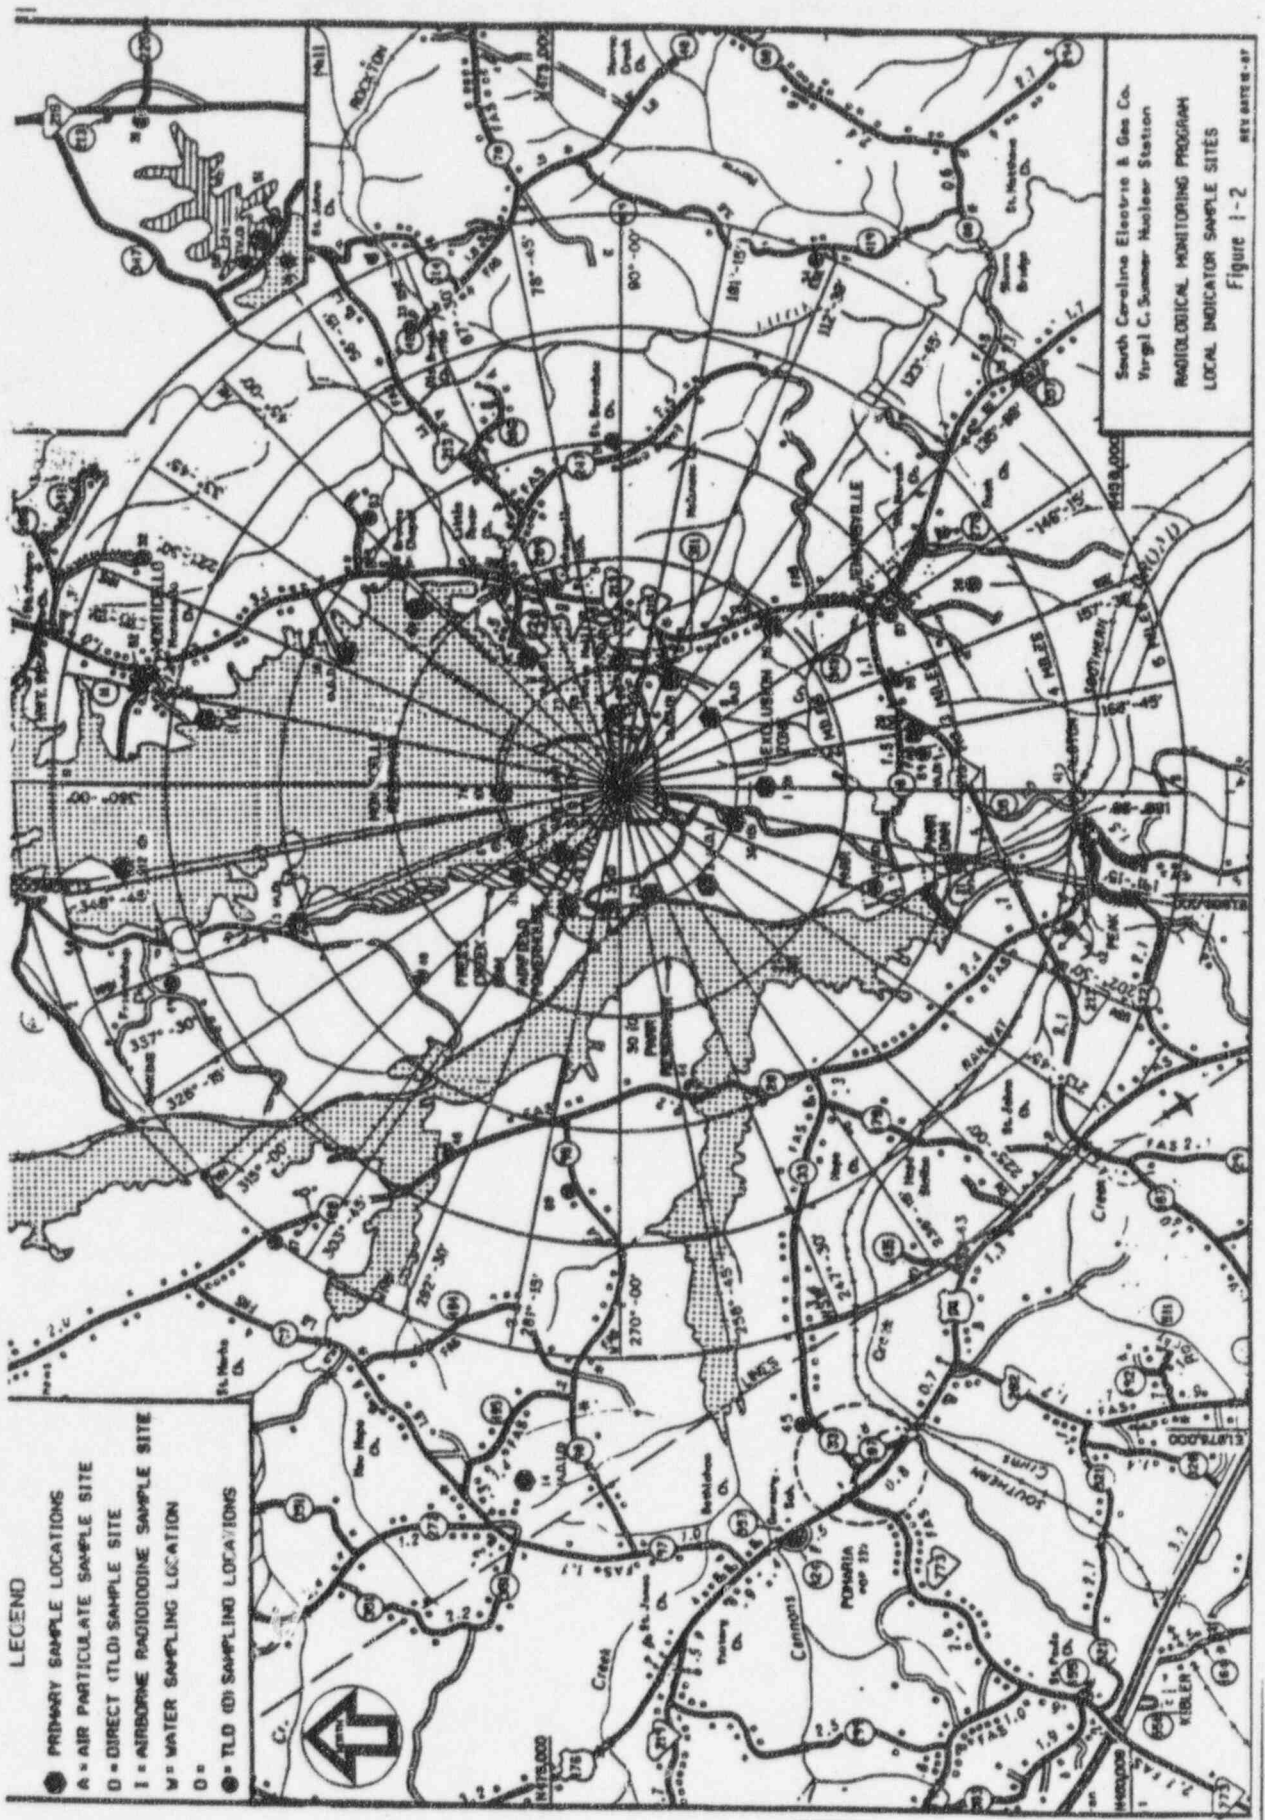



FIGURE 4.0-2

Radiological Environmental Sampling Locations
(Remote)

LEGEND

- CONTROL SAMPLE LOCATIONS
- A- AIR PARTICULATE SITE
- D- DIRECT (TLD) SITE
- I- AIRBORNE RADIOIODINE SITE
- W- WATER SITE
- O- OTHER (GARDEN PRODUCTS, FISH, SEDIMENT, GRASS, MILK)

REFERENCE:
THE BASE FOR THIS MAP WAS PREPARED FROM A
PORTION OF 1966 STATE OF GEORGIA, 1970



South Carolina Electric & Gas Co.
Virgil C. Summer Nuclear Station

Regional Location Map

Figure 1-1

REV DATE 10-87

