


Nebraska Public Power District  
Cooper Nuclear Station

# Annual Radiological Environmental Operating Report

Environmental Radiation Monitoring Program  
January 1, 1995 - December 31, 1995

USNRC Docket Number 50-298



Prepared by

**TELEDYNE  
ISOTOPES**


9605030086 960429  
PDR ADDCK 05000298  
R PDR

REPORT TO  
NEBRASKA PUBLIC POWER DISTRICT  
COLUMBUS, NEBRASKA  
RADIATION ENVIRONMENTAL MONITORING PROGRAM  
COOPER NUCLEAR STATION  
NEMAHA COUNTY, NEBRASKA

ANNUAL REPORT  
JANUARY 1 TO DECEMBER 31, 1995

PREPARED BY  
TELEDYNE BROWN ENGINEERING  
ENVIRONMENTAL SERVICES  
50 VAN BUREN AVENUE  
WESTWOOD, NEW JERSEY 07675-1235

REPORT APPROVED BY:

  
\_\_\_\_\_  
J. DAVID MARTIN, MANAGER  
ENVIRONMENTAL ANALYSIS DEPARTMENT

## PREFACE

This report covers the period of January 1 through December 31, 1995. All sample collections were made by a contractor and personnel of the Nebraska Public Power District. Analyses were performed and reports of analyses were prepared by Teledyne Brown Engineering - Environmental Services and forwarded to Nebraska Public Power District.

## TABLE OF CONTENTS

	<u>PAGE</u>
Preface.....	ii
List of Tables.....	vi
List of Figures.....	vii
I. Introduction .....	1
II. Summary .....	2
III. Sampling and Analyses Program, Stations and Maps .....	3
IV. Discussion .....	11
A. Program Objectives and Data Interpretation	
B. Atmospheric Nuclear Detonations	
V. Radiological Environmental Monitoring Program Summary Table 3....	12
REMPs TABLE 3 ANNUAL SUMMARY OF ALL STATIONS OF THE .....	13
ISOTOPES OF INTEREST WITH YEARLY AVERAGE	
ACTIVITY, NUMBER OF DETECTIONS PER TOTAL	
STATION WITH HIGHEST AVERAGE ACTIVITY,	
AVERAGE OF CONTROL STATION AND INCLUSIVE	
DATES OF ANALYSES	
VI.	
DISCUSSION, IMPACT ON THE ENVIRONMENT, GRAPHS OF .....	25
RESULTS AND STATISTICAL TABLES FOR EACH QUARTER	
A and B. AIR PARTICULATES - GROSS BETA - GROSS ALPHA .....	26
C. CHARCOAL FILTER, I-131 .....	41
D. COMPOSITE OF AIR PARTICULATE FILTERS - GAMMA .....	49
E. FISH .....	57
F. MILK - NEAREST PRODUCER .....	62
G. MILK - OTHER PRODUCERS .....	71

## TABLE OF CONTENTS

	<u>PAGE</u>
H. GROUNDWATER .....	80
I. RIVER WATER .....	86
J. THERMOLUMINESCENT DOSIMETERS .....	95
K. FOOD - BROADLEAF VEGETATION .....	103
L. SHORELINE SEDIMENT .....	109
VII. COMPLETE DATA TABLES .....	114
A,B,C. AIR PARTICULATE FILTERS - GROSS ALPHA, .....	115
GROSS BETA, I-131	
D. COMPOSITE - AIR PARTICULATE FILTERS .....	136
E. FISH .....	147
F. MILK - NEAREST PRODUCER .....	150
G. MILK - OTHER PRODUCERS .....	158
H. GROUNDWATER .....	161
I. RIVER WATER .....	164
J. THERMOLUMINESCENT DOSIMETERS .....	171
K. FOOD - BROADLEAF VEGETATION .....	176
L. SHORELINE SEDIMENT .....	189
REFERENCES.....	191

## TABLE OF CONTENTS

	<u>PAGE</u>
VIII. Appendix	
A. LAND USE CENSUS.....	A-1
B. INTERLABORATORY COMPARISON PROGRAM.....	B-1
C. STATISTICAL NOTES.....	C-1
D. NOTIFICATION LEVELS.....	D-1
E. CONVENTIONS.....	E-1
F. DETECTION CAPABILITIES.....	F-1
G. SAMPLE STATION LOCATION AND SAMPLE TYPES.....	G-1
H. SUMMARY OF DOSES TO A MEMBER OF THE PUBLIC.....	H-1
OFF-SITE	
I. NON-REMP ANALYSES.....	I-1

## LIST OF TABLES

<u>TABLES</u>	<u>TITLE</u>	<u>PAGE</u>
1	Sampling schedule and analysis, 1995, Cooper Nuclear Station	5
2	Sample Station Location with Distance and Direction from the Elevated Release Point (ERP)	7
3	Summary of Radiological Monitoring Program	13
A to L	Statistical Summary Tables - Section VI By Sample Type	pages 25-113
A to L	Data Tables - Section VII By Sample Type and Station	pages 114-190

## LIST OF FIGURES

<u>No.</u>	<u>Title</u>	<u>Page</u>
1.	Maps of sampling stations, Cooper Nuclear Station.....	9,10
A-1	Air Particulate, Gross Beta - CNS.....	28,29,30,50,51,52
A-2	Air Particulates, Gross Beta - ERAMS.....	31,32,53,54
B-1	Air Particulates, Gross Alpha - CNS.....	28,29,30,50,51,52
C-1	Airborne - Iodine, CNS.....	42,43,44
D-1	Air Particulates - Ce-144 - CNS.....	28,29,30,50,51,52
D-2	Air Particulates Ce-144 - EML.....	50,51,52
E-1	Fish, Gross Beta, K-40, Sr-90 and Cs-137 - All Locations.....	58,59
F-1	Milk - Nearest Producer, K-40, I-131 and Cs-137.....	63,64,65
F-2	Milk - Nearest Producer, Sr-89, Sr-90 and Elem. Ca.....	66,67,68
G-1	Milk - Commercial Producers, K-40, I-131 and Cs-137.....	72,73,74
G-2	Milk - Commercial Producers, Sr-89, Sr-90 and Elem. Ca.....	75,76,77
H-1	Groundwater - All Locations, Gross Alpha, Beta and H-3.....	81,82,83
I-1	River Water - All Locations, Gross Alpha, Beta.....	87,88,89
I-2	River Water - All Locations, Sr-89, Sr-90 and H-3.....	90,91,92
J-1	Thermoluminescent Dosimetry - All Locations.....	96,97,98
K-1	Food - Broadleaf Vegetation - All Locations.....	104,105
L-1	Shoreline Sediment - K-40, I-131, Cs-134 and Cs-137.....	110,111



## **I INTRODUCTION**

This report contains a complete tabulation of data collected during the period January through December 1995, for the operational Radiological Environmental Monitoring Program performed for the Cooper Nuclear Station (CNS) of the Nebraska Public Power District (NPPD) by Teledyne Brown Engineering - Environmental Services.

Cooper Nuclear Station is located in Nemaha County in the southeast corner of Nebraska on the Missouri River. A portion of the site extends into Missouri. The reactor is a 778 megawatt boiling water reactor. Initial criticality was attained on February 21, 1974. The reactor reached 50% power on June 25, 1974 and 100% power on November 20, 1974.

Radiological environmental monitoring began in 1971 before the plant became operational and has continued to the present. The program monitors radiation levels in air, terrestrial and aquatic environments. Most samples are collected by NPPD personnel. All are shipped for analysis to a contractor's laboratory where there exists special facilities required for measurements of extremely low levels of radioactivity. From 1971 through 1976 the contractor was Teledyne Isotopes, Westwood, New Jersey. NALCO Environmental Sciences assumed responsibility for the analyses effective January 1, 1977.

On November 1, 1978 Hazelton Environmental Sciences Corporation (HESC) assumed responsibility for the program. Prior to November 1, 1978 Hazelton Environmental Sciences operated as NALCO Environmental Sciences. Teledyne Isotopes (now trading as Teledyne Brown Engineering - Environmental Services) again assumed responsibility for the analyses effective January 1, 1979 through December 31, 1995.

## II. SUMMARY

Presented in this report are summaries and discussions of the data generated for the Radiological Environmental Monitoring Program (REMP) for the Cooper Nuclear Station (CNS) of the Nebraska Public Power District (NPPD) for 1995.

Part V, Table 3 presents the yearly summary of the program with the total number of samples of each type analyzed, the yearly average for all samples, the number of detections per total number of samples, the station with the highest average, the average of the control station, and the inclusive dates of the analyses.

Part VI is a discussion of each type of sample analyzed and its impact, if any, on the environment. Included also is a graph of the isotopes of interest since 1977 and the statistical results for each quarter of the year. This is followed by a complete tabulation of the data by sample type and station number.

The 1995 radiological environmental measurements for CNS indicates that there has been no residual fallout resulting from the explosion and fire at the Chernobyl Reactor in the Soviet Union which occurred on April 26, 1986. It may be concluded from all measurements taken that the operations of CNS had no detectable impact on the environment in the vicinity of CNS.

### III. SAMPLING AND ANALYSES PROGRAM, STATIONS AND MAPS

The 1995 sampling and analysis program is described in Table 1. The Teledyne Brown Engineering - Environmental Services has a comprehensive quality assurance/quality control program designed to assure the reliability of data obtained. The results for the 1995 Intercomparison Program conducted by the EPA Environmental Monitoring Systems Laboratory in Las Vegas, Nevada, are contained in Appendix B.

Sampling locations are summarized in Table 2. The type or status of each location and its distance and direction from the reactor elevated release point are specified. A map of locations follows (Figure 1). Complete descriptions of active sampling locations are given in Appendix G.

Results of the annual land use census for 1995 are summarized in Appendix A. There were no milk animals found within three miles of CNS in 1995 and no evidence of potable water use from the river. The nearest garden to CNS is in sector L, 1.3 miles from CNS. Gardens were found in 9 sectors during 1995 while gardens were found in 11 sectors during 1994. The nearest resident to CNS is in sector Q, 0.9 miles from CNS.

All of the required 1995 environmental monitoring, including sampling and analysis, was conducted as specified in Table 3.21.F.1 of the CNS Technical Specifications, except as noted below:

Station	Pathway	Sample	Collection Period	Reason
01	Airborne	Air Particulate & Charcoal Filter	04/25-05/02	Possible low air volume
01	Airborne	Air Particulate & Charcoal Filter	10/31-11/07	Pump not running
03	Airborne	Air Particulate & Charcoal Filter	05/23-05/30	Area flooded
03	Airborne	Air Particulate & Charcoal Filter	05/30-06/06	Area flooded
03	Airborne	Air Particulate & Charcoal Filter	06/06-06/13	Low air volume
04	Airborne	Air Particulate & Charcoal Filter	02/21-02/28	Vacuum failure
05	Airborne	Air Particulate only (Charcoal Filter O.K.)	07/18-07/25	Filter assembly malfunction
06	Airborne	Air Particulate & Charcoal Filter	01/24-01/31	Sampler separated

Station	Pathway	Sample	Collection Period	Reason
08	Airborne	Air Particulate & Charcoal Filter	07/25-08/01	Low air volume
09	Airborne	Air Particulate & Charcoal Filter	07/18-07/25	Pump not running
09	Airborne	Air Particulate & Charcoal Filter	07/25-08/01	Pump not running
28	Ingestion	Vegetation - Broadleaf	05/16-10/10	Replaced by Station 96 which was predicted to have the highest average ground-level D/Q, based on meteorological data
35	Ingestion	Fish	10/12	Bottom-feeder not available
44	Ingestion	Vegetation - Broadleaf	05/16-10/10	Replaced by Station 101 that was predicted to be the site of least prevalent wind direction, based on meteorological data
59	Gamma Exposure	TLD	01/05-04/12	Found on ground
66	Gamma Exposure	TLD	04/12-07/12	Missing
67	Gamma Exposure	TLD	04/12-07/12	Found on ground
67	Gamma Exposure	TLD	10/06-12/26	Found on ground
99	Ingestion	Milk (Nearest)	07/19-12/05	Replaced by Station 61 after it was determined that milk production had resumed at that dairy

The CNS Offsite Dose Assessment Manual (ODAM) was not promptly updated to reflect the changes in status of Sample Stations 28, 44, and 99. However, all applicable changes to these locations and their respective sample types were subsequently reviewed and accepted by the Station Operations Review Committee (SORC) on March 6, 1996.

**TABLE 1**

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
ENVIRONMENTAL RADIATION SURVEILLANCE PROGRAM**

**SAMPLING SCHEDULE AND ANALYSIS**

ONCE PER 7 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Airborne - Particulate	1 - 10	Gross alpha, beta, Gamma isotopic on quarterly composite of each station and on each sample in which gross beta activity is > 10 times the yearly mean of control samples.
Airborne - Iodine	1-10	I-131

ONCE PER 15 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Milk - Nearest Producer (peak pasture only)	61, 99	I-131 (low level) Gamma isotopic  Sr-89, Sr-90, Elem. Ca. on monthly composite

ONCE PER 31 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
River Water	12,28	Gross alpha - sus and dis Gross beta - sus and dis, Sr-89, Sr-90, Gamma isotopic  Tritium on quarterly composite

ONCE PER 31 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Milk - Nearest Producer (except peak pasture season)	61, 99	I-131 (low level) Sr-89, Sr-90 Elem. Ca Gamma isotopic
Food Products - Broad- leaf Vegetation (when available)	35, 96, 101	I-131 Gamma isotopic

ONCE PER 92 DAYS

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Background Radiation	1 - 10, 20, 44, 56, 58, 59, 66, 67, 71, 79 - 91, 94	TLD Readout (gamma dose)
Groundwater	11, 47	Gross alpha, beta Gamma isotopic Tritium
Milk - Commercial and Other Milk Producers	42, 100	I-131 (low level) Sr-89, Sr-90 Elem. Ca Gamma isotopic

2 TIMES/YEAR

<u>Sample Type</u>	<u>Station Nos.</u>	<u>Analyses</u>
Fish (Summer and Fall)	28, 35	Gross beta Sr-89, Sr-90 Gamma isotopic
Shoreline Sediment	28	Gamma isotopic

TABLE 2

NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
BROWNVILLE, NEBRASKA

DISTANCE AND DIRECTION FROM THE ELEVATED RELEASE POINT (ERP)  
TO THE SAMPLE STATION LOCATIONS

STATION NUMBER	DISTANCE <sup>a</sup> (MILES)	DIRECTION <sup>a</sup> (DEGREES)	CLASSIFICATION <sup>b</sup>
1	0.10	225	IND
2	0.75	225	IND
3	2.5	338	IND
4	3.0	43	IND
5	3.5	102	IND
6	3.0	165	IND
7	2.5	230	IND
8	2.5	260	IND
9	7.3	335	IND
10	10.0	160	IND
11	0.15	225	IND
12	0.10	360	CON
20	0.96	315	IND
28	1.8	150	IND
35	2.0	350	IND AND CON
42	12.9	156	IND
44	10.3	270	CON
47	25.8	154	IND
56	1.9	118	IND
58	1.1	219	IND
59	1.0	189	IND
61	3.5	326	IND
66	4.5	200	IND
67	4.8	325	IND
71	4.3	71	IND
79	0.85	299	IND
80	0.75	284	IND
81	0.80	265	IND
82	0.80	176	IND
83	4.4	189	IND
84	4.4	297	IND
85	3.1	3	IND
86	4.6	16	IND
87	1.75	20	IND
88	1.75	63	IND


STATION NUMBER	DISTANCE <sup>a</sup> (MILES)	DIRECTION <sup>a</sup> (DEGREES)	CLASSIFICATION <sup>b</sup>
89	2.0	86	IND
90	2.25	134	IND
91	6.9	54	IND
94	3.6	108	IND
96	1.25	334	IND
99	10.25	189	IND
100	11.5	197	IND
101	13.3	73	CON

a Distance and direction are specified with respect to the CNS reactor Elevated Release Point.

b Classification codes: IND = indicator; CON = control.




NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 AREA  
 SAMPLING STATION  
 LOCATION MAP

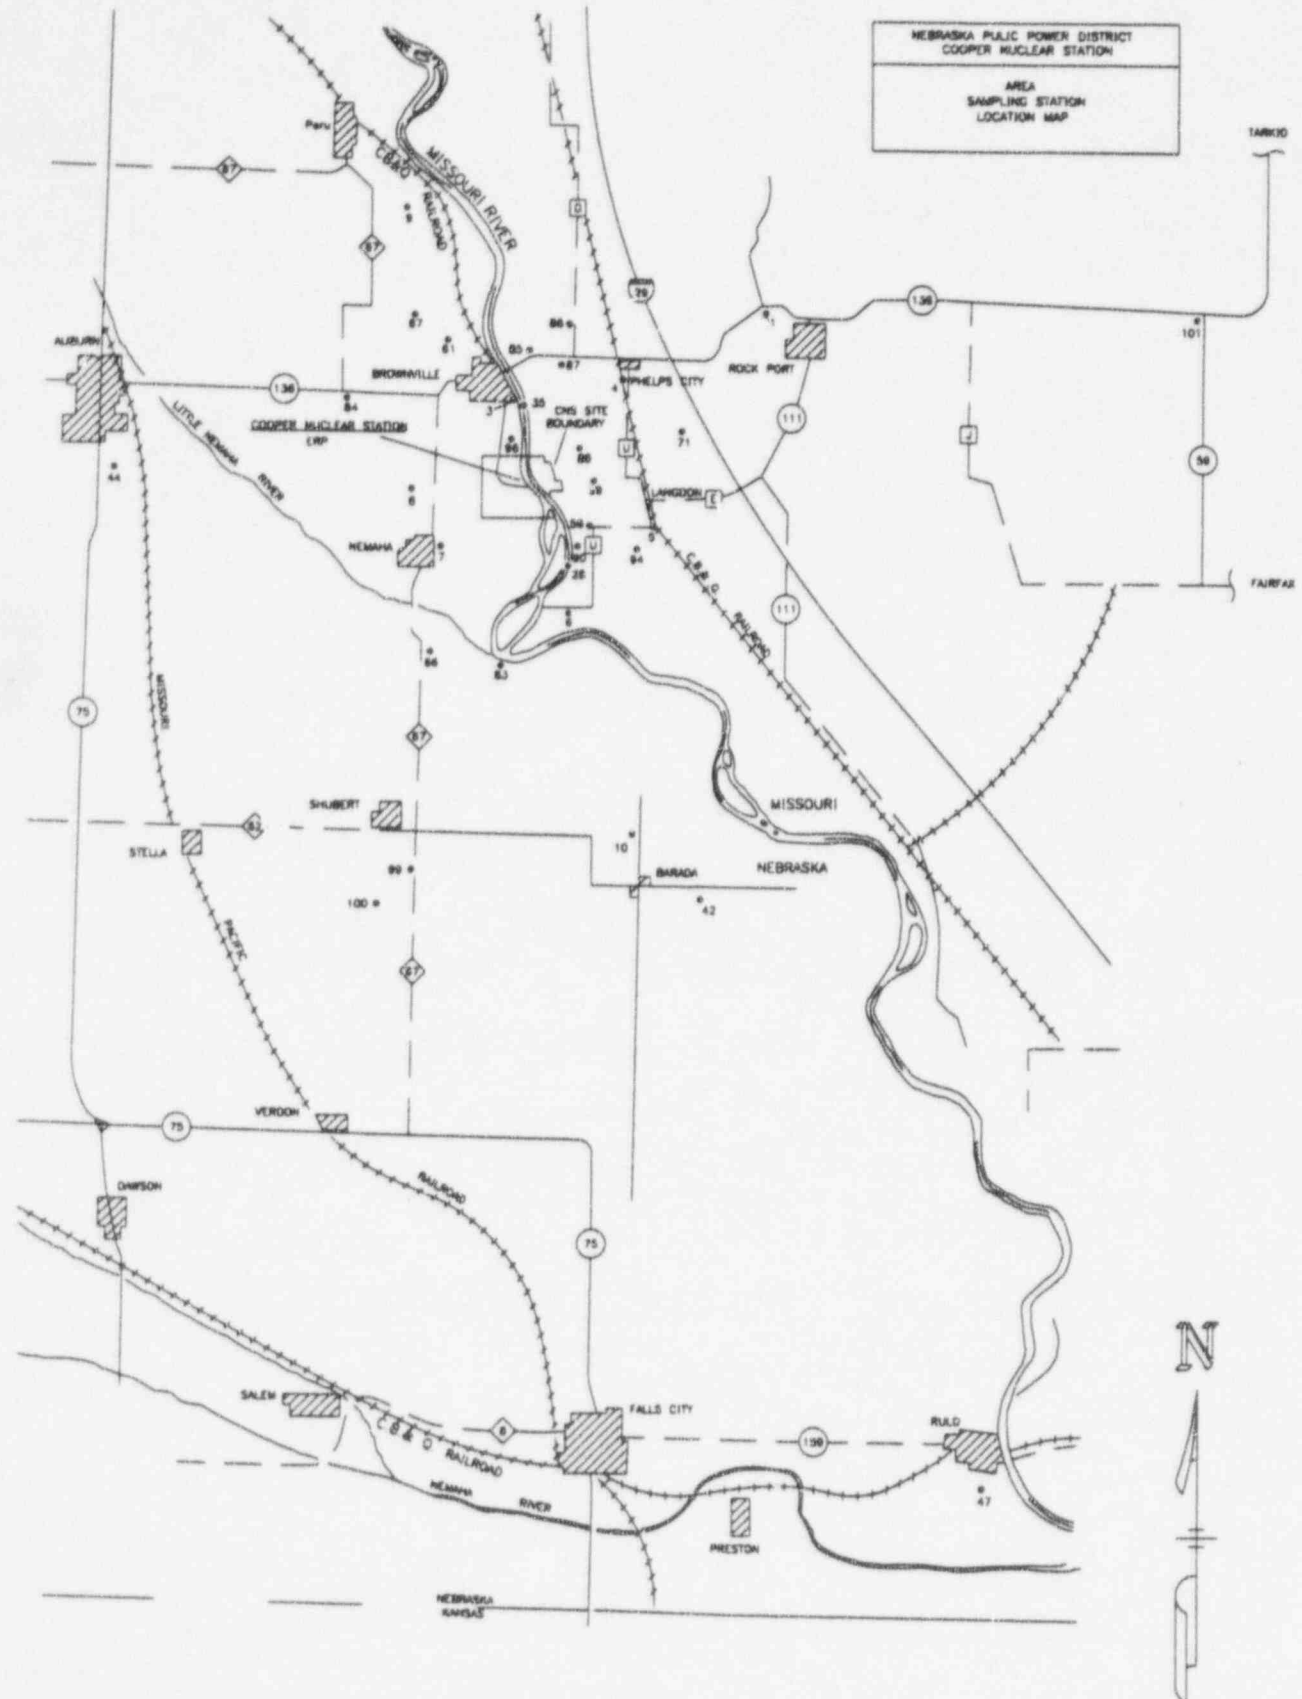



NEBRASKA

MISSOURI

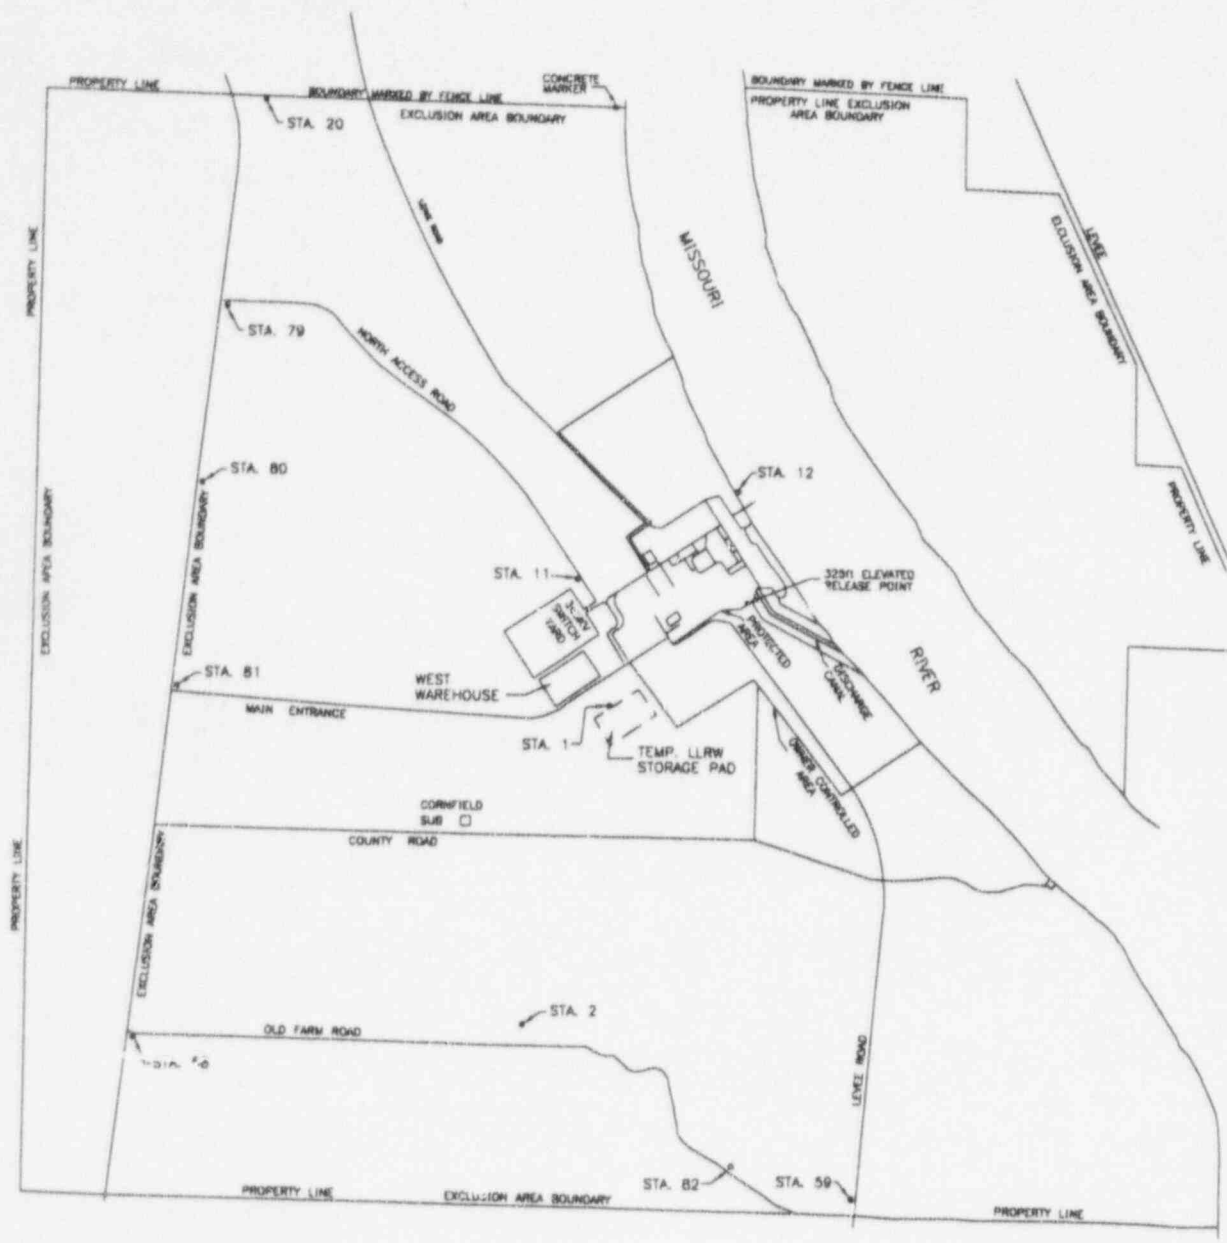

NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION

---

SITE  
SAMPLING STATION  
LOCATIONS MAP

#### **IV. DISCUSSION**

##### **A. Program Objectives and Data Interpretation**

The objective of the monitoring program is to detect and assess the impact of possible releases to the environs of radionuclides from the operations of the Cooper Nuclear Station. This objective requires measurements of low levels of radioactivity equal to or lower than pre-determined limits of detection. In addition the source of the environmental radiation must be established. Sources of environmental radiation include:

- (1) Natural background radiation from cosmic rays (Be-7).
- (2) Terrestrial, primordial radionuclides from the environment (K-40, Ra-226, Th-228).
- (3) Fallout from atmospheric nuclear tests such as the September 1977 detonation by the Peoples' Republic of China and the atmospheric weapons test of October 16, 1980 (fission products and fusion products).
- (4) Releases from nuclear power plants such as CNS (fission products and neutron activation products).
- (5) Fallout from the Chernobyl Nuclear Reactor Accident.

Radiation levels measured in the vicinity of an operating power station are compared with preoperational measurements at the same locations to distinguish power plant effects from other sources. Also, results of the monitoring program are related to events known to cause elevated levels of radiation in the environment, e.g., atmospheric nuclear detonations or abnormal plant releases.

##### **B. Atmospheric Nuclear Tests**

Three atmospheric nuclear detonations in the People's Republic of China influenced program results significantly in late 1976 and in 1977. Two of these detonations occurred in late 1976 (September 26 and November 17) and one in late 1977 (September 17). As a consequence of these tests elevated activities of gross beta in air particulate filters and I-131 in milk were observed throughout most of the United States.

No atmospheric nuclear tests have been conducted since 1977, thus no short-lived fission products were detected in air particulate samples. Also no I-131 was detected from radiogases from any sources.

On April 26, 1986 the fire and explosion of Chernobyl Reactor No. 4 in the Soviet Union resulted in the release of fission products to the atmosphere and worldwide fallout. Following the explosion, elevated levels of gross beta activities in air particulates and I-131 in charcoal filters and milk samples were measured. Additionally, in 1986, Cs-137 and the short-lived isotopes I-131, Ru-106, and Cs-134 were detected in broadleaf vegetation. Similar results occurred in other areas of the United States and the entire Northern Hemisphere.

## **V. RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM TABLES**

Presented in Table 3 are the radiological environmental monitoring program summaries (REMPS) generated from the reports of analyses performed during 1995 for the NPPD sampling and analyses program. The REMPS tables conform to the requirements of Table 1 in Regulatory Guide 4.8 (Reference 6).

The average activity level for all samples collected for the year for each sample type are summarized in this table. The mean, range and fraction of detections to total samples assayed are presented. The station location and station number with the highest annual mean is also tabulated. If a control station is specified the comparable results of the control are listed.

From the REMPS table it is possible to determine the total number of each type of sample analyzed and the average activity of all samples from all stations of each nuclide. If there were no positive detections the maximum of the lowest levels of detection is listed. The station having the highest level of activity is specified. From this data it is possible to determine any high levels of activity and the source. The dose impact on the population can thus be evaluated.

**TABLE 3**  
**RADIOLOGICAL ENVIRONMENTAL**  
**MONITORING PROGRAM SUMMARIES**  
**(REMP)**  
**1995**

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - AIRBORNE SAMPLE - AIR PARTICULATE FILTERS UNITS - PCI/CU.M.	ANALYSIS NO	NO LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES MEAN X E-00 RANGE	LOCATION WITH HIGHEST MEAN STATION FRACTION	COMPILATION - ANNUAL SUMMARY CONTROL -	NEBRASKA PUBLIC POWER DISTRICT COOPER NUCLEAR STATION	CONTROL LOCATION MEAN X E-00 RANGE	NON-ROUTINE REPORTING PERIOD FRACTION
GR-A	513	0.00200	0.00213 0.0008- 0.0067 512/513	4 STATION 4 - 3.0 MI. 43 DEG. IND.			0	01/03/95-01/02/96
GR-B	513	0.00300	0.0259 0.00370- 0.11000 513/513	04 STATION 4 - 3.0 MI. 43 DEG. IND.			0	01/03/95-01/02/96

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - AIRBORNE  
 SAMPLE - CHARCOAL FILTERS  
 UNITS - PCI/CU.M.

COMPILATION - ANNUAL SUMMARY  
 CONTROL -

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES		LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN X E-00 RANGE	NON- ROUTINE	REPORTING PERIOD
			FRACTION	RANGE	STATION FRACTION	RANGE			
					STATION DESCRIPTION				
I-131	515		LT	0.09000				0	01/03/95-01/02/96
			LT	0.0100-	LT 0.09000				
				000/515					

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - AIRBORNE SAMPLE - COMPOSITE OF AIR PARTICULATE FILTERS UNITS - PCI/CU.M.		COMPILATION - ANNUAL SUMMARY CONTROL -		NEBRASKA PUBLIC POWER DISTRICT COOPER NUCLEAR STATION	
ANALYSIS	NO LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES MEAN X E-00 RANGE	LOCATION WITH HIGHEST MEAN MEAN X E-00 RANGE	CONTROL LOCATION MEAN X E-00 RANGE	NON-ROUTINE REPORTING PERIOD
		FRACTION	STATION FRACTION STATION DESCRIPTION	FRACTION	
BE-7	40 0.05000	0.13400 0.0868- 0.2200 040/040	04 004/004 STATION 04 - 3.0 MI. 43 DEG. IND.	0.1563 0.0942- 0.2200	0 01/03/95-01/02/96
K-40	40 0.06000	0.0284 0.0077- 0.0495 000/040	09 002/004 STATION 09 - 7.3 MI. 335 DEG. IND.	0.0492 0.04890- 0.04950	0 01/03/95-01/02/96
I-131	40	LT 0.2000 LT 0.0600- LT 0.2000 000/040			0 01/03/95-01/02/96
CS-137	40 0.00300	LT 0.00090 LT 0.00030- LT 0.00090 000/040			



TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - INGESTION SAMPLE - FISH UNITS - PCI/GM WET	ANALYSIS NO	LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES MEAN X E-00 RANGE FRACTION	LOCATION WITH HIGHEST MEAN MEAN X E-00 RANGE STATION FRACTION STATION DESCRIPTION	CONTROL LOCATION MEAN X E-00 RANGE FRACTION	NON-ROUTINE ROUTINE	REPORTING PERIOD
	GR-B	9 0.250	4.8 4.5-09/09	28 005/005 4.6-5.2 STATION 28 - 1.8 MI. 150 DEG. IND.		0	07/25/95-10/12/95
	SR-89	9 0.0300	LT 0.0100 0.00300- LT 0.0100 000/09			0	07/25/95-10/12/95
	SR-90	9 0.0300	0.0085 0.0085-001/09	35 001/004 0.0085-0.0085 STATION 35 - 2.0 MI. 350 DEG. IND.		0	07/25/95-10/12/95
	K-40	9 0.4700	3.08 2.15-09/09	28 005/005 2.98-4.18 STATION 28 - 1.8 MI. 150 DEG. IND.		0	07/25/95-10/12/95
	I-131	9 0.03100	LT 0.0500 0.03000- LT 0.0500 000/09			0	07/25/95-10/12/95
	CS-137	9 0.03100	LT 0.02000 0.01000- LT 0.02000 000/09			0	07/25/95-10/12/95

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - INGESTION SAMPLE - MILK - NEAREST UNITS - PCI/LITER	ANALYSIS NO	NO LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES MEAN X E-00 RANGE FRACTION	LOCATION WITH HIGHEST MEAN MEAN X E-00 RANGE STATION FRACTION STATION DESCRIPTION	CONTROL LOCATION MEAN X E-00 RANGE FRACTION	NON-ROUTINE ROUTINE	REPORTING PERIOD
	CA (mg/l)	17	1.70- 1.8 017/017	99 08/08 1.7- 1.8 2.1		0	01/03/95-12/05/95
	I-131	26	LT 0.4 0.100- LT 0.4 000/026			0	01/03/95-12/05/95
	SR-89	17	LT 2.0 0.5- LT 2.0 000/017			0	01/03/95-12/05/95
	SR-90	17	0.73- 1.2 017/017	99 08/08 0.73- 1.3 2.0		0	01/03/95-12/05/95
	K-40	26	1060.- 1310. 026/026	99 011/011 1270.- 1370. 1470.		0	01/03/95-12/05/95
	I-131	26	LT 9.000 3.00- LT 9.00 000/026			0	01/03/95-12/05/95
	CS-137	26	LT 5.00 3.00- LT 5.00 000/026			0	01/03/95-12/05/95

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - INGESTION SAMPLE - MILK OTHER PRODUCERS UNITS - PCI/LITER	ANALYSIS NO	NO LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES MEAN X E-00 RANGE FRACTION	LOCATION WITH HIGHEST MEAN MEAN X E-00 RANGE STATION FRACTION STATION DESCRIPTION	CONTROL LOCATION MEAN X E-00 RANGE FRACTION	NON-ROUTINE ROUTINE	REPORTING PERIOD
	CA (mg/l)	8	1.8 1.7- 008/008	100 004/004 1.8 STATION 100 - 11.5 MI. 197 DEG. IND	0	0	01/17/95-10/24/95
	I-131	8	0.780 LT 0.200 000/008	100 004/004 1.7- STATION 100 - 11.5 MI. 197 DEG. IND	0	0	01/17/95-10/24/95
	SR-89	8	2.0 LT 0.7 000/008	100 004/004 1.7- STATION 100 - 11.5 MI. 197 DEG. IND	0	0	01/17/95-10/24/95
	SR-90	8	1.4 1.4- 008/008	100 004/004 1.5- STATION 100 - 11.5 MI. 197 DEG. IND	0	0	01/17/95-10/24/95
	K-40	8	140.0 1240.- 008/008	100 004/004 1.6 STATION 100 - 11.5 MI. 197 DEG. IND	0	0	01/17/95-10/24/95
	I-131	8	0.7800 LT 08.000 4.00- 000/008	100 004/004 1.7 STATION 100 - 11.5 MI. 197 DEG. IND	0	0	01/17/95-10/24/95
	CS-137	8	9.00 LT 5.00 4.00- 000/008	100 004/004 1.7 STATION 100 - 11.5 MI. 197 DEG. IND	0	0	01/17/95-10/24/95

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - AQUATIC SAMPLE - SHORELINE SEDIMENT UNITS - PCI/GM DRY	ANALYSIS NO	LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES		LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN X E-00 RANGE FRACTION	NON- ROUTINE	REPORTING PERIOD
			MEAN X E-00 RANGE FRACTION	STATION FRACTION STATION DESCRIPTION	MEAN X E-00 RANGE FRACTION	STATION FRACTION STATION DESCRIPTION			
	BE-7	3	0.2300	0.414 001/003	28 001/003	0.414 0.414	0.414 STATION 28 - 1.8 MI. 150 DEG. IND.	0	05/02/95-10/31/95
	K-40	3	0.4700	17.7- 003/003	17.9 003/003	18.3 17.7	18.3 STATION 28 - 1.8 MI. 150 DEG. IND.	0	05/02/95-10/31/95
	MN-54	3	0.03100	0.0096- 003/003	0.0111 0.0132	0.0111 0.0096	0.0132 STATION 28 - 1.8 MI. 150 DEG. IND.	0	05/02/95-10/31/95
	I-131	3	0.03100	LT 0.0100- 000/003	LT 0.0300	LT 0.0300	LT 0.0300	0	05/02/95-10/31/95
	CS-137	3	0.03100	0.0573- 003/003	0.0849 0.0996	0.0849 0.0573	0.0996 STATION 28 - 1.8 MI. 150 DEG. IND.	0	05/02/95-10/31/95
	CE-141	3	0.04700	LT 0.0160- 000/003	LT 0.0200	LT 0.0200	LT 0.0200	0	05/02/95-10/31/95
	RA-226	3	0.1100	1.80- 003/003	1.89 2.04	1.89 1.80	2.04 STATION 28 - 1.8 MI. 150 DEG. IND.	0	05/02/95-10/31/95
	TH-228	3	0.1100	0.9820 002/003	1.0000 0.9910	0.9820 0.9910	1.0000 STATION 28 - 1.8 MI. 150 DEG. IND.	0	05/02/95-10/31/95

NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION

COMPILATION - ANNUAL SUMMARY  
CONTROL -

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - GAMMA EXPOSURE  
 SAMPLE - ENVIRONMENTAL TLD  
 UNITS - mR

COMPILATION - ANNUAL SUMMARY  
 CONTROL -

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES MEAN X E-00 RANGE FRACTION	LOCATION WITH HIGHEST MEAN MEAN X E-00 RANGE STATION FRACTION STATION DESCRIPTION	CONTROL LOCATION MEAN X E-00 RANGE FRACTION	NON- ROUTINE	REPORTING PERIOD
TLD	127	2mR					
Total Exposure/year			65.7 mR 55.4- 73.1 127/127	56.8 mR 66 004/004 STATION 66 - 4.5 MI. 200 DEG. IND.	72.1 44 004/004 STATION 44 - 10.25 MI. 270 DEG. CON.	0	01/05/95-12/26/95
Average Exposure/ quarter			16.6 mR 14- 19 032/032	18.9mR 18.4- 19.5 66 004/004 STATION 66 - 4.5 MI. 200 DEG. IND.	18.0 mR 16.6- 19.5 44 004/004 STATION 44 - 10.25 MI. 270 DEG. CON.	0	01/05/95-12/26/95

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - INGESTION SAMPLE - BROADLEAF TERRESTRIAL VEGETATION UNITS - PCI/GM WET	ANALYSIS NO	NO LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES MEAN X E-00 RANGE FRACTION	LOCATION WITH HIGHEST MEAN MEAN X E-00 RANGE STATION FRACTION STATION DESCRIPTION	CONTROL LOCATION MEAN X E-00 RANGE FRACTION	NON- ROUTINE	REPORTING PERIOD
	I-131	60 0.0500	LT 0.01 0.004- LT 0.01 000/060			0	05/16/95-10/10/95
	BE-7	60 1.20	1.97 0.354- 4.27 060/060	101 020/020 0.587- 4.20 STATION 101 - 13.3 MI. 73 DEG. CON.		0	05/16/95-10/10/95
	K-40	60 0.9300	6.08 2.65- 11.6 006/060	101 020/020 2.79- 6.21 STATION 101 - 13.3 MI. 73 DEG. CON.		0	05/16/95-10/10/95
	I-131	60 0.05000	LT 0.0000 0.01- LT 0.0800 000/060			0	05/16/95-10/10/95
	CS-137	60 0.1600	0.0272 0.0272 0.0272 001/060	101 001/020 0.0272- 0.0272 STATION 101 - 13.3 MI. 73 DEG. CON.		0	05/16/95-10/10/95
	RA-226	60 0.8000	LT 0.800 0.0100- LT 0.800 000/060			0	05/16/95-10/10/95
	TH-228	60 0.4700	0.103 0.0290- 0.194 008/060	96 004/020 0.0714- 0.194 STATION 96 - 1.25 MI. 334 DEG. IND.		0	05/16/95-10/10/95

TABLE 3

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - WATERBORNE  
 SAMPLE - WATER - GROUND  
 UNITS - PCI/LITER

COMPILATION - ANNUAL SUMMARY  
 CONTROL -

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES		LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN X E-00 RANGE FRACTION	NON- ROUTINE	REPORTING PERIOD	
			MEAN X E-00	RANGE	STATION FRACTION	MEAN X E-00				RANGE
			FRACTION		STATION DESCRIPTION					
GR-A	8	4.0	7.9	7.9	47	001/004	7.9	7.9	0	01/24/95-10/25/95
			001/008		STATION 47 - 25.8 MI. 154 DEG. IND.					
GR-B	8	1.8	6.3-	8.4	11	004/004	7.6-	9.5	0	01/24/95-10/25/95
			008/008		STATION 11 - 0.15 MI. 225 DEG. IND.					
I-131	8	9.00	LT 4.00-	LT 7.00					0	01/24/95-10/25/95
			000/008							
CS-137	8	9.00	LT 3.00-	LT 5.00					0	01/24/95-10/25/95
			000/008							
H-3	8	140.	LT 100.-	100.					0	01/24/95-10/25/95
			000/008							

TABLE 3

## RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM SUMMARY

PATHWAY - WATERBORNE  
SAMPLE - WATER - RIVER  
UNITS - PCI/LITER

COMPILATION - ANNUAL SUMMARY  
CONTROL - STATION 12 - 0.1 MI. 360 DEG. CON.

NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES		LOCATION WITH HIGHEST MEAN		CONTROL LOCATION		NON- ROUTINE	REPORTING PERIOD
			MEAN X E-00	RANGE	STATION FRACTION	MEAN X E-00	RANGE	MEAN X E-00		
			FRACTION		STATION DESCRIPTION		FRACTION			
GR-A DIS	24	4.0	4.0	2.5-6.1	12 005/012 STATION 12 - 0.10 MI. 360 DEG. CON.	4.1	4.1	2.9-5.4	0	01/03/95-12/05/95
GR-A SUS	24	4.0	2.2	0.65-6.5	12 C10/012 STATION 12 - 0.10 MI. 360 DEG. CON.	2.3	2.3	0.73-6.5	0	01/03/95-12/05/95
GR-B DIS	24	1.8	11.0	7.6-14.0	12 012/012 STATION 12 - 0.10 MI. 360 DEG. CON.	11.0	11.0	8.7-14.0	0	01/03/95-12/05/95
GR-B SUS	24	1.8	5.9	1.6-15.0	28 011/012 STATION 28 - 1.8 MI. 150 DEG. IND.	5.9	5.9	2.1-12.0	0	01/03/95-12/05/95
SR-89	24	1.1	LT 2.0	LT 0.3-2.0		LT 2.0	LT 0.300-2.0		0	01/03/95-12/05/95
SR-90	24	0.930	LT 0.900	LT 0.200-0.900					0	01/03/95-12/05/95
K-40	24	140.0	LT 100	LT 50-100		LT 100	LT 50-100		0	01/03/95-12/05/95
I-131	24	9.00	LT 9.0	LT 3.0-9.0		LT 9.0	LT 3.0-9.0		0	01/03/95-12/05/95
CS-137	24	9.00	LT 5.0	LT 3.0-5.0		LT 4.0	LT 3.0-4.0		0	01/03/95-12/05/95
H-3	8	140.	LT 100.	LT 100-100					0	01/03/95-12/05/95



VI.

DISCUSSION, IMPACT ON THE ENVIRONMENT

GRAPHS OF RESULTS FROM 1977 -- 1995

AND

STATISTICAL TABLES

FOR

EACH QUARTER

A and B. AIR PARTICULATE SAMPLES - GROSS BETA AND GROSS ALPHA

(See Tables A-1 - A-4, B-1 - B-4)

STATIONS 01 to 10

Air particulates were collected on membrane filters at ten locations (01-10). The filters were changed weekly and analyzed for gross beta and gross alpha activities. Quarterly composites are analyzed for gamma emitting isotopes.

The average gross beta activity of all stations for each quarter of 1994 and 1995 is summarized below:

1994	First Quarter	0.029	pCi/Cu. M.
	Second Quarter	0.020	pCi/Cu. M.
	Third Quarter	0.024	pCi/Cu. M.
	Fourth Quarter	0.034	pCi/Cu. M.
	Average 1994	0.027	pCi/Cu. M.
1995	First Quarter	0.028	pCi/Cu. M.
	Second Quarter	0.017	pCi/Cu. M.
	Third Quarter	0.028	pCi/Cu. M.
	Fourth Quarter	0.030	pCi/Cu. M.
	Average 1995	0.026	pCi/Cu. M.

The level of beta activity was at normal environmental levels in 1995 showing the natural seasonal variations. There was a slight decrease in the level of gross beta activity during the first quarter; there was a slight decrease from the second quarter of 1994 and an increase from the third quarter of 1994; the fourth quarter was slightly higher as shown in Table A-4. The increase and decline in activity often occurs and is attributed to natural phenomena.

The gross alpha activity continued low and close to the limits of detection. Gross alpha activity is probably due to the alpha emitters found in soil and particulates drawn into the filters.

No effect attributable to the Cooper Nuclear Station was observed in the results of monitoring air particulates.

A and B. AIR PARTICULATE SAMPLES - GROSS BETA AND GROSS ALPHA

(See Tables A-1 - A-4, B-1 - B-4)

STATIONS 01 to 10

Figure A1, B1 shows the gross beta, gross alpha and Ce-144 activity in the environs of CNS. The results for 1986 through 1995 are on the second and third pages of Figure A-1, B-1. The gross beta activity in 1995 was similar to previous years in which there were no nuclear atmospheric weapons tests or nuclear accidents. The gross alpha activity remained low and near the normal detection level. Cesium-144 was below the level of detection.

Figure A-2 shows the gross beta activity in air samples through April 1989 at Jefferson City, Missouri as reported by the Environmental Radiation Monitoring System (ERAMS) of the US Environmental Protection Agency. No more recent data was available. This data was taken from Environmental Radiation Data distributed by the Eastern Environmental Radiation Facility, Montgomery, Alabama. The measurements by ERAMS were made after a waiting period which may explain the somewhat lower results because of decay of the isotopes having a shorter half-life. Measurements of Ce-144 were no longer reported because the activity has approached the limit of detection by the analytical techniques now used.

FIGURE A1, B1  
 AIR PARTICULATES - CNS  
 ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS  
 CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

28

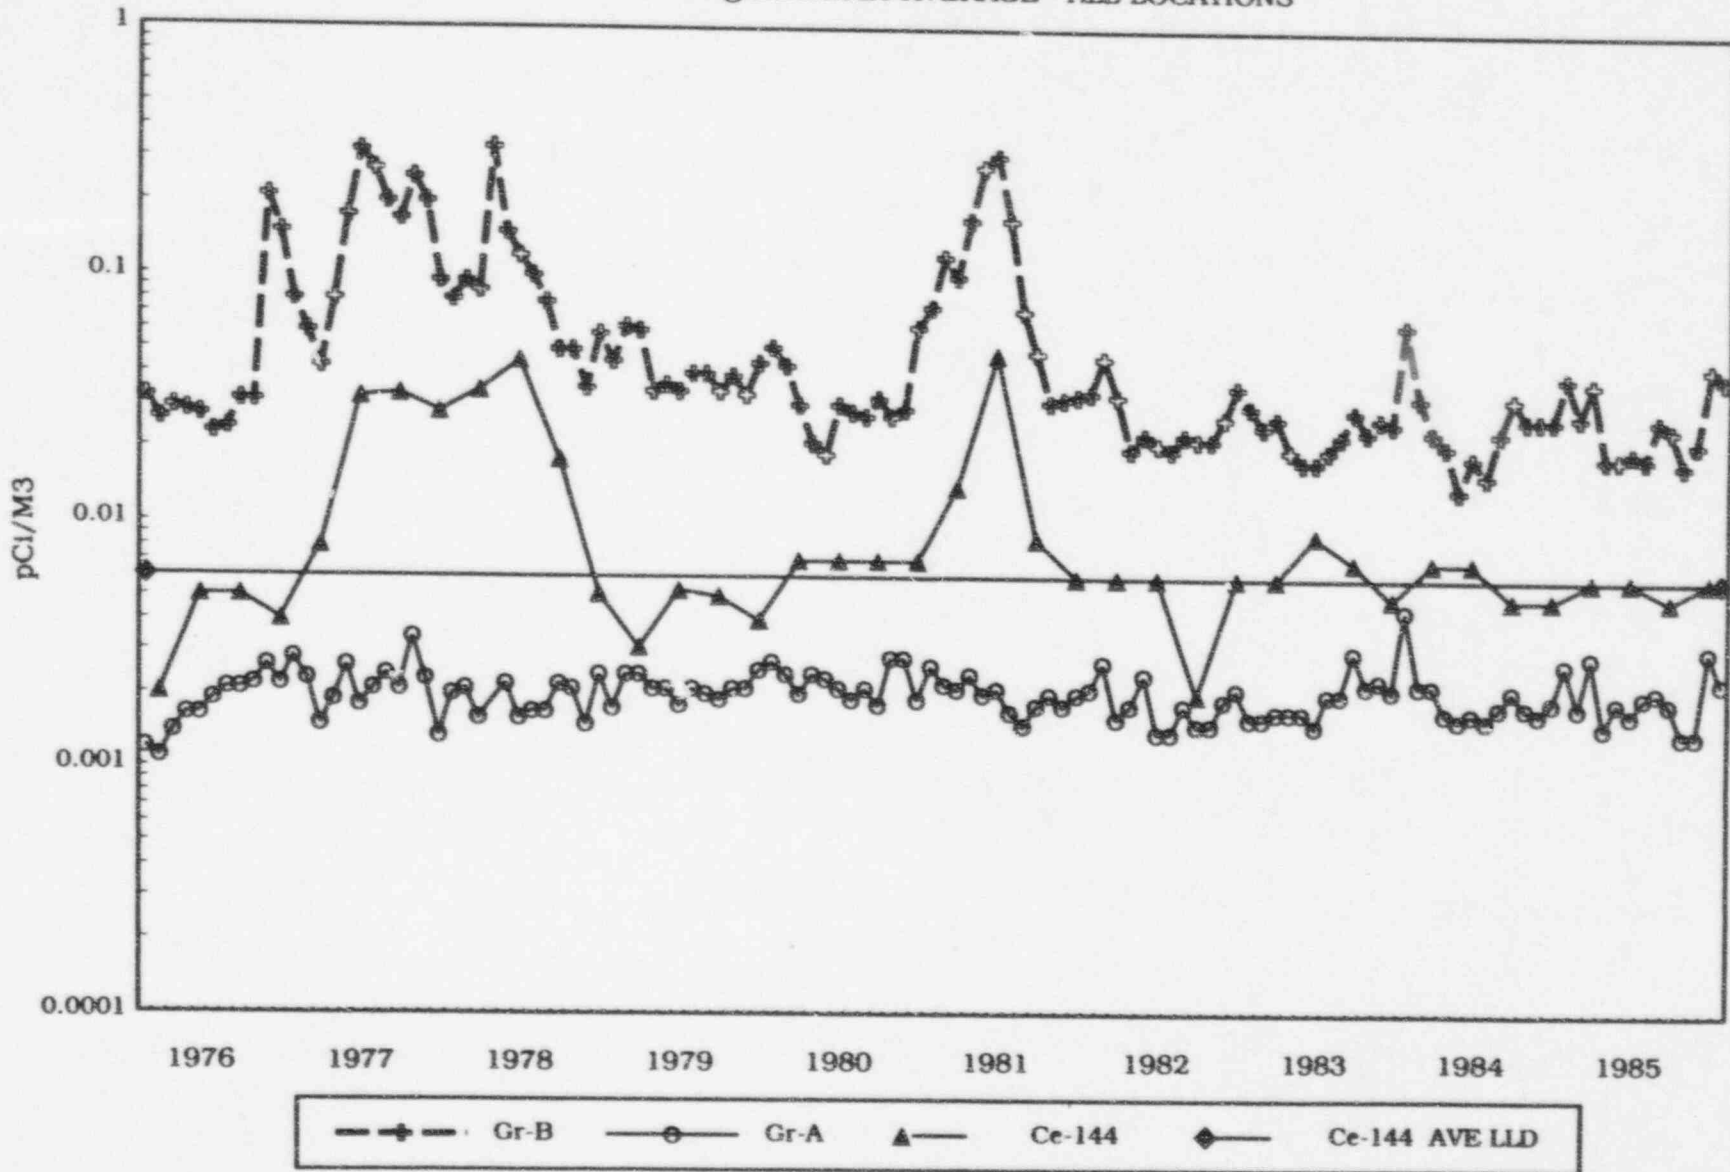


FIGURE A1, B1  
 AIR PARTICULATES - CNS  
 ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS  
 CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

29


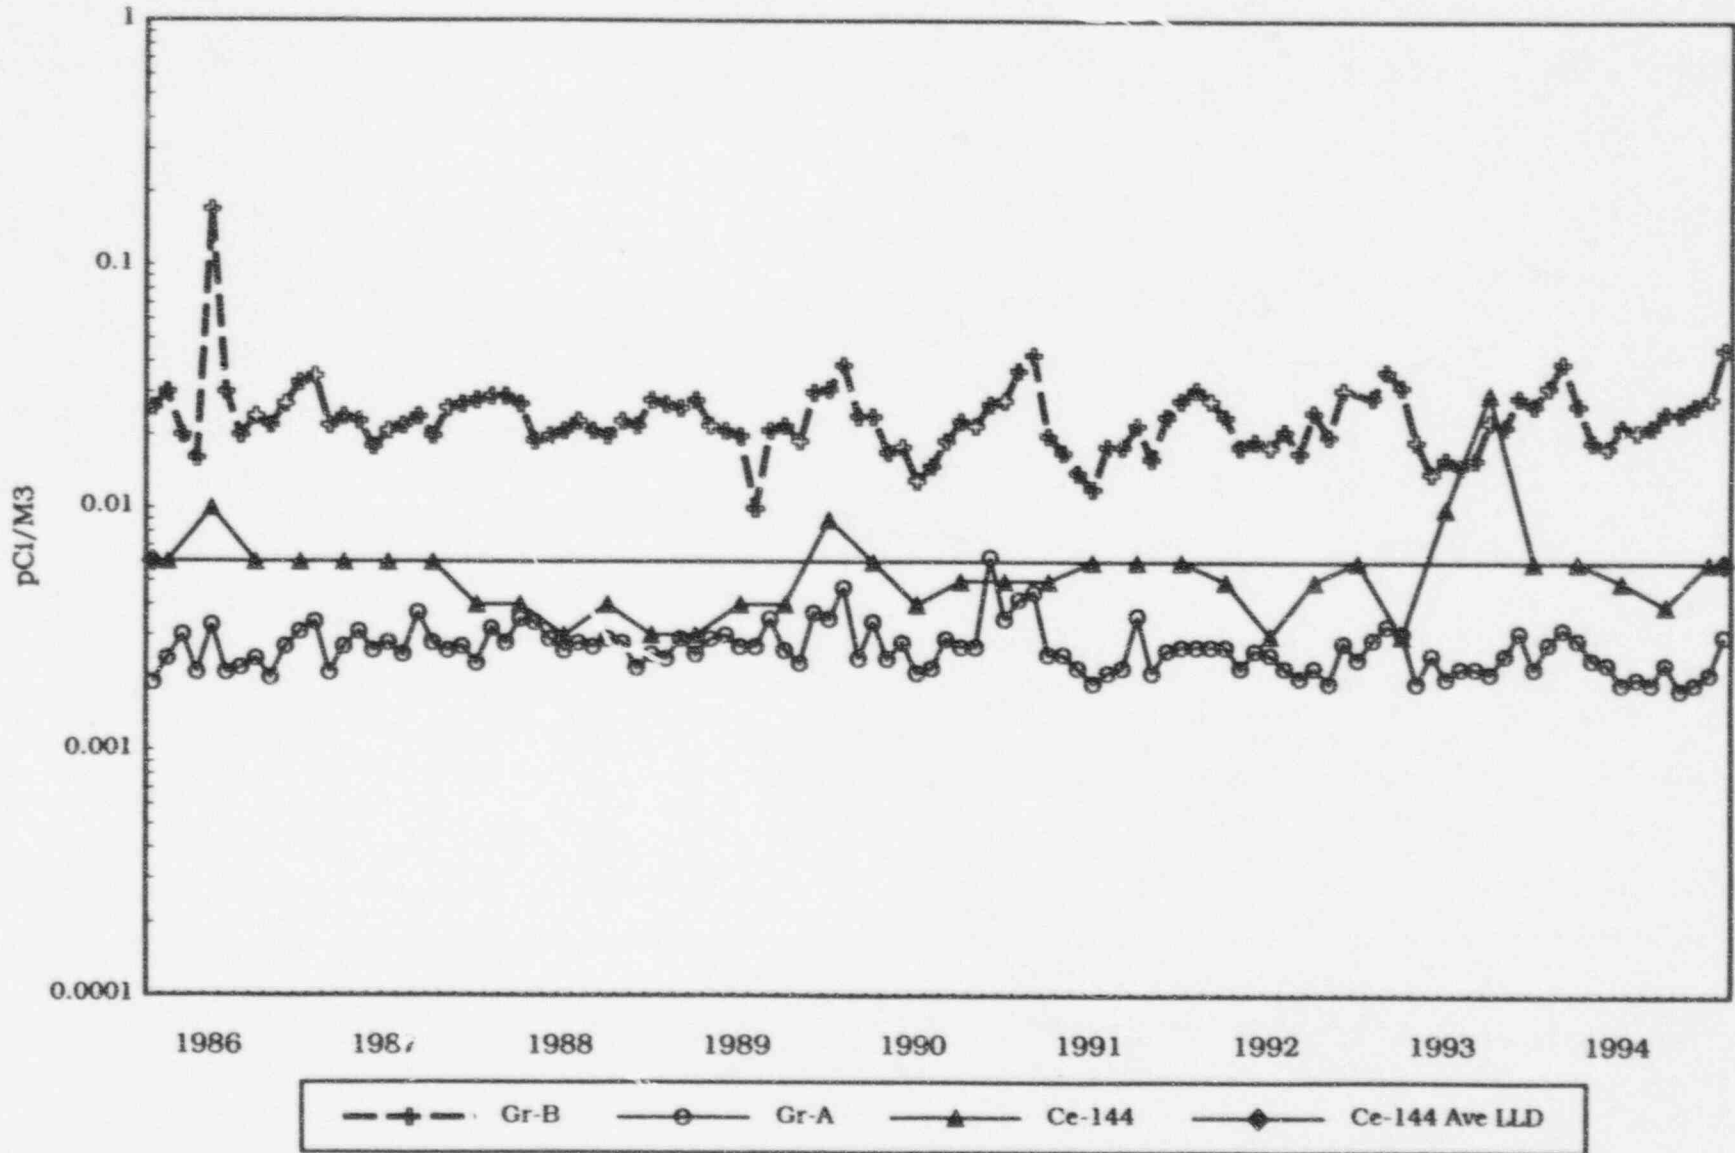


FIGURE A1, B1  
 AIR PARTICULATES - CNS  
 ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS  
 CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

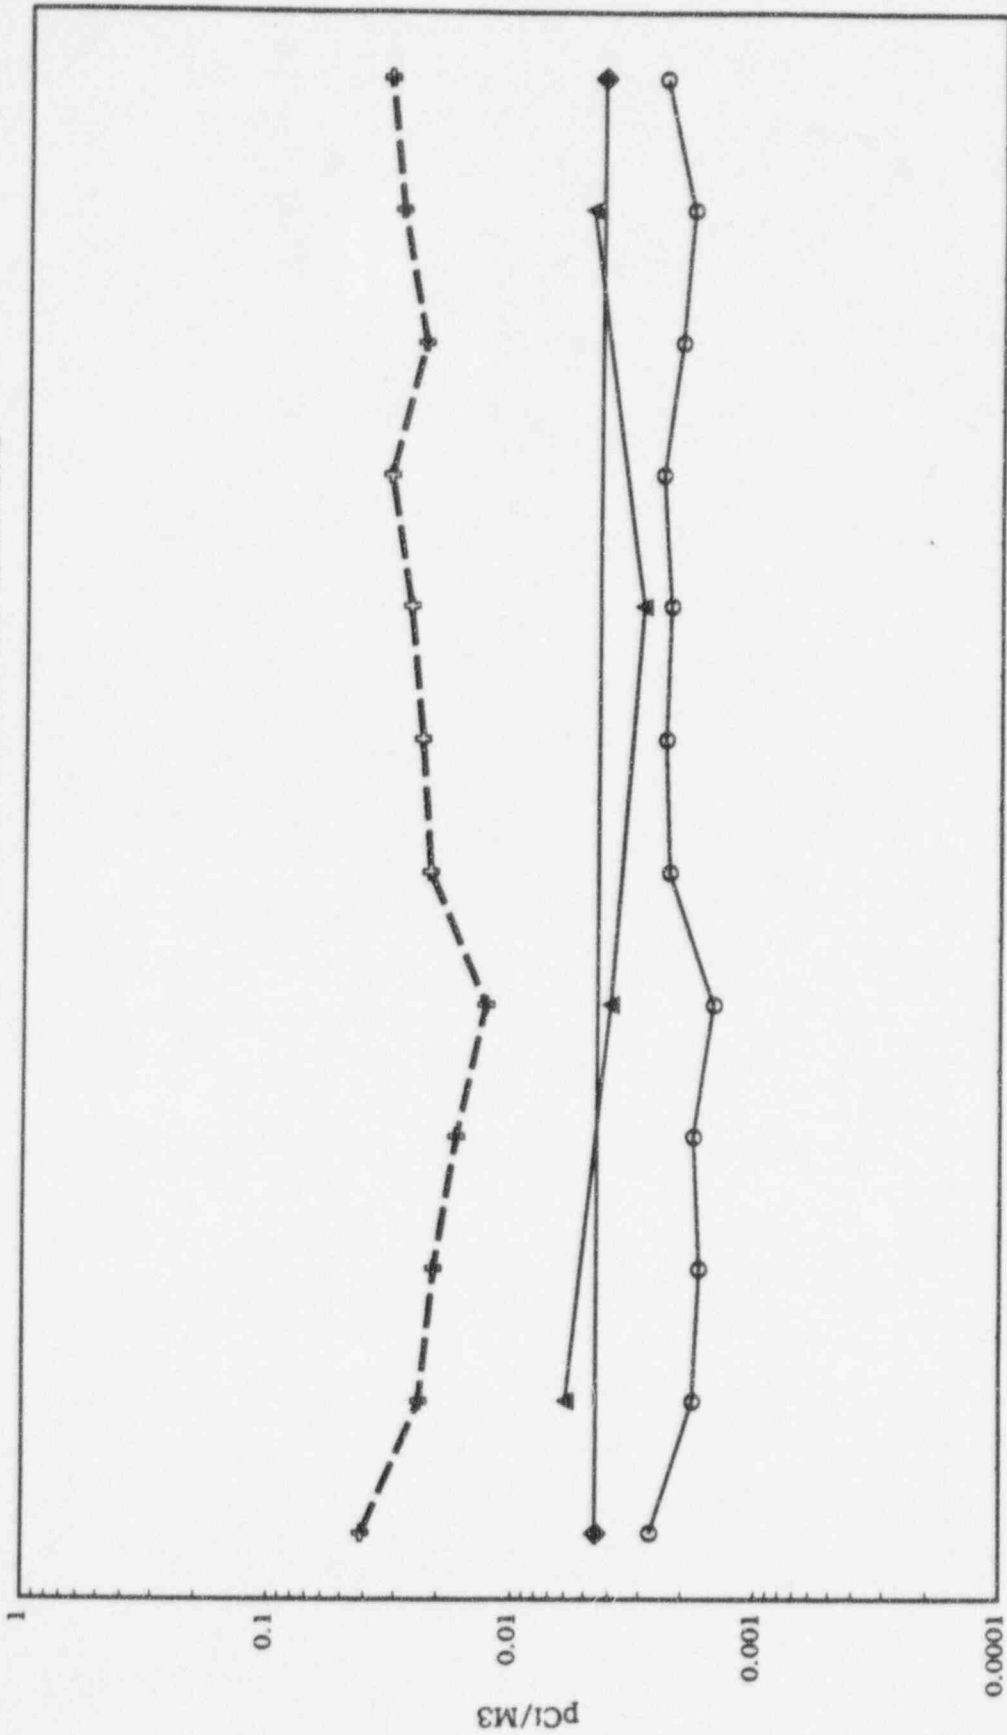

1995

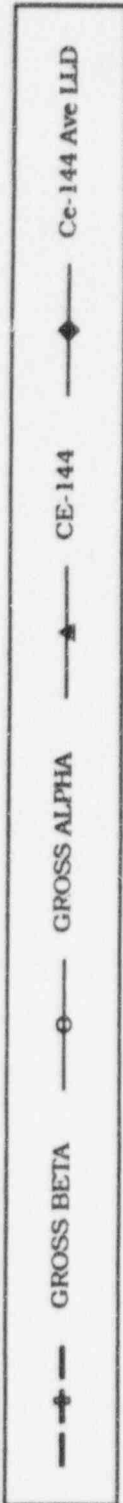


FIGURE A-2  
AIR PARTICULATES  
BETA MONTHLY AVERAGE - JEFFERSON CITY  
MISSOURI ERAMS EPA

31


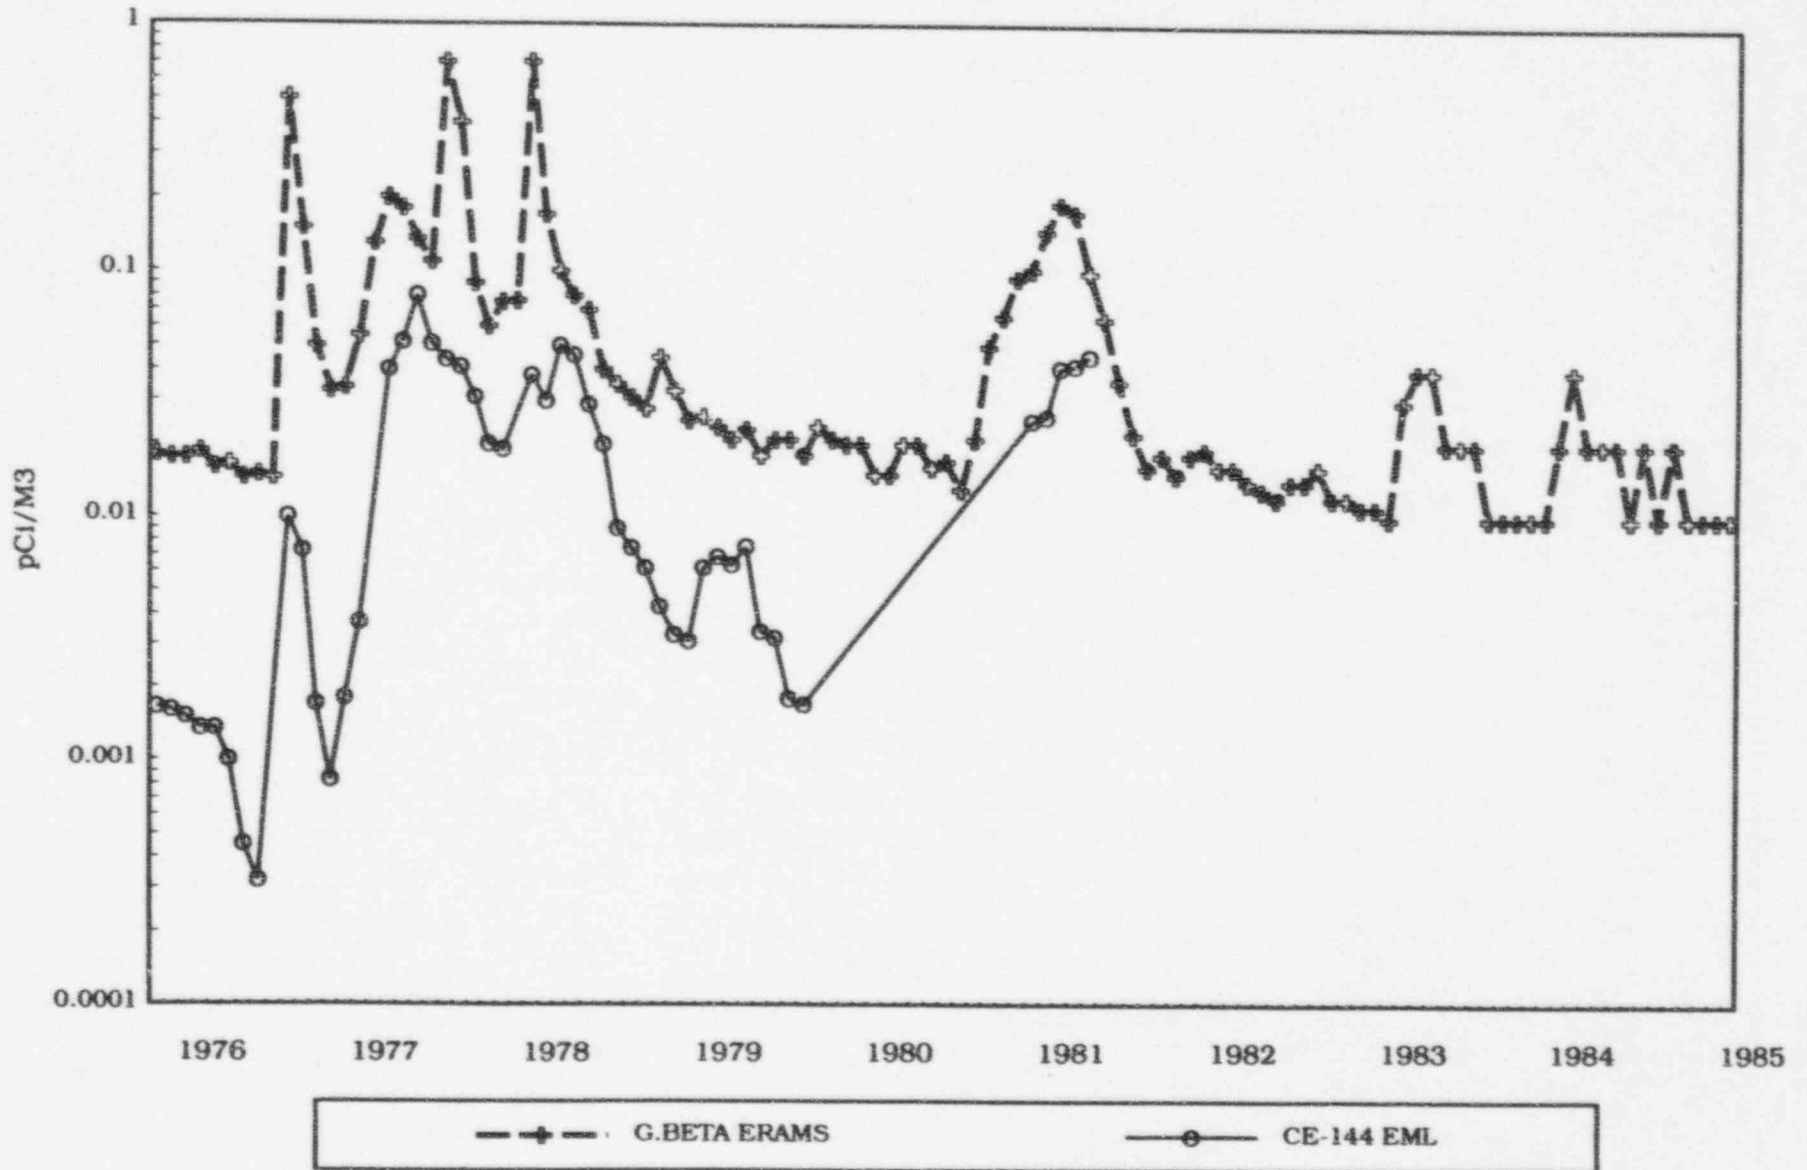


FIGURE A-2  
AIR PARTICULATES  
BETA MONTHLY AVERAGE - JEFFERSON CITY  
MISSOURI ERAMS EPA

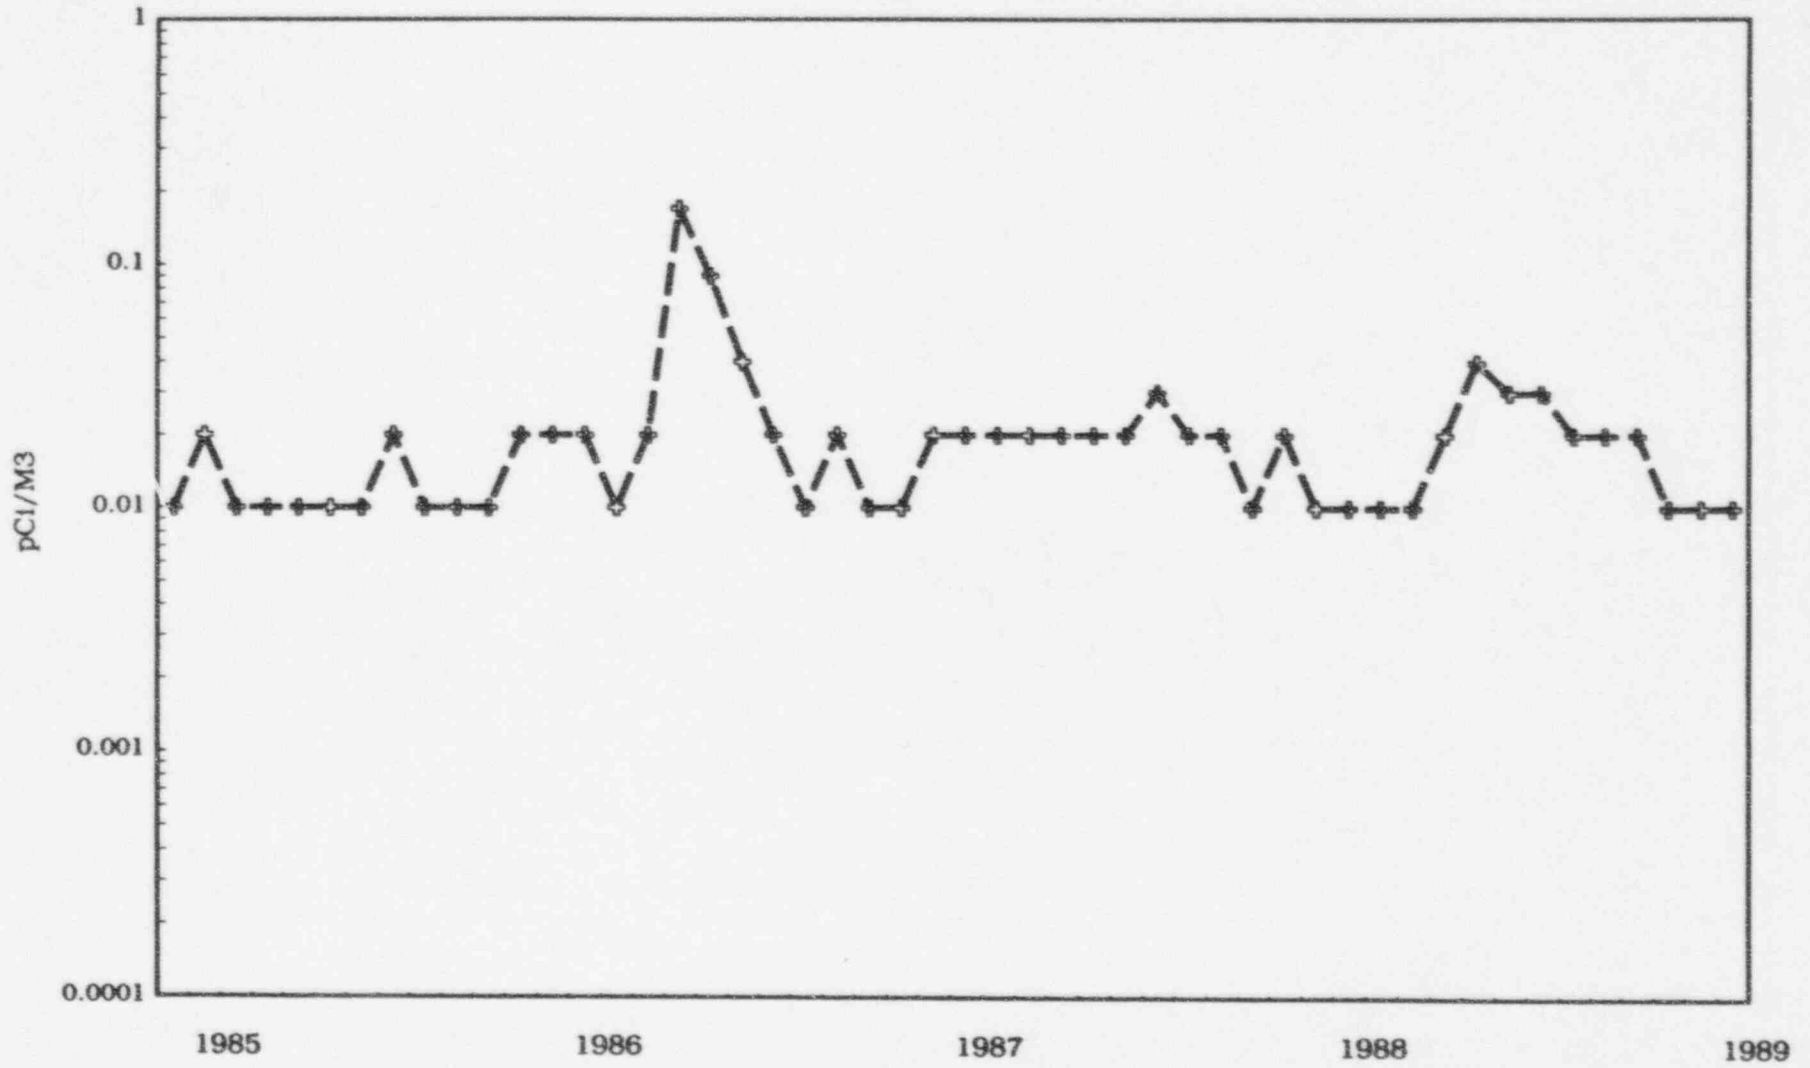

---+--- GROSS BETA ERAMS



**TABLE A-1**  
 WEEKLY COLLECTIONS FIRST QUARTER 1995  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE FILTERS  
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 01/03-01/31	MONTHLY SUMMARY 01/31-02/28	MONTHLY SUMMARY 02/28-03/28	FIRST QUARTER SUMMARY 01/03-03/28
GROSS BETA	01	3.4 ± 0.6 E-02	2.4 ± 0.5 E-02	2.1 ± 0.8 E-02	2.6 ± 0.8 E-02
	02	3.5 ± 0.8 E-02	2.1 ± 0.4 E-02	2.1 ± 0.9 E-02	2.6 ± 0.9 E-02
	03	3.6 ± 0.8 E-02	2.2 ± 0.3 E-02	2.0 ± 0.6 E-02	2.6 ± 0.9 E-02
	04	8.4 ± 1.9 E-02	4.0 ± 1.8 E-02	2.1 ± 0.8 E-02	4.8 ± 3.1 E-02
	05	4.5 ± 1.4 E-02	2.7 ± 0.6 E-02	2.8 ± 0.8 E-02	3.3 ± 1.2 E-02
	06	3.4 ± 0.6 E-02	2.0 ± 0.3 E-02	2.1 ± 0.8 E-02	2.4 ± 0.8 E-02
	07	3.7 ± 0.9 E-02	2.1 ± 0.5 E-02	2.0 ± 0.6 E-02	2.6 ± 1.0 E-02
	08	3.5 ± 1.2 E-02	2.2 ± 0.2 E-02	2.1 ± 0.9 E-02	2.6 ± 1.0 E-02
	09	3.5 ± 0.6 E-02	2.1 ± 0.3 E-02	2.0 ± 0.9 E-02	2.5 ± 0.9 E-02
	10	3.3 ± 0.9 E-02	1.9 ± 0.4 E-02	1.9 ± 0.6 E-02	2.4 ± 0.9 E-02
AVERAGE ALL STATIONS	01-10	4.1 ± 1.8 E-02	2.4 ± 0.8 E-02	2.1 ± 0.7 E-02	2.9 ± 1.5 E-02

$\bar{x}$  and s

Grand  $\bar{x}$  and s

TABLE A-2

WEEKLY COLLECTIONS SECOND QUARTER 1995

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

AIR PARTICULATE FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 03/28-05/02	MONTHLY SUMMARY 05/02-05/30	MONTHLY SUMMARY 05/30-06/27	SECOND QUARTER SUMMARY 03/28-06/27
GROSS BETA	01	1.9 ± 0.7 E-02	1.2 ± 0.3 E-02	2.4 ± 0.3 E-02	1.9 ± 0.7 E-02
	02	1.7 ± 0.3 E-02	1.3 ± 0.4 E-02	2.7 ± 0.7 E-02	1.9 ± 0.7 E-02
	03	1.5 ± 0.3 E-02	1.2 ± 0.2 E-02	2.2 ± 0.2 E-02	1.6 ± 0.4 E-02
	04	1.8 ± 0.3 E-02	1.3 ± 0.3 E-02	2.5 ± 1.3 E-02	1.9 ± 0.8 E-02
	05	2.3 ± 0.6 E-02	1.4 ± 0.4 E-02	2.3 ± 0.9 E-02	2.0 ± 0.7 E-02
	06	1.6 ± 0.4 E-02	1.3 ± 0.3 E-02	1.9 ± 0.6 E-02	1.6 ± 0.5 E-02
	07	1.6 ± 0.3 E-02	1.3 ± 0.3 E-02	2.1 ± 0.7 E-02	1.7 ± 0.5 E-02
	08	1.6 ± 0.3 E-02	1.1 ± 0.1 E-02	2.3 ± 1.0 E-02	1.7 ± 0.7 E-02
	09	1.6 ± 0.3 E-02	1.3 ± 0.4 E-02	1.9 ± 0.7 E-02	1.6 ± 0.5 E-02
	10	1.4 ± 0.4 E-02	1.2 ± 0.3 E-02	2.2 ± 0.8 E-02	1.6 ± 0.6 E-02
AVERAGE ALL STATIONS	01-10	1.7 ± 0.4 E-02	1.3 ± 0.3 E-02	2.2 ± 0.7 E-02	1.7 ± 0.6 E-02

 $\bar{x}$  and sGrand  $\bar{x}$  and s

TABLE A-3

WEEKLY COLLECTIONS - THIRD QUARTER 1995

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

AIR PARTICULATE FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 06/27-08/01	MONTHLY SUMMARY 08/01-08/29	MONTHLY SUMMARY 08/29-10/03	THIRD QUARTER SUMMARY 06/27-10/03
GROSS BETA	01	2.4 ± 0.4 E-02	2.5 ± 1.4 E-02	3.3 ± 0.7 E-02	2.7 ± 0.9 E-02
	02	2.7 ± 0.7 E-02	2.5 ± 1.0 E-02	3.3 ± 0.8 E-02	2.8 ± 0.8 E-02
	03	1.9 ± 0.5 E-02	2.5 ± 1.5 E-02	2.8 ± 1.0 E-02	2.4 ± 1.0 E-02
	04	3.3 ± 1.2 E-02	3.0 ± 0.5 E-02	4.7 ± 1.1 E-02	3.7 ± 1.2 E-02
	05	2.9 ± 1.1 E-02	2.8 ± 0.5 E-02	3.8 ± 1.0 E-02	3.2 ± 0.9 E-02
	06	2.4 ± 0.7 E-02	2.7 ± 0.9 E-02	2.9 ± 0.4 E-02	2.6 ± 0.7 E-02
	07	2.2 ± 0.5 E-02	2.3 ± 1.0 E-02	2.7 ± 0.5 E-02	2.4 ± 0.6 E-02
	08	2.2 ± 0.3 E-02	3.6 ± 1.8 E-02	3.7 ± 1.2 E-02	3.1 ± 1.3 E-02
	09	2.0 ± 0.6 E-02	2.5 ± 1.2 E-02	3.0 ± 0.7 E-02	2.5 ± 0.9 E-02
	10	2.2 ± 0.3 E-02	2.6 ± 1.3 E-02	3.3 ± 0.7 E-02	2.7 ± 0.9 E-02
AVERAGE ALL STATIONS	01-10	2.4 ± 0.7 E-02	2.7 ± 1.1 E-02	3.3 ± 1.0 E-02	2.8 ± 1.0 E-02

 $\bar{x}$  and sGrand  $\bar{x}$  and s

**TABLE A-4**  
 WEEKLY COLLECTIONS FOURTH QUARTER 1995  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE FILTERS  
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 10/03-10/31	MONTHLY SUMMARY 10/31-11/28	MONTHLY SUMMARY 11/28-01/02	FOURTH QUARTER SUMMARY 10/03-01/02
GROSS BETA	01	1.9 ± 1.1 E-02	2.9 ± 0.1 E-02	4.4 ± 2.3 E-02	3.2 ± 1.9 E-02
	02	2.3 ± 0.7 E-02	3.0 ± 0.9 E-02	3.2 ± 1.1 E-02	2.9 ± 0.9 E-02
	03	2.1 ± 0.5 E-02	2.8 ± 0.3 E-02	2.9 ± 0.9 E-02	2.6 ± 0.7 E-02
	04	3.2 ± 1.8 E-02	2.9 ± 0.4 E-02	3.1 ± 0.9 E-02	3.1 ± 1.1 E-02
	05	2.8 ± 0.9 E-02	2.7 ± 0.4 E-02	3.2 ± 1.3 E-02	2.9 ± 0.9 E-02
	06	2.3 ± 0.4 E-02	3.4 ± 0.2 E-02	3.6 ± 1.2 E-02	3.1 ± 0.9 E-02
	07	2.3 ± 0.8 E-02	3.0 ± 0.3 E-02	3.1 ± 1.6 E-02	2.8 ± 1.1 E-02
	08	2.7 ± 1.0 E-02	3.7 ± 0.7 E-02	3.7 ± 1.3 E-02	3.2 ± 1.1 E-02
	09	2.0 ± 0.6 E-02	3.3 ± 0.3 E-02	3.1 ± 1.2 E-02	2.8 ± 0.9 E-02
	10	2.4 ± 0.8 E-02	3.2 ± 0.3 E-02	3.3 ± 1.1 E-02	3.0 ± 0.9 E-02
AVERAGE ALL STATIONS	01-10	2.4 ± 0.9 E-02	3.0 ± 0.5 E-02	3.4 ± 1.3 E-02	3.0 ± 1.1 E-02

$\bar{x}$  and s

Grand  $\bar{x}$  and s

**TABLE B-1**  
 WEEKLY COLLECTIONS FIRST QUARTER 1995  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE FILTERS  
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 01/03-01/31	MONTHLY SUMMARY 01/31-02/28	MONTHLY SUMMARY 02/28-03/28	FIRST QUARTER SUMMARY 01/03-03/28
GROSS ALPHA	01	2.6 ± 0.7 E-03	1.5 ± 0.4 E-03	1.8 ± 1.0 E-03	2.0 ± 0.8 E-03
	02	2.4 ± 0.3 E-03	1.4 ± 0.3 E-03	1.9 ± 0.9 E-03	1.9 ± 0.7 E-03
	03	2.1 ± 0.9 E-03	1.9 ± 1.0 E-03	1.5 ± 0.6 E-03	1.8 ± 0.8 E-03
	04	5.3 ± 1.0 E-03	3.0 ± 2.0 E-03	1.7 ± 0.6 E-03	3.3 ± 2.0 E-03
	05	2.3 ± 0.7 E-03	2.0 ± 0.4 E-03	1.4 ± 0.5 E-03	1.9 ± 0.6 E-03
	06	2.6 ± 1.2 E-03	1.3 ± 0.7 E-03	1.7 ± 0.6 E-03	1.8 ± 0.9 E-03
	07	2.5 ± 0.5 E-03	1.6 ± 0.6 E-03	2.2 ± 1.2 E-03	2.1 ± 0.9 E-03
	08	3.3 ± 1.7 E-03	1.8 ± 0.6 E-03	1.4 ± 0.5 E-03	2.2 ± 1.3 E-03
	09	2.0 ± 0.6 E-03	1.7 ± 0.1 E-03	1.6 ± 0.5 E-03	1.8 ± 0.4 E-03
	10	1.8 ± 1.0 E-03	1.5 ± 0.6 E-03	1.9 ± 0.3 E-03	1.7 ± 0.7 E-03
AVERAGE ALL STATIONS	01-10	2.7 ± 1.3 E-03	1.8 ± 0.9 E-03	1.7 ± 0.7 E-03	2.0 ± 1.1 E-03

$\bar{x}$  and s

Grand  $\bar{x}$  and s

TABLE B-2  
WEEKLY COLLECTIONS SECOND QUARTER 1995

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

AIR PARTICULATE FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 03/28-05/02	MONTHLY SUMMARY 05/02-05/30	MONTHLY SUMMARY 05/30-06/27	SECOND QUARTER SUMMARY 03/28-06/27
GROSS ALPHA	01	1.6 ± 0.5 E-03	1.4 ± 0.5 E-03	2.2 ± 1.2 E-03	1.7 ± 0.8 E-03
	02	1.9 ± 0.7 E-03	1.4 ± 0.1 E-03	3.0 ± 0.7 E-03	2.1 ± 0.8 E-03
	03	1.5 ± 0.4 E-03	1.5 ± 0.6 E-03	2.6 ± 0.4 E-03	1.7 ± 0.6 E-03
	04	2.1 ± 1.1 E-03	1.6 ± 0.5 E-03	2.7 ± 1.5 E-03	2.1 ± 1.1 E-03
	05	2.2 ± 1.0 E-03	1.8 ± 0.8 E-03	2.3 ± 1.3 E-03	2.1 ± 1.0 E-03
	06	1.7 ± 0.3 E-03	1.5 ± 0.7 E-03	2.2 ± 1.1 E-03	1.8 ± 0.7 E-03
	07	1.9 ± 0.6 E-03	2.3 ± 0.4 E-03	2.2 ± 1.1 E-03	2.1 ± 0.7 E-03
	08	1.8 ± 0.4 E-03	1.4 ± 0.6 E-03	1.7 ± 0.4 E-03	1.7 ± 0.5 E-03
	09	1.5 ± 0.4 E-03	1.3 ± 0.4 E-03	2.0 ± 0.8 E-03	1.6 ± 0.6 E-03
	10	1.7 ± 0.4 E-03	1.1 ± 0.3 E-03	2.3 ± 1.0 E-03	1.7 ± 0.7 E-03
AVERAGE ALL STATIONS	01-10	1.8 ± 0.6 E-03	1.5 ± 0.6 E-03	2.3 ± 1.0 E-03	1.9 ± 0.8 E-03
	$\bar{x}$ and s				Grand $\bar{x}$ and s

38

TABLE B-3

WEEKLY COLLECTIONS - THIRD QUARTER 1995

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

AIR PARTICULATE FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 06/27-08/01	MONTHLY SUMMARY 08/01-08/29	MONTHLY SUMMARY 08/29-10/03	THIRD QUARTER SUMMARY 06/27-10/03
GROSS ALPHA	01	2.7 ± 1.0 E-03	2.2 ± 0.4 E-03	2.3 ± 0.3 E-03	2.4 ± 0.7 E-03
	02	3.3 ± 2.0 E-03	2.3 ± 0.7 E-03	2.2 ± 0.3 E-03	2.6 ± 1.3 E-03
	03	1.8 ± 0.8 E-03	1.8 ± 0.6 E-03	2.2 ± 0.4 E-03	1.9 ± 0.6 E-03
	04	2.5 ± 0.6 E-03	2.5 ± 0.7 E-03	3.2 ± 1.3 E-03	2.7 ± 0.9 E-03
	05	2.3 ± 0.6 E-03	2.6 ± 0.7 E-03	2.9 ± 0.8 E-03	2.6 ± 0.7 E-03
	06	2.1 ± 0.9 E-03	2.1 ± 0.6 E-03	2.2 ± 0.3 E-03	2.1 ± 0.6 E-03
	07	2.9 ± 1.4 E-03	2.6 ± 0.9 E-03	2.3 ± 0.3 E-03	2.6 ± 0.9 E-03
	08	2.2 ± 1.5 E-03	2.7 ± 0.7 E-03	2.7 ± 1.0 E-03	2.5 ± 1.1 E-03
	09	2.2 ± 0.4 E-03	2.5 ± 0.6 E-03	2.4 ± 0.9 E-03	2.4 ± 0.7 E-03
	10	1.7 ± 0.5 E-03	2.3 ± 0.2 E-03	2.3 ± 0.7 E-03	2.1 ± 0.6 E-03
AVERAGE ALL STATIONS	01-10	2.4 ± 1.1 E-03	2.3 ± 0.6 E-03	2.5 ± 0.7 E-03	2.4 ± 0.9 E-03

$\bar{x}$  and s

Grand  $\bar{x}$  and s

**TABLE B-4**  
 WEEKLY COLLECTIONS FOURTH QUARTER 1995  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE FILTERS  
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 10/03-10/31	MONTHLY SUMMARY 10/31-11/28	MONTHLY SUMMARY 11/28-01/02	FOURTH QUARTER SUMMARY 10/03-01/02
GROSS ALPHA	01	1.7 ± 0.5 E-03	1.9 ± 0.2 E-03	2.9 ± 1.4 E-03	2.3 ± 1.1 E-03
	02	2.3 ± 0.6 E-03	2.8 ± 1.6 E-03	1.9 ± 0.6 E-03	2.3 ± 1.0 E-03
	03	1.9 ± 0.3 E-02	1.7 ± 0.9 E-03	2.6 ± 1.3 E-03	2.1 ± 1.0 E-03
	04	2.7 ± 1.3 E-02	2.0 ± 1.1 E-03	2.3 ± 0.3 E-03	2.3 ± 0.9 E-03
	05	2.2 ± 0.6 E-02	1.4 ± 0.5 E-02	2.8 ± 2.1 E-03	2.2 ± 1.4 E-02
	06	2.1 ± 0.9 E-02	1.4 ± 0.5 E-03	2.4 ± 1.0 E-03	2.0 ± 0.9 E-03
	07	2.2 ± 0.7 E-03	2.1 ± 0.9 E-03	2.6 ± 0.8 E-03	2.3 ± 0.8 E-03
	08	2.4 ± 1.1 E-03	1.7 ± 0.8 E-03	2.3 ± 1.3 E-03	2.1 ± 1.1 E-03
	09	1.8 ± 0.5 E-03	1.8 ± 0.2 E-03	2.2 ± 0.5 E-03	2.0 ± 0.5 E-03
	10	2.2 ± 0.8 E-03	1.9 ± 0.3 E-03	2.7 ± 0.9 E-03	2.3 ± 0.7 E-03
AVERAGE ALL STATIONS	01-10	2.1 ± 0.7 E-03	1.9 ± 0.8 E-03	2.5 ± 1.1 E-03	2.2 ± 0.9 E-03

$\bar{x}$  and s

Grand  $\bar{x}$  and s



C. AIR RADIOIODINE - CHARCOAL FILTERS (See Tables C-1 through C-4)

STATIONS 01 TO 10

Charcoal filters used in series with air particulate filters were collected weekly during 1995 at stations 01 through 10 and monitored for radiiodine.

Tables C-1 through C-4 show the average monthly and quarterly results for each station and the average of all 10 stations. Airborne I-131 levels were below the limits of detection for all of 1995.

Figure C-1 plots the results of I-131 as monitored in charcoal filters and summarized monthly in 1995 compared with previous years. Results for 1995 were below the normal limits of detection indicating no atmospheric effect from the operations of CNS.

FIGURE C-1  
AIRBORNE I-131  
MONTHLY AVERAGE - ALL LOCATIONS

42

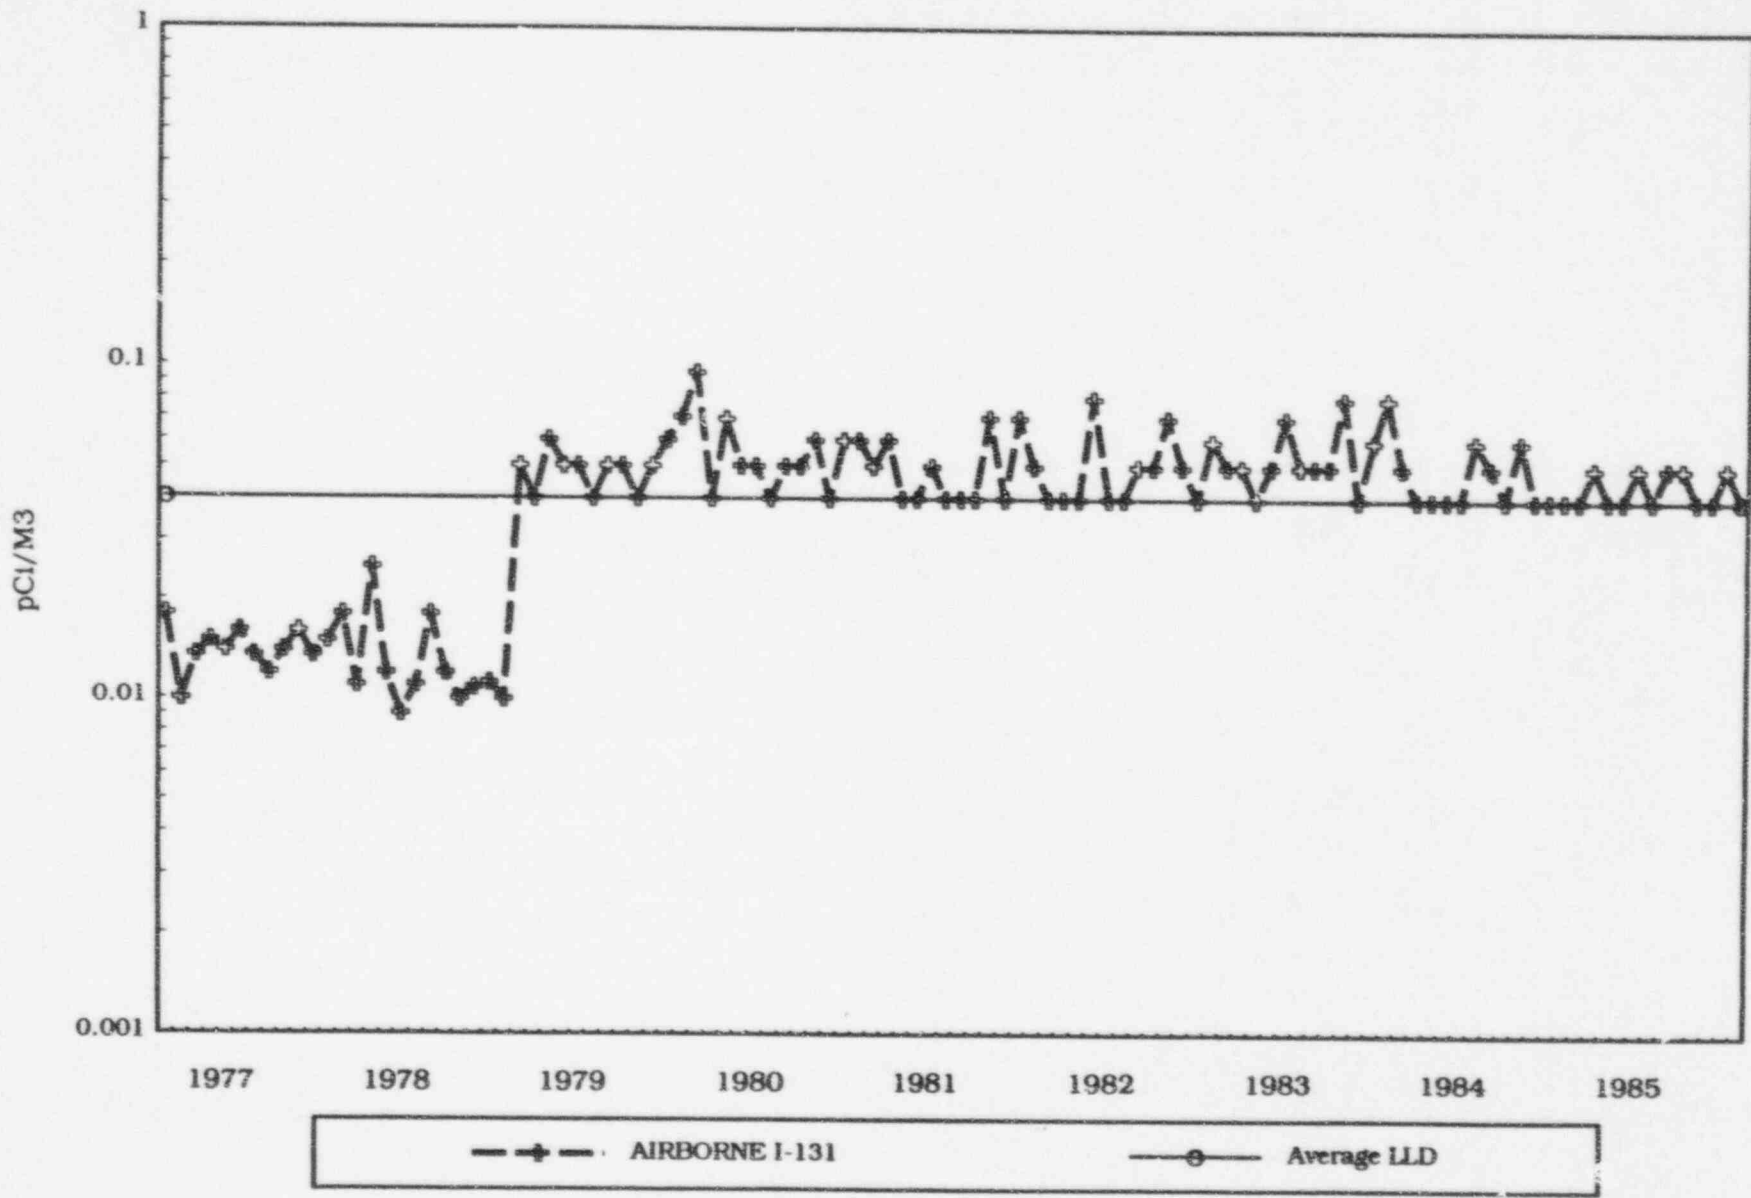


FIGURE C-1  
 AIRBORNE I-131  
 MONTHLY AVERAGE - ALL LOCATIONS


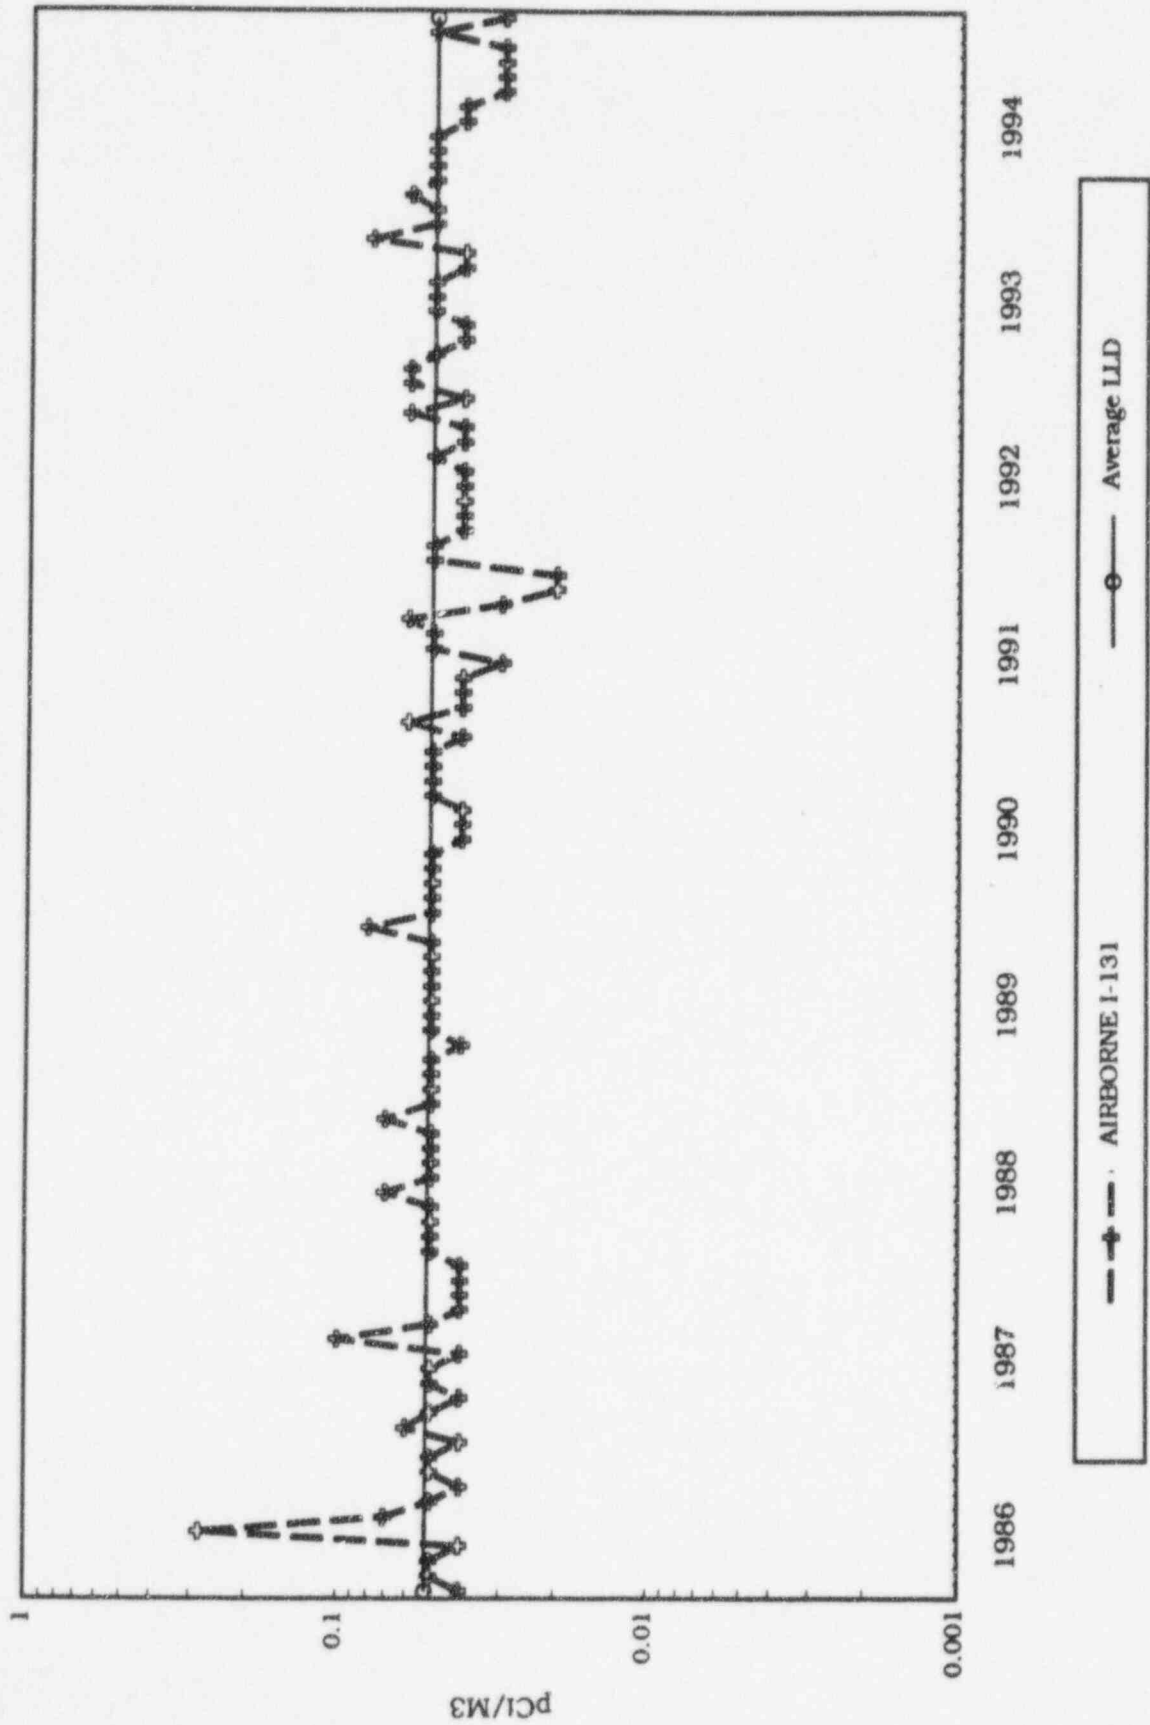


FIGURE C-1  
 AIRBORNE I-131  
 MONTHLY AVERAGE - ALL LOCATIONS

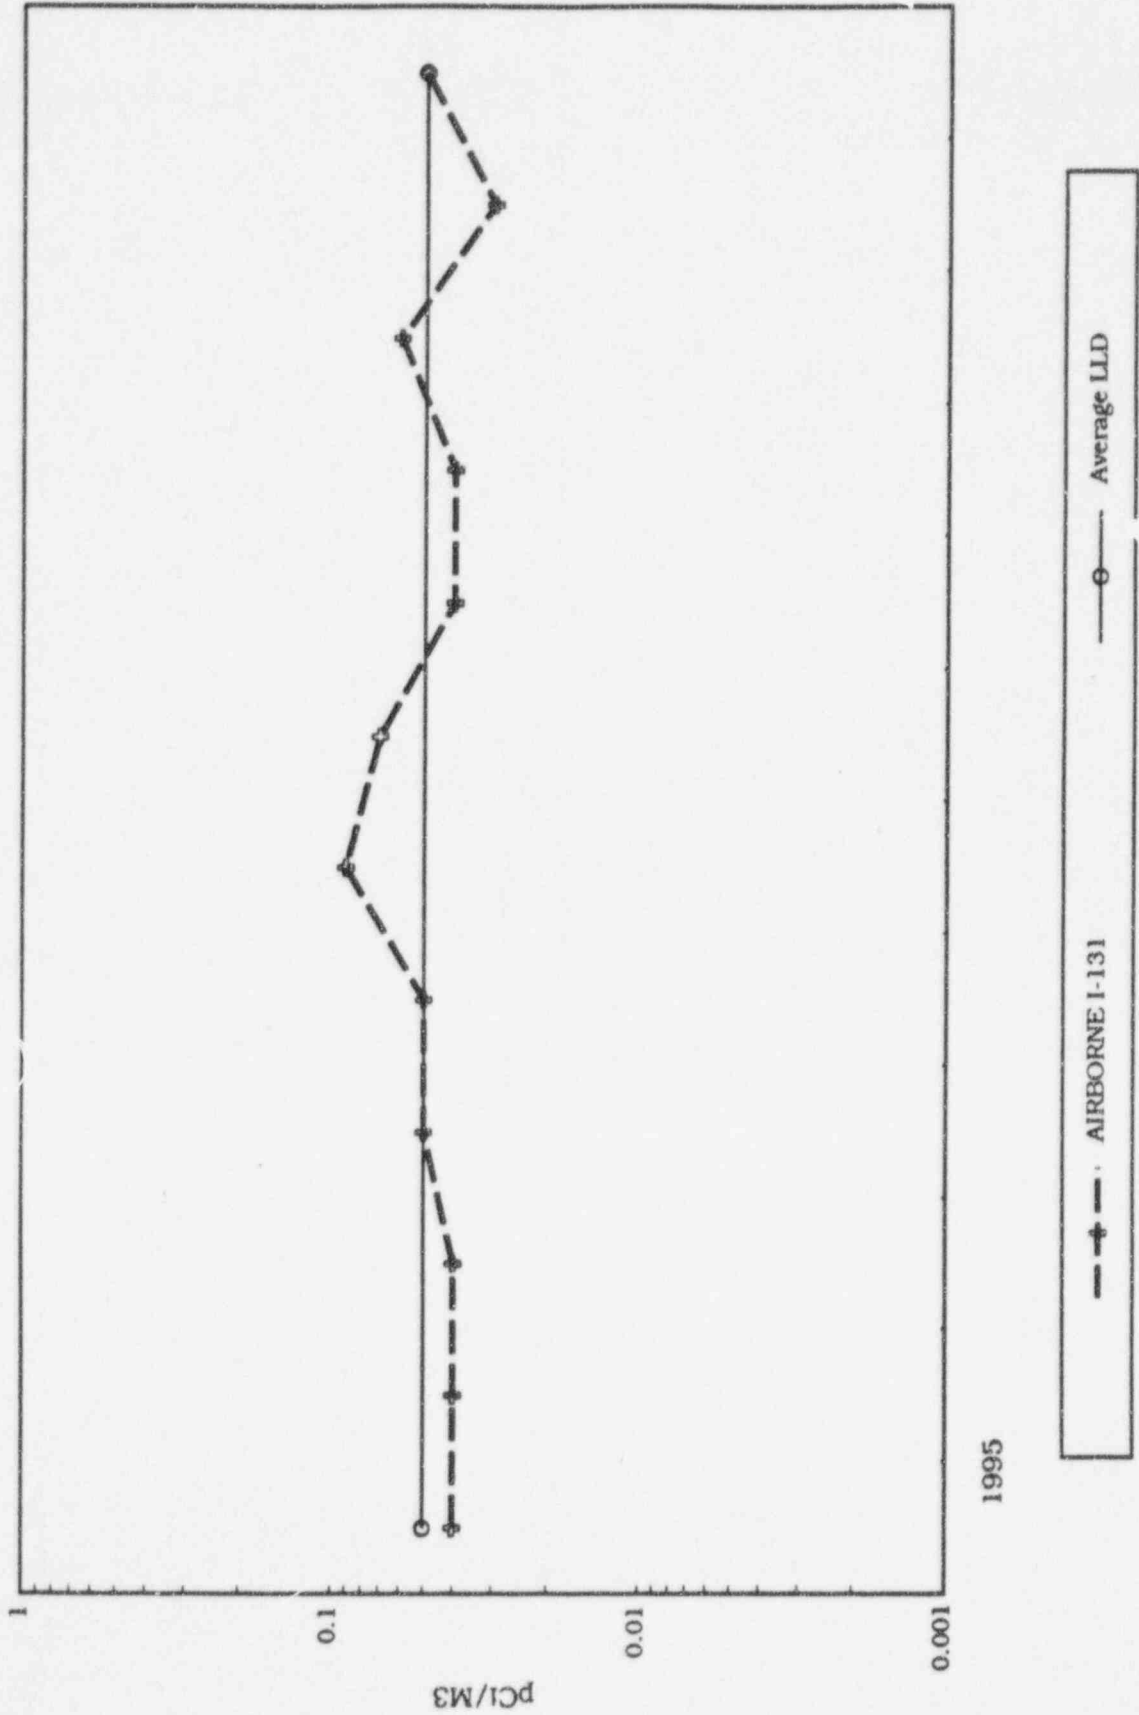

1995

TABLE C-1

WEEKLY COLLECTIONS FIRST QUARTER 1995

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

CHARCOAL FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 01/03-01/31		MONTHLY SUMMARY 01/31-02/28		MONTHLY SUMMARY 02/28-03/28		QUARTERLY SUMMARY 01/03-03/28		DET./ TOTAL	RANGE	
IODINE-131	01	L.T.	3. E-02	L.T.	4. E-02	L.T.	4. E-02	L.T.	4. E-02	0/12	(L.T.2.-L.T.4.)E-02	
	02	L.T.	3. E-02	L.T.	4. E-02	L.T.	3. E-02	L.T.	4. E-02	0/12	(L.T.1.-L.T.4.)E-02	
	03	L.T.	3. E-02	L.T.	4. E-02	L.T.	4. E-02	L.T.	4. E-02	0/12	(L.T.2.-L.T.4.)E-02	
	04	L.T.	3. E-02	L.T.	4. E-02	L.T.	4. E-02	L.T.	4. E-02	0/12	(L.T.2.-L.T.4.)E-02	
	05	L.T.	2. E-02	L.T.	3. E-02	L.T.	2. E-02	L.T.	3. E-02	0/12	(L.T.1.-L.T.3.)E-02	
	06	L.T.	4. E-02	L.T.	3. E-02	L.T.	3. E-02	L.T.	4. E-02	0/12	(L.T.2.-L.T.4.)E-02	
	07	L.T.	4. E-02	L.T.	3. E-02	L.T.	3. E-02	L.T.	4. E-02	0/12	(L.T.1.-L.T.4.)E-02	
	08	L.T.	4. E-02	L.T.	3. E-02	L.T.	3. E-02	L.T.	4. E-02	0/12	(L.T.1.-L.T.4.)E-02	
	09	L.T.	4. E-02	L.T.	3. E-02	L.T.	3. E-02	L.T.	4. E-02	0/12	(L.T.1.-L.T.4.)E-02	
	10	L.T.	2. E-02	L.T.	2. E-02	L.T.	2. E-02	L.T.	2. E-02	0/12	(L.T.1.-L.T.2.)E-02	
	01-10	L.T.	4. E-02	L.T.	4. E-02	L.T.	4. E-02	L.T.	4. E-02		--	
	DET./TOTAL		0/40		0/40		0/40		0/120		0/120	--
	RANGE	(L.T.1.-L.T.4.)E-02		(L.T.1.-L.T.4.)E-02		(L.T.1.-L.T.4.)E-02		(L.T.1.-L.T.4.)E-02		--	(L.T.1.-L.T.4.)E-02	

TABLE C-2

WEEKLY COLLECTIONS SECOND QUARTER 1995

NEBRASKA PUBLIC POWER DISTRICT

COOPER NUCLEAR STATION

EXPOSURE PATHWAY - AIRBORNE

CHARCOAL FILTERS

pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 03/28-05/02		MONTHLY SUMMARY 05/02-05/30		MONTHLY SUMMARY 05/30-06/27		QUARTERLY SUMMARY 03/28-06/27		DET./ TOTAL	RANGE				
IODINE-131	01	L.T.	3.	E-02	L.T.	4.	E-02	L.T.	6.	E-02	L.T.	6.	E-02	0/13	(L.T.1.-L.T.6.)E-02
	02	L.T.	4.	E-02	L.T.	4.	E-02	L.T.	9.	E-02	L.T.	9.	E-02	0/13	(L.T.2.-L.T.9.)E-02
	03	L.T.	4.	E-02	L.T.	4.	E-02	L.T.	4.	E-02	L.T.	4.	E-02	0/10	(L.T.2.-L.T.4.)E-02
	04	L.T.	4.	E-02	L.T.	4.	E-02	L.T.	6.	E-02	L.T.	6.	E-02	0/13	(L.T.2.-L.T.6.)E-02
	05	L.T.	2.	E-02	L.T.	2.	E-02	L.T.	3.	E-02	L.T.	3.	E-02	0/13	(L.T.1.-L.T.3.)E-02
	06	L.T.	5.	E-02	L.T.	5.	E-02	L.T.	3.	E-02	L.T.	5.	E-02	0/13	(L.T.2.-L.T.5.)E-02
	07	L.T.	5.	E-02	L.T.	5.	E-02	L.T.	3.	E-02	L.T.	5.	E-02	0/13	(L.T.2.-L.T.5.)E-02
	08	L.T.	5.	E-02	L.T.	5.	E-02	L.T.	3.	E-02	L.T.	5.	E-02	0/13	(L.T.2.-L.T.5.)E-02
	09	L.T.	5.	E-02	L.T.	5.	E-02	L.T.	3.	E-02	L.T.	5.	E-02	0/13	(L.T.2.-L.T.5.)E-02
	10	L.T.	4.	E-02	L.T.	3.	E-02	L.T.	2.	E-02	L.T.	4.	E-02	0/13	(L.T.1.-L.T.4.)E-02
	01-10	L.T.	5.	E-02	L.T.	5.	E-02	L.T.	9.	E-02	L.T.	9.	E-02		--
	DET./TOTAL		0/50			0/39		0/38		0/127		0/127			--
	RANGE		(L.T.1.-L.T.5.)E-02		(L.T.2.-L.T.5.)E-02		(L.T.2.-L.T.9.)E-02		(L.T.1.-L.T.9.)E-02		--		(L.T.1.-L.T.9.)E-02		

TABLE C-3  
WEEKLY COLLECTIONS THIRD QUARTER 1995  
NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
CHARCOAL FILTERS  
pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 06/27-08/01	MONTHLY SUMMARY 08/01-08/29	MONTHLY SUMMARY 08/29-10/03	QUARTERLY SUMMARY 06/27-10/03	DET./ TOTAL	RANGE
IODINE-131	01	L.T. 5. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 5. E-02	0/14	(L.T.2.-L.T.5.)E-02
	02	L.T. 7. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 7. E-02	0/14	(L.T.2.-L.T.7.)E-02
	03	L.T. 4. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 4. E-02	0/14	(L.T.2.-L.T.4.)E-02
	04	L.T. 5. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 5. E-02	0/14	(L.T.2.-L.T.5.)E-02
	05	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	0/14	(L.T.1.-L.T.3.)E-02
	06	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	0/14	(L.T.2.-L.T.4.)E-02
	07	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	0/14	(L.T.2.-L.T.4.)E-02
	08	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	0/14	(L.T.2.-L.T.4.)E-02
	09	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	0/13	(L.T.2.-L.T.4.)E-02
	10	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	0/14	(L.T.1.-L.T.3.)E-02
01-10		L.T. 7. E-02	L.T. 4. E-02	L.T. 4. E-02	L.T. 7. E-02		--
DET./TOTAL		0/49	0/40	0/50	0/139		--
RANGE		(L.T.1.-L.T.7.)E-02	(L.T.1.-L.T.4.)E-02	(L.T.1.-L.T.4.)E-02	(L.T.1.-L.T.7.)E-02		-- (L.T.1.-L.T.7.)E-02

TABLE C-4  
WEEKLY COLLECTIONS FOURTH QUARTER 1995  
NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
CHARCOAL FILTERS  
pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER	MONTHLY SUMMARY 10/03-10/31	MONTHLY SUMMARY 10/31-11/28	MONTHLY SUMMARY 11/28-01/02	QUARTERLY SUMMARY 10/03-01/02	DET./ TOTAL	RANGE
IODINE-131	01	L.T. 3. E-02	L.T. 3. E-02	L.T. 5. E-02	L.T. 5. E-02	0/12	(L.T.2.-L.T.5.)E-02
	02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	0/12	(L.T.2.-L.T.3.)E-02
	03	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	0/13	(L.T.2.-L.T.3.)E-02
	04	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	0/13	(L.T.2.-L.T.3.)E-02
	05	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	0/13	(L.T.1.-L.T.2.)E-02
	06	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	0/13	(L.T.2.-L.T.4.)E-02
	07	L.T. 5. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	08	L.T. 5. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 5. E-02	0/13	(L.T.2.-L.T.5.)E-02
	09	L.T. 6. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 6. E-02	0/13	(L.T.2.-L.T.6.)E-02
	10	L.T. 5. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 5. E-02	0/13	(L.T.1.-L.T.5.)E-02
01-10		L.T. 6. E-02	L.T. 3. E-02	L.T. 5. E-02	L.T. 6. E-02	0/129	
DET./TOTAL		0/40	0/39	0/50	0/129		
RANGE		(L.T.1.-L.T.6.)E-02	(L.T.1.-L.T.3.)E-02	(L.T.1.-L.T.5.)E-02	(L.T.1.-L.T.6.)E-02	--	(L.T.1.-L.T.6.)E-02



## D. COMPOSITES OF AIR PARTICULATE FILTERS - GAMMA

(See Tables D-1 and D-2)

### STATIONS 01 TO 10

Air Particulate Filters, which were collected weekly, were composited for each station for a quarterly gamma spectral analysis during the four quarters of 1995.

Beryllium-7, a naturally occurring cosmogenic nuclide, was detected in 40 of 40 samples at a level of 0.13 pCi per cubic meter which is similar to the levels of past years. Potassium-40, also a naturally occurring nuclide, was detected in nine of 40 samples at a level near the normal level of detection.

Figure D-1 graphs the gross beta, gross alpha and Ce-144 activity as measured on air particulate filters collected weekly at CNS. (This is the same as Figure A-1, B-1). The plot illustrates that there were no detections of Ce-144 above the normal level of detection as measured by the quarterly gamma scan of samples from CNS.

Figure D-2 shows that measurements of Ce-144 are no longer reported by the Environmental Measurements Laboratory of the US Department of Energy because the artificial nuclides such as Ce-144, have reached the limits of detection by the analytical techniques now used.

FIGURE D-1  
 AIR PARTICULATES - CNS  
 ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS  
 CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

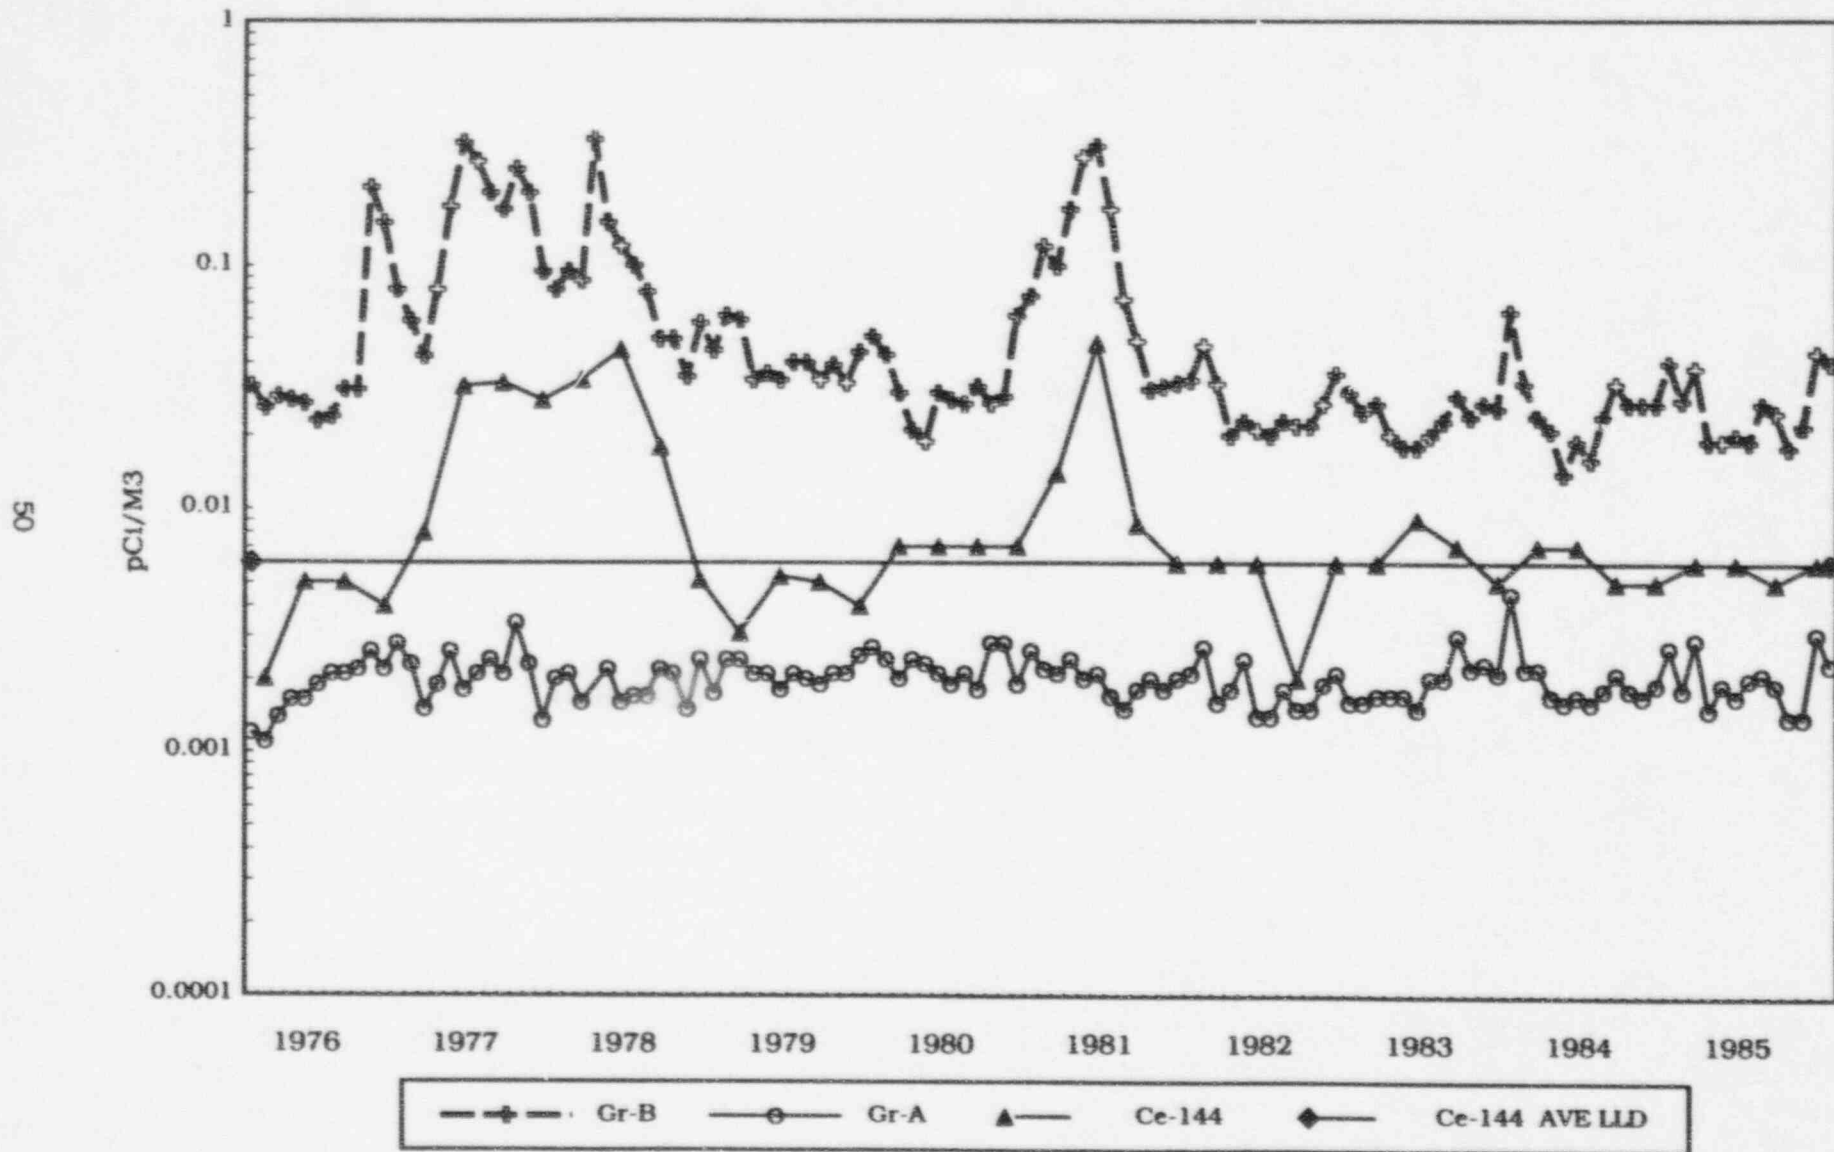


FIGURE D-1  
AIR PARTICULATES - CNS  
ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS  
CE-144 QUARTERLY AVERAGE - ALL LOCATIONS


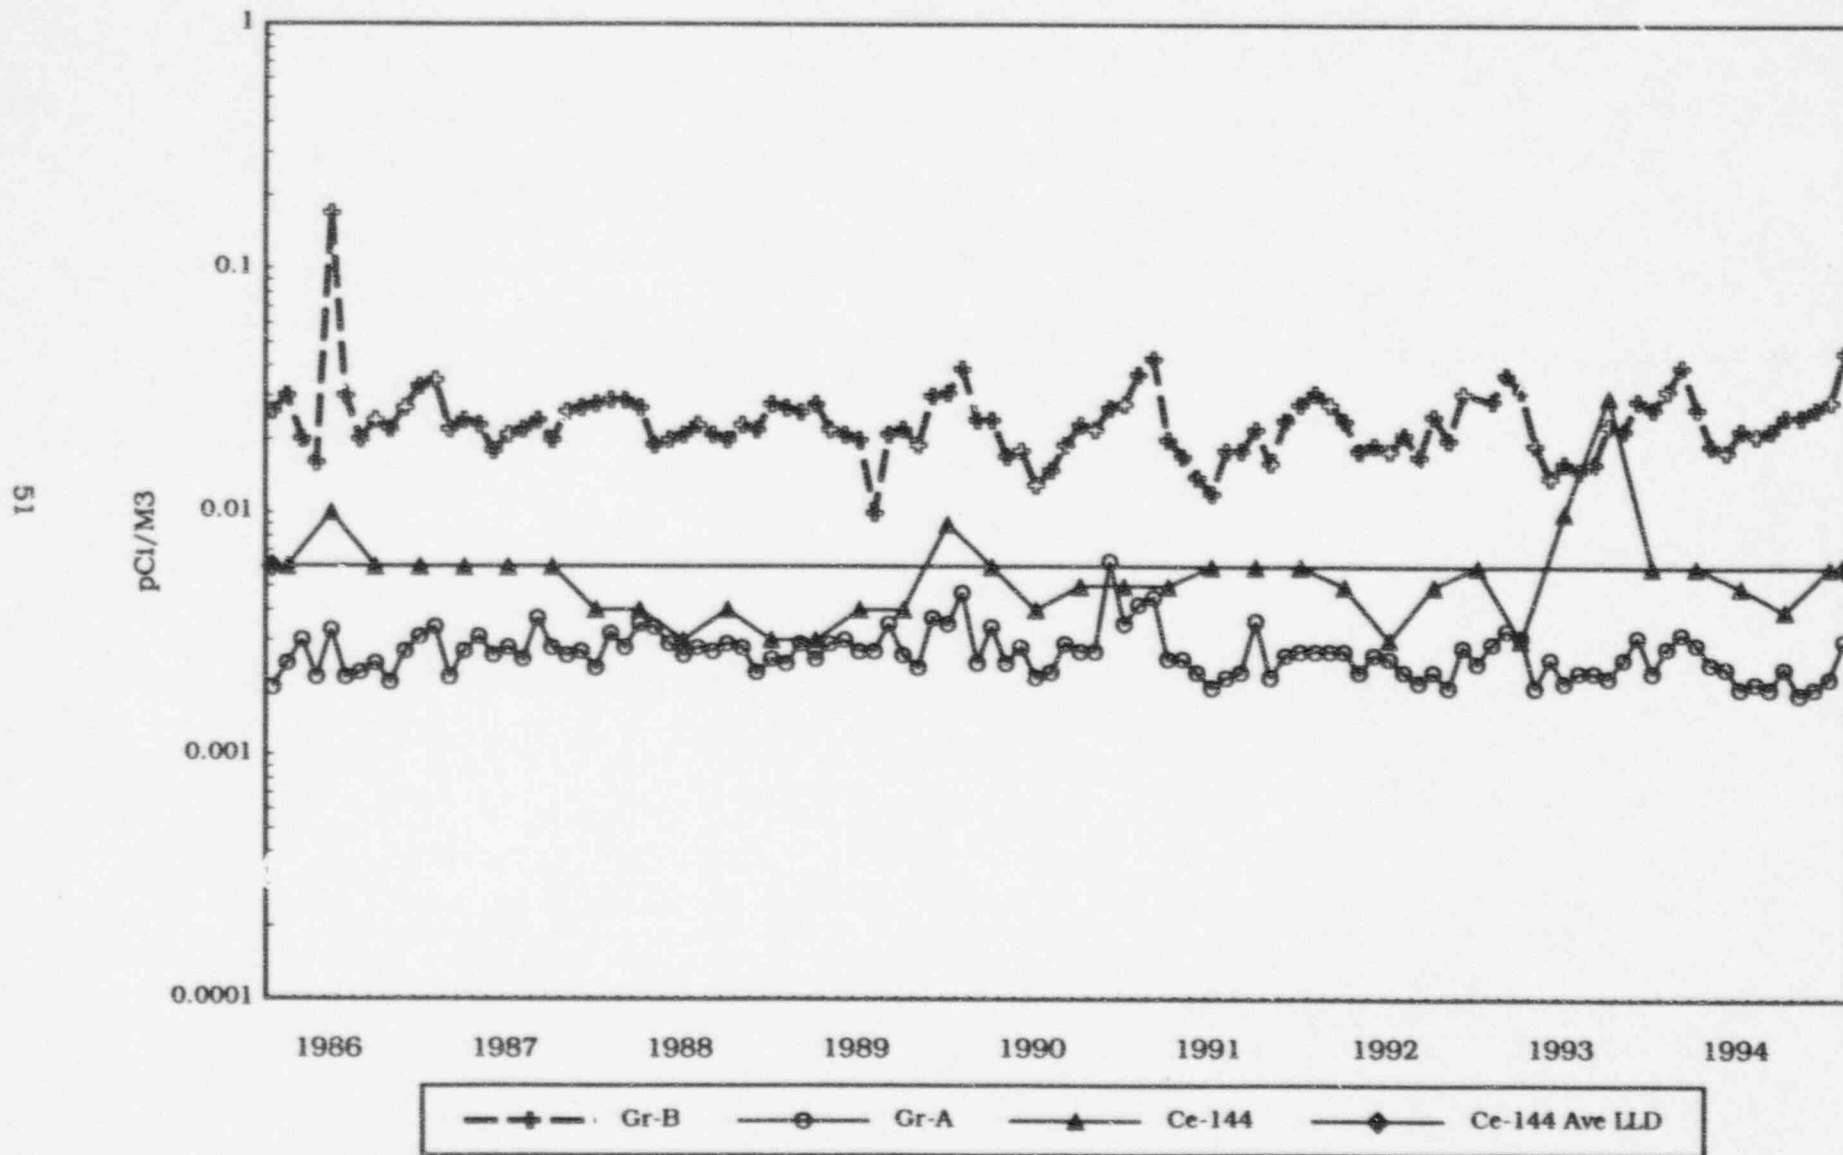


FIGURE D1  
 AIR PARTICULATES - CNS  
 ALPHA AND BETA MONTHLY AVERAGE - ALL LOCATIONS  
 CE-144 QUARTERLY AVERAGE - ALL LOCATIONS

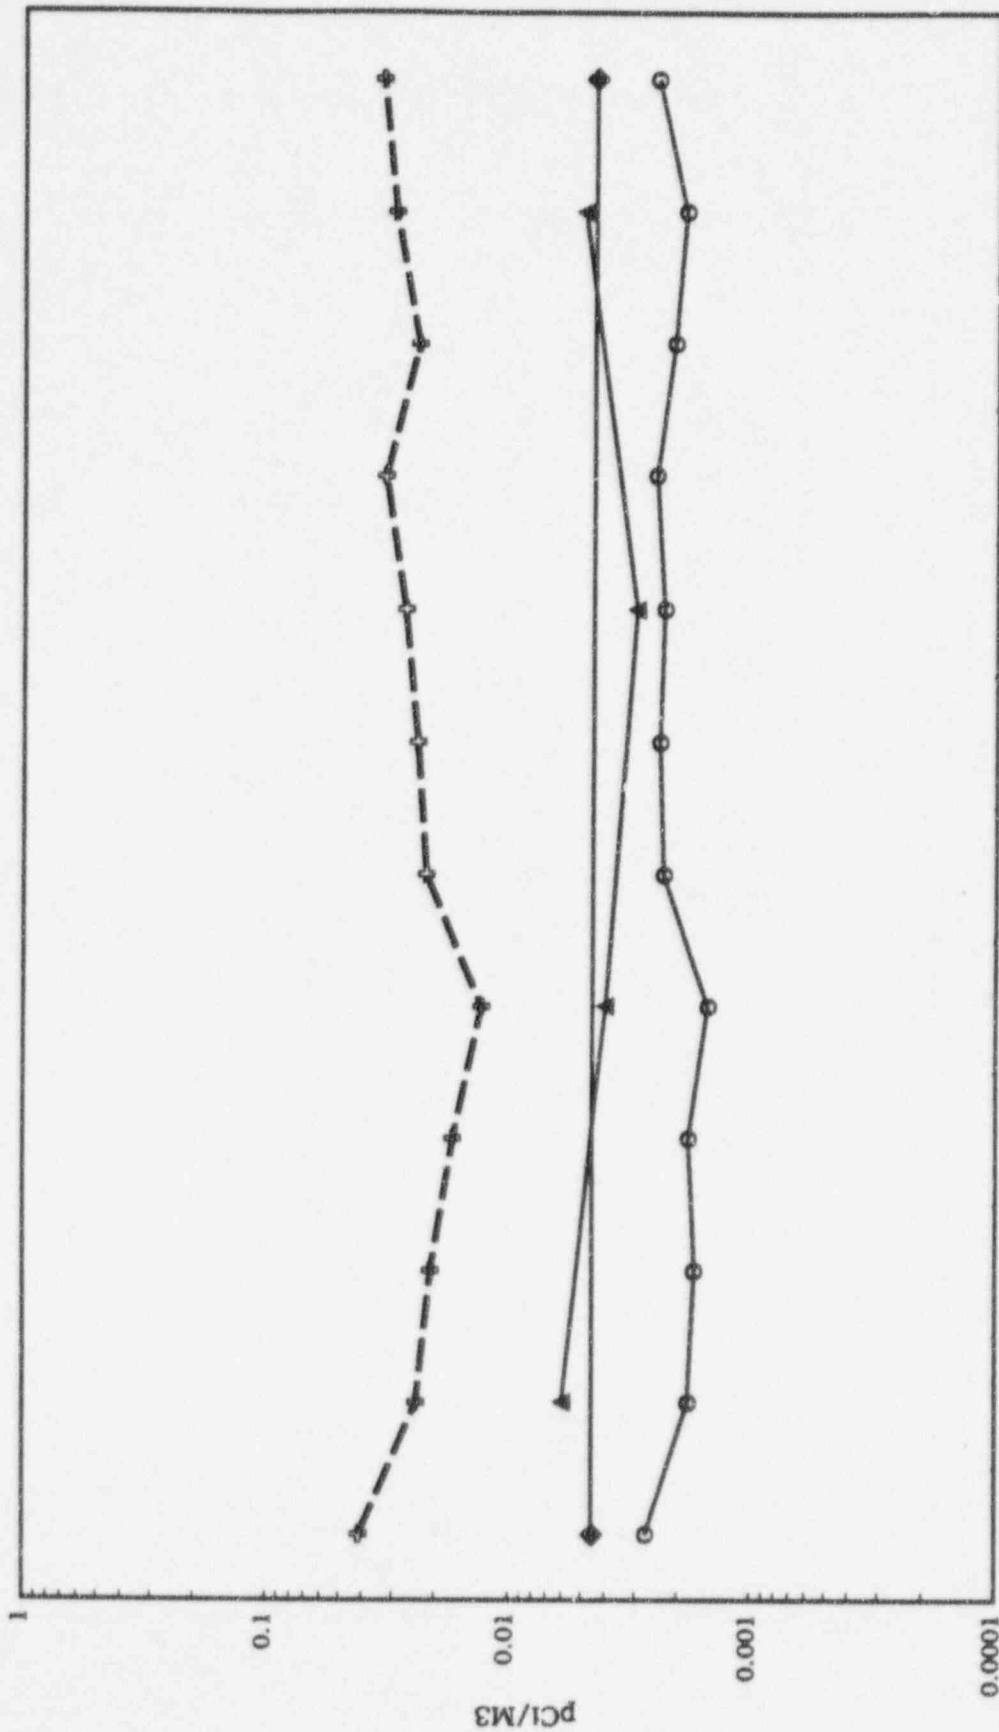

1995




FIGURE D-2  
AIR PARTICULATES  
BETA MONTHLY AVERAGE - JEFFERSON CITY  
MISSOURI ERAMS EPA

53

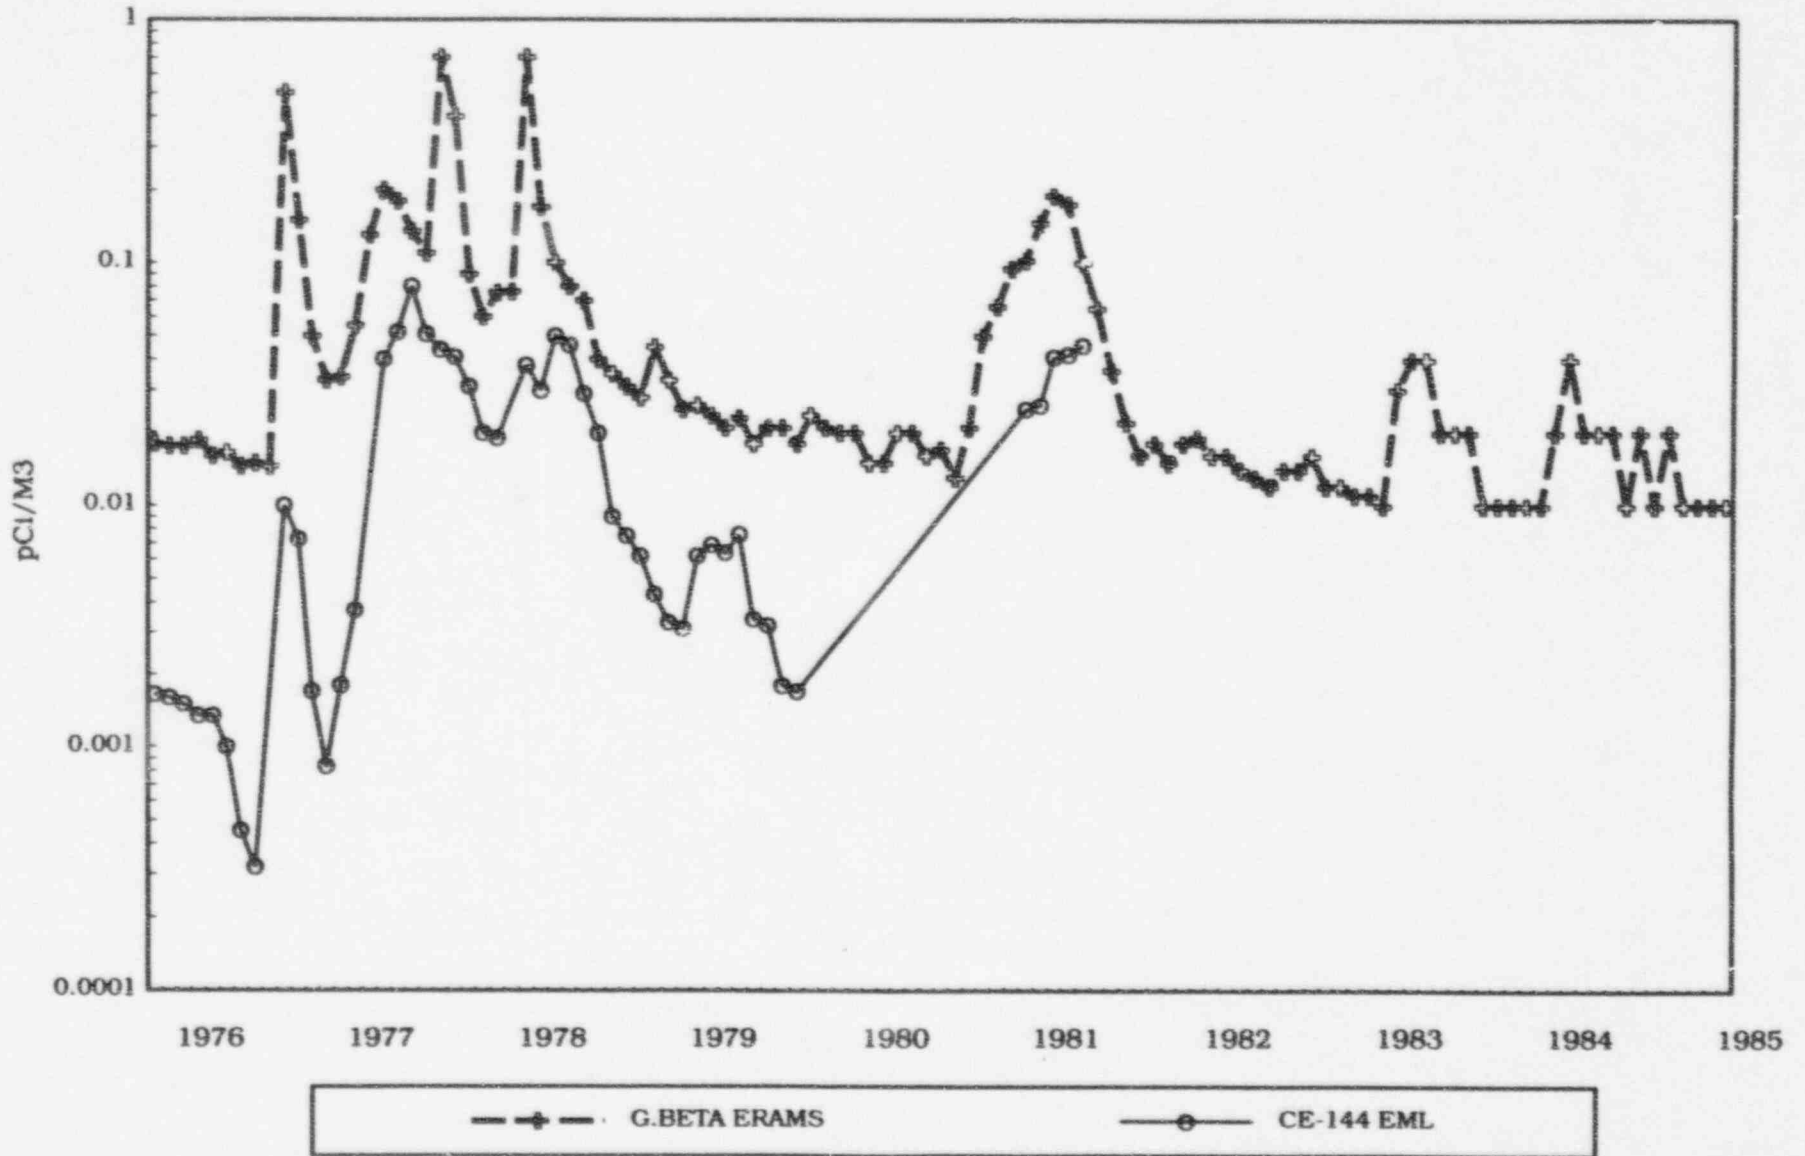
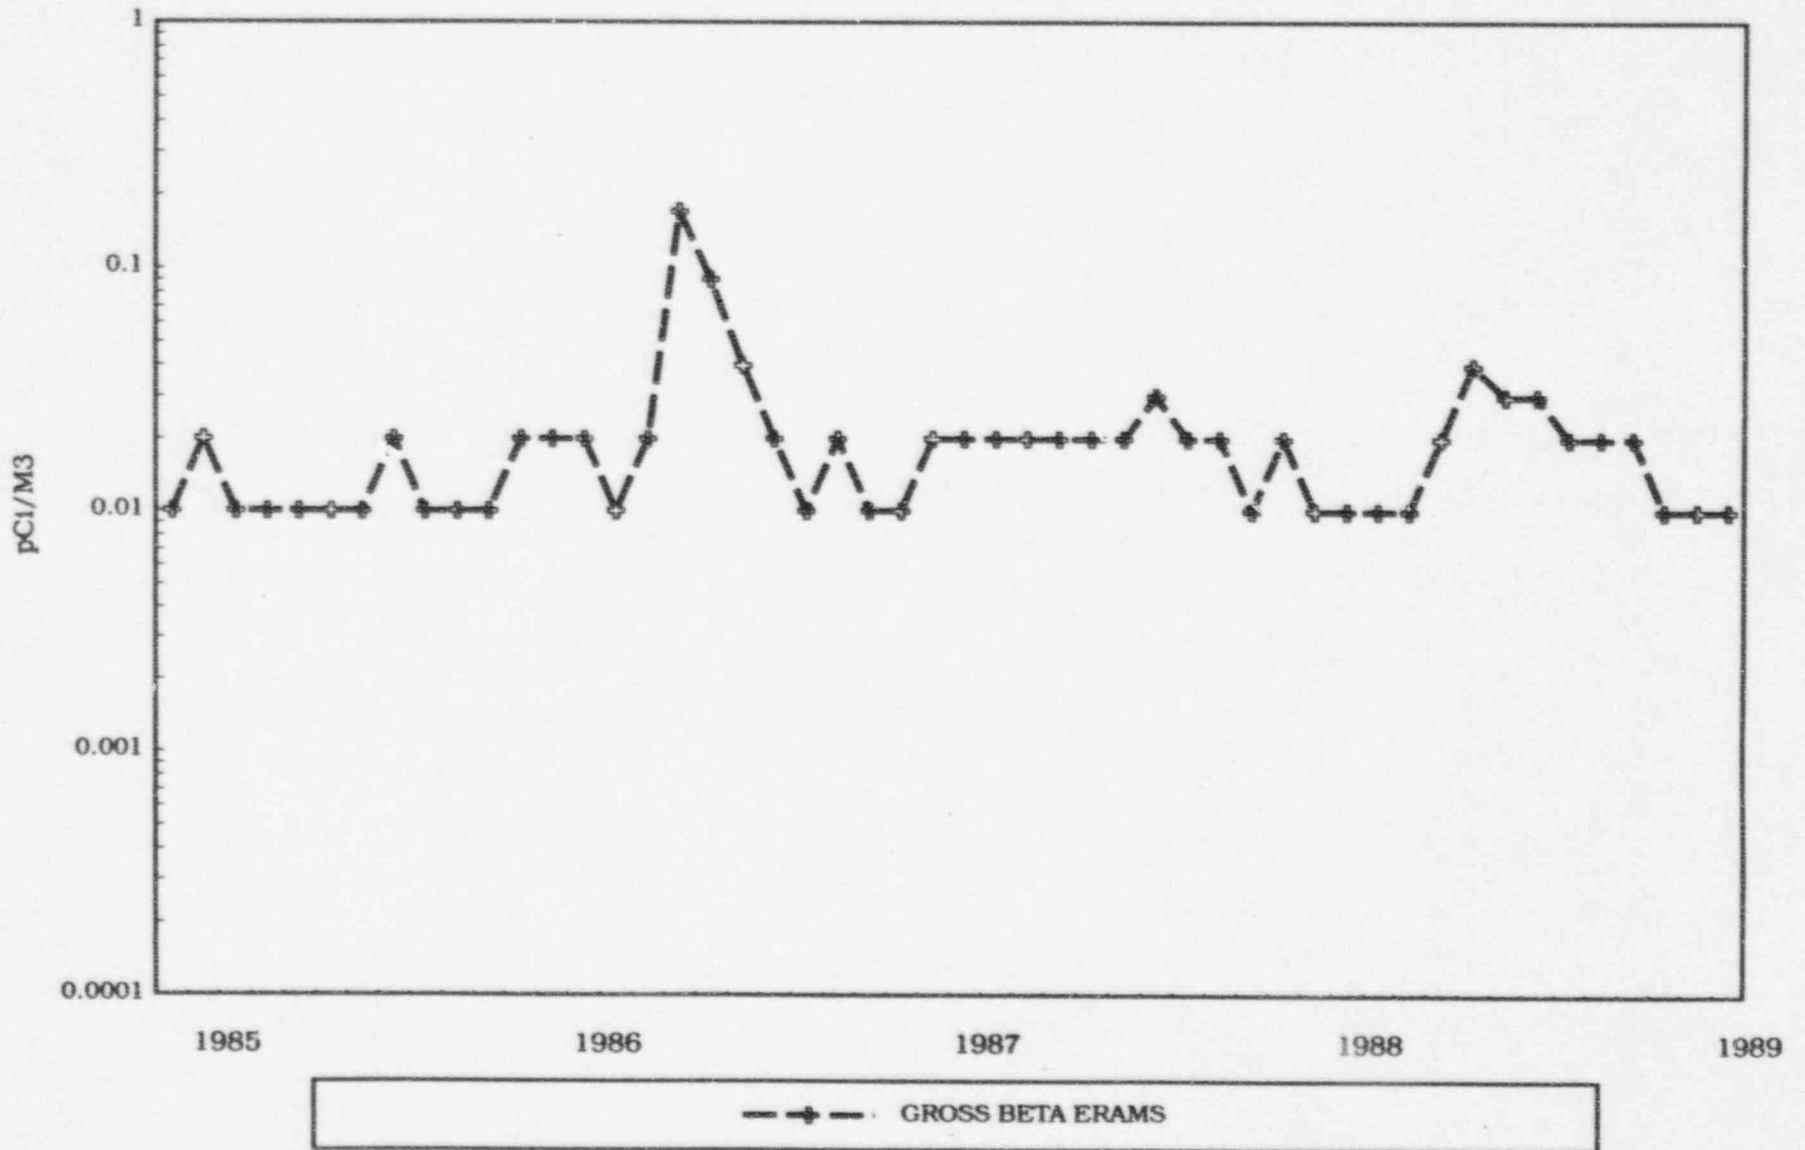


FIGURE D-2  
AIR PARTICULATES  
BETA MONTHLY AVERAGE - JEFFERSON CITY  
MISSOURI ERAMS EPA

54



**TABLE D-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE OF WEEKLY AIR PARTICULATE FILTERS  
 pCi/Cu. M.

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/03-03/28	SECOND QUARTER 03/28-06/27	THIRD QUARTER 06/27-10/03	FOURTH QUARTER 10/03-01/02
BE-7	01-10	Mean±std.dev. det./total range	1.15 ± 0.2 E-01 10/10 (0.94-1.52)E-01	1.66 ± 0.2 E-01 10/10 (1.32-1.85)E-01	1.58 ± 0.3 E-01 10/10 (1.17-2.20)E-01	9.48 ± 1.04E-02 10/10 (0.87-1.22)E-01
K-40	01-10	Mean±std.dev. det./total range	3.08 ± 0.64E-02 1/10 --	2.60 ± 2.0 E-02 5/10 (0.093-4.95)E-02	4.89 ± 0.76E-02 1/10 --	2.29 ± 2.16E-02 2/10 (0.77-3.82)E-02
I-131 (by gamma spectroscopy)	01-10	Mean±std.dev. det./total range	L.T. 2. E-01 0/10 --	L.T. 9. E-02 0/10 --	L.T. 1. E-01 0/10 --	L.T. 1. E-01 0/10 --
Cs-134	01-10	Mean±std.dev. det./total range	L.T. 9. E-04 0/10 --	L.T. 7. E-04 0/10 --	L.T. 7. E-04 0/10 --	L.T. 7. E-04 0/10 --
Cs-137	01-10	Mean±std.dev. det./total range	L.T. 9. E-04 0/10 --	L.T. 6. E-04 0/10 --	L.T. 6. E-04 0/10 --	L.T. 7. E-04 0/10 --
Ra-226	01-10	Mean±std.dev. det./total range	L.T. 1. E-02 0/10 --	L.T. 1. E-02 0/10 --	L.T. 9. E-03 0/10 --	L.T. 1. E-02 0/10 --
Th-228	01-10	Mean±std.dev. det./total range	L.T. 1. E-03 0/10 --	L.T. 1. E-03 0/10 --	L.T. 1. E-03 0/10 --	L.T. 1. E-03 0/10 --

TABLE D-2  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE OF WEEKLY AIR PARTICULATE FILTERS - PCI/CU.M.

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/03-03/28	SECOND QUARTER 03/28-06/27	THIRD QUARTER 06/27-10/03	FOURTH QUARTER 10/03-01/02
BE-7	1-10	1.15 ± 0.2 E-01 (10/10)	1.66 ± 0.2 E-01 (10/10)	1.58 ± 0.3 E-01 (10/10)	9.48 ± 1.04E-02 (10/10)
K-40	1-10	3.08 ± 0.64E-02 (1/10)	2.60 ± 2.0 E-02 (5/10)	4.89 ± 0.76E-02 (1/10)	2.29 ± 2.16E-02 (2/10)
Mn-54	1-10	L.T. 1. E-03 (0/10)	L.T. 7. E-04 (0/10)	L.T. 7. E-04 (0/10)	L.T. 6. E-04 (0/10)
Co-58	1-10	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 9. E-04 (0/10)
Fe-59	1-10	L.T. 4. E-03 (0/10)	L.T. 3. E-03 (0/10)	L.T. 3. E-03 (0/10)	L.T. 3. E-03 (0/10)
Co-60	1-10	L.T. 9. E-04 (0/10)	L.T. 7. E-04 (0/10)	L.T. 6. E-04 (0/10)	L.T. 6. E-04 (0/10)
Zn-65	1-10	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)
Zr-95	1-10	L.T. 2. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)
Ru-103	1-10	L.T. 3. E-03 (0/10)	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)	L.T. 2. E-03 (0/10)
Ru-106	1-10	L.T. 9. E-03 (0/10)	L.T. 7. E-03 (0/10)	L.T. 6. E-03 (0/10)	L.T. 6. E-03 (0/10)
I-131	1-10	L.T. 2. E-01 (0/10)	L.T. 9. E-02 (0/10)	L.T. 1. E-01 (0/10)	L.T. 1. E-01 (0/10)
Cs-134	1-10	L.T. 9. E-04 (0/10)	L.T. 7. E-04 (0/10)	L.T. 7. E-04 (0/10)	L.T. 7. E-04 (0/10)
Cs-137	1-10	L.T. 9. E-04 (0/10)	L.T. 6. E-04 (0/10)	L.T. 6. E-04 (0/10)	L.T. 7. E-04 (0/10)
Ba-140	1-10	L.T. 3. E-02 (0/10)	L.T. 2. E-02 (0/10)	L.T. 2. E-02 (0/10)	L.T. 2. E-02 (0/10)
Ce-141	1-10	L.T. 4. E-03 (0/10)	L.T. 2. E-02 (0/10)	L.T. 3. E-03 (0/10)	L.T. 3. E-02 (0/10)
Ce-144	1-10	L.T. 6. E-03 (0/10)	L.T. 4. E-03 (0/10)	L.T. 3. E-03 (0/10)	L.T. 5. E-03 (0/10)
Ra-226	1-10	L.T. 1. E-02 (0/10)	L.T. 1. E-02 (0/10)	L.T. 9. E-03 (0/10)	L.T. 1. E-02 (0/10)
Th-228	1-10	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)	L.T. 1. E-03 (0/10)



E. FISH (See Tables E-1, E-2)

STATIONS 28, 35

Fish samples were collected during the summer and fall at the above stations and analyzed for gross beta, Sr-89, Sr-90, and gamma emitting isotopes. An attempt was made to collect a middle-top feeding fish (carp) and a bottom feeding fish (catfish). Both types of fish were collected during the summer and fall sampling periods.

The gross beta and Sr-90 activities were similar to the levels of previous years. Strontium-90 was detected in one of nine samples at a level of 0.0085 pCi/gram, wet, which is below the normal level of detection. There were no detections of Sr-89. Naturally occurring K-40 was detected in all samples at an average level of 3.08 pCi/gm, wet.

There were no detections of Cs-137 during 1995.

Plotted in Figure E-1 are the radionuclides gross beta, K-40, Sr-90 and Cs-137 monitored in fish samples which show no appreciable change from 1977 through 1995. The plot of the nuclides shows that most of the gross beta activity is due to the terrestrial nuclide K-40.

FIGURE E-1

FISH

SEMIANNUAL AVERAGE - ALL LOCATIONS

GR-B K-40 SR-90 CS-137


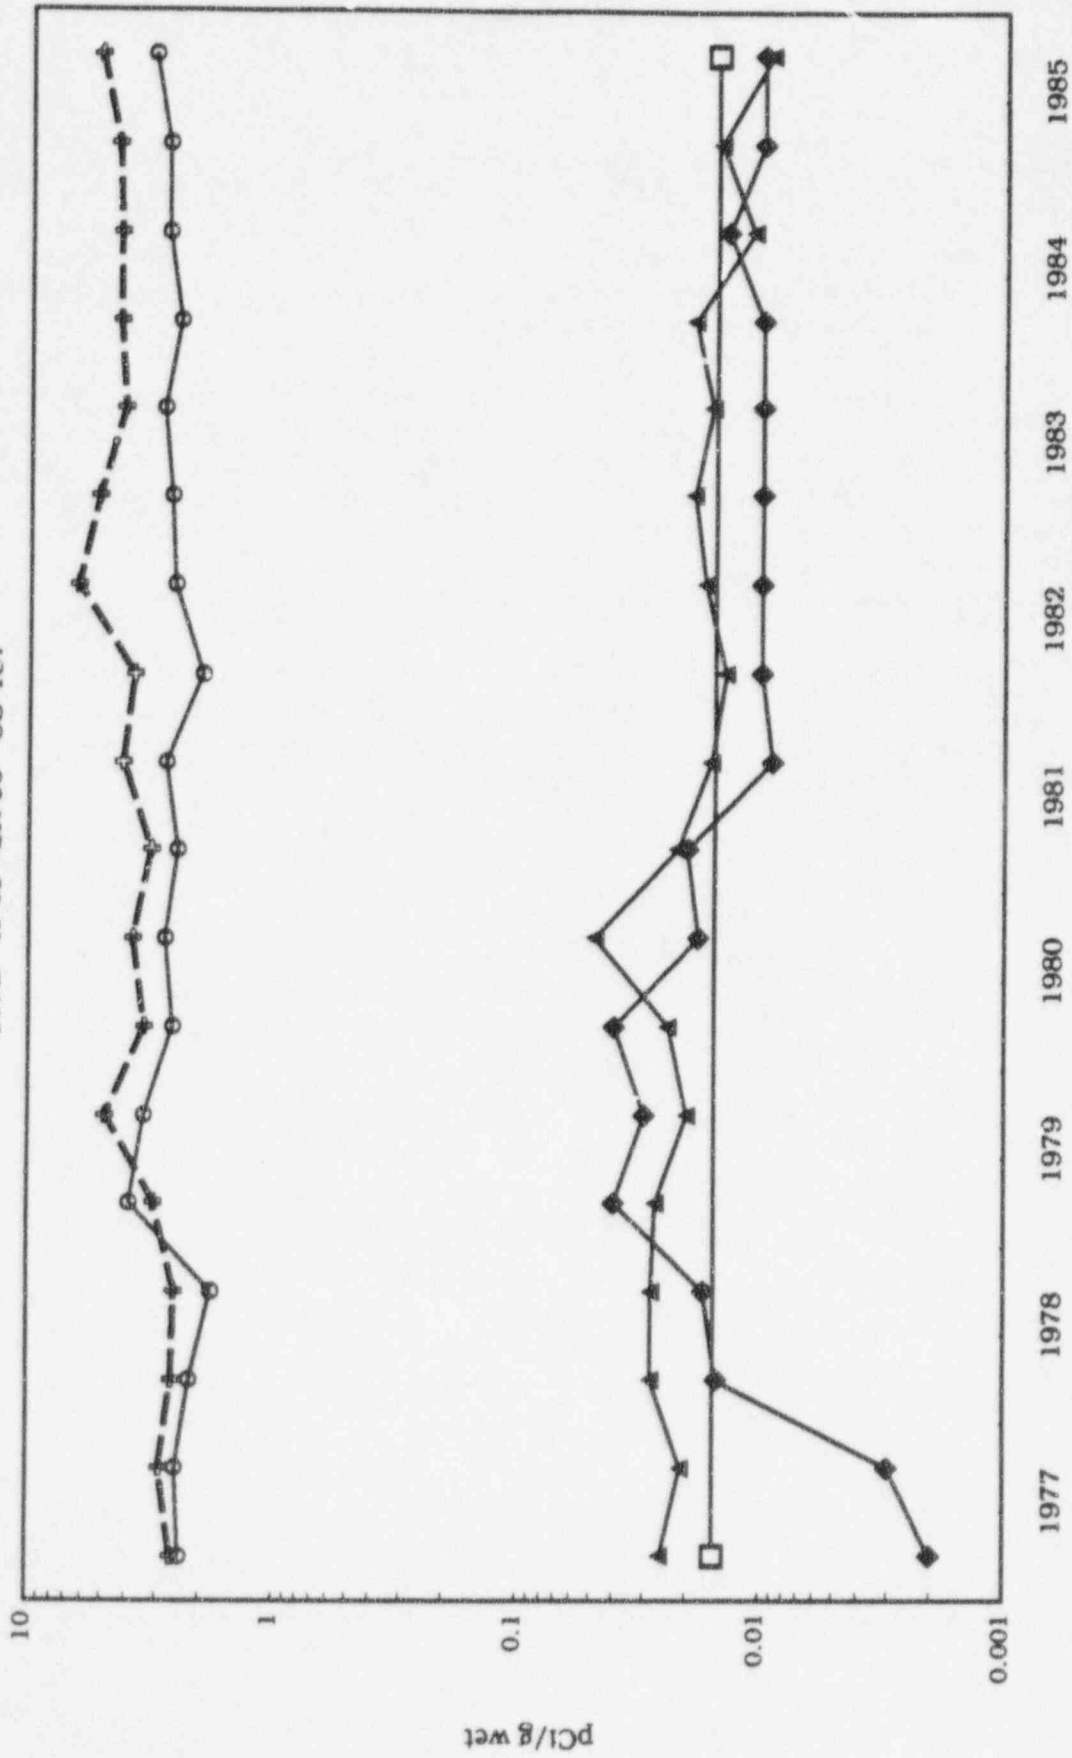
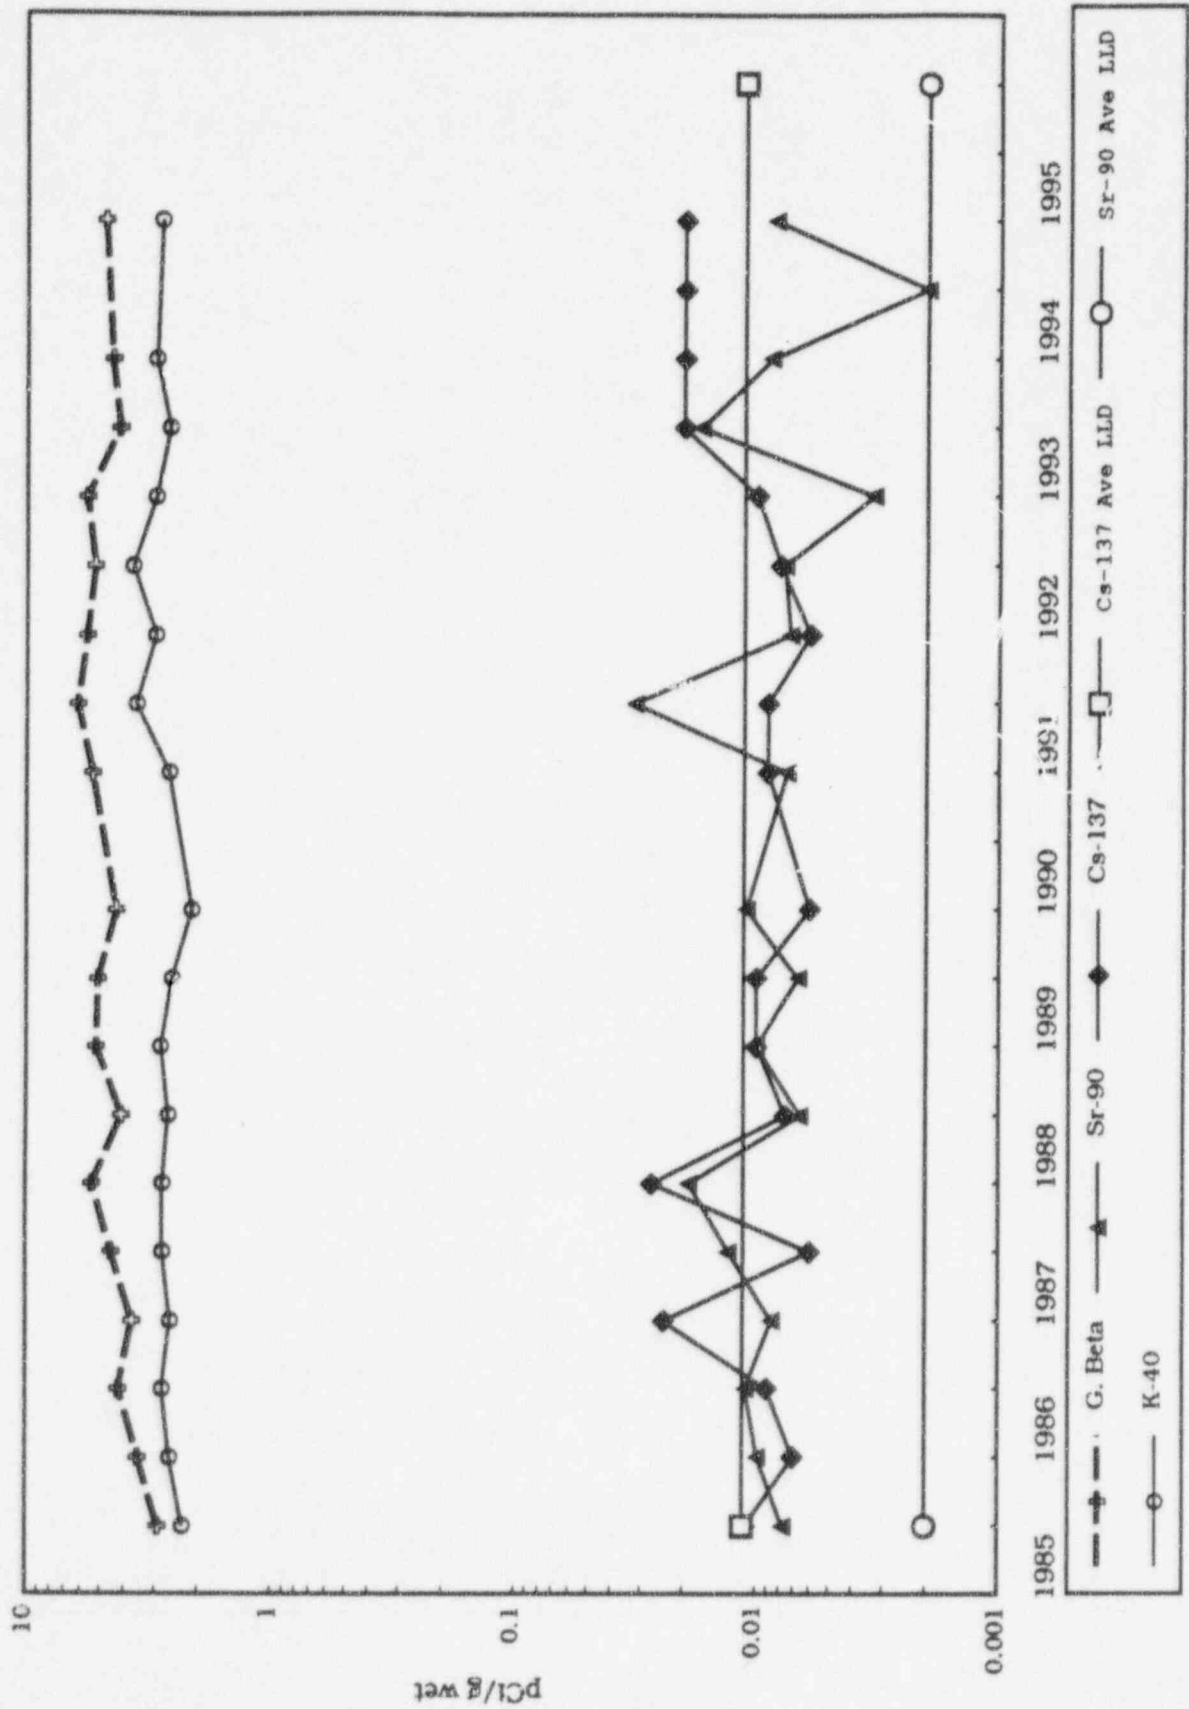


FIGURE E-1  
 FISH  
 SEMIANNUAL AVERAGE - ALL LOCATIONS  
 GR-B K-40 SR-90 CS-137



**TABLE E-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 FISH - PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER	SECOND QUARTER	THIRD QUARTER 07/25	FOURTH QUARTER 10/11,10/12
Gross Beta	28, 35	Mean±std.dev. det./total range			4.8 ± 0.3 E 00 5/5 (4.6-5.2)E 00	4.8 ± 0.3 E 00 4/4 (4.5-5.1)E 00
Sr-89	28, 35	Mean±std.dev. det./total range			L.T. 5. E-03 0/5 --	L.T. 1. E-02 0/4 --
Sr-90	28, 35	Mean±std.dev. det./total range			L.T. 2. E-03 0/5 --	8.5 ± 2.5 E-03 1/4 --
8 K-40	28, 35	Mean±std.dev. det./total range			3.27±0.5 E 00 5/5 (2.9-4.2)E 00	2.84±0.5 E 00 4/4 (2.2-3.1)E 00
Co-60	28, 35	Mean±std.dev. det./total range			L.T. 2. E-02 0/5 --	L.T. 2. E-02 0/4 --
I-131	28, 35	Mean±std.dev. det./total range			L.T. 5. E-02 0/5 --	L.T. 5. E-02 0/4 --
Cs-134	28, 35	Mean±std.dev. det./total range			L.T. 2. E-02 0/5 --	L.T. 2. E-02 0/4 --
Cs-137	28, 35	Mean±std.dev. det./total range			L.T. 2. E-02 0/5 --	L.T. 2. E-02 0/4 --

**TABLE E-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 FISH - PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER	SECOND QUARTER 06/08, 06/09	THIRD QUARTER 07/25	FOURTH QUARTER 10/11, 10/12
BE-7	28, 35			L.T. 2. E-01 (0/5)	L.T. 2. E-01 (0/4)
K-40	28, 35			3.27± 0.5 E 00 (5/5)	2.84± 0.5 E 00 (4/4)
Mn-54	28, 35			L.T. 2. E-02 (0/5)	L.T. 2. E-02 (0/4)
Co-58	28, 35			L.T. 2. E-02 (0/5)	L.T. 2. E-02 (0/4)
Fe-59	28, 35			L.T. 4. E-02 (0/5)	L.T. 4. E-02 (0/4)
Cg-60	28, 35			L.T. 2. E-02 (0/5)	L.T. 2. E-02 (0/4)
Zn-65	28, 35			L.T. 4. E-02 (0/5)	L.T. 4. E-02 (0/4)
Zr-95	28, 35			L.T. 2. E-02 (0/5)	L.T. 2. E-02 (0/4)
Ru-103	28, 35			L.T. 2. E-02 (0/5)	L.T. 2. E-02 (0/4)
Ru-106	28, 35			L.T. 1. E-01 (0/5)	L.T. 2. E-01 (0/4)
I-131	28, 35			L.T. 5. E-02 (0/5)	L.T. 5. E-02 (0/4)
Cs-134	28, 35			L.T. 2. E-02 (0/5)	L.T. 2. E-02 (0/4)
Cs-137	28, 35			L.T. 2. E-02 (0/5)	L.T. 2. E-02 (0/4)
Ba-140	28, 35			L.T. 3. E-02 (0/5)	L.T. 3. E-02 (0/4)
Ce-141	28, 35			L.T. 3. E-02 (0/5)	L.T. 3. E-02 (0/4)
Ce-144	28, 35			L.T. 1. E-01 (0/5)	L.T. 1. E-01 (0/4)
Ra-226	28, 35			L.T. 3. E-01 (0/5)	L.T. 3. E-01 (0/4)
Th-228	28, 35			L.T. 3. E-02 (0/5)	L.T. 3. E-02 (0/4)

F. MILK (See Tables F-1, F-2)

STATION 61 and 99 (NEAREST PRODUCER)

Milk samples from the nearest producer Station 99, 10.25 miles, 189 degrees from the elevated release point of CNS and Station 61, 3.5 miles, 326 degrees were collected once every 15 days in peak pasture season and once every 31 days the rest of the year. The monthly samples collected January through May and October through December were analyzed for I-131 by chemical separation, for elemental calcium and strontium 89 and 90. In addition they were analyzed for gamma emitting isotopes on a high resolution gamma spectrometer. The samples collected every 15 days during peak pasture season were analyzed upon receipt for I-131 and gamma emitting isotopes. A monthly composite was prepared and analyzed as described above.

There were no detections of I-131 in the twenty-six samples analyzed by chemical separation. There were no detections of Sr-89 in the samples analyzed. Strontium-90 was detected at an average level of 1.2 pCi/liter, which is a normal environmental level. Elemental calcium was found at an average level of 1.8 mg/liter. Potassium-40, a naturally occurring isotope, was detected at an average level of 1310 pCi/liter.

Cesium-137 was not detected in any of the samples analyzed. There was no indication of an effect on the milk of the producer nearest the plant from the operations of CNS.

Shown in Figure F-1 and F-2 are the plots of radionuclides monitored from 1977 through 1995 in milk samples from producers nearest the reactor. The levels of K-40, elemental calcium and Sr-90 remained stable. There were no detections of I-131, Sr-89 or Cs-137. This indicates no effect on milk samples from the operations of CNS.

FIGURE F-1  
 MILK - NEAREST PRODUCER  
 QUARTERLY AVERAGE - STATION 61  
 K-40 I-131 CS-137

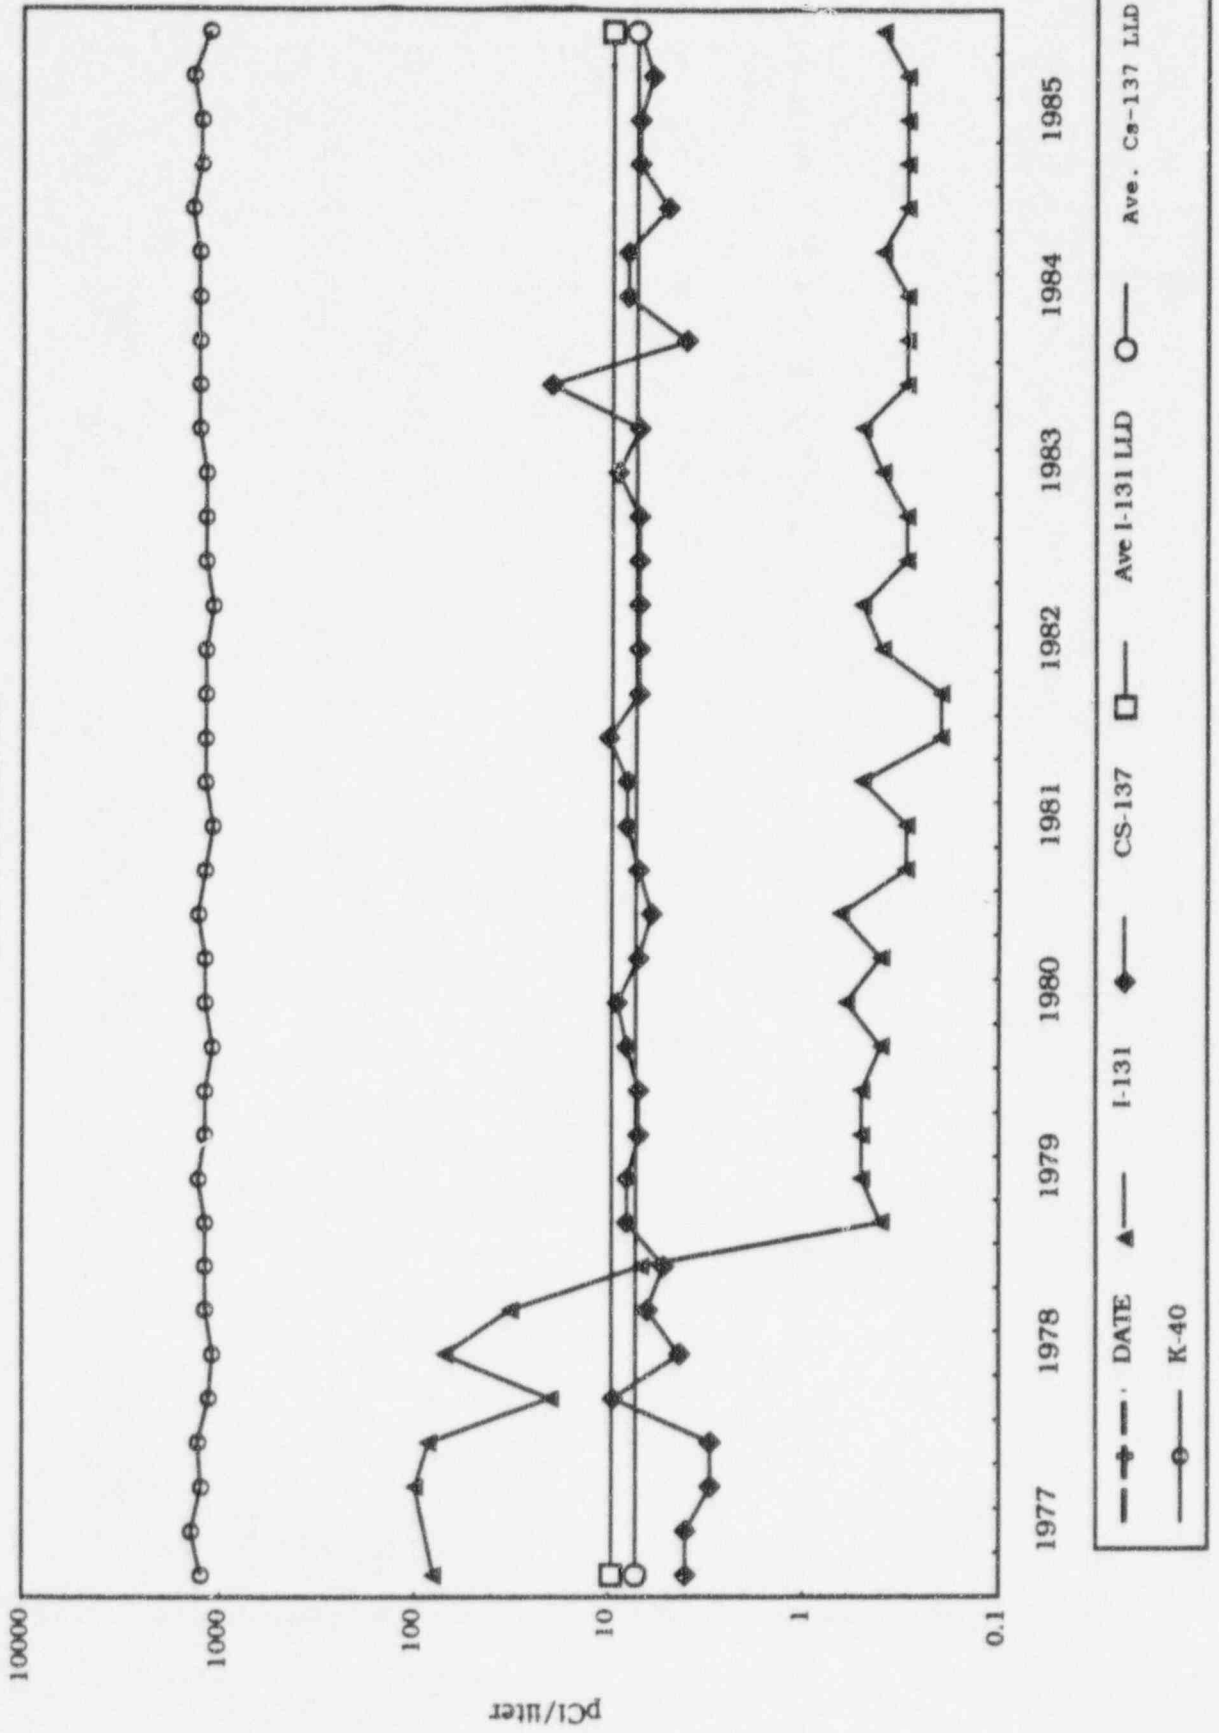


FIGURE F-1  
MILK- NEAREST PRODUCER  
QUARTERLY AVERAGE - STATION 99  
K-40 I-131 CS-137

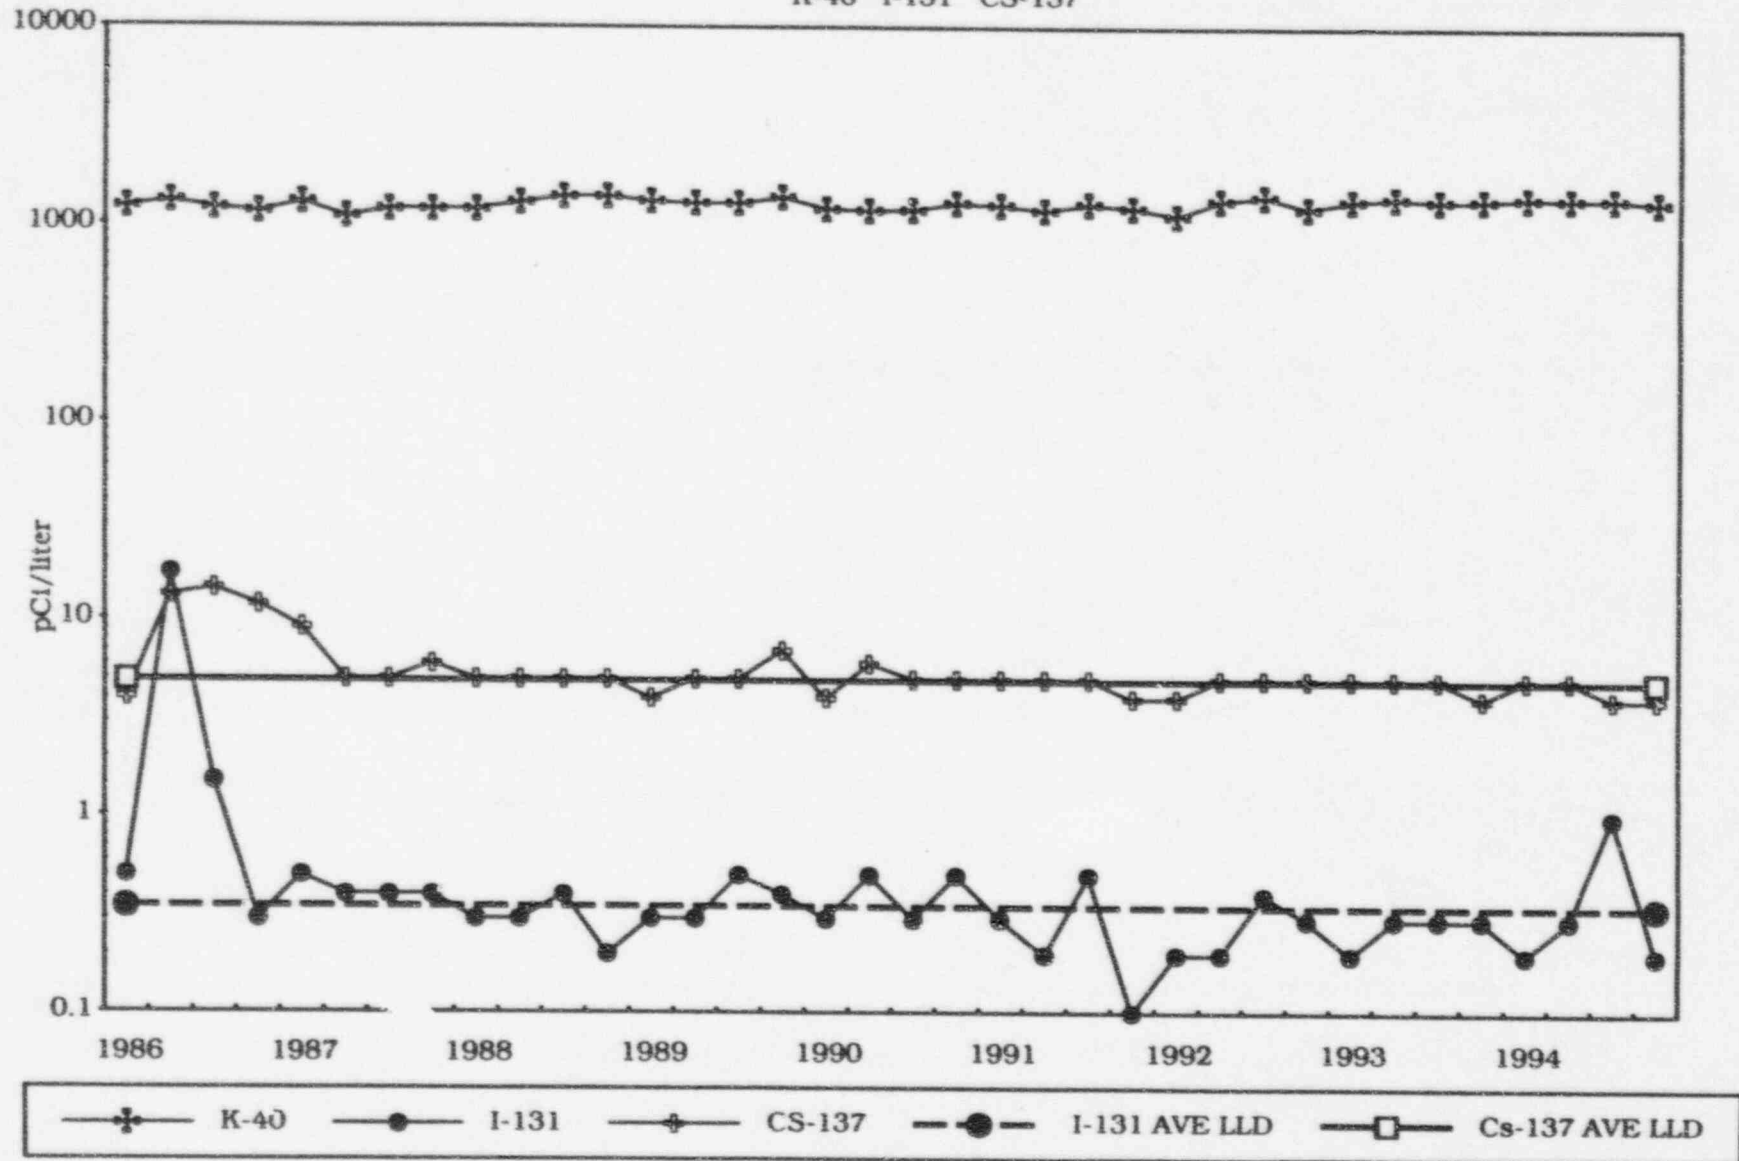




FIGURE F-1  
 MILK - NEAREST PRODUCER  
 QUARTERLY AVERAGE - STATION 99  
 K-40 I-131 CS-137

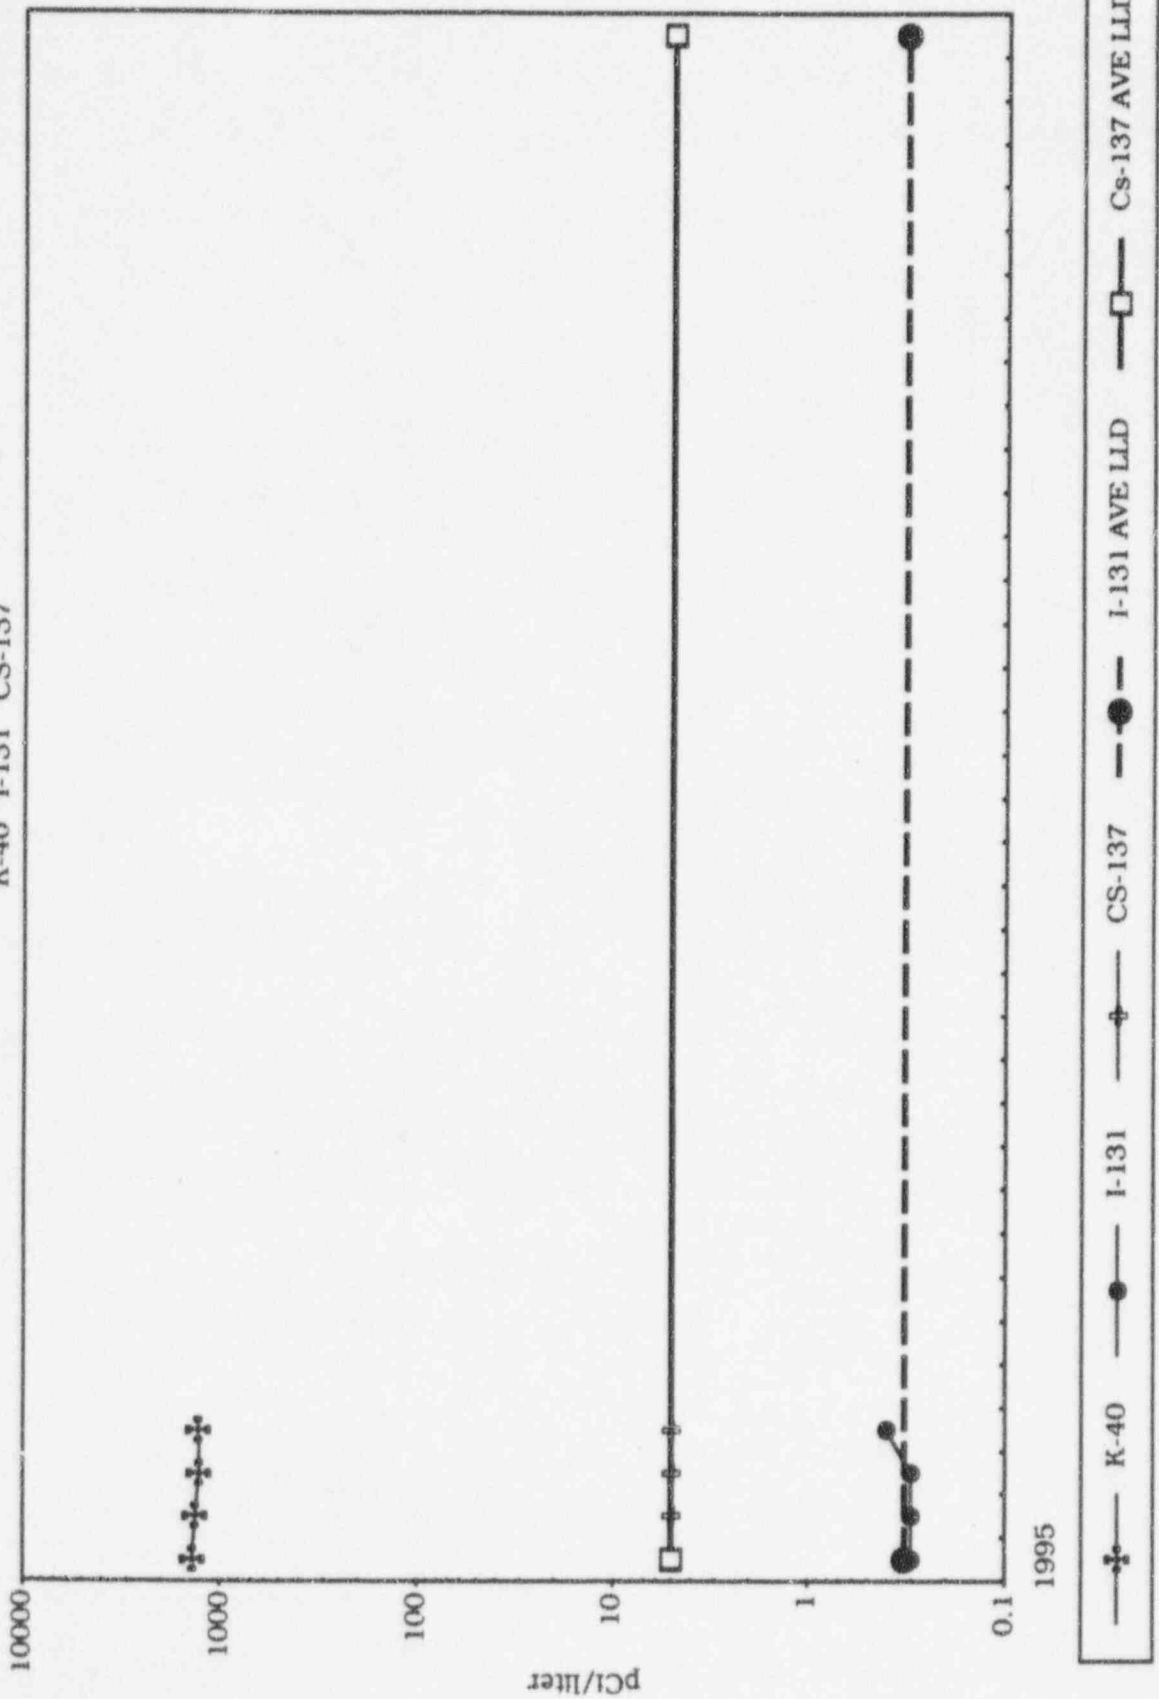


FIGURE F-2  
 MILK- NEAREST PRODUCER  
 QUARTERLY AVERAGE - STATION 61  
 SR-89 SR-90 ELEM. CA.

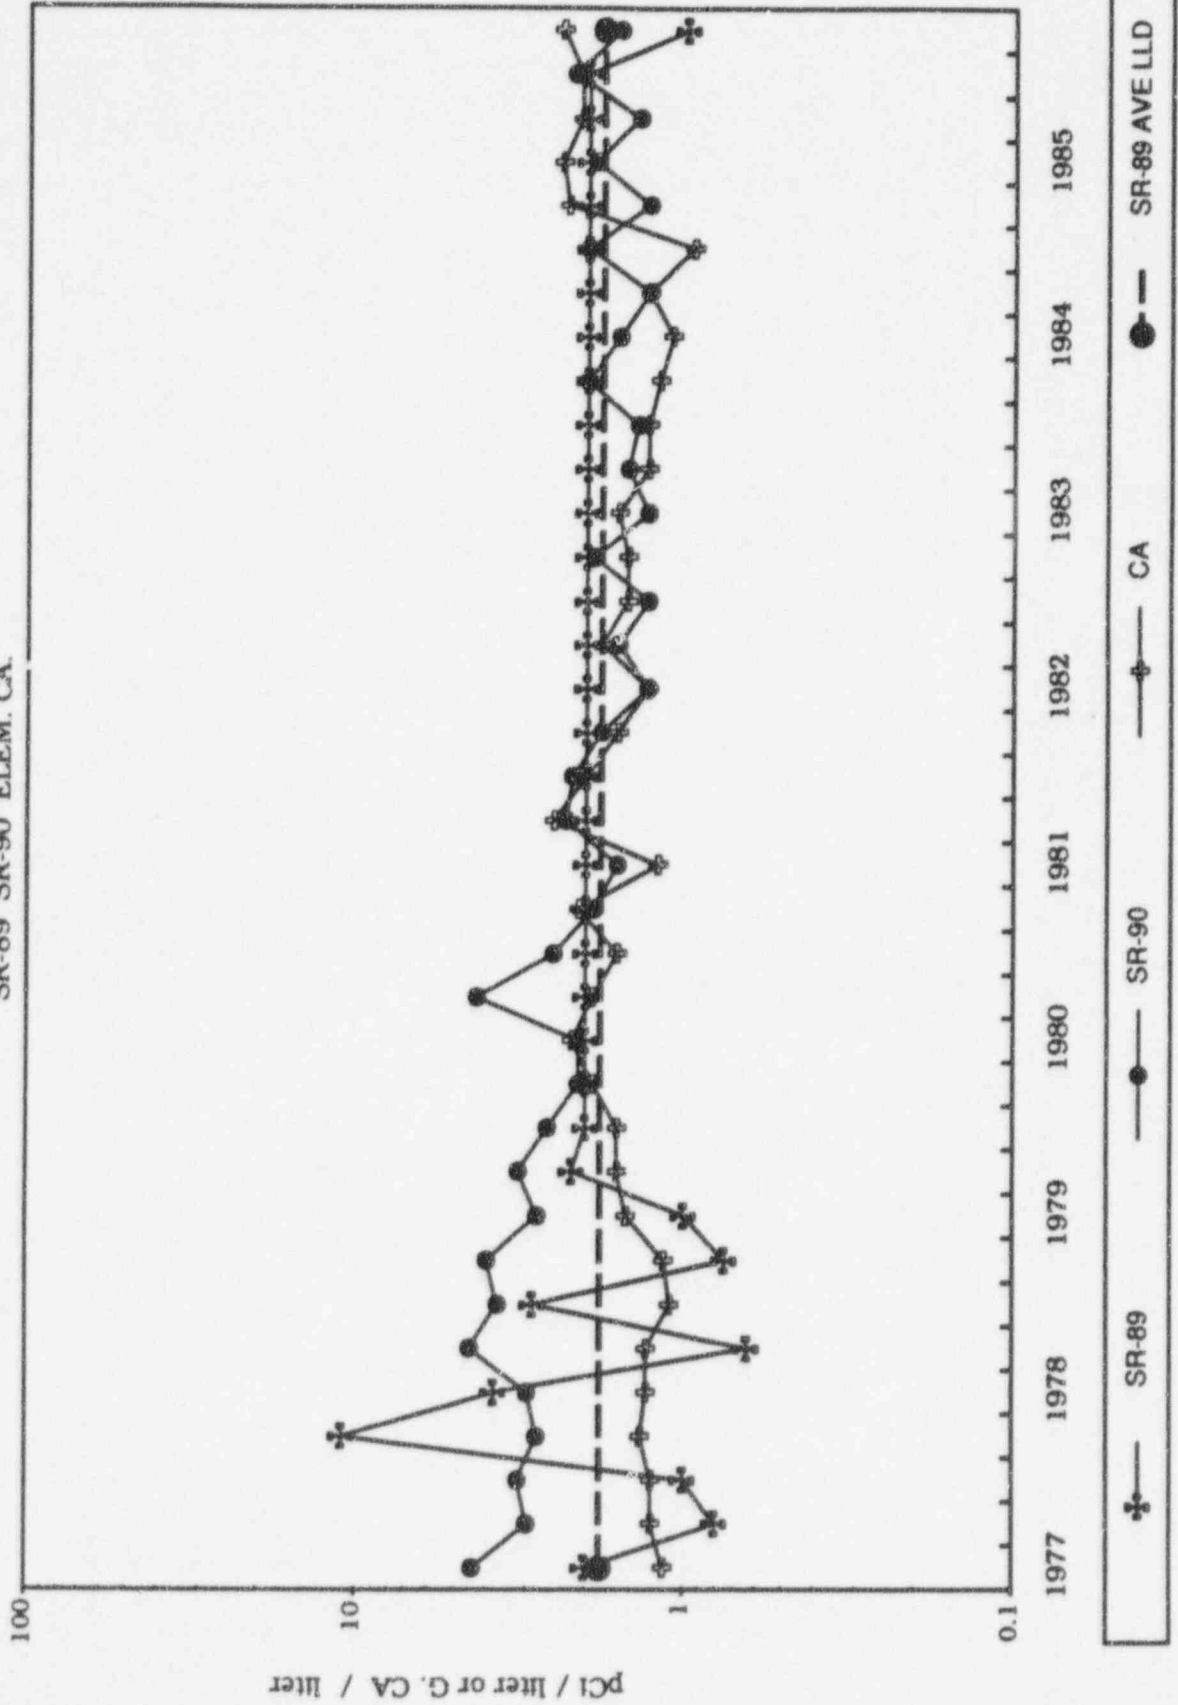


FIGURE F-2  
 MILK- NEAREST PRODUCER  
 QUARTERLY AVERAGE - STATION 99  
 SR-89 SR-90 ELEM. CA.

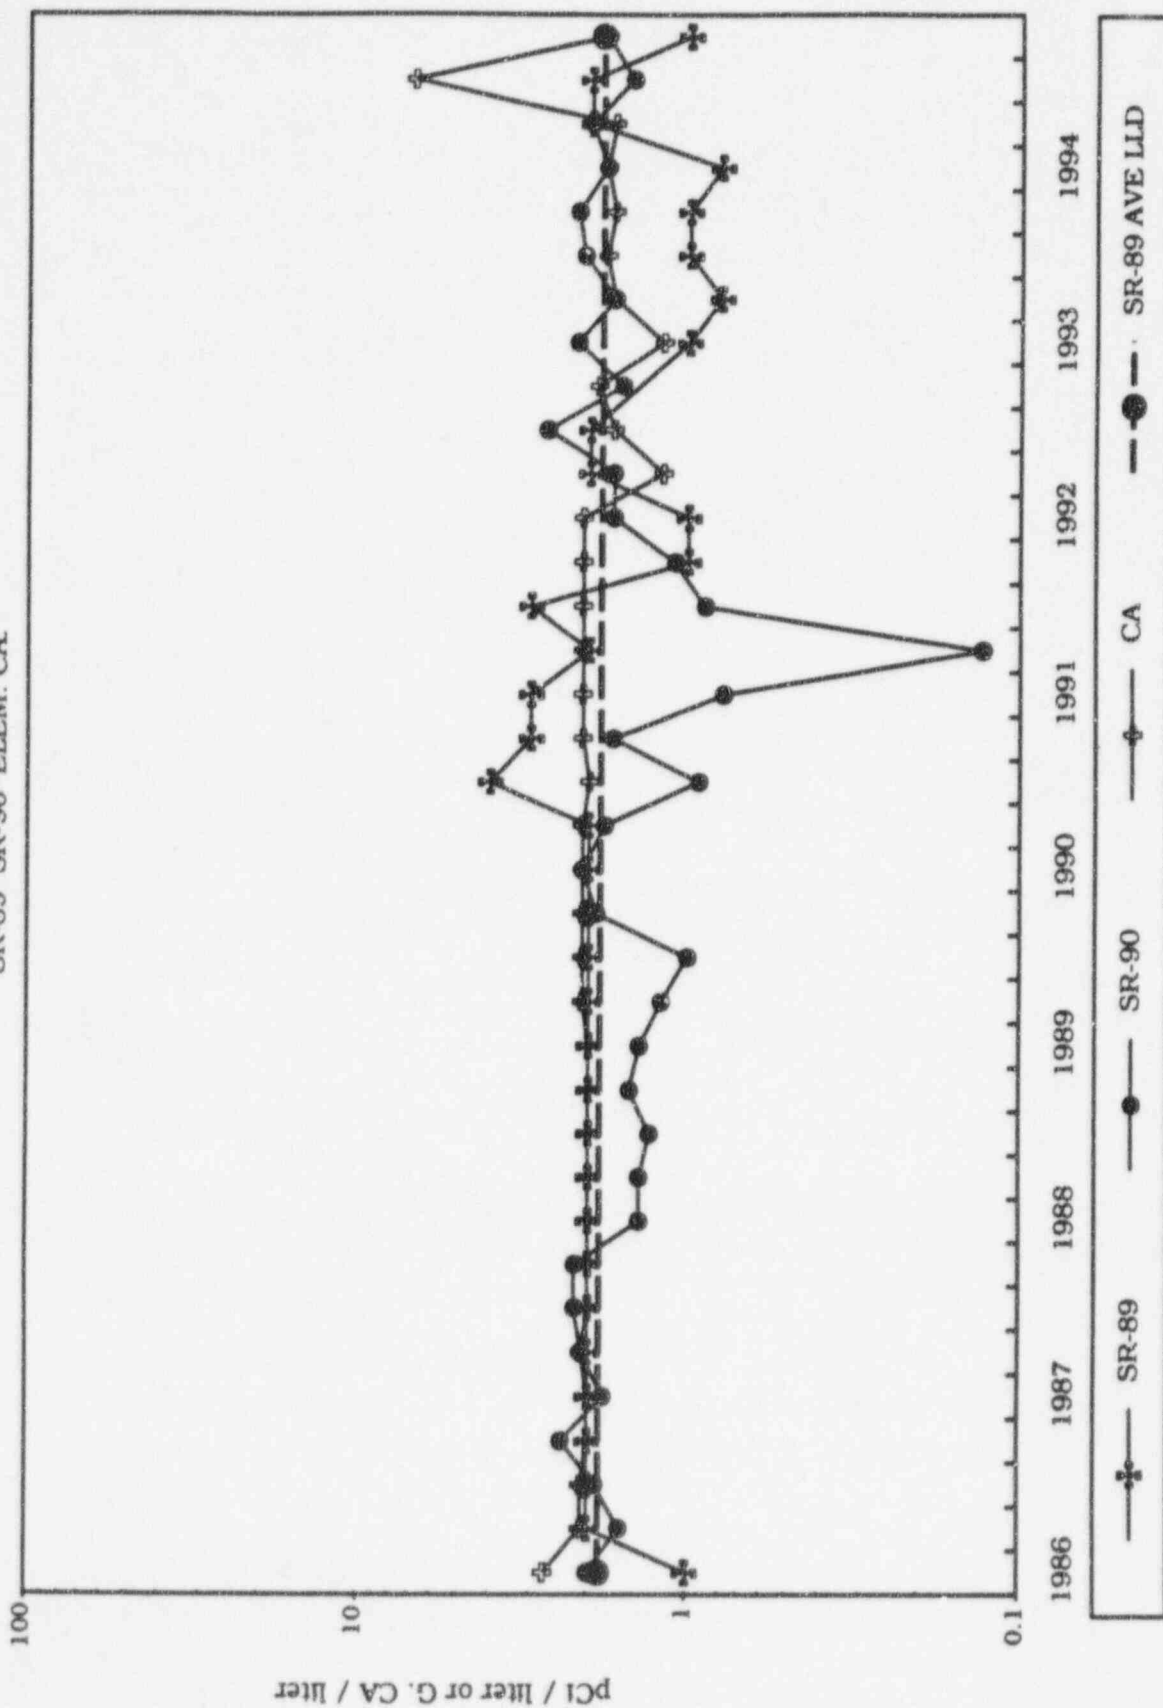
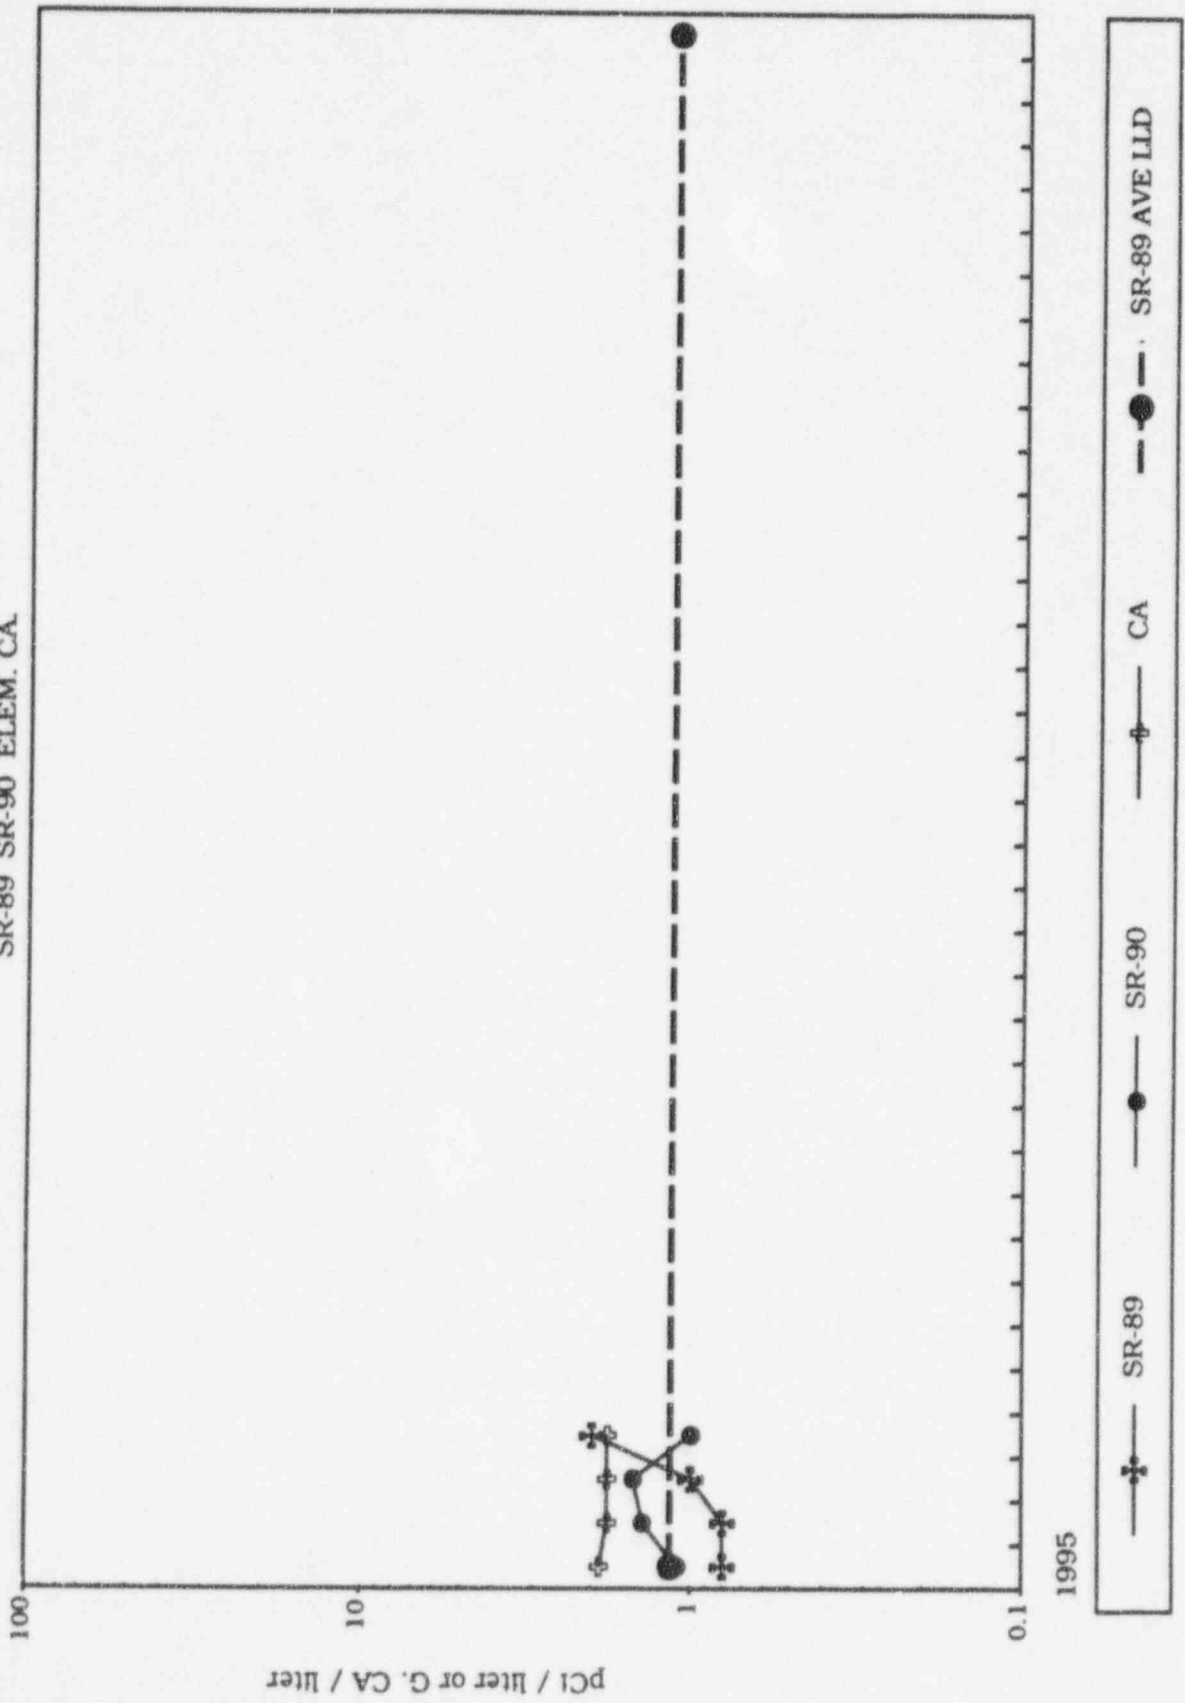


FIGURE F-2  
 MILK - NEAREST PRODUCER  
 QUARTERLY AVERAGE - STATION 99  
 SR-89 SR-90 ELEM. CA



**TABLE F-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK - NEAREST PRODUCER - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/03-03/07	SECOND QUARTER 04/04-06/20	THIRD QUARTER 07/05-09/19	FOURTH QUARTER 10/03-12/05
SR-89	61, 99	Meanstd.dev. det./total range	L.T. 8. E-01 0/4 --	L.T. 8. E-01 0/3 --	L.T. 1. E 00 0/4 --	L.T. 2. E 00 0/6 --
SR-90	61, 99	Meanstd.dev. det./total range	1.1 ± 0.2 E 00 4/4 (0.73-1.2)E 00	1.4 ± 0.6 E 00 3/3 (1.0-2.0)E 00	1.5 ± 0.3 E 00 4/4 (1.0-1.8)E 00	1.0 ± 0.1 E 00 6/6 (0.91-1.2)E 00
I-131 by chemical separation	61, 99	Meanstd.dev. det./total range	L.T. 3. E-01 0/4 --	L.T. 3. E-01 0/5 --	L.T. 3. E-01 0/11 --	L.T. 4. E-01 0/6 --
Ca gm/liter	61, 99	Meanstd.dev. det./total range	1.9 ± 0.2 E 00 4/4 (1.7-2.1) E 00	1.8 ± 0.1 E 00 3/3 (1.7-1.8)E 00	1.8 ± 0.1 E 00 4/4 (1.7-1.8)E 00	1.6 ± 0.1 E 00 6/6 (1.7-1.9)E 00
K-40	61, 99	Meanstd.dev. det./total range	1.39 ± 0.06E 03 4/4 (1.35-1.47)E 03	1.34 ± 0.05E 03 5/5 (1.27-1.38)E 03	1.28±0.13 E 03 11/11 (1.06-1.51)E 03	1.29±0.105E 03 6/6 (1.2-1.5)E 03
I-131 by gamma spectroscopy	61, 99	Meanstd.dev. det./total range	L.T. 8. E 00 0/4 --	L.T. 9. E 00 0/5 --	L.T. 8. E 00 0/11 --	L.T. 5. E 00 0/6 --
Cs-134	61, 99	Meanstd.dev. det./total range	L.T. 5. E 00 0/4 --	L.T. 5. E 00 0/5 --	L.T. 4. E 00 0/11 --	L.T. 4. E 00 0/6 --
Cs-137	61, 99	Meanstd.dev. det./total range	L.T. 5. E 00 0/4 --	L.T. 5. E 00 0/5 --	L.T. 5. E 00 0/11 --	L.T. 5. E 00 0/6 --

**TABLE F-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK - NEAREST PRODUCER - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/03-03/07	SECOND QUARTER 04/04-06/20	THIRD QUARTER 07/05-09/19	FOURTH QUARTER 10/03-12/05
BE-7	61, 99	L.T. 4. E 01 (0/4)	L.T. 4. E 01 (0/5)	L.T. 4. E 01 (0/11)	L.T. 3. E 01 (0/6)
K-40	61, 99	1.39±0.06 E 03 (4/4)	1.34±0.05 E 03 (5/5)	1.28±0.13 E 03 (11/11)	1.29±0.105E 03 (6/6)
Mn-54	61, 99	L.T. 4. E 00 (0/4)	L.T. 4. E 00 (0/5)	L.T. 4. E 00 (0/11)	L.T. 4. E 00 (0/6)
Co-58	61, 99	L.T. 4. E 00 (0/4)	L.T. 4. E 00 (0/5)	L.T. 4. E 00 (0/11)	L.T. 4. E 00 (0/6)
Fe-59	61, 99	L.T. 1. E 01 (0/4)	L.T. 9. E 00 (0/5)	L.T. 9. E 00 (0/11)	L.T. 9. E 00 (0/6)
Co-60	61, 99	L.T. 5. E 00 (0/4)	L.T. 4. E 00 (0/5)	L.T. 5. E 00 (0/11)	L.T. 4. E 00 (0/6)
Zn-65	61, 99	L.T. 1. E 01 (0/4)	L.T. 1. E 01 (0/5)	L.T. 1. E 01 (0/11)	L.T. 1. E 01 (0/6)
Zr-95	61, 99	L.T. 5. E 00 (0/4)	L.T. 4. E 00 (0/5)	L.T. 4. E 00 (0/11)	L.T. 4. E 00 (0/6)
Ru-103	61, 99	L.T. 5. E 00 (0/4)	L.T. 4. E 00 (0/5)	L.T. 4. E 00 (0/11)	L.T. 4. E 00 (0/6)
Ru-106	61, 99	L.T. 4. E 01 (0/4)	L.T. 4. E 01 (0/5)	L.T. 3. E 01 (0/11)	L.T. 3. E 01 (0/6)
I-131	61, 99	L.T. 8. E 00 (0/4)	L.T. 9. E 00 (0/5)	L.T. 8. E 00 (0/11)	L.T. 5. E 00 (0/6)
Cs-134	61, 99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 4. E 00 (0/11)	L.T. 4. E 00 (0/6)
Cs-137	61, 99	L.T. 5. E 00 (0/4)	L.T. 5. E 00 (0/5)	L.T. 5. E 00 (0/11)	L.T. 5. E 00 (0/6)
Ra-140	61, 99	L.T. 6. E 00 (0/4)	L.T. 6. E 00 (0/5)	L.T. 6. E 00 (0/11)	L.T. 5. E 00 (0/6)
Ce-141	61, 99	L.T. 9. E 00 (0/4)	L.T. 9. E 00 (0/5)	L.T. 9. E 00 (0/11)	L.T. 8. E 00 (0/6)
Ce-144	61, 99	L.T. 4. E 01 (0/4)	L.T. 4. E 01 (0/5)	L.T. 4. E 01 (0/11)	L.T. 3. E 01 (0/6)
Ra-226	61, 99	L.T. 1. E 02 (0/4)	L.T. 1. E 02 (0/5)	L.T. 1. E 02 (0/11)	L.T. 1. E 02 (0/6)
Th-228	61, 99	L.T. 1. E 01 (0/4)	L.T. 9. E 00 (0/5)	L.T. 8. E 00 (0/11)	L.T. 9. E 00 (0/6)

## G. MILK (SEE TABLES G-1, G-2)

### STATIONS 42, 100 (OTHER PRODUCERS)

Milk samples were collected quarterly from other producers, Station 42, 12.9 miles from the plant and Station 100 which is 11.5 miles from the plant. The samples were analyzed for I-131 by chemical separation, for elemental calcium, for Sr-89 and 90 and for gamma emitting isotopes. There were no detections of I-131 in the eight samples monitored.

There were no detections of Sr-89. Strontium-90 was found at an average level of 1.5 pCi/liter. There were 1.8 mg of calcium per liter of milk. Potassium-40 was detected at an average level of 1360. pCi/liter. The strontium-90, K-40 and elemental calcium were at normal environmental levels and were similar to the results obtained from analyses of milk from the nearest producer. There were no detections of Cs-137 in the samples collected. It can be concluded that the operations of CNS had no effect on milk samples and thus no dose impact on the population.

The levels of radioactivities of the nuclides K-40, I-131 and Cs-137 are plotted on Figure G-1. Potassium-40 was at normal environmental levels as in previous years. There were no detections of I-131 or Cs-137. Figure G-2 shows that Sr-90 and elemental calcium are at a level comparable to previous years and there were no detections of Sr-89. These graphs indicate that there was no appreciable difference between the levels of activity of the nearest producer and the commercial producers. This indicated no effect on milk samples from the operations of CNS.

FIGURE G-1  
 MILK - COMMERCIAL PRODUCERS  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 K-40 I-131 Cs-137

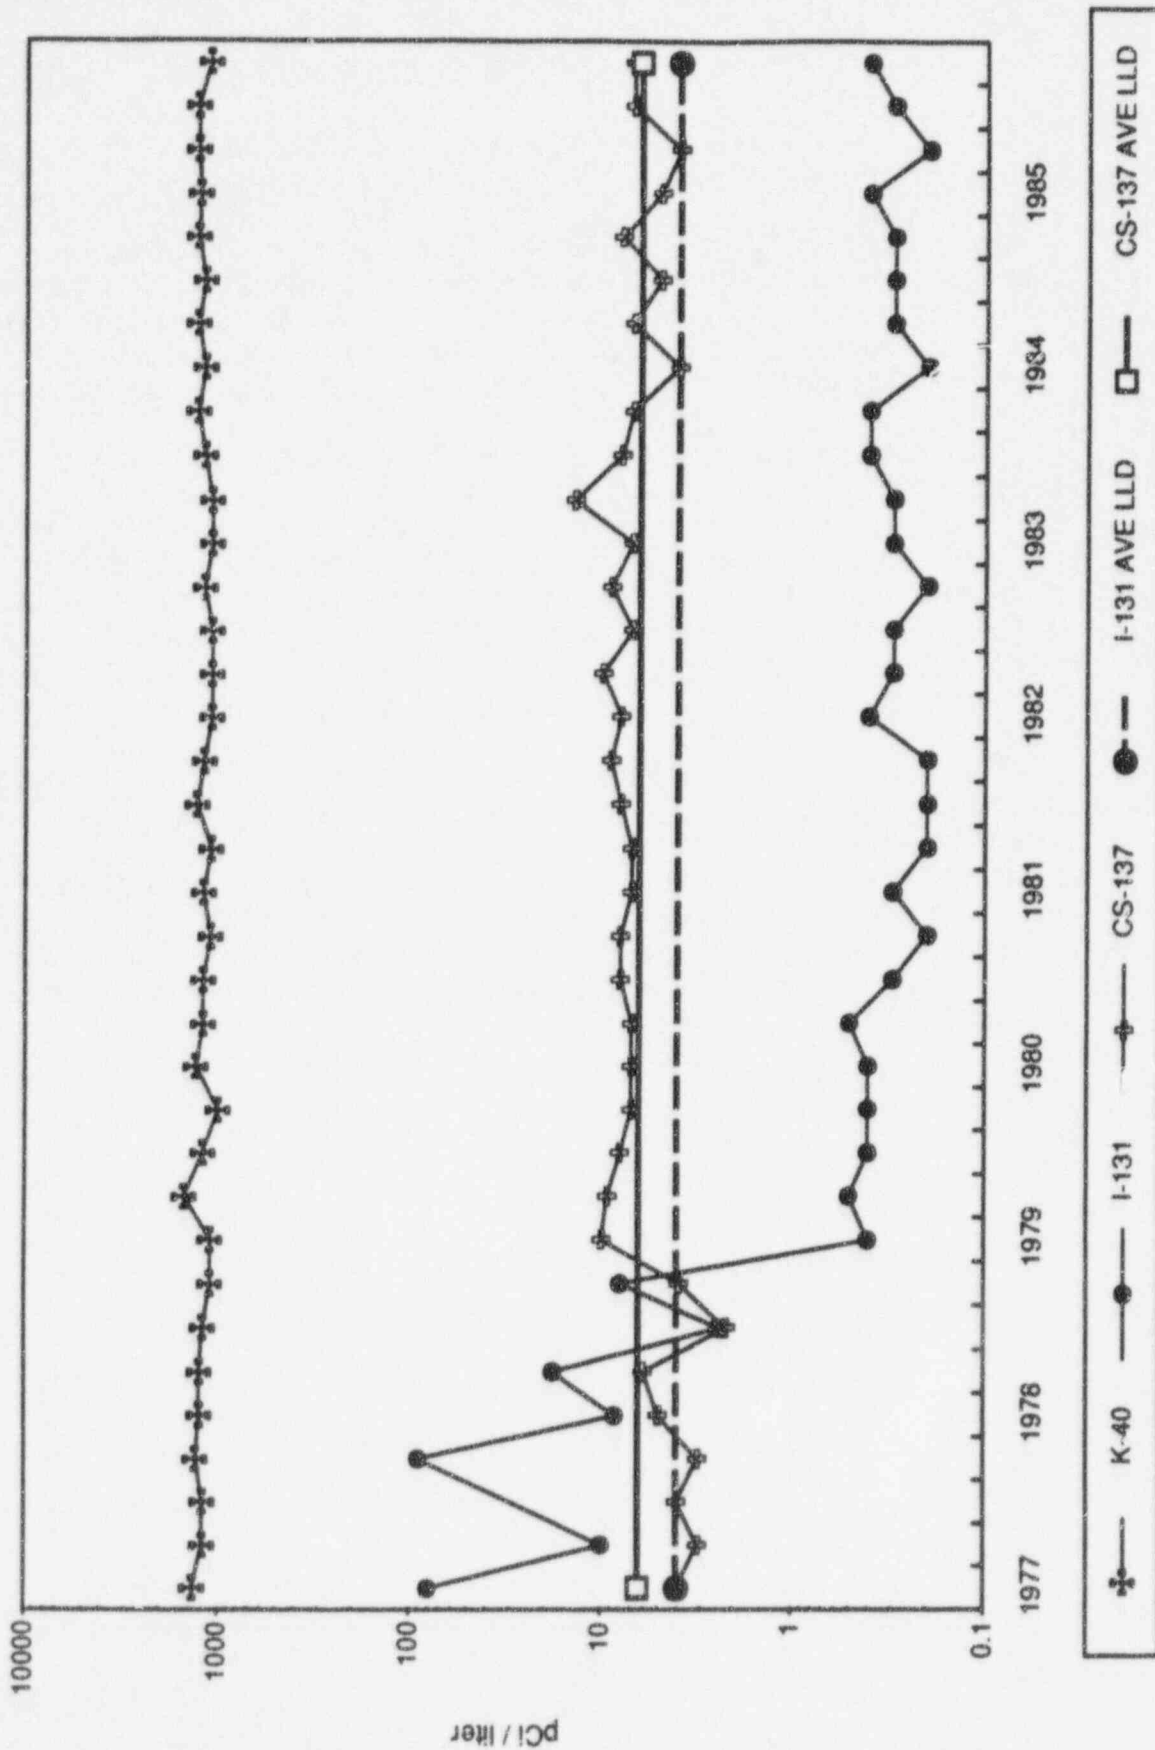




FIGURE G-1

MILK- COMMERCIAL PRODUCERS  
QUARTERLY AVERAGE - ALL LOCATIONS

K-40 I-131 Cs-137

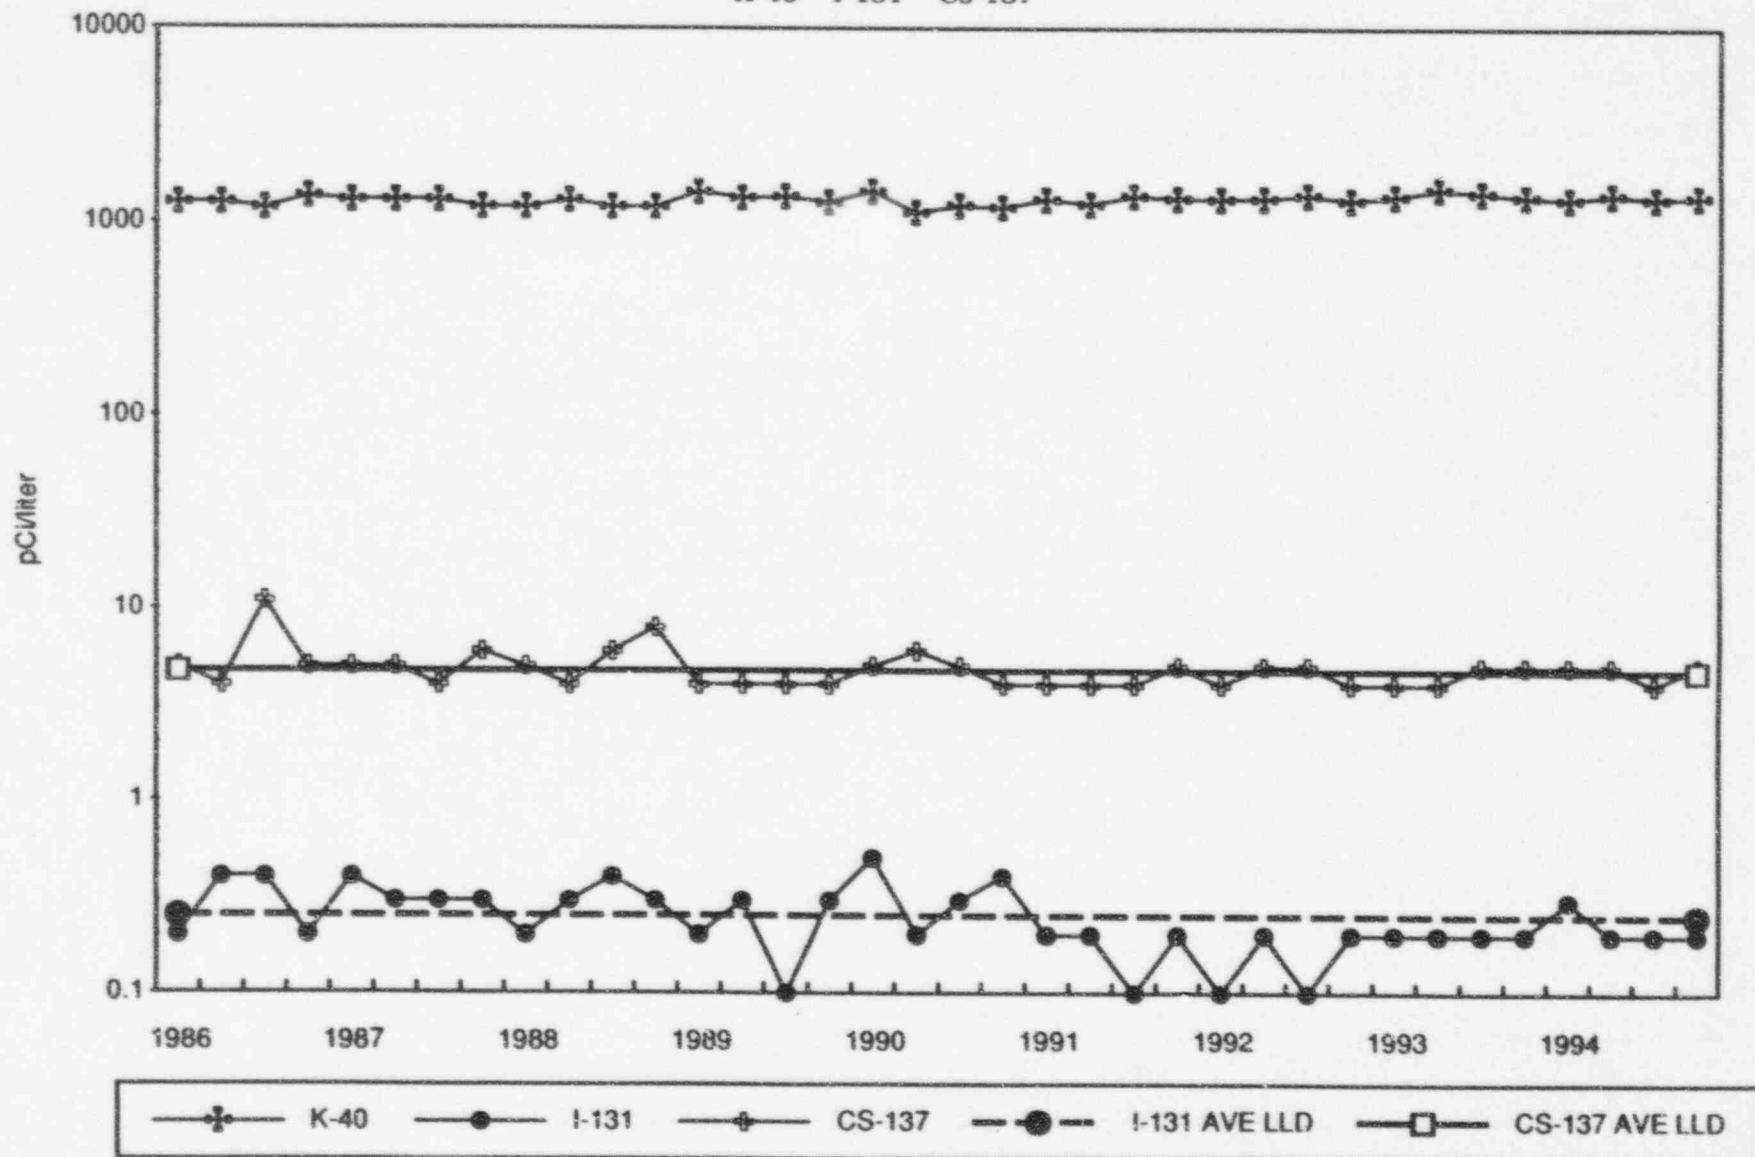


FIGURE G-1  
 MILK- COMMERCIAL PRODUCERS  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 K-40 I-131 Cs-137

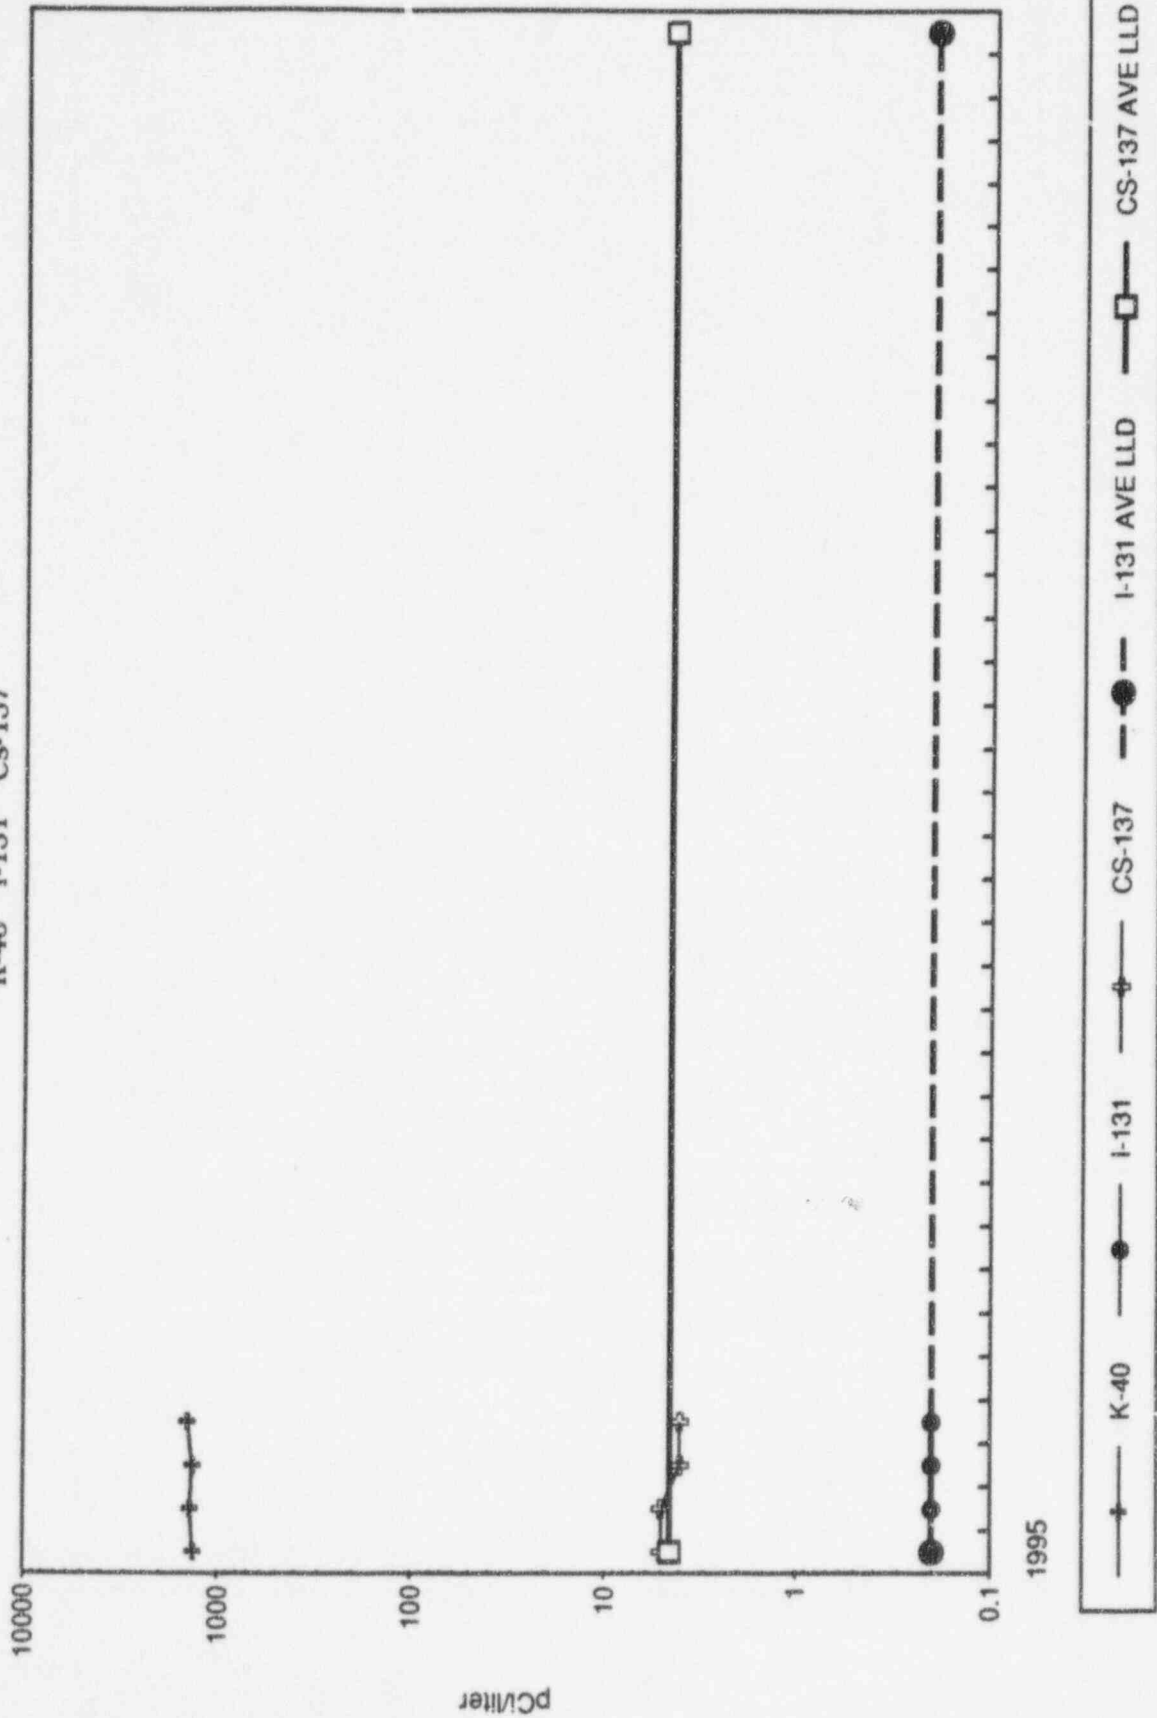


FIGURE G-2  
 MILK- COMMERCIAL PRODUCERS  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 SR-89 SR-90 ELEM. CA.

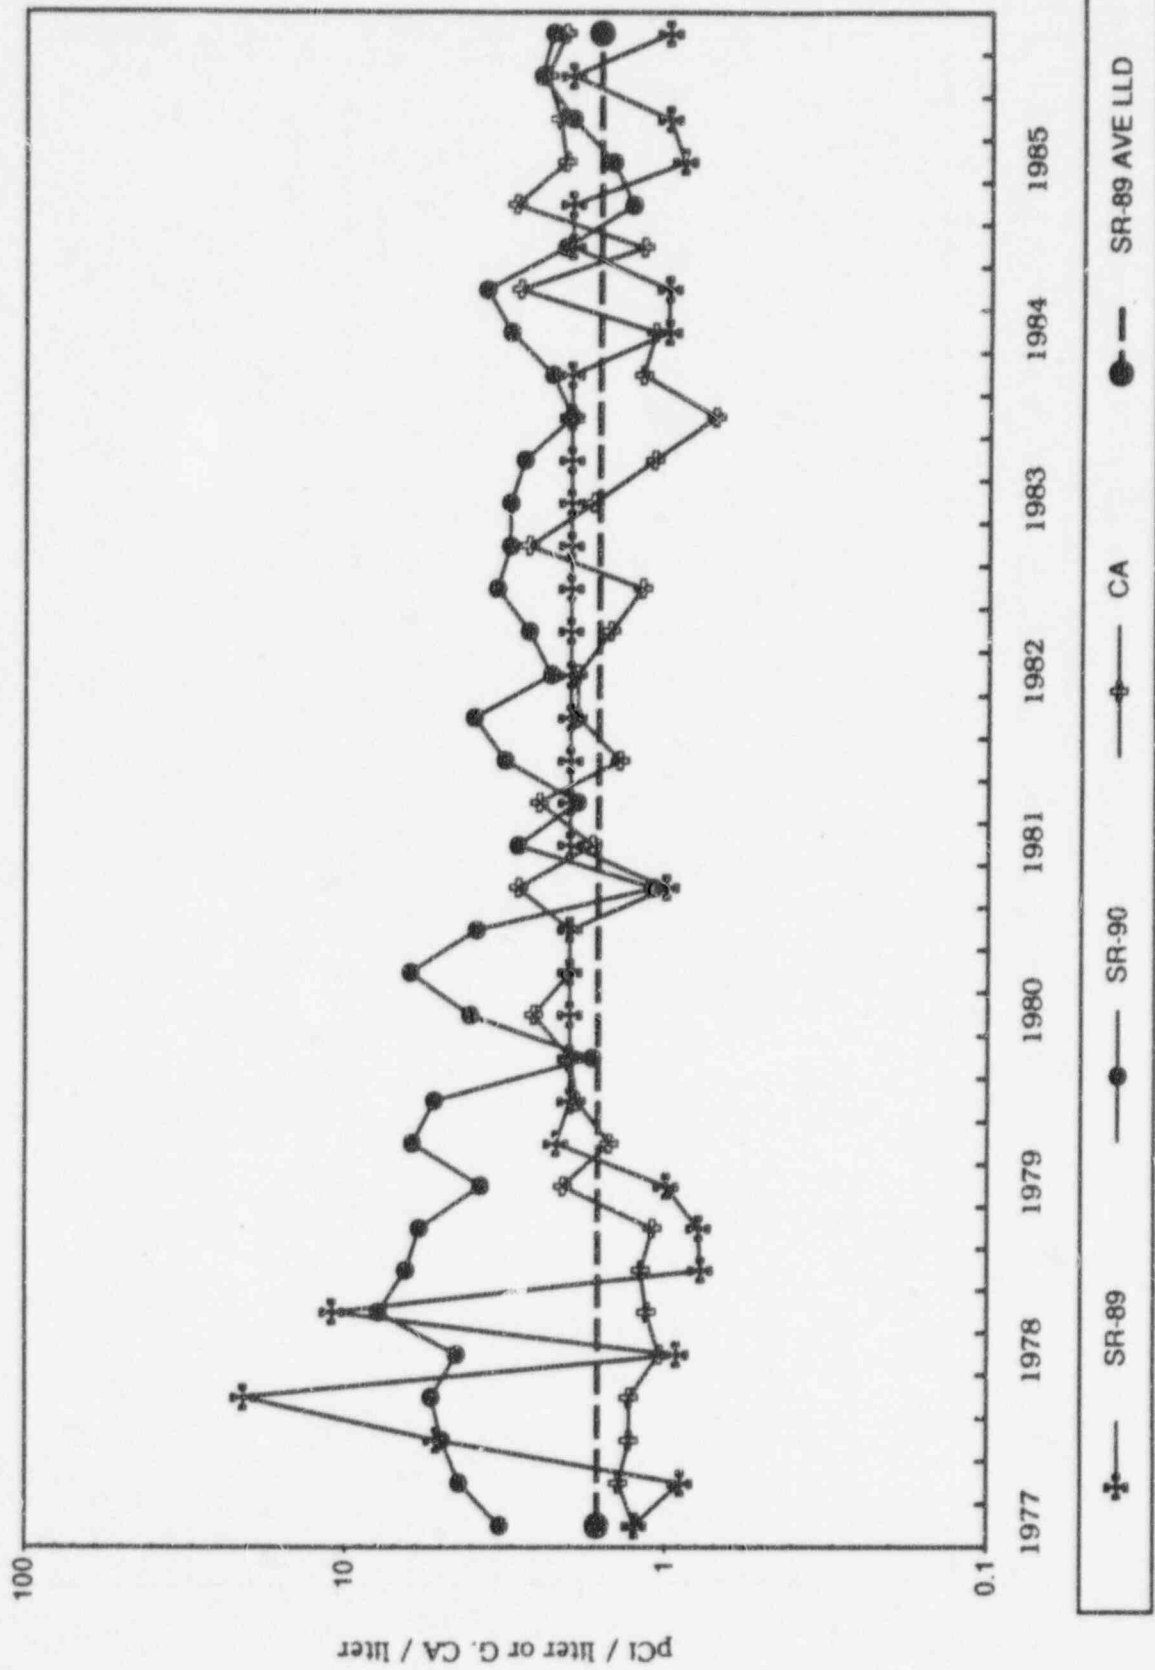


FIGURE G-2  
 MILK - COMMERCIAL PRODUCERS  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 SR-89 SR-90 ELEM. CA

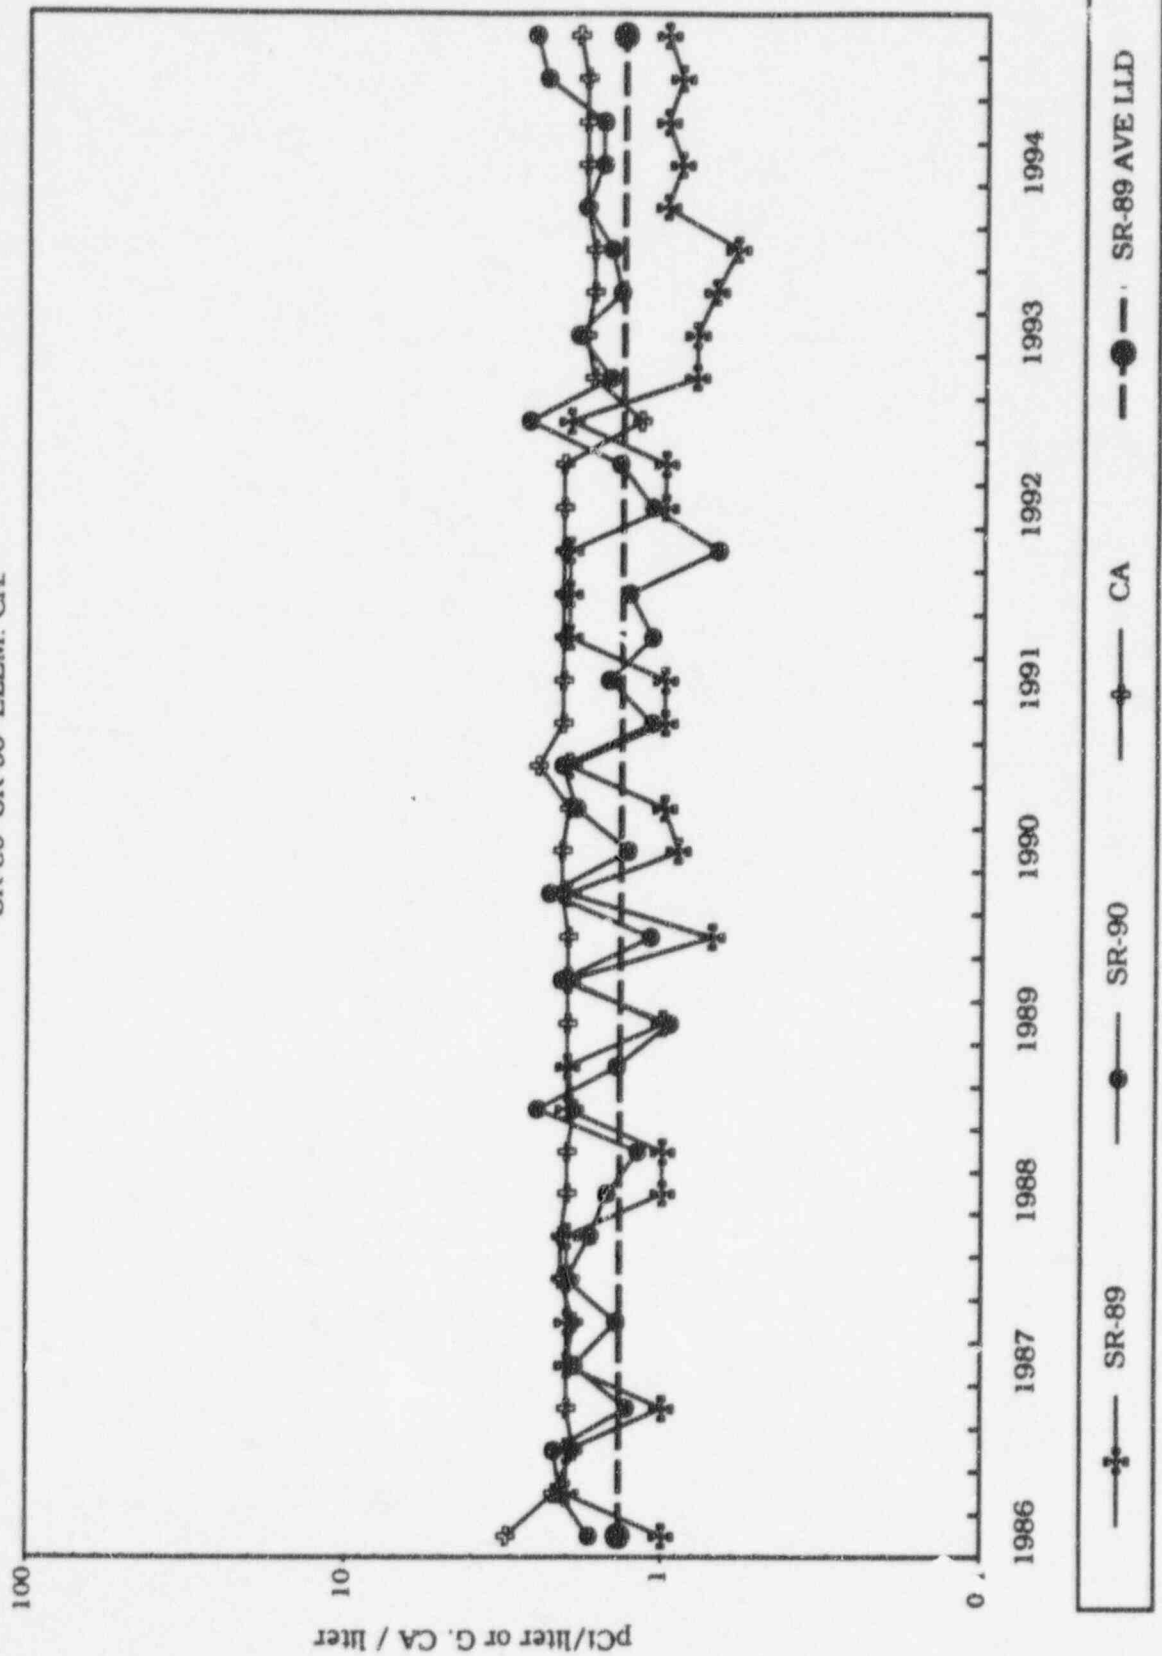
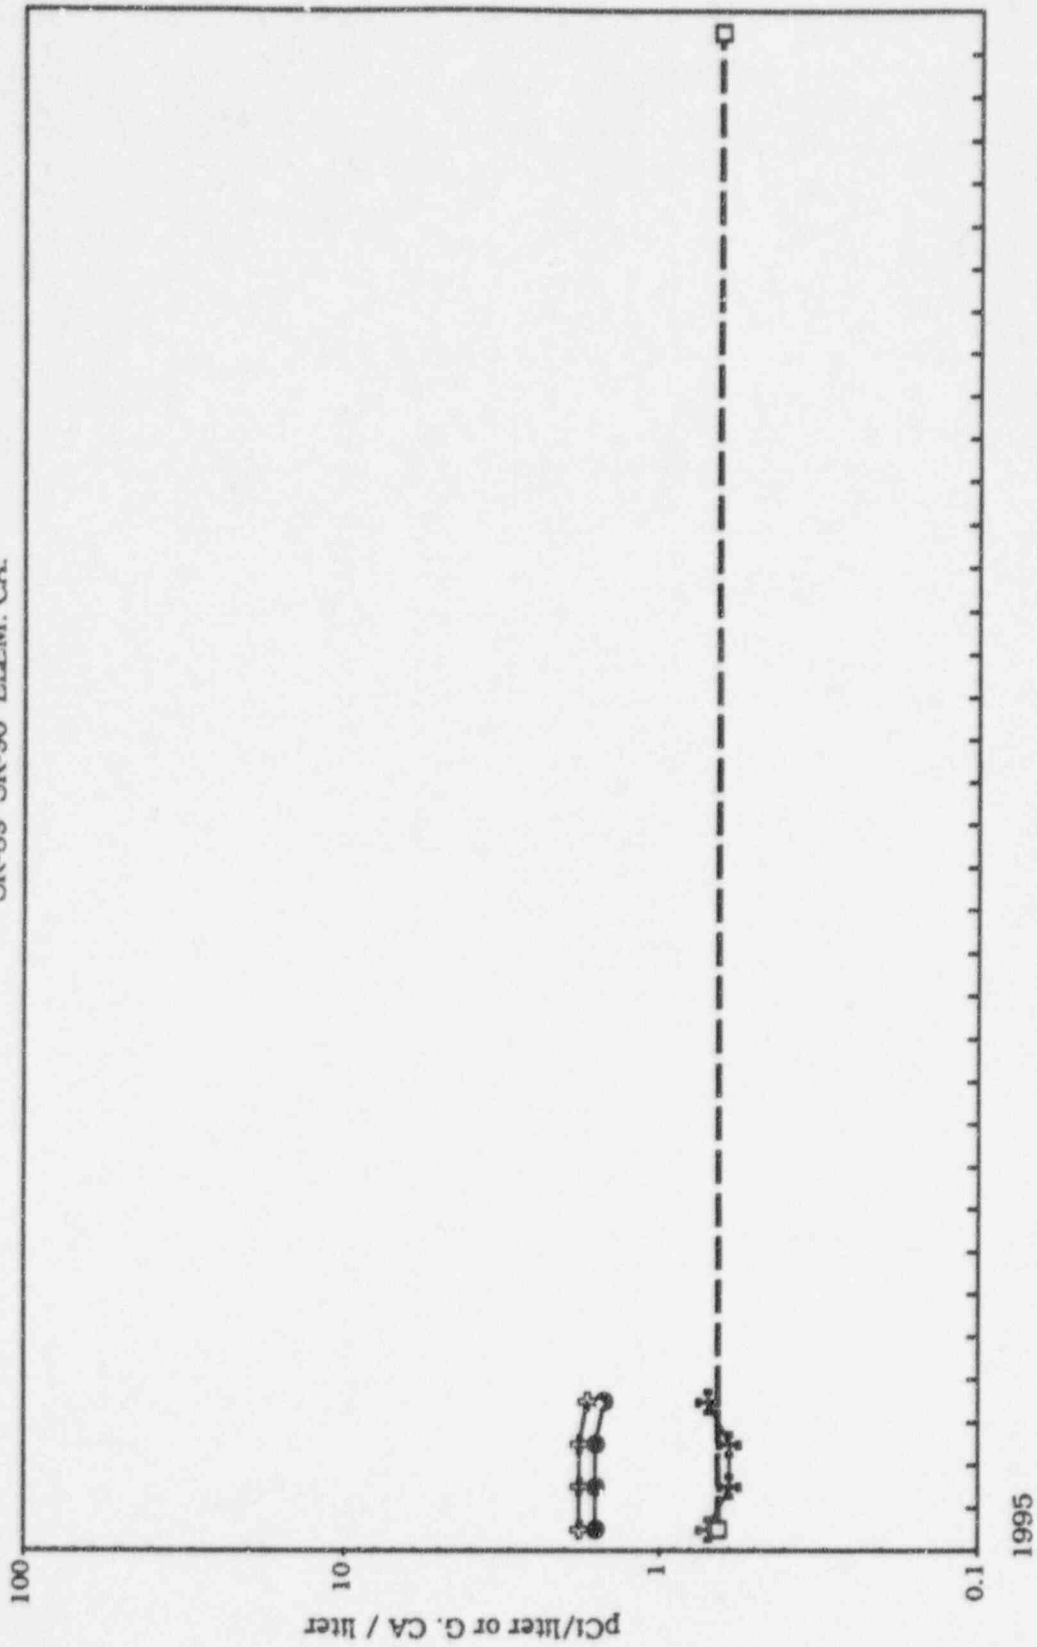


FIGURE G-2  
 MILK- COMMERCIAL PRODUCERS  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 SR-89 SR-90 ELEM. CA.



**TABLE G-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK - OTHER PRODUCERS -- PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/17	SECOND QUARTER 04/18	THIRD QUARTER 07/11-07/12	FOURTH QUARTER 10/24
SR-89	42, 100	Mean/std.dev. det./total range	L.T. 7. E-01 0/2 --	L.T. 6. E-01 0/2 --	L.T. 6. E-01 0/2 --	L.T. 7. E-01 0/2 --
SR-90	42, 100	Mean/std.dev. det./total range	1.6 ± 0.1 E 00 2/2 (1.5-1.6) E 00	1.6 ± 0.1 E 00 2/2 (1.5-1.7) E 00	1.6 ± 0.1 E 00 2/2 (1.5-1.6) E 00	1.5 ± 0.1 E 00 2/2 (1.4-1.5) E 00
I-131 (by chemical separation)	42, 100	Mean/std.dev. det./total range	L.T. 2. E-01 0/2 --	L.T. 2. E-01 0/2 --	L.T. 2. E-01 0/2 --	L.T. 2. E-01 0/2 --
Ca gm/liter	42, 100	Mean/std.dev. det./total range	1.8 ± 0.1 E 00 2/2 (1.7-1.9) E 00	1.8 ± 0.2 E 00 2/2 (1.8-1.8) E 00	1.8 ± 0.2 E 00 2/2 (1.8-1.8) E 00	1.7 ± 0.2 E 00 2/2 (1.7-1.7) E 00
K-40	42, 100	Mean/std.dev. det./total range	1.33 ± 0.1 E 03 2/2 (1.24-1.41) E 03	1.38 ± 0.02 E 03 2/2 (1.36-1.39) E 03	1.34 ± 0.02 E 03 2/2 (1.32-1.35) E 03	1.42 ± 0.14 E 03 2/2 (1.42-1.42) E 03
I-131 (by gamma spectroscopy)	42, 100	Mean/std.dev. det./total range	L.T. 5. E 00 0/2 --	L.T. 4. E 00 0/2 --	L.T. 8. E 00 0/2 --	L.T. 5. E 00 0/2 --
Cs-137	42, 100	Mean/std.dev. det./total range	L.T. 5. E 00 0/2 --	L.T. 5. E 00 0/2 --	L.T. 4. E 00 0/2 --	L.T. 4. E 00 0/2 --

**TABLE G-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK - OTHER PRODUCERS - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/17	SECOND QUARTER 04/18	THIRD QUARTER 07/11-07/12	FOURTH QUARTER 10/24
BE-7	42, 100	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)
K-40	42, 100	1.33 ± 0.1E 03 (2/2)	1.38±0.02E 03(2/2)	1.34±0.02E 03(2/2)	1.42±0.14E 03(2/2)
Mn-54	42, 100	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Co-58	42, 100	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Fe-59	42, 100	L.T. 1. E 01 (0/2)	L.T. 8. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 8. E 00 (0/2)
Co-60	42, 100	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Zn-65	42, 100	L.T. 1. E 01 (0/2)	L.T. 8. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 8. E 00 (0/2)
Zr-95	42, 100	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ru-103	42, 100	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ru-106	42, 100	L.T. 4. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 4. E 01 (0/2)
I-131	42, 100	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 5. E 00 (0/2)
Cs-134	42, 100	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Cs-137	42, 100	L.T. 5. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ba-140	42, 100	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ce-141	42, 100	L.T. 9. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 5. E 00 (0/2)
Ce-144	42, 100	L.T. 4. E 01 (0/2)	L.T. 2. E 01 (0/2)	L.T. 2. E 01 (0/2)	L.T. 2. E 01 (0/2)
Ra-226	42, 100	L.T. 1. E 02 (0/2)	L.T. 7. E 01 (0/2)	L.T. 7. E 01 (0/2)	L.T. 7. E 01 (0/2)
Th-228	42, 100	L.T. 9. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 7. E 00 (0/2)

## H. GROUNDWATER (See Tables H-1 and H-2)

### STATIONS 11, 47

Groundwater was collected from two stations quarterly and analyzed for gross beta and gross alpha activity, for tritium and for gamma emitting radionuclides. Station 11 is 0.15 miles from the plant and station 47 is 25.75 miles from the plant.

The gross beta activity averaged 8.4 pCi/liter which is statistically similar to past years. There was one detection of gross alpha at Station 47 (7.9 pCi/l). There were no detections of gamma emitters above the normal level of detection. The tritium level averaged 100 pCi/liter for the year which is the normal environmental level.

There was no difference in levels of beta activity or tritium for the station close to the plant as compared with the more distant station. It may be concluded that there was no impact from the operations of CNS on the environment as shown by measurements of radionuclides in groundwater.

Shown in Figure H-1 are the gross alpha, gross beta and tritium levels in groundwater. The levels of these activities have remained essentially unchanged.



FIGURE H-1  
 GROUNDWATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 GROSS ALPHA GROSS BETA H-3


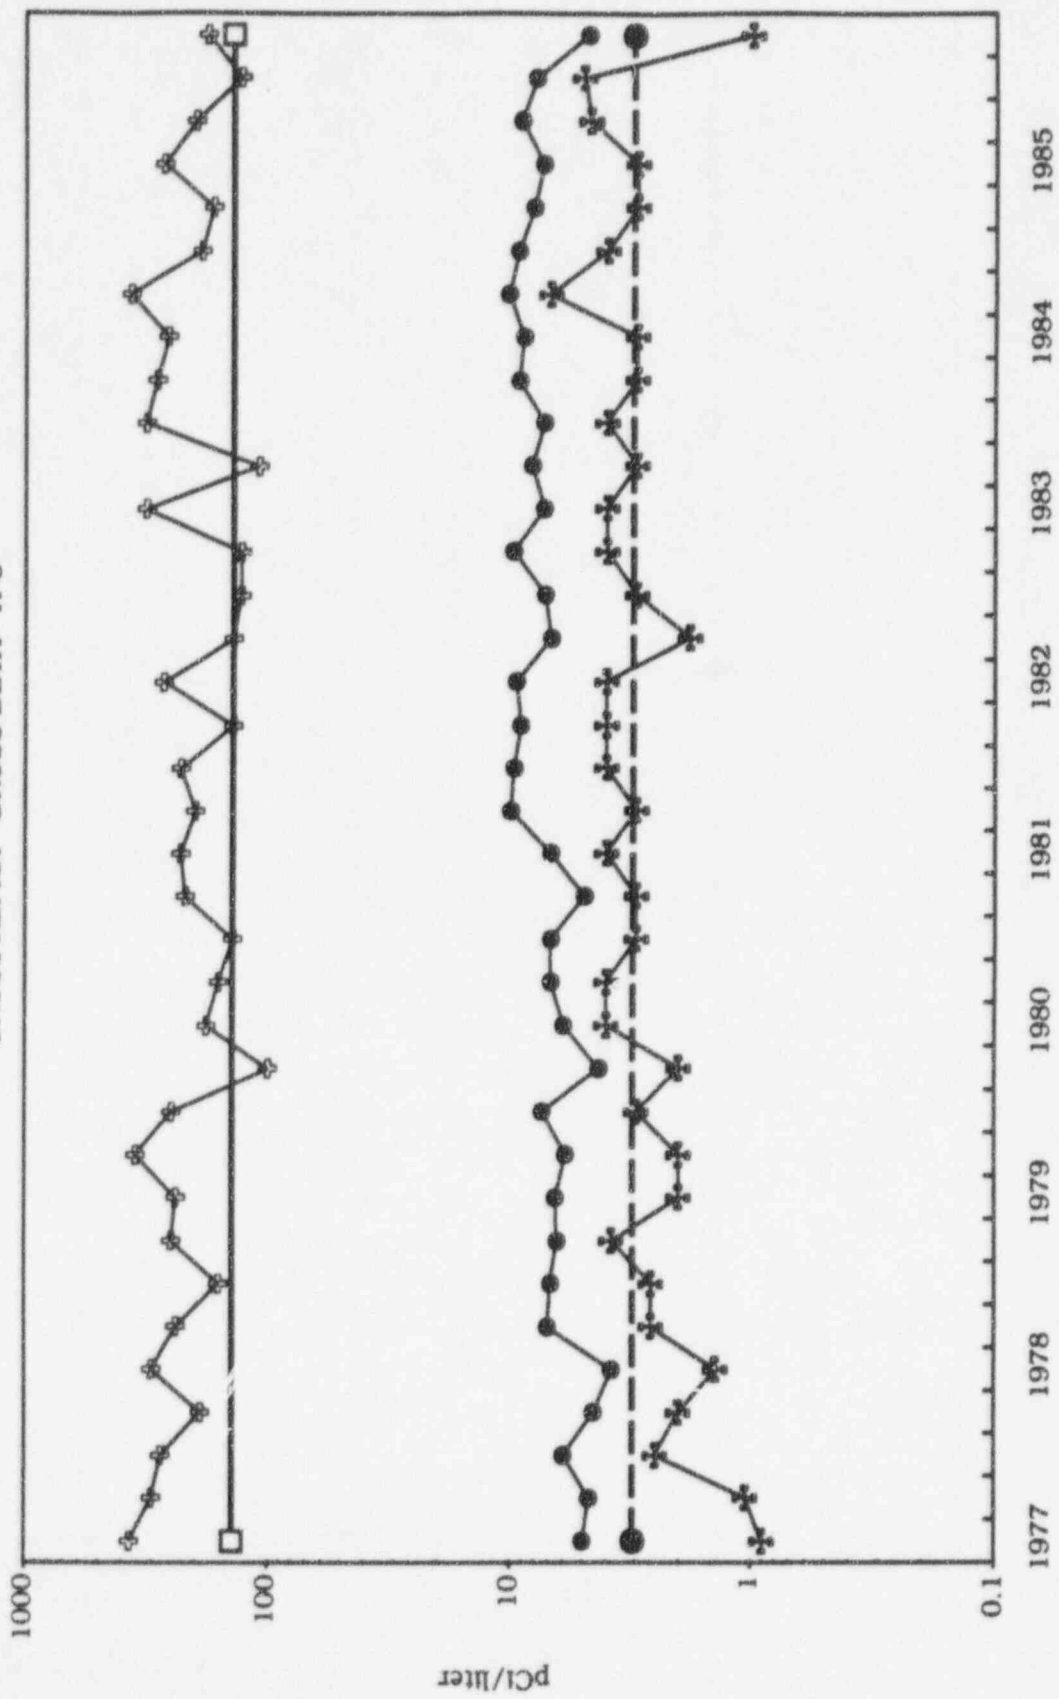


FIGURE H-1  
 GROUNDWATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 GROSS ALPHA GROSS BETA H-3

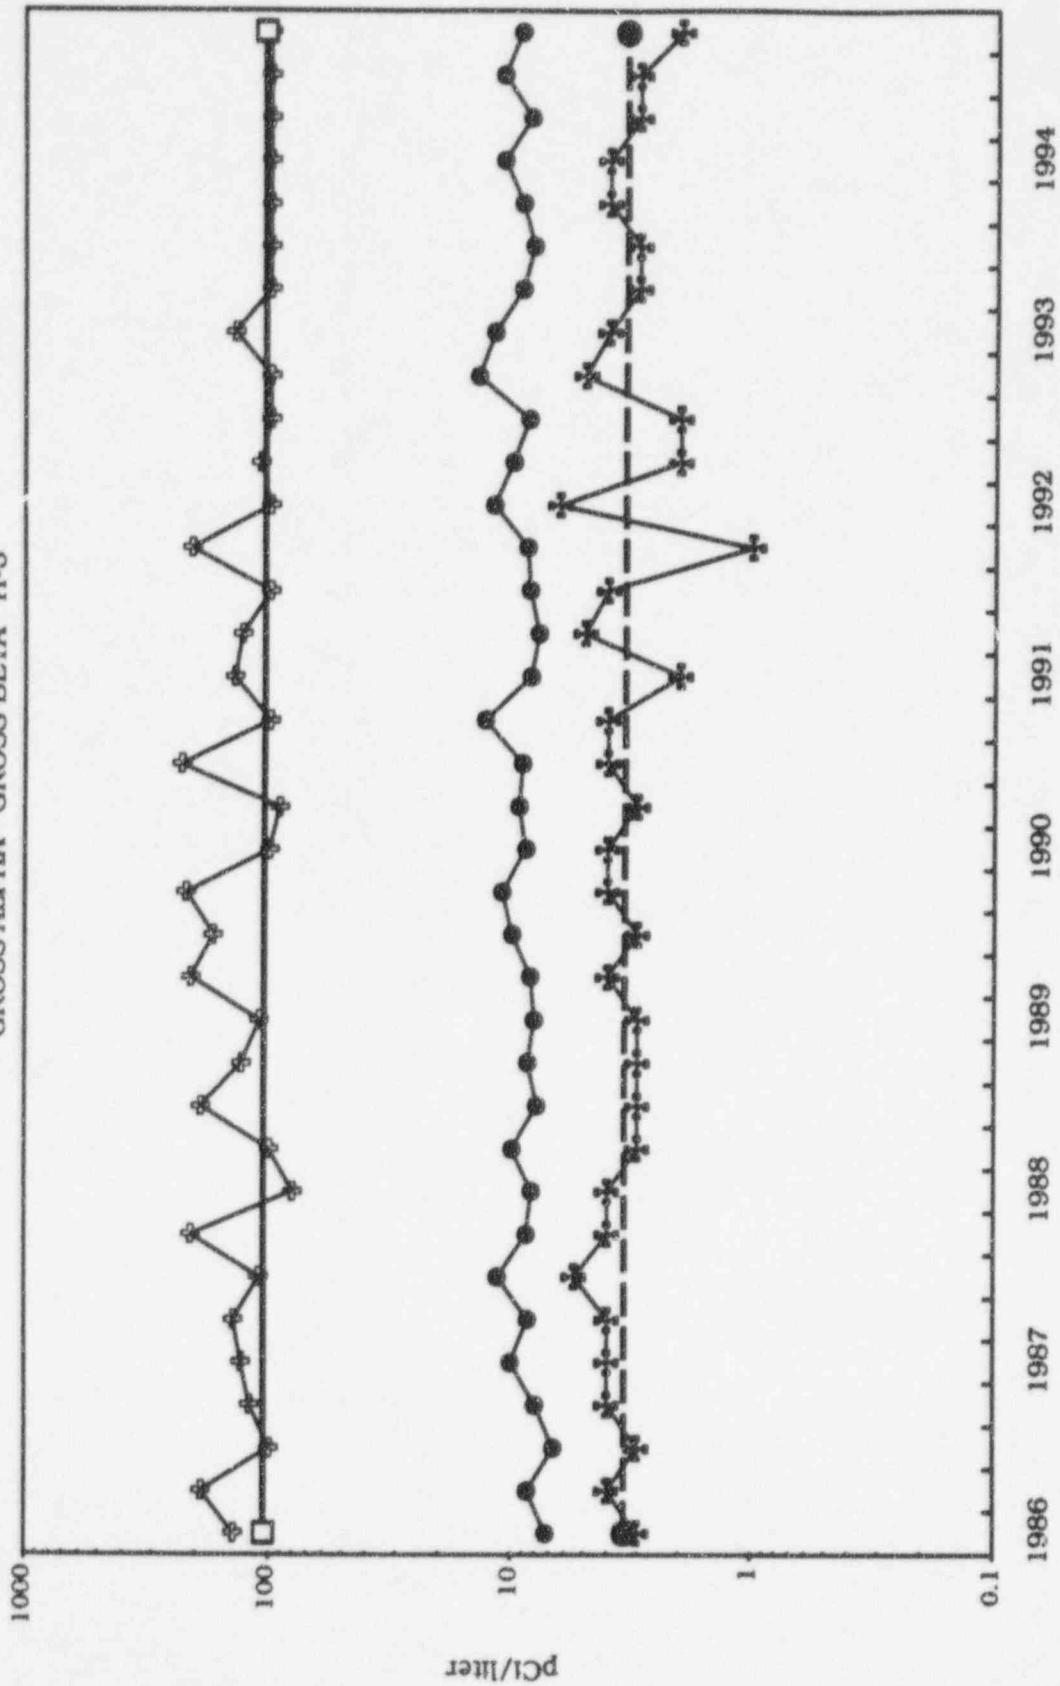
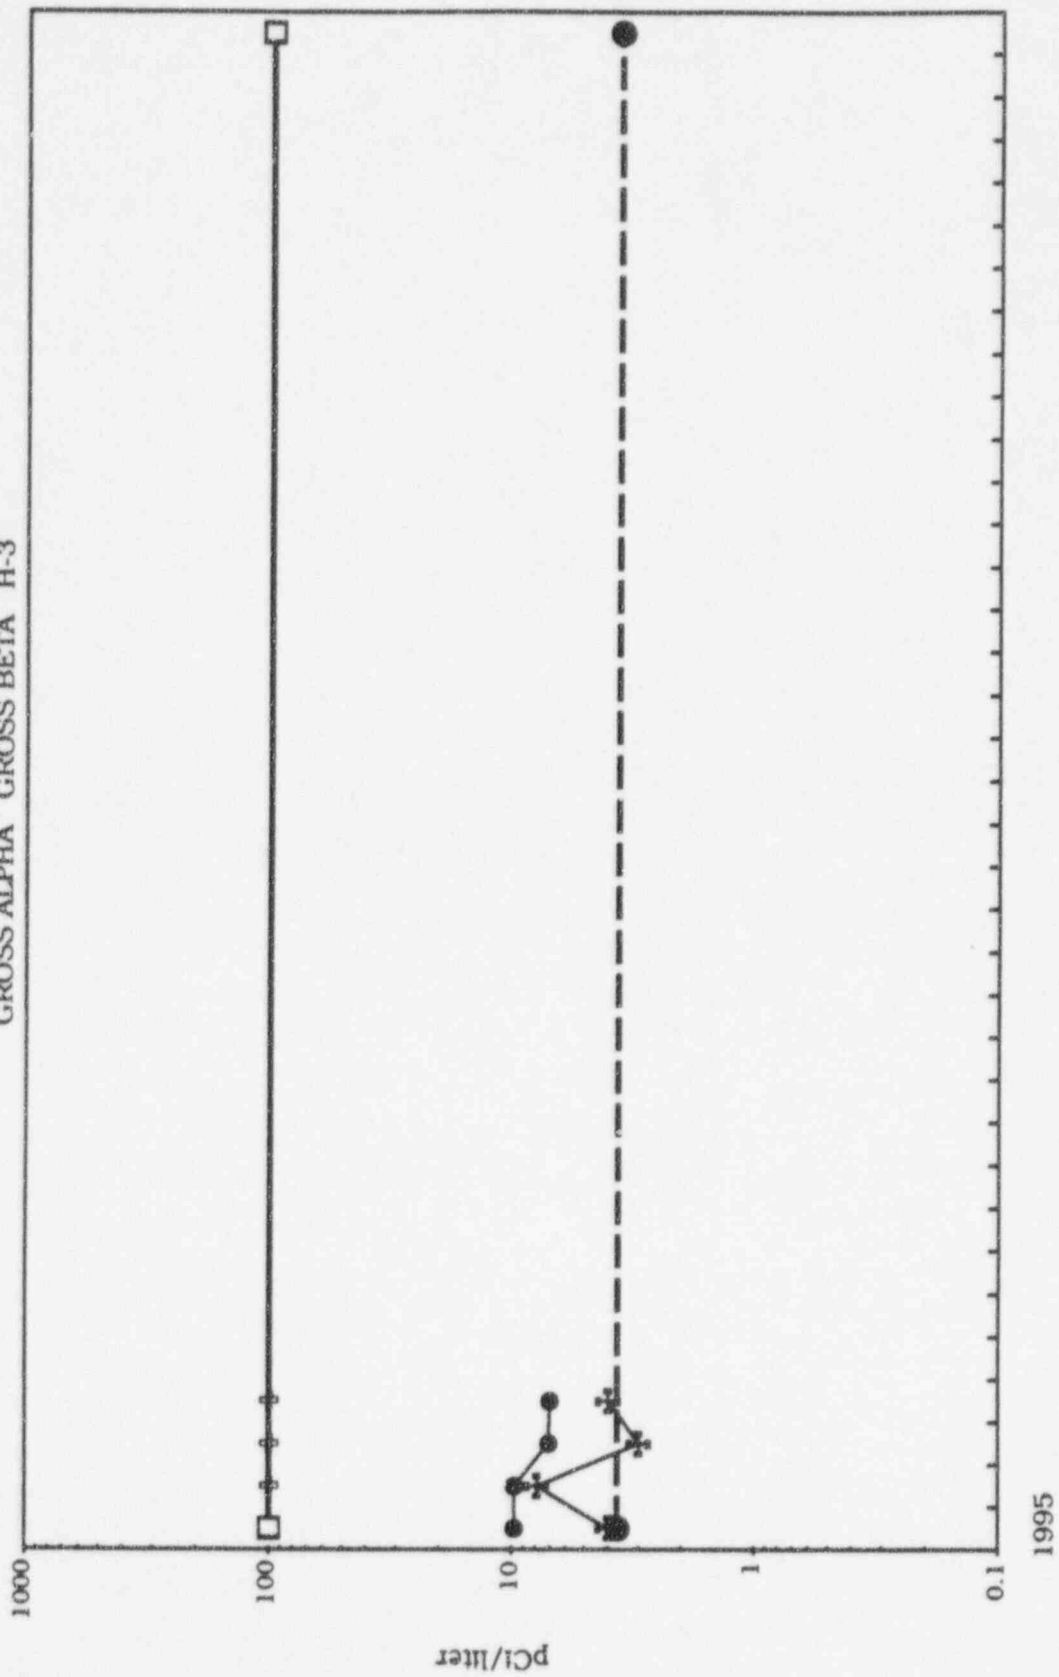


FIGURE H-1  
 GROUNDWATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 GROSS ALPHA GROSS BETA H-3



**TABLE E-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 GROUNDWATER - PCI/LITER

84

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/23, 01/24	SECOND QUARTER 04/25	THIRD QUARTER 07/18	FOURTH QUARTER 10/25
GROSS ALPHA	11, 47	Meanistd.dev. det./total range	L.T. 4. E 00 0/2 --	7.9 ± 3.6 E 00 1/2 --	L.T. 3. E 00 0/2 --	L.T. 4. E 00 0/2 --
GROSS BETA	11, 47	Meanistd.dev. det./total range	5.8 ± 0.4 E 00 2/2 (9.5-10) E 00	9.8 ± 1.7 E 00 2/2 (8.6-11) E 00	7.1 ± 0.9 E 00 2/2 (6.4-7.7) E 00	7.0 ± 0.9 E 00 2/2 (6.3-7.6) E 00
K-40	11, 47	Meanistd.dev. det./total range	L.T. 6. E 01 0/2 --	L.T. 9. E 01 0/2 --	L.T. 1. E 02 0/2 --	L.T. 8. E 01 0/2 --
I-131 (by gamma spectroscopy)	11, 47	Meanistd.dev. det./total range	L.T. 6. E 00 0/2 --	L.T. 4. E 00 0/2 --	L.T. 7. E 00 0/2 --	L.T. 4. E 00 0/2 --
Cs-137	11, 47	Meanistd.dev. det./total range	L.T. 5. E 00 0/2 --	L.T. 4. E 00 0/2 --	L.T. 4. E 00 0/2 --	L.T. 4. E 00 0/2 --
H-3	11, 47	Meanistd.dev. det./total range	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --

**TABLE B-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 GROUNDWATER - PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/23, 01/24	SECOND QUARTER 04/25	THIRD QUARTER 07/18	FOURTH QUARTER 10/25
BE-7	11, 47	L.T. 4. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 4. E 01 (0/2)	L.T. 3. E 01 (0/2)
K-40	11, 47	L.T. 6. E 01 (0/2)	L.T. 9. E 01 (0/2)	L.T. 1. E 02 (0/2)	L.T. 8. E 01 (0/2)
Mn-54	11, 47	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)
Co-58	11, 47	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)
Fe-59	11, 47	L.T. 8. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 9. E 00 (0/2)	L.T. 7. E 00 (0/2)
Co-60	11, 47	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)
Zn-65	11, 47	L.T. 8. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 8. E 00 (0/2)	L.T. 7. E 00 (0/2)
Zr-95	11, 47	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)
Ru-103	11, 47	L.T. 5. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 3. E 00 (0/2)
Ru-106	11, 47	L.T. 4. E 01 (0/2)	L.T. 3. E 01 (0/2)	L.T. 4. E 01 (0/2)	L.T. 3. E 01 (0/2)
I-131	11, 47	L.T. 6. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 4. E 00 (0/2)
Cs-134	11, 47	L.T. 5. E 00 (0/2)	L.T. 3. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Cs-137	11, 47	L.T. 5. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ba-140	11, 47	L.T. 6. E 00 (0/2)	L.T. 4. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ce-141	11, 47	L.T. 9. E 00 (0/2)	L.T. 5. E 00 (0/2)	L.T. 6. E 00 (0/2)	L.T. 4. E 00 (0/2)
Ce-144	11, 47	L.T. 4. E 01 (0/2)	L.T. 2. E 01 (0/2)	L.T. 2. E 01 (0/2)	L.T. 2. E 01 (0/2)
Ra-226	11, 47	L.T. 1. E 02 (0/2)	L.T. 7. E 01 (0/2)	L.T. 7. E 01 (0/2)	L.T. 7. E 01 (0/2)
Th-228	11, 47	L.T. 1. E 01 (0/2)	L.T. 6. E 00 (0/2)	L.T. 7. E 00 (0/2)	L.T. 6. E 00 (0/2)

I. RIVER WATER (See Table I-1 and I-2)

STATIONS 12, 28

River water was collected monthly and monitored for gross beta and gross alpha, suspended and dissolved, Sr-89 and Sr-90 plus gamma emitting isotopes. A quarterly composite was measured for tritium.

There were no detections of potassium-40 above the normal level of detection and no detections of Sr-89 and Sr-90.

The average gross alpha and gross beta readings were similar to previous years as indicated in the summary of 1994 and 1995 averages below:

	1994 Average pCi/liter	1995 Average pCi/liter
Gross Alpha (dissolved)	3.8	4.0
Gross Alpha (suspended)	3.0	2.2
Gross Beta (dissolved)	11.0	11.0
Gross Beta (suspended)	7.7	5.9

Figure I-1, which follows, is a plot of the gross alpha and gross beta of suspended and dissolved particles. The levels of activity continued to rise and fall within statistical limits depending on water levels and turbulence and were probably due to naturally occurring isotopes. No fission or reactor activation products were detected. Figure I-2 illustrates the level of activity for tritium, Sr-89 and Sr-90.

FIGURE I-1  
 RIVER WATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 GROSS ALPHA AND GROSS BETA (SUSPENDED AND DISSOLVED SOLIDS)

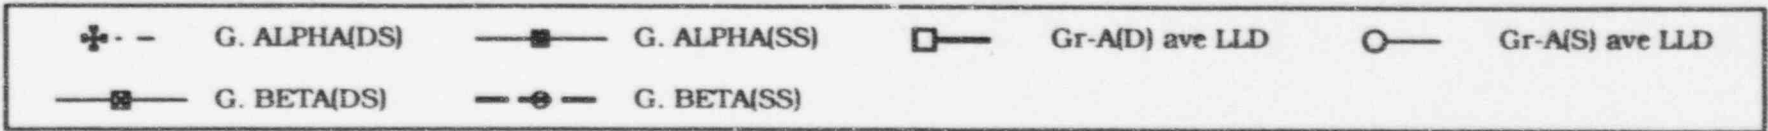
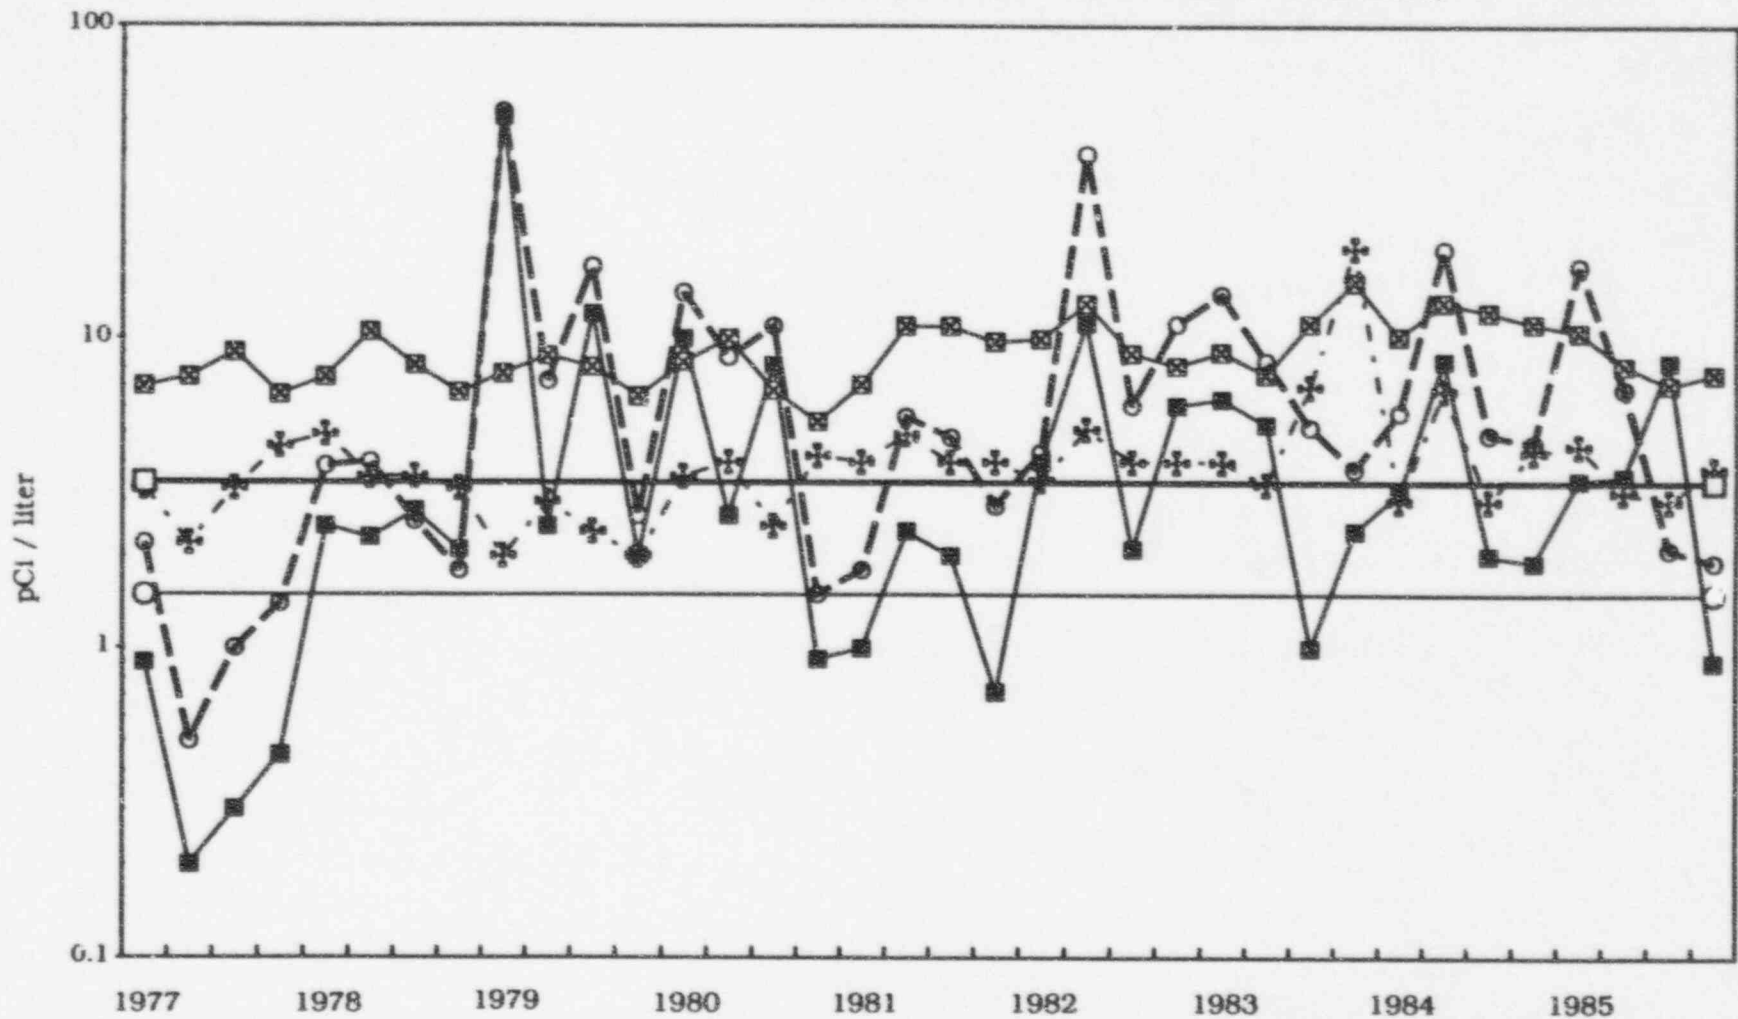


FIGURE I-1  
 RIVER WATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 GROSS ALPHA AND GROSS BETA (SUSPENDED AND DISSOLVED SOLIDS)

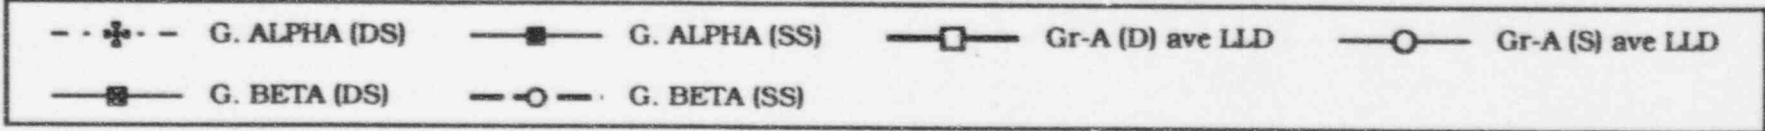
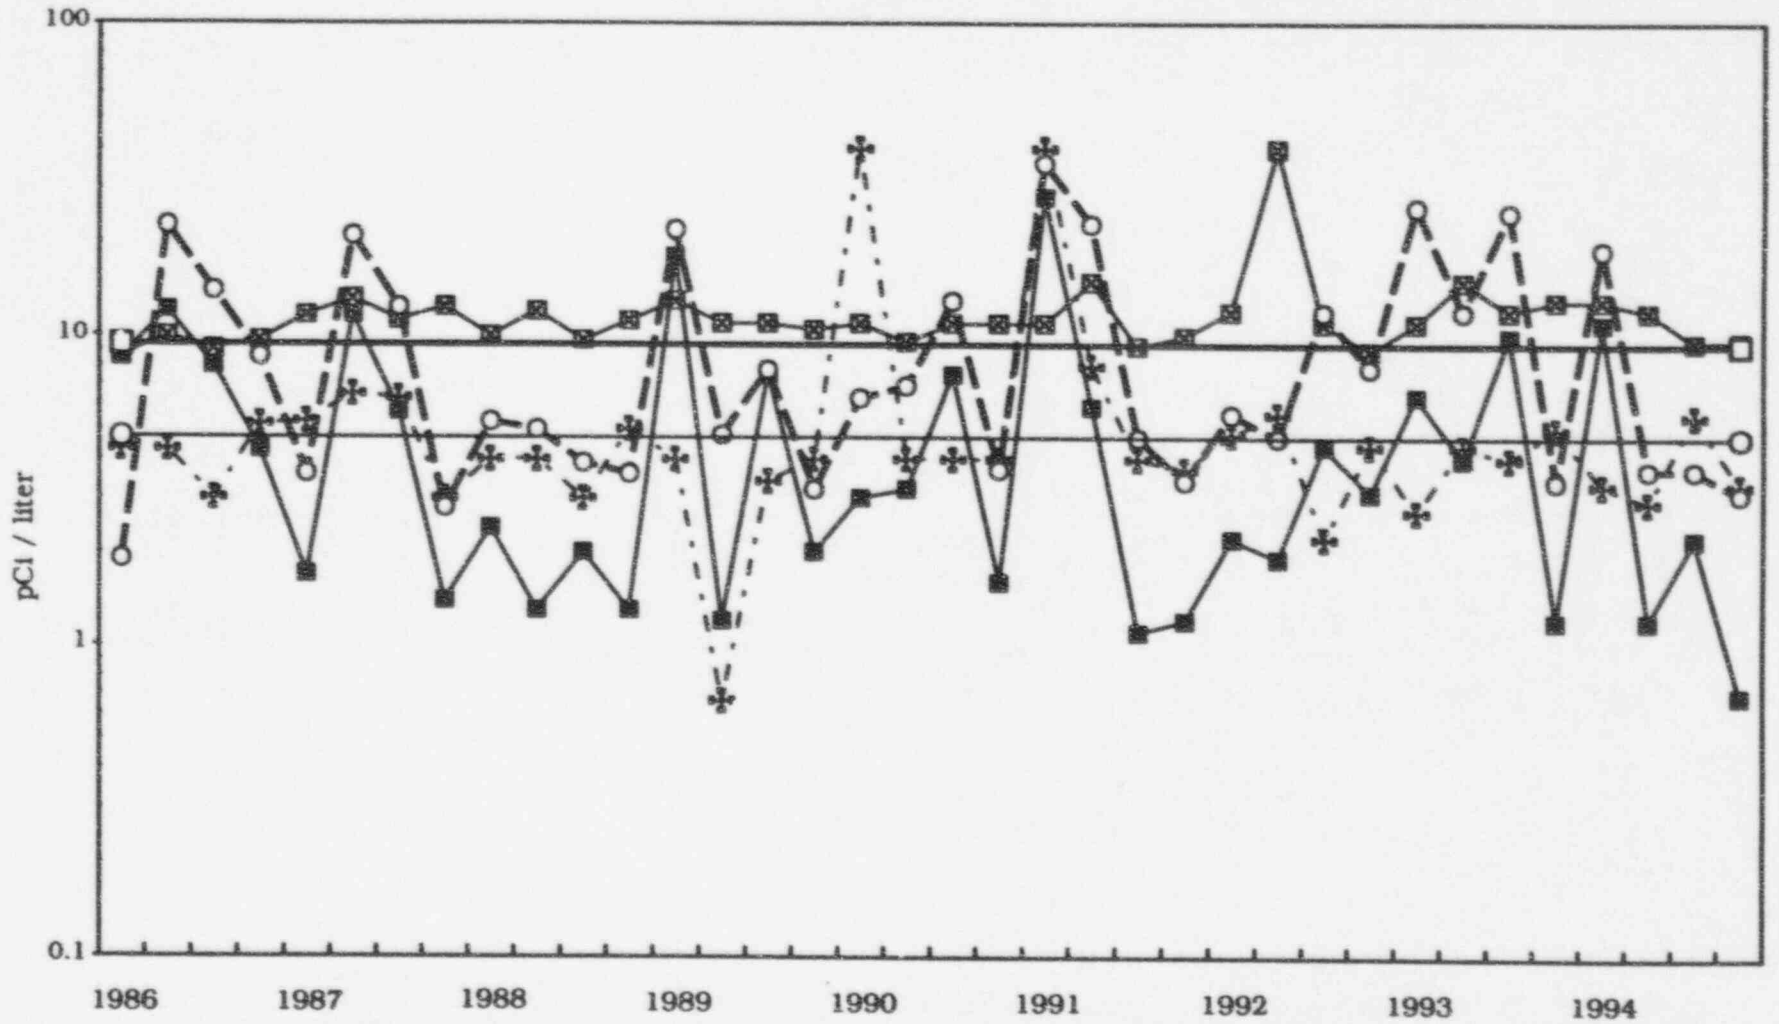




FIGURE I-1  
 RIVER WATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 GROSS ALPHA AND GROSS BETA (SUSPENDED AND DISSOLVED SOLIDS)


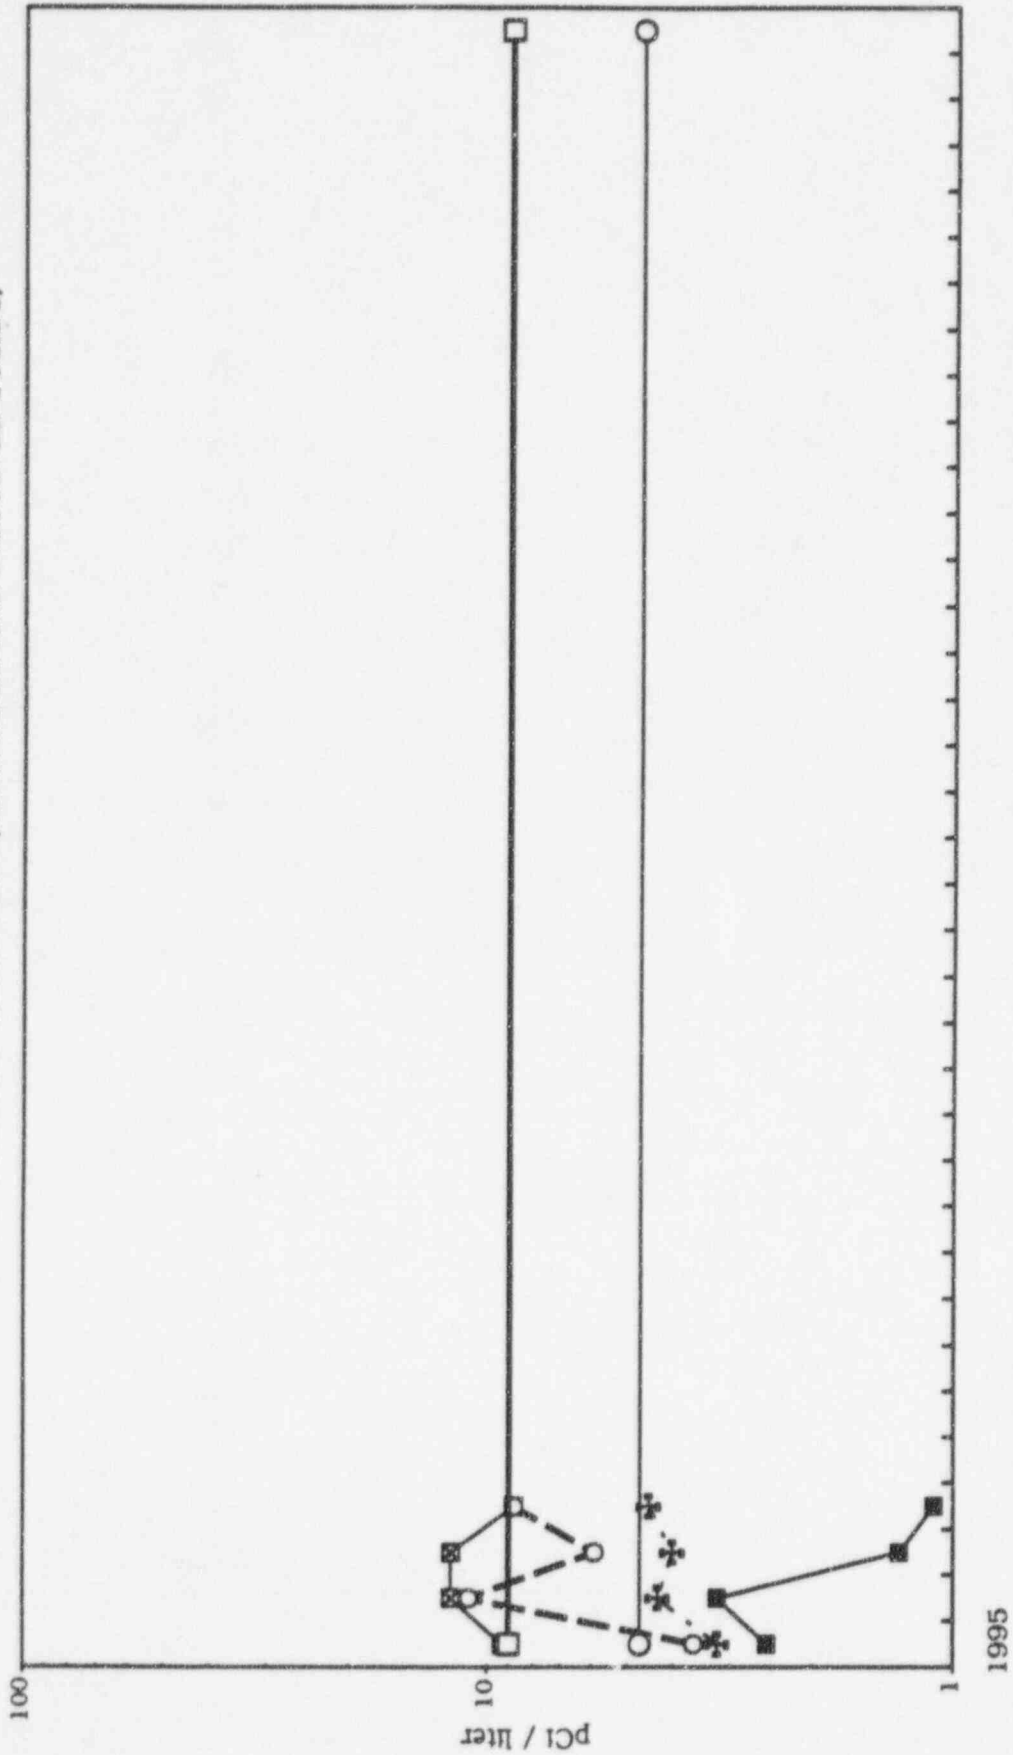


FIGURE I-2  
 RIVER WATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 SR-89 SR-90 H-3

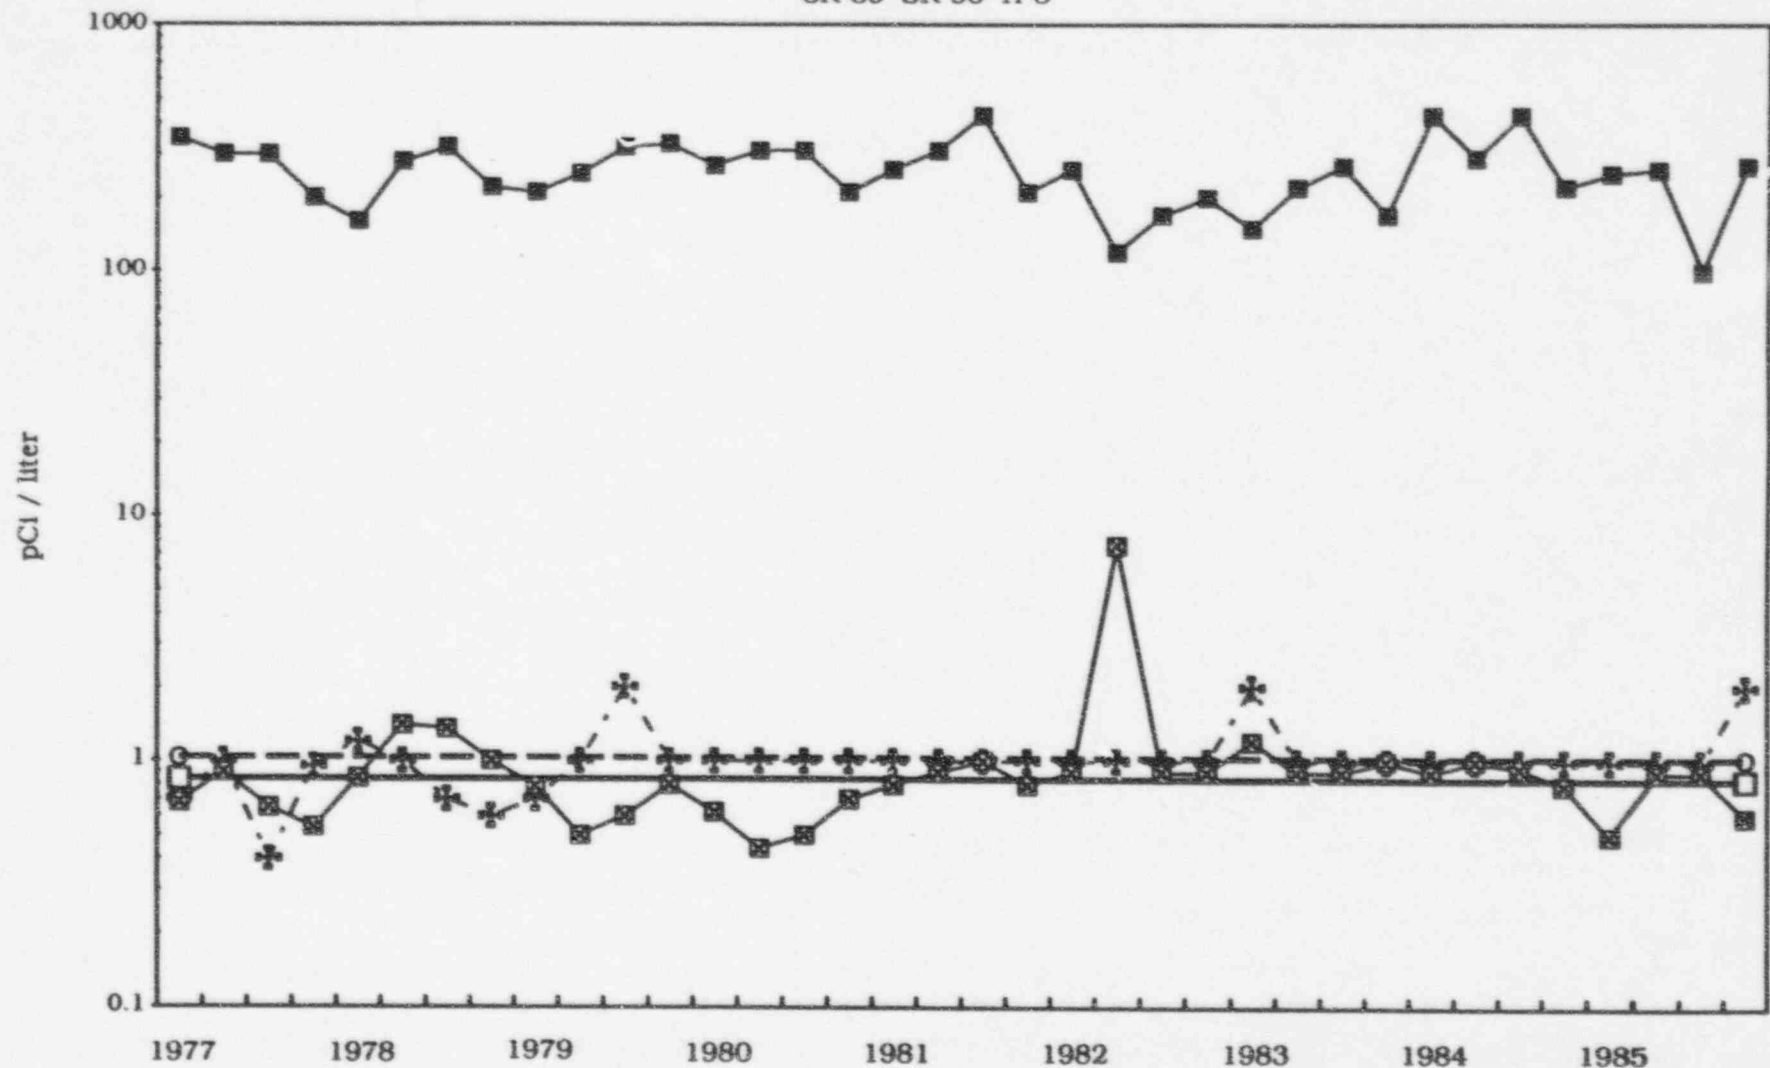

+ - - SR-89    —■— SR-90    —■— H-3    —○— SR-89 AVE LLD    □— SR-90 AVE LLD

FIGURE I-2  
 RIVER WATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 SR-89 SR-90 H-3

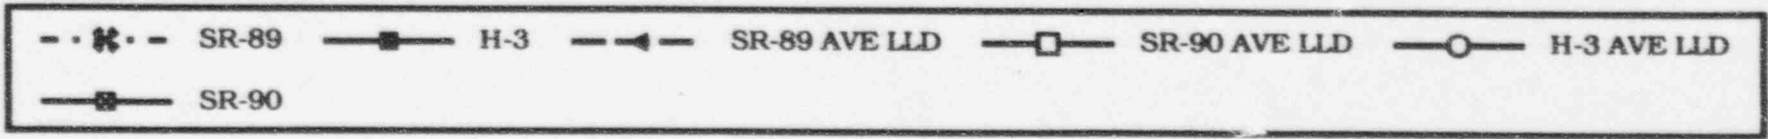
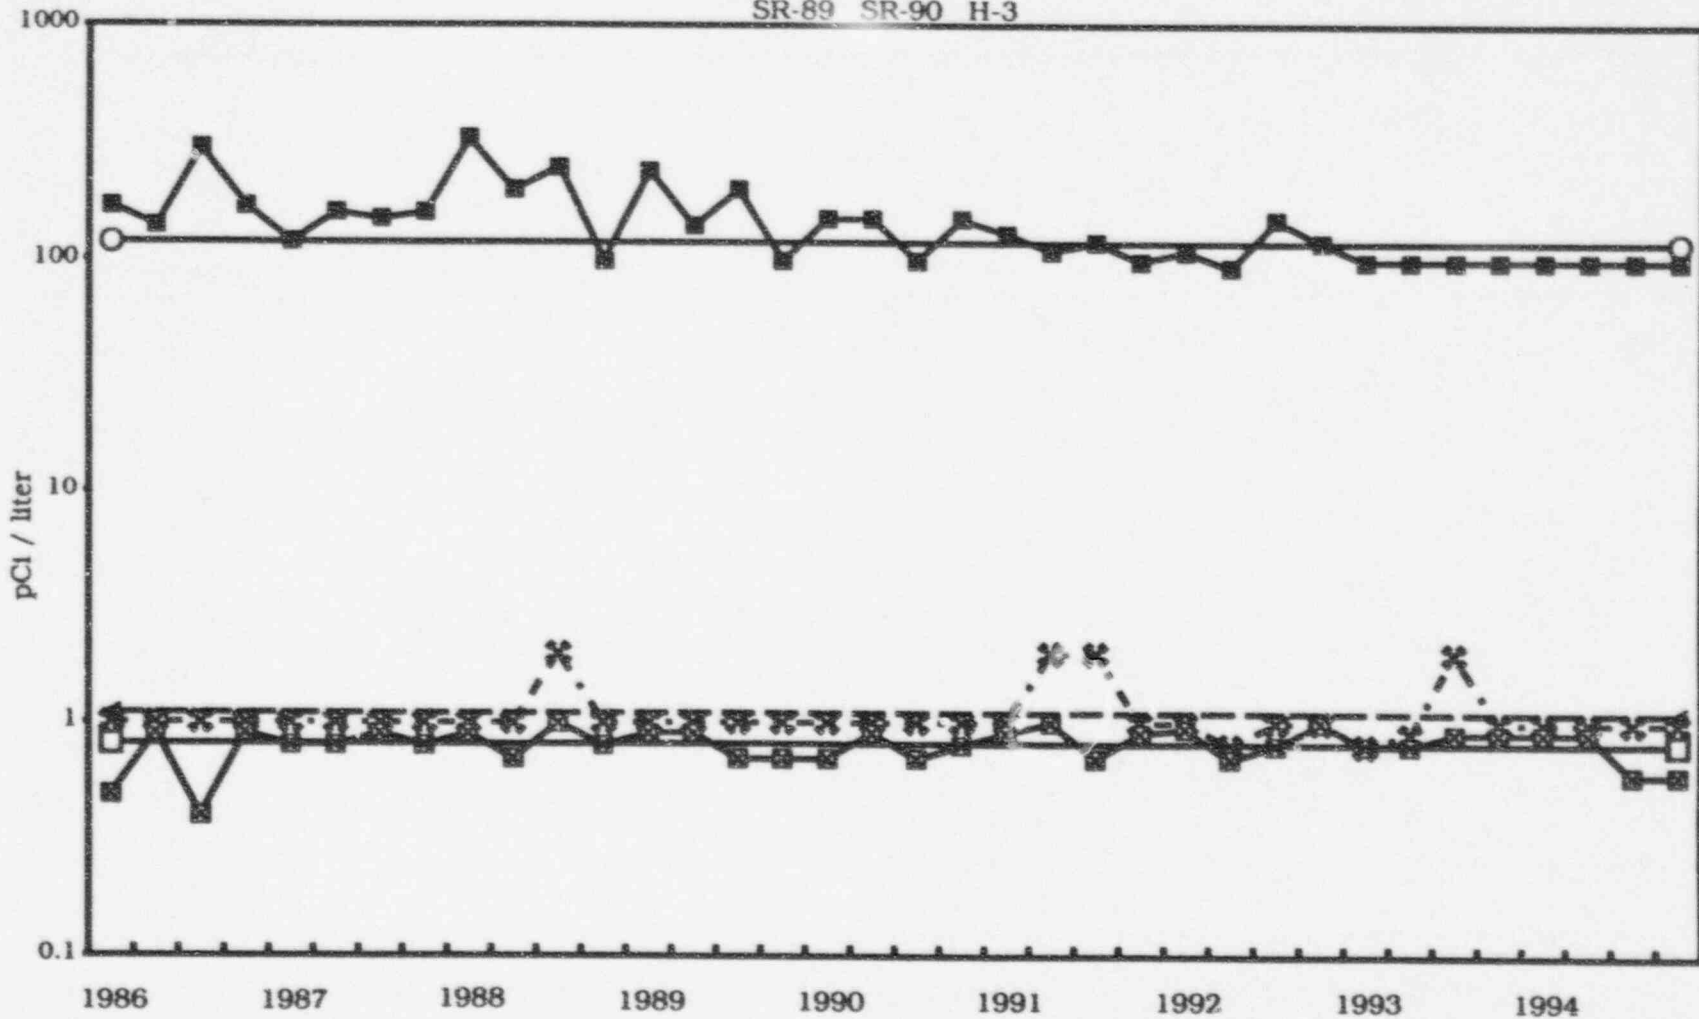


FIGURE I-2  
 RIVER WATER  
 QUARTERLY AVERAGE - ALL LOCATIONS  
 SR-89 SR-90 H-3

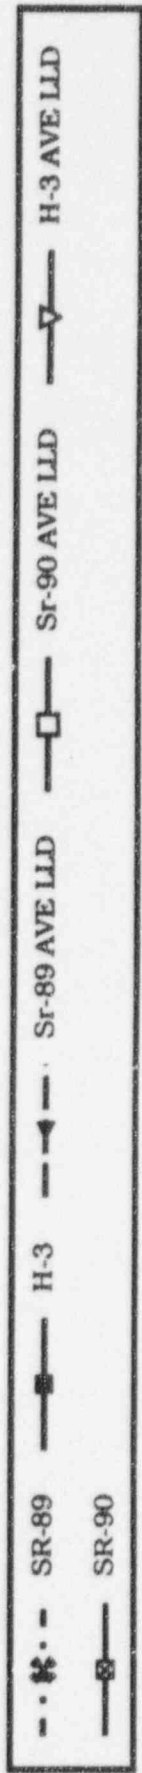
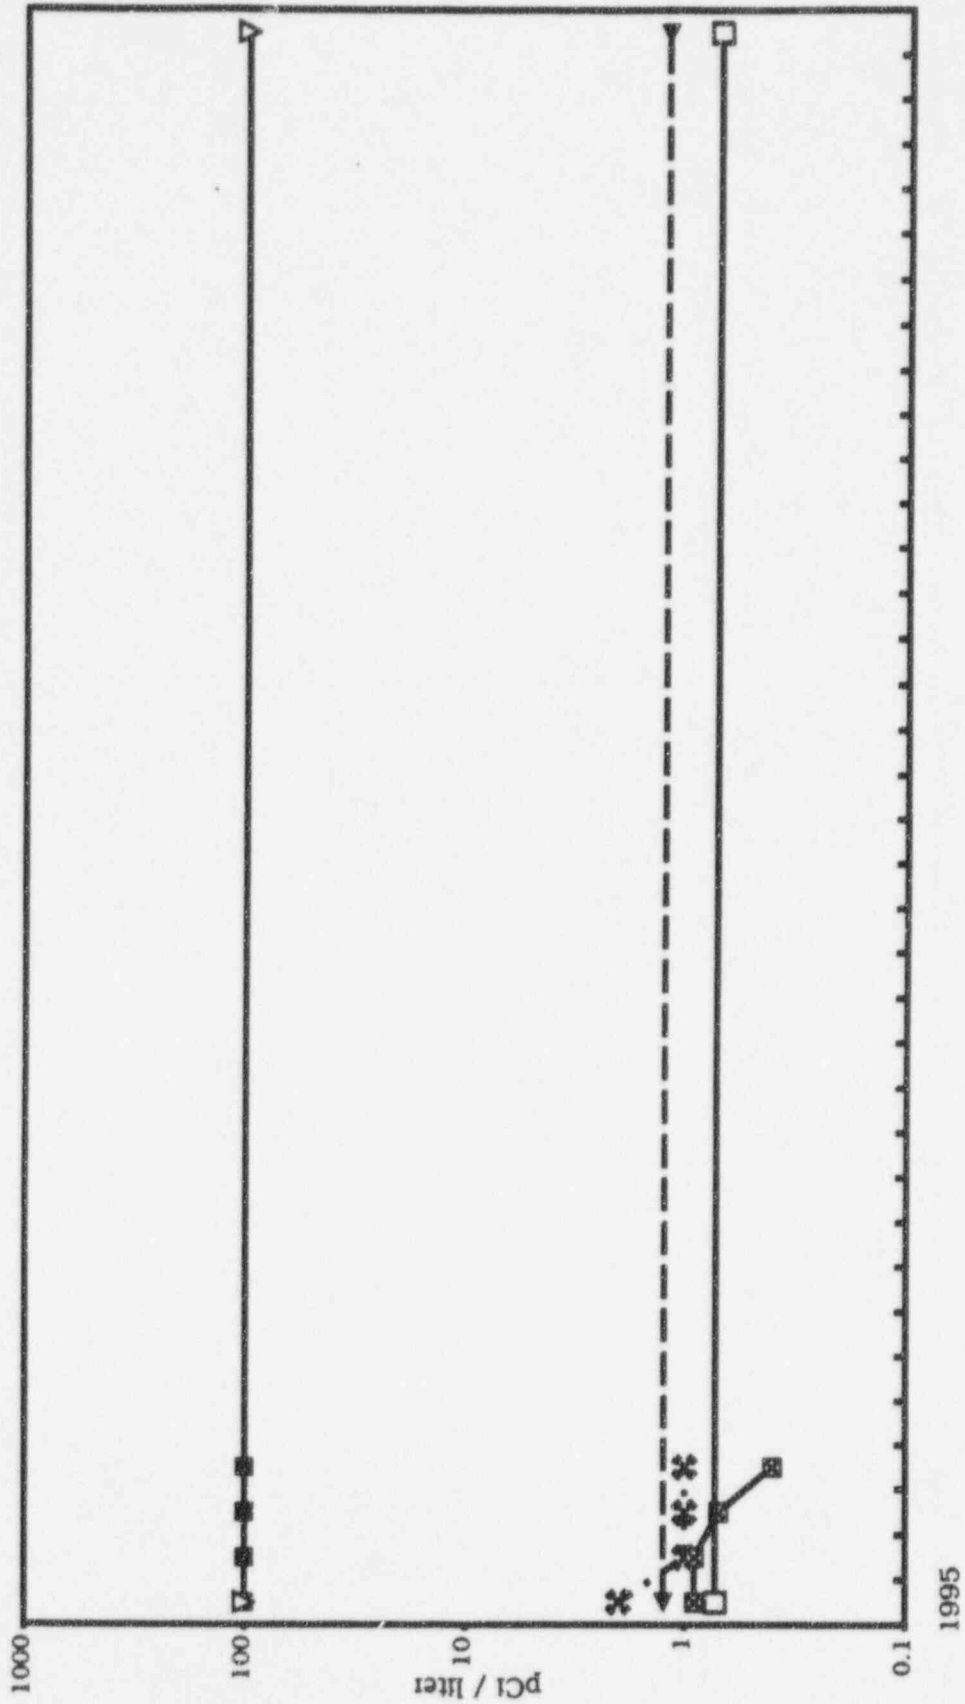


TABLE I-1  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - RIVER  
 PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER		FIRST QUARTER 01/03-03/07	SECOND QUARTER 04/04-06/13	THIRD QUARTER 07/05-09/06	FOURTH QUARTER 10/03-12/05
GROSS ALPHA (dissolved)	12, 28	Meanstd.dev. det./total range	3.2 ± 1.0 E 00 3/6 --	4.3 ± 1.2 E 00 3/6 (3.1-5.4)E 00	L.T. 4. E 00 0/6 --	4.5 ± 2.3 E 00 2/6 (2.9-6.1)E 00
GROSS ALPHA (suspended)	12, 28	Meanstd.dev. det./total range	2.5 ± 2.4 E 00 5/6 (0.65-6.5) E 00	3.2 ± 0.6 E 00 6/6 (2.3-3.8)E 00	1.3 ± 0.7 E 00 2/6 0.76-1.8)E 00	1.1 ± 0.2 E 00 5/6 (0.74-1.3)E 00
GROSS BETA (dissolved)	12, 28	Meanstd.dev. det./total range	9.3 ± 0.2 E 00 6/6 (9.1-9.7)E 00	1.2 ± 0.2 E 01 6/6 (1.0-1.4)E 01	1.2 ± 0.09E 01 6/6 (1.1-1.4)E 01	8.8 ± 1.0 E 00 6/6 (7.6-10)E 00
GROSS BETA (suspended)	12, 28	Meanstd.dev. det./total range	3.6 ± 2.0 E 00 6/6 (1.6-6.3)E 00	1.1 ± 0.2 E 01 6/6 (8.9-15)E 00	5.9 ± 3.5 E 00 4/6 (3.4-11)E 00	2.7 ± 0.4 E 00 6/6 (2.1-3.2)E 00
Sr-89	12, 28	Meanstd.dev. det./total range	L.T. 2. E 00 0/6 --	L.T. 1. E 00 0/6 --	L.T. 1. E 00 0/6 --	L.T. 1. E 00 0/6 --
Sr-90	12, 28	Meanstd.dev. det./total range	L.T. 9 E-01 0/6 --	L.T. 9 E-01 0/6 --	L.T. 7. E-01 0/6 --	L.T. 4. E-01 0/6 --
H-3 (a)	12, 28	Meanstd.dev. det./total range	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --	L.T. 1. E 02 0/2 --
I-131 (by gamma spectroscopy)	12, 28	Meanstd.dev. det./total range	L.T. 6. E 00 0/6 --	L.T. 9. E 00 0/6 --	L.T. 8. E 00 0/6 --	L.T. 5. E 00 0/6 --
Cs-137	12, 28	Meanstd.dev. det./total range	L.T. 5. E 00 0/6 --	L.T. 5. E 00 0/6 --	L.T. 4. E 00 0/6 --	L.T. 4. E 00 0/6 --

(a) Tritium analysis is performed on the quarterly composite of each station only.

**TABLE I-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - RIVER  
 PCI/LITER

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/03-03/07	SECOND QUARTER 04/04-06/13	THIRD QUARTER 07/05-09/06	FOURTH QUARTER 10/03-12/05
BE-7	12, 28	L.T. 4. E 01 (0/6)	L.T. 4. E 01 (0/6)	L.T. 3. E 01 (0/6)	L.T. 3. E 01 (0/6)
K-40	12, 28	6.67±2.58 E 01 (6/6)	6.83±1.17 E 01 (6/6)	L.T. 1. E 02 (0/6)	L.T. 1. E 02 (0/6)
Mn-54	12, 28	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Co-58	12, 28	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Fe-59	12, 28	L.T. 8. E 00 (0/6)	L.T. 8. E 00 (0/6)	L.T. 8. E 00 (0/6)	L.T. 8. E 00 (0/6)
Co-60	12, 28	L.T. 4. E 00 (0/6)	L.T. 5. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Zn-65	12, 28	L.T. 9. E 00 (0/6)	L.T. 8. E 00 (0/6)	L.T. 9. E 00 (0/6)	L.T. 8. E 00 (0/6)
Zr-95	12, 28	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Ru-103	12, 28	L.T. 5. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Ru-106	12, 28	L.T. 4. E 01 (0/6)	L.T. 4. E 01 (0/6)	L.T. 4. E 01 (0/6)	L.T. 3. E 01 (0/6)
I-131	12, 28	L.T. 6. E 00 (0/6)	L.T. 9. E 00 (0/6)	L.T. 8. E 00 (0/6)	L.T. 5. E 00 (0/6)
Cs-134	12, 28	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Cs-137	12, 28	L.T. 5. E 00 (0/6)	L.T. 5. E 00 (0/6)	L.T. 4. E 00 (0/6)	L.T. 4. E 00 (0/6)
Ba-140	12, 28	L.T. 5. E 00 (0/6)	L.T. 6. E 00 (0/6)	L.T. 6. E 00 (0/6)	L.T. 5. E 00 (0/6)
Ce-141	12, 28	L.T. 7. E 00 (0/6)	L.T. 9. E 00 (0/6)	L.T. 8. E 00 (0/6)	L.T. 8. E 00 (0/6)
Ce-144	12, 28	L.T. 3. E 01 (0/6)	L.T. 4. E 01 (0/6)	L.T. 3. E 01 (0/6)	L.T. 3. E 01 (0/6)
Ra-226	12, 28	L.T. 9. E 01 (0/6)	L.T. 1. E 02 (0/6)	L.T. 1. E 02 (0/6)	L.T. 1. E 02 (0/6)
Th-228	12, 28	L.T. 8. E 00 (0/6)	L.T. 1. E 01 (0/6)	L.T. 8. E 00 (0/6)	L.T. 9. E 00 (0/6)

J. AMBIENT RADIATION - THERMOLUMINESCENT DOSIMETERS

(TLDs - See Tables J-1 AND J-2)

STATIONS 01-10, 20, 44, 56, 58, 59, 66, 67, 71, 79-91, 94


Ambient radiation was monitored at 32 locations within a 10 mile radius of CNS and collected quarterly. The quarterly averages for all stations of ambient net gamma radiation ranged from 14.0 milliRoentgen/quarter to 19.0 milliRoentgen/quarter. The highest exposure during each of the four quarters was at Station 66 (4.5 miles, 200 degrees) and averaged 18.9 mR/quarter. The lowest exposure was at Station 03 (2.5 miles, 338 degrees) averaging 13.9 milliRoentgen/quarter.

The radiation at station 44, (10.5 miles, 270 degrees) which is the control station, was an average of 18.0 mR/quarter. This was similar to other stations and to the average of all stations which was 16.6 mR/quarter.

The average total exposure for the year was 65.7 mR which is considerably below the 125 millirems per quarter specified in 10 CFR 20.105 for an unrestricted area. The relationship between milliRoentgen (mR) and millirems (mr) is approximately one for the exposure conditions encountered. No plant effect from CNS was indicated.

The gamma exposures monitored by thermoluminescent dosimeters from 1977 through 1995 are plotted on Figure J-1. The data from year to year is in good agreement and indicates no adverse changes in radiation exposure to the population near CNS.

FIGURE J-1  
AMBIENT RADIATION  
THERMOLUMINESCENT DOSIMETRY  
QUARTERLY AVERAGE - ALL LOCATIONS

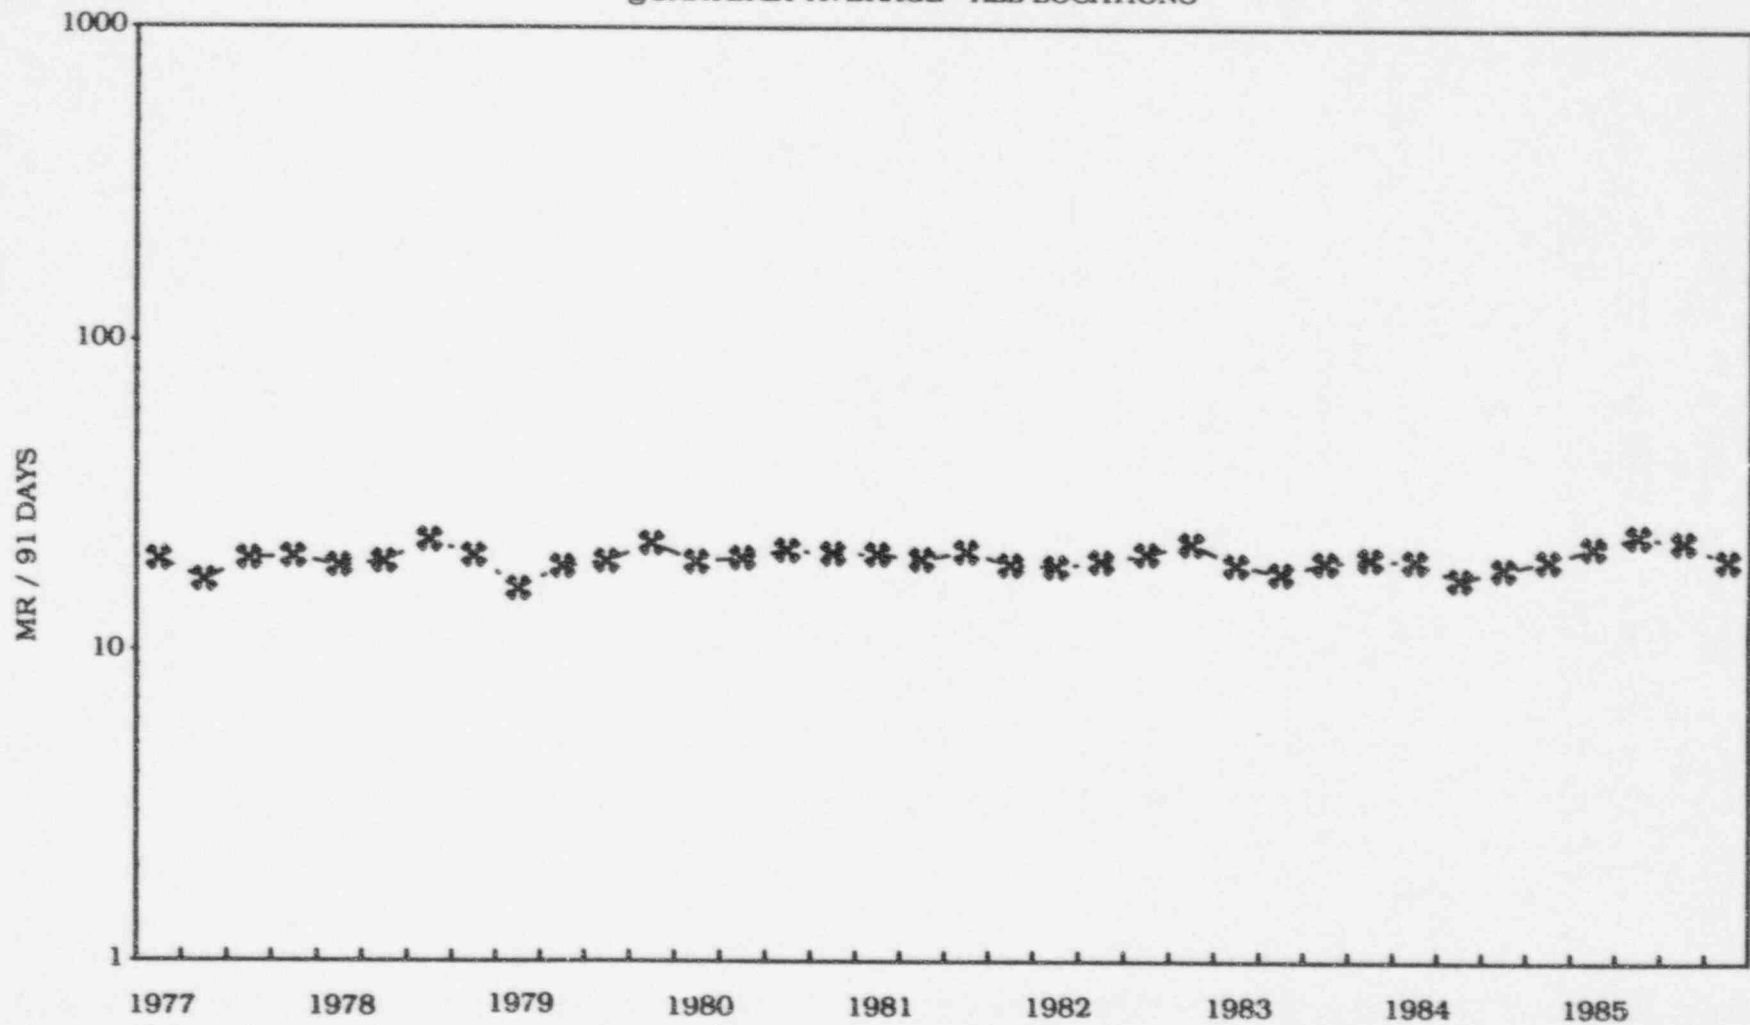

- \* - EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD



FIGURE J-1  
AMBIENT RADIATION  
THERMOLUMINESCENT DOSIMETRY  
QUARTERLY AVERAGE - ALL LOCATIONS


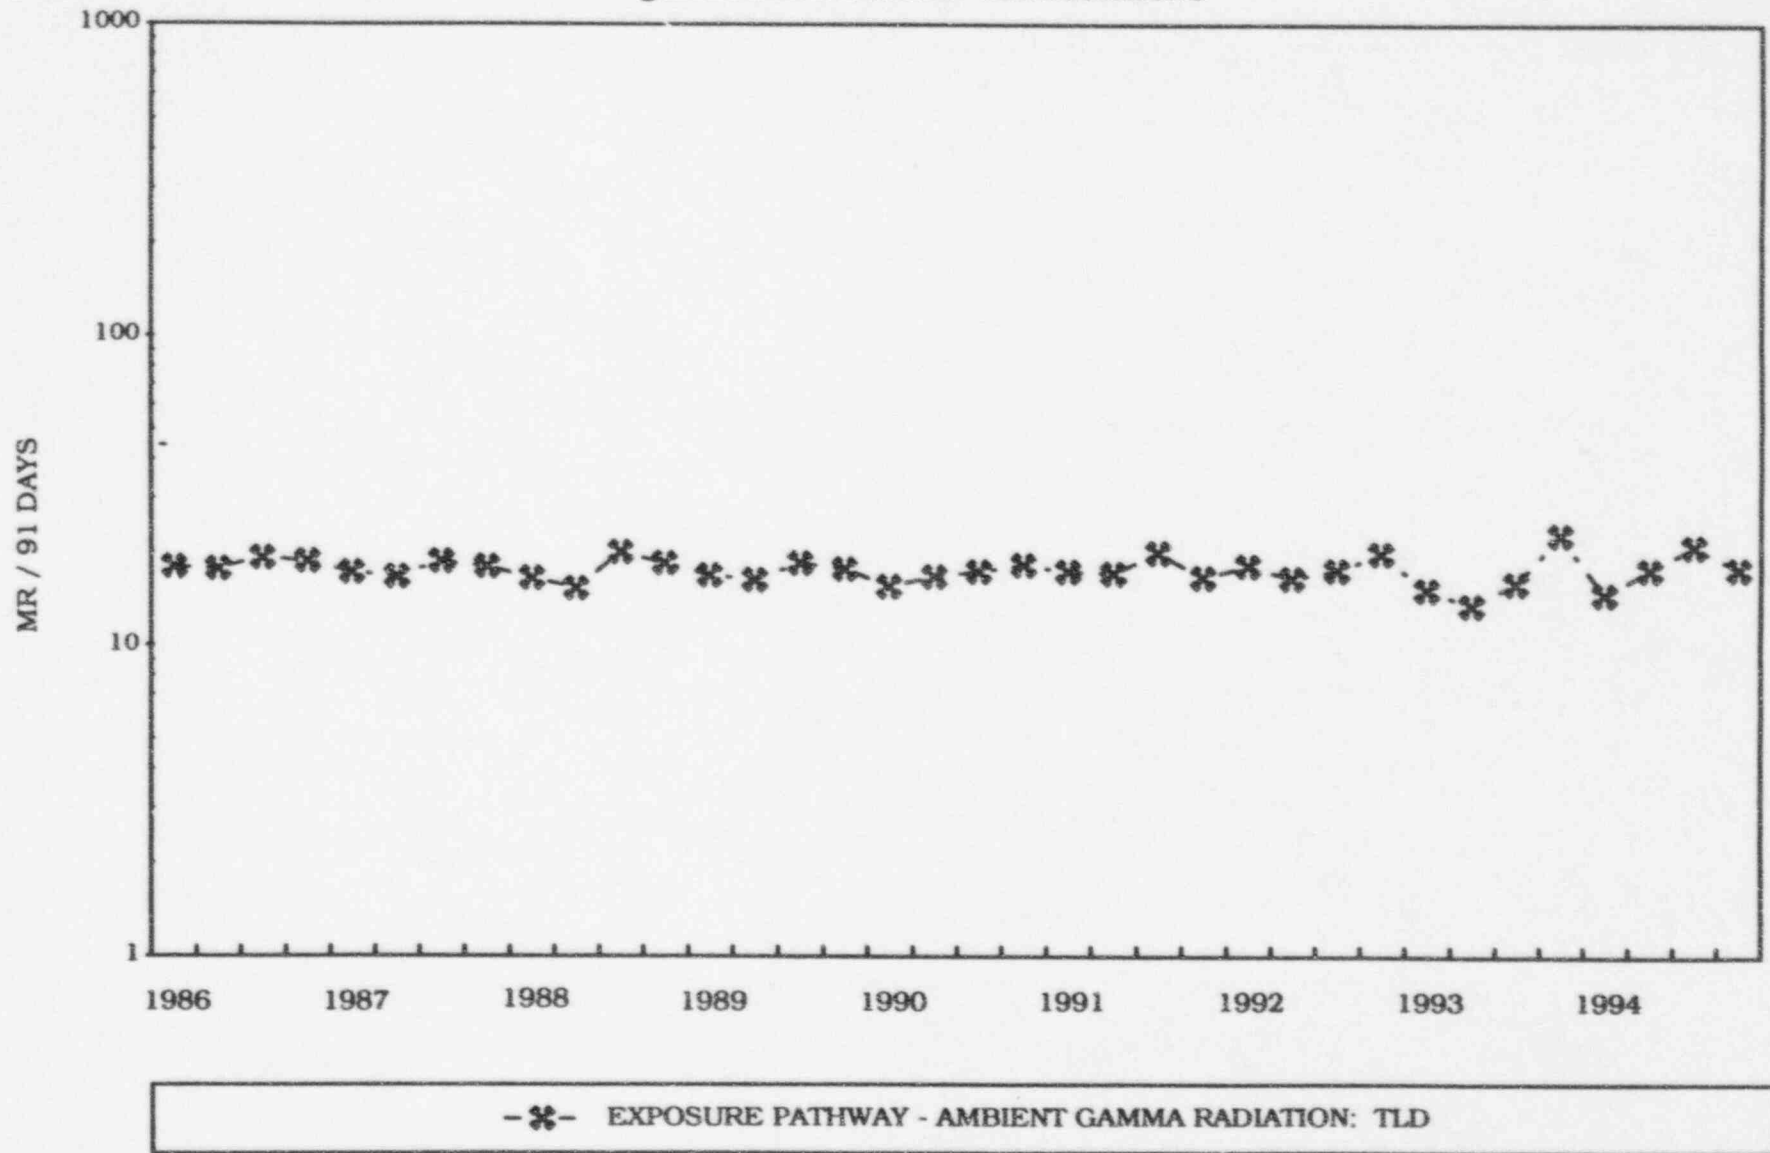


FIGURE J-1  
AMBIENT RADIATION  
THERMOLUMINESCENT DOSIMETRY  
QUARTERLY AVERAGE - ALL LOCATIONS

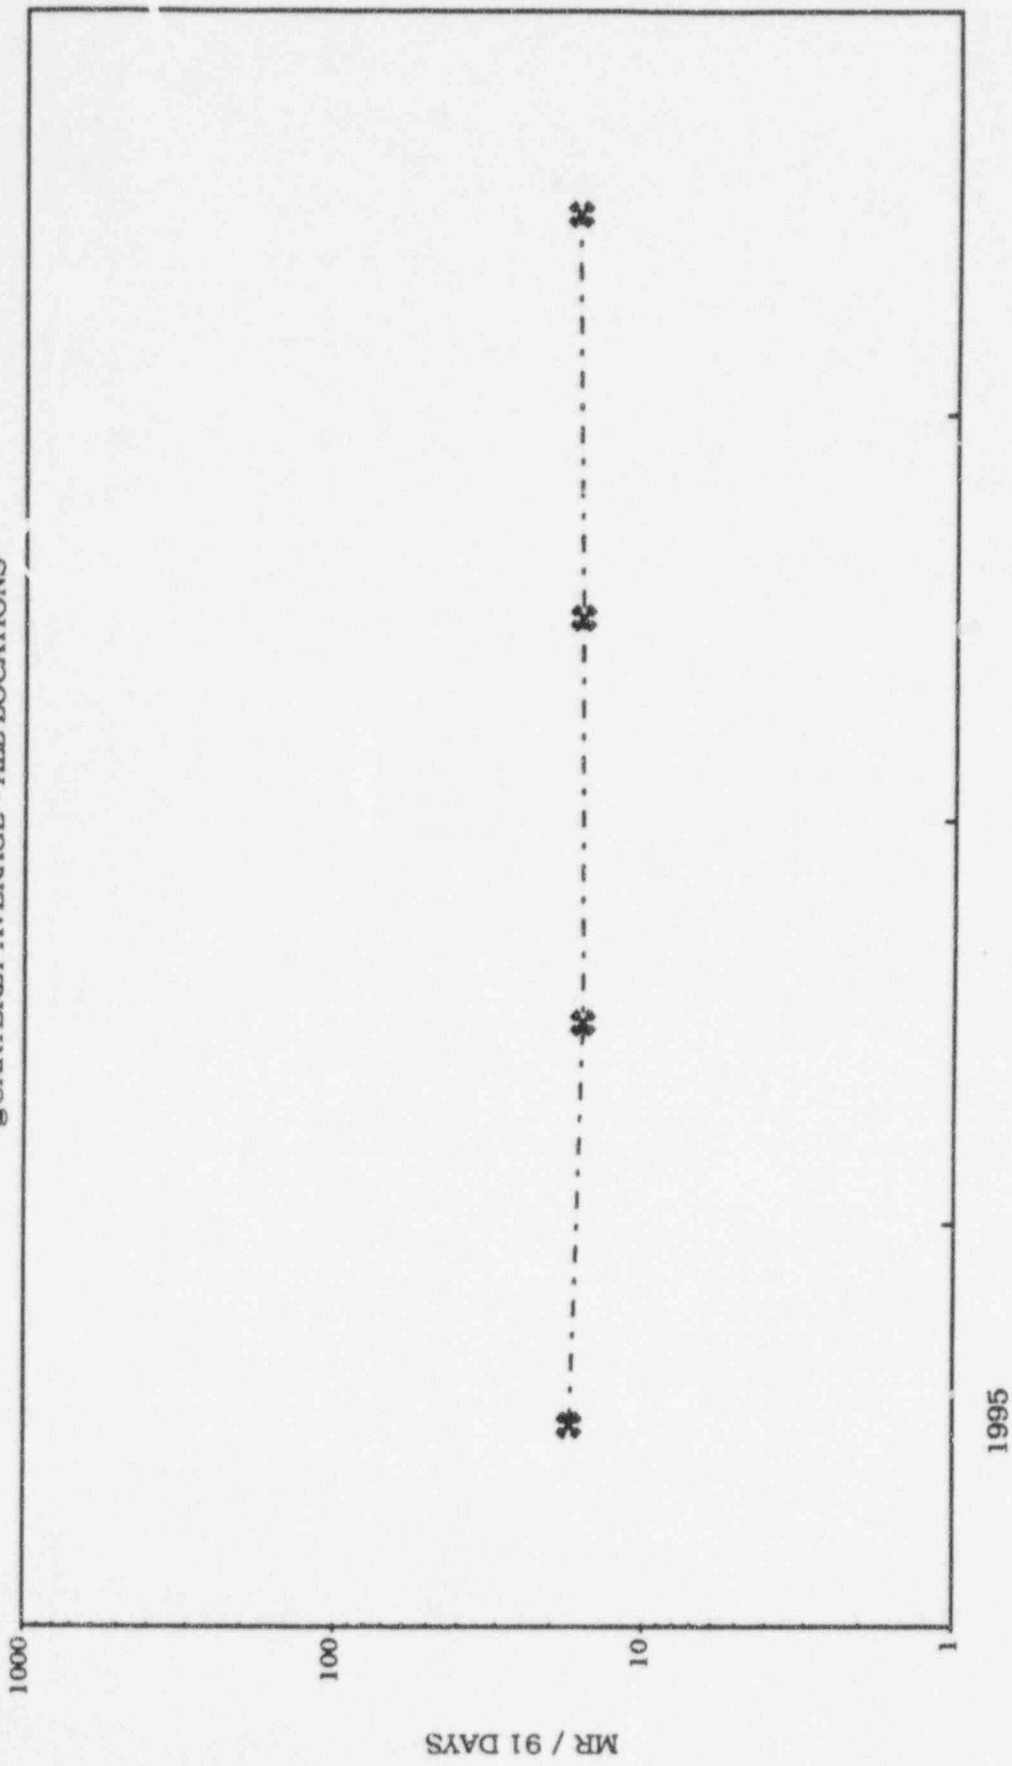

- \* - EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD

**TABLE J-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD  
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/05-04/12	SECOND QUARTER 04/12-07/11	THIRD QUARTER 07/11-10/06	FOURTH QUARTER 10/06-12/26
TLD (Gamma)	01	16.3 ± 1.1	15.5 ± 0.6	14.7 ± 1.0	16.8 ± 1.3
	02	16.4 ± 0.6	17.9 ± 0.9	14.3 ± 0.8	15.3 ± 1.0
	03	15.5 ± 0.5	12.2 ± 0.5	13.0 ± 0.6	14.7 ± 0.6
	04	15.9 ± 0.6	14.6 ± 0.8	13.7 ± 0.9	15.3 ± 1.1
	05	17.9 ± 1.3	17.7 ± 0.4	13.7 ± 0.6	15.2 ± 0.7
	06	16.7 ± 0.4	15.5 ± 0.6	14.0 ± 0.5	16.0 ± 0.9
	07	16.3 ± 1.4	14.2 ± 0.5	13.9 ± 0.8	15.8 ± 1.0
	08	16.4 ± 1.1	15.7 ± 0.9	15.0 ± 1.1	16.2 ± 1.4
	09	16.1 ± 0.8	14.0 ± 0.7	13.8 ± 0.6	15.0 ± 0.8
	10	16.3 ± 0.8	14.7 ± 0.8	14.3 ± 1.0	15.9 ± 0.6
	20	17.5 ± 0.6	15.1 ± 0.4	15.5 ± 0.7	17.0 ± 0.9
	44	19.5 ± 1.0	16.6 ± 0.6	17.8 ± 0.9	18.2 ± 0.5
	56	15.6 ± 0.5	15.1 ± 0.4	15.7 ± 0.9	17.0 ± 1.1
	58	17.2 ± 0.7	15.7 ± 0.7	16.5 ± 1.0	16.8 ± 0.9
	59	17.5 ± 0.5	17.4 ± 0.9	17.4 ± 1.0	16.8 ± 1.5
	66	19.5 ± 0.6	*	18.4 ± 0.8	18.9 ± 1.1
	67	20.9 ± 0.9	17.0 ± 0.6	17.8 ± 0.9	17.4 ± 0.9
	71	17.6 ± 0.8	15.6 ± 0.8	16.9 ± 0.8	17.7 ± 1.1

\*TLD missing

**TABLE J-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD  
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/05-04/12	SECOND QUARTER 04/12-07/11	THIRD QUARTER 07/11-10/06	FOURTH QUARTER 10/06-12/26
	79	18.9 ± 0.8	15.0 ± 0.7	16.2 ± 0.8	17.7 ± 0.8
	80	17.8 ± 0.3	16.5 ± 0.6	16.6 ± 0.8	17.4 ± 1.2
	81	18.0 ± 0.7	15.6 ± 0.8	17.0 ± 0.8	17.3 ± 1.0
	82	17.1 ± 1.0	15.7 ± 1.0	18.2 ± 0.5	17.5 ± 1.0
	83	17.9 ± 1.0	16.4 ± 1.1	17.7 ± 0.9	17.4 ± 0.5
	84	18.9 ± 1.1	17.2 ± 0.7	18.1 ± 1.2	18.3 ± 0.8
	85	17.0 ± 0.5	16.0 ± 0.5	15.9 ± 0.7	17.4 ± 0.9
	86	17.9 ± 0.6	18.7 ± 0.9	18.3 ± 0.5	17.1 ± 0.8
	87	18.3 ± 0.9	15.3 ± 0.8	17.0 ± 1.2	17.2 ± 1.3
	88	16.6 ± 0.5	15.7 ± 0.5	15.5 ± 0.4	16.1 ± 0.4
	89	18.1 ± 0.5	18.8 ± 0.7	17.2 ± 0.9	18.2 ± 0.9
	90	18.4 ± 0.7	14.7 ± 0.5	18.4 ± 0.5	17.5 ± 1.0
	91	16.7 ± 0.8	14.9 ± 0.7	15.1 ± 0.7	16.3 ± 1.1
	94	18.4 ± 1.0	16.5 ± 0.9	17.1 ± 1.1	17.0 ± 1.1
Average/Quarter		97 days	90.5 days	90.6 days	79.86 days
Average/Day		17.4 ± 1.2 mR/97 days	15.9 ± 1.4 mR/90.5 days	16.1 ± 1.7 mR/90.6 days	16.8 ± 1.0 mR/79.86 days
Range		0.18 ± 0.01 mR/day	0.18 ± 0.02 mR/day	0.17 ± 0.02	0.21 ± 0.01
Det./Total		(16-21)mR/97 days	(12-19)mR/90.5 days	(13-18)mR/90.6 days	(15-19) mR/79.86 days
		32/32	31/31	32/32	(32/32)

**TABLE J-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD  
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	Aver./Quarter	TOTAL mR/year 01/05/95-12/26/95
TLD (Gamma)	01	15.8 ± 0.9	63.3
	02	16.0 ± 1.5	63.9
	03	13.9 ± 1.5	55.4
	04	14.9 ± 1.0	59.5
	05	16.1 ± 2.0	64.5
	06	15.6 ± 1.1	62.2
	07	15.1 ± 1.2	60.2
	08	15.8 ± 0.6	63.3
	09	14.7 ± 1.1	58.9
	10	15.3 ± 1.0	61.2
	20	16.3 ± 1.2	65.1
	44	18.0 ± 1.2	72.1
	56	15.9 ± 0.8	63.4
	58	16.6 ± 0.6	66.2
	59	17.3 ± 0.3	69.1
	66	18.9 ± 0.6	56.8
	67	18.3 ± 1.8	73.1
	71	17.0 ± 1.0	67.8

**TABLE J-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD  
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	Aver./Quarter	TOTAL mR/year 01/05/95-12/26/95
TLD (Gamma)	79	17.0 ± 1.7	67.8
	80	17.1 ± 0.6	68.3
	81	17.0 ± 1.0	67.9
	82	17.1 ± 1.1	68.5
	83	17.4 ± 0.7	69.4
	84	18.1 ± 0.7	72.5
	85	16.6 ± 0.7	66.3
	86	18.0 ± 0.7	72.0
	87	17.0 ± 1.2	67.8
	88	16.0 ± 0.5	63.9
	89	18.1 ± 0.7	72.3
	90	17.3 ± 1.8	69.0
	91	15.8 ± 0.9	63.0
	94	17.3 ± 0.8	69.0
		16.6 ± 0.4 Average mR/Quarter	65.7 ± 4.7
		Range(14-19)	Aver. total mR year. All stations Range (55.4-73.1)

K. VEGETATION, BROADLEAF (See Tables K-1 and K-2)

STATIONS 28, 35, 44

Broadleaf vegetation was collected each month from June through October. Three samples were collected each month from each station plus a quality control sample. The samples were tested for I-131 by chemical separation and for gamma emitting isotopes by high resolution spectrometry.

The naturally occurring isotopes Be-7, K-40, and Th-228 were detected in the samples at normal environmental levels. No I-131 was detected in any of the 60 samples. Cesium-137 was detected in one sample at an average of 0.027 pCi/gm, wet. Cesium -137 is detected in other areas of the United States and is attributed to fallout from previous atomic weapons testing. The amounts detected are not considered to be significant.

See Figure K-1 for the levels of activities in food samples as represented in broadleaf vegetation in 1995.

FIGURE K-1  
 FOOD - BROADLEAF VEGETATION  
 QUARTERLY AVERAGE - ALL STATIONS  
 K-40 I-131 CS-137

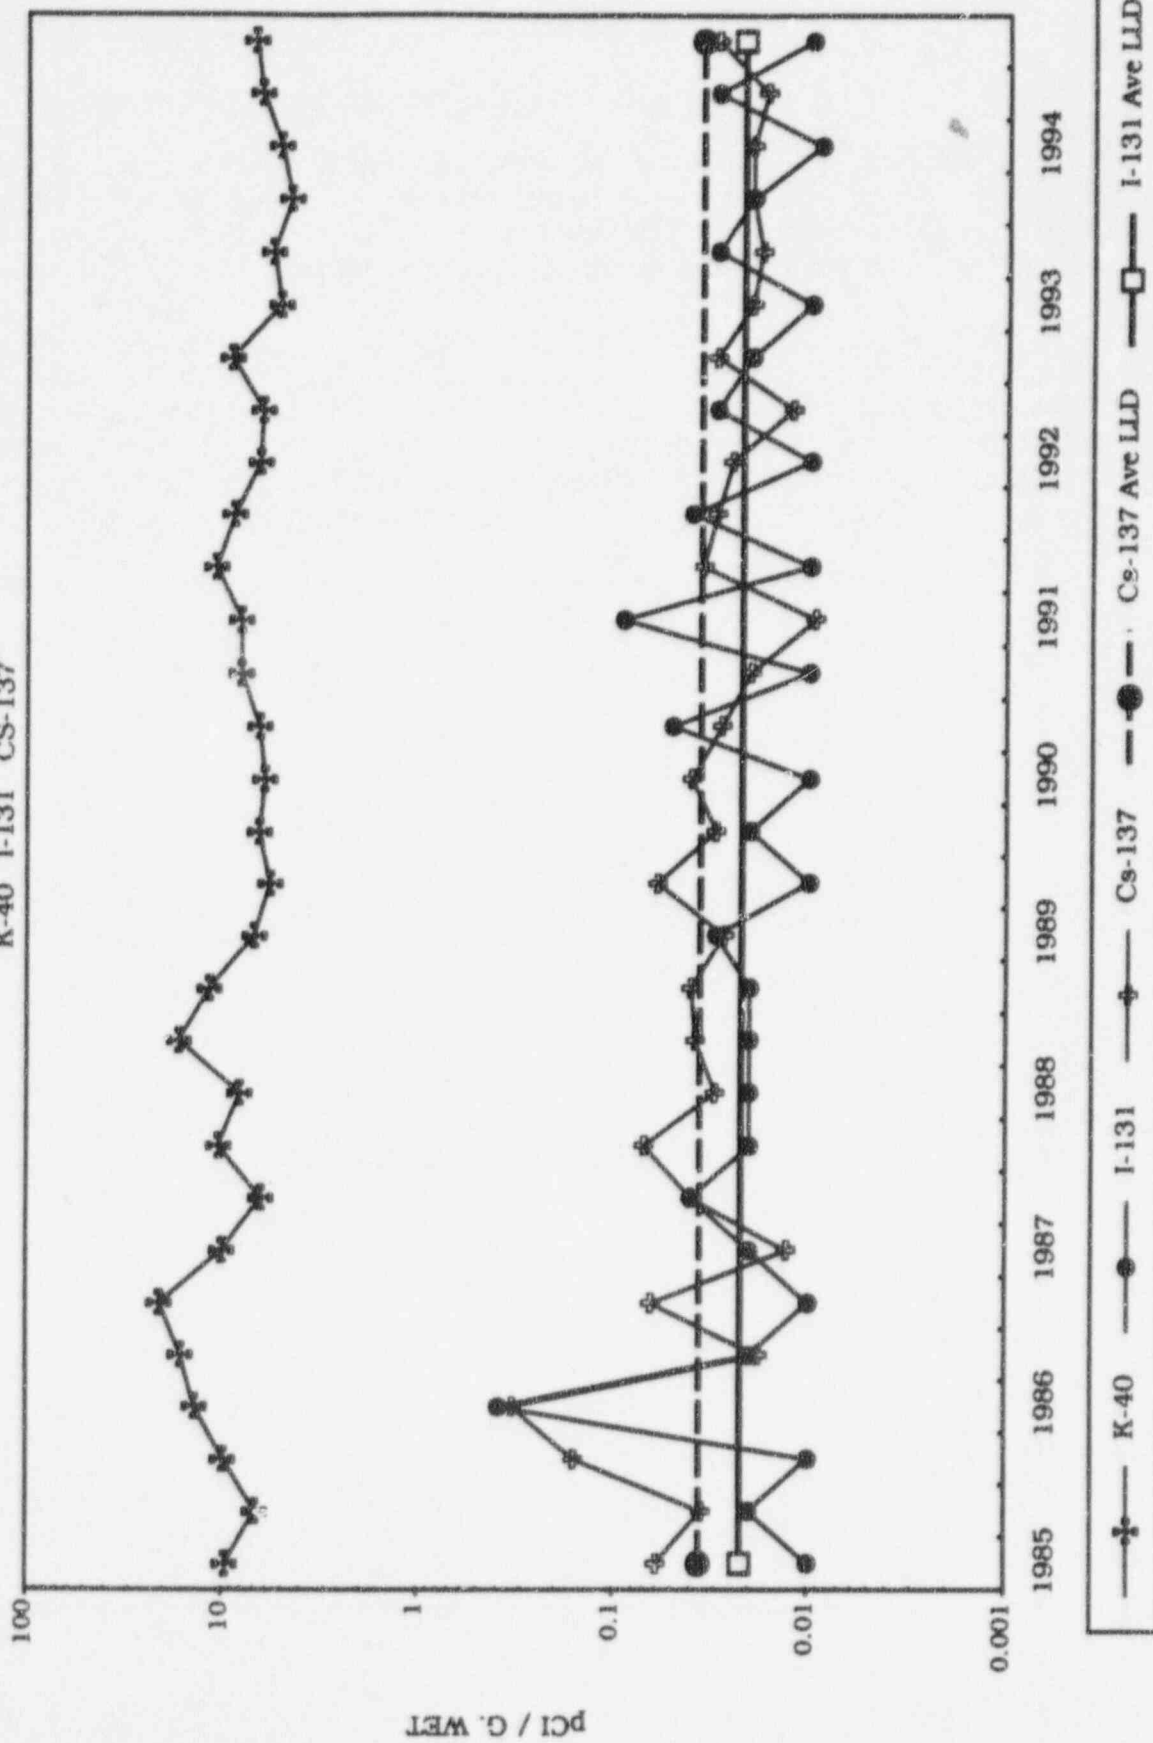
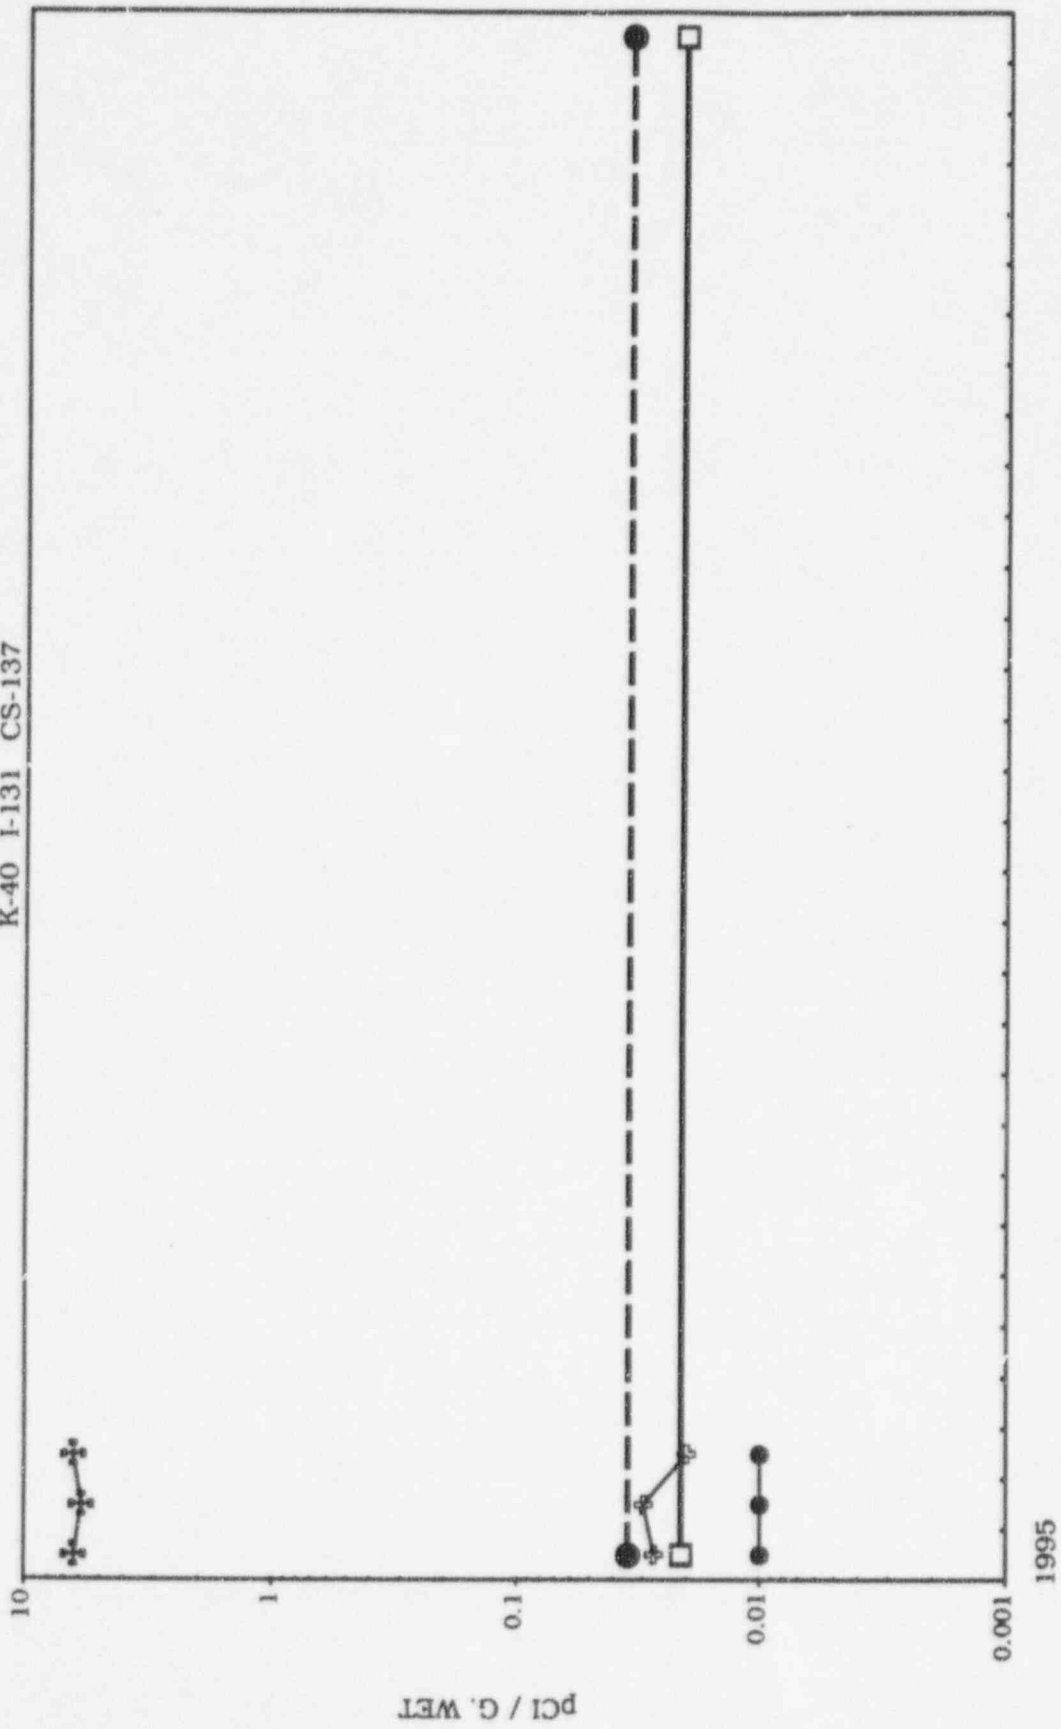




FIGURE K-1  
 FOOD - BROADLEAF VEGETATION  
 QUARTERLY AVERAGE - ALL STATIONS  
 K-40 I-131 CS-137



**TABLE K-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 BROADLEAF TERRESTRIAL VEGETATION  
 PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER		SECOND QUARTER		THIRD QUARTER		FOURTH QUARTER	
			05/16,	06/28	07/18,08/15,09/19	10/10		
I-131 (by chemical separation)	35,96, 101	Meanistd.dev. det./total range	L. T. 1. E-02 0/20 --		L. T. 1. E-02 0/30 --		L. T. 1. E-02 0/10 --	
Be-7	35,96, 101	Meanistd.dev. det./total range	2.1 ± 0.9 E 00 20/20 (0.71-4.3)E 00		1.78±0.8 E 00 30/30 (0.35-3.44)E 00		2.33±1.32E 00 10/10 ((0.59-4.20)E 00)	
K-40	35,96, 101	Meanistd.dev. det./total range	6.3 ± 2.2 E 00 20/20 (3.69-11.6)E 00		5.86± 2.0E 00 30/30 (2.8-9.9)E 00		6.32±2.26E 00 10/10 (2.65-9.69)E 00	
Co-60	35,96, 101	Meanistd.dev. det./total range	L. T. 4. E-02 0/20 --		L. T. 2. E-02 0/30 --		L. T. 2. E-02 0/10 --	
Ru-103	35,96, 101	Meanistd.dev. det./total range	L. T. 4. E-02 0/20 --		L. T. 3. E-02 0/30 --		L. T. 2. E-02 0/10 --	
I-131 (by gamma spectroscopy)	35,96, 101	Meanistd.dev. det./total range	L. T. 8. E-02 0/20 --		L. T. 5. E-02 0/30 --		L. T. 3. E-02 0/10 --	
Cs-134	35,96, 101	Meanistd.dev. det./total range	L. T. 5. E-02 0/20 --		L. T. 3. E-02 0/30 --		L. T. 2. E-02 0/10 --	

**TABLE K-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 BROADLEAF TERRESTRIAL VEGETATION  
 PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER		SECOND QUARTER	THIRD QUARTER	FOURTH QUARTER
			05/16, 06/28	07/18, 08/15, 09/19	10/10
Cs-137	35,96, 101	Mean±std.dev. det./total range	2.72±0.74 E-02 1/20 --	L. T. 3. E-02 0/30 --	L. T. 2. E-02 0/10 --
Ba-140	35,96,101	Mean±std.dev. det./total range	L. T. 7. E-02 0/20 --	L. T. 3. E-02 0/30 --	L. T. 3. E-02 0/10 --
Ra-226	35,96,101	Mean±std.dev. det./total range	L.T. 8. E-01 0/20 --	L.T. 5. E-01 0/30 --	L.T. 4. E-01 0/10 --
Th-228	35,96,101	Mean±std.dev. det./total range	9.02±4.56 E-02 7/20 (0.29-1.74)E-01	1.94±0.19E-01 1/30 --	L.T. 4. E-02 0/10 --

**TABLE K-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 BROADLEAF TERRESTRIAL VEGETATION - PCI/GM, WET

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER	SECOND QUARTER 05/16, 06/28	THIRD QUARTER 07/18, 08/15, 09/19	FOURTH QUARTER 10/10
BE-7	28, 35, 44		2.1 ± 0.9 E 00 (20/20)	1.78 ± 0.8 E 00 (30/30)	2.33 ± 1.32 E 00 (10/10)
K-40	28, 35, 44		6.3 ± 2.2 E 00 (20/20)	5.86 ± 1.95 E 00 (30/30)	6.32 ± 2.26 E 00 (10/10)
Mn-54	28, 35, 44		L.T. 4. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 2. E-02 (0/10)
Co-58	28, 35, 44		L.T. 4. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 2. E-02 (0/10)
Fe-59	28, 35, 44		L.T. 9. E-02 (0/20)	L.T. 5. E-02 (0/30)	L.T. 4. E-02 (0/10)
Co-60	28, 35, 44		L.T. 4. E-02 (0/20)	L.T. 2. E-02 (0/30)	L.T. 2. E-02 (0/10)
Zn-65	28, 35, 44		L.T. 9. E-02 (0/20)	L.T. 6. E-02 (0/30)	L.T. 5. E-02 (0/10)
Zr-95	28, 35, 44		L.T. 4. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 2. E-02 (0/10)
Ru-103	28, 35, 44		L.T. 4. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 2. E-02 (0/10)
Ru-106	28, 35, 44		L.T. 4. E-01 (0/20)	L.T. 2. E-01 (0/30)	L.T. 2. E-01 (0/10)
I-131	28, 35, 44		L.T. 8. E-02 (0/20)	L.T. 5. E-02 (0/30)	L.T. 3. E-02 (0/10)
Cs-134	28, 35, 44		L.T. 5. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 2. E-02 (0/10)
Cs-137	28, 35, 44		2.72 ± 0.74 E-02 (1/20)	L.T. 3. E-02 (0/30)	L.T. 2. E-02 (0/10)
Ba-140	28, 35, 44		L.T. 7. E-02 (0/20)	L.T. 3. E-02 (0/30)	L.T. 3. E-02 (0/10)
Ce-141	28, 35, 44		L.T. 6. E-02 (0/20)	L.T. 4. E-02 (0/30)	L.T. 4. E-02 (0/10)
Ce-144	28, 35, 44		L.T. 2. E-01 (0/20)	L.T. 2. E-01 (0/30)	L.T. 1. E-01 (0/10)
Ra-226	28, 35, 44		L.T. 8. E-01 (0/20)	L.T. 5. E-01 (0/30)	L.T. 4. E-01 (0/10)
Th-228	28, 35, 44		9.02 ± 4.56 E-02 (7/20)	1.94 ± 0.19 E-01 (1/30)	L.T. 4. E-02 (0/10)

## L SHORELINE SEDIMENT

### STATION 28

Shoreline sediment samples were collected in the spring and fall from Station 28, 1.8 miles, 150 degrees downstream of the release point of CNS. They were analyzed for gamma emitters by means of a high resolution gamma spectrometer. In the samples collected the naturally occurring isotopes Be-7, K-40, Ra-226 and Th-228 were detected at normal environmental levels. Cesium-137, a fission product, was detected at an average level of 0.082 pCi/gm, dry.

For the samples collected in the fourth quarter the naturally occurring isotopes K-40 and Ra-226 were detected at about the same level as in the second quarter. Thorium-228 had an average level of 0.99 pCi/gm dry for the fourth quarter. Beryllium-7 was detected at a level of 0.41 pCi/gm dry in the second quarter and was below the normal detection level in the fourth quarter. The average manganese-54, an activation product, was detected at a level of 0.011 pCi/gm dry. All other nuclides were below the detection limit for both the spring and fall.

Presented in Figure L-1 are the plots of the radionuclides K-40, I-131, Cs-134 and Cs-137 in shoreline sediment since 1985. No detections of I-131 nor Cs-134 were seen and K-40 was at a normal environmental level. The Cs-137 was at a low level which is found in many areas and media. Since sediment tends to trap and retain any elements in the water pathway, it acts as a good indicator of the effects on the water pathway of any reactor effluents.

FIGURE L-1  
 SHORELINE SEDIMENT  
 QUARTERLY AVERAGE - STATION 28  
 K-40 I-131 CS-134 CS-137

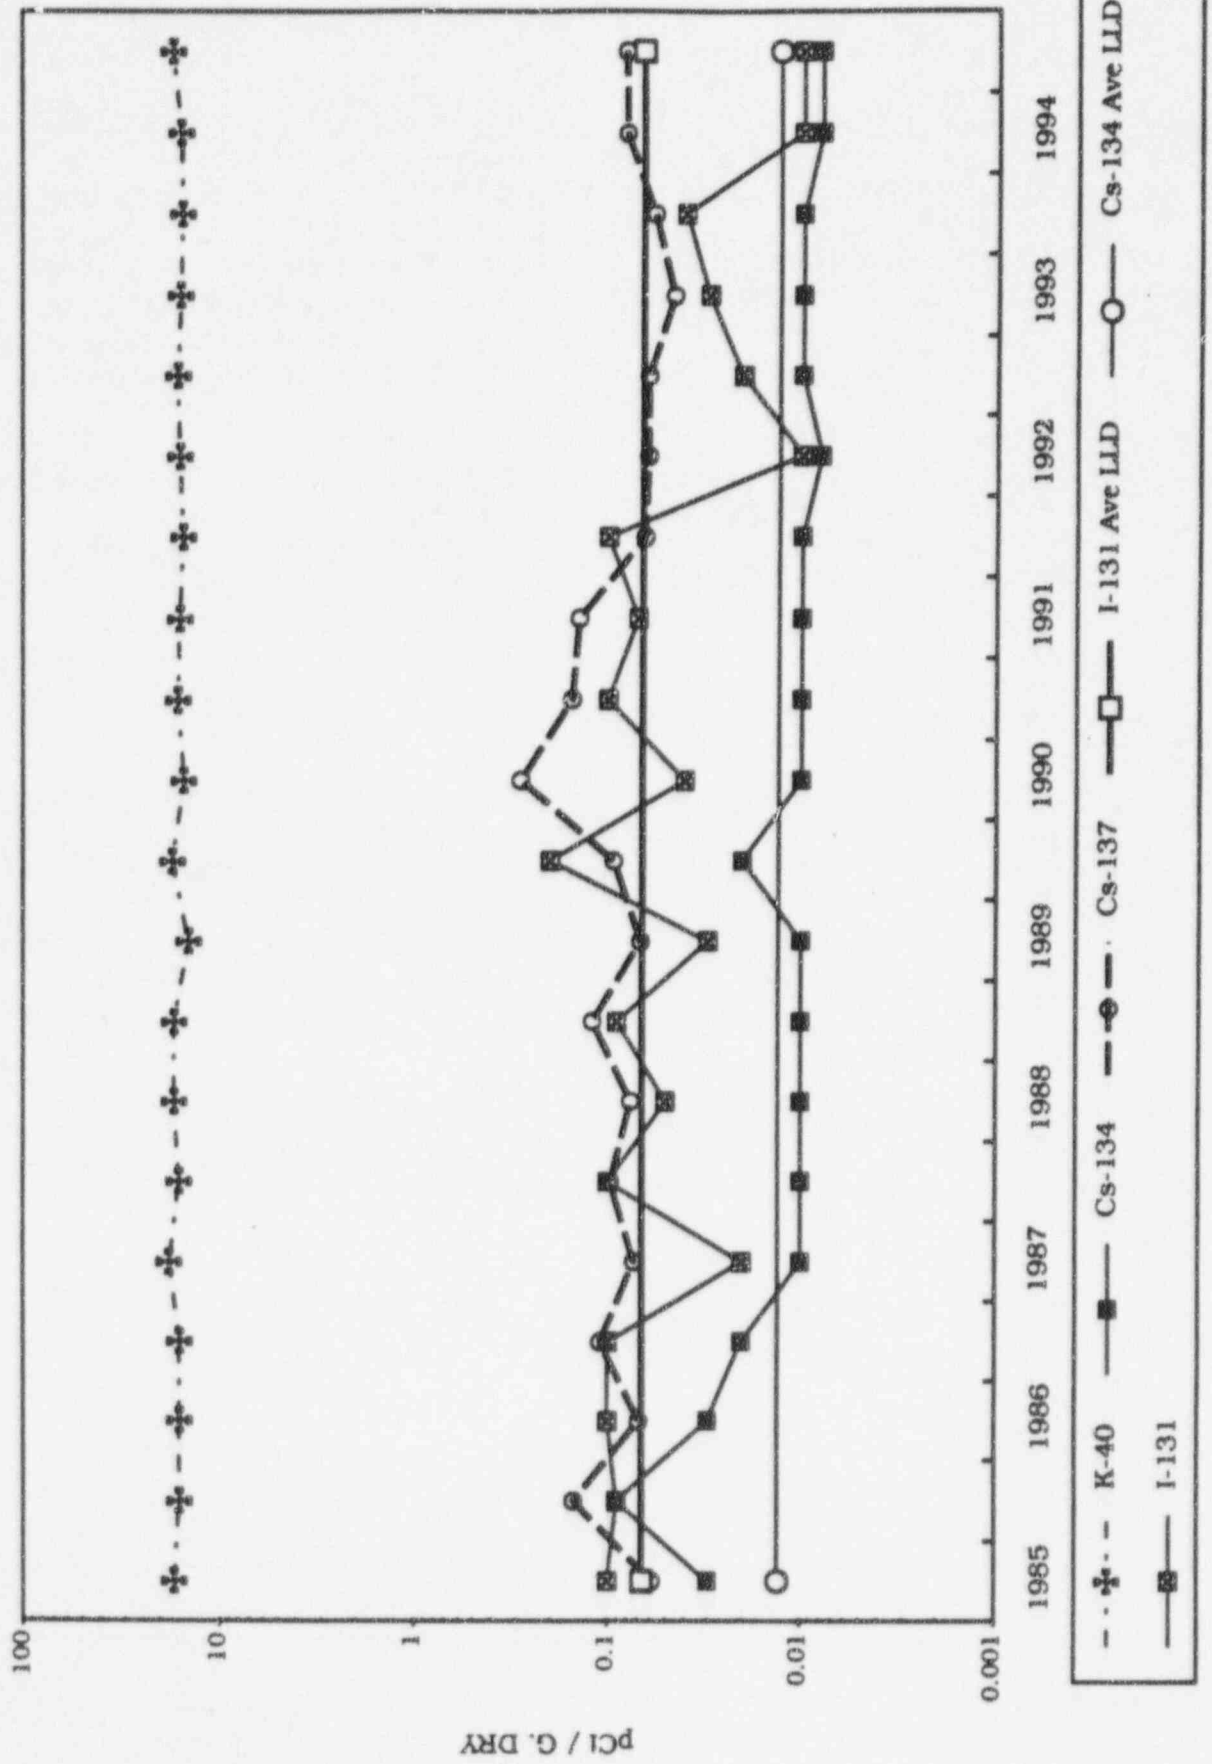
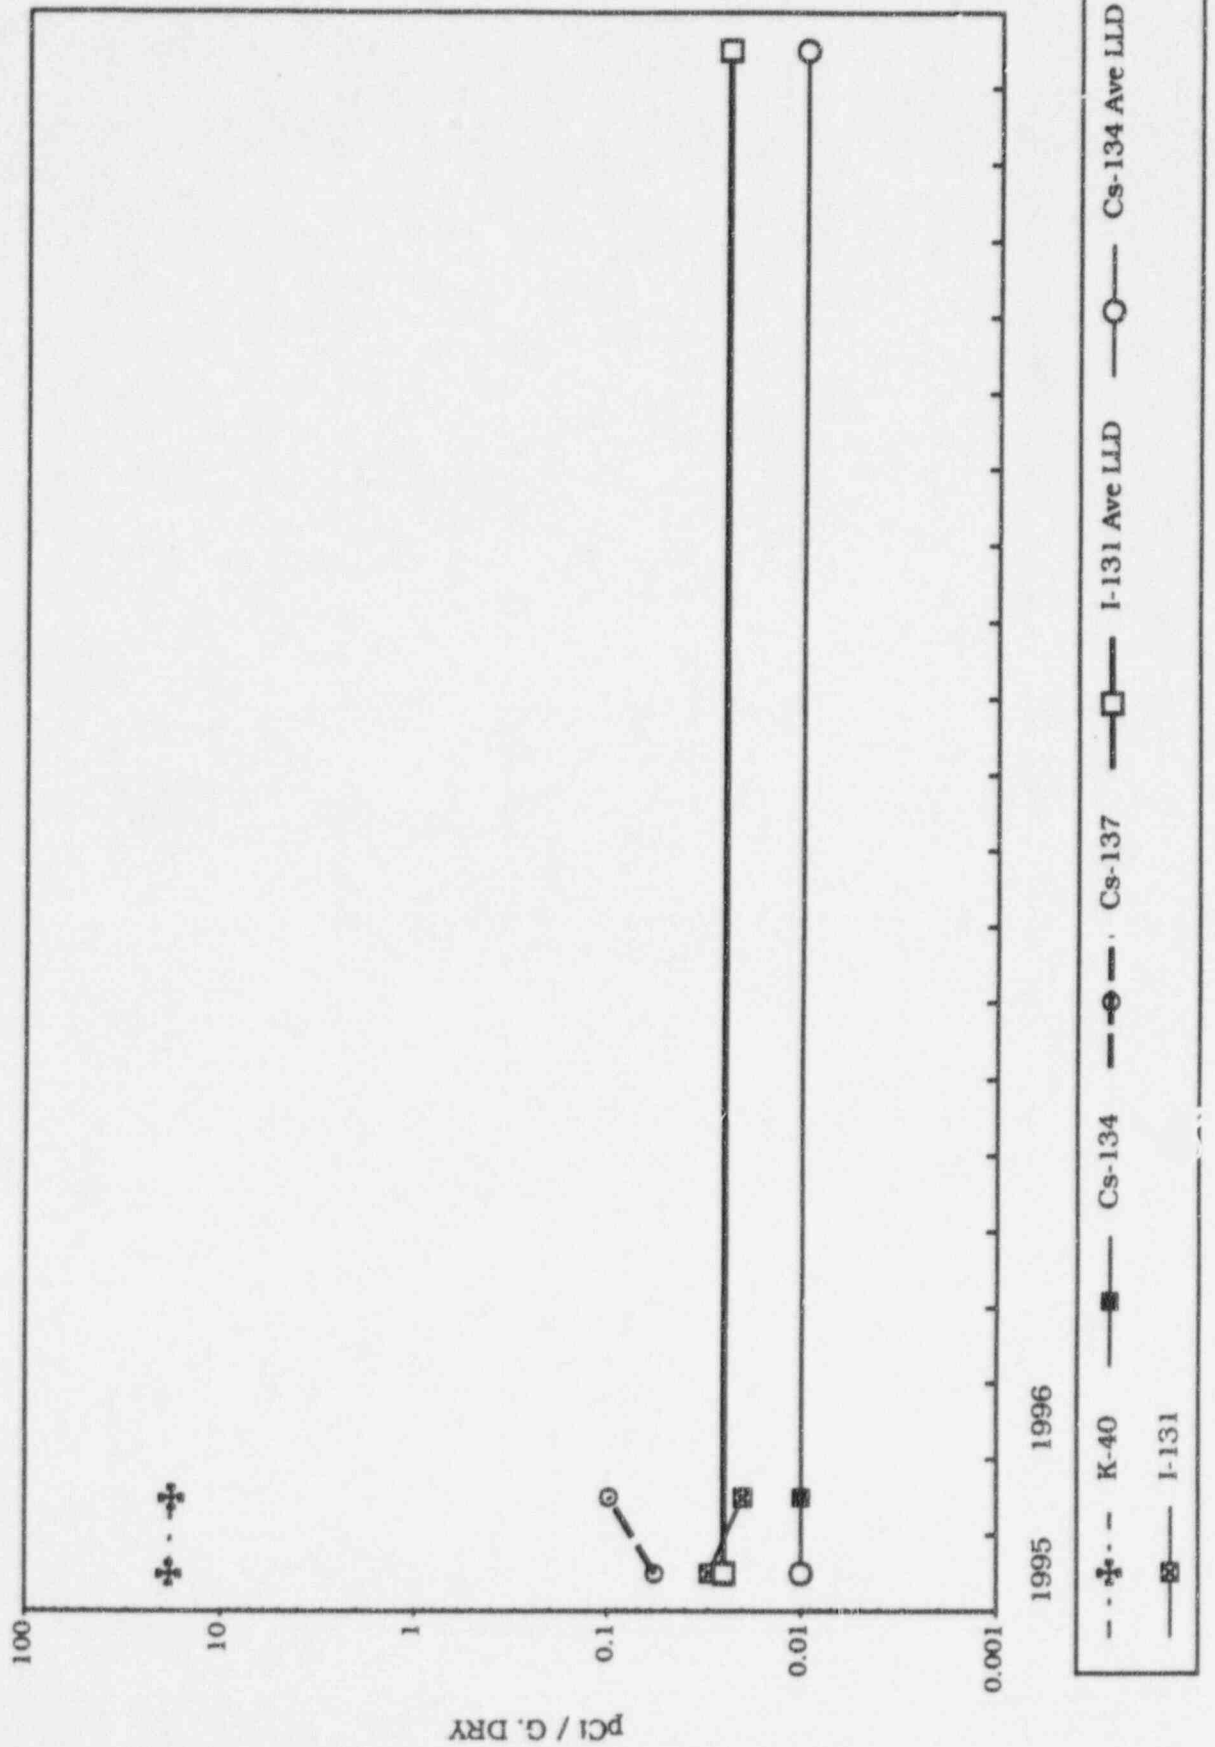


FIGURE L-1  
 SHORELINE SEDIMENT  
 QUARTERLY AVERAGE - STATION 28  
 K-40 I-131 CS-134 CS-137



**TABLE L-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AQUATIC  
 SHORELINE SEDIMENT - PCI/GM, DRY

SAMPLE NUCLIDE	STATION NUMBER		SECOND QUARTER 05/02	THIRD QUARTER	FOURTH QUARTER 10/31
Be-7	28	Mean±std.dev. det./total range	4.14 ± 0.63E-01 1/1 --		L.T. 8. E-02 0/2 --
K-40	28	Mean±std.dev. det./total range	1.83 ± 0.18E 01 1/1 --		1.78±0.07E 01 2/2 (1.77-1.78)E 01
Mn-54	28	Mean±std.dev. det./total range	9.58 ± 5.44E-03 1/1 --		1.18±0.198E-02 2/2 (1.04-1.32)E-02
CO-60	28	Mean±std.dev. det./total range	L.T. 9. E-03 0/1 --		L.T. 9. E-03 0/2 --
I-131 (by gamma spectroscopy)	28	Mean±std.dev. det./total range	L.T. 3. E-02 0/1 --		L.T. 2. E-02 0/2 --
Cs-134	28	Mean±std.dev. det./total range	L.T. 1. E-02 0/1 --		L.T. 1. E-02 0/2 --
Cs-137	28	Mean±std.dev. det./total range	5.73 ± 0.63E-02 1/1 --		9.87±0.127E-02 2/2 (9.78-9.96)E-02
Ra-226	28	Mean±std.dev. det./total range	1.80 ± 0.18E 00 1/1 --		1.94±0.14E 00 2/2 (1.84-2.04)E 00
Th-228	28	Mean±std.dev. det./total range	L.T. 3. E-02 0/1 --		9.91±0.127E-01 2/2 (0.98-1.0)E 00



**TABLE L-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AQUATIC  
 SHORELINE SEDIMENT - PCI/GM, DRY

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER	SECOND QUARTER 05/02	THIRD QUARTER	FOURTH QUARTER 10/31
BE-7	28		4.14±0.63 E-01 (1/1)		L.T. 8. E-02 (0/2)
K-40	28		1.83±0.18 E 01 (1/1)		1.78± 0.07E 01 (2/2)
Mn-54	28		9.58 ±5.44E-03 (1/1)		1.18±0.196E-02 (2/2)
Co-58	28		L.T. 9. E-03 (0/1)		L.T. 8. E-03 (0/2)
Fe-59	28		L.T. 2. E-02 (0/1)		L.T. 2. E-02 (0/2)
Co-60	28		L.T. 9. E-03 (0/1)		L.T. 9. E-03 (0/2)
Zn-65	28		L.T. 2. E-02 (0/1)		L.T. 2. E-02 (0/2)
Zr-95	28		L.T. 1. E-02 (0/1)		L.T. 1. E-02 (0/2)
Ru-103	28		L.T. 1. E-02 (0/1)		L.T. 9. E-03 (0/2)
Ru-106	28		L.T. 8. E-02 (0/1)		L.T. 8. E-02 (0/2)
I-131	28		L.T. 3. E-02 (0/1)		L.T. 2. E-02 (0/2)
Cs-134	28		L.T. 1. E-02 (0/1)		L.T. 1. E-02 (0/2)
Cs-137	28		5.73±0.63 E-02 (1/1)		9.87±0.127E-02 (2/2)
Ba-140	28		L.T. 3. E-02 (0/1)		L.T. 1. E-02 (0/2)
Ce-141	28		L.T. 2. E-02 (0/1)		L.T. 2. E-02 (0/2)
Ce-144	28		L.T. 6. E-02 (0/1)		L.T. 6. E-02 (0/2)
Ra-226	28		1.80±0.18 E 00 (1/1)		1.94± 0.14E 00 (2/2)
Th-228	28		L.T. 3. E-02 (0/1)		9.91±0.127E-01 (2/2)

**SECTION VII**  
**COMPLETE DATA TABLES**

**A, B, C,**

**GROSS ALPHA, GROSS BETA, I-131**

**STATIONS 01-10**

NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 01

STATION 01 - 0.1 MI. 225 DEG. IND.

COLL. TIME START STOP DATE DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
01/03 01/10	1.02E 04	CU. FT.	3.3 ± 0.3	E-02	2.2 ± 1.2	E-03	01/14	LT. 2.	E-02	
01/10 01/17	1.01E 04	CU. FT.	3.9 ± 0.4	E-02	2.0 ± 1.3	E-03	01/21	LT. 2.	E-02	
01/17 01/23	8.86E 03	CU. FT.	2.6 ± 0.4	E-02	3.5 ± 1.6	E-03	01/26	LT. 3.	E-02	
01/23 01/31	1.14E 04	CU. FT.	3.8 ± 0.3	E-02	2.7 ± 1.2	E-03	02/04	LT. 2.	E-02	
01/31 02/07	9.97E 03	CU. FT.	2.1 ± 0.3	E-02	1.6 ± 1.1	E-03	02/11	LT. 3.	E-02	
02/07 02/14	1.04E 04	CU. FT.	2.9 ± 0.3	E-02	2.0 ± 1.2	E-03	02/18	LT. 4.	E-02	
02/14 02/21	9.88E 03	CU. FT.	2.7 ± 0.3	E-02	1.4 ± 1.0	E-03	02/25	LT. 4.	E-02	
02/21 02/28	9.84E 03	CU. FT.	1.9 ± 0.3	E-02	L.T. 1.	E-03	03/04	LT. 4.	E-02	
02/28 03/07	1.06E 04	CU. FT.	2.9 ± 0.3	E-02	1.5 ± 1.0	E-03	03/12	LT. 2.	E-02	
03/07 03/14	1.01E 04	CU. FT.	2.3 ± 0.3	E-02	3.2 ± 1.7	E-03	03/18	LT. 2.	E-02	
03/14 03/21	9.63E 03	CU. FT.	1.9 ± 0.3	E-02	1.4 ± 1.2	E-03	03/24	LT. 4.	E-02	
03/21 03/28	1.00E 04	CU. FT.	1.1 ± 0.3	E-02	L.T. 1.	E-03	03/30	LT. 2.	E-02	
03/28 04/04	1.05E 04	CU. FT.	2.0 ± 0.3	E-02	2.0 ± 1.2	E-03	04/09	LT. 3.	E-02	
04/04 04/11	9.91E 03	CU. FT.	2.0 ± 0.3	E-02	1.3 ± 1.0	E-03	04/14	LT. 3.	E-02	
04/11 04/18	9.89E 03	CU. FT.	1.4 ± 0.3	E-02	L.T. 1.	E-03	04/21	LT. 2.	E-02	
04/18 04/25	1.01E 04	CU. FT.	1.2 ± 0.3	E-02	L.T. 2.	E-03	04/29	LT. 3.	E-02	
04/25 05/02	4.69E 03	CU. FT.	3.0 ± 0.6	E-02	L.T. 4.	E-03*	05/27	LT. 1.	E-02	
05/02 05/09	8.57E 03	CU. FT.	1.4 ± 0.3	E-02	2.0 ± 1.3	E-03	05/16	LT. 4.	E-02	
05/09 05/16	9.70E 03	CU. FT.	1.0 ± 0.2	E-02	L.T. 1.	E-03	05/19	LT. 3.	E-02	
05/16 05/23	1.01E 04	CU. FT.	1.5 ± 0.3	E-02	1.5 ± 1.1	E-03	05/26	LT. 3.	E-02	
05/23 05/30	1.00E 04	CU. FT.	1.0 ± 0.2	E-02	1.1 ± 1.0	E-03	06/01	LT. 2.	E-02	
05/30 06/06	7.42E 03	CU. FT.	2.1 ± 0.4	E-02	L.T. 2.	E-03	06/09	LT. 3.	E-02	
06/06 06/13	6.82E 03	CU. FT.	2.3 ± 0.4	E-02	L.T. 2.	E-03	06/18	LT. 6.	E-02	
06/13 06/20	9.88E 03	CU. FT.	2.6 ± 0.3	E-02	L.T. 1.	E-03	06/25	LT. 4.	E-02	
06/20 06/27	1.02E 04	CU. FT.	2.7 ± 0.3	E-02	3.8 ± 1.5	E-03	07/02	LT. 4.	E-02	
06/27 07/05	1.12E 04	CU. FT.	1.8 ± 0.3	E-02	3.9 ± 1.5	E-03	07/12	LT. 5.	E-02	
07/05 07/11	8.71E 03	CU. FT.	2.3 ± 0.3	E-02	3.5 ± 1.8	E-03	07/15	LT. 3.	E-02	
07/11 07/18	1.00E 04	CU. FT.	2.5 ± 0.3	E-02	L.T. 2.	E-03	07/22	LT. 3.	E-02	
07/18 07/25	1.00E 04	CU. FT.	2.4 ± 0.3	E-02	1.5 ± 1.3	E-03	07/27	LT. 2.	E-02	
07/25 08/01	1.02E 04	CU. FT.	2.8 ± 0.4	E-02	2.7 ± 1.4	E-03	08/05	LT. 3.	E-02	
08/01 08/08	9.85E 03	CU. FT.	1.5 ± 0.3	E-02	L.T. 2.	E-03	08/10	LT. 2.	E-02	

\*The Gr-A LLD could not be met because of the low air volume.

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 01

STATION 01 - 0.1 MI. 225 DEG. IND.

COLL. TIME START STOP DATE DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)	
08/08 08/15	1.01E 04	CU. FT.	2.0 ± 0.3	E-02	2.0 ± 1.4	E-03	08/17	LT. 2.	E-02
08/15 08/22	1.07E 04	CU. FT.	1.8 ± 0.3	E-02	1.9 ± 1.2	E-03	08/27	LT. 3.	E-02
08/22 08/29	9.88E 03	CU. FT.	4.5 ± 0.4	E-02	2.8 ± 1.7	E-03	09/01	LT. 3.	E-02
08/29 09/05	1.01E 04	CU. FT.	3.2 ± 0.3	E-02	2.6 ± 1.4	E-03	09/08	LT. 3.	E-02
09/05 09/12	1.00E 04	CU. FT.	3.1 ± 0.3	E-02	2.7 ± 1.4	E-03	09/18	LT. 4.	E-02
09/12 09/19	9.84E 03	CU. FT.	2.8 ± 0.3	E-02	L. T. 2.	E-03	09/22	LT. 3.	E-02
09/19 09/26	1.02E 04	CU. FT.	3.0 ± 0.4	E-02	L. T. 2.	E-03	10/01	LT. 4.	E-02
09/26 10/03	1.02E 04	CU. FT.	4.5 ± 0.4	E-02	2.4 ± 1.4	E-03	10/07	LT. 3.	E-02
10/03 10/10	1.01E 04	CU. FT.	2.4 ± 0.3	E-02	L. T. 1.	E-03	10/13	LT. 3.	E-02
10/10 10/17	1.02E 04	CU. FT.	3.0 ± 0.4	E-02	2.2 ± 1.5	E-03	10/20	LT. 3.	E-02
10/17 10/24	1.00E 04	CU. FT.	2.0 ± 0.3	E-02	1.7 ± 1.4	E-03	10/28	LT. 3.	E-02
10/24 10/31	9.97E 03	CU. FT.	3.7 ± 2.0	E-03	L. T. 2.	E-03	11/04	LT. 3.	E-02
10/31 11/07*									
11/07 11/14	1.00E 04	CU. FT.	2.8 ± 0.3	E-02	L. T. 2.	E-03	11/19	LT. 3.	E-02
11/14 11/21	1.00E 04	CU. FT.	3.0 ± 0.4	E-02	1.9 ± 1.2	E-03	11/23	LT. 2.	E-02
11/21 11/28	1.00E 04	CU. FT.	2.9 ± 0.3	E-02	1.7 ± 1.3	E-03	11/30	LT. 2.	E-02
11/28 12/05	1.00E 04	CU. FT.	2.9 ± 0.4	E-02	4.6 ± 1.8	E-03	12/07	LT. 3.	E-02
12/05 12/12	1.03E 04	CU. FT.	2.7 ± 0.3	E-02	1.9 ± 1.4	E-03	12/14	LT. 2.	E-02
12/12 12/18	5.26E 03	CU. FT.	8.0 ± 0.8	E-02	4.3 ± 2.3	E-03	12/27	LT. 5.	E-02
12/18 12/26	1.18E 04	CU. FT.	2.8 ± 0.3	E-02	L. T. 2.	E-03	12/29	LT. 2.	E-02
12/26 01/02	9.86E 03	CU. FT.	5.4 ± 0.4	E-02	1.9 ± 1.4	E-03	01/04	LT. 2.	E-02

\*Sample not collected - pump out of service.

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 02

STATION 02 - 0.75 MI. 225 DEG. IND.

COLL. TIME		VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME DATE TIME		CHARCOAL FILTER I-131 (PCI/CU. M.)		
START DATE	STOP DATE											
01/03	01/10	1.05E 04	CU. FT.	4.1 ± 0.4	E-02	1.9 ± 1.1	E-03	01/14	LT.	1.	E-02	
01/10	01/17	9.90E 03	CU. FT.	3.6 ± 0.4	E-02	2.3 ± 1.4	E-03	01/21	LT.	2.	E-02	
01/17	01/23	8.68E 03	CU. FT.	2.3 ± 0.3	E-02	2.6 ± 1.4	E-03	01/26	LT.	3.	E-02	
01/23	01/31	1.02E 04	CU. FT.	3.9 ± 0.4	E-02	2.6 ± 1.3	E-03	02/04	LT.	3.	E-02	
01/31	02/07	1.04E 04	CU. FT.	2.0 ± 0.3	E-02	1.3 ± 1.0	E-03	02/11	LT.	3.	E-02	
02/07	02/14	9.97E 03	CU. FT.	2.6 ± 0.3	E-02	1.8 ± 1.2	E-03	02/18	LT.	4.	E-02	
02/14	02/21	1.01E 04	CU. FT.	2.2 ± 0.3	E-02	1.4 ± 1.0	E-03	02/25	LT.	4.	E-02	
02/21	02/28	9.61E 03	CU. FT.	1.7 ± 0.3	E-02	L.T. 1.	E-03	03/04	LT.	4.	E-02	
02/28	03/07	1.04E 04	CU. FT.	3.3 ± 0.3	E-02	3.0 ± 1.3	E-03	03/12	LT.	2.	E-02	
03/07	03/14	1.03E 04	CU. FT.	2.2 ± 0.3	E-02	L.T. 2.	E-03	03/18	LT.	2.	E-02	
03/14	03/21	1.00E 04	CU. FT.	1.8 ± 0.3	E-02	1.5 ± 1.2	E-03	03/24	LT.	3.	E-02	
03/21	03/28	9.67E 03	CU. FT.	1.2 ± 0.3	E-02	L.T. 1.	E-03	03/30	LT.	3.	E-02	
03/28	04/04	1.07E 04	CU. FT.	1.8 ± 0.3	E-02	2.9 ± 1.3	E-03	04/09	LT.	2.	E-02	
04/04	04/11	1.00E 04	CU. FT.	1.8 ± 0.3	E-02	1.2 ± 1.0	E-03	04/14	LT.	3.	E-02	
04/11	04/18	9.90E 03	CU. FT.	2.0 ± 0.3	E-02	1.5 ± 1.2	E-03	04/21	LT.	2.	E-02	
04/18	04/25	1.02E 04	CU. FT.	1.3 ± 0.3	E-02	L.T. 2.	E-03	04/29	LT.	2.	E-02	
04/25	05/02	9.76E 03	CU. FT.	1.4 ± 0.3	E-02	L.T. 2.	E-03	05/10	LT.	4.	E-02	
05/02	05/09	9.94E 03	CU. FT.	1.6 ± 0.3	E-02	1.3 ± 1.0	E-03	05/16	LT.	4.	E-02	
05/09	05/16	1.01E 04	CU. FT.	1.1 ± 0.2	E-02	1.5 ± 1.2	E-03	05/19	LT.	3.	E-02	
05/16	05/23	1.01E 04	CU. FT.	1.8 ± 0.3	E-02	1.5 ± 1.1	E-03	05/26	LT.	3.	E-02	
05/23	05/30	1.00E 04	CU. FT.	0.87 ± 0.23	E-02	1.4 ± 1.0	E-03	06/01	LT.	2.	E-02	
05/30	06/06	1.01E 03	CU. FT.	1.8 ± 0.3	E-02	L.T. 2.	E-03	06/09	LT.	2.	E-02	
06/06	06/13	4.06E 03	CU. FT.	3.4 ± 0.6	E-02	3.4 ± 2.7	E-03	06/18	LT.	9.	E-02*	
06/13	06/20	8.83E 03	CU. FT.	2.8 ± 0.3	E-02	3.2 ± 1.7	E-03	06/25	LT.	5.	E-02	
06/20	06/27	9.65E 03	CU. FT.	2.8 ± 0.3	E-02	3.5 ± 1.5	E-03	07/02	LT.	4.	E-02	
06/27	07/05	7.55E 03	CU. FT.	2.5 ± 0.4	E-02	6.7 ± 2.3	E-03	07/12	LT.	7.	E-02	
07/05	07/11	9.07E 03	CU. FT.	2.4 ± 0.3	E-02	3.4 ± 1.7	E-03	07/15	LT.	3.	E-02	
07/11	07/18	9.28E 03	CU. FT.	3.9 ± 0.4	E-02	2.9 ± 1.7	E-03	07/22	LT.	3.	E-02	
07/18	07/25	9.69E 03	CU. FT.	2.0 ± 0.3	E-02	L.T. 2.	E-03	07/27	LT.	3.	E-02	
07/25	08/01	1.02E 04	CU. FT.	2.7 ± 0.4	E-02	1.5 ± 1.1	E-03	08/05	LT.	3.	E-02	
08/01	08/08	9.86E 03	CU. FT.	1.9 ± 0.3	E-02	2.6 ± 1.6	E-03	08/10	LT.	2.	E-02	
08/08	08/15	1.01E 04	CU. FT.	2.1 ± 0.3	E-02	L.T. 2.	E-03	08/17	LT.	2.	E-02	

\*Required detection limit could not be reached due to low volume sampled.

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 02

STATION 02 - 0.75 MI. 225 DEG. IND

COLL. TIME		VOLUME	UNITS	AP FILTER		AP FILTER		MID-COUNT	CHARCOAL FILTER	
START DATE	STOP DATE			GROSS BETA (PCI/CU. M.)	GROSS ALPHA (PCI/CU. M.)	TIME DATE TIME	I-131 (PCI/CU. M.)			
08/15	08/22	1.07E 04	CU. FT.	2.0 ± 0.3	E-02	1.4 ± 1.1	E-03	08/27	LT. 3.	E-02
08/22	08/29	1.01E 04	CU. FT.	4.0 ± 0.4	E-02	3.0 ± 1.7	E-03	09/01	LT. 3.	E-02
08/29	09/05	1.01E 04	CU. FT.	3.7 ± 0.4	E-02	2.5 ± 1.4	E-03	09/08	LT. 3.	E-02
09/05	09/12	1.00E 04	CU. FT.	2.9 ± 0.3	E-02	2.5 ± 1.3	E-03	09/18	LT. 4.	E-02
09/12	09/19	1.01E 04	CU. FT.	2.6 ± 0.3	E-02	L. T. 2.	E-03	09/22	LT. 3.	E-02
09/19	09/26	1.01E 04	CU. FT.	2.6 ± 0.3	E-02	L. T. 2.	E-03	10/01	LT. 3.	E-02
09/26	10/03	9.96E 03	CU. FT.	4.5 ± 0.4	E-02	2.1 ± 1.4	E-03	10/07	LT. 3.	E-02
10/03	10/10	1.02E 04	CU. FT.	2.2 ± 0.3	E-02	L. T. 2.	E-03	10/13	LT. 3.	E-02
10/10	10/17	1.00E 04	CU. FT.	3.3 ± 0.4	E-02	3.2 ± 1.7	E-03	10/20	LT. 3.	E-02
10/17	10/24	1.01E 04	CU. FT.	2.0 ± 0.3	E-02	L. T. 2.	E-03	10/28	LT. 3.	E-02
10/24	10/31	9.98E 03	CU. FT.	1.7 ± 0.3	E-02	L. T. 2.	E-03	11/04	LT. 3.	E-02
10/31	11/07	1.02E 04	CU. FT.	2.4 ± 0.3	E-02	1.4 ± 1.2	E-03	11/10	LT. 2.	E-02
11/07	11/14	9.94E 03	CU. FT.	3.6 ± 0.3	E-02	5.1 ± 1.2	E-03	11/19	LT. 3.	E-02
11/14	11/21	9.70E 03	CU. FT.	3.8 ± 0.3	E-02	2.5 ± 1.0	E-03	11/23	LT. 2.	E-02
11/21	11/28	1.00E 04	CU. FT.	2.0 ± 0.3	E-02	2.0 ± 1.4	E-03	11/30	LT. 2.	E-02
11/28	12/05	1.00E 04	CU. FT.	2.1 ± 0.3	E-02	L. T. 1.	E-03	12/07	LT. 3.	E-02
12/05	12/12	1.01E 04	CU. FT.	2.6 ± 0.3	E-02	2.0 ± 1.4	E-03	12/14	LT. 2.	E-02
12/12	12/18	8.60E 03	CU. FT.	4.3 ± 0.5	E-02	2.8 ± 1.5	E-03	12/27	LT. 3.	E-02
12/18	12/26	1.21E 04	CU. FT.	2.7 ± 0.3	E-02	1.8 ± 1.3	E-03	12/29	LT. 2.	E-02
12/26	01/02	9.61E 03	CU. FT.	4.5 ± 0.4	E-02	L. T. 2.	E-03	01/04	LT. 2.	E-02

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 03

STATION 03 - 2.5 MI. 338 DEG. IND.

COLL. TIME		VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
START DATE	STOP DATE							DATE TIME			
01/03	01/10	1.00E 04	CU. FT.	4.2 ± 0.4	E-02	2.4 ± 1.2	E-03	01/14	LT. 2.	E-02	
01/10	01/17	1.01E 04	CU. FT.	3.8 ± 0.4	E-02	LT. 1.	E-03	01/21	LT. 2.	E-02	
01/17	01/24	1.01E 04	CU. FT.	2.4 ± 0.3	E-02	1.7 ± 1.1	E-03	01/26	LT. 3.	E-02	
01/24	01/31	1.05E 04	CU. FT.	4.0 ± 0.4	E-02	3.1 ± 1.3	E-03	02/04	LT. 2.	E-02	
01/31	02/07	9.64E 03	CU. FT.	2.1 ± 0.3	E-02	1.1 ± 1.0	E-03	02/11	LT. 3.	E-02	
02/07	02/14	1.01E 04	CU. FT.	2.7 ± 0.3	E-02	2.8 ± 1.4	E-03	02/18	LT. 4.	E-02	
02/14	02/21	1.03E 04	CU. FT.	2.0 ± 0.3	E-02	LT. 1.	E-03	02/25	LT. 4.	E-02	
02/21	02/28	9.93E 03	CU. FT.	2.0 ± 0.3	E-02	2.8 ± 1.3	E-03	03/04	LT. 4.	E-02	
02/28	03/07	1.04E 04	CU. FT.	2.9 ± 0.3	E-02	1.9 ± 1.1	E-03	03/12	LT. 2.	E-02	
03/07	03/14	9.75E 03	CU. FT.	1.8 ± 0.3	E-02	LT. 2.	E-03	03/18	LT. 3.	E-02	
03/14	03/21	9.98E 03	CU. FT.	1.8 ± 0.3	E-02	LT. 1.	E-03	03/24	LT. 4.	E-02	
03/21	03/28	1.02E 04	CU. FT.	1.4 ± 0.3	E-02	LT. 1.	E-03	03/30	LT. 2.	E-02	
03/28	04/04	1.04E 04	CU. FT.	1.1 ± 0.2	E-02	1.3 ± 1.0	E-03	04/09	LT. 3.	E-02	
04/04	04/11	9.88E 03	CU. FT.	1.8 ± 0.3	E-02	1.4 ± 1.0	E-03	04/14	LT. 3.	E-02	
04/11	04/18	9.78E 03	CU. FT.	1.8 ± 0.3	E-02	LT. 1.	E-03	04/21	LT. 2.	E-02	
04/18	04/25	1.01E 04	CU. FT.	1.3 ± 0.3	E-02	1.9 ± 1.4	E-03	04/29	LT. 3.	E-02	
04/25	05/02	1.03E 04	CU. FT.	1.6 ± 0.3	E-02	LT. 2.	E-03	05/10	LT. 4.	E-02	
05/02	05/09	9.82E 03	CU. FT.	1.1 ± 0.2	E-02	1.4 ± 1.0	E-03	05/16	LT. 4.	E-02	
05/09	05/16	1.01E 04	CU. FT.	1.1 ± 0.2	E-02	2.2 ± 1.4	E-03	05/19	LT. 3.	E-02	
05/16	05/23	1.01E 04	CU. FT.	1.4 ± 0.3	E-02	.97 ± .92	E-03	05/26	LT. 3.	E-02	
05/23	05/30	*									
05/30	06/06	*									
06/06	06/13	**									
06/13	06/20	9.81E 03	CU. FT.	2.3 ± 0.3	E-02	2.3 ± 1.4	E-03	06/25	LT. 4.	E-02	
06/20	06/27	1.01E 04	CU. FT.	2.0 ± 0.3	E-02	2.8 ± 1.3	E-03	07/02	LT. 4.	E-02	
06/27	07/05	1.15E 04	CU. FT.	1.1 ± 0.2	E-02	3.0 ± 1.3	E-03	07/12	LT. 4.	E-02	
07/05	07/11	8.48E 03	CU. FT.	1.9 ± 0.3	E-02	1.7 ± 1.4	E-03	07/15	LT. 3.	E-02	
07/11	07/18	9.99E 03	CU. FT.	2.6 ± 0.3	E-02	LT. 2.	E-03	07/22	LT. 3.	E-02	
07/18	07/25	1.20E 04	CU. FT.	1.8 ± 0.3	E-02	LT. 1.	E-03	07/27	LT. 2.	E-02	
07/25	08/01	1.03E 04	CU. FT.	1.9 ± 0.3	E-02	1.2 ± 1.0	E-03	08/05	LT. 2.	E-02	
08/01	08/08	9.70E 03	CU. FT.	2.4 ± 0.3	E-02	LT. 2.	E-03	08/10	LT. 2.	E-02	
08/08	08/15	1.02E 04	CU. FT.	2.1 ± 0.3	E-02	1.8 ± 1.3	E-03	08/17	LT. 2.	E-02	

\*Sample not collected - flooding

\*\*Low air volume



NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 03

STATION 03 - 2.5 MI. 338 DEG. IND.

COLL. TIME		VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME		CHARCOAL FILTER I-131 (PCI/CU. M.)	
START DATE	STOP DATE							DATE	TIME		
08/15	08/22	1.06E 04	CU. FT.	0.97 ± 0.23E-02		L.T. 1.	E-03	08/27		L.T. 3.	E-02
08/22	08/29	9.79E 03	CU. FT.	4.6 ± 0.4 E-02		2.5 ± 1.7	E-03	09/01		L.T. 3.	E-02
08/29	09/05	1.00E 04	CU. FT.	3.3 ± 0.3 E-02		1.9 ± 1.2	E-03	09/08		L.T. 3.	E-02
09/05	09/12	1.00E 04	CU. FT.	2.1 ± 0.3 E-02		2.3 ± 1.3	E-03	09/18		L.T. 4.	E-02
09/12	09/19	9.91E 03	CU. FT.	2.9 ± 0.3 E-02		L.T. 2.	E-03	09/22		L.T. 3.	E-02
09/19	09/26	1.02E 04	CU. FT.	1.5 ± 0.3 E-02		L.T. 2.	E-03	10/01		L.T. 4.	E-02
10/03	10/10	1.00E 04	CU. FT.	2.4 ± 0.3 E-02		1.5 ± 1.2	E-03	10/13		L.T. 3.	E-02
10/10	10/17	1.02E 04	CU. FT.	2.5 ± 0.3 E-02		1.9 ± 1.4	E-03	10/20		L.T. 3.	E-02
10/17	10/24	1.00E 04	CU. FT.	1.9 ± 0.3 E-02		2.1 ± 1.5	E-03	10/28		L.T. 3.	E-02
10/24	10/31	9.96E 03	CU. FT.	1.4 ± 0.3 E-02		L.T. 2.	E-03	11/04		L.T. 3.	E-02
10/31	11/07	1.02E 04	CU. FT.	2.3 ± 0.3 E-02		L.T. 1.	E-03	11/10		L.T. 2.	E-02
11/07	11/14	1.00E 04	CU. FT.	3.0 ± 0.3 E-02		L.T. 2.	E-03	11/19		L.T. 3.	E-02
11/14	11/21	1.02E 04	CU. FT.	2.9 ± 0.4 E-02		1.1 ± 1.0	E-03	11/23		L.T. 2.	E-02
11/21	11/28	1.00E 04	CU. FT.	2.9 ± 0.3 E-02		2.8 ± 1.5	E-03	11/30		L.T. 2.	E-02
11/28	12/05	1.01E 04	CU. FT.	2.1 ± 0.3 E-02		2.3 ± 1.4	E-03	12/07		L.T. 2.	E-02
12/05	12/12	1.01E 04	CU. FT.	2.3 ± 0.3 E-02		2.4 ± 1.5	E-03	12/14		L.T. 2.	E-02
12/12	12/18	8.33E 03	CU. FT.	4.2 ± 0.5 E-02		4.8 ± 1.9	E-03	12/27		L.T. 3.	E-02
12/18	12/26	1.17E 04	CU. FT.	2.5 ± 0.3 E-02		L.T. 2.	E-03	12/29		L.T. 2.	E-02
12/26	01/02	1.00E 04	CU. FT.	3.6 ± 0.4 E-02		1.6 ± 1.3	E-03	01/04		L.T. 2.	E-02

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 04

STATION 04 - 3.0 MI. 43 DEG. IND.

COLL. TIME START STOP DATE DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
01/03 01/10	1.02E 04	CU. FT.	7.6 ± 0.5	E-02	5.7 ± 2.0	E-03	01/14	LT. 2.	E-02	
01/10 01/17	1.00E 04	CU. FT.	8.5 ± 0.5	E-02	3.8 ± 1.7	E-03	01/21	LT. 2.	E-02	
01/17 01/24	7.90E 03	CU. FT.	6.5 ± 0.6	E-02	5.7 ± 2.1	E-03	01/26	LT. 3.	E-02	
01/24 01/31	7.52E 03	CU. FT.	1.1 ± 0.1	E-01	5.9 ± 2.4	E-03	02/04	LT. 3.	E-02	
01/31 02/07	9.38E 03	CU. FT.	5.5 ± 0.5	E-02	3.9 ± 1.7	E-03	02/11	LT. 3.	E-02	
02/07 02/14	9.47E 03	CU. FT.	5.0 ± 0.4	E-02	5.3 ± 1.9	E-03	02/18	LT. 4.	E-02	
02/14 02/21	1.02E 04	CU. FT.	4.0 ± 0.4	E-02	1.8 ± 1.1	E-03	02/25	LT. 4.	E-02	
02/21 02/28	9.86E 03	CU. FT.	1.5 ± 0.3	E-02	LT. 1.	E-03	03/04	LT. 4.	E-02	
02/28 03/07	1.04E 04	CU. FT.	2.8 ± 0.3	E-02	2.2 ± 1.1	E-03	03/12	LT. 2.	E-02	
03/07 03/14	9.71E 03	CU. FT.	2.8 ± 0.3	E-02	LT. 2.	E-03	03/18	LT. 3.	E-02	
03/14 03/21	9.97E 03	CU. FT.	1.7 ± 0.3	E-02	1.4 ± 1.2	E-03	03/24	LT. 4.	E-02	
03/21 03/28	1.01E 04	CU. FT.	1.1 ± 0.3	E-02	LT. 1.	E-03	03/30	LT. 2.	E-02	
03/28 04/04	1.02E 04	CU. FT.	2.2 ± 0.3	E-02	4.0 ± 1.6	E-03	04/09	LT. 3.	E-02	
04/04 04/11	9.94E 03	CU. FT.	2.0 ± 0.3	E-02	1.6 ± 1.1	E-03	04/14	LT. 3.	E-02	
04/11 04/18	9.92E 03	CU. FT.	1.9 ± 0.3	E-02	LT. 1.	E-03	04/21	LT. 2.	E-02	
04/18 04/25	1.01E 04	CU. FT.	1.4 ± 0.3	E-02	1.7 ± 1.4	E-03	04/29	LT. 3.	E-02	
04/25 05/02	1.02E 04	CU. FT.	1.5 ± 0.3	E-02	LT. 2.	E-03	05/10	LT. 4.	E-02	
05/02 05/09	9.83E 03	CU. FT.	1.5 ± 0.3	E-02	1.5 ± 1.1	E-03	05/16	LT. 4.	E-02	
05/09 05/16	1.01E 04	CU. FT.	1.3 ± 0.3	E-02	2.1 ± 1.3	E-03	05/19	LT. 3.	E-02	
05/16 05/23	1.01E 04	CU. FT.	1.5 ± 0.3	E-02	1.7 ± 1.1	E-03	05/26	LT. 3.	E-02	
05/23 05/30	1.01E 04	CU. FT.	0.84 ± 0.23	E-02	LT. 9.	E-04	06/09	LT. 2.	E-02	
05/30 06/06	1.01E 04	CU. FT.	1.4 ± 0.3	E-02	LT. 2.	E-03	06/09	LT. 2.	E-02	
06/06 06/13	1.01E 04	CU. FT.	1.5 ± 0.3	E-02	LT. 1.	E-03	06/18	LT. 4.	E-02	
06/13 06/20	6.66E 03	CU. FT.	4.0 ± 0.5	E-02	4.4 ± 2.3	E-03	06/25	LT. 6.	E-02	
06/20 06/27	1.02E 04	CU. FT.	3.0 ± 0.3	E-02	3.2 ± 1.4	E-03	07/02	LT. 4.	E-02	
06/27 07/05	1.09E 04	CU. FT.	1.6 ± 0.3	E-02	2.2 ± 1.2	E-03	07/12	LT. 5.	E-02	
07/05 07/11	8.63E 03	CU. FT.	3.1 ± 0.4	E-02	3.1 ± 1.7	E-03	07/15	LT. 3.	E-02	
07/11 07/18	9.96E 03	CU. FT.	4.8 ± 0.4	E-02	2.7 ± 1.6	E-03	07/22	LT. 3.	E-02	
07/18 07/25	1.01E 04	CU. FT.	3.6 ± 0.4	E-02	2.8 ± 1.5	E-03	07/27	LT. 2.	E-02	
07/25 08/01	1.03E 04	CU. FT.	3.5 ± 0.4	E-02	1.5 ± 1.1	E-03	08/05	LT. 2.	E-02	
08/01 08/08	9.65E 03	CU. FT.	2.4 ± 0.3	E-02	LT. 2.	E-03	08/10	LT. 3.	E-02	
08/08 08/15	9.65E 03	CU. FT.	3.6 ± 0.4	E-02	2.4 ± 1.5	E-03	08/17	LT. 3.	E-02	
08/15 08/22	9.87E 03	CU. FT.	3.0 ± 0.3	E-02	3.4 ± 1.6	E-03	08/27	LT. 4.	E-02	
08/22 08/29	9.84E 03	CU. FT.	2.8 ± 0.3	E-02	LT. 2.	E-03	09/01	LT. 3.	E-02	

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 04

STATION 04 - 3.0 MI. 43 DEG. IND.

COLL. TIME		VOLUME	UNITS	AP FILTER		AP FILTER		MID-COUNT	CHARCOAL FILTER		
START DATE	STOP DATE			GROSS BETA (PCI/CU.M.)	E-02	GROSS ALPHA (PCI/CU.M.)	E-03	TIME DATE TIME	I-131 (PCI/CU. M.)		
08/29	09/05	1.01E 04	CU. FT.	5.5 ± 0.4	E-02	2.9 ± 1.4	E-03	09/08	LT. 3.	E-02	
09/05	09/12	1.00E 04	CU. FT.	4.8 ± 0.4	E-02	4.4 ± 1.7	E-03	09/18	LT. 4.	E-02	
09/12	09/19	1.02E 04	CU. FT.	3.3 ± 0.3	E-02	L. T. 2.	E-03	09/22	LT. 3.	E-02	
09/19	09/26	9.99E 03	CU. FT.	4.0 ± 0.4	E-02	L. T. 2.	E-03	10/01	LT. 4.	E-02	
09/26	10/03	1.01E 04	CU. FT.	5.9 ± 0.4	E-02	4.6 ± 1.8	E-03	10/07	LT. 3.	E-02	
10/03	10/10	9.98E 03	CU. FT.	3.3 ± 0.3	E-02	2.0 ± 1.3	E-03	10/13	LT. 3.	E-02	
10/10	10/17	9.51E 03	CU. FT.	5.7 ± 0.4	E-02	4.6 ± 1.8	E-03	10/20	LT. 3.	E-02	
10/17	10/24	9.89E 03	CU. FT.	2.2 ± 0.3	E-02	L. T. 2.	E-03	10/28	LT. 3.	E-02	
10/24	10/31	1.00E 04	CU. FT.	1.7 ± 0.3	E-02	L. T. 2.	E-03	11/04	LT. 3.	E-02	
10/31	11/07	1.02E 04	CU. FT.	2.3 ± 0.3	E-02	1.5 ± 1.2	E-03	11/10	LT. 2.	E-02	
11/07	11/14	9.98E 03	CU. FT.	3.1 ± 0.3	E-02	L.T. 2.	E-03	11/19	LT. 3.	E-02	
11/14	11/21	1.01E 04	CU. FT.	3.1 ± 0.4	E-02	1.1 ± 1.0	E-03	11/23	LT. 2.	E-02	
11/21	11/28	1.00E 04	CU. FT.	2.9 ± 0.3	E-02	3.5 ± 1.7	E-03	11/30	LT. 2.	E-02	
11/28	12/05	1.00E 04	CU. FT.	2.8 ± 0.4	E-02	2.4 ± 1.4	E-03	12/07	LT. 3.	E-02	
12/05	12/12	1.01E 04	CU. FT.	2.3 ± 0.3	E-02	2.0 ± 1.4	E-03	12/14	LT. 2.	E-02	
12/12	12/18	8.60E 03	CU. FT.	4.0 ± 0.4	E-02	2.7 ± 1.5	E-03	12/27	LT. 3.	E-02	
12/18	12/26	1.19E 04	CU. FT.	2.4 ± 0.5	E-02	2.5 ± 1.5	E-03	12/29	LT. 2.	E-02	
12/26	01/02	9.79E 03	CU. FT.	4.2 ± 0.4	E-02	2.0 ± 1.4	E-03	01/04	LT. 2.	E-02	

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 05

STATION 05 - 3.5 MI. 102 DEG. IND.

COLL. TIME START STOP DATE DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
01/03 01/10	1.02E 04	CU. FT.	5.6 ± 0.4	E-02	1.8 ± 1.1	E-03	01/14	LT.	1.	E-02
01/10 01/17	1.00E 04	CU. FT.	5.6 ± 0.4	E-02	3.2 ± 1.5	E-03	01/21	LT.	1.	E-02
01/17 01/24	1.00E 04	CU. FT.	3.7 ± 0.4	E-02	1.8 ± 1.2	E-03	01/26	LT.	2.	E-02
01/24 01/31	1.05E 04	CU. FT.	2.9 ± 0.3	E-02	2.2 ± 1.2	E-03	02/04	LT.	1.	E-02
01/31 02/07	9.74E 03	CU. FT.	3.1 ± 0.3	E-02	2.3 ± 1.3	E-03	02/11	LT.	1.	E-02
02/07 02/14	1.00E 04	CU. FT.	2.0 ± 0.3	E-02	2.2 ± 1.2	E-03	02/18	LT.	3.	E-02
02/14 02/21	9.94E 03	CU. FT.	3.2 ± 0.3	E-02	1.5 ± 1.1	E-03	02/25	LT.	2.	E-02
02/21 02/28	9.86E 03	CU. FT.	2.3 ± 0.3	E-02	2.1 ± 1.2	E-03	03/04	LT.	3.	E-02
02/28 03/07	1.05E 04	CU. FT.	3.7 ± 0.4	E-02	1.7 ± 1.0	E-03	03/12	LT.	1.	E-02
03/07 03/14	9.71E 03	CU. FT.	3.2 ± 0.4	E-02	LT. 2.	E-03	03/18	LT.	1.	E-02
03/14 03/21	1.00E 04	CU. FT.	2.4 ± 0.3	E-02	LT. 1.	E-03	03/24	LT.	2.	E-02
03/21-03/28	1.00E 04	CU. FT.	1.9 ± 0.3	E-02	LT. 1.	E-03	03/30	LT.	2.	E-02
03/28 04/04	1.04E 04	CU. FT.	2.2 ± 0.3	E-02	3.9 ± 1.5	E-03	04/09	LT.	1.	E-02
04/04 04/11	9.61E 03	CU. FT.	3.2 ± 0.4	E-02	1.8 ± 1.2	E-03	04/14	LT.	2.	E-02
04/11 04/18	9.92E 03	CU. FT.	2.1 ± 0.3	E-02	1.5 ± 1.2	E-03	04/21	LT.	1.	E-02
04/18 04/25	1.00E 04	CU. FT.	2.2 ± 0.3	E-02	LT. 2.	E-03	04/29	LT.	2.	E-02
04/25 05/02	1.02E 04	CU. FT.	1.7 ± 0.3	E-02	LT. 2.	E-03	05/10	LT.	2.	E-02
05/02 05/09	9.83E 03	CU. FT.	1.5 ± 0.3	E-02	0.95 ± 0.9	E-03	05/16	LT.	2.	E-02
05/09 05/16	1.01E 04	CU. FT.	1.2 ± 0.2	E-02	1.8 ± 1.3	E-03	05/19	LT.	2.	E-02
05/16 05/23	1.01E 04	CU. FT.	1.8 ± 0.3	E-02	2.8 ± 1.4	E-03	05/26	LT.	2.	E-02
05/23 05/30	9.98E 03	CU. FT.	0.98 ± 0.24	E-02	1.7 ± 1.1	E-03	06/01	LT.	2.	E-02
05/30 06/06	1.01E 04	CU. FT.	1.7 ± 0.3	E-02	LT. 2.	E-03	06/09	LT.	2.	E-02
06/06 06/13	1.01E 04	CU. FT.	1.4 ± 0.2	E-02	LT. 1.	E-03	06/18	LT.	2.	E-02
06/13 06/20	9.95E 03	CU. FT.	3.0 ± 0.3	E-02	2.0 ± 1.4	E-03	06/25	LT.	3.	E-02
06/20 06/27	9.78E 03	CU. FT.	3.0 ± 0.3	E-02	4.1 ± 1.6	E-03	07/02	LT.	3.	E-02
06/27 07/05	1.07E 04	CU. FT.	1.4 ± 0.2	E-02	1.9 ± 1.1	E-03	07/12	LT.	3.	E-02
07/05 07/11	8.63E 03	CU. FT.	2.8 ± 0.4	E-02	2.2 ± 1.5	E-03	07/15	LT.	2.	E-02
07/11 07/18	9.96E 03	CU. FT.	3.8 ± 0.4	E-02	3.2 ± 1.7	E-03	07/22	LT.	2.	E-02
07/18 07/25*	1.01E 04	CU. FT.					07/27	LT.	2.	E-02
07/25 08/01	1.03E 04	CU. FT.	3.5 ± 0.4	E-02	1.8 ± 1.2	E-03	08/05	LT.	2.	E-02
08/01 08/08	9.65E 03	CU. FT.	2.6 ± 0.3	E-02	LT. 2.	E-03	08/10	LT.	2.	E-02
08/08 08/15	1.01E 04	CU. FT.	3.3 ± 0.3	E-02	3.6 ± 1.7	E-03	08/17	LT.	2.	E-02
08/15 08/22	1.07E 04	CU. FT.	2.3 ± 0.3	E-02	2.4 ± 1.3	E-03	08/27	LT.	2.	E-02

\*Air Particulate no good - filter assembly malfunction. Charcoal filter ok.

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 05

STATION 05 - 3.5 MI. 102 DEG. IND.

COLL. TIME		VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)	
START DATE	STOP DATE			DATE	TIME	DATE	TIME	DATE	TIME	
08/22	08/29	9.85E 03	CU. FT.	3.1 ± 0.3	E-02	2.3 ± 1.7	E-03	09/01	LT. 1.	E-02
08/29	09/05	1.01E 04	CU. FT.	4.5 ± 0.4	E-02	4.1 ± 1.7	E-03	09/08	LT. 2.	E-02
09/05	09/12	1.00E 04	CU. FT.	4.2 ± 0.4	E-02	3.1 ± 1.4	E-03	09/18	LT. 3.	E-02
09/12	09/19	1.02E 04	CU. FT.	3.5 ± 0.3	E-02	2.5 ± 1.6	E-03	09/22	LT. 2.	E-02
09/19	09/26	1.00E 04	CU. FT.	2.2 ± 0.3	E-02	L.T. 2.	E-03	10/01	LT. 2.	E-02
09/26	10/03	1.01E 04	CU. FT.	4.5 ± 0.4	E-02	2.8 ± 1.5	E-03	10/07	LT. 2.	E-02
10/03	10/10	9.99E 03	CU. FT.	3.4 ± 0.4	E-02	1.6 ± 1.2	E-03	10/13	LT. 2.	E-02
10/10	10/17	1.02E 04	CU. FT.	3.5 ± 0.4	E-02	3.0 ± 1.6	E-03	10/20	LT. 2.	E-02
10/17	10/24	1.01E 04	CU. FT.	2.9 ± 0.3	E-02	2.0 ± 1.4	E-03	10/28	LT. 1.	E-02
10/24	10/31	1.00E 04	CU. FT.	1.5 ± 0.3	E-02	L.T. 2.	E-03	11/04	LT. 2.	E-02
10/31	11/07	1.02E 04	CU. FT.	2.3 ± 0.3	E-02	L.T. 1.	E-03	11/10	LT. 2.	E-02
11/07	11/14	9.98E 03	CU. FT.	3.1 ± 0.3	E-02	L.T. 2.	E-03	11/19	LT. 2.	E-02
11/14	11/21	1.01E 04	CU. FT.	3.0 ± 0.4	E-02	L.T. 1.	E-03	11/23	LT. 1.	E-02
11/21	11/28	1.00E 04	CU. FT.	2.4 ± 0.3	E-02	1.5 ± 1.3	E-03	11/30	LT. 2.	E-02
11/28	12/05	1.00E 04	CU. FT.	2.8 ± 0.4	E-02	2.7 ± 1.5	E-03	12/07	LT. 2.	E-02
12/05	12/12	1.00E 04	CU. FT.	2.1 ± 0.3	E-02	L.T. 1.	E-03	12/14	LT. 1.	E-02
12/12	12/18	8.60E 03	CU. FT.	5.0 ± 0.5	E-02	6.5 ± 2.2	E-03	12/27	LT. 2.	E-02
12/18	12/26	1.19E 04	CU. FT.	2.1 ± 0.3	E-02	L.T. 2.	E-03	12/29	LT. 1.	E-02
12/26	01/02	9.76E 03	CU. FT.	4.1 ± 0.4	E-02	L.T. 2.	E-03	01/04	LT. 1.	E-02

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 06

STATION 06 - 3.0 MI. 165 DEG. IND.

COLL. TIME START STOP DATE DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
01/03 01/10	1.02E 04	CU. FT.	3.8 ± 0.4 E-02	2.1 ± 1.2 E-03	01/14	LT. 2. E-02
01/10 01/17	1.00E 04	CU. FT.	3.6 ± 0.4 E-02	3.9 ± 1.6 E-03	01/21	LT. 4. E-02
01/17 01/24	1.00E 04	CU. FT.	2.7 ± 0.3 E-02	1.7 ± 1.1 E-03	01/26	LT. 2. E-02
01/24 01/31	9.60E 03	CU. FT.	*		02/04	LT. 2. E-02
01/31 02/07	9.77E 03	CU. FT.	1.9 ± 0.3 E-02	L.T. 9. E-04	02/11	LT. 3. E-02
02/07 02/14	1.00E 04	CU. FT.	2.4 ± 0.3 E-02	L.T. 9. E-04	02/19	LT. 3. E-02
02/14 02/21	1.03E 04	CU. FT.	2.1 ± 0.3 E-02	L.T. 1. E-03	02/25	LT. 2. E-02
02/21 02/28	9.86E 03	CU. FT.	1.7 ± 0.3 E-02	2.3 ± 1.2 E-03	03/04	LT. 3. E-02
02/28 03/07	1.05E 04	CU. FT.	3.2 ± 0.3 E-02	1.4 ± 0.9 E-03	03/12	LT. 3. E-02
03/07 03/14	9.71E 03	CU. FT.	1.9 ± 0.3 E-02	1.9 ± 1.5 E-03	03/18	LT. 2. E-02
03/14 03/21	9.98E 03	CU. FT.	1.9 ± 0.3 E-02	2.4 ± 1.4 E-03	03/24	LT. 2. E-02
03/21 03/28	1.01E 04	CU. FT.	1.3 ± 0.3 E-02	L.T. 1. E-03	03/30	LT. 3. E-02
03/28 04/04	1.05E 04	CU. FT.	2.1 ± 0.3 E-02	1.3 ± 1.0 E-03	04/09	LT. 2. E-02
04/04 04/11	9.88E 03	CU. FT.	1.8 ± 0.3 E-02	1.6 ± 1.1 E-03	04/15	LT. 3. E-02
04/11 04/18	9.88E 03	CU. FT.	1.6 ± 0.3 E-02	1.8 ± 1.2 E-03	04/22	LT. 3. E-02
04/18 04/25	1.02E 04	CU. FT.	1.1 ± 0.3 E-02	L.T. 2. E-03	05/01	LT. 4. E-02
04/25 05/02	1.01E 04	CU. FT.	1.6 ± 0.3 E-02	L.T. 2. E-03	05/10	LT. 5. E-02
05/02 05/09	9.83E 03	CU. FT.	1.5 ± 0.3 E-02	L.T. 0.9 E-03	05/16	LT. 5. E-02
05/09 05/16	1.01E 04	CU. FT.	1.1 ± 0.2 E-02	L.T. 1. E-03	05/19	LT. 4. E-02
05/16 05/23	1.01E 04	CU. FT.	1.6 ± 0.3 E-02	2.5 ± 1.3 E-03	05/26	LT. 2. E-02
05/23 05/30	1.01E 04	CU. FT.	1.0 ± 0.2 E-02	1.5 ± 1.1 E-03	06/02	LT. 3. E-02
05/30 06/06	1.01E 04	CU. FT.	1.4 ± 0.3 E-02	L.T. 2. E-03	06/09	LT. 2. E-02
06/06 06/13	1.01E 04	CU. FT.	1.4 ± 0.2 E-02	L.T. 1. E-03	06/18	LT. 3. E-02
06/13 06/20	9.49E 03	CU. FT.	2.3 ± 0.3 E-02	2.1 ± 1.4 E-03	06/25	LT. 3. E-02
06/20 06/27	1.01E 04	CU. FT.	2.5 ± 0.3 E-02	3.6 ± 1.5 E-03	07/02	LT. 3. E-02
06/27 07/05	1.07E 04	CU. FT.	1.6 ± 0.3 E-02	2.6 ± 1.3 E-03	07/12	LT. 4. E-02
07/05 07/11	8.62E 03	CU. FT.	2.2 ± 0.3 E-02	3.3 ± 1.7 E-03	07/15	LT. 4. E-02
07/11 07/18	9.13E 03	CU. FT.	3.4 ± 0.4 E-02	L.T. 2. E-03	07/22	LT. 2. E-02
07/18 07/25	1.01E 04	CU. FT.	2.2 ± 0.3 E-02	1.8 ± 1.3 E-03	07/27	LT. 2. E-02
07/25 08/01	1.03E 04	CU. FT.	2.4 ± 0.4 E-02	L.T. 1. E-03	08/05	LT. 3. E-02
08/01 08/08	9.65E 03	CU. FT.	2.3 ± 0.3 E-02	L.T. 2. E-03	08/10	LT. 2. E-02
08/08 08/15	1.01E 04	CU. FT.	2.1 ± 0.3 E-02	L.T. 2. E-03	08/18	LT. 3. E-02
08/15 08/22	1.07E 04	CU. FT.	2.2 ± 0.3 E-02	1.4 ± 1.1 E-03	08/27	LT. 2. E-02

\*Sampler separated.

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 06

STATION 06 - 3.0 MI. 165 DEG. IND.

COLL. TIME		VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME DATE TIME		CHARCOAL FILTER I-131 (PCI/CU. M.)		
START DATE	STOP DATE											
08/22	08/29	9.85E 03	CU. FT.	4.0 ± 0.4	E-02	2.8 ± 1.7	E-03	09/01	L.T.	3.	E-02	
08/29	09/05	1.01E 04	CU. FT.	3.4 ± 0.3	E-02	2.0 ± 1.3	E-03	09/08	L.T.	2.	E-02	
09/05	09/12	1.00E 04	CU. FT.	3.0 ± 0.3	E-02	2.3 ± 1.3	E-03	09/18	L.T.	3.	E-02	
09/12	09/19	1.02E 04	CU. FT.	2.5 ± 0.3	E-02	L. T. 2.	E-03	09/22	L.T.	2.	E-02	
09/19	09/26	1.01E 04	CU. FT.	2.4 ± 0.3	E-02	L. T. 2.	E-03	10/01	L.T.	3.	E-02	
09/26	10/03	9.97E 03	CU. FT.	3.2 ± 0.3	E-02	2.7 ± 1.5	E-03	10/07	L.T.	3.	E-02	
10/03	10/10	9.97E 03	CU. FT.	2.6 ± 0.3	E-02	L. T. 1.	E-03	10/13	L.T.	3.	E-02	
10/10	10/17	1.02E 04	CU. FT.	2.5 ± 0.3	E-02	L. T. 2.	E-03	11/07	L.T.	4.	E-02	
10/17	10/24	1.01E 04	CU.FT.	2.2 ± 0.3	E-02	3.2 ± 1.6	E-03	10/28	L.T.	3.	E-02	
10/24	10/31	1.01E 04	CU.FT.	1.8 ± 0.3	E-02	L. T. 2.	E-03	11/04	L.T.	3.	E-02	
10/31	11/07	1.01E 04	CU.FT.	3.1 ± 0.4	E-02	1.4 ± 1.2	E-03	11/10	L.T.	2.	E-02	
11/07	11/14	9.98E 03	CU. FT.	3.6 ± 0.4	E-02	L. T. 2.	E-03	11/19	L.T.	3.	E-02	
11/14	11/21	1.00E 04	CU. FT.	3.5 ± 0.4	E-02	L. T. 1.	E-03	11/23	L.T.	2.	E-02	
11/21	11/28	1.00E 04	CU. FT.	3.5 ± 0.4	E-02	L. T. 1.	E-03	11/30	L.T.	2.	E-02	
11/28	12/05	1.00E 04	CU. FT.	2.9 ± 0.4	E-02	2.6 ± 1.5	E-03	12/07	L.T.	2.	E-02	
12/05	12/12	1.01E 04	CU. FT.	2.6 ± 0.3	E-02	1.5 ± 1.3	E-03	12/14	L.T.	2.	E-02	
12/12	12/18	8.59E 03	CU. FT.	5.1 ± 0.5	E-02	4.0 ± 1.8	E-03	12/27	L.T.	3.	E-02	
12/18	12/26	1.19E 04	CU. FT.	2.6 ± 0.3	E-02	L.T. 2.	E-03	12/29	L.T.	2.	E-02	
12/26	01/02	9.77E 03	CU. FT.	4.7 ± 0.4	E-02	1.8 ± 1.4	E-03	01/04	L.T.	2.	E-02	

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 07

STATION 07 - 2.5 MI. 230 DEG. IND.

COLL. TIME		STOP	VOLUME	UNITS	AP FILTER		AP FILTER		MID-COUNT		CHARCOAL FILTER	
START	DATE				GROSS BETA	GROSS ALPHA	TIME	DATE	TIME	DATE	I-131	
DATE	DATE				(PCI/CU.M.)	(PCI/CU.M.)					(PCI/CU. M.)	
01/03	01/10		1.05E 04	CU. FT.	3.8 ± 0.4	E-02	2.5 ± 1.2	E-03	01/14		LT. 2.	E-02
01/10	01/17		9.94E 03	CU. FT.	3.3 ± 0.4	E-02	3.0 ± 1.5	E-03	01/21		LT. 4.	E-02
01/17	01/23		8.66E 03	CU. FT.	2.7 ± 0.4	E-02	1.8 ± 1.2	E-03	01/26		LT. 2.	E-02
01/23	01/31		1.10E 04	CU. FT.	4.9 ± 0.4	E-02	2.8 ± 1.3	E-03	02/04		LT. 2.	E-02
01/31	02/07		1.04E 04	CU. FT.	1.8 ± 0.3	E-02	L. T. 8.	E-04	02/11		LT. 3.	E-02
02/07	02/14		9.98E 03	CU. FT.	2.5 ± 0.3	E-02	1.7 ± 1.1	E-03	02/19		LT. 3.	E-02
02/14	02/21		1.01E 04	CU. FT.	2.5 ± 0.3	E-02	2.1 ± 1.2	E-03	02/25		LT. 2.	E-02
02/21	02/28		9.64E 03	CU. FT.	1.6 ± 0.3	E-02	1.7 ± 1.1	E-03	03/04		LT. 3.	E-02
02/28	03/07		1.03E 04	CU. FT.	2.4 ± 0.3	E-02	1.2 ± 0.9	E-03	03/12		LT. 3.	E-02
03/07	03/14		1.03E 04	CU. FT.	2.5 ± 0.3	E-02	2.2 ± 1.5	E-03	03/18		LT. 1.	E-02
03/14	03/21		1.00E 04	CU. FT.	1.7 ± 0.3	E-02	3.9 ± 1.7	E-03	03/24		LT. 2.	E-02
03/21	03/28		9.69E 03	CU. FT.	1.2 ± 0.3	E-02	1.6 ± 1.3	E-03	03/30		LT. 3.	E-02
03/28	04/04		1.06E 04	CU. FT.	2.0 ± 0.3	E-02	2.5 ± 1.3	E-03	04/09		LT. 2.	E-02
04/04	04/11		1.00E 04	CU. FT.	1.9 ± 0.3	E-02	2.0 ± 1.2	E-03	04/15		LT. 3.	E-02
04/11	04/18		9.74E 03	CU. FT.	1.5 ± 0.3	E-02	LT. 1.	E-03	04/22		LT. 3.	E-02
04/18	04/25		1.02E 04	CU. FT.	1.2 ± 0.3	E-02	LT. 2.	E-03	05/01		LT. 4.	E-02
04/25	05/02		9.70E 03	CU. FT.	1.6 ± 0.3	E-02	2.0 ± 1.5	E-03	05/10		LT. 5.	E-02
05/02	05/09		9.93E 03	CU. FT.	1.5 ± 0.3	E-02	2.7 ± 1.3	E-03	05/16		LT. 5.	E-02
05/09	05/16		1.01E 04	CU. FT.	1.2 ± 0.2	E-02	1.9 ± 1.3	E-03	05/19		LT. 4.	E-02
05/16	05/23		9.99E 03	CU. FT.	1.5 ± 0.3	E-02	2.5 ± 1.3	E-03	05/26		LT. 2.	E-02
05/23	05/30		1.00E 04	CU. FT.	0.91 ± 0.23	E-02	2.1 ± 1.2	E-03	06/02		LT. 3.	E-02
05/30	06/06		1.01E 04	CU. FT.	1.4 ± 0.3	E-02	LT. 2.	E-03	06/09		LT. 2.	E-02
06/06	06/13		1.01E 04	CU. FT.	1.5 ± 0.3	E-02	LT. 1.	E-03	06/18		LT. 3.	E-02
06/13	06/20		1.05E 04	CU. FT.	2.8 ± 0.3	E-02	3.6 ± 1.6	E-03	06/25		LT. 3.	E-02
06/20	06/27		1.01E 04	CU. FT.	2.5 ± 0.3	E-02	2.0 ± 1.2	E-03	07/02		LT. 3.	E-02
06/27	07/05		1.12E 04	CU. FT.	1.3 ± 0.2	E-02	3.9 ± 1.5	E-03	07/12		LT. 3.	E-02
07/05	07/11		9.05E 03	CU. FT.	2.1 ± 0.3	E-02	4.3 ± 1.8	E-03	07/15		LT. 4.	E-02
07/11	07/18		9.93E 03	CU. FT.	2.0 ± 0.3	E-02	3.2 ± 1.7	E-03	07/22		LT. 2.	E-02
07/18	07/25		9.71E 03	CU. FT.	2.3 ± 0.3	E-02	LT. 1.	E-03	07/27		LT. 2.	E-02
07/25	08/01		1.02E 04	CU. FT.	2.5 ± 0.4	E-02	2.1 ± 1.3	E-03	08/05		LT. 3.	E-02
08/01	08/08		9.85E 03	CU. FT.	2.1 ± 0.3	E-02	3.3 ± 1.7	E-03	08/10		LT. 2.	E-02
08/08	08/15		1.01E 04	CU. FT.	1.8 ± 0.3	E-02	3.3 ± 1.6	E-03	08/18		LT. 3.	E-02
08/15	08/22		1.07E 04	CU. FT.	1.6 ± 0.3	E-02	1.4 ± 1.1	E-03	08/27		LT. 2.	E-02
08/22	08/29		1.01E 04	CU. FT.	3.7 ± 0.4	E-02	2.4 ± 1.6	E-03	09/01		LT. 3.	E-02
08/29	09/05		1.01E 04	CU. FT.	3.1 ± 0.3	E-02	2.8 ± 1.4	E-03	09/08		LT. 2.	E-02



NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 07

STATION 07 - 2.5 MI. 230 DEG. IND.

COLL. TIME START DATE	STOP DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)	AP FILTER GROSS ALPHA (PCI/CU.M.)	MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)
09/05	09/12	1.00E 04	CU. FT.	2.3 ± 0.3 E-02	2.5 ± 1.3 E-03	09/18	LT. 3. E-02
09/12	09/19	1.01E 04	CU. FT.	2.4 ± 0.3 E-02	L.T. 2. E-03	09/22	LT. 2. E-02
09/19	09/26	1.01E 04	CU. FT.	2.3 ± 0.3 E-02	L.T. 2. E-03	10/01	LT. 3. E-02
09/26	10/03	9.97E 03	CU. FT.	3.3 ± 0.3 E-02	2.4 ± 1.4 E-03	10/07	LT. 3. E-02
10/03	10/10	1.02E 04	CU. FT.	2.6 ± 0.3 E-02	1.8 ± 1.2 E-03	10/13	LT. 2. E-02
10/10	10/17	1.01E 04	CU. FT.	3.3 ± 0.4 E-02	3.2 ± 1.7 E-03	11/07	LT. 5. E-02
10/17	10/24	1.01E 04	CU. FT.	2.1 ± 0.3 E-02	1.7 ± 1.4 E-03	10/28	LT. 3. E-02
10/24	10/31	9.97E 03	CU. FT.	1.3 ± 0.3 E-02	L. T. 2. E-03	11/04	LT. 3. E-02
10/31	11/07	1.02E 04	CU. FT.	2.7 ± 0.3 E-02	2.1 ± 1.3 E-03	11/10	LT. 2. E-02
11/07	11/14	9.93E 03	CU. FT.	3.4 ± 0.4 E-02	L. T. 2. E-03	11/19	LT. 3. E-02
11/14	11/21	9.73E 03	CU. FT.	2.9 ± 0.4 E-02	L. T. 1. E-03	11/23	LT. 2. E-02
11/21	11/28	1.00E 04	CU. FT.	2.8 ± 0.3 E-02	3.1 ± 1.6 E-03	11/30	LT. 2. E-02
11/28	12/05	1.00E 04	CU. FT.	1.8 ± 0.3 E-02	2.4 ± 1.4 E-03	12/07	LT. 2. E-02
12/05	12/12	1.01E 04	CU. FT.	1.7 ± 0.3 E-02	2.4 ± 1.5 E-03	12/14	LT. 2. E-02
12/12	12/18	8.60E 03	CU. FT.	4.2 ± 0.5 E-02	4.0 ± 1.8 E-03	12/27	LT. 3. E-02
12/18	12/26	1.21E 04	CU. FT.	2.5 ± 0.3 E-02	L.T. 2. E-03	12/29	LT. 2. E-02
12/26	01/02	9.60E 03	CU. FT.	5.2 ± 0.4 E-02	2.1 ± 1.4 E-03	01/04	LT. 2. E-02

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 08

STATION 08 - 2.5 Mi. 260 DEG. IND.

COLL. TIME START STOP DATE DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
01/03 01/10	1.04E 04	CU. FT.	3.4 ± 0.3	E-02	2.4 ± 1.2	E-03	01/14	LT.	2.	E-02
01/10 01/17	1.01E 04	CU. FT.	3.1 ± 0.3	E-02	2.0 ± 1.3	E-03	01/21	LT.	4.	E-02
01/17 01/24	9.70E 03	CU. FT.	2.4 ± 0.3	E-02	2.9 ± 1.4	E-03	01/26	LT.	2.	E-02
01/24 01/31	1.05E 04	CU. FT.	5.1 ± 0.4	E-02	5.7 ± 1.8	E-03	02/04	LT.	1.	E-02
01/31 02/07	9.95E 03	CU. FT.	2.5 ± 0.3	E-02	2.4 ± 1.3	E-03	02/11	LT.	3.	E-02
02/07 02/14	1.01E 04	CU. FT.	2.0 ± 0.3	E-02	2.1 ± 1.2	E-03	02/19	LT.	2.	E-02
02/14 02/21	1.03E 04	CU. FT.	2.1 ± 0.3	E-02	1.1 ± 0.9	E-03	02/25	LT.	2.	E-02
02/21 02/28	9.58E 03	CU. FT.	2.1 ± 0.3	E-02	1.7 ± 1.1	E-03	03/04	LT.	3.	E-02
02/28 03/07	1.07E 04	CU. FT.	3.2 ± 0.3	E-02	1.5 ± 1.0	E-03	03/12	LT.	3.	E-02
03/07 03/14	9.77E 03	CU. FT.	2.3 ± 0.3	E-02	L.T. 2.	E-03	03/18	LT.	2.	E-02
03/14 03/21	9.98E 03	CU. FT.	1.7 ± 0.3	E-02	L.T. 1.	E-03	03/24	LT.	2.	E-02
03/21 03/28	9.88E 03	CU. FT.	9.8 ± 2.6	E-03	L.T. 1.	E-03	03/30	LT.	3.	E-02
03/28 04/04	1.06E 04	CU. FT.	1.8 ± 0.3	E-02	2.2 ± 1.2	E-03	04/09	LT.	2.	E-02
04/04 04/11	9.96E 03	CU. FT.	1.8 ± 0.3	E-02	1.2 ± 1.0	E-03	04/15	LT.	3.	E-02
04/11 04/18	9.73E 03	CU. FT.	1.9 ± 0.3	E-02	1.5 ± 1.2	E-03	04/22	LT.	3.	E-02
04/18 04/25	1.01E 04	CU. FT.	1.1 ± 0.3	E-02	L.T. 2.	E-03	05/01	LT.	4.	E-02
04/25 05/02	9.90E 03	CU. FT.	1.6 ± 0.3	E-02	L.T. 2.	E-03	05/10	LT.	5.	E-02
05/02 05/09	9.90E 03	CU. FT.	1.1 ± 0.2	E-02	2.2 ± 1.2	E-03	05/16	LT.	5.	E-02
05/09 05/16	1.01E 04	CU. FT.	1.2 ± 0.2	E-02	L.T. 1.	E-03	05/19	LT.	4.	E-02
05/16 05/23	1.01E 04	CU. FT.	1.2 ± 0.3	E-02	1.5 ± 1.1	E-03	05/26	LT.	2.	E-02
05/23 05/30	1.00E 04	CU. FT.	0.91 ± 0.24	E-02	L.T. 0.9	E-03	06/02	LT.	3.	E-02
05/30 06/06	1.01E 04	CU. FT.	1.5 ± 0.3	E-02	L.T. 2.	E-03	06/09	LT.	2.	E-02
06/06 06/13	1.01E 04	CU. FT.	1.5 ± 0.3	E-02	1.2 ± 1.0	E-03	06/18	LT.	3.	E-02
06/13 06/20	9.20E 03	CU. FT.	3.6 ± 0.4	E-02	2.0 ± 1.4	E-03	06/25	LT.	3.	E-02
06/20 06/27	1.01E 04	CU. FT.	2.7 ± 0.3	E-02	1.7 ± 1.1	E-03	07/02	LT.	3.	E-02
06/27 07/05	8.70E 03	CU. FT.	2.3 ± 0.3	E-02	4.8 ± 1.9	E-03	07/12	LT.	4.	E-02
07/05 07/11	8.84E 03	CU. FT.	2.6 ± 0.3	E-02	L.T. 2.	E-03	07/15	LT.	4.	E-02
07/11 07/18	9.81E 03	CU. FT.	2.3 ± 0.3	E-02	L.T. 2.	E-03	07/22	LT.	2.	E-02
07/18 07/25	9.81E 03	CU. FT.	2.0 ± 0.3	E-02	L.T. 1.	E-03	07/27	LT.	2.	E-02
07/25 08/01	*									
08/01 08/08	9.82E 03	CU. FT.	1.8 ± 0.3	E-02	2.2 ± 1.5	E-03	08/10	LT.	2.	E-02
08/08 08/15	1.01E 04	CU. FT.	3.4 ± 0.3	E-02	3.2 ± 1.6	E-03	08/18	LT.	3.	E-02

\*Analyze for total activity only.

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 08

STATION 08 - 2.5 MI. 260 DEG. IND.

COLL. TIME		VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
START DATE	STOP DATE							DATE TIME			
08/15	08/22	1.07E 04	CU. FT.	3.0 ± 0.3	E-02	1.9 ± 1.2	E-03	08/27	L.T.	2.	E-02
08/22	08/29	9.97E 03	CU. FT.	6.0 ± 0.4	E-02	3.4 ± 1.6	E-03	09/01	L.T.	3.	E-02
08/29	09/05	1.01E 04	CU. FT.	5.0 ± 0.4	E-02	2.2 ± 1.3	E-03	09/08	L.T.	2.	E-02
09/05	09/12	9.99E 03	CU. FT.	3.6 ± 0.4	E-02	3.1 ± 1.4	E-03	09/18	L.T.	3.	E-02
09/12	09/19	1.01E 04	CU. FT.	3.0 ± 0.3	E-02	L.T. 2.	E-03	09/22	L.T.	2.	E-02
09/19	09/26	1.01E 04	CU. FT.	2.2 ± 0.3	E-02	L.T. 2.	E-03	10/01	L.T.	3.	E-02
09/26	10/03	9.97E 03	CU. FT.	4.9 ± 0.4	E-02	4.3 ± 1.7	E-03	10/07	L.T.	3.	E-02
10/03	10/10	1.02E 04	CU. FT.	2.9 ± 0.3	E-02	1.7 ± 1.2	E-03	10/13	L.T.	2.	E-02
10/10	10/17	1.00E 04	CU. FT.	3.9 ± 0.4	E-02	4.0 ± 1.8	E-03	11/07	L.T.	5.	E-02
10/17	10/24	1.01E 04	CU. FT.	2.6 ± 0.3	E-02	L.T. 2.	E-03	10/28	L.T.	3.	E-02
10/24	10/31	1.00E 04	CU. FT.	1.4 ± 0.3	E-02	L.T. 2.	E-03	11/04	L.T.	3.	E-02
10/31	11/07	1.03E 04	CU. FT.	2.1 ± 0.3	E-02	2.7 ± 1.4	E-03	11/10	L.T.	2.	E-02
11/07	11/14	9.91E 03	CU. FT.	2.9 ± 0.3	E-02	L.T. 2.	E-03	11/19	L.T.	3.	E-02
11/14	11/21	9.83E 03	CU. FT.	3.5 ± 0.4	E-02	L.T. 1.	E-03	11/23	L.T.	2.	E-02
11/21	11/28	1.01E 04	CU. FT.	3.7 ± 0.4	E-02	L.T. 1.	E-03	11/30	L.T.	2.	E-02
11/28	12/05	1.00E 04	CU. FT.	2.6 ± 0.3	E-02	L.T. 1.	E-03	12/07	L.T.	2.	E-02
12/05	12/12	1.01E 04	CU. FT.	2.7 ± 0.4	E-02	L.T. 1.	E-03	12/14	L.T.	2.	E-02
12/12	12/18	8.60E 03	CU. FT.	5.6 ± 0.5	E-02	4.2 ± 1.8	E-03	12/27	L.T.	3.	E-02
12/18	12/26	1.20E 04	CU. FT.	3.2 ± 0.3	E-02	2.5 ± 1.5	E-03	12/29	L.T.	2.	E-02
12/26	01/02	9.45E 03	CU. FT.	4.6 ± 0.4	E-02	2.7 ± 1.6	E-03	01/04	L.T.	2.	E-02

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 09

STATION 09 - 7.25 MI. 335 DEG. IND.

COLL. TIME START STOP DATE DATE	VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME DATE TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
01/03 01/10	1.03E 04	CU. FT.	3.8 ± 0.4	E-02	1.6 ± 1.1	E-03	01/14	LT. 2.	E-02	
01/10 01/17	9.97E 03	CU. FT.	3.7 ± 0.4	E-02	1.7 ± 1.2	E-03	01/21	LT. 4.	E-02	
01/17 01/24	9.91E 03	CU. FT.	2.6 ± 0.3	E-02	1.8 ± 1.2	E-03	01/26	LT. 2.	E-02	
01/24 01/31	1.03E 04	CU. FT.	3.8 ± 0.4	E-02	2.9 ± 1.3	E-03	02/04	LT. 1.	E-02	
01/31 02/07	9.91E 03	CU. FT.	2.0 ± 0.3	E-02	1.8 ± 1.1	E-03	02/11	LT. 3.	E-02	
02/07 02/14	1.01E 04	CU. FT.	2.1 ± 0.3	E-02	1.5 ± 1.1	E-03	02/19	LT. 2.	E-02	
02/14 02/21	1.03E 04	CU. FT.	2.5 ± 0.3	E-02	1.8 ± 1.1	E-03	02/25	LT. 2.	E-02	
02/21 02/28	9.62E 03	CU. FT.	1.8 ± 0.3	E-02	1.7 ± 1.1	E-03	03/04	LT. 3.	E-02	
02/28 03/07	1.06E 04	CU. FT.	3.2 ± 0.3	E-02	1.9 ± 1.0	E-03	03/12	LT. 3.	E-02	
03/07 03/14	9.75E 03	CU. FT.	2.1 ± 0.3	E-02	LT. 2.	E-03	03/18	LT. 2.	E-02	
03/14 03/21	9.95E 03	CU. FT.	1.5 ± 0.3	E-02	LT. 1.	E-03	03/24	LT. 2.	E-02	
03/21-03/28	9.98E 03	CU. FT.	1.3 ± 0.3	E-02	1.5 ± 1.2	E-03	03/30	LT. 3.	E-02	
03/28 04/04	1.05E 04	CU. FT.	1.9 ± 0.3	E-02	1.5 ± 1.0	E-03	04/09	LT. 2.	E-02	
04/04 04/11	9.94E 03	CU. FT.	2.0 ± 0.3	E-02	1.4 ± 1.0	E-03	04/15	LT. 3.	E-02	
04/11 04/18	9.88E 03	CU. FT.	1.3 ± 0.2	E-02	LT. 1.	E-03	04/22	LT. 3.	E-02	
04/18 04/25	1.02E 04	CU. FT.	1.3 ± 0.3	E-02	1.8 ± 1.4	E-03	05/01	LT. 4.	E-02	
04/25 05/02	9.94E 03	CU. FT.	1.5 ± 0.3	E-02	LT. 2.	E-03	05/10	LT. 5.	E-02	
05/02 05/09	9.90E 03	CU. FT.	1.6 ± 0.3	E-02	1.8 ± 1.1	E-03	05/16	LT. 5.	E-02	
05/09 05/16	1.01E 04	CU. FT.	1.2 ± 0.2	E-02	LT. 1.	E-03	05/19	LT. 4.	E-02	
05/16 05/23	1.01E 04	CU. FT.	1.6 ± 0.3	E-02	1.4 ± 1.0	E-03	05/26	LT. 2.	E-02	
05/23 05/30	1.01E 04	CU. FT.	0.83±0.23	E-02	LT. 0.9	E-03	06/02	LT. 3.	E-02	
05/30 06/06	1.01E 04	CU. FT.	1.3 ± 0.3	E-02	LT. 2.	E-03	06/09	LT. 2.	E-02	
06/06 06/13	1.01E 04	CU. FT.	1.4 ± 0.3	E-02	LT. 1.	E-03	06/18	LT. 3.	E-02	
06/13 06/20	1.03E 04	CU. FT.	2.8 ± 0.3	E-02	3.0 ± 1.5	E-03	06/25	LT. 3.	E-02	
06/20 06/27	9.90E 03	CU. FT.	2.0 ± 0.3	E-02	2.1 ± 1.2	E-03	07/02	LT. 3.	E-02	
06/27 07/05	1.10E 04	CU. FT.	1.2 ± 0.2	E-02	2.8 ± 1.3	E-03	07/12	LT. 4.	E-02	
07/05 07/11	8.77E 03	CU. FT.	2.2 ± 0.3	E-02	1.8 ± 1.4	E-03	07/15	LT. 4.	E-02	
07/11 07/18	1.00E 04	CU. FT.	2.7 ± 0.3	E-02	2.3 ± 1.5	E-03	07/22	LT. 2.	E-02	
07/18 07/25	5.07E 03	CU. FT.	1.8 ± 0.3	E-02	LT. 2.	E-03	07/27	LT. 3.	E-02	
07/25 08/01	*									
08/03 08/08	7.21E 03	CU. FT.	1.8 ± 0.3	E-02	2.8 ± 2.1	E-03	08/10	LT. 2.	E-02	
08/08 08/15	1.01E 04	CU. FT.	2.5 ± 0.3	E-02	3.3 ± 1.6	E-03	08/18	LT. 3.	E-02	

\*Sample not collected - not running at collection time.

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 09

STATION 09 - 7.25 MI. 335 DEG. IND.

COLL. TIME		VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
START DATE	STOP DATE							DATE TIME			
08/15	08/22	1.07E 04	CU. FT.	1.5 ± 0.3	E-02	2.0 ± 1.3	E-03	08/27	LT. 2.	E-02	
08/22	08/29	9.93E 03	CU. FT.	4.1 ± 0.4	E-02	L.T. 2.	E-03	09/01	LT. 3.	E-02	
08/29	09/05	1.01E 04	CU. FT.	3.7 ± 0.4	E-02	4.0 ± 1.6	E-03	09/08	LT. 2.	E-02	
09/05	09/12	1.00E 04	CU. FT.	2.3 ± 0.3	E-02	2.1 ± 1.3	E-03	09/18	LT. 3.	E-02	
09/12	09/19	1.01E 04	CU. FT.	2.7 ± 0.3	E-02	L.T. 2.	E-03	09/22	LT. 2.	E-02	
09/19	09/26	1.01E 04	CU. FT.	2.4 ± 0.3	E-02	L.T. 2.	E-03	10/01	LT. 3.	E-02	
09/26	10/03	9.97E 03	CU. FT.	3.7 ± 0.4	E-02	2.1 ± 1.4	E-03	10/07	LT. 3.	E-02	
10/03	10/10	1.02E 04	CU. FT.	2.2 ± 0.3	E-02	L.T. 1.	E-03	10/13	LT. 2.	E-02	
10/10	10/17	1.00E 04	CU. FT.	2.7 ± 0.3	E-02	L.T. 2.	E-03	11/07	LT. 6.	E-02	
10/17	10/24	1.01E 04	CU. FT.	1.6 ± 0.3	E-02	L.T. 2.	E-03	10/28	LT. 3.	E-02	
10/24	10/31	1.00E 04	CU. FT.	1.5 ± 0.3	E-02	L.T. 2.	E-03	11/04	LT. 3.	E-02	
10/31	11/07	1.03E 04	CU. FT.	3.0 ± 0.3	E-02	1.8 ± 1.2	E-03	11/10	LT. 2.	E-02	
11/07	11/14	9.88E 03	CU. FT.	3.3 ± 0.4	E-02	L.T. 2.	E-03	11/19	LT. 3.	E-02	
11/14	11/21	9.88E 03	CU. FT.	3.7 ± 0.4	E-02	1.6 ± 1.2	E-03	11/23	LT. 2.	E-02	
11/21	11/28	1.01E 04	CU. FT.	3.3 ± 0.4	E-02	1.9 ± 1.4	E-03	11/30	LT. 2.	E-02	
11/28	12/05	1.00E 04	CU. FT.	2.7 ± 0.4	E-02	2.7 ± 1.5	E-03	12/07	LT. 2.	E-02	
12/05	12/12	1.01E 04	CU. FT.	2.2 ± 0.3	E-02	1.6 ± 1.3	E-03	12/14	LT. 2.	E-02	
12/12	12/18	8.60E 03	CU. FT.	4.5 ± 0.5	E-02	2.8 ± 1.5	E-03	12/27	LT. 3.	E-02	
12/18	12/26	1.12E 04	CU. FT.	1.9 ± 0.3	E-02	2.0 ± 1.4	E-03	12/29	LT. 2.	E-02	
12/26	01/02	9.19E 03	CU. FT.	4.3 ± 0.4	E-02	L.T. 2.	E-03	01/04	LT. 2.	E-02	

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 AIR PARTICULATE & CHARCOAL FILTERS

STATION NUMBER 10

STATION 10 - 10.0 MI. 160 DEG. IND

COLL. TIME		VOLUME	UNITS	AP FILTER		AP FILTER		MID-COUNT	CHARCOAL FILTER	
START DATE	STOP DATE			GROSS BETA (PCI/CU.M.)	E-02	GROSS ALPHA (PCI/CU.M.)	E-03	TIME DATE	1-131 (PCI/CU. M.)	
01/03	01/10	1.04E 04	CU. FT.	3.5 ± 0.3	E-02	2.2 ± 1.2	E-03	01/14	LT. 1.	E-02
01/10	01/17	1.01E 04	CU. FT.	3.0 ± 0.3	E-02	LT. 1.	E-03	01/21	LT. 2.	E-02
01/17	01/23	8.62E 03	CU. FT.	2.3 ± 0.3	E-02	LT. 1.	E-03	01/26	LT. 1.	E-02
01/23	01/31	1.15E 04	CU. FT.	4.5 ± 0.4	E-02	3.0 ± 1.3	E-03	02/04	LT. 1.	E-02
01/31	02/07	1.01E 04	CU. FT.	1.9 ± 0.3	E-02	1.1 ± 0.9	E-03	02/11	LT. 2.	E-02
02/07	02/14	1.01E 04	CU. FT.	2.2 ± 0.3	E-02	2.3 ± 1.3	E-03	02/19	LT. 2.	E-02
02/14	02/21	1.01E 04	CU. FT.	2.2 ± 0.3	E-02	1.4 ± 1.0	E-03	02/25	LT. 1.	E-02
02/21	02/28	9.69E 03	CU. FT.	1.3 ± 0.2	E-02	LT. 1.	E-03	03/04	LT. 2.	E-02
02/28	03/07	1.03E 04	CU. FT.	2.6 ± 0.3	E-02	2.1 ± 1.1	E-03	03/12	LT. 2.	E-02
03/07	03/14	1.02E 04	CU. FT.	2.0 ± 0.3	E-02	LT. 2.	E-03	03/18	LT. 1.	E-02
03/14	03/21	9.82E 03	CU. FT.	1.6 ± 0.3	E-02	2.0 ± 1.3	E-03	03/24	LT. 2.	E-02
03/21	03/28	9.79E 03	CU. FT.	1.2 ± 0.3	E-02	1.4 ± 1.2	E-03	03/30	LT. 2.	E-02
03/28	04/04	1.04E 04	CU. FT.	2.0 ± 0.3	E-02	1.7 ± 1.1	E-03	04/09	LT. 2.	E-02
04/04	04/11	1.02E 04	CU. FT.	1.4 ± 0.3	E-02	1.7 ± 1.1	E-03	04/15	LT. 1.	E-02
04/11	04/18	9.88E 03	CU. FT.	1.2 ± 0.2	E-02	LT. 1.	E-03	04/22	LT. 2.	E-02
04/18	04/25	1.02E 04	CU. FT.	1.0 ± 0.2	E-02	LT. 2.	E-03	05/01	LT. 3.	E-02
04/25	05/02	9.25E 03	CU. FT.	1.6 ± 0.3	E-02	LT. 2.	E-03	05/10	LT. 4.	E-02
05/02	05/09	9.90E 03	CU. FT.	1.4 ± 0.3	E-02	LT. 9	E-03	05/16	LT. 3.	E-02
05/09	05/16	1.01E 04	CU. FT.	.97 ± .24	E-02	LT. 1.	E-03	05/19	LT. 2.	E-02
05/16	05/23	1.01E 04	CU. FT.	1.6 ± 0.3	E-02	1.5 ± 1.1	E-03	05/26	LT. 1.	E-02
05/23	05/30	1.00E 04	CU. FT.	0.88±0.23	E-02	LT. 0.9	E-03	06/02	LT. 2.	E-02
05/30	06/06	1.01E 04	CU. FT.	1.8 ± 0.3	E-02	LT. 2.	E-03	06/09	LT. 2.	E-02
06/06	06/13	1.01E 04	CU. FT.	1.3 ± 0.2	E-02	LT. 1.	E-03	06/18	LT. 2.	E-02
06/13	06/20	1.02E 04	CU. FT.	3.1 ± 0.3	E-02	3.0 ± 1.5	E-03	06/25	LT. 2.	E-02
06/20	06/27	1.01E 04	CU. FT.	2.4 ± 0.3	E-02	3.0 ± 1.3	E-03	07/02	LT. 2.	E-02
06/27	07/05	1.11E 04	CU. FT.	1.8 ± 0.3	E-02	LT. 2.	E-03	07/12	LT. 2.	E-02
07/05	07/11	8.95E 03	CU. FT.	2.1 ± 0.3	E-02	2.1 ± 1.5	E-03	07/15	LT. 3.	E-02
07/11	07/18	9.53E 03	CU. FT.	2.6 ± 0.3	E-02	LT. 2.	E-03	07/22	LT. 1.	E-02
07/18	07/25	9.80E 03	CU. FT.	2.3 ± 0.3	E-02	LT. 1.	E-03	07/27	LT. 1.	E-02
07/25	08/01	1.02E 04	CU. FT.	2.4 ± 0.4	E-02	1.2 ± 1.1	E-03	08/05	LT. 3.	E-02
08/01	08/08	9.84E 03	CU. FT.	1.5 ± 0.3	E-02	LT. 2.	E-03	08/10	LT. 1.	E-02
08/08	08/15	1.01E 04	CU. FT.	2.4 ± 0.3	E-02	2.4 ± 1.4	E-03	08/18	LT. 2.	E-02
08/15	08/22	1.07E 04	CU. FT.	2.0 ± 0.3	E-02	2.1 ± 1.3	E-03	08/27	LT. 2.	E-02

**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - AIRBORNE  
AIR PARTICULATE & CHARCOAL FILTERS**

STATION NUMBER 10

STATION 10 - 10.0 MI. 160 DEG. IND

COLL. TIME		VOLUME	UNITS	AP FILTER GROSS BETA (PCI/CU.M.)		AP FILTER GROSS ALPHA (PCI/CU.M.)		MID-COUNT TIME	CHARCOAL FILTER I-131 (PCI/CU. M.)		
START DATE	STOP DATE			DATE	TIME	DATE	TIME	DATE	TIME	DATE	TIME
08/22	08/29	1.00E 04	CU. FT.	4.5 ± 0.4	E-02	2.5 ± 1.7	E-03	09/01	LT.	2.	E-02
08/29	09/05	1.01E 04	CU. FT.	4.3 ± 0.4	E-02	3.2 ± 1.5	E-03	09/08	LT.	1.	E-02
09/05	09/12	1.00E 04	CU. FT.	2.9 ± 0.3	E-02	2.7 ± 1.4	E-03	09/18	LT.	2.	E-02
09/12	09/19	1.01E 04	CU. FT.	2.9 ± 0.3	E-02	1.8 ± 1.1	E-03	09/22	LT.	1.	E-02
09/19	09/26	1.01E 04	CU. FT.	2.6 ± 0.3	E-02	L.T. 2.	E-03	10/01	LT.	2.	E-02
09/26	10/03	9.97E 03	CU. FT.	3.8 ± 0.4	E-02	1.7 ± 1.3	E-03	10/07	LT.	2.	E-02
10/03	10/10	1.02E 04	CU. FT.	2.6 ± 0.3	E-02	1.6 ± 1.2	E-03	10/13	LT.	2.	E-02
10/10	10/17	1.00E 04	CU. FT.	3.5 ± 0.4	E-02	3.3 ± 1.7	E-03	11/05	LT.	5.	E-02
10/17	10/24	1.00E 04	CU. FT.	1.8 ± 0.3	E-02	1.9 ± 1.4	E-03	10/28	LT.	2.	E-02
10/24	10/31	1.00E 04	CU. FT.	1.7 ± 0.3	E-02	L. T. 2.	E-03	11/04	LT.	2.	E-02
10/31	11/07	1.02E 04	CU. FT.	3.1 ± 0.4	E-02	2.3 ± 1.4	E-03	11/10	LT.	2.	E-02
11/07	11/14	9.92E 03	CU. FT.	3.5 ± 0.4	E-02	L.T. 2.	E-03	11/19	LT.	2.	E-02
11/14	11/21	9.78E 03	CU. FT.	3.2 ± 0.4	E-02	1.6 ± 1.2	E-03	11/23	LT.	1.	E-02
11/21	11/28	1.00E 04	CU. FT.	2.8 ± 0.3	E-02	1.8 ± 1.3	E-03	11/30	LT.	1.	E-02
11/28	12/05	1.00E 04	CU. FT.	2.5 ± 0.3	E-02	2.3 ± 1.4	E-03	12/07	LT.	2.	E-02
12/05	12/12	1.01E 04	CU. FT.	2.4 ± 0.3	E-02	2.7 ± 1.5	E-03	12/14	LT.	1.	E-02
12/12	12/18	8.60E 03	CU. FT.	4.7 ± 0.5	E-02	4.2 ± 1.8	E-03	12/27	LT.	2.	E-02
12/18	12/26	1.21E 04	CU. FT.	2.7 ± 0.3	E-02	2.1 ± 1.4	E-03	12/29	LT.	1.	E-02
12/26	01/02	9.59E 03	CU. FT.	4.1 ± 0.4	E-02	L.T. 2.	E-03	01/04	LT.	1.	E-02

**D. QUARTERLY COMPOSITES OF AIR PARTICULATE FILTERS**  
**STATIONS 01-10**



NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE AIR PARTICULATE FILTERS  
 (PCI/CU. M.)  
 STATION NUMBER 01  
 STATION 01 - 0.1 MI. 225 DEG. IND.

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.08±0.11 E-01	1.74±0.17 E-01	1.51±0.15 E-01	9.15±1.15 E-02
K-40	LT. 9. E-03	LT. 9. E-03	LT. 8. E-03	LT. 1. E-02
MN-54	LT. 6. E-04	LT. 6. E-04	LT. 5. E-04	LT. 5. E-04
CO-58	LT. 8. E-04	LT. 9. E-04	LT. 8. E-04	LT. 8. E-04
FE-59	LT. 3. E-03	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03
CO-60	LT. 6. E-04	LT. 7. E-04	LT. 5. E-04	LT. 4. E-04
ZN-65	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03
ZR-95	LT. 9. E-04	LT. 9. E-04	LT. 1. E-03	LT. 8. E-04
RU-103	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03
RU-106	LT. 4. E-03	LT. 5. E-03	LT. 5. E-03	LT. 5. E-03
I-131	LT. 1. E-01	LT. 8. E-02	LT. 1. E-01	LT. 9. E-02
CS-134	LT. 5. E-04	LT. 7. E-04	LT. 5. E-04	LT. 6. E-04
CS-137	LT. 7. E-04	LT. 6. E-04	LT. 6. E-04	LT. 6. E-04
BA-140	LT. 2. E-02	LT. 2. E-02	LT. 2. E-02	LT. 1. E-02
CE-141	LT. 2. E-03	LT. 3. E-03	LT. 2. E-03	LT. 2. E-03
CE-144	LT. 3. E-03	LT. 3. E-03	LT. 3. E-03	LT. 3. E-03
RA-226	LT. 9. E-03	LT. 1. E-02	LT. 9. E-03	LT. 9. E-03
TH-228	LT. 9. E-04	LT. 1. E-03	LT. 8. E-04	LT. 1. E-03

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - AIRBORNE**  
**COMPOSITE AIR PARTICULATE FILTERS**  
 (PCI/CU. M.)  
**STATION NUMBER 02**  
**STATION 02 - 0.75 MI. 225 DEG. IND.**

DATE COLLECTED	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
GAMMA SPECTRAL ANALYSIS:				
BE-7	1.01±0.10 E-01	1.81±0.18 E-01	1.60±0.16 E-01	8.79±0.92 E-02
K-40	L.T. 9. E-03	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
MN-54	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04
CO-58	L.T. 7. E-04	L.T. 9. E-04	L.T. 8. E-04	L.T. 9. E-04
FE-59	L.T. 3. E-03	L.T. 2. E-03	L.T. 3. E-03	L.T. 2. E-03
CO-60	L.T. 5. E-04	L.T. 4. E-04	L.T. 4. E-04	L.T. 6. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 8. E-04	L.T. 9. E-04	L.T. 9. E-04	L.T. 8. E-04
RU-103	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
RU-106	L.T. 4. E-03	L.T. 4. E-03	L.T. 5. E-03	L.T. 5. E-03
I-131	L.T. 1. E-01	L.T. 8. E-02	L.T. 1. E-01	L.T. 8. E-02
CS-134	L.T. 4. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04
CS-137	L.T. 6. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04
BA-140	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02
CE-141	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03
CE-144	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03
RA-226	L.T. 7. E-03	L.T. 9. E-03	L.T. 6. E-03	L.T. 6. E-03
TH-228	L.T. 7. E-04	L.T. 9. E-04	L.T. 6. E-04	L.T. 7. E-04

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE AIR PARTICULATE FILTERS  
 (PCI/CU. M.)  
 STATION NUMBER 03  
 STATION 03 - 2.5 MI. 338 DEG. IND.

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.10±0.16 E-01	1.58±0.16 E-01	1.35±0.14 E-01	9.16±1.01 E-02
K-40	L.T. 2. E-02	9.31±5.40 E-03	L.T. 2. E-02	L.T. 2. E-02
MN-54	L.T. 1. E-03	L.T. 7. E-04	L.T. 5. E-04	L.T. 6. E-04
CO-58	L.T. 1. E-03	L.T. 1. E-03	L.T. 8. E-04	L.T. 8. E-04
FE-59	L.T. 4. E-03	L.T. 3. E-03	L.T. 3. E-03	L.T. 3. E-03
CO-60	L.T. 9. E-04	L.T. 7. E-04	L.T. 6. E-04	L.T. 6. E-04
ZN-65	L.T. 2. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 2. E-03	L.T. 1. E-03	L.T. 9. E-04	L.T. 1. E-03
RU-103	L.T. 3. E-03	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03
RU-106	L.T. 9. E-03	L.T. 7. E-03	L.T. 5. E-03	L.T. 5. E-03
I-131	L.T. 2. E-01	L.T. 9. E-02	L.T. 1. E-01	L.T. 9. E-02
CS-134	L.T. 9. E-04	L.T. 7. E-04	L.T. 6. E-04	L.T. 6. E-04
CS-137	L.T. 9. E-04	L.T. 6. E-04	L.T. 6. E-04	L.T. 6. E-04
BA-140	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CE-141	L.T. 4. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03
CE-144	L.T. 6. E-03	L.T. 3. E-03	L.T. 3. E-03	L.T. 3. E-03
RA-226	L.T. 1. E-02	L.T. 9. E-03	L.T. 8. E-03	L.T. 8. E-03
TH-228	L.T. 1. E-03	L.T. 8. E-04	L.T. 7. E-04	L.T. 7. E-04

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE AIR PARTICULATE FILTERS  
 (PCI/CU. M.)  
 STATION NUMBER 04  
 STATION 04 - 3.0 MI. 43 DEG. IND.

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.50±0.15 E-01	1.61±0.16 E-01	2.20±0.22 E-01	9.42±1.06 E-02
K-40	L.T. 1. E-02	L.T. 2. E-02	L.T. 6. E-03	L.T. 7. E-03
MN-54	L.T. 6. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 4. E-04
CO-58	L.T. 1. E-03	L.T. 1. E-03	L.T. 6. E-04	L.T. 6. E-04
FE-59	L.T. 3. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03
CO-60	L.T. 5. E-04	L.T. 6. E-04	L.T. 5. E-04	L.T. 5. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 1. E-03	L.T. 9. E-04	L.T. 6. E-04	L.T. 7. E-04
RU-103	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
RU-106	L.T. 6. E-03	L.T. 5. E-03	L.T. 3. E-03	L.T. 4. E-03
I-131	L.T. 1. E-01	L.T. 8. E-02	L.T. 9. E-02	L.T. 7. E-02
CS-134	L.T. 6. E-04	L.T. 7. E-04	L.T. 4. E-04	L.T. 5. E-04
CS-137	L.T. 6. E-04	L.T. 6. E-04	L.T. 4. E-04	L.T. 3. E-04
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
CE-141	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03
CE-144	L.T. 4. E-03	L.T. 3. E-03	L.T. 2. E-03	L.T. 3. E-03
RA-226	L.T. 1. E-02	L.T. 9. E-03	L.T. 7. E-03	L.T. 8. E-03
TH-228	L.T. 1. E-03	L.T. 8. E-04	L.T. 7. E-04	L.T. 7. E-04

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE AIR PARTICULATE FILTERS  
 (PCI/CU. M.)  
 STATION NUMBER 05  
 STATION 05 - 3.5 MI. 102 DEG. IND.

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.52±0.15 E-01	1.72±0.17 E-01	1.71±0.17 E-01	8.89±0.91 E-02
K-40	3.08±0.64 E-02	LT. 7. E-03	LT. 1. E-02	3.82±0.55 E-02
MN-54	LT. 7. E-04	LT. 4. E-04	LT. 5. E-04	LT. 5. E-04
CO-58	LT. 1. E-03	LT. 6. E-04	LT. 7. E-04	LT. 7. E-04
FE-59	LT. 3. E-03	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03
CO-60	LT. 6. E-04	LT. 5. E-04	LT. 5. E-04	LT. 5. E-04
ZN-65	LT. 2. E-03	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03
ZR-95	LT. 1. E-03	LT. 6. E-04	LT. 7. E-04	LT. 8. E-04
RU-103	LT. 2. E-03	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03
RU-106	LT. 6. E-03	LT. 4. E-03	LT. 4. E-03	LT. 4. E-03
I-131	LT. 1. E-01	LT. 7. E-02	LT. 1. E-01	LT. 7. E-02
CS-134	LT. 7. E-04	LT. 5. E-04	LT. 4. E-04	LT. 5. E-04
CS-137	LT. 6. E-04	LT. 4. E-04	LT. 4. E-04	LT. 5. E-04
BA-140	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 1. E-02
CE-141	LT. 3. E-03	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03
CE-144	LT. 3. E-03	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03
RA-226	LT. 9. E-03	LT. 8. E-03	LT. 6. E-03	LT. 6. E-03
TH-228	LT. 9. E-04	LT. 7. E-04	LT. 6. E-04	LT. 6. E-04

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - AIRBORNE**  
**COMPOSITE AIR PARTICULATE FILTERS**  
 (PCI/CU. M.)  
**STATION NUMBER 06**  
**STATION 06 - 3.0 MI. 165 DEG. IND.**

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
<b>GAMMA SPECTRUM ANALYSIS:</b>				
BE-7	1.23±0.14 E-01	1.32±0.13 E-01	1.68±0.17 E-01	1.22±0.13 E-01
K-40	L.T. 1. E-02	4.64±0.62 E-02	L.T. 9. E-03	L.T. 1. E-02
MN-54	L.T. 6. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04
CO-58	L.T. 1. E-03	L.T. 8. E-04	L.T. 7. E-04	L.T. 7. E-04
FE-59	L.T. 4. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03
CO-60	L.T. 5. E-04	L.T. 5. E-04	L.T. 6. E-04	L.T. 5. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 1. E-03	L.T. 9. E-04	L.T. 7. E-04	L.T. 8. E-04
RU-103	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
RU-106	L.T. 6. E-03	L.T. 4. E-03	L.T. 4. E-03	L.T. 4. E-03
I-131	L.T. 1. E-01	L.T. 6. E-02	L.T. 1. E-01	L.T. 9. E-02
CS-134	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 6. E-04
CS-137	L.T. 6. E-04	L.T. 5. E-04	L.T. 5. E-04	L.T. 5. E-04
BA-140	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02
CE-141	L.T. 3. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 3. E-03
CE-144	L.T. 4. E-03	L.T. 2. E-03	L.T. 3. E-03	L.T. 4. E-03
RA-226	L.T. 1. E-02	L.T. 7. E-03	L.T. 9. E-03	L.T. 1. E-02
TH-228	L.T. 1. E-03	L.T. 6. E-04	L.T. 9. E-04	L.T. 9. E-04

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE AIR PARTICULATE FILTERS  
 (PC1/CU. M.)  
 STATION NUMBER 07  
 STATION 07 - 2.5 MI. 230 DEG. IND.

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.03±0.12 E-01	1.84±0.18 E-01	1.41±0.14 E-01	8.94±1.00 E-02
K-40	L.T. 8. E-03	L.T. 9. E-03	L.T. 2. E-02	7.67±3.95 E-03
MN-54	L.T. 5. E-04	L.T. 5. E-04	L.T. 7. E-04	L.T. 5. E-04
CO-58	L.T. 7. E-04	L.T. 8. E-04	L.T. 1. E-03	L.T. 7. E-04
FE-59	L.T. 3. E-03	L.T. 2. E-03	L.T. 3. E-03	L.T. 2. E-03
CO-60	L.T. 6. E-04	L.T. 6. E-04	L.T. 5. E-04	L.T. 5. E-04
ZN-65	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
ZR-95	L.T. 9. E-04	L.T. 8. E-04	L.T. 1. E-03	L.T. 7. E-04
RU-103	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 1. E-03
RU-106	L.T. 5. E-03	L.T. 5. E-03	L.T. 6. E-03	L.T. 4. E-03
I-131	L.T. 1. E-01	L.T. 7. E-02	L.T. 1. E-01	L.T. 7. E-02
CS-134	L.T. 6. E-04	L.T. 5. E-04	L.T. 6. E-04	L.T. 5. E-04
CS-137	L.T. 6. E-04	L.T. 5. E-04	L.T. 6. E-04	L.T. 4. E-04
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
CE-141	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03	L.T. 2. E-03
CE-144	L.T. 3. E-03	L.T. 3. E-03	L.T. 3. E-03	L.T. 3. E-03
RA-226	L.T. 9. E-03	L.T. 1. E-02	L.T. 9. E-03	L.T. 8. E-03
TH-228	L.T. 9. E-04	L.T. 9. E-04	L.T. 9. E-04	L.T. 7. E-04

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - AIRBORNE**  
**COMPOSITE AIR PARTICULATE FILTERS**  
 (PCI/CU. M.)  
**STATION NUMBER 08**  
**STATION 08 - 2.5 MI. 260 DEG. IND.**

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
<b>GAMMA SPECTRUM ANALYSIS:</b>				
BE-7	1.03±0.11 E-01	1.85±0.18 E-01	1.86±0.19 E-01	1.01±0.13 E-01
K-40	LT. 7. E-03	1.43±0.47 E-02	LT. 1. E-02	LT. 1. E-02
MN-54	LT. 5. E-04	LT. 4. E-04	LT. 5. E-04	LT. 6. E-04
CO-58	LT. 7. E-04	LT. 8. E-04	LT. 8. E-04	LT. 9. E-04
FE-59	LT. 3. E-03	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03
CO-60	LT. 5. E-04	LT. 6. E-04	LT. 5. E-04	LT. 5. E-04
ZN-65	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03
ZR-95	LT. 8. E-04	LT. 9. E-04	LT. 9. E-04	LT. 1. E-03
RU-103	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03	LT. 2. E-03
RU-106	LT. 4. E-03	LT. 4. E-03	LT. 4. E-03	LT. 6. E-03
I-131	LT. 8. E-02	LT. 8. E-02	LT. 1. E-01	LT. 1. E-01
CS-134	LT. 5. E-04	LT. 5. E-04	LT. 5. E-04	LT. 6. E-04
CS-137	LT. 4. E-04	LT. 5. E-04	LT. 5. E-04	LT. 6. E-04
BA-140	LT. 2. E-02	LT. 1. E-02	LT. 2. E-02	LT. 2. E-02
CE-141	LT. 1. E-03	LT. 2. E-03	LT. 3. E-03	LT. 3. E-03
CE-144	LT. 2. E-03	LT. 3. E-03	LT. 3. E-03	LT. 5. E-03
RA-226	LT. 6. E-03	LT. 1. E-02	LT. 9. E-03	LT. 1. E-02
TH-228	LT. 6. E-04	LT. 9. E-04	LT. 9. E-04	LT. 1. E-03



NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE AIR PARTICULATE FILTERS  
 (PCI/CU. M.)  
 STATION NUMBER 09  
 STATION 09 - 7.25 MI. 335 DEG. IND

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
GAMMA SPECTRUM ANALYSIS:				
BE-7	9.44±0.94 E-02	1.34±0.13 E-01	1.41±0.14 E-01	8.68±0.97 E-02
K-40	LT. 7. E-03	4.95±0.72 E-02	4.89±0.76 E-02	LT. 2. E-02
MN-54	LT. 4. E-04	LT. 6. E-04	LT. 7. E-04	LT. 5. E-04
CO-58	LT. 6. E-04	LT. 8. E-04	LT. 1. E-03	LT. 9. E-04
FE-59	LT. 1. E-03	LT. 3. E-03	LT. 3. E-03	LT. 3. E-03
CO-60	LT. 4. E-04	LT. 6. E-04	LT. 6. E-04	LT. 6. E-04
ZN-65	LT. 1. E-03	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03
ZR-95	LT. 8. E-04	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03
RU-103	LT. 1. E-03	LT. 1. E-03	LT. 2. E-03	LT. 1. E-03
RU-106	LT. 3. E-03	LT. 5. E-03	LT. 5. E-03	LT. 6. E-03
I-131	LT. 8. E-02	LT. 7. E-02	LT. 1. E-01	LT. 9. E-02
CS-134	LT. 4. E-04	LT. 6. E-04	LT. 7. E-04	LT. 7. E-04
CS-137	LT. 4. E-04	LT. 6. E-04	LT. 6. E-04	LT. 7. E-04
BA-140	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
CE-141	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03
CE-144	LT. 3. E-03	LT. 3. E-03	LT. 3. E-03	LT. 2. E-03
RA-226	LT. 6. E-03	LT. 8. E-03	LT. 9. E-03	LT. 9. E-03
TH-228	LT. 6. E-04	LT. 8. E-04	LT. 9. E-04	LT. 8. E-04

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 COMPOSITE AIR PARTICULATE FILTERS  
 (PCI/CU. M.)  
 STATION NUMBER 10  
 STATION 10 - 10.0 MI. 160 DEG. IND.

DATE COLLECTED:	01/03-03/28	03/28-06/27	06/27-10/03	10/03-01/02
GAMMA SPECTRUM ANALYSIS:				
BE-7	1.09±0.11 E-01	1.83±0.18 E-01	1.62±0.16 E-01	9.47±0.95 E-02
K-40	LT. 2. E-02	1.06±0.47 E-02	LT. 7. E-03	LT. 8. E-03
MN-54	LT. 7. E-04	LT. 5. E-04	LT. 6. E-04	LT. 5. E-04
CO-58	LT. 1. E-03	LT. 7. E-04	LT. 8. E-04	LT. 7. E-04
FE-59	LT. 3. E-03	LT. 2. E-03	LT. 2. E-03	LT. 2. E-03
CO-60	LT. 6. E-04	LT. 4. E-04	LT. 5. E-04	LT. 5. E-04
ZN-65	LT. 2. E-03	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03
ZR-95	LT. 1. E-03	LT. 8. E-04	LT. 8. E-04	LT. 8. E-04
RU-103	LT. 2. E-03	LT. 1. E-03	LT. 1. E-03	LT. 1. E-03
RU-106	LT. 6. E-03	LT. 5. E-03	LT. 4. E-03	LT. 4. E-03
! 131	LT. 1. E-01	LT. 7. E-02	LT. 1. E-01	LT. 7. E-02
CS-134	LT. 6. E-04	LT. 4. E-04	LT. 5. E-04	LT. 5. E-04
CS-137	LT. 6. E-04	LT. 5. E-04	LT. 5. E-04	LT. 6. E-04
BA-140	LT. 2. E-02	LT. 8. E-03	LT. 1. E-02	LT. 1. E-02
CE-141	LT. 2. E-03	LT. 2. E-03	LT. 3. E-03	LT. 2. E-03
CE-144	LT. 3. E-03	LT. 4. E-03	LT. 3. E-03	LT. 3. E-03
RA-226	LT. 8. E-03	LT. 9. E-03	LT. 9. E-03	LT. 8. E-03
TH-228	LT. 8. E-04	LT. 9. E-04	LT. 1. E-03	LT. 8. E-04

**E. FISH**

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 FISH  
 (PCI/GM WET)  
 STATION NUMBER 28  
 STATION 28 - 1.8 MI. 150 DEG. IND

DATE COLLECTED:	07/25 FISH-CATFISH	07/25 FISH-CARP	07/25 FISH-CARP QA	10/11 CARP	10/12 CATFISH
<b>RADIOCHEMICAL ANALYSIS:</b>					
GR-B	5.2 ± 0.2 E 00	5.0 ± 0.2 E 00	4.8 ± 0.2 E 00	4.6 ± 0.2 E 00	4.9 ± 0.2 E 00
SR-89	L.T. 3. E-03	L.T. 3. E-03	L.T. 5. E-03	L.T. 7. E-03	L.T. 1. E-02
SR-90	L.T. 2. E-03	L.T. 1. E-03	L.T. 1. E-03	L.T. 6. E-03	L.T. 4. E-03
<b>GAMMA SPECTRUM ANALYSIS:</b>					
BE-7	L.T. 2. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 1. E-01
K-40	3.33±0.33 E 00	3.08±0.31 E 00	4.18±0.42 E 00	2.98±0.30 E 00	3.12±0.31 E 00
MN-54	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
CO-58	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
FE-59	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 3. E-02
CO-60	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
ZN-65	L.T. 4. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02	L.T. 3. E-02
ZR-95	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-103	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-106	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01
I-131	L.T. 5. E-02	L.T. 3. E-02	L.T. 5. E-02	L.T. 5. E-02	L.T. 4. E-02
CS-134	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
CS-137	L.T. 2. E-02	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
BA-140	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02
CE-141	L.T. 3. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02
CE-144	L.T. 1. E-01	L.T. 5. E-02	L.T. 8. E-02	L.T. 1. E-01	L.T. 1. E-01
RA-226	L.T. 3. E-01	L.T. 2. E-01	L.T. 3. E-01	L.T. 3. E-01	L.T. 3. E-01
TH-228	L.T. 3. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 FISH  
 (PCI/GM WET)  
 STATION NUMBER 35  
 STATION 35 - 2.0 MI. 350 DEG. CON.

DATE COLLECTED:	07/25 FISH-CATFISH	07/25 FISH-CARP	10/12 CARP	10/12 QA CARP
<b>RADIOCHEMICAL ANALYSIS:</b>				
GR-B	4.6 ± 0.1 E 00	4.6 ± 0.2 E 00	5.1 ± 0.2 E 00	4.5 ± 0.2 E 00
SR-89	L.T. 4. E-03	L.T. 3. E-03	L.T. 7. E-03	L.T. 7. E-03
SR-90	L.T. 1. E-03	L.T. 1. E-03	L.T. 6. E-03	8.5 ± 2.5 E-03
<b>GAMMA SPECTRUM ANALYSIS:</b>				
BE-7	L.T. 1. E-01	L.T. 1. E-01	L.T. 2. E-01	L.T. 2. E-01
K-40	2.88±0.29 E 00	2.90±0.29 E 00	2.15±0.22 E 00	3.09±0.31 E 00
MN-54	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CO-58	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
FE-59	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02
CO-60	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 2. E-02
ZN-65	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 4. E-02
ZR-95	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-103	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
RU-106	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 2. E-01
I-131	L.T. 3. E-02	L.T. 5. E-02	L.T. 5. E-02	L.T. 4. E-02
CS-134	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CS-137	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
BA-140	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02
CE-141	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02
CE-144	L.T. 8. E-02	L.T. 8. E-02	L.T. 9. E-02	L.T. 1. E-01
RA-226	L.T. 2. E-01	L.T. 3. E-01	L.T. 3. E-01	L.T. 3. E-01
TH-228	L.T. 2. E-02	L.T. 2. E-02	L.T. 3. E-02	L.T. 3. E-02

**F. MILK - NEAREST PRODUCERS**

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK NEAREST PRODUCER  
 (PCI/LITER)  
 STATION NUMBER 99  
 STATION 99 - 10.25 MI. 189 DEG. IND.

DATE COLLECTED:	01/03		02/07		03/07		03/07 QA		04/04	
RADIOCHEMICAL ANALYSIS:										
SR-89	L.T. 8.	E-01	L.T. 7.	E-01	L.T. 6.	E-01	L.T. 5.	E-01	L.T. 7.	E-01
SR-90	7.3 ± 1.5	E-01	1.2 ± 0.2	E 00	1.2 ± 0.2	E 00	1.2 ± 0.2	E 00	2.0 ± 0.2	E 00
I-131	L.T. 1.	E-01	L.T. 3.	E-01	L.T. 2.	E-01	L.T. 2.	E-01	L.T. 2.	E-01
CA (gm/liter)	2.1 ± 0.2	E 00	1.8 ± 0.2	E 00	1.8 ± 0.2	E 00	1.7 ± 0.2	E 00	1.8 ± 0.2	E 00
GAMMA SPECTRUM ANALYSIS:										
BE-7	L.T. 3.	E 01	L.T. 3.	E 01	L.T. 3.	E 01	L.T. 4.	E 01	L.T. 3.	E 01
K-40	1.35±0.13	E 03	1.35±0.14	E 03	1.47±0.15	E 03	1.37±0.14	E 03	1.27±0.13E 03	
MN-54	L.T. 4.	E 00	L.T. 3.	E 00	L.T. 3.	E 00	L.T. 4.	E 00	L.T. 3.	E 00
CO-58	L.T. 3.	E 00	L.T. 3.	E 00	L.T. 3.	E 00	L.T. 4.	E 00	L.T. 3.	E 00
TE-59	L.T. 9.	E 00	L.T. 8.	E 00	L.T. 8.	E 00	L.T. 1.	E 01	L.T. 7.	E 00
CO-60	L.T. 4.	E 00	L.T. 4.	E 00	L.T. 3.	E 00	L.T. 5.	E 00	L.T. 4.	E 00
ZN-65	L.T. 9.	E 00	L.T. 8.	E 00	L.T. 8.	E 00	L.T. 1.	E 01	L.T. 8.	E 00
ZR-95	L.T. 4.	E 00	L.T. 3.	E 00	L.T. 3.	E 00	L.T. 5.	E 00	L.T. 4.	E 00
RU-103	L.T. 4.	E 00	L.T. 4.	E 00	L.T. 4.	E 00	L.T. 5.	E 00	L.T. 4.	E 00
RU-106	L.T. 4.	E 01	L.T. 3.	E 01	L.T. 3.	E 01	L.T. 4.	E 01	L.T. 3.	E 01
I-131	L.T. 7.	E 00	L.T. 4.	E 00	L.T. 6.	E 00	L.T. 8.	E 00	L.T. 5.	E 00
CS-134	L.T. 4.	E 00	L.T. 4.	E 00	L.T. 4.	E 00	L.T. 5.	E 00	L.T. 4.	E 00
CS-137	L.T. 4.	E 00	L.T. 4.	E 00	L.T. 4.	E 00	L.T. 5.	E 00	L.T. 4.	E 00
BA-140	L.T. 6.	E 00	L.T. 4.	E 00	L.T. 4.	E 00	L.T. 6.	E 00	L.T. 4.	E 00
CE-141	L.T. 8.	E 00	L.T. 6.	E 00	L.T. 6.	E 00	L.T. 9.	E 00	L.T. 6.	E 00
CE-144	L.T. 3.	E 01	L.T. 3.	E 01	L.T. 2.	E 01	L.T. 4.	E 01	L.T. 3.	E 01
RA-226	L.T. 9.	E 01	L.T. 8.	E 01	L.T. 7.	E 01	L.T. 1.	E 02	L.T. 8.	E 01
TH-228	L.T. 7.	E 00	L.T. 7.	E 00	L.T. 6.	E 00	L.T. 1.	E 01	L.T. 7.	E 00

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK NEAREST PRODUCER  
 (PCI/LITER)  
 STATION NUMBER 99  
 STATION 99 - 10.25 MI. 189 DEG. IND.

DATE COLLECTED:	05/02	06/06	06/06 QA	06/06-06/20	06/20
<b>RADIOCHEMICAL ANALYSIS:</b>					
SR-89	LT. 6. E-01			LT. 8. E-01	
SR-90	1.1 ± 0.2 E 00			1.0 ± 0.1 E 00	
I-131	LT. 3. E-01	LT. 2. E-01	LT. 1. E-01		LT. 3. E-01
CA (gm/liter)	1.7 ± 0.2 E 00			1.8 ± 0.2 E 00	
<b>GAMMA SPECTRUM ANALYSIS:</b>					
BE-7	LT. 3. E 01	LT. 3. E 01	LT. 4. E 01		LT. 4. E 01
K-40	1.35±0.13 E 03	1.38±0.14 E 03	1.38±0.14 E 03		1.34±0.13 E 03
MN-54	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00		LT. 4. E 00
CO-58	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00		LT. 4. E 00
FE-59	LT. 8. E 00	LT. 9. E 00	LT. 9. E 00		LT. 9. E 00
CO-60	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00		LT. 4. E 00
ZN-65	LT. 7. E 00	LT. 9. E 00	LT. 1. E 01		LT. 9. E 00
ZR-95	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00		LT. 4. E 00
RU-103	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00		LT. 4. E 00
RU-106	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01		LT. 4. E 01
I-131	LT. 8. E 00	LT. 7. E 00	LT. 7. E 00		LT. 9. E 00
CS-134	LT. 4. E 00	LT. 4. E 00	LT. 5. E 00		LT. 4. E 00
CS-137	LT. 4. E 00	LT. 4. E 00	LT. 5. E 00		LT. 5. E 00
BA-140	LT. 5. E 00	LT. 5. E 00	LT. 6. E 00		LT. 6. E 00
CE-141	LT. 6. E 00	LT. 8. E 00	LT. 9. E 00		LT. 7. E 00
CE-144	LT. 2. E 01	LT. 3. E 01	LT. 4. E 01		LT. 3. E 01
RA-226	LT. 7. E 01	LT. 9. E 01	LT. 1. E 02		LT. 8. E 01
TH-228	LT. 6. E 00	LT. 7. E 00	LT. 9. E 00		LT. 8. E 00



**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**MILK NEAREST PRODUCER**  
**(PCI/LITER)**  
**STATION NUMBER 99**  
**STATION 99 - 10.25 MI. 189 DEG. IND.**

DATE COLLECTED:                    07/05                                    07/05 QA

RADIOCHEMICAL ANALYSIS:

SR-89	LT. 9.	E-01		
SR-90	1.8 ± 0.2	E 00		
I-131	LT. 2.	E-01	L.T. 2.	E-01
CA (gm/liter)	1.8 ± 0.2	E 00		

GAMMA SPECTRUM ANALYSIS:

BE-7	LT. 3.	E 01	LT. 3.	E 01
K-40	1.41±0.14	E 03	1.41±0.14	E 03
MN-54	LT. 4.	E 00	LT. 3.	E 00
CO-58	LT. 4.	E 00	LT. 3.	E 00
FE-59	LT. 9.	E 00	LT. 7.	E 00
CO-60	LT. 4.	E 00	LT. 4.	E 00
ZN-65	LT. 9.	E 00	LT. 8.	E 00
ZR-95	LT. 4.	E 00	LT. 3.	E 00
RU-103	LT. 4.	E 00	LT. 4.	E 00
RU-106	LT. 4.	E 01	LT. 3.	E 01
I-131	LT. 7.	E 00	LT. 6.	E 00
CS-134	LT. 4.	E 00	LT. 3.	E 00
CS-137	LT. 4.	E 00	LT. 5.	E 00
BA-140	LT. 6.	E 00	LT. 6.	E 00
CE-141	LT. 6.	E 00	LT. 6.	E 00
CE-144	LT. 2.	E 01	LT. 2.	E 01
RA-226	LT. 7.	E 01	LT. 7.	E 01
TH-228	LT. 6.	E 00	LT. 6.	E 00

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK NEAREST PRODUCER  
 (PCI/LITER)  
 STATION NUMBER 61  
 STATION 61 - 3.5 MI. 326 DEG. IND.

DATE COLLECTED:	07/19	08/01	08/01 QA	08/01-08/29	08/15
RADIOCHEMICAL ANALYSIS:					
SR-89	LT. 8. E-01			LT. 1. E00	
SR-90	1.6 ± 0.2 E 00			1.4 ± 0.2 E 00	
I-131	LT. 1. E-01	LT. 2. E-01	LT. 2. E-01		LT. 3. E-01
CA	1.8 ± 0.2 E 00			1.8 ± 0.2 E 00	
GAMMA SPECTRUM ANALYSIS:					
BE-7	LT. 3. E 01	LT. 3. E 01	LT. 4. E 01		LT. 3. E 01
K-40	1.18±0.12 E 03	1.24±0.12 E 03	1.28±0.13 E 03		1.06±0.11E 03
MN-54	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00		LT. 4. E 00
CO-58	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00		LT. 3. E 00
FE-59	LT. 8. E 00	LT. 8. E 00	LT. 9. E 00		LT. 9. E 00
CO-60	LT. 4. E 00	LT. 4. E 00	LT. 5. E 00		LT. 4. E 00
ZN-65	LT. 9. E 00	LT. 9. E 00	LT. 1. E 01		LT. 9. E 00
ZR-95	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00		LT. 3. E 00
RU-103	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00		LT. 4. E 00
RU-106	LT. 3. E 01	LT. 3. E 01	LT. 4. E 01		LT. 3. E 01
I-131	LT. 7. E 00	LT. 7. E 00	LT. 8. E 00		LT. 4. E 00
CS-134	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00		LT. 4. E 00
CS-137	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00		LT. 4. E 00
BA-140	LT. 6. E 00	LT. 5. E 00	LT. 6. E 00		LT. 4. E 00
CE-141	LT. 7. E 00	LT. 6. E 00	LT. 7. E 00		LT. 7. E 00
CE-144	LT. 3. E 01	LT. 2. E 01	LT. 3. E 01		LT. 3. E 01
RA-226	LT. 8. E 01	LT. 7. E 01	LT. 8. E 01		LT. 9. E 01
TH-228	LT. 6. E 00	LT. 6. E 00	LT. 8. E 00		LT. 7. E 00

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**MILK NEAREST PRODUCER**  
**(PCI/LITER)**  
**STATION NUMBER 61**  
**STATION 61 - 3.5 MI. 326 DEG. IND.**

DATE COLLECTED:	08/15 QA	08/29	09/05	09/05 QA	09/05-09/19
<b>RADIOCHEMICAL ANALYSIS:</b>					
SR-89					L.T. 7. E-01
SR-90					1.0 ± 0.2 E 00
I-131	L.T. 3. E-01	L.T. 2. E-01	L.T. 2. E-01	L.T. 2. E-01	1.7 ± 0.2 E 00
CA					
<b>GAMMA SPECTRUM ANALYSIS:</b>					
BE-7	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01	
K-40	1.36±0.14E 03	1.14±0.11 E 03	1.23±0.12 E 03	1.28±0.13E 03	
MN-54	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00	
CO-58	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00	
FE-59	L.T. 8. E 00	L.T. 8. E 00	L.T. 9. E 00	L.T. 9. E 00	
CO-60	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	
ZN-65	L.T. 9. E 00	L.T. 8. E 00	L.T. 1. E 01	L.T. 9. E 00	
ZR-95	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	
RU-103	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	
RU-106	L.T. 3. E 01	L.T. 3. E 01	L.T. 4. E 01	L.T. 4. E 01	
I-131	L.T. 5. E 00	L.T. 5. E 00	L.T. 7. E 00	L.T. 7. E 00	
CS-134	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	
CS-137	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00	
BA-140	L.T. 4. E 00	L.T. 5. E 00	L.T. 5. E 00	L.T. 6. E 00	
CE-141	L.T. 8. E 00	L.T. 8. E 00	L.T. 9. E 00	L.T. 6. E 00	
CE-144	L.T. 4. E 01	L.T. 3. E 01	L.T. 4. E 01	L.T. 2. E 01	
RA-226	L.T. 1. E 02	L.T. 9. E 01	L.T. 1. E 02	L.T. 7. E 01	
TH-228	L.T. 8. E 00	L.T. 8. E 00	L.T. 8. E 00	L.T. 6. E 00	

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION/  
 MILK NEAREST PRODUCER  
 (PCI/LITER)  
 STATION NUMBER 61  
 STATION 61 - 3.5 MI. 326 DEG. IND

DATE COLLECTED:	09/19	10/03	10/03 QA	11/07	11/07 QA
RADIOCHEMICAL ANALYSIS:					
SR-89		LT. 2. E 00	LT. 1. E 00	LT. 6. E-01	LT. 9. E-01
SR-90		1.0 ± 0.3 E 00	9.2 ± 1.6 E-01	9.1 ± 1.5 E-01	9.1 ± 1.8 E-01
I-131	LT. 2. E-01	LT. 4. E-01	LT. 3. E-01	LT. 3. E-01	LT. 1. E-01
CA		1.9 ± 0.2 E 00	1.8 ± 0.2 E 00	1.7 ± 0.2 E 00	1.7 ± 0.2 E 00
GAMMA SPECTRUM ANALYSIS:					
BE-7	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01
K-40	1.51±0.15 E 03	1.21±0.12 E 03	1.25±0.13 E 03	1.28±0.13 E 03	1.34±0.13E 03
MN-54	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00
CO-58	LT. 3. E 00	LT. 3. E 00	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00
FE-59	LT. 7. E 00	LT. 8. E 00	LT. 8. E 00	LT. 7. E 00	LT. 9. E 00
CO-60	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00
ZN-65	LT. 8. E 00	LT. 8. E 00	LT. 9. E 00	LT. 7. E 00	LT. 1. E 01
ZR-95	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00
RU-103	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00
RU-106	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01
I-131	LT. 4. E 00	LT. 5. E 00	LT. 5. E 00	LT. 4. E 00	LT. 5. E 00
CS-134	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00
CS-137	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00
BA-140	LT. 3. E 00	LT. 4. E 00	LT. 5. E 00	LT. 3. E 00	LT. 4. E 00
CE-141	LT. 5. E 00	LT. 7. E 00	LT. 8. E 00	LT. 5. E 00	LT. 7. E 00
CE-144	LT. 2. E 01	LT. 3. E 01	LT. 3. E 01	LT. 2. E 01	LT. 3. E 01
RA-226	LT. 6. E 01	LT. 9. E 01	LT. 1. E 02	LT. 7. E 01	LT. 8. E 01
TH-228	LT. 6. E 00	LT. 7. E 00	LT. 9. E 00	LT. 6. E 00	LT. 8. E 00

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK NEAREST PRODUCER  
 (PCI/LITER)  
 STATION NUMBER 61  
 STATION 61 - 3.5 MI. 326 DEG. IND.

DATE COLLECTED: 12/05 12/05 QA

RADIOCHEMICAL ANALYSIS:

SR-89	LT. 9.	E-01	LT. 6.	E-01
SR-90	1.2 ± 0.1	E 00	1.1 ± 0.2	E 00
I-131	LT. 1.	E-01	LT. 2.	E-01
CA	1.72±0.17	E 00	1.78±0.18	E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	LT. 3.	E 01	LT. 3.	E 01
K-40	1.18±0.12	E 03	1.47±0.15	E 03
MN-54	LT. 3.	E 00	LT. 3.	E 00
CO-58	LT. 3.	E 00	LT. 3.	E 00
FE-59	LT. 7.	E 00	LT. 6.	E 00
CO-60	LT. 3.	E 00	LT. 3.	E 00
ZN-65	LT. 8.	E 00	LT. 7.	E 00
ZR-95	LT. 3.	E 00	LT. 3.	E 00
RU-103	LT. 3.	E 00	LT. 3.	E 00
RU-106	LT. 3.	E 01	LT. 3.	E 01
I-131	LT. 4.	E 00	LT. 3.	E 00
CS-134	LT. 3.	E 00	LT. 3.	E 00
CS-137	LT. 5.	E 00	LT. 4.	E 00
BA-140	LT. 4.	E 00	LT. 3.	E 00
CE-141	LT. 6.	E 00	LT. 5.	E 00
CE-144	LT. 2.	E 01	LT. 2.	E 01
RA-226	LT. 7.	E 01	LT. 6.	E 01
TH-228	LT. 2.	E 00	LT. 6.	E 00

**G. MILK - OTHER PRODUCERS**

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**MILK OTHER PRODUCERS**  
**(PCI/LITER)**  
**STATION NUMBER 42**  
**STATION 42 - 12.85 MI. 156 DEG. IND.**

DATE COLLECTED:	01/17		04/18		07/12		10/24
<b>RADIOCHEMICAL ANALYSIS:</b>							
SR-89	LT. 7.	E-01	LT. 6.	E-01	LT. 6.	E-01	LT. 7. E-01
SR-90	1.5 ± 0.2	E 00	1.5 ± 0.2	E 00	1.5 ± 0.2	E 00	1.4 ± 0.1 E 00
I-131	LT. 2.	E-01	LT. 1.	E-01	LT. 1.	E-01	LT. 2. E-01
CA (gm/liter)	1.9 ± 0.2	E 00	1.8 ± 0.2	E 00	1.8 ± 0.2	E 00	1.7 ± 0.2 E 00
<b>GAMMA SPECTRUM ANALYSIS:</b>							
BE-7	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3. E 01
K-40	1.24 ± 0.12	E 03	1.39 ± 0.14	E 03	1.35 ± 0.14	E 03	1.42 ± 0.14 E 03
MN-54	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4. E 00
CO-58	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4. E 00
FE-59	LT. 8.	E 00	LT. 8.	E 00	LT. 7.	E 00	LT. 8. E 00
CO-60	LT. 4.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 4. E 00
ZN-65	LT. 8.	E 00	LT. 8.	E 00	LT. 7.	E 00	LT. 8. E 00
ZR-95	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4. E 00
RU-103	LT. 1.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4. E 00
RU-106	LT. 2.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3. E 01
I-131	LT. 5.	E 00	LT. 4.	E 00	LT. 6.	E 00	LT. 5. E 00
CS-134	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4. E 00
CS-137	LT. 4.	E 00	LT. 5.	E 00	LT. 4.	E 00	LT. 4. E 00
BA-140	LT. 5.	E 00	LT. 4.	E 00	LT. 5.	E 00	LT. 4. E 00
CE-141	LT. 7.	E 00	LT. 6.	E 00	LT. 6.	E 00	LT. 5. E 00
CE-144	LT. 3.	E 01	LT. 2.	E 01	LT. 2.	E 01	LT. 2. E 01
RA-226	LT. 9.	E 01	LT. 7.	E 01	LT. 7.	E 01	LT. 7. E 01
TH-228	LT. 7.	E 00	LT. 6.	E 00	LT. 6.	E 00	LT. 7. E 00

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 MILK OTHER PRODUCERS  
 (PCI/LITER)  
 STATION NUMBER 100  
 STATION 100 - 11.5 MI. 197 DEG. IND.

DATE COLLECTED:	01/17	04/18	07/11	10/24
<b>RADIOCHEMICAL ANALYSIS:</b>				
SR-89	LT. 7. E-01	LT. 6. E-01	LT. 6. E-01	LT. 7. E-01
SR-90	1.8 ± 0.2 E 00	1.7 ± 0.2 E 00	1.6 ± 0.2 E 00	1.5 ± 0.2 E 00
I-131	LT. 2. E-01	LT. 2. E-01	LT. 2. E-01	LT. 1. E-01
CA (gm/liter)	1. ± 0.2 E 00	1.8 ± 0.2 E 00	1.8 ± 0.2 E 00	1.7 ± 0.2 E 00
<b>GAMMA SPECTRUM ANALYSIS:</b>				
BE-7	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01
K-40	1.41±0.14 E 03	1.36±0.14 E 03	1.32±0.13 E 03	1.42±0.14 E 03
MN-54	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00
CO-58	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00
FE-59	LT. 1. E 01	LT. 6. E 00	LT. 8. E 00	LT. 8. E 00
CO-60	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00
ZN-65	LT. 1. E 01	LT. 7. E 00	LT. 8. E 00	LT. 8. E 00
ZR-95	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00
RU-103	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00
RU-106	LT. 4. E 01	LT. 3. E 01	LT. 3. E 01	LT. 4. E 01
I-131	LT. 5. E 00	LT. 4. E 00	LT. 8. E 00	LT. 5. E 00
CS-134	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00
CS-137	LT. 5. E 00	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00
BA-140	LT. 5. E 00	LT. 4. E 00	LT. 6. E 00	LT. 4. E 00
CE-141	LT. 9. E 00	LT. 5. E 00	LT. 6. E 00	LT. 5. E 00
CE-144	LT. 4. E 01	LT. 2. E 01	LT. 2. E 01	LT. 2. E 01
RA-226	LT. 1. E 02	LT. 6. E 01	LT. 7. E 01	LT. 7. E 01
TH-228	LT. 9. E 00	LT. 5. E 00	LT. 7. E 00	LT. 7. E 00



## H. GROUNDWATER

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - GROUND  
 (PCI/LITER)  
 STATION NUMBER 11  
 STATION 11 - 0.15 MI. 225 DEG. IND.

DATE COLLECTED:	01/24		04/25		07/18		10/25	
RADIOCHEMICAL ANALYSIS:								
GR-A	LT. 4.	E 00	LT. 2.	E 00	LT. 3.	E 00	LT. 4.	E 00
GR-B	9.5 ± 2.4	E 00	8.6 ± 1.8	E 00	7.7 ± 1.6	E 00	7.6 ± 1.6	E 00
GAMMA SPECTRUM ANALYSIS:								
BE-7	LT. 3.	E 01	LT. 2.	E 01	LT. 4.	E 01	LT. 3.	E 01
K-40	LT. 5.	E 01	LT. 5.	E 01	LT. 1.	E 02	LT. 8.	E 01
MN-54	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00
CO-58	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00
FE-59	LT. 7.	E 00	LT. 5.	E 00	LT. 9.	E 00	LT. 7.	E 00
CO-60	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00
ZN-65	LT. 8.	E 00	LT. 5.	E 00	LT. 8.	E 00	LT. 6.	E 00
ZR-95	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00
RU-103	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00
RU-106	LT. 3.	E 01	LT. 2.	E 01	LT. 4.	E 01	LT. 3.	E 01
I-131	LT. 4.	E 00	LT. 4.	E 00	LT. 7.	E 00	LT. 4.	E 00
CS-134	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00
CS-137	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 3.	E 00
BA-140	LT. 4.	E 00	LT. 4.	E 00	LT. 6.	E 00	LT. 4.	E 00
CE-141	LT. 5.	E 00	LT. 5.	E 00	LT. 6.	E 00	LT. 4.	E 00
CE-144	LT. 2.	E 01	LT. 2.	E 01	LT. 2.	E 01	LT. 2.	E 01
RA-226	LT. 7.	E 01	LT. 6.	E 01	LT. 7.	E 01	LT. 7.	E 01
TH-228	LT. 6.	E 00	LT. 5.	E 00	LT. 7.	E 00	LT. 6.	E 00
TRITIUM ANALYSIS:								
H-3	LT. 1.	E 02	LT. 1.	E 02	LT. 1.	E 02	LT. 1.	E 02

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - WATERBORNE**  
**WATER - GROUND**  
**(PCI/LITER)**  
**STATION NUMBER 47**  
**STATION 47 - 25.75 MI. 154 DEG. IND.**

DATE COLLECTED:	01/23	04/25	07/18	10/25
<b>RADIOCHEMICAL ANALYSIS:</b>				
GR-A	L.T. 3. E 00	7.9 ± 3.6 E 00	L.T. 3. E 00	L.T. 3. E 00
GR-B	1.0 ± 0.2 E 01	1.1 ± 0.2 E 01	6.4 ± 1.5 E 00	6.3 ± 1.5 E 00
<b>GAMMA SPECTRUM ANALYSIS:</b>				
BE-7	L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01
K-40	L.T. 6. E 01	L.T. 9. E 01	L.T. 9. E 01	L.T. 8. E 01
MN-54	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
CO-58	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
FE-59	L.T. 8. E 00	L.T. 6. E 00	L.T. 6. E 00	L.T. 6. E 00
CO-60	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
ZN-65	L.T. 8. E 00	L.T. 7. E 00	L.T. 7. E 00	L.T. 7. E 00
ZR-95	L.T. 4. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
RU-103	L.T. 5. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 3. E 00
RU-106	L.T. 4. E 01	L.T. 3. E 01	L.T. 3. E 01	L.T. 3. E 01
I-131	L.T. 6. E 00	L.T. 4. E 00	L.T. 6. E 00	L.T. 4. E 00
CS-134	L.T. 5. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
CS-137	L.T. 5. E 00	L.T. 3. E 00	L.T. 3. E 00	L.T. 4. E 00
BA-140	L.T. 6. E 00	L.T. 4. E 00	L.T. 4. E 00	L.T. 4. E 00
CE-141	L.T. 9. E 00	L.T. 5. E 00	L.T. 5. E 00	L.T. 4. E 00
CE-144	L.T. 4. E 01	L.T. 2. E 01	L.T. 2. E 01	L.T. 2. E 01
RA-226	L.T. 1. E 02	L.T. 7. E 01	L.T. 6. E 01	L.T. 6. E 01
TH-228	L.T. 1. E 01	L.T. 6. E 00	L.T. 5. E 00	L.T. 6. E 00
<b>TRITIUM ANALYSIS:</b>				
H-3	L.T. 1. E 02	L.T. 1. E 02	L.T. 1. E 02	L.T. 1. E 02

**L RIVER WATER**

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - RIVER  
 (PCI/LITER)  
 STATION NUMBER 12  
 STATION 12 - 0.1 MI. 360 DEG. CON

DATE COLLECTED:	01/03	02/07	03/07	04/04	05/02
RADIOCHEMICAL ANALYSIS:					
SR-89	LT. 2. E 00	LT. 7. E-01	LT. 7. E-01	LT. 1. E 00	LT. 8. E-01
SR-90	LT. 9. E-01	LT. 3. E-01	LT. 3. E-01	LT. 5. E-01	LT. 7. E-01
GR-A DIS	LT. 2. E 00	4.2 ± 2.7 E 00	LT. 4. E 00	5.4 ± 3.3 E 00	4.5 ± 2.7 E 00
GR-A SUS	7.3 ± 4.9 E-01	2.5 ± 1.2 E 00	6.5 ± 3.3 E 00	3.0 ± 1.7 E 00	2.3 ± 1.3 E 00
GR-B DIS	9.1 ± 1.6 E 00	9.2 ± 2.2 E 00	9.5 ± 1.6 E 00	1.2 ± 0.2 E 01	1.4 ± 0.2 E 01
GR-B SUS	2.2 ± 0.7 E 00	6.3 ± 1.5 E 00	2.5 ± 0.2 E 01	1.2 ± 0.2 E 01	9.7 ± 1.3 E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	LT. 2. E 01	LT. 2. E 01	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01
K-40	LT. 5. E 01	LT. 5. E 01	LT. 5. E 01	LT. 8. E 01	LT. 8. E 01
MN-54	LT. 3. E 00	LT. 2. E 00	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00
CO-58	LT. 3. E 00	LT. 2. E 00	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00
FE-59	LT. 5. E 00	LT. 5. E 00	LT. 7. E 00	LT. 7. E 00	LT. 8. E 00
CO-60	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00	LT. 3. E 00	LT. 3. E 00
ZN-65	LT. 6. E 00	LT. 5. E 00	LT. 7. E 00	LT. 7. E 00	LT. 7. E 00
ZR-95	LT. 3. E 00	LT. 3. E 00	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00
RU-103	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00	LT. 4. E 00	LT. 4. E 00
RU-106	LT. 2. E 01	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01	LT. 3. E 01
I-131	LT. 3. E 00	LT. 4. E 00	LT. 6. E 00	LT. 5. E 00	LT. 9. E 00
CS-134	LT. 3. E 00	LT. 3. E 00	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00
CS-137	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00	LT. 3. E 00	LT. 4. E 00
BA-140	LT. 3. E 00	LT. 3. E 00	LT. 5. E 00	LT. 4. E 00	LT. 6. E 00
CE-141	LT. 5. E 00	LT. 5. E 00	LT. 5. E 00	LT. 6. E 00	LT. 6. E 00
CE-144	LT. 2. E 01	LT. 2. E 01	LT. 2. E 01	LT. 3. E 01	LT. 2. E 01
RA-226	LT. 6. E 01	LT. 7. E 01	LT. 6. E 01	LT. 7. E 01	LT. 8. E 01
TH-228	LT. 5. E 00	LT. 6. E 00	LT. 6. E 00	LT. 6. E 00	LT. 7. E 00

TRITIUM ANALYSIS:

	01/03-03/07	04/04-06/13
H-3	LT. 1. E 02	LT. 1. E 02

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - RIVER  
 (PCI/LITER)  
 STATION NUMBER 12  
 STATION 12 - 0.1 MI. 360 DEG. CON

DATE COLLECTED:	06/13		07/05		08/01		09/06		10/03	
RADIOCHEMICAL ANALYSIS:										
SR-89	LT. 1.	E 00	LT. 8.	E-01	LT. 5.	E-01	LT. 1.	E 00	LT. 3.	E-01
SR-90	LT. 9.	E-01	LT. 7.	E-01	LT. 2.	E-01	LT. 3.	E-01	LT. 2.	E-01
GR-A DIS	3.1 ± 2.7	E 00	LT. 3.	E 00	LT. 2.	E 00	LT. 4.	E 00	2.9 ± 2.4	E 00
GR-A SUS	2.8 ± 1.4	E 00	1.8 ± 1.3	E 00	LT. 8.	E-01	LT. 6.	E-01	1.2 ± 0.7	E 00
GR-B DIS	1.4 ± 0.2	E 01	1.2 ± 0.2	E 01	1.4 ± 0.2	E 01	1.2 ± 0.2	E 01	8.7 ± 1.5	E 00
GR-B SUS	8.9 ± 1.3	E 00	1.1 ± 0.1	E 01	4.8 ± 0.9	E 00	LT. 7.	E-01	2.1 ± 0.7	E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01
K-40	LT. 5.	E 01	LT. 5.	E 01	LT. 1.	E 02	LT. 6.	E 01	LT. 5.	E 01
MN-54	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00
CO-58	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00
FE-59	LT. 6.	E 00	LT. 6.	E 00	LT. 7.	E 00	LT. 6.	E 00	LT. 6.	E 00
CO-60	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00
ZN-65	LT. 7.	E 00	LT. 6.	E 00	LT. 8.	E 00	LT. 7.	E 00	LT. 7.	E 00
ZR-95	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00
RU-103	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00
RU-106	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01
I-131	LT. 8.	E 00	LT. 8.	E 00	LT. 5.	E 00	LT. 5.	E 00	LT. 4.	E 00
CS-134	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00
CS-137	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00
BA-140	LT. 6.	E 00	LT. 6.	E 00	LT. 5.	E 00	LT. 5.	E 00	LT. 3.	E 00
CE-141	LT. 8.	E 00	LT. 7.	E 00	LT. 5.	E 00	LT. 6.	E 00	LT. 5.	E 00
CE-144	LT. 3.	E 01	LT. 3.	E 01	LT. 2.	E 01	LT. 3.	E 01	LT. 2.	E 01
RA-226	LT. 8.	E 01	LT. 7.	E 01	LT. 6.	E 01	LT. 7.	E 01	LT. 7.	E 01
TH-228	LT. 7.	E 00	LT. 6.	E 00	LT. 6.	E 00	LT. 6.	E 00	LT. 6.	E 00

TRITIUM ANALYSIS:

H-3			07/05-09/06							
			LT. 1.	E 02						

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - RIVER  
 (PCI/LITER)  
 STATION NUMBER 12  
 STATION 12 - 0.1 MI. 360 DEG. CON

DATE COLLECTED:                    11/07                                    12/05

RADIOCHEMICAL ANALYSIS:

SR-89	LT. 8.	E-01	LT. 1.	E 00
SR-90	LT. 4	E-01	LT. 4	E-01
GR-A DIS	LT. 3.	E 00	LT. 3.	E 00
GR-A SUS	1.3 ± 0.7	E 00	7.4 ± 5.9	E-01
GR-B DIS	1.0 ± 0.2	E 01	9.1 ± 1.6	E 00
GR-B SUS	3.2 ± 0.8	E 00	2.6 ± 0.7	E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	LT. 3.	E 01	LT. 3.	E 01
K-40	LT. 6.	E 01	LT. 1.	E 02
MN-54	LT. 3.	E 00	LT. 4.	E 00
CO-58	LT. 3.	E 00	LT. 4.	E 00
FE-59	LT. 7.	E 00	LT. 8.	E 00
CO-60	LT. 3.	E 00	LT. 4.	E 00
ZN-65	LT. 7.	E 00	LT. 8.	E 00
ZR-95	LT. 3.	E 00	LT. 4.	E 00
RU-103	LT. 4.	E 00	LT. 4.	E 00
RU-106	LT. 3.	E 01	LT. 3.	E 01
I-131	LT. 4.	E 00	LT. 4.	E 00
CS-134	LT. 4.	E 00	LT. 4.	E 00
CS-137	LT. 3.	E 00	LT. 4.	E 00
BA-140	LT. 4.	E 00	LT. 4.	E 00
CE-141	LT. 7.	E 00	LT. 5.	E 00
CE-144	LT. 3.	E 01	LT. 2.	E 01
RA-226	LT. 8.	E 01	LT. 7.	E 01
TH-228	LT. 7.	E 00	LT. 6.	E 00

TRITIUM ANALYSIS:                    10/30-12/05

H-3                                    LT. 1.                    E 02

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - RIVER  
 (PCI/LITER)  
 STATION NUMBER 28  
 STATION 28 - 1.8 MI. 150 DEG. IND.

DATE COLLECTED:	01/03		02/07		03/07		04/04		05/02	
RADIOCHEMICAL ANALYSIS:										
SR-89	LT. 1.	E 00	LT. 7.	E-01	LT. 7.	E-01	LT. 9.	E-01	LT. 1.	E 00
SR-90	LT. 9.	E-01	LT. 3.	E-01	LT. 3.	E-01	LT. 3.	E-01	LT. 7.	E-01
GR-A DIS	2.7 ± 2.2	E 00	2.5 ± 2.2	E 00	LT. 4.	E 00	LT. 2.	E 00	LT. 2.	E 00
GR-A SUS	6.5 ± 4.4	E-01	2.1 ± 1.2	E 00	LT. 9.	E-01	3.8 ± 2.1	E 00	3.5 ± 1.7	E 00
GR-B DIS	9.2 ± 1.6	E 00	9.7 ± 2.2	E 00	9.1 ± 1.6	E 00	1.0 ± 0.2	E 01	1.3 ± 0.2	E 01
GR-B SUS	1.6 ± 0.6	E 00	5.8 ± 1.5	E 00	3.4 ± 0.8	E 00	1.5 ± 0.2	E 01	1.1 ± 0.1	E 01
GAMMA SPECTRUM ANALYSIS:										
BE-7	LT. 4.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 4.	E 01	LT. 3.	E 01
K-40	LT. 1.	E 02	LT. 1.	E 02	LT. 5.	E 01	LT. 6.	E 01	LT. 7.	E 01
MN-54	LT. 4.	E 00	LT. 3.	E 00	LT. 2.	E 00	LT. 4.	E 00	LT. 3.	E 00
CO-58	LT. 4.	E 00	LT. 3.	E 00	LT. 2.	E 00	LT. 4.	E 00	LT. 3.	E 00
FE-59	LT. 8.	E 00	LT. 7.	E 00	LT. 5.	E 00	LT. 8.	E 00	LT. 6.	E 00
CO-60	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 5.	E 00	LT. 3.	E 00
ZN-65	LT. 9.	E 00	LT. 8.	E 00	LT. 6.	E 00	LT. 8.	E 00	LT. 6.	E 00
ZR-95	LT. 4.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00
RU-103	LT. 5.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00
RU-106	LT. 4.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 4.	E 01	LT. 3.	E 01
I-131	LT. 5.	E 00	LT. 5.	E 00	LT. 5.	E 00	LT. 6.	E 00	LT. 8.	E 00
CS-134	LT. 4.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 8.	E 00
CS-137	LT. 5.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 5.	E 00	LT. 3.	E 00
BA-140	LT. 4.	E 00	LT. 4.	E 00	LT. 3.	E 00	LT. 6.	E 00	LT. 3.	E 00
CE-141	LT. 7.	E 00	LT. 6.	E 00	LT. 6.	E 00	LT. 8.	E 00	LT. 6.	E 00
CE-144	LT. 3.	E 01	LT. 3.	E 01	LT. 2.	E 01	LT. 3.	E 01	LT. 2.	E 01
RA-226	LT. 9.	E 01	LT. 8.	E 01	LT. 7.	E 01	LT. 1.	E 02	LT. 7.	E 01
TH-228	LT. 8.	E 00	LT. 7.	E 00	LT. 5.	E 00	LT. 1.	E 01	LT. 6.	E 00
TRITIUM ANALYSIS:										
	01/03-03/07								04/04-06/13	
H-3	LT. 1.	E 02							LT. 1.	E 02



**NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - WATERBORNE  
WATER - RIVER  
(PCI/LITER)  
STATION NUMBER 28  
STATION 28 - 1.8 MI. 150 DEG. IND.**

DATE COLLECTED:	06/13		07/05		08/01		09/05		10/03	
<b>RADIOCHEMICAL ANALYSIS:</b>										
SR-89	LT. 1.	E 00	LT. 1.	E 00	LT. 7.	E-01	LT. 1.	E 00	LT. 7.	E-01
SR-90	LT. 6.	E-01	LT. 4.	E-01	LT. 3.	E-01	LT. 4.	E-01	LT. 4.	E-01
GR-A DIS	LT. 2.	E 00	LT. 3.	E 00	LT. 2.	E 00	LT. 3.	E 00	LT. 2.	E 00
GR-A SUS	3.7 ± 1.7	E 00	7.6 ± 6.1	E-01	LT. 7.	E-01	LT. 6.	E-01	1.1 ± 0.7	E 00
GR-B DIS	1.1 ± 0.2	E 01	1.2 ± 0.2	E 01	1.2 ± 0.2	E 01	1.1 ± 0.2	E 01	7.6 ± 1.4	E 00
GR-B SUS	1.2 ± 0.1	E 01	3.4 ± 0.8	E 00	4.2 ± 0.8	E 00	LT. 7.	E-01	2.6 ± 0.7	E 00
<b>GAMMA SPECTRUM ANALYSIS:</b>										
BE-7	LT. 4.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01
K-40	LT. 7.	E 01	LT. 6.	E 01	LT. 7.	E 01	LT. 8.	E 01	LT. 9.	E 01
MN-54	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00
CO-58	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 3.	E 00
FE-59	LT. 7.	E 00	LT. 6.	E 00	LT. 7.	E 00	LT. 8.	E 00	LT. 7.	E 00
CO-60	LT. 4.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00
ZN-65	LT. 7.	E 00	LT. 6.	E 00	LT. 7.	E 00	LT. 9.	E 00	LT. 7.	E 00
ZR-95	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00
RU-103	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00
RU-106	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 4.	E 01	LT. 3.	E 01
I-131	LT. 8.	E 00	LT. 8.	E 00	LT. 7.	E 00	LT. 5.	E 00	LT. 5.	E 00
CS-134	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00
CS-137	LT. 4.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00
BA-140	LT. 6.	E 00	LT. 6.	E 00	LT. 5.	E 00	LT. 5.	E 00	LT. 5.	E 00
CE-141	LT. 9.	E 00	LT. 8.	E 00	LT. 8.	E 00	LT. 6.	E 00	LT. 6.	E 00
CE-144	LT. 4.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 2.	E 01
RA-226	LT. 1.	E 02	LT. 8.	E 01	LT. 1.	E 02	LT. 8.	E 01	LT. 7.	E 01
TH-228	LT. 8.	E 00	LT. 7.	E 00	LT. 8.	E 00	LT. 7.	E 00	LT. 6.	E 00
<b>TRITIUM ANALYSIS:</b>										
			07/05-09/06							
H-3			LT. 1.	E 02						

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - RIVER  
 (PCI/LITER)  
 STATION NUMBER 28  
 STATION 28 - 1.8 MI. 150 DEG. IND.

DATE COLLECTED:            11/07                            12/05

RADIOCHEMICAL ANALYSIS:

SR-89	LT. 9.	E-01	LT. 8.	E-01
SR-90	LT. 4.	E-01	LT. 4.	E-01
GR-A DIS	6.1 ± 3.5	E 00	LT. 3.	E 00
GR-A SUS	1.3 ± 0.7	E 00	LT. 7.	E-01
GR-B DIS	9.6 ± 1.7	E 00	7.7 ± 1.4	E 00
GR-B SUS	3.1 ± 0.8	E 00	2.6 ± 0.7	E 00

GAMMA SPECTRUM ANALYSIS:

BE-7	LT. 3.	E 01	LT. 3.	E 01
K-40	LT. 7.	E 01	LT. 9.	E 01
MN-54	LT. 3.	E 00	LT. 3.	E 00
CO-58	LT. 3.	E 00	LT. 3.	E 00
FE-59	LT. 6.	E 00	LT. 7.	E 00
CO-60	LT. 4.	E 00	LT. 3.	E 00
ZN-65	LT. 7.	E 00	LT. 7.	E 00
ZR-95	LT. 4.	E 00	LT. 3.	E 00
RU-103	LT. 4.	E 00	LT. 4.	E 00
RU-106	LT. 3.	E 01	LT. 3.	E 01
I-131	LT. 5.	E 00	LT. 4.	E 00
CS-134	LT. 4.	E 00	LT. 4.	E 00
CS-137	LT. 4.	E 00	LT. 4.	E 00
BA-140	LT. 5.	E 00	LT. 4.	E 00
CE-141	LT. 8.	E 00	LT. 5.	E 00
CE-144	LT. 3.	E 01	LT. 2.	E 01
RA-226	LT. 1.	E 02	LT. 7.	E 01
TH-228	LT. 9.	E 00	LT. 6.	E 00

TRITIUM ANALYSIS:            10/30-12/05

H-3                            LT. 1.        E 02

**J. THERMOLUMINESCENT DOSIMETRY - RADIATION DOSE**

**TABLE J-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD  
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/05-04/12	SECOND QUARTER 04/12-07/11	THIRD QUARTER 07/11-10/06	FOURTH QUARTER 10/06-12/26
TLD (Gamma)	01	16.3 ± 1.1	15.5 ± 0.6	14.7 ± 1.0	16.8 ± 1.3
	02	16.4 ± 0.6	17.9 ± 0.9	14.3 ± 0.8	15.3 ± 1.0
	03	15.5 ± 0.5	12.2 ± 0.5	13.0 ± 0.6	14.7 ± 0.6
	04	15.5 ± 0.6	14.6 ± 0.8	13.7 ± 0.9	15.3 ± 1.1
	05	17.9 ± 1.3	17.7 ± 0.4	13.7 ± 0.6	15.2 ± 0.7
	06	16.7 ± 0.4	15.5 ± 0.6	14.0 ± 0.5	16.0 ± 0.9
	07	16.3 ± 1.4	14.2 ± 0.5	13.9 ± 0.8	15.8 ± 1.0
	08	16.4 ± 1.1	15.7 ± 0.9	15.0 ± 1.1	16.2 ± 1.4
	09	16.1 ± 0.8	14.0 ± 0.7	13.8 ± 0.6	15.0 ± 0.8
	10	16.3 ± 0.8	14.7 ± 0.8	14.3 ± 1.0	15.9 ± 0.6
	20	17.5 ± 0.6	15.1 ± 0.4	15.5 ± 0.7	17.0 ± 0.9
	44	19.5 ± 1.0	16.6 ± 0.6	17.8 ± 0.9	18.2 ± 0.5
	56	15.6 ± 0.5	15.1 ± 0.4	15.7 ± 0.9	17.0 ± 1.1
	58	17.2 ± 0.7	15.7 ± 0.7	16.5 ± 1.0	16.8 ± 0.9
	59	17.5 ± 0.5	17.4 ± 0.9	17.4 ± 1.0	16.8 ± 1.5
	66	19.5 ± 0.6	*	18.4 ± 0.8	18.9 ± 1.1
	67	20.9 ± 0.9	17.0 ± 0.6	17.8 ± 0.9	17.4 ± 0.9
	71	17.6 ± 0.8	15.6 ± 0.8	16.9 ± 0.8	17.7 ± 1.1

\*TLD missing

**TABLE J-1**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD  
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	FIRST QUARTER 01/05-04/12	SECOND QUARTER 04/12-07/11	THIRD QUARTER 07/11-10/06	FOURTH QUARTER 10/06-12/26
	79	18.9 ± 0.8	15.0 ± 0.7	16.2 ± 0.8	17.7 ± 0.8
	80	17.8 ± 0.3	16.5 ± 0.6	16.6 ± 0.8	17.4 ± 1.2
	81	18.0 ± 0.7	15.6 ± 0.8	17.0 ± 0.8	17.3 ± 1.0
	82	17.1 ± 1.0	15.7 ± 1.0	18.2 ± 0.5	17.5 ± 1.0
	83	17.9 ± 1.0	16.4 ± 1.1	17.7 ± 0.9	17.4 ± 0.5
	84	18.9 ± 1.1	17.2 ± 0.7	18.1 ± 1.2	18.3 ± 0.8
	85	17.0 ± 0.5	16.0 ± 0.5	15.9 ± 0.7	17.4 ± 0.9
	86	17.9 ± 0.6	18.7 ± 0.9	18.3 ± 0.5	17.1 ± 0.8
	87	18.3 ± 0.9	15.3 ± 0.8	17.0 ± 1.2	17.2 ± 1.3
	88	16.6 ± 0.5	15.7 ± 0.5	15.5 ± 0.4	16.1 ± 0.4
	89	18.1 ± 0.5	18.8 ± 0.7	17.2 ± 0.9	18.2 ± 0.9
	90	18.4 ± 0.7	14.7 ± 0.5	18.4 ± 0.5	17.5 ± 1.0
	91	16.7 ± 0.8	14.9 ± 0.7	15.1 ± 0.7	16.3 ± 1.1
	94	18.4 ± 1.0	16.5 ± 0.9	17.1 ± 1.1	17.0 ± 1.1
Average/Quarter		97 days	90.5 days	90.6 days	79.86 days
Average/Day		17.4±1.2 mR/97 days	15.9±1.4 mR/90.5 days	16.1±1.7 mR/90.6 days	16.8±1.0 mR/79.86 days
Range		0.18±0.01 mR/day	0.18±0.02 mR/day	0.17±0.02	0.21±0.01
Det./Total		(16-21)mR/97 days	(12-19)mR/90.5 days	(13-18)mR/90.6 days	(15-19) mR/79.86 days
		32/32	31/31	32/32	(32/32)

**TABLE J-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD  
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	Aver./Quarter	TOTAL mR/year 01/01/95-12/26/95
TLD (Gamma)	01	15.8 ± 0.9	63.3
	02	16.0 ± 1.5	63.9
	03	13.9 ± 1.5	55.4
	04	14.9 ± 1.0	59.5
	05	16.1 ± 2.0	64.5
	06	15.6 ± 1.1	62.2
	07	15.1 ± 1.2	60.2
	08	15.8 ± 0.6	63.3
	09	14.7 ± 1.1	58.9
	10	15.3 ± 1.0	61.2
	20	16.3 ± 1.2	65.1
	44	18.0 ± 1.2	72.1
	56	15.9 ± 0.8	63.4
	58	16.6 ± 0.6	66.2
	59	17.3 ± 0.3	69.1
	66	18.9 ± 0.6	56.8
	67	18.3 ± 1.8	73.1
	71	17.0 ± 1.0	67.8

**TABLE J-2**  
 1995 QUARTERLY REPORT  
 NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AMBIENT GAMMA RADIATION: TLD  
 milliRoentgen/Quarter

SAMPLE NUCLIDE	STATION NUMBER	Aver./Quarter	TOTAL mR/year 01/05/95-12/26/95
TLD (Gamma)	79	17.0 ± 1.7	67.8
	80	17.1 ± 0.6	68.3
	81	17.0 ± 1.0	67.9
	82	17.1 ± 1.1	68.5
	83	17.4 ± 0.7	69.4
	84	18.1 ± 0.7	72.5
	85	16.6 ± 0.7	66.3
	86	18.0 ± 0.7	72.0
	87	17.0 ± 1.2	67.8
	88	16.0 ± 0.5	63.9
	89	18.1 ± 0.7	72.3
	90	17.3 ± 1.8	69.0
	91	15.8 ± 0.9	63.0
	94	17.3 ± 0.8	69.0
		16.6 ± 0.4 Average mR/Quarter	65.7 ± 4.7
		Range(14-19)	Aver. total mR year. All stations Range (55.4-73.1)

**K FOOD - BROADLEAF VEGETATION**



**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 35**  
**STATION 35 - 2.0 MI. 350 DEG. CON.**

DATE COLLECTED:	05/16 CURLY DOCK		05/16 WILD MUSTARDS		05/16 WILD CARROT		06/28 VINES		06/28 BL 2		
<b>RADIOCHEMICAL ANALYSIS:</b>											
I-131	LT. 7.	E-03	LT. 5.	E-03	LT. 7.	E-03	LT. 1.	E-02	LT. 1.	E-02	
<b>GAMMA SPECTRUM ANALYSIS:</b>											
BE-7	7.17±1.01	E-01	2.23±0.22	E 00	1.36±0.14	E 00	1.39±0.14	E 00	2.58±0.26	E 00	
K-40	5.43±0.54	E 00	4.07±0.41	E 00	5.70±0.57	E 00	4.26±0.43	E 00	8.52±0.85	E 00	
MN-54	LT. 1.	E-02	LT. 2.	E-02	LT. 9.	E-03	LT. 2.	E-02	LT. 1.	E-02	
CO-58	LT. 1.	E-02	LT. 2.	E-02	LT. 9.	E-03	LT. 2.	E-02	LT. 1.	E-02	
FE-59	LT. 3.	E-02	LT. 4.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	
CO-60	LT. 1.	E-02	LT. 2.	E-02	LT. 9.	E-03	LT. 2.	E-02	LT. 1.	E-02	
ZN-65	LT. 3.	E-02	LT. 5.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	
ZR-95	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	
RU-103	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	
RU-106	LT. 1.	E-01	LT. 2.	E-01	LT. 9.	E-02	LT. 1.	E-01	LT. 1.	E-01	
I-131	LT. 3.	E-02	LT. 5.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 4.	E-02	
CS-134	LT. 2.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	
CS-137	LT. 2.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	
BA-140	LT. 2.	E-02	LT. 4.	E-02	LT. 1.	E-02	LT. 3.	E-02	LT. 2.	E-02	
CE-141	LT. 2.	E-02	LT. 4.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	
CE-144	LT. 8.	E-02	LT. 1.	E-01	LT. 6.	E-02	LT. 9.	E-02	LT. 7.	E-02	
RA-226	LT. 3.	E-01	LT. 4.	E-01	LT. 2.	E-01	LT. 3.	E-01	LT. 2.	E-01	
TH-228	LT. 3.	E-02	8.53±2.90	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 2.	E-02	

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - INGESTION  
 VEGETATION - TERRESTRIAL, BROADLEAF  
 (PCI/GM WET)  
 STATION NUMBER 35  
 STATION 35 - 2.0 MI. 350 DEG. CON.

DATE COLLECTED:	06/28 CURLY DOCK	07/18 VINE	07/18 BL#1	07/18 WILD RHUBARB	07/18 QA VINE
RADIOCHEMICAL ANALYSIS:					
I-131	LT. 1. E-02	LT. 8. E-03	LT. 7. E-03	LT. 1. E-02	LT. 7. E-03
GAMMA SPECTRUM ANALYSIS:					
BE-7	4.08±0.41 E 00	2.77±0.28 E 00	2.35±0.24 E 00	3.54±0.71 E-01	2.01±0.20 E 00
K-40	1.16±0.12 E 01	6.26±0.63 E 00	7.91±0.79 E 00	6.79±0.68 E 00	4.66±0.47 E 00
MN-54	LT. 4. E-02	LT. 2. E-02	LT. 2. E-02	LT. 9. E-03	LT. 2. E-02
CO-58	LT. 4. E-02	LT. 2. E-02	LT. 2. E-02	LT. 9. E-03	LT. 2. E-02
FE-59	LT. 9. E-02	LT. 5. E-02	LT. 5. E-02	LT. 2. E-02	LT. 4. E-02
CO-60	LT. 4. E-02	LT. 2. E-02	LT. 2. E-02	LT. 9. E-03	LT. 2. E-02
ZN-65	LT. 9. E-02	LT. 5. E-02	LT. 5. E-02	LT. 2. E-02	LT. 4. E-02
ZR-95	LT. 4. E-02	LT. 2. E-02	LT. 2. E-02	LT. 9. E-03	LT. 2. E-02
RU-103	LT. 4. E-02	LT. 2. E-02	LT. 2. E-02	LT. 9. E-03	LT. 2. E-02
RU-106	LT. 4. E-01	LT. 2. E-01	LT. 2. E-01	LT. 7. E-02	LT. 2. E-01
I-131	LT. 8. E-02	LT. 4. E-02	LT. 4. E-02	LT. 2. E-02	LT. 4. E-02
CS-134	LT. 5. E-02	LT. 3. E-02	LT. 2. E-02	LT. 1. E-02	LT. 2. E-02
CS-137	LT. 5. E-02	LT. 2. E-02	LT. 2. E-02	LT. 9. E-03	LT. 2. E-02
BA-140	LT. 7. E-02	LT. 3. E-02	LT. 3. E-02	LT. 9. E-03	LT. 3. E-02
CE-141	LT. 6. E-02	LT. 3. E-02	LT. 3. E-02	LT. 2. E-02	LT. 3. E-02
CE-144	LT. 2. E-01	LT. 1. E-01	LT. 1. E-01	LT. 7. E-02	LT. 1. E-01
RA-226	LT. 8. E-01	LT. 5. E-01	LT. 3. E-01	LT. 2. E-01	LT. 3. E-01
TH-228	1.05±0.39 E-01	LT. 4. E-02	LT. 3. E-02	LT. 2. E-02	LT. 3. E-02

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 35**  
**STATION 35 - 2.0 MI. 350 DEG. CON.**

DATE COLLECTED:	08/15 WILD GRAPE		08/15 GIANT RAGWEED		08/15 RED ROOT		09/19 BL 1		09/19 BL 2	
<b>RADIOCHEMICAL ANALYSIS:</b>										
I-131	L.T. 1.	E-02	L.T. 1.	E-02	L.T. 9.	E-03	L.T. 9.	E-03	L.T. 1.	E-02
<b>GAMMA SPECTRUM ANALYSIS:</b>										
BE-7	1.67±0.21	E 00	3.44±0.34	E 00	1.37±0.14	E 00	1.16±0.18	E 00	1.74±0.18	E 00
K-40	3.83±0.38	E 00	7.87±0.79	E 00	3.63±0.36	E 00	6.05±0.60	E 00	4.56±0.46	E 00
MN-54	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	L.T. 2.	E-02	L.T. 2.	E-02
CO-58	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	L.T. 2.	E-02	L.T. 2.	E-02
FE-59	L.T. 4.	E-02	L.T. 4.	E-02	L.T. 3.	E-02	L.T. 4.	E-02	L.T. 4.	E-02
CO-60	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	L.T. 2.	E-02	L.T. 2.	E-02
ZN-65	L.T. 5.	E-02	L.T. 5.	E-02	L.T. 3.	E-02	L.T. 4.	E-02	L.T. 4.	E-02
ZR-95	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	L.T. 2.	E-02	L.T. 2.	E-02
RU-103	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	L.T. 2.	E-02	L.T. 2.	E-02
RU-106	L.T. 2.	E-01	L.T. 2.	E-01	L.T. 1.	E-01	L.T. 2.	E-01	L.T. 2.	E-01
I-131	L.T. 3.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 3.	E-02
CS-134	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	L.T. 2.	E-02	L.T. ?	E-02
CS-137	L.T. 3.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	L.T. 2.	E-02	L.T. 2.	E-02
BA-140	L.T. 3.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	L.T. 3.	E-02	L.T. 2.	E-02
CE-141	L.T. 4.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 3.	E-02	L.T. 4.	E-02
CE-144	L.T. 2.	E-01	L.T. 1.	E-01	L.T. 1.	E-01	L.T. 1.	E-01	L.T. 1.	E-01
RA-226	L.T. 5.	E-01	L.T. 3.	E-01	L.T. 3.	E-01	L.T. 3.	E-01	L.T. 4.	E-01
TH-228	L.T. 5.	E-02	L.T. 3.	E-02	L.T. 3.	E-02	L.T. 3.	E-02	L.T. 4.	E-02

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 35**  
**STATION 35 - 2.0 MI. 350 DEG. CON.**

DATE COLLECTED:	09/19 GIANT RAGWEED		10/10 WHITEFLOWER		10/10 SANDWEED		10/10 VINE		10/10 QA VINE		
<b>RADIOCHEMICAL ANALYSIS:</b>											
I-131	L.T. 9.	E-03	L.T. 6.	E-03	L.T. 7.	E-03	L.T. 7.	E-03	L.T. 5.	E-03	
<b>GAMMA SPECTRUM ANALYSIS:</b>											
BE-7	2.31±0.23	E 00	2.92±0.29	E 00	2.14±0.21	E 00	1.41±0.15	E 00	2.40±0.24	E 00	
K-40	6.54±0.65	E 00	5.89±0.59	E 00	6.53±0.65	E 00	4.13±0.41	E 00	5.39±0.54	E 00	
MN-54	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	
CO-58	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	
FE-59	L.T. 4.	E-02	L.T. 4.	E-02	L.T. 4.	E-02	L.T. 4.	E-02	L.T. 3.	E-02	
CO-60	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	
ZN-65	L.T. 4.	E-02	L.T. 4.	E-02	L.T. 4.	E-02	L.T. 4.	E-02	L.T. 3.	E-02	
ZR-95	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	
PU-103	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	
RU-106	L.T. 2.	E-01	L.T. 2.	E-01	L.T. 2.	E-01	L.T. 2.	E-01	L.T. 1.	E-01	
I-131	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 3.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	
CS-134	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	
CS-137	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 1.	E-02	
BA-140	L.T. 2.	E-02	L.T. 2.	E-02	L.T. 3.	E-02	L.T. 2.	E-02	L.T. 2.	E-02	
CE-141	L.T. 2.	E-02	L.T. 3.	E-02	L.T. 4.	E-02	L.T. 2.	E-02	L.T. 3.	E-02	
CE-144	L.T. 9.	E-02	L.T. 1.	E-01	L.T. 1.	E-01	L.T. 1.	E-01	L.T. 1.	E-01	
RA-226	L.T. 3.	E-01	L.T. 4.	E-01	L.T. 4.	E-01	L.T. 3.	E-01	L.T. 3.	E-01	
TH-228	L.T. 3.	E-02	L.T. 3.	E-02	L.T. 4.	E-02	L.T. 3.	E-02	L.T. 3.	E-02	

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 96**  
**STATION 96 - 1.25 MI. 334 DEG. IND.**

DATE COLLECTED:	05/16 PLANTAIN	05/16 DANDELION	05/16 DANDELION QA	05/16 CURLY DOCK	06/27 FLEABANE
<b>RADIOCHEMICAL ANALYSIS:</b>					
I-131	L.T. 4. E-03	L.T. 8. E-03	L.T. 6. E-03	L.T. 6. E-03	L.T. 1. E-02
<b>GAMMA SPECTRUM ANALYSIS:</b>					
BE-7	2.10±0.21 E 00	2.56±0.26 E 00	2.77±0.28 E 00	1.74±0.17 E 00	4.27±0.43 E 00
K-40	5.53±0.55 E 00	6.10±0.61 E 00	6.56±0.66 E 00	6.91±0.69 E 00	1.02±0.10 E 01
MN-54	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 3. E-02
CO-58	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 3. E-02
FE-59	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 6. E-02
CO-60	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 9. E-03	L.T. 3. E-02
ZN-65	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 6. E-02
ZR-95	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 3. E-02
RU-103	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 3. E-02
RU-106	L.T. 1. E-01	L.T. 1. E-01	L.T. 1. E-01	L.T. 9. E-02	L.T. 3. E-01
I-131	L.T. 3. E-02	L.T. 3. E-02	L.T. 3. E-02	L.T. 2. E-02	L.T. 6. E-02
CS-134	L.T. 1. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 1. E-02	L.T. 3. E-02
CS-137	L.T. 1. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 3. E-02
BA-140	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02	L.T. 5. E-02
CE-141	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02	L.T. 4. E-02
CE-144	L.T. 7. E-02	L.T. 9. E-02	L.T. 8. E-02	L.T. 6. E-02	L.T. 1. E-01
RA-226	L.T. 2. E-01	L.T. 3. E-01	L.T. 3. E-01	L.T. 2. E-01	L.T. 5. E-01
TH-228	7.14±1.41 E-02	1.06±0.15 E-01	L.T. 3. E-02	L.T. 2. E-02	1.74±0.28 E-01
RA-224		3.40±1.78 E-01			

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 96**  
**STATION 96 - 1.25 MI. 334 DEG. IND.**

DATE COLLECTED:	06/27 BUNDLEFLOWER		06/27 BL 3		07/18 SMARTWEED		07/18 MILKWEED		07/18 COCKLEBURR		
<b>RADIOCHEMICAL ANALYSIS:</b>											
I-131	LT. 1.	E-02	LT. 9.	E-03	LT. 7.	E-03	LT. 7.	E-03	LT. 9.	E-03	
<b>GAMMA SPECTRUM ANALYSIS:</b>											
BE-7	1.31±0.15 E 00		1.56±0.16 E 00		2.52±0.25 E 00		7.83±1.79 E-01		1.19±0.12E 00		
K-40	7.53±0.75 E 00		8.85±0.88 E 00		3.76±0.38 E 00		6.36±0.64 E 00		7.53±0.75E 00		
MN-54	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 1.	E-02	
CO-58	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 1.	E-02	
FE-59	LT. 4.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 5.	E-02	LT. 3.	E-02	
CO-60	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 1.	E-02	
ZN-65	LT. 4.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 6.	E-02	LT. 3.	E-02	
ZR-95	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 1.	E-02	
RU-103	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 1.	E-02	
RU-106	LT. 2.	E-01	LT. 1.	E-01	LT. 2.	E-01	LT. 2.	E-01	LT. 1.	E-01	
I-131	LT. 4.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 5.	E-02	LT. 2.	E-02	
CS-134	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 1.	E-02	
CS-137	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 1.	E-02	
BA-140	LT. 3.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 1.	E-02	
CE-141	LT. 3.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 1.	E-02	
CE-144	LT. 1.	E-01	LT. 8.	E-02	LT. 1.	E-01	LT. 1.	E-01	LT. 5.	E-02	
RA-226	LT. 4.	E-01	LT. 2.	E-01	LT. 4.	E-01	LT. 5.	E-01	LT. 2.	E-01	
TH-228	LT. 3.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 2.	E-02	

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 96**  
**STATION 96 - 1.25 MI. 334 DEG. IND.**

DATE COLLECTED:	08/15 RED ROOT	08/15 COMMON RAGWEED	08/15 BUNDLEWEED	08/15 QA RED ROOT	09/19 GOLDENROD
<b>RADIOCHEMICAL ANALYSIS:</b>					
I-131	LT. 7. E-03	LT. 1. E-02	LT. 1. E-02	LT. 9. E-03	LT. 7. E-03
<b>GAMMA SPECTRUM ANALYSIS:</b>					
BE-7	2.42±0.24 E 00	1.44±0.14 E 00	7.13±1.11 E-01	1.63±0.16 E 00	1.91±0.19E 00
K-40	3.88±0.39 E 00	7.07±0.71 E 00	3.32±0.33 E 00	4.73±0.47 E 00	5.66±0.57E 00
MN-54	LT. 1. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
CO-58	LT. 1. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
FE-59	LT. 3. E-02	LT. 3. E-02	LT. 3. E-02	LT. 4. E-02	LT. 3. E-02
CO-60	LT. 2. E-02	LT. 1. E-02	LT. 2. E-02	LT. 2. E-02	LT. 1. E-02
ZN-65	LT. 3. E-02	LT. 3. E-02	LT. 3. E-02	LT. 4. E-02	LT. 3. E-02
ZR-95	LT. 1. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
RU-103	LT. 1. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
RU-106	LT. 1. E-01	LT. 1. E-01	LT. 1. E-01	LT. 2. E-01	LT. 1. E-01
I-131	LT. 2. E-02	LT. 2. E-02	LT. 2. E-02	LT. 3. E-02	LT. 2. E-02
CS-134	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
CS-137	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
BA-140	LT. 2. E-02	LT. 2. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
CE-141	LT. 2. E-02	LT. 2. E-02	LT. 2. E-02	LT. 3. E-02	LT. 2. E-02
CE-144	LT. 8. E-02	LT. 7. E-02	LT. 1. E-01	LT. 1. E-01	LT. 8. E-02
RA-226	LT. 3. E-01	LT. 2. E-01	LT. 3. E-01	LT. 4. E-01	LT. 2. E-01
TH-228	LT. 3. E-02	1.94±0.19 E-01	LT. 3. E-02	LT. 3. E-02	LT. 2. E-02

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 96**  
**STATION 96 - 1.25 MI. 334 DEG. IND.**

DATE COLLECTED:	09/19 BL 2	09/19 BL 3	10/10 GOLDENROD	10/10 POKEWEED	10/10 SMARTWEED
<b>RADIOCHEMICAL ANALYSIS:</b>					
I-131	LT. 1. E-02	LT. 1. E-02	LT. 7. E-03	LT. 6. E-03	LT. 8. E-03
<b>GAMMA SPECTRUM ANALYSIS:</b>					
BE-7	7.14±1.65 E-01	8.02±0.95 E-01	1.77±0.18 E 00	6.72±1.12 E-01	4.06±0.41 E 00
K-40	3.00±0.30 E 00	5.07±0.51 E 00	6.46±0.65 E 00	9.69±0.97 E 00	2.65±0.26 E 00
MN-54	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
CO-58	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
FE-59	LT. 5. E-02	LT. 3. E-02	LT. 3. E-02	LT. 4. E-02	LT. 3. E-02
CO-60	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
ZN-65	LT. 5. E-02	LT. 2. E-02	LT. 3. E-02	LT. 4. E-02	LT. 4. E-02
ZR-95	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 1. E-02
RU-103	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 2. E-02
RU-106	LT. 2. E-01	LT. 1. E-01	LT. 1. E-01	LT. 1. E-01	LT. 1. E-01
I-131	LT. 4. E-02	LT. 3. E-02	LT. 2. E-02	LT. 2. E-02	LT. 3. E-02
CS-134	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 2. E-02
CS-137	LT. 2. E-02	LT. 1. E-02	LT. 1. E-02	LT. 2. E-02	LT. 2. E-02
BA-140	LT. 3. E-02	LT. 2. E-02	LT. 1. E-02	LT. 2. E-02	LT. 2. E-02
CE-141	LT. 4. E-02	LT. 2. E-02	LT. 2. E-02	LT. 2. E-02	LT. 2. E-02
CE-144	LT. 2. E-01	LT. 9. E-02	LT. 8. E-02	LT. 8. E-02	LT. 9. E-02
RA-226	LT. 4. E-01	LT. 3. E-01	LT. 2. E-01	LT. 2. E-01	LT. 3. E-01
TH-228	LT. 4. E-02	LT. 2. E-02	LT. 2. E-02	LT. 2. E-02	LT. 3. E-02



**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 101**  
**STATION 101 - 13.3 MI. 73 DEG. CON.**

DATE COLLECTED:	05/16 CURLY DOCK		05/16 DANDELION		05/16 PENNYCREST		06/28 SMARTWEED		06/28 RAGWEED		
<b>RADIOCHEMICAL ANALYSIS:</b>											
I-131	LT. 5.	E-03	LT. 7.	E-03	LT. 6.	E-03	LT. 9.	E-03	LT. 1.	E-02	
<b>GAMMA SPECTRUM ANALYSIS:</b>											
BE-7	1.44±0.14	E 00	2.15±0.22	E 00	1.16±0.12	E 00	2.08±0.21	E 00	2.98±0.30	E 00	
K-40	3.69±0.37	E 00	4.21±0.42	E 00	3.87±0.39	E 00	4.93±0.49	E 00	7.86±0.79	E 00	
MN-54	LT. 6.	E-03	LT. 6.	E-03	LT. 8.	E-03	LT. 2.	E-02	LT. 2.	E-02	
CO-58	LT. 7.	E-03	LT. 6.	E-03	LT. 9.	E-03	LT. 2.	E-02	LT. 2.	E-02	
FE-59	LT. 1.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 4.	E-02	LT. 3.	E-02	
CO-60	LT. 7.	E-03	LT. 6.	E-03	LT. 9.	E-03	LT. 2.	E-02	LT. 1.	E-02	
ZN-65	LT. 1.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 4.	E-02	LT. 3.	E-02	
ZR-95	LT. 7.	E-03	LT. 7.	E-03	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
RU-103	LT. 8.	E-03	LT. 7.	E-03	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
RU-106	LT. 6.	E-02	LT. 5.	E-02	LT. 8.	E-02	LT. 2.	E-01	LT. 1.	E-01	
I-131	LT. 2.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 6.	E-02	LT. 4.	E-02	
CS-134	LT. 7.	E-03	LT. 7.	E-03	LT. 9.	E-03	LT. 2.	E-02	LT. 2.	E-02	
CS-137	LT. 8.	E-03	LT. 7.	E-03	2.72±0.74	E-02	LT. 2.	E-02	LT. 2.	E-02	
BA-140	LT. 1.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 4.	E-02	LT. 3.	E-02	
CE-141	LT. 1.	E-02	LT. 1.	E-02	LT. 1.	E-02	LT. 3.	E-02	LT. 2.	E-02	
CE-144	LT. 4.	E-02	LT. 4.	E-02	LT. 5.	E-02	LT. 1.	E-01	LT. 8.	E-02	
RA-226	LT. 2.	E-01	LT. 1.	E-01	LT. 1.	E-01	LT. 3.	E-01	LT. 3.	E-01	
TH-228	LT. 1.	E-02	2.90±0.67	E-02	6.08±0.81	E-02	LT. 3.	E-02	LT. 3.	E-02	

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 101**  
**STATION 101 - 13.3 MI. 73 DEG. CON.**

DATE COLLECTED:	06/28 MILKWEED		06/28 QA SMARTWEED		07/18 COCKLEBURR		07/18 RAGWEED		07/18 SMARTWEED		
<b>RADIOCHEMICAL ANALYSIS:</b>											
I-131	LT. 1.	E-02	LT. 1.	E-02	LT. 1.	E-02	LT. 8.	E-03	LT. 7.	E-03	
<b>GAMMA SPECTRUM ANALYSIS:</b>											
BE-7	1.19±0.12	E 00	1.46±0.15	E 00	1.36±0.14	E 00	3.05±0.31	E 00	2.04±0.20	E 00	
K-40	5.57±0.56	E 00	4.42±0.44	E 00	9.05±0.90	E 00	9.88±0.99	E 00	5.24±0.52	E 00	
MN-54	LT. 9.	E-03	LT. 2.	E-02	LT. 1.	E-02	LT. 1.	E-02	LT. 1.	E-02	
CO-58	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 1.	E-02	LT. 1.	E-02	
FE-59	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 4.	E-02	
CO-60	LT. 1.	E-02	LT. 1.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
ZN-65	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 4.	E-02	
ZR-95	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
RU-103	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
RU-106	LT. 9.	E-02	LT. 1.	E-01	LT. 1.	E-01	LT. 1.	E-01	LT. 1.	E-01	
I-131	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 3.	E-02	
CS-134	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
CS-137	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
BA-140	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	
CE-141	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 2.	E-02	
CE-144	LT. 5.	E-02	LT. 9.	E-02	LT. 8.	E-02	LT. 9.	E-02	LT. 8.	E-02	
RA-226	LT. 2.	E-01	LT. 3.	E-01	LT. 2.	E-01	LT. 3.	E-01	LT. 3.	E-01	
TH-228	LT. 2.	E-02	LT. 3.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 2.	E-02	

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 101**  
**STATION 101 - 13.3 MI. 73 DEG. CON.**

DATE COLLECTED:	08/15 MILKWEED		08/15 SMARTWEED		08/15 WILD CUCUMBER		09/19 BL 1		09/19 SMARTWEED		
<b>RADIOCHEMICAL ANALYSIS:</b>											
I-131	LT. 8.	E-03	LT. 8.	E-03	LT. 8.	E-03	LT. 8.	E-03	LT. 1.	E-02	
<b>GAMMA SPECTRUM ANALYSIS:</b>											
BE-7	2.09±0.21	E 00	2.73±0.27	E 00	1.95±0.19	E 00	1.18±0.15	E 00	3.40±0.34	E 00	
K-40	7.92±0.79	E 00	3.50±0.35	E 00	5.23±0.52	E 00	7.64±0.76	E 00	2.79±0.28	E 00	
MN-54	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 1.	E-02	LT. 2.	E-02	
CO-58	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
FE-59	LT. 3.	E-02	LT. 4.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 4.	E-02	
CO-60	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	
ZN-65	LT. 4.	E-02	LT. 4.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 4.	E-02	
ZR-95	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
RU-103	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
RU-106	LT. 1.	E-01	LT. 2.	E-01	LT. 1.	E-01	LT. 1.	E-01	LT. 2.	E-01	
I-131	LT. 2.	E-02	LT. 3.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	
CS-134	LT. 2.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
CS-137	LT. 1.	E-02	LT. 2.	E-02	LT. 1.	E-02	LT. 2.	E-02	LT. 2.	E-02	
BA-140	LT. 2.	E-02	LT. 3.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 3.	E-02	
CE-141	LT. 2.	E-02	LT. 4.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	
CE-144	LT. 8.	E-02	LT. 1.	E-01	LT. 8.	E-02	LT. 1.	E-01	LT. 1.	E-01	
RA-226	LT. 2.	E-01	LT. 4.	E-01	LT. 2.	E-01	LT. 4.	E-01	LT. 3.	E-01	
TH-228	LT. 2.	E-02	LT. 4.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 3.	E-02	

**NEBRASKA PUBLIC POWER DISTRICT**  
**COOPER NUCLEAR STATION**  
**EXPOSURE PATHWAY - INGESTION**  
**VEGETATION - TERRESTRIAL, BROADLEAF**  
**(PCI/GM WET)**  
**STATION NUMBER 101**  
**STATION 101 - 13.3 MI. 73 DEG. CON.**

DATE COLLECTED:	09/19 Bl. 3		09/19 QA Bl 1		10/10 SMARTWEED		10/10 GOLDENROD		10/10 CURLY DOCK		
<b>RADIOCHEMICAL ANALYSIS:</b>											
I-131	LT. 7.	E-03	LT. 7.	E-03	LT. 8.	E-03	LT. 1.	E-02	LT. 7.	E-03	
<b>GAMMA SPECTRUM ANALYSIS:</b>											
9E-7	1.49±0.15	E 00	8.38±1.41	E-01	3.46±0.35	E 00	4.20±0.42	E 00	5.87±0.78	E-01	
K-40	7.61±0.76	E 00	8.43±0.84	E 00	4.74±0.47	E 00	8.61±0.86	E 00	9.06±0.91	E 00	
MN-54	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 8.	E-03	
CO-58	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 8.	E-03	
FE-59	LT. 4.	E-02	LT. 4.	E-02	LT. 4.	E-02	LT. 4.	E-02	LT. 2.	E-02	
CO-60	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 1.	E-02	
ZN-65	LT. 4.	E-02	LT. 4.	E-02	LT. 5.	E-02	LT. 4.	E-02	LT. 2.	E-02	
ZR-95	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 8.	E-03	
RU-103	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 8.	E-03	
RU-106	LT. 2.	E-01	LT. 2.	E-01	LT. 2.	E-01	LT. 2.	E-01	LT. 7.	E-02	
I-131	LT. 3.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 1.	E-02	
CS-134	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 9.	E-03	
CS-137	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 2.	E-02	LT. 8.	E-03	
BA-140	LT. 3.	E-02	LT. 2.	E-02	LT. 3.	E-02	LT. 2.	E-02	LT. 9.	E-03	
CE-141	LT. 3.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 3.	E-02	LT. 1.	E-02	
CE-144	LT. 1.	E-01	LT. 1.	E-01	LT. 1.	E-01	LT. 1.	E-01	LT. 4.	E-02	
RA-226	LT. 3.	E-01	LT. 3.	E-01	LT. 4.	E-01	LT. 4.	E-01	LT. 1.	E-01	
TH-228	LT. 3.	E-02	LT. 3.	E-02	LT. 4.	E-02	LT. 3.	E-02	LT. 1.	E-02	

**L SHORELINE SEDIMENT**

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - AIRBORNE  
 SHORELINE SEDIMENT  
 (PCI/GM DRY)  
 STATION NUMBER 28  
 STATION 28 - 1.8 MI. 150 DEG. IND.

DATE COLLECTED:	05/02	10/31	10/31 QA
GAMMA SPECTRUM ANALYSIS:			
BE-7	4.14±0.63 E-01	L.T. 7. E-02	L.T. 8. E-02
K-40	1.83±0.18 E 01	1.77±0.18 E 01	1.78±0.18 E 01
MN-54	9.58±5.44 E-03	1.32±0.45 E-02	1.04±0.57 E-02
CO-58	L.T. 9. E-03	L.T. 8. E-03	L.T. 8. E-03
FE-59	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
CO-60	L.T. 9. E-03	L.T. 9. E-03	L.T. 9. E-03
ZN-65	L.T. 2. E-02	L.T. 2. E-02	L.T. 2. E-02
ZR-95	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
RU-103	L.T. 1. E-02	L.T. 8. E-03	L.T. 9. E-03
RU-106	L.T. 8. E-02	L.T. 7. E-02	L.T. 8. E-02
I-131	L.T. 3. E-02	L.T. 1. E-02	L.T. 2. E-02
CS-134	L.T. 1. E-02	L.T. 1. E-02	L.T. 1. E-02
CS-137	5.73±0.63 E-02	9.78±0.98 E-02	9.96±1.00 E-02
BA-140	L.T. 3. E-02	L.T. 1. E-02	L.T. 1. E-02
CE-141	L.T. 2. E-02	L.T. 2. E-02	L.T. 1. E-02
CE-144	L.T. 6. E-02	L.T. 6. E-02	L.T. 6. E-02
RA-226	1.80±0.18 E 00	2.04±0.20 E 00	1.84±0.18 E 00
TH-228	L.T. 3. E-02	9.82±0.98 E-01	1.00±0.10 E 00

100


## REFERENCES

1. Nebraska Public Power District, Cooper Nuclear Station Environmental Radiation Monitoring Program, Annual Report, January 1, 1982-December 31, 1982 (prepared by Teledyne Isotopes).
2. Nebraska Public Power District, Cooper Nuclear Station Environmental Radiation Monitoring Program, Annual Report, January 1, 1983-December 31, 1983 (prepared by Teledyne Isotopes).
3. Nebraska Public Power District Cooper Nuclear Station, Environmental Monitoring Program, Annual Report, January 1, 1984 to December 31, 1984. (Prepared by Teledyne Isotopes).
4. U.S. Department of Energy; EML 440 March 1985; EML-444 April 1989; Environmental Measurements Laboratory, US Department of Energy, New York, New York 10014.
5. U.S. Environmental Protection Agency; Environmental Radiation Data, Report 35, July -- September 1983, Report 39, July -- September 1985; Report 40, October -- December 1984; Report 41, January -- March 1985. Report 42, April -- June 1985; Report 43, July-September 1985, Report 44-45, October-March 1986; Report 46, April-June 1986; Report 47, July-September 1986; Report 48, October-December 1986; Report 49, January-March 1987. Environmental Radiation Facility, Montgomery, Alabama.
6. U.S. Department of Energy; EML 460, October 1, 1986; Environmental Measurements Laboratory, US Department of Energy, New York, New York 10014.
7. U.S. Nuclear Regulatory Commission, 1975, Regulatory Guide 4.8, Environmental Technical Specifications for Nuclear Power Plants.





**APPENDICES**

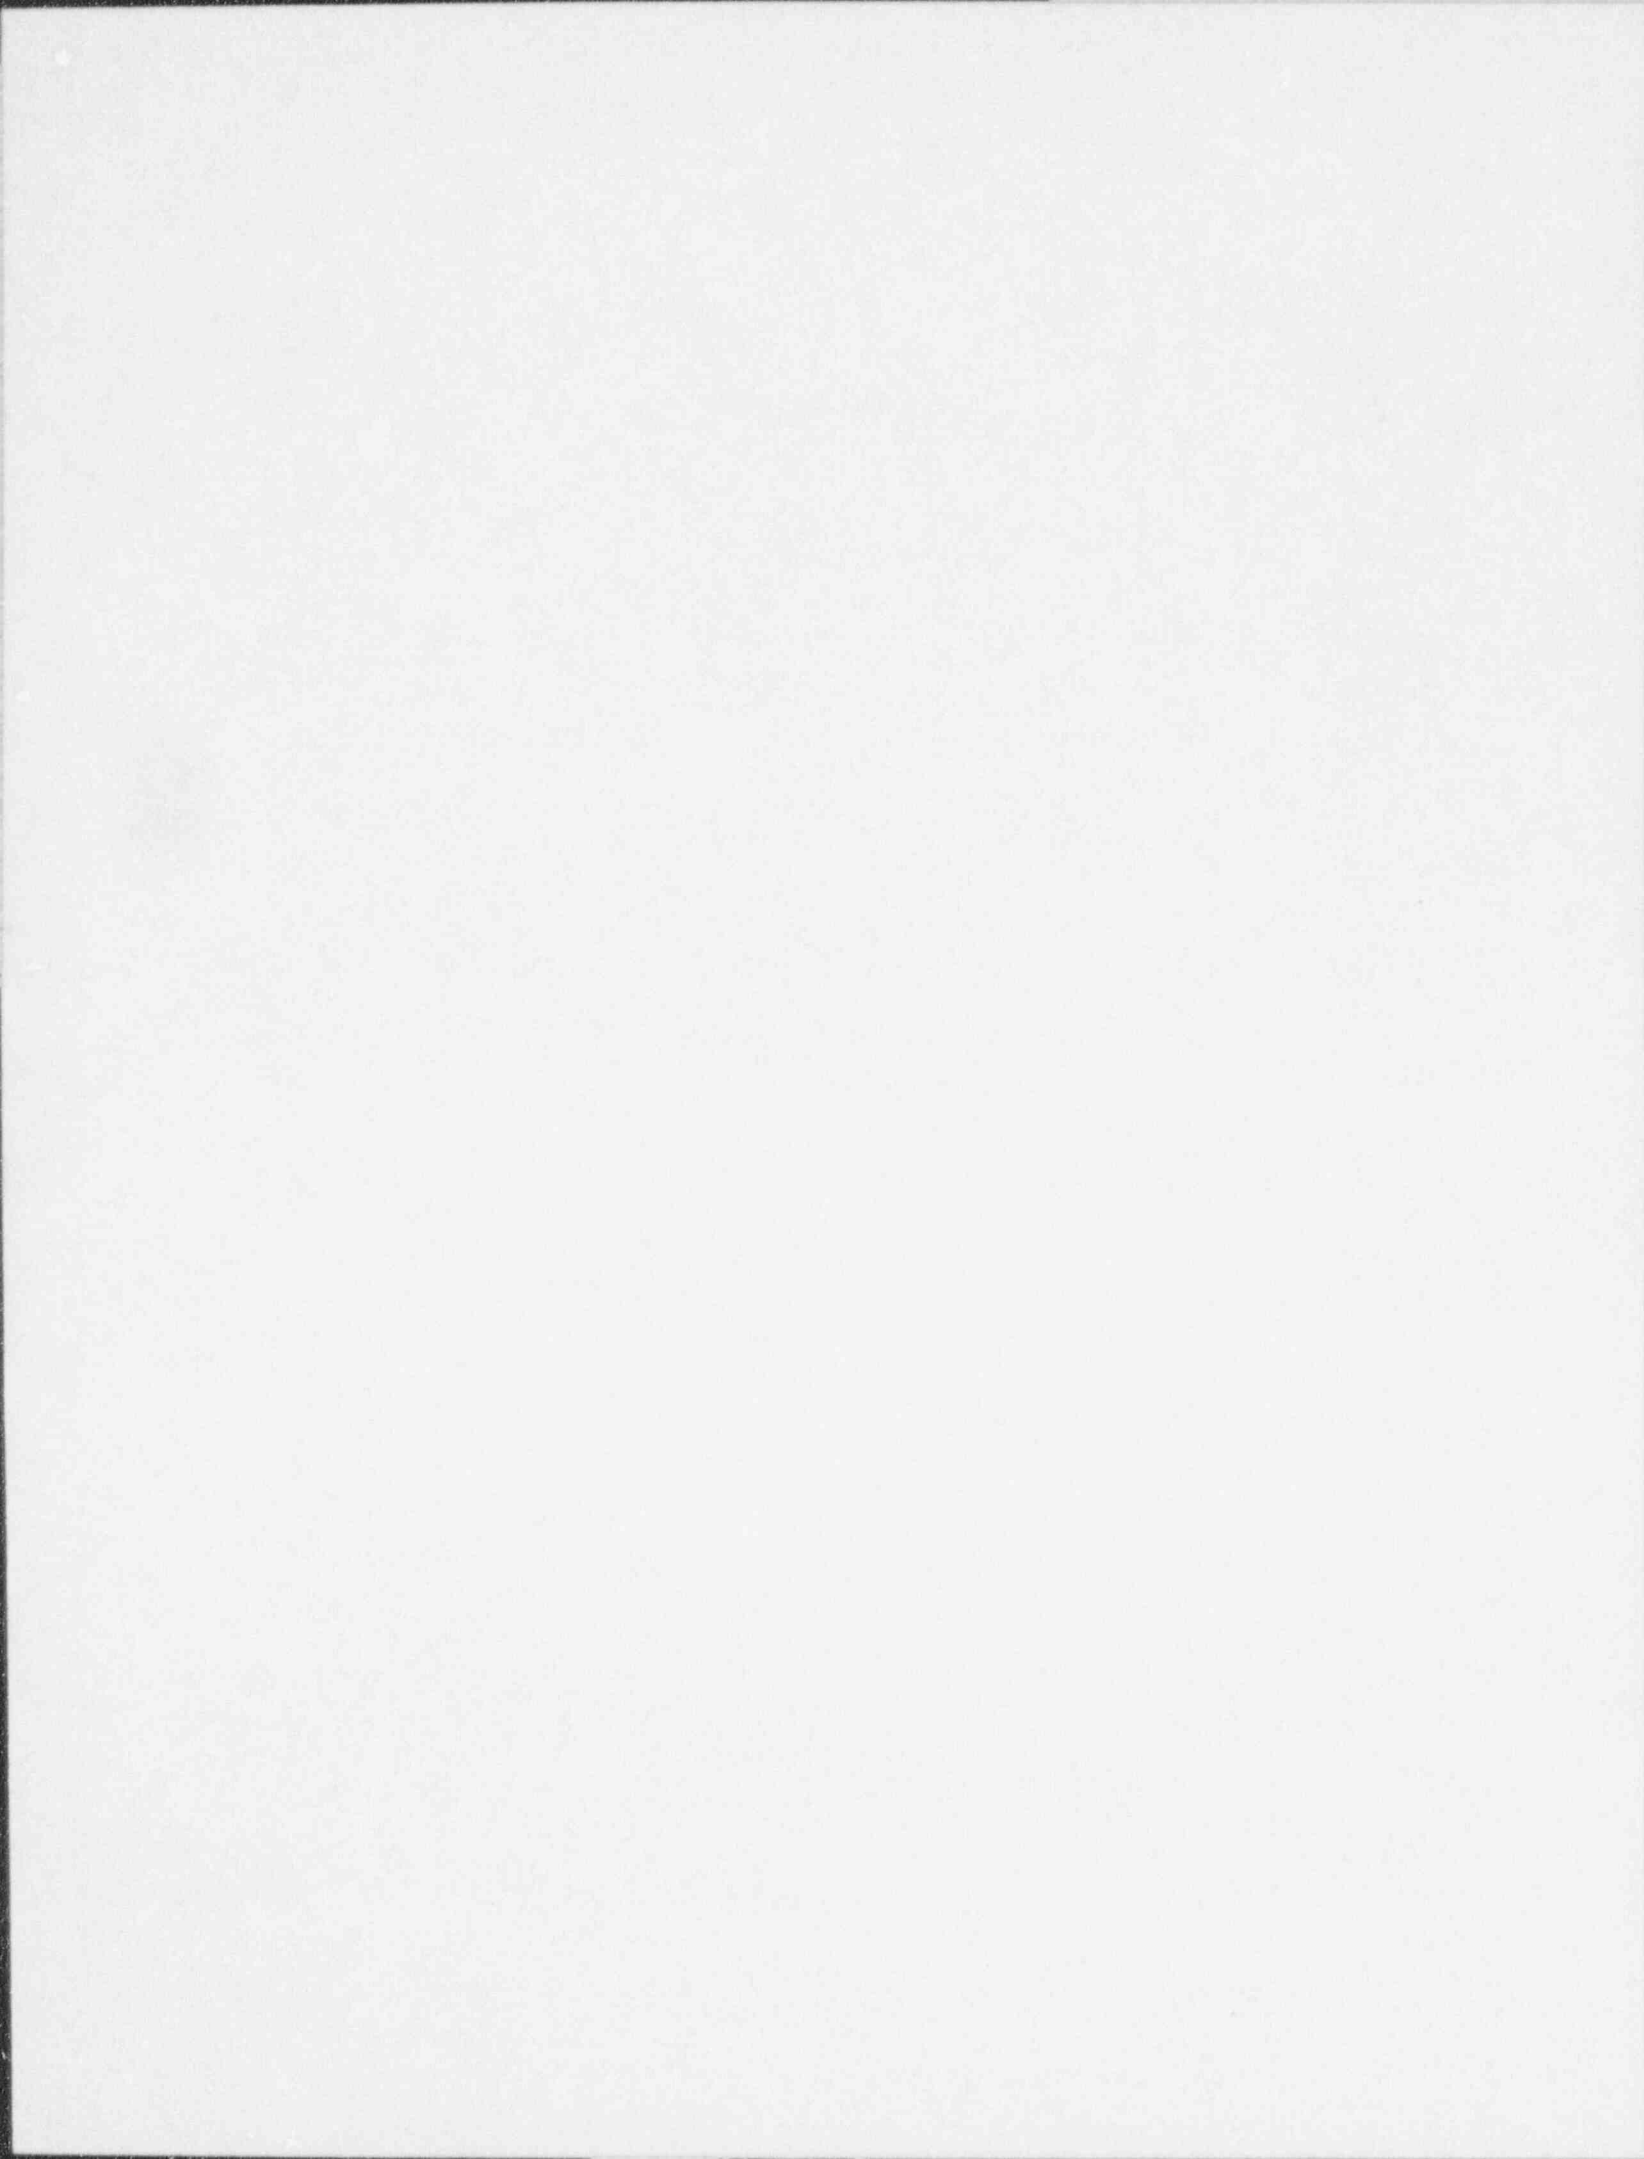

APPENDIX A  
SUMMARY OF LAND USE CENSUS

## LAND USE CENSUS

June 29, 1995

0-3 Miles

Cooper Nuclear Station (CNS) Radiological Effluent Technical Specifications (RETS) require an annual land use census. This census identifies the location of the nearest garden that is greater than 500 square feet in area and yields leafy green vegetables, the nearest milk animal, and the location of the nearest resident in each of the 16 meteorological sectors within 3 miles of CNS.

In accordance with CNS RETS, a land use census was performed on June 29, 1995. The nearest garden to CNS is in sector L, 1.3 miles from CNS. The nearest resident to CNS is in sector Q, 0.9 miles from CNS.

No milk animals were found within 3 miles of CNS in 1995 and there was no evidence of potable water use from the river.

LAND USE CENSUS

June 29, 1995

0-3 Miles

SECTOR	NEAREST RESIDENT		NEAREST GARDEN		NEAREST MILK ANIMAL
A	3.0 Miles	1.0°	3.0 Miles	1.0°	NONE
B	2.7 Miles	13.0°	NONE		NONE
C	NONE		NONE		NONE
D	1.7 Miles	62.0°	1.7 Miles	62.0°	NONE
E	1.8 Miles	94.0°	1.8 Miles	94.0°	NONE
F	2.4 Miles	112°	2.4 Miles	112°	NONE
G	NONE		NONE		NONE
H	NONE		NONE		NONE
J	NONE		NONE		NONE
K	NONE		NONE		NONE
L	1.3 Miles	221.0°	1.3 Miles	221.0°	NONE
M	1.3 Miles	251.0°	1.8 Miles	241.0°	NONE
N	1.0 Miles	266.5°	NONE		NONE
P	1.6 Miles	293.5°	1.6 Miles	293.5°	NONE
O	0.9 Miles	307.0°	2.8 Miles	323.0°	NONE
R	1.9 Miles	335.0°	1.9 Miles	335.0°	NONE

**APPENDIX B**

**INTERLABORATORY COMPARISON PROGRAM**

1995

A summary of the Results of the Analyses by Teledyne Brown Engineering -  
Environmental Services of the EPA Cross Check Samples

Compared with the Known Activity as reported by the Environmental  
Monitoring Systems Laboratory, Las Vegas, Nevada

All results which exceed three sigma deviation from the known are  
appended with a note giving the possible cause of the deviation and  
corrective action taken.

**EPA INTERLABORATORY COMPARISON PROGRAM 1995**  
**Environmental**

Collection Date	Media	Nuclide	EPA Result(a)		Teledyne Brown Engineering Result(b)		Deviation(c)
01/13/95	Water	Sr-89	20.0 ±	5.0	19.00 ±	2.65	-0.35
		Sr-90	15.0 ±	5.0	14.00 ±	0.00	-0.35
01/27/95	Water	Gr-Alpha	5.0 ±	5.0	5.00 ±	1.00	0.00
		Gr-Beta	5.0 ±	5.0	6.00 ±	1.00	0.35
02/03/95	Water	I-131	100.0 ±	10.0	88.33 ±	2.31	-2.02 (d)
02/10/95	Water	Ra-226	19.1 ±	2.9	20.67 ±	0.58	0.94
		Ra-228	20.0 ±	5.0	18.67 ±	0.58	-0.46
03/10/95	Water	H-3	7435.0 ±	744.0	7066.67 ±	115.47	-0.86
04/18/95	Water	Gr-Beta	86.6 ±	10.0	80.33 ±	2.52	-1.09
		Sr-89	20.0 ±	5.0	20.67 ±	1.15	0.23
		Sr-90	15.0 ±	5.0	14.67 ±	0.58	-0.12
		Co-60	29.0 ±	5.0	31.67 ±	2.08	0.92
		Cs-134	20.0 ±	5.0	19.67 ±	1.73	-0.12
		Cs-137	11.0 ±	5.0	11.67 ±	1.53	0.23
		Gr-Alpha	47.5 ±	11.9	39.67 ±	2.52	-1.14
		Ra-226	14.9 ±	2.2	15.67 ±	0.58	0.60
		Ra-228	15.8 ±	4.0	13.00 ±	1.73	-1.21
06/09/95	Water	Co-60	40.0 ±	5.0	42.33 ±	2.52	0.81
		Zn-65	76.0 ±	8.0	82.33 ±	3.51	1.37
		Cs-134	50.0 ±	5.0	46.67 ±	2.08	-1.15
		Cs-137	35.0 ±	5.0	37.67 ±	1.15	0.92
		Ba-133	79.0 ±	8.0	74.33 ±	2.08	-1.01
06/16/95	Water	Ra-226	14.8 ±	2.2	15.00 ±	0.00	0.16
		Ra-228	15.0 ±	3.8	14.00 ±	0.00	-0.46
07/14/95	Water	Sr-89	20.0 ±	5.0	18.33 ±	1.53	-0.58
		Sr-90	8.0 ±	5.0	8.0 ±	0.00	0.00
07/21/95	Water	Gr-Alpha	27.5 ±	6.9	18.33 ±	1.53	-2.30 (e)
		Gr-Beta	19.4 ±	5.0	19.33 ±	1.53	-0.02
08/04/95	Water	H-3	4872.0 ±	487.0	4866.67 ±	152.75	-0.02
09/15/95	Water	Ra-226	24.8 ±	3.7	27.33 ±	1.15	1.19
		Ra-228	20.0 ±	5.0	14.67 ±	0.58	-1.85
10/06/95	Water	I-131	148.0 ±	15.0	150.0 ±	0.00	0.23

Note: Footnotes are located at end of table.



**EPA INTERLABORATORY COMPARISON PROGRAM 1995  
Environmental**

Collection Date	Media	Nuclide	EPA Result(a)	Teledyne Brown Engineering Result(b)	Deviation(c)
-----------------	-------	---------	---------------	--------------------------------------	--------------

**Footnotes:**

- (a) EPA Results-Expected laboratory precision (1 sigma). Units are pCi/liter for water and milk except K is in mg/liter. Units are total pCi for air particulate filters.
- (b) Teledyne Results - Average  $\pm$  one sigma. Units are pCi/liter for water and milk except K is in mg/liter. Units are total pCi for air particulate filters.
- (c) Normalized deviation from the known.
- (d) The normalized deviation marginally exceeded the warning level and an apparent trend in the results appeared. The cause was a probable high bias in the beta counting efficiency. Check source control charts did not indicate any changes in the counting equipment, so the I-131 calibration was suspected. New I-131 calibrations were performed July 3 through 6, 1995 after receiving a new standard from the EPA. The intercomparison sample data sheets were recalculated with the new efficiencies and the average result was in excellent agreement with the EPA (96 pCi/l versus the EPA value of 100 pCi/l). The discrepancy in the I-131 efficiency between the current calibration and the previous one (aside from the uncertainty in the standard) appears to be an abnormally low yield in the preparation of the standard for the older calibration which created a high bias in the counter efficiencies. The bias was less than ten percent, therefore further corrective action or revision of previously reported data is deemed not necessary.
- (e) The mineral salt content of the water used by the EPA to prepare the samples has been shown to vary substantially throughout the year. Absorption curves to account for mount weight may vary from the true absorption characteristics of a specific sample. Previous results do not indicate a trend toward "out of control" for gross alpha/beta analysis and the normalized deviation from the grand average is only -0.36. The normalized deviation from the known for TBE-ES does not exceed three standard deviations and internal spikes have been in control. No corrective action is planned at this time.

**APPENDIX C**  
**STATISTICAL NOTES**

APPENDIX C

STATISTICAL NOTES

1. Each activity is reported in one of two forms:

$$x \pm s \text{ or}$$

$$<L,$$

where

$x$  = value of measurement;

$s$  = counting error at the 95%  
confidence level (2 sigma error);

$L$  = detection limit based on 4.66 sigma error  
for counter background

2. All activities are corrected to collection time except for gross alpha and gross beta.
3. Computation of means:

(a) In any statistical table, the values are entered as

$$\bar{x} \pm \bar{s}$$

or  $<L$

where

$$\bar{x} = \text{sample mean} = \frac{\sum x}{n};$$

$n$  = number of data points averaged;

$$\bar{s} = \text{average of the 2 sigma counting errors} = \frac{\sum s}{n}$$

- (b) For gross beta and gross alpha results in air particulates, averaging includes values which are less than the lower limits of detection. The detection limit is used as the sample activity in these cases.
- (c) In all cases, if all values in an averaging group are below detection limits, the highest of the detection limits is reported as a "less than" value without an associated tolerance. If some values are above detection limits and some are below, then:

- (1) The mean of the positive results is reported and the number of positives is listed in parentheses.
- (d) Means are reported on a quarterly basis except for air particulate and airborne iodine data which are reported monthly. For air particulate and charcoal filters, data for samples collected on the 1st, 2nd, and 3rd day of a month are assigned to the previous month.
- (e) In rounding off, numbers followed by a 5 or higher digit are rounded upwards.

**APPENDIX D**  
**NOTIFICATION LEVELS**

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 ENVIRONMENTAL RADIATION SURVEILLANCE PROGRAM  
 NOTIFICATION LEVELS

Media and Nuclide

Notification Level

Air

Gross Alpha . . . . .	0.1	pCi/m <sup>3</sup>
Gross Beta . . . . .	1.0	pCi/m <sup>3</sup>
I-131 . . . . .	0.31	pCi/m <sup>3</sup>
Cs-134 . . . . .	3.3	pCi/m <sup>3</sup>
Cs-137 . . . . .	6.7	pCi/m <sup>3</sup>

Milk

I-131 (low level) . . . . .	1.09	pCi/l
Sr-89 . . . . .	6.04	pCi/l
Sr-90 . . . . .	14.82	pCi/l
Cs-134 . . . . .	20.0	pCi/l
Cs-137 . . . . .	23.0	pCi/l

Groundwater

Gross Alpha . . . . .	12.0	pCi/l
Gross Beta . . . . .	33.8	pCi/l
H-3 . . . . .	6700	pCi/l
Mn-54 . . . . .	330	pCi/l
Fe-59 . . . . .	130	pCi/l
Co-58 . . . . .	330	pCi/l
Co-60 . . . . .	100	pCi/l
Zn-65 . . . . .	100	pCi/l
Zr-Nb-95 . . . . .	67	pCi/l
I-131 . . . . .	0.67	pCi/l
Cs-134 . . . . .	10	pCi/l
Cs-137 . . . . .	17	pCi/l
Ba-La-140 . . . . .	67	pCi/l

Food Products

I-131 . . . . .	0.1	pCi/g wet
Cs-134 . . . . .	0.33	pCi/g wet
Cs-137 . . . . .	0.66	pCi/g wet

Fish

Gross Beta . . . . .	10.8	pCi/g wet
Sr-89 . . . . .	3.3	pCi/g wet
Sr-90 . . . . .	1.2	pCi/g wet
Mn-54 . . . . .	10	pCi/g wet

Media and Nuclide

Notification Level

Fish (Continued)

Fe-59 . . . . .	3.3	pCi/g wet
Co-58 . . . . .	10	pCi/g wet
Co-60 . . . . .	3.3	pCi/g wet
Zn-65 . . . . .	6.7	pCi/g wet
Cs-134 . . . . .	0.33	pCi/g wet
Cs-137 . . . . .	0.67	pCi/g wet

River Water

Gross Alpha Sus . . . . .	22.0	pCi/l
Gross Alpha Dis . . . . .	27.6	pCi/l
Gross Beta Sus . . . . .	58.8	pCi/l
Gross Beta Dis . . . . .	88.6	pCi/l
Sr-89 . . . . .	1000.0	pCi/l
Sr-90 . . . . .	100.0	pCi/l
H-3 . . . . .	6700	pCi/l
Mn-54 . . . . .	330	pCi/l
Fe-59 . . . . .	130	pCi/l
Co-58 . . . . .	330	pCi/l
Co-60 . . . . .	100	pCi/l
Zn-65 . . . . .	100	pCi/l
Zr-Nb-95 . . . . .	67	pCi/l
I-131 . . . . .	0.67	pCi/l
Cs-134 . . . . .	10	pCi/l
Cs-137 . . . . .	17	pCi/l
Ba-La-140 . . . . .	67	pCi/l

Shoreline Sediment

Co-60 . . . . .	0.1	pCi/g dry
Cs-134 . . . . .	0.75	pCi/g dry
Cs-137 . . . . .	0.75	pCi/g dry

APPENDIX E  
CONVENTIONS USED  
IN  
DATA TREND GRAPHS



## APPENDIX E

### Conventions used in Data Trend Graphs

1. The data trend plots are based on statistical summaries of Section VI.
2. Monthly or quarterly averages are plotted.
3. The conventions used to determine if a "less than" (<) value or detectable result is plotted are those given in Appendix C.
4. Lowest levels of detection (LLD) are noted by a straight line on the graphs.
5. A typical less-than value arising from delayed counting of short-lived isotopes (such as I-131 or Ba-140) or reduced sample size are omitted.

**APPENDIX F**  
**DETECTION CAPABILITIES**

DETECTION CAPABILITIES  
FOR  
ENVIRONMENTAL SAMPLE ANALYSIS  
Radiochemical Methods  
Lower Limit of Detection

LLD<sup>a</sup>

	Water (pCi/l)	Milk (pCi/l)	Air Part (pCi/m <sup>3</sup> )	Food Products Broadleaf Vegetation <sup>b</sup> (pCi/g wet)	Fish (pci/g wet)
Quantity <sup>c</sup>	0.4 ℓ	-	280 m <sup>3</sup>		0.1 g ash
Ash Wt. % <sup>d</sup>	-	-	-		4
α <sup>e</sup>	4.0	-	0.002		-
β <sup>e</sup>	1.4	-	0.003		0.25
Quantity	2 ℓ	1 ℓ	-		3 g ash
Ash Wt. %	-	-	-		4
Sr-89	1.08	2.02	-		0.03
Sr-90	0.93	1.39	-		0.03
Quantity	-	1 ℓ	280 m <sup>3</sup>	20 g	-
I-131	-	0.78	0.05 <sup>f</sup>	0.05	-
H-3	140	-	-	-	-

F-1

<sup>a</sup>LLD - lower limit of detection based on  $4.66s_b$ ; where  $s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute), specified for listed quantity and ash weight percentage.

<sup>b</sup>The minimum sensitivity will vary with the weight reduction achieved by ashing the sample. Minimum sensitivities for three typical ash weight percentages are specified.

<sup>c</sup>Typical analysis quantity.

<sup>d</sup>Typical ash weight percentage of wet weight.

<sup>e</sup>Listed α and β LLD's are for weightless sample. Self-absorption in sample will increase these LLD's. Typical increases will be factors in the range 1 to 1.3 for β analysis and 1-5 for α analysis.

<sup>f</sup>Iodine collected Charcoal Cartridge air filter.

<sup>a</sup>LLD = lower limit of detection based on  $4.66s_b$  ; & where  $s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute). The LLD is at counting time and must be corrected to collection time. The LLDs given above are based on the quantities indicated and the background count rate in the absence of any radionuclides in the sample. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry, the background shall include the typical contributions of other radio-nuclides normally present in the samples (e.g., potassium-40 in milk samples).

Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLD's unachievable. In such cases, the contributing factors will be identified and described in the Environmental Radiation Monitoring Program Annual Report.

Note: All LLD's which we require are listed in this table for Ge(Li) Gamma Spectroscopy. If any nuclide is detected, it shall be reported quantitatively whether or not it is one of the 20 nuclides listed above.

LOWER LIMITS OF DETECTION (LLD)  
OF  
ANALYSES FOR Ge (Li) DETECTOR

LLD<sup>a</sup>

		Milk, Water (pCi/l)	Air Part (pCi/m <sup>3</sup> )	Fish, (pCi/kg wet)	Food Products (pCi/kg wet)	Shoreline Sediment (pCi/kg dry)
Quantity:		3.5 l	3600 m <sup>3</sup>	400 g wet	200 g wet	600 g dry
Isotope	Half-life					
Be-7	53.2 d	78	0.05	311	1243	233
K-40	1.26x10 <sup>9</sup> y	140	0.06	466	932	466
Mn-54	313 d	8	0.003	31	124	31
Co-58	70.8 d	8	0.003	31	124	16
Fe-59	45 d	30	0.006	260	311	31
Co-60	5.26 y	8	0.005	31	124	47
Zn-65	245 d	30	0.003	260	311	31
Nb-95	35.2 d	9	0.003	31	124	31
Zr-95	65 d	9	0.005	47	93	78
Ru-103	39.4 d	8	0.003	31	124	47
Ru-106	368 d	62	0.03	311	1243	233
I-131	8.04 d	9	0.003	31	60	31
Cs-134	2.06 y	9	0.003	31	60	47
Cs-137	30.2 y	9	0.003	31	80	31
Ba-140	12.8 d	15	0.09	109	621	233
La-140	40.2 h	15	0.09	109	621	233
Ce-141	32.5 d	16	0.003	47	155	47
Ce-144	284 d	78	0.01	155	621	233
Re-226	1600 y	100	0.08	200	800	109
Th-228	1.91 y	31	0.01	93	466	109

<sup>a</sup>LLD = lower limit of detection based on  $4.66s_b$ ; and where  $s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute). The LLD is at counting time and must be corrected to collection time. The LLDs given above are based on the quantities indicated and the background count rate in the absence of any radionuclides in the sample. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry, the background shall include the typical contributions of other radio-nuclides normally present in the samples (e.g., potassium-40 in milk samples).

Occasionally background fluctuations, unavoidable small sample size, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLD's unachievable. In such cases, the contributing factors will be identified and described in the Environmental Radiation Monitoring Program Annual Report.

Note: All LLD's which we require are listed in this table for Ge(Li) Gamma Spectroscopy. If any nuclide is detected, it shall be reported quantitatively whether or not it is one of the 20 nuclides listed above.

**APPENDIX G**

**SAMPLE STATION LOCATIONS AND SAMPLE TYPES**

**COOPER NUCLEAR STATION  
LIST OF ACTIVE SAMPLE STATIONS  
1995**

<u>Sample Station*</u>	<u>Sample Description -- Type and Location</u>
No. 1	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry  Location: Outside the northwest edge of fence, east of the gate to the LLRW storage pad on the CNS site, NW $\frac{1}{4}$ , S32, T5N, R16E, Nemaha County, Nebraska.
No. 2	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry  Location: North side of county road access to the south portion of CNS site approximately 275 feet west of the former Jefferson Broady farmstead, SW $\frac{1}{4}$ , S32, T5N, R16E, Nemaha County, Nebraska.
No. 3	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry  Location: Located on the north side of the Brownville State Recreation Park access road near water gauging station, SE $\frac{1}{4}$ , S18, T5N, R16E, Nemaha County, Nebraska.
No. 4	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry  Location: Located $\frac{1}{2}$ mile south of Phelps City, Missouri, on west side of Highway "U", NE $\frac{1}{4}$ , S2, T64N, R42W, Atchison County, Missouri.
No. 5	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry  Location: Located $\frac{1}{2}$ mile south and $\frac{1}{2}$ mile east of Langdon, Missouri, on north side of road, west of railroad tracks, SW $\frac{1}{4}$ , S18, T64N, R41W, Atchison County, Missouri.
No. 6	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry  Location: One mile west of the end of Missouri State Highway "U", south side of road, SW corner of the intersection, NW $\frac{1}{4}$ , S34, T64N, R42W, Atchison County, Missouri.
No. 7	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry  Location: 300 yards east of Highway 67 on north side of road, west of Nemaha elevator, SW $\frac{1}{4}$ , S6, T4N, R16E, Nemaha County, NE
No. 8	Type: (1) Air Particulate and Charcoal Filters (2) Environmental Thermoluminescent Dosimetry  Location: $\frac{1}{2}$ mile north, $\frac{1}{2}$ mile west and $\frac{1}{2}$ mile north of Nemaha, on west side of road adjacent to Mark T. Moore Transmission Line, NE $\frac{1}{4}$ , S35, T5N, R15E, Nemaha County, Nebraska.

Sample Station      Sample Description -- Type and Location

- No. 9      Type: (1) Air Particulate and Charcoal Filters  
          (2) Environmental Thermoluminescent Dosimetry  
  
Location:    Four miles north of Highway 136, on Highway 67. Then 1 mile east of Highway 67 and ¼ mile north on west side of road, SW¼, S26, T6N, R15E, Nemaha County, Nebraska.
- No. 10     Type: (1) Air Particulate and Charcoal Filters  
          (2) Environmental Thermoluminescent Dosimetry  
  
Location:    One mile north of Barada, Nebraska, in SW corner of intersection, NE¼, S14, T3N, R16E, Richardson County, Nebraska.
- No. 11     Type: (1) Water - Ground  
  
Location:    Plant well water supply header at well pits, NW¼, S32, T5N, R16E, Nemaha County, Nebraska.
- No. 12     Type: (1) Water - River  
  
Location:    Sample (1) is taken from the Missouri River immediately upstream from the Plant Intake Structure (River Mile 532.5). (During periods when unsafe conditions warrant, Station 35 may be used as an alternate upstream collection site.)
- No. 20     Type: (1) Environmental Thermoluminescent Dosimetry  
  
Location:    On NNW boundary of NPPD property, approximately 20 yards east of county road, SE¼, S30, T5N, R16E, Nemaha county, Nebraska.
- No. 28     Type: (1) Water - River  
          (2) Fish  
          (3) Sediment from Shoreline  
  
Location:    Samples (1) and (3) are taken from the Missouri River or its shore, below the Plant Discharge Flume near River Mile 530. Sample (2) is taken from the Missouri River ¼ to 3 miles downstream of the plant site.
- No. 35     Type: (1) Fish  
          (2) Food Products - Broadleaf Vegetation  
          (3) Water - River (Alternate Site)  
  
Location:    Sample (1) is taken from the Missouri River about 1 to 3 miles above the CNS intake structure. Sample (2) is taken about ¼ mile south of the Brownville State Recreation Area in Sector A. During periods when unsafe conditions warrant, Station 35 may be used as an alternate to Station 12 for sample type (3).
- No. 42     Type: (1) Milk - Other Producer  
  
Location:    One mile south, 1-¼ miles east of Barada, Nebraska, south side of county road, NW¼, S30, T3N, R17E, Richardson County, Nebraska.



Sample  
Station

Sample Description -- Type and Location

- No. 44      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    Two miles south of Auburn stoplight and  $\frac{1}{4}$  mile south of Auburn Country Club on Highway 75, then  $\frac{1}{4}$  mile east of Highway 75 at fence line north of county road, SE $\frac{1}{4}$ , S27, T5N, R14E, Nemaha County, Nebraska.
- No. 47      Type: (1) Water - Ground  
Location:    At Falls City municipal water supply well south of Rulo, Nebraska, out of main header flow meter, SW $\frac{1}{4}$ , S20, T1N, R18E, Richardson County, Nebraska.
- No. 56      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    1- $\frac{1}{4}$  miles SW of Langdon, Missouri, on Highway "U", on the right side of the highway (Bill Gebheart farm), NW $\frac{1}{4}$ , S23, T64N, R42W, Atchison County, Missouri.
- No. 58      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    Three miles south of Brownville, Nebraska, on county road, at the SE corner of the intersection with the farm road leading to Sample Station No. 2, SE $\frac{1}{4}$ , S31, T5N, R16E, Nemaha County, Nebraska.
- No. 59      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    One mile SSE of the CNS Elevated Release Point, 50 yards west of the levee at the south boundary of NPPD property, SE $\frac{1}{4}$ , S32, T5N, R16E, Nemaha County, Nebraska.
- No. 61      Type: (1) Milk - Nearest Producer  
Location:    One mile west of Brownville, Nebraska, on Highway 136, then 1 mile north on the county road, turn right and proceed approximately  $\frac{1}{4}$  mile east, on south side of road (Raymond Gentert dairy), NW $\frac{1}{4}$ , S13, T5N, R15E, Nemaha County, Nebraska.
- No. 66      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    Two miles south of Nemaha, Nebraska, on Highway 67 - east side of road (Mrs. Lola Kennedy farm), NW $\frac{1}{4}$ , S19, T4N, R16E, Nemaha County, Nebraska.
- No. 67      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    Two miles west of Brownville, Nebraska, on Highway 136, then north 1- $\frac{1}{4}$  miles on county road and east  $\frac{1}{4}$  mile, on north side of road (Walter Parkhurst farm), NE $\frac{1}{4}$ , S11, T5N, R15E, Nemaha County, Nebraska.
- No. 71      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    Two miles east of Phelps City, Missouri, on Highway 136, then south 1- $\frac{1}{4}$  miles on county road and west  $\frac{1}{4}$  mile (Tom Boatman farm), SE $\frac{1}{4}$ , S6, T64N, R41W, Atchison County, Missouri.

Sample  
Station

Sample Description -- Type and Location

- No. 79      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    1- $\frac{1}{4}$  miles south of Brownville, NE, on east side of paved road, NPPD property, SE $\frac{1}{4}$ , S30, T5N, R16E, Nemaha County, NE.
- No. 80      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    2- $\frac{1}{4}$  miles south of Brownville, east side of paved road, NPPD property, NE $\frac{1}{4}$ , S31, T5N, R16E, Nemaha County, NE.
- No. 81      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    2- $\frac{3}{4}$  miles south of Brownville, Nebraska, in the NE corner of the intersection of the paved county road and CNS access road, NPPD property, NE $\frac{1}{4}$ , S31, T5N, R16E, Nemaha County, NE.
- No. 82      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:     $\frac{1}{4}$  mile south of CNS in a field, on NPPD property, SW $\frac{1}{4}$ , S32, T5N, R16E, Nemaha County, Nebraska.
- No. 83      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    2- $\frac{1}{4}$  miles south of Nemaha, Nebraska, on Highway 67, then east 1 mile to the junction of the driveway and county road (east side of driveway, Leroy Kennedy), NE $\frac{1}{4}$ , S19, T4N, R16E, Nemaha County, Nebraska.
- No. 84      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    2- $\frac{1}{2}$  miles west of Brownville, Nebraska, south side of Highway 136 west of Locust Grove School (Bruce L. Solie), NW $\frac{1}{4}$ , S22, T5N, R15E, Nemaha County, NE.
- No. 85      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    One mile east of Brownville, Nebraska, on Highway 136, then north  $\frac{1}{4}$  mile on the east side of the county road (Scott Leseburg), NE $\frac{1}{4}$ , S33, T65N, R42W, Atchison County, Missouri.
- No. 86      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    One mile west of Phelps City, Missouri, on Highway 136, then north 1- $\frac{1}{4}$  miles on Highway "D" on west side (Mrs. Olin Harmes), SE $\frac{1}{4}$ , S22, T65N, R43W, Atchison County, Missouri.
- No. 87      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    One mile west of Phelps City, MO, on Hwy 136, south  $\frac{1}{2}$  mile on county road and  $\frac{1}{4}$  mile west on county road (to end of road, Robert Graf), SW $\frac{1}{4}$ , S3, T64N, R42W, Atchison County, MO.
- No. 88      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    One mile west of Phelps City, Missouri, on Highway 136, then south 2 miles at the end of the county road (David Meyerkorth), NW $\frac{1}{4}$ , S11, T64N, R42W, Atchison County, Missouri.

Sample  
Station

Sample Description -- Type and Location

- No. 89      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    2- $\frac{1}{2}$  miles south of Phelps City, Missouri, on Highway "U",  
then  $\frac{1}{2}$  mile west in the SE corner of the county road  
intersection (Gertrude Rosenbohm), NE $\frac{1}{4}$ , S14, T64N, R42W,  
Atchison County, Missouri.
- No. 90      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:    1- $\frac{1}{2}$  miles west and  $\frac{1}{2}$  mile south of Langdon, Missouri, on  
Highway "U", then  $\frac{1}{2}$  mile west (Garth Green), SW $\frac{1}{4}$ , S23, T64N,  
R42W, Atchison County, Missouri.
- No. 91      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:     $\frac{1}{2}$  mile west of Rock Port, Missouri, on the south side of the  
intersection of Highway 136 and Highway 275, at the water  
tower (Richard H. and Vicki Cook), NW $\frac{1}{4}$ , S28, T65N, R41W,  
Atchison County, Missouri.
- No. 94      Type: (1) Environmental Thermoluminescent Dosimetry  
Location:     $\frac{1}{2}$  mile south of Langdon, Missouri, on the west side of the  
road (Max Peeler), NE $\frac{1}{4}$ , S24, T64N, R42W, Atchison County,  
Missouri.
- No. 96      Type: (1) Food Products - Broadleaf Vegetation  
Location:    Approximately 1 mile south of Brownville, Nebraska, along the  
paved road in the road ditch, in Sector R, SW $\frac{1}{4}$ , S19, T5N,  
R16E, Nemaha County, Nebraska.
- No. 99      Type: (1) Milk (Nearest and Other Producer)  
Location:    1- $\frac{1}{2}$  miles south of Shubert, Nebraska, on west side of Highway  
67 (James Zentner dairy), NE $\frac{1}{4}$ , S24, T3N, R15E, Richardson  
County, Nebraska.
- No. 100     Type: (1) Milk (Other Producer)  
Location:    Two miles south and 1 mile west of Shubert, Nebraska (Dick  
James dairy), SW $\frac{1}{4}$ , S23, T3N, R15E, Richardson County,  
Nebraska.
- No. 101     Type: (i) Food Products - Broadleaf Vegetation  
Location:    5 $\frac{1}{2}$  miles east and  $\frac{1}{2}$  mile north of Rock Port, Missouri, near  
the junction of Highway 136 and Highway 59, in Sector D,  
encompasses portions of S19 and S30, T65N, R41W, Atchison  
County, Missouri.

NOTES:

- (\*) Sample Station numbers missing from the sequence are inactive or discontinued Sample Stations.

**APPENDIX H**

**SUMMARY OF DONES TO A MEMBER OF THE PUBLIC OFF-SITE**

Summary of Gaseous Effluent Dose Calculations

DOSES TO MAXIMUM INDIVIDUAL (MREM), JANUARY-DECEMBER 1995

COOPER NUCLEAR STATION JANUARY-DECEMBER 1995  
SPECIAL LOCATION # 1 SITE BOUNDARY  
AT 0.67 MILES N

PATHWAY	T.BODY	GI-TRACT	BONE	LIVER	KIDNEY	THYROID	LUNG	SKIN
ADULT	9.25E-05	9.24E-05	9.26E-05	9.27E-05	9.31E-05	2.53E-04	9.36E-05	2.36E-04
TEEN	9.26E-05	9.24E-05	9.28E-05	9.30E-05	9.36E-05	3.16E-04	9.36E-05	2.36E-04
CHILD	9.30E-05	9.23E-05	9.35E-05	9.35E-05	9.44E-05	5.19E-04	9.36E-05	2.36E-04
INFANT	9.34E-05	9.23E-05	9.46E-05	9.50E-05	9.54E-05	9.98E-04	9.36E-05	2.36E-04

COOPER NUCLEAR STATION JANUARY-DECEMBER 1995  
SPECIAL LOCATION # 2 NEAR RESIDENCE  
AT 0.90 MILES NW

PATHWAY	T.BODY	GI-TRACT	BONE	LIVER	KIDNEY	THYROID	LUNG	SKIN
ADULT	1.72E-04	1.72E-04	1.72E-04	1.73E-04	1.73E-04	3.33E-04	1.74E-04	4.25E-04
TEEN	1.72E-04	1.72E-04	1.73E-04	1.73E-04	1.73E-04	3.95E-04	1.74E-04	4.25E-04
CHILD	1.73E-04	1.72E-04	1.73E-04	1.73E-04	1.74E-04	5.96E-04	1.74E-04	4.25E-04
INFANT	1.73E-04	1.72E-04	1.74E-04	1.75E-04	1.75E-04	1.07E-03	1.74E-04	4.25E-04

Summary of Doses to Maximum Individual at the Site Boundary, Resulting from Exposure to Radioactivity Discharged in Liquid Effluents, January-December 1995, Cooper Nuclear Station

Dose to Individual, mrem

Period and Pathway	Skin	Bone	Liver	Total Body	Thyroid	Kidney	Lung	GI-LLI
<u>1st Quarter</u>	2.61 E-05	3.77 E-04	4.53E-04	5.84E-04	2.22E-05	9.76E-05	3.99E-05	4.05E-03
<u>2nd Quarter</u>	1.03 E-05	9.92 E-04	8.79 E-04	7.59 E-04	8.84 E-06	2.61 E-04	9.30 E-05	2.46 E-03
<u>3rd Quarter</u>	6.54 E-06	1.21 E-03	5.20 E-04	4.48 E-04	6.41 E-06	1.61 E-04	5.66 E-05	1.25 E-03
<u>4th Quarter</u>	1.10 E-04	3.71 E-03	1.01 E -02	1.07 E-02	9.40 E-05	2.24 E-03	7.22 E-04	6.90 E-02
<b>Totals for 1995</b>	<b>1.53 E-04</b>	<b>6.29 E-03</b>	<b>1.20 E-02</b>	<b>1.25 E-02</b>	<b>1.31 E-04</b>	<b>2.76 E-03</b>	<b>9.12 E-04</b>	<b>7.68 E-02</b>

**APPENDIX I**  
**NON-REMP ANALYSES**

## APPENDIX I

Six runoff water samples were collected from the LL Waste Pad during 1995. These samples were analyzed for gross alpha and gross beta (suspended and dissolved), and by gamma spectroscopy. These analyses are not part of the regular CNS REMP, and the data contained in this appendix is provided for informational purposes only.

The LL Waste Pad became operational on June 12, 1995. Sampling that was conducted prior to that date was used to establish baseline levels. Runoff samples have been obtained from the area of the LL Waste Pad since that date on a quarterly basis, when available. No sample was collected in the fourth quarter of 1995 due to the unavailability of runoff.



LL WASTE PAD WATER SUMMARY

PATHWAY - WATERBORNE  
 SAMPLE - WATER - WASTE  
 UNITS - PCI/LITER

COMPILATION - ANNUAL SUMMARY  
 CONTROL - STATION 12 - 0.1 MI. 360 DEG. CON.

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION

ANALYSIS	NO	LIMIT OF DETECTION MEAN X E-00	ALL INDICATOR SAMPLES		LOCATION WITH HIGHEST MEAN		CONTROL LOCATION MEAN X E-00 RANGE FRACTION	NON- ROUTINE	REPORTING PERIOD
			MEAN X E-00	RANGE	STATION FRACTION	MEAN X E-00 RANGE			
			FRACTION		STATION DESCRIPTION				
GR-A DIS	6	4.0	2.3-	3.6 4.0	005/006	2.3- 3.6 4.0		0	01/27/95-09/29/95
			005/006		LL WASTE PAD				
GR-A SUS	6	4.0	0.99-	1.3 1.9	004/006	0.99- 1.3 1.9		0	01/27/95-09/29/95
			004/006		LL WASTE PAD				
GR-B DIS	6	1.8	6.8-	7.8 9.7	006/006	6.8- 7.8 9.7		0	01/27/95-09/29/95
			006/006		LL WASTE PAD				
GR-B SUS	6	1.8	0.65-	3.9 5.6	005/006	0.65- 3.9 5.6		0	01/27/95-09/29/95
			005/006		LL WASTE PAD				
K-40	6	140.0	106-	106 106				0	01/27/95-09/29/95
			001/006						
I-131	6	9.00	LT 4.0-	LT 8.0 LT 8.0				0	01/27/95-09/29/95
			000/006						
CS-137	6	9.00	LT 4.0-	LT 5.0 LT 5.0				0	01/27/95-09/29/95
			000/006						

1-2

NEBRASKA PUBLIC POWER DISTRICT  
 COOPER NUCLEAR STATION  
 EXPOSURE PATHWAY - WATERBORNE  
 WATER - EFFLUENT  
 (PCI/LITER)  
 LL WASTE PAD - WATER

DATE COLLECTED:	01/27		04/21		05/17		06/06		06/27	
RADIOCHEMICAL ANALYSIS:										
GR-A DIS	4.0 ± 1.7	E 00	4.0 ± 1.9	E 00	LT. 2.	E 00	3.9 ± 2.2	E 00	2.3 ± 1.4	E 00
GR-A SUS	1.1 ± 0.6	E 00	1.9 ± 0.9	E 00	9.9 ± 7.4	E-01	LT. 2.	E-01	1.4 ± 0.8	E 00
GR-B DIS	9.7 ± 1.3	E 00	6.8 ± 1.3	E 00	8.0 ± 1.5	E 00	7.5 ± 1.4	E 00	7.0 ± 1.2	E 00
GR-B SUS	3.6 ± 0.8	E 00	5.0 ± 0.9	E 00	4.5 ± 0.9	E 00	6.5 ± 4.4	E-01	5.6 ± 1.0	E 00
GAMMA SPECTRUM ANALYSIS:										
BE-7	LT. 3.	E 01	LT. 2.	E 01	LT. 4.	E 01	LT. 3.	E 01	LT. 4.	E 01
K-40	LT. 5.	E 01	LT. 5.	E 01	LT. 7.	E 01	LT. 1.	E 02	LT. 1.	E 02
MN-54	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00
CO-58	LT. 3.	E 00	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00
FE-59	LT. 6.	E 00	LT. 6.	E 00	LT. 8.	E 00	LT. 8.	E 00	LT. 8.	E 00
CO-60	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00
ZN-65	LT. 6.	E 00	LT. 5.	E 00	LT. 9.	E 00	LT. 8.	E 00	LT. 9.	E 00
ZR-95	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00
RU-103	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00
RU-106	LT. 3.	E 01	LT. 2.	E 01	LT. 3.	E 01	LT. 3.	E 01	LT. 4.	E 01
I-131	LT. 4.	E 00	LT. 4.	E 00	LT. 8.	E 00	LT. 6.	E 00	LT. 8.	E 00
CS-134	LT. 3.	E 00	LT. 3.	E 00	LT. 4.	E 00	LT. 4.	E 00	LT. 4.	E 00
CS-137	LT. 4.	E 00	LT. 4.	E 00	LT. 5.	E 00	LT. 4.	E 00	LT. 4.	E 00
BA-140	LT. 4.	E 00	LT. 4.	E 00	LT. 6.	E 00	LT. 6.	E 00	LT. 7.	E 00
CE-141	LT. 6.	E 00	LT. 5.	E 00	LT. 9.	E 00	LT. 6.	E 00	LT. 7.	E 00
CE-144	LT. 2.	E 01	LT. 2.	E 01	LT. 4.	E 01	LT. 2.	E 01	LT. 2.	E 01
RA-226	LT. 7.	E 01	LT. 6.	E 01	LT. 1.	E 02	LT. 7.	E 01	LT. 7.	E 01
TH-228	LT. 6.	E 00	LT. 5.	E 00	LT. 9.	E 00	LT. 6.	E 00	LT. 7.	E 00

NEBRASKA PUBLIC POWER DISTRICT  
COOPER NUCLEAR STATION  
EXPOSURE PATHWAY - WATERBORNE  
WATER - EFFLUENT  
(PCI/LITER)  
LL WASTE PAD - WATER

DATE COLLECTED: 09/29

RADIOCHEMICAL ANALYSIS:

GR-A DIS	3.8 ± 2.5	E 00
GR-A SUS	L.T. 5.	E-01
GR-B DIS	8.0 ± 1.4	E 00
GR-B SUS	L.T. 8.	E-01

GAMMA SPECTRUM ANALYSIS:

BE-7	L.T. 3.	E 01
K-40	1.06±0.31	E 02
MN-54	L.T. 3.	E 00
CO-58	L.T. 3.	E 00
FE-59	L.T. 7.	E 00
CO-60	L.T. 3.	E 00
ZN-65	L.T. 7.	E 00
ZR-95	L.T. 3.	E 00
RU-103	L.T. 4.	E 00
RU-106	L.T. 3.	E 01
I-131	L.T. 5.	E 00
CS-134	L.T. 3.	E 00
CS-137	L.T. 4.	E 00
BA-140	L.T. 5.	E 00
CE-141	L.T. 7.	E 00
CE-144	L.T. 3.	E 01
RA-226	L.T. 8.	E 01
TH-228	L.T. 7.	E 00