




**GULF STATES UTILITIES COMPANY**

RIVER BEND STATION POST OFFICE BOX 220 ST. FRANCISVILLE, LOUISIANA 70775  
AREA CODE 504 635-6094 346-8651

March 1, 1985  
RBG-20307  
File Nos. G9.5, G9.25.1.1

Mr. Robert D. Martin, Regional Administrator  
U. S. Nuclear Regulatory Commission, Region IV  
611 Ryan Plaza Drive, Suite 1000  
Arlington, Texas 76011

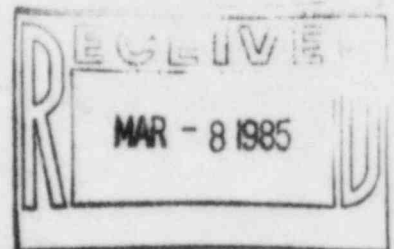


Dear Mr. Martin:

River Bend Station - Unit 1  
Docket No. 50-458  
Final Report/DR-264

Gulf States Utilities Company (GSU) has completed its evaluation of DR-264 concerning the physical separation between Division I and Division II panel wiring in a General Electric supplied Remote Shutdown Panel (C61-P001). Analysis of the remote shutdown panel concluded that the physical separation between Division I and Division II panel wiring would not adversely affect the safe operations of the plant. GSU has therefore determined this condition is not reportable under 10CFR50.55(e). However, Field Deviation and Disposition Request No. LD1-2487 was issued to correct the identified nonconforming condition and has been implemented in accordance with Engineering and Design Coordination Report Nos. C-52,695 and C-68,781.

Sincerely,

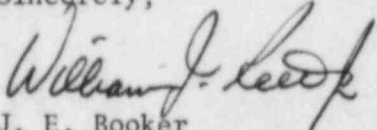  
for J. E. Booker  
Manager-Engineering,  
Nuclear Fuels & Licensing  
River Bend Nuclear Group

*trp*  
JEB/PJD/trp

cc: Director of Inspection & Enforcement  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

NRC Resident Inspector-Site

8503120437 850301  
PDR ADOCK 05000458  
S PDR

1/0  
13-27