

NUCLEAR REGULATORY COMMISSION

Docket No. 50-400 Official Exh. No. 5I-28  
 In the matter of Shelton Harris #:  
 Staff \_\_\_\_\_ IDENTIFIED   
 Applicant \_\_\_\_\_ RECEIVED   
 Intervenor  \_\_\_\_\_ REJECTED \_\_\_\_\_  
 Cont'g Off'r \_\_\_\_\_  
 Contractor \_\_\_\_\_ DATE 9-10-84  
 Other \_\_\_\_\_ Witness \_\_\_\_\_  
 Reporter WRB

JI 28 (CP&L EXHIBIT  
 PWH-1  
50-400 OL E2-5481)

CAROLINA POWER & LIGHT COMPANY


BRUNSWICK PLANT  
OUTAGE SCHEDULE\*

I-5I-28  
 9/10/84

DOCKETED  
 USNRC

'85 JAN -8 P3:53

OFFICE DOCKET SERVICE  
 BRANCH 1986

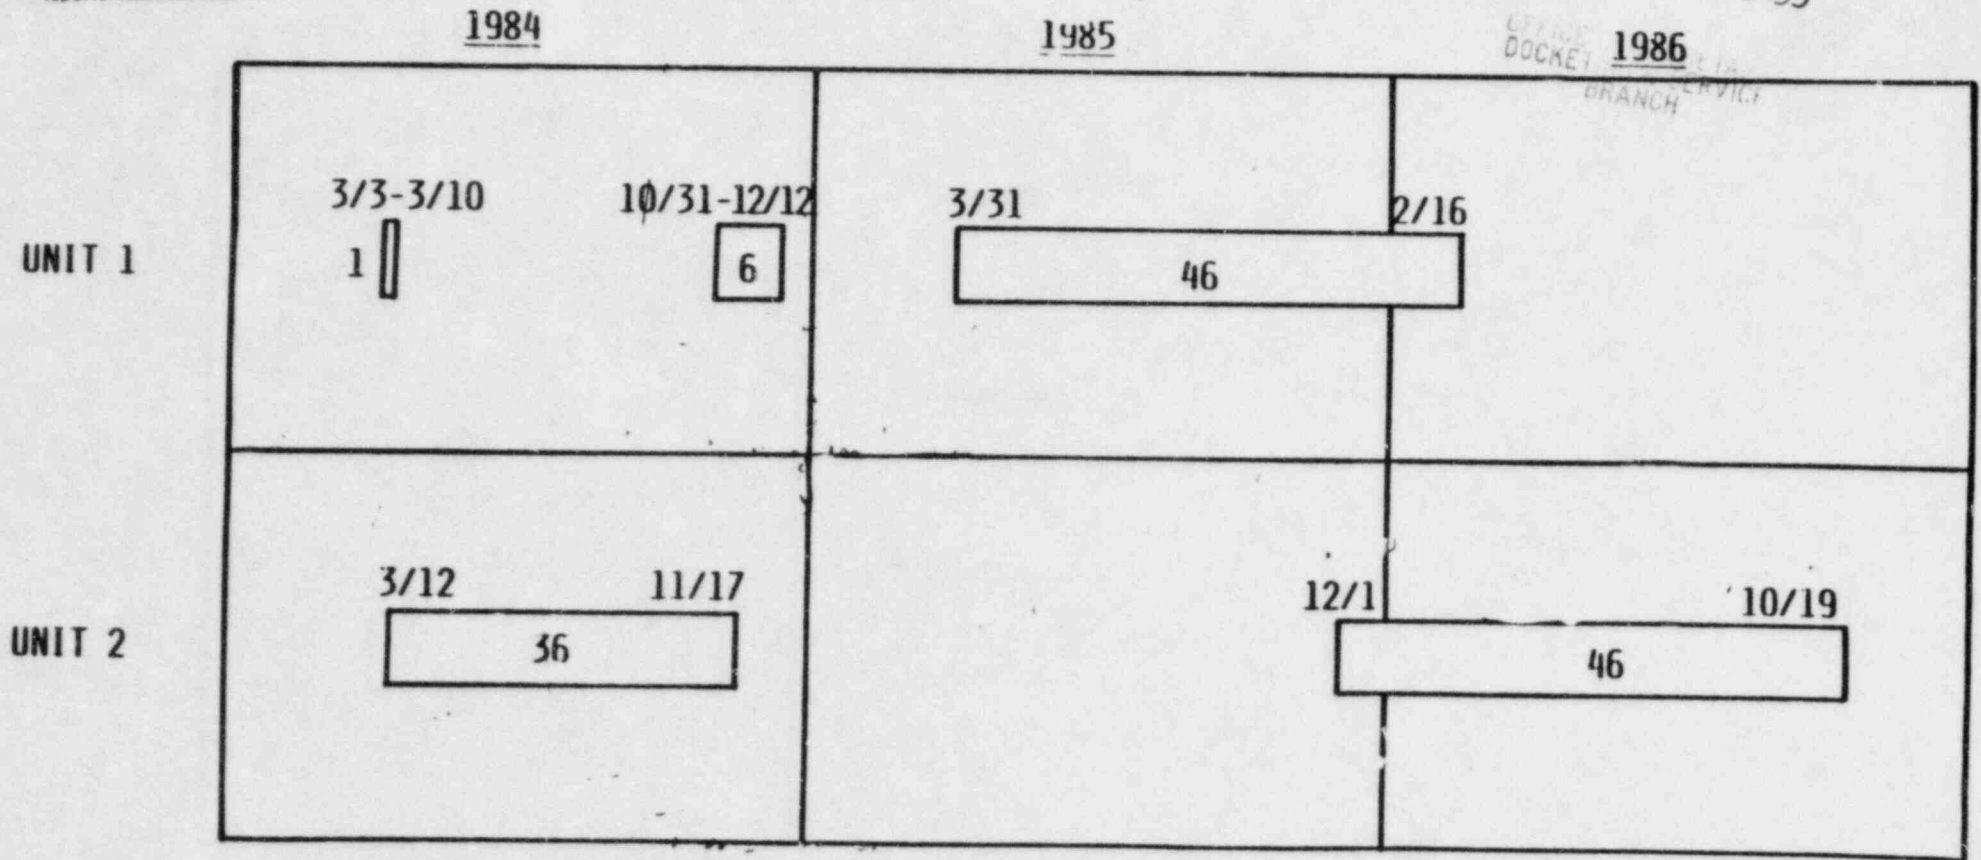

\*THE PLANNED OUTAGE SCHEDULE IS SUBJECT TO REVISION AS A RESULT OF CHANGING SYSTEM CONDITIONS, SPECIFIC PLANT REQUIREMENTS, OR OTHER FACTORS.

8501110227 840910  
 PDR ADOCK 05000400  
 PDR