


# ARKANSAS POWER & LIGHT COMPANY ARKANSAS NUCLEAR ONE

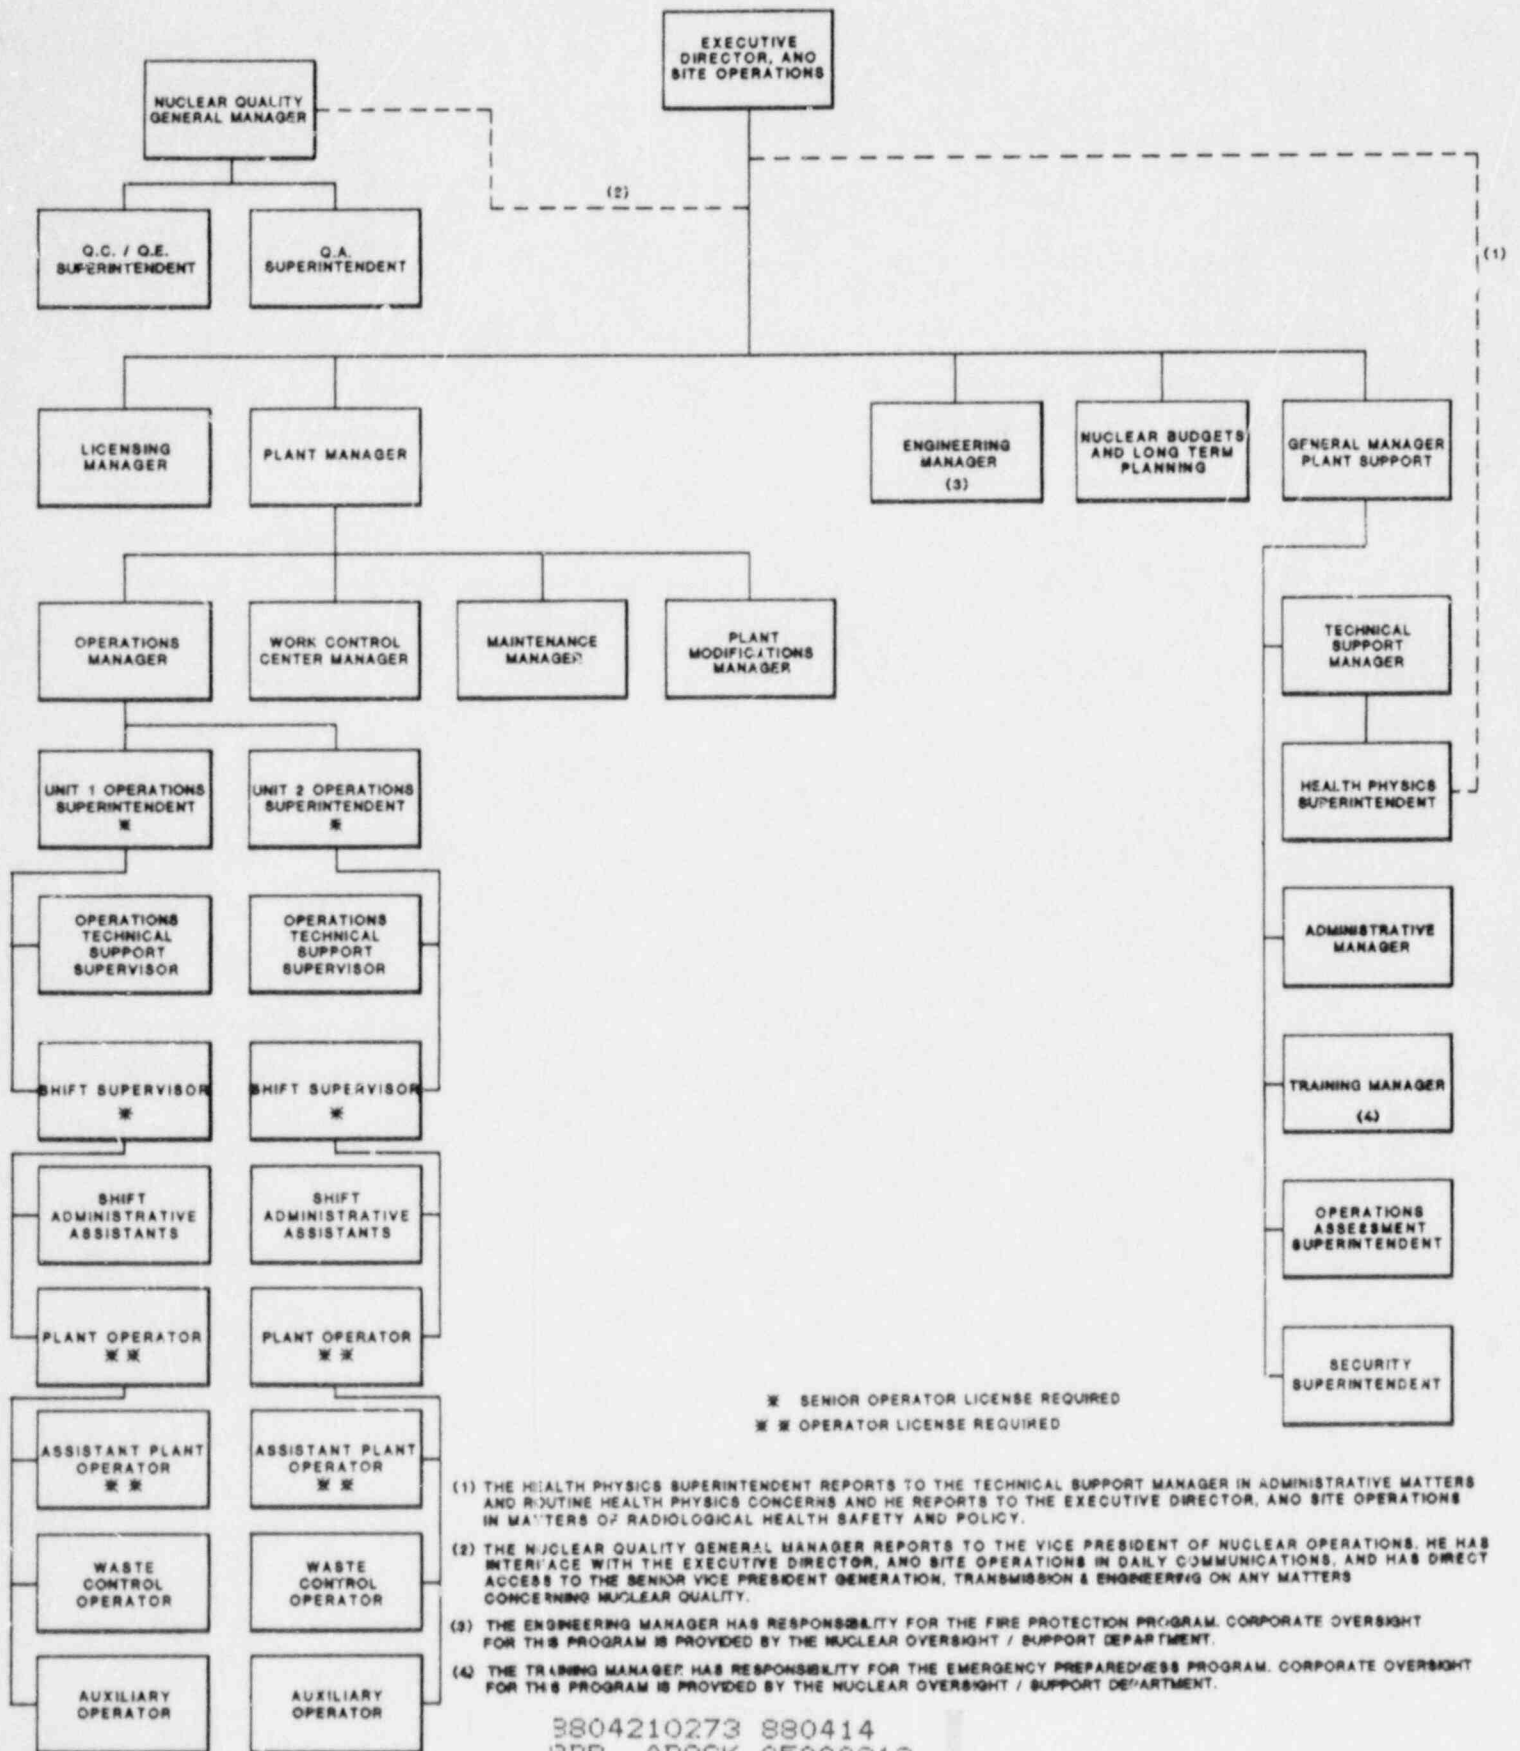

3804210273 880414  
PDR ADOCK 05000313  
DCD

**FIGURE 6.2-2 FUNCTIONAL ORGANIZATION FOR PLANT OPERATIONS**

- d. metallurgy
- e. instrumentation and control
- f. radiological safety
- g. mechanical and electrical engineering
- h. quality assurance practices

#### COMPOSITION

- 6.5.2.2 The Safety Review Committee shall be composed of a Chairman and eight to twelve members which collectively have the experience and competence required by ANSI/ANS-3.1-1981 to review problems in the areas specified in Section 6.5.2.1, a-h.

The Vice President of Nuclear Operations shall designate, in writing, the Chairman and all SRC members.

The Chairman shall designate, in writing, the alternate Chairman in the absence of the SRC Chairman

#### ALTERNATES

- 6.5.2.3 All alternate members shall be appointed in writing by the SRC Chairman to serve on a temporary basis; however, no more than two alternates shall participate as voting members in SRC activities at any one time.

#### CONSULTANTS

- 6.5.2.4 Consultants shall be utilized as determined by the SRC Chairman to provide expert advice to the SRC.

#### MEETING FREQUENCY

- 6.5.2.5 The SRC shall meet at least once per calendar quarter during the initial year of facility operation following fuel loading and at least once per six months thereafter.

#### QUORUM

- 6.5.2.6 The minimum quorum of the SRC necessary for the performance of the SRC review and audit functions of these technical specifications shall consist of the Chairman or his designated alternate and at least a majority of the SRC members including alternates. No more than a minority of the quorum shall have line responsibility for operation of the unit.