
A Reliability Program for Emergency Diesel Generators at Nuclear Power Plants

Program Structure

Prepared by E.V. Lofgren, G.M. DeMoss, J.R. Fragola,
P.L. Appignani, G. Delarche, J. Boccio

Science Applications International Corporation

Sandia National Laboratories

Prepared for
U.S. Nuclear Regulatory
Commision

NOTICE

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, or any of their employees, makes any warranty, expressed or implied, or assumes any legal liability of responsibility for any third party's use, or the results of such use, of any information, apparatus, product or process disclosed in this report, or represents that its use by such third party would not infringe privately owned rights.

NOTICE

Availability of Reference Materials Cited in NRC Publications

Most documents cited in NRC publications will be available from one of the following sources:

1. The NRC Public Document Room, 1717 H Street, N.W.
Washington, DC 20555
2. The Superintendent of Documents, U.S. Government Printing Office, Post Office Box 37032,
Washington, DC 20013-7082
3. The National Technical Information Service, Springfield, VA 22161

Although the listing that follows represents the majority of documents cited in NRC publications, it is not intended to be exhaustive.

Referenced documents available for inspection and copying for a fee from the NRC Public Document Room include NRC correspondence and internal NRC memoranda; NRC Office of Inspection and Enforcement bulletins, circulars, information notices, inspection and investigation notices; Licensee Event Reports; vendor reports and correspondence; Commission papers; and applicant and licensee documents and correspondence.

The following documents in the NUREG series are available for purchase from the GPO Sales Program: formal NRC staff and contractor reports, NRC sponsored conference proceedings, and NRC booklets and brochures. Also available are Regulatory Guides, NRC regulations in the *Code of Federal Regulations*, and *Nuclear Regulatory Commission Issuances*.

Documents available from the National Technical Information Service include NUREG series reports and technical reports prepared by other federal agencies and reports prepared by the Atomic Energy Commission, forerunner agency to the Nuclear Regulatory Commission.

Documents available from public and special technical libraries include all open literature items, such as books, journal and periodical articles, and transactions. *Federal Register* notices, federal and state legislation, and congressional reports can usually be obtained from these libraries.

Documents such as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings are available for purchase from the organization sponsoring the publication cited.

Single copies of NRC draft reports are available free, to the extent of supply, upon written request to the Division of Information Support Services, Distribution Section, U.S. Nuclear Regulatory Commission, Washington, DC 20555.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at the NRC Library, 7920 Norfolk Avenue, Bethesda, Maryland, and are available there for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from the American National Standards Institute, 1430 Broadway, New York, NY 10018.

A Reliability Program for Emergency Diesel Generators at Nuclear Power Plants

Program Structure

Manuscript Completed: February 1988
Date Published: April 1988

Prepared by
E.V. Lofgren, G.M. DeMoss, J.R. Fragola,
P.L. Appignani, G. Delarche*, J. Boccio**

Science Applications International Corporation
1710 Goodridge Drive
McLean, VA 22102

Under Contract to:
Sandia National Laboratories
Albuquerque, NM 87185

*Trident Engineering
**Brookhaven National Laboratory

Prepared for
Division of Reactor and Plant Systems
Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, DC 20555
NRC FIN A1806

ABSTRACT

The purpose of this report is to provide technical guidelines for NRC staff use in the development of positions for evaluating emergency diesel generator (EDG) reliability programs. Such reviews will likely result following resolution of USI A-44 and GSI B-56. The diesel generator reliability program is a management system for achieving and maintaining a selected (or target) level of reliability. This can be achieved by: (1) understanding the factors that control the EDG reliability and (2) then applying reliability and maintenance techniques in the proper proportion to achieve selected performance goals. The concepts and guidelines discussed in this report are concepts and approaches that have been successful in applications where high levels of reliability must be maintained.

Both an EDG reliability program process and a set of review items for NRC use are provided. The review items represent a checklist for reviewing EDG reliability programs. They do not, in themselves, constitute a reliability program. Rather, the review items are those distinctive features of a reliability program that must be present for the program to be effective.

CONTENTS

	<u>Page</u>
ABSTRACT.....	iii
CONTENTS.....	v
FIGURES.....	vi
TABLES.....	vi
FORWARD.....	vii
ACKNOWLEDGMENTS.....	ix
1.0 INTRODUCTION	1-1
1.1 Purpose of Document	1-1
1.2 EDG Mission	1-1
1.3 Diesel Generator Reliability Target	1-1
1.4 EDG Reliability Program Overview.....	1-2
2.0 DIESEL GENERATOR RELIABILITY PROGRAM TEMPLATE	2-i
3.0 REVIEW ITEMS DISCUSSION.....	3-1
3.1 Review Item A: EDG Reliability Target.....	3-1
3.2 Review Item B: EDG Surveillance Needs	3-1
3.3 Review Item C: EDG Performance Monitoring	3-6
3.4 Review Item D: EDG Maintenance Program.....	3-6
3.5 Review Item E: EDG Failure Analysis and Root Cause Investigation	3-7
3.6 Review Item F: Problem Closeout.....	3-9
3.7 Review Item G: Data System.....	3-10
3.8 Review Item H: Responsibilities and Management Controls.....	3-11
REFERENCES.....	R-1
GLOSSARY.....	G-1
APPENDIX A - EMERGENCY DIESEL GENERATOR RELIABILITY TARGET.....	A-1
APPENDIX B - EDG SURVEILLANCE NEEDS	B-1
APPENDIX C - EDG PERFORMANCE MONITORING	C-1
APPENDIX D - EDG MAINTENANCE PROGRAM	D-1
APPENDIX E - FAILURE ANALYSIS AND IDENTIFICATION OF CORRECTABLE CAUSES.....	E-1
APPENDIX F - PROBLEM CLOSEOUT.....	F-1
APPENDIX G - DATA SYSTEM.....	G-1
APPENDIX H - RESPONSIBILITIES AND MANAGEMENT CONTROLS	H-1
APPENDIX I - EMERGENCY DIESEL GENERATOR DATA REVIEW	I-1

LIST OF FIGURES

Figure 2-1.	Reliability Program Process	2-2
Figure 3-1.	Top-Level Work Breakdown Structure Showing Tasks Necessary to Provide a Reliability Focus for Surveillance	3-2
Figure 3-2.	Systematic Root Cause Approach	3-8

LIST OF TABLES

Table 1-1.	Diesel Generator Reliability Program Review Items.....	1-3
Table 3-1.	Definition of Diesel Subsystems.....	3-3

FOREWORD

PREPARED BY THE NRC STAFF

This report provides insights into the principal elements of an emergency diesel generator (EDG) reliability program which have been derived from applications where high levels of reliability must be achieved and maintained. This report was prepared by Science Applications International Corporation for use by NRC staff in connection with the resolution of Generic Safety Issue B-56, "Diesel Reliability". This report therefore provides technical guidelines to NRC staff for use in evaluating emergency diesel reliability programs that may have to be reviewed in the future. It should be clearly noted that the findings and recommendations provided in this report are those of the contractor and contributing authors and do not constitute regulatory positions or requirements.

ACKNOWLEDGMENTS

The authors thank Arthur Payne of Sandia National Laboratories, Lawrence Kripps of EI International, Ron Battle of Oak Ridge National Laboratory, and Carl Johnson of the U.S. Nuclear Regulatory Commission for their many constructive comments and valuable insights in review of this document; Wallace Norris of the U.S. Nuclear Regulatory Commission expedited the acquisition of the Nuclear Plant Reliability Data System data. The authors also thank Aleck Serkiz of the U.S. Nuclear Regulatory Commission for his leadership and foresight in initiating and guiding the development of this document.

1. INTRODUCTION

This report was prepared to support the resolution of Generic Safety Issue B-56, "Diesel Reliability." B-56 is a generic safety issue (GSI) related to the Unresolved Safety Issue (USI) A-44, "Station Blackout." The resolution of USI A-44 establishes a need for an emergency diesel generator (EDG) reliability program that has the capability to achieve and maintain EDG reliability levels in the range of 0.95, or better. Regulatory Guide 1.155, "Station Blackout," provides guidance for assessing EDG reliability levels and implementing a reliability program to meet the requirements of 10 CFR Part 50, Section 50.63, "Loss of All Alternating Current Power." This report describes an EDG reliability program that is consistent with guidance in Regulatory Guide 1.155.

1.1 Purpose of Document

The purpose of this report is to develop the major elements of an EDG reliability program and to maintain EDG reliability levels at 0.95, or better. Therefore, a reliability program becomes a structured approach to integrate concepts and approaches that have been shown successful in applications where high levels of reliability must be maintained. This can be achieved by: (1) understanding the factors that lead to EDG failures, (2) applying reliability monitoring and maintenance techniques in proper proportion to achieve reliability targets, and (3) providing a structured approach for closing out problems encountered and for their avoidance in the future.

1.2 EDG Mission

The primary mission of EDGs at nuclear power plants is to provide highly reliable ac power to safety-related systems in the event offsite ac power sources are not available. To accomplish this, EDGs (normally in the stand-by mode) must start and carry electrical loads within a specified period of time, depending on the accident or event, and continue to provide ac power until offsite power is restored.

1.3 Diesel Generator Reliability Target

The minimum EDG reliability level should be targeted at 0.95 per demand for each EDG for plants in emergency ac (EAC) Groups A, B, and C, and at 0.975 per demand for each EDG for plants in EAC Group D, as defined in Regulatory Guide 1.155 (Ref. 1). These reliability levels should be considered minimum target reliabilities and each plant should have an EDG reliability program containing the principal elements, or their equivalent, as outlined in Section 1.2 of Regulatory Guide 1.155. The principal elements of an EDG reliability program should be consistent with guidance provided in Regulatory Guide 1.155.

1.4 EDG Reliability Program Overview

A diesel generator reliability program is a management system for managing diesel generator reliability. The rules and procedures that flow from the management system are all based on a consistent philosophy, which states that a specified reliability target can be achieved by understanding the factors that drive a diesel generator's reliability, and then applying reliability and engineering techniques in sufficient depth to ensure that the target is reached.

Table 1-1 provides an overview of the review items of an EDG reliability program that are consistent with Regulatory Guide 1.155. Items A through H represent program elements that should be developed in the preparation of an EDG reliability program. These items represent the necessary considerations in the development of a reliability program designed to sustain the reliability levels needed for EDGs at nuclear power plants.

Therefore, these items provide a checklist for assessing EDG reliability programs. However, these items, in themselves, do not constitute a reliability program process. The reliability program process that is developed in Section 2 of this report and detailed in the appendices can be used in assessments of reliability programs. Further, this report is not intended to establish unconditional and specific requirements. Rather, this report provides a reliability program approach consistent with current experience and findings from other reliability program applications where sustaining a high level of reliability is essential.

Section 2 also presents the relationships between these items (referred to as review items) and the logic of a reliability program process. Section 3 provides summary definitions of each of the review items. Appendices A through H, corresponding to the items identified in Table 1-1, provide further insights into considerations, examples, and guidance for development of such elements. Appendix I was included for identification of EDG failure modes encountered for EDG subsystems and for the various manufacturers. This appendix can be used as a supplemental aid in developing an EDG reliability program. However, Appendix I is not to be used to draw broad conclusions. The variability of failures, underlying causes, and historic trends cannot be properly extracted from Appendix I without reviewing the reported details for each event (which in many instances was sparse or lacking).

TABLE 1-1

DIESEL GENERATOR RELIABILITY PROGRAM REVIEW ITEMS

A. EDG Reliability Target

Ensure that the reliability target for the diesel generator has been established and that calculational measures have been defined that can be evaluated and compared to the target.

B. EDG Surveillance Needs

Ensure that the diesel generator equipment boundary has been defined and that the diesel generator reliability program has specified a task for analyzing the surveillance needs of this equipment

C. EDG Performance Monitoring

Ensure that the reliability program specifies a task to monitor diesel generator performance, using both statistical trending and engineering data, to spot degradations in performance.

D. EDG Maintenance Program

Ensure that the diesel generator maintenance program has a reliability focus that includes preventive maintenance, prioritization of maintenance actions and spare parts considerations.

E. EDG Failure Analysis and Root Cause Investigation

Ensure that there is a task to systematically reduce identified diesel generator problems to correctable causes.

F. Problem Closeout

Ensure that the diesel generator reliability program requires a formal problem closeout procedure and that this procedure involves both (1) establishing criteria for problem closeout when a reliability problem is detected, and (2) providing for any special monitoring activity to ensure that the criteria have been satisfied by the corrective action.

G. Data System

Ensure that a data gathering, storage, and retrieval system with sufficient capabilities to support all features of the reliability program is in place or will be implemented as part of the diesel generator reliability program.

H. Responsibilities and Management Controls

Ensure that there are clear line responsibilities and management controls in place that identify responsible individuals for implementing and operating the diesel generator reliability program, and ensure that these individuals are qualified to perform the functions for which they are responsible.

2. DIESEL GENERATOR RELIABILITY PROGRAM TEMPLATE

The important elements necessary for successful operation of a diesel generator reliability program are depicted in Figure 2-1, although these elements could be combined in ways alternative to Figure 2-1. However, the reliability program should be a closed loop process with the following characteristics:


- A structured approach to problem detection. A direct means of problem detection is monitoring EDG performance and comparing it to a reliability target. Other important problem detection means come from diesel generator condition monitoring and reliability engineering (e.g., performance monitoring, operating experience) techniques.
- A means for problem prioritization and correction. The prioritization should take into account problem severity and impact on EDG reliability; the problem correction should take into account the priority and include, when appropriate, failure and root cause analysis.
- A formal problem closeout. The corrective action should be verified and the problem closed out by monitoring the EDG in order to ensure that the problem has been effectively corrected.

A brief discussion of each of the essential elements (as identified in Figure 2-1) of a diesel generator reliability program and how they relate to the review items identified in Section 1 is provided next. Section 3 follows with a detailed discussion of each review item. Reference 2 provides a more detailed discussion of the reliability program process.

Monitor Diesel Generator Reliability Performance

This element encompasses both diesel reliability monitoring and condition monitoring that are required by Review Item C (EDG Performance Monitoring). Reliability monitoring refers to the direct tracking of diesel generator failure frequency and downtime and to tracking of characteristics that are related to failure frequency and downtime such as severity and cause of failure. Condition monitoring refers to tracking predictive conditions that are associated with diesel generator failure modes, e.g., moisture in the air start system or excessive vibration, temperature, or pressure.

Performance monitoring is accomplished by using information obtained from diesel generator surveillance. For the purpose of this document, "surveillance" refers to any purposeful act to obtain information concerning the operational readiness of, or deterioration of, the diesel generators. It includes demand testing, partial demand testing, walkaround and visual inspection, teardown inspection, and condition monitoring. The

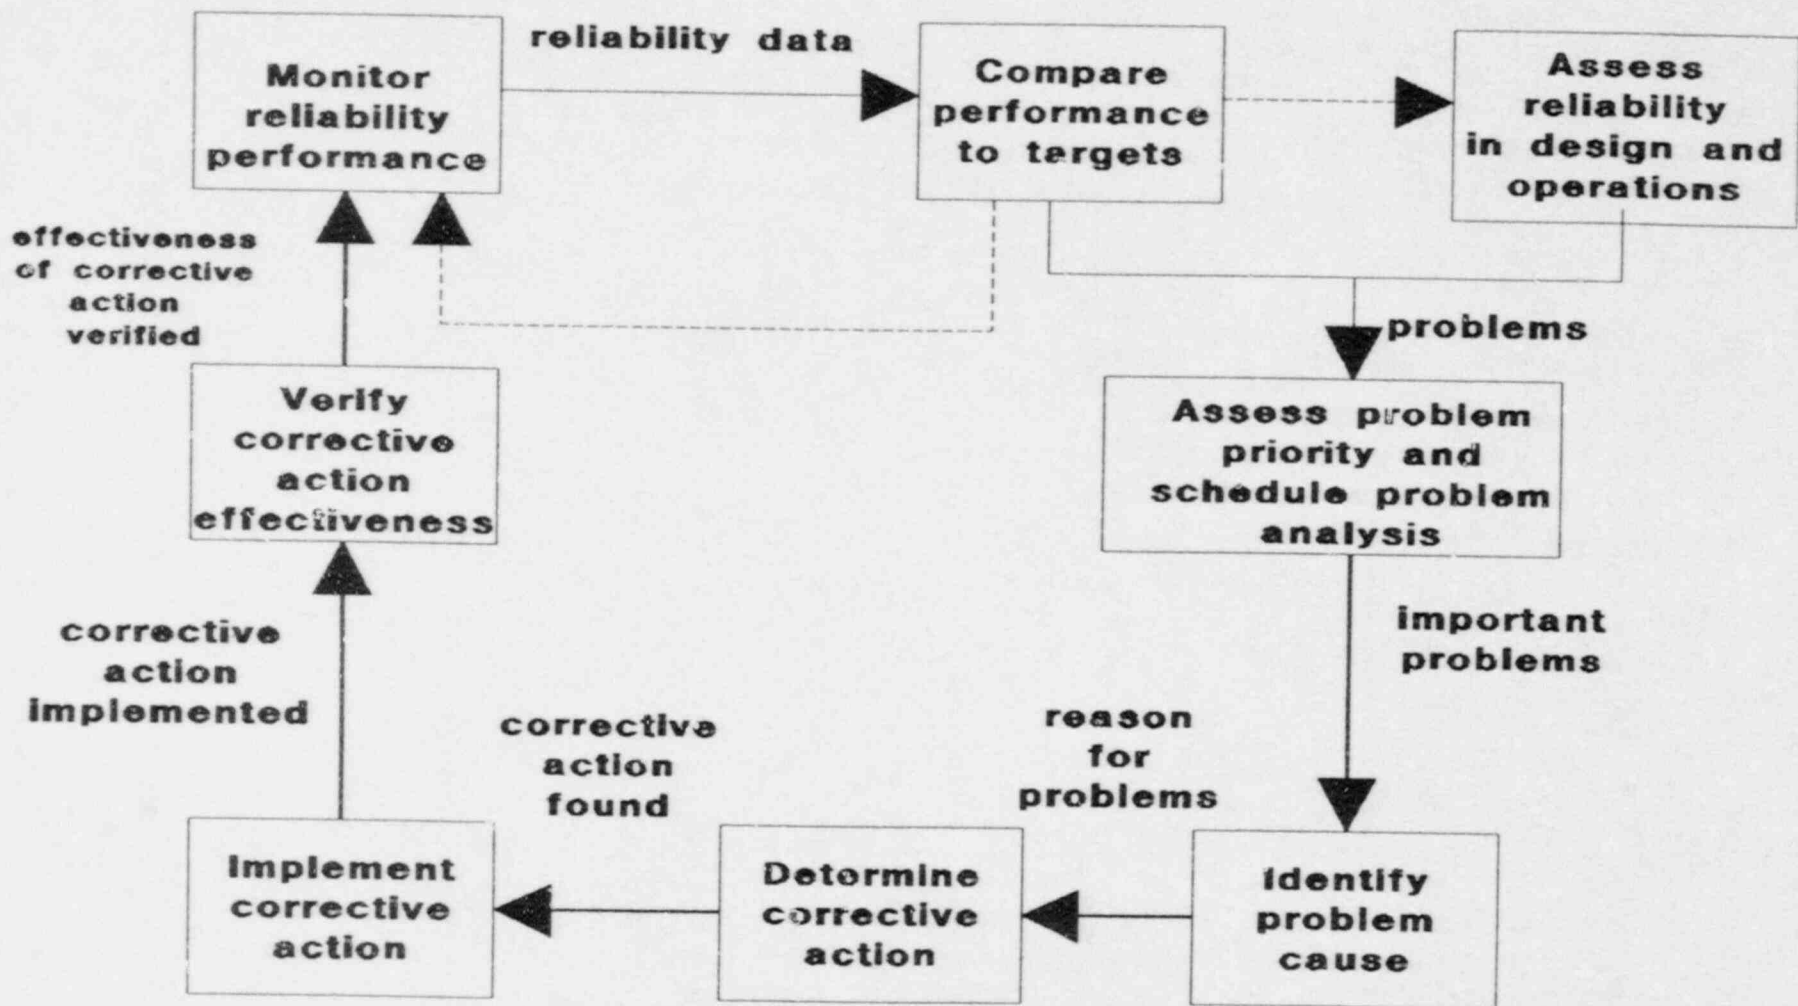

2-2

FIGURE 2-1. RELIABILITY PROGRAM PROCESS

determination of appropriate surveillance needs is addressed by Review Item B (EDG Surveillance Needs).

Compare Diesel Generator Performance to Targets

This element provides for the periodic assessment of diesel generator performance by comparing the actual performance, as estimated in the first element described above, to alert levels related to the diesel generator reliability target. Included in this element is comparison of observed degraded or incipient conditions to alert levels for these conditions. The alert levels should be set to ensure reliability levels of Regulatory Guide 1.155. They need to be quantitatively related directly to the diesel generator reliability target but should be consistent with this target level. Alert levels for NRC use and suggested actions are addressed in Review Item A (EDG Reliability Targets).

Evaluate Diesel Generator Reliability Related to Design and Operation

This element consists of the evaluation of the design and operation of the diesel generator to determine if conditions exist that may result in unreliable operation or deterioration of the diesel generator. This element could uncover potential reliability concerns before they manifest themselves in deterioration of the diesel generators. Specific reliability techniques for accomplishing this element include design review to identify failure modes using techniques such as failure modes and effects analysis (FMEA) or fault trees, analysis of data collected through performance monitoring such as condition monitoring data, and analysis of other data sources such as maintenance records, Nuclear Plant Reliability Data System (NPRDS) reports, licensee events reports (LERs), inservice inspection testing results, etc. The major thrust of this element is the evaluation of EDG design and operations in order to (1) identify design problems so they can be corrected and (2) identify specific surveillance issues (Review Item B) related to design (e.g., common cause, system interaction). The work in this element also drives aspects of Review Item C (Performance Monitoring).

Assess the Priority of Diesel Generator Investigations and Corrective Actions

This element provides for prioritizing maintenance actions on repair of noncatastrophic diesel generator failures and conditions (catastrophic diesel generator failures must be repaired when they are detected). The prioritization must account for the mean time to catastrophic failure given the observed condition, the outage time required for repair, and collateral damage that could result if the observed condition progressed to a catastrophic diesel generator failure. This prioritization creates a

reliability center to the maintenance actions addressed by Review Item D (EDG Maintenance Program).

Diesel Generator Failure and Root Cause Analysis

This element provides for a failure investigation that can ultimately lead to a root cause analysis of diesel generator reliability problems, including assessment of when to apply root cause investigations. Root cause of failure or maintenance unavailability for diesel generator components can usually be attributed to one of the following broad areas:

- Design, manufacturing/construction inadequacy
- Operating procedures inadequacy
- Maintenance activities (scheduled, forced)
- Environmental stress.

Determination of appropriate corrective actions can only be accomplished when the problem root cause has been identified.

Determine Corrective Action; Implement Corrective Action

These two diesel generator reliability program elements are largely engineering-related activities needed to complete the reliability program process. They are currently performed at all plants.

Verify Diesel Generator Corrective Action Effectiveness

This element must show that the corrective action implemented was effective in correcting the diesel generator reliability problem. Two steps are necessary. First, identify criteria that would be satisfied if the corrective action is to be counted as a success. This is done before the decision regarding corrective action effectiveness is made. Second, monitor the diesel generator performance to ensure that the actual performance meets the criteria. This element corresponds to Review Item F (Problem Closeout).

Implicit in the EDG reliability program depicted by Figure 2-1 are elements that must be present to support the process. These supporting elements include (1) the existence of an EDG data base and data management system (Review Item G, "Data System") and (2) assignment of responsibilities and existence of management controls to ensure that the reliability program process is adequately managed (Review Item H, "Responsibilities and Management Controls").

3. REVIEW ITEMS DISCUSSION

The review items summarize the features that should be present for a successful diesel generator reliability program, that is, one that will provide assurance that the diesel generator reliability target will continue to be met over the plant lifetime. The review items were listed in Table 1-1. A brief discussion of each of the review items is presented in the following subsections.

3.1 Review Item A: EDG Reliability Target

The reliability target for individual diesel generators has been established, as part of the resolution of USI A-44, to be 0.95 or 0.975, depending on the plant-specific emergency ac power system (see Ref. 1). This target reliability is to be interpreted in the following way:

- o The target is to be interpreted as an average value over a specified base-time or number of demands.
- o The number of demands are to include actual demands for the diesel generator systems' function and demand tests of the system that involve an attempted start and run.
- o Both failures to start and failures to run are to be included in the calculation of diesel generator reliability.
- o Diesel generator failures that are recovered with a successful start and load within 5 minutes are not to be counted as failures.

Appendix A presents a more detailed discussion of the diesel generator reliability target and how that target is to be estimated. Appendix A also contains an EDG failure evaluation criterion for judging the acceptability of EDG failure histories.

3.2 Review Item B: EDG Surveillance Needs

Surveillance is defined to include all failure detection and in-plant reliability information-gathering activities. The surveillance strategy for the diesel generators should be a result of an analysis of diesel generator surveillance needs. This analysis should be systematically performed and the resultant surveillance needs periodically evaluated. The dynamic nature of the surveillance plan, with respect to the EDG's performance, helps to ensure a reliability focus to the surveillance activities. The tasks necessary to provide a reliability focus to diesel generator surveillance are shown in Figure 3-1.

A diesel generator is defined as the diesel generator subsystems and equipment exclusively employed to produce emergency ac power, appropriately partitioned among the generating units at the plant. Table 3-1 defines a diesel generator in terms of its subsystems. The pieceparts to be associated with the diesel generator are those whose sole function is related to

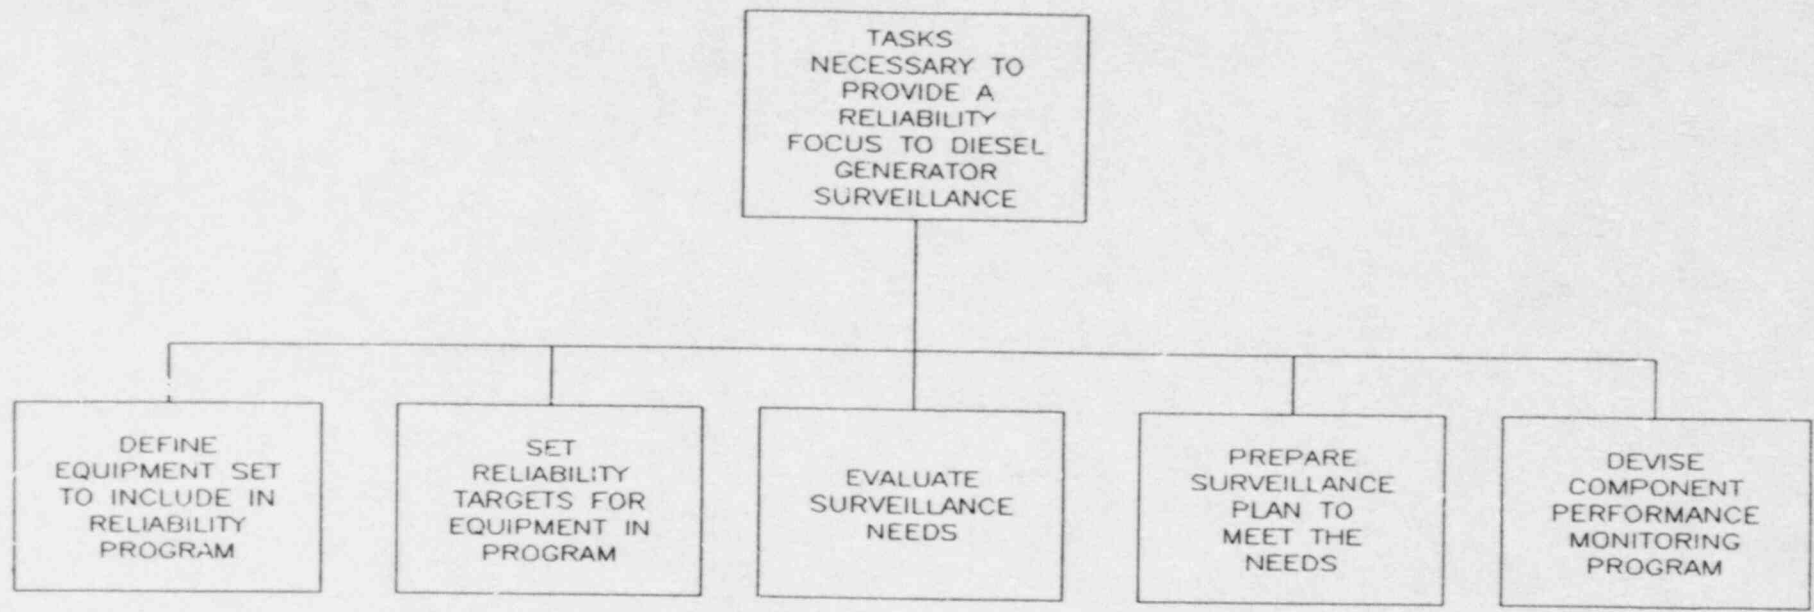


FIGURE 3-1. TOP-LEVEL WORK BREAKDOWN STRUCTURE SHOWING TASKS NECESSARY TO PROVIDE A RELIABILITY FOCUS FOR SURVEILLANCE

TABLE 3-1
DEFINITION OF DIESEL SUBSYSTEMS

Inside the Boundary

Speed Control -	<i>(Includes governor, speed sensing, frequency sensing, and fuel racks positioning)</i>
Fuel Supply -	<i>(Includes equipment from the day tank through injectors)</i>
Fuel Storage -	
Lube Oil -	<i>(Includes prelube, preheating if applicable)</i>
Engine Cooling -	<i>(Diesel-specific cooling water)</i>
Heat Sink -	<i>(Radiator or site service water system up to and including inlet and outlet valves of heat exchangers)</i>
Exhaust -	
Environment Control -	<i>(Room temperature and humidity control)</i>
Intake Air Supply -	
Turbocharger -	
Diesel Mechanical -	<i>(The casing and all components within, up to, but not including, attached pumps or other piping systems)</i>
Air Start -	<i>(Includes starting air supply)</i>
Generator Electro-Mechanical -	<i>(Including up to output breaker)</i>
Voltage Regulation/Field Flash -	
Start Control -	<i>(Autostart sensors, logic, remote manual start capability)</i>
Other I&C -	<i>(Including trips, control room indications)</i>

TABLE 3-1 (Continued)
DEFINITION OF DIESEL SUBSYSTEMS

Outside the Boundary

Load Sequencer -

DC Power Supply -

AC Power Supply - *(For auxiliaries, I&C)*

Synchronization Circuitry -

Service Water Supply -

AC Power Distribution System -

diesel generator operability. For instance, a diesel generator may require service water for operability, but only those service water components and pieceparts whose function is solely to support the diesel generator should be included in the diesel generator boundary.

Analysis is required to ensure that surveillance of diesel generators addresses a minimum set of criteria for acceptable surveillance. The analysis must result in a documented surveillance plan. The surveillance plan should specify the diesel generator surveillance and the rationale for the specified surveillance. The considerations that must be addressed to provide acceptable diesel generator surveillance are:

1. All critical failure modes of the diesel are covered by the surveillance. Critical failure modes are likely failure modes that would fail the diesel generator function of providing emergency ac power.
2. The analysis should identify engineering conditions that are precursors to critical failure modes and suggest surveillance methods (e.g., condition monitoring) to detect those conditions in a timely fashion.
3. The analysis should identify likely standby diesel generator aging mechanisms and identify surveillance to detect these.
4. The analysis should emphasize consideration of common cause failure mechanisms that could fail more than one diesel generator at a site and identify surveillance to protect against these failures.
5. Diesel generator repair outages can result from off-normal conditions or failures that are caused by stress on the diesel from starting and running. Failures can also result from mechanisms that operate on the diesel generator while it is in standby. Diesel generator demand test periods should be set by balancing the effects of these two failure causes (failure modes related to demand stress and those related to standby stress). The analysis should contain these considerations.
6. A surveillance plan should be prepared that defines the types of surveillance to be employed, the surveillance intervals for each type, and other considerations such as test staggering. Justification based on engineering, human, or reliability considerations should be given as to why the surveillance types and intervals were chosen and why they are sufficient to achieve the reliability target.

Appendix B presents a more detailed discussion of the assessment of diesel generator surveillance needs.

3.3 Review Item C: EDG Performance Monitoring

Performance monitoring of a diesel generator includes monitoring physical conditions that are precursors to failure or correlated to degradations in performance. Examples include lube oil temperature, manifold temperature and starting air moisture. Performance monitoring also includes statistical trending of failures and outages that may show detectable degradations in performance. While surveillance provides a "snapshot" of diesel generator operability, performance monitoring provides the "memory" portion of the problem detection task of a diesel generator reliability program.

The criteria for evaluating a diesel generator performance monitoring approach are:

1. The reliability information necessary to track diesel performance should be identified and correlated to the proposed surveillance. This is to ensure that the proposed surveillance will provide all the reliability information necessary to track diesel generator performance.
2. All performance monitoring computations required to be performed on both the diesel generator engineering information (i.e., physical condition data) and repair outages/failures should be explicitly defined.
3. Alert levels that signal possible diesel generator degradation should be defined for each engineering and statistical parameter used for the diesel generator performance monitoring program. The alert levels should be chosen to minimize false alarm but be sufficiently sensitive to detect problems.

Appendix C presents a more detailed discussion of diesel generator performance monitoring.

3.4 Review Item D: EDG Maintenance Program

The maintenance policy for the diesel generators should be documented and clearly exhibit a reliability focus. The maintenance policy should include procedures for preventive maintenance, triggered by observed conditions and/or regularly scheduled, and a description of the spare parts policy. The maintenance policy should also establish the basis for maintenance actions and their priority. This involves the identification of those conditions or precursors to catastrophic failure that are (1) detectable, (2) potentially severe in terms of diesel failure, i.e., lead to catastrophic diesel generator functional failure, (3) require long out-of-service times for repair, if the condition proceeds to catastrophic failure, and (4) are relatively likely to occur. Thus, the maintenance policy should have the following characteristics:

1. A distinction in the treatment of failures or conditions that result in, or could proceed to, catastrophic failure of the diesel generator versus those that do not.

2. A distinction in treatment of those repair or maintenance actions that result in disabling the diesel generator versus those that do not.
3. A recognition that preventive maintenance actions can be triggered on either time, using failure mode mean time between failures as a guide, or on conditions observed during surveillance.
4. A recognition that disabling repair times for noncatastrophic diesel generator failures or conditions, compared to the repair times and outage times for the catastrophic failures that could result from these conditions if the non-catastrophic conditions are not repaired, are an important element in the maintenance policy.
5. A recognition that the maintenance policy is driven by the target reliability of the diesel generator.
6. A recognition that the spare parts policy must include a consideration of both the frequency with which the spare part is needed and the downtime necessary to complete the repair with and without the spare part on hand.

A more detailed presentation of the issues to address in this review item is given in Appendix D.

3.5 Review Item E: EDG Failure Analysis and Root Cause Investigation

The diesel generator reliability program should contain a structured approach for systematically reducing identified diesel generator problems to correctable causes. An example top level structured approach is shown in Figure 3.2. This structured approach involves the following steps:

1. Use a failure cause analysis to determine the proximate cause of the failure. The proximate cause is expressed as a description of the piecepart failure cause, e.g., "relay xx failed to transfer due to corroded contacts."
2. Compare the proximate cause to past failures or conditions on the same and other EDGs to determine if the problem appears to have a systematic root cause, e.g., corroded contacts could be caused by an environmental mechanism.
3. If no systematic root cause is indicated, continue EDG operations as usual, including EDG performance monitoring. If a systematic root cause is indicated, begin a structured root cause investigation.
4. Determine if the problem is generic or plant specific by reviewing NPRDS and other data and analyses for similar

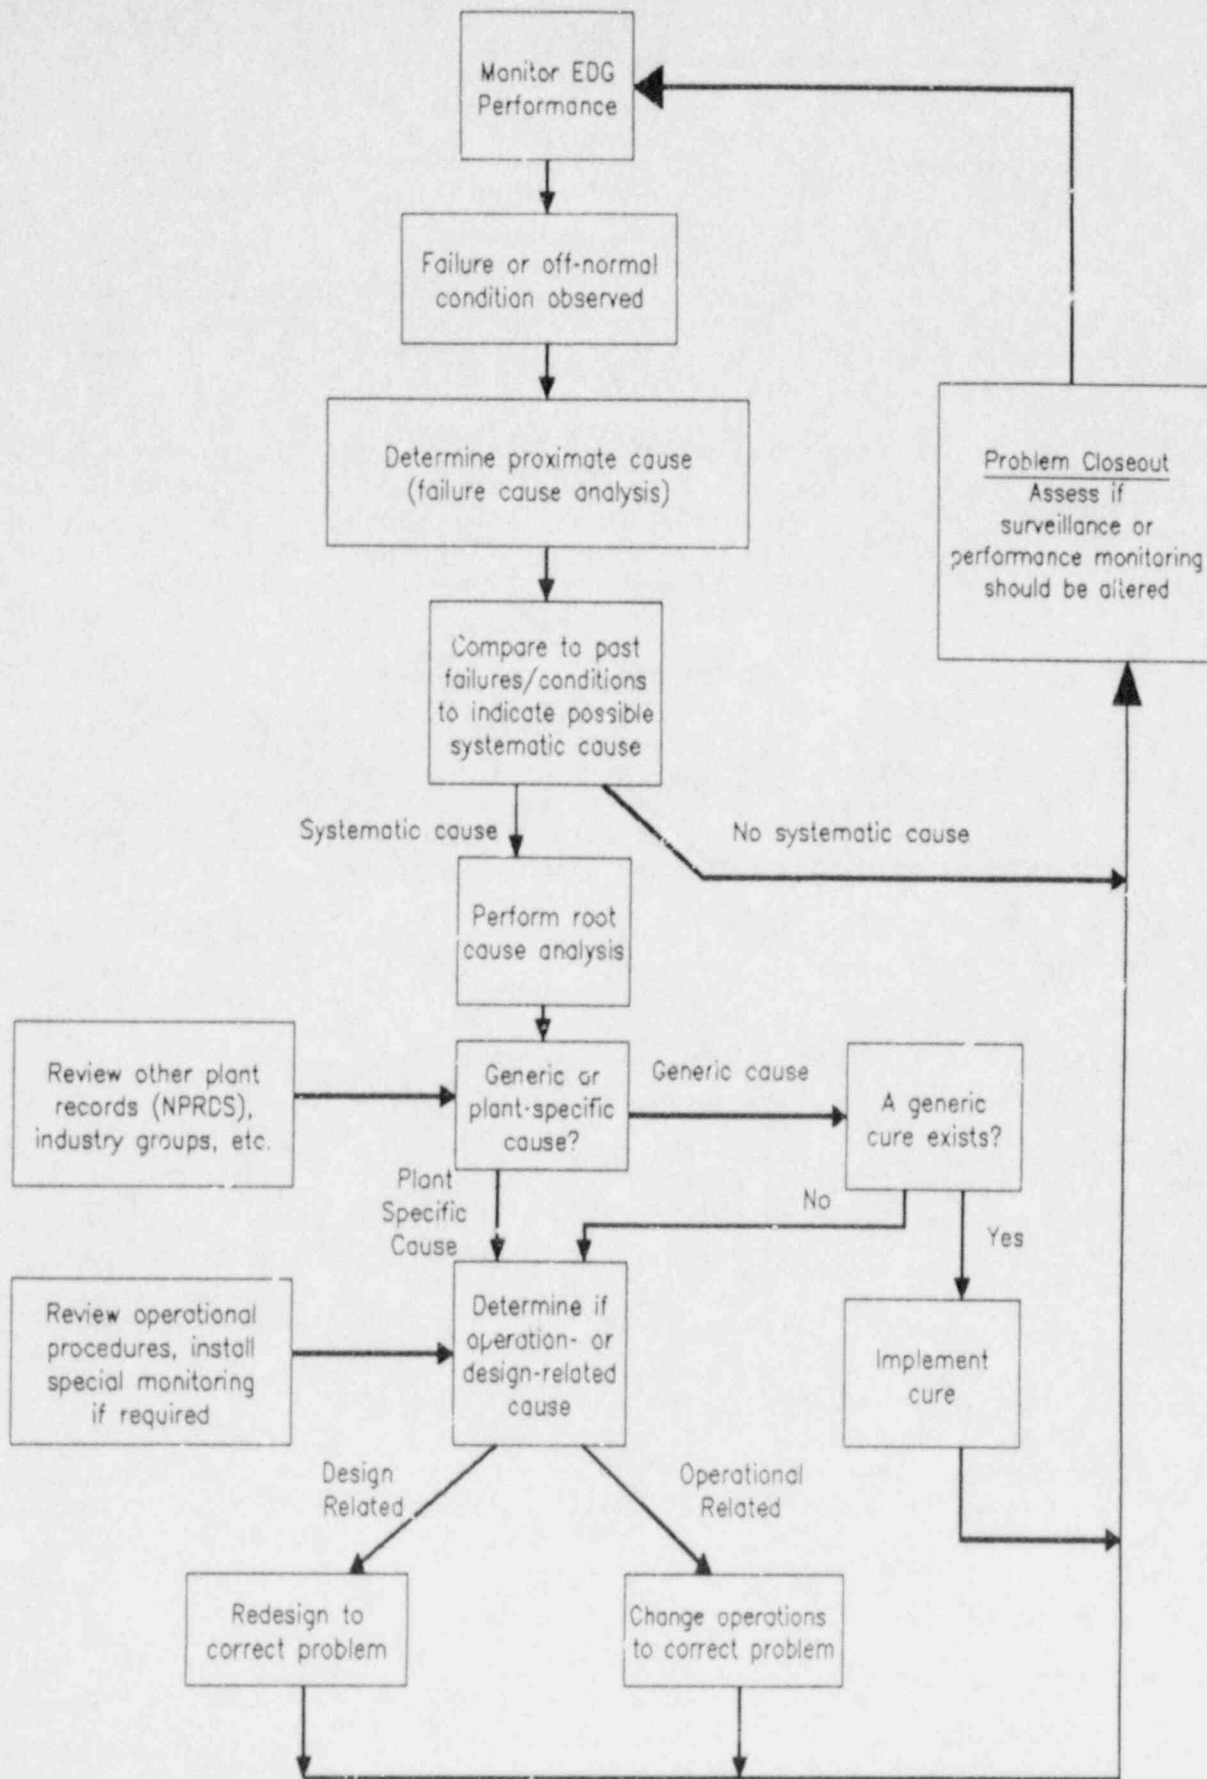


FIGURE 3-2. SYSTEMATIC ROOT CAUSE APPROACH

problem symptoms, or through contact with other utilities or industry groups.

5. If the detected reliability problem is generic, contact other plants that have had the problem to determine what corrective actions, if any, have proved effective. If an effective corrective action has been devised, implement it and proceed to the problem closeout portion of the EDG reliability program. If not, proceed to the next step.
6. If the detected reliability problem is plant specific, determine if the cause is related to the systems unique design or to operational aspects such as test or maintenance. This can be done by special monitoring during test, review of operational procedures, or engineering design review.
7. If the reliability problem is determined to be design related, determine the particular design deficiency (through special condition monitoring, perhaps), and redesign or specify other corrective action.
8. If the reliability problem is related to faulty operations, identify and correct the specific procedure(s) that are the root cause of the problem.
9. When the root cause has been identified and corrective action implemented, proceed to the problem closeout item of the EDG reliability program.

Appendix E describes the process in more detail. An EDG reliability program should be able to verify that the above or similar steps are included in the systematic problem investigation procedures.

3.6 Review Item F: Problem Closeout

The reliability program plan should specify the procedure that will be used for closing out diesel generator reliability problems. The closeout procedure occurs as the last of the following steps in the reliability program process:

1. Problem detection.
2. Problem cause determination.
3. Corrective action implementation.
4. Problem closeout.

The problem closeout procedures should be verified to contain two elements:

1. Establish criteria for problem closeout that are based on the nature of the reliability problem detected.

2. Provide for any monitoring activity, and specify closeout procedures to ensure that the criteria have been satisfied.

The problem closeout criteria should be numerically based and be capable of measurement. The diesel generator reliability program submittal should specify any special problem closeout procedures that will be employed to provide assurance that corrective actions will be effective.

Appendix F presents a more detailed discussion of this review item.

3.7 Review Item G: Data System

The reliability program should include a description of the data gathering, storage, and retrieval system that will support the diesel generator reliability program tasks. The supporting system should contain the following operational and maintenance data:

1. Store both catastrophic diesel generator failures and diesel repair outages from noncatastrophic failures.
2. Store the time of detection, times when repair was initiated and completed, and restoration time of the equipment for each diesel generator repair action.
3. Store a description of the root cause or condition that led to repair and the method by which it was detected.
4. Store each attempted start and run, runtime, and any failure rate or failure probability denominator information as described Appendix A.
5. Store in a retrievable way all the information identified in the licensee's response to all of the above stated review items.

In addition to the above identified operational and failure information, the data gathering, storage, and retrieval system should contain operating experience information on similar EDGs as provided through NPRDS, Part 21 reports, 50.55(c) reports, LERs, consultants, and especially EDG manufacturers and their suppliers (e.g., governor vendors). This information would be used to supplement data on plant experiences and as a basis for corrective actions to preclude problems experienced by other EDG owners. EDG vendor correspondence and recommendations and updated operation test and maintenance procedures should also be stored in support of the reliability program.

Appendix G presents a more detailed discussion of this review item.

3.8 Review Item H: Responsibilities and Management Controls

The reliability program should have clearly defined responsibilities and management check points to ensure that all items are interacting effectively to maintain the EDG reliability at, or above, target values. This item should provide a means for plant management to review the operation and effectiveness of the reliability program and for altering the program if it becomes necessary. In addition, a means for independent audit of the effectiveness of the EDG reliability program should be incorporated into this item.

The following considerations are important:

1. A procedure and schedule for verifying that the EDG reliability targets are being met should be established.
2. There should be an identified mechanism for altering the EDG reliability program should it become necessary.
3. Identification of qualified personnel who will implement and maintain the reliability program. Personnel qualifications should include diesel operation, maintenance, diesel design, reliability methodology, and implementation of reliability programs.
4. An unconditional commitment on the part of plant management to implement and maintain an EDG reliability program.

Appendix H presents a more detailed discussion of this item.

REFERENCES

1. Regulatory Guide 1.155, "Station Blackout," (Task SI 501-4), USNRC, Draft, November 1987.
2. M.A. Azarm, E.V. Lofgren et al., "Effectiveness of Reliability Technology Applicable to LWR Operational Safety," NUREG/CR-4618, Draft, April 1986.
3. Nuclear Management and Resources Council, "Guidelines and Technical Bases for NUMARC Initiatives Addressing Station Blackout at Light Water Reactors," NUMARC-8700, November 20, 1987.

=====

*Available in the NRC Public Document Room, 1717 H Street NW., Washington, D.C.

GLOSSARY

Availability - The probability that a component is ready to perform its mission, thus it is not out of service for maintenance or repair or in a failed state.

Catastrophic Failure* - A failure that is both sudden and complete. It causes cessation of one or more component functions.

Degraded Failure* - A failure that is gradual, partial, or both. Such a failure does not cease all component functions, but compromises a function. The function may be compromised by any combination of reduced, increased, or erratic outputs.

Disabling Repair Time - The time for which a component is unavailable due to being removed from service for a maintenance act (preventive or corrective). The time is measured from the time a component or system is taken out of service until the time at which that component or system is restored to a fully operational condition.

Failure* - The termination of the ability of an item or equipment to perform its required function.

Incipient Failure* - An imperfection in the state or condition of an item or equipment so that a degraded or catastrophic failure can eventually be expected to result if corrective action is not taken.

Reliability - The probability that a component or system will carry out its mission.

Unavailability - The probability that a component is not ready to perform its mission, thus it is out of service for maintenance or repair, or in a failed state. The opposite of availability, and numerically equal to one minus the availability.

Unreliability - The probability that a component or system will not carry out its mission. The opposite of reliability, and numerically equal to one minus the reliability.

* Consistent with IEEE Standard-500-1984.

APPENDIX A
EMERGENCY DIESEL GENERATOR RELIABILITY TARGET
(Review Item A)

TABLE OF CONTENTS

	<u>Page</u>
A.1 INTRODUCTION	A-5
A.2 ISSUES TO CONSIDER WHEN MEASURING EDG RELIABILITY	A-5
A.3 TEST VALIDITY	A-7
A.4 TEST FAILURE	A-8
A.4.1 Failure to Start	A-8
A.4.2 Failure to Load	A-8
A.4.3 Failure to Satisfactorily Function for Specified Test Runtime	A-8
A.4.4 Other Diesel Generator Failure Conditions	A-9
A.5 EDG FAILURE EVALUATION CRITERIA.	A-9
A.6 MEASUREMENT OF EDG RELIABILITY	A-17
A.7 INTERFACES WITH OTHER EDG RELIABILITY PROGRAM REVIEW ITEMS	A-18
REFERENCES FOR APPENDIX A	A-20

Table

LIST OF TABLES

A-1 EDG Failure Evaluation Criteria for EDGs with Reliability Target of 95%	A-11
A-2 EDG Failure Evaluation Criteria for EDGs with Reliability Target of 97.5%	A-12
A-3 An Alternate Presentation of EDG Failure Evaluation Criteria for EDGs with a Reliability Target of 97.5%.	A-13

Figure

LIST OF FIGURES

A-1 Representation of Successful Diesel Generator Test	A-10
--	------

A.1 INTRODUCTION

The objectives of this appendix are to (1) define the reliability target for emergency diesel generators (EDGs) and (2) to clarify the measures necessary to evaluate the achievement of this target.

The EDG reliability target will be derived from the guidelines provided in Regulatory Guide 1.155, "Station Blackout." These guidelines establish EDG reliability levels of 0.95 or 0.975. The EDG reliability program will key on minimum reliability targets; all EDG failures should be acted upon without dependence on either achieved reliability levels or target reliability levels. The EDG reliability can serve as an indicator of how well a plant's diesels are prepared to combat a loss of offsite power. In order to achieve consistency and realism in reporting the EDG reliability, the following elements are herein defined for the Diesel Generator Reliability Program: (1) diesel test runtime, (2) test validity, (3) test failure, (4) calculation/estimation of EDG reliability, and (5) EDG failure evaluation.

A.2 ISSUES TO CONSIDER WHEN MEASURING EDG RELIABILITY

The following issues should be addressed in order to define the EDG reliability target and to measure the achieved EDG reliability. The purpose of this section is to lay out the issues. Sections A.3 through A.7 provide general solutions to the issues that must be addressed by this program.

What are the EDG test runtime requirements?

Each EDG must be started and run for a sufficiently long time to demonstrate its continued operation under the same stresses that would be present at the random occurrence for an actual demand. Reference A-1 recommends that, to demonstrate continued reliability, an EDG should be run at or near full load for at least 2 hours. A test time less than 2 hours (e.g., 1 hour) could be used if any of the following conditions are met:

1. The lesser test runtime is shown to cover all the dominant failure modes of the EDG.
2. Adequate condition monitoring is performed while under test, and such conditions being monitored exhibit a stable, steady-state characteristic.
3. The shorter EDG test runtime should be shown to be preferable, from an operational standpoint, to cover all operational modes and likely failure modes of the EDG, and not to subject the engine to undesirable thermal transients.

What constitutes a valid test?

A valid test requires the diesel to be started in the same condition and subjected to the same stresses that would be present at the random occurrence of an actual demand, with the

exception that mission requirements for fast start and fast load need not be met during all routine surveillance tests provided that the fast start/load tests are performed at some appropriate interval (e.g., 6 months). A more detailed discussion of test validity is provided in Section A.3.

What constitutes a countable test failure?

Failure of the diesel generator to perform its required mission during an actual demand, or failure to start and run successfully for the test runtime on a valid test should be accounted for in the calculation of diesel reliability. Section A.4 and NSAC-108 contain the specific definitions of EDG failures.

How should EDG reliability be measured and compared to a specified target?

EDG reliability calculations should accurately take into account the number of actual demands and valid tests, EDG runtime, failures to start, run, and load. The reliability measure should be a point estimate of the average reliability of the EDG. Comparisons to the target reliability should take into account both this point estimate and the corresponding uncertainties. A more detailed explanation of the approach is provided in Section A.5.

How can the NRC determine if a plant's EDGs are performing satisfactorily?

Evaluation criteria for determining satisfactory performance and various stages of alert are proposed in Section A.5. These evaluation criteria (which are to be considered interim criteria) are based on the number of catastrophic failures in a specified number of demands. They are consistent with the criteria in Regulatory Guide 1.155, but also account for the false alarm rate, and they weight recent history more heavily than past history. The proposed action statements (see Section A.5) do not include more frequent testing when alerts are violated, but rather require a reassessment of the EDG reliability program to ensure that the EDG reliability target will be met in the future.

When can partial demand tests be substituted for full tests?

Plant operating conditions will often prohibit exact simulations of the conditions under which an EDG should operate during an actual diesel demand. Each plant should determine what conditions are not exactly simulated in EDG tests and determine through other reliability activities (condition monitoring, preventive maintenance, shorter test intervals, etc.) the adequacy of partial demand tests and the need for supplemental surveillance. It has been determined that slow starts and gradual loading can be used to obtain a valid measure of the EDG reliability level.

A.3 TEST VALIDITY

A valid test requires that the emergency diesel generator be tested in a condition in which it would normally exist when asked to respond to a random loss-of-offsite-power event, and other plant transients requiring the EDGs.

This requirement is specifically intended to preclude actions solely for the purpose of guaranteeing a successful test. This requirement is NOT intended to preclude required or necessary maintenance to the emergency diesel generator or its support systems. Nor is it intended to allow a known adverse condition to go uncorrected. Good engineering practices and condition monitoring can actually mask reliability problems when these tasks are performed merely to meet a requirement or the purpose of performing either task is not properly understood. For instance, any action taken just prior to test, and not performed on a routine basis, or any action scheduled to be performed only just prior to test would tend to mask problems that would occur during a random test.

An example is that blowing down the diesel starting air receivers just prior to a test to eliminate the failure modes resulting from accumulated moisture in the air start system would bias the failure to start probability and present an inaccurate and misleading picture of diesel reliability. Since actual demands for the diesels occur at unpredictable times, there would be no opportunity to blow down the air receivers just prior to an actual demand. Therefore, the impact of a possibly important failure mode would be masked from the reliability performance measures, unless the test procedure required checking for, and recording, the condition of excess water in the system. In this case, blowing down the air receiver just prior to test could be in the category of a good engineering practice and would not mask reliability problems associated with this condition as long as diesel failure to start was correlated to finding the condition. Blowing down the air receivers on a daily, or on some other periodic schedule not tied to demand tests, or per shift basis (as part of an operators normal routine duties) would be an acceptable form of condition monitoring.

Another example of invalidating a test is when a preventive maintenance check is always scheduled to be performed just prior to the diesel generator test. Maintenance actions designed to operate, check, or perform a special inspection of components directly affecting the satisfactory operation of the diesel generator fall into this category. This includes checking valve operations, relay operations, circuit breaker operations, etc. However, regularly scheduled maintenance actions not scheduled only prior to test, but occasionally occurring prior to test, are expected and acceptable. Also, if these maintenance actions are performed as part of the test or as an addendum to the test and are performed to correspond with a relationship to a specific failure mode or modes of the diesel generator, and the test allows for the evaluation of that relationship, then this would also be acceptable.

A.4 TEST FAILURE

A failure of an emergency diesel generator test is indicated by any one of the following:

1. A failure to start (manually or automatically, remotely or locally).
2. A successful start, followed by a failure to load.
3. A successful start and load but the diesel generator does not satisfactorily function for the specified test runtime.

Failure is defined as either a catastrophic failure in accordance with IEEE Standard-500 or immediate failure in accordance with the NPRDS Reporting Procedures Manual, Rev. 10.

A.4.1 Failure to Start

A failure to start is defined as a failure of the diesel generator to respond to a start signal either manually or automatically. The diesel generator should be started from ambient condition and accelerate to the required speed (RPM) in the time specified by the plant's technical specifications. However, an automatic start failure by itself, if immediately (in less than 5 minutes) recovered manually from the control room or from the EDG area, will not count as a failure (for station blackout). In all cases, the cause of the failure must be ascertained and corrected; however, the investigation should not interfere with the current operation of the diesel generator.

A.4.2 Failure to Load

A failure to load is defined as a failure of the generator to produce adequate electrical power or fail to provide that power to the appropriate emergency bus. This includes inadequate voltage output, either too high or too low; inadequate frequency regulation, either too low or too high; the failure of the electrical current path from the generator to the bus (including cables, output breakers, etc. All generator load ratings will be considered satisfactory if the load ratings meet the requirement set forth in the plant's technical specifications.

A.4.3 Failure to Satisfactorily Function for Specified Test Runtime

A failure of the diesel generator to satisfactorily function for the specified test runtime occurs only if the diesel generator does not function properly and either be manually tripped, or is automatically tripped, before the completion of the runtime. Tripping the diesel for an emergency condition that would not prevent mission success in an actual emergency is not considered as a valid run test or failure to run. A test runtime of at least the suggested 2-hour minimum runtime suggested in Reference A-1 should be used if any of the conditions given in Section A.2 are met.

A.4.4 Other Diesel Generator Failure Conditions

Abnormalities of the diesel generator are considered actual failures only if the diesel generator is incapable of functioning to support recovery of a station blackout event or other plant transients requiring EDGs. That is, only catastrophic or immediate failures of the diesel generator are to be considered actual failures for the purpose of this document. Note that while noncatastrophic conditions should not be considered as failures from the standpoint of calculating the EDG unreliability measures, they do constitute failures from the point of view of the reliability program in that they must be addressed within the context of the program. For example, during a diesel generator test, an operator notices that one of the cylinders is operating at a slightly elevated temperature, still within the safe operating limits of the diesel, and although the temperature is stable, he decides to shut down the diesel to investigate the cause. By shutting down the diesel, the specified test runtime requirement has not been met. Although this would imply a failure, it does not constitute a failure since, if required, the diesel generator would still be able to function satisfactorily.


While the above example denotes a degraded or incipient class of failure that would not be counted as an actual failure, the following example illustrates an actual catastrophic or immediate failure that would be counted as a failure.

If the operator, in the above example, actually noticed a high cylinder temperature in one cylinder and he also realized that the cylinder temperature was increasing so that in a short period of time the temperature would be above the safe operating limit, he would have no choice but to shut down the diesel to protect it from further possible damage. Since the diesel would not be available to supply emergency ac power, this would constitute an actual failure of the diesel generator and therefore would be counted as a failure.

Figure A-1 illustrates a diesel generator test success, with the associated failure parameters indicated.

A.5 EDG FAILURE EVALUATION CRITERIA

For NRC use, the progression of failures as well as the overall failure history should be used to judge the acceptability of diesel generator performance. The EDG failure evaluation criteria are presented in Table A-1 (for EDGs having a reliability target of 0.95), and in Table A-2 (for EDGs having a reliability of 0.975). These criteria are based on the number of catastrophic failures recorded in a succession of three operating histories. For Table A-1, the operating histories are the last 20 demands, the last 50 demands, and the last 100 demands. For Table A-2, the operating histories are the last 40 demands, the last 80 demands, and the last 120 demands. Table A-3 is provided in order to assist the NRC in evaluating EDGs having a target reliability level of 0.975 by showing the failure progressions for the last 20, 50 and 100 demands.

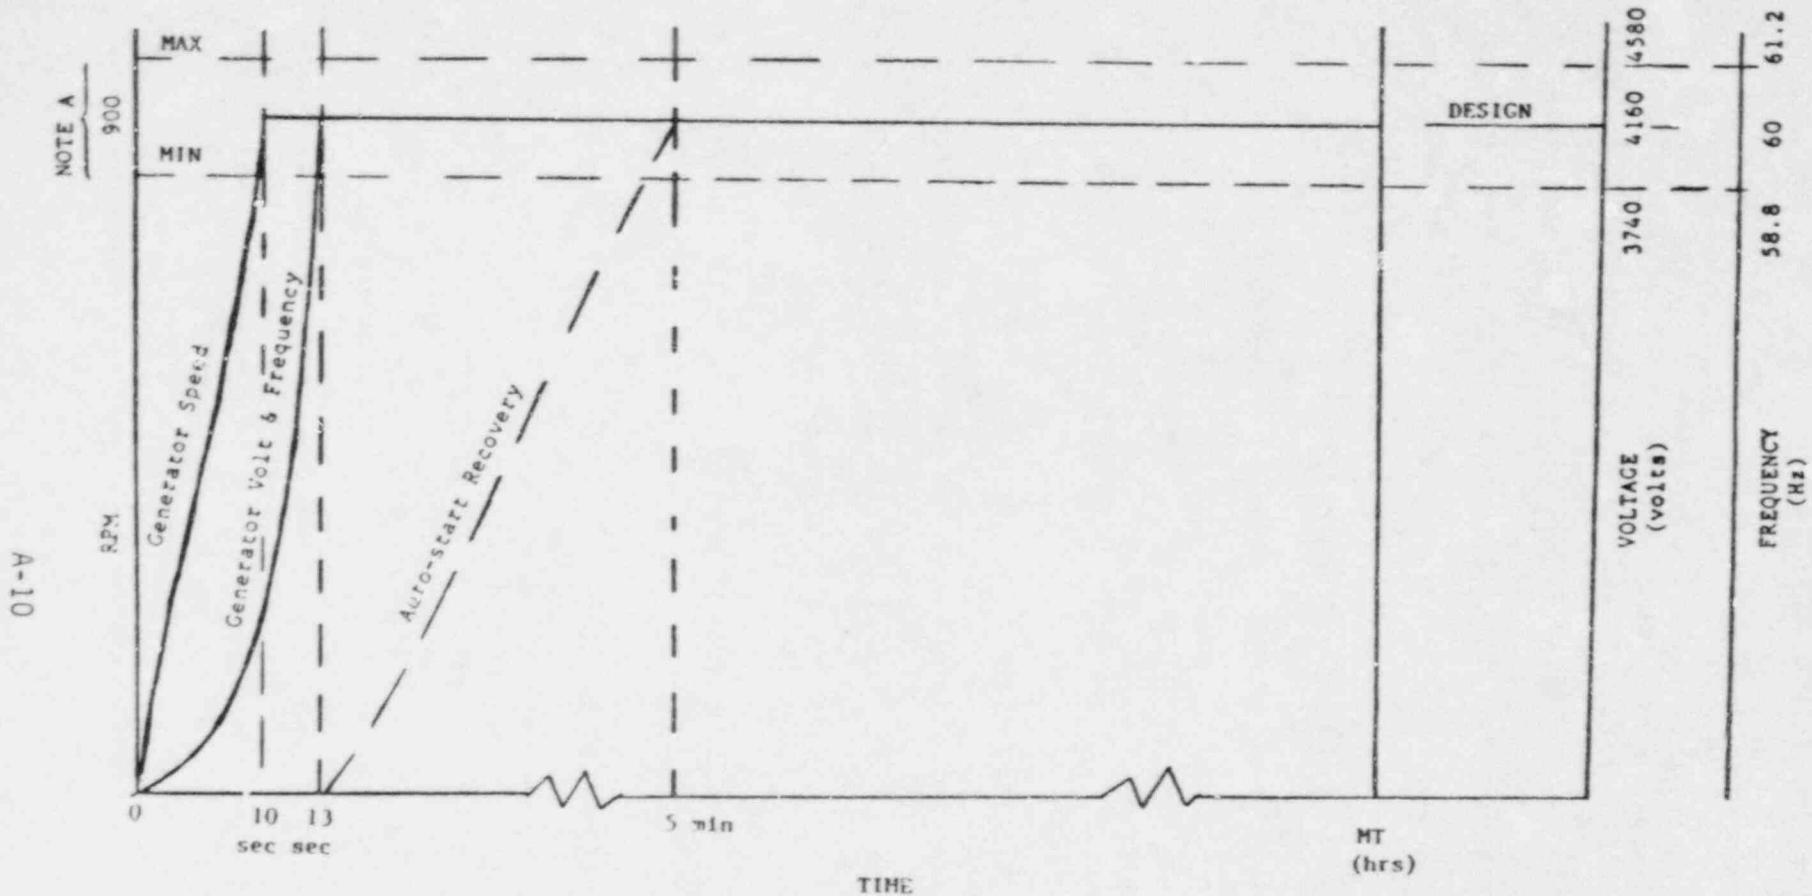

10 sec - Requirement to achieve 900 RPM
 13 sec - Requirement to achieve electrical ratings
 5 min - Recovery period for auto-start failure
 MT - Requirement to meet required mission time

NOTE A - denotes success area - the D/C test is successful if all parameters stay within the success area for the required mission time duration.

FIGURE A-1 REPRESENTATION OF SUCCESSFUL DIESEL GENERATOR TEST
 (SOURCE, G.E. STANDARD TECHNICAL SPECIFICATIONS)

TABLE A-1

EDG FAILURE EVALUATION CRITERIA
FOR EDGs WITH RELIABILITY TARGET OF 95%

Evaluation Criteria (# Failures/# Demands)	Combinations of Failure Evaluation Criteria	Time Period (1 Demand/2 Wks)	False Ala Rate
≥ 2/20	Y Y Y N N N N Y	~ 10 Months	26%
≥ 5/50	Y Y N N N Y Y N	~ 2 Years	11%
≥ 10/100	Y N N N Y Y N Y	~ 4 Years	3%
Failure Progression	1 2 3 4 5 6 7 8		
Legend:	Y = Yes N = No		

Interpretations of the Failure Progressions

Failure Progression	Interpretation
1. \geq 2 failures in 20 demands \geq 5 failures in 50 demands \geq 10 failures in 100 demands	This is an unacceptable condition requiring immediate action to declare the EDG inoperable. There is strong evidence that the long-term EDG unreliability is larger than the target value and no evidence that it is improving. The EDG reliability program must be improved or enhanced before the EDG can be declared operable again.
2. \geq 2 failures in 20 demands \geq 5 failures in 50 demands \geq 10 failures in 100 demands	This is an alert condition where action is recommended to declare the EDG inoperable. There is evidence that the EDG is deteriorating over time and that the current reliability is unacceptable. The action taken may depend on other circumstances and information from the plant.
3. \geq 2 failures in 20 demands \geq 5 failures in 50 demands \geq 10 failures in 100 demands	This is a mild alert condition where no action by the NRC is recommended unless there are other recent indications of EDG deterioration. EDGs with acceptable unreliabilities will display this condition about 26 percent of the time. Although some concern is justified, a single failure, with no evidence of degraded performance, should not lead to excessive concern.
4. \leq 2 failures in 20 demands \leq 5 failures in 50 demands \leq 10 failures in 100 demands	This is an acceptable condition. No concrete evidence of unacceptable performance.
5. \leq 2 failures in 20 demands \leq 5 failures in 50 demands \leq 10 failures in 100 demands	This is an acceptable condition. There is an indication of a past problem that has probably been corrected. Low-level vigilance is prudent to ensure continued acceptable operation.
6. \leq 2 failures in 20 demands \leq 5 failures in 50 demands \leq 10 failures in 100 demands	This is an acceptable condition but one that needs continued vigilance. There is indication that a continuing past problem is being corrected, but the evidence is not convincing enough to warrant a decrease in vigilance.
7. \leq 2 failures in 20 demands \leq 5 failures in 50 demands \leq 10 failures in 100 demands	This is an acceptable condition but one that needs continued vigilance. The interpretation of this condition is similar to the interpretation of condition 6 above, except that the history of unacceptable performance is less extensive.
8. \leq 2 failures in 20 demands \leq 5 failures in 50 demands \leq 10 failures in 100 demands	The interpretation of this condition is somewhat similar to the interpretation of condition 3, except that there is a history of a performance problem that may have been corrected, or partially alleviated. This situation is an ambiguous one, requiring a more detailed evaluation. The assessment would be different if there were 2 failures in the last 50 demands and 2 failures in the last 20 demands than if there were 5 failures in the last 50 and 2 in the last 20. An alert condition is indicated by this condition.

TABLE A-2

EDG FAILURE EVALUATION CRITERIA
FOR EDGs WITH RELIABILITY TARGET OF 97.5%

Evaluation Criteria (# Failures/# Demands)	Combinations of Failure Evaluation Criteria	Time Period (1 Demand/2 Wks)	False Alarm Rate
≥ 2/40	Y Y Y N N N N Y	~ 6 Months	26%
≥ 4/80	Y Y N N N Y Y N	~ 3 1/2 Years	14%
≥ 6/120	Y N N N Y Y N Y	~ 5 Years	8%
Failure Progression	1 2 3 4 5 6 7 8		

Legend: Y = Yes
N = No

Interpretations of the Failure Progressions

Failure Progression	Interpretation
1. M M M 2 failures in 40 demands 4 failures in 80 demands 6 failures in 120 demands	This is an unacceptable condition requiring immediate action to declare the EDG inoperable. There is strong evidence that the long-term EDG unreliability is larger than the target value and no evidence that it is improving. The EDG reliability program must be improved or enhanced before the EDG can be declared operable again.
2. M M M 2 failures in 40 demands 4 failures in 80 demands 6 failures in 120 demands	This is an alert condition where action is recommended to declare the EDG inoperable. There is evidence that the EDG is deteriorating over time and that the current reliability is unacceptable. The action taken may depend on other circumstances and information from the plant.
3. M M M 2 failures in 40 demands 4 failures in 80 demands 6 failures in 120 demands	This is a mild alert condition where no action by the NRC is recommended unless there are other recent indications of EDG deterioration. EDGs with acceptable unreliabilities will display this condition about 26 percent of the time. Although some concern is justified, a single failure, with no evidence of degraded performance, should not lead to excessive concern.
4. M M M 2 failures in 40 demands 4 failures in 80 demands 6 failures in 120 demands	This is an acceptable condition. No concrete evidence of unacceptable performance.
5. M M M 2 failures in 40 demands 4 failures in 80 demands 6 failures in 120 demands	This is an acceptable condition. There is an indication of a past problem that has probably been corrected. Low-level vigilance is prudent to ensure continued acceptable operation.
6. M M M 2 failures in 40 demands 4 failures in 80 demands 6 failures in 120 demands	This is an acceptable condition but one that needs continued vigilance. There is indication that a continuing past problem is being corrected, but the evidence is not convincing enough to warrant a decrease in vigilance.
7. M M M 2 failures in 40 demands 4 failures in 80 demands 6 failures in 120 demands	This is an acceptable condition but one that needs continued vigilance. The interpretation of this condition is similar to the interpretation of condition 6 above, except that the history of unacceptable performance is less extensive.
8. M M M 2 failures in 40 demands 4 failures in 80 demands 6 failures in 120 demands	The interpretation of this condition is somewhat similar to the interpretation of condition 3, except that there is a history of a performance problem that may have been corrected or partially alleviated. This situation is an ambiguous one, requiring a more detailed evaluation. The assessment would be different if there were 2 failures in the last 80 demands and 2 failures in the last 40 demands than if there were 4 failures in the last 80 and 2 in the last 40. An alert condition is indicated by the latter.

TABLE A-3

AN ALTERNATE PRESENTATION OF EDG FAILURE EVALUATION CRITERIA
FOR EDGs WITH RELIABILITY TARGET OF 97.5%

Evaluation Criteria (# Failures/# Demands)	Combinations of Failure Evaluation Criteria	Time Period (1 Demand/2 Wks)	False Alarm Rate
≥ 1/20	Y Y Y N N N N Y	10 Months	39%
≥ 3/50	Y Y N N N Y Y N	~ 2 Years	13%
≥ 6/100	Y N N N Y Y N Y	~ 4 Years	4%
Failure Progression	1 2 3 4 5 6 7 8		

Legend: Y = Yes
N = No

Interpretations of the Failure Progressions

Failure Progression	Interpretation
1. $\begin{matrix} \text{N} \\ \text{N} \\ \text{N} \end{matrix}$ 1 failure in 20 demands 3 failures in 50 demands 6 failures in 100 demands	This is an unacceptable condition requiring immediate action to declare the EDG inoperable. There is strong evidence that the long-term EDG unreliability is larger than the target value and no evidence that it is improving. The EDG reliability program must be improved or enhanced before the EDG can be declared operable again.
2. $\begin{matrix} \text{N} \\ \text{N} \\ \text{N} \end{matrix}$ 1 failure in 20 demands 3 failures in 50 demands 6 failures in 100 demands	This is an alert condition where action is recommended to declare the EDG inoperable. There is evidence that the EDG is deteriorating over time and that the current reliability is unacceptable. The action taken may depend on other circumstances and information from the plant.
3. $\begin{matrix} \text{N} \\ \text{N} \\ \text{N} \end{matrix}$ 1 failure in 20 demands 3 failures in 50 demands 6 failures in 100 demands	This is a mild alert condition where no action by the NRC is recommended unless there are other recent indications of EDG deterioration. EDGs with acceptable unreliabilities will display this condition about 39 percent of the time. Although some concern is justified, a single failure, with no evidence of degraded performance, should not lead to excessive concern.
4. $\begin{matrix} \text{N} \\ \text{N} \\ \text{N} \end{matrix}$ 1 failure in 20 demands 3 failures in 50 demands 6 failures in 100 demands	This is an acceptable condition. No concrete evidence of unacceptable performance.
5. $\begin{matrix} \text{N} \\ \text{N} \\ \text{N} \end{matrix}$ 1 failure in 20 demands 3 failures in 50 demands 6 failures in 100 demands	This is an acceptable condition. There is an indication of a past problem that has probably been corrected. Low-level vigilance is prudent to ensure continued acceptable operation.
6. $\begin{matrix} \text{N} \\ \text{N} \\ \text{N} \end{matrix}$ 1 failure in 20 demands 3 failures in 50 demands 6 failures in 100 demands	This is an acceptable condition but one that needs continued vigilance. There is indication that a continuing past problem is being corrected, but the evidence is not convincing enough to warrant a decrease in vigilance.
7. $\begin{matrix} \text{N} \\ \text{N} \\ \text{N} \end{matrix}$ 1 failure in 20 demands 3 failures in 50 demands 6 failures in 100 demands	This is an acceptable condition but one that needs continued vigilance. The interpretation of this condition is similar to the interpretation of condition 6 above, except that the history of unacceptable performance is less extensive.
8. $\begin{matrix} \text{N} \\ \text{N} \\ \text{N} \end{matrix}$ 1 failure in 20 demands 3 failures in 50 demands 6 failures in 100 demands	The interpretation of this condition is somewhat similar to the interpretation of condition 3, except that there is a history of a performance problem that may have been corrected or partially alleviated. This situation is an ambiguous one, requiring a more detailed evaluation.

In interpreting the failure data, the progression of failures is very important. The interpretations consider the fact that failures that occur early in a series of demands are not as important as failures that occur in more recent history. The interpretations also consider the false alarm rates. For instance, in Table A-1, the false alarm rates are defined here as the percentage of time that a diesel whose true EDG reliability was satisfactory, i.e., .95 or less per demand, would generate 2 or more failures in 20 demands, 5 or more failures in 50 demands, and 10 or more failures in 100 demands. These false alarm rates are shown on Table A-1 in the last column. The EDG on-line time required to generate 20, 50, and 100 demands, assuming demands occur on the average of once every 2 weeks, is also given on this table. Table A-2 presents similar information for EDGs having a reliability target of 0.975.

All combinations of the evaluation criteria are shown in Table A-1 (and for EDGs with a reliability target of 0.975, in Table A-2). There are eight such combinations, each with a somewhat different interpretation. The progression of failures represented by the combinations of the evaluation criteria, and their interpretations, are presented on each table.

The EDG failure evaluation criteria address several of the objections raised in Reference A-2 concerning using an average unreliability value as a measure of EDG performance. Even though the criteria are indicators of long-term performance, recent history is weighted more heavily than less recent history in the interpretations of the failure progressions. Also, the likelihood of false alarms (incorrectly concluding that there is an EDG performance problem) is accounted for in the interpretations. The objection in Reference A-2 that the evaluation criteria are slow acting remains a drawback to the scheme presented in Tables A-1 and A-2. This is an inevitable consequence of using a (catastrophic) failure count as a performance measure. However, it is deemed satisfactory as an interim measure until more sophisticated performance measures are developed and validated for NRC and industry use.

A more detailed description of the interpretation of each failure progression is given below.

Failure Progression #1 (Immediate Action Required)

<u>For EDGs with Reliability Target of 95%</u>	<u>For EDGs with Reliability Target of 97.5%</u>
≥ 2 failures in 20 demands	≥ 1 failure in 20 demands
≥ 5 failures in 50 demands	≥ 3 failures in 50 demands
≥ 10 failures in 100 demands	≥ 6 failures in 100 demands

This condition is unacceptable and requires immediate action by the licensee to declare the diesel generator inoperable, and enter the corresponding limiting condition for operation (LCO) action statement appropriate to the end of an allowed outage time with the EDG inoperable. There is less than a 3 percent chance that the long-term EDG unreliability is acceptable, and there is no indication that it is improving. This strongly suggests that

there are serious deficiencies in the EDG reliability program that must be corrected before the diesel generator can be declared operable with the targeted reliability.

Failure Progression #2 (Strong Alert)

<u>For EDGs with Reliability Target of 95%</u>	<u>For EDGs with Reliability Target of 97.5%</u>
≥ 2 failures in 20 demands	≥ 1 failure in 20 demands
≥ 5 failures in 50 demands	≥ 3 failures in 50 demands
< 10 failures in 100 demands	< 6 failures in 100 demands

This is a strong alert condition where action by the NRC is recommended to determine if conditions warrant putting the subject diesel generator into an inoperable status. There is strong evidence that the long-term EDG unreliability is deteriorating over time or is unacceptable. The action taken by the NRC and licensee may depend on circumstances other than the number of catastrophic failures. For instance, if the EDG repair outage time was also large and increasing, this would substantiate the fact that the EDG performance in recent history was deteriorating and below the target performance. Several failures in succession due to the same failure cause, or several repair actions in succession due to the same cause, would also indicate that the EDG reliability program was inadequate to achieve the target reliability. The reliability program must be improved before the diesel generator can be declared operable and capable of achieving the targeted EDG reliability.

Failure Progression #3 (Mild Alert)

<u>For EDGs with Reliability Target of 95%</u>	<u>For EDGs with Reliability Target of 97.5%</u>
≥ 2 failures in 20 demands	≥ 1 failure in 20 demands
< 5 failures in 50 demands	< 3 failures in 50 demands
< 10 failures in 100 demands	< 6 failures in 100 demands

This is a condition that provides a mild alert to the NRC and licensee that a diesel generator may be experiencing performance problems. EDGs with an acceptable reliability of .95 per demand will experience two or more failures in 20 demands about 26 percent of the time. Similarly, EDGs with an acceptable reliability of .975 will experience 2 failures in 40 demands about 26 percent of the time. No immediate action by the NRC is recommended unless there are other recent indications that the EDG performance is deteriorating. Other indications of EDG performance deterioration are increasing or large repair outage times in recent history compared to past performance, or several failures or repairs due to the same failure cause. Also, more than 2 failures in the last 20 (or last 40) demands should be cause for heightened concern. If these conditions are noted, they may indicate a failure of the EDG reliability program, and steps must be taken to improve the program. If they are not noted, no action should be taken by the NRC.

Failure Progression #4 (Acceptable)

For EDGs with Reliability
Target of 95%

- < 2 failures in 20 demands
- < 5 failures in 50 demands
- < 10 failures in 100 demands

For EDGs with Reliability
Target of 97.5%

- < 1 failure in 20 demands
- < 3 failures in 50 demands
- < 6 failures in 100 demands

This is an acceptable condition. There is no concrete evidence of unacceptable EDG performance. No action by the NRC is recommended.

Failure Progression #5 (Acceptable)

For EDGs with Reliability
Target of 95%

- < 2 failures in 20 demands
- < 5 failures in 50 demands
- ≥ 10 failures in 100 demands

For EDGs with Reliability
Target of 97.5%

- < 1 failure in 20 demands
- < 3 failures in 50 demands
- ≥ 6 failures in 100 demands

This is an acceptable condition. There is an indication of a past problem that has probably been corrected. However, low-level vigilance by the NRC is recommended to ensure that the EDG performance remains acceptable. No other action by the NRC is recommended.

Failure Progression #6 (Needs Continued Vigilance)

For EDGs with Reliability
Target of 95%

- < 2 failures in 20 demands
- ≥ 5 failures in 50 demands
- ≥ 10 failures in 100 demands

For EDGs with Reliability
Target of 97.5%

- < 1 failure in 20 demands
- ≥ 3 failures in 50 demands
- ≥ 6 failures in 100 demands

This is an acceptable condition but one that needs continued vigilance by the NRC. There is evidence that a long-term EDG performance problem is being corrected, but the evidence is not strong enough to warrant a decrease in vigilance. No other action by the NRC is recommended unless an additional catastrophic failure occurs to change the failure progression.

Failure Progression #7 (Needs Continued Vigilance)

For EDGs with Reliability
Target of 95%

- < 2 failures in 20 demands
- ≥ 5 failures in 50 demands
- < 10 failures in 100 demands

For EDGs with Reliability
Target of 97.5%

- < 1 failure in 20 demands
- ≥ 3 failures in 50 demands
- > 6 failures in 100 demands

This condition has an interpretation similar to that of failure progression #6 above. The condition is acceptable, but requires continued vigilance to ensure that an apparent long-term EDG performance problem has been

corrected. Additional catastrophic failures could change this progression into one where NRC action is recommended.

Failure Progression #8 (Needs Investigative Action)

<u>For EDGs with Reliability Target of 95%</u>	<u>For EDGs with Reliability Target of 97.5%</u>
≥ 2 failures in 20 demands	≥ 1 failure in 20 demands
< 5 failures in 50 demands	< 3 failures in 50 demands
≥ 10 failures in 100 demands	≥ 6 failures in 100 demands

The interpretation of this failure progression is somewhat similar to the interpretation of progression #3, but the condition is an ambiguous one. There is an indication that a past EDG performance problem may have been corrected or partially alleviated. However, current EDG performance indicates a possible partial recurrence of the problem, or another problem. A more detailed evaluation must be performed before action by the NRC is specified. However, this is an alert condition where investigative action by the NRC is necessary.

A.6 MEASUREMENT OF EDG RELIABILITY

The EDG reliability calculation method described herein differs from the NSAC-108 method by explicitly including diesel generator outage in the reliability calculations. Although the NRC has determined, in Regulatory Guide 1.155 and other publications, that the probability of failure on demand provides an adequate indication of EDG performance, the inclusion of EDG outage time in the reliability calculations will ensure high diesel generator reliability (by encouraging licensees to take EDG out of service when it is absolutely necessary).

The reliability (Q) of a diesel generator should be calculated as follows:

$$Q = 1 - (q_d + q_r)$$

where:

q_d is estimated by the numbered starts that are failures in the last 20, 50, and 100 demands accumulated over no greater than a 3-year period, in accordance with NSAC-108, and is the value reported to the NRC for comparison to reliability target levels. The uncertainty of the calculation must also be considered.

q_r is estimated by summing the actual outage times of the diesel generator and dividing the sum by the length of time it took to accumulate the total number of demands (20, 50, and 100). Each outage time measured as the total time the diesel generator is declared out of service. Outage times that accrue when the diesel generator is required operable, whether due to a corrective maintenance action or to a scheduled preventive maintenance action, and all outage times that accrue as a result of a corrective maintenance action regardless of the requirement

for the diesel generator should be included in the unavailability calculation. Preventive maintenance actions that are scheduled when the diesel generator is not required are not to be included in the reliability calculations. For example, a preventive maintenance action that disables the diesel generator during a refueling period would not be accrued in the calculation of q_r .

An example calculation is provided below;

Example Reliability Calculation

Suppose the number of catastrophic failures for the specified diesel generator was determined to be one in its last 20 load-run tests and there were no failures to start. The total time to accumulate 20 tests was one year.

hence,

$$q_d = \frac{1}{20} = .05$$

The outage time associated with the diesel, resulting from the repair of the above failure, was 72 hours (allowable by Technical Specification). The total time period is 365 days, and the diesel generator was required for the entire time window. Additional outage time may come from repair of incipient or degraded failures, preventive maintenance, or possibly unavailability during surveillance tests.

hence,

$$q_r = \frac{72 \text{ hrs}}{365 \text{ days}} = \frac{72 \text{ hrs}}{8760 \text{ hrs}} = 82 \times 10^{-4}$$

and

$$Q = 1 - (.05 + 82 \times 10^{-4}) = 0.942 = 94.2\%$$

These realistic calculations show how EDG outage time can affect overall reliability and can cause an EDG not to meet the reliability target.

A.7 INTERFACES WITH OTHER EDG RELIABILITY PROGRAM REVIEW ITEMS

The achievement of a target reliability provides an easy to use, top-level indication of the EDG's performance. However, it is not necessarily a single sufficient measure of the EDG's satisfactory or unsatisfactory performance. Review Item B (EDG Surveillance Needs) and Item C (EDG Performance Monitoring) will use the reliability measures and be required to respond to any degradations in this measure. As shown in the example of Section A.6, one failure can result in a significant degradation of this reliability measure.

The Review Item G (Data System) is necessary to provide the raw data (demands, failures, run hours, and outages) required to calculate the reliability measure and the EDG failure evaluation criteria. The change in this measure and the evaluation criteria should be monitored throughout the

diesel reliability program and, if the reliability program is working, the measure and criteria should improve. In this sense, the use of the reliability measure and criteria over the long-term is a measure of the long-term success of the reliability program.

REFERENCES FOR APPENDIX A

- A-1. K. Hoopingarner et al., "Aging of Nuclear Station Diesel Generators: Evaluation of Operating and Expert Experience (Phase I Study)" Pacific Northwest Laboratories, NUREG/CR-4590, Vol. 1, PNL-5832, August 1987.
- A-2. Letter from Joseph R. Fragola to Aleck Serkiz, Subject: "Comments to Station Blackout Regulatory Guide (Task SI 501-4)," dated June 6, 1987.

APPENDIX B
EMERGENCY DIESEL GENERATOR SURVEILLANCE NEEDS
(Review Item B)

TABLE OF CONTENTS

	<u>Page</u>
B.1 INTRODUCTION	B-5
B.2 ISSUES TO CONSIDER WHEN ADDRESSING EDG EQUIPMENT BOUNDARY AND SURVEILLANCE NEEDS	B-5
B.3 INTERFACES WITH OTHER EDG RELIABILITY PROGRAM REVIEW ITEMS	B-16
REFERENCES FOR APPENDIX B	B-18

LIST OF TABLES

Table

B-1 Definition of Diesel Subsystems	B-8
B-2 EPRI/NRC Cause Codes	B-13

LIST OF FIGURES

Figure

B-1 Issues for Defining EDG Surveillance Needs (Review Item B).	B-6
B-2 Hypothetical EDG Stress Level During Standby Period and During Demand Test	B-14

B.1 INTRODUCTION

The objectives of this appendix are to (1) define the equipment boundary that comprises the emergency diesel generator (EDG) system and (2) define the important elements that must be included in submitted assessments that define the surveillance needs of the EDG system. EDG surveillance must provide a measure of assurance that the EDG reliability target is being achieved. The EDG equipment boundary must be explicitly defined so that all pieceparts considered as part of the EDG system will be assessed as to their surveillance needs. The surveillance needs of the EDG system must be assessed so that, in the long term, the diesel generator reliability goal will be met. Therefore, review of a diesel generator reliability program must include a review of the equipment considered within the boundary of the EDG and a review of the process and rationale by which the surveillance needs of this equipment were determined.

Analysis of equipment boundaries and surveillance needs are two tasks of a Reliability Centered Surveillance (RCS) concept. This concept was developed to implement the problem detection portion of a reliability program. A description of RCS is given in Reference B-1. This reference provides additional detail that could be useful for reviewing submittals to ensure that they reflect an acceptable assessment of EDG surveillance needs.


Section B.2 of this appendix identifies the technical issues that must be considered when addressing EDG surveillance needs. This section provides a review checklist of issues to match against the surveillance needs issues that may be contained in a diesel generator reliability program under review. Section B.3 lists the interfaces between the assessment of EDG surveillance needs and other review items.

B.2 ISSUES TO CONSIDER WHEN ADDRESSING EDG EQUIPMENT BOUNDARY AND SURVEILLANCE NEEDS

Figure B-1 identifies the issues that must be addressed to provide Review Item B. (Also shown on Figure B-1 (dotted lines) are the other tasks that are required to implement an RCS program to provide the problem detection portion of a diesel generator reliability program.) Each of the issues are discussed, under separate heading, below.

Has the EDG equipment boundary been established?

The EDG equipment is defined to be comprised of those subsystems and pieceparts that are exclusively employed to produce emergency ac power. A single diesel generator is defined to include the diesel engine, generator, and the subset of supporting equipment that is associated exclusively with the generation of emergency ac power using that diesel generator. The pieceparts to be associated with the diesel generator are those whose sole function is related to diesel generator operability and production of emergency ac power. For instance, a diesel generator may require service water for operability, but only those service water components and pieceparts that are solely there for the diesel generator are to be included in the diesel generator boundary.

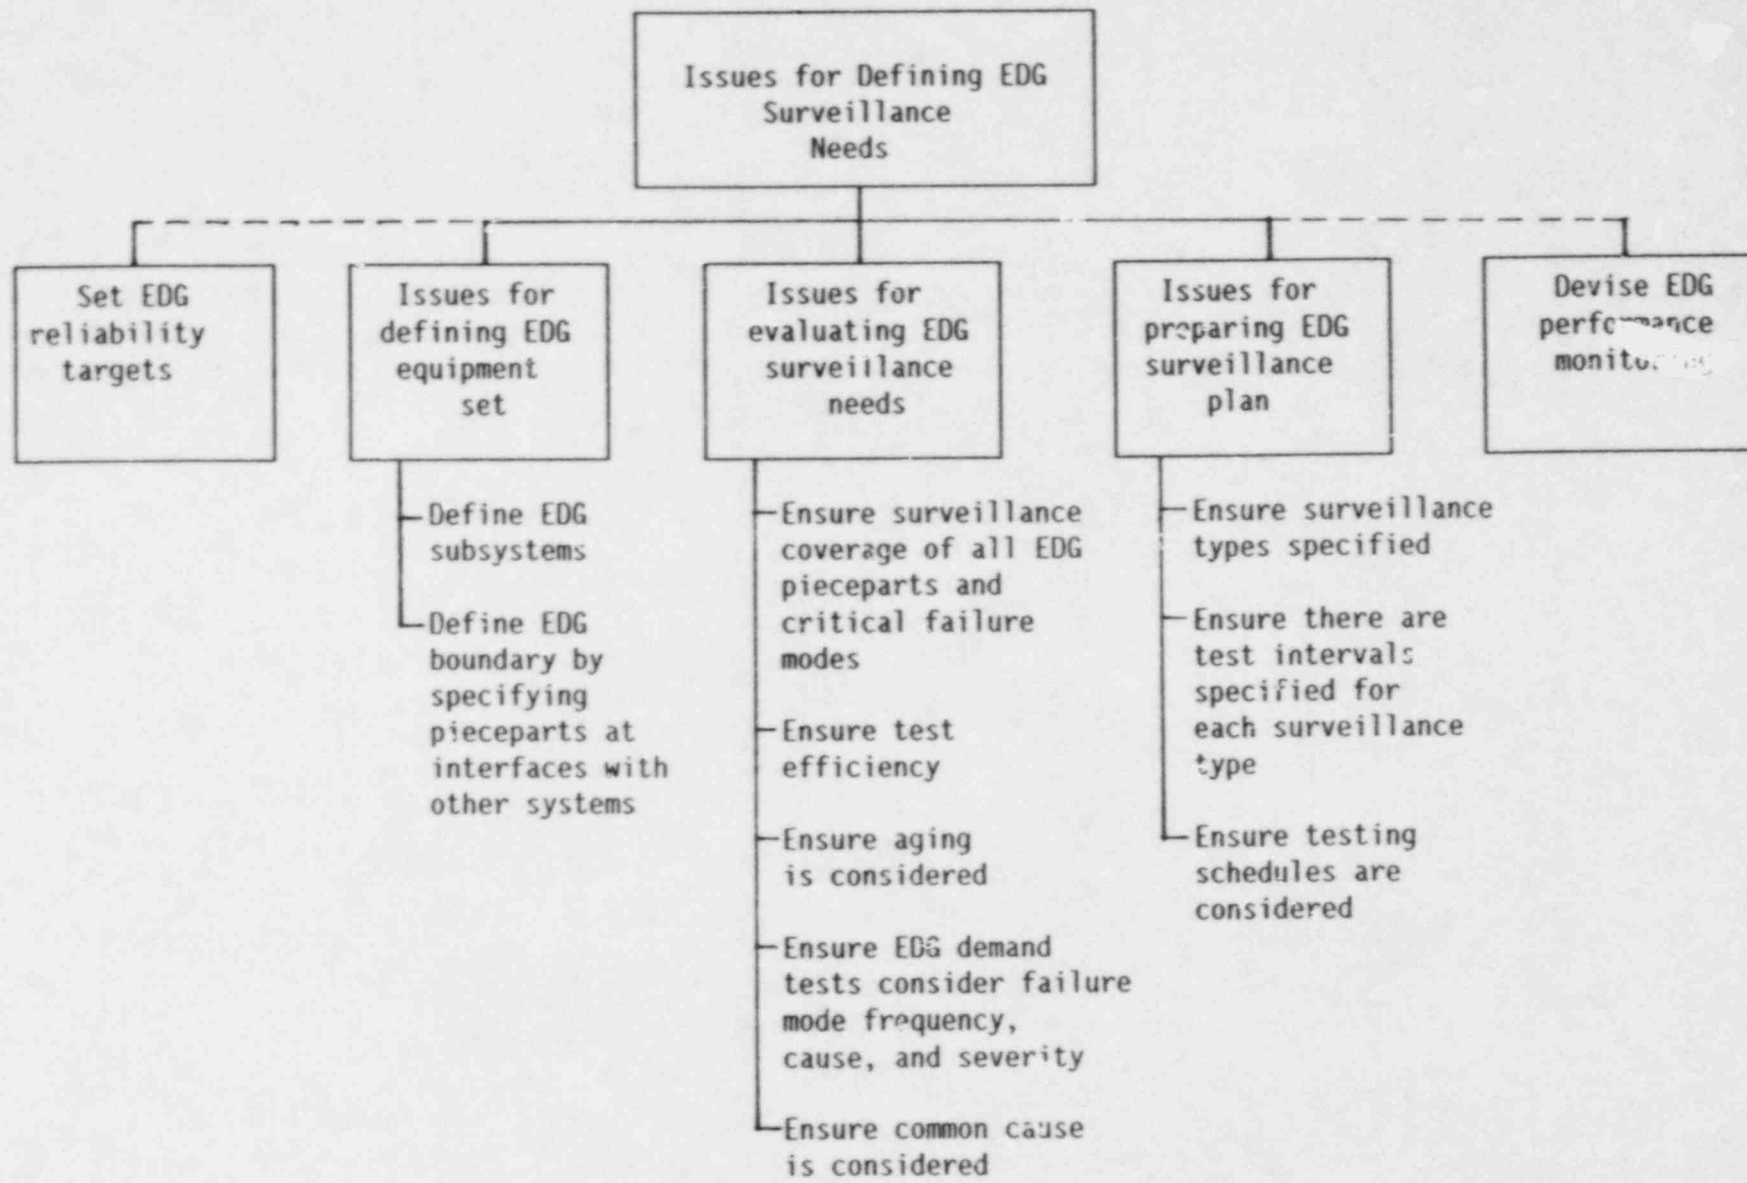

B-6

FIGURE B-1. ISSUES FOR DEFINING EDG SURVEILLANCE NEEDS (REVIEW ITEM B)

Table B-1 generically suggests a diesel generator definition in terms of its subsystems.

Has the assessment of diesel generator surveillance needs identified the critical failure modes and provided surveillance coverage for them?

Critical failure modes are defined as those diesel generator piecepart or subsystem failure modes that would fail the diesel generator mission of successful start, load, and runtime as specified in the surveillance plan. Critical failure modes can be identified using reliability techniques such as Failure Modes and Effects Analysis (FMEA), as described in Reference B-2. All critical failure modes must be identified and considered when devising the diesel generator surveillance plan. Between-test and between-surveillance intervals should be established based on the expected frequencies of the critical failure modes. The concept of adequate surveillance coverage of critical failure modes is referred to in the reliability literature as "test adequacy." An "adequate" test is one that is capable of detecting any of the critical failure modes with sufficient likelihood that the diesel generator reliability target is met.

Has an assessment been performed of noncatastrophic failures and conditions that will, if left unattended, proceed to catastrophic diesel generator failure?

Some diesel generator critical failure modes are preceded by non-catastrophic failures or conditions that are detectable through test, inspection, or condition monitoring. The diesel generator surveillance assessment should identify these and assess surveillance needs by examining tradeoffs among:

- The diesel generator reliability target.
- The repair outage time for repair of the noncatastrophic failure or condition.
- The repair outage time if the noncatastrophic failure or condition is allowed to progress to a catastrophic failure.
- Any diesel generator surveillance outage time required to detect the noncatastrophic failure or condition.
- The expected lag-time between when the noncatastrophic precursor condition becomes detectable, and when the catastrophic failure occurs, versus the interval between scheduled EDG outages.

It is cautioned that not all critical failure modes have non-catastrophic precursors that are readily detectable. The ones with nondetectable precursors are referred to as residual failures. The only maintenance strategy for "residual" failures

TABLE B-1
DEFINITION OF DIESEL SUBSYSTEMS

Inside the Boundary

Speed Control -	<i>(Includes governor, speed sensing, frequency sensing, and fuel racks positioning)</i>
Fuel Supply -	<i>(Includes equipment from the day tank through injectors)</i>
Fuel Storage -	
Lube Oil -	<i>(Includes prelube, preheating if applicable)</i>
Engine Cooling -	<i>(Diesel-specific cooling water)</i>
Heat Sink -	<i>(Radiator or site service water system up to and including inlet and outlet valves of heat exchangers)</i>
Exhaust -	
Environment Control -	<i>(Room temperature and humidity control)</i>
Intake Air Supply -	
Turbocharger -	
Diesel Mechanical -	<i>(The casing and all components within, up to, but not including, attached pumps or other piping systems)</i>
Air Start -	<i>(Includes starting air supply)</i>
Generator Electro-Mechanical -	<i>(Including up to output breaker)</i>
Voltage Regulation/Field Flash -	
Start Control -	<i>(Autostart sensors, logic, remote manual start capability)</i>
Other I&C -	<i>(Including trips, control room indications)</i>

TABLE B-1 (Continued)

DEFINITION OF DIESEL SUBSYSTEMS

Outside the Boundary

Load Sequencer -

DC Power Supply -

AC Power Supply - *(For auxiliaries, I&C)*

Synchronization Circuitry -

Service Water Supply -

AC Power Distribution System -

is to repair them as they occur. The only surveillance strategy for residual failures is to ensure that the surveillance mix will result in their detection when they occur.

The ability of a test or inspection to detect precursors to catastrophic failures is referred to in References B-1 and B-2 as the efficiency of the test. An efficient test is one that has a high likelihood of detecting precursors to nonresidual critical failure modes.

Achieving efficient surveillance is important when the dominant diesel generator failure modes are of the nonresidual type, i.e., they have detectable precursors. An example of this type of condition is water in the EDG airstart system, which could result in a failure of the diesel generators to start (and, depending on the commonality of starting subsystems, could result in a common cause failure of more than one diesel generator at a plant).

References B-1 and B-2 provide further discussion of the issue of test efficiency. The determination of which critical failure modes are residual and which have detectable precursors requires an engineering evaluation. Once that determination has been made, statistical and reliability techniques could be useful for characterizing the detectability of the precursor, frequency of occurrence, or relative repair times to use in the tradeoffs suggested above. Use of these techniques is discussed in Reference B-2.

Has the assessment of EDG surveillance needs considered detection of aging conditions?

The definition of aging used herein is defined to include both the time-related deterioration of EDG pieceparts or subsystems and the equipment-use-related wearout of pieceparts or subsystems due to diesel generator cycling. Assessment of the EDG surveillance needs should include an assessment of any special surveillance needed to detect deterioration of the diesel generators due to aging phenomena.

Aging of EDG subsystems or pieceparts could be manifested by increased frequency and/or duration of repairs or changes in measurable physical conditions such as crankcase temperature or pressure, lube oil pressure, starting air pressure, or cycling frequency, etc. Since piecepart or subsystem aging will eventually show up as degraded diesel generator performance unless the aged parts are repaired or replaced, the surveillance assessment should include assessing the need to provide surveillance or condition monitoring to detect these conditions. The first step in this process is to identify which portions of the EDG are expected to age quickly. The second step is to identify measurable physical conditions that can be used to detect the aging process. Finally, surveillance can be specified to detect changes in the measurable physical conditions.

Reference B-3 provides a detailed discussion of aging phenomena and the detectable physical conditions that accompany aging for various types of components and pieceparts.

Has the assessment of the EDG surveillance needs considered the need to detect common cause failures?

The assessment of surveillance needs should consider two types of hardware common cause failures: (1) "hard-wired" common cause failures due to the dependency of more than one diesel generator on a single supporting subsystem and (2) common cause failures due to a single common cause shock. An example of the hard-wired type of common cause failure is the dependence of more than one diesel generator on a common diesel fuel tank. An example of a single common cause shock resulting in failure of more than one diesel generator could be a common moisture problem in the air start accumulators that provide starting air to the diesel generators. Both types of common cause failure mechanisms must be identified and the needs for surveillance to detect potential common cause faults assessed.

The surveillance needs to protect against common cause failures must be assessed based on a reliability target for the EDG system, as opposed to the target for an individual diesel generator. The reliability target for the EDG system will depend on the system configuration at an individual plant and therefore is plant specific. In general, the target for the EDG system will be more constraining than for an individual diesel generator, which will result in more intensive surveillance needs for the system than for an individual diesel generator. As always, the frequency of occurrence of the common cause shock, which results in the common cause failure, repair times, and whether or not precursors to the common cause failure can be identified will also impact the type and frequency of surveillance.

Hard-wired common cause failures can be identified by performing a fault tree analysis of the EDG system to the piecepart level of detail or through use of an FMEA. In fact, the analysis to identify the diesel generator critical failure modes, if accomplished with identification of hard-wired common cause failures in mind or if done at the EDG system level, will result in identifying hard-wired common cause failure modes. Single piecepart or subsystem failure modes that result in failure of more than one diesel generator represent hard-wired common cause failures modes, and the above techniques are all capable of identifying these. Reference B-2 discusses identification of critical failure modes and therefore, by extension, hard-wired common cause failure modes, using FMEA and fault tree analysis.

A common cause system is defined as a set of components that are all subjected to a particular common cause shock or a particular type of common cause shock. Identification of common cause

systems that are not hard-wired can hypothetically be accomplished through application of a four-step process:

1. Develop a fault tree for the EDG system to the piecepart level of detail (useful for hard-wired common cause failure mode identification, also).
2. Extend the EDG piecepart fault tree to the failure cause level. Failure causes with potential common cause significance are shown in Table B-2, which are the EPRI/NRC cause codes from Reference B-4.
3. Obtain the reduced Boolean equation corresponding to the failure cause tree developed in step 2 above. A Boolean reduction code such as SETS, FTAP, or CAFTA can be used for this step.
4. Identify and collect all the single-term cut sets from the Boolean reduction process. These represent potential common cause systems. Additional engineering assessment is required to prioritize these and devise surveillance types and intervals to protect against them.

The above is a formalized process for identifying potential and nonobvious common cause systems. The process is described in more detail in Reference B-5. It has been developed in theory but has not, at the time of publication of these guidelines, been demonstrated in practice. An alternative method is to assess common cause systems using engineering judgment.

Has the assessment of EDG demand test intervals considered the causes and severities of dominant failure modes?

Figure B-2 represents (conceptually) the stress on a standby diesel generator through a cycle that includes: (1) in standby, (2) start-up for demand testing, (3) run during demand testing, (4) shutdown, and (5) return to standby status. The stresses during standby are due to environmental factors that produce oxidation, corrosion, thickening of lubricants, stratification of fuel, accumulation of moisture, etc. The stresses during the test cycle are due principally to factors that occur during diesel operation such as vibration, wear, mechanical stresses, and electrical contact burning due to arcing. Both types of stresses, those that result in failure while the diesel generator is in standby (standby stresses) and those that result in failure when the diesel generator is started and operated for a demand test (demand stresses), are capable of producing catastrophic diesel generator failure, or alternatively, the need to repair a detected noncatastrophic failure or condition.

The partition of EDG failures by cause (standby stress-caused and demand stress-caused) and by severity (catastrophic failure or noncatastrophic failure requiring diesel generator outage for repair) leads to a situation where there is an optimum demand

TABLE B-2
EPRI/NRC CAUSE CODES*

- D - Design/Manufacturing/Construction Inadequacy
 - DR - Plant Definition Requirements Inadequacy
 - DE - Design Error or Inadequacy
 - DM - Manufacturing Error or Inadequacy
 - DC - Construction Error or Inadequacy
 - DX - Other (explain)

- P - Procedures Inadequacy (ambiguous, incomplete, erroneous)
 - PO - Defective Operational Procedure
 - PM - Defective Maintenance Procedure
 - PC - Defective Calibration/Test Procedure
 - PX - Other (explain)

- H - Human Actions, Plant Staff
 - HP - Failure to Follow Procedures
 - HM - Misdiagnosis (followed wrong procedure)
 - HA - Accidental Action
 - HX - Other (explain)

- M - Maintenance
 - MS - Scheduled Preventive Maintenance (including surveillance tests and calibration)
 - MF - Forced Maintenance (repair of a known failure)

- E - Abnormal Environmental Stress
 - EE - Electromagnetic Interference
 - EM - Moisture (spray, flood, etc.)
 - EF - Fire
 - ET - Temperature (abnormally high or low)
 - ER - Radioactive Radiation (irradiation)
 - EC - Chemical Reactions
 - EV - Vibration Loads
 - EI - Impact Loads
 - EH - Human-Caused External Event
 - EN - Acts of Nature

- I - Internal (internal to component, piecepart ambient environmental stress)
 - IC - Internal to Component, Piecepart
 - IE - Ambient Environmental Stress

- U - Unknown

*From Reference B-4.

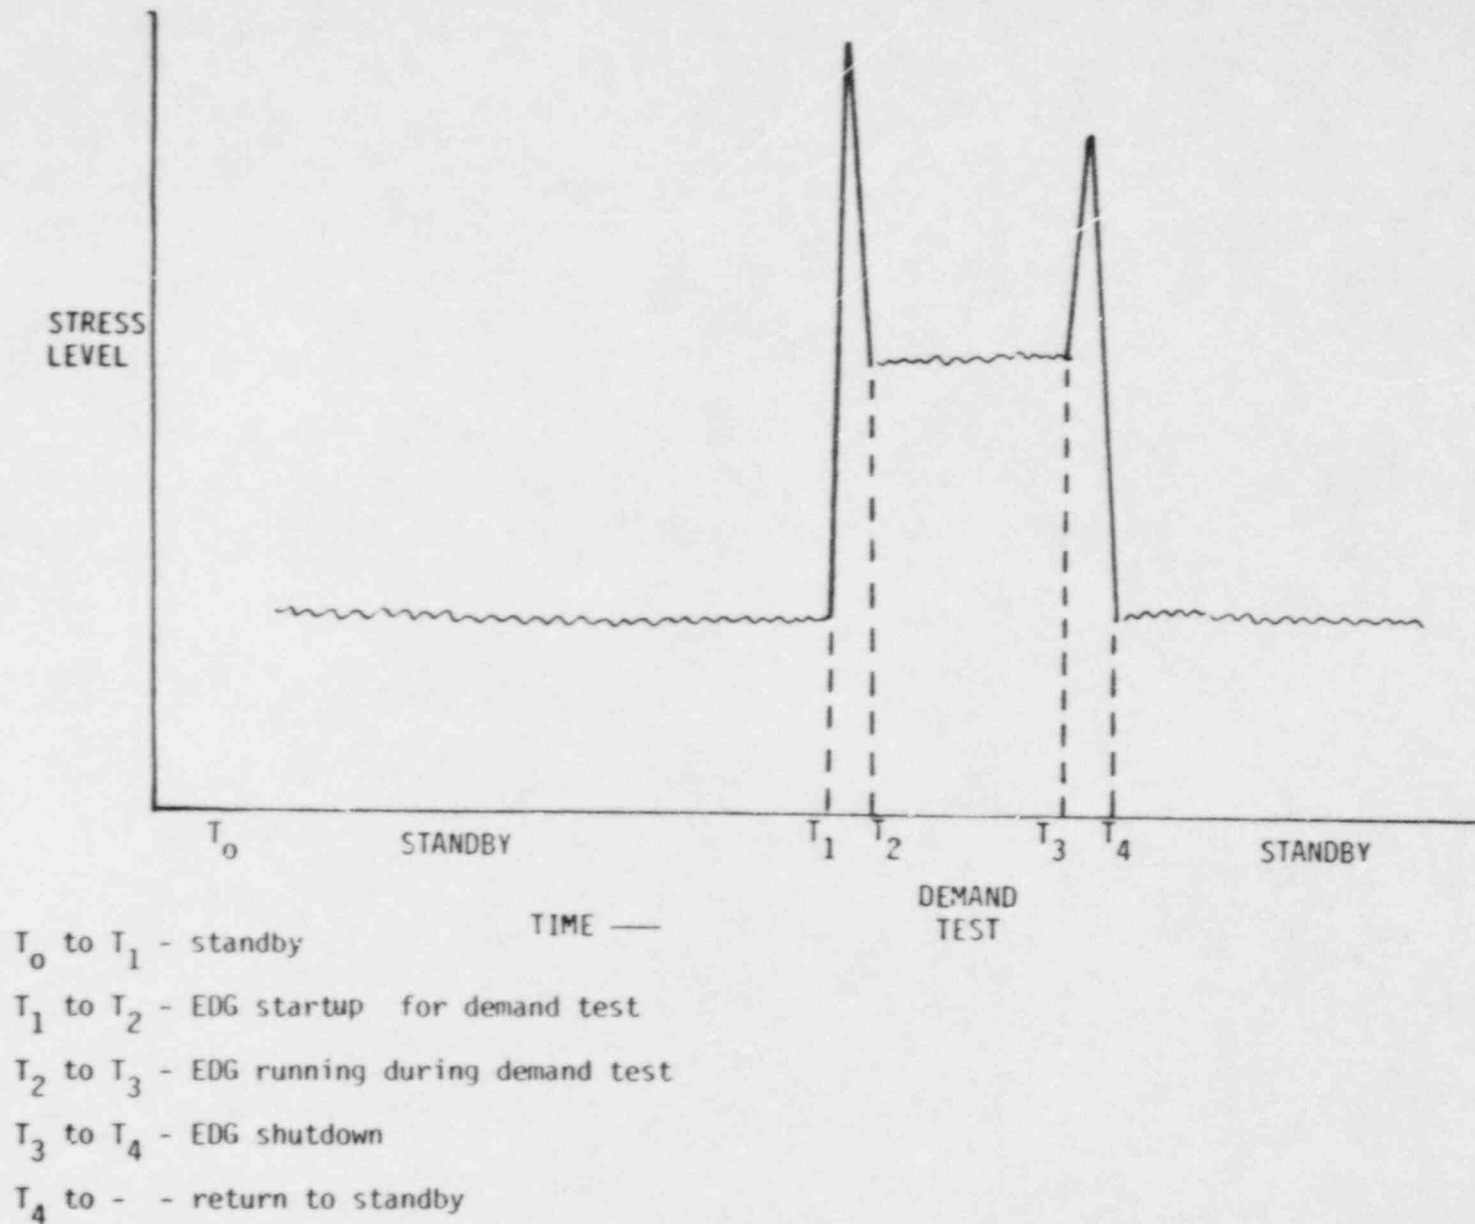


FIGURE B-2. HYPOTHETICAL EDG STRESS LEVEL DURING STANDBY PERIOD AND DURING DEMAND TEST

test interval. This can be seen by considering the four categories of failures resulting from the above double-partition, namely:

1. Catastrophic failures due to standby stress causes.
2. Catastrophic failures due to demand stress causes.
3. Noncatastrophic failures resulting in a need to repair due to standby stress causes.
4. Noncatastrophic failures resulting in a need to repair due to demand stress causes.

To provide timely detection of catastrophic diesel generator failures of the category 1 type, frequent demand tests should be conducted. However, frequent demand tests could result in frequent repair outages of the category 2 and category 4 types. Therefore, the optimum demand test interval is obtained by balancing the expected diesel generator unreliability due to standby stress-caused catastrophic failures with the expected repair outage unavailability due to demand stress-caused requirements to repair. The actual mix of the four categories of failure types is thought to be diesel generator dependent and therefore plant specific.

Reference B-6 provides a more detailed description of the dependence of diesel generator reliability on test interval for various assumed mixes of the above four failure categories. Reference B-7 also discusses this influence on demand test intervals.

Surveillance needs using the above model can be assessed using a data analysis to partition failure modes into the four categories. Thus, this can only be accomplished for diesel generators with an operating history. A conservative estimate of upper limits on demand test intervals can be obtained by assuming all failure modes are standby stress caused. A data analysis to partition the failure modes will generally result in significantly larger acceptable demand test intervals than the conservative assumptions would indicate. Engineering considerations, such as corrosion, wear, or fluid stratification, may indicate the need for longer or for shorter test intervals.

Has a surveillance plan for the EDG system been prepared?

The assessment of surveillance needs must be codified in an EDG surveillance plan. Since this plan is one of the documents that must be reviewed as part of the EDG reliability program review, it must contain evidence that all the above "surveillance needs" issues were considered in the assessment of EDG surveillance. This plan must list the types of surveillance to be employed, the intervals between surveillance for each type, and any schedules that will be used to synchronize surveillance among

diesel generators in the EDG system, or between the diesel generators and equipment in other systems, e.g., with emergency core cooling system (ECCS) pump testing. Each of the above decisions concerning surveillance type, surveillance intervals, and surveillance schedules should be accompanied by a description of the rationale and assessments that led to the decisions. Also included in the surveillance plan must be discussion of any considerations for surveillance that result from performance monitoring requirements for the EDG system. These considerations could include surveillance types or intervals that are set solely to support the performance monitoring techniques to be employed. Proposed surveillance should also be reconciled with technical specification requirements and with any other regulatory requirements or guides for surveillance of the EDG system.

The EDG surveillance plan should not be written as a static document. Operational experience could indicate that either more or less intensive surveillance than originally assessed is needed. Thus, the surveillance plan must allow for possible changes in surveillance as these changes become necessary or desirable. To accomplish this, the surveillance plan should call for periodic reassessments of the surveillance needs of the EDG system. Changes could be based on operational experience with the system or based on research or other plant findings.

B.3 INTERFACES WITH OTHER EDG RELIABILITY PROGRAM REVIEW ITEMS

Review of the assessment of surveillance needs for the EDG system should be coordinated with the review of the EDG reliability target (Review Item A) and review of the performance indicators (Review Item C) that will be used. The surveillance of the EDG system must support the calculations used to estimate whether or not the reliability target is being met. The surveillance types and schedules must also provide the information used to track EDG performance in a broader context to spot possible degradations or recurring failures.

The following process can be used to ensure that the specification of EDG surveillance as described in the surveillance plan will provide the needed information for estimating whether or not the EDGs are meeting the reliability target and for detecting possible performance degradations that may be occurring:

1. The following data are required to estimate the EDG reliability (see Appendix A):
 - Base operational period and base number of trials involving a diesel generator mission simulation.
 - Number of catastrophic failures in the base period.
 - Number of diesel generator attempted starts in the base period and the number of failures to start.

- Total diesel generator operating time (i.e., running time) during the base period and total number of failures experienced while running.
2. Compose a list of the data necessary for operation of the diesel generator performance tracking system (Review Item C), including type of data and frequency with which it must be taken.
 3. Reconcile the lists in 1 and 2 above to obtain the list of data necessary to estimate the EDG reliability relative to the target and the list necessary for detecting possible performance degradations.
 4. Match the list in 3 to the information flow that would be generated by application of the EDG surveillance plan.

As a further review check, it should be verified that the review of the data system capabilities (Review Item G) verifies that the reliability program data storage and retrieval system specifies explicitly that all the data types in the list developed in step 3 above will be stored and are retrievable.

REFERENCES FOR APPENDIX B

- B-1. E.V. Lofgren, "A Reliability Centered Surveillance Concept for Nuclear Power Plant Standby Safety Equipment: Definitions, Risk Considerations, and Issues," BNL Technical Report A-3282, December 9, 1986.
- B-2. S.M. Wong et al., "Trial Application of Reliability Technology to Emergency Diesel Generators at Trojan," BNL Technical Report A-3282, April 1986.
- B-3. K. Houpingarner et al., "Aging of Nuclear Station Diesel Generators: Evaluation of Operating and Expert Experience (Phase I Study)," Pacific Northwest Laboratories, NUREG/CR-4590, Vol. 1, PNL-5832, August 1987.
- B-4. K.N. Fleming et al., "Classification and Analysis of Reactor Operating Experience Involving Dependent Events," EPRI NP-3967, June 1985.
- B-5. E.V. Lofgren, "A Potential Method for Identifying Nonobvious Common-Cause Failure Systems in Nuclear Power Plant Safety Equipment," SAIC Report prepared for BNL OSRR Project, 22 October 1986.
- B-6. W.E. Vesely, G.M. DeMoss, and E.V. Lofgren, "Evaluation of Diesel Unavailability and Risk Effective Surveillance Test Intervals," BNL Technical Report A-3230, May 1986.
- B-7. G.M. DeMoss and E.V. Lofgren, "Availability Analysis of Trojan Diesel Generators," SAIC Report prepared for BNL OSRR Project, November 1985.

APPENDIX C
EDG PERFORMANCE MONITORING
(Review Item C)

TABLE OF CONTENTS

	<u>Page</u>
C.1 INTRODUCTION	C-5
C.2 CONSIDERATIONS FOR EVALUATING EDG PERFORMANCE MONITORING.	C-6
C.2.1 EDG Condition Monitoring.	C-6
C.2.1.1 Example EDG Conditions to Monitor	C-6
C.2.1.2 Technical Issues for EDG Condition Monitoring	C-12
C.2.2 EDG Reliability Monitoring.	C-15
C.2.2.1 Example EDG Reliability Monitoring Techniques	C-16
C.2.2.2 Technical Review Issues for EDG Reliability Monitoring	C-28
C.3 INTERFACES WITH OTHER RELIABILITY PROGRAM REVIEW ITEMS . . .	C-29
REFERENCES FOR APPENDIX C	C-30

LIST OF TABLES

<u>Table</u>	
C-1	Per Shift Checks C-8
C-2	Daily Checks C-9
C-3	Weekly Checks. C-9
C-4	Emergency Diesel Generator Monthly Test Data Sheet. C-10
C-5	Failure Cause Type Cross-Classified with Recent and Earlier Operating History C-23

LIST OF FIGURES

<u>Figure</u>	Page
C-1 Work Breakdown Structure for Section C.2 "Considerations for Evaluating EDG Performance Monitoring" .	C-7
C-2(a) Timeline Showing Hypothetical Repair Occurrence Times.	C-17
C-2(b) Timeline Showing Ranked Intervals Between Repairs.	C-17
C-3 Scatterplot and Hypothetical Regression Line For Repair Interval Ranks Versus Repair Occurrence Times.	C-21

C.1 INTRODUCTION

Emergency diesel generator reliability programs should not only specify EDG surveillance, which provides a "snapshot" view of EDG reliability and operability at periodic intervals, but should also contain provisions for tracking EDG performance, using the results of successive surveillances. In this way trends in reliability and operability, and the engineering conditions related to these, can be observed. This performance tracking aspect of an acceptable EDG reliability program will provide the basis for detecting deteriorating EDG performance and instituting corrective actions before the performance becomes unacceptable (i.e., the EDG reliability falls below the target value).

The performance monitoring aspect of the reliability program provides the necessary information on EDG performance to trigger preventive maintenance actions. An acceptable EDG reliability program will contain adequate provisions for performance monitoring. These "adequate provisions" are addressed in Section C.2 in terms of the characteristics that the performance monitoring portion of an EDG reliability program must have.

As used herein, performance monitoring is defined to include two types of monitoring activities: condition monitoring and reliability monitoring. Condition monitoring refers to means by which the state of a component, subsystem, piecepart, or engineering condition is tracked over time or use and includes the criteria for alerting when abnormal conditions or trends are observed. Examples of condition monitoring for EDGs are: tracking lube oil pressure or crank case pressure and temperature; measurement of moisture content in starting air systems; tracking water jacket outlet temperature while the EDG is running; and periodic measurements of electrical contacts to detect and track corrosion or burning. Reliability monitoring for EDGs refers to the tracking of component, subsystem, or piecepart failures or repairs with the objective of providing an alert when the failure/repair frequency, or trends in frequency, indicate a deteriorating condition. Examples of EDG reliability monitoring include: direct tracking of repair frequency; tracking of repair frequency for failures of specific types, e.g., by distinguishing among failure severities or failure causes; and tracking repair or failure frequencies of EDG subsystems such as the governor or automatic actuation system. Whereas condition monitoring is primarily an engineering activity, reliability monitoring is primarily a statistical activity.

The performance monitoring techniques and issues discussed in this appendix are primarily for the use of plant personnel who are operating the EDG reliability program. They provide plant personnel a means of recognizing and anticipating EDG performance problems. They are included in this discussion of EDG reliability programs to provide the NRC with a basis for assessing the adequacy of this aspect of EDG reliability programs. These monitoring techniques may eventually result in useful information that NRC personnel may choose to use directly to evaluate industry EDG performance. However, because of the large amount of information that they generate, considerable research effort is required before these component-specific techniques can be adapted to NRC direct use. An interim EDG failure tracking scheme, consistent with the EDG reliability goal as presented in the approach to resolving USI A-44 (Station Blackout), is presented in

Appendix A. This failure tracking scheme is appropriate for NRC direct use to monitor EDG reliability performance.

Section C.2 of this appendix identifies the issues that must be addressed in an EDG performance monitoring program in order that the program be acceptable in this regard. Thus, Section C.2 identifies the EDG performance monitoring review items. Section C.2 is partitioned according to the structure presented in Figure C-1. Section C.3 identifies those performance monitoring review items that must be coordinated with review of other review items.

C.2 CONSIDERATIONS FOR EVALUATING EDG PERFORMANCE MONITORING

This section identifies the detailed review items for reviewing EDG performance monitoring approaches that are proposed as part of an EDG reliability program.

C.2.1 EDG Condition Monitoring

Condition monitoring of emergency diesel generators refers to the process of obtaining information about the state of engineering conditions that impact EDG reliability. The information may be obtained either directly (for example, direct measurement of the moisture content of the air start system or direct observation of corrosion or burning of electrical contacts) or indirectly (for example, measurement of metallic particles in the lubrication system as an indicator of bearing or cylinder wear or measurement of acoustic vibrations as an indicator of crankshaft alignment problems or bearing wear). To be effective, the condition monitoring program must be applied to engineering conditions that are: (1) characterized by a measurable, precursor condition that is known to be related to an important EDG failure mode, (2) conveniently and practically measured without incurring an inappropriately large EDG outage time, and (3) accurate and give a minimum number of false indications.

C.2.1.1 Example EDG Conditions to Monitor

Reference C-1 lists examples of conditions to monitor to provide a high degree of assurance of EDG operability. These condition monitoring parameters have been abstracted from this reference and are shown in Tables C-1 through C-4. They represent examples of parameters to monitor at periods of per shift, daily, weekly, monthly, and start/run/load tests, and yearly or refueling cycle.

The condition monitoring parameters measured and recorded should be subjected to trend analysis so that problem areas can be identified. Graphical techniques are the preferred method of trending EDG parameters; however, a simple listing of the parameter can sometimes provide insight into a trend. For example, if cylinder temperatures started to rise, it would be readily noticed on a graph; however, it would also be noted if the temperatures were listed in chronological order.

Other EDG test requirements should not be overlooked. Some examples include but are not limited to fuel oil, lube oil, and jacket water chemical

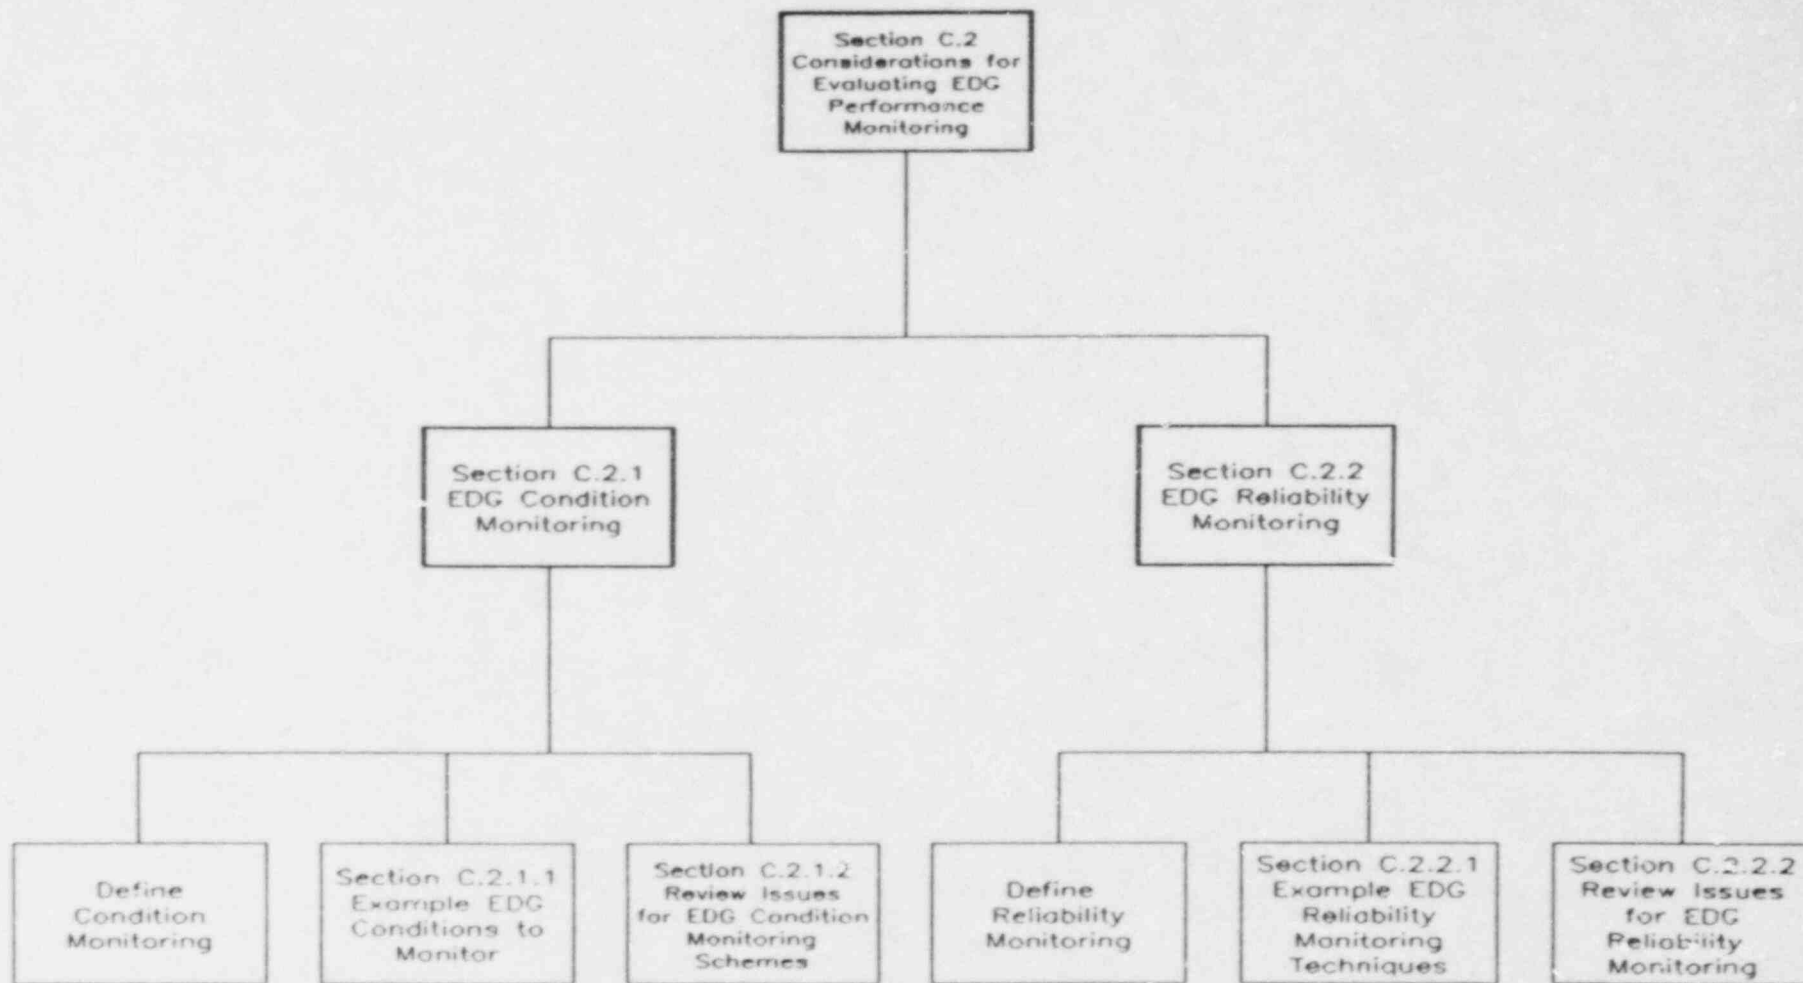


FIGURE C-1.
WORK BREAKDOWN STRUCTURE FOR SECTION C.2.

"CONSIDERATIONS FOR EVALUATING EDG PERFORMANCE MONITORING"

TABLE C-1. PER SHIFT CHECKS

To be performed by an auxiliary operator as part of routine shift walk-through:

1. The remote/local start switch in the remote position
2. The auto/manual start switch in the auto position
3. The fuel oil level (day tank)
4. The lube oil level
5. The jacket water/cooling water expansion tank level
6. Diesel generator keep warm system
 - Lube oil temperature, pressure
 - Jacket water temperature, pressure
 - Soak back pump pressure
7. Governor setting, automatic or manual
8. Starting air receiver pressure
9. Any fluid leakage should be noted
10. Barring device disengaged
11. Cleanliness of the area
12. Starting air compressor should be checked for overheating
13. L.O. filter D/P
14. F.O. filter D/P
15. Duplex strainer/filters handle should not be in mid position, flow through one filter only
16. Annunciator circuit

TABLE C-2. DAILY CHECKS

(includes all of the per shift checks plus)

1. Blowdown air receiver to check for moisture/water accumulated
2. Fuel oil storage tank level
3. EDG fire suppression system check.

TABLE C-3. WEEKLY CHECKS

(includes all of the daily and per shift checks plus)

1. Associated circuit breakers/motor controllers
 - Racked in
 - Remote/manual in remote
 - Control fuses installed
 - Power to break verified
 - Auto/manual in auto
 - Aligned to appropriate power source
 - Fault indicators (flags)

TABLE C-4. EMERGENCY DIESEL GENERATOR MONTHLY TEST DATA SHEET

(includes all of the per shift, daily, and weekly checks plus the following)

Pre-operational Check List

EDG ID #: _____
Date: _____ Time: _____
EDG Integrator Reading: _____
Starting Air Pressure, Receiver A: _____ psig
Receiver B: _____ psig
Governor Setting: Automatic/Manual
Fuel oil level, Day Tank _____ gallons
Storage Tank _____ gallons
Engine Cooling Water Expansion Tank level: _____ inches
Lube oil filter D/P: _____
Barring device disengaged: _____
Lube oil temperature: _____
Lube oil pressure: _____ psig
Jacket water temperature: _____
Jacket water pressure: _____ psig
Duplex strainer in use: _____
Annunciator circuit check: _____

Operational Checklist

Time EDG Started: _____
Method of Starting: _____

Postoperational Checklist

Time EDG Secured: _____
Fuel oil level at end of run: _____ (or amount of F.O. oil used)
Lube oil sump level at end of run: _____ gallons
EDG Integrator reading (time): _____

Other tests as required:

- starting air compressor operational checks
- alternate power supply operational checks
- F.O. transfer pump operability checks
- etc.

Filling of the day tank and fuel oil storage tank (if required) should be accomplished immediately after the EDG is secured. Any special tests associated with the fuel oil system should be accomplished at this time.

TABLE C-4 (cont.). EMERGENCY DIESEL GENERATOR MONTHLY TEST DATA SHEET

Hourly Readings
(to be recorded every hour during the test)

Jacket water pressure	Fuel rack settings
Jacket water temperature (in)	#1 cylinder (for each cylinder)
Jacket water temperature (out)	#2 cylinder
Jacket water cooler D/T	#3 cylinder
Jacket water cooler D/P	#4 cylinder
Water pressure to turbocharger	#5 cylinder
Water pressure from turbocharger	#6 cylinder
Water temperature to turbocharger	#7 cylinder
Water temperature from turbocharger	#8 cylinder
Engine oil pressure	#9 cylinder
L.O. cooler outlet temperature	#10 cylinder
L.O. cooler inlet temperature	Turbocharger RPM
L.O. filter inlet pressure	Engine RPM
L.O. filter outlet pressure	KW
Oil press to turbocharger	Volts
Oil temperature from turbocharger	Frequency (Hz)
Turbocharger inlet air temperature	Amps
After cooler air temperature	Kilovars
After cooler air pressure	Alternator winding temperature
	Alternator bearing temperature
	EDG vibration (mils)
	Crankcase pressure

#1 Cylinder exhaust temperature (for each cylinder)
 #2 Cylinder exhaust temperature
 #3 Cylinder exhaust temperature
 #4 Cylinder exhaust temperature
 #5 Cylinder exhaust temperature
 #6 Cylinder exhaust temperature
 #7 Cylinder exhaust temperature
 #8 Cylinder exhaust temperature
 #9 Cylinder exhaust temperature
 #10 Cylinder exhaust temperature
 Turbine exhaust pressure
 Turbine exhaust temperature
 Turbine exhaust backpressure
 F.O. filter inlet pressure
 F.O. filter outlet pressure
 F.O. temperature

analysis. Fuel oil should be tested when brought on site and analyzed for conformance to the appropriate American Society of Testing and Materials (ASTM) standard. Standard technical specifications currently require this test every 92 days. Engine cooling water should be analyzed as recommended by the manufacturer (i.e., chromate and antifreeze concentrations). Lube oil analysis should also be performed in accordance with the manufacturer's instructions and the appropriate ASTM standard. Trending of these parameters should also be accomplished, as they too can provide some valuable insight. For example, if lube oil analysis shows additional water accumulation each month, it may be an indication of a leaking lube oil cooler, or if the chromate concentration in the jacket water decreases rapidly, it may be an indication of a jacket water leak. Other component tests may also be required, such as the governor or relay. Those components should be tested as required by the manufacturer, keeping in mind the operability requirements of the EDG.

There have also been several recommendations regarding additional testing. When viewed from the function of an EDG at a nuclear power facility, this testing may or may not be justified. One such recommendation is circuit diagnostic testing. Because of the automatic starting circuitry, this may be an insurmountable task and introduce new and unwanted failure modes to the function of the EDG. Any new testing should be evaluated to ensure that new and unwanted failure modes and mechanisms are not introduced.

Although this appendix has mainly addressed mechanical components, it is not intended to place a lower priority on electrical, instrumentation, or control systems. In fact, the instrumentation and control systems are considered by some to have the highest incidence of failure among the EDG support systems. For those items, the appropriate tests and checks should be performed as required by technical specifications, manufacturer's recommendations, etc.

C.2.1.2 Technical Issues for EDG Condition Monitoring

The following items should be reviewed to provide assurance that an EDG condition monitoring scheme, established as part of an EDG reliability program, has the features necessary to be successful.

Have the engineering conditions to be monitored been explicitly identified?

The first and most obvious feature that is necessary for a successful EDG condition monitoring program is that the engineering conditions that are to be monitored as part of the program must be explicitly identified. Examples of engineering conditions to be monitored were shown in Tables C-1 through C-4. Although this list represents a good "start" at identifying an EDG condition monitoring program, each plant may wish to institute its own scheme, in order to treat the particular problems experienced by each diesel. Because there appear to be differences in the reliability problems experienced by different plants, even among those using the same types of diesels, each plant must provide at least a nominal justification for the particular choice of a set of engineering conditions that it will monitor. It is not

necessary for any plant to monitor all engineering conditions identified - only those important ones that could prevent the EDG from achieving the reliability target.

Listed below are specific questions that should be answered by the diesel generator user:

- Are all key parameters such as temperatures (cooling water, lube oil, bearings, exhaust gases), pressures (cylinders, fuel, lube oil, air), speed, torque, load or vibration levels monitored?
- Are there sufficient test points for each parameter?
- Is the monitoring equipment properly calibrated and accurate over time?
- Is the response of the monitoring equipment rapid enough for adequate correlation of operating changes and parameter variations particularly under test conditions?
- Are the data recorded with a satisfactory frequency and accuracy?
- Are all additions of fuel, lube oil, cooling water treatment chemicals, etc., recorded accurately (time, type, quantity)?
- Are all fluids (fuel, lube oil, cooling water) sampled at a sufficient frequency?
- Are the fluid samples representative (sampling point, volume, time at which the sample is taken in relation to other events) and the analyses properly specified?
- Are all operations of drains, blowdowns, and vents recorded accurately (time, duration) along with the reasons for these operations?

For a new unit, care should be taken to specify instrumentation and procedures that meet the requirements of the condition monitoring program.

Have alert levels, or criteria for corrective action, been identified for each engineering condition to be monitored?

Alert levels, or criteria for corrective action, must be identified for each of the engineering conditions contained in the set to be monitored as part of the EDG condition monitoring program. Alert levels are normally as simple as a minimum and/or maximum value for a parameter or a trend in a parameter. They also include combinations of condition levels (e.g., high crankcase pressure coupled with high temperature). A single engineering condition may have a multiplicity of alert levels, some of which merely alert the operator that a long-term

phenomenon is continuing to progress at some rate toward eventual degradation. An example is the continuous change in acoustic vibration level at a given set of frequencies that may be tied to some wear-out phenomena. The actual "alert" may be a spectrum frequency level whereby the decision may be made, for the sake of prudence, to overhaul a portion of the EDG at the next scheduled reactor shutdown. Thus, the alert may require immediate action, or simply result in a preventive maintenance action at some specified time in the future. Both the alert level value and a simple statement of the probable action to be taken should be presented as part of the condition monitoring plan.

Are there procedures for conducting the condition monitoring?

The EDG condition monitoring program should be formalized in a set of procedures that contain checklists for the conditions monitored, monitoring frequencies, alert levels, and action statements for plant use. Examples of condition monitoring checklists were presented in Tables C-1 through C-4. These checklists also implicitly contain the condition monitoring frequency, since there are separate checklists for checks per shift, daily, weekly, etc. Alert levels and action statements would be condition specific and are highly dependent on the expected lag-time between observation of the engineering condition and the EDG failure mode related to the condition; severity of EDG failure by the failure mode related to the observed condition; and EDG repair outage time to correct the observed condition, compared to the repair outage time required if the condition were allowed to proceed to failure. These considerations should be implicit in the condition monitoring procedures.

Has justification been given for the monitoring frequencies for the EDG conditions to be monitored?

As previously discussed, the frequencies with which the various EDG engineering conditions are to be sampled, or monitored, depend on the nature of the conditions and how they are related to the EDG failure mode that is being protected against. These frequencies must be set based on the expected lag-time from observing the failure precursor condition to the subsequent failure mode; whether the observed condition is a direct observation of a condition that will impact reliability, or an indirect observation of a condition that will eventually result in deteriorated reliability; and the severity of the failure if the failure mode were to occur. These considerations must be explicitly discussed in the condition monitoring frequency justification.

Has consideration been given to the EDG outage time required to perform the condition monitoring?

It is almost always beneficial from the standpoint of EDG availability to incur EDG outage time for the purpose of

condition monitoring, which leads to preventive maintenance, in order to avoid the subsequent EDG failures that would be experienced had the preventive maintenance not been performed. However, it is still incumbent upon the licensee to ensure that EDG outages for condition monitoring and preventive maintenance do not become excessive. That is, the licensee's condition monitoring program must reflect the tradeoff on EDG reliability (as calculated in Appendix A) between preventive maintenance and EDG failure (and subsequent corrective maintenance).

Are there provisions in the EDG reliability program to alter the condition monitoring performed in response to updated information or monitoring techniques becoming available?

It is inevitable that the appropriate set of monitored parameters and frequency of monitoring will change over time. This is true for two reasons: (1) because of wearout and aging mechanisms, the important EDG failure causes are expected to change with time, and (2) additional failure information, and improved techniques for condition monitoring, will almost certainly result in a changed perception of the appropriate condition monitoring for an individual EDG. Therefore, it is important that the EDG reliability program have provisions for periodically reviewing and updating the condition monitoring performed on the diesel generators.

Is the proposed condition monitoring plan supported by the proposed EDG surveillance?

Since condition monitoring is included as a type of surveillance, the review of EDG condition monitoring must be coordinated with review of EDG surveillance to ensure that there is absolute consistency between the surveillance planned and the condition monitoring planned.

C.2.2 EDG Reliability Monitoring

The purpose of reliability monitoring is to provide an overall, summary-type reliability assessment of the EDG or of individual EDG subsystems. Whereas condition monitoring is primarily an engineering activity, reliability monitoring is primarily a statistical activity. Reliability monitoring is not intended to be a replacement for condition monitoring. It is intended to augment a condition monitoring program. It is necessary to consider using reliability monitoring in conjunction with condition monitoring because, while condition monitoring provides a defense against individual, identified failure modes that have detectable precursor conditions associated with them, reliability monitoring provides an overall summary measure of the total impact of all failure modes, including those associated with the concurrent effects of several off-normal conditions operating together to produce EDG failure, which might not be detected if only condition monitoring were used.

Reliability monitoring can be applied to the entire EDG system or to individual subsystems such as the air start subsystem or the governor

subsystem. It can also be applied to classes of pieceparts, e.g., the overall reliability of all small valves, or all electrical contacts used in the emergency electric power system can be monitored. An application such as this could have value as a monitoring system designed to detect aging mechanisms that could have common cause implications. At the very least, the licensee should use the summary failure tracking scheme described in Appendix A for NRC overview use. This failure tracking scheme is a type of reliability monitoring.

The following subsections present some examples of reliability monitoring techniques to further define their use (Section C.2.2.1) and present the issues that must be addressed to review the adequacy of reliability monitoring schemes proposed as part of an EDG reliability program (Section C.2.2.2).

C.2.2.1 Example EDG Reliability Monitoring Techniques

The following presents a sample of some statistically based techniques that could be used to track EDG reliability or to indicate degradation or improvement in performance over time. A more detailed discussion of these techniques is provided in Reference C-2. Techniques of a similar nature are discussed in Reference C-3. It is emphasized that these tracking techniques are intended only as examples to indicate the nature of such techniques and how they could be used and are not intended to be a recommended set of approaches to reliability monitoring. Indeed, since reliability monitoring is a developing art, there may be approaches that are superior to the ones outlined here; the techniques presented herein are not meant to be review standards.

Tests to indicate if the failure or repair frequency has changed over time

Repair frequency has been identified as a reasonable measure of equipment aging or degradation (Ref. C-3) in some cases, especially the frequency of unscheduled repairs. Therefore, an indication of either a gradual or an abrupt change in the EDG repair frequency may be associated with a reliability problem that should be corrected. Change in repair frequency can be detected by plotting the occurrence dates of the repair actions on a timeline, as indicated in Figure C-2(a). Several methods can be used to provide a numerical basis for evaluating whether or not any trends noted in the repair occurrence-time plot are likely to represent actual changes in the repair frequency.

If the repair occurrence-time plot seems to indicate a somewhat abrupt change in the repair frequency, a Mann-Whitney test can be used to test the statistical significance of the indicated change. This procedure is described in detail in Reference C-2. An abbreviated outline of the process is given below.

1. Rank the times-between-repairs, as shown in Figure C-2(b), from smallest (rank 1) to largest. (Ref. C-2 gives the procedure for tied ranks.)

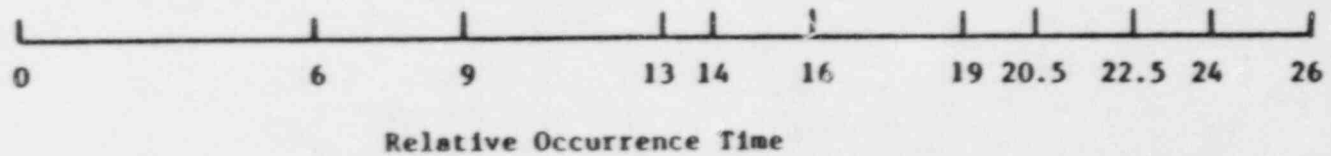


FIGURE C-2(a). TIMELINE SHOWING HYPOTHETICAL REPAIR OCCURRENCE TIMES

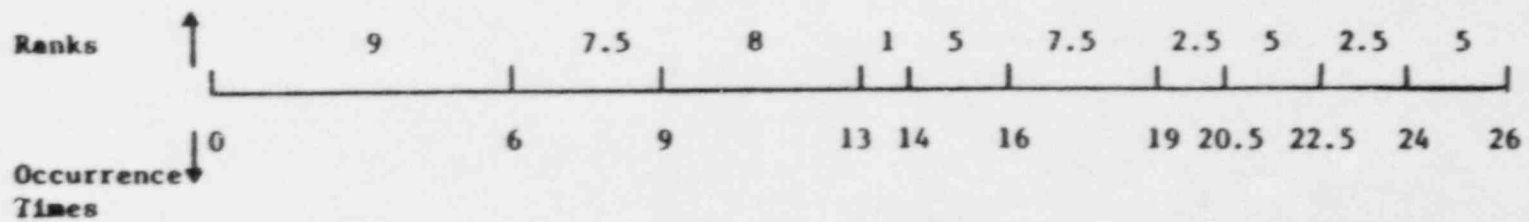


FIGURE C-2(b). TIMELINE SHOWING RANKED INTERVALS BETWEEN REPAIRS

4. The analysis segment is partitioned at the arrow in step 1 above. The times between events to the right of the arrow are to be considered "recent operating history." This partitioning is entirely at the user's discretion but should be done so that roughly half the event intervals occur on either side of the partition. In this case, there are 8 intervals in "recent operating history," and 6 intervals in "past operating history." Thus:

$$\begin{aligned} N &= 8 + 6 \\ &= 14 \\ n &= 8 \end{aligned}$$

5. The Z statistic (unit standardized normal) is estimated using:

$$z = \frac{R - (N + 1)/2}{\sqrt{\sigma_R^2}}$$

To estimate z, the terms R and σ_R^2 must be estimated.

6. R is estimated by summing all the ranks contained in the "recent operating history" segment, and dividing by the number of segments:

$$\begin{aligned} R &= (3 + 5 + 7 + 8 + 2 + 9 \frac{1}{2} + 1 + 5)/8 \\ &= 40.5/8 \\ &= 5.0625 \end{aligned}$$

7. σ^2 is estimated by:

$$\sigma_R^2 = \frac{N(N^2 - 1) - \sum_j T_j}{12Nn} \cdot \frac{N - n}{N - 1}$$

where $\sum_j T_j$ was calculated in step 3 to be 30

$$\sigma_R^2 = \frac{14(14^2 - 1) - 30}{12(14)(7)} \cdot \frac{14 - 8}{14 - 1}$$

$$= 1.05965$$

8. Calculate z using the expression in step 5 above:

$$\begin{aligned} z &= \frac{5.0625 - 7.5}{\sqrt{1.05965}} \\ &= \frac{-2.4375}{1.0294} \cdot (.461538) \\ &= -2.3679 \end{aligned}$$

9. Obtain f_z for $z = -2.3679$ from a standard normal distribution function.

$$f_z = .009$$

Since $f_z < .02$, the Kruskal-Wallis correction should not be applied.

10. The interpretation is that there is only a 0.9% chance of getting as many small ranks as observed in "recent operating history," as compared to past operating history, if the process had not changed. Therefore, it is concluded that the process has changed and that the repair (or failure) frequency has increased.

If the repair occurrence-time plot seems to indicate a gradual change with time (e.g., a gradual degradation process), a somewhat different trending approach may be appropriate (although the Mann-Whitney test could still be used for this). Figure C-3 shows the between-repair interval ranks in Figure C-2(b) plotted versus their occurrence times. A statistical regression analysis could be performed on the data shown in this plot, and the slope of the regression line tested for significance. A statistically significant negative slope would indicate an increase in repair frequency over time. It is not necessary to partition the analysis segment into "recent" and "earlier" operating history to perform this test. Reference C-2 also discusses this trending technique in detail. Caution must be used in accepting the significance level of the slope test since the normality assumptions usually made for regression analysis do not exactly apply in this case. However, the test can be used as an indicator of a trend in the repair frequency.

A test to indicate changes in EDG failure cause

This reliability tracking test provides a way of detecting if the type of failure cause experienced by the EDG has changed over time. The test is for a change in the proportion of repair actions in response to demand stress causes, compared to those due to standby stress causes; the change does not necessarily result in a change in the frequency of EDG repair actions as a whole, although it could. Such a change could come about due to wearout or aging mechanisms, or as a result of instituting a change in preventive maintenance, which predominantly affects one failure cause type.

This tracking scheme uses a normal approximation to the binomial to test if the relative proportion of repairs due to standby stress or demand stress failures has changed between "recent operating history" and "earlier operating history." Thus, the history of EDG repair actions must be partitioned into these two parts, as in the Mann-Whitney test. Also, each repair action must be tagged as being standby stress caused, or demand stress caused.

Reference C-2 contains a detailed description of this tracking scheme. The procedure is briefly summarized in the steps below:

1. The EDG repair history to be analyzed is partitioned into "recent" and "earlier" operating history.

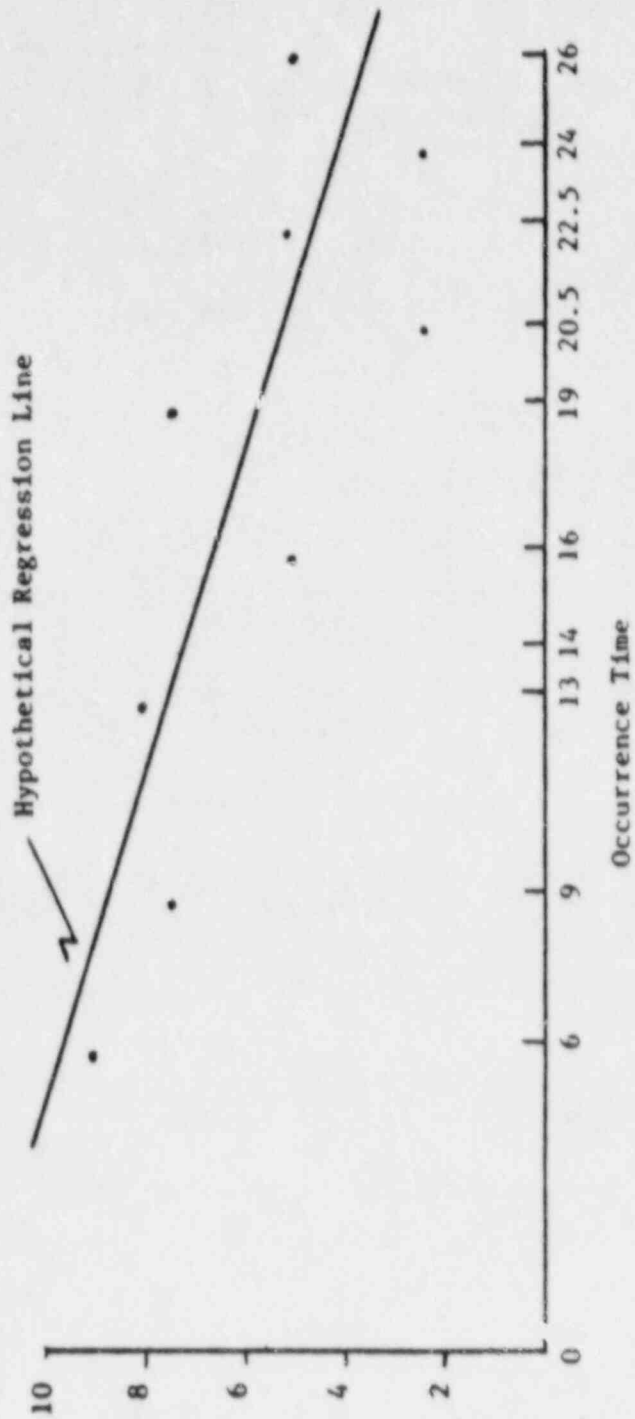


FIGURE C-3. SCATTERPLOT AND HYPOTHETICAL REGRESSION LINE FOR REPAIR INTERVAL RANKS VERSUS REPAIR OCCURRENCE TIMES

2. The number of standby-stress-caused and demand-stress-caused repair events are recorded in each segment of operating history. A cross-classified table is developed, as shown in Table C-5.
3. The proportion of demand-stress and standby-stress-caused repair actions in "recent" and "earlier" operating history are statistically tested using the normal approximation to the binomial (Ref. C-2) to indicate if these proportions have changed between earlier and recent operating history.

A numerical example of using the normal approximation to the binomial to test for a change in failure cause type between operating history and earlier operating history is given below:

Example Approximation to Binomial Test for Changes in Failure Cause

1. Partition the analysis segment into "recent operating history" and "earlier operating history."
2. Count standby-stress-caused failures and demand-stress-caused failures in each partitioned part of the analysis segment. For example:

	Segment 1 (Earlier Operating History)	Segment 2 (Recent Operating History)	Totals
Standby Stress	10 = n_{11}	3 = n_{21}	13 = $n_{.1}$
Demand Stress	6 = n_{12}	15 = n_{22}	21 = $n_{.2}$
TOTALS	16 = $n_{1.}$	18 = $n_{2.}$	34 = n

3. Estimate proportion of standby-stress failures to total failures as $13/34 = .382353 = \theta$
4. Get smallest product of four combinations $n_i, n_j/n = P$

If $P > 4$, normal approximation is acceptable. For example, smallest $n_i, n_j/n = (16)(13)/34 = 6.12$, which implies that the approximation is acceptable.

TABLE C-5. FAILURE CAUSE TYPE CROSS-CLASSIFIED WITH RECENT AND EARLIER OPERATING HISTORY

	Earlier Operating History	Recent Operating History	Totals
Repairs of <u>standby</u> stress caused failures or conditions	n_{11} = Number of standby stress repairs in earlier operating history	n_{21} = Number of standby stress repairs in recent operating history	$n_{.1}$ = Total number of standby stress repairs
Repairs of <u>demand</u> stress caused failures or conditions	n_{12} = Number of demand stress repairs in earlier operating history	n_{22} = Number of demand stress repairs in recent operating history	$n_{.2}$ = Total number of demand stress repairs
Totals	$n_{1.}$ = Total number of repairs in earlier operating history	$n_{2.}$ = Total number of repairs in recent operating history	n = Total number of repairs of all types

5. In general

$$p_s = 1 - \Phi \left(\frac{(n_{11}/n_1 - 1/2n_1) - (n_{21}/n_2 + 1/2n_2)}{\sqrt{\theta(1-\theta)(1/n_1 + 1/n_2)}} \right)$$

$$p_d = \Phi \left(\frac{(n_{12}/n_1 + 1/2n_1) - (n_{22}/n_2 - 1/2n_2)}{\sqrt{\theta(1-\theta)(1/n_1 + 1/n_2)}} \right)$$

6. Calculate the statistics:

$$p_s = 1 - \Phi \left(\frac{(10/16 - 1/2(2 \times 16)) - (3/18 + 1/2(2 \times 18))}{\sqrt{\theta(1-\theta)(1/16 + 1/18)}} \right)$$

$$p_s = 1 - \Phi(3.416)$$

$$p_d = 1 - \Phi \left(\frac{(6/16 + 1/(2 \times 16)) - (15/18 - 1/(2 \times 18))}{\sqrt{\theta(1-\theta)(1/16 + 1/18)}} \right)$$

$$p_d = \Phi(-2.341)$$

7. p_s and p_d indicate significant changes in standby and demand stress failures. Perform table lookup for significance.

$$p_s = .00032 \text{ (is significant at the 0.032\% level)}$$

$$p_d = .0084 \text{ (is significant at the 0.84\% level)}$$

Both indicate a definite change. Thus, standby-stress-caused failure frequency has decreased, and demand stress-caused failure frequency has increased.

A tracking scheme for EDG repair outage time unavailability

Tracking the proportion of time that an EDG spends out-of-service for repairs can indicate that EDG performance is degrading with age or wear (increasing outage time unavailability) or that repair and maintenance practices are becoming more effective (decreasing outage time unavailability). A technique for tracking EDG repair outage time unavailability is presented in Reference C-2. This technique is summarized in the steps below:

1. Display the segment of repair history on a timeline that shows when each repair action was initiated.
2. Tag each repair or maintenance act by the EDG outage time required to complete the repair and restore the EDG to operable status.

3. Compute a running estimate of repair outage unavailability. For the j^{th} repair action, the estimate of repair unavailability is:

$$q_j = r_j / T_j$$

where q_j = Estimate of EDG repair unavailability at the time of the j^{th} repair.

r_j = Outage time required to complete the j^{th} repair.

T_j = Interval between the $(j-1)^{\text{th}}$ and j^{th} repair events.

4. Plot the repair outage time unavailabilities (q_j 's) versus the repair occurrence times.
5. Regress the repair outage times on repair occurrence times for the above plot and test slope for statistical significance.

A statistically significant slope (either positive or negative) would provide quantitative substantiation to the argument that EDG repair outage time unavailability is changing with time. Of course, the interpretation of this change is not inherent in the statistics. Engineering judgment and other information must be used to interpret the change in terms of reliability or maintainability changes.

A numerical example illustrating use of scatterplots and regression analysis to indicate if there is a change in EDG repair outage unavailability over time is given below.

Example Repair Unavailability Tracking Option


1. Assume the following set of repair actions constituting the analysis segment. The relative outage occurrence times, and the outage times are displayed on the timeline below.

Outage times	18	12	24	8	30	16	12	1	.5	4	1	2	8.5	3	
event occurrence times ($\times 10^3$)	0	3.2	4.2	6.3	8.8	10.3	12.5	13.2	14.2	15.3	16.7	17.3	18.8	19.2	20.2

2. The first step is to estimate the unavailability at each of the outage occurrence times. These are shown in the table below:

<u>Interval</u>	<u>Interval Length</u>	<u>Unavailability Calculation (x.001)</u>	<u>Unavailability (x.001)</u>	<u>Occurrence Time</u>
0 - 3.2	3.2	12/3.2	3.75	3.2
3.2 - 4.2	1.0	24/1.0	24.0	4.2
4.2 - 6.3	2.1	8/2.1	3.8	6.3
6.3 - 8.8	2.5	30/2.5	12.0	8.8
8.8 - 10.3	1.5	16/1.5	10.67	10.3
10.3 - 12.5	2.2	12/2.2	5.45	12.5
12.5 - 13.2	0.7	1/0.7	1.43	13.2
13.2 - 14.2	1.0	0.5/1.0	0.5	14.2
14.2 - 15.3	1.1	4/1.1	3.64	15.3
15.3 - 16.7	1.4	1/1.4	0.71	16.7
16.7 - 17.3	0.6	2/0.6	3.33	17.3
17.3 - 18.8	1.5	8/1.5	5.33	18.8
18.8 - 19.2	0.4	0.5/0.4	1.25	19.2
19.2 - 20.2	1.0	3/1.0	3.0	20.2

3. The next step is to plot the repair unavailabilities (column 4 of the above table) versus the repair occurrence times (column 5 of the above table). The plot is shown below.

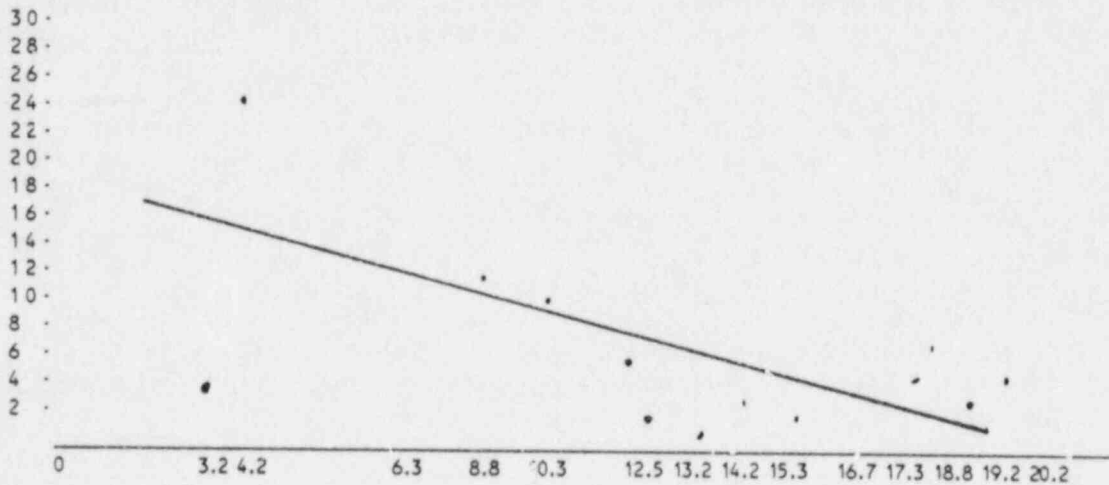


4. The next step is to use the regression module to estimate the best linear fit through the scatterplot. A hypothetical regression line is also shown in the figure above.
5. Significance tests would be performed as part of the regression analysis.

The possibilities are indicated in the following table.

		Positive slope	Negative slope
>10%	No trend	No trend	No trend
<10%, >1%	Indication of a trend	Indication of increase in repair unavailability	Indication of decrease in repair unavailability
<1%	Strong indication of repair time increasing	Strong indication of repair unavailability increasing	Strong indication of repair unavailability decreasing

6. If desired, smooth over several repair actions, and repeat steps 2 through 5.


Smoothing over 2 Repair Actions (n = 2)



7. Table of intervals, unavailabilities, and occurrence dates for the smoothed data.

<u>Interval</u>	<u>Interval Length</u>	<u>Unavailability Calculation (x.001)</u>	<u>Unavailability (x.001)</u>	<u>Occurrence Time</u>
0 - 4.2	4.2	36/4.2	8.6	4.2
4.2 - 8.8	4.6	38/4.6	8.3	8.8
8.8 - 12.5	3.7	28/3.7	7.6	12.5
12.5 - 14.2	1.7	1.5/1.7	0.9	14.2
14.2 - 16.7	2.5	5/2.5	2.0	16.7
16.7 - 18.8	2.1	10/2.1	4.8	18.8
18.8 - 20.2	1.4	3.5/1.4	2.5	20.2

8. Plot repair unavailability (column 4) versus occurrence time (column 5).

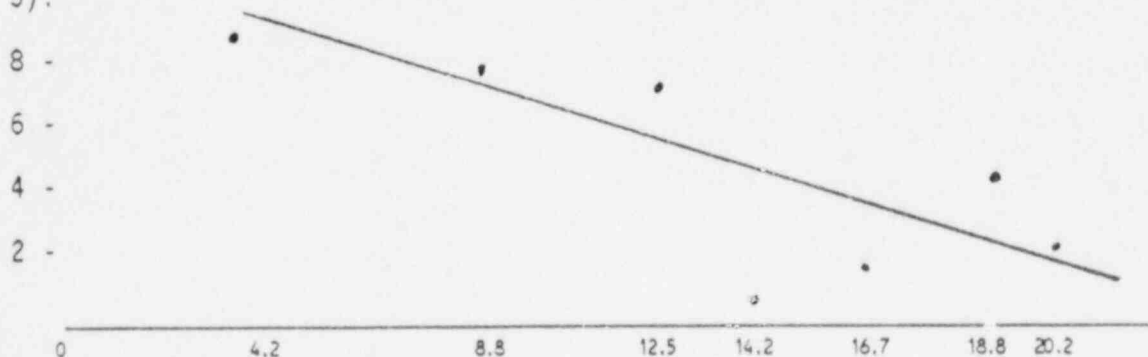

9. The regression line and significance tests are performed on the smoothed data scatterplot as they are on the unsmoothed data.

The above tracking techniques illustrate that methods do exist to perform reliability monitoring. Each licensee should evaluate what reliability monitoring applications and techniques are appropriate for their EDGs. There are a set of issues that must be addressed to accomplish this determination. These are discussed in the next section.

C.2.2.2 Technical Review Issues for EDG Reliability Monitoring

The following presents items to review to provide a degree of assurance that EDG reliability monitoring established as part of an EDG reliability program and in conjunction with a condition monitoring program has the features necessary to be successful.

Has the reliability monitoring been directed toward EDG subsystems that have historically been the major contributors to EDG unreliability?

Appendix I lists diesel generator subsystems, by diesel manufacturer, that have historically been major contributors to EDG unreliability. Reference C-4 also contains an analysis of EDG subsystem reliability by manufacturer. Also listed are those subsystems (by manufacturer) that have proved reliable in standby operation. Unless plant experience indicates otherwise, reliability monitoring should be directed toward the major contributors to EDG unreliability. Reliability monitoring should also be directed toward EDG subsystem failures or problems that the plant has experienced in the past unless these problems have been corrected. Review of the EDG reliability monitoring approach should verify that the monitoring effort is being directed toward those areas where it is most likely to be needed.

Does the EDG surveillance plan support the monitoring plan?

Tracking information that will be used to monitor EDG reliability must come from surveillance of the EDGs. Therefore, the planned surveillance of the EDGs must support the requirements of the reliability monitoring plan. Information necessary to monitor the reliability of the EDGs must be obtained as part of the surveillance of the EDGs. Review of the reliability monitoring approach must be coordinated with review of surveillance of the EDGs to ensure that there is consistency between the information required for monitoring and information likely to be generated by surveillance.

Are there clear procedures and assigned responsibilities for implementing, conducting, and changing the proposed EDG reliability monitoring scheme?

The procedures to be used to monitor EDG reliability, including the statistical procedures that will be used as alert levels, should be defined in the reliability program documentation. Responsibilities for implementation and operation of the reliability monitoring activity should be clearly spelled out. Periodic review of EDG reliability monitoring is suggested as a

way of introducing changes to the program to provide more, less, or different monitoring. Review of a licensee's reliability monitoring program should verify that there are provisions for adapting the monitoring to the (possibly) changing characteristics of EDG performance.

C.3 INTERFACES WITH OTHER RELIABILITY PROGRAM REVIEW ITEMS

Review of the planned performance monitoring to be conducted as part of an EDG reliability program should be coordinated with review of the proposed surveillance of the EDGs. Both condition monitoring and reliability monitoring involve trending data obtained during EDG surveillance. There should be a correspondence between the information obtained from EDG surveillance and the information needs of the condition and reliability monitoring schemes.

Both condition monitoring and reliability monitoring require comparing current performance to past performance. Therefore, sufficient information concerning past performance should be stored to allow these comparisons to be made. This will impact the needs of the data storage and retrieval system that will support the EDG reliability program. Thus, review of the performance monitoring proposed for an EDG reliability program should be coordinated with review of the data storage and retrieval capabilities that are to support the program to ensure that these capabilities are adequate.

Since the primary function of condition monitoring is to support the EDG preventive maintenance program (i.e., to trigger preventive maintenance) review of EDG condition monitoring should be coordinated with review of the preventive maintenance policy (Review Item D) to ensure that there are no disjointed aspects of either of these features of the reliability program.

The EDG reliability monitoring and alert levels must be consistent with the EDG reliability target (Appendix A). Therefore review of EDG reliability monitoring must be coordinated with review of the Appendix A issues.

Finally, since condition and reliability monitoring require a coordinated, planned effort, review of performance monitoring of EDGs must be coordinated with review of the management of the reliability program to ensure that EDG performance monitoring will be adequately managed.

REFERENCES FOR APPENDIX C

- C-1. K. Hoopingarner et al., "Aging of Nuclear Station Diesel Generators: Evaluation of Operating and Expert Experience (Phase I Study)," Pacific Northwest Laboratories, NUREG/CR-4590, Vol. 1, PNL-5832, August 1987.
- C-2. G.M. DeMoss et al., "Component Reliability Parameter Studies (CRPS); System Architecture Document for Computer Assisted Reliability Data System (CARDS)," Report prepared for EPRI by SAIC, December 30, 1987.
- C-3. W. Vesely and A. Azarm, "System Unavailability Indicators," BNL Technical Report A-3295, 30 September 1987 (to be published).
- C-4. R. Battle and D. Campbell, "Reliability of Emergency AC Power Systems at Nuclear Power Plants," Oak Ridge National Laboratory, NUREG/CR-2989, ORNL/TM-8545, July 1983.

APPENDIX D
EMERGENCY DIESEL GENERATOR MAINTENANCE PROGRAM
(Review Item D)

TABLE OF CONTENTS

	<u>Page</u>
D.1 INTRODUCTION	D-5
D.2 ISSUES TO CONSIDER WHEN ADDRESSING AN EDG MAINTENANCE PROGRAM	D-5
D.3 EDG MAINTENANCE PROGRAM INTERFACES WITH OTHER REVIEW ITEMS.	D-8

D.1 INTRODUCTION

The objective of this appendix is to define the elements of reliability focused maintenance that are important for an EDG reliability program. EDG maintenance plays an important part in the achievement of a reliability target but is not a self-contained activity. Maintenance actions must be driven by surveillance and performance monitoring results. All required elements of a maintenance program should exist to some extent in an existing plant maintenance program. However, to be an effective part of an EDG reliability program, EDG maintenance should be based on reliability considerations and actively interface with the other elements of the reliability program. The maintenance policy is needed for a satisfactory preventive maintenance program, an acceptable spare parts inventory, correctly prioritized responses to problems, and the input of needed data for other review items such as failure analysis and root cause investigations.

A great deal of published material refers to or describes reliability centered maintenance programs. The descriptions can be very complex and somewhat prescriptive approaches to a program that really has a relatively straightforward function. In order for a maintenance program to function as an effective part of a nuclear power plant EDG reliability program, it must include:

- Prioritization of maintenance action based on failure cause, root cause, fault severity, detectability, anticipated repair time, and likelihood of occurrences repeating or the severity increasing.
- Planning of preventive maintenance based on reliability characteristics of EDG subsystems and components.
- A proactive spare parts administration policy that includes a prioritization based on the conditions mentioned in the first bullet.

Section D.2 of this appendix discusses the technical issues that must be considered in reviewing an EDG maintenance policy. Section D.3 describes the interfaces between the EDG maintenance program and other items of the reliability program.

D.2 ISSUES TO CONSIDER WHEN ADDRESSING AN EDG MAINTENANCE PROGRAM

The purpose of this section is to identify the issues that must be addressed when reviewing the planning and implementation of EDG maintenance. The issues are not specific to EDGs, and probably are addressed to some extent in existing maintenance programs. The identified issues are designed to ensure that maintenance is focused toward improving EDG reliability. The major thrust of the corrective maintenance and unscheduled preventive maintenance policy should be prioritization of action in dealing with problems.

Has a distinction been made in the response to problems based on the problems severity?

The major consideration in determining the level of response to a failure or other off-normal condition should be the severity of the problem. Among the data recorded upon occurrence of a failure or abnormal condition (see Appendix G) is the severity of that condition, which can be categorized as catastrophic, degraded, or incipient. All catastrophic failures will get immediate maintenance attention, directed toward correcting the failed condition, so that the EDG can be retested and restored to its standby condition. Failure cause analysis, root cause analysis, and other reliability program activities should not be allowed to significantly delay returning a failed EDG to service but are still required to understand the failure cause and how to prevent its recurrence.

The response to degraded and incipient failures is not as clear as the response to catastrophic failures. As failures occur, they must subjectively be evaluated for the potential of leading to a catastrophic failure and for the potential long-term adverse effects of operating a diesel with the failure or abnormal condition present. A condition classified as incipient, such as a drop per minute lube oil leak at a flange (during EDG operation), may have essentially no chance of leading to a catastrophic failure. The only adverse effect may be correctable by occasionally wiping up an oily area. A problem like this may be better off left alone until the next reactor or diesel outage. Other incipient or degraded conditions may have long-term implications (e.g., high vibration levels) or have a high potential for leading to a catastrophic failure (e.g., governor oil leak). Engineering judgment and experience indicate that these conditions should be repaired promptly.

Has a distinction been made in the response to problems based on the expected repair outage time?

This distinction is closely related to the first issue of this section. If the condition severity does not indicate a problem requiring immediate action, the expected outage time to repair should be considered. A slightly reduced risk of catastrophic failure is sometimes not worth an extensive EDG outage for maintenance, especially during reactor operation. Repair outage time should be considered when planning maintenance and should be reduced when possible by staging tools and spare parts and by repairing several conditions during a single diesel repair outage.

Is preventive maintenance adequately focused?

The purpose of preventive maintenance should be to reduce the number of catastrophic failures and to reduce the long-term degradations due to aging and wearout. In order to accomplish this, preventive maintenance can be keyed by:

- Calendar time
- EDG runtime
- Number of EDG starts
- Response to condition monitoring or
- A combination of 2 or more of the above.

The preventive maintenance tasks themselves should be determined based on systematic consideration of subsystem and component functions, the way functions can fail, and priority-based consideration of safety, reliability, and economics to identify applicable and effective preventive maintenance.

Preventive maintenance should be scheduled to minimize the EDG downtime during reactor operations. The reliability program should allow some flexibility in scheduling preventive maintenance so that a preventive maintenance that is required by one of the keys can be evaluated and if possible postponed until the next reactor outage.

Does the maintenance program support the failure cause and root cause analysis?

The elements of failure cause and root cause investigations are described in detail in Appendix E. The maintenance policy must be supportive of these investigations by directing activity to look for indications of failure causes and potential failure causes. During corrective maintenance and preventive maintenance, all abnormal conditions should be reported and documented into the data storage system (Appendix G) for future use. Any failed or degraded pieceparts that may be important in a detailed investigation should be saved until the analysis is closed out.

Does the spare parts system support preventive and corrective maintenances?

The utilities should periodically evaluate their spare parts requirements to ensure that they adequately support all maintenance activities. Two types of evaluations should be performed on the spare parts support. The first is to measure the responsiveness in supplying the necessary parts for unscheduled and scheduled preventive and corrective maintenances. This is a relatively simple evaluation to perform regularly. The second is a more detailed evaluation of the spare parts inventory. The

evaluation must take into account potential component failures that will lead to catastrophic engine failures, the likelihood of the components failing, and the difficulty of repair. The emphasis should be on stocking critical instrumentation and control (I&C) components because they cause many catastrophic failures, but the repairs are usually relatively simple. Major mechanical parts, such as the casing or head, probably cannot be replaced within the allowed outage time by onsite personnel, so there is little gain to having these parts as ready spares.

D.3 EDG MAINTENANCE PROGRAM INTERFACES WITH OTHER REVIEW ITEMS

The key to the success of the maintenance program lies in the successful interfaces with the other reliability program elements. One of the key functions of a reliability program is to deal with problems, failures, and other off-normal conditions so that they do not recur or lead to catastrophic engine failures. The maintenance program is central to this function.

In carrying out actions in the maintenance program, one must recognize that the policy is driven by the target reliability defined in Review Item A. However, specific maintenances (as opposed to the policy) should not be driven by these targets but by the performance indicators identified in Review Item C. Analysis of the performance indicators should indicate a preventive maintenance that will reduce the likelihood of adverse performance and indicate the frequency with which maintenance of various types should be performed.

The interface with the failure analysis work described under Review Item E is vital for successful failure analysis. The maintenance people who actually tear down machines for the repairs should be involved with and aware of the failure analysis and root cause investigation.

Another major interface is with the data collection system. It is extremely important that all insights, including suspicions, of the maintenance personnel are entered into the data system. The information may seem minor at the time, especially if the condition being repaired is seemingly minor or routine, but the performance monitoring work or a failure investigation may need this information to spot trends or focus on the root cause of a problem. Recording detailed information also provides added assurance of meeting the criteria for problem closeout (Review Item F). Conversely, the experts using the information from the data system for failure analysis, unreliability reporting, performance monitoring, and problem closeout must ensure that maintenance personnel are trained to include the pertinent data in the collection system. In addition to being able to enter data into the system, maintenance personnel must be able to retrieve historical repair information from the data system.

APPENDIX E
FAILURE ANALYSIS AND IDENTIFICATION OF CORRECTABLE CAUSES
(Review Item E)

TABLE OF CONTENTS

	<u>Page</u>
E.1 INTRODUCTION	E-5
E.2 ISSUES TO CONSIDER WHEN REVIEWING FAILURE ANALYSIS AND ROOT CAUSE INVESTIGATION	E-5
E.3 EXAMPLES OF FAILURE ANALYSIS	E-13
E.3.1 Example 1	E-13
E.3.2 Example 2	E-13
E.3.3. Example 3	E-20
E.4 INTERFACES WITH OTHER REVIEW ITEMS	E-20

LIST OF FIGURES

Figure

E.1 Systematic Root Cause Approach	E-9
E.2 Example 1	E-14
E.3 Example 2	E-19
E.4 Example 3	E-21

E.1 INTRODUCTION

The purpose of this critical review item is to ensure that the licensee aggressively and systematically reduces EDG problems to correctable causes. Substantial long-term benefits can be derived from the identification of the root causes of problems and the development of solutions that either eliminate these causes or minimize their impact. Diesel generator failures cannot be entirely avoided due to the complexity of these units and the type of service experienced in nuclear power plants. However, systematically eliminating the root causes of problems will improve diesel generator reliability.

Diesel generator problems requiring investigation and correction can be of several types. They include catastrophic failures, unsatisfactory conditions detected through surveillance or monitoring, or damage and other physical conditions found during maintenance work.

The investigation of these diesel generator problems can be carried out to various levels that, in most cases, are not clearly separated. In order to show a progression in the degree of detail, a distinction is made whenever possible between failure analysis, which covers the entire range, and its subset, root cause analysis. Failure analysis starts from the most apparent symptoms and progresses to the determination of the underlying failure or incipient condition. The root cause analysis attempts to find the cause(s) of the underlying failure or incipient condition that could be related to design or a procedure used in operation or maintenance.

In general, the likelihood of performing a successful analysis is increased by the availability of a large amount of meaningful data. The quality of those data and the manner of their retrieval are critical to their usefulness. The availability of data to address each issue identified in Section E.2 should be considered by the reviewer as the issues are reviewed.

A root cause investigation must be conducted very methodically since the root may be several levels below the visible symptoms, or there may be several synergistic causes, some more predominant than the others. The methodical approach to investigations is stressed in the examples of Section E.3.

E.2 ISSUES TO CONSIDER WHEN REVIEWING FAILURE ANALYSIS AND ROOT CAUSE INVESTIGATION

The specific issues that must be addressed when reviewing the failure analysis and root cause investigations of a reliability program are presented in this section.

Does the licensee collect and incorporate the necessary information for a failure and root cause investigation?

One or more of the following elements may be required for a successful root cause analysis of an identified problem:

- All parts removed from the unit in connection with the repairs necessitated by the problem.
- Reports on the condition of all adjacent parts and other visual observations made during disassembly (including, for example, verbal descriptions, schematics, and photographs).
- Clearance and alignment readings, measurement of piece-parts (with properly calibrated measuring devices).
- Design and manufacturing data.
- Operational data.
- Test data.
- Reports of fluid analyses (fuel, lube oil, cooling water, etc.).
- Documentation on all prior failures, preventive maintenance, and modifications of the same unit (specific documentation).
- Documentation on similar failures in other units at the plant or at other plants (generic documentation).

Are problems documented in a retrievable manner and in a manner that allows the use of both plant and generic information to solve a problem?

A distinction must be made between the problems experienced by the subject unit (specific documentation) and those experienced in similar units (generic documentation). However, the organization of the data should be common to both types of documentation. The data's organization will facilitate using generic documentation in the EDG reliability program and reporting occurrences to the NRC and the generic data collection agencies (INPO, NPE, etc.). This organization should follow logical groupings and could, for example, use the following major categories for equipment "inside the boundary" (as defined in Table B-1):

- Engine structure and drive train
- Starting system
- Combustion air intake and gas exhaust systems
- Valve mechanism (if so equipped)
- Lubrication system

- Cooling system
- Generator and associated switchgear
- Instruments and controls including the governor
- Monitoring equipment

The specific documentation should be very dynamic with regard to both inputs and outputs. It should be updated continuously and should be available to all involved personnel from management to the lead-mechanic levels. To increase its usefulness, it may use PC-based storage and retrieval methods. Significant specific data should be codified to facilitate its release, subject to proper approval, to manufacturers, other plants, consultants, etc., and to accelerate the identification of generic problems.

All abnormal conditions including failure should be recorded in the specific documentation, whether or not they are subject to any regulatory reporting requirements. Often "non-reportable" conditions can result in excessive maintenance costs due to accelerated parts replacement or can eventually lead to major failures if allowed to recur. The documentation should include operators' or other employees' opinions. This material, although often speculative can benefit the investigative team.

In many cases, the solution to a diesel generator problem will affect more than one of the subsystems or plant organizations (e.g., electrical and mechanical repair). When the repair data are subsequently recorded in the specific documentation, they should be entered in all applicable categories and properly cross-referenced. This can be facilitated by electronic data processing.

The generic documentation, which should use the same groupings, would be more static, but access to it should be as broad as for the specific documentation. Use of the same format will facilitate communications and review at all plant levels. The NPRDS provides a format for data exchange, but the scope and depth is not usually adequate for root cause investigations. However, the NPRDS records do identify if and when similar problems have occurred. Identifications of a similar problem that was experienced by one or more EDG owners can initiate a beneficial exchange of technical information.

Does the reliability program systematically approach failure and root cause investigations?

Considering the complexity of diesel generators, the diversity in operations, and the variety of failure modes, it is not possible to design a failure analysis tree for each type of failure that could be encountered. Some examples of analyses are provided in Section E.3 to illustrate the concept.

A failure and root cause investigation must be very systematic. This systematic approach is time consuming but is a necessary ingredient in a root cause analysis program. This implies that predetermined patterns be followed all the way through, even if a very early strong candidate is identified. A particular failure will often result from a combination of causes. Some causes will be more predominant and causes tend to aggravate each other. The structured approach will help sort out these interrelationships. The predetermined patterns must, however, remain dynamic and be subject to modification as the root cause analysis progresses. Figure E-1 describes a systematic failure and analysis root cause approach.

The diesel generator problem is detected through surveillance, monitoring, preventive maintenance, or catastrophic failure. In all cases, a failure analysis should be carried out. In the case of relatively minor and nonrecurring problems, this failure analysis could be very rudimentary, yet it must provide some assurance that the problem is minor. Adequate documentation must be provided in case the problem changes in severity or recurrence frequency.

The failure analysis should be carried out to the determination of the incipient condition. That incipient condition could be a condition such as the degradation or failure of a piecepart or a mechanism, or control out of adjustment or improperly timed. On Figure E-1, the steps are identified as the determination of the proximate cause.

When the incipient condition or failure has been repetitive, has resulted in substantial downtime, or may lead to a major catastrophic failure if the failure should recur, the analysis should continue until the root cause has been identified. The decision to perform a root cause analysis should take into account any available specific and generic information.

In the event the problem appears to be a generic one, it is still necessary to look into potential specific causes that contributed to the appearance of the problem or may have increased its severity. Similarly, if in the early stages of the analysis a problem appears to be specific to the plant or unit, the results should be checked against the generic data as the analysis progresses. It must be kept in mind that no two units are exactly identical due to slight modifications in design through the years, changes in manufacturing methods, status of implementation of vendor-recommended modifications, and other differences in operating and maintenance histories.

Using an example of a connecting rod bearing failure, which falls in the structure and drive train grouping, we can see how the systematic approach is used. The suspected causes of the failure could be:

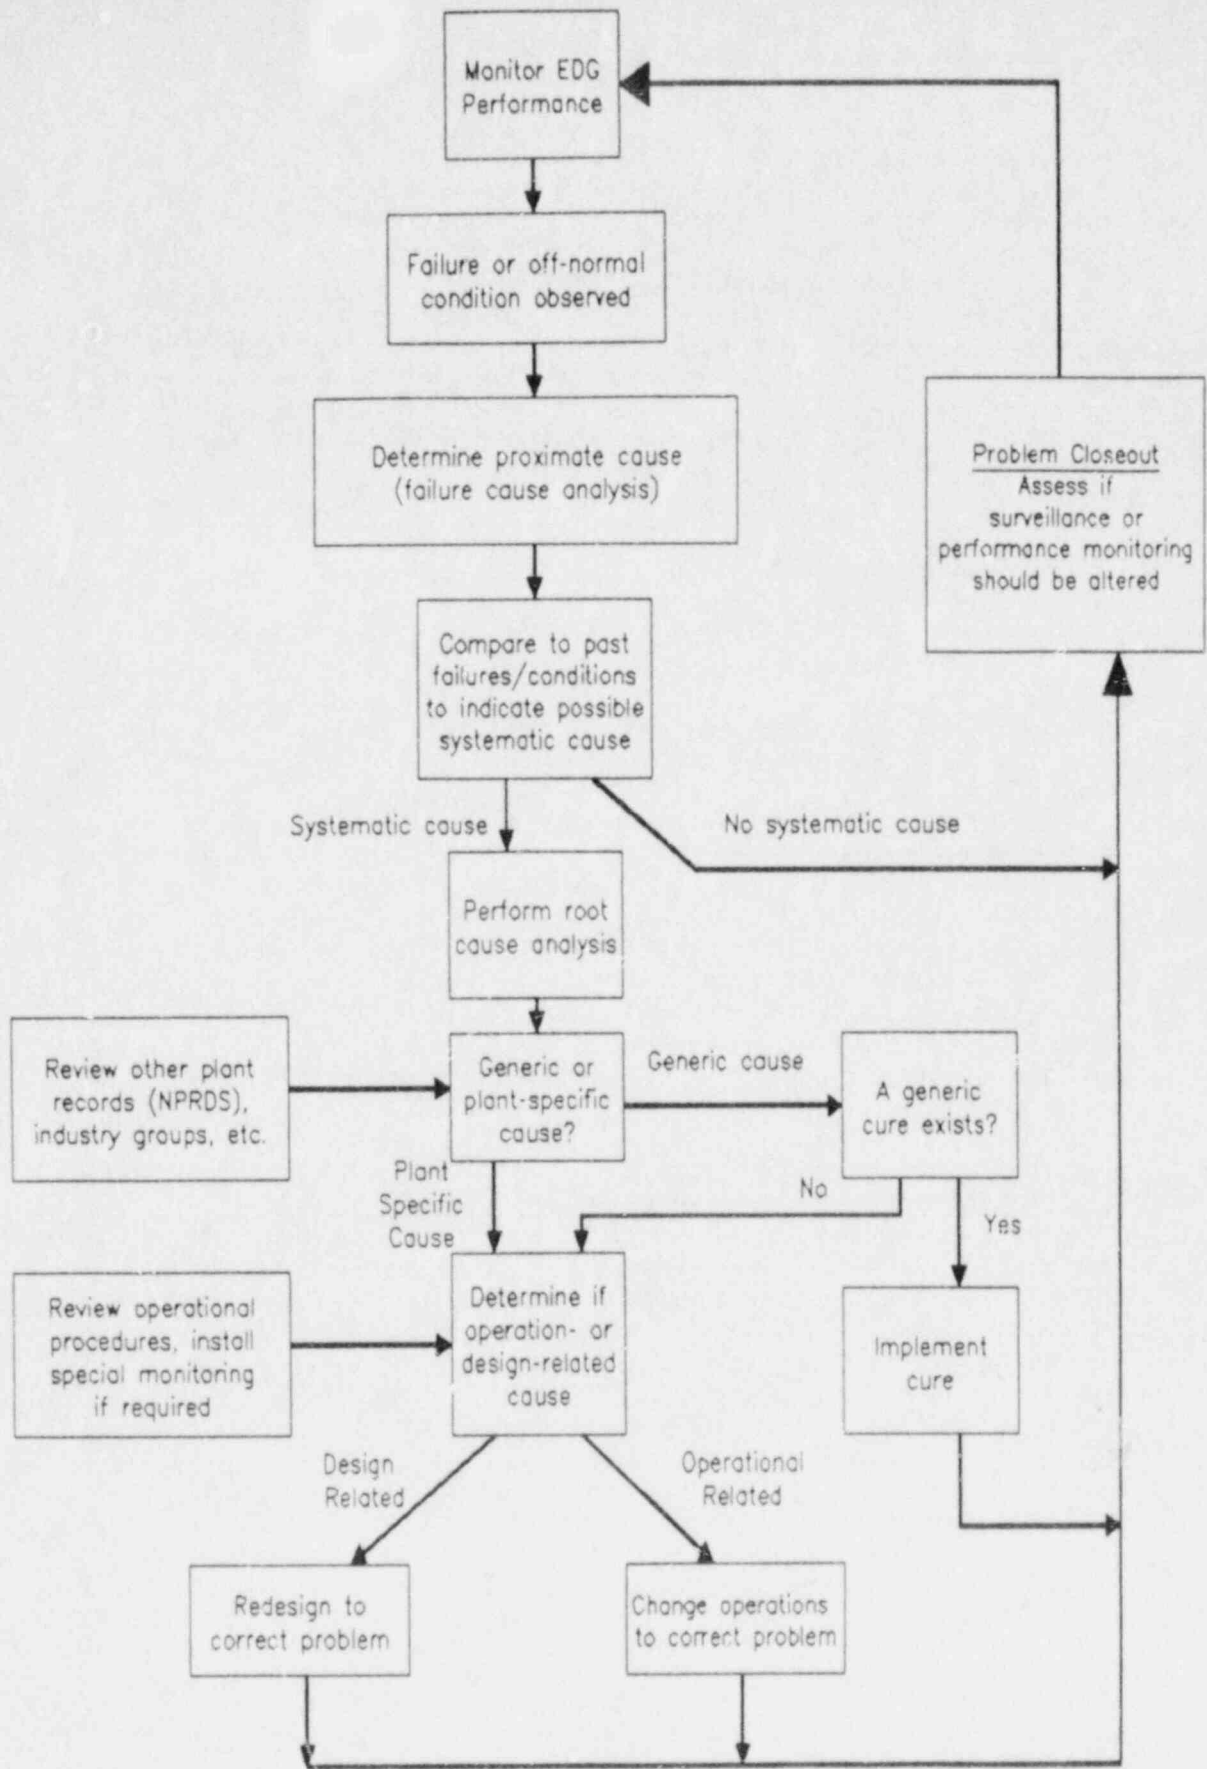


FIGURE E-1. SYSTEMATIC ROOT CAUSE APPROACH

1. In the bearing itself

- Poor design
- Improper material application
- Material not meeting specifications or presenting a defect
- Improper machining of the bearing parts
- Improper installation of the bearing parts

2. Outside the bearing proper

- Abnormal operation of the diesel generator as a unit
- Abnormal firing pressure in the corresponding cylinder
- Improperly machined or damaged shaft
- Inadequate lubrication, etc.

Obviously the operating characteristics and physical condition of the EDG would be different for each suspected cause. However, the differences would generally be subtle. Only a systematic approach can identify the proximate cause and subsequently proceed toward establishing a root cause.

Are failure and root cause investigations performed by an appropriately qualified team using an adequate task plan?

There are three principal elements to the establishment of a failure analysis task: (1) a plant organization that puts emphasis on that task, (2) a well-organized, complete, and easily accessible data base, and (3) a means of exchanging with other plants, manufacturers, consultants, etc., information relative to generic problems.

Traditionally, a root cause investigation is conducted by a multidiscipline team. Even if, on the surface, a problem appears to be strictly mechanical, it may, for example, have its root in a lubrication problem that should be addressed by a specialist in this area. The team must include plant personnel to ensure continuity and involvement of plant management (see Appendix H for details). Some team members should be knowledgeable of materials testing methods, their applications, and limitations to ensure that the most pertinent laboratory analyses will be performed on any failed or damaged parts covered by the root cause investigation. It is also important that representatives of the root cause analysis team follow any major maintenance

operation taking note of the condition of parts during disassembly and monitoring reassembly. Although the observers should be independent from the maintenance work force, an acceptable alternative would be to train the mechanics to perform the observations and to specify the documentation requirements in the maintenance procedures and work orders.

The task plan should stress continuity in assignments since repeated observations of diesel generator conditions are necessary to acquire the expertise necessary for successful root cause analysis. It is also important to clearly establish the priorities of the team members. Root cause analysis requires a methodical approach and may be very time consuming. To avoid distractions, interruptions, and superficiality, the key members of the team should be able to give to this task the highest priority. If the plant organization does not allow this, it is acceptable to seek, on a continuing basis, outside help that can be entirely dedicated to the task.

The development of a data base meeting the requirements of a failure analysis task requires close cooperation between the future users (from management to the lead-mechanic level) and the personnel with strong data management expertise. The volume of data that will eventually accumulate in that base will be far too large to permit substantial modifications of the system after it is placed in service. It is, therefore, very important to apply sufficient resources to this item during its development. If plant personnel lack sufficient expertise, outside help can be used.

In a vacuum, it is not possible to determine if a problem is of a generic nature. Also, users should not wait for a problem to appear to try to determine, through contacts with other plants or manufacturers, if it has been experienced by others. This can increase the burden brought by the problem and result in additional delays in making satisfactory repairs. For these reasons, it is suggested that the generic documentation be systematically included in the root cause data bank.

Do the on-scene mechanics support and contribute to the failure and root cause investigation?

A large amount of very valuable information can be lost if observations are not made during the disassembly. For example, an observer noticed that a mechanic removing a connecting rod bearing cap experienced difficulty in turning a large nut because it was no longer making contact with the cap. This was caused by lack of depth in the thread. The resulting friction had probably caused the required torque to be reached before the proper bolt tension was achieved during installation.

Other examples of valuable teardown information are:

- Uniformity of bolt tightening.
- Discoloration of parts, especially if not uniform across the engine.
- Marks on surfaces indicating movement or fretting that can be affected by cleaning.
- Judgment on fit-ups when measurements cannot be taken.

Many of the questions and uncertainties of the problems shown in the examples of Section E.3 are solved by the on-scene mechanics. They need to be trained to spot and record pertinent failure cause and effect information.

Independent observations made during reassembly can also play a critical role. For example, an observer noticed sharp edges at the oil-spreading grooves of a batch of new bearings that were being installed by a mechanic. These sharp edges were the result of a manufacturing error and would have probably resulted in bearing damage.

Knowing what to look for and how to read the telltales requires a great deal of experience that can be gained only through long association with the equipment and effective training. Stability in assignments to a root cause team is, therefore, important and if it cannot be maintained with plant personnel, the team can include, on a continuing basis, an outside diesel specialist (in addition to any manufacturer service representative that may be invited to participate in the analyses, depending on the circumstances).

It should be the responsibility of the root cause team to save any damaged parts for future analysis and to preserve them from any alterations until a plan of action has been agreed upon. The team should also be responsible for making contacts with other plants, manufacturers, etc., when the problem has the potential of being generic but is not sufficiently documented in the existing data base.

Is the entire failure and root cause analysis team consulted and kept appraised throughout the entire reliability program process (see Figure 2-1), including corrective action and corrective action verification?

The team that evaluates the failure and the failure cause should continue to add technical insight to the reliability program process. When the failure and root cause analysis is completed, the team should review the proposed corrective actions with all appropriate personnel involved. Their recommendations should become part of the specific documentation and should, therefore,

be in a format that will permit their integration in those data. Any modifications implemented as a result of a root cause analysis should be referenced to the analysis in the documentation to facilitate its tracking.

The root cause should not be a substitute for maintenance management but should continue to follow analyzed problems until full resolution.

Any revised operating procedures resulting directly from the root cause analysis, or indirectly through equipment modifications, should be reviewed by the operating personnel before any subsequent operation of the diesel generator unit. This can also be facilitated by electronic data processing.

E.3 EXAMPLES OF FAILURE ANALYSIS

Following are three examples of analyses that are given to illustrate the many possibilities that may have to be investigated and how misleading some of the symptoms may be. This reinforces the need for a structured approach.

E.3.1 Example 1

Symptoms: The engine rolls over but fails to start.


The example assumes that the unit is equipped with an air starting system that injects high-pressure air into the engine cylinders.

The potential causes are illustrated in Figure E-2, which shows only a few levels of investigation ending with the identification of the proximate cause. When one or several of the causes listed are identified as contributing to the problem, the decision has to be made whether to do a root cause analysis, which may require continuing the investigation several levels below the proximate cause.

It is important not to stop as soon as the first abnormal condition is found, but to continue the analysis until every possible cause at that level has been investigated. In the example, the unit may be found to roll over slower than normal due to a faulty air starting system. However, even at the lower speed, it is possible that the unit would have started if all the other elements had been optimum. The other elements that were not optimum and this time contributed to a lesser degree to the failure to start may be the primary cause of the next failure to start, if no correction is made.

E.3.2 Example 2

Symptoms: Water leaking into the engine.
Cracked cylinder liners.
Scuffed pistons.

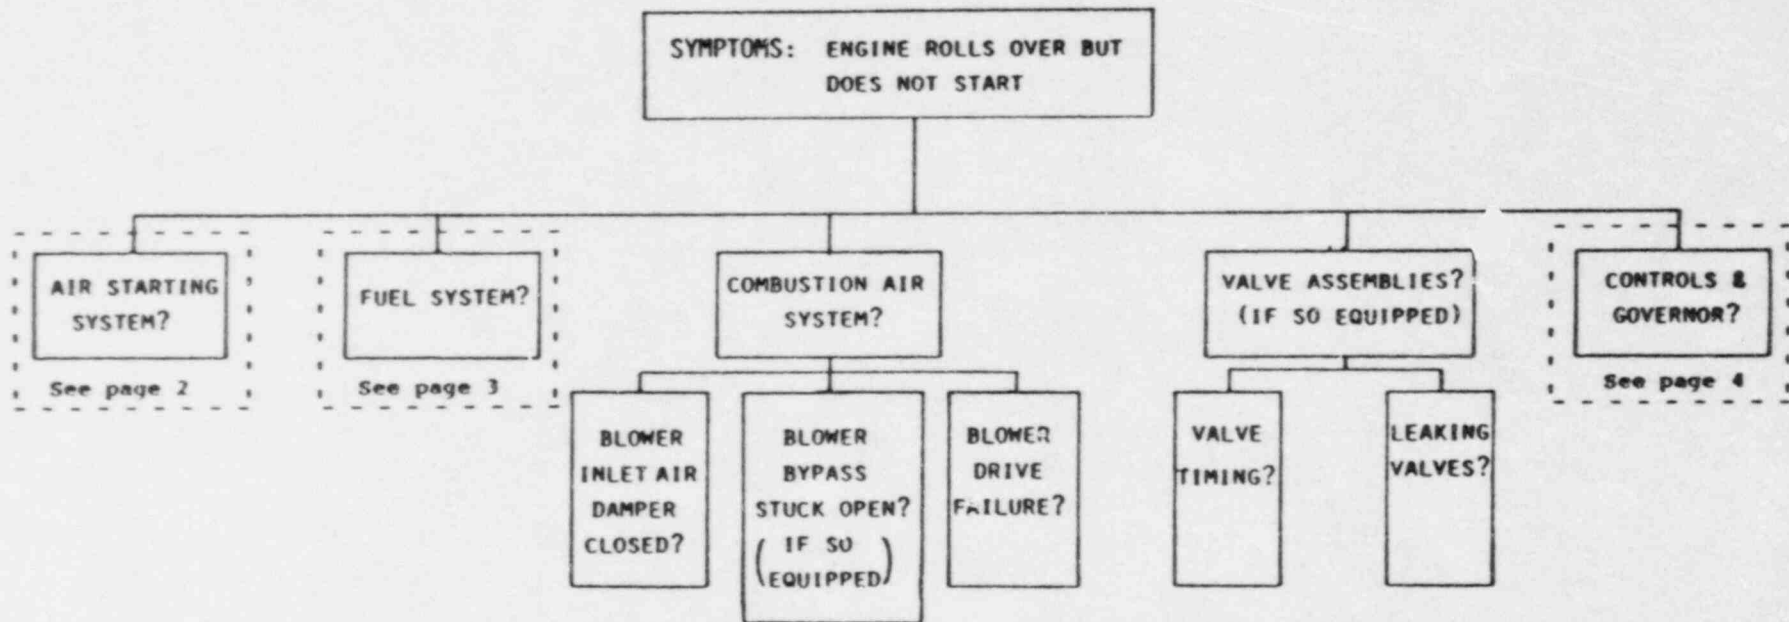

NOTE: WHEN ONE OR SEVERAL OF THE ITEMS SHOWN ON FIGURE E.2 (PAGES 1 THROUGH 4) ARE IDENTIFIED AS THE CAUSE OF THE FAILURE TO START, A DECISION MUST BE MADE WHETHER TO CONTINUE THE ANALYSIS DOWN TO THE ROOT(S).

FIGURE E-2. EXAMPLE 1

E-15

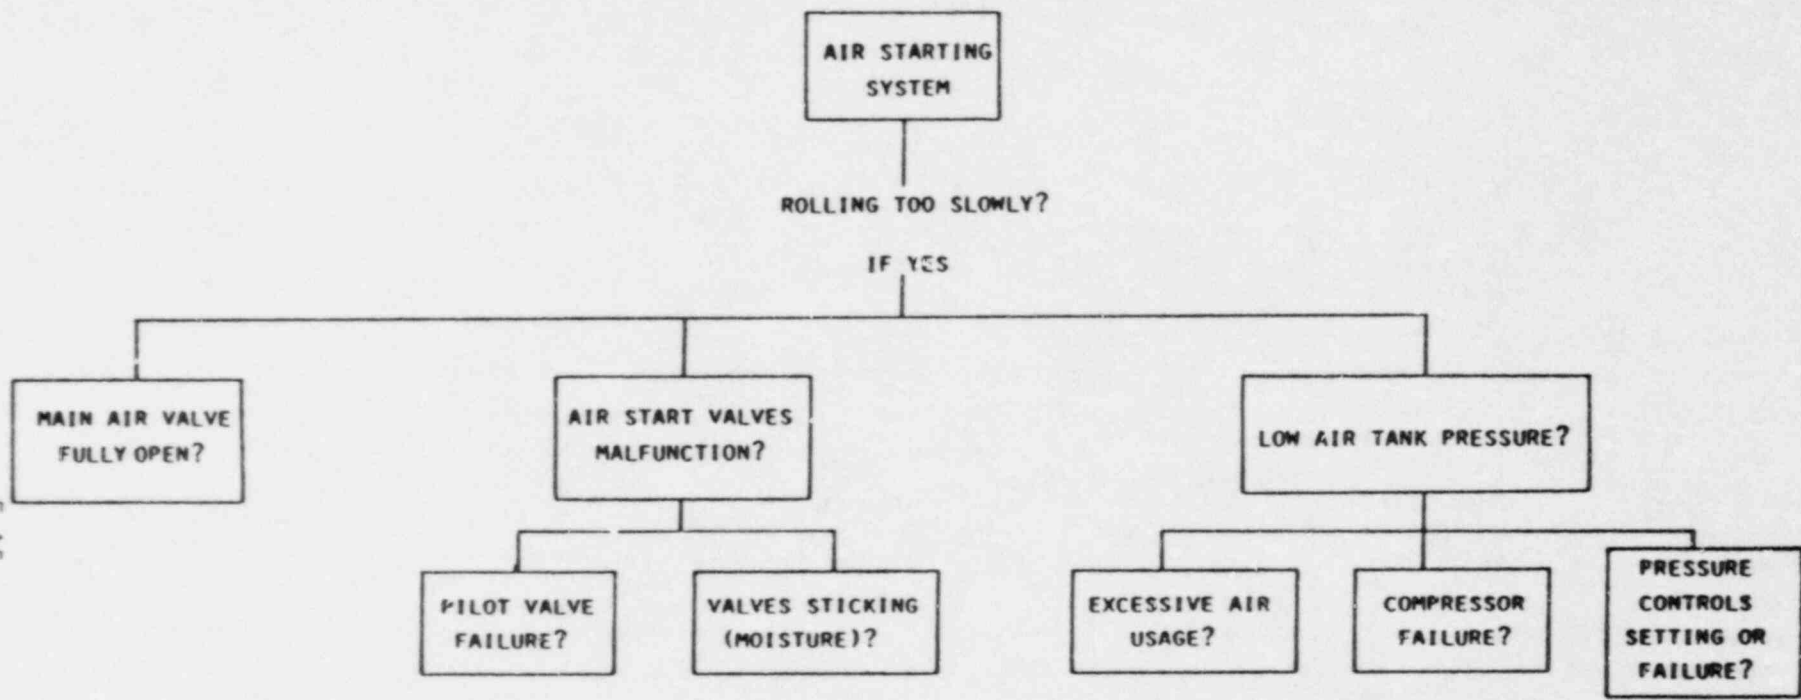


FIGURE E-2. EXAMPLE 1 (CONTINUED)

E-16

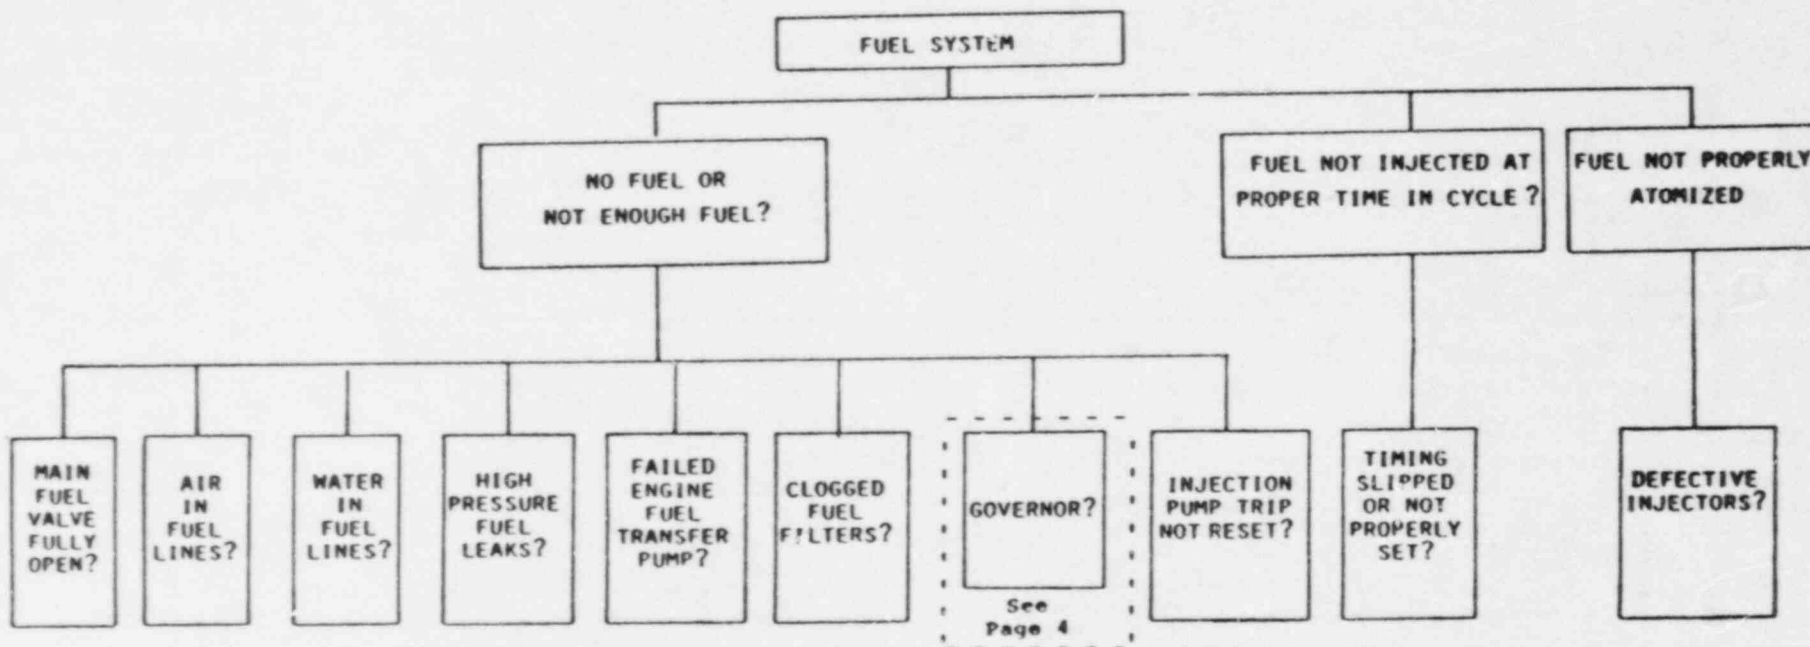


FIGURE E-2. EXAMPLE 1 (CONTINUED)

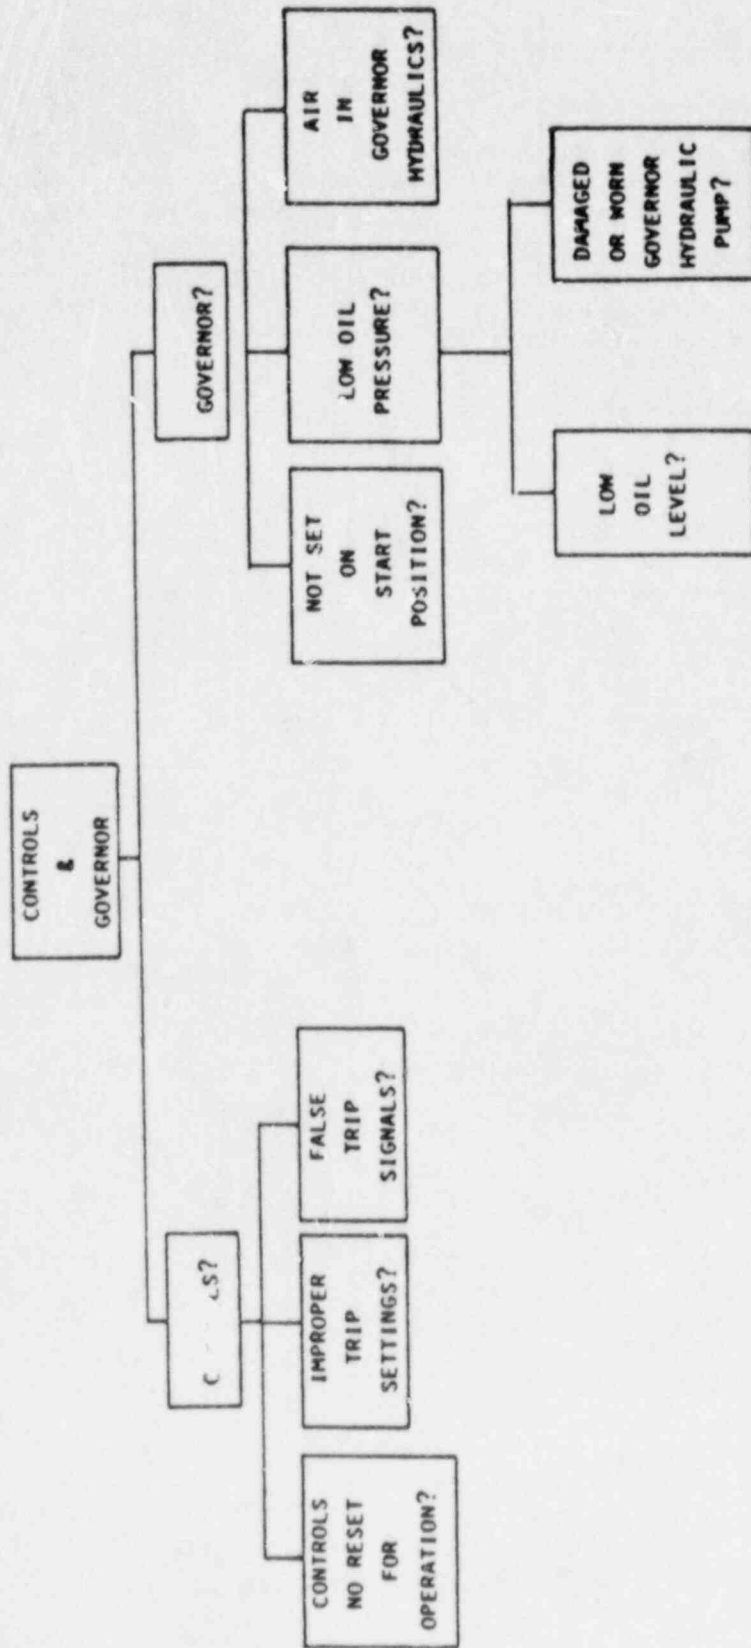


FIGURE E-2. EXAMPLE 1 (CONTINUED)

Three possibilities as to the initiation of the failure had to be analyzed: (1) cooling water leaking past seals that caused a degradation of the lube oil, (2) liners cracking due to defects in material or fabrication, or (3) pistons not round and being scuffed.

It could not be established that the leaks started prior to the scuffing. Further, some scuffing was found in cylinders where there was no leak. Also, some pistons were found in the very early stages of scuffing in cylinders where the liners were not cracked. In those pistons, it was found that the piston pin bushing had started elongating through extrusion. This elongation eventually caused the piston to go "out of round," which itself resulted in the scuffing of the piston. The friction against the cylinder liner, which increased with the scuffing, caused localized overheating that resulted in the cracking of that liner. The bushing degradation was the incipient underlying condition.

The decision was made to continue the analysis in an attempt to identify the root cause for the bushing extrusion. Since this did not appear to be a generic failure, improper design or material specifications were eliminated.

The following possible failure causes remain:

- Improper bushing manufacture. This could not be demonstrated.
- Engine overloading, which could result from reported instability in the governor system. This could not be demonstrated using the available data.
- Excessive cylinder peak firing pressure due to imbalance between the injection pumps. This was probably a contributing factor but not the primary factor. The pumps were adjusted.
- Improper lubrication. This appeared to be the best candidate. Further investigation revealed excessive foaming of the lube oil.

This example is further illustrated in Figure E-3.

Since this is a significant failure, a root cause investigation is warranted. Using improper lubrication as the proximate cause (per Figure E-1), the first step is to determine if it is a generic or specific cause. If the cause (a lubrication problem) was generic, another plant may have already identified and verified a cure. In this case, assume no generic information was discovered. The inability to discover a generic cause does not conclusively prove the problem to be unique. It only means that no record of or experience with the problem is readily accessible. Thus, the problem must be approached as specific in nature. The cause is unlikely to be related to maintenance or operations, so the investigation focused primarily on design issues. It was determined that there was incompatibility between the material of the bushing and additives in the oil. A different lube oil was recommended and was subsequently used in the unit.

Incidentally, the above is an excellent example of a problem that should be in a generic data base. The material incompatibility is likely to exist in many diesels. With this information, other diesel owners would know to

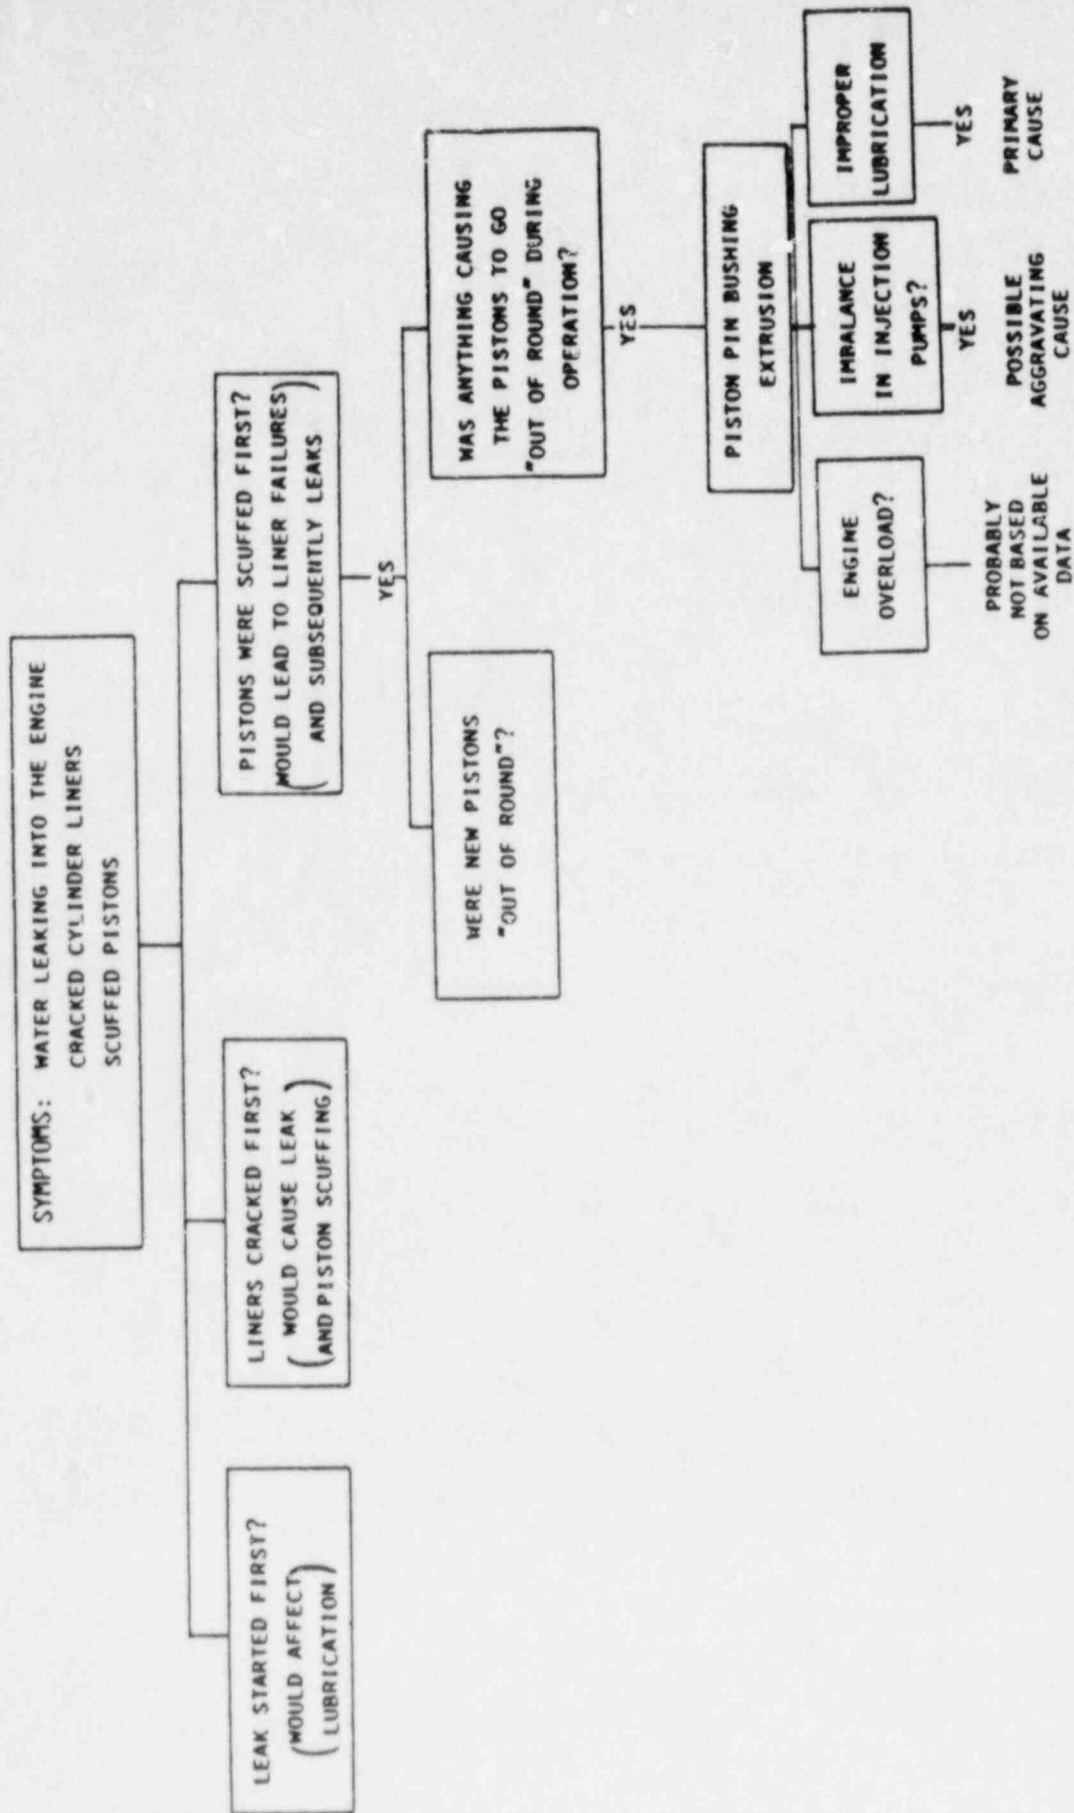


FIGURE E-3. EXAMPLE 2

switch lube oils and check the pistons and cylinder liners. A catastrophic failure and a time-consuming and expensive repair could be avoided.

E.3.3 Example 3

Symptoms: Gas pressure built up in the surge tank for the cooling system.

Gas samples were taken and analyzed. They contained a high concentration of carbon monoxide, which seemed to point to an exhaust gas leak. This could not, however, be demonstrated by hydrostatic testing of the engine itself.

Other parts of the cooling system were then included in the investigation, including the combustion air aftercooler loop. A review of the system indicated that, at some point, the cooling water pressure dropped below the air pressure in the heat exchanger. This could allow combustion air to enter the cooling water if there was a leak in the heat exchanger. With attention focused on the exchanger, a leak was found at the gasket that had either not been installed properly or was not under sufficient compression. The leak was in an area extremely difficult to inspect and would have been much harder to detect, were it not for the systematic approach used.

This leak could explain the pressure buildup in the cooling system surge tank but not the high concentration of carbon monoxide. The failure root cause investigation, therefore, turned to the combustion air system. It was found that the engine exhaust stack and the combustion air intake were close enough to explain the aspiration of exhaust gas.

This example is further illustrated in Figure E-4.

E.4 INTERFACES WITH OTHER REVIEW ITEMS

The root cause program interfaces with several of the other review items of the diesel generator reliability program.

Reliability Target (Review Item A)

The method used to calculate availability (described in Appendix A) includes both failures to start and run and downtimes for repair and test actions. A balance must, therefore, be struck between outage extensions that may be required to implement a root cause program and the risk of increased failures to start and run, or long outages following major catastrophic failures, if the root causes of too many problems remain undetermined.

Surveillance (Review Item B)

Elements of the surveillance program such as identification of critical failure modes or aging mechanisms can be used as inputs to the failure analysis program through the documentation suggested in this appendix. Conversely, the identification of the root cause of problems may require a modification of the surveillance plan.

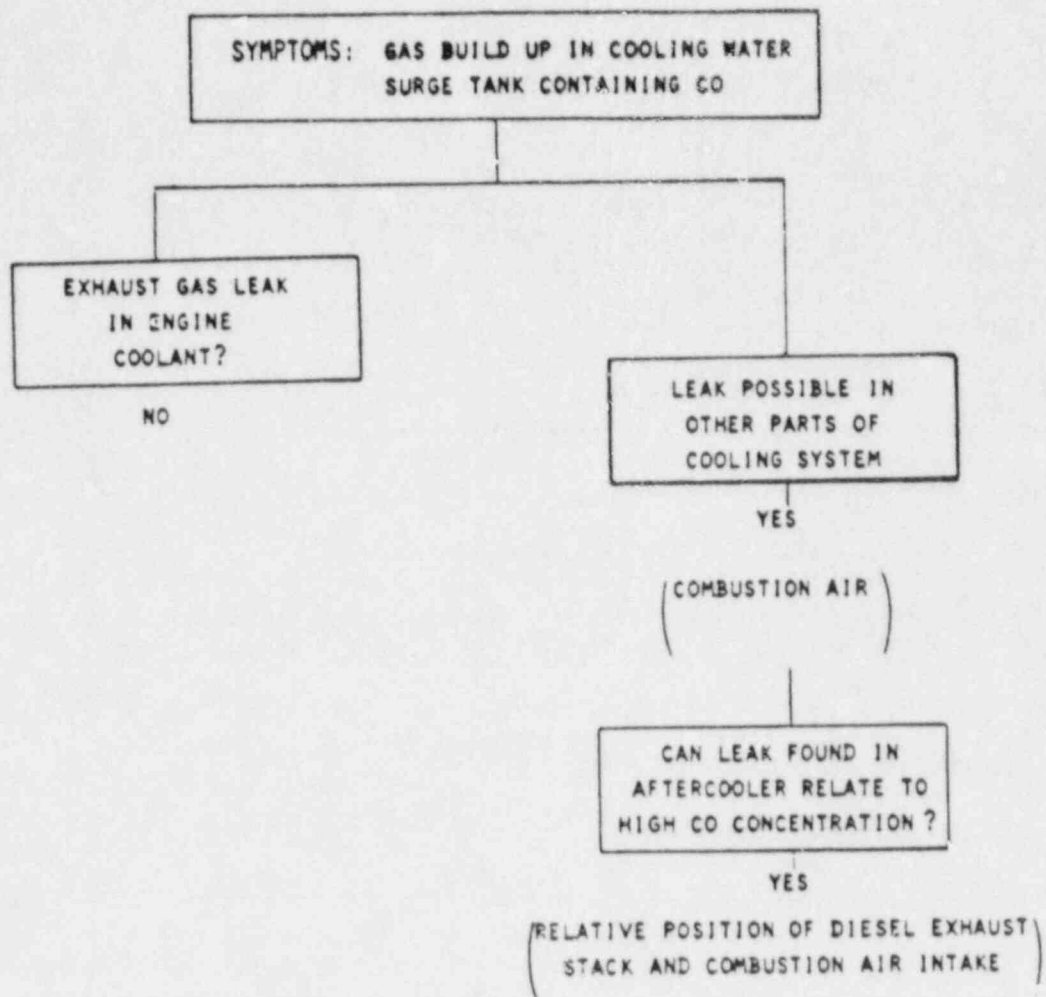


FIGURE E-4. EXAMPLE 3

Performance Monitoring (Review Item C)

The results of performance monitoring are one of the triggers of failure analyses. The monitoring data can also play a very important role in the root cause determination as detailed in Section E.2.

Maintenance (Review Item D)

It is stressed that much is to be gained from having designated members of the root cause analysis team independently observe all major maintenance operations, especially the disassembly of the units. This requires coordination with maintenance from a scheduling point of view. If the alternative solution of having the mechanics make and record the observations is selected, this must be made a part of the maintenance program. Accurate and complete records of all prior maintenance operations are often critical to a successful root cause analysis.

Problem Closeout (Review Item F)

The problem closeout procedure should include the suggested review by operating personnel of any new operating procedures, resulting directly from the root cause analysis or indirectly through equipment modifications. This review could be made jointly with members of the root cause team.

If the root cause was an improper maintenance procedure, both the original and revised procedures should be reviewed with all appropriate maintenance personnel, clearly identifying their differences.

Data System (Review Item G)

Appendix G, Section G.2, lists the elements that are necessary to a successful failure analysis. One of these is documentation of all prior failures of the same unit, preventive maintenance, and modifications. This is referred to as the specific documentation. To avoid duplication of efforts, the format used to record that information should be compatible with data collection for the other tasks. It must be emphasized, however, that the specific documentation for root cause analysis must remain available at all levels from management to the lead mechanic.

Responsibilities and Management Controls (Review Item H)

Management should retain the responsibility for deciding to what level the failure analyses should be carried.

APPENDIX F
PROBLEM CLOSEOUT
(Review Item F)

TABLE OF CONTENTS

	<u>Page</u>
F.1 INTRODUCTION	F-5
F.2 ISSUES TO CONSIDER WHEN REVIEWING PROBLEM CLOSEOUT PROCEDURES	F-5
F.3 INTERACTIONS WITH OTHER REVIEW ITEMS	F-7

F.1 INTRODUCTION

The purpose of formal problem closeout procedures is to ensure in a timely way that effective solutions to detected EDG reliability problems have been devised and implemented. An effective solution is one that corrects the observed EDG reliability problem and does not create any other reliability or performance problems that are as bad as, or worse than, the corrected problem. Often measurements can be taken that are not part of the normal, established performance monitoring procedure but will provide assurance that the implemented corrective action is effective. The problem closeout review item must ensure that consideration is given in the EDG reliability program to providing for any additional monitoring or surveillance that would expedite the assessment of corrective action effectiveness.

Two elements are necessary for an effective problem closeout procedure:

- The problem closeout procedure should provide for the establishment of specific, numerically-based criteria that have to be met before the detected reliability problem will be considered to be corrected. The actual criteria should be based on the nature of the reliability problem and cannot be specified before hand.
- The problem closeout procedure should provide for any additional monitoring activity that might be necessary to provide a timely judgment concerning the effectiveness of the corrective action. Again, the additional monitoring used, if any, should be based on the characteristics of the detected problem and cannot be specific beforehand.

An example of a numerically-based closeout criterion is: "No failures, including incipient failures, attributable to the detected failure cause for a period of ___ months." Another example, applicable to a single demand test, is: "Oil pressure levels out at ___ psi by 15 minutes after diesel generator start and does not increase thereafter during a 4-hour run of the diesel generator." Examples of special monitoring for problem closeout could be, for the first example above, any special surveillance that might be required to ensure that incipient failures due to the corrected cause do not appear; and for the second example above, continuous monitoring of the oil pressure during the 4-hour run. The closeout criteria must be specified before the trial period during which the corrective action effectiveness is being assessed.

Review of a reliability program for EDGs should verify that there is an element of the program that deals specifically with problem closeout procedures. Section F.2 specifies specific issues that should be dealt with under Review Item F. Section F.3 discusses the interfaces that should be considered when reviewing the problem closeout item of a diesel generator reliability program and reviews other facets of the program.

F.2 ISSUES TO CONSIDER WHEN REVIEWING PROBLEM CLOSEOUT PROCEDURES

The specific issues that must be addressed when reviewing the problem closeout element of an EDG reliability program are presented in this section.

Does the EDG reliability program specifically address the problem closeout portion of the reliability program?

For an EDG reliability program to be complete, there must be a formal problem closeout element of the program. The characteristics of the problem closeout procedure must be addressed explicitly in the documentation describing the program. This documentation must address at least the issues presented below as additional questions.

Does the reliability program documentation specify a procedure for setting criteria for problem closeout based on the results of the failure analysis or root cause investigation?

Criteria for problem closeout must specify required measurements or observations for closeout, which may or may not be in addition to surveillance routinely performed on the EDG and must specify an outcome from these measurements that define minimum conditions for success. Also specified must be the length of time or number of cycles over which these measurements must be taken and for which the minimum conditions for success apply. The nature of the closeout criteria is that they specify engineering or performance results that should be observed if the corrective action is to be judged effective. The criteria that are appropriate will depend on the nature of the reliability problem corrected and thus cannot be specified beforehand. Also, criteria that are too rigid or that are too extensive may divert resources away from more risky problems and are therefore as undesirable as criteria that are too lax, or no criteria. The discussion of the criteria in the EDG reliability program documentation should reflect this balance. The discussion should also present a credible procedure for developing the criteria.

Does the EDG reliability program specify credible formal closeout procedures?

Options for instituting formal problem closeout procedures include: (1) documentation of specified aspects of the problem closeout, including results of surveillance and monitoring related to the subject problem, and (2) a review committee to review any or all aspects of the problem closeout. A combination of the above could also be used. Again, the closeout procedures must be credible in the sense that they specify appropriate resources to be expended to ensure the timely correction of the problem. The reliability program documentation must reflect the dependence of the resources required for problem closeout on the severity of the reliability problem.

Does the reliability program documentation exhibit an understanding of the types of special monitoring that could be used during the period when the effectiveness of corrective actions is being assessed?

The reliability program documentation must contain a discussion of the surveillance and monitoring that could be used to verify corrective action effectiveness. This discussion must include an indication of how the length of the trial period during which the assessment will be conducted is to be established. One option is to base the length of the trial period on the expected return-time for the problem if the problem had not been corrected.

F.3 INTERACTIONS WITH OTHER REVIEW ITEMS

The problem closeout review item must be coordinated with Review Item G, "Data System," to ensure that the proposed EDG data system has the capability of supporting any additional monitoring requirements conceived of for problem closeout. Thus, the data system should be capable of storing in a retrievable way information generated over the problem closeout period, even if this information is taken at a different rate or is different information from that which is normally taken and stored.

The problem closeout review item must also be coordinated with the review conducted to ensure adequate management of the EDG reliability program (Review Item H, "Reliability Program Management and Responsibilities") if the closeout procedures are to involve a problem closeout committee. This problem closeout committee will be part of the management team for the reliability program. Assurance must be obtained that the committee members have adequate background and authority to act in this capacity.

APPENDIX G
DATA SYSTEM
(Review Item G)

TABLE OF CONTENTS

	<u>Page</u>
G.1 INTRODUCTION	G-5
G.2 ISSUES THAT MUST BE ADDRESSED WHEN REVIEWING AN EDG DATA SYSTEM	G-5
G.3 INTERACTIONS WITH OTHER REVIEW ITEMS	G-10
REFERENCE FOR APPENDIX G	G-12

G.1 INTRODUCTION

The objective of this appendix is to identify review issues for the data elements that are necessary to support the EDG reliability program and for the system by which these elements will be collected and stored. A definitive and aggregate set of information is required to properly address the reliability and availability issues associated with the reliability program. The data set must support the assessment of the specified goals and targets. The data set must also support the combined elements of the reliability program. Operating hours, number of demands, number of catastrophic failures, outage times, repair times, and other necessary information to achieve the requirements of all the review items are included in this appendix.

Data storage and retrieval may be performed on a computer or may be performed manually. In either case an organized system must be available or be developed. This may be accomplished in several ways, for example, by using a capable, readily available data base management system on a computer or by setting up and maintaining an adequate file system for manual data storage and retrieval.

It is not necessary to duplicate and store all information in one specified location. However, all information (i.e., maintenance work orders, completed test procedures, vendor manuals, etc.) should be stored in a systematic and easily accessible method. For example, vendor material and test procedures may easily be obtained in a well-organized plant library, while copies of completed test procedures may be available in a well-organized plant document room.

The data storage and retrieval process should be documented and procedures developed to ensure compliance with and support of the reliability program.

It is not the intention of this appendix to require the reconstruction of failure, maintenance, and operating information related to the EDG prior to the establishment of the reliability program.

G.2 ISSUES THAT MUST BE ADDRESSED WHEN REVIEWING AN EDG DATA SYSTEM

The specific issues that must be addressed when reviewing the data system of an EDG reliability program are presented in this section.

Is the EDG reliability program information and data administered properly and in a manner supportive to the other program elements?

The failure data, outage data, and operating history data are required to estimate the EDG performance as described in Appendix A. For this reason, it is necessary to provide a secure, designated location for these data in order that the required calculations can be performed and updated on a timely basis. An appropriate plant individual or plant group should be designated as responsible to perform all data storage and retrieval tasks. This data custodian will be responsible for issuing the required reports and for maintaining the EDG data set. A procedure should

be developed to ensure that all required information is received by the data custodian in a timely manner, recognizing that completeness of the data is an important consideration. Also any changes to documents or components directly affecting the EDG, such as procedures, test frequency, or modifications to the design of the EDG, will be required to be reviewed by the data custodian in a timely manner to allow for a determination of any changes to the reporting requirements. Changes may affect items such as failure rate or reliability calculations, the determination of a proper failure severity, or a change in the original boundary. The data custodian should also review all failure and maintenance reports to check for both accuracy and completeness. The data custodian should document all changes and corrections to the reports and provide feedback to the training process, described below, in an effort to improve the information that is vital to the reliability program.

Does the failure reporting portion of the data system contain information of adequate scope and depth to support reliability calculations (Appendix A) and performance monitoring (Appendix C)?

Failure reporting consists of describing the events leading up to and occurring during the failure process. Failure reports are necessary to calculate the reliability level of the EDG as described in Appendix A. This may be accomplished on a properly structured work authorization form, or a separate failure report form may be developed. The information in a failure report form should be documented as the information becomes available and not reconstructed after the fact. The failure report should include as a minimum the data elements listed below:

Originator: The person discovering the failure.

Department/Organization: The plant department or organization of the originator.

Unique Document Identifier: A unique identifier to allow for tracking of the document. This may be a job order number or work authorization number.

Component Identification: The unique identifier for the component or piecepart as applicable. This identifier can be related to the manufacturer, model number, and other engineering and spare parts data.

Component Type: A description of the component, e.g., valve, pump, relay, etc. The diesel generator is somewhat unique in the sense that the names of certain pieceparts may be confusing such as "valve." A method should be established to prevent such items as intake and exhaust valves from being confused with motor-operated and check valves.

Equipment Location: Location of the failed equipment.

Status of Component: The status of the component at the time of failure (i.e., operating, in test, etc.).

Condition of Parts or Materials Removed: Technicians on-scene appraisal of any parts (e.g., covers or nearby pieceparts) or materials (e.g., lube oil drained).

Plant Status: The status of the plant at the time of component failure.

System/Subsystem: The EDG system and/or subsystem of which the component is a part.

System/Subsystem Status: The status of the system or subsystem at the time of the component failure.

Discovery Date:

Discovery Time:

Date of Failure: May be different from discovery date, if known.

Time of failure: If known.

Failure Severity: Catastrophic/Immediate, Degraded or Incipient, using definitions similar to those in IEEE Std 500-1984 (Ref. G-1). Failure severity is important at three levels:

Piecepart Failure Severity:

EDG Subsystem Failure Severity:

EDG Failure Severity:

Time and Date of Repair Initiation: The time and date repair actions commenced.

Time and Date of Repair Completion: The time and date the repair was successfully completed.

System Effect: The effect, if any, that the component failure had on the system.

Plant Effect: The effect, if any, that the component failure had on plant operations.

Detailed Failure Description: This should describe all events leading up to and during the failure process. This should include procedures, tests, test equipment, all instrument readings that were taken, pieceparts involved, a description of the evolution taking place, anything that may have been seen, heard, smelled, or felt that may be important in determining the root cause. The

cause of the failure if known. Any supporting documentation should be attached to this form.

Corrective Action Taken: This must contain enough information to reconstruct exactly what corrective action occurred. An entry such as "rebuilt" is not adequate. An entry such as "rebuilt in accordance with Section 4.2.7 of Tech Manual" would be appropriate. A description of the process of rebuilding the failed component would also be acceptable.

Spare Parts Used: Either list the spare parts used or attach the spare part ordering documentation.

Postmaintenance Retest Performed: The retests performed to verify component or system operability and test results.

The plant personnel (operators, maintenance technicians, engineering staff, etc.) who gather the failure information should be trained to properly fill out the forms. The failure report should reference all procedures, instructions, and personnel involved and should include any information that may aid in the failure analysis.

A method should be developed to ensure that all components reflected in the boundary, as described in Appendix B, are appropriately reviewed for reliability concerns affecting the EDG. Example methods include a list of all components determined to be within the EDG boundary or a special set of piping and instrumentation diagrams (P&IDs) and electrical schematics denoting the developed EDG boundary.

Most of the information described above is available via the NPRDS Failure Reporting System. However, since the NPRDS failure reports do not include all the above information, the NPRDS failure reports, in and by themselves, are not considered adequate to support the EDG reliability program.

Does the operating history portion of the data system contain information of adequate scope and depth to support reliability calculations (Appendix A) and performance monitoring (Appendix C)?

A comprehensive operating history of the plant and of the EDG are required to be established. This should include, but should not be limited to, the following:

Demand Information

The date and time of each EDG start attempt. The reason for starting the EDG (i.e., test, tech spec requirement, challenge, etc.) and whether or not the attempt to start the EDG was successful or unsuccessful.

Operating Information

The length of time the EDG operated for each successful start. The operating parameters, if available, such as lube oil pressure and temperature, generator voltage and frequency, water temperature, etc.

Test Information

This consists of the test frequency, test interval, and test duration for each EDG test and the reason the specific test was performed. All documentation should be available to support this information.

Operating Characteristics

Operating characteristics should be developed for all components within the EDG boundary. This includes operating parameters for the components and information to determine reliability and availability of components, such as starting air compressor cycle and operating times, diesel subsystem status, and parameters checked or tested on a routine schedule.

Plant Operating History

A plant operating history should be developed and used by the data custodian to help determine the EDG operating frequencies and to aid in verifying the accuracy of the submitted reports.

Maintenance History

A complete maintenance history of all components included in the EDG boundary should be developed and maintained. The maintenance history should be developed to support the EDG reliability program requirements, especially the requirements of the EDG performance tracking task. A list of all corrective and preventive maintenances and of all piecepart and component replacements should be included in the maintenance history.

Does the information base support reliability program activities, especially the root cause investigations suggested in Appendix E?

A set of documents generated external to the plant is necessary to provide assurance that problems experienced by owners of similar EDGs are not experienced. Technically qualified participants in the reliability program should have regular access to information such as NPRDS records, Part 21 reports, 50.55(e) reports, LERs, and other pertinent information from consultants and vendors.

Other documents required in support of the EDG reliability program include:

- Associated portions of the Technical Specifications.
- Associated P&IDs and electrical diagrams.
- Vendor manuals associated with the EDG, including all vendor reports and updates.
- Set of surveillance and test procedures and requirements.
- Set of EDG operating procedures.
- Set of Emergency Instructions associated with the EDG.
- The EDG design specifications and requirements.
- Recommended and implemented modifications (per vendor notices, NRC bulletins, etc.).

G.3 INTERACTIONS WITH OTHER REVIEW ITEMS

The EDG data system must have the capacity and flexibility to support all the elements of the EDG reliability program that require historical performance data for their successful implementation. Specifically, the performance monitoring, performance evaluation, root cause, maintenance, and problem closeout all have a need for historical performance data. Therefore, the other review items that must be considered when reviewing the adequacy of the EDG data system are:

- Evaluation of the EDG reliability target.
- EDG surveillance needs.
- EDG performance monitoring.
- EDG maintenance program.
- EDG failure analysis and root cause investigation.
- Problem closeout.
- Responsibilities and management involvement.

Thus, there is a need to review the data system in light of the EDG reliability program needs and characteristics discussed in each of the other review items.

The EDG data system is the primary repository for the information required by the NRC to evaluate EDG performance. Therefore, all information identified in Review Item A as necessary to evaluate EDG performance must be collected and stored by this system. The EDG documentation describing the proposed reliability program must identify this information explicitly and present a plausible description of the techniques to be used to collect and store it.

Review Items B, C, D, and E (surveillance needs, performance monitoring, maintenance program, and failure and root cause analysis) all require historical data for their successful implementation, operation, or adaptation to changing reliability characteristics. This information could be unique for each EDG reliability program and therefore cannot be specified in advance. Each submittal must be reviewed to ensure that the data system is capable of supporting the data needs of these other reliability program features.

Review of problem closeout procedures (Review Item F) may indicate that special monitoring techniques will be used for problem closeout. The review of the data system must verify that the data system is flexible enough to accommodate these special monitoring schemes.

Finally, the data system must be managed to ensure that all the above needs are accommodated. Review of the EDG reliability program management considerations must ensure that they include day-to-day management of the data system with qualified personnel assigned to manage and operate the system.

REFERENCE FOR APPENDIX G

- G-1. Institute of Electrical and Electronic Engineers, Inc., "IEEE Guide to the Collection of Electrical, Electronic, Sensing Component and Mechanical Equipment Reliability Data for Nuclear Power Generating Stations," IEEE Standard 500-1984, December 1983.

APPENDIX H
RESPONSIBILITIES AND MANAGEMENT CONTROLS
(Review Item H)

TABLE OF CONTENTS

	<u>Page</u>
H.1 INTRODUCTION	H-5
H.2 ISSUES TO CONSIDER WHEN REVIEWING MANAGEMENT CONTROLS	H-5
H.3 INTERACTIONS WITH OTHER REVIEW ITEMS	H-8

H.1 INTRODUCTION

The purpose of this review item is to ensure that the management controls under which the EDG reliability program will be operated are adequate and that individual responsibilities for operating the program have been clearly defined.

A diesel generator reliability program is a management system for managing diesel generator reliability. The rules and procedures that flow from the management system are all based on a consistent philosophy, which states that a specified reliability target can be achieved by understanding the factors that drive a diesel generator's reliability and then applying reliability and engineering techniques in sufficient depth to ensure that the target is reached.

Management reviews and controls are necessary to ensure that the EDG reliability program results in achieving the reliability target for the diesel generators. Also, responsible individuals for implementing and operating the reliability program must be identified. These individuals must be qualified or suitably trained to carry out their assigned responsibilities. Achievement of the EDG reliability target depends on there being adequate management review and controls of the reliability program, as well as qualified individuals responsible for implementing and operating the program who have the authority to manage the program to achieve the target. Even though consultants and vendors may assist the utility in implementing the EDG reliability program, the plant management retains the ultimate responsibility and is the key to the program's success.

Section H.2 presents issues that must be addressed when reviewing the proposed management plans for EDG reliability programs. Section H.3 discusses the need to coordinate review of the reliability program management with review of other items of importance to maintaining the EDG reliability target.

H.2 ISSUES TO CONSIDER WHEN REVIEWING MANAGEMENT CONTROLS

The specific issues that must be addressed when reviewing the management plan and assignment of responsibilities for an EDG reliability program are presented in this section.

Are there management procedures for reviewing and verifying that the EDGs are meeting the reliability target?

The review conducted under this review item should verify that procedures are in place to regularly assess whether or not the EDG reliability target is being met. These procedures should provide the schedule for this assessment and identify responsibility for its completion. They should identify the computational techniques that will be used, including the data to be used for the assessment.

Does the plant management periodically perform detailed reviews of the EDG reliability program?

in addition to frequent reviews to ensure that reliability targets are being met, detailed programmatic reviews should periodically be performed. These reviews should be performed by a team independent from the EDG reliability program and the day-to-day operation and maintenance of the EDGs. The emphasis of this review process is to ensure that the reliability program is operating in the closed loop process described in Section 2. The team should perform a technical review designed to ensure that problems are being detected and analyzed and, most importantly, corrected and closed out.

Does the implementation and operation of the EDG reliability program have the unequivocal support of plant management?

Probably the single most important factor that will determine the ultimate success or failure of the EDG reliability program is the degree of commitment to the program by the top plant management. Indications of management commitment can be obtained from: (1) assessment of whether or not the projected resources allocated to implementation and operation of the program are adequate; (2) assessment of how high in the organization relatively detailed knowledge of the program exists (at a minimum, all operators and supervisors responsible for plant operations and maintenance should have detailed knowledge of the program); (3) assessment of the ability and readiness of line maintenance and operations personnel to describe advantages of the program; and (4) assessment of the qualifications of the personnel assigned to manage and operate the program (other than personnel performing routine operation that would be performed even if the program did not exist).

If the program is to be newly set up or newly modified, are there clear procedures and policies available that treat the program implementation phase?

There is expected to be a transition phase for a newly established EDG reliability program or one that is newly modified to conform to the guidelines herein presented. It is a management function to ensure that the transition between no program, or incomplete program, and an adequate reliability program, is as smooth as possible. For instance, transition between use of prescriptive technical specification restrictions on EDG (before implementation of the program) and performance-based indicators (after implementation of the program) will require an evaluation of the performance-based indicators to ensure that they are adequate to meet the EDG reliability target. Managing the transition requires treatment of it in a plan and then implementing the plan. The review of the EDG reliability program management plan should include verification that this problem has been recognized and that there is a plan to manage the transition period.

Is there an individual with responsibility at the plant management level that is dedicated to implementation and use of a

reliability program for diesel generators, and is this individual responsible for implementing, operating, and, if required, altering the program?

The licensee should give a technically qualified individual adequate authority to run the EDG reliability program. If the EDG reliability program has an influential "champion" that is in charge of implementing, operating, and, if required, altering the program, there is an added measure of confidence that the program will continue to be successful.

Do the personnel assigned to manage and operate the program have a credible mix of qualifications that are required for such a program?

The mix of qualifications necessary to successfully manage and run the EDG reliability program includes maintenance and diesel operations, diesel generator engineering design, engineering root cause investigation, and reliability assessment methods. The review must identify where each of these qualifications will come from and if authority over use of these resources resides with the personnel managing the EDG reliability program.

What is the relationship of management of the EDG reliability program to top level plant management and to management of other functions in the plant?

Plant management at the top level and managers of other plant functions must recognize the reliability program as the vehicle for achieving the EDG reliability target. The review conducted under this review item must verify that this relationship among plant management functions exists. An EDG reliability program could conceivably function correctly as either a program managed by line management or as a program managed by staff. However, the program will not work if it is conceived of as simply an add-on to current surveillance and maintenance practices (i.e., entirely as a staff function). The EDG reliability program should replace current surveillance and maintenance practices. This is not to imply that the current practices (e.g., monthly testing and approaches to failure cause and root cause analysis) will not be adopted as part of the reliability program. To the extent that they provide a reliability focus to surveillance and maintenance, they will remain as part of the reliability program. Thus, the program must be integrated into everyday plant operations.

Is there an identified mechanism for altering the EDG reliability program if this becomes necessary or cost effective?

The EDG reliability program focuses surveillance and maintenance of the EDG according to the reliability of the equipment. Thus, management of the program must allow for the periodic reassessment of whether the current program is appropriate to achieving the EDG reliability target. Surveillance and

maintenance activities should be somewhat flexible in that more or less may be needed, depending on the mechanisms that are driving the reliability. It is a management function to ensure periodic reviews of the programs' applicability. The review conducted under this review item should ascertain what management controls are in place to ensure that the reliability program will be focused by periodic assessments of the EDG reliability characteristics.

H.3 INTERACTIONS WITH OTHER REVIEW ITEMS

Review of the proposed management of the EDG reliability program should be coordinated with review of every other item. The success of the reliability program depends on the support of plant management and the skills of the personnel operating the program. If the program exists on paper but is never implemented, or is implemented and then abandoned or de-emphasized, the EDG reliability target will not be met in the long run. Improper attention to the EDG reliability program by the plant will eventually become known to the NRC through the long-term trends in the EDG reliability estimate (as described in Appendix A).

The review of the proposed management of the reliability program should be coordinated with review of analysis of EDG surveillance needs (Review Item B) to ensure that there are assigned responsibilities for determining the EDG surveillance needs and preparing the surveillance plan as part of implementing the program. The coordinated review should also ensure that the individuals assigned responsibility for this task have the proper qualifications.

The review should be coordinated with review of the licensees' proposed EDG performance monitoring scheme (Review Item C) to ensure that performance monitoring is intended by the licensee to be a continuing process and to ensure that management control mechanisms will allow this process to adapt to the changing reliability needs of the EDG.

The review should be coordinated with Review Items D and E (maintenance and failure analysis and root cause investigation) to ensure that qualified personnel will be assigned to handle these responsibilities.

The review should be coordinated with review of problem closeout procedures (Review Item F) to ensure that there are adequate procedures and management controls for problem closeout.

The review should be coordinated with review of procedures for storing and retrieving the data necessary for operation of the reliability program (Review Item G) to ensure that management controls are adequate for the continued operation of this critical function, to ensure that all necessary or potentially necessary data have been considered as candidates for the data base, and to ensure that qualified personnel will be charged with the data input duty.

APPENDIX I
EMERGENCY DIESEL GENERATOR DATA REVIEW

TABLE OF CONTENTS

	<u>Page</u>
I.1 INTRODUCTION	I-5
I.2 HISTORIC EDG PROBLEMS	I-5
I.2.1 Insights from NUREG/CR-4590 Data	I-6
I.2.2 Insights from a Collection of NPRDS Data	I-14
I.3 INTERFACES WITH OTHER EDG RELIABILITY REVIEW ITEMS	I-16
I.4 EMERGENCY DIESEL GENERATOR DATA BIBLIOGRAPHY	I-17

LIST OF TABLES

Tables

I-1 Subsystem Failures by Diesel Generator Manufacturer	I-7
I-2 A Ranking of Diesel Generator Subsystem Failure Occurrences	I-8
I-3 Diesel Generator Failures by Components	I-12
I-4 Critical Component Ranking for Each EDG Manufacturer	I-13
I-5 NPRDS-Derived EDG Insights	I-15

1.1 INTRODUCTION

The major objective of this appendix is to summarize historical diesel generator problems and to categorize these problems by subsystem and component. While analyzing historical problems, useful data sources will be identified and examples of how historical information can be used to supplement a reliability program will be provided. Although knowledge about the EDG at one's own plant is essential in order to administer a reliability program, a great deal can be learned by studying problems occurring at other plants. EDG equipment failure data have been collected and studied frequently, and all data collections and analyses have potential uses.

Historical diesel generator data give a good idea as to which subsystems and which components are likely to cause the most diesel generator failures. The list of critical components and subsystems varies between diesel generators but can generally be predicted for each diesel generator manufacturer. The list of problems that must be emphasized will be revised as the plant's reliability program proceeds, but this appendix can provide a useful starting point. Once the likely and potentially important problems are identified, preventive maintenance and surveillance policies can be focused. NUREG/CR-4590 and the Nuclear Plant Reliability Data System (NPRDS) (see bibliography in Section I.4) were chosen for this study. Other references, such as vendor records and LERs, are suitable for similar studies.

Section I.2 examines historical diesel generator problems from several perspectives. This section provides the user with a generic prioritization list for critical components and subsystems. If plant-specific historical information is not available, these lists can be used in setting up an EDG reliability program. Section I.3 examines the interfaces between historical information and the review items of the EDG reliability program. Section I.4 discusses the data sources used in this study.

1.2 HISTORIC EDG PROBLEMS

Two major sources were used to gain an understanding of what diesel generator problems are occurring in the industry. NUREG/CR-4590 contains an extensive data base of diesel generator failures that are categorized in several ways. The NPRDS data storage system contains a large amount of raw data that can be processed. Unfortunately, neither data source contains adequate information to accurately estimate the number of demands on diesel generators or groups of diesel generators, so no failure rate calculation can be correlated to failure causes and modes. The data tables in this appendix are arranged by diesel manufacturer. Since the number of diesels made by each manufacturer varies greatly, the actual number of diesel failures for any manufacturer means little in itself and can be misleading (for example, since there are more GM diesels than any other type, in most cases the GM diesels have experienced more failures, even when that failure category is of relatively low importance to the overall performance of GM diesels). No conclusions should be made as to the relative reliability level of the various EDGs, but insights can be derived for identifying the types of problems that can be expected to occur in the various types of EDGs.

I.2.1 Insights From NUREG/CR-4590 Data

The authors of NUREG/CR-4590 assembled a data base in order to study aging of diesel generators. The data base consists of 500 randomly selected failure records from each of the following sources:

- Licensee Event Reports (LERs)
- Nuclear Plant Reliability Data System (NPRDS)
- Nuclear Plant Experience (NPE)
- Transamerican Delavel, Inc. (TDI) Owners Group

The randomly selected failures occurred between 1965 and 1984, but most actually occurred in the later 1970's and 1980's. Relatively few plants were in service prior to 1975, and the data collection at those plants was sparse. Although failure causes were divided into those caused by aging and those not caused by aging rather than being categorized by more conventional severity and cause breakdowns, there were several breakdowns useful for this study. The breakdowns by subsystem, component, and diesel generator manufacturer provide some historical evidence as to the best areas for a reliability program to focus.

Table I-1 contains the failure data from NUREG/CR-4590 categorized by subsystem and diesel manufacturer. The severity of failures cannot be gleaned from the information sources, but since the four information sources only contain catastrophic and significant noncatastrophic failures (by varying definitions), the failures should illustrate the types of failures that a reliability program should address.

Table I-2 provides an alternative display of the data from Table I-1. For each manufacturer, the highest number of failures was ranked as 1, second highest was ranked as 2, etc. The few ties that occurred were ranked according to the analysts estimation of the severity associated with failures in those subsystems. For each manufacturer, the ranking was terminated at the level where there were too few failures to tell the difference. The "overall rank" column was obtained by ranking the sums of failures listed in Table I-1. Engineering insight can be gained from Table I-2, but further discussion of the nature of component failures is warranted. The following is a discussion of significant reliability insights, by diesel generator subsystem, starting with the subsystem with the most failures. The qualitative comments generally are based on the more detailed breakdowns of component failures and subsystems found in NUREG/CR-4590.

Instruments and Controls (I&C)

The number of reported I&C failures was clearly larger than any other single type of failure. The I&C failures appear to be about equally significant for each of the diesel generator manufacturers, which can be expected since the I&C system design varies from plant to plant, but not much from manufacturer to manufacturer. The reason for the large number of failures is the catchall nature of this category. The governor subsystem dominates the category, followed by startup-related I&C. The subsystem breakdown recommended for a diesel generator reliability

TABLE I-1.
SUBSYSTEM FAILURES BY DIESEL GENERATOR MANUFACTURER
(NUREG/CR-4590 Data)

<u>SUBSYSTEM</u>	<u>ALCO</u>	<u>ALCH</u>	<u>CAT</u>	<u>CB</u>	<u>GM</u>	<u>FM</u>	<u>NBG</u>	<u>TDI</u>	<u>WOR</u>	<u>TOTAL</u>
Engine Structure	2	0	0	12	13	55	3	11	3	100
Drive Train	3	0	0	10	5	18	2	11	0	51
Valve Mechanism	3	0	0	7	2	1	2	3	0	18
Starting	9	0	1	16	95	40	7	15	6	197
Intake & Exhaust	10	0	0	10	31	41	0	17	1	113
Fuel	15	1	0	21	44	75	14	28	8	215
Lubrication	11	2	0	23	41	33	7	6	4	131
Cooling	21	1	6	5	65	36	15	18	1	172
Generator	5	1	0	6	49	27	1	7	3	105
Switchgear	15	1	0	11	86	60	5	0	4	194
I&C	38	4	9	73	169	112	23	40	14	498
Structural	2	0	2	0	1	5	0	1	0	9
Mechanical	3	0	0	1	1	5	1	0	1	12
Electrical	8	0	0	11	53	18	11	4	3	112
Miscellaneous	0	0	0	0	2	0	0	0	1	3
Unrelated	1	0	0	0	11	2	2	2	0	31
Noncomponents	1	0	0	1	13	5	1	0	1	23
<hr/>										
Total Number of Failures	147	10	18	207	681	533	95	164	49	1984
<hr/>										
Number of Diesels in Service (1985)	18	3	5	11	84	49	8	31	4	213

Abbreviations

ALCO - ALCO
ALCH - Allis Chambers
CAT - Caterpillar
CB - Cooper Besemer
GM - Electro-Motive Division of General Motors
FM - Fairbanks Morse
NBG - Nordberg
TDI - Transamerican Delaval, Inc.
WOR - Worthington

TABLE I-2.
A RANKING* OF DIESEL GENERATOR
SUBSYSTEM FAILURE OCCURRENCES
(NUREG/CR-4590 Data)

SUBSYSTEM	ALCO	ALCH	CAT	CE	GM	FM	NBG	IDI	WOR	OVERALL
										RANK
Engine Structure				5	11	4		7	8	10
Drive Train				9		10		6		11
Valve Mechanism				10						14
Starting	3		3	4	2	6	6	5	3	3
Intake & Exhaust	6			8	9	5		4		7
Fuel	3			3	7	2	3	2	2	2
Lubrication	5			2	8	8	5		5	6
Cooling	2		2	12	4	7	2	3		5
Generator	9			11	6	9		8	7	9
Switchgear	4			7	3	3	7		4	4
I&C	1	1	1	1	1	1	1	1	1	1
Structural										16
Mechanical										15
Electrical	8			6	5	11	4		6	8
Miscellaneous										17
Unrelated					12					12
Noncomponents					10					13
<hr/>										
Total Number of Failures in Data Base	147	10	18	207	681	533	95	184	49	1984

*This ranking is obtained from the information in Table I-1 and is based on the number of failures shown for each manufacturer and in the "Total" column.

program (Table B-1) separates these failures from other I&C because of the specific nature and reliability impact of these failures.

Fuel Subsystem

The fuel subsystem experienced the second or third largest number of failures for all the major manufacturers except for GM diesels. The GM fuel subsystem showed the seventh largest number of failures. In general, fuel system failures were dominated by injection component failures (injectors, injector pumps, injector nozzles) and by piping on the engine. GM diesels experienced fewer injector failures (relative to other components) than any other diesel generator. Injector reliability is closely related to periodic preventive maintenance and inspections, as well as to design.

Starting Subsystem

The diesel generator starting system consists of components made by diesel generator manufacturers and plant contractors. The system, as defined in NUREG/CR-4590, consists of the air start mechanical components and their associated controls. The dominant failures occur in the starting air valve, controls, and starting motors. Catastrophic failure of starting motors results in the most risk, since the diesel generator must be air started. Failures of the starting air valve and other controls are likely to be recoverable in a short time, allowing for a manual start of the diesel generator. Starting system failures are important for each diesel generator, especially for GM. GM has experienced failures of the starting motors somewhat more frequently than for other diesel generators. However, since no certain count is available of how many EDGs use air start motors and how many inject air directly to cylinders via a distributor instead of using an air start motor, no specific conclusion can be made. The major failure cause is attributed as "adverse environment: dust, humidity, chemicals, etc."

Switchgear Components

Switchgear component failures are important for all types of diesel generators. However, no trend or correlation to manufacturer is noted. This category is mainly comprised of breaker and relay failures caused by poor manufacturing and construction. Applicable reliability program activities include periodic inspection (non-teardown) and cleaning and more specialized condition monitoring such as ground detection and infrared surveys.

Cooling Components

Pump, heat exchanger, and piping failures each contribute about equally to cooling system failures. Cooling system failures comprise a significant part of the total number of failures for

all but CB diesel generators, which have experienced very few cooling failures of any type. FM diesel generator cooling subsystems appeared somewhat better than average due to few pump and heat exchanger problems. The following diesel generator manufacturers were noted to have specific problems:

ALCO	-	Piping
TDI	-	Intercoolers
NBG	-	Pumps

Lubrication Components

The next most important diesel generator subsystem is lubrication. Lubricating oil system failures were dominated by pump and heat exchanger failure, with filters, piping, and oil also contributing significantly. Although lube oil systems are specific to each diesel generator type, the variations across manufacturers were small. CB exhibited a high occurrence of filter problems, making lube oil the second most frequent source of failures. FM had more failures attributed to oil content, relative to the total number of lubrication component failures.

Intake and Exhaust

Intake and exhaust failures are overwhelmingly dominated by the turbocharger. A significant percentage of these failures appear to be catastrophic, and the degraded and incipient failures often require very long repair outages, making turbocharger an important component. Turbocharger failure predominance does not appear to vary greatly with diesel generator manufacturer, but TDI experiences a little more than expected, and NBG has experienced the lowest relative number of these failures. Turbochargers are subjected to high stress levels in adverse environments and should be addressed in a reliability program.

Electrical Components

Electrical components are important to most diesel generators; but their construction is specific to each plant. NUREG/CR-4590 breaks components into switches, wiring, transformers, controls, and others. Most failures fall into the "others" category, so no pattern emerges.

Generator

The number of generator failures are fairly low, but significant, for each of the major diesel generator manufacturers except for GM. GM's generator and voltage regulator failures appear more frequently than normal. Since GM doesn't manufacture these components, the high occurrence rate may be coincidental.

Engine Structure

The engine structure subsystem consists of the base, block, crankcase, main bearings, cylinder liners, and head, with the most failures attributed to the crankcase. Engine structure ranks higher in failure frequency for CB and FM than for other manufacturers. CB failures were dominated by liners and FM failures were dominated by the crankcase, liners, and bearings. These problems probably are vendor specific. They will often be catastrophic to the diesel generator mission and usually will be expensive and time consuming to fix. Condition monitoring, such as vibration and clearance measurements, and cylinder temperature trending are a key to reducing these problems. These problems often require engine overhauls to correct, so it is important to predict them so that repairs can be done during a reactor outage.

The above-mentioned failures account for over 92 percent of diesel generator failures in the NUREG/CR-4590 data base. The remaining subsystems, in order of decreasing importance, are drive train, unrelated, noncomponents (mostly human error), valve mechanisms, mechanical, structural, and miscellaneous. These failures are fairly rare, and there are insufficient data to make significant observations.

The failures in the NUREG/CR-4590 data base can be tabulated by component failures in a manner similar to that used for subsystem failures. Breaking failures down into critical components provides additional information about diesel generator failure characteristics. Table I-3 contains the number of failure records for each component and is backed up by Table I-4, which provides a ranking of diesel failure occurrences by component. As expected, the governor failure was dominant in NUREG/CR-4590. It was the leading contributor to the total number of failures for each manufacturer. The consistent governor failure rate is not surprising since, to the best of our information, all EDG governors are made by the same manufacturer (Woodward).

Four out of the top eight components contributing to the number of diesel generator failures fall under the general category of I&C. Relays in the switchgear system show a large contribution, being the second largest contributor. Since relay failures are generally complete and catastrophic rather than degraded or incipient, plants that experience switchgear relay problems need to address them in a reliability program. Relays in standby systems tend to fail because of standby stress-related causes, such as corrosion, dust buildup, and other slow degradations. Surveillance tests that allow more frequent operation of control relays would decrease the exposure time for undetected failures, and the increased number of cycles would probably reduce sticking-type failures without significantly increasing wearout. Unfortunately, most switchgear cannot be tested and cycled during normal plant operation, so condition monitoring, especially visual inspection, is often recommended. Other major I&C problems come from starting control I&C, nonswitchgear relays, and sensors. The failure modes and their corrections are similar to switchgear relays.

The next major contributor to problems is the turbocharger. More turbocharger failures tend to be degraded or incipient than catastrophic.

TABLE I-3.
DIESEL GENERATOR FAILURES BY COMPONENTS
(NUREG/CR-4590 DATA)

<u>COMPONENT</u>	<u>ALCO</u>	<u>ALCH</u>	<u>CAT</u>	<u>CB</u>	<u>EMD</u>	<u>FM</u>	<u>NBG</u>	<u>IDI</u>	<u>WOR</u>	<u>TOTAL</u>
Governor	19	0	4	15	66	33	4	14	4	159
Relays (switchgear)	6	0	1	6	44	24	3	0	1	85
Turbocharger	6	0	0	8	30	21	0	12	1	78
Sensors (I&C)	4	1	1	11	22	17	4	5	3	68
Fuel Piping	2	0	0	14	7	22	3	9	1	58
Breakers	6	0	0	4	28	18	1	0	1	58
Starting Controls	2	0	3	3	30	9	3	1	0	51
Relays (I&C)	1	0	1	2	19	12	3	3	3	44
Starting Airvalve	0	0	0	6	12	11	3	9	4	45
Starting Motors	3	0	0	2	33	7	0	1	0	46
Injector Pumps	1	0	1	5	1	17	4	11	5	46
Startup I&C	2	1	0	2	19	15	1	4	0	44
Overspeed Governor	3	1	0	11	11	8	1	2	1	38
Voltage Regulator	0	0	0	4	14	13	0	2	2	35
Alarms and Shutdowns	2	0	0	4	7	9	4	6	0	32
Cooling System Piping	9	1	0	3	5	12	0	3	0	33
Cooling Heat Exchangers	2	0	0	1	22	3	4	0	0	32
Crankcase	0	0	0	0	4	21	0	4	0	29
Control Air I&C	4	0	1	17	5	2	3	0	0	32
Lube Oil Heat Exchangers	4	2	0	4	12	6	0	0	1	29
Lube Oil Pumps	4	0	0	1	17	2	1	0	0	25
Generator	4	1	0	1	13	5	0	2	0	25
TOTALS	64	7	12	124	421	287	42	88	27	1092

TABLE I-4.
 CRITICAL COMPONENT RANKING* FOR EACH EDG MANUFACTURER
 (NUREG/CR-4590 Data)

COMPONENT	ALCO	ALCH	CAT	CB	EMD	FM	NBG	IDI	WOR
(by overall rank)									
1. Governor	1		1	2	1	1	1	1	2
2. Relays (switchgear)	3			7	2	2	6		
3. Turbocharger	4			6	4	4		2	
4. Sensors (I&C)	6			4	7	7	2	7	4
5. Fuel Piping				3	17	3	7	4	
6. Breakers	5			10	6	6			
7. Starting Controls			2	14	5	14	8		5
8. Relays (I&C)					9	11	9	10	
9. Starting Airvalve				8	14	13	10	5	3
10. Starting Motors	11				3	17			
11. Injector Pumps				9		8	3	3	1
12. Startup I&C					10	9		8	
13. Overspeed Governor	12			5	16	16			
14. Voltage Regulator				11	12	10			
15. Alarms and Shutdowns				12	18	15	4	6	
16. Cooling System Piping	2			15	19	12		11	
17. Cooling Heat Exchangers					8	20	5		
18. Crankcase					21	5		9	
19. Control Air I&C	7			1	20		11		
20. Lube Oil Heat Exchangers	8			13	15	18			
21. Lube Oil Pumps	9				11				
22. Generator	10				13	19			6

*The rank is derived from Table I-3, and represents the rank by manufacturer of each component.

However, turbocharger repairs tend to require taking the EDG out of service for long periods. Any turbocharger repairs that cannot be scheduled during an outage will significantly affect diesel generator reliability.

Table I-4 also ranks, in as detailed a manner as possible, the component failure importances by diesel generator manufacturer. With a few notable exceptions, they generally follow the same overall ranking. The noticeable exceptions may be due in part to the random selection of failures that were included in the NUREG/CR-4590 data base. A more detailed analysis would be required to identify problems that are specific to diesel manufacturers, but the generic order would provide a good starting point for prioritizing reliability program activities.

I.2.2 Insights From a Collection of NPRDS Data

NPRDS uses a different set of component and subsystem boundaries than NUREG/CR-4590, so it is somewhat difficult to make direct comparisons between the data sources. NPRDS failure records generally provide good failure analysis and corrective action descriptions for failures of mechanical components (governors, turbochargers, etc.) but contain relatively poor electrical and electronic equipment failure analysis. The differences in subsystem and component breakdown between NPRDS and other sources, and the difference between individual EDG I&C, make it impossible to do a generic study of I&C problems without reading and classifying each failure report. However, with a specific plant problem, it has been proven beneficial to use NPRDS to analyze I&C.

Recent NPRDS data support the previous conclusions about mechanical components. Governor failures are important to each diesel generator manufacturer (about 1 in 15 failures) and are often catastrophic. Turbocharger failures are important, more from their contribution to maintenance outage than from frequent catastrophic engine failures. Many of the turbocharger maintenances require involved work that is performed during reactor outages. However, catastrophic EDG failures due to turbocharger failures are important and occur fairly often.

Table I-5 shows the distribution of diesel generator failures contained in the NPRDS data base used for this study. The records were found using the NPRDS SEEK function for the EDG air start, EDG fuel oil, EDG lube oil, and EDG cooling subsystems, and the diesel-generator-related components of the emergency power system. A usable data base of 2458 was created.

Unfortunately, the NPRDS data base does not contain enough information to calculate an equipment online time or the number of demands, and thus failure rates cannot be estimated. Additionally, the NPRDS data are also influenced by a plant-specific interpretation of reporting requirements. Failures must be classified by severity prior to entry into the NPRDS system; only catastrophic and degraded failures are entered. The classification by severity becomes judgmental. However, the sample is believed to be large enough and random enough to identify any significant problems or strengths of EDGs. No glaring differences in the major contributors to diesel generator unreliability and unavailability were noted when comparing NPRDS data to NUREG/CR-4590 data.

TABLE I-5.
NPRDS-DERIVED EDG INSIGHTS

<u>VENDORS</u>	<u>CATASTROPHIC FAILURES</u>	<u>DEGRADED FAILURES</u>	<u>*INCIPIENT FAILURES</u>	<u>TOTAL NUMBER OF FAILURES</u>
(EDG Itself, No Subsystem)				
EMD	121	255	13	389
CB	33	106	10	149
ALCO	13	16	1	32
FM	78	162	19	259
NORD	8	17	2	27
WORT	4	11	0	13
TDI	8	9	0	<u>17</u>
				888
(Cooling Subsystem)				
EMD	21	39	0	60
CB	5	9	0	19
ALCO	0	5	0	5
FM	11	93	2	106
NORD	2	9	1	12
WORT	0	0	0	0
TDI	1	8	1	<u>10</u>
				207
(Air Start Subsystem)				
EMD	72	344	9	425
CB	10	65	2	77
ALCO	6	10	1	17
FM	35	235	4	274
NORD	6	28	3	37
WORT	3	32	0	35
TDI	17	58	4	<u>79</u>
				944
(Fuel Oil Subsystem)				
EMD	7	34	0	61
CB	1	2	0	3
ALCO	3	0	0	3
FM	6	35	0	41
NORD	1	3	0	4
WORT	0	0	0	0
TDI	1	1	0	<u>2</u>
				114
(Lube Oil Subsystem)				
EMD	37	98	9	144
CB	4	10	3	17
ALCO	18	14	0	32
FM	13	80	2	75
NORD	3	13	4	20
WORT	1	2	2	5
TDI	1	9	22	<u>12</u>
				305

*Incipient Failures reports are not required to be submitted to NPRDS.

Review of the data in Table I-5 provides several insights and rankings. In the NPRDS category "EDG, no subsystem," which generally consists of the engine attached components, Cooper-Bessemer (CB) supplied engines showed a disproportionately high number of NPRDS records as compared to the number of diesels in service (11 percent of the NPRDS records are from CB diesels, but 17 percent of the "no subsystem" records are from CB diesels). CB engines tend to be older than most engines, so there may be a set of age-induced, or manufacturer-induced problems acting on these engines. The problems predominantly have a severity indicated to be degraded, but the number of catastrophic failures is also slightly high. A more detailed, failure-by-failure analysis and categorization is necessary to identify specific problems and could refute the above hypothesis concerning aging.

Continuing down Table I-5, Fairbanks-Morse EDGs have experienced a disproportionately high number of degraded conditions in their cooling systems when compared to the total number of NPRDS records submitted from other types of EDGs. This tendency is not apparent in Table I-1 or I-3, so it may be a result of NPRDS reporting procedures. Another significant fact apparent from Table I-5 is that 29 percent of all cooling subsystem failures are classified as catastrophic. Most studies treat the cooling system as one unlikely to lead to catastrophic failure. Only engine failures, for which 30 percent of failures are catastrophic, has a higher fraction of catastrophic failures than the cooling subsystem. The air start, lube oil, and fuel oil subsystems experienced 15 percent, 23 percent, and 17 percent catastrophic failures, respectively.

Transamerican Delaval, Inc. (TDI) diesel generators tend to exhibit more air start failures, as compared to the total number of failures, than expected. It may be misleading to attribute this phenomenon to TDI, since much of the starting system is not specific to the EDG vendor. GM also has experienced quite a few air start failures, as indicated in both Tables I-1 and I-5.

The results of the NPRDS data breakdown are very similar to the results of the NSAC-108 study, which was performed over the same period.

I.3 INTERFACES WITH OTHER EDG RELIABILITY REVIEW ITEMS

The collection and use of EDG failure information can be of significant use in developing an EDG reliability program. Operating experience should be drawn upon whenever possible. Surveillance needs, performance monitoring, and maintenance aspects would all benefit from operational feedback. In addition, the data collection system should provide a means to access offsite relatable experience.

Generic information on diesel generator failures is also important for failure analyses and root cause investigations. Generic information is most useful when the analysis of a specific failure has begun, the nature of the problem is generally understood, and it has been determined that root cause analysis is needed. Information on the nature of problems, and their solutions, is generally obtainable from LER and NPRDS descriptions. However, detailed information on the root cause (or potential root causes) is often more difficult to find. Historical diesel data are most useful for initial searches for (1) how frequently a given problem or problem type has

occurred and (2) who (meaning utility, vendor, etc.) has had similar problem(s). The problem frequency is useful in prioritizing the root cause efforts and the identification of who has had similar problems gives an idea of who to contact for specific relevant experience.

However, extracting plant, or machine, specific conclusions should not be made from the condensed data bases provided in this appendix. The various limitations have been noted above.

I.4 EMERGENCY DIESEL GENERATOR DATA BIBLIOGRAPHY (with comments)

1. NUREG/CR-4557, "A Review of Issues Related to Improving Nuclear Power Plant Diesel Generator Reliability," J. Higgins, C. Czajkowski, A. Tingle, Brookhaven National Laboratory, BNL-NUREG-51969, April 1986.

The data and recommendations of utility responses to Generic Letter 84-15 and the recommendations for DG reliability by other groups (EPRI, vendors, NRC, etc.) are summarized and analyzed in this NUREG/CR. The document is not a reliability data analysis but does contain a large amount of information on views and concerns about diesel reliability.

2. NUREG/CR-4590, Vol. 1, "Aging of Nuclear Station Diesel Generators: Evaluation of Operating and Expert Experience," K. Hoopingarner et al., Pacific Northwest Laboratories, PNL-5832, August 1987.

This NUREG/CR contains a very large and elaborate diesel failure data base, with failures broken down by subsystem, component, diesel manufacturer, and various aging parameters. Any study of aging is important, but is beyond the scope of this task, so the aging parameters were not used. An engineer administering a diesel reliability program would find this a good general reference as to the nature of other plant problems, but it does not contain specific failure and root cause information.

3. NUREG/CR-2989, "Reliability of Emergency AC Power System at Nuclear Power Plants," R. Battle and D. Campbell, Oak Ridge National Laboratory, ORNL/TM-8545, July 1983.

This report contains the results of a reliability analysis of the onsite ac power system. It uses the results of a separate analysis of offsite power systems to calculate the expected frequency of station blackout. Included is a design and operating experience review and onsite power system models.

4. NSAC-108, "The Reliability of Emergency Diesel Generators at U.S. Nuclear Power Plants," H. Wyckoff, Electric Power Research Institute, September 1986.

This report describes the EPRI effort toward organizing, investigating, and compiling a realistic data base of EDG success/failure experience for the years 1983, 1984, and 1985.

EPRI chose not to count easily recoverable failures as a failure to start. The strength of the study is the concentrated effort to make the survey comprehensive, and to report the experience of all utilities in a rigorously consistent manner.

5. Nuclear Plant Reliability Data System (NPRDS), Institute of Nuclear Power Operations (INPO).

The NPRDS data for diesel failures between 1984 and the present (Spring, 1987) have been collected. The data will be used to augment the analysis of the NUREG/CR-4590 data base. Nearly 7500 NPRDS failure reports were used for this study and could be used for general insights into failures (e.g., by manufacturer, component, and subsystem) or for specific examples of diesel failures.

NRC FORM 330 (2-84) NRCM 1102, 3201, 3202 BIBLIOGRAPHIC DATA SHEET SEE INSTRUCTIONS ON THE REVERSE		U.S. NUCLEAR REGULATORY COMMISSION 1 REPORT NUMBER (Assigned by TIDC add Vol. No. if any) NUREG/CR-5078, Vol. 1 SAND87-7176	
2 TITLE AND SUBTITLE A Reliability Program for Emergency Diesel Generators at Nuclear Power Plants Program Structure		3 LEAVE BLANK	
5 AUTHOR(S) E. V. Lofgren, G. M. DeMoss, J. R. Fragola, P. L. Appignani, G. Delarche, J. Boccio		4 DATE REPORT COMPLETED MONTH: February YEAR: 1988 6 DATE REPORT ISSUED MONTH: April YEAR: 1988	
7 PERFORMING ORGANIZATION NAME AND MAILING ADDRESS (Include Zip Code) Science Applications International Corporation 1710 Goodridge Drive, McLean, VA, 22102 Under Contract to Sandia National Laboratories Albuquerque, NM 87185		8 PROJECT TASK WORK UNIT NUMBER GSI B-56 9 FIN OR GRANT NUMBER A1806	
10 SPONSORING ORGANIZATION NAME AND MAILING ADDRESS (Include Zip Code) Division of Reactor and Plant Systems Office of Nuclear Regulatory Research U.S. Nuclear Regulatory Commission Washington, DC 20555		11 TYPE OF REPORT Technical (Final Report) 12 PERIOD COVERED (Inclusive Dates)	
12 SUPPLEMENTARY NOTES None			
13 ABSTRACT (200 words or less) <p>The purpose of the report is to develop guidance for the NRC staff to evaluate emergency diesel generator (EDG) reliability programs. Such reviews will likely result following the resolution of USI A-44 and GSI B-56. The diesel generator reliability program is a management system for achieving and maintaining a selected (or target) level of reliability. This can be achieved by: (1) understanding the factors that control the EDG reliability and (2) then applying reliability and maintenance techniques in proper proportion to achieve selected performance goals. The concepts and guidelines discussed in this report are concepts and approaches that have been successful in applications where high levels of reliability must be maintained.</p> <p>Both the EDG reliability program process and a set of review items for NRC use are provided. The review items represent a checklist for reviewing EDG reliability programs. They do not, in themselves, constitute a reliability program. Rather, the review items are those distinctive features of a reliability program that must be present for the program to be acceptable.</p>			
14 DOCUMENT ANALYSIS - KEY WORDS DESCRIPTORS Station Blackout GSI B-56 Diesel Generator Reliability USI A-44 15 IDENTIFIERS OPEN ENDED TERMS		15 AVAILABILITY STATEMENT Unlimited 16 SECURITY CLASSIFICATION (This page) Unclassified (This report) Unclassified 17 NUMBER OF PAGES 18 PRICE	

UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D.C. 20555

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE, \$300

SPECIAL FOURTH-CLASS RATE
POSTAGE & FEES PAID
USNRC
PERMIT No. G-67

120555078877 1 1AN1AI11S
US NRC-OARM-ADM
DIV OF PUB SVCS
POLICY & PUB MGT BR-PDR NUREG
W-537
WASHINGTON DC 20555