

VIRGINIA ELECTRIC AND POWER COMPANY  
RICHMOND, VIRGINIA 23261

October 5, 1998

United States Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington, D.C. 20555-0001

Serial No.: 98-538  
NLOS/MM R2  
Docket No.: 50-338  
License No.: NPF-4

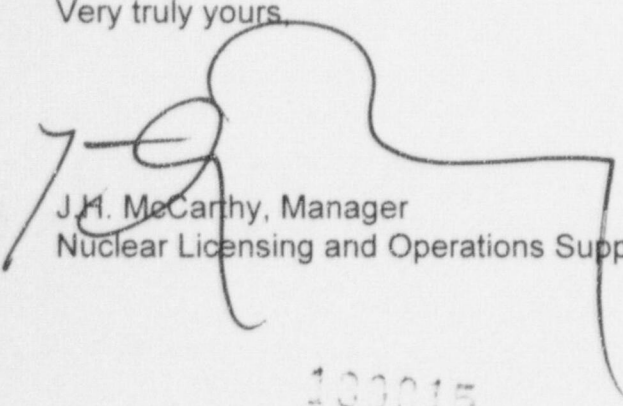
Gentlemen:

**VIRGINIA ELECTRIC AND POWER COMPANY**  
**NORTH ANNA POWER STATION UNIT 1**  
**STEAM GENERATOR TUBE INSPECTION REPORT**

Planned inservice inspection of the North Anna Unit 1 "C" steam generator was completed during the fall 1998 refueling outage. In accordance with North Anna Power Station Technical Specifications, Surveillance Requirement 4.4.5.5.a, this letter provides notification of the steam generator tubes that were plugged during the outage. In steam generator "C" one tube (Row 36, Column 22) was plugged. The indication of interest was a small volumetric condition, as confirmed by RPC examination, classified as a "pit" by the North Anna analysis guidelines. Because the signal was poorly formed on the sizing channel of the bobbin data, a determination of through-wall extent was not made and the tube was plugged as a precautionary measure.

No new commitments are intended by this letter. If you have any questions concerning these results, please contact us.

Very truly yours,

  
J.H. McCarthy, Manager  
Nuclear Licensing and Operations Support

ADD 1/0

100015

9810130122 981005  
PDR ADOCK 05000338  
Q PDR

cc: U.S. Nuclear Regulatory Commission  
Region II .  
Atlanta Federal Center  
61 Forsyth St., SW Suite 23 T85  
Atlanta, Georgia 30303-3415

Mr. M. J. Morgan  
NRC Senior Resident Inspector  
North Anna Power Station