


TEXAS UTILITIES GENERATING COMPANY
SKYWAY TOWER • 400 NORTH OLIVE STREET, L.B. 81 • DALLAS, TEXAS 75201

February 28, 1986

WILLIAM G. COUNCIL
EXECUTIVE VICE PRESIDENT

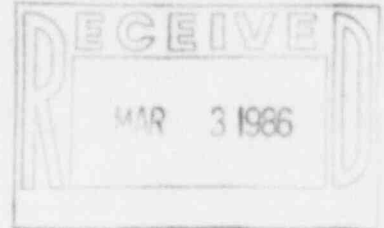

Mr. Eric H. Johnson, Director
Division of Reactor Safety and Projects
U.S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76012

SUBJECT: COMANCHE PEAK STEAM ELECTRIC STATION
DOCKET NOS. 50-445 AND 50-446
CONTROL BOARD SEPARATION MATERIAL
SDAR: CP-85-38 (FINAL REPORT)

Dear Mr. Johnson:

On September 18, 1985, we verbally notified your Mr. T. Westerman of a deficiency regarding glastic material separation barriers installed in Class 1E main control boards and panels without proper design basis documentation. We have submitted an interim report logged TXX-4586, dated October 10, 1985.

Evaluation efforts to assess this issue have included field verification to identify specific applications and qualification of this material through "shake table" testing. The results of these efforts have concluded that the mounting and application of glastic material is seismically adequate. Installation and configuration requirements have been properly documented. No adverse conditions exist. The issue is not reportable under the provisions of 10CFR50.55(e). Records supporting this determination are available for your inspectors to review at the CPSES site.

Very truly yours,

A handwritten signature in cursive script that reads "W. G. Council".

W. G. Council

JCH/arm

c - NRC Region IV (0 + 1 copy)

Director, Inspection & Enforcement (15 copies)
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

8603100665 860228
PDR ADOCK 05000445
S PDR

A DIVISION OF TEXAS UTILITIES ELECTRIC COMPANY

86-224

ICB7
10