

CORE OPERATING LIMITS REPORT (COLR)

NORTH ANNA POWER STATION UNIT 1 CYCLE 14 PATTERN XY

Virginia Electric and Power Company

9810190133 981014  
PDR ADDCK 05000338  
P PDR

## N1C14 CORE OPERATING LIMITS REPORT

### 1.0 INTRODUCTION

The Core Operating Limits Report (COLR) for North Anna Unit 1 Cycle 14 has been prepared in accordance with Technical Specification 6.9.1.7. The Technical Specifications affected by this report are listed below:

3/4.1.1.4	Moderator Temperature Coefficient
3/4.1.3.5	Shutdown Bank Insertion Limit
3/4.1.3.6	Control Bank Insertion Limits
3/4.2.1	Axial Flux Difference
3/4.2.2	Heat Flux Hot Channel Factor
3/4.2.3	Nuclear Enthalpy Rise Hot Channel Factor and Power Factor Multiplier

The cycle-specific parameter limits for North Anna 1 Cycle 14 for the specifications listed above are provided on the following pages, and were developed using the NRC-approved methodologies specified in Technical Specification 6.9.1.7.

## 2.0 OPERATING LIMITS

### 2.1 Moderator Temperature Coefficient (Specification 3/4.1.1.4)

2.1.1 The moderator temperature coefficient (MTC) limits are:

The BOC/ARO-MTC shall be less positive than or equal to  $+0.6E-4 \Delta k/k/^{\circ}F$  ( $+6 \text{ pcm}/^{\circ}F$ ) below 70 percent of RATED THERMAL POWER.

The BOC/ARO-MTC shall be less positive than or equal to 0 (zero)  $\Delta k/k/^{\circ}F$  ( $0 \text{ pcm}/^{\circ}F$ ) at or above 70 percent of RATED THERMAL POWER.

The EOC/ARO/RTP-MTC shall be less negative than  $-5.0E-4 \Delta k/k/^{\circ}F$  ( $-50 \text{ pcm}/^{\circ}F$ ).

2.1.2 The MTC surveillance limits are:

The 300 ppm/ARO/RTP-MTC should be less negative than or equal to  $-4.0E-4 \Delta k/k/^{\circ}F$  ( $-40 \text{ pcm}/^{\circ}F$ ).

The 60 ppm/ARO/RTP-MTC should be less negative than or equal to  $-4.7E-04 \Delta k/k/^{\circ}F$  ( $-47 \text{ pcm}/^{\circ}F$ ).

where:       BOC - Beginning of Cycle  
              ARO - All Rods Out  
              EOC - End of Cycle  
              RTP - RATED THERMAL POWER

### 2.2 Shutdown Bank Insertion Limit (Specification 3/4.1.3.5)

2.2.1 The shutdown rods shall be withdrawn to 227 steps.

### 2.3 Control Bank Insertion Limits (Specification 3/4.1.3.6)

2.3.1 The control rod banks shall be limited in physical insertion as shown in Figure A-1.

2.4 Axial Flux Difference (Specification 3/4.2.1)

2.4.1 The axial flux difference limits are provided in Figure A-2.

2.5 Heat Flux Hot Channel Factor- $F_Q(z)$  (Specification 3/4.2.2)

2.5.1 The  $F_Q(z)$  limits are:

$$F_Q(z) \leq \frac{2.19}{P} * K(z) \quad \text{for } P > 0.5$$

$$F_Q(z) \leq 4.38 * K(z) \quad \text{for } P \leq 0.5$$

where:  $P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$ , and

$K(z)$  is provided in Figure A-3

2.5.2 The  $F_Q(z)$  surveillance limits are:

$$F_Q(z)^M \leq \frac{2.19}{P} * \frac{K(z)}{N(z)} \quad \text{for } P > 0.5$$

$$F_Q(z)^M \leq 4.38 * \frac{K(z)}{N(z)} \quad \text{for } P \leq 0.5$$

$$\text{where: } P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}},$$

K(z) is provided in Figure A-3, and N(z) is a non-equilibrium multiplier on  $F_Q(z)^M$  to account for power distribution transients during normal operation, provided in Table A-1. The top and bottom 15% of the core is excluded per TS 4.2.2.2.G.

**2.6 Nuclear Enthalpy Rise Hot Channel Factor -  $F_{\Delta H}(N)$  and Power Factor Multiplier (Specification 3/4.2.3)**

$$F_{\Delta H}(N) \leq 1.49 * \{1 + 0.3 * (1 - P)\}$$

$$\text{where: } P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$$

Table A-1  
N1C14 NORMAL OPERATION N(Z)'s

node	Height (feet)	0 to 1000 MWD/MTU	1000 to 3000 MWD/MTU	3000 to 5000 MWD/MTU	5000 to 7000 MWD/MTU	7000 to 9000 MWD/MTU	9000 to 18200 MWD/MTU	18200 to EOC MWD/MTU
10	10.2	1.141	1.141	1.146	1.146	1.146	1.146	1.124
11	10.0	1.139	1.139	1.146	1.146	1.146	1.146	1.126
12	9.8	1.135	1.135	1.149	1.149	1.149	1.149	1.130
13	9.6	1.134	1.134	1.154	1.154	1.154	1.154	1.138
14	9.4	1.140	1.140	1.159	1.159	1.159	1.159	1.146
15	9.2	1.151	1.151	1.165	1.165	1.165	1.165	1.153
16	9.0	1.159	1.159	1.168	1.168	1.168	1.168	1.159
17	8.8	1.165	1.165	1.172	1.172	1.172	1.172	1.165
18	8.6	1.170	1.170	1.180	1.180	1.180	1.180	1.168
19	8.4	1.172	1.172	1.188	1.188	1.188	1.187	1.173
20	8.2	1.174	1.174	1.194	1.194	1.194	1.192	1.183
21	8.0	1.172	1.172	1.197	1.197	1.197	1.198	1.194
22	7.8	1.170	1.170	1.200	1.200	1.200	1.207	1.206
23	7.6	1.167	1.167	1.200	1.200	1.200	1.216	1.217
24	7.4	1.165	1.165	1.200	1.200	1.200	1.224	1.224
25	7.2	1.161	1.161	1.197	1.197	1.197	1.229	1.229
26	7.0	1.155	1.155	1.193	1.193	1.193	1.231	1.231
27	6.8	1.149	1.149	1.190	1.190	1.190	1.231	1.232
28	6.6	1.141	1.141	1.185	1.185	1.185	1.228	1.228
29	6.4	1.131	1.131	1.178	1.178	1.178	1.223	1.223
30	6.2	1.122	1.122	1.168	1.168	1.168	1.213	1.213
31	6.0	1.119	1.119	1.158	1.158	1.158	1.203	1.203
32	5.8	1.118	1.118	1.147	1.147	1.147	1.188	1.188
33	5.6	1.114	1.114	1.134	1.134	1.134	1.175	1.175
34	5.4	1.108	1.108	1.121	1.121	1.121	1.159	1.159
35	5.2	1.097	1.097	1.109	1.109	1.109	1.140	1.140
36	5.0	1.090	1.090	1.104	1.104	1.104	1.127	1.127
37	4.8	1.089	1.089	1.105	1.106	1.106	1.120	1.120
38	4.6	1.095	1.095	1.108	1.109	1.109	1.119	1.119
39	4.4	1.105	1.105	1.110	1.111	1.111	1.122	1.122
40	4.2	1.115	1.115	1.115	1.115	1.115	1.125	1.125
41	4.0	1.124	1.124	1.124	1.121	1.121	1.128	1.128
42	3.8	1.134	1.134	1.134	1.126	1.126	1.134	1.134
43	3.6	1.144	1.144	1.144	1.130	1.130	1.141	1.141
44	3.4	1.154	1.154	1.154	1.131	1.131	1.145	1.145
45	3.2	1.163	1.163	1.163	1.135	1.135	1.150	1.150
46	3.0	1.173	1.173	1.172	1.141	1.141	1.152	1.152
47	2.8	1.181	1.181	1.181	1.149	1.149	1.158	1.158
48	2.6	1.189	1.189	1.189	1.157	1.157	1.168	1.168
49	2.4	1.197	1.197	1.197	1.165	1.165	1.180	1.180
50	2.2	1.204	1.204	1.204	1.172	1.172	1.190	1.190
51	2.0	1.212	1.212	1.212	1.178	1.178	1.200	1.200
52	1.8	1.220	1.220	1.220	1.185	1.185	1.209	1.209

Figure A-1  
Control Rod Bank Insertion Limits

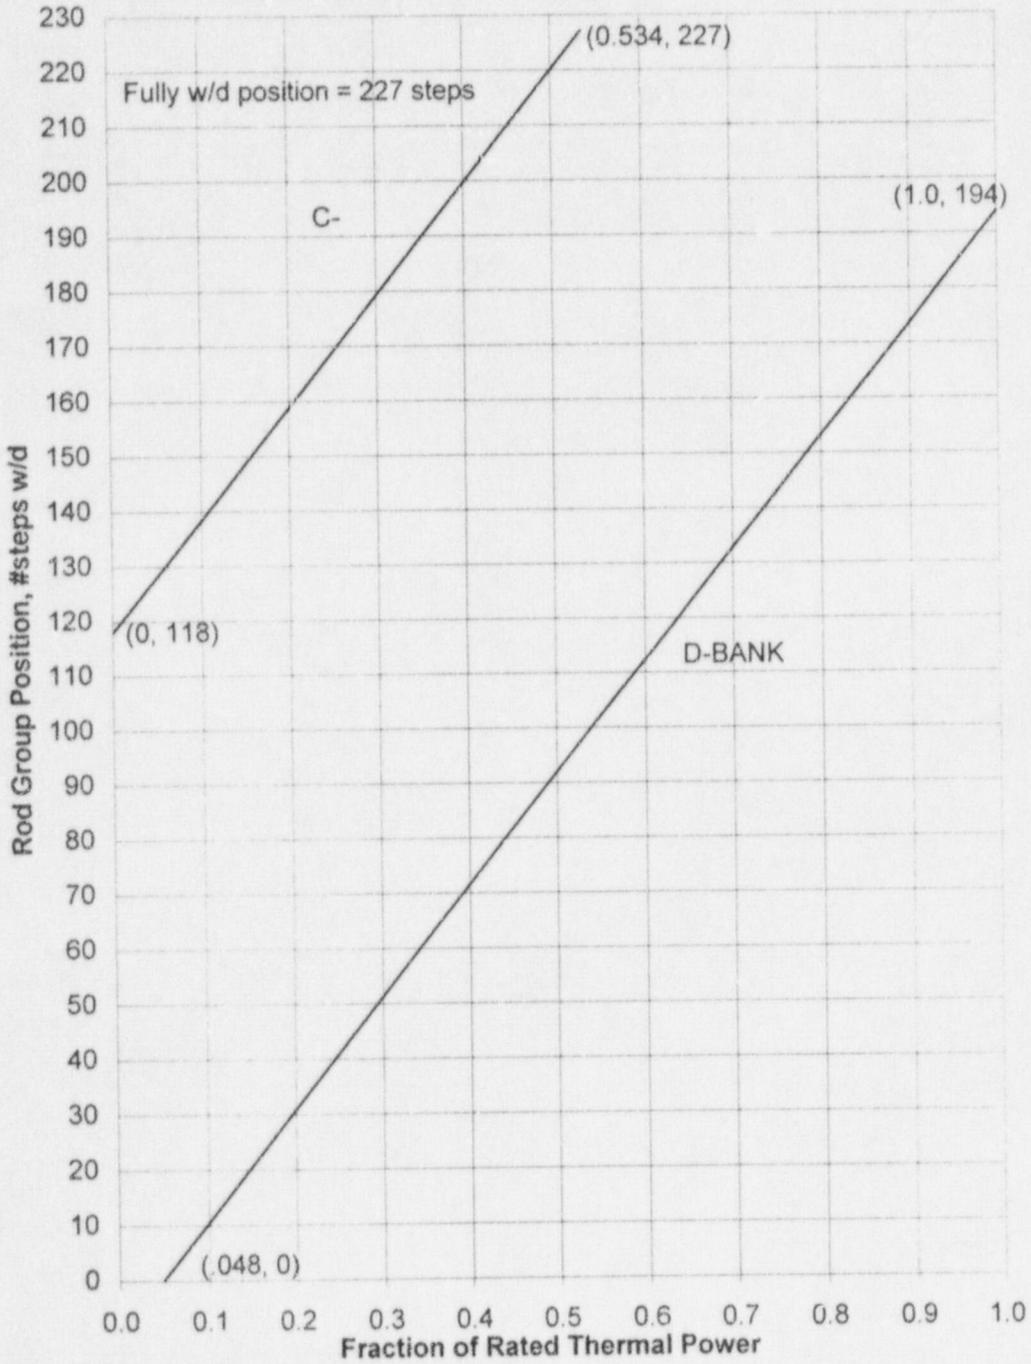


Figure A-2  
N1C14 Axial Flux Difference Limits

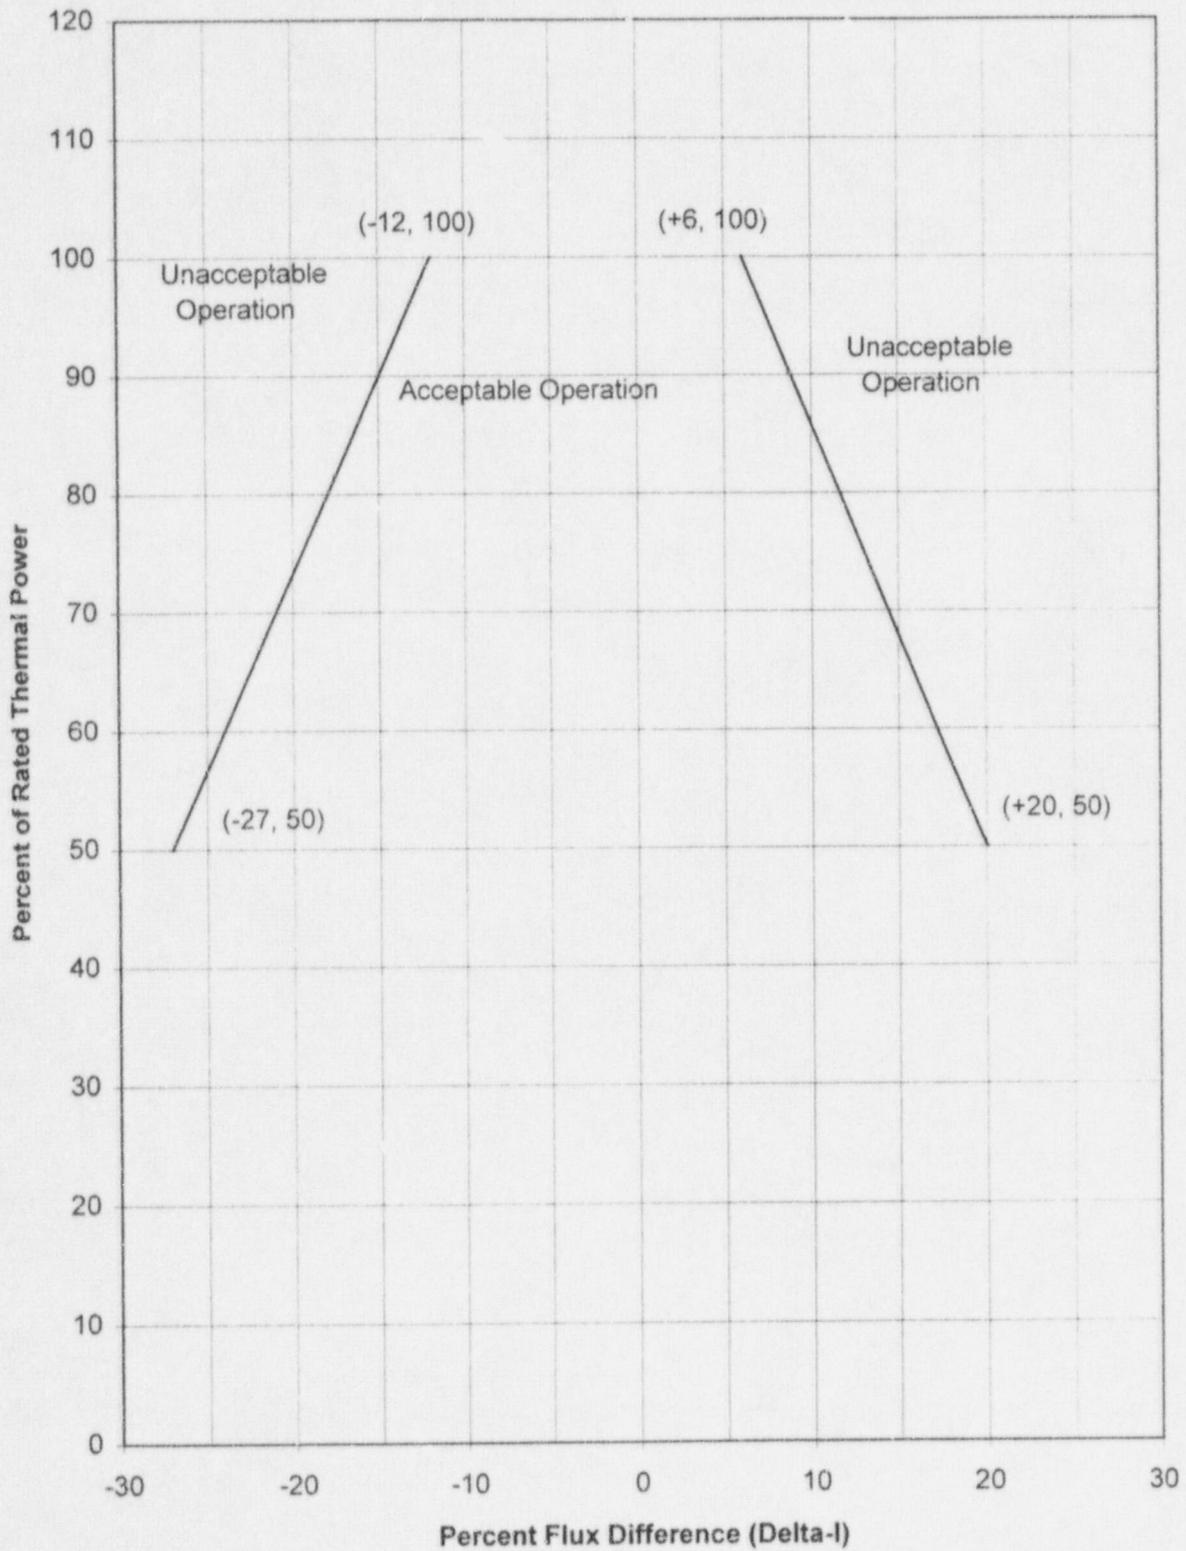


Figure A-3  
K(Z) - Normalized FQ as a Function of Core Height

