NUREG/CR-5497 INEEL/EXT-97-01328

Common-Cause Failure Parameter Estimations

Prepared by F. M. Marshall/INEEL D. M. Rasmuson/NRC A. Mosleh/Univ. of MD

Idaho National Engineering and Environmental Laboratory

University of Maryland

DFO2%

Prepared for U.S. Nuclear Regulatory Commission



B11170329 981031 DR NUREG R-5497 R PDR

AVAILABILITY NOTICE

Availability of Reference Materials Cited in NRC Publications

NRC publications in the NUREG series, NRC regulations, and *Title 10, Energy*, of the *Code of Federal Regulations*, may be purchased from one of the following sources:

The Supprintendent of Documents
U.S. Government Printing Office
P.O. Box 37082
Washington, DC 20402-9328
<http://www.access.gpo.gov/su_docs>
202-512-1800

 The National Technical Information Service Springfield, VA 22161-0002 <http://www.ntis.gov/ordernow> 703-487-4650

The NUREG series comprises (1) technical and administrative reports, including those prepared for international agreements, (2) brochures, (3) proceedings of conferences and workshops, (4) adjudications and other issuances of the Commission and Atomic Safety and Licensing Boards, and (5) books.

A single copy of each NRC draft report is available free, to the extent of supply, upon written request as follows:

Address: Office of the Chief Information Officer Reproduction and Distribution Services Section U.S. Nuclear Regulatory Commission Washington, DC 20555-0001 E-mail: <GRW1@NRC.GOV> Fucsimile: 301-415-2289

A portion of NRC regulatory and technical information is a suble at NRC's World Wide Web site:

<http://www.nrc.gov>

All NRC documents released to the public are available for inspection or copying for a fee, in paper, microfiche, or, in some cases, diskette, from the Public Document Room (PDR): NRC Public Document Room 2121 L Street, N.W., Lower Level Washington, DC 20555-0001 <http://www.nrc.gov/NRC/PDR/pdr1.htm> 1-800-397-4209 or locally 202-634-3273

Microfiche of most NRC documents made publicly available since January 1981 may be found in the Local Public Document Rooms (LPDRs) located in the vicinity of nuclear power plants. The locations of the LPDRs may be obtained from the PDR (see previous paragraph) or through:

<http://www.nrc.gov/NRC/NUREGS/ SR1350/V9/lpdr/html>

Publicly released documents include, to name a few, NUREG-series reports; *Federal Register* notices; applicant, licensee, and vendor documents and correspondence; NRC correspondence and internal memoranda; bulles and information notices; inspection and investigation reports; licensee event reports; and Commission papers and their attachments.

Documents available from public and special technical libraries include all open literature items, such as books, journal articles, and transactions, *Federal Register* notices, Federal and State legislation, and congressional reports. Such documents as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings may be purchased from their sponsoring organization.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at the NRC Library, Two White Flint North, 11545 Rockville Pike, Rockville, MD 20852-2738. These standards are available in the library for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from—

American National Standards Institute 11 West 42nd Street New York, NY 10036-8002 <http://www.ansi.org> 212-642-4900

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product, or process disclosed in this report, or represents that its use by such third party would not infringe privately owned rights.

NUREG/CR-5497 INEEL/EXT-97-01328

Common-Cause Failure Parameter Estimations

Manuscript Completed: May 1998 Date Published: October 1998

Prepared by F. M. Marshall/INEEL D. M. Rasmuson/NRC A. Mosleh/Univ. of MD

Idaho National Engineering and Environmental Laboratory Lockheed Martin Idaho Technologies Company Idaho Fails, ID 83415

Subcontractor: Department of Materials and Nuclear Engineering University of Maryland College Park, MD 20742-2115

Prepared for Safety Programs Division Office for Analysis and Evaluation of Operational Data U.S. Nuclear Regulatory Commission Washington, DC 20555-0001 NRC Job Code E8247



ABSTRACT

This report documents the quantitative results of the common cause failure (CCF) data collection effort described in Volumes 1 - 4 of the Common Cause Failure System Database and Analysis System (References 2-5), as well as some qualitative insights about the data. These results are for use in Probabilistic Risk Assessment (PRA) studies of commercial nuclear power plants in the U.S. It summarizes the results of the parameter estimation quantification process, performed on the CCF data, as described in Volume 2 of that series of reports.

Equipment failures that contribute to CCF events are identified during searches of Licensee Event Reports and Nuclear Plant Reliability Data System failure reports. Once CCF events are identified by screening reports of equipment failures, they are coded for entry into a personal computer storage system. Once all data for a specific system and component data set have been entered, parameter estimations are performed, producing the results. The results of the database analysis are presented here as a summary of the entire database, and as individual reports for individual system/component combinations describe the system and component boundaries, along with the guidelines for identifying CCF events that may be unique to the data set.

The quantitative results are presented as both alpha factors and multiple Greek letter parameter estimations. The alpha factor uncertainty distributions are also presented.

CONTENTS

ABS	TRACTiii
EXE	CUTIVE SUMMARY vii
ACR	IONYMSix
1.	INTRODUCTION
2.	GENERAL INSIGHTS FROM ANALYSIS OF CCF DATA
3.	REFERENCES
4.	SUMMARY REPORTS
	2. DC Power Distribution Circuit Breakers
	3. 4160 Volt AC Power Distribution Circuit Breakers
	4. Reactor Trip Circuit Breakers
	5. Emergency Diesel Generators
	6. Containment Spray Heat Exchangers
	7. Residual Heat Removal Heat Exchangers
	8. BWR Isolation Condensers
	9. PWR Auxiliary Feedwater Pumps
	10. Emergency Service Water Pumps
	11. PWR High Pressure Safety Injection Pumps
	12. BWR Low Pressure Coolant Injection Pumps
	13. PWR Low Pressure Safety Injection Pumps
	14. BWR Standby Liquid Control Pumps
	15. BWR High Pressure Coolant Injection and Reactor Core Isolation Cooling Pumps 125
	16. BWR Suppression Pool Strainers
	17. PWR Containment Sump Strainers
	18. Emergency Service Water Strainers
	19. Main Steam Isolation Air-Operated Valves
	20. BWR Isolation Condenser Air-Operated Valves

	Continue Air	
	1. High Pressure Coolant Injection and Reactor Core Isolation Cooling Air Operated Valves	
	2. PWR Auxiliary Feedwater Air-Operated Valves	
	3. BWR Low Pressure Coolant Injection Check Valves	
24	4. PWR Low Pressure Safety Injection Check Valves	193
2	5. PWR Auxiliary Feedwater Check Valves	203
20	6. BWR High Pressure Coolant Injection/Reactor Core Isolation Cooling Check Valves	213
2	7. PWR High Pressure Safety Injection Check Valves	223
21	8. BWR Isolation Condenser Motor-Operated Valves	233
	9. BWR High Pressure Coolant Injection and Reactor Core Isolation Cooling Motor-Operated Valves	241
3(0. BWR Residual Heat Removal Motor-Operated Valves	255
3	1. PWR High Pressure Safety Injection Motor-Operated Valves	265
32	2. PWR Low Pressure Safety Injection Motor-Operated Valves	275
3:	3. PWR Containment Spray Motor Operated Valves	285
34	4. PWR Auxiliary Feedwater Motor-Operated Valves	295
3	5. Pressurizer PORV Motor-Operated Block Valves	305
30	5. PWR Refueling Water Storage Tank Suction Motor-Operated Valves	315
31	7. PWR Pressurizer Power Operated Relief Valves	323
31	8. PWR Steam Generator Power Operated Relief Valves	333
39	9. BWR Pressure Relief and ADS Valves	343
	D. PWR Steam Generator Safety Valves	
4	I. BWR Safety Valves	363
42	2. PWR Pressurizer Safety Valves	365

EXECUTIVE SUMMARY

The U.S. Nuclear Regulatory Commission's (NRC's) Office for Analysis and Evaluation of Operational Data (AEOD) has developed and maintained a common cause failure (CCF) database for the U.S. commercial nuclear power industry. Previous studies documented methods for identifying and quantifying CCFs. This report contains the CCF parameter estimates for the majority of the risk important safety systems and components in commercial nuclear power plants. The methods used to quantify these parameters are described in Volumes 1 - 4 of the Common Cause Failure Database and Analysis System.⁽²⁻⁵⁾

A CCF event consists of component failures that meet four criteria: (1) two or more individual components fail or are degraded, including failures during demand, in-service testing, or deficiencies that would have resulted in a failure if a demand signal had been received; (2) components fail within a selected period of time such that success of the PRA mission would be uncertain; (3) component failures result from a single common cause and coupling mechanism; and (4) a component failure occurs within the established component boundary.

Two data sources are used to select equipment failures to be reviewed for CCF events: The Nuclear Plant Reliability Data System and the Sequence Coding and Search System. These sources served as the developmental basis for the CCF data collection and analysis system. The CCF data collection and analysis system consists of (1) CCF event identification methodology, (2) event coding guidance, and (3) a software system to estimate CCF parameters.

A software system stores CCF and independent failure data, and automates the PRA parameter estimation process. The system employs two quantification models: alpha factor and the multiple Greek letter. These models are used throughout the nuclear industry. The individual summary reports for each system/component combination provide the parameter estimations for that set of data. These results can be used in PRA studies throughout the industry in place of the current CCF parameter estimates, giving a more accurate treatment of CCFs in risk modeling.

In addition to the individual results provided in this report, there are some general insights about the CCF events that are contained in the database.

ACRONYMS

ADS	automatic depressurization system	LER	Licensee Event Report
AEOD	Nuclear Regulatory Commission's Office	LOCA	loss of coolant accident
	for the Analysis and Evaluation of Oper- ational Data	LOSP	loss of offsite power
AFP	auxiliary feedwater pump	LPCI	low pressure coolant injection
AFW	auxiliary feedwater	LPSI	low pressure safety injection
AOV	air operates valve (AOV)	MCC	motor control centers
BWR	boiling water reactor	MFP	main feedwater pump
CCCG	common cause component group	MGL	multiple Greek letter
CCF	common cause failure	MLE	maximum likelihood estimates
ССР	centrifugal charging pump	MOV	motor operated valve
CSR	containment spray recirculation	MS	main steam
CSS	containment spray system	MSIV	main steam isolation valve
CST	condensate storage tank	NPRDS	Nuclear Plant Reliability Data System
ECCS	emergency core cooling system	NRC	Nuclear Regulatory Commission
EDG	emergency diesel generator	PORV	power operated relief valve
ESFAS	engineered safety features actuation	PRA	probabilistic risk assessment
POW	system	PRT	pressurizer relief tank
ESW	emergency service water	PWR	pressurized water reactor
HPCI	high pressure coolant injection	RCIC	reactor core isolation cooling
HPSI	high pressure safety injection	RCS	reactor coolant system
HX	heat exchanger	RHR	residual heat removal
IC	isolation condenser	RPV	reactor pressure vessel
INEEL	Idaho National Engineering and Environ- mental Laboratory	RTB	reactor trip breaker

RV	relief valve	SV	safety valve
RWST	refueling water storage tank	TS	technical specifications
SI	safety injection	VAC	volts alternating current
SLC	standby liquid control	VDC	volts direct current

1. INTRODUCTION

Purpose of the Database

The U.S. Nuclear Regulatory Commission's (NRC's) Office for Analysis and Evaluation of Operational Data (AEOD) has developed and maintained a common cause failure (CCF) database for the U.S. commercial nuclear power industry. Previous studies documented methods for identifying and quantifying CCF events.1 This document contains the summaries of common cause failure event analyses based upon event data contained in the CCF event database, using the CCF database software. The purpose of these summaries is to provide estimates of common cause parameters for use in agency reliability and risk studies. An overview of this CCF project and coding process is contained in Reference 2. The CCF data collection and analysis system consists of (1) CCF event identification methodology, (2) event coding guidance, and (3) a software system to estimate CCF parameters.

Data Sources

The data sources used are Licensee Event Reports (LERs) and failure records contained in the Nuclear Plant Reliability Data System (NPRDS). Data from 1980 through 1995 were analyzed. Because of the differences in the two di ta sources (LERs discuss plant and system events, while NFRDS contains component failure information), there is little duplication of data, and a check for duplicated events is performed. Data from other sources were used in special cases (e.g., "Special Reports" for emergency diesel generators).

Event Classification

A CCF event consists of component failures that meet four criteria: (1) two or more individual components fail or are degraded, including failures during demand, in-service testing, or deficiencies that would have resulted in a failure if a demand signal had been received; (2) components fail within a selected period of time such that success of the PRA mission would be uncertain; (3) component failures result from a single common cause and coupling mechanism; and (4) a component failure occurs within the established component boundary. Each event is coded following rules that are found in References 3 and 4. These rules were developed to help reduce the variability that exists between different analysts when they code the events.

Database Content and Use

The table of contents contains a list of the components for which CCF events have sen collected and analyzed. Component definitions follow probabilistic risk assessment (PRA) component boundaries and are described in the individual summary report for each system/component combination set of data. Reference 5 contains guidance for performing database searches and CCF parameter estimations. Section 2 of this document presents a summary of the data contained within the database, along with some general insights about the complete set of CCF data.

Use of Parameter Estimates

The recommended parametric model to use in quantifying CCFs is the alpha factor model. It is preferred to the multiple Greek letter (MGL) method for several reasons. First, it has a firm statistical sampling basis. Secondly, reasonable and defensible uncertainty distributions can be defined and estimated for the alpha factor CCF parameters. It is recommended that mean values be used instead of the maximum likelihood estimates. Table 1 contains formulas for using the alpha factor method in CCF analyses (assuming staggered testing). Table 2 contains formulas related to nonstaggered testing. Note that $Q_T = A_1/\alpha_1$ where Q_T is the total failure probability, Q1 is the independent failure probability of the component, and

$$\alpha_i = \sum_{i=1}^{i} i \alpha_i$$

Section 4 of this document contains summary reports for each set of data for which CCF events are in the CCF database. These reports contain the alpha factor parameter estimates with the uncertainty distributions for each set of data. MGL model estimates for each set of data are also displayed in the summary reports. Additional information about the quantification of CCF parameters in reliability and risk studies are found in References 3 and 6.

Quality Assurance

The data classification, loading, and parameter estimation have several levels of quality control built into the process. First, all events are reviewed by two data analysts to make sure that the events are classified as CCF events and coded correctly. Subsequently, a PRA analyst reviews the CCF events and results for consistency and comparison with PRA experience. A final review is performed by an independent CCF expert, outside the Idaho National Engineering and Environmental Laboratory (INEEL).

Sources of Uncertainty

Several sources of uncertainty exists in the parameter estimates. One source is the inherent variability of the data itself. Additional uncertainty results from the analysts' interpretation of the events from the written event description, usually due to the lack of information in the source data. To reduce the effect of this uncertainty on the final results, event identification and coding guidelines were developed. Other sources of uncertainty include plant-to-plant variation, etc. Future efforts will address and quantify these uncertainties. Prior to using the estimates provided in this report, it is recommended that the user evaluate the individual event data from the database to ensure that the events included in the parameter estimations are relevant to the individual study being performed.

Special CCF Data Analysis

Special CCF event analyses can be performed using the database. The summary reports contain generic or average CCF parameter estimates that can be used in most studies at the NRC. When an application requires plant-specific values, the CCF database can be used to obtain specific CCF parameter estimates for these specialized cases.

Additional Information

Additional information about CCFs, how the data were classified, and how to use the data in reliability and risk studies can be found in the references.

Proprietary Information

Because the CCF event database contains proprietary information from NPRDS, the database itself is proprietary. However, the results presented here in the individual summary reports can be used and published as needed.

Contacts

For more information about the database, please contact:

Dr. Dale M. Rasmuson Telephone: (301) 415-7571

Organization and Mailing Address Reliability and Risk Assessment Branch Safety Programs Division Office for Analysis and Evaluation of Operational Data U.S. Nuclear Regulatory Commission Mail Stop: T4A9 Washington, D.C. 20555-0001

CCCG SLa	Configuration	Common Cause Failure Probability
	1 of 2	$\alpha_2 Q_T$
2	2 of 2	
	1 of 3	$\alpha_3 Q_T$
3	2 of 3	[3α ₂] -
	3 of 3	$\left \frac{3\alpha_2}{2} + \alpha_3\right Q_T$
	1 of 4	$\alpha_4 Q_T$
4	2 of 4	$\left \frac{6\alpha_2}{3} + \frac{4\alpha_3}{3} + \alpha_4\right Q_T$
	3 of 4	[4α,]
	4 of 4	$\left \frac{4\alpha_3}{3} + \alpha_4\right Q_T$
EROPPTYLANDOLOGY LAAT DOOL	1 of 5	$\alpha_5 Q_T$
5	2 of 5	$\left \frac{5\alpha_4}{4} + \alpha_5\right Q_T$
	3 of 5	$\left \frac{10\alpha_3}{6} + \frac{5\alpha_4}{4} + \alpha_5\right Q_T$
	4 of 5	$10\alpha_{2}$ $10\alpha_{3}$ $5\alpha_{4}$
	5 of 5	$\left \frac{10\alpha_2}{4} + \frac{10\alpha_3}{6} + \frac{5\alpha 4}{4} + \alpha_5\right Q_T$
	1 of 6	$\alpha_6 Q_T$
6	2 of 6	$\left \frac{6\alpha_5}{5} + \alpha_6\right Q_T$
	3 of 6	$\left \frac{15\alpha_4}{10} + \frac{6\alpha_5}{5} + \alpha_6\right Q_T$
	4 of 6	$\left \frac{20\alpha_3}{10} + \frac{15\alpha_4}{10} + \frac{6\alpha_5}{5} + \alpha_6\right Q_T$
	5 of 6	$15\alpha_{2}$ 20 α_{3} 15 α_{4} 6 α_{5} 10
	6 of 6	$\left \frac{15\alpha_2}{5} + \frac{20\alpha_3}{10} + \frac{15\alpha_4}{10} + \frac{6\alpha_5}{5} + \alpha_6\right Q_T$

Table 1. Common cause quantification using alpha factor model (staggered testing).

NUREG/CR-5497

CCG Size	Configuration	Common Cause Failure Probability
	i of 2	$\frac{2\alpha_2}{\alpha_2}Q_T$
2	2 of 2	-
	1 of 3	$\frac{3\alpha_3}{\alpha_t}Q_T$
3		$\alpha_{t} \sim 1$
	2 of 3	$\frac{3(\alpha_2 + \alpha_3)}{\alpha_2}Q_T$
	3 of 3	u,
	1 of 4	$\frac{4\alpha_4}{\alpha_t}Q_T$
4	2 of 4	$\frac{4(\alpha_2 + \alpha_3 + \alpha_4)}{\alpha}Q_T$
	3 of 4	$\frac{\alpha_{t}}{4(\alpha_{3}+\alpha_{4})}Q_{T}$
	4 of 4	
	1 of 5	$\frac{5\alpha_5}{\alpha_1}Q_T$
5	2 of 5	$\frac{5(\alpha_4 + \alpha_5)}{\alpha_t}Q_T$
	3 of 5	$\frac{5(\alpha_3 + \alpha_4 + \alpha_5)}{\alpha_4 + \alpha_5}Q_T$
İ	4 of 5	$\frac{\alpha_t}{5(\alpha_2 + \alpha_3 + \alpha_4 + \alpha_5)}Q_T$
1	5 of 5	α_{t}
	1 of 6	$\frac{6\alpha_6}{\alpha_i}Q_T$
6	2 of 6	$\frac{6(\alpha_5 + \alpha_6)}{\alpha_1}Q_T$
	3 of 6	$\frac{6(\alpha_4 + \alpha_5 + \alpha_6)}{\alpha_1}Q_T$
	4 of 6	$\frac{6(\alpha_3 + \alpha_4 + \alpha_5 + \alpha_6)}{\alpha_1}Q_T$
ſ	5 of 6	$\frac{6(\alpha_2 + \alpha_3 + \alpha_4 + \alpha_5 + \alpha_6)}{\alpha_2}Q_T$
T	6 of 6	α_{t}

Table 2. Common cause quantification using alpha factor model (nonstaggered testing).

NUREG/CR-5497

2. GENERAL INSIGHTS FROM ANALYSIS OF CCF DATA

The CCF database developed in this project is a rich source of information on various aspects of common cause failure. Exploring the full potential of the database merits a dedicated activity and is outside the scope of the current effort, which has focused on building the infrastructure for such analyses. Nevertheless, some general observations have been made about the character of CCF events, including their causes and coupling factors, and frequency of occurrence. Some of these insights are summarized in this section.

Table 3 lists the systems, component types, and failure modes for which CCF events have been collected and entered into the database. It also contains the number of CCF events for each system and component combination and the number of associated independent failure events. Table 3 only displays the event counts for failure modes that are relevant to PRA studies. Other failure modes, such as failure to close for reactor trip breakers, were found in the source data; these events were coded and entered into the CCF database, even though they are not likely to be used in PRA studies.

Basic information about the nature of CCF events is displayed in Figures 1 and 2, which illustrate the distribution of CCF event proximate causes and coupling factors, respectively. This information provides a general picture of the types of CCF events that may be expected to occur, and what design features might be most susceptible to CCF events. These figures also illustrate the different characteristics of partial CCF events and complete CCF events (events with timing factor, shared cause factor, and component degradation values for each component in the CCCG =1.0). Figures 3, 4, and 5 display the number of CCF events by year of occurrence.

A general review of the actual events and the distributions provided in Figures 1 and 2, reveals the following insights regarding CCF events:

 A major contributor to CCF events is programmatic maintenance practices. The frequency of scheduling has been a factor in the numerous wear out-caused and aging-caused events. Additionally, the quality of the maintenance, both in the procedures and in performance of the maintenance activities, is a key factor. Similar events have occurred at different plants—lubrication of circuit breakers (too much, too little, or too long between lubrications), improperly set torque and limit switches on motor operated valves (MOV) that are reported as misadjustments and not setpoint drift. This indicates that there are maintenance practices that need to be reviewed to reduce common cause failure potential.

- Another contributor is design problems. Many of the design-related events resulted from a design modification, indicating that perhaps the modification review processes were not rigorous and resulted in CCF susceptibilities. This theory was not investigated as part of the project, but can be considered in CCF event reduction efforts.
- Human errors related to procedures caused a small percentage of the total events, but the impact of the individual events is usually greater, since human errors have overridden the programmatic controls. This is illustrated by comparing Figure 1b with Figure 1a, which shows that human error causes a larger portion of complete CCF events than partial CCF events. Examples of events caused by human error are all emergency diesel generator (EDG) day tanks simultaneously drained for a chemistry surveillance, two pump breakers racked out as the plant changed modes from shutdown to power.
- A vast majority of the CCF events are not due to multiple failures in response to an operational demand, but result from a "condition of equipment." The most common is inspection or surveillance test of one component revealing a deficiency that prompts the licensee to inspect/test the redundant component, resulting in the discovery that the same defective condition exists on both components. This demonstrates that detection of

failures during the testing and surveillance program prevents CCF events from occurring during demand situations.

The CCF database contains several examples . where both CCF and independent events recur at some, but not all, plants, perhaps indicating ineffective root cause analysis and corrective action Examples of repeated events are water in compressed air systems, pump seal wear out, and turbine governor misadjustment. Additionally, not all plants experience the same type of recurring event. This indicates that plant-toplant variability exists in the CCF parameters that might cause the CCF parameter estimates for some plants to be higher than the industry average for certain component and system combinations. Thus, it is very important to perform plant-specific CCF parameter estimations for plant-specific PRAs and reliability studies.

With respect to quantification of common cause failures, the overall conclusion is that, based on the evaluation of over 15 years of operating experience data, CCF parameters for similar components vary among systems and failure modes. Table 4 displays maximum likelihood estimates (MLE) for both EDG failure modes, fail to start and fail to run. Tables 5 and 6 display the MLEs for both the alpha factors (α_2) and beta factors for several component and system combinations. These results illustrate that the parameter estimates vary for different failure modes within the same component group, and that they also vary between different systems for the same component.

Another useful observation is that common cause failure parameters of different components are available. Figure 6 shows the component-to-component variability of the mean α_2 for various system and component combinations. It also shows a beta distribution fit to these data. The equation for this beta distribution is:

$$\pi(\alpha) \propto \underline{\Gamma(A+B)} \qquad \alpha^{A-1} (1-\alpha)^{B-1}$$

$$\Gamma(A)(B)$$

where A = 2.0291, B = 45.707.

a.5%	=	0.0079
01.95%	=	0.0984
Climean	222	0.0425

Сотпроњене Туре	PRA-relevant Failure Modes	Systems Analyzed for the Component Type	No. of CCF Events for System and Component Type	No. of Independent Failures for System & Component Type	Total No. of CCF Events for Com- ponent Type	Total Number of Inde pendent Failures for Component Type
Air-Operated Valves	Fail to Open	Auxiliary Feedwater (PWR)	-26	197	197 127	
un operante raine	Fail to Close	High Pressure Injection (BWR)	2	28		
	Fail to Remain Closed	Isolation Condenser (BWR)	1	9		
	2 all to Remain crosse	Main Steam Isolation (BWR & PWR)	Condenser (BWR) 1 9 am Isolation (BWR & PWR) 78 197 am Isolation (BWR & PWR) 60 1,260 60 if (BWR & PWR) 60 1,260 60 if (BWR & PWR) 59 202 139 ssure Injection (BWR/PWR) 15/21 84/145 88/38 ssure Injection (BWR/PWR) 23/21 88/38 112 er (BWR & PWR) 8 112 116 er (BWR & PWR) 82 755 116 er (BWR & PWR) 82 755 116 er (BWR & PWR) 131 1,361 131 er (BWR & PWR) 131 1,361 131 er (BWR & PWR) 10 14 19 Heat Removal (BWR/PWR) 8 15 15 Condensers (BWR) 1 2 195 nent Spray (PWR) 15 250 195 ssure Injection (BWR/PWR) 61/23 498/470 155 esture Injection/RHR (BWR/PWR) 61/23			
Batteries/Chargers	No, High Output	DC Power (BWR & PWR)	60	1,260	60	1,260
Check Valves	Fail to Open	Auxiliary Feedwater (PWR)	59	202	139	557
CHECK VAIVES	Fail to Close	High Pressure Injection (BWR/PWR)	15/21	84/145		
	Fail to Remain Closed	Low Pressure Injection (BWR/PWR)	23/21	88/38		
Circuit Breakers	Fail to Open	DC Power (BWR & PWR)	8	112	116	977
CHCCH DICARCIO	Fail to Close	AC Power (BWR & PWR)	82	755		
	Fail to Remain Closed	Reactor Trip Breakers (fail to open only) (PWR)	26	110		
Emergency Diesel Generators	Fail to Start, Run	Emergency Power (BWR & PWR)	131	1,361	131	1,361
Heat Exchangers	Fail to Transfer Heat	Containment Spray (PWR)	10	14	19	32
near Exchangers		Residual Heat Removal (BWR/PWR)	8	15		
		Isolation Condensers (BWR)	1	2		
Motor-Operated Valves	Fail to Open	Auxiliary Feedwater (PWR)	30	422	195	2,577
motor operates varies	Fail to Close	Containment Spray (PWR)	15	250		
	Fail to Remain Closed	High Pressure Injection (BWR/PWR)	11/40	372/292		
		Isolation Condenser (BWR)	2	44		
		Low Pressure Injection/RHR (BWR/PWR)	61/23	498/470		
		Pressurizer (PWR)	7	155		
		Refueling Water Storage Tank (PWR)	6	74		
Pumps	Fail to Start	Auxiliary Feedwater (PWR)	51	919	281	3,519
I onitra	Tau to start	Emergency Service Water (BWR & PWR)	141	1,184		
		High Pressure Injection (BWR/PWR)	2/42	343/492		
		Low Pressure Injection (BWR/PWR)	9/26	149/362	1	
		Standby Liquid Control (BWR)	10	70		
Relief Valves	Fail to Open	BWR Primary System	38	271	121	1,047
Renet Fartes	Fail to Close	Pressurizer (PWR)	22	337	1	
	Fail to Remain Closed	Steam Generator (PWR)	61	439	L	
Safety Valves	Fail to Open	Pressurizer (PWR)	6	119	38	280
	Fail to Close Fail to Remain Closed	Steam Generator (PWR)	32	161		
Strainers	Fail to Allow Flow	Containment Sump (PWR)	1	3	37	170
Summers		Emergency Service Water (BWR & PWR)	34	162		
		Suppression Pool (BWR)	2	5		

Table 3. Component types and systems analyzed	I for CCF events	(1980-1995).
---	------------------	--------------

-1

		Fail to Start		Fail to Run			
	CCCG=2	CCCG=3	CCCG=4	CCCG=2	CCCG=3	CCCG=4	
Alpha Factor		Alph	a Factor Para	meter Estima	tions		
α,	0.968323	0.9630082	0.9636932	0.9599057	0.950802	0.949033	
α2	3.12E-02	2.04E-02	1.35E-02	4.01E-02	2.89E-02	2.19E-02	
α,	and a second sec	1.66E-02	1.14E-02		2.11E-02	1.46E-02	
α,	annen		1.14E-02			1.45E-02	
MGL Parameter	MGL Parameter Estimations						
1-Beta	9.69E-01	9.63E-01	9.64E-01	9.60E-01	9.50E-01	9.49E-01	
Beta	3.12E-02	3.70E-02	3.63E-02	4.01E-02	4.99E-02	5.10E-02	
Gamma		4.50E-01	6.27E-01		4.22E-01	5.72E-01	
Delta		-	5.01E-01	_		4.99E-01	
dj. Independent Events	544.37	816.55	1,088.73	461.18	691.77	922.35	

 \mathbf{O}

Table 4. Emergency diesel generator CCF parameter estimations.

Fail to Start


Number of Independent Failure Events: 773 Number of Common Cause Failure Events: 55 **Fail to Run** Number of Independent Failure Events: 588 Number of Common Cause Failure Events: 76

Table 5. Alpha and beta factors for motor operated valves (CCCG=6).


	Alpha Fa	ector (α_2)	Beta Factor (B)		
System	Fail to Open	Fail to Close	Fail to Open	Fail to Close	
Auxiliary Feedwater - PWR	1.31E-2	2.20E-2	3.47E-2	5.41E-2	
High Pressure Safety Injection - PWR	2.22E-2	2.66E-2	5.69E-2	3.53E-2	
Low Pressure Safety Injection - PWR	1.17E-2	9.33E-3	1.74E-2	1.54E-2	
Low Pressure Coolant Injection - BWR	1.53E-2	2.06E-2	3.44E-2	4.37E-2	

Table 6. Alpha and beta factors for pumps.

and the second	CCCG	Alpha Fa	ctor (α_2)	Beta Factor (B)	
System		Fail to Start	Fail to Run	Fail to Start	Fail to Run
Emergency Service Water- BWR & PWR	6	4.03E-2	1.28E-2	9.70E-2	3.94E-2
Auxiliary Feedwater - PWR	4	4.52E-2	2.42E-2	1.33E-2	3.88E-2
High Pressure Safety Injection - PWR	3	2.58E-2	1.96E-2	5.53E-2	2.80E-2
Low Pressure Safety Injection - PWR	2	6.32E-2	5.35E-2	6.32E-2	5.35E-2
Low Pressure Coolant Injection - BWR	4	3.15E-2	6.49E-3	3.17E-2	6.49E-3
Standby Liquid Control - BWR	2	9.80E-2	3.24E-2	9.80E-2	3.24E-2

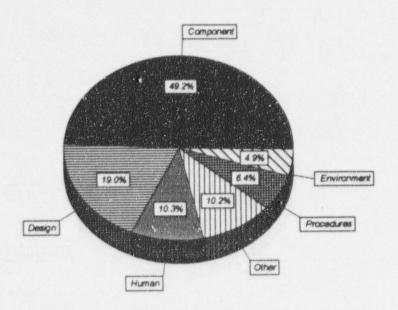


a. Distribution of causes of complete and partial CCF events.

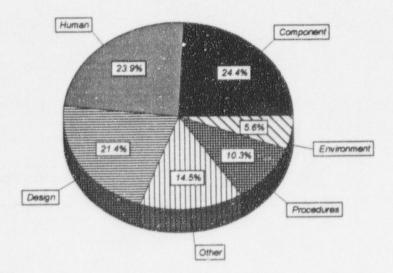


b. Distribution of causes of only the complete CCF events.

Figure 1. Distribution of CCF events by cause.

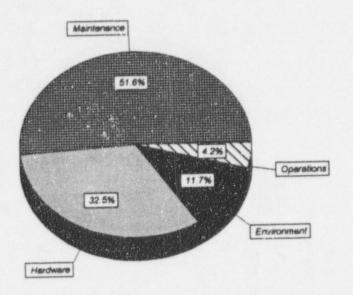

a. Distribution of coupling factors for both complete and partial CCF events.

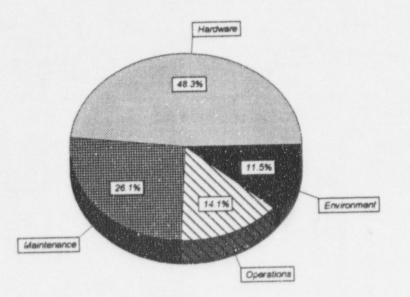


b. Distribution of coupling factors for only the complete CCF events.

Figure 2. Distribution of CCF events by coupling factor.

1.0

-

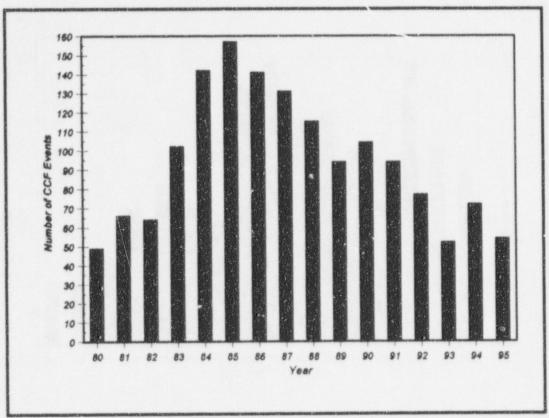

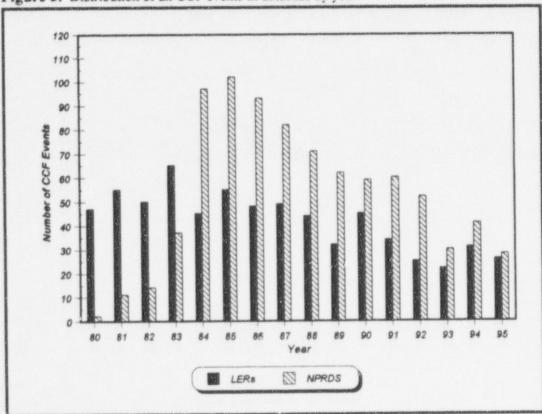


Figure 3. Distribution of all CCF events in database by year.

Figure 4. Distribution of CCF events by year and source.


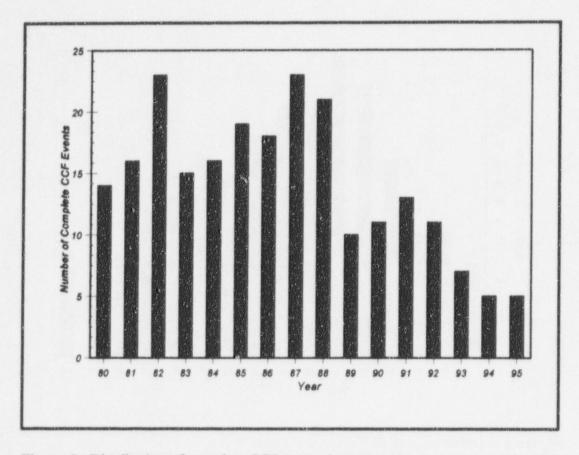


Figure 5. Distribution of complete CCF events by year.



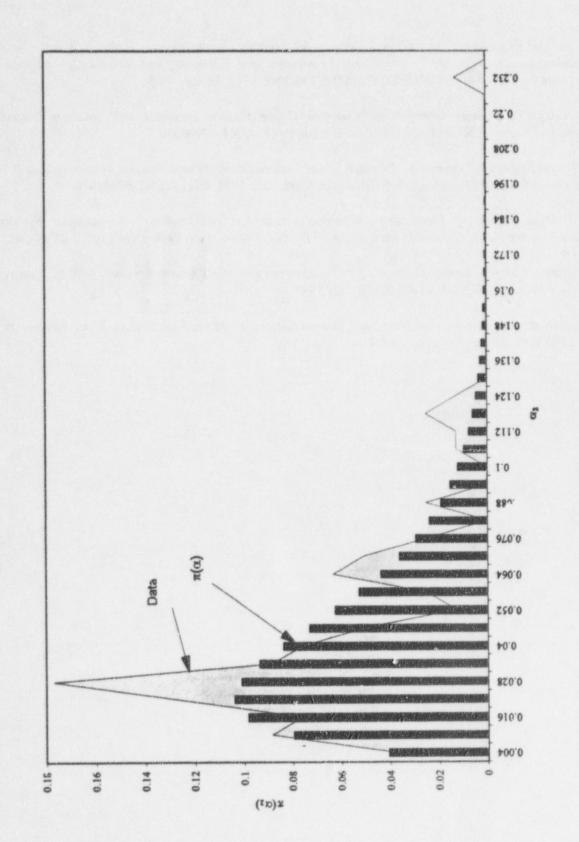

3. REFERENCES

- 1. U.S. Nuclear Regulatory Commission, Procedure for Treating Common Cause Failures in Safety and Reliability Studies, Volume 1, Procedural Framework and Examples, and Volume 2, Analytical Background and Techniques, NUREG/CR-4780, EPRI NP-5613, January 1989.
- 2. U.S Nulcear Regulatory Commission, Common Cause Failure Database and Analysis System Volume 1---Overview, NUREG/CR-6268, June 1998, INEEL/EXT-97-00696.
- 3. U.S Nulcear Regulatory Commission, Common Cause Failure Database and Analysis System Volume 2-Event Definition and Classification, NUREG/CR-6268, June 1998, INEEL/EXT-97-00696.
- 4. U.S Nulcear Regulatory Commission, Common Cause Failure Database and Analysis System Volume 3—Data Collection and Event Coding, NUREG/CR-6268, June 1998, INEEL/EXT-97-00696.
- 5. K. J. Kvarfordt, et al., Common Cause Failure Database and Analysis System Volume 4-CCF Software Reference Manual, INEEL/EXT-97-00696, July 1997.
- 6. A. Mosleh, et. al., Guidelines on Modeling Common Cause Failures in Probabilistic Risk Assessments, INEEL/EXT-97-01327, November, 1997.

4. SUMMARY REPORTS

The following sections of this document summarize the information about each set of data for which CCF events were collected and are contained in the CCF database. They are listed by the system/component combination that is of interest from a risk perspective. The full listing of the data sets and the order in which they appear in this section of the document is in the Table of Contents. These summary reports are all in the same format, and contain the same information, individualized for each specific set of data.

Each report briefly describes the system, with discussion of the specific components within the system that are risk significant. There is also discussion of the failure mode of interest, typically only for those failure modes that are risk important. The CCF parameter estimates displayed in the summary report tables, for both the alpha factor and multiple Greek letter methods, were obtained directly from the CCF database software, along with the uncertainty distributions for the alpha factor estimates.

1. DC Power System - Batteries and Chargers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving batteries and battery charger at both boiling water reactor (BWR) power plants and pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to provide voltage/amperage output and providing high voltage/amperage output. The data cover the time period from 1980 through 1995.

The data review identified 12 common-cause failure to provide voltage/amperage events for batteries, 42 commoncause failure to provide voltage/amperage output events for battery chargers, and six common-cause high voltage/amperage output events for battery chargers. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for battery failure to provide voltage/amperage are shown in Tables 1-1 and 1-2, respectively. Table 1-3 contains the average impact vectors (N₁-N₄) and the number of adjusted independent events for this failure mode. Tables 1-4 through 1-9 contain the corresponding information for the battery charger failure to provide output and battery charger high output failure modes. The size of the affected population of batteries and chargers is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 1-10 through 1-24.

2. SYSTEM DESCRIPTION

The Class 1E DC power system consists of batteries and their respective output breaker, battery chargers and their associated input/output breakers supplying 250 VDC, 125 VDC and a few lower voltages to essential equipment. Two Boiling Water Reactors, Nine Mile Point 1 and Oyster Creek, have motor-generator sets suppling DC power in place of battery chargers, but were considered within this report. Components of the DC power system are arranged in trains, or divisions, which are electrically independent and physically separated.

A DC power train or division normally consists of one battery, one or two battery chargers, and associated distribution panels. Four trains of DC power are typical but the number can be as few as one train for older plants (e.g., Big Rock Point). Some sites have shared DC power systems between the units. For example, at Browns Ferry, a multi-unit site, one DC power system provides power to all three units. Each DC power train receives power from the Class 1E 480 VAC electrical busses via the battery charger and supplies the normal source of DC power to the various loads while maintaining the batteries in a fully charged condition. A battery charger's electrical capacity is usually sufficient to supply all DC loads and concurrently charge the associated battery. In the event of a loss of AC power, the station batteries supply an emergency source of DC power to the essential DC loads. The capacity of the storage battery is sufficient to power all required loads on a DC power train for a specific length of time. A schematic of a single train of the DC power system is shown in Figure 1-1.

ALPHA FACTOR AND MGL PARAMETERS DC Power Batteries

Table 1-1: Summary of Alpha Factor Parameter Estimations - Batteries No Voltage Amperage Output	Table 1-1: Summary of Alpha Factor Parameter Estimations - Batteries No Voltage/	Amperage Output
---	--	-----------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG~5	CCCG=6
α.,	0.9901388	0.9873122	0.9868140	0.9872159	0.9875319
α ₂	9.86E-03	7.81E-03	6.77E-03	5.17E-03	3.89E-03
α,		4.88E-03	3.05E-03	3.69E-03	3.36E-03
			3.37E-03	1.30E-03	2.22E-03
α,				2.62E-03	7.83E-04
α ₅					2.22E-03

Table 1-2: Summary of MGL Parameter Estimations - Batteries No Voltage/Amperage Output

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.90E-01	9.87E-01	9.87E-01	9.87E-01	9.88E-01
Beta	9.86E-03	1.27E-02	1.32E-02	1.28E-02	1.25E-02
Gamma		3.85E-01	4.87E-01	5.96E-01	6.88E-01
Delta			5.25E-01	5.15E-01	6.08E-01
Epsilon				6.68E-01	5.75E-01
Mu	an a				7.39E-01

Table 1-3: Summary of Average Impact Vectors - Batteries No Voltage/Amperage Output

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	154.35	231.53	308.71	385.89	463.06
N,	3.8827	3.6533	3.3410	3.0925	2.9390
N ₂	1.5759	1.8593	2.1391	2.0365	1.8337
N3		1.1630	0.9650	1.4548	1.5866
N,			1.0656	0.5129	1.0458
N ₅				1.0330	0.3696
N ₆					1.0478

Total Number of Independent Failure Events: 257 Total Number of Common-Cause Failure Events: 12

ALPHA FACTOR AND MGL PARAMETERS DC Power Chargers

Table 1-4: Summar	y of Alpha I	Factor Parameter	Estimations -	Chargers No	Voltage/Amperage

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9873822	0.9795111	0.9766041	0.9749025	0.9716802
α,	1.26E-02	1.80E-02	1.49E-02	1.33E-02	1.23E-02
ø,		2.51E-03	6.81E-03	6.83E-03	6.53E-03
α.,			1.67E-03	3.76E-03	4.16E-03
α,				1.27E-03	3.12E-03
a.,				An annual school one can be an	2.25E-03

Table 1-5: Summary of MGL Parameter Estimations - Chargers No Voltage/Amperage

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.87E-01	9 80E-01	9.77E-01	9.75E-01	9.72E-01
Beta	1.26E-02	2.05E-02	2.34E-02	2.51E-02	2.83E-02
Gamma		1.22E-01	3.62E-01	4.72E-01	5.67E-01
Delta	The second s		1.97E-01	4.24E-01	5.93E-01
Epsilon				2.52E-01	5.63E-01
Mu					4.19E-01

Table 1-6: Summary of Average Impact Vectors - Chargers No Voltage/Amperage

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	344.77	517.16	689.55	861.93	1034.32
N ₁	23.2786	24.9458	25.5530	24.8060	22.6062
N2	4.7033	9.9522	10.9280	12.0477	13.3289
N ₂		1.3873	4.9832	6.2092	7.1050
N,			1.2201	3.4184	4.5295
Ns				1.1525	3.3963
N ₆					2.4446

Total Number of Independent Failure Events: 874 Total Number of Common-Cause Failure Events: 42

ALPHA FACTOR AND MGL PARAMETERS DC Power Chargers

Table 1.7 Summary of Alpha Factor Parameter	r Estimations - Chargers High Voltage/Amperage
---	--

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Cl.1	0.9950344	0.9900374	0.9849809	0.9844117	0.9818690
٤.,	4.97E-03	9.96E-03	1.50E-02	1.19E-02	1.11E-02
α,	Contraction of the second s	0.00E+00	0.00E+00	3.65E-03	5.57E-03
a.	Land Contraction Contraction		0.00E+00	0.00E+00	1.44E-03
α.			and a sublime show on our of Links and the Constant	0.00E+00	0.00E+00
e,					0.00E+00

Table 1-8: Summary of MGL Parameter Estimations - Chargers High Voltage/Amperage

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.95E-01	9.90E-01	9.85E-01	9.84E-01	9.82E-01
Beta	4.97E-03	9.96E-03	1.50E-02	1.56E-02	1.81E-02
Gamma		0.00E+00	0.00E+00	2.34E-01	3.87E-01
Delta			0.00E+00	0.00E+00	2.06E-01
Epsilon				0.00E+00	0.00E+00
Mu			and a second		0.00E+00

Table 1-9: Summary of Average Impact Vectors - Chargers High Voltage/Amperage

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	59.58	89.38	119.17	148.96	178.75
N,	2.6802	3.0890	2.8780	2.9177	2.3736
N ₂	0.3107	0.9305	1.8610	1.8419	2.0520
N,	ala a manfaanala ay yn llwyday o cannolyn had y yn bry	0.0000	0.0000	0.5631	1.0270
N.			0.0000	0.0000	0.2656
Ns				0.0000	0.0000
N.					0.0000

Total Number of Independent Failure Events: 129 Total Number of common-Cause Failure Events: 6

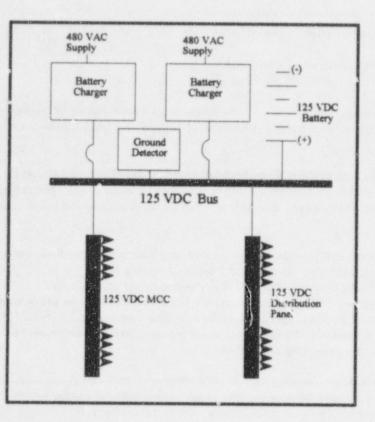


Figure 1-1. Generic DC power train.

3. COMPONENT BOUNDARIES

C

4

The super component of this analysis was the DC Power train consisting of several sub-components (e.g., battery charger, battery, and connecting bus work). Individual load breakers in the distribution panels were not included. Each battery charger's piece-parts included the AC input breaker as well as the DC output breaker. The battery output breaker and associated fuses were considered integral parts of the battery.

4. FAILURE EVENT DEFINITION

Successful operation of a DC power system is defined as each train maintaining DC power from either the battery charger or the battery to the essential loads. The respective failure modes used for evaluating the battery and battery charger data were:

NO No Voltage/Amperage Output. Examples are:

- battery charger input/output circuit breaker fails open,
- battery output circuit breaker fails open,
- circuit breakers fails to close,
- battery charger fails to produce output,
- battery electrolyte level or specific gravity low, and
- battery fuses blown.

1

HI High Voltage/Amperage Output. Examples are:

- · battery charger setpoint drift, and
- battery charger output phase imbalance.

DC power malfunctions are considered to be failures to provide adequate DC power on demand. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the DC power system.

Battery chargers and battery failures are evaluated to determine the effect on the DC power system. In general, if the failure causes the component to fail to operate, it will be considered a failure of a DC power train. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered DC power system failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of DC power system demand. The exception to this is if a licensee reported that the DC power system component "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications for individual components (i.e., battery chargers or batteries) in the proper configuration is not considered a failure, unless the improper configuration would have prevented the DC power system or individual train from operating as designed.

Some LERs reported only one actual failure, but the report information indicated that a second component would have failed. If the cause of the actual failure would have clearly caused failure of another battery charger, then the event was identified as a CCF. If, however, the report did not clearly identify that another battery charger would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 1-10 through 1-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of DC power. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS DC Power Batteries

Table 1-10: Alpha Factor Distribution Summary - Battery No Voltage/Amperage Output, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9717763	0.9879515	0.9898062	0.9977822	0.9901388	1.6776E+02	2.0459E+00
α,	2.22E-03	1.21E-02	1.02E-02	2.82E-02	9.86E-03	2.0459E+00	1.6776E+02

Table 1-11: Alpha Factor Distribution Summary - Battery No Voltage/Amperage Output, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9706556	0.9849635	0.9862149	0.9949938	0.9873122	2.5038E+02	3.8223E+00
α,	1.81E-03	8.84E-03	7.59E-03	2.01E-02	7.81E-03	2.2465E+00	2.5196E+02
α,	7.91E-04	6.20E-03	4.96E-03	1.58E-02	4.88E-03	1.5758E+00	2.5263E+02

Table 1-12: Alpha Factor Distribution Summary - Battery No Voltage/Amperage Output, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	9	b
α,	0.9715154	0.9840170	0.9849484	0.9933295	0.9868140	3.3675E+02	5.4697E+00
α,	1.95E-03	7.87E-03	6.93E-03	1.70E-02	6.77E-03	2.6929E+00	3.3953E+02
α,	2.93E-04	3.59E-03	2.68E-03	9.99E-03	3.05E-03	1.2276E+00	3.4099E+02
α.,	5.62E-04	4.53E-03	3.61E-03	1.16E-02	3.37E-03	1.5492E+00	3.4067E+02

Table 1-13: Alpha Factor	Distribution	Summary - I	Battery	No V	oltage/A	Imperage	Output,	CCCG = 5	

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9728488	0.9838839	0.9846190	0.9923949	0.9872159	4.2703E+02	6.9948E+00
α2	1.62E-03	6.37E-03	5.63E-03	1.37E-02	5.17E-03	2.7645E+00	4.3126E+02
α,	7.01E-04	4.30E-03	3.57E-03	1.04E-02	3.69E-03	1.8668E+00	4.3216E+02
α.,	3.76E-05	1.72E-03	1.04E-03	5.72E-03	1.30E-03	7.4650E-01	4.3328E+02
α,	4.94E-04	3.73E-03	3.00E-03	9.45E-03	2.62E-03	1.6170E+00	4.3241E+03

Table 1-14: Alpha Factor Distribution Summary - Battery No Voltage/Amperage Output, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9740430	0.9839752	0.9845835	0.9918218	0.9875319	5.1647E+02	8.4111E+00
α,	1.20E-03	4.98E-03	4.37E-03	1.09E-02	3.89E-03	2.6128E+00	5.2227E+02
α.,	7.79E-04	4.05E-03	3.44E-03	9.41E-03	3.36E-03	2.1272E+00	5.2275E+02
α.,	2.56E-04	2.59E-03	1.99E-03	6.96E-03	2.22E-03	1.3585E+00	5.2352E+02
as	1.21E-05	1.17E-03	6.25E-04	4.17E-03	7.83E-04	6.1290E-01	5.2427E+02
a.,	4.62E-04	3.24E-03	2.63E-03	8.08E-03	2.22E-03	1.6997E+00	5.2318E+02

NUREG/CR-5497

ALPHA FACTOR DISTRIBUTIONS DC Power Battery Chargers

Table 1-15: Alpha Factor Distribution Summary - Charger No Voltage/Amperage Output, CCCG = 2

Table 1-15. A	upha racion i		D.C. Har	95th%	MLE	8	b
Alpha Factor	5th%	Mean	Median		A COLUMN TWO IS NOT THE OWNER WATER AND AND A DOT THE OWNER WATER AND A DOT THE OWNER AN	2 77595-02	5 1733E+00
Construction of the second	0.9755644	0.9864840	0.9873253	0.9945362	0.9873822	3.7758E+02	5.17552.00
α,		1.35E-02	1.27E-02	2.44E-02	1.26E-02	5.1733E+00	3.7758E+02
α.	5.46E-03	1.350-02	1.476.08	And the second s	CONTRACTOR OF THE OWNER OWNER OF THE OWNER OWNE	A BARRY IS AND A BARRY IS A DATA OF	

Table 1-16: Alpha Factor Distribution Summary - Charger No Voltage/Amperage Output, CCCG = 3

ipna racioi L	Jist louron a	20 11-0	05+6%	MLE	2	b
5th%	Mean	Median		A CONTRACTOR OF A CONTRACTOR O	C 6721E+02	1 2139E+01
0.9678705	0.9786828	0.9792392	0.9875901	0.9795111	5.5/31E+02	1.21352.01
		and some research on the second s		1.80E-02	1.0339E+01	5.5911E+02
1.00E-02	1.82E-02	1.702-02		0.615 02	1 8010E+00	5 6765E+02
4.90E-04	3.16E-03	2.60E-03	7.74E-03	2.51E-03	1.80102400	5.01052
	5th% 0.9678705 1.00E-02	Sth% Mean 0.9678705 0.9786828 1.00E-02 1.82E-02	Sth% Mean Median 0.9678705 0.9786828 0.9792392 1.00E-02 1.82E-02 1.76E-02	Sth% Mean Median 95th% 0.9678705 0.9786828 0.9792392 0.9875901 1.00E-02 1.82E-02 1.76E-02 2.82E-02 2.60E-03 7.74E-03 2.74E-03	Sth% Mean Median 95th% MLE 0.9678705 0.9786828 0.9792392 0.9875901 0.9795111 1.00E-02 1.82E-02 1.76E-02 2.82E-02 1.80E-02 1.00E-02 1.82E-02 2.60E-03 7.74E-03 2.51E-03	Sth% Mean Median Still // Still

Table 1-17: Alpha Factor Distribution Summary - Charger No Voltage/Amperage Output, CCCG = 4

Table 1-17. A	And and a second s		Median	95th%	MLE	a	b
Alpha Factor	5th%	Mean			0.0766041	7.3980E+02	1.8432E+01
α,	0.9658384	0.9756914	0.9761114	0.9841213	0.2100011	1	PROPERTY AND INCOMES IN TRACK PARTICIPATION AND ADDRESS OF THE
G 1	8.65E-03	1.51E-02	1.47E-02	2.31E-02		1.1482E+01	COLOR OF A DESCRIPTION OF A DESCRIPTION OF THE REAL PROPERTY OF THE PROPERTY OF THE REAL PROP
Ø.2	8.05E-03		C 105 02	1.25E-02	6.81E-03	5.2458E+00	7.5299E+02
α,	2.81E-03	6.92E-03	6.49E-03		0.012	1.7037E+00	Contractor in station, which is shaded on the state of the
α,	3.22E-04	2.25E-03	1.83E-03	5.61E-03	1.67E-03	1.70376400	17.303312.03

Table 1-18: Alpha Factor Distribution Summary - Charger No Voltage/Amperage Output, CCCG = 5

Table 1-18: A	Jpha Factor L			95th%	MLE		b
Alpha Factor	5th%	Mean	Median	The second s	And the state of t	9.2478E+02	2 4786E+01
α,	0.9648649	0.9738979	0.9742318	0.9817981	0.9749025		Line one based becauty on a second of a second
u ₁		1.35E-02	1.31E-02	2.01E-02	1.33E-02	1.2776E+01	9.3679E+02
α.2	7.94E-03			1 19E-02	6.83E-03	6.6212E+00	9.4295E+02
α,	3.20E-03	6.97E-03	6.63E-03		0.000000	3.6520E+00	Contract of the owner own
	1.2 JE-03	3.85E-03	3.50E-03	7.63E-03	3.76E-03		CONTRACTOR OF THE OWNER WALL PORT OF THE OWNER
¢7.4	and prove the Constant of Cons	1.83E-03	1.49E-03	4.54E-03	1.27E-03	1.7365E+00	9.4783E+02
α.	2.69E-04	1.830-03	1.4912-05		And the subscription of th	or a constant of a general second sec	

Table 1-19: Alpha Factor Distribution Summary - Charger No Voltage/Amperage Output, CCCG = 6

Table 1-19: A			Median	95th%	MLE	8	b
Alpha Factor	5th%	Mean	and the other states and the state of the st		0.0716902	1.1074E+03	3 3332E+01
α,	0.9621408	0.9707803	0.9710582	0.9784809	0.9716802	and social risks of Section and Section and Section and Section and Section 201	A REAL PROPERTY AND ADDRESS OF THE OWNER.
W 1	7.52E-03	1.24E-02	1.21E-02	1.82E-02	1.23E-02	1.41001 01	1.1266E+0
α.,				1.11E-02	6.53E-03	7.6456E+00	1.1331E+0
α,	3.28E-03	6.70E-03	6.42E-03			4.8422E+00	1.1359E+0
α.,	1.64E-03	4.25E-03	3.96E-03	7.82E-03	4.16E-03	4.01.0	
564		3.19E-03	2.91E-03	6.34E-03	3.12E-03	3.6396E+00	1.1371E+0
α,	1.02E-03			E CAE 03	2.25E-03	3.0965E+00	1.1376E+0
α.,	7.62E-04	2.71E-03	2.43E-03	5.64E-03	6.650-05	1	1 and and an

ALPHA FACTOR DISTRIBUTIONS

NUREG/CR-5497

DC Power Battery Chargers

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9649838	0.9892422	0.9932855	0.9997226	0.9950344	7.1790E+01	7.8070E-01
α ₂	2.76E-04	1.08E-02	6.72E-03	3.50E-02	4.97E-03	7.8070E-01	7.1790E+01

Table 1-20: Alpha Factor Distribution Summary - Charger High Voltage/Amperage Output, CCCG = 2

Table 1-21: Alpha Factor Distribution Summary - Charger High Voltage/Amperage Output, CCCG = 3

Apha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9609826	0.9841820	0.9870264			1.0767E+02	1.7305E+00
α,	1.14E-03	1.20E-02	9.23E-03	3.26E-02	9.96E-03	1.3177E+00	1.0808E+02
α,	4.85E-06	3.77E-03	1.43E-03	1.55E-02	0.00E+00	4.1280E-01	1.0899E+02

Table 1-22: Alpha Factor Distribution Summary - Charger High Voltage/Amperage Output, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9567497	0.9789141	0.9810055	0.9939244	0.9849809	1.4675E+02	3.1610E+00
α,	3.59E-03	1.61E-02	1.40E-02	3.58E-02	1.50E-02	2.4148E+00	1.4750E+02
α,	5.06E-08	1.75E-03	3.39E-04	8.36E-03	0.00E+00	2.6260E-01	1.4965E+02
α,	1.07E-05	3.23E-03	1.43E-03	1.25E-02	0.00E+00	4.8360E-01	1.4943E+02

Table 1-23: Alpha Factor Distribution Summary - Charger High Voltage/Amperage Output, CCCG = 5	Table 1-23: Alpha	a Factor Distribution	Summary -	Charger High	Voltage/Amperage	Output, $CCCG = 5$
--	-------------------	-----------------------	-----------	--------------	------------------	--------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
œ,	0.9577666	0.9775451	0.9791626	0.9917905	0.9844117	1.8992E+02	4.3626E+00
α,	3.14E-03	1.32E-02	1.16E-02	2.89E-02	1.19E-02	2.5699E+00	1.9171E+02
α,	2.43E-04	5.02E-03	3.46E-03	1.51E-02	3.65E-03	9.7510E-01	1.9331E+02
α,	9.29E-09	1.20E-03	1.83E-04	5.94E-03	0.00E+00	2.3360E-01	1.9405E+02
α,	2.52E-05	3.01E-03	1.56E-03	1.09E-02	0.00E+00	5.8400E-01	1.9370E+02

Table 1-24: Alpha Factor Distribution Summary - Charger High Voltage/Amperage Output, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9567749	0.9752721	0.9765979	0.9892538	0.9818690	2.3160E+02	5.8722E+00
α2	3.10E-03	1.19E-02	1.06E-02	2.53E-02	1.11E-02	2.8311E+00	2.3464E+02
α,	8.36E-04	6.60E-03	5.28E-03	1.69E-02	5.57E-03	1.5676E+00	2.3591E+02
α.,	1.95E-05	2.44E-03	1.25E-03	8.87E-03	1.44E-03	5.7830E-01	2.3689E+02
α,	1.28E-08	1.03E-03	1.70E-04	5.00E-03	0.00E+00	2.4330E-01	2.3723E+02
a.	3.65E-05	2.75E-03	1.53E-03	9.57E-03	0.00E+00	6.5190E-01	2.3682E+02

2. DC Power Distribution Circuit Breakers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving DC power distribution circuit breakers at both pressurized water reactor (PWR) and boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure event reports from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify CCF events. Failure modes analyzed are failure to close and failure to remain closed (spurious open). The data cover the time period from 1980 through 1995.

The data review identified iour common-cause failure to close events, and two common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to close are shown in Tables 2-1 and 2-2, respectively. Table 2-3 contains the average impact vectors (N_1-N_6) and the number of adjusted independent events for this failure mode. Tables 2-4 through 2-6 contain the corresponding information for the failure to remain closed failure mode. The size of the affected population of circuit breakers is denoted as CCCG. The alpha factor model parameters are denoted by $\alpha_1-\alpha_6$. Beta (β), gamma (γ), delta (δ), epsilor (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 2-7 through 2-16.

2. SYSTEM DESCRIPTION

The DC distribution circuit breakers are part of the class 1E DC electrical power distribution system providing reliable power to various safety related components and instrumentation necessary for safe shutdown of the reactor plant. Most DC loads are supplied from 125 volt DC (VDC) panels through individual distribution breakers, though some plants may have 250 VDC distribution systems to support DC-powered motor-operated valves or other relatively large DC-powered loads. In general, each DC distribution circuit breaker configuration ensures that adequate instrumentation and safety related components are available for postulated accidents in the Final Safety Analysis.

Multiple trains or divisions are available to ensure DC power is supplied to redundant components. These DC distribution divisions typically number from as few as two to as many as eight depending on the design of the plant. The DC power is normally distributed to the loads from a battery charger in parallel with a battery. The battery charger is usually powered from a class 1E 480 VAC bus, supplied from off-site power or the emergency diesel generators. In the event power is not available from the normal source, dedicated station batteries supply DC power to the distribution system. A simplified schematic for a typical train or division of DC-power distribution is presented in Figure 2-1.

The DC distribution breakers are normally in the closed position regardless of whether the plant is at power or shutdown. Most of the DC distribution breakers are manipulated locally with only instrumentation available to the control room operator.

ALPHA FACTUR AND MGL PARAMETERS DC Power Distribution Circuit Breakers

	C	of Alpha	Factor	Parameter	Estimations	- Fail to Close	
Table 7-1	Summary	OI AIDIIA	Lacion	I MIGHTERED	And the supervision of the super	Browning restored and the second and the second	1

Table 2-	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Alpha Factor	0.9473154	0.9571841	0.9559739	0.9512818	0.9482570
α,	5.27E-02	1.04E-02	1.76E-02	2.21E-02	2.04E-02
α ₁	3.27E-02	3.24E-02	1.90E-03	6.19E-03	9.91E-03
α,		5.240 02	2.45E-02	6.64E-04	3.94E-03
α.,				1.98E-02	8.03E-04
α,					1.67E-02
α.,				Landon management of the second	and the star start of the start

Table 2-2: Summary of MGL Parameter Estimations - Fail to Close

	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
MGL Parameter			9.56E-01	9.51E-01	9.48E-01
1-Beta	9.47E-01	9.57E-01		4.87E-02	5.17E-02
Beta	5.27E-02	4.28E-02	4.40E-02	THE REAL PROPERTY AND ADDRESS OF TAXABLE PARTY AND ADDRESS OF TAXABLE PARTY.	6.05E-01
Gamma		7.57E-01	6.00E-01	5.47E-01	
Delta		1	9.28E-01	7.68E-01	6.84E-01
CAVE SECTION AND AND AN ADDRESS OF ADDRESS O				9.68E-01	8.16E-01
Epsilon					9.54E-01
Mu			1	A STREET, IS IN CAMPACITY OF A STREET, STREET, CO.S.	1

Table 2-3: Summary of Average Impact Vectors - Fail to Close

ANY OWN IN THE PROPERTY AND ADDRESS OF A DESCRIPTION OF A	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Avg. Impact Vector	and the second	27.20	36.27	45.33	54.40
Adj. Ind. Events	18.13	2.6450	2.9017	2.8001	2.7358
N,	1.9798		0.7220	1.1163	1.2304
N ₂	1.1184	0.3250	0.0780	0.3134	0.5969
N,		1.0100	And the subscription of the subscription of the subscription of	0.0336	0.2374
N,			1.0040		0.0484
N ₅				1.0016	1.0046
N.					1.0040

Total Number of Independent Failure Events: 34 Total Number of Common-Cause Failure Events: 4

NUREG/CR-5497

ALPHA FACTOR AND MGL PARAMETERS DC Power Distribution Circuit Breakers

	Table 2-4	Summar	y of Alpha	Factor	Parameter	Estimations -	Fail	to Rem	ain Closed
--	-----------	--------	------------	--------	-----------	---------------	------	--------	------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
a,	0.9933168	0.9865754	0.9797273	0.9835007	0.9859907
α,	6.68E-03	1.34E-02	2.03E-02	8.52E-03	4.00E-03
α,		0.00E+00	0.00E+00	7.98E-03	6.67E-03
α.4			0.00E+00	0.00E+00	3.34E-03
α _s				0.00E+00	0.00E+00
as				A CONTRACTOR OF	0.00E+00

Table 2-5: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.93E-01	9.87E-01	9.80E-01	9.84E-01	9.86E-01
Beta	6.68E-03	1.34E-02	2.03E-02	1.65E-02	1.40E-02
Gamma		0.00E+00	0.00E+00	4.84E-01	7.14E-01
Delta			0.00E+00	0.00E+00	3.33E-01
Epsilon	and a second second second second second			0.00E+00	0.00E+00
Mu					0.00E+00

Table 2-6: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	24.00	36.00	48.00	60.00	72.00
Ni	1.3264	1.4800	1.2940	1.5994	1.9000
N ₁	0.1704	0.5100	1.0200	0.5334	0.3000
N,	and an and a second descent of the second	0.0000	0.0000	0.5000	0.5000
N,			0.0000	0.0000	0.2500
N ₅				0.0000	0.0000
N.	And Annotable to Provide a second second second	Contraction of the second s			0.0000

Total Number of Independent Failure Events: 60 Total Number of Common-Cause Failure Events: 2

DC Distribution Breakers

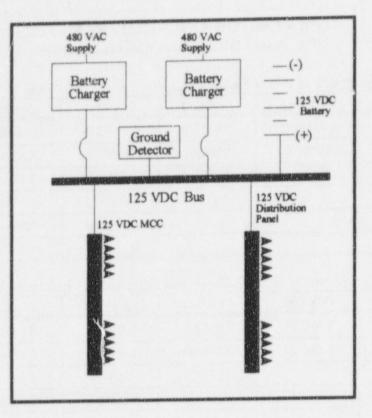


Figure 2-1. Generic DC distribution system.

3. COMPONENT BOUNDARIES

The safety function of a DC circuit breaker is to connect a power source to a load, monitor the current flow through the breaker, and isolate the load from the source if the current demand exceeds the design current flow or when an external trip signal is initiated. This action protects both the source and the load from equipment damage and executes the design function of the breaker.

DC circuit breakers have overcurrent protection that is a built in part of breaker unit. Most circuit breakers, especially for safety related equipment applications, provide additional protection by monitoring such parameters as under voltage, ground faults, and other protection schemes as required for breaker/system protection or the specific safety application. This additional spplication hardware is generally located exterior to the circuit breaker and merely utilizes the remote operating features of the breaker. This hardware as well as the remote operating hardware is considered integral to the function of the circuit breaker and part of the breaker for failure analysis. It includes all sensing devices, cabling, and components necessary to process the signals and provide control signals to the individual breaker.

4. FAILURE EVENT DEFINITION

Successful DC distribution breakers system response to a demand requires that DC electrical power be available to the required safety related loads for the duration of the mission time. The failure modes used in evaluating the DC distribution breakers data were:

- OO Failure to Close: The breaker did not close or would not have been able to close if a close signal had been generated. A failure reported as a miscalibration with no indication of high or low will be coded as "CC."
- SA Failure to Remain Closed (Spurious Operation): The breaker opened when it should have stayed closed, as a result of a breaker fault. (There were no events of a spurious closing breaker found in the data review.) Some reports state that the breaker was found in the tripped condition; these are considered SA. Also included are spurious operation of the breaker due to bumping the cabinet or radio interference.

A breaker found open when it should have been closed, with no indication that it had ever been closed, and incapable of actuating due to physical block (e.g. locked or actually out of the cabinet) was considered a CC.

Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of breaker demand. The exception to this is if a licensee reported that the breaker "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the breaker from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that a second circuit breaker would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another circuit breaker, then the event was identified as a CCF. If, however, the report did not clearly identify that another circuit breaker would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to a circuit breaker demand (e.g. the condition was found during inspection, and no actual demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 2-7 through 2-16 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of DC distribution breakers. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS DC Power Distribution Circuit Breakers

Table 2-7	Alpha Factor	Distribution	Summary	- Fail	to Close,	CCCG = 2	

Alpha Factor	5th%	Mean	Median	95th%	MLE	2	b
	0.8731594	0.9491360	0.9584446	0.9931974	0.9473154	2.9640E+01	1.5884E+00
QL,	6.80E-03	5.09E-02	4.16E-02	1.27E-01	5.27E-02	1.5884E+00	2.9640E+01

Table 2-8: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
anadamenanananananan A1	0.8969182	0.9547478	0.9610404	0.9910350	0.9571841	4.5045E+01	2.1350E+00
α,	2.84E-04	1.51E-02	9.00E-03	5.07E-02	1.04E-02	7.1220E-01	4.6468E+01
α,	3.31E-03	3.02E-02	2.38E-02	7.88E-02	3.24E-02	1.4228E+00	4.5757E+01

Table 2-9: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha factor	5th%	Miean	Median	95th%	MLE	8	b
α,	0.9053988	0.9536551	0.9581134	0.9866630	0.9559739	6.3872E+01	3.1040E+00
CL ₁	1.70E-03	1.91E-02	1.45E-02	5.19E-02	1.76E-02	1.2758E+00	6.5700E+01
α,	1.63E-06	5.09E-03	1.52E-03	2.23E-02	1.90E-03	3.4060E-01	6.6635E+01
Ø.,	2.62E-03	2.22E-02	1.77E-02	5.74E-02	2.45E-02	1.4876E+00	6.5488E+01

Table 2-10: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
L.	0.9093273	0.9511836	0.9544780	0.9817768	0.9512818	8.6172E+01	4.4225E+00
a.	3.30E-03	2.04E-02	1.69E-02	4.91E-02	2.21E-02	1.8443E+00	8.8750E+01
α,	1.60E-04	8.01E-03	4.79E-03	2.68E-02	6.19E-03	7.2540E-01	8.9869E+01
α.,	1.03E-07	2.95E-03	5.91E-04	1.40E-02	6.64E-04	2.6720E-01	9.0327E+01
a _s	2.27E-03	1.75E-02	1.41E-02	4.44E-02	1.98E-02	1.5856E+00	8.9090E+01

Table 2-11: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b		
α,	0.9127378	0.9501542	0.9527894	0.9785713	0.9482570	1.0761E+02	5.6453E+00		
α,	3.21E-03	1.77E-02	1.50E-02	4.17E-02	2.04E-02	2.0950E+00	1.1125E+02		
α,	7.02E-04	1.00E-02	7.34E-03	2.86E-02	9.91E-03	1.1375E+00	1.1212E+02		
α.,	3.10E-05	4.86E-03	2.41E-03	1.80E-02	3.94E-03	5.5010E-01	1.1271E+02		
as	2.14E-07	2.58E-03	6.03E-04	1.19E-02	8.03E-04	2.9170E-01	1.1296E+02		
a.,	2.03E-03	1.46E-02	1.19E-02	3.66E-02	1.67E-02	1.6565E+00	1.1160E+02		

ALPHA FACTOR DISTRIBUTIONS DC Power Distribution Circuit Breakers

Table 2-12: Alpha Factor Distribution Summary - Fa	ail to Remain Closed, $CCCG = 2$	
--	----------------------------------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9371516	0.9819588	0.9898860	0.9997741	0.9933168	3.4856E+01	6.4040E-01
α,	2.28E-04	1.80E-02	1.01E-02	6.29E-02	6.68E-03	6.4040E-01	3.4856E+01

Table 2-13: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9346175		1		1	5.2680E+01	1.310E+00
α2	6.51E-04	1.66E-02	1.11E-02	5.13E-02	1.34E-02	8.9720E-01	5.3093E+01
α,	9.89E-06	7.65E-03	2.91E-03	3.13E-02	0.00E+00	4.1280E-01	5.3577E+01

Table 2-14: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9320285	0.9695993	0.9736112	0.9934481	0.9797273	7.3994E+01	2.3200E+00
α,	2.66E-03	2.06E-02	1.66E-02	5.24E-02	2.03E-02	1.5738E+00	7.4740E+01
α,	9.99E-08	3.44E-03	6.68E-04	1.64E-02	0.00E+00	2.6260E-01	7.6051E+01
α.,	2.10E-05	6.34E-03	2.82E-03	2.46E-02	0.00E+00	4.8360E-01	7.5830E+01

Table 2-15: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9394756	0.9708570	0.9738659	0.9919555	0.9835007	9.9641E+01	2.9910E+00
α2	1.07E-03	1.23E-02	9.30E-03	3.38E-02	8.52E-03	1.2614E+00	1.0137E+02
α,	3.61E-04	8.89E-03	5.97E-03	2.74E-02	7.98E-03	9.1200E-01	1.0172E+02
α.4	1.76E-08	2.28E-03	3.46E-04	1.12E-02	0.00E+00	2.3360E-01	1.0240E+02
α,	4.79E-05	5.69E-03	2.95E-03	2.06E-02	0.00E+00	5.8400E-01	1.0205E+02

Table 2-16: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9447094	0.9720386	0.9744660	0.9910729	0.9859907	1.2437E+02	3.5776E+00
α1	5.23E-04	8.43E-03	6.05E-03	2.45E-02	4.00E-03	1.0791E+00	1.2687E+02
α,	4.63E-04	8.13E-03	5.75E-03	2.39E-02	6.67E-03	1.0406E+00	1.2691E+02
α,	3.12E-05	4.40E-03	2.22E-03	1.62E-02	3.34E-03	5.6270E-01	1.2739E+02
α,	2.37E-08	1.90E-03	3.16E-04	9.28E-03	0.00E+00	2.4330E-01	1.2770E+02
α,	6.80E-05	5.10E-03	2.85E-03	1.78E-02	0.00E+00	6.5190E-01	1.2730E+02

NUREG/CR-5497

.

3. 4160 Volt AC Power Distribution Circuit Breakers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving 4160 volt AC (VAC) circuit breakers at both pressurized water reactors (PWR) and boiling water reactors (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to close and failure to remain closed (spurious open). The data cover the time period from 1980 through 1995.

The data review identified 21 common-cause failure to close events and 7 common cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to close are shown in Tables 3-1 and 3-2, respectively. Table 3-3 contains the average impact vectors (N_1-N_6) and the number of adjusted independent events for this failure mode. Tables 3-4 through 3-6 contain the corresponding information for the failure to remain closed failure mode. The size of the affected population of circuit breakers is denoted as CCCG. The alpha factor model parameters are denoted by $\alpha_1-\alpha_6$. Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 3-7 through 3-16.

2. SYSTEM DESCRIPTION

The 4160 VAC circuit breakers are part of the AC electrical power distribution system that supply power to safety related and non-safety related large loads. For the purpose of this study, only those breakers supplying safety related loads will be considered. These breakers are normally remotely operated but may also be locally operated in most cases.

The 4160 VAC breakers considered here are feeder breakers to smaller electrical distribution centers (480 VAC motor control center), breakers between two 4160 busses, and the supply feeder breakers from off-site power. Breakers which supply power to 4160 volt busses, as well as breakers supplying loads from the 4160 busses, were considered. Circuit breakers that supply individual components (e.g. safety injection pumps) are not included in this study, but are included in the component studies as a part of the individual component. Breakers used to supply power from an emergency diesel generator (EDG) to a 4160 volt bus will be specifically excluded and will be considered under a separate study of EDGs. Figure 3-1 shows a typical AC power distribution system. The circuit breakers considered in this study are enclosed in boxes.

2.46E-02

6.87E-03

1.28E-04

9.12E-03

1.06E-02

ALPHA FACTOR AND MGL PARAMETERS 4160 Volt AC Power Distribution Breakers

I doit 5-1	. Summary or 1	upila i actor i c			and the second
Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9615087	0.9467144	0.9483494	0.9486893	0.9486355

2.05E-02

1.55E-02

1.56E-02

2.36E-02

4.19E-03

1.09E-02

1.27E-02

3.21E-02

2.12E-02

3.85E-02

α2

a.,

α.

α,

a.

Table 3-1: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 3-2:	Summary	ot	MGL	Parameter	Estimations	- Fail to	Close	
ALLOS CAPPAL APPROXIMATION AND APPROXIMATION OF A DESCRIPTION OF A DESCRIP	THE REAL PROPERTY AND DESCRIPTION OF ADDRESS OF ADDRESS AND ADDRESS AD	-	ALC MARCHINE ROUTE AND	and the second s	OF R REAL PROPERTY AND ADDRESS OF THE REAL PROPERTY ADDRESS OF THE REAL PR	And the state of the second	And appropriate the second second of the second sec	1

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.62E-01	9.47E-01	9.48E-01	9.49E-01	9.49E-01
Beta	3.85E-02	5.33E-02	5.17E-02	5.13E-02	5.14E-02
Gamma	na a charann ann an Anna ann	3.98E-01	6.02E-01	5.40E-01	5.21E-01
Delta			5.02E-01	8.49E-01	7.43E-01
Epsilon				5.37E-01	9.94E-01
Mu					5.38E-01

Table 3-3: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	57.53	86.30	115.07	143.84	172.60
N,	10.0880	10.8399	12.6096	13.6983	14.6228
N ₂	2.7069	3.2941	2.7657	3.9164	4.8554
N,	and the dependence of the second of the second s	2.1734	2.0850	0.6952	1.3559
N4	ana panana ana panana ana panana ana panana		2.1032	1.8089	0.0252
N ₅	nend det Fahrindelik op as sy stansas skot en			2.1001	1.8008
N ₆					2.1000

Total Number of Independent Failure Events: 189 Total Number of Common-Cause Failure Events: 21

ALPHA FACTOR AND MGL PARAMETERS 4160 Volt AC Power Distribution Breakers

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9508714	0.9514366	0.9566398	0.9578107	0.9600692
α2	4.91E-02	2.25E-02	1.62E-02	1.23E-02	9.82E-03
α,		2.61E-02	1.04E-02	1.08E-02	7.86E-03
Ø.4			1.68E-02	7.06E-03	8.44E-03
α,			Contrast and the second start and second starts	1.21E-02	4.43E-03
a.					9.38E-03

Table 3-4: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Table 3-5: Summary of MGL Parameter Estimations- Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.51E-01	9.51E-01	9.57E-01	9.58E-01	9.60E-01
Beta	4.91E-02	4.86E-02	4.34E-02	4.22E-02	3.99E-02
Gamma	and a second	5.37E-01	6.26E-01	7.09E-01	7.54E-01
Velta	an a		6.17E-01	6.38E-01	7.39E-01
Epstion				6.31E-01	6.21E-01
Mu	an de la la la companya de la compa	A CONTRACTOR OF THE OWNER	A REAL PROPERTY AND A REAL PROPERTY AND A REAL PROPERTY AND A		6.79E-01

Table 3-6: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	35.00	52.50	70.00	87.50	105.00
N,	2.1611	1.9040	1.8248	1.5196	1.2858
N ₁	1.9200	1.2858	1.2163	1.1393	1.0870
N,		1.4911	0.7810	1.0065	0.8705
N.			1.2582	0.6558	0.9348
N ₃		l		1.1195	0.4904
N ₆	an a			Construction of Construction of Construction of Construction	1.0379

Total Number of Independent Failure Events: 140 Total Number of Common-Cause Failure Events: 7

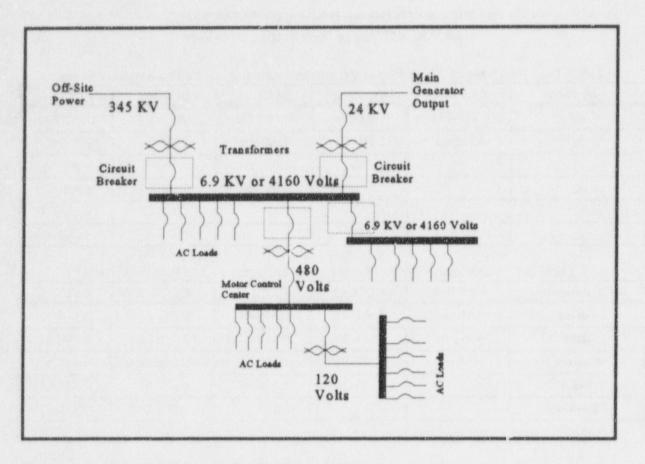


Figure 3-1. Generic AC power distribution system.

3. COMPONENT BOUNDARIES

The super component, the 4160 VAC circuit breaker, is defined as the breaker itself and the equipment contained in the breaker cubicle. External equipment used to monitor under voltage, ground faults, differential faults, and other protection schemes for individual breakers are also considered part of the breaker.

AC circuit breakers have overcurrent protection that is integral to the breaker unit. Most circuit breakers, especially for safety related equipment applications, provide additional protection by monitoring such parameters as under voltage, differential faults, ground faults, and other protection schemes as required for breaker/system protection or the specific safety application. This additional application hardware is generally located external to the circuit breaker and merely utilizes the remote operating features of the breaker. This hardware, as well as the remote operating hardware, is considered integral to the function of the circuit breaker for failure analysis. It includes all sensing devices, cabling, and components necessary to process the signals and provide control signals to the individual breaker.

4. FAILURE EVENT DEFINITION

Successful 4160 VAC circuit breaker response to a demand requires that the 4160 VAC circuit breaker provide electrical power to the bus or load for the duration of the mission time. The failure modes used in evaluating the 4160 VAC circuit breaker data are:

- OO Failure to Close: The breaker did not close or would not have been able to close if a close signal had been generated. A failure reported as a miscalibration with no indication of high or low will be coded as "CC".
- SA Failure to Remain Closed (Spurious Operation): The broader opened when it should have stayed closed, as a result of a breaker fault. Some reports indicate that the breaker was found in the tripped condition; these are considered CX. Also included are spurious operation of the breaker due to bumping the cabinet or radio interference.

A breaker found open when it should have been closed, with no indication that it had ever been closed, and incapable of actuating due to physical block (e.g. locked or actually out of the cabinet) was considered a CC.

Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of breaker demand. The exception to this is if a licensee reported that the breaker "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the breaker from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that a second circuit breaker would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another circuit breaker, then the event was identified as a CCF. If, however, the report did not clearly identify that another circuit breaker would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to an circuit breaker actuation demand (e.g. the condition was found during inspection, and no actual demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 3-7 through 3-16 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of 4160 volt breakers. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS 4160 Volt AC Power Distribution Breakers

Table 3-7: Alpha Factor Distribution Summar	y - Fail to Remain Closed, C	CCG = 2
---	------------------------------	---------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9195659	0.9604494	0.9642149	0.9884371	0.9615087	7.7148E+01	3.1769E+00
α,	1.16E-02	3.96E-02	3.58E-02	8.04E-02	3.85E-02	3.1769E+00	7.7148E+01

Table 3-8: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	B	b
α,	0.9097540	0.9471576	C.9496600	0.9760211	0.9467144	1.1234E+02	6.2675E+00
α,	1.01E-02	3.10E-02	2.84E-02	6.08E-02	3.21E-02	3.6813E+00	1.1493E+02
α,	5.24E-03	2.18E-02	1.92E-02	4.74E-02	2.12E-02	2.5862E+00	1.1602E+02

Table 3-9: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α1	0.9172217	0.9486167	0.9504691	0.9736767	0.9483494	1.5238E+02	8.2539E+00
α,	6.20E-03	2.07E-02	1.87E-02	4.18E-02	2.05E-02	3.3195E+00	1.5731E+02
α,	3.16E-03	1.46E-02	1.27E-02	3.28E-02	1.55E-02	2.3476E+00	1.5829E+02
α,	3.86E-03	1.61E-02	1.41E-02	3.51E-02	1.56E-02	2.5868E+00	1.5805E+02

Table 3-10: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9217985	0.9491493	0.9505953	0.9715542	0.9486893	1.9558E+02	1.0478E+01
α,	8.58E-03	2.25E-02	2.10E-02	4.17E-02	2.36E-02 .	4.6444E+00	2.0141E+02
α,	3.53E-04	5.37E-03	3.88E-03	1.55E-02	4.19E-03	1.1072E+00	2.0495E+02
α.,	1.82E-03	9.91E-03	8.38E-03	2.33E-02	1.09E-02	2.0425E+00	2.0402E+0
as	3.23E-03	1.30E-02	1.15E-02	2.81E-02	1.27E-02	2.6841E+00	2.0337E+02

Table 3-11: Alpha Factor Distribution Summ	ary - Fail to Remain Closed, $CCCG = 6$

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
a	0.9248135	0.9494143	0.9506095	0.9699408	0.9486355	2.3770E+02	1.2665E+01
α1	9.57E-03	2.25E-02	2.13E-02	3.98E-02	2.46E-02	5.6345E+00	2.4473E+02
α,	1.26E-03	7.58E-03	6.31E-03	1.82E-02	6.87E-03	1.8965E+00	2.4847E+02
α,	4.04E-07	1.35E-03	3.95E-04	5.94E-03	1.28E-04	3.3790E-01	2.5030E+02
α,	1.50E-03	8.16E-03	6.90E-03	1.92E-02	9.12E-03	2.0441E+00	2.4832E+02
a.	2.79E-03	1.10E-02	9.72E-03	2.36E-02	1.06E-02	2.7519E+00	2.4761E+02

ALPHA FACTOR DISTRIBUTIONS 4160 Volt AC Power Distribution Breakers

Table 3-12: Alpha Factor Distribution Summar	y - Fail to Close, $CCCG = 2$
--	-------------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.8929497	0.9513050	0.9573305	0.9890407	0.9508714	4.6691E+01	2.390E+00
α2	1.10E-02	4.87E-02	4.27E-02	1.07E-01	4.91E-02	2.390E+00	4.6691E+01

Table 3-13: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Meun	Median	95th%	MLE	R	b
œ.,	0.9041008	0.9511225	0.9551858	0.9842352	0.9514366	6.9604E+01	3.5769E+00
α,	3.24E-03	2.29E-02	1.87E-02	5.68E-02	2.25E-02	1.6730E+00	7.1508E+01
α,	4.42E-03	2.60E-02	2.18E-02	6.20E-02	2.61E-02	1.9039E+00	7.1277E+01

Table 3-14: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9167994	0.9549320	0.9579085	0.9828894	0.9566398	9.6525E+01	4.5555E+00
α.2	2.68E-03	1.75E-02	1.44E-02	4.29E-02	1.62E-02	1.7701E+00	9.9310E+01
α,	5.94E-04	1.03E-02	7.32E-03	3.03E-02	1.04E-02	1.0436E+00	1.0040E+02
α,	2.58E-03	1.72E-02	1.42E-02	4.24E-02	1.68E-02	1.7418E+00	9.9339E+01

Table 3-15: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

					anningay seas ta tanta in the system content that they do		
Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9231756	0.9557788	0.9580466	0.9806273	0.9578107	1.2706E+02	5.8787E+00
α,	2.31E-03	1.41E-02	1.17E-02	3.38E-02	1.23E-02	1.8673E+00	1.3107E+02
α,	1.15E-03	1.07E-02	8.34E-03	2.82E-02	1.08E-02	1.4185E+00	1.3152E+02
α.,	2.53E-04	6.69E-03	4.43E-03	2.08E-02	7.06E-03	8.8940E-01	1.3205E+02
a,	1.85E-03	1.28E-02	1.05E-02	3.18E-02	1.21E-02	1.7035E+00	1.3124E+02

Table 3-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9289252	0.9575574	0.9594123	0.9798560	0.9600692	1.5676E+02	6.9482E+00
α,	1.87E-03	1.14E-02	9.48E-03	2.75E-02	9.82E-03	1.8661E+00	1.6184E+02
α,	9.17E-04	8.62E-03	6.72E-03	2.28E-02	7.86E-03	1.4111E+00	1.6230E+02
C.	6.44E-04	7.62E-03	5.73E-03	2.11E-02	8.44E-03	1.2475E+00	1.6246E+02
α,	9.26E-05	4.48E-03	2.69E-03	1.50E-02	4.43E-03	7.3370E-01	1.6298E+02
α.,	1.47E-03	1.03E-02	8.41E-03	2.57E-02	9.38E-03	1.6898E+00	1.6202E+02

4. Reactor Trip Circuit Breakers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving reactor trip circuit breakers (RTB) at pressurized water reactor (PWR) power plants. Due to the difference in the control rod drive systems between the boiling water reactors (BWRs) and the PWRs, data for the BWR reactor trip system were not included here. Licensee Event Reports (LERs) and failure reports from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify CCF events. The only failure mode analyzed is failure to open. The data cover the time period from 1980 through 1995.

The data review identified 26 common-cause failure to open events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 4-1 and 4-2, respectively. Table 3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events. The size of the affected population of RTBs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 4-4 through 4-8.

2. SYSTEM DESCRIPTION

The RTBs are part of the reactor protection system, and supply power to the control rod drive mechanisms. Both AC and DC breakers are used for the RTBs. On a reactor trip signal, the breakers will open, removing power from the control rod drive mechanisms. The control rods will then unlatch and drop into the reactor core due to gravity. Figure 4-1 shows the RTB arrangement for a 4-RTB plant.

ALPHA	FACTOR AND MGL PARAMETERS	
	Reactor Trip Breakers	

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9345364	0.9080446	0.9127947	0.9031512	0.9060815
α.,	6.55E-02	5.67E-02	2.69E-02	3.91E-02	2.85E-02
α,		3.52E-02	3.70E-02	1.45E-02	2.45E-02
α,			2.34E-02	2.47E-02	6.73E-03
an a sure of the second s				1.86E-02	1.86E-02
α,			1		1.55E-02
α.,				1	1.556

Table 4-1: Summary of Parameter Estimations - Fail to Open

Table 4-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.35E-01	9.08E-01	9.13E-01	9.03E-01	9.06E-01
Beta	6.55E-02	9.20E-02	8.72E-02	9.69E-02	9.39E-02
Gamma		3.83E-01	6.92E-01	5.96E-01	6.96E-01
Delta			3.87E-01	7.49E-01	6.25E-01
Epsilon		1		4.30E-01	8.35E-01
Mu				a rest of the second	4.55E-01

Table 4-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	35.77	53.66	71.55	89.43	107.32
N.	9.8793	9.5893	11.1638	10.1976	10.7098
N ₂	3.1977	3.9513	2.4333	4.3167	3.7172
N,		2.4538	3.3525	1.6001	3.1938
N	a contractor and an out for an and an out		2.1164	2.7196	0.8772
N.	and Andrew Concerning and an and an and a second an			2.0471	2.4226
N.		And the Parameter of the Annual Parameter			2.0234

Total Number of Independent Failure Events: 110 Total Number of Common-Cause Failure Events: 26

Reactor Trip Breakers

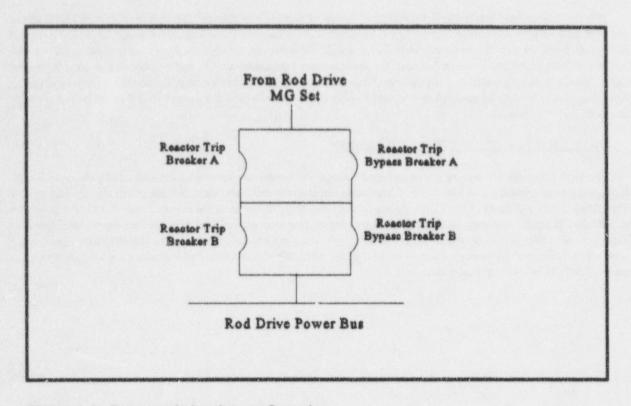


Figure 4-1. Reactor trip breaker configuration.

3. COMPONENT BOUNDARIES

The component, RTB, is defined as the breaker itself as well the components that control the individual breakers. The component would include those circuit breakers that supply the power which causes the breaker to remain closed. The circuitry that provides input power to the breakers is not viewed as part of the breaker.

4. FAILURE EVENT DEFINITION

Successful RTB response to a demand requires that the control rods are released and the reactor trips. The only failure mode used in evaluating the RTB data is:

CC Failure to Open: The breaker did not open or would not have been able to open if an open signal had been generated. Slow opening times are considered to be failures.

For purposes of this CCF study, a personnel error resulting in more than one functionally inoperable RTBs (even without any component malfunction) was considered a CCF failure.

Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of breaker demand. The exception to this is if a licensee reported that the breaker "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the breaker from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second RTB would have occurred from the same cause if a scram signal was present. If the cause of the actual failure would have clearly caused failure of another RTB, then the event was identified as a CCF. If, however, the report did not clearly identify that another RTB would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to a RTB demand (e.g. the condition was found during inspection, and no actual demand failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPL'A FACTOR DISTRIBUTION SUMMARIES

Tables 4-4 through 4-8 present the alpha factor uncertainty distribution summaries for each configuration of RTBs. Westinghouse plants typically have four RTBs; Combustion Engineering and Babcock & Wilcox plants can have up to nine RTBs. Due to the limitations of the CCF software in analyzing large redundancy components, the CCCG of 6 is used to represent the CE and B&W plants. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

Reactor Trip Breakers

ALPHA FACTOR DISTRIBUTIONS Reactor Trip Breakers

3 55	ore that The	na i actor L	ristribution	Summary - 1	an to open	,	
Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8791355	0.9376736	0.9425879	0.9793896	0.9345364	5.5179E+01	3.6677E+00
α.2	2.06E-02	6.23E-02	5.74E-02	1.21E-01	6.55E-02	3.6677E+00	5.5179E+01

Table 4-4: Alpha Factor Distribution Summary - Fail to Open. CCCG = 2

Table 4-5: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8618842	0.9158815	0.9191093	0.9588360	0.9080446	7.8449E+01	7.2051E+00
α,	1.87E-02	5.07E-02	4.72E-02	9.45E-02	5.67E-02	4.3385E+00	8.1316E+01
α,	8.92E-03	3.35E-02	2.99E-02	7.02E-02	3.52E-02	2.8666E+00	8.2788E+01

Table 4-6: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.8764690	0.9210872	0.9234878	0.9574900	0.9127947	1.0741E+02	9.2022E+00
α,	7.05E-03	2.56E-02	2.30E-02	5.33E-02	2.69E-02	2.9871E+00	1.1363E+02
α,	9.99E-03	3.10E-02	2.84E-02	6.11E-02	3.70E-02	3.6151E+00	1.1300E+02
α,	5.38E-03	2.23E-02	1.96E-02	4.84E-02	2.34E-02	2.6000E+00	1.1401E+02

Table 4-7: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8758854	0.9159004	0.9177401	0.9496183	0.9031512	1.3767E+02	1.2641E+01
α2	1.35E-02	3.36E-02	3.15E-02	6.07E-02	3.91E-02	5.0447E+00	1.4527E+02
α,	2.42E-03	1.34E-02	1.13E-02	3.15E-02	1.45E-02	2.0121E+00	1.4830E+02
α.,	5.34E-03	1.97E-02	1.76E-02	4.11E-02	2.47E-02	2.9532E+00	1.4736E+02
as	4.27E-03	1.75E-02	1.54E-02	3.79E-02	1.86E-02	2.6311E+00	1.4768E+02

Table 4-8: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8840584	0.9194497	0.9209712	0.9496321	0.9060815	1.6850E+02	1.4762E+01
α,	9.16E-03	2.45E-02	2.28E-02	4.58E-02	2.85E-02	4.4963E+00	1.7877E+02
α,	6.69E-03	2.04E-02	1.87E-02	3.99E-02	2.45E-02	3.7344E+00	1.7953E+02
α4	4.98E-04	6.49E-03	4.81E-03	1.82E-02	6.73E-03	1.1899E+00	1.8207E+02
a _s	3.58E-03	1.46E-02	1.28E-02	3.14E-02	1.86E-02	2.6659E+00	1.8060E+02
α.,	3.61E-03	1.46E-02	1.29E-02	3.15E-02	1.55E-02	2.6753E+00	1.8059E+02

47

5. Emergency Diesel Generators

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common cause failure (CCF) parameters of various models using operational data involving emergency diesel generators (EDGs) at both pressurized water reactor (PWR) and boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and special reports retrieved from NUDOCS have been screened to identify common cause failure events. Failure modes analyzed are failure to start and failure to run. The data cover the time period from 1980 through 1995.

The data review identified 55 common cause failure-to-start events and 76 common cause failure-to-run events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to start are shown in Tables 5-1 and 5-2, respectively. Table 5-3 contains the average impact vectors (N₁-N₃) and the number of adjusted independent events for this failure mode. Tables 5-4 through 5-6 contain the corresponding information for the failure to run failure mode. The size of the affected population of EDGs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_4 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 5-7 through 5-14.

Important events identified during the data review include two events in which the failure of a single component, (rather than multiple components) resulted in the failure of more than one EDG. In one case, the fuel oil storage tank isolation valve was locked closed instead of locked open, which limited the fuel supply for each EDG to the contents of the day tank. The other event was caused by a mispositioned service water valve that resulted in three EDGs overheating.

2. SYSTEM DESCRIPTION

The emergency diesel generators (EDGs) are part of the class 1E AC electrical power distribution system providing reliable emergency power to electrical buses that supply the emergency core cooling system (ECCS) and various other equipment necessary for safe shutdown of the reactor plant. In general, each EDG configuration ensures that adequate electrical power is available in a postulated loss-of-offsite power (LOSP), with or without a concurrent large break loss of coolant accident (LOCA). Gas turbine generators and hydroelectric generators (used at some locations for emergency power) are not part of this study. High pressure core spray diesels are considered (for this study) to be a separate train of the emergency AC power system. Diesel engines used for fire pumps, Appendix R purposes, or non-class 1E backup generators are not included.

The EDGs are normally in standby, whether the plant is at power or shutdown. At least one EDG is required by Technical Specifications to be aligned to provide emergency power to safety related electrical buses in case of a LOSP to the plant. In some cases a "swing" EDG is used that can supply power to more than one power plant (but not simultaneously) such that two power plants will have a total of only three EDGs: one EDG dedicated to each specific power plant, and the third, a swing EDG, capable of powering either plant. Electrical load shedding (intentional load removal) of the safety bus and subsequent sequencing of required loads after closure of the EDG output breaker, is considered part of the EDG function. The EDG system is automatically actuated by signals that sense either a loss of coolant accident or a loss of, or degraded, electrical power to its safety bus. Manual initiation of the EDG system is accomplished by the control room operator if necessary.

ALPHA FACTOR AND MGL PARAMETERS Emergency Diesel Generators

CCCG=2	CCCG=3	CCCG=4	CCCG=5
0.9688323	0.9630082	0.9636932	0.9635193
3.12E-02	2.04E-02	1.35E-02	1.22E-02
and a second	1.66E-02	1.14E-02	8.34E-03
and a subsect of the subse	Construction of the second	1.14E-02	6.99E-03
		a succession of the second	8.92E-03
	0.9688323	0.9688323 0.9630082 3.12E-02 2.04E-02	0.9688323 0.9630082 0.9636932 3.12E-02 2.04E-02 1.35E-02 1.66E-02 1.14E-02

Table 5-1: Summary of Alpha Factor Parameter Estimations - Fail to Start

Table 5-2: Summary of MGL Parameter Estimations - Fail to Start

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5
1-Beta	9.69E-01	9.63E-01	9.64E-01	9.64E-01
Beta	3.12E-02	3.70E-02	3.63E-02	3.65E-02
Gamma		4.50E-01	6.27E-01	6.65E-01
Delta			5.01E-01	6.56E-01
Epsilon				5.61E-01

Table 5-3: Summary of Average Impact Vectors - Fail to Start

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5
Adj.Ind.Events	544.37	816.55	1088.73	1360.92
N,	30.0085	24.2744	19.7472	11.9150
N ₁	18.4780	17.7723	15.5719	17.4351
N,	Opened and the opened of the second second	14.5261	13.0616	11.8825
N,			13.1280	9.9522
N,	ann an an an an Poince and Anno Chainmailt and Anno Poince and			12.7084

Total Number of Independent Failure Events: 773 Total Number of Common Cause Failure Events: 55

ALPHA FACTOR AND MGL PARAMETERS Emergency Diesel Generators

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5
ai	0.9599057	0.950802	0.949033	0.9522332
α,	4.01E-02	2.89E-02	2.19E-02	1.47E-02
α,		2.11E-02	1.46E-02	1.39E-02
α.4	and a second sec	ar termine out to be of an above provide supervised by the providence of the provide	1.45E-02	8.01E-03
a.,		and a second of a second cash a second se		1.11E-02

Table 5-4: Summary of Alpha Factor Parameter Estimations - Fail to Run

Table 5-5: Summary of MGL Parameter Estimations - Fail to Run

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5
1-Beta	9.60E-01	9.50E-01	9.49E-01	9.52E-01
Beta	4.01E-02	4.99E-02	5.10E-02	4.78E-02
Gamma		4.22E-01	5.72E-01	6.92E-01
Delta	And a second		4.99E-01	5.79E-01
Epsilon				5.81E-01


Table 5-6: Summary of Average Impact Vectors - Fail to Run

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5
Adj.Ind.Events	461.18	691.77	922.35	1152.94
Ni	36.3009	28.8207	21.2966	16.6702
N ₂	20.7793	21.8777	21.7294	18.0603
N ₃	an te de la companya de la companya da construir de la companya de la companya de la companya de la companya d	15.9841	14.5212	17.1180
N.			14.4583	9.8346
N ₃	Contraction of Contraction and Contract and Address and Address and Address and Address and Address and Address			13.6582

Total Number of Independent Failure Events: 588 Total Number of Common Cause Failure Events: 76

3. COMPONENT BOUNDARIES

The super component, EDG, is defined as the combination of the diesel engine(s) with all components in the exhaust path, electrical generator, generator exciter, output breaker, combustion air, lube oil systems(including the device that physically controls the cooling medium), cooling system (including the device that physically controls the cooling medium), fuel oil system (including all storage tanks permanently connected to the engine supply), and the starting compressed air system. All pumps, valves and valve operators with their power supply breakers, and associated piping for the above systems are included. The only portions of the EDG cooling systems included were the specific devices that control cooling medium flow to the individual EDG auxiliary heat exchangers, including the control instruments. The service water system (cooling medium) outside the control valves was excluded. The EDG room ventilation was included if the licensee reported ventilation failures that affected EDG functional operability. Figure 5-1 shows the component boundary as defined for this study.

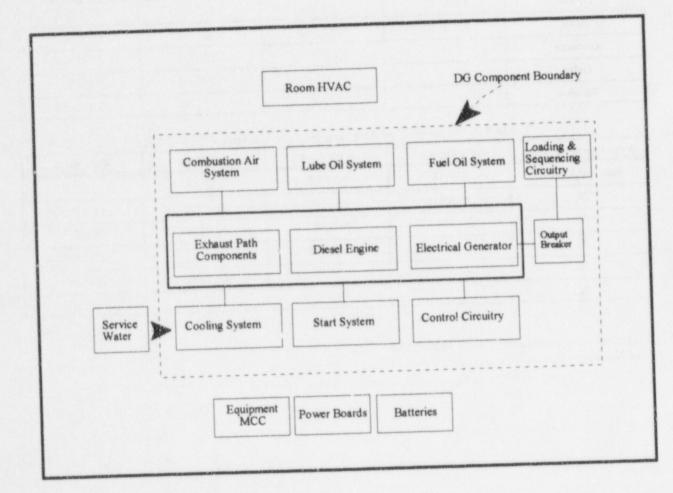



NUREG/CR-5497

Included within the EDG system are the circuit breakers that are located at the motor control centers (MCC) and the associated power boards, that supply power specifically to any of the EDG equipment. The MCCs and the power boards are not included except the load shedding and load sequencing circuitry/devices that are, in some cases, physically located within the MCCs. Load shedding of the safety bus and subsequent load sequencing onto the bus of vital electrical loads is considered integral to the EDG function and is therefore considered within the bounds of this study. All instrumentation, control logic, and the attendant process detectors for system initiations, trips, and operational control are included. Batteries were included if failures impacted EDG functional operability.

4. FAILURE EVENT DEFINITION

Successful EDG system response to a demand requires that the EDGs provide electrical power to the safety bus with all required loads energized (sequenced onto the bus) for the duration of the mission time. The failure modes used in evaluating the EDG data are:

- FS Fail to Start: A successful start will be the EDG start through output breaker closing and loading to the requirement for the current configuration. For example, if the start is in response to an actual loss of power, the full sequence of loading must be completed in order for the start to be considered successful. If only partial loading occurs before the failure, the failure mode will be fail to start. If the start requires no loading (e.g. a test or on a SI signal), the success criteria will be only the EDG start.
- FR Fail to Run: In order for the failure to be a failure to run, the EDG must be loaded (required for the current conditions) and stable before the failure. This failure mode implies a successful start, but a subsequent failure to run for the duration of the mission time.

The EDG failures represent malfunctions that hindered or prevented successful operation of the EDG system. Slow EDG starting times during testing, were considered successful provided the start tock less than 20 seconds and the EDG was otherwise fully capable. Most licensees reporting a slow start time provided additional analysis to indicate that the slow start time did not adversely affect the ability of the plant to respond to a design basis accident. Conditions related to potential failure due to seismic design, environmental qualification, or other similar concerns were not considered. Any EDG inoperabilities declared strictly for administrative reasons were not considered failures (e.g. a surveillance test not performed within the required time frame). Failures during troubleshooting or when the EDG would not reasonably be considered fully capable, such as after major maintenance, were also not considered failures. If a failure occurred on equipment other than what had been repaired during an operational surveillance test following maintenance, another failure was counted.

For purposes of this CCF study, a personnel error resulting in more than one functionally inoperable EDG (even without any component malfunction) was considered a CCF failure. Examples are improper prestart lineup and significant setting errors in the governor or voltage regulator controls. These types of errors would have prevented fulfillment of the EDG system design function. On the other hand, operator error in such things as paralleling to the grid or improper adjustment of voltage or speed controls were not considered failures because these do not normally apply to an actual EDG demand.

Some CCF events affected the second unit of a multiple-unit site; if the report indicated that EDGs at the other unit(s) would have also failed for the same reason one CCF event was coded, with the CCCG value assigned as the total number of EDGs at the site. When a licensee modified the design or replaced parts on multiple EDGs (at a site) in response to the failure of a single component, the replaced components were considered to have failed. These events were coded as CCFs.

Many LERs and special reports reported only one actual failure, but the report information indicated that failure of a second EDG would have occurred from the same cause if a start and run had been attempted. When the cause of the actual failure would have clearly caused failure of another EDG, the event was identified as a CCF. If, however, the report did not clearly identify that another EDG would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an EDG start demand (e.g. the condition was found during inspection, and no actual start or run failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 5-7 through 5-14 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of EDGs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

NUREG/CR-5497

the

ALPHA FACTOR DISTRIBUTIONS Emergency Diesel Generators

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9560716	0.9685697	0.9690884	0.9792986	0.9688323	5.8391E+02	1.8948E+01
α2	2.07E-02	3.14E-02	3.09E-02	4.39E-02	3.12E-02	1.8948E+01	5.8391E+02

Table 5-7: Alpha Factor Distribution Summary - Fail to Start CCCG = 2

Table 5-8: Alpha Factor Distribution Summary - Fail to Start, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9517748	0.9627733	0.9631228	0.9725894	0.9630082	8.5602E+02	3.3099E+01
α,	1.33E-02	2.04E-02	2.01E-02	2.88E-02	2.04E-02	1.8160E+01	8.7096E+02
α,	1.04E-02	1.68E-02	1.64E-02	2.45E-02	1.66E-02	1.4939E+01	8.7418E+02

Table 5-9: Alpha Factor Distribution Summary - Fail to Start, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9539635	0.9633908	0.9636560	0.9719226	0.9636932	1.1332E+03	4.3062E+01
α2	8.64E-03	1.37E-02	1.34E-02	1.97E-02	1.35E-02	1.6126E+01	1.1601E+03
œ,	6.77E-03	1.13E-02	1.11E-02	1.68E-02	1.14E-02	1.3324E+01	1.1629E+03
α,	6.96E-03	1.16E-02	1.13E-02	1.71E-02	1.14E-02	1.3612E+01	1.1627E+03

Table 5-10: Alpha Factor Distribution Summary - Fail to Start, CCCG =5

PART and an or 5 where Partners, the setting weak to be placed product of a setting of the setti										
Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b			
α,	0.9547430	0.9631795	0.9633931	0.9708936	0.9635193	1.4109E+03	5.3936E+01			
α,	8.05E-03	1.24E-02	1.22E-02	1.75E-02	1.22E-02	1.8163E+01	1.4467E+03			
α,	4.89E-03	8.39E-03	8.17E-03	1.27E-02	8.34E-03	1.2295E+01	1.4525E+03			
α.,	3.81E-03	6.95E-03	6.73E-03	1.09E-02	6.99E-03	1.0186E+01	1.4547E+0			
α,	5.42E-03	9.07E-03	8.85E-03	1.35E-02	8.92E-03	1.3292E+01	1.4515E+0			

0000 0

ALPHA FACTOR DISTRIBUTIONS Emergency Diesel Generators

- 11 - 11.	Alaba Factor	Distribution	Summary -	Fail to Kun	, ((10-2
able 3-11	Albha racioi	LISUIDANON	C. C	COLUMN AND ADDRESS OF THE OWNER, AND ADDRESS OF THE	A CONTRACTOR OF A CONTRACTOR O

AND OR OTHER DESIGNATION OF THE DESIGNATION OF THE OWNER O			Median	95th%	MLE		b
Alpha Factor	5th%	Mean			0.0500057	5 07015+02	2 1249E+01
6%.1	0.9448042	0.9597754	0.9603523	0.9727656	0.9599057	5.0701E+02	2.12472.01
wo1	2.72E-02	And an other states and the state of the sta	3.97E-02			2.1249E+01	5.0701E+02
CL2	6.160-06	4.0200 02		And I wanted which the set of the owner of the set of the set	Construction and a subserver as the subserver of the subserver as the subs		

Table 5-12: Alpha Factor Distribution Summary - Fail to Run, CCCG = 3

1 0	010 5-12. 12	AND IN CALIFORNIA DISCOURSE IN AND IN THE OWNER WAS	Median	95th%	MLE	8	b
Alpha Factor	5th%	Mean		A REAL PROPERTY AND A REAL	CONTRACTOR OF CONTRACTOR OF CONTRACTOR	12 0620E 102	2 96625+01
and the second second second second	0.9365886	0.9500783	0.9504684	0.9622466	0.9500802	7.3579E+02	3.80020101
Ø.1		CONT. OTHER DESIGNATION OF ADDRESS OF ADDRESS OF	2.83E-02	3.93E-02	2.89E-02	2.2265E+01	7.5219E+02
α.2	1.96E-02	2.88E-02	2.031-02	0.700		1.6397E+01	And the second
α.	1.34E-02	2.12E-02	2.08E-02	3.03E-02	2.11E-02	1.03972401	17.500001.02

Table 5-13: Alpha Factor Distribution Summary - Fail to Run, CCCG = 4

A DESCRIPTION OF THE OWNER OWNER OF THE OWNER			Median	95th%	MLE	8	b
Alpha Factor	5th%	Mean	A second second second second second	And in case of the local division of the loc	0.0100022	9.6835E+02	5 209E+01
α,	0.9372270	0.9490287	0.9493250	0.9598252	0.2.12.2.2		State of the local distance of the state of
G ₁		2.18E-02	2.15E-02	2.99E-02	2.19E-02	2.2283E+01	9.9808E+02
α.2	1.49E-02	2.100-02		0.115.00	1.46E-02	1.4784E+01	1.056E+03
α,	8.93E-03	1.45E-02	1.42E-02	2.11E-02	1.1025 02	1	Contractor of Contractor Strengt, State
and the second	9.05E-03	1.46E-02	1.43E-02	2.13E-02	1.45E-02	1.4942E+01	1.054E+03
α4	9.050-05			CALIFORNIA CONTRACTOR DE LA CALIFORNIA CONTRACTOR DE LA CALIFORNIA DE LA CALIFORNIA CONTRACTOR DE LA CALIFICACIONA CONT	and see a second s		

Table 5-14: Alpha Factor Distribution Summary - Fail to Run, CCCG =5

A STREET, STRE	DIE 3-14. A		Median	95th%	MLE	8	b
Alpha Factor	5th%	Mean		0.9616241	0.9522332	1.2077E+03	6.0628E+01
α,	0.9419575	0.9521985	0.9524344			1.8788E+01	
α,	9.70E-03	1.48E-02	1.46E-02	2.08E-02	1.47E-02	1.7530E+01	and the subscription of the second
Ø.	8.90E-03	1.38E-02	1.36E-02	1.96E-02	1.39E-02		CONTRACTOR OF THE OWNER OF TAXABLE
and the rank to be not a reaction of the second s	4.33E-03	7.94E-03	7.68E-03	1.24E-02	8.01E-03	1.0680E+01	1.2583E+03
α ₄ α ₅	6.84E-03	1.12E-02	1.10E-02	1.65E-02	1.11E-02	1.4242E+01	1.2541E+03

6. Containment Spray Heat Exchangers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common cause failure (CCF) parameters of various models using operational data involving heat exchangers (HX) in the containment spray and recirculation (CSR) system at both pressurized water reactors (PWRs) and boiling water reactors (BWRs). Only two BWR plants have a containment spray system separate from the residual heat removal or low pressure coolant injection system. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common cause failure events. The only failure modes analyzed is failure to transfer heat. The data cover the time period from 1980 through 1995.

The data review identified 10 common-cause failure-to-transfer heat events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to transfer heat are shown in Tables 6-1 and 6-2, respectively. Table 6-3 contains the average impact vectors (N_1-N_2) and the number of adjusted independent events for this failure mode. The alpha factor model parameters are denoted by $\alpha_1-\alpha_4$ Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. The size of the affected population of condensers is denoted as CCCG. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Table 6-4 through 6-6.

2. SYSTEM DESCRIPTION

The containment spray system is a subsystem of the emergency core cooling system (ECCS) that provides for the removal of heat and containment pressure control following a loss of coolant accident (LOCA) or a steamline break inside containment. Following the initial post-accident injection phase, primary coolant from the containment sump or suppression pool is pumped through spray headers in the top of the containment building. The containment spray system typically consists of two separate and complete trains, each with a vertically mounted centrifugal pump, heat exchangers, and piping that allows pump suction from either an initial injection coolant source (on PWRs) or the containment recirculation coolant source. Power to the containment spray pumps is provided from the 1E electrical system, backed up by the 1E emergency diesels generators. Not all plant designs include a heat exchanger for cooling, and these plants are not included in the study. Some plant designs include a sodium hydroxide chemical addition to the containment spray system to improve the removal of iodine from the containment atmosphere, and some plants have both heat exchangers and chemical addition systems.

The containment spray system is normally in standby and is automatically started by the engineered safety features actuation system (ESFAS) on high containment pressure. The containment spray system can be manually actuated from the main control panel. Figure 6-1 provides an illustration of a typical flow path for the containment spray system.

ALPHA FACTOR AND MGL PARAMETERS Containment Spray Heat Exchangers

Table 6-1: Summary of Alpha Factor Parameter Estimations - Fail to Transfer Heat

CCCG	2	3	4
α,	0.7010040	0.6995701	0.6733120
α1	2.99E-01	1.07E-01	1.54E-01
CL 3		1.94E-01	1.53E-02
α.,	NA MANANANA MANANA MININA AMIN'NA MANANA MININA	A CONTROL AND A CONTROL OF A CONTROL OF A CONTROL OF A CONTROL AND A CONTROL OF A CONTROL AND A CONTROL A	1.58E-01

Table 6-2: Summary of MGL Parameter Estimations - Fail to Transfer Heat

CCCG	2	3	4
1-Beta	7.01E-01	7.00E-01	6.73E-01
Beta	2.99E-01	3.00E-01	3.27E-01
Gamma		6.45E-01	5.30E-01
Delta	and provide the standard and a manager of the standard state of the state of the state of the state of the stat		9.12E-01

Table 6-3: Summary of Average Impact Vectors - Fail to Transfer Heat

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	
Adj. Ind. Events	8.00	12.00	16.00	
N ₁	3.5414	3.0183	1.3800	
N2	4.9227	2.2918	3.9663	
N ₃		4.1578	0.3937	
N,	ana ang kang kang kang kang kang kang ka	Construction in the second	4.0727	

Total Number of Independent Failure Events: 14 Total Number of Common Cause Failure Events: 10

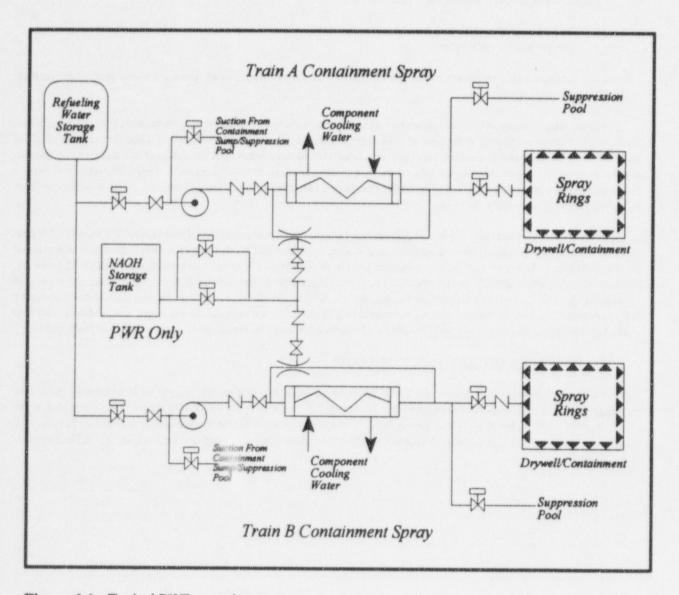


Figure 6-1. Typical PWR containment spray system.

3. COMPONENT BOUNDARIES

The main component of a CSR heat exchanger is the heat exchanger itself. It consists of the main tank (shell), internal cooling water tub..., temperature sensors, and a temperature control valve. The cooling water system on the heat exchanger side of the isolation valves in included; the remainder of the cooling water system is not.

4. FAILURE EVENT DEFINITION

Successful operation of a containment spray heat exchanger is defined as heat transfer above the minimum design basis requirements. The only failure mode used in evaluating CSR heat exchanger data is:

NUREG/CR-5497

- PG Plugged or Failure to Transfer Heat. Examples are:
 - Reduction in flow affecting heat transfer rate, and
 - Temperature switch failure.

Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the CSR heat exchangers.

Administrative inoperability, such as seismic qualification, were not considered failures because they are conditional upon the circumstances existing at the time of CSR system demand. The exception to this is if a licensee reported that the heat exchanger "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the heat exchanger from operating properly on a safety demand.

Some LERs reported only one actual failure, but the report information indicated that failure of a second CSR heat exchanger would have occurred from the same cause if system operation had been attempted. When the cause of the actual failure would have clearly caused failure of another CSR heat exchanger, the event was identified as a CCF. If, however, the report did not clearly identify that another CSR heat exchanger would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another CSR heat exchanger operation was found during inspection, and no actual heat exchanger operation was required), only those cases for which a second failure could be certain was identified as a CCF.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 6-4 through 6-6 present the alpha factor uncertainty distribution summaries for containment spray heat exchangers. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Containment Spray Heat Exchangers

Table 6-4: Alpha Factor Distribution Summary - Fail to Transfer Heat, CCCG = 2

Name	5th%	Mean	Median	95%	MLE	8	b
α,	0.6578248	0.7962228	0.8037526	0.9087970	0.7010040	2.1071E+01	5.3927E+00
α2	9.12E-02	2.04E-01	1.96E-01	3.42E-01	2.99E-01	5.3927E+00	2.1071E+01

Table 6-5: Alpha Factor Distribution Summary - Fail to Transfer Heat, CCCG = 3

Name	5th%	Mean	Median	95%	MLE	8	b
α,	0.6929708	0.8065102	0.8120006	0.9012601	0.6995701	3.0218E+01	7.2496E+00
α,	1.83E-02	7.15E-02	6.40E-02	1.51E-01	1.07E-01	2.6790E+00	3.4789E+01
α,	4.80E-02	1.22E-01	1.15E-01	2.19E-01	1.94E-01	4.5706E+00	3.2897E+01

Table 6-6: Alpha Factor Distribution Summary - Fail to Transfer Heat, CCCG = 4

Nam e	5th%	Mean	Median	95%	MLE	8	b
a,	0.7172539	0.8121561	0.8161921	0.8932539	0.6733120	4.2080E+01	9.7327E+00
α,	3.36E-02	8.72E-02	8.20E-02	1.59E-01	1.54E-01	4.5201E+00	4.7293E+01
α,	1.75E-04	1.27E-02	7.17E-03	4.39E-02	1.53E-02	6.5630E-01	5.1156E+01
α.,	3.40E-02	8.79E-02	8.27E-02	1.60E-01	1.58E-01	4.5563E+00	4.7256E+01

7. Residual Heat Removal Heat Exchangers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common cause failure (CCF) parameters of various models using operational data involving heat exchangers (HX) in the residual heat removal (RHR) system [including BWR low pressure coolant injection (LPCI) heat exchanger] at both pressurized water reactor (PWR) and boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NFRDS) have been screened to identify common cause failure events. The only failure mode analyzed is failure to transfer heat. The data cover the time period from 1980 through 1995.

The data review identified eight common cause failure-to-transfer heat events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to transfer heat are shown in Tables 7-1 and 7-2, respectively. Table 7-3 contains the average impact vectors (N_1-N_4) and the number of adjusted independent events for this failure mode. The size of the affected population of heat exchangers is denoted as CCCG. The alpha factor model parameters are denoted by $\alpha_1-\alpha_4$. Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 7-4 through 7-6.

2. SYSTEM DESCRIPTION

The RHR system, including the BWR LPCI system, is a subsystem of the emergency core cooling system (ECCS) that functions to provide decay heat removal/shutdown cooling to maintain reactor coolant inventory and provide adequate long term decay heat removal following an emergency plant shutdown. This is the general design of both a PWR and a BWR power plant. The RHR function is performed over a relatively long time interval after shutdown. The RHR system injects directly into the primary system through the heat exchangers. Figure 7-1 illustrates the typical flow path for the RHR system, and it is general enough to apply to either a BWR or a PWR power plant. The system is typically comprised of two separate trains, each train with one or two high capacity centrifugal pumps, heat exchangers, connecting piping, and valves to control flow, etc. The pumps receive power from the 1E emergency power system which is backed up by the emergency diesel generators.

The system is normally aligned and in the standby mode. The RHR pumps are started by the engineered safety features actuation system (ESFAS) or may be manually actuated from the main control room.

ALPHA FACTOR AND MGL PARAMETERS Residual Heat Removal Heat Exchangers

Table 7.1. Summary of Alpha Factor Farameter Estimations 1 and contract	Table 7.1.	Summary of Alpha Fa	ctor Parameter	Estimations -	Fail to	Transfer	Heat
---	------------	---------------------	----------------	---------------	---------	----------	------

CCCG=2	CCCG=3	CCCG=4
0.6613589	0.7321429	0.7692530
3.39E-01	1.79E-02	2.88E-02
	2.50E-01	0.00E+00
		2.02E-01
	0.6613589	0.6613589 0.7321429 3.39E-01 1.79E-02

Table 7-2: Summary of MGL Parameter Estimations - Fail to Transfer Heat


CCCG=2	CCCG=3	CCCG=4
6.61E-01	7.32E-01	7.69E-01
3.39E-01	2.68E-01	2.31E-01
	9.33E-01	8.75E-01
na felle fan de mei felle i de felle alle de felle ander de felle felle felle felle felle felle felle felle fel		1.00E+00
	6.61E-01	6.61E-01 7.32E-01 3.39E-01 2.68E-01


Table 7-3: Summary of Average Impact Vectors - Fail to Transfer Heat

CCCG=2	CCCG=3	CCCG=4
13.33	20.00	26.67
0.6670	0.5000	0.0000
7.1670	0.5000	1.0000
	7.0000	0.0000
	an a	7.0000
	0.6670	13.33 20.00 0.6670 0.5000 7.1670 0.5000

Total Number of Independent Failure Events: 15 Total Number of Common Cause Failure Events: 8

RHR Heat Exchangers

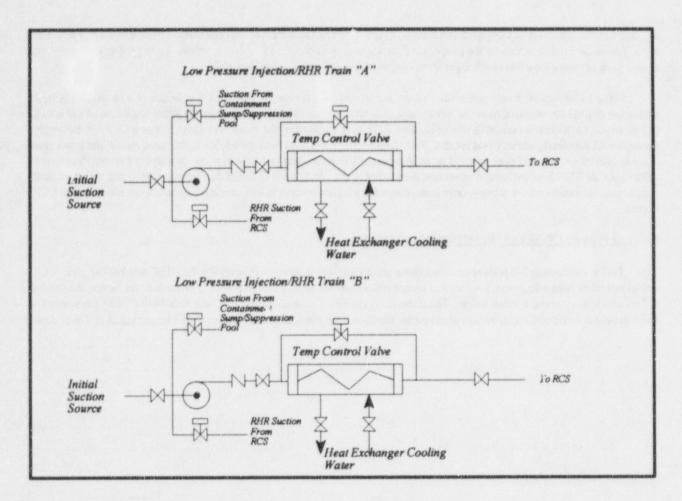



3. COMPONENT BOUNDARIES

The main component of an RHR heat exchanger is the heat exchanger itself. It consists of the main tank (shell), internal cooling water tubes, temperature sensors, and a temperature control valve. The cooling water on the heat exchanger side of the isolation valves is included; the remainder of the cooling water system is not.

4. FAILURE EVENT DEFINITION

Successful operation of an RHR heat exchanger is defined as heat transfer above the minimum design basis requirements. The only failure mode used in evaluating RHR heat exchanger data is:

- PG Plugged or Failure to Transfer Heat. Examples are:
 - Reduction in flow affecting heat transfer rate,
 - Temperature switch failure, and
 - Biofouling.

Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the RHR heat exchangers. Administrative inoperabilities, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of RHR system demand. The exception to this is if a licensee reported that the heat exchanger "would have" (instead of "may" or "could have") failed to

-

perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the heat exchanger from operating properly on a safety demand.

Some LERs reported only one actual failure, but the report information indicated that failure of a second RHR heat exchanger would have occurred from the same cause if system operation had been attempted. When the cause of the actual failure would have clearly caused failure of another RHR heat exchanger, the event was identified as a CCF. If, however, the report did not clearly identify that another RHR heat exchanger would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another RHR heat exchanger operation demand (e.g. the condition was found during inspection, and no actual heat exchanger operation was required), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 7-4 through 7-6 present the alpha factor uncertainty distribution summaries for the RHR heat exchangers. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Residual Heat Removal Heat Exchangers

Table 7-4: Alpha Factor Distribution Summary - Fail to Transfer Heat, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.6211913	0.7549416	0.7604498	0.8698278	0.6613589	2.3527E+01	7.6370E+00
α,	1.30E-01	2.45E-01	2.40E-01	3.79E-01	3.39E-01	7.6370E+00	2.3527E+01

Table 7-5: Alpha Factor Distribution Summary - Fail to Transfer Heat, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.7078387	0.8113636	0.8161079	0.8986601	0.7321429	3.570E+01	8.300E+00
α,	7.69E-04	2.02E-02	1.35E-02	6.24E-02	1.79E-02	8.8720E-01	4.3113E+01
α,	8.60E-02	1.69E-01	1.63E-01	2.68E-01	2.50E-01	7.4128E+00	3.6587E+01

Table 7-6: Alpha Factor Distribution Summary - Fail to Transfer Heat, C

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.7651855	0.8467117	0.8505293	0.9151798	0.7692530	5.1370E+01	9.300E+00
α,	3.24E-03	2.56E-02	2.06E-02	6.51E-02	2.88E-02	1.5538E+00	5.9116E+01
α,	1.26E-07	4.33E-03	8.42E-04	2.06E-02	0.00E+00	2.6260E-01	6.0407E+01
α,	6.22E-02	1.23E-01	1.19E-01	1.99E-01	2.02E-01	7.4836E+00	5.3186E+01

3. **BWR Isolation Condensers**

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving the isolation condenser (IC) system at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. The only failure mode analyzed is failure to transfer heat. The data cover the time period from 1980 through 1995.

The data review identified one common-cause failure-to-transfer heat event. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to transfer heat are shown in Tables 8-1 and 8-2, respectively. Table 8-3 contains the average impact vectors (N_1-N_2) and the number of adjusted independent events for this failure mode. The size of the affected population of condensers is denoted as CCCG. The alpha factor model parameters are denoted by $\alpha_1-\alpha_2$. Beta (β) is the multiple Greek letter model parameter. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Table 8-4.

2. SYSTEM DESCRIPTION

The isolation condenser is part of the BWR emergency core cooling system (ECCS) that transfers residual and decay heat from the reactor coolant system to the atmosphere in the event that the main condenser is not available, or when a high reactor pressure condition exists. The IC system may be placed into service either manually or automatically. The IC system operates using natural circulation as the driving he. Chrough the isolation condenser tubes, and is available for operation when there is no electrical power. The primary side of the isolation condenser system is a closed loop from the reactor pressure vessel steam space through the tubes in the isolation condenser, with the condensate returning back to the recirculation loops. During normal plant operations, the secondary (shell) side of the isolation condenser contains sufficient water to cover the primary side tubes. The water in the shell side transfers the heat from the primary side by boiling off and venting directly to the atmosphere. Makeup to the secondary side is provided through the fire water system or through an alternate makeup source, such as the condensate transfer system.

Only five BWR plants have an IC system; those that don't have the IC have reactor core isolation cooling, which is a pump driven system. Some plants have two ICs, and other plants have one IC that contains two sets of steam cooling tubes. Figure 8-1 shows a typical isolation condenser system.

ALPHA FACTOR AND MGL PARAMETERS Isolation Condensers

Table 8-1: Summary of Alpha Factor Parameter Estimations - Fail to Transfer Heat

Alpha Factor	CCCG=2
α,	0.9333333
α1	6.67E-02

Table 8-2: Summary of MGL Parameter Estimations - Transfer Heat

MGL Parameter	CCCG=2
1-Beta	9.33E-01
Beta	6.67E-02

Table 8-3: Summary of Average Impact Vectors - Fail to Transfer Heat

Avg. Impact Vector	CCCG=2
Adj.Ind.Events	3.00
N ₁	0.5000
N ₂	0.2500

Total Number of Independent Failure Events: 3 Total Number of Common-Cause Failure Events: 1

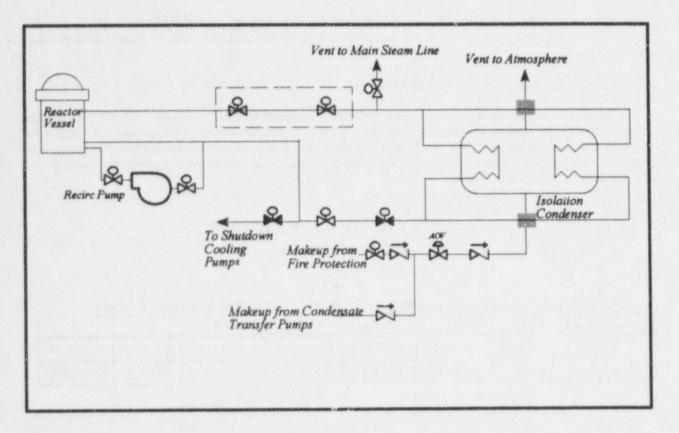


Figure 8-1. Typical isolation condenser system.

3. COMPONENT BOUNDARIES

The main components of a condenser are the tubes, tubesheets and shell.

4. FAILURE EVENT DEFINITION

The function of the isolation condenser is to provide an alternate decay heat removal path, separate from the other systems within the ECCS. The PRA mission for the isolation condenser system is to provide water for heat transfer for the removal of decay heat from the reactor coolant system. Failure of the isolation condenser system is defined as any condition that does not permit either the steam flow from the reactor pressure vessel, or condensate water return to the reactor coolant system (RCS) or makeup water flow to the IC shell flow from the makeup sources.

Only one failure mode was used in evaluating the isolation condenser data:

PG Plugged or Fail to Transfer Heat: The cooling operation must be hampered. Flow blockage, either from internal contamination, or by unintended valve closure is included.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of demand.

If the failure of the IC to perform its heat transfer function was due to a valve failure, the failure would be recorded as a valve failure. If, however, the IC failure was due to human action that misaligned a valve, the failure was recorded as a failure of the IC.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Table 8-4 presents the alpha factor uncertainty distribution summaries for each failure mode and each configuration of condenser. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Isolation Condenser

Table 8-4: Alpha F	factor Distribution Summar	y - Fail to Transfer Heat,	CCCG = 2
--------------------	----------------------------	----------------------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α	0.8284946	0.9476364				1.3030E+01	
α	1.07E-03	5.24E-02	3.25E-02	1.72E-01	6.67E-02	7.2000E-01	1.3030E+01

9. PWR Auxiliary Feedwater Pumps

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving pumps in the auxiliary feedwater (AFW) system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to start and failure to run. The data cover the time period from 1980 through 1995.

The data review identified 18 common-cause failure-to-start events and 18 common-cause failure-to-run events for all AFW pump (AFP) types; 22 common-cause failure-to-start events and 19 common-cause failure-to-run events for motordriven AFPs; 19 common-cause failure-to-start events and 23 common-cause failure-to-run events for turbine-driven AFPs. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to start for all pumps are shown in Tables 9-1 and 9-2, respectively. Table 9-3 contains the average impact vectors (N₁-N₄) and the number of adjusted independent events for this failure mode for all pumps. Tables 9-4 through 9-18 contain the corresponding information for the failure to start and failure to run failure modes for motor-driven and turbine-driven pumps. The size of the affected population of auxiliary feedwater pumps is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_4 . Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 9-19 through 9-32.

2. SYSTEM DESCRIPTION

The auxiliary feedwater system provides a source of feedwater to the steam generators to remove decay heat from the reactor coolant system (RCS) when: (a) the main feedwater system is not available, and (b) RCS pressure is too high to permit heat removal by the residual heat removal (RHR) system. The AFW system is comprised of two, three, or four flow trains, each with an AFP, including the associated pump driver. The combinations of pump-driver sets range from all motor-driven to all turbine-driven AFW pumps and, in a few cases, diesel-driven pumps. Most of the designs incorporate a combination of two full-capacity motor-driven and one double capacity turbine-driven pump. There are no plants with more than one diesel-driven AFP, so CCF analysis of diesel-driven pumps is not applicable. The motor-driven pumps are supplied power from the IE class power system with backup power available from the IE emergency diesel generators (EDG). The water supply for the system is from the condensate storage tank (CST) with a backup source of water (untreated) available from the service water system.

The AFW system is normally in standby. The motor-driven pumps start on one of the following conditions: a safety injection (SI) signal, a low-low level in any steam generator, loss of both main feedwater pumps (MFP), a loss of off-site power (LOSP) or manual initiation. The turbine-driven pump will start on either a low-low level in more than one steam generator or a loss of off-site power. Feedwater flow to the steam generators is controlled from the main control room by air, motor, or hydraulically operated valves. Motor-driven pump run out is controlled by an air or hydraulically controlled regulator valve on the pump discharge. The turbine-driven pump steam supply is controlled by air or hydraulically operated valves. Figure 9-1 shows a typical auxiliary feedwater system.

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Pumps

Table 9-1:	Summary of Al	oha Factor Parame	ter Estimations -All	AFP	Types Fail to Start
------------	---------------	-------------------	----------------------	-----	---------------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
C1	0.8803750	0.8666979	0.8673138
a2	1.20E-01	6.46E-02	4.52E-02
α,	na na na mangana na mangana na mangana na na mangana na na mangana na mangana na mangana na mangana na mangana Na na na mangana na mangana na mangana na na mangana na na mangana na mangana na mangana na mangana na mangana n	6.87E-02	3.58E-02
α,	na o de la de la el de la desena e de la de la esta o en de la de la dela de la dela de la dela de		5.16E-02

Table 9-2: Summary of MGL Parameter Estimations - All AFP Types Fail to Start

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	8.80E-01	8.67E-01	8.67E-01
Beta	1.20E-01	1.33E-01	1.33E-01
Gamma	en solvergen på for anne de sonre med er tre el appelante af generalen er en sol	5.16E-01	6.59E-01
Delta	CONSISTENCE CHARGENEY OF RESPONDED AND THE PERSON OF CONSISTENCE (, 1973		5.90E-01

Table 9-3: Summary of Average Impact Vectors -All AFP Types Fail to Start

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj. Ind. Events	54.10	81.15	108.20
N ₁	8.7527	5.8630	2.9820
N ₁	8.5404	6.4845	5.7989
N ₃		6.8985	4.5938
N,	S - π. δ. μαι προγκραφή ανακοποιού που στην που καλλογησης του το καταληγότητα που την ποτο το του βαλογογόρι, 4 κα	an an ann an Anna Anna Anna Ann	6.6165

Total Number of Independent Failure Events: 66 Total Number of Common-Cause Failure Events: 18

PWR AFW Pumps

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Pumps

Table 9-4: Summar	y of Alpha Factor	Parameter Estimations	-All AFP Types Fail to Run
-------------------	-------------------	-----------------------	----------------------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
α,	0.9828422	0.9718415	0.9611720
α,	1.72E-02	2.21E-02	2.42E-02
α,	anner der geschlart in der eine der geschlicht in die regione. Offertregen und der finder der der der verheit i	6.11E-03	1.07E-02
CL.4	n dae de la marca de la construiente de la construit de la construit de la de la de la de la de la de la deserv	and and a substantial conjector. Being and a sound of provide day and and the second	3.89E-03

Table 9-5: Summary of MGL Parameter Estimations -All AFP Types Fail to Run

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.83E-01	9.72E-01	9.61E-01
Beta	1.72E-02	2.82E-02	3.88E-02
Gamma		2.17E-01	3.76E-01
Delta	anna an a bhainn da mar ann chuir feol ann ann an tra ann ann an tra ann ann an tra ann an tra fhairte An Ann		2.67E-01

Table 9-6: Summary of Average Impact Vectors -All AFP Types Fail to Run

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj. Ind. Events	158.80	238.20	317.60
N ₁	11.8448	11.3830	7.3169
N ₂	2.9790	5.6625	8.1891
N,		1.5690	3.6201
N ₄			1.3163

Total Number of Independent Failure Events: 212 Total Number of Common-Cause Failure Events: 18

()

NUREG/CR-5497

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Motor-Driven Pumps

Table 9-7:	Summary	of Alpha	Factor	Parameter	Estimations - 1	Motor-l	Driven A	FPs Fail to S	tart
I auto /-/	JULI 1 1 1 1 2 104 Y	WA A BADYLAGE	* *****				and the second se	and the second sec	and the second se

Alpha Factor	CCCG=2	CCCG=3
α,	0.9190320	0.9204196
α2	8.10E-02	3.16E-02
<u>α</u> ,		4.80E-02

Table 9-8: Summary of MGL Parameter Estimations - Motor-Driven AFPs Fail to Start

MGL Parameter	CCCG=2	CCCG=3
1-Beta	9.19E-01	9.20E-01
Beta	8.10E-02	7.96E-02
Gamma		6.03E-01

Table 9-9: Summary of Average Impact Vectors -Motor-Driven AFPs Fail to Start

Avg. Impact Vector	CCCG=2	CCCG=3
Adj. Ind. Events	118.67	178.01
N	9.4857	7.1485
N ₂	11.2907	6.3605
N ₃	acta - Again International Community in Spectral La grany and an Additional Additional Additional Community of	9.6485

Total Number of Independent Failure Events: 143 Total Number of Common-Cause Failure Events: 22

PWR AFW Pumps

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Motor-Driven Pumps

Table 9-10: Summary of Alpha Factor Parameter Estimations - Motor-Driven AFPs Fail to Run

Alpha Factor	CCCG=2	CCCG=3
a,	0.9782316	0.9560107
α.,	2.18E-02	3.60E-02
α,		8.04E-03

Table 9-11: Summary of MGL Parameter Estimations - Motor-Driven AFPs Fail to Run

MGL Parameter	CCCG=2	CCCG=3
1-Beta	9.78E-01	9.56E-01
Beta	2.18E-02	4.40E-02
Gamma		1.83E-01

Table 9-12: Summary of Average Impact Vectors - Motor-Driven AFPs Fail to Run

Avg. Impact Vector	CCCG=2	CCCG=3
Adj.Ind.Events	124.72	187.07
N,	13.6448	11.3830
N ₂	3.0790	7.4625
N ₃	anderen deten anderen er en anderen forstande af de de samen anderen anderen anderen anderen en anderen anderen	1.6690

Total Number of Independent Failure Events: 164 Total Number of Common-Cause Failure Events: 19

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Turbine-Driven Pumps

Table 9-13: Summary of Alpha Factor Parameter Estimations - Turbine-Driven AFPs Fail to Start

Alpha Factor	CCCG=2	CCCG=3
α,	0.9661927	0.9630709
α,	3.38E-02	1.90E-02
α,		1.80E-02

Table 9-14: Summary of MGL Parameter Estimations - Turbine-Driven AFPs Fail to Start

MGL Parameters	CCCG=2	CCCG=3
1-Beta	9.66E-01	9.63E-01
Beta	3.38E-02	3.69E-02
Gamma	MARKAL LATTE CAMPACTOR INCOMENTATION OF A SUBMITTING AND	4.87E-01

Table 9-15: Summary of Average Impact Vectors - Turbine-Driven AFPs Fail to Start

Avg. Impact Vectors	CCCG=2	CCCG=3
Adj. Ind. Events	246.15	369.23
N ₁	9.3530	5.8630
N ₂	8.9401	7.3845
N3	r an fair fear fai dhuchardh ann ann a' fhair ann an shùir ann a' shùir ann ann ann ann ann ann ann ann ann an	6.9985

Total Number of Independent Failure Events: 304 Total Number of Common-Cause Failure Events: 19

1

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Turbine-Driven Pumps

Table 9-16: Summary of Alpha Factor Parameter Estimations - 7	Turbine-Driven AFPs Fai	l to Run
---	--------------------------------	----------

Alpha Factor	CCCG=2	CCCG=3
α,	0.9770723	0.9712737
α	2.29E-02	1.68E-02
α,		1.19E-02

Table 9-17: Summary of MGL Parameter Estimations - Turbine-Driven AFPs Fail to Run

MGL Parameter	CCCG=2	CCCG=3
1-Beta	9.77E-01	9.71E-01
Beta	2.29E-02	2.87E-02
Gamma		4.15E-01

Table 9-18: Summary of Average Impact Vectors - Turbine-Driven AFPs Fail to Run

Avg. Impact Vector	CCCG=2	CCCG=3
Adj. Ind. Events	236.02	354.02
N,	14.1620	13.7280
N ₂	5.8707	6.3650
N,		4.5115

Total Number of Independent Failure Events: 308 Total Number of Common-Cause Failure Events: 23

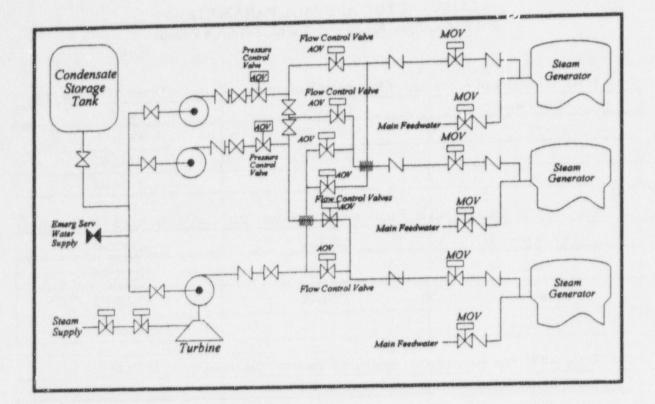


Figure 9-1. Typical auxiliary feedwater system.

3. COMPONENT BOUNDARIES

The main components of an AFW pump are the pump and pump driver. The AFP is normally in standby and is started by sensors actuating the circuit breaker or steam supply valve to the driver which will in turn operate the pump. These pumps can also be started manually via remote control switches. Stopping of the pump is accomplished by operator actions via the control switches or automatic signals designed to protect the pumps or drivers (e.g., overcurrent, overspeed).

The boundaries include the pump itself, the turbine or motor, including governor control or circuit breaker as applicable, lubrication or cooling systems, and any sensors, controls, or indication required for operation of the pump. Only controls and sensors unique to the operation of the individual pump are included in the pump boundary for CCF analysis.

4. FAILURE EVENT DEFINITION

Successful operation of an AFW pump is comprised of two distinct modes of operation. If the AFW system is in the normal standby condition, it must respond to an actuation signal by starting and obtaining design discharge pressure or flow. Once running, the AFW pump must continue to produce design flow or discharge pressure until its service is no longer needed (for the PRA mission time). The respective failure modes used for evaluating the AFP data are:

HUREG/CR-5497

- FS Failure to Start: Examples are:
 - circuit breaker fails to close,
 - pump fails to achieve design flow or pressure,
 - governor fails to control rpm,
 - control switch failure, and
 - pressure switch failure.

FR Failure to Run: Examples are:

- excessive bearing vibration,
- cavitation,
- decreasing performance (less than design flow or pressure),
- excessive packing leaks, and
- loss of lubrication/cooling.

AFW pump malfunctions are considered to be failures to start and failure to run. Pump failures include those failures that are caused by power supplies or sensors that are unique to the pump-driver combination. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the AFW pumps.

Pump-driver failures are evaluated to determine the effect on pump operability. In general, if the failure causes the pump to fail to operate, it will be considered a failure. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered pump failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of pump demand. The exception to this is if a licensee reported that the pump "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the pump from operating property on a safety demand. An example is starting up of the normal feedwater system (after outages) when the AFW starting signals are required to be unblocked. On occasion, licensees forgot to unblock the signals when they change modes, resulting in a TS violation, and preventing the pump from starting at the required condition.

Many LERs reported only one actual failure, but the report information indicated that a second AFW pump would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another AFW pump, then the event was identified as a CCF. If, however, the report did not clearly identify that another AFW pump would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to an AFW pump actuation demand (e.g. the condition was found during inspection, and no actual demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 9-19 through 9-32 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of AFW pumps. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

The data included in the "All AFP Types" analysis are those events that affect multiple types of AFPs, events affecting just the pump portion of multiple motor-driven AFPs, and events affecting just the pump portion of multiple turbine-driven AFPs. The data included in the "Motor-Driven AFP" analysis are events affecting multiple types of AFPs, events affecting just motor-driven AFPs, and events affecting just the AFP motors at plants that have multiple motor-driven AFPs. The data included in the "Turbine-Driven AFP" analysis are events affecting multiple types of AFPs, events affecting just turbine-driven AFPs, and events affecting just the AFP motors at plants that have multiple motor-driven AFPs. The data included in the "Turbine-Driven AFP" analysis are events affecting multiple types of AFPs, events affecting just turbine-driven AFPs, and events affecting just the AFP motors at plants that have multiple motor-driven AFPs.

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Pumps - All Pumps Types

Table 9-19: Alpha	Factor Distribution Summar	y -All AFP Ty	vpes Fail to Start	CCCG = 2
		J	The service of the se	1 1 1 1 1 m

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8274546	0.8892981	0.8924850	0.9402466	0.8803750	7.2383E+01	9.0104E+00
CC.2	5.98E-02	1.11E-01	1.08E-01	1.73E-01	1.20E-01	9.0104E+00	7.2383E+01

Table 9-20: Alpha Factor Distribution Summary - All AFP Types Fail to Start, CCCG = 3

6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α.,	0.8250265	0.8781455	0.8803150	0.9238621	0.8666979	1.0221E+02	1.4183E+01
α,	2.80E-02	5.90E-02	5.65E-02	9.86E-02	6.46E-02	6.8717E+00	1.0952E+02
۵٫	3.07E-02	6.28E-02	6.03E-02	1.03E-01	6.87E-02	7.3113E+00	1.0908E+02

Table 9-21: Alpha Factor Distribution Summary · All AFP Types Fail to Start, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α.,	0.1158.86	0.8812550	0.8829064	0.9209917	0.8673138	1.3588E+02	1.8309E+01
α,	1.872-02	4.12E-02	3.92E-02	7.04E-02	4.52E-02	6.3527E+00	1.4784E+02
α,	1.24E-02	3.15E-02	2.95E-02	5.75E-02	3.58E-02	4.8564E+00	1.4933E+02
α.,	2.21E-02	4.61E-02	4.41E-02	7.67E-02	5.16E-02	7.101E+00	1.4709E+02

-

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Pumps-All Pump Types

TableQ-22 Alnha	FactorDistributionSummar	v-All A	AFP Type	s Fail to	Run,	CCCG=2
Jahley-22 Albhar	*actorDistributionSummar	y=run r	MI IJPO	0 A 6644 64		

Alpha factor	5th%	Mean	Median	95th%	MLE	â	b
α,	0.9623646	0.9812176	0.9829349	0.9941993	0.9828422	1.8018E+02	3.4490E+00
a,	5.80E-03	1.88E-02	1.71E-02	3.76E-02	1.72E-02	3.4490E+00	1.8018E+02

Table 9-23: Alpha Factor Distribution Summary - All AFP Types Fail to Run, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
CL 1	0.9520280				0.9718415	2.6478E+02	8.0315E+00
α,	9.78E-03	2.22E-02	2.10E-02	3.85E-02	2.21E-02	6.0497E+00	2.6676E+02
α,	1.28E-03	7.26E-03	6.10E-03	1.72E-02	6.11E-03	1.9818E+00	2.7083E+02

Table 9-24: Alpha Factor Distribution Summary - All AFP Types Fail to Run, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9422655	0.9603745	0.9612185	0.9756121	0.9611720	3.4962E+02	1.4426E+01
α.,	1.25E-02	2.40E-02	2.32E-02	3.85E-02	2.42E-02	8.7429E+00	3.5530E+02
α	3.59E-03	1.07E-02	9.78E-03	2.08E-02	1.07E-02	3.8827E+00	3.6016E+02
α,	7.67E-04	4.94E-03	4.07E-03	1.21E-02	3.89E-03	1.7999E+00	3.6225E+02

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Motor-Driven Pumps

Table 9-25: Alpha Factor Distribution Summar	y -Motor-Driven AFPs Fail to Start, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8822534	0.9213053	0.9231795	0.9539436	0.9190320	1.3769E+02	1.1761E+01
α.,	4.61E-02	7.87E-02	7.68E-02	1.18E-01	8.10E-02	1.1761E+01	1.3769E+02

Table 9-26: Alpha Factor	Distribution Summary	-Motor-Driven	AFPs Fail to Start.	CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
æ,	0.8907815	0.9226008	0.9238942	0.9499907	0.9204196	2.036E+02	1.6809E+01
a.1	1.45E-02	3.11E-02	2.96E-02	5.25E-02	3.16E-02	6.7477E+00	2.1042E+02
α,	2.55E-02	4.63E-02	4.49E-02	7.19E-02	4.80E-02	1.061E+01	2.0711E+02

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Motor-Driven Pumps

Table 0. 27.	Alpha Factor	Distribution	Summary	- Motor-Driven	AFPs Fail to Run, $CCCG = 2$
Table 0-77	Almha Factor	DISTIDUTION	Summary	- 1480101 *****	a series and an and a series of the series o

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
and a sufficient surger of the surger of the	0.9534845	0.9765664	0.9786363	0.9925842	0.9782316	1.4790E+02	3.5490E+00
α,	7.42E-03	2.34E-02	2.14E-02	4.65E-02		3.5490E+00	
CL,	1.428-03	2.342-02	6.142-06	1.000000	And a subscription of the	1	And and and an

m. 1.1. 0 00.	Alaba Factor	Distribution	Summary	-Motor-Driven	AFPs Fail to Run, $CCCG = 3$	
I ohle U-/A	AIDDA FACIO	Distribution	Justinitiany		A REAL PROPERTY OF A REAL PROPER	-

1 abie 9-20.	Your other or an other or and an other or an	and the re- manager of and an interest of a second se		95th%	MLE		b	
Alpha Factor	5th%	Mean	Median	1	Contractor of the state of the			
Q 1	0.9308810	0.9555799	0.9569313	0.9756581	0.9560107	2.1365E+02	9.9315E+00	
-1	1.75E-02	3.51E-02	3.37E-02	5.74E-02	3.60E-02	7.8497E+00	2.1573E+02	
α,		and an owned when the second s	7.89E-03	2 17E-02	8.04E-03	2.0818E+00	2.2150E+02	
α,	1.75E-03	9.31E-03	1.070-03	2.171-02	1	1		

NUREG/CR-5497

.

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Turbine-Driven Pumps

Table 9-29: Alpha Factor Distribution Summary - Turbine-Driven AFPs Fail to St) Start, C	CCG = 2
--	------------	---------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9459550	0.9657117	0.9668360	0.9816230	0.9661927	2.6503E+02	9.4101E+00
α2	1.84E-02	3.43E-02	3.32E-02	5.41E-02	3.38E-02	9.4101E+00	2.6503E+02

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9458789	0.9625548	0.9633151	0.9766418	0.9630709	3.9029E+02	1.5183E+01
α.,	9.48E-03	1.92E-02	1.84E-02	3.15E-02	1.90E-02	7.7717E+00	3.9770E+02
α,	8.86E-03	1.83E-02	1.75E-02	3.04E-02	1.80E-02	7.4113E+00	3.9806E+02

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Turbine-Driven Pumps

Table 0.31. Ale	ha Factor Distribution Sur	mmary - Turbine-Driv	en AFPs Fail to Ru	in, $CCCG = 2$

Alpha Factor	Sth%	Mean	Median	95th%	MLE	a	b
	0.9590514	0.9761673	0.9773541	0.9892347	0.9770723	2.5971E+02	6.3407E+00
αι	1.08E-02	2.38E-02	2.27E-02	4.10E-02	2.29E-02	6.3407E+00	2.5971E+02

Table 9-32	Alpha Factor	Distribution	Summary	-Turbine-Driven	AFPs F	ail to F	Run, CC	CG = 3	
18010 7-34		1 100110000000000			and the second second second second	COLUMN STREET, STRE	CONTRACTOR OF TAXABLE PARTY.	And a local difference of the	-

Alpha Factor	Sth%	Mean	Median	95th%	MLE	a	b
ennadour raconsummers IL	0.9551773	0.9704112	0.9712046	0.9829430	0.9712737	3.8295E+02	1.1677E+01
a.2	7.94E-03	1.71E-02	1.63E-02	2.90E-02	1.68E-02	6.7522E+00	3.8787E+02
α,	4.90E-03	1.25E-02	1.17E-02	2.28E-02	1.19E-02	4.9243E+00	3.8970E+02

10. Emergency Service Water Pumps

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving pumps in the emergency service water (ESW) system at both boiling water reactor (BWR) power plants and pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to start and failure to run. The data cover the time period from 1980 through 1995.

The data review identified 61 common-cause failure-to-start events and 80 common-cause failure-to-run events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to start are shown in Tables 10-1 and 10-2, respectively. Table 10-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 10-4 through 10-6 contain the corresponding information of failure to close and failure to remain closed. The size of the affected population of pumps is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 10-7 through 10-16.

2. SYSTEM DESCRIPTION

The emergency service water system is designed to ensure adequate cooling is provided to the safety related equipment during all analyzed accident conditions where Class 1E AC power is available. Service water is supplied from a designated ultimate heat sink (e.g., cooling tower, river lake, ocean etc.) to heat exchangers in closed loop cooling systems. This safety function is normally provided by multiple trains of the ESW system, each with an ESW pump and associated driver. Some power plants use storage water in a limited amount via gates and canals.

A variety of pump combinations are utilized across the vendor designs to accomplish this safety function. The combinations range from as few as two, to twelve or more. In most cases, piping configurations allow each ESW pump to supply cooling water to multiple closed loop system heat exchangers. However, BWR ESW system arrangements are split into more sections by location of equipment supplied (e.g., reactor building etc.). Power to the motor-driven ESW pumps is supplied from the Class 1E AC power system which has an emergency source (usually an emergency diesel generator). A simplified schematic diagram of the ESW system is shown in Figure 10-1.

ALPHA FACTOR AND MGL PARAMETERS Emergency Service Water Pumps

Table 10-1: Summary of Alpha Factor Parameter Estimations - Fail to Start

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9638931	0.9461791	0.9228140	0.9089041	0.9029763
α.2	3.61E-02	4.37E-02	6.20E-02	5.32E-02	4.03E-02
α,		1.01E-02	8.47E-03	2.83E-02	3.36E-02
œ,	1		6.74E-03	4.29E-03	1.48E-02
a,	1		Parate Second States of States of States	5.37E-03	5.19E-03
α.			1		3.21E-03

Table 10-2: Summary of MGL Parameter Estimations - Fail to Start

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.64E-01	9.46E-01	9.23E-01	9.09E-01	9.03E-01
Beta	3.61E-02	5.38E-02	7.72E-02	9.11E-02	9.70E-02
Gemma		1.88E-01	1.97E-01	4.16E-01	5.85E-01
Delta			4.43E-01	2.55E-01	4.09E-01
Epsilon	T			5.56E-01	3.62E-01
Mu					3.82E-01

Table 10-3: Summary of Average Impact Vectors - Fail to Start

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	129.01	193.51	258.01	322.52	387.02
N,	32.3127	37.7868	35.2266	30.4601	26.9867
N ₂	6.0422	10.6786	19.6921	20.6534	18.4712
N,		2.4781	2.6924	10.9742	15.3808
N.4			2.1424	1.6663	6.7800
N,				2.0839	2.3800
N.	and deputy where the property of a second system of the second system of				1.4725

Total Number of Independent Failure Events: 318 Total Number of Common-Cause Failure Events: 61

ALPHA FACTOR AND MGL PARAMETERS Emergency Service Water Pumps

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Ø.,	0.9617605	0.9634743	0.9622712	0.9615668	0.9606430
α,	3.82E-02	1.44E-02	1.61E-02	1.50E-02	1.28E-02
α,		2.22E-02	5.49E-03	7.86E-03	8.65E-03
α.,			1.61E-02	2.79E-03	4.73E-03
as				1.27E-02	2.38E-03
a.,					1.08E-02

Table 10-4: Summary of Alpha Factor Parameter Estimations - Fail to Run


Table 10-5: Summary of MGL Parameter Estimations - Fail to Run

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.62E-01	9.64E-01	9.62E-01	9.62E-01	9.61E-01
Beta	3.82E-02	3.65E-02	3.77E-02	3.84E-02	3.94E-02
Gamma		6.07E-01	5.73E-01	6.09E-01	6.74E-01
Delta			7.46E-01	6.64E-01	6.74E-01
Epsilon				8.20E-01	7.36E-01
Mu			Contraction of the second s		8.19E-01

Table 10-6: Summary of Average Impact Vectors - Fail to Run

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	442.97	664.45	885.93	1107.42	1328.90
N ₁	34.4529	35.8558	35.2866	32.1411	29.0731
N2	18.9823	10.4299	15.4361	17.8229	18.1225
N ₃		16.1190	5.2590	9.3180	12.2240
N,			15.4240	3.3091	6.6851
N ₅	an (201) SP, wilds P, Sand Annalayd Angel Walson Balance			15.0979	3.3604
N ₆					15.2434

Total Number of Independent Failure Events: 866 Total Number of Common-Cause Failure Events: 80

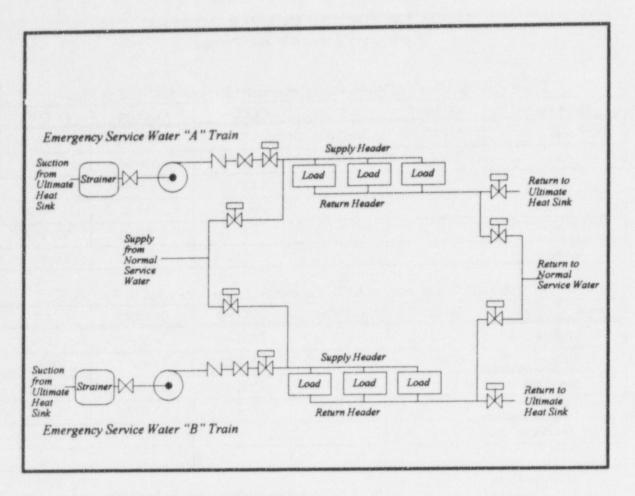



3. COMPONENT BOUNDARIES

The main component of an ESW pump is the pump itself coupled to an AC electric motor for a driver. This component can be in one of two states, standby or running. In the standby condition, starting is accomplished by sensors actuating a circuit breaker. These pumps can also be started manually via remote control switches. Stopping of the pump is accomplished only by operator actions via the control switches or automatic signals designed to protect the pump or driver (e.g., overcurrent). The boundaries include the pump itself and internal piece-parts, the driver, circuit breaker, lubrication or cooling systems, and any sensors, controls, or indication required for operation of the pump.

4. FAILURE EVENT DEFINITION

Successful operation of an ESW pump is defined for two distinct modes of operation. If the ESW pump is in the standby condition, it must respond to an actuation signal by starting, which includes of obtaining design discharge pressure or flow. Once running, the ESW pump must continue to produce design flow or discharge pressure until its service is no longer needed. The respective failure modes used for evaluating the data are:

- FS Failure to Start: Examples are:
 - Circuit breaker fails to close,
 - Pump fails to achieve design flow or pressure,
 - Control switch failure, and
 - Pressure switch failure.

FR Failure to Run: Examples are:

- Excessive bearing vibration,
- Cavitation,
- Decreasing performance (less than design flow or pressure) while running,
- Excessive packing leaks, and
- Loss of lubrication/cooling.

ESW pump malfunctions are considered to be failures to start or run on demand 7 ump failures include those failures that are caused by power supplies or sensors that are unique to the pump-driver combination. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the ESW pumps.

Pump-driver failures are evaluated to determine the effect on pump operability. In general, if the failure causes the pump to fail to operate, it will be considered a failure. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered pump failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of pump demand. The exception to this is if a licensee reported that the pump "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the pump from operating properly on a safety demand.

Some LERs reported only one actual failure, but the report information indicated that a second ESW pump would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another ESW pump, then the event was identified as a CCF. If, however, the report did not clearly identify that another ESW pump would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to an ESW pump actuation demand (e.g., the condition was found during inspection, and no actual demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 10-7 through 10-16 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of ESW pumps. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Emergency Service Water Pumps

Table 10-7: Alpha Factor Distribution Summary - Fail to Start, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9375315	0.9632831	0.9650163	0.9831287	0.9638981	1.7085E+02	6.5122E+00
α,	1.69E-02	3.67E-02	3.50E-02	6.25E-02	3.61E-02	6.5122E+00	1.7085E+02

Table 10-8: Alpha Factor Distribution Summary - Fail to Start, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α.	0.9217195	0.9464138	0.9475555	0.9672214	0.9461791	2.4650E+02	1.3957E+01
α,	2.42E-02	4.25E-02	4.13E-02	6.48E-02	4.37E-02	1.1066E+01	2.4939E+02
α,	2.94E-03	1.11E-02	9.87E-03	2.34E-02	1.01E-02	2.8909E+00	2.5757E+02

Table 10-9: Alpha Factor Distribution Summary - Fail to Start, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9001951	0.9248706	0.9256917	0.9467360	0.9228140	3.1794E+02	2.5827E+01
α,	3.96E-02	5.89E-02	5.80E-02	8.11E-02	6.20E-02	2.0246E+01	3.2352E+02
α,	2.32E-03	8.60E-03	7.66E-03	1.81E-02	8.47E-03	2.9550E+00	3.4081E+02
α.,	1.85E-03	7.64E-03	6.71E-03	1.66E-02	6.74E-03	2.6260E+00	3.4114E+02

Table 10-10: Alpha Factor Distribution Summary - Fail to Start, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8894056	0.9128414	0.9134861	0.9340845	0.9089041	3.9102E+02	3.7335E+01
α,	3.39E-02	4.99E-02	4.92E-02	6.83E-02	5.32E-02	2.1381E+01	4.0697E+02
α,	1.52E-02	2.66E-02	2.59E-02	4.05E-02	2.83E-02	1.1386E+01	4.1697E+02
α,	7.40E-04	4.44E-03	3.69E-03	1.07E-02	4.29E-03	1.8999E+00	4.2646E+02
α,	1.53E-03	6.23E-03	5.48E-03	1.35E-02	5.37E-03	2.6679E+00	4.2569E+02

Table 10-11: Alpha Factor Distribution Summary - Fail to Start, CCCG = 6

5th%	Mean	Median	95th%	MLE	a	b
0.8862246	0.9080896	0.9086238	0.9281349	0.9029763	4.6448E+02	4.7011E+01
2.49E-02	3.76E-02	3.70E-02	5.24E-02	4.03E-02	1.9250E+01	4.9224E+02
1.96E-02	3.11E-02	3.05E-02	4.47E-02	3.36E-02	1.5921E+01	4.9557E+02
6.58E-03	1.39E-02	1.32E-02	2.33E-02	1.48E-02	7.0927E+00	5.0440E+02
1.24E-03	5.13E-03	4.50E-03	1.12E-02	5.19E-03	2.6233E+00	5.0887E+02
7.97E-04	4.15E-03	3.53E-03	9.65E-03	3.21E-03	2.1244E+00	5.0937E+02
	0.8862246 2.49E-02 1.96E-02 6.58E-03 1.24E-03	0.88622460.90808962.49E-023.76E-021.96E-023.11E-026.58E-031.39E-021.24E-035.13E-03	0.88622460.90808960.90862382.49E-023.76E-023.70E-021.96E-023.11E-023.05E-026.58E-031.39E-021.32E-021.24E-035.13E-034.50E-03	0.88622460.90808960.90862380.92813492.49E-023.76E-023.70E-025.24E-021.96E-023.11E-023.05E-024.47E-026.58E-031.39E-021.32E-022.33E-021.24E-035.13E-034.50E-031.12E-02	0.88622460.90808960.90862380.92813490.90297632.49E-023.76E-023.70E-025.24E-024.03E-021.96E-023.11E-023.05E-024.47E-023.36E-026.58E-031.39E-021.32E-022.33E-021.48E-021.24E-035.13E-034.50E-031.12E-025.19E-03	0.88622460.90808960.90862380.92813490.90297634.6448E+022.49E-023.76E-023.70E-025.24E-024.03E-021.9250E+011.96E-023.11E-023.05E-024.47E-023.36E-021.5921E+016.58E-031.39E-021.32E-022.33E-021.48E-027.0927E+001.24E-035.13E-034.50E-031.12E-025.19E-032.6233E+00

ALPHA FACTOR DISTRIBUTIONS Emergency Service Water Pumps

Table 10-12: Alpha Factor Distribution Summary - Fail to Run, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9465909	0.9615879	0.9621973	0.9745147	0.9617605	4.8695E+02	1.9452E+01
α,	2.55E-02	3.84E-02	3.78E-02	5.34E-02	3.82E-02	1.9452E+01	4.8695E+02

Table 10-13: Alpha Factor Distribution Summary - Fail to Run, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	£	b
α,	0.9511597	0.9631841	0.9636015	0.9737887	0.9634743	7.1551E+02	2.7349E+01
α,	8.15E-03	1.46E-02	1.41E-02	2.25E-02	1.44E-02	1.0817E+01	7.3204E+02
α,	1.42E-02	2.23E-02	2.18E-02	3.18E-02	2.22E-02	1.6532E+01	7.2633E+02

Table 10-14: Alpha Factor Distribution Summary - Fail to Run, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9514073	0.9619464	0.9622573	0.9714137	0.9622712	9.4592E+02	3.7420E+01
α,	1.02E-02	1.63E-02	1.59E-02	2.34E-02	1.61E-02	1.5990E+01	9.6735E+02
α,	2.35E-03	5.62E-03	5.28E-03	1.0E-02	5.49E-03	5.5216E+00	9.7782E+02
α.,	1.02E-02	1.62E-02	1.59E-02	2.33E-02	1.61E-02	1.5908E+01	9.6743E+02

Table 10-15: Alpha Factor Distribution Summary - Fail to Run, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9517437	0.9612232	0.9614717	0.9698423	0.9615668	1.1776E+03	4.7506E+01
α,	9.89E-03	1.51E-02	1.49E-02	2.13E-02	1.50E-02	1.8551E+01	1.2066E+03
α,	4.28E-03	7.94E-03	7.68E-03	1.25E-02	7.86E-03	9.730E+00	1.2154E+03
α,	9.05E-04	2.89E-03	2.63E-03	5.79E-03	2.79E-03	3.5427E+00	1.2216E+03
α,	8.01E-03	1.28E-02	1.25E-02	1.85E-02	1.27E-02	1.5682E+01	1.2094E+03

Table 10-16: Alpha Factor Distribution Summary - Fail to Run, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9516203	0.9603430	0.9605500	0.9683479	0.9606430	1.4085E+03	5.8164E+01
α,	8.45E-03	1.29E-02	1.27E-02	1.81E-02	1.28E-02	1.8902E+01	1.4478E+03
α,	5.13E-03	8.70E-03	8.48E-03	1.30E-02	8.65E-03	1.2765E+01	1.4539E+03
α,	2.24E-03	4.77E-03	4.55E-03	8.06E-03	4.73E-03	6.9978E+00	1.4597E+03
α,	7.79E-04	2.46E-03	2.24E-03	4.89E-03	2.38E-03	3.6037E+00	1.4631E+03
α,	6.80E-03	1.08E-02	1.06E-02	1.56E-02	1.08E-02	1.5895E+01	1.4508E+03

NUREG/CR-5497

11. PWR High Pressure Safety Injection Pumps

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving pumps in the high pressure safety injection system (HPSI) system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to start and failure to run. The data cover the time period from 1980 through 1995.

The data review identified 21 common-cause failure-to-start events and 21 common-cause failure-to-run events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to start are shown in Tables 11-1 and 11-2, respectively. Table 11-3 contains the average impact vectors (N_1-N_3) and the number of adjusted independent events for this failure mode. Tables 11-4 through 11-6 contain the corresponding information for the failure to run failure modes. The size of the affected population of PWR high pressure injection pumps is denoted as CCCG. The alpha factor model parameters are denoted by $\alpha_1-\alpha_3$. Beta (β), gamma (γ), delta (δ), and epsilon (ε) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 11-7 through 11-14.

2. SYSTEM DESCRIPTION

The high pressure safety injection (HPSI) system is a subsystem of the emergency core cooling system (ECCS) that functions to provide emergency coolant injection to maintain reactor coolant inventory and provide adequate decay heat removal following a loss of coolant accident (LOCA). The injection function is performed in a relatively short time interval after initiation of the LOCA. The system is typically comprised of two safety injection (SI) pumps and two or three high pressure centrifugal charging pumps (CCP); one CCP is an installed spare which can be manually aligned to either train. Positive displacement (reciprocating) charging pumps were not included in this study due to the differences in design and operating characteristics between them and centrifugal pumps. CCF events can affect only the SI pumps, only the CCPs, or both SI pumps and CCPs, so the CCCG for events at a single plant can range from two to five.

Both the charging and the SI pumps inject directly into the primary loop cold legs, and the SI pumps can be realigned to inject into the hot legs. The suction source for the HPSI pumps is the refueling water storage tank (RWST) which contains enough highly borated water to satisfy the injection needs of the core. Figure 11-1 illustrates the typical flow path for the HPSI system. All pumps and motor operated valves receive power from the 1E emergency power system backed up by the emergency diesel generators.

The system is normally aligned and in the standby mode. The HPSI pumps are started by the engineered safety features actuation system (ESFAS) or may be manually actuated. A HPSI signal starts the charging and SI pumps, shifts the charging pump suction to the RWST, isolates normal charging and letdown flow and completes additional valve lineup changes. The injection phase ends when the RWST reaches the low level setpoint and the system is realigned for the recirculation phase which takes suction from the containment sump through the RHR system.

ALPHA FACTOR AND MGL PARAMETERS PWR High Pressure Safety Injection Pumps

Table 11-1: Summa	ry of Alpha Factor 1	Parameter Estimations -	Fail to Start
-------------------	----------------------	-------------------------	---------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5
a,	0.9443582	0.9446865	0.9467303	0.9503090
α,	5.56E-02	2.58E-02	2.45E-02	1.67E-02
α,		2.95E-02	6.72E-03	1.17E-02
œ,		A CONTINUE TRANSPORTATION AND A CONTRACTOR AND A STREET	2.21E-02	3.53E-03
as				1.77E-02

Table 11-2: Summary of MGL Parameter Estimations - Fail to Start

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5
1-Beta	9.44E-01	9.45E-01	9.47E-01	9.50E-01
Beta	5.56E-02	5.53E-02	5.33E-02	4.97E-02
Gamma		5.34E-01	5.40E-01	6.63E-01
Delta		MAY 1979 - BOARD MINISTER & BOARD AND AND AND AND AND AND AND AND AND AN	7.66E-01	6.44E-01
Epsilon	An Address of the Annual			8.33E-01

Table 11-3: Summary of Average Impact Vectors - Fail to Start

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5
Adj. Ind. Events	128.66	192.99	257.33	321.66
N,	8.5527	7.3543	5.7121	4.3340
N ₂	3.0846	5.4708	6.8068	5.7440
N,		6.2598	1.8676	4.0272
N,			6.1262	1.2119
N ₅				6.0629

Total Number of Independent Failure Events: 202 Total Number of Common-Cause Failure Events: 21

ALPHA FACTOR AND MGL PARAMETERS PWR High Pressure Safety Injection Pumps

Table 11-4: S	Summary of Alpha	Factor Parameter	Estimations - Fail to Run
---------------	------------------	------------------	---------------------------

Alpha Factor	CCCG=2	CCCC -3	CCCG=4	CCCG=5
α,	0.9790682	0.9719681	0.9716753	0.9729580
α2	2.09E-02	1.96E-02	1.41E-02	9.90E-03
a,		8.44E-03	8.70E-03	8.44E-03
α.4			5.55E-03	4.57E-03
as	a parameter des neuronneurs and make an events and an an	all an anna an ann ann an an an an an an an		4.13E-03

Table 11-5: Summary of MGL Parameter Estimations - Fail to Run

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5
1-Beta	9.79E-01	9.72E-01	9.72E-01	9.73E-01
Beta	2.09E-02	2.80E-02	2.83E-02	2.70E-02
Gamma		3.01E-01	5.03E-01	6.34E-01
Delta			3.89E-01	5.08E-01
Epsikn		ann an Allandia ann an Staine ann ann ann ann an Stàine Stàine ann. Stàinean an		4.74E-01

Table 11-6: Summary of Average Impact Vectors - Fail to Run

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5
Adj. Ind. Events	212.98	319.47	425.95	532.44
N ₁	9.9688	7.9357	6.3669	5.0404
N ₂	4.7665	6.5984	6.2637	5.4699
N ₃	anan ar a anan a bar na anan an a	2.8441	3.8700	4.6633
N.			2.4685	2.5257
Ns				2.2796

Total Number of Independent Failure Events: 279 Total Number of Common-Cause Failure Events: 21

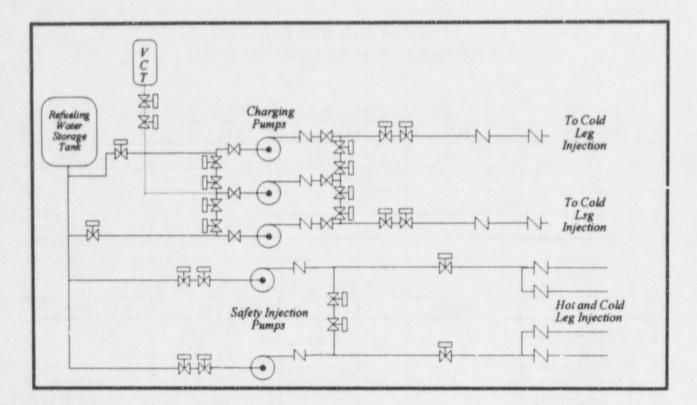


Figure 11-1. Typical high pressure safety injection system.

3. COMPONENT BOUNDARIES

The main component of an HPSI pump is the pump itself. The SI pumps are normally in standby and started by sensors actuating the circuit breaker to the driver which will in turn operate the pump. These pumps can also be started manually via remote control switches. There is usually one charging pump operating, and it will continue running on a LOCA signal. Stopping of the pump is accomplished only by operator actions via the control switches or automatic signals designed to protect the pumps or motors (e.g., overcurrent, overspeed).

The boundaries include the pump itself, the driver including the circuit breaker, lubrication or cooling systems, and any sensors, controls, or indication required for operation of the pump. Sensors or input logic that affect components other than a single SI or charging pump are not included in the component boundaries.

4. FAILURE EVENT DEFINITION

Successful operation of an HPSI pump is defined for two distinct modes of operation. If the HPSI is in the normal standby condition, it must respond to an actuation signal by starting which consists of obtaining design discharge pressure and flow. Once running, the HPSI pump must continue to produce design flow and discharge pressure until its service is no longer needed. The respective failure modes used for evaluating the HPSI pump data are:

- FS Failure to Start: Examples are:
 - Circuit breaker fails to close,
 - Pump fails to achieve design flow or pressure,
 - Control switch failure, and
 - Pressure switch failure.
- FR Failure to Run: Examples are:
 - Excessive bearing vibration,
 - Cavitation,
 - Decreasing performance (less than design flow or pressure) while running,
 - Excessive packing leaks, and
 - Loss of lubrication/cooling.

HPSI pump malfunctions are considered to be failures to start or failures to run. Pump failures include those failures that are caused by power supplies or sensors that are unique to the pump-driver combination. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the HPSI pumps.

Pump motor failures are evaluated to determine the effect on pump operability. In general, if the failure causes the pump to fail to operate, it will be considered a failure. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered pump failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of pump demand. The exception to this is if a licensee reported that the pump "would have" (instead of "may" or "could nave") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the pump from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second HPSI pump would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another HPSI pump, the event was identified as a CCF. If, however, the report did not clearly identify that another pump would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another HPSI pump operation demand (e.g. the condition was found during inspection, and no actual pump start was attempted), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 11-7 through 11-14 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of pumps. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS PWR High Pressure Safety Injection Pumps

Table 11-7: Alpha Factor Distribution Summary	- Fail	to Start,	CCCG = 2
---	--------	-----------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9119826	0.9449137	0.9468151	0.9713447	0.9443582	1.4674E+02	8.5546E+00
α,	2.87E-02	5.51E-02	5.32E-02	8.80E-02	5.56E-02	8.5546E+00	1.4674E+02

Table 11-8: Alpha Factor Distribution Summary - Fail to Start, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9182689	0.9450582	0.9463533	0.9674159	0.9446865	2.1554E+02	1.2531E+01
α,	1.12E-02	2.57E-02	2.43E-02	4.49E-02	2.58E-02	5.8580E+00	2.2221E+02
α,	1.36E-02	2.93E-02	2.79E-02	4.96E-02	2.95E-02	6.6726E+00	2.2140E+02

Table 11-9: Alpha Factor Distribution Summary - Fail to Start, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9243639	0.9470097	0.9479904	0.9663187	0.9467303	2.8774E+02	1.6101E+01
α2	1.17E-02	2.42E-02	2.32E-02	4.03E-02	2.45E-02	7.3606E+00	2.9648E+02
α,	1.35E-03	7.01E-03	5.96E-03	1.63E-02	6.72E-03	2.1302E+00	3.0171E+02
α,	1.0E-02	2.18E-02	2.07E-02	3.71E-02	2.21E-02	6.6098E+00	2.9723E+02

Table 11-10: Alpha Factor Distribution Summary - Fail to Start, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
œ ₁	0.9309180	0.9503879	0.9511725	0.9671870	0.9503090	3.6404E+02	1.904E+01
α.	7.69E-03	1.69E-02	1.61E-02	2.90E-02	1.67E-02	6.4720E+00	3.7657E+02
α,	4.27E-03	1.16E-02	1.08E-02	2.18E-02	1.17E-02	4.4392E+00	3.7860E+02
α.,	4.17E-04	3.77E-03	2.95E-03	9.94E-03	3.53E-03	1.4455E+00	3.8160E+02
α.,	8.0E-03	1.74E-02	1.65E-02	2.96E-02	1.77E-02	6.6469E+00	3.7640E+02

ALPHA FACTOR DISTRIBUTIONS PWR High Pressure Safety Injection Pumps

Table 11-11: Alph	a Factor Distribution	Summary - Fai	il to Run,	CCCG = 2
-------------------	-----------------------	---------------	------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9604043	0.9779717	0.9792973	0.9910095	0.9790682	2.3248E+02	5.2365E+00
α,	8.99E-03	2.20E-02	2.07E-02	3.96E-02	2.09E-02	5.2365E+00	2.3248E+02

Table 11-12: Alpha Factor Distribution Summary - Fail to Run, CCCG = 3

Alpha Factor	5th%	Mean	Medien	95th%	MLE	8	b
a ₁	0.9549345	0.9709723	0.9718611	0.9839909	0.9719681	3.4261E+02	1.0243E+01
α,	9.35E-03	1.98E-02	1.89E-02	3.33E-02	1.96E-02	6.9856E+00	3.4587E+02
α,	2.71E-03	9.23E-03	8.32E-03	1.89E-02	8.44E-03	3.2569E+00	3.4960E+02

Table 11-13: Alpha Factor Distribution Summary - Fail to Run, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	2	b
Ø.	0.9566302	0.9704788	0.9711466	0.9820622	0.9716753	4.5702E+02	1.3902E+01
α,	6.75E-03	1.45E-02	1.38E-02	2.45E-02	1.41E-02	6.8175E+00	4.6411E+02
α,	3.08E-03	8.78E-03	8.09E-03	1.68E-02	8.70E-03	4.1326E+00	4.6679E+02
α,	1.69E-03	6.27E-03	5.59E-03	1.32E-02	5.55E-03	2.9521E+00	4.6797E+02

Table 11-14: Alpha Factor Distribution Summary - Fail to Run, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9594095	0.9714794	0.9720066	0.9817424	0.9729580	5.7552E+02	1.6896E+0
α,	4.65E-03	1.05E-02	9.92E-03	1.81E-02	9.90E-03	6.1979E+00	5.8622E+3
α,	3.42E-03	8.57E-03	8.02E-03	1.56E-02	8.44E-03	5.0753E+00	5.27347.+0
α,	1.18E-03	4.66E-03	4.11E-03	1.0E+01	4.57E-03	2.7593E+00	5.8966E+0
α,	1.27E-03	4.83E-03	4.29E-03	1.03E-02	4.13E-03	2.8636E+00	5.8955E+0

12. BWR Low Pressure Coolant Injection Pumps

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving pumps in the low pressure coolant injection (LPCI) system, including RHR pumps in the injection mode, at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to start and failure to run. The data cover the time period from 1980 through 1995.

The data review identified seven common-cause failure-to-start events and two common-cause failure-to-run events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to start are shown in Tables 12-1 and 12-2, respectively. Table 12-3 contains the average impact vectors (N₁-N₄) and the number of adjusted independent events for this failure mode. Tables 12-4 through 12-6 contain the corresponding information for the failure to run failure modes. The size of the affected population of BWR low pressure injection pumps is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_4 . Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 12-7 through 12-12.

2. SYSTEM DESCRIPTION

LPCI is a mode of the residual heat removal (RHR) subsystem of the emergency core cooling system (ECCS) or a specific separate system in early BWR designs that serves several functions by operating in different modes:

- Low pressure coolant injection (LPCI) mode to provide low pressure makeup water to the reactor vessel for core cooling under loss of coolant accident (LOCA) conditions,
- · Containment spray mode to reduce primary containment pressure and temperature following a LOCA, and
- Suppression pool cooling mode to remove heat from the suppression pool.

Under accident conditions, the LPCI mode is automatically initiated. All other modes require manual system alignment for proper operation. The LPCI mode takes suction from the suppression pool and discharges to the reactor vessel penetrations. The RHR heat exchangers are bypassed in this mode. The containment spray mode protects the containment structure from possible over pressurization from steam which might bypass the suppression pool, including system breaks within the containment volume. In this mode water is pumped from the suppression pool through heat exchangers to spray nozzles located high in the containment space. The suppression pool cooling mode is designed to limit the long term bulk temperature rise of the suppression pool water following a design basis LOCA. A closed path from the suppression pool through the RHR loops to the reactor vessel and back to the suppression pool through the break can be maintained for decay heat removal from the core.

A simplified schematic drawing of a typical BWR LPCI system configuration in presented in Figure 12-1.

ALPHA FACTOR AND MGL PARAMETERS BWR Low Pressure Coolant Injection Pumps

Table 12-1	Summary	of Alpha Factor	Parameter	Estimations -	Fail to Start

Alpha Factor	CCCG=2	CCCG=3	CCCG~4
C.	0.9894718	0.9789343	0.9682947
α,	1.05E-02	2.10E-02	3.15E-02
Ø.,	naar bennen veren mennet bescher vertrefendensem Anthenen ander finselnet en ander en seinen vertrefendensem	8.21E-05	2.18E-04
a,	ana a sheka kuman ay sa kuma kuma kuma kuma kuma kuma kuma kum		7.78E-06

Table 12-2: Summary of MGL Parameter Estimations - Fail to Start

MGL Parameters	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.90E-01	9.76E-01	9.68E-01
Beta	1.05E-02	2.11E-02	3.17E-02
Gamma	na nagany ika mangkan kalang di kangkanan yanakan Cananan yang ka katala kananan	3.90E+03	7.12E+03
Deita	connect and a characterization of the table and an experimentary services and the service of the		3.45E+02

Table 12-3: Summary of Average Impact Vectors - Fail to Start

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj.Ind.Events	28.00	42.00	56.00
N,	4.4616	5.6695	6.2110
N	0.3454	1.0218	2.0225
N,	NEW YORK AND A MEANING AND	0.0040	0.0140
N,	ngar galanter ninga ar antalante sa majorni is das til genines in annan hant til revenues som		0.0005

Total Number of Independent Failure Events: 56 Total Number of Common-Cause Failure Events: 7

NUREG/CR-5497

ALPHA FACTOR AND MGL PARAMETERS BWR Low Pressure Coolant Injection Pumps

Table 12-4: Summary of Alpha Factor Parameter Estimations - Fail to Run

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
۵.,	0.9978412	0.9956831	0.9935106
α,	2.16E-03	4.32E-03	6.49E-03
α,	and an and a second	0.00E+00	0.00E+00
α.,			0.00E+00

Table 12-5: Summary of MGL Parameter Estimations - Fail to Run

MGL Parameters	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.98E-01	9.96E-01	9.94E-01
Beta	2.16E-03	4.32E-03	6.49E-03
Gamma	anances of the system wing an electronic devices of the second data proved with	0.00E+00	0.00E+00
Delta	WATER AND A REAL AND A	An annual control of all of the last of th	0.00E+00

Table 12-6: Summary of Average Impact Vectors - Fail to Run

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj. Ind. Events	38.00	57.00	76.00
N,	1.3802	1.8150	2.0800
N ₁	0.0852	0.2550	0.5100
N,	n gan na magana ang kang kang kang kang kang kang	0.0000	0.0000
N.		A REAL OF THE REAL PROPERTY OF	0.0000

Total Number of Independent Failure Events: 76 Total Number of Common-Cause Failure Events: 2

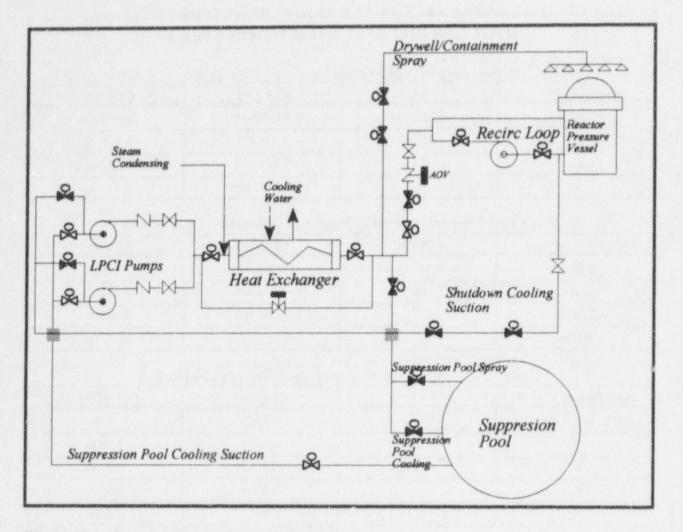


Figure 12-1. Low pressure coolant injection system.

3. COMPONENT BOUNDARIES

The main component of a LPCI pump is the pump itself. This component is normally in standby and is started by sensors actuating the circuit breaker to the driver which will in turn operate the pump. These pumps can also be started up manually via remote control switches. Stopping of the pump is accomplished only by operator actions via the control switches or automatic signals designed to protect the pumps or motors (e.g., overcurrent).

The boundaries include the pump itself, the motor including the circuit breaker, lubrication or cooling systems, and any sensors, controls, or indication required for operation of the pump. Sensors or input logic that affect components other than a single LPCI pump are not included in the component boundaries.

4. FAILURE EVENT DEFINITION

Successful operation of a LPCI pump is defined for two distinct modes of operation. If the system is in the normal standby condition, it must respond to an actuation signal by starting which consists of obtaining design discharge pressure and flow. Once running, the LPCI pump must continue to produce design flow and discharge pressure until its service is no longer needed. The respective failure modes used for evaluating the LPCI pump data are:

- FS Failure to Start: Examples are:
 - Circuit breaker fails to close,
 - Pump fails to achieve design flow or pressure,
 - Control switch failure, and
 - Flow switch failure.

FR Failure to Run: Examples are:

- Excessive bearing vibration,
- Cavitation,
- Decreasing performance (less than design flow or pressure) while running,
- Excessive packing leaks, and
- Loss of lubrication/cooling.

LPCI pump malfunctions are considered to be failures to start or failures to run. Pump failures include those failures that are caused by power supplies or sensors that are unique to the pump-driver combination. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the LPCI pumps.

Pump motor failures are evaluated to determine the effect on pump operability. In general, if the failure causes the pump to fail to operate, it will be considered a failure. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered pump failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of pump demand. The exception to this is if a licensee reported that the pump "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the pump from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second LPCI pump would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another LPCI pump, the event was identified as a CCF. If, however, the report did not clearly identify that another LPCI pump would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another LPCI pump operation demand (e.g. the condition was found during inspection, and no actual pump start was attempted), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 12-7 through 12-12 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of pumps. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS BWR Low Pressure Coolant Injection Pumps

Table 12-7: Alpha Factor Distribution Summar	y - Fail to Start, CCCG = 2
--	-----------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9392302	0.9809519	0.9877585	0.9994319	0.9894718	4.1992E+01	8.1540E-01
α,	5.65E-04	1.91E-02	1.22E-02	6.08E-02	1.05E-02	8.1540E-01	4.1992E+01

Table 12-8: Alpha Factor Distribution Summary - Fail to Start, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9319679	0.9717787	0.9764931	0.9954600	0.9789343	6.2870E+01	1.8258E+00
α,	2.34E-03	2.18E-02	1.71E-02	5.73E-02	2.10E-02	1.4090E+00	6.3287E+01
α,	8.85E-06	6.44E-03	2.47E-03	2.63E-02	8.21E-05	4.1680E-01	6.4279E+01

Table 12-9: Alpha Factor Distribution Summary - Fail to Start, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9257452	0.9630241	0.9664008	0.9887644	0.9682947	8.6911E+01	3.3370E+00
α,	6.86E-03	2.86E-02	2.51E-02	6.19E-02	3.15E-02	2.5763E+00	8.7672E+01
α,	1.52E-07	3.07E-01	6.54E-04	1.40E-02	2.18E-04	2.7660E-01	8.9971E+01
α,	1.79E-05	5.36E-03	2.39E-03	2.08E-02	7.78E-06	4.8410E-01	8.9764E+01

ALPHA FACTOR DISTRIBUTIONS BWR Low Pressure Coolant Injection Pumps

Table 12-10:	Alpha Factor	Distribution	Summary	- Fail to Run.	CCCG = 2	

Aipha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9586822	0.9887760	0.9943569	0.9999262	0.9978412	4.8910E+01	5.5520E-01
α,	7.56E-05	1.12E-02	5.65E-03	4.13E-02	2.16E-03	5.5520E-01	4.8910E+01

Table 12-11: Alpha Factor Distribution Summary - Fail to Run, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9589755	0.9859465	0.9899666	0.9991654	0.9956831	7.4015E+01	1.0550E+00
α,	1.08E-04	8.56E-03	4.76E-03	2.99E-02	4.32E-03	6.4220E-01	7.4428E+01
α,	7.09E-06	5.50E-03	2.08E-03	2.26E-02	0.00E+00	4.1280E-01	7.4657E+01

Table 12-12: Alpha Factor Distribution Summary - Fail to Run, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9579508	0.9826943	0.9856679	0.9972736	0.9935106	1.0278E+02	1.8100E+00
α,	6.12E-04	1.02E-02	7.27E-03	2.97E-02	6.49E-03	1.0638E+00	1.0353E+02
α,	7.27E-08	2.51E-03	4.86E-04	1.20E-02	0.00E+00	2.6260E-01	1.0433E+02
α,	1.53E-05	4.62E-03	2.05E-03	1.79E-02	0.00E+00	4.8360E-01	1.0411E+02

13. PWR Low Pressure Safety Injection Pumps

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving pumps in the low pressure safety injection (LPSI) system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to start and failure to run. The data cover the time period from 1980 through 1995.

The data review identified six common-cause failure-to-start events and 19 common-cause failure-to-run events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to start are shown in Tables 13-1 and 13-2, respectively. Table 13-3 contains the average impact vectors (N_1-N_2) and the number of adjusted independent events for this failure mode. Tables 13-4 through 13-6 contain the corresponding information for the failure to run failure mode. The size of the affected population of low pressure safety injection pumps is denoted as CCCG, and is two for all plants. The alpha factor model parameters are denoted by $\alpha_1-\alpha_2$. Beta (β) is the multiple Greek letter model parameter. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 13-7 and 13-8.

2. SYSTEM DESCRIPTION

The low pressure safety injection system (LPSI) is a subsystem of the emergency core cooling system (ECCS) that functions to provide emergency coolant injection to maintain reactor coolant inventory and provide adequate long term decay heat removal following a loss of coolant accident (LOCA). The low pressure safety injection function is performed over a relatively long time interval after initiation of the LOCA. The LPSI pumps inject directly into the primary loop cold legs and can be realigned to inject into the hot legs. The initial suction source for the LPSI pumps is the refueling water storage tank (RWST) which contains enough highly borated water to satisfy the injection needs of the core. During the recirculation phase the pumps take a suction from the containment sump and supply flow to the loops or to the suction of the high pressure safety injection pumps. These pumps also provide for the shutdown cooling function. Figure 13-1 illustrates the typical flow path for the LPSI system. The system is typically comprised of two high capacity centrifugal pumps. The pumps receive power from the 1E emergency power system and are backed up by the emergency diesel generators.

The system is normally aligned and in the standby mode. The LPSI pumps are started by the engineered safety features actuation system or may be manually actuated. A safety injection (SI) signal starts the pumps and aligns the pump suction to the RWST. The injection phase ends when the RWST reaches the low level setpoint and the system is realigned for the recirculation phase.

ALPHA FACTOR AND MGL PARAMETERS PWR Low Pressure Safety Injection Pumps

Table 13-1: Summary of Alpha Factor Parameter Estimations - Fail to Start

CCCG=2
0.9368421
6.32E-02

Table 13-2: Summary of MGL Parameter Estimations - Fail to Start

MGL Parameter	CCCG=2
1-Beta	9.37E-01
Beta	6.32E-02

Table 13-3: Summary of Average Impact Vectors - Fail to Start

Avg. Impact Vector	CCCG=2
Adj.Ind.Events	89
N.	0.0000
N.	6.0000

Total Number of Independent Failure Events: 89 Total Number of Common-Cause Failure Events: 6

NUREG/CR-5497

114

ALPHA FACTOR AND MGL PARAMETERS PWR Low Pressure Safety Injection Pumps

Table 13-4: Summary of Alpha Factor Parameter Estimations - Fail to Run

Alpha Factor	CCCG=2
α,	0.9465153
α ₂	5.35E-02

Table 13-5: Summary of MGL Parameter Estimations - Fail to Run

MGL Parameter	CCCG=2
1-Beta	9.47E-01
Beta	5.35E-02

Table 13-6: Summary of Average Impact Vectors - Fail to Run

Avg. Impact Vector	CCCG=2		
Adj.Ind.Events	273		
N,	1.5698		
N ₂	15.5151		

Total Number of Independent Failure Events: 273 Total Number of Common-Cause Failure Events: 19

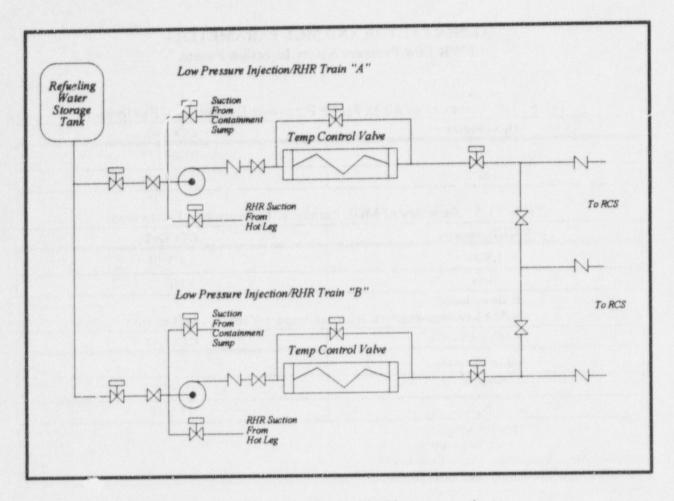


Figure 13-1. PWR low pressure safety injection/residual heat removal system.

3. COMPONENT BOUNDARIES

The main component of an LPSI pump is the pump itself. This component is normally in a standby mode and is started by sensors actuating the circuit breaker to the driver which will in turn operate the pump. These pumps can also be started up manually via remote control switches. Stopping of the pump is accomplished only by operator actions via the control switches or automatic signals designed to protect the pumps or motors (e.g., overcurrent, overspeed).

The boundaries include the pump itself, the driver including the circuit breaker, lubrication or cooling systems, and any sensors, controls, or indications required for operation of the pump. Sensors or input logic that affect components other than a single LPSI pump are not included in the component boundaries.

4. FAILURE EVENT DEFINITION

Successful operation of a LPSI pump is defined for two distinct modes of operation. If the LPSI system is in the normal standby condition, it must respond to an actuation signal by starting which consists of obtaining design discharge pressure and flow. Once running, the LPSI pump must continue to produce design flow and discharge pressure until its service is no longer needed. The respective failure modes used for evaluating the LPSI pump data are:

- FS Failure to Start: Examples are:
 - Circuit breaker fails to close,
 - Pump fails to achieve design flow or pressure,
 - Control switch failure, and
 - Pressure switch failure.
- FR Failure to Run: Examples are:
 - Excessive bearing vibration,
 - Cavitation,
 - Decreasing performance (less than design flow or pressure) while running.
 - Excessive packing leaks, and
 - Loss of lubrication/cooling.

LPSI pump malfunctions are considered to be failures to start or failures to run. Pump failures include those failures that are caused by power supplies or sensors that are unique to the pump motor combination. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the LPSI pumps.

Pump motor failures are evaluated to determine the effect on pump operability. In general, if the failure causes the pump to fail to operate, it will be considered a failure. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered pump failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of pump demand. The exception to this is if a licensee reported that the pump "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the pump from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second LPSI pump would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another LPSI pump, the event was identified as a CCF. If, however, the report did not clearly identify that another LPSI pump would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another LPSI pump operation demand (e.g. the condition was found during inspection, and no actual pump start was attempted), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 13-7 and 13-8 present the alpha factor uncertainty distribution summaries for each failure mode. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

PWR LPSI Pumps

ALPHA FACTOR DISTRIBUTIONS PWR Low Pressure Safety Injection Pumps

Table 13-7:	Alpha Factor	Distribution	Summary	- Fail to S	Start,	CCCG = 2	

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
	0.8957730	0.9383810	0.9411541	0.9715172	0.9368421	9.8530E+01	6.470E+00
CL,	2.85E-02	6.16E-02	5.89E-02	1.04E-01	6.32E-02	6.470E+00	9.8530E+01

ALPHA FACTOR DISTRIBUTIONS PWR Low Pressure Safety Injection Pumps

Table 13-8: Alpha Factor Distribution Summary - Fail to Run, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
CL ₁	0.9238843	0.9467318	0.9477241	0.9662029	0.9465153	2.8410E+02	1.5985E+01
α,	3.38E-02	5.33E-02	5.23E-02	7.61E-02	5.35E-02	1.5985E+01	2.8410E+02

14. BWR Standby Liquid Control Pumps

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving pumps in the standby liquid control (SLC) system at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to start and failure to run. The data cover the time period from 1980 through 1995.

The data review identified two common-cause failure-to-start events and eight common-cause failure-to-run events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to start are shown in Tables 14-1 and 14-2, respectively. Table 14-3 contains the average impact vectors (N_1 - N_2) and the number of adjusted independent events for this failure mode. Tables 14-4 through 14-6 contain the corresponding information for the failure to run failure mode. The size of the affected population of standby liquid control pumps is denoted as CCCG and is two for all plants. The alpha factor model parameters are denoted by α_1 - α_2 . Beta (β) is the multiple Greek letter model parameter. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Distributions of the mean values of the alpha factor estimates are also included in this report in Tables 14-7 and 14-8.

2. SYSTEM DESCRIPTION

The standby liquid control system is a backup to the control rod reactor scram system designed to shut down the reactor by chemical poisoning in the event the control rods fail to shut down the reactor. The SLC system, illustrated in Figure 14-1, consists of a heated storage tank, two suction valves, two positive displacement pumps, two explosive actuated valves, and piping necessary to inject the neutron absorber into the reactor vessel. The storage tank contains enough neutron absorbing solution (sodium pentaborate) to shutdown the reactor anytime in core life without the use of the control rods. The SLC is initiated with a keylock switch located in the control room. When the SLC control switch for a train is placed in the run position, the explosive valve opens, the appropriate train's motor operated suction valve (for the plants that have the motor-operated suction valves) opens, the reactor wate. cleanup system isolates and the SLC pump starts.

ALPHA FACTOR AND MGL PARAMETERS BWR Standby Liquid Control Pumps

Table 14-1: Summary of Alpha Factor Parameter Estimations - Fail to Start

CCCG=2		
0.9019608		
9.80E-02		

Table 14-2: Summary of MGL Parameter Estimations - Fail to Start

MGL Parameter	CCCG=2
1-Beta	9.02E-01
Beta	9.80E-02

Table 14-3: Summary of Average Impact Vectors - Fail to Start

Avg. Impact Vector	CCCG=2
Adj. Ind. Events	11.00
N ₁	0.5000
N ₂	1.2500

Total Number of Independent Failure Events: 11 Total Number of Common-Cause Failure Events: 2

NUREG/CR-5497

ALPHA FACTOR AND MGL PARAMETERS BWR Standby Liquid Control Pumps

Table 14-4: Summary of Alpha Factor Parameter Estimations - Fail to Run

Alpha Factor	CCCG=2		
α,	0.9676016	in a subscription	
α2	3.24E-02		

Table 14-5: Summary of MGL Parameter Estimations - Fail to Run

MGL Parameter	CCCG=2
1-Betu	9.68E-01
Beta	3.24E-02

Table 14-6: Summary of Average Impact Vectors - Fail to Run

Avg. Impact Vector	CCCG=2		
Adj. Ind. Events	59.00		
N,	2.3890		
N ₂	2.0555		

Total Number of Independent Failure Events: 59 Total Number of Common-Cause Failure Events: 8

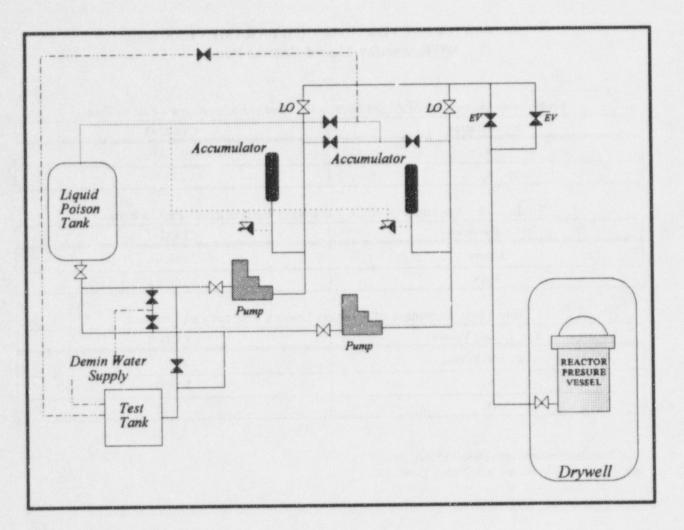


Figure 14-1. Standby liquid control system.

3. COMPONENT BOUNDARIES

The main component of a SLC pump is the pump itself coupled to an AC electric motor for a driver. This component can be in one of two states, standby or running. In the standby condition, starting is accomplished by a keylock control switch actuating a circuit breaker. These pumps can also be started manually at the SLC pump breakers. Stopping of the pump is accomplished only by operator actions via the control switches or automatic signals designed to protect the pump or driver (e.g., overcurrent).

The boundaries include the pump itself and internal piece-parts, the motor, circuit breaker, lubrication or cooling systems, and any sensors, controls, or indication required for operation of the pump. Sensors or input logic that affect components other than a single SLC pump are not included in the component boundaries.

NUREG/CR-5497

4. FAILURE EVENT DEFINITION

The function of the standby liquid control pumps is to allow borated water flow to the reactor vessel. The pumps must respond to an initiation signal by starting, including reaching design discharge pressure and flow. Once running, the SLC pumps must continue to produce design flow and discharge pressure until their service is no longer needed. The failure modes used in evaluating the SLC system pump data are:

- FS Failure to Start: Examples are:
 - Circuit breaker fails to close,
 - Pump fails to achieve design flow or pressure, and
 - Control switch failure.
- FR Failure to Run: Examples are:
 - Excessive bearing vibration,
 - Cavitation,
 - Decreasing performance (less than design flow or pressure),
 - Excessive packing leaks, and
 - Loss of lubrication/cooling.

SLC pump malfunctions are considered to be failures to start or failures to run. Pump failures include those failures that are caused by power supplies or sensors that are unique to the pump motor combination. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the SLC pumps.

Pump motor failures are evaluated to determine the effect on pump operability. In general, if the failure causes the pump to fail to operate, it will be considered a failure. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered pump failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of pump demand. The exception to this is if a licensee reported that the pump "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the pump from operating properly on a safety demand.

Some LERs reported only one pump actual failure, but the report information indicated that failure of a second pump would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of the other pump, the event was identified as a CCF. If, however, the report did not clearly identify that another pump would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before a pump operation demand (e.g. the condition was found during inspection, and no actual pump start was attempted), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 14-7 and 14-8 present the alpha factor uncertainty distribution summaries for each failure mode. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS BWR Standby Liquid Control Pumps

Table 14-7: Alpha Factor Distribution Summary - Fail to Start, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
	0.8184919	0.9243956	0.9366053	0.9884081	0.9019608	2.1030E+01	1.7200E+0
α.,	1.16E-02	7.56E-02	6.34E-02	1.82E-01	9.80E-02	1.7200E+00	2.1030E+0

ALPHA FACTOR DISTRIBUTIONS BWR Standby Liquid Control Pumps

Table 14-8: Alpha Factor Distribution Summary - Fail to Run, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
	0.9251711	0.9656135	0.9697558	0.9918786	0.9676016	7.0919E+01	2.5255E+00
α,	8.12E-03	3.44E-02	3.02E-02	7.48E-02	3.24E-02	2.5255E+00	7.0919E+01

15. BWR High Pressure Coolant Injection and Reactor Core Isolation Cooling Pumps

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models usin⁻⁻⁻ operational data involving pumps in the high pressure coolant injection (HPCI) and reactor core isolation cooling (RCIC) systems at boiling water reactor (BWRs) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to start, and failure to run. The data cover the time period from 1980 through 1995.

The data review identified one common-cause failure-to-start event and one common-cause failure-to-run event. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to start are shown in Tables 15-1 and 15-2, respectively. Table 15-3 contains the average impact vectors (N_1-N_2) and the number of adjusted independent events for this failure mode. Tables 15-4 through 15-6 contain the corresponding information for the failure to run failure mode. The size of the affected population of high pressure coolant injection pumps is denoted as CCCG and is two for all plants. The alpha factor model parameters are denoted by $\alpha_1-\alpha_2$. Beta (β) is the multiple Greek letter model parameter. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 15-7 and 15-8.

2. SYSTEM DESCRIPTION

BWRs can have HPCI and RCIC systems, only a RCIC system for late model BWR's, or only a HPCI system (if an Isolation Condenser is present). Both the HPCI and the RCIC are single train systems, and are not consequently subject to CCF events by themselves. This analysis combined the failures of pumps across the system boundaries to examine CCFs.

The HPCI system supplies high volume, high pressure make-up water to the reactor pressure vessel (RPV) in the event of a small break LOCA which does not result in a rapid depressurization of the reactor vessel. The HPCI system consists of a turbine driven pump, system piping, valves and controls. The HPCI system is normally in standby when the plant is at power. The HPCI system is normally aligned to take a suction on the Condensate Storage Tank (CST) but suction is automatically switched from the CST to the suppression pool upon low CST level or high suppression pool water level. The HPCI system is automatically started in response to decreasing RPV water level or high dry well pressure and is injected into the reactor via the feedwater header which injects outside the RPV shroud. HPCI is the primary source of makeup if RCS pressure remains high. The HPCI turbine steam supply is from main steam. Figure 15-1 shows a typical HPCI system.

The RCIC system provides low volume, high pressure makeup water to the RPV for core cooling when the main steam lines are isolated or the condensate/feedwater system is not available. The RCIC system consists of a turbine driven pump, piping, valves, and controls. The RCIC system is normally shut down and aligned in standby, if the plant is at power. The RCIC system is normally aligned for suction from the CST, but suction is automatically switched from the CST to the suppression pool on low CST level or high suppression pool water level. The RCIC system is automatically started in response to decreasing RPV water level and is injected into the RPV via the feedwater line. Steam to drive the RCIC turbine is routed from main steam. The RCIC system is similar to the HPCI system in terms of components and configuration.

ALPHA FACTOR AND MGL PARAMETERS BWR High Pressure Coolant Injection/ Reactor Core Isolation Cooling Pumps

Table 15-1: Summary of Alpha Factor Parameter Estimations - Fail to Start

Alpha Factor	CCCG=2		
α,	0.9986092		
α,	1.39E-03		

Table 15-2: Summary of MGL Parameter Estimations - Fail to Start

MGL Parameter	CCCG=2
1-Deta	9.99E-01
Beta	1.39E-03

Table 15-3: Summary of Average Impact Vectors - Fail to Start

Avg. Impact Vector	CCCG=2		
Adj. Ind. Events	178		
N ₁	1.5000		
N ₂	0.2500		

Total Number of Independent Failure Events: 178 Total Number of Common-Cause Failure Events: 1

NUREG/CR-5497

ALPHA FACTOR AND MGL PARAMETERS BWR High Pressure Coolant Injection/ Reactor Core Isolation Cooling Pumps

Table 15-4: Summary of Alpha Factor Parameter Estimations - Fail to Run

Alpha Factor	CCCG=2
α,	0.9998494
a ₁	1.51E-04

Table 15-5: Summary of MGL Parameter Estimations - Fail to Run

MGL Parameter	CCCG=2		
1-Beta	1.00E+01		
Beta	1.51E-04		

Table 15-6: Summary of Average Impact Vectors - Fail to Run

Avg. Impact Vector	CCCG=2		
Adj. Ind. Events	165.00		
N ₁	0.9500		
N ₂	0.0250		

Total Number of Independent Failure Events: 165 Total Number of Common-Cause Failure Events: 1

BWR HPCI and RCIC Pumps

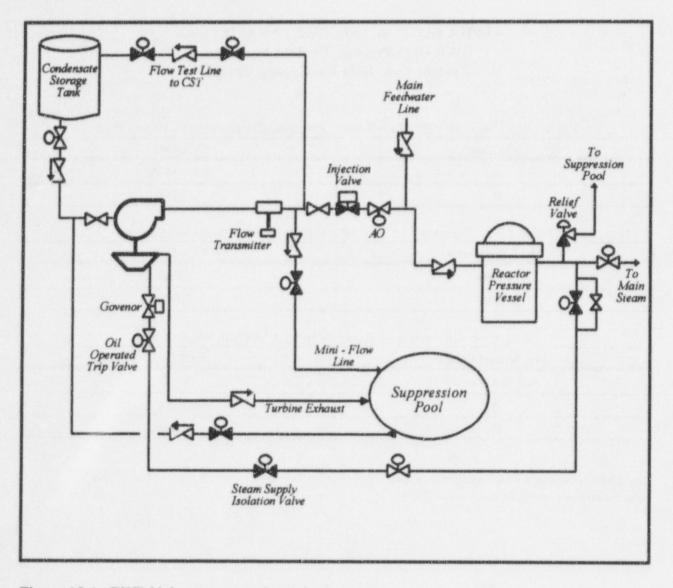


Figure 15-1. BWR high pressure coolant injection system.

3. COMPONENT BOUNDARIES

The main component of an HPCI/RCIC pump is the pump itself. This component is normally in a standby mode and is started up by a sensor opening the steam inlet value to start the steam turbine, which will in turn operate the pump. These pumps can also be started manually via remote control switches. Stopping of the pump is accomplished only by operator actions via the control switches or automatic signals designed to protect the pumps or turbines (e.g., overspeed).

The boundaries include the pump itself, the driver including the governor system, lubrication or cooling systems, and any sensors, controls, or indication required for operation of the pump. Sensors or input logic that affect components other than a single HPCI/RCIC pump are not included in the component boundaries.

4. FAILURE EVENT DEFINITION

Successful operation of a HPCI/RCIC pump is defined for two distinct modes of operation. If the HPCI/RCIC is in the normal standby condition, it must respond to an actuation signal by starting which consists of obtaining design discharge pressure and flow. Once running, the HPCI/RCIC pump must continue to produce design flow and discharge pressure until its service is no longer needed. The respective failure modes used for evaluating the HPCI/RCIC pump data are:

- FS Failure to Start: Examples are:
 - Steam supply valve fails to opens,
 - Pump fails to achieve design flow or pressure,
 - · Governor fails to control rpm, and
 - Control switch failure.
- FR Failure to Run: Examples are:
 - Excessive bearing vibration,
 - Cavitation,
 - Decreasing performance (less than design flow or pressure) while running,
 - Excessive packing leaks, and
 - Loss of lubrication/cooling.

HPCI/RCIC pump malfum tions are considered to be failures to start or failures to run. Pump failures include those failures that are caused by power supplies or sensors that are unique to the pump-driver combination. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the HPCI/RCIC pumps.

Pump-turbine failures are evaluated to determine the effect on pump operability. In general, if the failure causes the pump to fail to operate, it will be considered a failure. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered pump failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of pump demand. The exception to this is if a licensee reported that the pump "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the pump from operating properly on a safety demand. An example is starting up the plant following an outage when the HPCI/RCIC starting signals are required to be unblocked. On occasion, licensees forget to unblock the signals when they change modes, resulting in a TS violation, and preventing the HPCI/RCIC pumps from starting at the required condition.

Many LERs reported only one actual failure, but the report information indicated that failure of a second HPCI/RCIC pump would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another HPCI/RCIC pump, the event was identified as a CCF. If, however, the report did not clearly identify that another HPCI/RCIC pump would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another HPCI/RCIC pump operation demand (e.g. the condition was found during inspection, and no actual pump start was attempted), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 15-7 and 15-8 present the alpha factor uncertainty distribution summaries for each failure mode. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS BWR High Pressure Coolant Injection/ Reactor Core Isolation Cooling Pumps

Table 15-7: Alpha Factor Distribution Summary - Fail to Start, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9872374	0.9962055	0.9977501	0.9999251	0.9986092	1.8903E+02	7.2000E-01
α.2	7.33E-05	3.79E-03	2.25E-03	1.28E-02	1.39E-03	7.2000E-01	1.8903E+02

ALPHA FACTOR DISTRIBUTIONS High Pressure Coolant Injection/ Reactor Core Isolation Cooling Pumps

Table 15-8: Alpha Factor Distribution Sum	nary - Fail to Run, $CCCG = 2$
---	--------------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
Ø.	0.9891709	0.9971871	0.9987245	0.9999906	0.9998494	1.7548E+02	4.9500E-01
Ø2	1.05E-05	2.81E-03	1.27E-03	1.08E-02	1.51E-04	4.9500E-01	1.7548E+02

16. BWR Suppression Pool Strainers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common cause failure (CCF) parameters of various models using operational data involving suppression pool strainers at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common cause failure events. The only failure mode analyzed are failure to is failure to allow flow. The data cover the time period from 1980 through 1995.

The data review identified two common cause failure-to-allow flow events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to allow flow are shown in Tables 16-1 and 16-2, respectively. Table 16-3 contains the average impact vectors $(N_1 \cdot N_6)$ and the number of adjusted independent events for this failure mode. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 16-4 through 16-8.

2. SYSTEM DESCRIPTION

The suppression pool in a BWR plant serves as the primary means of containment pressure suppression during a large break loss of coolant accident (LOCA). The primary containment design is such that the steam from a large break LOCA is directed through the water in the suppression pool, where the steam is condensed and much of the fission product activity in the coolant is scrubbed. The suppression pool also serves as a source of water for emergency core cooling (ECCS) pumps. High pressure ECCS pump suction paths can be switched between a condensate storage tank (CST) outside of containment, and the suppression pool. These systems normally take their suction first from the CST, and then switch to the suppression pool upon a low level in the CST or a high level in the suppression pool. The plant Technical Specifications normally only require the suction from the suppression pool for system operability. The low pressure ECCS subsystems take a suction only from the suppression pool. All of the high and low pressure ECCS pumps have a suction strainer to filter any debris which may be present in the suppression pool. Figures 16-1 and 16-2 show typical suppression pool configurations.

After a large break LOCA, much of the residual heat from the reactor will have been transferred to the suppression pool. Core cooling will be maintained by the ECCS pumps recirculating water from the suppression pool (through the suction strainers) to the reactor vessel and core, and back out to the suppression pool through the break in the primary coolant system. This heat is then removed from the suppression pool via one or more low pressure ECCS trains using heat exchangers in the injection flow path or being switched from the injection mode to the suppression pool cooling mode. In this mode, suppression pool water is circulated by the residual heat removal (RHR) system from the suppression pool (through the RHR suction strainers), through heat exchangers cooled by service water, and back to the suppression pool.

ALPHA FACTOR AND MGL PARAMETERS BWR Suppression Pool Strainers

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
œ,	0.8148148	0.8400000	0.8586387	0.8747244	0.8886809
α,	1.85E-01	4.00E-02	3.14E-02	2.16E-02	1.38E-02
α,		1.20E-01	2.09E-02	2.16E-02	1.84E-02
α.,			8.90E-02	1.08E-02	1.38E-02
a,				7.13E-02	5.52E-03
a.					5.98E-02

Table 16-1: Summary of Alpha Factor Parameter Estimations - Fail to Allow Flow

Table 16-2: Summary of MGL Parameter Estimations - Fail to Allow Flow

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	8.15E-01	8.40E-01	8.59E-01	8.75E-01	8.89E-01
Beta	1.85E-01	1.60E-01	1.41E-01	1.25E-01	1.11E-01
Gamma		7.50E-01	7.78E-01	8.28E-01	8.76E-01
Delta			8.10E-01	7.92E-01	8.11E-01
Epsilon				8.68E-01	8.26E-01
Mu					9.15E-01

Table 16-3: Summary of Average Impact Vectors - Fail to Allow Flow

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	5.00	7.50	10.00	12.50	15.00
N ₁	0.5000	0.3750	0.2500	0.1563	0.0938
N ₂	1.2500	0.3750	0.3750	0.3125	0.2344
N,		1.1250	0.2500	0.3125	0.3125
N,			1.0625	0.1563	0.2344
Ns				1.0313	0.0938
N.					1.0156

Total Number of Independent Failure Events: 5 Total Number of Common-Cause Failure Events: 2

BWR Suppression Pool Strainers

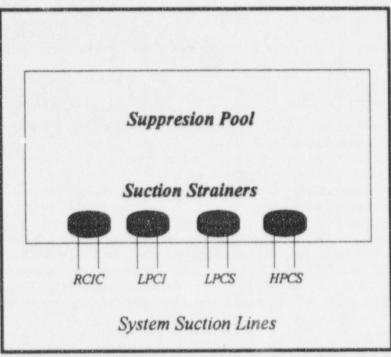


Figure 16-1. BWR suppression pool suction strainers.

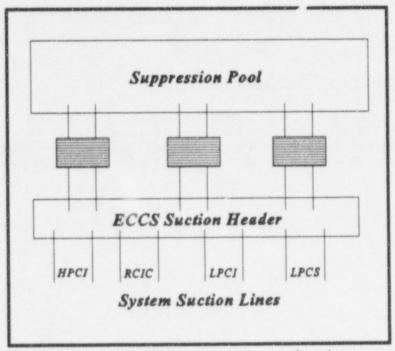


Figure 16-2. BWR Mark 1 suppression pool strainer.

3. COMPONENT BOUNDARIES

The main component of a sump strainer is the strainer itself. This component is normally in a standby mode and is a passive component with no moving parts.

4. FAILURE EVENT DEFINITION

Successful operation of the containment sump strainer is allowing flow from the sump to the pumps. The only failure mode used for evaluating the sump strainer data is:

- PG Plugged, or Failure to Allow Flow. Examples are:
 - · Physical damage (to screens) that reduces flow cross-section, and
 - Accumulation of debris in sump.

Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of strainer demand. The exception to this is if a licensee reported that the strainer "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the strainers from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second pool strainer would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another pool strainer, the event was identified as a CCF. If, however, the report did not clearly identify that another pool strainer would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another pool strainer operation demand (e.g. the condition was found during inspection, and no actual strainer demand was initiated), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 16-4 through 16-8 present the alpha factor uncertainty distribution summaries for each configuration of suppression pool strainers. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

NUREG/CR-5497

ALPHA FACTOR DISTRIBUTIONS BWR Suppression Pool Strainers

Table 16-4: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α,	0.7569184	0.8973134	0.9129722	0.9839224	0.8148148	1.5030E+01	1.720E+00
α,	1.61E-02	1.03E-01	8.70E-02	2.43E-01	1.85E-01	1.720E+00	1.5030E+01

Table 16-5: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
a	0.8022571	0.9093596	0.9200261	0.9798831	0.8400000	2.3075E+01	2.3000E+00
α,	7.28E-04	3.00E-02	1.88E-02	9.76E-02	4.00E-02	7.6220E-01	2.4613E+01
α,	7.76E-03	6.06E-02	4.94E-02	1.52E-01	1.20E-01	1.5378E+00	2.3837E+01

Table 16-6: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	B	b
α,	0.8396673	0.9212521	0.9285998	0.9776719	0.8586387	3.4950E+01	2.9875E+00
α2	1.06E-03	2.45E-02	1.68E-02	7.43E-02	3.14E-02	9.2880E-01	3.7090E+01
α,	6.17E-05	1.35E-02	6.39E-03	5.11E-02	2.09E-02	5.1260E-01	3.7425E+01
α,	5.18E-03	4.08E-02	3.30E-02	1.03E-01	8.90E-02	1.5461E+00	3.6391E+01

Table 16-7: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8670792	0.9307816	0.9360191	0.9765710	0.8747244	5.0698E+01	3.7702E+00
α2	1.10E-03	1.91E-02	1.36E-02	5.59E-02	2.16E-02	1.0405E+00	5.3428E+01
α,	2.66E-04	1.33E-02	7.99E-03	4.44E-02	2.16E-02	7.2450E-01	5.3744E+01
α.,	6.31E-06	7.16E-03	2.55E-03	2.99E-02	1.08E-02	3.8990E-01	5.4078E+01
α,	4.00E-03	2.97E-02	2.41E-02	7.43E-02	7.13E-02	1.6153E+00	5.2853E+01

Table 16-8: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8832959	0.9368672	0.9409990	0.9763009	0.8886809	6.5566E+01	4.4183E+00
α,	7.79E-04	1.45E-02	1.02E-02	4.29E-02	1.38E-02	1.0135E+00	6.8971E+01
α,	4.11E-04	1.22E-02	7.96E-03	3.84E-02	1.84E-02	8.5310E-01	6.9131E+01
α ₄	4.89E-05	7.82E-03	3.87E-03	2.90E-02	1.38E-02	5.4710E-01	6.9437E+01
α,	1.42E-06	4.82E-03	1.42E-03	2.12E-02	5.52E-03	3.3710E-01	6.9647E+01
α.,	3.36E-03	2.38E-02	1.95E-02	5.93E-02	5.98E-02	1.6675E+00	6.8317E+01

NUREG/CR-5497

17. PWR Containment Sump Strainers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving containment sump strainers at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify CCF events. The only failure mode analyzed is failure to allow flow. The data cover the time period from 1980 through 1993.

The data review identified one common-cause failure-to-allow-flow event. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to allow flow are shown in Tables 17-1 and 17-2, respectively. Table 17-3 contains the average impact vectors (N_1-N_4) and the number of adjusted independent events. The size of the affected population of strainers is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_4 . Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 17-4 through 17-6.

2. SYSTEM DESCRIPTION

The containment sump strainers are stationary screens in the emergency core cooling system (ECCS) that function to protect the ECCS pumps and prevent plugging of containment spray nozzles from debris that may be in containment when the sump is used as a coolant source. The containment is used a suction source for the containment recirculation spray pumps, the residual heat removal pumps, and the high pressure safety injection pumps.

The sump screen assembly is divided into two or more sections to prevent damage and large debris on one side from affecting the other side. Typically the sump strainers are a combination of a heavy grate (to keep out large debris) and smaller mesh strainers to strain out small debris such as insulation fibers. The containment sump strainers do not have any moving parts or electrical connections. Figure 17-1 illustrates the configuration of the containment sump strainers.

ALPHA FACTOR AND MGL PARAMETERS PWR Containment Sump Strainers

Table 17-1: Summary of Alpha Factor Parameter Estimations - Fail to Allow Flow

Alpha Factor	CCCG=2	CCCG=2 CCCG=3	
a1	0.8750000	0.8426966	0.8565031
α,	1.25E-01	8.99E-02	3.75E-02
α,		6.74E-02	6.62E-02
α.,	anti-ann a saonar ann ann a' fuirte. An tro nann ann ann an an an ann an	a an ann ann an an ann an ann an ann an	3.97E-02

Table 17-2: Summary of MGL Parameter Estimations - Fail to Allow Flow

CCCG	2	3	4
1-Beta	8.75E-01	8.43E-01	8.57E-01
Beta	1.25E-01	1.57E-01	1.44E-01
Gamma		4.29E-01	7.39E-01
Delta	n an		3.75E-01

Table 17-3: Summary of Average Impact Vectors - Fail to Allow Flow

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj. Ind. Events	3.00	4.50	6.00
N,	0.5000	0.1875	0.0625
N ₂	0.5000	0.5000	0.2656
N ₃		0.3750	0.4688
N.			0.2813

Total Number of Independent Failure Events: 3 Total Number of Common Cause Failure Events: 1

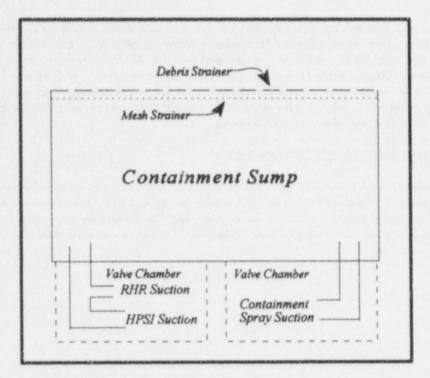


Figure 17-1. PWR containment sump strainers.

3. COMPONENT BOUNDARIES

The containment sump strainer includes the strainer screens used to filter debris and the sump area that serves to accumulate coolant for ECCS pump suction.

4. FAILURE EVENT DEFINITION

Successful operation of the containment sump strainer is allowing flow from the sump to the pumps. The only failure mode used for evaluating the sump strainer data is:

- PG Plugged, or Failure to Allow Flow. Examples are:
 - Physical damage (to screens) that reduces flow cross-section, and
 - Accumulation of debris in sump.

Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of flow demand. The exception to this is if a licensee reported that the strainer "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the strainer from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second sump strainer would have occurred from the same cause if flow had been required. When the cause of the actual failure would have clearly caused failure of another sump strainer, the event was identified as a CCF. If, however, the report did not clearly identify that another sump strainer would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another sump strainer operation demand (e.g. the condition was found during inspection, and no actual flow was required), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 17-4 through 17-6 present the alpha factor uncertainty distribution summaries for each configuration of containment sump strainers. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

Alpha Factor Distributions PWR Containment Sump Strainers

Table 17-4: Alpha Factor Distribution Summary - Fail	to Allow	Flow,	CCCG = 2
--	----------	-------	----------


Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.7979730	0.9307143	0.9502500	0.9964643	0.8750000	1.3030E+01	9.7000E-01
α,	3.53E-03	6.93E-02	4.98E-02	2.02E-01	1.25E-01	9.7000E-01	1.3030E+01

Table 17-5: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	2	b
α,	0.8121409	0.9223207	0.9351384	0.9885157	0.8426966	1.9888E+01	1.6750E+00
α,	1.60E-03	4.11E-02	2.80E-02	1.26E-01	8.99E-02	8.8720E-01	2.0676E+01
α,	9.93E-04	3.65E-02	2.34E-02	1.17E-01	6.74E-02	7.8780E-01	2.0775E+01

Table 17-6: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8461229	0.9299942	0.9385474	0.9845584	0.8565031	3.0763E+01	2.3157E+00
α,	7.51E-04	2.48E-02	1.60E-02	7.87E-02	3.75E-02	8.1940E-01	3.2259E+01
α,	4.61E-04	2.21E-02	1.35E-02	7.32E-02	6.62E-02	7.3140E-01	3.2347E+01
α,	5.62E-04	2.31E-02	1.44E-02	7.53E-02	3.97E-02	7.6490E-01	3.2314E+01

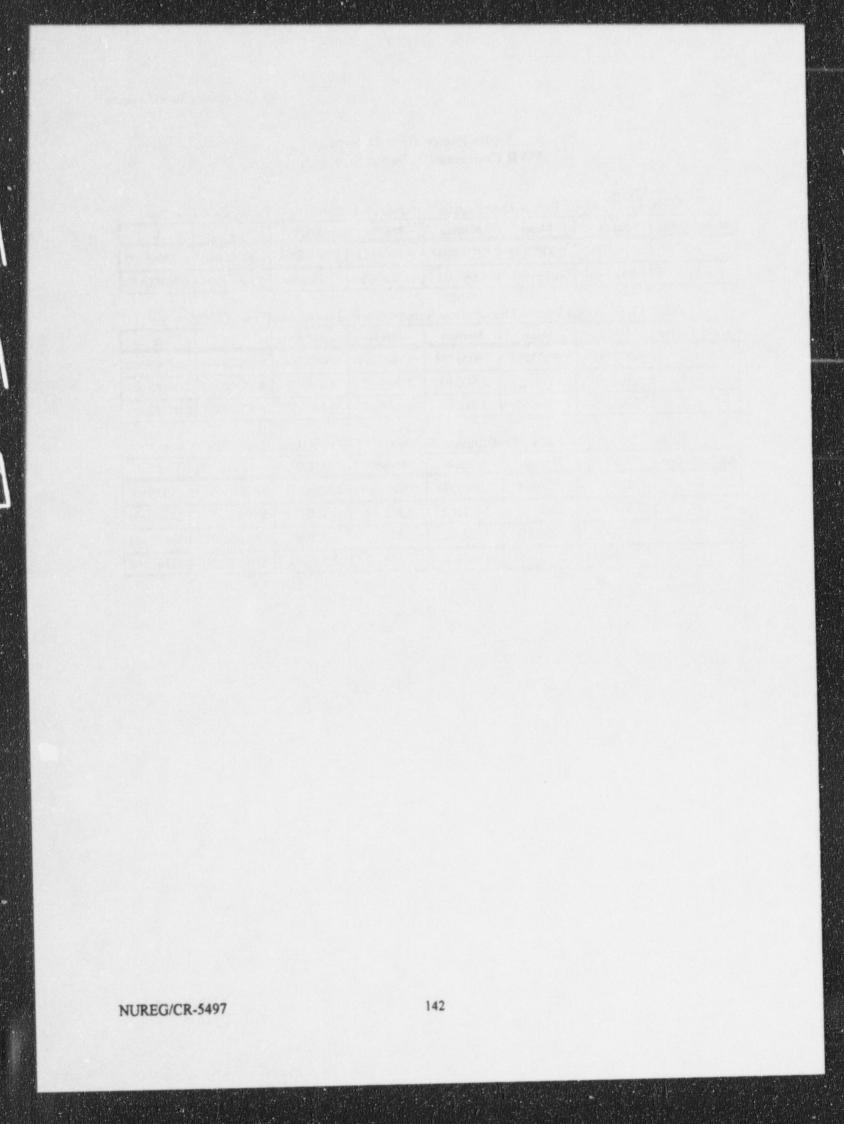

18. Emergency Service Water Strainers

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving strainers in the emergency service water (ESW) system at both pressurized water reactor (PWR) and boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify CCF events. The only failure mode analyzed is failure to allow flow. The data cover the time period from 1980 through 1995.

The data review identified 34 common-cause failure-to-allow-flow events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to allow flow are shown in Tables 18-1 and 18-2, respectively. Table 18-3 contains the average impact vectors (N_1-N_6) and the number of adjusted independent events. The size of the affected population of strainers is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_{ϕ} . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 18-4 through 18-8.

2. SYSTEM DESCRIPTION

The emergency service water system is designed to provide cooling water to the safety related equipment during all analyzed accident conditions where class 1E AC power is available. Service water is supplied from a designated ultimate heat sink (e.g., cooling tower, river lake, ocean etc.) to heat exchangers in closed loop cooling systems. This safety function is normally provided by multiple trains of the ESW system, each with an ESW pump, strainer, and associated equipment.

Water from the ultimate heat sink is drawn to the pump suction through trash racks and/or traveling screens to eliminate large debris from damaging the pumps and plugging the suction flow. Self-cleaning strainers are on the discharge of each pump to clear small debris and organic material out of the ESW system.

A variety of pump/strainer combinations are utilized across the plant designs to help accomplish this safety function. Some plants have as few as two ESW pumps and others have up to twelve ESW pumps. In most cases, piping configurations allow each ESW pump to supply cooling water to multiple closed loop system heat exchangers, however, the BWR ESW system arrangements are split into more sections by location of equipment supplied (e.g., reactor building etc.). Power to the motor-driven ESW strainers is supplied from the class 1E AC electrical system which has an emergency source, usually an emergency diesel generator. A simplified schematic of the ESW system is shown in Figure 18-1.

NUREG/CR-5497

ALPHA FACTOR AND MGL PARAMETERS Emergency Service Water Strainers

Table 18-1: Summary of Alpha Factor Parameter Estimations - Fail to Allow Flow

Alpha Factor	CCCG=2	CCCG#3	CCCG=4	CCCG=5	CCCG=6
CL1	0.8672708	0.8660779	0.8605542	0.8756065	0.8917825
α,	1.33E-01	5.37E-02	5.23E-02	2.61E-02	1.86E-02
α,		8.03E-02	2.61E-02	3.29E-02	1.88E-02
a,			6.10E-02	1.57E-02	1.04E-02
α.,	1			4.97E-02	2.31E-02
α.,					3.74E-02

Table 18-2: Summary of MGL Parameter Estimations - Fail to Allow Flow

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	8.67E-01	8.66E-01	8.61E-01	8.76E-01	8.92E-01
Beta	1.33E-01	1.34E-01	1.39E-01	1.24E-01	1.08E-01
Gamma		5.99E-01	6.25E-01	7.90E-01	8.28E-01
Delta			7.0E-01	6.65E-01	7.90E-01
Epsilon				7.60E-01	8.53E-01
Mu				and Sold and conclusion. Also and an	6.18E-01

Table 18-3: Summary of Average Impact Vectors - Fail to Allow Flow

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	81.61	122.42	163.22	204.03	244.84
N ₁	17.0640	16.1167	12.1884	12.3096	12.7428
\mathbb{N}_2	15.1013	8.5824	10.6612	6.4496	5.3710
N,		12.8396	5.3267	8.1299	5.4326
N,	and a second set of the product of a contract of the second second second second second second second second se		12.4356	3.8778	3.0019
N ₅				12.2771	6.6644
N ₆					10.7877

Total Number of Independent Failure Events: 162 Total Number of Common-Cause Failure Events: 34

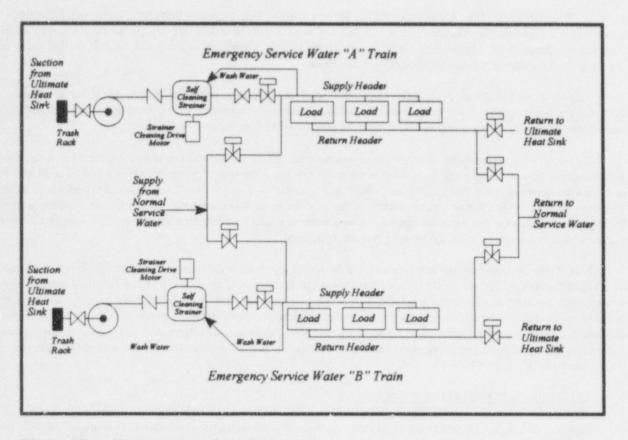


Figure 18-1. Emergency service water system.

3. COMPONENT BOUNDARIES

The main component of an ESW strainer is the strainer itself coupled to an AC electric motor for a driver that rotates the strainer for continuous cleaning. This component can be in one of two states, standby or operation, in conjunction with the associated pump. Typically, the strainers will start and operate whenever the pump is running unless there is a problem, such as strainer motor overload. These strainers can also be started manually via remote control switches. Stopping of the strainer is accomplished by operator actions via the control switches or automatic signals designed to protect the strainer or driver (e.g., overcurrent). The boundaries include the strainer itself and internal piece-parts, the motor, circuit breaker, lubrication or cooling systems, and any sensors, controls, or indication required for operation of the strainer.

4. FAILURE EVENT DEFINITION

Successful operation of an ESW strainer is starting from the standby condition, and allowing flow to the downstream portion of the system. The only failure mode used for evaluating the ESW strainer data is:

- PG Failure to Allow Flow. Examples are:
 - Clogging due to grass/seaweed, and
 - Fouling due to organic buildup.

ESW strainer malfunctions are considered to be failures to allow flow, including loss of the motor, since plugging of the strainer will follow shortly. Strainer failures include those failures that are caused by power supplies or sensors that are unique to the strainer-driver combination. Failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the ESW strainer.

Strainer motor failures are evaluated to determine the effect on strainer operability. In general, if the failure causes the strainer to fail to operate, it will be considered a failure. Failures of the sensors or control circuitry to provide input in other systems (e.g., interlocks or indication) will not be considered strainer failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of pump/strainer demand. The exception to this is if a licensee reported that the strainer "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the strainer from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that a second ESW strainer would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another ESW strainer, then the event was identified as a CCF. If, however, the report did not clearly identify that another ESW strainer would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to an ESW strainer actuation demand (e.g., the condition was found during inspection, and no actual strainer operation was attempted), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 18-4 through 18-8 present the alpha factor uncertainty distribution summaries for each configuration of ESW strainers. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Emergency Service Water Strainers

Table 18-4: Alpha Factor Distribution Summary - F	Fail to Allow Flow, $CCCG = 2$	
---	--------------------------------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.8221297	0.8741951	0.8762136	0.9193713	0.8672708	1.0820E+02	1.5571E+01
α,	8.06E-02	1.26E-01	1.24E-01	1.78E-01	1.33E-01	1.5571E+01	1.0820E+02

Table 18-5: Alpha Factor Distribution Summary - Fail to Allow Flow CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.8303452	0.8737134	0.8751326	0.9122456	0.8660779	1.5374E+02	2.2222E+01
α,	2.70E-02	5.10E-02	4.93E-02	8.08E-02	5.37E-02	8.9696E+00	1.6699E+02
æ,	4.56E-02	7.53E-02	7.37E-02	1.11E-01	8.03E-02	1.3252E+01	1.6271E+02

Table 18-6: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8325878	0.8706745	0.8717481	0.9050882	0.8605542	2.011E+02	2.9723E+01
α,	2.79E-02	4.88E-02	4.75E-02	7.41E-02	5.23E-02	1.1215E+01	2.1862E+02
α,	1.03E-02	2.43E-02	2.30E-02	4.30E-02	2.61E-02	5.5893E+00	2.2424E+02
α.,	3.37E-02	5.62E-02	5.49E-02	8.32E-02	6.10E-02	1.2919E+01	2.1691E+02

Table 18-7: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8538732	0.8861195	0.8870187	0.9153050	0.8756065	2.5438E+02	3.2692E+01
α,	1.20E-02	2.50E-02	2.39E-02	4.18E-02	2.61E-02	7.1776E+00	2.7989E+02
α,	1.54E-02	2.98E-02	2.87E-02	4.79E-02	3.29E-02	8.5419E+00	2.7853E+02
α.,	5.02E-03	1.43E-02	1.32E-02	2.74E-02	1.57E-02	4.1114E+00	2.8296E+02
α,	2.67E-02	4.48E-02	4.38E-02	6.65E-02	4.97E-02	1.2861E+01	2.7421E+02

Table 18-8: Alpha Factor Distribution Summary - Fail to Allow Flow, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8733800	0.9011671	0.9019509	0.9262804	0.8917825	3.0806E+02	3.3786E+01
α.2	7.99E-03	1.80E-02	1.71E-02	3.12E-02	1.86E-02	6.1501E+00	3.3570E+02
α,	7.64E-03	1.75E-02	1.65E-02	3.05E-02	1.88E-02	5.9732E+00	3.3587E+02
α4	2.89E-03	9.70E-03	8.76E-03	1.97E-02	1.04E-02	3.3146E+00	3.3853E+02
α,	9.49E-03	2.02E-02	1.93E-02	3.41E-02	2.31E-02	6.9077E+00	3.3494E+02
α	1.92E-02	3.35E-02	3.26E-02	5.08E-02	3.74E-02	1.1440E+01	3.3041E+02

19. Main Steam Isolation Air-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving Main Steam Isolation air-operated valves (MSIVs) in the main steam (MS) system at both pressurized water reactors (PWR) and boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. The only failure modes of interest for these valves is failure to close. The data cover the time period from 1980 through 1995.

The data review identified 78 failure-to-close events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to remain close are shown in Tables 19-1 and 19-2, respectively. Table 19-3 contains the average impact vectors (N₁-N₄) and the number of adjusted independent events for this failure mode. The size of the affected population of MSIVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_4 . Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 19-4 through 19-8.

2. SYSTEM DESCRIPTION

The main steam system is part of the PWR Steam Generating system that transfers sensible and decay heat from the reactor coolant system to the turbine and steam auxiliaries during normal operation. Steam leaves the steam generator through a steam line at the top of the steam generator. Each steam line has a main steam isolation valve (MSIVs) outside of the containment building.

The main steam system is part of the BWR core cooling system that transfers sensible and decay heat from the reactor coolant system to the turbine and steam auxiliaries during normal operation. Steam leaves the reactor vessel through four steam lines. Each steam line has two main steam isolation valves (MSIVs) one inside and one outside of the containment building.

Typically the steam lines join outside of the containment building through a cross-connect header and then split into two main steam headers that supply main and auxiliary steam to the turbine and other auxiliaries.

Figure 19-1 shows a typical PWR main steam isolation valve arrangement and Figure 19-2 illustrates a typical BWR arrangement.

ALPHA FACTOR AND MGL PARAMETERS Main Steam Isolation Air-Operated Valves

		n in n i Cloud
TILL 10 1. Cummany of	Alpha Factor Parameter	Estimations - Fail to Remain Closed
Table 19-1 Summary OL	Alpha I actor I then there is	Burd for a second

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α.	0.8605790	0.8433169	0.8251480	0.8068196	0.8023736
<u>a</u> 1	1.39E-01	8.44E-02	9.21E-02	9.10E-02	7.04E-02
KORANINA IN THE AREA COMMON IN AN ADVIDUATION OF		7.23E-02	3.03E-02	4.38E-02	5.40E-02
<u>α</u> ,	+		5.24E-02	1.48E-02	2.23E-02
α,	+			4.35E-02	1.17E-02
α,	+				3.93E-02
α.,				and Caller Statement and all a state and an analysis and all and an annual statements of	1

Table 19-2: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	8.61E-01	8.43E-01	8.25E-01	8.07E-01	8.02E-01
Beta	1.39E-01	1.57E-01	1.75E-01	1.93E-01	1.98E-01
Gamma		4.61E-01	4.73E-01	5.29E-01	6.44E-01
Delta			6.34E-01	5.71E-01	5.76E-01
Epsilon				7.46E-01	6.96E-01
Mu					7.70E-01

Table 19-3: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	72.16	108.24	144.32	180.40	216.48
N ₁	33.6037	35.1840	33.1870	26.0231	22.5532
N ₂	17.1346	14.3566	19.8179	23.2837	20.9665
N ₂	an a star canada a sa canada a canada da	12.2907	6.5196	11.2148	16.0911
N,	annar ann a' an a' ann a' an ann a' ann ann a		11.2769	3.7911	6.6306
N,	Angenarie, word warge die ondere er of a bannen er weere di			11.1352	3.4864
N,					11.6998

Total Number of Independent Failure Events: 197 Total Number of Common-Cause Failure Events: 78

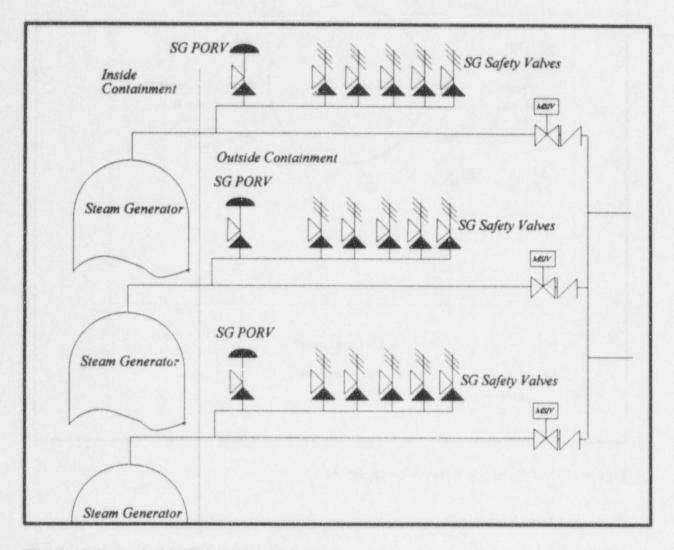


Figure 19-1. Typical PWR MSIV arrangement.

3. COMPONENT BOUNDARIES

The main components of an air-operated valve are the valve, including its internal piece-part components (e.g. disk, seat, stem, packing), and the operator. The operator includes the internal air operator piece-parts, the air supply lines specific to the AOV, sensors, solenoids to control the air supply, and the power leads to these solenoids as piece-parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. Some AOVs have manual handwheels, and can be manually operated or blocked. AC or DC power is required for solenoid and sensor operation.

The AOVs in the main steam system are used to control steam flow to the main steam headers.

Main Steam Isolation Valves

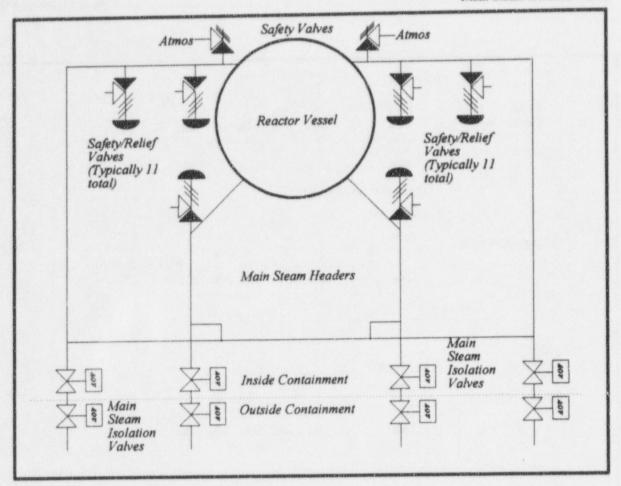


Figure 19-2. Typical BWR MSIV arrangement.

4. FAILURE EVENT DEFINITION

The function of the main steam isolation AOVs is to isolate steam flow to the steam headers to the turbines. The PRA mission for the main steam system is to provide steam to the turbine and steam auxiliaries. The event boundary for the main steam system isolation valves is defined as any condition that does not permit control of the flow either from the steam generators (PWR) or the reactor coolant system (BWR).

The only failure mode used in evaluating the main steam isolation valve data are:

OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are loss of instrument air to the valve operator, control power de-energized, and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the pneumatic operator without coincident failure of the manual operator is considered as a failure. These events were considered individually to determine of the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. Many LERs reported only one actual failure, but the report information indicated that failure of a second MSIV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MSIV, the event was identified as a CCF. If, however, the report did not clearly identify that another MSIV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MSIV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 19-4 through 19-8 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of MSIVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Main Steam Isolation Air-Operated Valves

Table 19-4: Alpha Factor Distribution Summary - F	Fail	to	Close,	CCCG = 2	
---	------	----	--------	----------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
		0.8675270	0.8693744	0.9123854	0.8605790	1.1529E+02	1.7605E+01
α,	8.76E-02	1.33E-01	1.31E-01	1.84E-01	1.39E-01	1.7605E+01	1.1529E+02

Table 19-5: Alpha Factor Distribution Summary - Fail to Close, CCCG=3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
CL.	0.8077681	0.8524840	0.8537502	0.8928843	0.8433169	1.5862E+02	2.7448E+01
α.,	4.95E-02	7.92E-02	7.77E-02	1.14E-01	8.44E-02	1.4744E+01	1.7132E+02
α,	4.08E-02	6.83E-02	6.67E-02	1.01E-01	7.23E-02	1.2704E+01	1.7336E+02

Table 19-6: Alpha Factor Distribution Summary - Fail to Close, CCCG=4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.7981769	0.8386100	0.8395484	0.8758441	0.8251480	2.0221E+02	3.8915E+01
α,	5.72E-02	8.45E-02	8.33E-02	1.16E-01	9.21E-02	2.0372E+01	2.2075E+02
α,	1.31E-02	2.81E-02	2.68E-02	4.75E-02	3.03E-02	6.7822E+00	2.3434E+02
α,	2.83E-02	4.88E-02	4.75E-02	7.35E-02	5.24E-02	1.1761E+01	2.2936E+02

Table 19-7: Alpha Factor Distribution Summary - Fail to Close, CCCG=5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.7889344	0.8263234	0.8270579	0.8611977	0.8068196	2.4447E+02	5.1383E+01
α,	5.68E-02	8.12E-02	8.02E-02	1.09E-01	9.10E-02	2.4012E+01	2.7184E+02
α,	2.27E-02	3.93E-02	3.83E-02	5.95E-02	4.38E-02	1.1627E+01	2.8423E+02
α.	4.70E-03	1.36E-02	1.25E-02	2.62E-02	1.48E-02	4.0247E+00	2.9183E+02
α,	2.29E-02	3.96E-02	3.86E-02	5.98E-02	4.35E-02	1.1719E+01	2.8413E+02

Table 19-8: Alpha Factor Distribution Summary - Fail to Close, CCCG=6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.7906780	0.8250193	0.8256347	0.8572556	0.8023736	2.8951E+02	6.1403E+01
α,	4.23E-02	6.20E-02	6.11E-02	8.44E-02	7.04E-02	2.1746E+01	3.2917E+02
α,	3.03E-02	4.74E-02	4.65E-02	6.74E-02	5.40E-02	1.6632E+01	3.3428E+02
α.,	9.31E-03	1.98E-02	1.89E-02	3.34E-02	2.23E-02	6.9433E+00	3.4397E+02
α,	3.47E-03	1.06E-02	9.71E-03	2.09E-02	1.17E-02	3.7297E+00	3.4718E+02
α.,	2.07E-02	3.52E-02	3.43E-02	5.27E-02	3.93E-02	1.2352E+01	3.3856E+02

NUREG/CR-5497

20. BWR Isolation Condenser Air-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving air-operated valves (AOVs) in the isolation condenser (IC) system at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified one common-cause failure-to-remain closed event. No common-cause failure-to-open or failure-to-close events were identified during the data review. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to remain open are shown in Tables 20-1 and 20-2, respectively. Table 20-3 contains the average impact vectors (N₁-N₄) and the number of adjusted independent events for this failure mode. The size of the affected population of AOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_4 . Beta (β), gamma (γ), and delta (δ)) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 20-4 through 20-6.

2. SYSTEM DESCRIPTION

The isolation condenser is part of the BWR emergency core cooling system (ECCS) that transfers residual and decay heat from the reactor coolant system to the atmosphere in the event that the main condenser is not available, or when a high reactor pressure condition exists. The IC system may be placed into service either manually or automatically. The IC system operates using natural circulation as the driving head through the isolation condenser tubes, and is available for operation when there is no electrical power. The primary side of the isolation condenser, with the condensate returning back to the recirculation loops. During normal plant operations, the secondary (shell) side of the isolation condenser contains sufficient water to cover the primary side tubes. The water in the shell side transfers the heat from the primary side by boiling off and venting directly to the atmosphere. Makeup to the secondary side is provided through the fire water system or through an alternate makeup source, such as the condensate transfer system.

Only five BWR plants have an IC system; those that don't have the IC have reactor core isolation cooling, which is a pump driven system. Some plants have two ICs, and other plants have one IC that contains two sets of steam cooling tubes. Figure 20-1 shows a typical isolation condenser system.

ALPHA FACTOR AND MGL PARAMETERS Isolation Condenser Air-Operated Valves

Table 20-1: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
α,	0.9997851	0.9995236	0.9992861
a	2.15E-04	4.76E-04	7.14E-04
α,	a stad de la marte de la de	0.00E+00	0.00E+00
α.			0.00E+00

Table 20-2: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	1.00E+01	1.00E+01	9.99E+01
Beta	2.15E-04	4.76E-04	7.14E-04
Gamma	na de neuer lant () i data alar picto natione anno chin t di alter tany formani data	0.00E+00	0.00E+00
Delta			0.00E+00

Table 20-3: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG≈3	CCCG=4	
Adj.Ind.Events	1.33	2.00	2.67	
N ₁	0.0659	0.0980	0.1294	
N ₂	0.0003	0.0010	0.0020	
N,		0.0000	0.0000	
N,	anna an an an an an anna an far an an ann an ann an ann an ann an ann an a		0.0000	

Total Number of Independent Failure Events: 4 Total Number of Common-Cause Failure Events: 1

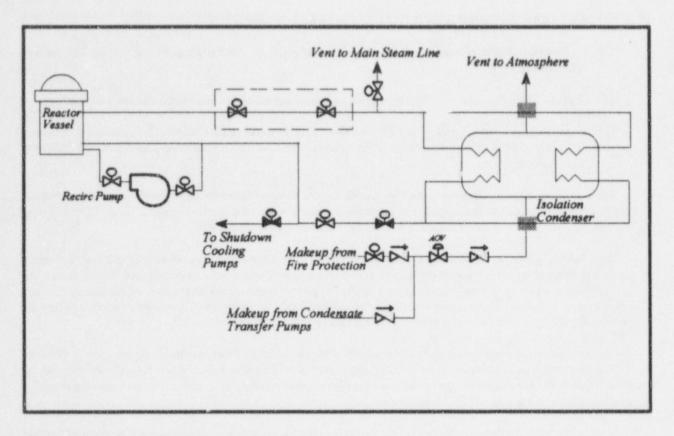


Figure 20-1. Typical isolation condenser system.

3. COMPONENT BOUNDARIES

The main components of an air-operated valve are the valve, including its internal piece-part components (e.g. disk, seat, stem, packing), and the operator. The operator includes the internal air operator piece-parts, the air supply lines specific to the AOV, sensors, solenoids to control the air supply, and the power leads to these solenoids as piece-parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. Some AOVs have manual hand wheels, and can be manually operated or blocked. AC or DC power is required for solenoid and sensor operation.

The AOVs in the isolation condenser system are used to control condensing water flow to the isolation condenser and to provide a vent path from the steam inlet line to a main steam line during standby conditions.

4. FAILURE EVENT DEFINITION

The function of the isolation condenser AOVs is to control makeup flow to the IC shell from the and to vent the steam inlet line. The PRA mission for the isolation condenser system is to provide for the removal of decay heat from the reactor coolant system when the main condenser is not available. The event boundary for the isolation condenser system AOVs is defined as any condition that does not permit control of the makeup flow to the IC shell or prevents venting the steam inlet line.

The failure modes used in evaluating the isolation condenser AOV data are:

- CC Fail to Open: The valve must be in the demanded (open) position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Fail to Remain Closed: Leakage through the valve following a successful closure. This is intended to capture leakage events that affect the operation of the system or the plant, and not minor leakage resulting in failure of local leak rate tests.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are loss of instrument air to the valve operator, control power de-energized, and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the pneumatic operator without coincident failure of the manual operator is considered as a failure. These events were considered individually to determine of the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a loss of instrument air to the operator may cause the valve to cycle to its fail-safe position, but the resulting effect on the valve is failure to reposition so the failure mode is failure to operate to that position (if it is readily discernable, otherwise a failure of "CC" is assigned.)

Many LERs reported only one actual failure, but the report information indicated that failure of a second AOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another AOV, the event was identified as a CCF. If, however, the report did not clearly identify that another AOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an AOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 20-4 through 20-8 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of AOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Isolation Condenser Air-Operated Valves

Table 20-4: Alpha Factor Distribution Summa	ry - Fail to Remain Closed, $CCCG = 2$
---	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8410731	0.9587323	0.9812171	0.9998778	0.9997851	1.0926E+01	4.7030E-01
α1	1.24E-04	4.13E-02	1.88E-02	1.59E-01	2.15E-04	4.7030E-01	1.0926E+01

Table 20-5: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8598532	0.9557434	0.9712154	0.9987228	0.9995236	1.7298E+01	8.0100E-01
α,	1.88E-05	2.15E-02	7.78E-03	8.94E-02	4.76E-04	3.8820E-01	1.7711E+01
α,	3.03E-05	2.28E-02	8.88E-03	9.29E-02	0.00E+00	4.1280E-01	1.7686E+01

Table 20-6: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8792452	0.9547932	0.9649005	0.9957107	0.9992861	2.7499E+01	1.3020E+00
α,	1.32E-04	1.93E-02	9.81E-03	7.07E-02	7.14E-04	5.5580E-01	2.8245E+01
a,	2.68E-07	9.12E-03	1.79E-03	4.35E-02	0.00E+00	2.6260E-01	2.8538E+01
α.,	5.67E-05	1.68E-02	7.58E-03	6.48E-02	0.00E+00	4.8360E-01	2.8317E+01

21. High Pressure Coolant Injection and Reactor Core Isolation Cooling Air Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common cause failure (CCF) parameters of various models using operational data involving air operated valves (AOVs) in the high pressure coolant injection (HPCI) and reactor core isolation cooling (RCIC) system at boiling water reactors (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified two common cause failure-to-open events. There were no failure-to-close or failure-to-remain-open events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 21-1 and 21-2, respectively. Table 21-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. The size of the affected population of AOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 21-4 through 21-6.

2. SYSTEM DESCRIPTION

BWRs can have HPCI and RCIC systems or only a HPCI system (if an Isolation Condenser is present). Both the HPCI and the RCIC are single train systems, and are consequently not subject to CCF events by themselves. This analysis combined the failures of AOVs across the system boundaries to identify CCF events.

The HPCI system supplies high volume, high pressure make-up water to the reactor pressure vessel (RPV) in the event of a small break LOCA which does not result in a rapid depressurization of the reactor vessel. The HPCI system consists of a turbine driven pump, system piping, valves and controls. The HPCI system is normally in standby, and is aligned to take a suction on the condensate storage tank (CST) but suction is automatically switched from the CST to the suppression pool upon low CST level or high suppression pool water level. The HPCI system is automatically started in response to decreasing RPV water level and is injected into the reactor via the RPV shroud. HPCI serves as the primary source of makeup if RCS pressure remains high. Steam to drive the HPCI turbine is routed from main steam.

The RCIC system is provided to provide low volume, high pressure makeup water to the RPV for core cooling when the main steam lines are isolated or the condensate and feedwater system is not available. The RCIC system consists of a turbine driven pump, system piping, valves and controls. The RCIC system is normally in standby, and is normally aligned to take a suction on the CST but suction is automatically switched from the CST to the suppression pool upon low CST level or high suppression pool water level. The RCIC system is automatically started in response to decreasing RPV water level and is injected into the reactor via the feedwater line. Steam for the RCIC turbine-driven pump is routed from main steam. Figure 21-1 shows a typical HPCI system; the configuration of the RCIC system is similar.

HPCI and RCIC AOVs

ALPHA FACTOR AND MGL PARAMETERS High Pressure Coolant Injection/Reactor Core Isolation Cooling Air Operated Valves

Table 21-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

CCCG	2	3	4
a,	0.9994513	0.9989236	0.9983845
a ₂	5.49E-04	1.08E-03	1.62E-03
α,		0.00E+00	0.00E+00
α.,		an a	0.00E+00

Table 21-2: Summary of MGL Parameter Estimations - Fail to Open

CCCG	2	3	4
1-Beta	1.0E+01	9.99E-01	9.98E-01
Beta	5.49E-04	1.08E-03	1.62E-03
Gamma		0.00E+00	0.00E+00
Delta			0.00E+00

Table 21-3: Summary of Average Impact Vectors - Fail to Open

CCCG	2	3	4
Adj. Ind. Events	6.00	9.00	12.00
Ni	0.1934	0.2800	0.3600
N ₁	0.0034	0.0100	0,0200
N,		0.0000	0.0000
N4	Semalitan Marcal And Select solutions. We also get a first data and a second solution of the		0.0000

Total Number of Independent Failure Events: 12 Total Number of Common Cause Failure Events: 2

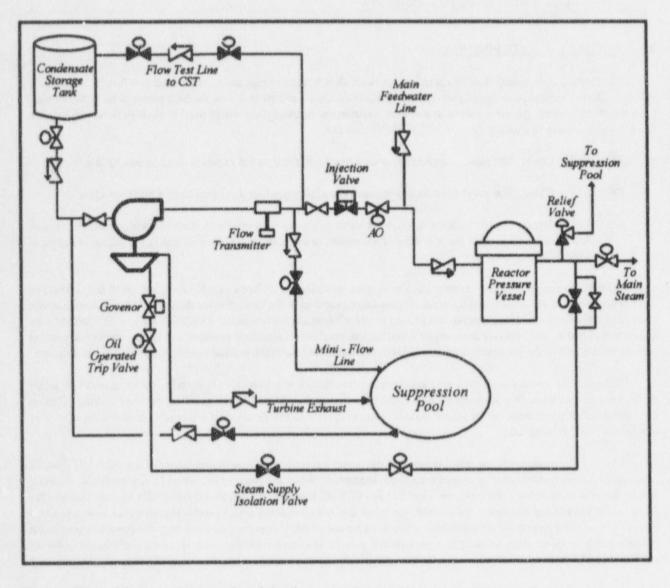


Figure 21-1. High pressure coolant injection system.

3. COMPONENT BOUNDARIES

The main components of an air-operated valve are the valve, including its internal piece-part components (e.g. disk, seat, stem, packing), and the operator. The operator includes the internal air operator piece-parts, the air supply lines specific to the AOV, sensors, solenoids to control the air supply, and the power leads to these solenoids as piece-parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. Some AOVs have manual hand wheels, and can be manually operated or blocked. AC or DC power is required for solenoid and sensor operation.

The AOVs in the HPCI/RCIC systems are used in the following applications:

- controlling flow from the pumps to the RPV,
- controlling steam condensate drains.

4. FAILURE EVENT DEFINITION

The function of the injection AOVs is to initiate steam flow to the turbines and to allow injection flow to the primary system. During normal plant operations, most of the AOVs remain closed to isolate the high pressure and low pressure portions of the system. All valves serve as a system containment boundary and would need to close to isolate leaks. The failure modes used in evaluating the HPCI/RCIC AOV data are:

- CC Fail to Open: The valve must be fully open. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Fail to Remain Closed: Leakage through the valve following a successful closure. This is intended to capture leakage events that affect the operation of the system or the plant, and not minor leakage resulting in failure of local leak rate tests.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are loss of instrument air to the valve operator, control power de-energized, and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the pneumatic operator without coincident failure of the manual operator is still coded as a failure.

Failures of the operator were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a loss of instrument air may cause the valve to cycle to its fail-safe position, but the resulting effect on the valve is failure to reposition, so the failure mode is failure to operate to that position (if it is readily discernable, otherwise a failure of "CC" is assigned.)

Many LERs reported only one actual failure, but the report information indicated that failure of a second AOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another AOV, the event was identified as a CCF. If, however, the report did not clearly identify that another AOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an AOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 21-4 through 21-6 present the alpha factor uncertainty distribution summaries for failure to open and each configuration of AOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS High Pressure Coolant Injection/Reactor Core Isolation Cooling Air-Operated Valves

Table 21-4:	Alpha Factor Distribution Sur	mmary - Fail to Open, $CCCG = 2$

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
e,	0.8870097	0.9707713	0.9868360	0.9999123	0.9994513	1.5723E+01	4.7340E-01
α.,	8.94E-05	2.92E-02	1.32E-02	1.13E-01	5.49E-04	4.7340E-01	1.5723E+01

Table 21-5: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	ä	b
α,	0.8982831	0.9679715	0.9792719	0.9990517	0.9989236	2.4480E+01	8.1000E-01
α,	1.60E-05	1.57E-02	5.79E-03	6.51E-02	1.08E-03	3.9720E-01	2.4893E+01
α,	2.14E-05	1.63E-02	6.29E-03	6.67E-02	0.00E+00	4.1280E-01	2.4877E+01

Table 21-6: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9080375	0.9656071	0.9733435	0.9966872	0.9983845	3.7060E+01	1.320E+00
α,	1.18E-04	1.50E-02	7.74E-03	5.43E-02	1.62E-03	5.7380E-01	3.7806E+01
α,	2.00E-07	6.84E-03	1.34E-03	3.26E-02	0.00E+00	2.6260E-01	3.8117E+01
Ø.4	4.22E-05	1.26E-02	5.66E-03	4.87E-02	0.00E+00	4.8360E-01	3.7896E+01

22. PWR Auxiliary Feedwater Air-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving air-operated valves (AOVs) in the auxiliary feedwater (AFW) system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified seven common-cause failure-to-open events, 13 common-cause failure-to-close events, and nine failure-to-remain-closed CCF events for steam generator injection flow control valves. For pump turbine steam inlet air-operated valves, the data review identified one failure to open common-cause events, five common-cause failure to close events, and three common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 22-1 and 22-2, respectively. Table 22-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 22-4 through 22-18 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of AOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 22-19 through 22-48.

2. SYSTEM DESCRIPTION

The auxiliary feedwater system provides a source of feedwater to the steam generators to remove decay heat from the reactor coolant system (RCS) when: (a) the main feedwater system is not available, and (b) RCS pressure is too high to permit heat removal by the residual heat removal (RHR) system. The AFW system is typically comprised of two motordriven, full capacity, pumps and a steam driven, double capacity pump along with valves and control systems to allow control of steam generator level and feedwater flow rate. The motor-driven pumps are supplied power from the IE class power system with backup power available from the IE emergency diesel generators (EDG). The water supply for the system is from the condensate storage tank (CST) with a backup source of water (untreated) available from the service water system.

The AFW system is normally in standby, whether the plant is at power or shutdown. The motor-driven pumps start on one of the following conditions: a safety injection (SI) signal, a low-low level in any steam generator, loss of both main feedwater pumps (MFP), a loss of off-site power (LOSP) or manual initiation. The turbine-driven pump will start on either a low-low level in more than one steam generator or a loss of off-site power. Flow to the steam generators is a two stage process at some plants. First the pumps start on demand from a steam generator low level signal. Control valves regulate the flow as needed. Feedwater flow to the steam generators is controlled from the main control room by air, motor, or hydraulically operated valves. Motor-driven pump run out is controlled by an air or hydraulically controlled regulator valve on the pump discharge. The turbine-driven pump steam supply is controlled by AOVs or hydraulically operated valves. Figure 22-1 shows a typical auxiliary feedwater system.

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Air-Operated Valves Steam Generator Injection Flow Control Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG-6
α,	0.9724137	0.9545685	0.9543692	0.9542087	0.9542531
α,	2.76E-02	4.00E-02	2.66E-02	2.33E-02	2.13E-02
α,		5.48E-03	1.69E-02	1.28E-02	1.12E-02
α,			2.21E-03	8.63E-03	5.36E-03
a,				1.08E-03	5.27E-03
α,		************************************			2.63E-03

Table 22-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 22-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.72E-01	9.55E-01	9.54E-01	9.54E-01	9.54E-01
Bets	2.76E-02	4.54E-02	4.56E-02	4.58E-02	4.58E-02
Gamma		1.21E-01	4.18E-01	4.92E-01	5.35E-01
Delta			1.16E-01	4.31E-01	5.42E-01
Epsilon				1.12E-01	5.96E-01
Mu			an a superior of the second state of the second	Contract and them being of the balances in the story of	3.33E-01

Table 22-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	27.04	40.55	54.07	67.59	81.11
N ₁	3.2255	3.0145	3.1367	3.0995	2.9806
N ₂	0.8586	1.8233	1.5924	1.7225	1.8763
N ₃		0.2501	1.0103	0.9502	0.9866
N,		and a substantial second se	0.1325	0.6393	0.4725
N,			A MATCHINA MARKAN MARKAN MATANANAN PATANANAN PATANANAN	0.0803	0.4642
N ₆					0.2317

Total Number of Independent Failure Events: 83 Total Number of Common-Cause Failure Events: 7

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Air-Operated Valves Steam Generator Injection Flow Control Valves

Table 22-4: Summary	of Alpha Factor	Parameter Estimations -	Fail to Close
---------------------	-----------------	-------------------------	---------------

Alpha Factor	CCCG=2	CCCG=3	CCCGm4	CCCG=5	CCCG=6
α,	0.9880192	0.9769070	0.9641062	0.9519127	0.9397404
α1	1.20E-02	2.30E-02	3.56E-02	4.74E-02	5.91E-02
α,		1.19E-04	3.41E-04	6.86E-04	1.13E-03
α,			2.72E-06	1.10E-05	2.23E-05
α,				0.00E+00	1.86E-06
α,					0.00E+00

Table 22-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.88E-01	9.77E-01	9.64E-01	9.52E-01	9.40E-01
Beta	1.20E-02	2.31E-02	3.59E-02	4.81E-02	6.03E-02
Gamma		5.13E-03	9.56E-03	1.45E-02	1.91E-02
Delta			7.94E-03	1.58E-02	2.10E-02
Epsilon	1			0.00E+00	7.69E-02
Mu					0.00E+00

Table 22-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	15.32	22.98	30.64	38.30	45.95
N ₁	3.2516	4.2167	4.7507	4.8404	4.5649
N ₁	0.2252	0.6396	1.3050	2.1477	3.1772
N,		0.0033	0.0125	0.0311	0.0607
N,			0.0001	0.0005	0.0012
N _s				0.0000	0.0001
N ₆					0.0000

Total Number of Independent Failure Events: 53 Total Number of Common-Cause Failure Events: 13

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Air-Operated Valves Steam Generator Injection Flow Control Valves

Table 22-7: Summary	of Alpha	Factor Parameter	Estimations - Fi	ail to Remain Clo	sed
---------------------	----------	------------------	------------------	-------------------	-----

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
œ.,	0.9703467	0.9506596	0.9402541	0.9369419	0.9382050
a.,	2.97E-02	4.32E-02	4.37E-02	3.60E-02	2.58E-02
α,		6.10E-03	1.52E-02	2.33E-02	2.65E-02
α.,			9.15E-04	3.76E-03	9.55E-03
a,				0.00E+00	4.42E-06
œ.					0.00E+00

Table 22-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.70E-01	9.51E-01	9.40E-01	9.37E-01	9.38E-01
Beta	2.97E-02	4.93E-02	5.98E-02	6.31E-02	6.18E-02
Gamma		1.24E-01	2.69E-01	4.29E-01	5.83E-01
Deita			5.69E-02	1.39E-01	2.65E-01
Epsilon				0.00E+00	4.62E-04
Mu					0.00E+00

Table 22-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	6.21	9.32	12.42	15.53	18.63
N,	1.6599	1.9726	2.1750	2.3714	2.6119
N ₂	0.2405	0.5136	0.6777	0.6885	0.5830
N,		0.0725	0.2355	0.4445	0.5998
N,			0.0142	0.0718	0.2162
N,			ann ann an an ann an ann an ann an ann ann an a	0.0000	0.0001
N.					0.0000

Total Number of Independent Failure Events: 20 Total Number of Common-Cause Failure Events: 9

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Air-Operated Valves Pump Turbine Steam Supply Control Valves

Alpha Factor	CCCG#2	CCCG=3	CCCG=4	CCCG=5	CCCG-6
α,	0.9230769	0.9473684	0.9600000	0.9677419	0.9729730
α2	7.69E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00
α,		5.26E-02	0.00E+00	0.00E+00	0.00E+00
α.4			4.00E-02	0.00E+00	0.00E+00
as			and a second	3.23E-02	0.00E+00
α.,					2.70E-02

Table 22-10: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 22-11: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.23E-01	9.47E-01	9.60E-01	9.68E-01	9.73E-01
Beta	7.69E-02	5.26E-02	4.00E-02	3.23E-02	2.70E-02
Gamma		1.00E+00	1.00E+00	1.00E+00	1.00E+00
Delta			1.00E+00	1.00E+00	1.00E+00
Epsilon				1.00E+00	1.00E+00
Mu				a hinney or a Anthon any source by the product of	1.00E+00

Table 22-12: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	12.00	18.00	24.00	30.00	36.00
N ₁	0.0000	0.0000	0.0000	0.0000	0.0000
N ₂	1.0000	0.0000	0.0000	0.0000	0.0000
N ₃		1.0000	0.0000	0.0000	0.0000
N,			1.0000	0.0000	0.0000
N ₅				1.0000	0.0000
N ₆	A REAL PROPERTY AND ADDRESS OF ADDR				1.0000

Total Number of Independent Failure Events: 12 Total Number of Common-Cause Failure Events: 1

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Air-Operated Valves Pump Turbine Steam Supply Control Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α	0.9833373	0.9664044	0.9490796	0.9554160	0.9592296
a,	1.67E-02	3.35E-02	5.06E-02	2.60E-02	1.72E-02
α,		1.16E-04	3.19E-04	1.85E-02	1.60E-02
α4			8.86E-06	3.58E-05	7.60E-03
α,				0.00E+00	6.02E-06
a.					0.00E+00

Table 22-13: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 22-14: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.83E-01	9.66E-01	9.49E-01	9.55E-01	9.59E-01
Beta	1.67E-02	3.36E-02	5.09E-02	4.46E-02	4.08E-02
Gamma		3.46E-03	6.44E-03	4.16E-01	5.78E-01
Delta			2.70E-02	1.93E-03	3.23E-01
Epsilon				0.00E+00	7.92E-04
Mu					0.00E+00

Table 22-15: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	10.00	15.00	20.00	25.00	30.00
N ₁	1.4783	1.6410	1.4268	1.6648	1.8658
N ₂	0.1945	0.5765	1.1422	0.7268	0.5716
N ₃		0.0020	0.0072	0.5165	0.5302
N4			0.0002	0.0010	0.2524
N ₅	A Concernation of the second se			0.0000	0.0002
N ₆					0.0000

Total Number of Independent Failure Events: 18 Total Number of Common-Cause Failure Events: 5

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Air-Operated Valves Pump Turbine Steam Supply Control Valves

Table 22-16: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed
--

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG-6
α,	0.9961272	0.9514549	0.9361668	0.9331861	0.9352109
a.2	3.87E-03	4.74E-02	4.51E-02	3.37E-02	2.32E-02
α,		1.20E-03	1.83E-02	2.53E-02	2.43E-02
a.			4.61E-04	7.62E-03	1.39E-02
α,				1.85E-04	3.30E-03
α.					8.04E-05

Table 22-17: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG-6
1-Beta	9.96E-01	9.52E-01	9.36E-01	9.33E-01	9.35E-01
Beta	3.87E-03	4.86E-02	6.33E-02	6.68E-02	6.48E-02
Gamma		2.46E-02	2.94E-01	4.96E-01	6.41E-01
Delta			2.46E-02	2.36E-01	4.16E-01
Epsilon		an anna an Anna an Anna an Anna anna an		2.36E-02	1.96E-01
Mu	Contraction of the second seco				2.38E-02

Table 22-18: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	6.00	8.99	11.99	14.99	17.98
N ₁	1.1247	0.9665	0.8030	0.6907	0.6292
N ₂	0.0277	0.4955	0.6160	0.5660	0.4623
N,	NAMES AND ADDRESS AND ADDRESS OF ADDRESS	0.0125	0.2500	0.4255	0.4831
N,			0.0063	0.1281	0.2766
N ₅	Designation specific des regardades de militario demonstration			0.0031	0.0656
N ₆					0.0016

Total Number of Independent Failure Events: 11 Total Number of Common-Cause Failure Events: 3

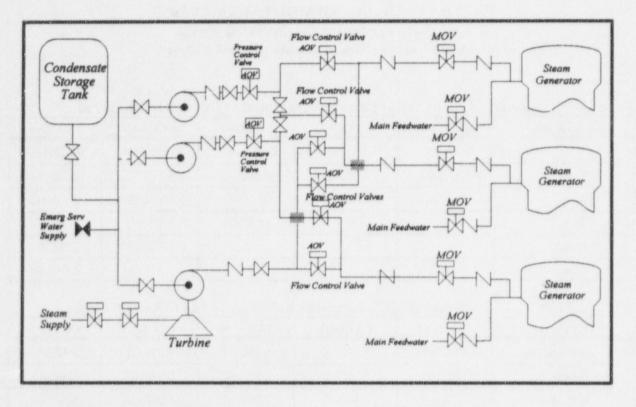


Figure 22-1. Auxiliary feedwater system

3. COMPONENT BOUNDARIES

The main components of an air-operated valve are the valve, including its internal piece-part components (e.g. disk, seat, stem, packing), and the operator. The operator includes the internal air operator piece-parts, the air supply lines specific to the AOV, sensors, solenoids to control the air supply, and the power leads to these solenoids as piece-parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. Some AOVs have manual hand wheels, and can be manually operated or blocked. AC or DC power is required for solenoid and sensor operation.

The AOVs in the AFW system are used in the following applications:

- Controlling feedwater flow from the pumps to the steam generators,
- Convolving pump discharge pressure to limit motor-driven pump run out, and
- Controlling and/or admitting steam flow to the turbine-driven AFW pump.

The number of air-operated values in the AFW system varies from two to ten, depending on the number of trains and pumps in the system; six is a typical value. The pump recirculation values, the steam condensate drain values, and the steam line warming values are not included in this data set, since they are not considered in PRA applications. For parameter estimations, the steam generator flow control values (water flow) were separated from the pump turbine steam supply values (steam flow).

4. FAILURE EVENT DEFINITION

The function of the AFW AOVs is to control feedwater flow to the steam generators from the AFW pumps and, in some plants, to supply steam to the turbine-driven pump. The PRA mission for the AFW system is to provide water to the steam generators for the removal of decay heat from the reactor coolant system. The event boundary for the AFW System AOVs is defined as any condition that does not permit control of the flow either from the AFW pumps to the steam generators, or from the main steam system to the pump turbine.

The failure modes used in evaluating the AFW AOV data are:

- CC Fail to Open: A successful operation of the valve is the valve in the demanded (open) position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Fail to Remain Closed: Leakage through the valve following a successful closure. This is intended to capture leakage events that affect the operation of the system or the plant, and not minor leakage resulting in failure of local leak rate tests.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are loss of instrument air to the valve operator, control power de-energized, and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the pneumatic operator without coincident failure of the manual operator is considered as a failure. These events were considered individually to determine of the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a loss of instrument air may cause the valve to cycle to its fail-safe position, but the resulting effect on the valve is failure to reposition so the failure mode is failure to operate to that position (if it is readily discernable, otherwise a failure of "CC" is assigned.)

Many LERs reported only one actual failure, but the report information indicated that failure of a second AOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another AOV, the event was identified as a CCF. If, however, the report did not clearly identify that another AOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an AOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 22-19 through 22-48 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of AOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS AFW Air-Operated Valves - Steam Generator Injection Flow Control Valves

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
a.	0.9137163	0.9676933	0.9749427	0.9968562	0.9724137	3.9796E+01	1.3286E+00
α.,	3.15E-03	3.23E-02	2.51E-02	8.63E-02	2.76E-02	1.3286E+00	3.9796E+01

Table 22-19: Alpha Factor Distribution Summary - Fail to Open, CCCG = 2

Table 22-20: Alpha Factor Distribution Summary - Fail to Open, CCCG=3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α ₁	0.9027648	0.9533830	0.9582186	0.9874551	0.9545685	5.8765E+01	2.8734E+00
α,	7.35E-03	3.59E-02	3.10E-02	8.12E-02	4.00E-02	2.2105E+00	5.9428E+01
α,	1.54E-04	1.08E-02	6.12E-03	3.71E-02	5.48E-03	6.6290E-01	6.0976E+01

Table 22-21: Alpha Factor Distribution Summary - Fail to Open, CCCG=4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9106820	0.9530475	0.9565265	0.9835098	0.9543692	8.1907E+01	4.0352E+00
α,	4.91E-03	2.50E-02	2.14E-02	5.73E-02	2.66E-02	2.1462E+00	8.3796E+01
α,	1.31E-03	1.48E-02	1.13E-02	4.05E-02	1.69E-02	1.2729E+00	8.4669E+01
a,	7.62E-05	7.17E-03	3.87E-03	2.55E-02	2.21E-03	6.1610E-01	8.5326E+01

Table 22-22: Alpha Factor Distribution Summary - Fail to Open, CCCG=5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9167885	0.9531039	0.9557304	0.9804316	0.9542087	1.0873E+02	5.3499E+00
α,	4.88E-03	2.15E-02	1.88E-02	4.74E-02	2.33E-02	2.4505E+00	1.1163E+02
a,	1.20E-03	1.19E-02	9.23E-03	3.20E-02	1.28E-02	1.3622E+00	1.1272E+02
α.	2.75E-04	7.65E-03	5.03E-03	2.40E-02	8.63E-03	8.7290E-01	1.1321E+02
a,	8.37E-05	5.82E-03	3.30E-03	2.01E-02	1.08E-03	6.6430E-01	1.1342E+02

Table 22-23: Alpha Factor Distribution Summary - Fail to Open, CCCG=6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9212745	0.9535222	0.9556554	0.9784914	0.9542531	1.3456E+02	6.5589E+00
α,	4.63E-03	1.88E-02	1.66E-02	4.06E-02	2.13E-02	2.6554E+00	1.3846E+02
α,	1.32E-03	1.08E-02	8.61E-03	2.79E-02	1.12E-02	1.5272E+00	1.3959E+02
α.,	1.44E-04	5.56E-03	3.47E-03	1.81E-02	5.36E-03	7.8520E-01	1 4033E+02
a,	9.11E-05	5.01E-03	2.95E-03	1.70E-02	5.27E-03	7.0750E-01	1.4041E+02
a,	2.33E-04	6.26E-03	4.14E-03	1.95E-02	2.63E-03	8.8360E-01	1.4024E+02

NUREG/CR-5497

ALPHA FACTOR DISTRIBUTIONS AFW Air-Operated Valves-Steam Generator Injection Flow Control Valves

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α.,	0.9186363	0.9758588	0.9856882	0.9995765	0.9880192	2.8102E+01	
α2	4.21E-04	2.41E-02	1.43E-02	8.14E-02	1.20E-02	6.9520E-01	2.8102E+01

Table 22-24: Alpha Factor Distribution Summary - Fail to Close, CCCG=2

Table 22-25: Alpha Factor Distribution Summary - Fail to Close, CCCG=3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9145232	0.9670870	0.9739114	0.9962905	0.9769070	4.2397E+01	1.4429E+00
α,	1.31E-03	2.34E-02	1.67E-02	6.87E-02	2.30E-02	1.0268E+00	4.2813E+01
α,	1.30E-05	9.49E-03	3.65E-03	3.88E-02	1.19E-04	4.1610E-01	4.3424E+01

Table 22-26: Alpha Factor Distribution Summary - Fail to Close, CCCG=4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9103869	0.9582577	0.9630479	0.9897359	0.9641062	6.091E+01	2.6176E+00
α,	4.89E-03	2.96E-02	2.48E-02	7.10E-02	3.56E-02	1.8588E+00	6.0850E+01
α,	2.06E-07	4.39E-03	9.30E-04	2.06E-02	3.41E-04	2.7510E-01	6.2434E+01
α,	2.57E-05	7.71E-03	3.44E-03	2.99E-02	2.72E-06	4.8370E-01	6.2225E+01

Table 22-27: Alpha Factor Distribution Summary - Fail to Close, CCCG=5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9083948	0.9515125	0.9550110	0.9826704	0.9519127	8.1182E+01	4.1369E+00
α,	9.01E-03	3.37E-02	3.01E-02	7.07E-02	4.74E-02	2.8757E+00	8.2443E+01
α,	1.04E-05	5.19E-03	2.12E-03	2.08E-02	6.86E-04	4.4310E-01	8.4876E+01
α,	2.18E-08	2.74E-03	4.20E-04	1.36E-02	1.10E-05	2.3410E-01	8.5085E+01
α.,	5.77E-05	6.85E-03	3.56E-03	2.48E-02	0.00E+00	5.840E-01	8.4735E+01

Table 22-28: Alpha Factor Distribution Summary - Fail to Close, CCCG=6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9060239	0.9459819	0.9487481	0.9764798	0.9397404	1.099E+02	5.7668E+00
α,	1.28E-02	3.71E-02	3.42E-02	7.11E-02	5.91E-02	3.9563E+00	1.0280E+02
α,	5.39E-05	5.63E-03	2.99E-03	2.02E-02	1.13E-03	6.0130E-01	1.0616E+02
α.,	4.75E-07	2.94E-03	7.75E-04	1.33E-02	2.23E-05	3.1390E-01	1.0644E+02
α,	2.86E-08	2.28E-03	3.79E-04	1.11E-02	1.86E-06	2.4340E-01	1.0651E+02
α.,	8.16E-05	6.11E-03	3.42E-03	2.13E-02	0.00E+00	6.5190E-01	1.0611E+02

ALPHA FACTOR DISTRIBUTIONS AFW Air-Operated Valves - Steam Generator Injection Flow Control Valves

Table 22-29:	Alpha Factor D	istribution Su	ummary - Fa	il to Remain	Closed, CC	CCG=2	
	NUMBER OF THE OWNER OF A SAME OF A SAME PARTY AND A DATA OF A	1		BETE		h	

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
		0.9607686	0.9761159	0.9992420	0.9703467	1.740E+01	7.1050E-01
a.	7.55E-04	3.92E-02	2.39E-02	1.30E-01	2.97E-02	7.1050E-01	1.740E+01

Table 22-30: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
CL.	The arrival contemporary and an a second second second	0.9502817	0.9606724	0.9946930	0.9506596	2.6493E+01	1.3861E+00
a,	1.30E-03	3.23E-02	2.19E-02	9.88E-02	4.32E-02	9.0800E-01	2.6978E+01
α,	5.99E-05	1.74E-02	7.89E-03	6.71E-02	6.10E-03	4.8530E-01	2.7394E+01

Table 22-31: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α.,	0.8798252	0.9463567	0.9533923	0.9887817	0.9402541	3.9295E+01	2.2274E+00
α,	2.49E-03	2.97E-02	2.25E-02	8.14E-02	4.37E-02	1.2315E+00	4.0291E+01
α,	4.71E-05	1.20E-02	5.52E-03	4.59E-02	1.52E-02	4.9810E-01	4.1024E+01
α,	4.69E-05	1.20E-02	5.52E-03	4.59E-02	9.15E-04	4.9780E-01	4.1025E+01

Table 22-32: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8916493	0.9464956	0.9514760	0.9843010	0.9369419	5.5943E+01	3.1624E+00
α,	2.60E-03	2.40E-02	1.88E-02	6.29E-02	3.60E-02	1.4165E+00	5.7689E+01
α,	4.96E-04	1.45E-02	9.50E-03	4.55E-02	2.33E-02	8.5650E-01	5.8249E+01
a.,	6.58E-07	5.17E-03	1.31E-03	2.35E-02	3.76E-03	3.0540E-01	5.8800E+01
α,	8.37E-05	9.88E-03	5.15E-03	3.57E-02	0.00E+00	5.8400E-01	5.8521E+01

Table 22-33: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9007214	0.9480875	0.9520031	0.9820644	0.9382050	7.1714E+01	3.9267E+00
α,	1.81E-03	1.80E-02	1.40E-02	4.80E-02	2.58E-02	1.3621E+00	7.4279E+01
æ,	1.07E-03	1.51E-02	1.11E-02	4.28E-02	2.65E-02	1.1404E+00	7.4500E+01
α,	3.70E-05	6.99E-03	3.37E-03	2.62E-02	9.55E-03	5.2890E-01	7.5112E+01
α,	4.05E-08	3.22E-03	5.36E-04	1.57E-02	4.42E-06	2.4340E-01	7.5397E+01
a,	1.16E-04	8.62E-03	4.84E-03	3.00E-02	0.00E+00	6.5190E-01	7.4989E+01

ALPHA FACTOR DISTRIBUTIONS AFW Air-Operated Valves - Pump Turbine Steam Supply Control Valves

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8376352	0.9360870	0.9483768	0.9923674		2.1530E+01	1.4700E+00
α,	7.63E-03	6.39E-02	5.16E-02	1.62E-01	7.69E-02	1.4700E+00	2.1530E+01

Table 22-34: Alpha Factor Distribution Summary - Fail to Open, CCCG = 2

Table 22-35: Alpha Factor Distribution Summary - Fail to Open, CCCG=3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8768240	0.9485714	0.9569053	0.9917545	0.9473684	3.3200E+01	1.8000E+00
a.,	9.36E-06	1.11E-02	3.93E-03	4.63E-02	0.00E+00	3.8720E-01	3.4613E+01
α,	4.42E-03	4.04E-02	3.19E-02	1.05E-01	5.26E-02	1.4128E+00	3.3587E+01

Table 22-36: Alpha Factor Distribution Summary - Fail to Open, CCCG=4

Alpha Factor	5th%	Mean	Median	95th%	MLE		5
α,	0.8995526	0.9549019	0.9607363	0.9902813	0.9600000	4.8700E+01	2.300E+00
α,	7.22E-05	1.09E-02	5.45E-03	4.00E-02	0.00E+00	5.5380E-01	5.0446E+0
α,	1.50E-07	5.15E-03	1.00E-03	2.46E-02	0.00E+00	2.6260E-01	5.0737E+0
α,	3.43E-03	2.91E-02	2.32E-02	7.50E-02	4.00E-02	1.4836E+00	4.9516E+0

Table 22-37: Alpha Factor Distribution Summary - Fail to Open, CCCG=5

Alpha Factor	5th%	Mean	Median	95th%	MLE	£	b
α,	0.9136494	0.9583435	0.9625853	0.9885298	0.9677419	6.8042E+01	2.9576E+0
α.,	2.08E-004	1.03E-002	6.16E-003	3.42E-002	0.00E+000	7.2800E-01	7.0272E+01
α,	7.39E-06	5.80E-03	2.20E-03	2.38E-02	0.00E+00	4.1200E-01	7.0588E+01
α.,	2.56E-08	3.29E-03	5.02E-04	1.63E-02	0.00E+00	2.3360E-01	7.0766E+01
α,	2.91E-03	2.23E-02	1.80E-02	5.65E-02	3.23E-02	1.5840E+00	6.9416E+01

Table 22-38: Alpha Factor Distribution Summary - Fail to Open, CCCG=6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9225296	0.9608043	0.9641727	0.9875497	0.9729730	8.6472E+01	3.5276E+00
α,	2.20E-04	8.66E-03	5.39E-03	2.82E-02	0.00E+00	7.7910E-01	8.9221E+01
α,	3.54E-05	6.01E-03	2.94E-03	2.24E-02	0.00E+00	5.4060E-01	8.9459E+01
CL.4	5.44E-07	3.47E-03	9.11E-04	1.57E-02	0.00E+00	3.1270E-01	8.9687E+01
α,	3.38E-08	2.70E-03	4.49E-04	1.32E-02	0.00E+00	2.4330E-01	8.9756E+01
α.,	2.54E-03	1.84E-02	1.49E-02	4.59E-02	2.70E-02	1.6519E+00	8.8348E+01

-

ALPHA FACTOR DISTRIBUTIONS AFW Air-Operated Valves - Pump Turbine Steam Supply Control Valves

1 able 22-39.		Alpha Factor Distribution Summer			PROFESSION OF STREET, STRE	The second many second second second	Th
Alpha Factor	5th%	Mean	Median	95th%	MLE	a	D
a,	0.8953226	0.9693390	0.9821908	0.9995423	0.9833373	2.108E+01	6.6450E-01
	4.55E-04	A REAL PROPERTY OF A DESCRIPTION OF A DE	1.78E-02	and the second sec	1.67E-02	6.6450E-01	2.108E+01
a.,	4.335,-04	3.011.00	1.1.01.0 0.0	Anna and a substantion of the substantion of the	Louise and the second second second	and the second of the second state of the seco	Correst and the second s

Table 22-39: Alpha Factor Distribution Summary - Fail to Close, CCCG=2

Table 22-40: Alpha Factor Distribution Summary - Fail to Close, CCCG=3

Stb %	Mean	Median	95th%	MLE	8	D
0 8910472	0 9585033	0.9673470	0.9956436	0.9664044	3.1841E+01	1.3785E+00
	Construction of some statements and	Construction of the owner	and the second of the second se			
		4.81E-03	5.10E-02	1.16E-04	4.1480E-01	3.2805E+0
	5th% 0.8910472 1.40E-03 1.68E-05	0.8910472 0.9585033 1.40E-03 2.90E-02	Strift Intern Intern 0.8910472 0.9585033 0.9673470 1.40E-03 2.90E-02 2.02E-02	Strip Mean Mean Mean Mean 0.8910472 0.9585033 0.9673470 0.9956436 1.40E-03 2.90E-02 2.02E-02 8.67E-02	Sth% Mean Median Sth // Sth //	Sth% Mean Median Sth% Sth% Median Sth% <

Table 22-41: Alpha Factor Distribution Summary - Fail to Close, CCCG=4

Comparison of the cost of the	010 22 41.	Maria	Median	95th%	MLE	8	b
Alpha Factor	5th%	Mean	TALCOSAN	An owner of the same of the sa	And the second division of the second divisio		A MOST IN
α.	0.8900255	0.9495724	0.9556381	0.9883432	0.9490796	4.6127E+01	2.4496E+0
-1	5.0012-03	3.49E-02	2.87E-02	8.59E-02	5.06E-02	1.6960E+00	4.6881E+0
α,	2.15E-07	5.55E-03	1.14E-03	2.63E-02	3.19E-04	2.6980E-01	4.8307E+0
α,		9.96E-03	4 46E-03	3.86E-02	8.86E-06	4.8380E-01	4.8093E+0
α,	3.33E-05	9.90E-03	4.401.00	5.0015 72			and the state of t

Table 22-42: Alpha Factor Distribution Summary - Fail to Close, CCCG=5

Alaba Factor	5th%	Mean	Median	95th%	MLE	8	b
Alpha Factor	0.9046086	0.9528500	0.9572419	0.9860702	0.9554160	6.4707E+01	3.2019E+00
α,	2.43E-03	2.14E-02	1.69E-02	5.58E-02	2.60E-02	1.4548E+00	6.6454E+0
α, α,	5.87E-04	1.37E-02	9.28E-03	4.18E-02	1.85E-02	9.2850E-01	6.6980E+0
α,	2.83E-08	3.46E-03	5.32E-04	1.71E-02	3.58E-05	2.3460E-01	6.7674E+0
α,	7.27E-05	8.60E-03	4.48E-03	3.11E-02	0.00E+00	5.8400E-01	6.7325E+0

Table 22-43: Alpha Factor Distribution Summary - Fail to Close, CCCG=6

PROPERTY OF THE OWNER	Mean	Median	95th%	MLE	8	b
	0.9549757	0.9584602	0.9846184	0.9592296	8.2338E+01	3.8820E+00
1.55E-03	1.57E-02	1.21E-02	4.20E-02	1.72E-02	1.3507E+00	8.4869E+01
	1.24E-02	8.90E-03	3.61E-02	1.60E-02	1.0708E+00	8.5149E+0
	6.55E-03	3.32E-03	2.40E-02	7.60E-03	5.6510E-01	8.5655E+0
	2.82E-03	4.71E-04	1.38E-02	6.02E-06	2.4350E-01	8.5977E+0
		4.24E-03	2.63E-02	0.00E+00	6.5190E-01	8.5568E+0
	5th% 0.9134252 1.55E-03 7.60E-04 4.76E-05 3.56E-08	Sth% Mean 0.9134252 0.9549757 1.55E-03 1.57E-02 7.60E-04 1.24E-02 4.76E-05 6.55E-03 3.56E-08 2.82E-03	Sth%MeanMedian0.91342520.95497570.95846021.55E-031.57E-021.21E-027.60E-041.24E-028.90E-034.76E-056.55E-033.32E-033.56E-082.82E-034.71E-04	Sth%MeanMedian95th%0.91342520.95497570.95846020.98461841.55E-031.57E-021.21E-024.20E-027.60E-041.24E-028.90E-033.61E-024.76E-056.55E-033.32E-032.40E-023.56E-082.82E-034.71E-041.38E-02	Sth%MeanMedian95th%MLE0.91342520.95497570.95846020.98461840.95922961.55E-031.57E-021.21E-024.20E-021.72E-027.60E-041.24E-028.90E-033.61E-021.60E-024.76E-056.55E-033.32E-032.40E-027.60E-033.56E-082.82E-034.71E-041.38E-026.02E-06	Stn % Meetral John C 0.9134252 0.9549757 0.9584602 0.9846184 0.9592296 8.2338E+01 1.55E-03 1.57E-02 1.21E-02 4.20E-02 1.72E-02 1.3507E+00 7.60E-04 1.24E-02 8.90E-03 3.61E-02 1.60E-02 1.0708E+00 4.76E-05 6.55E-03 3.32E-03 2.40E-02 7.60E-03 5.6510E-01 3.56E-08 2.82E-03 4.71E-04 1.38E-02 6.02E-06 2.4350E-01

NUREG/CR-5497

ALPHA FACTOR DISTRIBUTIONS AFW Air-Operated Valves - Pump Turbine Steam Supply Control Valves

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8898437	0.9709842	0.9863462	0.9998810	0.9961272	1.6655E+01	4.9770E-01
Ø2	1.16E-04	2.90E-02	1.37E-02	1.10E-01	3.87E-03	4.9770E-01	1.6655E+01

Table 22-44: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=2

Table 22-45: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α _i	0.8684788				0.9514549	2.5157E+01	1.3080E+00
α,	1.27E-03	3.34E-02	2.25E-02	1.03E-01	4.74E-02	8.8270E-01	2.5582E+01
α,	2.55E-05	1.61E-02	6.39E-03	6.50E-02	1.20E-03	4.2530E-01	2.6040E+01

Table 22-46: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8764422	0.9452342	0.9525784	0.9888548	0.9361668	3.7493E+01	2.1723E+00
α.2	2.23E-03	2.95E-02	2.20E-02	8.24E-02	4.51E-02	1.1698E+00	3.8496E+01
α,	5.90E-05	1.29E-02	6.11E-03	4.89E-02	1.83E-02	5.1260E-01	3.9153E+01
α.,	4.44E-05	1.24E-02	5.61E-03	4.75E-02	4.61E-04	4.8990E-01	3.9175E+01

Table 22-47: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=5

Alpha Factor	5th%	Mean	Median	95th%	MLE	31	b
α,	0.8894154	0.9457725	0.9509453	0.9844292	0.9331861	5.3723E+01	3.0803E+00
α.,	2.09E-03	2.28E-02	1.75E-02	6.17E-02	3.37E-02	1.2940E+00	5.5509E+01
α,	4.72E-04	1.47E-02	9.56E-03	4.67E-02	2.53E-02	8.3750E-01	5.5966E+01
α,	3.27E-06	6.37E-03	2.06E-03	2.73E-02	7.62E-03	3.6170E-01	5.6442E+01
as	8.97E-05	1.03E-02	5.41E-03	3.73E-02	1.85E-04	5.8710E-01	5.6216E+01

Table 22-48: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG=6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8991427	0.9476418	0.9516950	0.9822636	0.9352109	6.9081E+01	3.8168E+00
α,	1.44E-03	1.70E-02	1.29E-02	4.69E-02	2.32E-02	1.2414E+00	7.1656E+01
α,	7.74E-04	1.40E-02	9.91E-03	4.14E-02	2.43E-02	1.0237E+00	7.1874E+01
α,	7.11E-05	8.08E-03	4.24E-03	2.92E-02	1.39E-02	5.8930E-01	7.2309E+01
α,	5.96E-07	4.24E-03	1.09E-03	1.92E-02	3.30E-03	3.0890E-01	7.2589E+01
a.	1.21E-04	8.97E-03	5.04E-03	3.11E-02	8.04E-05	6.5350E-01	7.2244E+01

23. BWR Low Pressure Coolant Injection Check Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving check valves in low pressure coolant injection, including RHR check valves in the injection mode, (LPCI) systems at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified three common-cause failure to open events, five common-cause failure to close events, and 15 common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 23-1 and 23-2, respectively. Table 23-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 23-4 through 23-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of BWR LPCI check valves is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 23-10 through 23-24.

2. SYSTEM DESCRIPTION

LPCI is a mode of the residual heat removal (RHR) emergency core cooling system, or a specific separate system in early BWR designs, (ECCS) that serves several functions by operating in different modes:

- Low pressure coolant injection (LPCI) mode to provide low pressure makeup water to the reactor vessel for core cooling under loss of coolant accident (LOCA) conditions,
- · Containment spray mode to reduce primary containment pressure and temperature following a LOCA, and
- Suppression pool cooling mode to remove heat from the suppression pool.

Under accident conditions, the LPCI mode is automatically initiated. All other modes require manual system alignment for proper operation. The LPCI mode takes suction from the suppression pool and discharges to the reactor vessel penetrations. The RHR heat exchangers are bypassed in this mode, until manually placed into service. The containment spray mode protects the containment structure from possible over pressurization from steam which might bypass the suppression pool, including system breaks within the containment volume. In this mode water is pumped from the suppression pool through heat exchangers to spray nozzle, usually located high in the containment space. The suppression pool cooling mode is designed to limit the long term bulk temperature rise of the suppression pool water following a design basis LOCA. A closed path from the suppression pool through the RHR loops to the reactor vessel and back to the suppression pool through the break can be maintained for decay heat removal from the core.

A simplified schematic drawing of a typical BWR LPCI system configuration in presented in Figure 23-1.

ALPHA FACTOR AND MGL PARAMETERS BWR Low Pressure Coolant Injection Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9172037	0.8447060	0.8367443	0.8411186	0.8410325
α,	8.28E-02	1.53E-01	8.44E-02	6.25E-02	4.83E-02
α,		2.50E-03	7.89E-02	5.63E-02	4.37E-02
Ø.4	1		0.00E+00	4.01E-02	2.23E-02
œ,	1			0.0E+00	2.98E-02
a.	1				1.49E-02

Table 23-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 23-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.17E-01	8.45E-01	8.37E-01	8.41E-01	8.41E-01
Beta	8.28E-02	1.55E-01	1.63E-01	1.59E-01	1.59E-01
Gamma		1.61E-02	4.83E-01	6.07E-01	6.96E-01
Delta			0.00E+00	4.16E-01	6.06E-01
Epsilon				0.00E+00	6.67E-01
Mu					3.33E-01

Table 23-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	3.48	5.21	6.95	8.69	10.43
Ν,	1.4441	0.8843	0.8754	0.6248	0.7231
N ₂	0.4445	1.1024	0.7891	0.6917	0.6400
N ₃	NANG NE MANUNUNUNUNUNUNUNUNUNUNUNUNUNUNUNUNUNUNU	0.0180	0.7377	0.6234	0.5792
N,	In a second s		0.0000	0.4444	0.2963
N _s				0.0000	0.3951
N.					0.1975

Total Number of Independent Failure Events: 11 Total Number of Common-Cause Failure Events: 3

ALPHA FACTOR AND MGL PARAMETERS BWR Low Pressure Coolant Injection Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9888835	0.9807538	0.9724399	0.9677596	0.9648915
a2	1.11E-02	1.81E-02	2.44E-02	2.53E-02	2.42E-02
α,		1.15E-03	2.91E-03	6.46E-03	9.50E-03
α.			2.86E-04	4.72E-04	1.32E-03
a.,		Construction of the second second	a na anna an an anna anna anna anna an	1.72E-05	7.42E-05
α.,	The second s				2.06E-06

Table 23-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 23-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.89E-01	9.81E-01	9.72E-01	9.68E-01	9.65E-01
Beta	1.11E-02	1.93E-02	2.76E-02	3.22E-02	3.51E-02
Gamma		5.96E-02	1.16E-01	2.16E-01	3.10E-01
Delta			8.96E-02	7.03E-02	1.28E-01
Epsilon				3.52E-02	5.45E-02
Mu					2.70E-02

Table 23-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	14.71	22.06	29.41	36.77	44.12
N,	1.8536	2.3082	2.5435	2.6423	2.7278
N ₂	0.1862	0.4497	0.8007	1.0300	1.1755
N,	an er en grede als antendes son en sols defenseen og van ber a net som	0.0285	0.0955	0.2631	0.4612
N.		Construction of the second	0.0094	0.0192	0.0642
Ns				0.0007	0.0036
N ₆		1			0.0001

Total Number of Independent Failure Events: 50 Total Number of Common-Cause Failure Events: 5

ALPHA FACTOR AND MGL PARAMETERS BWR Low Pressure Coolant Injection Check Valves

Table 23-7: Summary of Alpha Factor Parameter Estimations - Fail to Remain (Closed	
--	--------	--

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9939654	0.9875786	0.9794613	0.9573996	0.9425989
α.2	6.04E-03	1.23E-02	1.99E-02	3.92E-02	4.79E-02
α,		1.75E-04	6.46E-04	3.42E-03	9.03E-03
α.4	1		7.34E-06	2.37E-05	5.05E-04
Ø2,5	1			0.00E+00	0.00E+00
a.	1				0.00E+00

Table 23-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.94E-01	9.88E-01	9.80E-01	9.57E-01	9.43E-01
Beta	6.04E-03	1.24E-02	2.05E-02	4.26E-02	5.74E-02
Gamma		1.41E-02	3.18E-02	8.07E-02	1.66E-01
Delta			1.12E-02	6.90E-03	5.30E-02
Epsilon				0.00E+00	0.00E+00
Mu					0.00E+00

Table 23-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	9.87	14.81	19.74	24.68	29.62
N,	3.8668	5.5038	6.9656	7.5881	8.1013
N ₂	0.0834	0.2519	0.5422	1.3199	1.9157
N ₃	ente internationalista de la sub-sector para de la sector d	0.0036	0.0176	0.1151	0.3612
N.			0.0002	0.0008	0.0202
Ns				0.0000	0.0000
N.					0.0000

Total Number of Independent Failure Events: 27 Total Number of Common-Cause Failure Events: 15

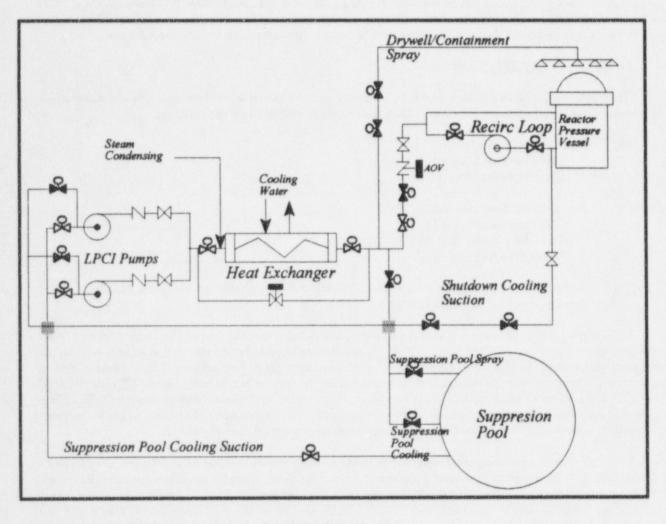


Figure 23-1. BWR low pressure coolant injection system.

3. COMPONENT BOUNDARIES

The main component of a check valve is the valve itself. This component is operated by system pressure overcoming gravity. Typically, there is no capability to manual open, close, or isolate these valves, however, some check valves have manual hand wheels on them (stop-check) and can be manually closed. Other check valves are "air-testable." This should not affect component operation and in some cases the air supply is turned off during operation as a precaution. No power is required for valve operation. Check valves are installed in LPCI systems in the following areas:

- Pump discharge,
- Suppression pool suction, and
- Loop injection.

The function of the check valve is to form a conditional boundary (i.e., one direction) between high pressure and low pressure sections of a system during static conditions. By design, the valve will open to allow flow when the low pressure section has experienced a pressure increase (e.g., pump start). For the purposes of this study, the boundaries will encompass the valve body including internals (e.g. disk, spring), and operators in the cases of air assisted check valves.

4. FAILURE EVENT DEFINITION

Check valve malfunctions are considered to be failures to open or close on demand and failure to stay closed which includes excessive leakage through the valve. Failure modes used to analyze check valve data are:

- CC Failure to Open. Examples are:
 - Check valve sticks closed,
 - Check valve partially opens.
- OO Failure to Close. Examples are:
 - Check valve sticks closed,
 - Valve doesn't fully close, and
 - Failure to re-seat.
- VR Failure to Remain Closed. In cases where the check valve has been closed for a substantial period of time and is then discovered leaking the failure will be coded as VR.

LPCI check valve failures that occurred during testing are included with the failures that cocurred during plant transients requiring operation of the LPCI check valves. Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of check valve demand. The exception to this is if a licensee reported that the check valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the check valve from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second LPCI check valve would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another LPCI check valve, the event was identified as a CCF. If, however, the report did not clearly identify that another check valve would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another LPCI check valve operation demand (e.g. the condition was found during inspection, and no check valve demand occurred only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 23-10 through 23-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of check valve. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS BWR Low Pressure Coolant Injection Check Valves

Table 23-10: Alpha Factor Distribution Summary - F	ail to	Open,	CCCG = 2
--	--------	-------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.8218398	0.9404952	0.9585151	0.9974291	0.9172037	1.4454E+01	9.1450E-01
α,	2.57E-03	5.95E-02	4.15E-02	1.78E-01	8.28E-02	9.1450E-01	1.4454E+01

Table 23-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α,	0.8087754	0.9172755	0.9290977	0.9852185	0.8447060	2.1294E+01	1.9204E+00
α,	7.83E-03	6.42E-02	5.20E-02	1.62E-01	1.53E-01	1.4896E+00	2.1725E+01
α,	3.21E-05	1.86E-02	7.51E-03	7.46E-02	2.50E-03	4.3080E-01	2.2784E+01

Table 23-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α ₁	0.8347592	0.9200380	0.9278971	0.9783907	0.8367443	3.2525E+01	2.8268E+00
α.,	3.79E-03	3.80E-02	2.96E-02	1.01E-01	8.44E-02	1.3429E+00	3.4090E+01
α,	1.49E-03	2.83E-02	2.00E-02	8.35E-02	7.89E-02	1.0030E+00	3.4352E+01
α.,	4.59E-05	1.37E-02	6.15E-03	5.29E-02	0.00E+00	4.8360E-01	3.4868E+01

Table 23-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
a	0.8599099	0.9272214	0.9327633	0.9755721	0.8411186	4.7357E+01	3.7171E+00
α,	3.04E-03	2.78E-02	2.19E-02	7.28E-02	6.25E-02	1.4197E+00	4.9654E+01
α,	1.16E-03	2.03E-02	1.44E-02	5.94E-02	5.63E-02	1.0354E+00	5.0390E+01
Ø.4	2.08E-04	1.33E-02	7.68E-03	4.54E-02	4.01E-02	6.7800E-01	5.0396E+01
a,	9.70E-05	1.14E-02	5.97E-03	4.13E-02	0.00E+00	5.8400E-01	5.0490E+01

Table 23-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8724920	0.9300385	0.9343442	0.9728645	0.8410325	6.1625E+01	4.6357E+00
α.,	2.33E-03	2.14E-02	1.68E-02	5.63E-02	4.83E-02	1.4191E+00	6.4842E+01
α,	1.15E-03	1.69E-02	1.23E-02	4.82E-02	4.37E-02	1.1198E+00	6.5141E+01
a.,	9.33E-05	9.19E-03	4.94E-03	3.28E-02	2.23E-02	6.0900E-01	6.5652E+01
α,	1.19E-04	9.64E-03	5.34E-03	3.37E-02	2.98E-02	6.3840E-01	6.5622E+01
a.	4.28E-04	1.28E-02	8.36E-03	4.04E-02	1.49E-02	8.4940E-01	6.5411E+01

ALPHA FACTOR DISTRIBUTIONS BWR Low Pressure Coolant Injection Check Valves

Table 23-15: Alpha Factor Distribution Summary - Fa	ail to Close,	CCCG = 2
---	---------------	----------

Alpha Factor	3th%	Mean	Median	95th%	MLE	8	b
α,	0.9155855	0.9754694	0.9859473	0.9996539	0.9888835	2.6094E+01	6.5620E-01
a ₁	3.44E-04	2.45E-02	1.41E-02	8.44E-02	1.11E-02	6.5620E-01	2.6094E+01

Table 23-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9152772	0.9687070	0.9760014	0.9971712	0.9807538	3.9568E+01	1.2782E+00
α,	6.59E-04	2.05E-02	1.33E-02	6.47E-02	1.81E-02	8.3690E-01	4.0090E+01
α,	2.13E-05	1.08E-02	4.43E-03	4.32E-02	1.15E-03	4.4130E-01	4.0405E+01

Table 23-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.9151908	0.9625278	0.9676478	0.9923273	0.9724399	5.6654E+01	2.2056E+00
α,	2.30E-03	2.30E-02	1.79E-02	6.14E-02	2.44E-02	1.3545E+00	5.7505E+01
α,	2.89E-06	6.08E-03	1.95E-03	2.62E-02	2.91E-03	3.5810E-01	5.8502E+01
α,	3.10E-05	8.38E-03	3.80E-03	3.22E-02	2.86E-04	4.9300E-01	5.8367E+01

Table 23-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9182928	0.9594845	0.9632253	0.9878636	0.9677596	7.7454E+01	3.2706E+00
α,	3.31E-03	2.18E-02	1.80E-02	5.33E-02	2.53E-02	1.7580E+00	7.8967E+01
α,	1.28E-04	8.36E-03	4.80E-03	2.87E-02	6.46E-03	6.7510E-01	8.0500E+01
α.4	6.03E-08	3.13E-03	5.64E-04	1.51E-02	4.72E-04	2.5280E-01	8.0472E+01
œ _s	6.15E-05	7.24E-03	3.77E-03	2.62E-02	1.72E-05	5.8470E-01	8.0140E+01

Table 23-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α	0.9215372	0.9583249	0.9613026	0.9849258	0.9648915	9.7320E+01	4.2322E+00
α2	3.37E-03	1.93E-02	1.62E-02	4.56E-02	2.42E-02	1.9546E+00	9.9598E+01
α,	5.13E-04	9.87E-03	6.89E-03	2.94E-02	9.50E-03	1.0180E+00	1.0550E+02
α.,	2.56E-06	3.71E-03	1.26E-03	1.57E-02	1.32E-03	3.7690E-01	1.0118E+02
α,	3.59E-08	2.43E-03	4.17E-04	1.18E-02	7.42E-05	2.4690E-01	1.0131E+02
α.,	8.59E-05	6.42E-03	3.60E-03	2.24E-02	2.06E-06	6.5200E-01	1.0900E+02

ALPHA FACTOR DISTRIBUTIONS BWR Low Pressure Coolant Injection Check Valves

Table 23-20:	Alpha Factor Distribution	n Summary - Fail to	Remain Closed.	CCCG = 2
--------------	---------------------------	---------------------	----------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	R.	b
α,	0.9148859	0.9767678	0.9881761	0.9998454	0.9939654	2.3267E+01	5.5340E-01
α,	1.57E-04	2.32E-02	1.18E-02	8.51E-02	6.04E-03	5.5340E-01	2.3267E+01

Table 23-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	ß	b
α,	0.9164147	0.9711372	0.9792045	0.9982621	0.9875786	3.5514E+01	1.0555E+00
α,	2.19E-04	1.75E-02	9.78E-03	6.09E-02	1.23E-02	6.3910E-01	3.5930E+01
α,	1.57E-05	1.14E-02	4.40E-03	4.65E-02	1.75E-04	4.1640E-01	3.6153E+01

Table 23-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4


Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9165734	0.9650809	0.9707358	0.9942185	0.9794613	5.1406E+01	1.860E+00
α,	1.34E-03	2.06E-02	1.50E-02	5.91E-02	1.99E-02	1.0960E+00	5.2170E+01
α,	2.98E-07	5.26E-03	1.16E-03	2.46E-02	6.46E-04	2.8020E-01	5.2986E+01
α,	3.03E-05	9.08E-03	4.06E-03	3.52E-02	7.34E-06	4.8380E-01	5.2782E+01

Table 23-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9082788	0.9539587	0.9580131	0.9857574	0.9573996	7.0310E+01	3.3934E+00
α,	5.18E-03	2.78E-02	2.36E-02	6.46E-02	3.92E-02	2.0479E+00	7.1656E+01
α,	3.73E-05	7.15E-03	3.43E-03	2.69E-02	3.42E-03	5.2710E-01	7.3176E+01
α,	2.57E-08	3.18E-03	4.89E-04	1.57E-02	2.37E-05	2.3440E-01	7.3469E+01
α,	6.69E-05	7.92E-03	4.12E-03	2.87E-02	0.00E+00	5.840E-01	7.3119E+0

Table 23-24: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9058092	0.9481314	0.9513183	0.9795517	0.9425989	8.8193E+01	4.8247E+00
α,	7.27E-03	2.90E-02	2.57E-02	6.20E-02	4.79E-02	2.6948E+00	9.0323E+01
α,	3.83E-04	9.70E-03	6.48E-03	3.00E-02	9.03E-03	9.0180E-01	9.2116E+01
α,	9.52E-07	3.58E-03	1.03E-03	1.58E-02	5.05E-04	3.3290E-01	9.2685E+01
α,	3.27E-08	2.62E-03	4.35E-04	1.28E-02	0.00E+00	2.4330E-01	9.2774E+01
α,	9.37E-05	7.01E-03	3.93E-03	2.44E-02	0.00E+00	6.5190E-01	9.2366E+01

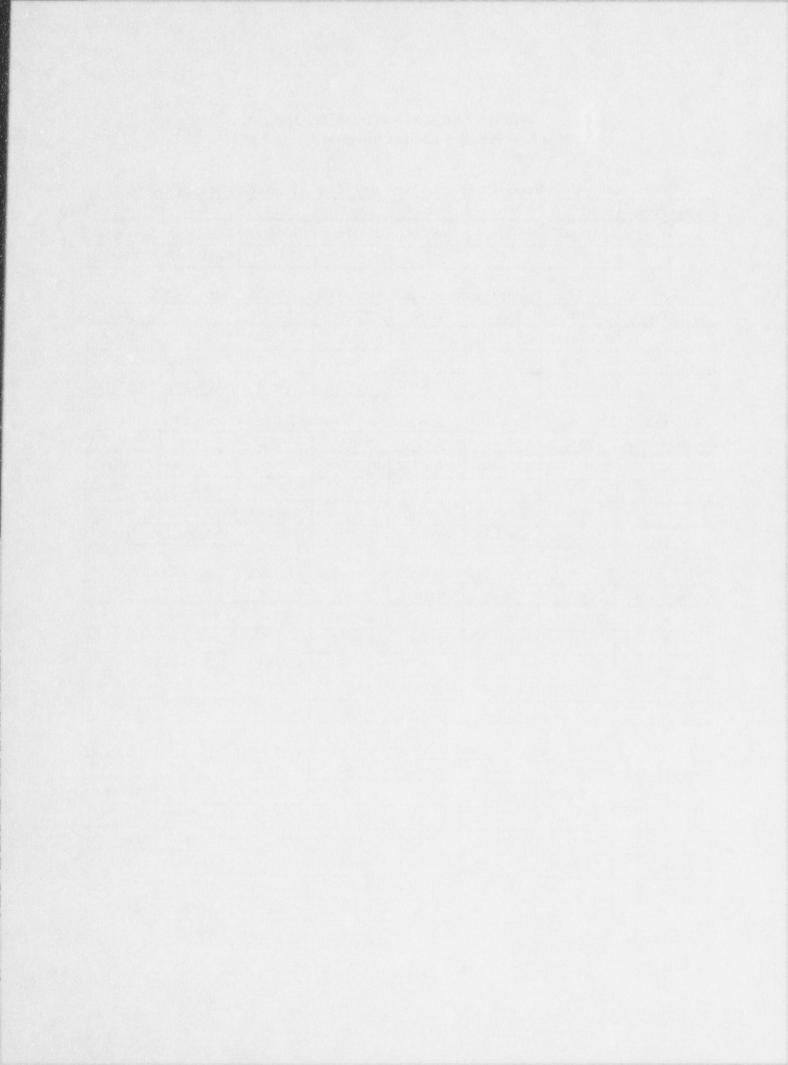

24. PWR Low Pressure Safety Injection Check Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving check valves in low pressure safety injection (LPSI) systems at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failures. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified one common-cause failure to open event, four common-cause failure to close events, and 16 common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 24-1 and 24-2, respectively. Table 24-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 24-4 through 24-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of low pressure safety injection check valves is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 24-10 through 24-24.

2. SYSTEM DESCRIPTION

The low pressure safety injection system (LPSI) is a subsystem of the emergency core cooling (ECCS) that provides emergency coolant injection to maintain reactor coolant inventory and provide adequate long term decay heat removal following a Loss of Coolant Accident (LOCA). The low pressure safety injection function is performed over a relatively long time interval after initiation of the LOCA. The LPSI pumps feed a common header that injects directly into the loop cold legs and can be realigned to inject into the hot legs. The initial suction source for the LPSI pumps is the refueling water storage tank (RWST) which contains enough highly borated water to satisfy the injection needs of the core. During the recirculation phase the pumps can take a suction from the containment sump and supply flow to the loops or to the suction of the safety injection pumps. These pumps also provide a shutdown cooling function. Figure 24-1 illustrates the typical flow path for the LPSI system. The system typically contains two high capacity high pressure centrifugal pumps. The pumps receive power from the IE emergency power system which is backed up by the emergency diesel generators.

The LPSI system is normally in standby. The LPSI pumps are started by the engineered safety features actuation system (ESFAS) or may be manually actuated. A safety injection (SI) signal starts the pumps, aligns the pump suction to the RWST, and completes additional valve lineup changes. The injection phase ends when the RWST reaches the low level setpoint and the system is manually realigned for the recirculation phase.

ALPHA FACTOR AND MGL PARAMETERS PWR Low Pressure Safety Injection Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.7930678	0.6800000	0.6451613	0.7142857	0.7500000
α,	2.07E-01	2.40E-01	1.29E-01	0.00E+0	0.00E+0
æ,		8.00E-02	1.72E-01	1.91E-01	0.00E+0
æ.			5.39E-02	9.51E-02	2.50E-01
a _s				0.00E+0	0.00E+00
au					0.00E+00

Table 24-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 24-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	7.93E-01	6.80E-01	6.45E-01	7.14E-01	7.50E-01
Beta	2.07E-01	3.20E-01	3.55E-01	2.86E-01	2.50E-01
Gamma		2.50E-01	6.36E-01	1.00E+00	1.00E+00
Delta	And and a second s		2.39E-01	3.33E-01	1.00E+00
Epsilon				0.00E+00	0.00E+00
Mu	Male de relación de Calanda Companya Guille a contra contra a dana de la contra contra de la contra de la contr				0.00E+00

Table 24-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	1.00	1.50	2.00	2.50	3.00
N ₁	0.5330	0.2000	0.0000	0.0000	0.0000
N2	0.4000	0.6000	9.4000	0.0000	0.0000
N ₃		0.2000	0.5330	0.6670	0.0000
N.			0.1670	0.3330	1.0000
N ₅			Contraction and the second	0.0000	0.0000
N ₆					0.0000

Total Number of Independent Failure Events: 3 Total Number of Common-Cause Failure Events: 1

ALPHA FACTOR AND MGL PARAMETERS PWR Low Pressure Safety Injection Check Valves

Table 24-4: Si	ummary of Alpha	Factor Parameter	Estimations -	Fail to Close
----------------	-----------------	-------------------------	---------------	---------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9289102	0.8940886	0.8779394	0.8787685	0.8790286
a ₃	7.11E-02	8.04E-02	7.81E-02	5.79E-02	5.36E-02
a,	1	2.55E-02	3.07E-02	3.52E-02	2.55E-02
α.,			1.33E-02	2.00E-02	2.29E-02
a.,				8.12E-03	1.38E-02
Ø.6	AND DESCRIPTION OF THE OWNER OF THE OWNER AND THE	1			5.16E-03

Table 24-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.29E-01	8.94E-01	8.78E-01	8.79E-01	8.79E-01
Beta	7.11E-02	1.06E-01	1.22E-01	1.21E-01	1.21E-01
Gamma		2.41E-01	3.60E-01	5.23E-01	5.57E-01
Delta			3.02E-01	4.44E-01	6.22E-01
Epsilon				2.88E-01	4.53E-01
Mu		Contraction of the second second	and the second	and the second	2.72E-01

Table 24-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	9.00	13.50	18.00	22.50	27.00
N ₁	2.2034	1.8608	1.3245	0.9676	0.5041
N ₂	0.8574	1.3818	1.7186	1.5458	1.6776
N,	17 ANNAL OCTUBER OF CONTRACT OF CONTRACT OF CONTRACT OF CONTRACT	0.4378	0.6758	0.9401	0.7974
N,	anna maranan amerikan keneratak keneratak menangkan di kana dari dari		0.2923	0.5349	0.7170
N ₅	angang sangang di mangan angangan ang ang ang di ang ang ang			0.2167	0.4318
N ₆	CONTRACTOR (1997)				0.1613

Total Number of Independent Failure Events: 18 Total Number of Common-Cause Failure Events: 4

ALPHA FACTOR AND MGL PARAMETERS PWR Low Pressure Safety Injection Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9547287	0.9126781	0.8715604	0.8576585	0.8461376
α,	4.53E-02	8.42E-02	1.19E-01	1.03E-01	9.95E-02
a,	1	3.09E-03	9.33E-03	3.67E-02	4.01E-02
α.,			1.43E-04	2.19E-03	1.36E-02
αs				8.19E-06	6.58E-04
α.			1	Construction of the second	0.00E+00

Table 24-7: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Table 24-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.55E-01	9.13E-01	8.72E-01	8.58E-01	8.46E-01
Beta	4.53E-02	8.73E-02	1.28E-01	1.42E-01	1.54E-01
Gamma	and a second	3.53E-02	7.37E-02	2.74E-01	3.53E-01
Delta			1.51E-02	5.65E-02	2.62E-01
Epsilon				3.72E-03	4.62E-02
Mu	Profit And Control of			and and fairst the second strategic second	0.00E+00

Table 24-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6	
Adj. Ind. Events	5.91	8.87	11.83	14.78	17.74	
N,	4.6050	5.5630	5.8123	6.1557	6.3228	
N ₂	0.4986	1.3321	2.4082 2.5244		2.8296	
Ν,		0.0488	0.1888	0.8965	1.1412	
N,			0.0029	0.0535	0.3861	
Ns				0.0002	0.0187	
N ₆			a name and a second		0.0000	

Total Number of Independent Failure Events: 17 Total Number of Common-Cause Failure Events: 16

PWR LPSI Check Valves

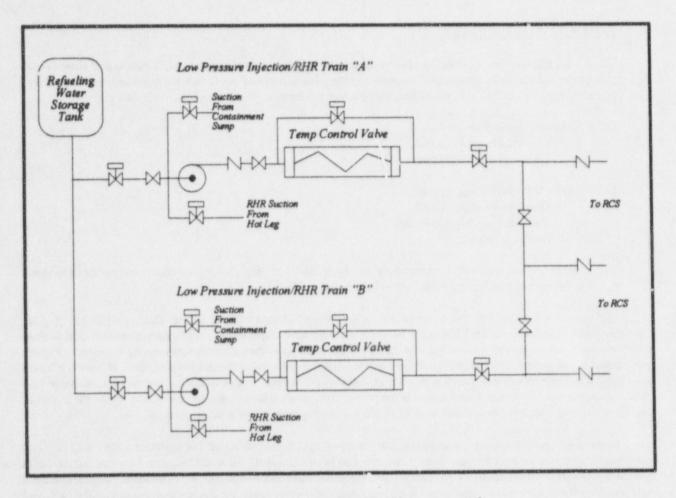


Figure 24-1. PWR low pressure safety injection/residual heat removal.

3. COMPONENT BOUNDARIES

The main component of a check value is the value itself. This component is operated by system pressure overcoming gravity. Typically, there is no capability to manually open, close, or isolate these values, however, some check values have manual hand wheels or levers (stop-check) and can be manually closed. Other check values are "air-testable"; which should not affect normal component operation and in some cases the air supply is turned off during operation as a precaution. No power is required for value operation. Check values are installed in LPSI systems in the following areas:

- Pump discharge,
- Pump suction,
- Loop injection, and
- System inter- or cross-connection.

The function of the check valve is to form a conditional boundary (i.e., one direction) between high pressure and low pressure sections of a system during static conditions. By design, the valve will open to allow flow when the low pressure section has experienced a pressure increase (e.g., pump start). For the purposes of this study, the boundaries will encompass the valve body including internals (e.g. disk, spring) and operators in the cases of air assisted check valves.

4. FAILURE EVENT DEFINITION

Check valve malfunctions are considered to be failures to open or close on demand and, failure to stay closed which includes excessive leakage through the valve. Examples of the consequences of this failure are increased containment leak rate, interfacing systems LOCA, and system drainage. Failure modes used to analyze check valve data are:

- CC Failure to Open. Examples are:
 - Check valve sticks closed,
 - Check valve partially opens.
- OO Failure to Close. Examples are:
 - Check valve sticks closed,
 - Valve doesn't fully close, and
 - Failure to re-seat.
- VR Failure to Remain Closed. In cases where the check valve has been closed for a substantial period of time and is then discovered leaking the failure will be coded as VR.

LPSI check valves failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the LPSI check valves. Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of check valve demand. The exception to this is if a licensee reported that the check valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the check valve from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second LPSI check valve would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another LPSI check valve, the event was identified as a CCF. If, however, the report did not clearly identify that another check valve would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another LPSI check valve operation demand (e.g. the condition was found during inspection, and no check valve demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 24-10 through 24-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of check valve. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS PWR Low Pressure Safety Injection Check Valves

Table 24-10:	Alpha Factor	Distribution	Summary -	Fail	to	Open,	CCCG = 2
--------------	--------------	--------------	-----------	------	----	-------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.7796135	0.9270929	0.9496681	0.9972110	0.7930678	1.1063E+01	8.7000E-01
α,	2.79E-03	7.29E-02	5.03E-02	2.20E-01	2.07E-01	8.7000E-01	1.1063E+01

Table 24-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.7887526	0.9135135	0.9281658	T		1.690E+01	1.600E+00
α,	2.80E-03	5.34E-02	3.81E-02	1.56E-01	2.40E-01	9.8720E-01	1.7513E+01
α,	3.57E-04	3.31E-02	1.83E-02	1.16E-01	8.00E-02	6.1280E-01	1.7887E+01

Table 24-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α.	0.8216223	0.9175258	0.9270002	0.9809549	0.6451613	2.6700E+01	2.4000E+00
α,	1.54E-03	3.28E-02	2.28E-02	9.82E-02	1.29E-01	9.5380E-01	2.8146E+01
α,	7.59E-04	2.73E-02	1.75E-02	8.76E-02	1.72E-01	7.9560E-01	2.8304E+01
α,	3.03E-04	2.24E-02	1.27E-02	7.73E-02	5.39E-02	6.5060E-01	2.8449E+01

Table 24-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8605568	0.9320086	0.9385659	0.9810034	0.7142857	4.0542E+01	2.9576E+00
α,	3.41E-04	1.67E-02	1.01E-02	5.57E-02	0.00E+00	7.2800E-01	4.2772E+01
α,	1.56E-03	2.48E-02	1.80E-02	7.14E-02	1.91E-01	1.0790E+00	4.2421E+01
α,	9.66E-05	1.30E-02	5.67E-03	4.76E-02	9.51E-02	5.6660E-01	4.2933E+01
α,	1.14E-04	1.34E-02	7.03E-03	4.85E-02	0.00E+00	5.8400E-01	4.2916E+0

Table 24-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α,	0.8787236	0.9381118	0.9431881	0.9801221	0.7500000	5.3472E+01	3.5276E+00
α,	3.49E-04	1.37E-02	8.55E-03	4.45E-02	0.00E+00	7.7910E-01	5.6221E+0
α,	5.61E-05	9.48E-03	4.66E-03	3.53E-02	0.00E+00	5.4060E-01	5.6459E+0
α,	2.18E-03	2.30E-02	1.77E-02	6.21E-02	2.50E-01	1.3127E+00	5.5687E+0
α.	5.36E-08	4.27E-03	7.12E-04	2.08E-02	0.00E+00	2.4330E-01	5.6756E+0
α.,	1.54E-04	1.14E-02	6.44E-03	3.97E-02	0.00E+00	6.5190E-01	5.6348E+0

ALPHA FACTOR DISTRIBUTIONS PWR Low P

Table 24-15: Alpha Factor Distribution Summary - Fail to Close, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.8415788	0.9398288	0.9526759	0.9940046	0.9289102	2.0733E+01	1.3274E+00
α.2	5.99E-03	6.02E-02	4.73E-02	1.58E-01	7.11E-02	1.3274E+00	2.0733E+01

Table 24-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8332334	0.9210503	0.9294337	0.9801377	0.8940886	3.0561E+01	2.6196E+00
α,	8.36E-03	5.33E-02	4.46E-02	1.28E-01	8.04E-02	1.7690E+00	3.1412E+01
α,	8.71E-04	2.56E-02	1.69E-02	8.03E-02	2.55E-02	8.5060E-01	3.2330E+01

Table 24-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8436157	0.9169640	0.9227250	0.9705844	0.8779394	4.4025E+01	3.9867E+00
α,	1.01E-02	4.73E-02	4.12E-02	1.06E-01	7.81E-02	2.2724E+00	4.5739E+01
α,	8.68E-04	1.96E-02	1.34E-02	5.93E-02	3.07E-02	9.3840E-01	4.7073E+01
α,	4.08E-04	1.62E-02	1.01E-02	5.26E-02	1.33E-02	7.7590E-01	4.7236E+01

Table 24-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8622430	0.9221184	0.9263194	0.9676232	0.8787685	6.1510E+01	5.1951E+00
α2	7.21E-03	3.41E-02	2.95E-02	7.66E-02	5.79E-02	2.2738E+00	6.4431E+01
α,	2.02E-03	2.03E-02	1.57E-02	5.41E-02	3.52E-02	1.3521E+00	6.5353E+01
α ₄	2.81E-04	1.15E-02	7.14E-03	3.77E-02	2.00E-02	7.6850E-01	6.5937E+01
a _s	3.34E-04	1.20E-02	7.60E-03	3.87E-02	8.12E-03	8.0700E-01	6.5904E+01

Table 24-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8731394	0.9251062	0.9284559	0.9656163	0.8790286	7.7976E+01	6.3127E+00
α,	6.67E-03	2.92E-02	2.55E-02	6.41E-02	5.36E-02	2.4567E+00	8.1832E+01
α,	1.55E-03	1.59E-02	1.22E-02	4.27E-02	2.55E-02	1.3380E+00	8.2951E+01
α.,	6.81E-04	1.22E-02	8.63E-03	3.60E-02	2.29E-02	1.0297E+00	8.3259E+01
α,	1.23E-04	8.01E-03	4.60E-03	2.75E-02	1.38E-02		8.3614E+01
as	2.81E-04	9.65E-03	6.14E-03	3.10E-02	5.16E-03	8.1320E-01	8.3476E+01

ALPHA FACTOR DISTRIBUTIONS PWR Low Pressure Safety Injection Check Valves

Table 24-20: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
a.,	0.8637156	0.9539061	0.9674533	0.9977174	0.9547287	2.045E+01	9.6860E-01
α2	2.29E-03	4.61E-02	3.26E-02	1.36E-01	4.53E-02	9.6860E-01	2.045E+01

Table 24-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8464995	0.9314482	0.9403577	0.9858633	0.9126781	2.9633E+01	2.1809E+00
α,	8.15E-03	5.40E-02	4.49E-02	1.31E-01	8.42E-02	1.7193E+00	3.0950E+01
a,	3.76E-05	1.45E-02	6.25E-03	5.70E-02	3.09E-03	4.6160E-01	3.1352E+01

Table 24-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	'35th%	MLE	a	b
α,	0.8403530	0.9156631	0.9216262	0.9705513	0.8715604	4.2342E+01	3.8999E+00
α,	1.79E-02	6.41E-02	5.78E-02	1.32E-01	1.19E-01	2.9620E+00	4.3280E+01
α,	2.20E-05	9.76E-03	4 09E-03	3.87E-02	9.33E-03	4.5140E-01	4.5791E+01
α.,	3.63E-05	1.05E-02	4 74E-03	4.06E-02	1.43E-04	4.8650E-01	4.5755E+01

Table 24-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	5'5th%	MLE	8	b
α,	0.8526741	0.9156624	0.9199499	0.9639828	0.8576585	5.8978E+01	5.4322E+00
α,	1.51E-02	5.05E-02	4.59E-02	1.02E-01	1.03E-01	3.2524E+00	6.1158E+01
α,	90E-03	2.03E-02	1.56E-02	5.49E-02	3.67E-02	1.3085E+00	6.3102E+01
α.,	3 10 07	4.46E-03	1.02E-03	2.07E-02	2.19E-03	2.8710E-01	6.4123E+01
α.	7.035-05	9.07E-03	4.73E-03	3.28E-02	8.19E-06	5.8420E-01	6.3826E+01

Table 24-24: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8595857	0.9152339	0.9186235	0.9592854	0.8461376	7.4535E+01	6.9032E+00
Ø.2	1.44E-02	4.43E-02	4.06E-02	8.69E-02	9.95E-02	3.6087E+00	7.7830E+01
α,	2.94E-03	2.07E-02	1.69E-02	5.13E-02	4.01E-02	1.6818E+00	7.9756E+01
α.,	1.50E-04	8.58E-03	5.03E-03	2.91E-02	1.36E-02	6.9880E-01	8.0739E+0
α,	9.11E-08	3.22E-03	6.21E-04	1.54E-02	6.58E-04	2.6200E-01	8.1176E+01
α,	1.07E-04	8.01E-03	4.49E-03	2.79E-02	0.00E+00	6.5190E-01	8.0786E+01

25. PWR Auxiliary Feedwater Check Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving check valves in auxiliary feedwater (AFW) systems at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified five common-cause failure to open events, fifteen common cause failure to close events, and 39 common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 25-1 and 25-2, respectively. Table 25-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 25-4 through 25-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of PWR auxiliary feedwater check valves is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_{ϕ} . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 25-10 through 25-24.

2. SYSTEM DESCRIPTION

The auxiliary feedwater system provides a source of feedwater to the steam generators to remove decay heat from the reactor coolant system (RCS) when: (a) the main feedwater system is not available, and (b) RCS pressure is too high to permit heat removal by the residual heat removal (RHR) system. The AFW system is comprised of two, three, or four flow trains, each with an AFP, including the associated pump driver. The combinations of pump-driver sets range from all motor-driven to all turbine-driven AFW pumps and, in a few cases, diesel-driven pumps. Most of the designs incorporate a combination of two full-capacity motor-driven and one double capacity turbine-driven pump. There are no plants with more than one diesel-driven AFP, so CCF analysis of diesel-driven pumps is not applicable. The motor-driven pumps are supplied power from the IE class power system with backup power available from the IE emergency diesel generators (EDG). The water supply for the system is from the condensate storage tank (CST) with a backup source of water (untreated) available from the service water system.

The AFW system is normally in standby. The motor-driven pumps start on one of the following conditions: a safety injection (SI) signal, a low-low level in any steam generator, loss of both main feedwater pumps (MFP), a loss of off-site power (LOSP) or manual initiation. The turbine-driven pump will start on either a low-low level in more than one steam generator or a loss of off-site power. Feedwater flow to the steam generators is controlled from the main control room by air, motor, or hydraulically operated valves. Motor-driven pump run out is controlled by an air or hydraulically controlled regulator valve on the pump discharge. The turbine-driven pump steam supply is controlled by air or hydraulically operated valves. Figure 25-1 shows a typical auxiliary feedwater system.

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG==6
α,	0.8245484	0.8524372	0.8582592	0.8796748	0.9230306
α2	1.76E-01	3.30E-02	5.17E-02	2.74E-02	1.95E-02
α,		1.15E-01	1.62E-04	1.88E-02	1.68E-02
α.4			8.99E-02	1.48E-05	8.18E-03
α,				7.41E-02	3.26E-06
CL.6					3.26E-02

Table 25-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 25-2: Summary of MGL Parameter Estimations - Fail to Open

IGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	8.25E-01	8.52E-011	8.58E-01	8.80E-01	9.23E-01
Beta	1.76E-01	1.48E-01	1.42E-01	1.20E-01	7.70E-02
Gamma		7.76E-01	6.36E-01	7.72E-01	7.47E-01
Deita			9.98E-01	7.97E-01	7.09E-01
Epsilon				1.00E+01	7.99E-01
Mu					1.00E+01

Table 25-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	9.17	13.75	18.33	22.92	27.50
N,	1.1404	1.1431	0.7582	0.8277	0.8543
N ₂	2.1939	0.5771	1.1487	0.7397	0.5984
N ₃	nananan anala mara a marang kang kang kang kang kang kang kang k	2.0010	0.0036	0.5082	0.5146
N,			2.0001	0.0004	0.2513
N ₅				2.0000	0.0001
N ₆					1.0000

Total Number of Independent Failure Events: 22 Total Number of Common-Cause Failure Events: 5

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Check Valves

Table 25-4: Summary	y of Alpha Factor I	Parameter Estimations -	Fail to Close
---------------------	---------------------	-------------------------	---------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9297050	0.9182645	0.9095029	0.9083575	0.9064307
œ.,	7.03E-02	4.97E-02	5.07E-02	4.72E-02	4.74E-02
α,		3.21E-02	1.78E-02	2.21E-02	1.70E-02
œ.4			2.21E-02	7.19E-03	1.54E-02
a,				1.52E-02	1.17E-03
Ø.6				and a statistic strategy of the state	1.27E-02

Table 25-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.30E-01	9.18E-01	9.10E-01	9.08E-01	9.06E-01
Beta	7.03E-02	8.17E-02	9.05E-02	9.16E-02	9.36E-02
Gamma		3.92E-01	4.40E-01	4.85E-01	4.94E-01
Deita			5.53E-01	5.03E-01	6.33E-01
Epsilon				6.78E-01	4.73E-01
Mu					9.15E-01

Table 25-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	22.67	34.00	45.33	56.67	68.00
N ₁	5.0750	5.4570	5.3907	5.1103	4.6419
N ₂	2.0978	2.1347	2.8252	3.2095	3.7955
N,		1.3774	0.9921	1.5028	1.3593
N,	CONTRACTOR OF A CONTRACTOR OF A CONTRACTOR		1.2295	0.4893	1.2345
N,		1		1.0313	0.0938
N.				1	1.0156

Total Number of Independent Failure Events: 68 Total Number of Common-Cause Failure Events: 15

ALPHA FACTOR AND MGL PARAMETERS PWR Auxiliary Feedwater Check Valves

Table 25-7: Summary	of Alpha Factor	Parameter	Estimations -	Fail to	Remain Closed	
---------------------	-----------------	-----------	---------------	---------	---------------	--

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
¢L ₁	0.9808694	0.9675906	0.9569199	0.9507171	0.9465537
α,	1.91E-02	2.95E-02	3.53E-02	3.67E-02	3.60E-02
α,		2.90E-03	7.03E-03	1.08E-02	1.37E-02
α.,			7.81E-04	1.75E-03	3.22E-03
Ø.5				9.24E-05	5.22E-04
a.					1.17E-05

Table 25-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.81E-01	9.68E-01	9.57E-01	9.51E-01	9.47E-01
Beta	1.91E-02	3.24E-02	4.31E-02	4.93E-02	5.35E-02
Gamma		8.94E-02	1.81E-01	2.56E-01	3.27E-01
Delts			9.99E-02	1.46E-01	2.15E-01
Epsilon				5.02E-02	1.42E-01
Mu					2.20E-02

Table 25-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	36.54	54.81	73.08	91.35	109.63
N,	10.4562	13.5644	15.9036	17.7253	19.3742
N ₁	0.9166	2.0855	3.2795	4.2088	4.9013
N,	AND AN AVAILABLE TO TAKE AN AVAILABLE AVAILABLE AVAILABLE TO AN	0.2047	0.6539	1.2343	1.8716
N,			0.0726	0.2005	0.4384
N ₅	er alle delle d			0.0106	0.0712
N,				1	0.0016

Total Number of Independent Failure Events: 112 Total Number of Common-Cause Failure Events: 39

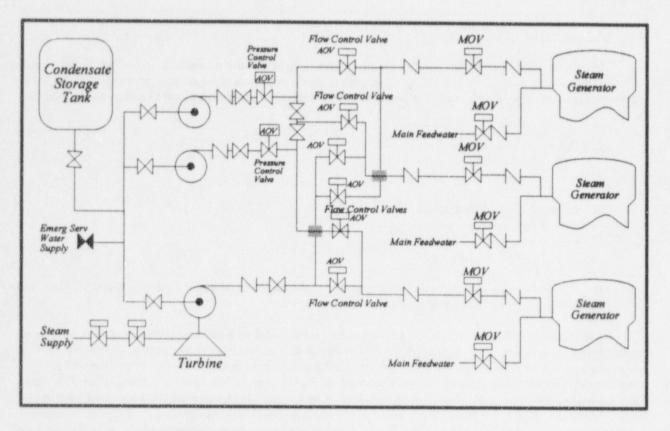


Figure 25-1. Typical auxiliary feedwater system.

3. COMPONENT BOUNDARIES

The main component of a check valve is the valve itself. This component is operated by system pressure overcoming gravity. Typically, there is no capability to manually open, close, or isolate these valves, however, some check valves have manual hand wheels or levers (stop-check) and can be manually closed. Other check valves are "air-testable" which should not affect normal component operation and in some cases the air supply is turned off during operation as a precaution. No power is required for valve operation. Check valves are installed in AFW systems in the following areas:

- Pump discharge,
- Pump suction,
- System inter- or cross-connection, and
- Pump turbine steam inlet.

The function of the check valve is to form a conditional boundary (i.e., one direction) between high pressure and low pressure sections of a system during static conditions. By design, the valve will open to allow flow when the low pressure section has experienced a pressure increase (e.g., pump start). For the purposes of this study, the boundaries will encompass the valve body including internals (e.g. disk, spring) and operators in the cases of air assisted check valves.

4. FAILURE EVENT DEFINITION

Check valve malfunctions are considered to be failures to open or close on demand, and failure to stay closed, including excessive leakage through the valve. Examples of the consequences of these failures are vapor binding AFW pumps, over pressurization of pump suction piping, and system drainage. Failure modes used to analyze check valve data are:

- CC Failure to Open. Examples are:
 - Check valve sticks closed,
 - Check valve partially opens.
- OO Failure to Close. Examples are:
 - Check valve sticks closed,
 - Valve doesn't fully close, and
 - Failure to re-seat.
- VR Failure to Remain Closed. In cases where the check valve has been closed for a substantial period of time and is then discovered leaking the failure will be coded as VR.

AFW check valve failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the AFW check valves. Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of check valve demand. The exception to this is if a licensee reported that the check valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the check valve from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second AFW check valve would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another AFW check valve, the event was identified as a CCF. If, however, the report did not clearly identify that another check valve would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another AFW check valve operation demand (e.g. the condition was found during inspection, and no check valve demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 25-10 through 25-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of check valve. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Check Valves

Table 25-10: Alpha Factor Distribution Summary	y - Fail to	Open.	CCCG = 2	
--	-------------	-------	----------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.7554818	0.8816249	0.8929177	0.9690046	0.8245484	1.9840E+01	2.6639E+00
α2	3.10E-02	1.18E-01	1.07E-01	2.45E-01	1.76E-01	2.6639E+00	1.9840E+01

Table 25-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8030019	0.8990741	0.9069976	0.9679880	0.8524372	3.093E+01	3.3781E+00
α,	1.39E-03	2.88E-02	2.01E-02	8.61E-02	3.30E-02	9.6430E-01	3.2507E+01
α,	1.67E-02	7.21E-02	6.37E-02	1.56E-01	1.15E-01	2.4138E+00	3.1057E+01

Table 25-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8314571	0.9077039	0.9133202	0.9647192	0.8582592	4.3788E+01	4.4524E+00
α2	5.17E-03	3.53E-02	2.91E-02	8.67E-02	5.17E-02	1.7025E+00	4.6538E+01
9	1.86E-07	5.52E-03	1.10E-03	2.62E-02	1.62E-04	2.6620E-01	4.7974E+01
α,	1.21E-02	5.15E-02	4.54E-02	1.12E-01	8.99E-02	2.4837E+00	4.5757E+01

Table 25-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α_i	0.8626103	0.9222953	0.9264796	0.9676620	0.8796748	6.1790E+01	5.2059E+00
α,	2.52E-03	2.19E-02	1.74E-02	5.69E-02	2.74E-02	1.4677E+00	6.5528E+01
α,	5.75E-04	1.37E-02	9.29E-03	4.21E-02	1.88E-02	9.2020E-01	6.6076E+01
α.	2.77E-08	3.49E-03	5.35E-04	1.73E-02	1.48E-05	2.3400E-01	6.6762E+01
α,	9.35E-03	3.86E-02	3.41E-02	8.32E-02	7.41E-02	2.5840E+00	6.4412E+01

Table 25-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8944739	0.9415658	0.9450570	0.9767100	0.9230306	7.8826E+01	4.8920E+00
α2	1.69E-03	1.65E-02	1.28E-02	4.38E-02	1.95E-02	1.3775E+00	8.2341E+01
α,	7.45E-04	1.26E-02	8.99E-03	3.68E-02	1.68E-02	1.0552E+00	8.2663E+01
α,	4.85E-05	6.74E-03	3.41E-03	2.47E-02	8.18E-03	5.6400E-01	8.3154E+01
as	3.65E-08	2.91E-03	4.84E-04	1.42E-02	3.26E-06	2.4340E-01	8.3475E+01
α,	2.73E-03	1.97E-02	1.61E-02	4.93E-02	3.26E-02	1.6519E+00	8.2066E+01

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Check Valves

Table 25-15: Alpha Factor Distribution Summary - Fail to Close, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α ₁	0.8622159	0.9355517	0.9427487	0.9842367	0.9297050	3.7275E+01	2.5678E+00
α,	1.58E-02	6.45E-02	5.73E-02	1.38E-01	7.03E-02	2.5678E+00	3.7275E+01

Table 25-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α ₁	0.8644844	0.9268752	0.9316775	0.9728483	0.9182645	5.4657E+01	4.3121E+00
α,	1.01E-02	4.28E-02	3.77E-02	9.28E-02	4.97E-02	2.5219E+00	5.6447E+01
α,	4.76E-03	3.04E-02	2.52E-02	7.36E-02	3.21E-02	1.7902E+00	5.7179E+01

Table 25-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α.	0.8687897	0.9223802	0.9258117	0.9642364	0.9095029	7.5421E+01	6.3468E+00
α,	1.27E-02	4.13E-02	3.76E-02	8.26E-02	5.07E-02	3.3790E+00	7.8389E+01
α,	1.32E-03	1.53E-02	1.16E-02	4.22E-02	1.78E-02	1.2547E+00	8.0513E+01
α,	3.07E-03	2.10E-02	1.72E-02	5.17E-02	2.21E-02	1.7131E+00	8.055E+001

Table 25-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α ₁	0.8784432	0.9241708	0.9267808	0.9609733	0.9083575	9.9822E+01	8.1905E+00
α,	1.25E-02	3.65E-02	3.36E-02	7.01E-02	4.72E-02	3.9375E+00	1.0408E+02
α,	3.02E-003	1.77E-002	1.49E-002	4.23E-002	2.21E-002	1.9148E+00	1.0610E+02
α.,	1.32E-04	6.69E-03	3.99E-03	2.24E-02	7.19E-03	7.2290E-01	1.0729E+02
α,	2.00E-03	1.50E-02	1.21E-02	3.77E-02	1.52E-02	1.6153E+00	1.0640E+02

Table 25-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.8839160	0.9246914	0.9268120	0.9582202	0.9064307	1.2311E+02	1.0260E+01
α1	1.30E-02	3.44E-02	3.21E-02	6.36E-02	4.74E-02	4.5746E+00	1.2856E+02
α,	2.40E-03	1.43E-02	1.19E-02	3.42E-02	1.70E-02	1.8999E+00	1.3124E+02
R.4	1.45E-03	1.16E-02	9.28E-03	2.98E-02	1.54E-02	1.5472E+00	1.3159E+02
As	7.45E-07	2.53E-03	7.41E-04	1.11E-02	1.17E-03	3.3710E-01	1.3280E+02
α,	1.75E-03	1.25E-02	1.02E-02	3.13E-02	1.27E-02	1.6675E+00	1.3147E+02

ALPHA FACTOR DISTRIBUTIONS PWR Auxiliary Feedwater Check Valves

Remain Closed.	CCCG = 2
	Remain Closed.

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9367023	0.9760571	0.9812937	0.9975002	0.9808694	5.6526E+01	1.3866E+00
α.2	2.50E-03	2.39E-02	1.87E-02	6.33E-02	1.91E-02	1.3866E+00	5.6526E+01

Table 25-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9268172	0.9643428	0.9678577		0.9675906	8.3574E+01	3.0902E+00
α,	6.57E-03	2.85E-02	2.50E-02	6.26E-02	2.95E-02	2.4727E+00	8.4192E+01
α,	7.65E-05	7.13E-03	3.85E-03	2.53E-02	2.90E-03	6.1750E-01	8.6047E+01

Table 25-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9206623	0.9554065	0.9579374	0.9814926	0.9569199	1.1368E+02	5.3060E+00
a ₁	1.08E-02	3.22E-02	2.96E-02	6.24E-02	3.53E-02	3.8333E+00	1.1515E+02
α,	3.17E-04	7.70E-03	5.18E-03	2.37E-02	7.03E-03	9.1650E-01	1.1807E+02
α,	3.15E-05	4.67E-03	2.34E-03	1.73E-02	7.81E-04	5.5620E-01	1.1843E+02

Table 25-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9193650	0.9508065	0.9527382	0.9756430	0.9507171	1.4712E+02	7.6118E+00
α,	1.26E-02	3.19E-02	2.99E-02	5.80E-02	3.67E-02	4.9368E+00	1.4980E+02
α,	1.46E-03	1.06E-02	8.62E-03	2.67E-02	1.08E-02	1.6463E+00	1.5309E+02
α,	4.95E-06	2.81E-03	1.12E-03	1.13E-02	1.75E-03	4.3410E-01	1.5430E+02
α,	3.49E-05	3.84E-03	2.02E-03	1.39E-02	9.24E-05	5.9460E-01	1.5414E+02

Table 25-24: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
a	0.9193082	0.9481663	0.9497370	0.9716516	0.9465537	1.7948E+02	9.8117E+00
α,	1.29E-02	3.00E-02	2.84E-02	5.28E-02	3.60E-02	5.6804E+00	1.8361E+02
α,	2.83E-03	1.27E-02	1.11E-02	2.84E-02	1.37E-02	2.4122E+00	1.8688E+02
α.,	8.88E-05	3.97E-03	2.41E-03	1.31E-02	3.22E-03	7.5110E-01	1.8854E+02
α,	2.72E-07	1.66E-03	4.38E-04	7.48E-03	5.22E-04	3.1450E-01	1.8898E+02
a,	4.64E-05	3.45E-03	1.93E-03	1.20E-02	1.17E-05	6.5350E-01	1.8864E+02

26. BWR High Pressure Coolant Injection/Reactor Core Isolation Cooling Check Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving check valves in high pressure coolant injection (HPCI) and reactor core isolation cooling (RCIC) systems at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) event reports (LERs) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified one common-cause failure to open events, one common-cause failure to close events, and 13 common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Table 26-1 and 26-2, respectively. Table 26-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 26-4 through 26-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of for high pressure coolant injection check valves is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in tables 26-10 Through 26-24.

2. SYSTEM DESCRIPTION

BWRs can have HPCI and RCIC systems or only a HPCI system (if an Isolation Condenser is present). Both the HPCI and the RCIC are single train systems, and are consequently not subject to CCF events by themselves. This analysis combined the failures of check valves across the system boundaries to identify CCF events.

The HPCI system provides high volume, high pressure makeup water to the reactor pressure vessel (RPV) in the event of a small break LOCA that does not result in a rapid depressurization of the reactor vessel. The HPCI system consists of a turbine driven pump, system piping, valves, and controls. The HPCI system is normally in standby, aligned to take suction from the condensate storage tank (CST), but suction automatically switches from the CST to the suppression pool upon low CST level or high suppression pool water level. The HPCI system automatically starts in response to decreasing RPV water level and is injected into the reactor via the feedwater header. HPCI serves as the primary source of makeup if RCS pressure remains high. Steam to drive the HPCI turbine is routed from main steam. Figure 26-1 shows a typical HPCI System.

The RCIC system provides low volume, high pressure makeup water to the RPV for core cooling when the main steam lines are isolated or the condensate/feedwater system is not available. The RCIC system consists of a turbine driven pump, system piping, valves, and controls. The RCIC system is normally in standby and aligned to take a suction on the CST, but suction automatically switches from the CST to the suppression pool upon low CST level or high suppression pool water level. The RCIC system automatically starts in response to decreasing RPV water level and is injected into the RPV via the feedwater line. Steam to drive the RCIC turbine is routed from main steam. The RCIC system is similar to the HPCI system in terms of components and configuration.

BWR HPCI/RCIC Check Valves

ALPHA FACTOR AND MGL PARAMETERS BWR High Pressure Coolant Injection/Reactor Core Isolation Cooling Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9473684	0.9642857	0.9729730	0.9782609	0.9818182
<u>Ø</u> ₁	5.26E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00
α,		3.57E-02	0.00E+00	0.00E+00	0.00E+00
α,			2.70E-02	0.00E+00	0.00E+00
CL4				2.17E-02	0.00E+00
α.					1.82E-02

Table 26-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 26-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Farameter	arameter CCCG=2 CCCG=3		CCCG=4	CCCG=5	CCCG=6	
1-Beta	9.47E-01	9.64E-01	9.73E-01	9.78E-01	9.82E-01	
Beta	5.26E-02	3.57E-02	2.70E-02	2.17E-02	1.82E-02	
Gamma		1.00E+00	1.00E+00	1.00E+00	1.00E+00	
Delta	Delta		1.00E+00	1.00E+00	1.00E+00	
Epsilon				1.00E+00	1.00E+00	
Mu					1.00E+00	

Table 26-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	18.00	27.00	36.00	45.00	54.00
N ₁	0.0000	0.0000	0.0000	0.0000	0.0000
N ₁	1.0000	0.0000	0.0000	0.0000	0.0000
N,	nanna e a anador boll, dia di Annani, sebudu (Akara) dinasma	1.0000	0.0000	0.0000	0.0000
N,	ante al anna antes delle alle est anné delle alle sent and en		1.0000	0.0000	0.0000
N ₅	na arean ang managang at managang ang ang ang ang ang ang ang ang			1.0000	0.0000
N.	and a state of the			Í	1.0000

Total Number of Independent Failure Events: 18 Total Number of Common-Cause Failure Events: 1

BWR HPCI/RCIC Check Valves

ALPHA FACTOR AND MGL PARAMETERS BWR High Pressure Coolant Injection/Reactor Core Isolation Cooling Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9756098	0.9836066	0.9876543	0.9900990	0.9917355
α,	2.44E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00
α,		1.64E-02	0.00E+00	0.00E+00	0.00E+00
α.4			1.24E-02	0.00E+00	0.00E+00
a,				9.90E-03	0.00E+00
α,					8.26E-03

Table 26-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 26-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=2 CCCG=3		CCCG=5	CCCG=6	
1-Beta	9.76E-01	9.84E-01	9.88E-01	9.90E-01	9.92E-01	
Beta	2.44E-02	1.64E-02	1.24E-02	9.90E-03	8.26E-03	
Gamma		1.00E+00	1.00E+00	1.00E+00	1.00E+00	
Delta			1.00E+00	1.00E+00	1.00E+00	
Epsilon				1.00E+00	1.00E+00	
Mu					1.00E+00	

Table 26-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	40.00	60.00	80.00	100.00	120.00
N ₁	0.0000	0.0000	0.0000	0.0000	0.0000
N ₂	1.0000	0.0000	0.0000	0.0000	0.0000
N,		1.0000	0.0000	0.0000	0.0000
N4	AN HE DISCONTENENTS IN ADDRESS CONTINUES. C. M. MCHARLEN		1.0000	0.0000	0.0000
N,				1.0000	0.0000
N ₆	and the second second second second second second				1.0000

Total Number of Independent Failure Events: 40 Total Number of Common-Cause Failure Events: 1

ALPHA FACTOR AND MGL PARAMETERS BWR High Pressure Coolant Injection/Reactor Core Isolation Cooling Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9334588	0.8831130	0.8611957	0.8537604	0.8536341
a,	6.65E-02	9.56E-02	8.99E-02	7.57E-02	6.16E-02
α,	1	2.13E-02	4.09E-02	4.82E-02	4.71E-02
α,			8.02E-03	1.92E-02	2.69E-02
α,				3.28E-03	9.40E-03
Q.					1.39E-03

Table 26-7: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Table 26-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=2 CCCG=3		CCCG=5	CCCG=6	
1-Beta	9.34E-01	8.83E-01	8.61E-01	8.54E-01	8.54E-01	
Beta	6.65E-02	1.17E-01	1.39E-01	1.46E-01	1.46E-01	
Gamma		1.82E-01	3.52E-01	4.83E-01	5.79E-01	
Delta			1.64E-01	3.18E-01	4.45E-01	
Epsilon				1.46E-01	2.86E-01	
Mu		A STATE OF THE OWNER AND A STATE OF THE OWNER AND A STATE OF	and a supply distance of the state of the st		1.29E-01	

Table 26-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	10.30	15.45	20.60	25.75	30.89
N ₁	4.3806	4.2330	3.8608	3.4936	3.1910
N ₁	1.0465	2.1304	2.5536	2.5917	2.4588
N,		0.4748	1.1610	1.6491	1.8803
N,			0.2279	0.6560	1.0739
Ns				0.1123	0.3752
N ₆					0.0554

Total Number of Independent Failure Events: 19 Total Number of Common-Cause Failure Events: 13

BWR HPCI/RCIC Check Valves

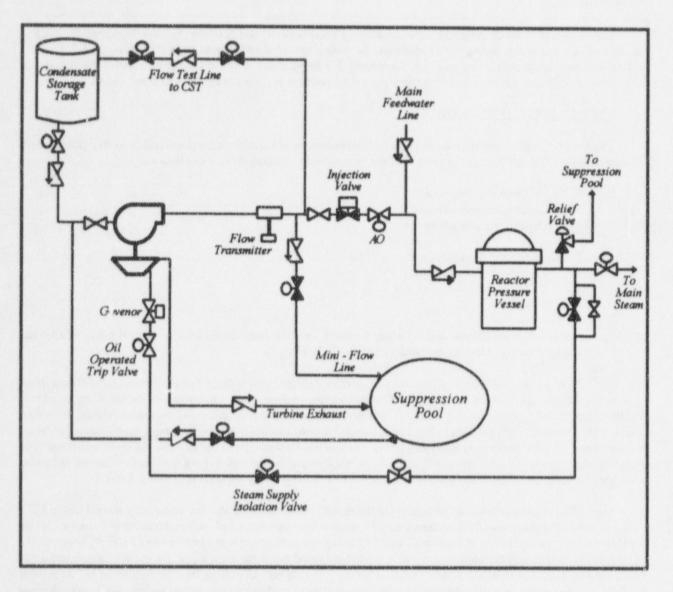


Figure 26-1. High pressure coolant injection/reactor core isolation cooling system.

3. COMPONENT BOUNDARIES

The main component of a check valve is the valve itself. This component is operated by system pressure overcoming gravity. Typically, there is no capability to manually open, close, or isolate these valves however, some check valves have manual hand wheels or levers (stop-check) and can be manually closed. Other check valves are "air-testable" which should not affect normal component operation and in some cases the air supply is turned off during operation as a precaution. No power is required for valve operation. Check valves are installed in HPCI/RCIC systems in the following areas:

- Pump discharge,
- Pump suction,
- Loop injection,
- System inter- or cross-connection, and
- Pump turbine steam inlet.

BWR HPCI/RCIC Check Valves

The function of the check valve is to form a conditional boundary (i.e., one direction) between high pressure and low pressure sections of a system during static conditions. By design, the valve will open to allow flow when the low pressure section has experienced a pressure increase (e.g., pump start). For the purposes of this study, the boundaries will encompass the valve body including internals (e.g. disk, springs) and operators in the cases of air assisted check valves.

4. FAILURE EVENT DEFINITION

Check valve malfunctions are considered to be failures to open or close on demand and failure to stay closed which includes excessive leakage through the valve. Failure modes used to analyze check valve data are:

- CC Failure to Open Examples are:
 - Check valve sticks closed,
 - Check valve partially opens.
- OO Failure to Close Examples are:
 - Check valve sticks closed,
 - Valve doesn't fully close, and
 - Failure to re-seat.
- VR Failure to Remain Closed In cases where the check valve has been closed for a substantial period of time and is then discovered leaking the failure will be coded as VR.

HPCI/RCIC check valve failures that occurred during testing are included with the failures that occurred during plant transients requiring operation of the HPCI/RCIC check valves. Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of check valve demand. The exception to this is if a licensee reported that the check valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the check valve from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second HPCI/RCIC check valve would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another HPCI/RCIC check valve, the event was identified as a CCF. If, however, the report did not clearly identify that another check valve would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another HPCI/RCIC check valve operation demand (e.g. the condition was found during inspection, and no check valve demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 26-10 through 26-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of check valves. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS BWR High Pressure Coolant Injection/Reactor Core Isolation Cooling Check Valves

Table 26-10:	Alpha Factor	Distribution	Summary	- Fail to O	pen, $CCCG = 2$	
--------------	--------------	--------------	---------	-------------	-----------------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.8703398	0.9493104	0.9593096	0.9940119	0.9473684	2.7530E+01	1.4700E+00
α,	5.99E-03	5.07E-02	4.07E-02	1.30E-01	5.26E-02	1.4700E+00	2.7530E+01

Table 26-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9015232	0.9590909	0.9658571	0.9934920	0.9642857	4.2200E+01	1.8000E+00
α,	7.42E-06	8.80E-03	3.12E-03	3.69E-02	0.00E+00	3.8720E-01	4.3613E+01
α,	3.49E-03	3.21E-02	2.53E-02	8.40E-02	3.57E-02	1.4128E+00	4.2587E+01

Table 26-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9183807	0.9634920	0.9682943	0.9921767	0.9729730	6.0700E+01	2.3000E+00
α1	5.83E-05	8.79E-03	4.40E-03	3.24E-02	0.00E+00	5.5380E-01	6.2446E+01
α,	1.21E-07	4.17E-03	8.10E-04	1.99E-02	0.00E+00	2.6260E-01	6.2737E+01
α.,	2.76E-03	2.36E-02	1.87E-02	6.09E-02	2.70E-02	1.4836E+00	6.1516E+01

Table 26-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9284992	0.9656091	0.9691633	0.9905682	0.9782609	8.3042E+01	2.9576E+00
α2	1.71E-04	8.47E-03	5.08E-03	2.83E-02	0.00E+00	7.2800E-01	8.5272E+01
α,	6.09E-06	4.79E-03	1.81E-03	1.97E-02	0.00E+00	4.1200E-01	8.5588E+01
α,	2.11E-08	2.72E-03	4.14E-04	1.34E-02	0.00E+00	2.3360E-01	8.5766E+01
α,	2.39E-03	1.84E-02	1.48E-02	4.67E-02	2.17E-02	1.5840E+00	8.4416E+01

Table 26-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9352785	0.9673363	0.9701802	0.9896582	0.9818182	1.0447E+02	3.5276E+00
α2	1.83E-04	7.21E-03	4.49E-03	2.35E-02	0.00E+00	7.7910E-01	1.0722E+02
α,	2.94E-05	5.01E-03	2.45E-03	1.87E-02	0.00E+00	5.4060E-01	1.0746E+02
α.,	4.52E-07	2.90E-03	7.58E-04	1.31E-02	0.00E+00	3.1270E-01	1.0769E+02
α,	2.81E-08	2.25E-03	3.74E-04	1.10E-02	0.00E+00	2.4330E-01	1.0775E+02
α.,	2.11E-03	1.53E-02	1.24E-02	3.83E-02	1.82E-02	1.6519E+00	1.0635E+02

ALPHA FACTOR DISTRIBUTIONS BWR High Pressure Coolant Injection/Reactor Core Isolation Cooling Check Valves

Table 26-15:	Alpha Factor	Distribution	Summary	- Fail to Close	, $CCCG = 2$
	1 P15/1100 V P0/10/1			the survey of the second s	Concerns in a strainty of the state of the state of the strain of the state of the

Alpha Factor	5th%	Mean	Median	95th%	MLE	a constant of the second of th	b
	0.9254542	0.9711765	0.9770915	0.9966590	0.9756098	4.9530E+01	1.4700E+00
α,	3.34E-03	2.88E-02	2.29E-02	7.46E-02	2.44E-02	1.4700E+00	4.9530E+01

Table 26-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α.	0.9432585	0.9766234	0.9806176	0.9963292	0.9836066	7.5200E+01	1.8000E+00
α,	4.21E-06	5.03E-03	1.77E-03	2.11E-02	0.00E+00	3.8720E-01	7.6613E+01
α,	1.97E-03	1.84E-02	1.44E-02	4.83E-02	1.64E-02	1.4128E+00	7.5587E+01

Table 26-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9516272	0.9785047	0.9814149	0.9954382	0.9876543	1.0470E+02	2.3000E+00
α,	3.42E-05	5.18E-03	2.58E-03	1.91E-02	0.00E+00	5.5380E-01	1.0645E+02
α,	7.11E-08	2.45E-03	4.75E-04	1.17E-02	0.00E+00	2.6260E-01	1.0674E+02
α,	1.61E-03	1.39E-02	1.10E-02	3.60E-02	1.24E-02	1.4836E+00	1.0552E+02

Table 26-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9561561	0.9790238	0.9812448	0.9942881	0.9900990	1.3804E+02	2.9576E+00
α,	1.04E-04	5.16E-03	3.09E-03	1.73E-02	0.00E+00	7.2800E-01	1.4027E+02
α,	3.70E-06	2.92E-03	1.10E-03	1.20E-02	0.00E+00	4.1200E-01	1.4059E+02
α.,	1.28E-08	1.66E-03	2.52E-04	8.18E-03	0.00E+00	2.3360E-01	1.4076E+02
α,	1.45E-03	1.12E-02	9.02E-03	2.86E-02	9.90E-03	1.5840E+00	1.3941E+02

Table 26-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9596477	0.9797261	0.9815341	0.9936199	0.9917355	1.7047E+02	3.5276E+00
α2	1.13E-04	4.48E-03	2.78E-03	1.46E-02	0.00E+00	7.7910E-01	1.7322E+02
α,	1.82E-05	3.11E-03	1.52E-03	1.16E-02	0.00E+00	5.4060E-01	1.7346E+02
α,	2.80E-07	1.80E-03	4.70E-04	8.11E-03	0.00E+00	3.1270E-01	1.7369E+02
α,	1.74E-08	1.40E-03	2.32E-04	6.82E-03	0.00E+00	2.4330E-01	1.7375E+02
α,	1.31E-03	9.49E-03	7.69E-03	2.39E-02	8.26E-03	1.6519E+00	1.7235E+02

ALPHA FACTOR DISTRIBUTIONS BWR High Pressure Coolant Injection/Reactor Core Isolation Cooling Check Valves

	Table 26-20:	Alpha Factor D	Distribution Summar	v - Fail to Remain (Closed, $CCCG = 2$
--	--------------	----------------	---------------------	----------------------	--------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α,	0.8513890	0.9410553	0.9521613	0.9926238	0.9334588	2.4211E+01	1.5165E+00
α1	7.37E-03	5.89E-02	4.78E-02	1.49E-01	6.65E-02	1.5165E+00	2.4211E+01

Table 26-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	Sth%	Mean	Median	95th%	MLE	8	b
α,	0.8259289	0.9110640	0.9181849	0.9718003	0.8831130	3.4883E+01	3.4052E+00
α,	1.58E-02	6.58E-02	5.83E-02	1.41E-01	9.56E-02	2.5176E+00	3.5771E+01
α,	8.88E-04	2.32E-02	1.55E-02	7.16E-02	2.13E-02	8.8760E-01	3.7401E+01

Table 26-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8309564	0.9036367	0.9085718	0.9594243	0.8611957	4.9161E+01	5.2425E+00
α,	1.65E-02	5.71E-02	5.18E-02	1.16E-01	8.99E-02	3.1074E+00	5.1296E+01
α,	2.87E-03	2.62E-02	2.06E-02	6.85E-02	4.09E-02	1.4236E+00	5.2980E+01
α.4	2.45E-04	1.31E-02	7.78E-03	4.40E-02	8.02E-03	7.1150E-01	5.3692E+01

Table 26-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α	0.8452952	0.9061758	0.9098151	0.9546047	0.8537604	6.7286E+01	6.9667E+00
α,	1.36E-02	4.47E-02	4.07E-02	8.97E-02	7.57E-02	3.3197E+00	7.0933E+01
α,	5.21E-03	2.78E-02	2.36E-02	6.44E-02	4.82E-02	2.0611E+00	7.2192E+01
α.,	4.56E-04	1.20E-02	7.97E-03	3.72E-02	1.92E-02	8.8960E-01	7.3363E+01
a,	1.62E-04	9.38E-03	5.49E-03	3.18E-02	3.28E-03	6.9630E-01	7.3556E+01

Table 26-24:	Alpha Facto	r Distribution Sur	nmary - Fail to	Remain Closed,	CCCG = 6
--------------	-------------	--------------------	-----------------	----------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	2	b
α,	0.8567748	0.9099137	0.9128480	0.9530188	0.8536341	8.4553E+01	8.3712E+00
α.2	1.03E-02	3.48E-02	3.16E-02	7.06E-02	6.16E-02	3.2379E+00	8.9686E+01
α,	5.86E-03	2.61E-02	2.27E-02	5.76E-02	4.71E-02	2.4209E+00	9.0503E+01
α.,	1.55E-03	1.49E-02	1.16E-02	3.96E-02	2.69E-02	1.3866E+00	9.1538E+01
α,	7.19E-05	6.66E-03	3.60E-03	2.36E-02	9.40E-03	6.1850E-01	9.2306E+01
CL.6	1.39E-04	7.61E-03	4.49E-03	2.57E-02	1.39E-03	7.0730E-01	9.2217E+01

27. PWR High Pressure Safety Injection Check Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving check valves in high pressure safety injection (HPSI) systems at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified five common-cause failure to open events, one common-cause failure to close event, and 15 common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 27-1 and 27-2, respectively. Table 27-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 27-4 through 27-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of high pressure safety injection systems check valves is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 27-10 through 27-24.

2. SYSTEM DESCRIPTION

The high pressure safety injection (HPSI) system is a subsystem of the emergency core cooling system (ECCS) that functions to provide emergency coolant injection to maintain reactor coolant inventory and provide adequate decay heat removal following a loss of coolant accident (LOCA). The injection function is performed in a relatively short time interval after initiation of the LOCA. The system is typically comprised of two safety injection (SI) pumps and two or three high pressure centrifugal charging pumps (CCP); one CCP is an installed spare which can be manually aligned to either train.

Both the charging and the SI pumps inject directly into the primary loop cold legs, and the SI pumps can be realigned to inject into the hot legs. The suction source for the HPSI pumps is the refueling water storage tank (RWST) which contains enough highly borated water to satisfy the injection needs of the core. Figure 27-1 illustrates the typical flow path for the HPSI system. All pumps and motor operated valves receive power from the 1E emergency power system backed up by the emergency diesel generators.

The HPSI pumps are normally in standby, and are started by the engineered safety features actuation system, or may be manually actuated. A HPSI signal starts the charging and SI pumps, shifts the charging pump suction to the RWST, isolates normal charging and letdown flow and completes additional valve lineup changes. The injection phase ends when the RWST reaches the low level setpoint and the system is realigned for the recirculation phase which takes suction from the containment sump through the RHR system.

ALPHA FACTOR AND MGL PARAMETERS PWR High Pressure Safety Injection Check Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
ai	0.8410201	0.8358037	0.8549101	0.8643100	0.8688148
α,	1.59E-01	7.43E-02	3.19E-02	3.92E-02	4.55E-02
α,	And a second secon	8.99E-02	5.66E-02	1.46E-02	7.50E-03
CL.4			5.66E-02	3.51E-02	1.56E-02
α,	1		and the second sec	4.68E-02	2.25E-02
a.	The second s				4.00E-02

Table 27-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 27-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	8.41E-01	8.36E-01	8.55E-01	8.64E-01	8.69E-01
Beta	1.59E-01	1.64E-01	1.45E-01	1.36E-01	1.31E-01
Gamma		5.48E-01	7.80E-01	7.12E-01	6.53E-01
Delta			5.00E-01	8.49E-01	9.12E-01
Epsilon				5.71E-01	8.00E-01
Mu					6.40E-01

Table 27-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	6.79	10.18	13.57	16.96	20.36
N ₁	1.6456	1.4360	1.5378	1.5046	1.3509
N ₂	1.5946	1.0320	0.5640	0.8363	1.1376
N ₂	C. A A MERCENDER CONTRACTOR OF A MERCENCIPTIC OF A MERCENCIPTIC OF A MERCENCIPTIC OF A MERCENCIPTIC OF A MERCEN	1.2500	1.0000	0.3125	0.1875
N4	Aan and family and charles of our and the second sec		1.0000	0.7500	0.3906
N _s	A CLUTYPE CARLES & CANAD STRUCTURE OF STRATEGIES			1.0000	0.5625
N.					1.0000

Total Number of Independent Failure Events: 19 Total Number of Common-Cause Failure Events: 5

ALPHA FACTOR AND MGL PARAMETERS PWR High Pressure Safety Injection Check Valves

Table 27-4: Summary of Al	pha Factor Parameter	Estimations - Fail to Close
---------------------------	----------------------	-----------------------------

Alpha Factor	CCCG#2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9936584	0.9872612	0.9807692	0.9845560	0.9870968
α.,	6.34E-03	1.27E-02	1.92E-02	7.72E-03	3.23E-03
α,		0.00E+00	0.00E+00	7.72E-03	6.45E-03
α.,			0.00E+00	0.00E+00	3.23E-03
α,				0.00E+00	0.00E+00
α.	1				0.00E+00

Table 27-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.94E-01	9.87E-01	9.81E-01	9.85E-01	9.87E-01
Beta	6.34E-03	1.27E-02	1.92E-02	1.54E-02	1.29E-02
Gamma		0.00E+00	0.00E+00	5.00E-01	7.50E-01
Delta			0.00E+00	0.00E+00	3.33E-01
Epsilon		Contraction of a statistical part data at 1981.		0.00E+00	0.00E+00
Mu	and the second sec				0.00E+00

Table 27-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	25.50	38.25	51.00	63.75	76.50
N,	0.6670	0.5000	0.0000	0.0000	0.0000
N ₂	0.1670	0.5000	1.0000	0.5000	0.2500
N,		0.0000	0.0000	0.5000	0.5000
N,			0.0000	0.0000	0.2500
N ₅		1		0.0000	0.0000
Né	and a second				0.0000

Total Number of Independent Failure Events: 51 Total Number of Common-Cause Failure Events: 1

ALPHA FACTOR AND MGL PARAMETERS PWR High Pressure Safety Injection Check Valves

Table 27-7: Summar	y of Alpha Factor	Parameter Estimations	- Fail to Remain Closed

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9869072	0.9803322	0.9766072	0.9747465	0.9737559
α1	1.31E-02	1.63E-02	1.70E-02	1.60E-02	1.53E-02
α,		3.36E-03	5.09E-03	6.16E-03	6.05E-03
α4			1.27E-03	2.55E-03	3.42E-03
۵s	1			5.10E-04	1.28E-03
œ,					2.13E-04

Table 27-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.87E-01	9.80E-01	9.77E-01	9.75E-01	9.74E-01
Beta	1.31E-02	1.97E-02	2.34E-02	2.53E-02	2.62E-02
Gamma	den de M ^o Collega et alle bronde de Dir Kerder et e	1.71E-01	2.72E-01	3.65E-01	4.18E-01
Delta			1.99E-01	3.32E-01	4.48E-01
Epsilon				1.67E-01	3.04E-01
Mu					1.43E-01

Table 27-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	22.29	33.43	44.58	55.72	66.87
Ni	2.5094	3.1558	3.6474	4.0651	4.4325
N ₂	0.3290	0.6086	0.8415	0.9833	1.1192
N,		0.1254	0.2512	0.3779	0.4429
N4			0.0625	0.1564	0.2502
Ns	enderster in der schler stendensener versten den des des an			0.0313	0.0938
N.	NAMES OF CONTRACTORS OF THE OWNER OF THE CONTRACT				0.0156

Total Number of Independent Failure Events: 75 Total Number of Common-Cause Failure Events: 15

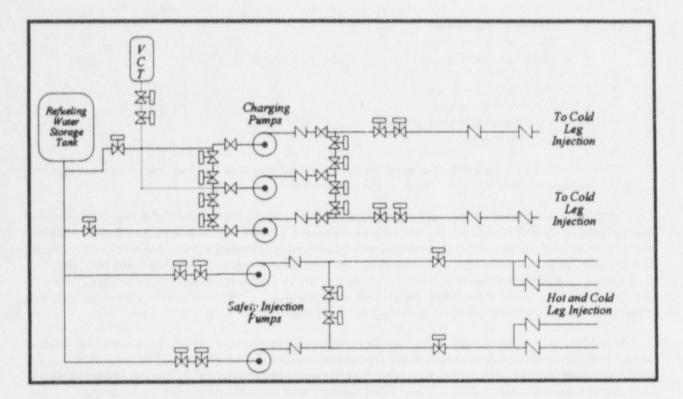


Figure 27-1. PWR high pressure safety injection system.

3. COMPONENT BOUNDARIES

The main component of a check valve is the valve itself. This component is operated by system pressure overcoming gravity. Typically, there is no capability to manual open, close, or isolate these valves, however, some valves have manual hand wheels or levers (stop-check) and can be manually closed. Other valves are "air-testable" which should not affect normal component operation and in some cases the air supply is turned off during operation as a precaution. No power is required for valve operation. Valves are installed in HPSI systems in the following areas:

- Pump discharge,
- Pump suction,
- Loop injection, and
- System inter- or cross-connection.

The function of the check valve is to form a conditional boundary (i.e., one direction) between high pressure and low pressure sections of a system during static conditions. By design, the valve will open to allow flow when the low pressure section has experienced a pressure increase (e.g., pump start). For the purposes of this study, the boundaries will encompass the valve body including internals (e.g. disk, springs) and operators in the cases of air assisted valves.

4. FAILURE EVENT DEFINITION

Check valve malfunctions are considered to be failures to open or close on demand, and failure to stay closed, including excessive leakage through the valve. Examples of the consequences of this failure an increase in containment leak rate, system drainage, and interfacing system LOCA. Failure modes used to analyze check valve data are:

- CC Failure to Open. Examples are:
 - Check valve sticks closed, and
 - Check valve partially opens.
- OO Failure to Close. Examples are:
 - Check valve sticks open,
 - Valve doesn't fully close, and
 - Failure to re-seat.
- VR Failure to Remain Closed. In cases where the check valve has been closed for a substantial period of time and is then discovered leaking the failure will be coded as VR.

HPSI check valve failures that occurred during testing are included with failures that occurred during plant transients requiring operation of the HPSI check valves. Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of check valve demand. The exception to this is if a licensee reported that the check valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the check valve from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that failure of a second HPSI check valve would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another HPSI check valve, the event was identified as a CCF. If, however, the report did not clearly identify that another check valve would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before another HPSI check valve operation demand (e.g. the condition was found during inspection, and no check valve demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 27-10 through 27-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of check valve. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS PWR High Pressure Safety Injection Check Valves

Table 27-10:	Alpha Factor	Distribution Sun	nmary - Fail to O	pen, $CCCG = 2$
--------------	--------------	-------------------------	-------------------	-----------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.7692310	0.8969277	0.9100508	0.9795710	0.8410201	1.7966E+01	2.0646E+00
α,	2.04E-02	1.03E-01	9.00E-02	2.31E-01	1.59E-01	2.0646E+00	1.7966E+01

Table 27-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	ь
α,	0.7940009	0.8969162	0.9057374	0.9695810	0.8358037	2.6816E+01	3.0820E+00
α,	5.27E-03	4.75E-02	3.77E-02	1.23E-01	7.43E-02	1.4192E+00	2.8479E+01
α,	8.00E-03	5.56E-02	4.60E-02	1.36E-01	8.99E-02	1.6628E+00	2.8235E+01

Table 27-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8323817	0.9115223	0.9177768	0.9692400	0.8549101	3.9808E+01	3.8640E+00
a,	1.75E-03	2.56E-02	1.88E-02	7.28E-02	3.19E-02	1.1178E+00	4.2554E+01
α,	2.55E-03	2.89E-02	2.21E-02	7.87E-02	5.66E-02	1.2626E+00	4.2409E+01
α,	4.02E-03	3.40E-02	2.71E-02	8.74E-02	5.66E-02	1.4836E+00	4.2188E+01

Table 27-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8578237	0.9208584	0.9254106	0.9683179	0.8643100	5.6507E+01	4.8564E+00
α,	3.26E-03	2.55E-02	2.05E-02	6.47E-02	3.92E-02	1.5643E+00	5.9799E+01
α,	2.35E-04	1.18E-02	7.09E-03	3.95E-02	1.46E-02	7.2450E-01	6.0639E+01
α.	8.01E-04	1.60E-02	1.12E-02	4.79E-02	3.51E-02	9.8360E-01	6.0380E+01
as	3.37E-03	2.58E-02	2.09E-02	6.52E-02	4.68E-02	1.5840E+00	5.9779E+0

Table 27-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8715048	0.9255560	0.9291788	0.9672148	0.8688148	7.2183E+01	5.8058E+00
α1	4.21E-03	2.46E-02	2.06E-02	5.84E-02	4.55E-02	1.9167E+00	7.6072E+01
α,	1.89E-04	9.34E-03	5.61E-03	3.12E-02	7.50E-03	7.2810E-01	7.7261E+01
α,	1.61E-04	9.02E-03	5.31E-03	3.05E-02	1.56E-02	7.0330E-01	7.7286E+01
α,	2.93E-04	1.03E-02	6.55E-03	3.33E-02	2.25E-02	8.0580E-01	7.7183E+01
Ø.,	2.94E-03	2.12E-02	1.72E-02	5.29E-02	4.00E-02	1.6519E+00	7.6337E+01

ALPHA FACTOR DISTRIBUTIONS PWR High Pressure Safety Injection Check Valves

Table 27-15:	Alpha Factor Distribu	ition Summary - F	fail to Close,	CCCG = 2
--------------	-----------------------	-------------------	----------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9387921	0.9824682	0.9902105	0.9997852	0.9936584	3.5697E+01	6.3700E-01
α.,	2.17E-04	1.75E-02	9.79E-03	6.12E-02	6.34E-03	6.3700E-01	3.5697E+01

Table 27-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9364069	0.9764706	0.9819416	0.9978132	0.9872612	5.3950E+01	1.3000E+00
α,	6.09E-04	1.61E-02	1.07E-02	4.98E-02	1.27E-02	8.8720E-01	5.4363E+01
α,	9.66E-06	7.47E-03	2.84E-03	3.06E-02	0.00E+00	4.1280E-01	5.4837E+01

Table 27-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9338719	0.9705128	0.9744440	0.9937044	0.9807692	7.5700E+01	2.3000E+00
α,	2.51E-03	1.99E-02	1.60E-02	5.08E-02	1.92E-02	1.5538E+00	7.6446E+01
α,	9.77E-08	3.37E-03	6.53E-04	1.61E-02	0.00E+00	2.6260E-01	7.7737E+01
α,	2.06E-05	6.20E-03	2.76E-03	2.40E-02	0.00E+00	4.8360E-01	7.7516E+01

Table 27-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9411519	0.9717645	0.9747173	0.9922861	0.9845560	1.0179E+02	2.9576E+00
α1	9.64E-04	1.17E-02	8.79E-03	3.25E-02	7.72E-03	1.2280E+00	1.0352E+02
α,	3.54E-04	8.71E-03	5.84E-03	2.68E-02	7.72E-03	9.1200E-01	1.0384E+02
α.4	1.73E-08	2.23E-03	3.39E-04	1.10E-02	0.00E+00	2.3360E-01	1.0451E+02
α,	4.69E-05	5.58E-03	2.89E-03	2.02E-02	0.00E+00	5.8400E-01	1.0416E+02

Table 27-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9463253	0.9729681	0.9753522	0.9914653	0.9870968	1.2697E+02	3.5276E+00
aı	4.37E-04	7.89E-03	5.56E-03	2.33E-02	3.23E-03	1.0291E+00	1.2947E+02
α,	4.54E-04	7.97E-03	5.64E-03	2.35E-02	6.45E-03	1.0406E+00	1.2946E+02
α.,	3.06E-05	4.31E-03	2.17E-03	1.59E-02	3.23E-03	5.6270E-01	1.2994E+02
as	2.33E-08	1.86E-03	3.09E-04	9.10E-03	0.00E+00	2.4330E-01	1.3025E+02
α,	6.67E-05	5.00E-03	2.80E-03	1.74E-02	0.00E+00	6.5190E-01	1.2985E+02

NUREG/CR-5497

ALPHA FACTOR DISTRIBUTIONS PWR High Pressure Safety Injection Check Valves

Table 27-20:	Alpha Factor	Distribution	Summary -	- Fail to	Remain	Closed,	CCCG = 2	2
--------------	--------------	--------------	-----------	-----------	--------	---------	----------	---

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
a	0.9270462	0.9772546	0.9854888	0.9993609	0.9869072	3.4329E+01	7.9900E-01
α,	6.36E-04	2.28E-02	1.45E-02	7.30E-02	1.31E-02	7.9900E-01	3.4329E+01

Table 27-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9266294	0.9712303	0.9769009	0.9964243	0.9803322	5.1786E+01	1.5340E+00
α,	9.66E-04	1.87E-02	1.31E-02	5.55E-02	1.63E-02	9.9580E-01	5.2324E+01
α,	5.85E-05	1.01E-02	4.95E-03	3.76E-02	3.36E-03	5.3820E-01	5.2782E+01

Table 27-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9284744	0.9674300	0.9714761	0.9925311	0.9766072	7.2927E+01	2.4552E+00
α,	1.95E-03	1.85E-02	1.45E-02	4.90E-02	1.70E-02	1.3953E+00	7.3987E+01
α,	3.12E-05	6.82E-03	3.20E-03	2.59E-02	5.09E-03	5.1380E-01	7.4868E+01
α,	4.49E-05	7.24E-03	3.58E-03	2.69E-02	1.27E-03	5.4610E-01	7.4836E+01

Table 27-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9313735	0.9653965	0.9684200	0.9890836	0.9747465	9.7827E+01	3.5065E+00
α,	2.46E-03	1.69E-02	1.38E-02	4.18E-02	1.60E-02	1.7113E+00	9.9622E+01
α,	2.07E-04	7.80E-03	4.88E-03	2.53E-02	6.16E-03	7.8990E-01	1.0540E+02
α.,	3.38E-06	3.85E-03	1.36E-03	1.61E-02	2.55E-03	3.9000E-01	1.0940E+02
α.	6.41E-05	6.07E-03	3.27E-03	2.16E-02	5.10E-04	6.1530E-01	1.0720E+02

Table 27-24: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α,	0.9343194	0.9647495	0.9671823	0.9868689	0.9737559	1.2177E+02	4.4493E+00
α,	2.52E-03	1.50E-02	1.26E-02	3.60E-02	1.53E-02	1.8983E+00	1.2432E+02
α,	3.86E-04	7.79E-03	5.39E-03	2.34E-02	6.05E-03	9.8350E-01	1.2524E+02
α,	3.17E-05	4.46E-03	2.25E-03	1.64E-02	3.42E-03	5.6290E-01	1.2566E+02
α,	7.86E-07	2.67E-03	7.82E-04	1.18E-02	1.28E-03	3.3710E-01	1.2588E+02
α.,	7.74E-05	5.29E-03	3.01E-03	1.83E-02	2.13E-04	6.6750E-01	1.2555E+02

NUREG/CR-5497

28. BWR Isolation Condenser Motor-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving motor-operated valves (MOVs) in the isolation condenser (IC) system at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified one common-cause failure-to-open event and one common-cause failure-to-close event. No failure-to-remain-closed CCF events were identified during the data review. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 28-1 and 28-2, respectively. Table 28-3 contains the average impact vectors (N₁-N₄) and the number of adjusted independent events for this failure mode. Tables 28-4 through 28-6 contain the corresponding information for the failure to close failure mode. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 28-7 through 28-12.

2. SYSTEM DESCRIPTION

The isolation condenser is part of the BWR emergency core cooling system (ECCS) that transfers residual and decay heat from the reactor coolant system to the atmosphere in the event that the main condenser is not available, or when a high reactor pressure condition exists. The IC system may be placed into service either manually or automatically. The IC system operates using natural circulation as the driving head through the isolation condenser tubes, and is available for operation when there is no electrical power. The primary side of the isolation condenser system is a closed loop from the reactor pressure vessel steam space through the tubes in the isolation condenser, with the condensate returning back to the recirculation loops. During normal plant operations, the secondary (shell) side of the isolation condenser contains sufficient water to cover the primary side tubes. The water in the shell side transfers the heat from the primary side by boiling off and venting directly to the atmosphere. Makeup to the secondary side is provided through the fire water system or through an alternate makeup source, such as the condensate transfer system.

Only five BWR plants have an IC system; those that don't have the IC have reactor core isolation cooling, which is a pump driven system. Some plants have two ICs, and other plants have one IC that contains two sets of steam cooling tubes. Figure 8-1 shows a typical isolation condenser system.

ALPHA FACTOR AND MGL PARAMETERS Isolation Condenser Motor-Operated Valves

Table 28-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
α,	0.9989552	0.9979123	0.9968652
α2	1.05E-03	2.09E-03	3.14E-03
a,	na an far faran na da ina manana dina. San ar tan kana ar kana an kana an kana an kana an kana an kana an	0.00E+00	0.00E+00
œ4	anna a na da maiar é foct annaiste cachan de ann cértain an ann annaisteanna dha annaisteanna ann an Marainne	Constant of the second s	0.00E+00

Table 28-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.99E-01	9.98E-01	9.97E-01
Beta	1.05E-03	2.09E-03	3.14E-03
Gamma		0.00E+00	0.00E+00
Delta			0.00E+00

Table 28-3: Summary of Average Impact Vectors - Fail to Open

CCCG=2	CCCG=3	CCCG=4	
15.00	22.50	30.00	
0.9667	1.4000	1.8000	
0.0167	0.0167 0.0500	0.1000	
	0.0000	0.0000	
n nga kantan kulun tempu kantan kantan kantan tang bili seban kan seberti in kanya kan seberti kan k		0.0000	
	15.00 0.9667 0.0167	15.00 22.50 0.9667 1.4000 0.0167 0.0500 0.0000 0.0000	

Total Number of Independent Failure Events: 30 Total Number of Common-Cause Failure Events: 1

ALPHA FACTOR AND MGL PARAMETERS Isolation Condenser Motor-Operated Valves

Table 28-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Alpha Factor	CCCGss2	CCCG=3	CCCG=4
a.,	0.9874756	0.9746835	0.9615385
α,	1.25E-02	2.53E-02	3.85E-02
α,	nenn a directer na tearraichte de sected de traditionen vol extension (manadet de sected de sected de sected d	0.00E+00	0.00E+00
a,	sanananan ministra yana kana kata ministra da yang kananan kananan kananan kananan kananan kananan kanana kana		0.00E+00

Table 28-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.88E-01	9.75E-01	9.62E-01
Beta	1.25E-02	2.53E-02	3.85E-02
Gamma		0.00E+00	0.00E+00
Delta	n na an		0.00E+00

Table 28-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	
Adj. Ind. Events	6.00	9.00	12.00	
N ₁	0.5835	0.6250	0.5000	
N ₂	0.0835	0.0835 0.2500 0.5	0.5000	
N,	an na bhairte a frian ia gu ann an Arlann an Shri and tal taga, bhriai Airre e ri na bhairtean a bhair	0.0000	0.0000	
N,	na na hinge kanna mandar kana ka pina kana kana kana kana kana kana kana k	in energing to characterize and a constant design of the second of the second of the second of the second of the	0.0000	

Total Number of Independent Failure Events: 12 Total Number of Common-Cause Failure Events: 1

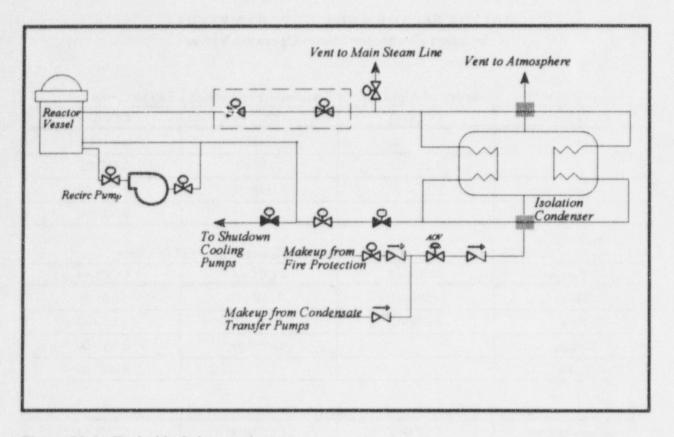


Figure 28-1. Typical isolation condenser system.

3. COMPONENT BOUNDARIES

The main components of a motor-operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual hand wheels, and can be manually operated. AC or DC power is required for valve operation.

The MOVs in the isolation condenser system are used in the following applications:

- Admitting steam to the isolation condenser from the reactor,
- Supplying condensate from the isolation condenser back to the reactor recirculation loop, and
- Supplying cooling water to the isolation condenser from either the condensate system or the fire water system.

4. FAILURE EVENT DEFINITION

The function of the primary side MOVs is to allow primary coolant flow to the isolation condenser. The function of the secondary side MOV is to allow condensing medium makeup flow into the isolation condenser shell. All valves serve as a system containment boundary and would need to close to isolate leaks. The failure modes used in evaluating the isolation condenser MOV data are:

- CC Fail to Open: The valve must be in the fully open position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Fail to Remain Closed: In cases where the motor-operated valve has been closed for a substantial period of time and is then discovered leaking, the failure is coded as VR. If the discovery is made soon after a system configuration change (i.e., pump operation), then the failure is coded as OO.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure.

These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC".

Many LERs reported only one actual failure, but the report information indicated that failure of a second MOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure is certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 28-7 through 28-12 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of MOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Isolation Condenser Motor-Operated Valves

Table 28-7: Alpha Factor Distribution Summary	- Fail to Open.	CCCG = 2
---	-----------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
ai	0.9279471	0.9812690	0.9914733	0.9999312	0.9989552	2.5497E+01	4.8670E-01
a,	6.56E-05	1.87E-02	8.53E-03	7.21E-02	1.05E-03	4.8670E-01	2.5497E+01

Table 28-8: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9332039	0.9787234	0.9860351	0.9992794	0.9979123	3.910E+01	8.5000E-01
α,	2.04E-05	1.09E-02	4.45E-03	4.39E-02	2.09E-03	4.3720E-01	3.9513E+01
α,	1.34E-05	1.03E-02	3.95E-03	4.23E-02	0.00E+00	4.1280E-01	3.9537E+01

Table 28-9: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9362904	0.9758204	0.9810590	0.9974318	0.9968652	5.6500E+01	1.4000E+00
α,	1.54E-04	1.13E-02	6.37E-03	3.92E-02	3.14E-03	6.5380E-01	5.7246E+01
α,	1.32E-07	4.54E-03	8.82E-04	2.16E-02	0.00E+00	2.6260E-01	5.7637E+01
Ø.4	2.78E-05	8.35E-03	3.73E-03	3.24E-02	0.00E+00	4.8360E-01	5.7416E+01

ALPHA FACTOR DISTRIBUTIONS Isolation Condenser Motor-Operated Valves

1 able 28-10:	Alpha Factor	Distribution	Summary -	- Fail to	Close.	CCCG = 2	

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.8789790	0.9667916	0.9829012	0.9997697	0.9874756	1.6114E+01	5.5350E-01
α,	2.28E-04	3.32E-02	1.71E-02	1.21E-01	1.25E-02	5.5350E-01	1.6114E+01

ľ

Table 28-11: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8830041	0.9594203	0.9705938	0.9975603	0.9746835	2.4825E+01	1.0500E+00
α,	3.08E-04	Contraction of the Contractor Cont	Contraction of the second second desired and	Control & Annual Agence of the State	TOT IN ADDRESS OF THE OWNER AND THE OWNER AN	6.3720E-01	
α,	2.09E-05	1.60E-02	6.15E-03	6.52E-02	0.00E+00	4.1280E-01	2.5462E+01

Table 28-12: Alpha Factor Distribution Summary - Fail to Ciose, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8891726	0.9538462	0.9614052	0.9926291	0.9615385	3.7200E+01	1.8000E+00
α	1.62E-03	2.70E-02	CALCULATION OF THE PARTY OF THE PARTY A. IN	and show on the subsect sectors, we read an address of the subsect	A REAL PROPERTY AND A REAL PROPERTY AND ADDRESS OF THE REAL PROPERTY	1.0538E+00	
α,	1.97E-07	6.73E-03	1.32E-03	3.21E-02	0.00E+00	2.6260E-01	3.8737E+01
α.,	4.16E-05	1.24E-02	5.56E-03	4.80E-02	0.00E+00	4.8360E-01	3.8516E+01

29. BWR High Pressure Coolant Injection and Reactor Core Isolation Cooling Motor-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving motor-operated valves (MOVs) in the high pressure coolant injection (HPCI) and reactor core isolation cooling (RCIC) system at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified three common-cause failure-to-open events and two common-cause failure-to-close event for the injection valves, two common-cause failure-to-remain-closed events for the pump turbine steam supply valves, five failure-to-open common-cause events and four common-cause failure-to-close events that affect both types of MOVs. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for the injection valve failure to open failure mode are shown in Tables 29-1 and 29-2, respectively. Table 29-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 29-4 through 29-15 contain the corresponding information for the failure to close and failure to remain closed failure modes for the injection, steam supply, and both types of MOVs. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by $\alpha_1-\alpha_6$. Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 29-29-16 through 29-38.

2. SYSTEM DESCRIPTION

BWRs can have HPCI and RCIC systems or only a HPCI system (if an isolation condenser is present). Both the HPCI and the RCIC are single train systems, and are not consequently subject to CCF events by themselves. This analysis combined the failures of MOVs across the system boundaries to identify CCF events.

The HPCI system supplies high volume, high pressure make-up water to the reactor pressure vescel (RPV) in the event of a small break LOCA which does not result in a rapid depressurization of the reactor vessel. The HPCI system consists of a turbine driven pump, system piping, valves and controls. The HPCI system is normally in star dby, isolates on low pressure, and is aligned to take a suction from the condensate storage tank (CST) but suction is automatically switched from the CST to the suppression pool upon low CST level or high suppression pool water level. The HPCI system is automatically started in response to decreasing RPV water level and is injected into the reactor via the feedwater system. HPCI serves as the primary source of makeup if RCS pressure remains high. Steam to drive the HPCI turbine is routed from main steam.

The RCIC system provides low volume, high pressure makeup water to the RPV for core cooling when the main steam lines are isolated or the condensate and feedwater system is not available. The RCIC system consists of a turbine driven pump, system piping, valves and controls. The RCIC system is normally in standby, and is aligned to take a suction from the CST, but suction is automatically switched from the CST to the suppression pool upon low CST level or high suppression pool water level. The RCIC system is automatically started in response to decreasing RPV water level and is injected into the reactor via the feedwater line. Steam for the RCIC turbine-driven pump is routed from mail steam. Figure 29-1 shows a typical HPCI system; the configuration of the RCIC system is similar.

ALPHA FACTOR AND MGL PARAMETERS HPCI/RCIC Injection Motor-Operated Valves

Table 20.1.	Summery of	Alpha	Factor	Parameter	Estimations -	Fail to	Open

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
C.	0.9536339	0.9675266	0.9743904	0.9784509	0.9811204
<u> </u>	4.64E-02	1.59E-03	2.08E-03	2.39E-03	2.57E-03
04.1		3.09E-02	2.24E-04	3.93E-04	5.71E-04
G.			2.33E-02	2.90E-05	6.35E-05
				1.87E-02	3.92E-06
α _s			The second se		1.57E-02
a.				La restaura de la caracteria de la carac	1

Table 29-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.54E-01	9.68E-01	9.74E-01	9.79E-01	9.81E-01
Beta	4.64E-02	3.25E-02	2.56E-02	2.16E-02	1.89E-02
Gamma		9.51E-01	9.19E-01	8.89E-01	8.64E-01
Delta			9.91E-01	9.80E-01	9.65E-01
Epsilon	and a state of the second state of the second states and states			9.99E-01	9.96E-01
Mu	1				1.00E+01

Table 29-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	41.54	62.31	83.08	103.85	124.63
N,	0.4197	0.5265	0.5833	0.6011	0.5905
N ₂	2.0401	0.1035	0.1782	0.2553	0.3281
N ₂	Remains and a constraints of a spectrum when a sub-optimized	2.0055	0.0192	0.0419	0.0729
N,	Randolf all constants of solid to one distance where a		2.0015	0.0031	0.0081
N _s	NE WALL AND DE CAMPACTURE AND A CONTRACT AND A CONTRACT A CONTRACT A CONTRACT A CONTRACT A CONTRACT A CONTRACT			2.0001	0.0005
N.	A CONTRACTOR OF THE OWNER OF THE				2.0000

Total Number of Independent Failure Events: 97 Total Number of Common-Cause Failure Events: 3

ALPHA FACTOR AND MGL PARAMETERS HPCI/RCIC Injection Motor-Operated Valves

Table 29-4: Summar	of Alpha Factor	Parameter	Estimations	- Fail to Close	

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9973117	0.9951217	0.9933549	0.9900165	0.9883734
α,	2.69E-03	4.63E-03	5.96E-03	7.90E-03	7.76E-03
α,		2.53E-04	6.57E-04	1.90E-03	3.19E-03
α.,			2.43E-05	1.85E-04	6.19E-04
æ _s			and the second sec	5.85E-06	5.38E-05
a.,					1.63E-06

Table 29-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG==6
1-Beta	9.97E-01	9.95E-01	9.93E-01	9.90E-01	9.88E-01
Beta	2.69E-03	4.88E-03	6.65E-03	9.98E-03	1.16E-02
Gamma		5.18E-02	1.03E-01	2.09E-01	3.33E-01
Delta			3.57E-02	9.16E-02	1.75E-01
Epsilon				3.06E-02	8.21E-02
Mu			Names and an an and an and a constrained and an an an and an		2.94E-02

Table 29-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=
Adj. Ind. Events	20.00	30.00	40.00	50.00	60.00
N ₁	0.5894	0.7412	0.8247	0.7330	0.6375
N2	0.0555	0.1429	0.2451	0.4046	0.4760
N,	A CONTRACTOR OF A CONTRACTOR OF A CONTRACTOR	0.0078	0.0270	0.0972	0.1959
N,			0.0010	0.0095	0.0380
N _s				0.0003	0.0033
N ₆	And the second	and a second			0.0001

Total Number of Independent Failure Events: 60 Total Number of Common-Cause Failure Events: 2

ALPHA FACTOR AND MGL PARAMETERS HPCI/RCIC Turbine Steam Supply Motor-Operated Valves

Table 29-7: Summary of Alpha Factor Parameter Estima	nations - rai	il to Kemair	1 Closed
--	---------------	--------------	----------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
G.	0.9999871	0.9999770	0.9999677
α,	1.29E-05	2.30E-05	3.23E-05
a,	ne disk stylleter i sjølde av på være operatielse op profe stal telefore frænse frænse støre en stal	0.00E+00	0.00E+00
-,	una consensation de la seconda chomacan chance meteronamiente		0.00E+00

Table 29-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	1.00E+00	1.00E+00	1.00E+00
Beta	1.29E-05	2.30E-05	3.23E-05
Gamma		0.00E+00	0.00E+00
Delta			0.00E+00

Table 29-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj. Ind. Events	23.00	34.50	46.00
N,	0.1995	0.2985	0.3970
N ₂	0.0003	0.0008	0.0015
N ₃		0.0000	0.0000
N,			0.0000

Total Number of Independent Failure Events: 46 Total Number of Common-Cause Failure Events: 2

ALPHA FACTOR AND MGL PARAMETERS HPCI/RCIC Motor-Operated Valves, both Injection and Turbine Steam Supply

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG-6
æ,	0.9712123	0.9798879	0.9841097	0.9865718	0.9881654
α,	2.88E-02	1.09E-03	1.44E-03	1.69E-03	1.86E-03
α,		1.90E-02	1.37E-04	2.41E-04	3.50E-04
Ø.4			1.43E-02	1.78E-05	3.88E-05
α,			and a second	1.15E-02	2.40E-06
α.,					9.59E-03

Table 29-10: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 29-11: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG
1-Beta	9.71E-01	9.80E-01	9.84E-01	9.87E-01	9.88E-01
Beta	2.88E-02	2.01E-02	1.59E-02	1.34E-02	1.18E-02
Gamma		9.46E-01	9.09E-01	8.74E-01	8.43E-01
Delta			9.91E-01	9.80E-01	9.65E-01
Epsilon				9.99E-01	9.96E-01
Mu			and a summaries in the second second second second		1.00E+01

Table 29-12: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG-
Adj. Ind. Events	68.00	102.00	136.00	170.00	204.00
N ₁	0.9619	1.3280	1.6361	1.8976	2.1227
N2	2.0441	0.1153	0.2017	0.2946	0.3871
N,		2.0055	0.0192	0.0419	0.0729
N,	n manan mar Ar manan manan kanan karangan dan dari yan karar da		2.0015	0.0031	0.0081
N _s		A THE RECTANCE OF THE PARTY OF	Novel and an excellence of the state of the	2.0001	0.0005
N ₆					2.0000

Total Number of Independent Failure Events: 204 Total Number of Common-Cause Failure Events: 5

ALPHA FACTOR AND MGL PARAMETERS HPCI/RCIC Motor-Operated Valves, both Injection and Turbine Steam Supply

Alpha Factor	3: Summary of CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
and a second	0.9972286	0.9947832	0.9925857	0.9893969	0.9872568
α,	2.77E-03	5.06E-03	6.99E-03	9.30E-03	1.03E-02
a.	2.112 00	1.57E-04	4.09E-04	1.18E-03	1./9E-03
α ₃			1.52E-05	1.16E-04	3.86E-04
α,				3.65E-06	3.35E-05
α,					1.02E-06
α.,			and the second s	CO. No. of Concession, State o	

Table 29, 13: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 29-14: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter CCCG=2		CCCG=3	CCCG=4	CCCG=5	CCCG=6	
1-Beta	9.97E-01	9.95E-01	9.93E-01	9.89E-01	9.87E-01	
Beta	2.77E-03	5.22E-03	7.41E-03	1.06E-02	1.27E-02	
Gamma		3.01E-02	5.72E-02	1.23E-01	1.89E-01	
Delta			3.57E-02	9.16E-02	1.75E-01	
				3.06E-02	8.21E-02	
Epsilon	+				2.94E-02	
Mu		1		A DECEMBER OF THE OWNER	AND A REPORT OF A REAL PROPERTY	

Table 29-15: Summary of Average Impact Vectors - Fail to Close

CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
32.00	48.00	64.00	80.00	96.00
A DESCRIPTION OF A DESC	1.3501	1.4914	1.3869	1.2058
0.0919	0.2510	0.4612	0.7652	1.0174
	0.0078	0.0270	0.0972	0.1959
THE CONTRACTOR DESIGNS AND CONTRACTOR OF STREET	1	0.0010	0.0095	0.0380
			0.0003	0.0033
			1	0.0001
	CCCG=2 32.00 1.0677	CCCG=2 CCCG=3 32.00 48.00 1.0677 1.3501 0.0919 0.2510	CCCG=2 CCCG=3 CCCG=4 32.00 48.00 64.00 1.0677 1.3501 1.4914 0.0919 0.2510 0.4612 0.0078 0.0270	CCCCG=2 CCCCG=3 CCCCG=4 CCCCG=5 32.00 48.00 64.00 80.00 1.0677 1.3501 1.4914 1.3869 0.0919 0.2510 0.4612 0.7652 0.0078 0.0270 0.0972 0.0010 0.0095

Total Number of Independent Failure Events: 112 Total Number of Common-Cause Failure Events: 4

BWR HPCI and RCIC MOVs

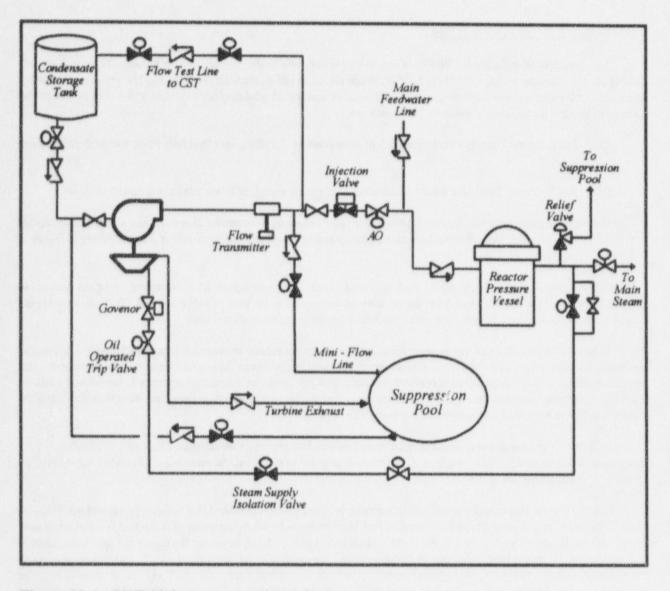


Figure 29-1. BWR high pressure coolant injection system.

3. COMPONENT BOUNDARIES

The main components of a motor-operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual hand wheels, and can be manually operated. AC or DC power is required for valve operation.

MOVs are used in the HPCI/RCIC system in the following applications:

- Pump discharge,
- Pump suction,
- Loop injection,
- System inter- or cross-connection, and
- Steam supply.

4. FAILURE EVENT DEFINITION

The function of the injection MOVs is to allow injection flow to the primary system through the reactor vessel. During normal plant operations, most of the MOVs remain closed to isolate the high pressure and low pressure portions of the system. All valves serve as a system containment boundary and would need to close to isolate leaks. The failure modes used in evaluating the isolation condenser MOV data are:

- CC Fail to Open: The valve must be in the fully open position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a f...lure to close.
- VR Fail to Remain Closed: Leakage through the valve following a successful closure. This is intended to capture leakage events that affect the operation of the system or the plant, and not minor leakage resulting in failure of local leak rate tests.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure. These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC."

Many LERs reported only one actual failure, but the report information indicated that failure of a second MOV would have occurred from the same cause if a operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 29-16 through 29-38 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of MOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS HPCI/RCIC Injection Motor-Operated Valves

Table 29-16: Alpha Factor Distribution Summary - Fail to Open, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	ь
α,	0.8991799	0.9535168	0.9590234	0.9890106	0.9536339	5.1490E+01	2.5101E+00
a	1.10E-02	4.65E-02	4.10E-02	1.01E-01	4.64E-02	2.5101E+00	5.1490E+01

Table 29-17: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

A REAL PROPERTY AND A REAL								
Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b	
α,	0.9249820	0.9640625	0.9678196	0.9902796	0.9675266	7.8037E+01	2.9090E+00	
α.,	2.18E-05	6.06E-03	2.73E-03	2.34E-02	1.59E-03	4.9070E-01	8.0455E+01	
α,	6.73E-03	2.99E-02	2.61E-02	6.60E-02	3.09E-02	2.4183E+00	7.8528E+01	

Table 29-18: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9378518	0.9687204	0.9714726	0.9901649	0.9743904	1.0836E+02	3.4989E+00
α	1.34E-04	6.54E-03	3.93E-03	2.19E-02	2.08E-03	7.3200E-01	1.1113E+02
α,	1.50E-07	2.52E-03	5.55E-04	1.18E-02	2.24E-04	2.8180E-01	1.1158E+02
α,	5.13E-03	2.22E-02	1.94E-02	4.88E-02	2.33E-02	2.4851E+00	1.0937E+02

Table 29-19: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

THE OWNER WATER A VEHICLE A VEHICLE AND A		A DEST ACTION OF A DESCRIPTION OF A DESC				And the second		
Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b	
α	0.9452170	0.9709843	0.9731016	0.9895223	0.9784509	1.4249E+02	4.2580E+00	
α	3.32E-04	6.70E-03	4.63E-03	2.01E-02	2.39E-03	9.8330E-01	1.4577E+02	
α,	7.13E-06	3.09E-03	1.29E-03	1.23E-02	3.93E-04	4.5390E-01	1.4629E+02	
α.4	1.46E-08	1.61E-03	2.52E-04	7.94E-03	2.90E-05	2.3670E-01	1.4651E+02	
α,	4.22E-03	1.76E-02	1.55E-02	3.83E-02	1.87E-02	2.5841E+00	1.4416E+02	

Table 29-20: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

						A		
Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b	
α,	0.9502438	0.9726664	0.9743961	0.9891877	0.9811204	1.7569E+02	4.9372E+00	
α2	4.02E-04	6.13E-03	4.43E-03	1.77E-02	2.57E-03	1.1072E+00	1.7952E+02	
α,	3.53E-05	3.40E-03	1.82E-03	1.21E-02	5.71E-04	6.1350E-01	1.8010E+02	
α.4	3.45E-07	1.78E-03	4.83E-04	7.95E-03	6.35E-05	3.2080E-01	1.8031E+02	
a _s	1.72E-08	1.35E-03	2.25E-04	6.58E-03	3.92E-06	2.4380E-01	1.8038E+02	
a.	3.60E-03	1.47E-02	1.29E-02	3.18E-02	1.57E-02	2.6519E+00	1.7798E+02	

NUREG/CR-5497

ALPHA FACTOR DISTRIBUTIONS HPCI/RCIC Injection Motor-Operated Valves

Table 29-21: Alpha Factor Distribution Summary - Fail to Close, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	â	b
α,	0.9357905	0.9828517	0.9916825	0.9999140	0.9973117	3.0119E+01	5.2550E-01
a,	8.93E-05	1.72E-02	8.32E-03	6.42E-02	2.69E-03	5.2550E-01	3.0119E+01

Table 29-22: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	ь
α,	0.9388026	0.9797256	0.9860416	0.9990647	0.9951217	4.5941E+01	9.5070E-01
α,	6.09E-05	1.13E-02	5.48E-03	4.23E-02	4.63E-03	5.3010E-01	4.6362E+01
α,	1.31E-05	8.97E-03	3.49E-03	3.65E-02	2.53E-04	4.2060E-01	4.6471E+01

Table 29-23: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9405549	0.9765552	0.9811102	0.9969800	0.9933549	6.5525E+01	1.5731E+00
α,	3.29E-04	1.19E-02	7.53E-03	3.84E-02	5.96E-03	7.9890E-01	6.6299E+01
α,	3.35E-07	4.32E-03	1.00E-03	2.00E-02	6.57E-04	2.8960E-01	6.6809E+01
α.,	2.43E-05	7.22E-03	3.23E-03	2.80E-02	2.43E-05	4.8460E-01	6.6614E+01

Table 29-24: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9405291	0.9729385	0.9763218	0.9937824	0.9900165	8.8775E+01	2.4692E+00
α,	8.62E-04	1.24E-02	9.08E-03	3.54E-02	7.90E-03	1.1326E+00	9.0112E+01
α,	2.43E-05	5.58E-03	2.60E-03	2.13E-02	1.90E-03	5.0920E-01	9.0735E+01
α.,	3.30E-08	2.66E-03	4.42E-04	1.30E-02	1.85E-04	2.4310E-01	9.1001E+01
α,	5.41E-05	6.40E-03	3.33E-03	2.32E-02	5.85E-06	5.8430E-01	9.0660E+01

Table 29-25: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.9424303	0.9716583	0.9743675	0.9916310	0.9883734	1.1111E+02	3.2409E+00
α	9.42E-04	1.10E-02	8.29E-03	3.02E-02	7.76E-03	1.2551E+00	1.1310E+02
α,	1.35E-04	6.44E-03	3.88E-03	2.15E-02	3.19E-03	7.3650E-01	1.1361E+02
α.,	1.24E-06	3.07E-03	9.49E-04	1.33E-02	6.19E-04	3.5070E-01	1.1400E+02
α,	3.14E-08	2.16E-03	3.68E-04	1.05E-02	5.38E-05	2.4660E-01	1.1410E+02
α.,	7.62E-05	5.70E-03	3.19E-03	1.99E-02	1.63E-06	6.520E-01	1.1370E+02

ALPHA FACTOR DISTRIBUTIONS HPCI/RCIC Turbine Steam Supply Motor-Operated Valves

Table 29-26: Alpha Factor Distribution Summa	ry - Fail to Remain Closed, $CCCG = 2$
--	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α,	0.9447164	0.9858345	0.9937925	0.9999562	0.9999871	3.2730E+01	4.7030E-01
α.,	4.08E-05	1.42E-02	6.21E-03	5.53E-02	1.29E-05	4.7030E-01	3.2730E+01

Table 29-27: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.9492929	0.9842362	0.9899859	0.9995570	0.9999770	4.9999E+01	8.080E-01
α,	6.52E-06	7.64E-03	2.71E-03	3.20E-02	2.30E-05	3.8800E-01	5.0412E+01
a,	1.05E-05	8.13E-03	3.09E-03	3.33E-02	0.00E+00	4.1280E-01	5.0387E+01

Table 29-28: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.9513015	0.9820231	0.9862377	0.9983386	0.9999677	7.1097E+01	1.3015E+00
α,	5.14E-05	7.67E-03	3.84E-03	2.83E-02	3.23E-05	5.5530E-01	7.1843E+01
α,	1.05E-07	3.63E-03	7.04E-04	1.73E-02	0.00E+00	2.6260E-01	7.2136E+01
α.,	2.22E-05	6.68E-03	2.98E-03	2.59E-02	0.00E+00	4.8360E-01	7.1915E+01

ALPHA FACTOR DISTRIBUTIONS HPCI/RCIC Motor-Operated Valves, both Injection and Turbine Steam Supply

Table 29-29:	Alpha Factor	Distribution S	ummary -	Fail to	o Op	en, (CCC	CG	= 2	

Alpha Factor	Sth%	Mean	Median	95th%	MLE	B	b
α.,	0.9322727	0.9689640	0.9727469	0.9927144	0.9712123	7.8492E+01	2.5141E+00
α,	7.28E-03	3.10E-02	2.73E-02	6.77E-02	2.88E-02	2.5141E+00	7.8492E+01

Table 29-30: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	2	b
α,	0.9496141	0.9759508	0.9785184	0.9935182	0.9798879	1.1853E+02	2.9208E+00
a ₂	1.68E-05	4.14E-03	1.90E-03	1.58E-02	1.09E-03	5.0250E-01	1.2095E+02
α,	4.46E-03	1.99E-02	1.73E-02	4.42E-02	1.90E-02	2.4183E+00	1.1903E+02

Table 29-31: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,		0.9787631	0.9806564	0.9933203	0.9841097	1.6234E+02	3.5224E+00
α,	1.04E-04	4.56E-03	2.78E-03	1.51E-02	1.44E-03	7.5550E-01	1.6511E+02
α,	1.01E-07	1.70E-03	3.74E-04	7.93E-03	1.37E-04	2.8180E-01	1.6558E+02
α,	3.44E-03	1.50E-02	1.31E-02	3.30E-02	1.43E-02	2.4851E+00	1.6338E+02

Table 29-32: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9621018	0.9799414	0.9814146	0.9927455	0.9865718	2.0994E+02	4.2973E+00
α2	2.60E-04	4.77E-03	3.35E-03	1.42E-02	1.69E-03	1.0226E+00	2.1322E+02
α,	4.88E-06	2.12E-03	8.83E-04	8.42E-03	2.41E-04	4.5390E-01	2.1378E+02
α.	9.98E-09	1.11E-03	1.73E-04	5.44E-03	1.78E-05	2.3670E-01	2.1400E+02
α,	2.88E-03	1.21E-02	1.06E-02	2.63E-02	1.15E-02	2.5841E+00	2.1165E+02

Table 29-33: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α.,	0.9652425	0.9809011	0.9821116	0.9924212	0.9881654	2.5660E+02	4.9962E+00
α,	3.27E-04	4.46E-03	3.28E-03	1.26E-02	1.86E-03	1.1662E+00	2.6043E+02
α,	2.43E-05	2.35E-03	1.26E-03	8.36E-03	3.50E-04	6.1350E-01	2.6098E+02
α.4	2.38E-07	1.23E-03	3.33E-04	5.49E-03	3.88E-05	3.2080E-01	2.6128E+02
α,	1.19E-08	9.32E-04	1.55E-04	4.55E-03	2.40E-06	2.4380E-01	2.6135E+02
α.,	2.48E-03	1.01E-02	8.92E-03	2.20E-02	9.59E-03	2.6519E+00	2.5894E+02

NUREG/CR-5497

ALPHA FACTOR DISTRIBUTIONS HPCI/RCIC Motor-Operated Valves, both Injection and Turbine Steam Supply

Table 29-34:	Alpha Factor Distribution	Summary - Fail to Close	, $CCCG = 2$
--------------	---------------------------	-------------------------	--------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.9523236	0.9869810	0.9933807	0.9999036	0.9972286	4.2598E+01	5.6190E-01
α.,	9.30E-05	1.30E-02	6.62E-03	4.77E-02	2.77E-03	5.6190E-01	4.2598E+01

Table 29-35: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9530013	0.9838619	0.9884480	0.9990323	0.9947832	6.4550E+01	1.0588E+00
α,	1.20E-04	9.73E-03	5.39E-03	3.41E-02	5.06E-03	6.3820E-01	6.4971E+01
α,	9.33E-06	6.41E-03	2.48E-03	2.61E-02	1.57E-04	4.2060E-01	6.5188E+01

Table 29-36: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9526069	0.9805480	0.9839147	0.9969793	0.9925857	9.0191E+01	1.7892E+00
α.,	5.94E-04	1.10E-02	7.75E-03	3.27E-02	6.99E-03	1.0150E+00	9.0965E+01
α,	2.44E-07	3.15E-03	7.29E-04	1.46E-02	4.09E-04	2.8960E-01	9.1691E+01
α,	1.77E-05	5.27E-03	2.35E-03	2.04E-02	1.52E-05	4.8460E-01	9.1496E+01

Table 29-37: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9510468	0.9768542	0.9794076	0.9939408	0.9893969	1.1943E+02	2.8298E+00
α2	1.44E-03	1.22E-02	9.67E-03	3.17E-02	9.30E-03	1.4932E+00	1.2077E+02
α,	1.81E-05	4.17E-03	1.94E-03	1.59E-02	1.18E-03	5.0920E-01	1.2175E+02
CL4	2.46E-08	1.99E-03	3.29E-04	9.71E-03	1.16E-04	2.4310E-01	1.2202E+02
α,	4.03E-05	4.78E-03	2.48E-03	1.73E-02	3.65E-06	5.8430E-01	1.2168E+02

Table 29-38: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9513028	0.9750281	0.9770935	0.9917097	0.9872568	1.4768E+02	3.7823E+00
α,	1.84E-03	1.19E-02	9.79E-03	2.90E-02	1.03E-02	1.7965E+00	1.4967E+02
α,	1.02E-04	4.86E-03	2.93E-03	1.62E-02	1.99E-03	7.3650E-01	1.5073E+02
α.,	9.31E-07	2.32E-03	7.15E-04	1.01E-02	3.86E-04	3.5070E-01	1.5111E+02
α.,	2.37E-08	1.63E-03	2.78E-04	7.91E-03	3.35E-05	2.4660E-01	1.5122E+02
α,	5.74E-05	4.31E-03	2.41E-03	1.50E-02	1.02E-06	6.5200E-01	1.5081E+02

30. BWR Residual Heat Removal Motor-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving motor-operated valves (MOVs) in the residual heat removal (RHR) system and low pressure coolant injection (LPCI) system at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified 23 common-cause failure-to-open events, 24 common-cause failure-to-close events, and 14 common-cause failure-to-remain-closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 30-1 and 30-2, respectively. Table 30-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 30-4 through 30-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 30-10 through 30-24.

2. SYSTEM DESCRIPTION

The RHR system and LPCI system in BWR plants is a part of the emergency core cooling system (ECCS) that serves several functions by operating in different modes:

- Low pressure coolant injection (LPCI) mode to provide low pressure makeup water to the reactor vessel for core cooling under loss of coolant accident (LOCA) conditions,
- Containment spray mode to reduce primary containment pressure and temperature following a LOCA,
- Shutdown cooling and head spray mode to remove decay heat from the reactor core following a reactor shutdown and to reduce reactor vessel dome pressure during normal cooldown,
- Suppression pool cooling mode to remove heat from the suppression pool,
- Steam condensing mode to provide a means of removing decay heat with main steam isolation valves closed,
- Containment flooding mode to provide a means of flooding primary containment, and
- Fuel pool cooling assist mode to provide a means to augment the fuel pool cooling and cleanup system.

Under accident conditions, the LPCI mode is automatically initiated. All other modes require manual system alignment for proper operation. In the LPCI mode, the pumps takes suction from the suppression pool and discharge to the recirculation loops. The RHR heat exchangers are bypassed in this mode. The containment spray mode protects the containment structure from possible over pressurization from steam which might bypass the suppression pool, including system breaks within the containment volume. In this mode water is pumped from the suppression pool through heat exchangers to spray nozzles located high in the containment space. The suppression pool cooling mode is designed to

ALPHA FACTOR AND MGL PARAMETERS BWR Residual Heat Removal Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9747769	0.9720205	0.9664169	0.9654873	0.9656303
α,	2.52E-02	1.66E-02	2.30E-02	1.84E-02	1.53E-02
α,		1.14E-02	2.45E-03	8.71E-03	9.32E-03
α,			8.17E-03	8.52E-04	3.84E-03
۵۹				6.56E-03	4.32E-04
α.,					5.49E-03

Table 30-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 30-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.75E-01	9.72E-01	9.66E-01	9.66E-01	9.66E-01
Beta	2.52E-02	2.80E-02	3.36E-02	3.45E-02	3.44E-02
Gamma		4.08E-01	3.16E-01	4.67E-01	5.55E-01
Delta			7.69E-01	4.60E-01	5.12E-01
Epsilon				8.85E-01	6.06E-01
Mu					9.27E-01

Table 30-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	113.37	170.05	226.74	283.42	340.11
N ₁	10.5529	12.4522	12.7760	12.9310	13.4675
N ₂	3.2066	3.1084	5.6924	5.6472	5.5963
N ₃	and an	2.1449	0.6072	2.6729	3.4142
N4			2.0236	0.2614	1.4068
Ns				2.0120	0.1582
N.					2.0094

Total Number of Independent Failure Events: 318 Total Number of Common-Cause Failure Events: 23

ALPHA FACTOR AND MGL PARAMETERS BWR Residual Heat Removal Motor-Operated Valves

Table 30-4:	Summary of	f Alpha Factor	Parameter	Estimations -	Fail to Close
nan sening seminan a substantion was also also also also also also also al	gantes entrance according the second	second and provide state of the second second second	Contraction of the local division of the loc	CEREMONAL PROPERTY AND ADDRESS OF AN ADDRESS OF AN ADDRESS OF ADDRES	Company of the second s

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9722298	0.9635205	0 9579754	0.9561519	0.9562972
α,	2.78E-002	2.44E-02	2.77E-02	2.49E-02	2.06E-02
α,		1.21E-02	6.17E-03	1.08E-02	1.35E-02
œ.,			8.19E-03	1.76E-03	3.51E-03
a.				6.40E-03	6.88E-04
Ø.6					5.34E-03

Table 30-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.72E-01	9.64E-01	9.58E-01	9.56E-01	9.56E-01
Beta	2.78E-02	3.65E-02	4.20E-02	4.39E-02	4.37E-02
Gamma		3.32E-01	3.42E-01	4.32E-01	5.28E-01
Delta			5.70E-01	4.31E-01	4.13E-01
Epsilon				7.84E-01	6.32E-01
Mu			A HARVEN A REAL AND A R		8.86E-01

Table 30-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	55.58	83.36	111.15	138.94	166.72
N ₁	8.8765	10.7351	11.8845	12.8798	13.9079
N ₂	1.8411	2.3814	3.5540	3.9561	3.8944
N,	and a second or a second s	1.1811	0.7920	1.7100	2.5577
N,		and an	1.0513	0.2796	0.6634
N ₅	an ann an a' sur an	and the second	Comparison and the second s	1.0166	0.1300
N.			A DESCRIPTION OF THE OWNER OWNER OF THE OWNER		1.0092

Total Number of Independent Failure Events: 162 Total Number of Common-Cause Failure Events: 24

ALPHA FACTOR AND MGL PARAMETERS BWR Residual Heat Removal Motor-Operated Valves

Table 30-7: Summary of	Alpha Factor	Parameter Estimations	- Fail to Remain Closed
------------------------	--------------	-----------------------	-------------------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9887587	0.9773790	0.9656687	0.9430002	0.9286212
α,	1.12E-02	2.26E-02	3.43E-02	5.23E-02	5.89E-02
α,		0.00E+00	0.00E+00	4.75E-03	1.10E-02
α.,			0.00E+00	0.00E+00	1.50E-03
α,				0.00E+00	0.00E+00
α.,					0.00E+00

Table 30-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.89E-01	9.77E-01	9.66E-01	9.43E-01	9.29E-01
Beta	1.12E-02	2.26E-02	3.43E-02	5.70E-02	7.14E-02
Gamma		0.00E+00	0.00E+00	8.34E-02	1.76E-01
Delta			0.00E+00	0.00E+00	1.20E-01
Epsilon		1		0.00E+00	0.00E+00
Mu					0.00E+00

Table 30-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	5.37	8.05	10.73	13.41	16.10
N ₁	2.7485	3.8491	4.7657	5.2350	5.6315
N ₂	0.0923	0.2754	0.5509	1.0330	1.3771
N,		0.0000	0.0000	0.0940	0.2581
N4			0.0000	0.0000	0.0352
N ₅				0.0000	0.0000
N.		And and the second dense showing the second s			0.0000

Total Number of Independent Failure Events: 18 Total Number of Common-Cause Failure Events: 14 limit the long term bulk temperature rise of the suppression pool water following a design basis LOCA. A closed path from the suppression pool through the RHR loops to the reactor vessel and back to the suppression pool through the break can be maintained for decay heat removal from the core.

The shutdown cooling and head spray mode takes suction from the recirculation system loop and discharges back into the condensate and feedwater system lines. The water passes through the heat exchangers where it is cooled by the service water system. Following isolation of the reactor from its primary heat sink, the RHR steam condensing mode is used in conjunction with the reactor core isolation cooling system to remove decay heat, via the heat exchangers, and minimize the makeup water requirements. Containment flooding is accomplished by the standby coolant supply mode by cross connecting the service water system and pumping service water into the reactor vessel. The fuel pool assist mode allows the RHR system to provide additional cooling to the spent fuel in the fuel pool.

A simplified schematic drawing of a typical BWR RHR system configuration in presented in Figure 30-1.

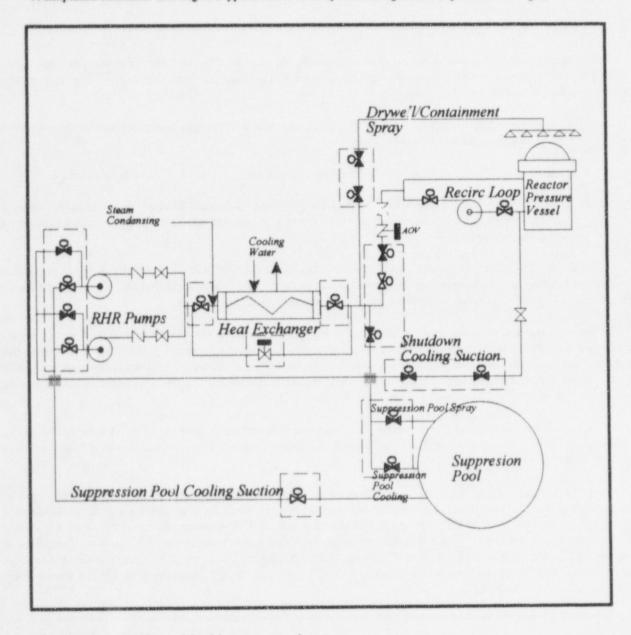


Figure 30-1. BWR residual heat removal system.

3. COMPONENT BOUNDARIES

The main components of a motor-operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual hand wheels, and can be manually operated. AC or DC power is required for valve operation.

MOVs are used in the RHR system in the following applications:

- Pump discharge,
- Pump suction,
- Loop injection, and
- System inter- or cross-connection.

4. FAILURE EVENT DEFINITION

The function of the injection MOVs is to allow injection flow to the reactor vessel. During normal plant operations, most of the MOVs remain closed to isolate the high pressure and low pressure portions of the system. The failure modes used in evaluating the RHR MOV data are:

- CC Fail to Open: A successful operation of the valve is the valve is in the fully open position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Fail to Remain Closed: Leakage through the valve following a successful closure. This is intended to capture leakage events that affect the operation of the system or the plant, and not minor leakage resulting in failure of local leak rate tests.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure. These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC."

Many LERs reported only one actual failure, but the report information indicated that failure of a second MOV would have occurred from the same cause if a operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

NUREG/CR-5497

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 30-10 through 30-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of MOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS BWR Residual Heat Removal Motor-Operated Valves

Table 30-10: Alpha Factor Distribution Summary - Fail to Open, CCCG = 2	Table 30-10:	Alpha Factor	Distribution	Summary -	Fail t	o Open.	CCCG = 2	
---	--------------	--------------	--------------	-----------	--------	---------	----------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α	0.9473482	0.9731883	0.9754598	0.9912686	0.9747769	1.3345E+02	3.6766E+00
α,	8.73E-03	2.68E-02	2.45E-02	5.27E-02	2.52E-02	3.6766E+00	1.3345E+02

Table 30-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	93th%	MLE		b
α,	0.9485072	0.9702910	0.9718152	0.9868635	0.9720205	1.9770E+02	6.0533E+00
α,	5.35E-03	1.72E-02	1.56E-02	3.43E-02	1.66E-02	3.4956E+00	2.026E+02
α,	2.97E-03	1.26E-02	1.10E-02	2.75E-02	1.14E-02	2.5577E+00	2.0120E+02

Table 30-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
ai	0.9448602	0.9648587	0.9659872	0.9810100	0.9664169	2.6422E+02	9.6232E+00
α,	1.02E-02	2.28E-02	2.17E-02	3.93E-02	2.30E-02	6.2462E+00	2.6760E+02
α,	1.12E-04	3.18E-03	2.08E-03	9.98E-03	2.45E-03	8.6980E-01	2.7297E+02
α,	2.12E-03	9.16E-03	7.99E-03	2.02E-02	8.17E-03	2.5072E+00	2.7134E+02

Table 30-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9459783	0.9638236	0.9647136	0.9786397	0.9654873	3.3439E+02	1.2551E+01
α,	8.30E-03	1.84E-02	1.75E-02	3.16E-02	1.84E-02	6.3752E+00	3.4057E+02
α,	2.50E-03	8.89E-03	7.97E-03	1.85E-02	8.71E-03	3.0849E+00	3.4386E+02
α,	5.33E-06	1.43E-03	6.45E-04	5.50E-03	8.52E-04	4.9500E-01	3.4645E+02
α,	1.79E-03	7.48E-03	6.56E-03	1.63E-02	6.56E-03	2.5960E+00	3.4435E+02

Table 30-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9478310	0.9639460	0.9646846	0.9775496	0.9656303	4.0405E+02	1.5113E+01
a,	6.87E-03	1.52E-02	1.45E-02	2.62E-02	1.53E-02	6.3754E+00	4.1279E+02
α,	3.21E-03	9.44E-03	8.67E-03	1.83E-02	9.32E-03	3.9548E+00	4.1521E+02
α,	5.96E-04	4.10E-03	3.35E-03	1.02E-02	3.84E-03	1.7195E+00	4.1744E+02
α,	1.02E-06	9.58E-04	3.49E-04	3.97E-03	4.32E-04	4.0150E-01	4.1876E+02
a	1.55E-03	6.35E-03	5.58E-03	1.38E-02	5.49E-03	2.6613E+00	4.1650E+02

ALPHA FACTOR DISTRIBUTIONS BWR Residual Heat Removal Motor-Operated Valves

	Table 30-15: /	Alpha Factor	Distribution	Summary	- Fail	to Close,	CCCG = 2	
--	----------------	--------------	--------------	---------	--------	-----------	----------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α _i	0.9321933	0.9697096	0.9737228	0.9935002	0.9722298	7.3987E+01	2.3111E+00
α,	6.50E-03	3.03E-02	2.63E-02	6.78E-02	2.78E-02	2.3111E+00	7.3987E+01

Table 30-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9282071	0.9616188	0.9642975	0.9858619	0.9635205	1.0930E+02	4.3625E+00
α,	6.26E-03	2.44E-02	2.16E-02	5.18E-02	2.44E-02	2.7686E+00	1.1089E+02
a,	1.83E-03	1.40E-02	1.13E-02	3.56E-02	1.21E-02	1.5939E+00	1.1207E+02

Table 30-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9268079	0.9566314	0.9585934	0.9797550	0.9579754	1.4773E+02	6.6973E+00
α,	9.37E-03	2.66E-02	2.46E-02	5.07E-02	2.77E-02	4.1078E+00	1.5032E+02
α,	4.01E-04	6.83E-03	4.85E-03	2.00E-02	6.17E-03	1.0546E+00	1.5337E+02
α,	1.22E-03	9.94E-03	7.92E-03	2.56E-02	8.19E-03	1.5349E+00	1.5289E+02

Table 30-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α ₁	0.9287053	0.9551268	0.9566451	0.9763528	0.9561519	1.8986E+02	8.9199E+00
α,	9.02E-03	2.36E-02	2.20E-02	4.35E-02	2.49E-02	4.6841E+00	1.9410E+02
α,	2.05E-03	1.07E-02	9.08E-03	2.47E-02	1.08E-02	2.1220E+00	1.9666E+02
α,	1.17E-05	2.58E-03	1.21E-03	9.82E-03	1.76E-03	5.1320E-01	1.9827E+02
α,	1.05E-03	8.05E-03	6.47E-03	2.05E-02	6.40E-03	1.6060E+00	1.9718E+02

Table 30-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	B	b
α,	0.9317061	0.9554234	0.9566721	0.9748693	0.9562972	2.3110E+02	1.0782E+01
α,	7.37E-03	1.93E-02	1.80E-02	3.58E-02	2.06E-02	4.6735E+00	2.3721E+02
α,	3.62E-03	1.28E-02	1.15E-02	2.65E-02	1.35E-02	3.0983E+00	2.3878E+02
α,	1.96E-04	4.04E-03	2.78E-03	1.22E-02	3.51E-03	9.7610E-01	2.4091E+02
α,	9.90E-07	1.54E-03	5.16E-04	6.56E-03	6.88E-04	3.7330E-01	2.4151E+02
α,	9.50E-04	6.87E-03	5.56E-03	1.72E-02	5.34E-03	1.6611E+00	2.4022E+02

NUREG/CR-5497

ALPHA FACTOR DISTRIBUTIONS BWR Residual Heat Removal Motor-Operated Valves

Table 30-20: Alpha Factor Dis	stribution Summary - Fail to	Remain Closed, $CCCG = 2$
-------------------------------	------------------------------	---------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8879870	0.9691235	0.9839587	0.9997701	0.9887587	1.7649E+01	5.6230E-01
α,	2.27E-04	3.09E-02	1.60E-02	1.12E-01	1.12E-02	5.6230E-01	1.7649E+01

Table 30-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	Sth%	Mean	Median	95th%	MLE	8	b
α,	0.8907270	0.9618306	0.9721523	0.9975799		2.7099E+01	
α,	3.42E-04	2.35E~02	1.35E-02	8.07E-02	2.26E-02	6.6260E-01	2.7512E+01
α,	1.92E-05	1.47E-02	5.63E-03	5.99E-02	0.00E+00	4.1280E-01	2.7762E+01

Table 30-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8951225	0.9559801	0.9630261	0.9927108	0.9656687	4.0196E+01	1.8509E+00
α,	1.75E-03	2.63E-02	1.92E-02	7.50E-02	3.43E-02	1.1047E+00	4.0942E+01
α,	1.83E-07	6.25E-03	1.22E-03	2.98E-02	0.00E+00	2.6260E-01	4.1784E+01
α.,	3.85E-05	1.15E-02	5.16E-03	4.45E-02	0.00E+00	4.8360E-01	4.1563E+01

Table 30-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8946908	0.9483936	0.9533358	0.9851853	0.9430002	5.6687E+01	3.0846E+00
α,	4.51E-03	2.95E-02	2.44E-02	7.18E-02	5.23E-02	1.7610E+00	5.8011E+01
α,	3.59E-05	8.47E-03	3.93E-03	3.23E-02	4.75E-03	5.0600E-01	5.9266E+01
α,	3.04E-08	3.91E-03	5.97E-04	1.93E-02	0.00E+00	2.3360E-01	5.9538E+01
α,	8.27E-05	9.77E-03	5.10E-03	3.53E-02	0.00E+00	5.8400E-01	5.9188E+01

Table 30-24: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8968199	0.9450538	0.9489041	0.9801115	0.9286212	7.2204E+01	4.1980E+00
aı	5.60E-03	2.82E-02	2.42E-02	6.46E-02	5.89E-02	2.1562E+00	7.4246E+01
α,	2.88E-04	1.05E-02	6.60E-03	3.38E-02	1.10E-02	7.9870E-01	7.5603E+01
α.,	1.73E-06	4.55E-03	1.40E-03	1.98E-02	1.50E-03	3.4790E-01	7.6054E+01
α,	3.98E-08	3.18E-03	5.30E-04	1.55E-02	0.00E+00	2.4330E-01	7.6159E+01
a.	1.14E-04	8.53E-03	4.79E-03	2.97E-02	0.00E+00	6.5190E-01	7.5750E+01

NUREG/CR-5497

31. PWR High Pressure Safety Injection Motor-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD eff to estimate common-cause failure (CCF) parameters of various models using operational data involving motor-operate talves (MOVs) in the high pressure safety injection system (HPSI) system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified 23 common-cause failure-to-open events, 11 common-cause failure-to-close, and six failure-to-remain closed CCF events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 31-1 and 31-2, respectively. Table 31-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 31-4 through 31-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the maximum could be affected restinates are also included in this report in Tables 31-10 through 31-24.

2. SYSTEM DESCRIPTION

The high pressure safety injection (HPSI) system is a subsystem of the emergency core cooling system (ECCS) that functions to provide emergency coolant injection to maintain reactor coolant inventory and provide adequate decay heat removal following a loss of coolant accident (LOCA). The coolant injection function is performed in a relatively short time interval after initiation of the LOCA. The system is typically comprised of two safety injection (SI) pumps and two or three high pressure centrifugal charging pumps (CCP); one CCP is an installed spare which can be manually aligned to either train. The HPSI pumps inject directly into the primary loop cold legs, and the SI pumps can be realigned to inject into the hot legs. The suction source for the HPSI MOVs is the refueling water storage tank (RWST) and contains enough highly borated water to satisfy the injection needs of the core. Figure 31-1 illustrates the typical flow path for the HPSI system. All pumps and most motor-operated valves receive power from the 1E emergency power system and are backed up by the emergency diesel generators.

The system is normally aligned and in the standby mode. The HPSI pumps are started by the engineered safety features actuation system (ESFAS) or may be manually actuated. A HPSI signal starts the charging and SI pumps, shifts the charging pump suction to the RWST, isolates normal charging and letdown flow and completes additional valve lineup changes. The injection phase ends when the RWST reaches the low level setpoint and the system is realigned for the recirculation phase. The number of HPSI MOVs at a plant is usually at least 12, but due to the diversity of the system functions, most CCF events only affect about six MOVs.

ALPHA FACTOR AND MGL PARAMETERS High Pressure Safety Injection Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	0.9430793	
α,	0.9213610	0.9355827	0.9386097	0.9412263		
Ø.2	7.86E-02	1.57E-02	2.32E-02	2.25E-02	2.22E-02	
۵		4.87E-02	1.28E-03	6.00E-03	7.04E-03	
α.,			3.69E-02	3.06E-04	2.33E-03	
a,				3.00E-02	8.83E-05	
a.					2.52E-02	

Table 31-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 31-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.21E-01	9.36E-01	9.39E-01	9.41E-01	9.43E-01
Beta	7.86E-02	6.44E-02	2 6.14E-02 5.88E-02		5.69E-02
Gamma		7.56E-01	6.22E-01	6.17E-01	6.09E-01
Deita			9.66E-01	8.35E-01	7.97E-01
Epsilon		ter met den se de la desterre de la deste de la de		9.90E-01	9.16E-01
Mu					9.97E-01

Table 31-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6	
Adj. Ind. Events	71.81	107.72	143.63	179.53	215.44	
N ₁	7.1499	8.6794	9.0664	9.0046	8.8002	
N ₂	6.7393	1.9575	3.7738	4.5094	5.2865	
N,		6.0569	0.2089	1.2016	1.6735	
N,		1000 1000 1000 1000 1000 1000 1000 100	6.0045	0.0612	0.5533	
Ns			Contract of the Contract of th	6.0006	0.0210	
N ₆					6.0000	

Total Number of Independent Failure Events: 200 Total Number of Common-Cause Failure Events: 23

ALPHA FACTOR AND MGL PARAMETERS High Pressure Safety Injection Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6	
α,	0.9859859	0.9780496	0.9727823	0.9685667	0.9647397	
α.2	1.40E-02	1.88E-02			2.66E-02	
α,		3.16E-03	4.82E-03	4.92E-03	4.23E-03 3.03E-03	
α.,			1.19E-03	2.40E-03		
a,				4.79E-04	1.21E-03	
α.,			and a second s		2.01E-04	

Table 31-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 31-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.86E-01	9.78E-01	9.73E-01	9.69E-01	9.65E-01
Beta	1.40E-02	2.20E-02	2.72E-02	3.14E-02	3.53E-02
Gamma		1.44E-01	2.21E-01	2.48E-01	2.46E-01
Delta			1.98E-01	3.69E-01	5.12E-01
Epsilon				1.66E-01	3.17E-01
Mu					1.43E-01

Table 31-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6	
Adj. Ind. Events	23.95	35.92	47.90	59.87	71.85	
N,	2.5323	3.0497	3.3202	3.3776	3.2245	
N ₂	0.3764	0.7486	1.1168	1.5432	2.0699 0.3289	
N,		0.1260	0.2537	0.3213		
N4			0.0626	0.1568	0.2356	
N ₅		and all on the second	Construction of the second second	0.0313	0.0939	
N,					0.0156	

Total Number of Independent Failure Events: 74 Total Number of Common-Cause Failure Events: 11

ALPHA FACTOR AND MGL PARAMETERS High Pressure Safety Injection Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6	
α,	0.9943181	0.9886125	0.9828025	0.9780968	0.9749604	
α,	5.68E-03	1.14E-02	1.72E-02	1.87E-02	1.90E-02	
α,		0.00E+00	DE+00 6.25E-06 3.20E-03		5.40E-03	
α.,			0.00E+00	0.00E+00	6.57E-04	
α _s			and the second se	0.00E+00	0.00E+00	
a.					0.00E+00	

Table 31-7: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Table 31-8: Summary of MGL Parameter Estimations - Fail to Remain Closed


MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.94E-01	9.89E-01	9.83E-01	9.78E-01	9.75E-01
Beta	5.68E-03	1.14E-02	1.72E-02	2.19E-02	2.50E-02
Gamma		0.00E+00	3.63E-04	1.46E-01	2.42E-01
Delta			0.00E+00	0.00E+00	1.08E-01
Epsilon				0.00E+00	0.00E+00
Mu	Contraction of the second second second second second	and a second second second	And the second se		0.00E+00


Table 31-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6	
Adj. Ind. Events	7.20	10.80	14.40	18.00	21.60	
Ni	0.8499	1.1371	1.3328	1.4653	1.5674	
N ₃	0.0460	0.1375	0.2752	0.3723	0.4510	
N,		0.0000	0.0001	0.0636	0.1284	
N,			0.0000	0.0000	0.0156	
N _s				0.0000	0.0000	
N ₆					0.0000	

Total Number of Independent Failure Events: 18 Total Number of Common-Cause Failure Events: 6

PWR HPSI MOVs

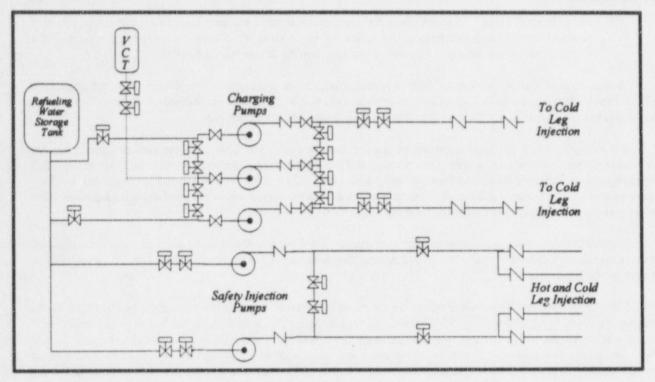



3. COMPONENT BOUNDARIES

The main components of a motor-operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual hand wheels, and can be manually operated. AC or DC power is required for valve operation.

The MOVs in the HPSI system are used in the following applications:

- Admitting borated water to the suction of the charging pumps and safety injection pumps,
- Shifting charging pump and safety injection pump suction to the containment sump, and
- Aligning discharge of safety injection pumps from cold leg to hot leg injection.

4. FAILURE EVENT DEFINITION

The function of the HPSI MOVs is to allow borated water flow through the HPSI system into the reactor coolant system. All valves serve as a system containment boundary and would need to close to isolate leaks. The failure modes used in evaluating the Safety Injection System MOV data are:

- CC Fail to Open: The valve must be in the fully open position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.

VR Fail to Remain Closed: In cases where the motor-operated valve has been closed for a substantial period of time and is then discovered leaking, the failure will be coded as VR. If the discovery is made soon after a system configuration change (i.e., pump operation), then the failure is coded as OO.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure. These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC."

Many LERs reported only one actual failure, but the report information indicated that failure of a second MOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 31-10 through 31-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of motor operated valves. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS High Pressure Safety Injection Motor-Operated Valves

Table 31-10:	Alpha Factor	Distribution	Summary	- Fail	to Onen	CCCC = 2	
CARACTERISATION AND A RESIDENCE AND A DESCRIPTION OF A DE	and the second se		the second second g	A 6621	io open,	UUU - 4	

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8760082	0.9246672	0.9276156	0.9632430	0.9213610	8.8490E+01	7.2093E+00
α,	3.68E-02	7.53E-02	7.24E-02	1.24E-01	7.86E-02	7.2093E+00	8.8490E+01

Table 31-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9004928	0.9372258	0.9392932	0.9668882	0.9355827	1.3160E+02	8.8144E+00
α,	3.61E-03	1.67E-02	1.45E-02	3.74E-02	1.57E-02	2.3447E+00	1.3807E+02
α,	2.12E-02	4.61E-02	4.39E-02	7.83E-02	4.87E-02	6.4697E+00	1.3395E+02

Table 31-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9094451	0.9401804	0.9417344	0.9656175	0.9386097	1.7740E+02	1.1287E+01
a2	8.35E-03	2.29E-02	2.13E-02	4.32E-02	2.32E-02	4.3276E+00	1.8436E+02
α,	7.16E-06	2.50E-03	1.08E-03	9.79E-03	1.28E-03	4.7150E-01	1.8822E+02
α,	1.58E-02	3.44E-02	3.28E-02	5.86E-02	3.69E-02	6.4881E+00	1.8220E+02

Table 31-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9163618	0.9428639	0.9440875	0.9651758	0.9412263	2.2658E+02	1.3730E+01
α,	8.90E-03	2.18E-02	2.05E-02	3.92E-02	2.25E-02	5.2374E+00	2.3507E+02
α,	8.89E-04	6.72E-03	5.41E-03	1.70E-02	6.00E-03	1.6136E+00	2.3870E+02
α.,	1.12E-07	1.23E-03	2.91E-04	5.64E-03	3.06E-04	2.9480E-01	2.4002E+02
a,	1.26E-02	2.74E-02	2.61E-02	4.66E-02	3.00E-02	6.5846E+00	2.3373E+02

Table 31-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9211586	0.9447612	0.9457806	0.9648946	0.9430793	2.7471E+02	1.6062E+01
α2	9.21E-03	2.09E-02	1.98E-02	3.62E-02	2.22E-02	6.0656E+00	2.8471E+02
α,	1.54E-03	7.62E-03	6.52E-03	1.74E-02	7.04E-03	2.2141E+00	2.8856E+02
α,	1.04E-04	2.98E-03	1.95E-03	9.38E-03	2.33E-03	8.6600E-01	2.8991E+02
as	2.81E-08	9.09E-04	1.78E-04	4.33E-03	8.83E-05	2.6430E-01	2.9051E+02
α,	1.06E-02	2.29E-02	2.18E-02	3.89E-02	2.52E-02	6.6519E+00	2.8412E+02

ALPHA FACTOR DISTRIBUTIONS High Pressure Safety Injection Motor-Operated Valves

Table 31-15	Alpha Factor	Distribution	Summary - 1	Fail	to (Close,	CCCG = 2	
-------------	--------------	--------------	-------------	------	------	--------	----------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	A CONSTRUCTION OF A CONSTRUCTO	b
		0.9770364	0.9849376	0.9992307	0.9859859	3.6012E+01	8.4640E-01
a ,	7.66E-04	2.30E-02	1.51E-02	7.21E-02	1.40E-02	8.4640E-01	3.6012E+01

Table 31-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
C.		0.9700132	0.9754375	0.9957255	0.9780496	5.4170E+01	1.6746E+00
a,	1.43E-03	2.03E-02	1.50E-02	5.77E-02	COLUMN ACCOUNTS OF A DESCRIPTION OF A DE	1.1358E+00	
α,	5.62E-05	9.65E-03	4.73E-03	3.59E-02	3.16E-03	5.3880E-01	5.5306E+01

Table 31-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
C.	And the second	0.9652512	0.9691281	0.9911345	0.9727823	7.5920E+01	2.7331E+00
a.	3.00E-03	2.12E-02	1.73E-02	5.29E-02	2.12E-02	1.6706E+00	7.6983E+01
<u> </u>	3.08E-05	6.56E-03	3.10E-03	2.49E-02	4.82E-03	5.1630E-01	7.8137E+0
α,	4.30E-05	6.94E-03	3.43E-03	2.58E-02	1.19E-03	5.4620E-01	7.8107E+0

Table 31-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
C.	0.9272028	0.9619165	0.9648071	0.9867360	0.9685667	1.0129E+02	4.0102E+00
a,	4.52E-03	2.16E-02	1.86E-02	4.87E-02	2.36E-02	2.2712E+00	1.0303E+02
α,	1.44E-04	6.96E-03	4.19E-03	2.32E-02	4.92E-03	7.3330E-01	1.0457E+0
α,	3.28E-06	3.71E-03	1.32E-03	1.55E-02	2.40E-03	3.9040E-01	1.0491E+0
a,	6.17E-05	5.84E-03	3.15E-03	2.08E-02	4.79E-04	6.1530E-01	1.0469E+0

Table 31-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
erendensennenenen en en erendet CL.	0.9280955	0.9597046	0.9620263	0.9833660	0.9647397	1.2555E+02	5.2715E+00
QL ₂	5.73E-03	2.18E-02	1.94E-02	4.60E-02	2.66E-02	2.8490E+00	1.2797E+02
α.,	2.36E-04	6.65E-03	4.36E-03	2.09E-02	4.23E-03	8.6950E-01	1.2995E+02
α,	2.63E-05	4.19E-03	2.07E-03	1.56E-02	3.03E-03	5.4830E-01	1.3027E+02
a,	7.60E-07	2.58E-03	7.54E-04	1.13E-02	1.21E-03	3.3720E-01	1.3048E+02
a,	7.47E-05	5.10E-03	2.90E-03	1.76E-02	2.01E-04	6.6750E-01	1.3015E+02

ALPHA FACTOR DISTRIBUTIONS High Pressure Safety Injection Motor-Operated Valves

Table 31-20: Alpha Factor Distribution Summary - Fai	ul to Remain Closed, CCC	CG = 2
--	--------------------------	--------

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α,	0.8931325	0.9714854	0.9861789	0.9998643	0.9943181	1.7580E+01	5.160E-01
α,	1.38E-04	2.85E-02	1.38E-02	1.07E-01	5.68E-03	5.160E-01	1.7580E+01

Table 31-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8994148	0.9666067	0.9769272	0.9985020	0.9886125	2.7137E+01	9.3750E-01
α,	9.68E-05	1.87E-02	9.07E-03	7.00E-02	1.14E-02	5.2470E-01	2.7550E+01
α,	1.93E-05	1.47E-02	5.65E-03	6.01E-02	0.00E+00	4.1280E-01	2.7662E+01

Table 31-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9056076	0.9625003	0.9695904	0.9950997	0.9828025	4.0433E+01	1.5753E+00
α,	6.17E-04	1.97E-02	1.28E-02	6.26E-02	1.72E-02	8.2900E-01	4.1179E+01
α,	1.84E-07	6.25E-03	1.22E J3	2.98E-02	6.25E-06	2.6270E-01	4.1746E+01
α,	3.85E-05	1.15E-02	5.16E-03	4.45E-02	0.00E+00	4.8360E-01	4.1525E+01

Table 31-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9118577	0.9600421	0.9650603	0.9910414	0.9780968	5.7507E+01	2.3935E+00
<u>a</u> 1	1.20E-03	1.84E-02	1.33E-02	5.27E-02	1.87E-02	1.1030E+00	5.8800E+01
α,	2.41E-05	7.94E-03	3.49E-03	3.10E-02	3.20E-03	4.7560E-01	5.9425E+01
α.4	3.04E-08	3.90E-03	5.96E-04	1.93E-02	0.00E+00	2.3360E-01	5.9667E+01
α,	8.26E-05	9.75E-03	5.08E-03	3.53E-02	0.00E+00	5.8400E-01	5.9317E+01

Table 31-24: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9169117	0.9593208	0.9632555	0.9882700	0.9749604	7.3639E+01	3.1226E+00
α,	1.33E-03	1.60E-02	1.21E-02	4.43E-02	1.90E-02	1.2301E+00	7.5532E+01
α,	1.29E-04	8.72E-03	4.98E-03	3.00E-02	5.40E-03	6.690E-01	7.6093E+01
α,	1.02E-06	4.28E-03	1.21E-03	1.90E-02	6.57E-04	3.2830E-01	7.6433E+01
α,	3.97E-08	3.17E-03	5.28E-04	1.55E-02	0.00E+00	2.4330E-01	7.6518E+01
α ₆	1.14E-04	8.49E-03	4.77E-03	2.95E-02	0.00E+00	6.5190E-01	7.6110E+01

32. PWR Low Pressure Safety Injection Motor-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving motor-operated valves (MOVs) in the low pressure safety injection (LPSI) system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified 13 common-cause failure-to-open events, six common-cause failure-to-close, and four failure-to-remain closed CCF events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 32-1 and 32-2, respectively. Table 32-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 32-4 through 32-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 32-10 through 32-24.

2. SYSTEM DESCRIPTION

The low pressure safety injection system (LPSI) is a subsystem of the emergency core cooling system (ECCS) that functions to provide emergency coolant injection to maintain reactor coolant inventory and provide adequate long term decay heat removal following a loss of coolant accident (LOCA). The low pressure safety injection function is performed over a relatively long time interval after initiation of the LOCA. The LPSI pumps inject directly into the primary loop cold legs and can be realigned to inject into the hot legs. The initial suction source for the LPSI pumps is the refueling water corage tank (RWST) which contains enough highly borated water to satisfy the injection needs of the core. During the recipient of the asterna safety injection pumps. These pumps also provide for the shutdown cooling function. Figure 32-1 illustrates the typical flow path for the LPSI system. The system is typically comprised of two high capacity centrifugal pumps. The pumps receive power from the 1E emergency power system and are backed up by the emergency diesel generators.

The system is normally aligned and in the standby mode. The LPSI pumps are started by the engineered safety features actuation system or may be manually actuated. A safety injection (SI) signal starts the pumps, aligns the pump suction to the RWST, and completes additional valve lineup changes. The injection phase ends when the RWST reaches the low level setpoint and the system is realigned for the recirculation phase. The number of LPSI MOVs is usually at east eight; some plant designs have multiple MOVs in series on the reactor coolant system (RCS) suction line.

ALPHA FACTOR AND MGL PARAMETERS PWR Low Pressure Safety Injection Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9910681	0.9863696	0.9851123	0.9839008	0.9826218
α,	8.93E-03	1.15E-02	9.04E-03	1.05E-02	1.17E-02
α,		2.17E-03	5.49E-03	2.50E-03	2.10E-03
α,			3.56E-04	3.02E-03	1.70E-03
a				1.04E-04	1.83E-03
α,					4.34E-05

Table 32-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 32-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.91E-01	9.86E-01	9.85E-01	9.84E-01	9.83E-01
Beta	8.93E-03	1.36E-02	1.49E-02	1.61E-02	1.74E-02
Gamma		1.59E-01	3.93E-01	3.49E-01	3.26E-01
Delta			6.09E-02	5.55E-01	6.29E-01
Epsilon				3.34E-02	5.24E-01
Mu					2.32E-02

Table 32-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	115.16	172.74	230.33	287.91	345.49
N ₁	5.8514	6.6975	7.4762	7.7578	7.6235
N ₂	1.0906	2.0856	2.1821	3.1479	4.2080
Ν,		0.3940	1.3258	0.7525	0.7556
N4			0.0860	0.9062	0.6095
N ₅				0.0313	0.6563
Ns		1			0.0156

Total Number of Independent Failure Events: 319 Total Number of Common-Cause Failure Events: 13

ALPHA FACTOR AND MGL PARAMETERS PWR Low Pressure Safety Injection Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG-6
α	0.9947762	0.9895297	0.9842125	0.9846306	0.9846113
α2	5.22E-03	1.05E-02	1.58E-02	1.08E-02	9.33E-03
α,		0.00E+00	0.00E+00	4.58E-03	4.25E-03
α.4			0.00E+00	0.00E+00	1.81E-03
α,				0.00E+00	0.00E+00
α,					0.00E+00

Table 32-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 32-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.95E-01	9.90E-01	9.84E-01	9.85E-01	9.85E-01
Beta	5.22E-03	1.05E-02	1.58E-02	1.54E-02	1.54E-02
Gamma		0.00E+00	0.00E+00	2.98E-01	3.94E-01
Delta			0.00E+00	0.00E+00	2.98E-01
Epsilon				0.00E+00	0.00E+00
Mu					0.00E+00

Table 32-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	47.66	71.48	95.31	119.14	142.96
N ₁	1.9472	2.1420	1.8176	1.8582	1.7819
N ₂	0.2605	0.7790	1.5580	1.3262	1.3716
Ν,		0.0000	0.0000	0.5625	0.6250
N,	and designeet of the analysis and an endowing the second of the designeet.		0.0000	0.0000	0.2656
N ₅		And an and a supervised of the second s		0.0000	0.0000
N ₆					0.0000

Total Number of Independent Failure Events: 127 Total Number of Common-Cause Failure Events: 6

ALPHA FACTOR AND MGL PARAMETERS PWR Low Pressure Safety Injection Motor-Operated Valves

T 11 22 7 6	- CAlaba Fastar	Decemptor Estimations	- Fail to Remain Closed
Table 32-7: Summar	of Alpha Factor	Parameter Estimations	- ran to Remain crosed

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9989834	0.9979804	0.9969734	0.9959494	0.9949434
α,	1.02E-03	2.02E-03	3.03E-03	4.05E-03	5.05E-03
α,		0.00E+00	0.00E+00	4.69E-06	3.91E-06
Q.			0.00E+00	0.00E+00	0.00E+00
α,				0.00E+00	0.00E+00
Q,					0.00E+00

Table 32-8: Summary of MGL Parameter Estimations - Fail to Remain Closed


MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.99E-01	9.98E-01	9.97E-01	9.96E-01	9.95E-01
Beta	1.02E-03	2.02E-03	3.03E-03	4.05E-03	5.06E-03
Gamma		0.00E+00	0.00E+00	1.16E-03	7.73E-04
Delta			0.00E+00	0.00E+00	0.00E+00
Epsilon			l	0.00E+00	0.00E+00
Mu					0.00E+00


Table 32-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	8.00	12.00	16.00	20.00	24.00
N ₁	0.5489	0.7982	1.0303	1.2437	1.4413
N ₂	0.0087	0.0259	0.0517	0.0863	0.1292
N,	AP 48 14 CANTON 147 COMPANY AND COMPANY AND	0.0000	0.0000	0.0001	0.0001
N4			0.0000	0.0000	0.0000
N,	and main way weak to could all of all the statistic line		A DESCRIPTION OF A	0.0000	0.0000
N ₆			1		0.0000

Total Number of Independent Failure Events: 24 Total Number of Common-Cause Failure Events: 4

PWR LPSI MOVs

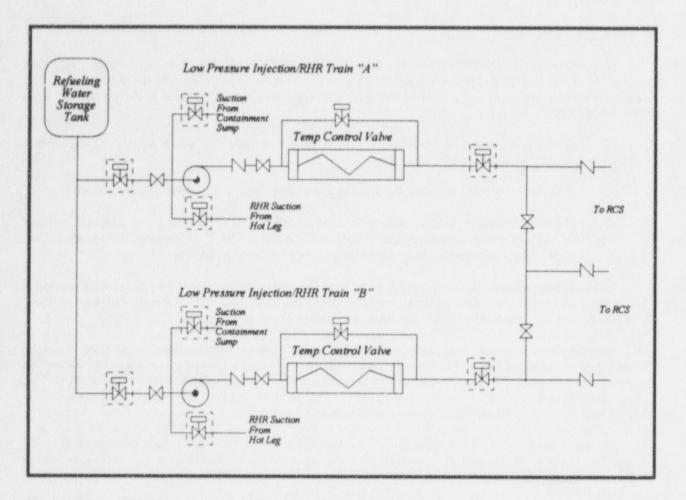



3. COMPONENT BOUNDARIES

The main components of a motor-operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual hand wheels, and can be manually operated. AC or DC power is required for valve operation.

The MOVs in the low pressure safety injection system are used in the following applications:

- Provide a suction source from the RWST,
- Allow shifting suction to the containment sump, and
- Allow a suction path from the RCS hot legs for shutdown cooling.

4. FAILURE EVENT DEFINITION

The function of the LPSI MOVs is to provide a suction from the RWST, allow shifting the suction to the containment sump at the end of the injection phase, and provide for a suction from the RCS hot leg. All valves serve as a system containment boundary and would need to close to isolate leaks. The failure modes used in evaluating the low pressure safety injection system MOV data are:

- CC Fail to Open: A successful operation of the valve is the valve is in the fully open position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Fail to Remain Closed: In cases where the motor-operated valve has been closed for a substantial period of time and is then discovered leaking, the failure will be coded as VR. If the discovery is made soon after a system configuration change (i.e., pump operation), then the failure is coded as OO.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. Stroke time testing failures were not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure. These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC."

Many LERs reported only one actual failure, but the report information indicated that failure of a second MOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 32-10 through 32-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of motor operated valves. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Low Pressure Safety Injection Motor-Operated Valves

Table 32-10: Alpha Factor Distribution Summary	- Fail to	Open,	CCCG = 2	
--	-----------	-------	----------	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
a.,	0.9697998	0.9881863	0.9905472	0.9985111	0.9910681	1.3054E+02	1.5606E+00
α,	1.49E-03	1.18E-02	9.46E-03	3.02E-02	8.93E-03	1.5606E+00	1.3054E+02

Table 32-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.9663049	0.9834296	0.9850282	0.9950897		1.9464E+02	3.2796E+00
α,	2.85E-03	1.25E-02	1.09E-02	2.76E-02	1.15E-02	2.4728E+00	1.9545E+02
α,	1.15E-04	4.08E-03	2.57E-03	1.32E-02	2.17E-03	8.0680E-01	1.9711E+02

Table 32-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α	0.9665105	0.9816985	0.9828842	0.9928278	0.9851123	2.6251E+02	4.8939E+00
α,	2.58E-03	1.02E-02	9.04E-03	2.20E-02	9.04E-03	2.7359E+00	2.6467E+02
α,	7.67E-04	5.94E-03	4.76E-03	1.51E-02	5.49E-03	1.5884E+00	2.6582E+02
α,	1.60E-05	2.13E-03	1.08E-03	7.80E-03	3.56E-04	5.6960E-01	2.6683E+02

Table 32-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9661996	0.9800429	0.9809737	0.9907010	0.9839008	3.3371E+02	6.7955E+00
α,	3.82E-03	1.14E-02	1.04E-02	2.22E-02	1.05E-02	3.8759E+00	3.3663E+02
α,	2.50E-04	3.42E-03	2.51E-03	9.70E-03	2.50E-03	1.1645E+00	3.3934E+02
α.,	2.34E-04	3.35E-03	2.44E-03	9.56E-03	3.02E-03	1.1398E+00	3.3937E+02
α,	1.90E-05	1.81E-03	9.70E-04	6.44E-03	1.04E-04	6.1530E-01	3.3989E+02

Table 32-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9658863	0.9787260	0.9794938	0.9889379	0.9826218	4.0359E+02	8.7726E+00
α,	4.78E-03	1.21E-02	1.13E-02	2.21E-02	1.17E-02	4.9871E+00	4.0738E+02
α,	2.85E-04	3.14E-03	2.39E-03	8.59E-03	2.10E-03	1.2962E+00	4.1107E+02
α,	9.31E-05	2.24E-03	1.50E-03	6.89E-03	1.70E-03	9.2220E-01	4.1144E+02
α,	8.48E-05	2.18E-03	1.45E-03	6.78E-03	1.83E-03	8.9960E-01	4.1146E+02
α,	2.36E-05	1.62E-03	9.17E-04	5.60E-03	4.34E-05	6.6750E-01	4.1170E+02

ALPHA FACTOR DISTRIBUTIONS Low Pressure Safety Injection Motor-Operated Valves

Table 32-15: Alpha Factor Distribution Summar	y - Fail to Close, $CCCG = 2$
---	-------------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.9593499	0.9877980	0.9926426	0.9997523	0.9947762	5.9137E+01	7.3050E-01
α2	2.51E-04	1.22E-02	7.36E-03	4.07E-02	5.22E-03	7.3050E-01	5.9137E+01

Table 32-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9556364	0.9825334	0.9859504	0.9977471	0.9895297	8.8822E+01	1.5790E+00
α,	9.54E-04	1.29E-02	9.53E-03	3.64E-02	1.05E-02	1.1662E+00	8.9235E+01
α,	5.88E-06	4.57E-03	1.73E-03	1.87E-02	0.00E+00	4.1280E-01	8.9988E+01

Table 32-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9516556	0.9770788	0.9795842	0.9939452	0.9842125	1.2183E+02	2.8580E+00
α,	3.25E-03	1.69E-02	1.44E-02	3.92E-02	1.58E-02	2.1118E+00	1.2258E+02
α,	6.09E-08	2.11E-03	4.08E-04	1.00E-02	0.00E+00	2.6260E-01	1.2443E+02
α.,	1.28E-05	3.88E-03	1.72E-03	1.51E-02	0.00E+00	4.8360E-01	1.2420E+02

Table 32-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9541340	0.9763866	0.9783132	0.9920707	0.9846306	1.5904E+02	3.8463E+00
α2	2.34E-03	1.26E-02	1.07E-02	2.95E-02	1.08E-02	2.0542E+00	1.6083E+02
α,	2.89E-04	5.98E-03	4.12E-03	1.80E-02	4.58E-03	9.7450E-01	1.6191E+02
α,	1.11E-08	1.43E-03	2.18E-04	7.08E-03	0.00E+00	2.3360E-01	1.6265E+02
as	3.01E-05	3.59E-03	1.86E-03	1.30E-02	0.00E+00	5.8400E-01	1.6230E+02

Table 32-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9560295	0.9760510	0.9776241	0.9907131	0.9846113	1.9521E+02	4.7898E+00
α	2.10E-03	1.08E-02	9.17E-03	2.48E-02	9.33E-03	2.1507E+00	1.9785E+02
α,	4.28E-04	5.83E-03	4.29E-03	1.65E-02	4.25E-03	1.1656E+00	1.9883E+02
α.4	2.32E-05	2.89E-03	1.49E-03	i.05E-02	1.81E-03	5.7830E-01	1.9942E+02
α,	1.51E-08	1.22E-03	2.02E-04	5.94E-03	0.00E+00	2.4330E-01	1.9976E+02
a.,	4.34E-05	3.26E-03	1.82E-03	1.14E-02	0.00E+00	6.5190E-01	1.9935E+02

ALPHA FACTOR DISTRIBUTIONS Low Pressure Safety Injection Motor-Operated Valves

Table 32-20: Alpha Factor Distribution Summary -	- Fail to Remain Closed,	CCCG = 2
--	--------------------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	æ	b
α,	0.9005178	0.9742048	0.9883199	0.9999129	0.9989834	1.8079E+01	4.7870E-01
α,	8.35E-05	2.58E-02	1.17E-02	9.95E-02	1.02E-03	4.7870E-01	1.8079E+01

Table 32-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor		Mean	Median	95th%	MLE	8	b
α,	0.9094715	0.9713467	0.9813354	0.9991028	0.9979804	2.7998E+01	8.2590E-01
α,	1.89E-05	1.43E-02	5.51E-03	5.86E-02	2.02E-03	4.1310E-01	2.8411E+01
α,	1.87E-05	1.43E-02	5.50E-03	5.86E-02	0.00E+00	4.1280E-01	2.8411E+01

Table 32-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.9166504	0.9686247	0.9755631	0.9968513	0.9969734	4.1730E+01	1.3517E+00
α.2	1.40E-04	1.41E-02	7.56E-03	5.01E-02	3.03E-03	6.0550E-01	4.2476E+01
α,	1.78E-07	6.10E-03	1.19E-03	2.91E-02	0.00E+00	2.6260E-01	4.2819E+01
¢1.4	3.75E-05	1.12E-02	5.03E-03	4.34E-02	0.00E+00	4.8360E-01	4.2598E+01

Table 32-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9226385	0.9666721	0.9716131	0.9937822	0.9959494	5.9286E+01	2.0440E+00
α,	3.90E-04	1.33E-02	8.49E-03	4.25E-02	4.05E-03	8.1430E-01	6.0516E+01
α,	8.58E-06	6.72E-03	2.55E-03	2.76E-02	4.69E-06	4.1210E-01	6.0918E+01
Ø.4	2.96E-08	3.81E-03	5.82E-04	1.88E-02	0.00E+00	2.3360E-01	6.1096E+01
α,	8.06E-05	9.52E-03	4.97E-03	3.44E-02	0.00E+00	5.8400E-01	6.0746E+01

Table 32-24: Alpha Factor Distribution S	mmary - Fail to Remain Closed, CCCG = 6
--	---

Alpha Factor	5th%	Mean	Median	95th%	MLE	R	b
α,	0.9274827	0.9661843	0.9700648	0.9916065	0.9949434	7.5913E+01	2.6569E+00
α,	4.66E-04	1.16E-02	7.76E-03	3.56E-02	5.05E-03	9.0830E-01	7.7662E+01
α.,	4.06E-05	6.88E-03	3.37E-03	2.56E-02	3.91E-06	5.4070E-01	7.8029E+01
α.	6.23E-07	3.98E-03	1.05E-03	1.80E-02	0.00E+00	3.1270E-01	7.8257E+01
α,	3.87E-08	3.10E-03	5.15E-04	1.51E-02	0.00E+00	2.4330E-01	7.8327E+01
a,	1.11E-04	8.30E-03	4.66E-03	2.89E-02	0.00E+00	6.5190E-01	7.7918E+01

33. PWR Containment Spray Motor Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common cause failure (CCF) parameters of various models using operational data involving motor operated valves (MOVs) in the containment spray system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common cause failure events. Failure modes analyzed are failure to open, failure to close and failure to remain open. The data cover the time period from 1980 through 1995.

The data review identified 12 common cause failure-to-open events, two common cause failure-to-close, and one failure-to-remain closed CCF event. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 33-1 and 33-2, respectively. Table 33-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 33-4 through 33-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 33-10 through 33-24.

2. SYSTEM DESCRIPTION

The containment spray system (CSS) is a subsystem of the emergency core cooling system (ECCS) that provides for the removal of heat and containment pressure control following a loss of coolant accident (LOCA) or a steamline break inside containment. Initially, water from the refueling water storage tank (RWST), and subsequently, primary coolant from the containment sump is pumped through spray headers in the top of the containment building. The CSS typically consists of two separate and complete trains with a vertically mounted centrifugal pump, valves, and piping connecting the pump suction to the refueling water storage tank (RWST), and valves to allow shifting the CSS pump suction to the containment sump. Power to the CSS pumps and valves is provided from the 1E electrical system, which is backed up by the 1E emergency diesels generators. Some plant designs provide a heat exchanger for cooling, others provide for a sodium hydroxide chemical addition to the CSS to improve the removal of iodine from the containment atmosphere, and some plants have both. The number of MOVs in the PWR containment spray system is typically six or eight, depending on plant-specific designs.

The CSS is normally in standby and is automatically started by the Engineered Safety Features Actuation System on high containment pressure. The CSS can be manually actuated from the main control panel. Figure 33-1 provides an illustration of a typical flow path for the containment spray system.

ALPHA FACTOR AND MGL PARAMETERS PWR Containment Spray Motor-Operated Valves

Table 33-1: Summary of Alpha Factor Parameter Estimations - Fa	ul to	Open	
--	-------	------	--

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9477037	0.9608982	0.9663222	0.9714503	0.9747696
α,	5.23E-02	5.34E-03	8.05E-03	5.54E-03	4.77E-03
α,		3.38E-02	3.69E-05	2.39E-03	2.26E-03
α ₄			2.56E-02	4.12E-06	9.26E-04
α,				2.06E-02	6.91E-07
α,		ave bit the district data and the second			1.73E-02

Table 33-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.48E-01	9.61E-011	9.66E-01	9.72E-01	9.75E-01
Beta	5.23E-02	3.91E-02	3.37E-02	2.86E-02	2.52E-02
Gamma		8.63E-01	7.61E-01	8.06E-01	8.11E-01
Delta		And a second	9.99E-01	8.96E-01	8.89E-01
Epsilon	and a second of a second s			1.00E+01	9.49E-01
Mu		a de Année a service de los		Contraction of the Contraction o	1.00E+00

Table 33-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	93.14	139.71	186.29	232.86	279.43
N ₁	2.3022	2.6610	2.4992	2.6958	2.7775
N2	5.2667	0.7915	1.5722	1.3429	1.3815
Ν,		5.0020	0.0072	0.5788	0.6548
N,			5.0002	0.0010	0.2680
N,				5.0000	0.0002
N ₆				ar management and and and an entry constrained on	5.0000

Total Number of Independent Failure Events: 163 Total Number of Common Cause Failure Events: 12

ALPHA FACTOR AND MGL PARAMETERS PWR Containment Spray Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9530411	0.9680902	0.9757544	0.9803788	0.9834611
α2	4.70E-02	1.59E-04	2.40E-04	3.22E-04	4.03E-04
α,		3.18E-02	0.00E+00	0.00E+00	0.00E+00
α.,	1		2.40E-02	0.00E+00	0.00E+00
α,				1.93E-02	0.00E+00
Ø.,					1.61E-02

Table 33-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 33-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.53E-01	9.68E-01	9.76E-01	9.80E-01	9.84E-01
Beta	4.70E-02	3.19E-02	2.43E-02	1.96E-02	1.65E-02
Gamma		9.95E-01	9.90E-01	9.84E-01	9.76E-01
Delta		And the second se	1.00E+00	1.00E+00	1.00E+00
Epsilon		A MANAGEMENT WITH THE ALL PROPERTY AND ADDRESS OF A		1.00E+00	1.00E+00
Mu					1.00E+00

Table 33-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	20.00	30.00	40.00	50.00	60.00
N ₁	0.3297	0.4900	0.6470	0.7997	0.9500
N ₂	1.0017	0.0050	0.0100	0.0167	0.0250
N ₃		1.0000	0.0000	0.0000	0.0000
N,			1.0000	0.0000	0.0000
N,			a barren aleman arren a series a series de la serie de la series de la series de la series de la series de la s	1.0000	0.0000
N,					1.0000

Total Number of Independent Failure Events: 50 Total Number of Common Cause Failure Events: 2

ALPHA FACTOR AND MGL PARAMETERS PWR Containment Spray Motor-Operated Valves

Table 33-7: Sun	nmary of Alpha	Factor Param	eter Estimations -	Fail to l	Remain Closed
	The second secon	POSTACE AND ADDRESS AND DESCRIPTION OF ADDRESS OF ADDRESS AND ADDRESS A	and the second se	CONTRACTOR AND ADDRESS OF THE ADDRESS OF	Comparison to their respects to the boundaries of the second s

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
æ,	0.9999303	0.9998677	0.9998096	0.9993864	0.9990451
α,	6.97E-05	1.29E-04	1.82E-04	5.97E-04	9.03E-04
œ,		3.58E-06	8.04E-06	1.72E-05	5.01E-05
a.			0.00E+00	0.00E+00	1.79E-06
αs			Contraction of the second seco	0.00E+00	0.00E+00
α					0.00E+00

Table 33-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	1.00E+01	1.00E+01	1.00E+01	9.99E-01	9.99E-01
Beta	6.97E-05	1.32E-04	1.90E-04	6.14E-04	9.55E-04
Gamma		2.70E-02	4.23E-02	2.80E-02	5.43E-02
Delta			0.00E+00	0.00E+00	3.45E-02
Epsilon		And a rest of the second s		0.00E+00	0.00E+00
Ми		And other derived descent of the book of the base		Construction and an action and an	0.00E+00

Table 33-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	18.50	27.75	37.00	46.25	55.50
N ₁	0.1476	0.2178	0.2858	0.3304	0.3668
N ₁	0.0013	0.0036	0.0068	0.0278	0.0505
N,		0.0001	0.0003	0.0008	0.0028
N.			0.0000	0.0000	0.0001
N,				0.0000	0.0000
N ₆			and a second		0.0000

Total Number of Independent Failure Events: 37 Total Number of Common Cause Failure Events: 1

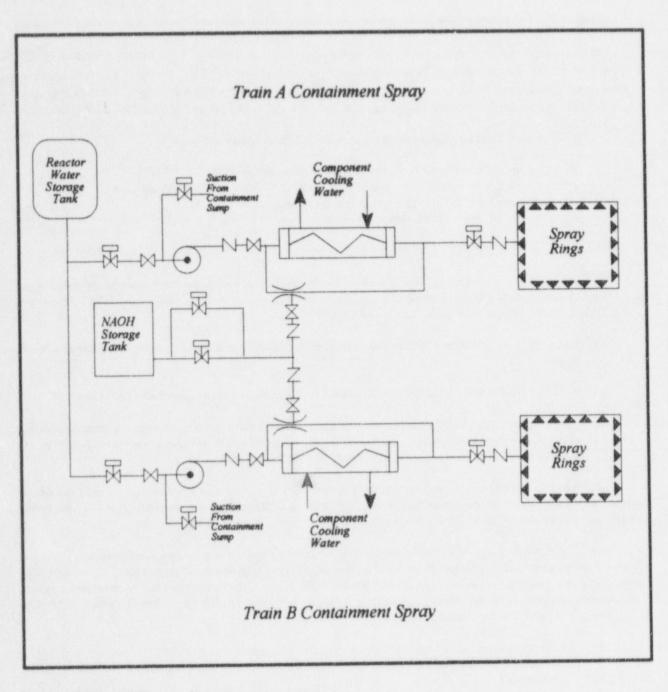


Figure 33-1. PWR containment spray system.

3. COMPONENT BOUNDARIES

The main components of a motor operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual handwheels, and can be manually operated. AC or DC power is required for valve operation.

The MOVs in the containment spray system are used in the following applications:

- admitting borated water to the containment spray system from the RWST ,
- shifting suction of the containment spray pumps from the RWST to the containment sump,
- admitting chemical addition to the containment spray, and
- admitting coolant to the containment spray rings.

4. FAILURE EVENT DEFINITION

The function of the containment spray MOVs is to allow borated water flow to the containment spray system spray rings. Some valves serve as a system containment boundary and would need to close to isolate leaks. The failure modes used in evaluating the containment spray system MOV data are:

- CC Fail to Open: The valve must be in the fully open position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Failure to Remain Closed: In cases where the motor operated valve has been closed for a substantial period of time and is then discovered leaking, the failure will be coded as VR. If the discovery is made soon after a system configuration change (i.e., pump operation), then the failure is coded as OO.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure. These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC."

Many LERs reported only one actual failure, but the report information indicated that failure of a second MOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 33-10 through 33-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of MOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS PWR Containment Spray Motor-Operated Valves

Table 33-10: Alpha Factor Distribution Sum	mary - Fail to Open, $CCCG = 2$
--	---------------------------------

Alphn Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9096740	0.9481811	0.9508659	0.9775176	0.9477037	1.0497E+02	5.7367E+00
12 ₂	2.25E-02	5.18E-02	4.91E-02	9.03E-02	5.23E-02	5.7367E+00	1.0497E+02

Table 33-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9319187	0.9598358	0.9616949	0.9814135	0.9608982	1.5757E+02	6.5935E+00
α,	5.40E-04	7.18E-03	5.30E-03	2.02E-02	5.34E-03	1.1787E+00	1.6299E+02
α.,	1.38E-02	3.30E-02	3.11E-02	5.86E-02	3.38E-02	5.4148E+00	1.5875E+02

Table 33-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9418620	0.9644052	0.9657984	0.9822022	0.9663222	2.1349E+02	7.8796E+00
α,	1.85E-03	9.60E-03	8.17E-03	2.23E-02	8.05E-03	2.1260E+00	2.1924E+02
α,	4.67E-08	1.22E-03	2.48E-04	5.77E-03	3.69E-05	2.6980E-01	2.2110E+02
α.,	1.04E-02	2.48E-02	2.34E-02	4.40E-02	2.56E-02	5.4838E+00	2.1589E+02

Table 33-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9498414	0.9685631	0.9696665	0.9835321	0.9714503	2.7360E+02	8.8803E+00
α,	1.37E-03	7.33E-03	6.21E-03	1.71E-02	5.54E-03	2.0709E+00	2.8041E+02
α,	1.76E-04	3.51E-03	2.43E-03	1.05E-02	2.39E-03	9.9080E-01	2.8149E+02
α,	6.75E-09	8.31E-04	1.27E-04	4.10E-03	4.12E-06	2.3460E-01	2.8225E+02
œ,	8.35E-03	1.98E-02	1.86E-02	3.50E-02	2.06E-02	5.5840E+00	2.7690E+02

Table 33-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9550789	0.9712942	0.9722056	0.9843916	0.9747696	3.3268E+02	9.8321E+00
α,	1.24E-03	6.31E-03	5.38E-03	1.46E-02	4.77E-03	2.1606E+00	3.4035E+02
α,	2.70E-04	3.49E-03	2.58E-03	9.81E-03	2.26E-03	1.1954E+00	3.4132E+02
α,	1.38E-05	1.70E-03	8.73E-04	6.17E-03	9.26E-04	5.8070E-01	3.4193E+02
α,	8.92E-09	7.11E-04	1.18E-04	3.47E-03	6.91E-07	2.4350E-01	3.4227E+02
α ₆	7.01E-03	1.65E-02	1.56E-02	2.92E-02	1.73E-02	5.6519E+00	3.3686E+02

ALPHA FACTOR DISTRIBUTIONS PWR Containment Spray Motor-Operated Valves

Table 33-15: Alpha Facto	or Distribution Summa	ry - Fail to Close	, $CCCG = 2$
--------------------------	-----------------------	--------------------	--------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8796665	0.9530284	0.9623470	0.9944572	0.9530411	2.9860E+01	1.4717E+00
α	5.54E-03	4.70E-02	3.77E-02	1.20E-01	4.70E-02	1.4717E+00	2.9860E+01

Table 33-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9084668	0.9619960	0.9682995	0.9939442	0.9680902	4.5690E+01	1.8050E+00
α,	7.60E-06	8.26E-03	2.97E-03	3.45E-02	'.59E-04	3.9220E-01	4.7103E+01
α,	3.23E-03	2.98E-02	2.34E-02	7.79E-02	3.18E-02	1.4128E+00	4.6082E+01

Table 33-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9236851	0.9658572	0.9703456	0.9926585	0.9757544	6.5347E+01	2.310E+00
α,	6.00E-05	8.33E-03	4.23E-03	3.06E-02	2.40E-04	5.6380E-01	6.7093E+01
α,	1.13E-07	3.88E-03	7.54E-04	1.85E-02	0.00E+00	2.6260E-01	6.7394E+01
α,	2.57E-03	2.19E-02	1.74E-02	5.67E-02	2.40E-02	1.4836E+00	6.6173E+01

Table 33-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9327042	0.9676060	0.9709429	0.9910865	0.9803788	8.8842E+01	2.9743E+00
a,	1.77E-04	8.11E-03	4.93E-03	2.69E-02	3.22E-04	7.4470E-01	9.1072E+01
α.,	5.70E-06	4.49E-03	1.70E-03	1.84E-02	0.00E+00	4.1200E-01	9.1404E+01
œ4	1.97E-08	2.54E-03	3.87E-04	1.26E-02	0.00E+00	2.3360E-01	9.1583E+01
a,	2.24E-03	1.73E-02	1.39E-02	4.38E-02	1.93E-02	1.5840E+00	9.0232E+01

Table 33-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9388505	0.9691005	0.9717805	0.9901727	0.9834611	1.1142E+02	3.5526E+00
a	1.96E-04	6.99E-03	4.42E-03	2.26E-02	4.03E-04	8.0410E-01	1.1417E+02
α,	2.76E-05	4.70E-03	2.30E-03	1.75E-02	0.00E+00	5.4060E-01	1.1443E+02
α,	4.25E-07	2.72E-03	7.12E-04	1.23E-02	0.00E+00	3.1270E-01	1.1466E+02
α,	2.64E-08	2.12E-03	3.51E-04	1.03E-02	0.00E+00	2.4330E-01	1.1473E+02
α,	1.98E-03	1.44E-02	1.17E-02	3.60E-02	1.61E-02	1.6519E+00	1.1332E+02

ALPHA FACTOR DISTRIBUTIONS PWR Containment Spray Motor-Operated Valves

Table 33-20: Alpha Factor Distribution Summar	y - Fail to Remain Closed,	CCCG = 2
---	----------------------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
a	0.9359135	0.9835494	0.9927546	0.9999487	0.9999303	2.8178E+01	4.7130E-01
α	4.81E-05	1.65E-02	7.25E-03	6.41E-02	6.97E-05	4.7130E-01	2.8178E+01

Table 33-21: Alpha Factor Distribution Summary -Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.9413607	0.9817224	0.9883440	0.9994792	0.9998677	4.3168E+01	8.0370E-01
α,	7.99E-06	8.89E-03	3.18E-03	3.71E-02	1.29E-04	3.9080E-01	4.3581E+01
α,	1.22E-05	9.39E-03	3.58E-03	3.85E-02	3.58E-06	4.1290E-01	4.3559E+01

Table 33-22: Alpha Factor Distribution Summary -Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9442117	0.9793485	0.9841492	0.9980660	0.9998096	6.1986E+01	1.3071E+00
α,	6.22E-05	8.86E-03	4.48E-03	3.25E-02	1.82E-04	5.6060E-01	6.2733E+01
α,	1.22E-07	4.15E-03	8.09E-04	1.98E-02	8.04E-06	2.6290E-01	6.3030E+01
α,	2.54E-05	7.64E-03	3.41E-03	2.96E-02	0.00E+00	4.8360E-01	6.2810E+01

Table 33-23: Alpha Factor Distribution Summary -Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.9460345	0.9770668	0.9806347	0.9959015	0.9993864	8.4622E+01	1.9862E+00
α,	2.00E-04	8.73E-03	5.35E-03	2.88E-02	5.97E-04	7.5580E-01	8.5852E+01
α,	6.14E-06	4.77E-03	1.81E-03	1.96E-02	1.72E-05	4.1280E-01	8.6195E+01
α,	2.09E-08	2.70E-03	4.11E-04	1.33E-02	0.00E+00	2.3360E-01	8.6375E+01
α _s	5.69E-05	6.74E-03	3.51E-03	2.44E-02	0.00E+00	5.8400E-01	8.6024E+01

Table 33-24: Alpha Factor Distribution Summary -Fail to Remain Closed, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9485313	0.9763039	0.9791602	0.9943121	0.9990451	1.0634E+02	2.5810E+00
α,	2.35E-04	7.62E-03	4.89E-03	2.43E-02	9.03E-04	8.2960E-01	1.0809E+02
α,	3.01E-05	4.99E-03	2.45E-03	1.86E-02	5.01E-05	5.4340E-01	1.0838E+02
α,	4.50E-07	2.87E-03	7.53E-04	1.30E-02	1.79E-06	3.1280E-01	1.0861E+02
a,	2.79E-08	2.23E-03	3.71E-04	1.09E-02	0.00E+00	2.4330E-01	1.0868E+02
α	8.00E-05	5.99E-03	3.35E-03	2.08E-02	0.00E+00	6.5190E-01	1.0827E+02

34. PWR Auxiliary Feedwater Motor-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving motor-operated valves (MOVs) in the auxiliary feedwater (AFW) system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed. The data cover the time period from 1980 through 1995.

The data review identified 12 common-cause failure-to-open events, 11 common-cause failure-to-close events, and four failure-to-remain closed CCF events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple C---ek letter (MGL) parameters for failure to open are shown in Tables 34-1 and 34-2, respectively. Table 34-3 contains he attracted impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 34-4 u_ough 34-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ϵ), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 34-10 through 34-24.

2. SYSTEM DESCRIPTION

The auxiliary feedwater system provides a source of feedwater to the steam generators to remove decay heat from the reactor coolant system (RCS) when: (a) the main feedwater system is not available, and (b) RCS pressure is too high to permit heat removal by the residual heat removal (RHR) system. The AFW system is typically comprised of two motordriven, full capacity pumps and a steam driven, double capacity pump along with valves and control systems to allow control of steam generator level and feedwater flow rate. The motor-driven pumps are supplied power from the 1E class power system with backup power available from the 1E emergency diesel generators (EDG). The water supply for the system is from the condensate storage tank (CST) with a backup source of water (untreated) available from the service water system.

The AFW system is normally in standby, regardless of whether the plant is at power or shutdown. The motor-driven pumps start on one of the following conditions: a safety injection (SI) signal, a low-low level in any steam generator, loss of both main feedwater pumps (MFP), a loss of off-site power (LOSP) or manual initiation. The turbine-driven pump will start on either a low-low level in more than one steam generator or a loss of off-site power. Flow to the steam generators is a two stage process at some plants. First the pumps start on demand from a steam generator low level signal. Control valves regulate the flow as needed. Feedwater flow to the steam generators is controlled from the main control room by air, motor, or hydraulically operated valves. Motor-driven pump runout is controlled by an air or hydraulically controlled regulator valve on the pump discharge. The turbine-driven pump steam supply is controlled by air or hydraulically operated valves. Figure 34-1 shows a typical auxiliary feedwater system. The manber of MOVs in the AFW system ranges from four to cight, depending on the number of steam generators and pump types.

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
αι	0.9787183	0.9624049	0.9624494	0.9622645	0.9653305
a2	2.13E-02	2.84E-02	1.76E-02	1.86E-02	1.31E-02
a,		9.22E-03	1.40E-02	4.94E-03	8.35E-03
œ₄			5.95E-03	9.70E-03	1.93E-03
a,				4.49E-03	7.67E-03
a.				1	3.62E-03

Table 34-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Table 34-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.79E-01	9.62E-01	9.62E-01	9.62E-01	9.65E-01
Beta	2.13E-02	3.76E-02	3.76E-02	3.77E-02	3.47E-02
Gamma		2.45E-01	5.32E-01	5.07E-01	6.22E-01
Delta			2.98E-01	7.42E-01	6.13E-01
Epsilon			And the second design was reacted as a sub-	3.17E-01	8.54E-01
Mu					3.20E-01

Table 34-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	94.91	142.36	189.82	237.27	284.73
N ₁	6.7249	4.7150	3.9251	2.5574	2.0497
\mathbb{N}_2	2.2100	4.3369	3.5388	4.6356	3.8931
N,	Contraction of the second s	1.4084	2.8228	1.2323	2.4790
N4			1.1975	2.4176	0.5742
Ns				1.1194	2.2789
N ₆					1.0744

Total Number of Independent Failure Events: 261 Total Number of Common-Cause Failure Events: 12

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9710148	0.9464114	0.9408460	0.9438771	0.9459012
a.,	2.º0E-02	4.32E-02	3.53E-02	2.65E-02	2.20E-02
α,		1.04E-02	1.74E-02	1.31E-02	1.32E-02
α.			6.51E-03	1.15E-02	5.80E-03
ü,		And have a second of the secon		5.01E-03	8.94E-03
a.					4.12E-03

Table 34-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 34-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.71E-01	9.46E-01	9.41E-01	9.44E-01	9.46E-01
Beta	2.90E-02	5.36E-02	5.92E-02	5.61E-02	5.41E-02
Gamma		1.94E-01	4.04E-01	5.28E-01	5.93E-01
Deita			2.73E-01	5.57E-01	5.88E-01
Epsilon		AN AN ADDRESS OF ADDRE		3.04E-01	6.92E-01
Mu	1				3.15E-01

Table 34-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	37.94	56.92	75.89	94.86	113.83
N ₁	4.9673	4.0853	3.5190	3.2446	2.9712
N ₂	1.2808	2.7855	2.9771	2.7547	2.7217
N,		0.6688	1.4658	1.3655	1.6300
N,		a an at the part of a state of the second data at the second d	0.5498	1.1924	0.7165
N ₅	******			0.5207	1.1038
N ₆					0.5082

Total Number of Independent Failure Events: 107 Total Number of Common-Cause Failure Events: 11

ALPHA FACTOR AND MGL PARAMETERS Auxiliary Feedwater Motor-Operated Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG==6
α _i	0.9996404	0.9992960	0.9989821	0.9986779	0.9983941
α,	3.60E-04	6.92E-04	9.88E-04	1.27E-03	1.51E-03
α,		1.18E-05	2.95E-05	5.67E-05	9.05E-05
α,			0.00E+00	0.00E+00	1.97E-06
α,				0.00E+00	0.00E+00
a.			an contrar and statement of the line and the second of the second		0.00E+00

Table 34-7: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Table 34-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	1.00E+01	9.99E-01	9.99E-01	9.99E-01	9.98E-01
Beta	3.60E-04	7.04E-04	1.02E-03	1.32E-03	1.61E-03
Gamma		1.68E-02	2.90E-02	4.29E-02	5.76E-02
Delta			0.00E+00	0.00E+00	2.13E-02
Epsilon				0.00E+00	0.00E+00
Mu					0.00E+00

Table 34-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG
Adj. Ind. Events	16.62	24.92	33.23	41.54	49.85
N ₁	0.3376	0.4893	0.6302	0.7604	0.8821
N ₂	0.0061	0.0176	0.0335	0.0536	0.0769
N ₃		0.0003	0.0010	0.0024	0.0046
N4			0.0000	0.0000	0.0001
Ns				0.0000	0.0000
Ns			an a		0.0000

Total Number of Independent Failure Events: 54 Total Number of Common-Cause Failure Events: 4

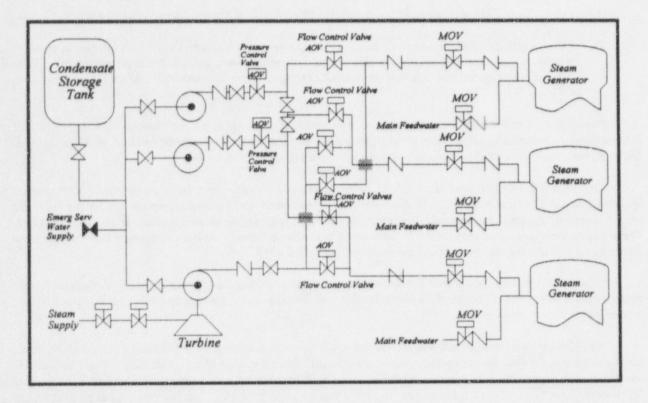


Figure 34-1. PWR auxiliary feedwater system.

3. COMPONENT BOUNDARIES

The main components of a motor-operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual handwheels, and can be manually operated. AC or DC power is required for valve operation.

The MOVs in the auxiliary feedwater system are used in the following applications:

- Supply or isolation of AFW flow to individual steam generators, and
- Supply of condensate to the AFW pumps.

4. FAILURE EVENT DEFINITION

The function of the auxiliary feedwater MOVs is to allow feedwater flow to the steam generators or to isolate flow to individual steam generators. All valves serve as a system containment boundary and would need to close to isolate leaks. The failure modes used in evaluating the auxiliary feedwater MOV data are:

CC Fail to Open: The valve must be in the fully open position. Anything less than fully open is considered a failure to open.

- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Fail to Remain Closed: In cases where the motor-operated valve has been closed for a substantial period of time and is then discovered leaking or unable to pass a surveillance test, the failure will be coded as VR. If the discovery is made soon after a system configuration change (i.e., pump operation), then the failure is coded as OO.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware confinitions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure. These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC."

Many LERs reported only one actual failure, but the report information indicated that failure of a second MOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 34-10 through 34-24 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of AFW MOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Auxiliary Feedwater Motor-Operated Valves

Table 54-10. Alpha Factor Distribution Summary - Fan to Open, CCCG - 2								
Alpha Factor	5th%	Mean	Median	95th%	MLE	8.	b	
α,	0.9494295	0.9764603	0.9791964	0.9941394	0.9787183	1.1117E+02	2.680E+00	
CL.	5.86E-03	2.35E-02	2.08E-02	5.06E-02	2.13E-02	2.680E+00	1.1117E+02	

Table 34-10: Alpha Factor Distribution Summary - Fail to Open, CCCG = 2

Table 34-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α	0.9341490	0.9612303	0.9630426	0.9821297	0.9624049	1.6228E+02	6.5453E+00
α,	1.08E-02	2.80E-02	2.61E-02	5.15E-02	2.84E-02	4.7241E+00	1.6410E+02
α,	1.71E-03	1.08E-02	8.93E-03	2.62E-02	9.22E-03	1.8212E+00	1.6700E+02

Table 34-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9379049	0.9610262	0.9623698	0.9795561	0.9624494	2.1845E+02	8.8591E+00
2 ₂	6.30E-03	1.80E-02	1.66E-02	3.45E-02	1.76E-02	4.0926E+00	2.2322E+02
α,	3.82E-03	1.36E-02	1.22E-02	2.81E-02	1.40E-02	3.0854E+00	2.2422E+02
α,	1.04E-03	7.40E-03	6.01E-03	1.85E-02	5.95E-03	1.6811E+00	2.2563E+02

Table 34-13: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9403213	0.9607150	0.9617755	0.9774994	0.9622645	2.7787E+02	1.1363E+01
α,	7.66E-03	1.85E-02	1.75E-02	3.32E-02	1.86E-02	5.3636E+00	2.8387E+02
α,	7.74E-04	5.69E-03	4.59E-03	1.43E-02	4.94E-03	1.6443E+00	2.8759E+02
α.4	2.24E-03	9.17E-03	8.06E-03	1.99E-02	9.70E-03	2.6512E+00	2.8658E+02
a,	8.45E-04	5.89E-03	4.80E-03	1.47E-02	4.49E-03	1.7034E+00	2.8753E+02

Table 34-14: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

					and the second	In the second state of the second		
Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b	
α,	0.9454938	0.9633589	0.9642417	0.9782201	0.9653305	3.3725E+02	1.2827E+01	
α2	5.08E-03	1.34E-02	1.24E-02	2.47E-02	1.31E-02	4.6722E+00	3.4541E+02	
α,	2.38E-03	8.63E-03	7.71E-03	1.80E-02	8.35E-03	3.0196E+00	3.4706E+02	
α.,	9.47E-05	2.53E-03	1.67E-03	7.91E-03	1.93E-03	8.8690E-01	3.4919E+02	
a,	1.67E-03	7.21E-03	6.29E-03	1.59E-02	7.67E-03	2.5222E+00	3.4756E+02	
CL.	7.21E-04	4.93E-03	4.03E-03	1.22E-02	3.62E-03	1.7263E+00	3.4835E+02	

ALPHA FACTOR DISTRIBUTIONS Auxiliary Feedwater Motor-Operated Valves

able 54-15. Alpha lactor Distribution Summary -1 an to close, coop w	Table 34-15:	Alpha Factor Distribution Summar	ry - Fail to Close, $CCCG = 2$
--	--------------	----------------------------------	--------------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9212071	0.9676902	0.9732668	0.9950811	0.9710148	5.2437E+01	1.7508E+00
α,	4.92E-03	3.23E-02	2.67E-02	7.88E-02	2.90E-02	1.7508E+00	5.2437E+01

Table 34-16: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9009675	0.9471248	0.9508013	0.9807118	0.9464114	7.6205E+01	4.2543E+00
a.,	1.15E-02	3.94E-02	3.57E-02	8.02E-02	4.32E-02	3.1727E+00	7.7287E+01
α,	8.43E-04	1.34E-02	9.68E-03	3.89E-02	1.04E-02	1.0816E+00	7.9378E+01

Table 34-17: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9028653	0.9430023	0.9456620	0.9740403	0.9408460	1.0411E+02	6.2927E+00
α,	1.01E-02	3.20E-02	2.92E-02	6.34E-02	3.53E-02	3.5309E+00	1.0687E+02
α,	2.31E-03	1.57E-02	1.28E-02	3.86E-02	1.74E-02	1.7284E+00	1.0867E+02
α.	5.25E-04	9.36E-03	6.61E-03	2.76E-02	6.51E-03	1.0334E+00	1.0937E+02

Table 34-18: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9118292	0.9458743	0.9479294	0.9728941	0.9438771	1.3615E+02	7.7909E+00
α,	7.55E-03	2.42E-02	2.20E-02	4.83E-02	2.65E-02	3.4827E+00	1.4046E+02
α,	1.89E-03	1.24E-02	1.02E-02	3.03E-02	1.31E-02	1.7775E+00	1.4216E+02
α.,	1.08E-03	9.91E-03	7.75E-03	2.61E-02	1.15E-02	1.4260E+00	1.4252E+02
α,	5.02E-04	7.68E-03	5.55E-03	2.21E-02	5.01E-03	1.1047E+00	1.4284E+02

Table 34-19: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.9177781	0.9478246	0.9495081	0.9721128	0.9459012	1.6727E+02	9.2078E+00
α.,	6.20E-03	1.98E-02	1.81E-02	3.96E-02	2.20E-02	3.5080E+00	1.7298E+02
α,	2.43E-03	1.23E-02	1.05E-02	2.83E-02	1.32E-02	2.1706E+00	1.7431E+02
α,	3.23E-04	5.83E-03	4.10E-03	1.72E-02	5.80E-03	1.0292E+00	1.7545E+02
a _s	7.47E-04	7.63E-03	5.87E-03	2.05E-02	8.94E-03	1.3471E+00	1.7513E+02
α.,	4.78E-04	6.57E-03	4.83E-03	1.86E-02	4.12E-03	1.1601E+00	1.7532E+02

NUREG/CR-5497

0

ALPHA FACTOR DISTRIBUTIONS Auxiliary Feedwater Motor-Operated Valves

Table 34-20: AI	pha Factor	Distribution S	Summary	- Fail to F	Remain	Closed.	CCCG = 2	

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9315031	0.9823432	0.9921322	0.9999420	0.9996404	2.6488E+01	4.7610E-01
α,	5.47E-05	1.77E-02	7.87E-03	6.85E-02	3.60E-04	4.7610E-01	2.6488E+01

Table 34-21: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9371050	0.9802568	0.9872858	0.9994053	0.9992960	4.0609E+01	8.1790E-01
α	1.12E-05	9.77E-03	3.65E-03	4.03E-02	6.92E-04	4.0480E-01	4.1022E+01
α,	1.30E-05	9.97E-03	3.81E-03	4.08E-02	1.18E-05	4.1310E-0!	4.1014E+01

Table 34-22: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.9402808	0.9777191	0.9827851	0.9978276	0.9989821	5.8560E+01	1.3345E+00
α,	8.51E-05	9.81E-03	5.14E-03	3.54E-02	9.88E-04	5.8730E-01	5.9307E+01
α,	1.33E-07	4.40E-03	8.62E-04	2.10E-02	2.95E-05	2.6360E-01	5.9631E+01
α.,	2.69E-05	8.07E-03	3.60E-03	3.13E-02	0.00E+00	4.8360E-01	5.9411E+01

Table 34-23: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.9427507	0.9755499	0.9792933	0.9955501	0.9986779	8.0342E+01	2.0136E+00
α,	2.44E-04	9.49E-03	5.92E-03	3.09E-02	1.27E-03	7.8160E-01	8.1574E+01
α,	6.65E-06	5.03E-03	1.91E-03	2.06E-02	5.67E-05	4.1440E-01	8.1941E+01
α,	2.20E-08	2.84E-03	4.32E-04	1.40E-02	0.00E+00	2.3360E-01	8.2122E+01
α,	5.98E-05	7.09E-03	3.69E-03	2.57E-02	0.00E+00	5.8400E-01	8.1772E+01

Table 34-24: A	Jpha Factor	Distribution	Summary	- Fail to	Remain	Closed,	CCCG = 6	

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9456136	0.9748654	0.9778547	0.9939016	0.9983941	1.0120E+02	2.6092E+00
α,	2.80E-04	8.25E-03	5.38E-03	2.60E-02	1.51E-03	8.5600E-01	1.0295E+02
α,	3.22E-05	5.25E-03	2.59E-03	1.95E-02	9.05E-05	5.4520E-01	1.0326E+02
α,	4.72E-07	3.01E-03	7.90E-04	1.36E-02	1.97E-06	3.1280E-01	1.0350E+02
as	2 93E-08	2.34E-03	3.89E-04	1.14E-02	0.00E+00	2.4330E-01	1.0357E+02
α,	8.39E-05	6.28E-03	3.52E-03	2.19E-02	0.00E+00	6.5190E-01	1.0316E+02

35. Pressurizer PORV Motor-Operated Block Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving the pressurizer relief valve motor-operated block valves (MOVs) in the primary coolant system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open and failure to close. The data cover the time period from 1980 through 1995.

The data review identified one common-cause failure-to-open event and five common-cause failure-to-close, and one common-cause failure-to-remain-closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to close are shown in Tables 35-1 and 35-2, respectively. Table 35-3 contains the average impact vectors (N₁-N₃) and the number of adjusted independent events for this failure mode. Tables 35-4 through 35-9 contain the corresponding information for the failure to close failure mode. The size of the affected population of block MOVs is denoted as CCCG and is either two or three for all plants. The alpha factor model parameters are denoted by α_1 - α_3 . Beta (β) and gamma (γ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 35-10 through 35-15.

2. SYSTEM DESCRIPTION

1

The pressurizer power operated relief valves (PORV) automatically actuate to lower pressure in the event of a power mismatch that causes high reactor pressure. The PORVs are not required in order to prevent over pressurization but rather function to increase plant operability. Pressurizer safety valves, with setpoints higher than the PORVs, are used for over pressure protection. The discharge from both the PORVs and the safety valves goes to the pressurizer relief tank (PRT). The PORVs may also be remotely actuated manually. During shutdown conditions the PORVs may provide cold over pressure protection. In order to provide cold over pressure protection, operator action is required to reset the automatic lift setpoints.

Motor operated block valves are located between the pressurizer and the PORV, and function to isolate the PORVs in the event of leakage through the PORVs and, thus, out of the primary coolant system. Figure 35-1 illustrates a typical configuration of pressurizer PORVs, safety valves, and the block MOVs. There are either two or three PORVs on a pressurizer, so each plant will have two or three block MOVs.

ALPHA FACTOR AND MGL PARAMETERS Pressurizer PORV Block Motor-Operated Valves

Table 35-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Alpha Factor	CCCG=2	CCCG=3
α,	0.9814815	0.9875776
œ,	1.85E-02	0.00E+00
α,	annon a darra chaire dhach chèine dhach chèine ann an taonach an taonach an taonach ann an an taonach ann an ta	1.24E-02

Table 35-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameters	CCCG=2	CCCG=3
1-Beta	9.82E-01	9.88E-01
Beta	1.85E-02	1.24E-02
Gamma		1.00E+00

Table 35-3: Summary of average Impact Vectors - Fail to Open

Avg. Impact Vectors	CCCG=2	CCCG=3
Adj. Ind. Events	53.00	79.50
N ₁	0.0000	0.0000
N ₂	1.0000	0.0000
N ₃		1.0000

Total Number of Independent Failure Events: 53 Total Number of Common-Cause Failure Events: 1

NUREG/CR-5497

ALPHA FACTOR AND MGL PARAMETERS Pressurizer PORV Block Motor-Operated Valves

Table 35-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Alpha Factor	CCCG=2	CCCG=3
α,	0.9790023	0.9781485
α,	2.10E-02	1.05E-02
α,		1.13E-02

Table 35-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCGro3
1-Beta	9.79E-01	9.78E-01
Beta	2.10E-02	2.19Ė-02
Gamma	and an an and a second seco	5.18E-01

Table 35-6: Summary of average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3
Adj. Ind. Events	81.82	122.73
N ₁	1.9403	1.4440
N ₂	1.7965	1.3360
N,		1.4380

Total Number of Independent Failure Events: 90 Total Number of Common-Cause Failure Events: 5

ALPHA FACTOR AND MGL PARAMETERS Pressurizer PORV Block Motor-Operated Valves

Table	35-7.	Summary	of Al	pha	Factor	Parameter	Estimations -	- Fai	1 to	Remain	Closed	
Table	17-/	SLL IIIIALV		DING	racion	I GUI GUILINENI	Proversion and a second				and the second se	÷

Alpha Factor	CCCG=2	CCCG=3
α,	0.9991797	0.9984675
۵,	8.20E-04	1.48E-03
G ₁	and an a barrach special and an	5.47E-05

Table 35-8: Summary of MGL Parameter Estimations -Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3
1-Beta	9.99E-01	9.99E-01
Beta	8.20E-04	1.53E-03
Gamma		3.57E-02

Table 35-9: Summary of average Impact Vectors -Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3
Adj. Ind. Events	12.00	18.00
N ₁	0.1800	0.2430
N ₁	0.0100	0.0270
N,	namen and an	0.0010

Total Number of Independent Failure Events: 12 Total Number of Common-Cause Failure Events: 1

Pressurizer PORV Block MOVs

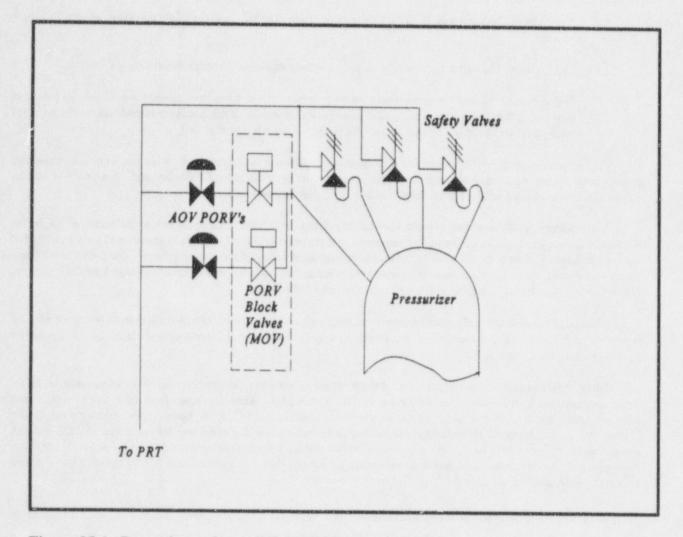


Figure 35-1. Pressurizer safety, relief, and PORV block valves.

3. COMPONENT BOUNDARIES

The main components of a motor-operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual handwheels, and can be manually operated. AC or DC power is required for valve operation.

The PORV block MOVs are used to isolate the PORVs to prevent the loss of primary coolant. They are normally open. The block MOVs would be closed remotely manually if the associated PORV leaks, or doesn't reseat fully following a transient.

4. FAILURE EVENT DEFINITION

The function of the PORV block MOVs is to isolate leakage from the primary coolant system through the PORV. The failure modes used in evaluating the PORV block MOV data are:

- CC Fail to Open: The valve must be in the fully open position. Anything less than fully open is considered a failure to open.
- OO Fail to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Fail to Remain Closed: In cases where the motor-operated valve has been closed for a substantial period of time and is then discovered leaking, the failure is coded as VR. If the discovery is made soon after a system configuration change (i.e., pump operation), then the failure is coded as OO.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open or closed state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure. These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC."

Many LERs reported only one actual failure, but the report information indicated that failure of a second block MOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another block MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another block MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an block MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 35-10 through 35-15 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of block MOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions that capture plant-to-plant variability will be provided later.

ALPHA FACTOR DISTRIBUTIONS Pressurizer PORV Block Motor-Operated Valves

Table 35-10: Alpha Factor Distribution Summa	ary - Fail to Open, CCCG = 2
--	------------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9404258	0.9770312	0.9817937	0.9973500	0.9814815	6.2530E+01	1.4700E+00
α	2.65E-03	2.30E-02	1.82E-02	5.96E-02	1.85E-02	1.4700E+00	6.2530E+01

Table 35-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	SI .	b
α,	0.9546249	0.9813471	0.9845616	0.9970809	0.9875776	9.4700E+01	1.8000E+00
α,	3.35E-06	4.01E-03	1.41E-03	1.68E-02	0.00E+00	3.8720E-01	9.6113E+01
α,	1.57E-03	1.46E-02	1.15E-02	3.86E-02	1.24E-02	1.4128E+00	9.5087E+01

ALPHA FACTOR DISTRIBUTIONS Pressurizer PORV Block Motor-Operated Valves

Table 35-12:	Alpha Factor	Distribution Summ	nary - Fail to C	Close, $CCCG = 2$
--------------	--------------	-------------------	------------------	-------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9464360	0.9762811	0.9795245	0.9950401	0.9790023	9.3290E+01	2.2665E+00
Ø.1	4.96E-03	2.37E-02	2.05E-02	5.36E-02	2.10E-02	2.2665E+00	9.3290E+01

Table 35-13: A	Inha Factor Distribution	Summary - Fail to	Close, $CCCG = 3$

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
a,	0.9504925	0.9749972	0.9771835	0.9920397	0.9781485	1.3937E+02	3.5740E+00
α,	1.77E-03	1.21E-02	9.87E-03	2.98E-02	1.05E-02	1.7232E+00	1.4122E+02
α,	2.10E-03	1.30E-02	1.08E-02	3.13E-02	1.13E-02	1.8508E+00	1.4109E+02

ALPHA FACTOR DISTRIBUTIONS Pressurizer PORV Block Motor-Operated Valves

Table 35-14:	Alpha I	Factor	Distribution	Summary	- Fail to	Remain	Closed,	CCCG = 2	2

Alpha Factor	5th%	Mean	Median	95th%	MLE	۵	b
α,	0.9164866	0.9783686	0.9902368	0.9999259	0.9991797	2.1710E+01	4.8000E-01
α,	7.06E-05	2.16E-02	9.76E-03	8.35E-02	8.20E-04	4.8000E-01	2.1710E+01

Table 35-15:	Alpha Factor Distribution Summar	y - Fail to Remain Closed,	CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9235517	0.9758396	0.9842998	0.9992411	0.9984675	3.3443E+01	8.2800E-01
α,	1.61E-05	1.21E-02	4.65E-03	4.94E-02	1.48E-03	4.1420E-01	3.3857E+01
α,	1.60E-05	1.21E-02	4.64E-03	4.94E-02	5.47E-05	4.1380E-01	3.3857E+01

36. PWR Refueling Water Storage Tank Suction Motor-Operated Valves

1. INTRODUCTION

This report documents the results of an AEOD c.fort to estimate common-cause failure (CCF) parameters of various models using operational data involving motor-operated valves (MOVs) in the piping from the refueling water storage tank (RWST) to the emergency core cooling system (ECCS) pumps at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports retrieved from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open. The data cover the time period from 1980 through 1995.

The data review identified four common-cause failure-to-open events, two common-cause failure-to-close and no failure-to-remain closed events were identified. The maximum likelihood estimates(MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 36-1 and 36-2, respectively. Table 36-3 contains the average impact vectors (N₁-N₄) and the number of adjusted independent events for this failure mode. Tables 36-4 through 36-6 contain the corresponding information for the failure to close failure mode. The size of the affected population of MOVs is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_4 . Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factor estimates are also included in this report in Tables 36-7 through 36-12.

2. SYSTEM DESCRIPTION

The refueling water storage tank stores borated water that is used for two purposes: injection into the reactor v = 4 following a loss of coolant accident (LOCA), and to fill the reactor cavity during refueling operations. The tank serves a suction source for the containment spray, charging pumps, high pressure safety injection, and low pressure safety injection systems following a LOCA.

Several valves are in the piping lines from the RWST to the pumps; some are MOVs, and all are open during normal plant operations. Figure 36-1 shows a schematic diagram of the relationship between the RWST and the ECCS pumps. A typical plant has four RWST suction MOVs.

ALPHA FACTOR AND MGL PARAMETERS Refueling Water Storage Tank Suction Motor-Operated Valves

Table 36-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
α,	0.9866757	0.9298096	0.9311714
¢L ₂	1.33E-02	6.75E-02	3.0E-02
œ,		2.67E-03	3.68E-02
α,	na anna an a sharan anna a anna a anna an anna anna an	an a	2.05E-03

Table 36-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.87E-01	9.30E-01	9.31E-01
Beta	1.33E-02	7.02E-02	6.88E-02
Gamma		3.80E-02	5.65E-01
Delta	en e		5.26E-02

Table 36-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	
Adj. Ind. Events	22.22	33.33	44.44	
N,	3.3128	1.5360	1.0710	
N ₂	0.3448	2.5320	1.4640	
N,		0.1000	1.8000	
N,			.0.1000	

Total Number of Independent Failure Events: 50 Total Number of Common-Cause Failure Events: 4

ALPHA FACTOR AND MGL PARAMETERS Refueling Water Storage Tank Suction Motor-Operated Valves

Table 36-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
α,	0.9951807	0.9903537	0.9854605
α,	4.82E-03	9.65E-03	1.45E-02
α,	an and an	0.00E+00	0.00E+00
α.,		and any set out and part of an output of a set o	0.00E+00

Table 36-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.95E-01	9.90E-01	9.86E-01
Beta	4.82E-03	9.65E-03	1.45E-02
Gamma	an. Az man daga ang ang ang ang ang ang ang ang ang	0.00E+00	0.00E+00
Delta		And a set of the set o	0.00E+00

Table 36-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG≃3	CCCG=4
Adj. Ind. Events	8.80	13.20	17.60
N ₁	1.5662	2.2000	2.7335
N2	0.0502	0.1500	0.3000
N,		0.0000	0.0000
N,			0.0000

Total Number of Independent Failure Events: 22 Total Number of Common-Cause Failure Events: 2

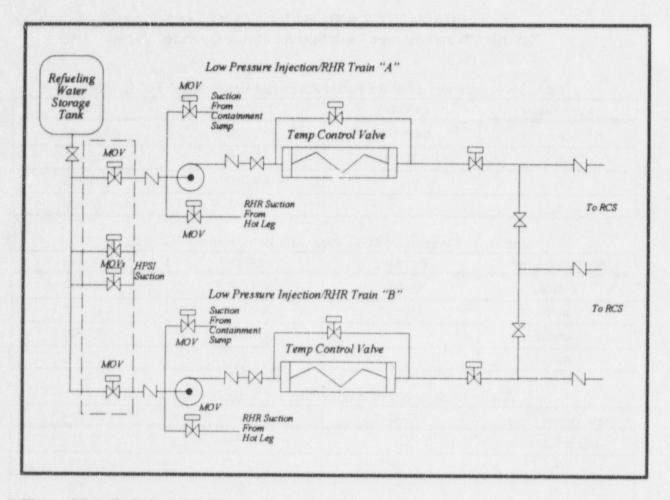


Figure 36-1. Refueling water storage tank system.

3. COMPONENT BOUNDARIES

The main components of a motor-operated valve are the valve, including its internal piece-part components (e.g. gate, stem), and the operator. The operator includes the circuit breaker, power leads, sensors (flow, pressure, and level) and motor as piece parts. Only sensors unique to the operation of the individual valve are included with the valve for CCF analysis. All MOVs have manual handwheels, and can be manually operated. AC or DC power is required for valve operation.

The MOVs in the RWST system are used to supply borated water to the suction of selected ECCS pumps. The valves are normally open, and will close, either automatically or by operator action, when the RWST reaches a low setpoint as the ECCS pump suction is shifted to the containment sump.

4. FAILURE EVENT DEFINITION

The function of the RWST MOVs is to allow primary coolant flow to the selected systems. All valves serve as a system containment boundary and would need to close to isolate leaks. The failure modes used in evaluating the RWST MOV data are:

- CC Fail to Open: The valve must be in the fully open position. Anything less than fully open is considered a failure to open.
- OO Failure to Close: The valve must be fully closed on a close signal, or it is considered a failure to close.
- VR Failure to Remain Closed: In cases where the motor-operated valve has been closed for a substantial period of time and is then discovered leaking, the failure is coded as VR. If the discovery is made soon after a system configuration change (i.e., pump operation), then the failure is coded as OO.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. A stroke time testing failure was not considered a failure if the valve reached the required open state.

Valve failures include functional inoperabilities due to reasons not related to valve hardware malfunctions. Examples are breaker de-energized and locked open (human error), and system conditions (abnormal pressure and temperature) that prevent operation. Failure of the electrical operator without coincident failure of the manual operator is considered a failure. These events were considered individually to determine if the failure occurred within the component boundary, or if the failure was due to external factors such that the event was not a CCF event.

Failures of the operator and circuit breaker were evaluated to determine the ultimate effect on valve operability for assignment of failure mode. For example, a circuit breaker may fail to close, but the resulting effect on the valve is failure to open, so the failure mode is "CC."

Many LERs reported only one actual failure, but the report information indicated that failure of a second MOV would have occurred from the same cause if operation had been attempted. When the cause of the actual failure would have clearly caused failure of another MOV, the event was identified as a CCF. If, however, the report did not clearly identify that another MOV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered before an MOV operation demand (e.g. the condition was found during inspection, and no actual stroking failures occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 36-7 through 36-12 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of RWST MOVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Refueling Water Storage Tank Suction Motor-Operated Valves

Table 36-7: Alpha Factor Distribution Summar	y - Fail to Open, $CCCG = 2$
--	------------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	. 8	b
α,	0.9276680	0.9772896	0.9853721	0.9993218	0.9866757	3.5063E+01	8.1480E-01
a,	6.75E-04	2.27E-02	1.46E-02	7.23E-02	1.33E-02	8.1480E-01	3.5063E+01

Table 36-8: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α	0.8734735	0.9358481	0.9412286	0.9797987	0.9298096	5.0660E+01	3.4320E+00
α2	1.50E-02	5.46E-02	4.91E-02	1.13E-01	6.75E-02	2.9192E+00	5.0579E+01
α,	4.36E-05	9.59E-03	4.51E-03	3.63E-02	2.67E-03	5.1280E-01	5.2985E+01

Table 36-9: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.8863455	0.9377095	0.9415803	0.9758317	0.9311714	7.0211E+01	4.6640E+00
α,	4.93E-03	2.70E-02	2.29E-02	6.30E-02	3.00E-02	2.0178E+00	7.2857E+01
α,	5.18E-03	2.76E-02	2.35E-02	6.39E-02	3.68E-02	2.0626E+00	7.2812E+01
œ4	6.56E-05	7.79E-03	4.05E-03	2.82E-02	2.05E-03	5.8360E-01	7.4291E+01

ALPHA FACTOR DISTRIBUTIONS Refueling Water Storage Tank Suction Motor-Operated Valves

Table 36-10: Alpha Factor	Distribution Summa	ry - Fail to Close,	CCCG = 2
---------------------------	--------------------	---------------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	â	b
α,	0.9046363	0.9745202	0.9876153	0.9998744	0.9951807	1.9896E+01	5.2020E-01
α.,	1.28E-04	2.55E-02	1.24E-02	9.54E-02	4.82E-03	5.2020E-01	1.9896E+01

Table 36-11: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	B	b
α,	0.9095652	0.9698890	0.9791326	0.9986066	0.9903537	3.0600E+01	9.5000E-01
α,	9.88E-05	1.70E-02	8.40E-03	6.33E-02	9.65E-03	5.3720E-01	3.1013E+01
α.,	1.71E-05	1.31E-02	5.02E-03	5.35E-02	0.00E+00	4.1280E-01	3.1137E+01

Table 36-12: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.9139360	0.9656903	0.9721173	0.9954186	0.9854605	4.5034E+01	1.6000E+00
α.,	6.24E-04	1.83E-02	1.20E-02	5.75E-02	1.45E-02	8.5380E-01	4.5780E+01
a,	1.64E-07	5.63E-03	1.10E-03	2.69E-02	0.00E+00	2.6260E-01	4.6371E+01
œ.	3.46E-05	1.04E-02	4.64E-03	4.01E-02	0.00E+00	4.8360E-01	4.6150E+01

37. PWR Pressurizer Power Operated Relief Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving power operated relief valves (PORVs) in the primary coolant system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and information from the Nuclear Plant Reliability Date System (NPRDS) have been screened to identify common-cause failure events for Pressurizer PORVs. Failure modes analyzed are failure to open, failure to close, and failure to remain closed (spurious opening or leakage past the valve seat). The data cover the time period from 1980 through 1995.

The data review identified 17 common-cause failure to open event, two common-cause failure to close events, and three common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 37-1 and 37-2, respectively. Table 37-3 contains the average impact vectors (N₁-N₃) and the number of adjusted independent events for this failure mode. Tables 37-4 through 37-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of configurations of pressurizer PORVs is denoted as CCCG and is either two or three for all plants. The alpha factor model parameters are denoted by α_1 - α_3 . Beta (β) and gamma (γ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 37-10 through 37-15.

2. SYSTEM DESCRIPTION

The primary coolant system in a PWR consists of the piping and other components necessary to remove heat from the reactor core. Part of the system is the pressurizer which serves to regulate the system pressure, both raising pressure to maintain solid water in the pressurizer flow path, and lowering pressure to control plant operations and prevent system over pressurization. The PORVs are used for pressure control and safety valves are used for over pressure protection purposes.

The pressurizer PORVs automatically actuate to lower pressure in the event of a power mismatch. The PORVs are not required in order to prevent over pressurization but rather function to increase plant operability. The PORVs may also be manually actuated. During shutdown conditions the PORVs may provide cold over pressure protection. In order to provide cold over pressure protection, operator action is required to reset the automatic lift setpoints. Figure 37-1 shows a typical configuration of pressurizer PORVs and safety valves.

ALPHA FACTOR AND MGL PARAMETERS Pressurizer PORVs

Table 37-1: Summary of Alpha Factor Parameter Estimations - Fail to Open

Alpha Parameter	CCCG=2	CCCG=3
<u>a</u> 1	0.9314746	0.9282503
α2	6.85E-02	2.73E-02
α,		4.45E-02

Table 37-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3
1-Beta	9.32E-01	9.28E-01
Beta	6.85E-02	7.18E-02
Gamma		6.20E-01

Table 37-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3
Adj. Ind. Events	132.04	198.06
N ₁	6.1070	1.2915
N ₂	10.1630	5.8560
N,		9.5530

Total Number of Independent Failure Events: 136 Total Number of Common-Cause failure Events: 17

ALPHA FACTOR AND MGL PARAMETERS Pressurizer PORVs

Table 37-4: Summary of Alpha Factor Parameter Estimations - Fail to Close

Alpha Parameter	CCCG=2	CCCG=3
a,	0.9641667	0.9635037
α ₂	3.58E-02	1.83E-02
G .3		1.83E-02

Table 37-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3
1-Beta	9.64E-01	9.64E-01
Beta	3.58E-02	3.65E-02
Gamma		5.00E-01

Table 37-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3
Adj. Ind. Events	35.20	52.80
N ₁	0.6670	0.0000
N ₂	1.3330	1.0000
N ₃	en den namen an anderen en en ante en	1.0000

Total Number of Independent Failure Events: 44 Total Number of Common-Cause Failure Events: 2

ALPHA FACTOR AND MGL PARAMETERS Pressurizer PORVs

Table 37-7: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Alpha Factor	CCCG=2	CCCG=3
α,	0.9859155	0.9895123
α,	1.41E-02	1.57E-03
α ₃	n mana di kanangan k	B.92E-03

Table 37-8: Summary of MGL Parameter Estimations - Fail to Rem in Closed

MGL Parameter	CCCG=2	CCCG=3
1-Beta	9.86E-01	9.90E-01
Beta	1.41E-02	.05E-02
Gamma	If representation of the second se second second s second second se	8.50E-01

Table 37-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vectors	CCCG=2	CCCG=3
Adj. Ind. Events	157.00	235.50
N,	0.5000	0.3750
N2	2.2500	0.3750
N ₃		2.1250

Total Number of Independent Failure Events: 157 Total Number of Common-Cause Failure Events: 3

326

PWR Pressurizer PORVs

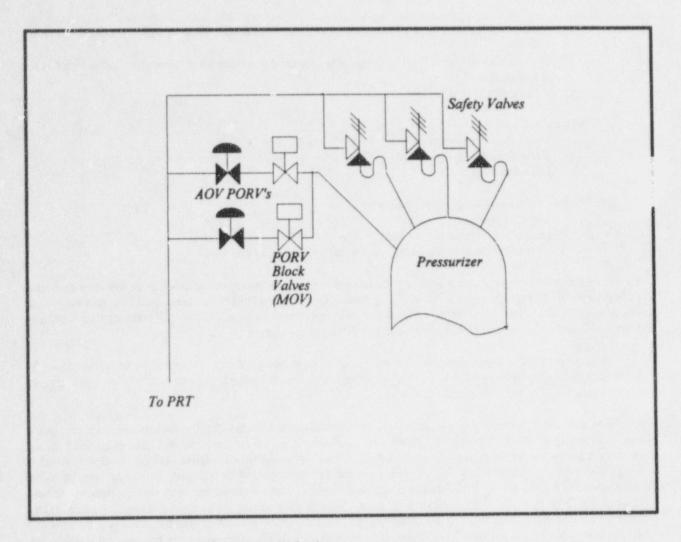


Figure 37-1. Pressurizer safety and relief valves.

3. COMPONENT BOUNDARIES

The pressurizer PORV consists of the valve itself along with control and power systems that are specific to the individual PORV. The air supply or gas accumulator to each individual valve is included with that valve. The instrument air system upstream of the PORV air supply isolation valve is not included. Specifically excluded are indication circuitry and control and power systems that are not specific to an individual PORV, but that provide input to multiple PORVs.

4. FAILURE EVENT DEFINITION

Successful operation of a relief value is defined as opening in response to high system pressure, and reclosing when pressure is reduced. The failure modes used in evaluating the pressurizer PORV data are:

- CC Failure to Open: Examples are:
 - PORV sticks closed,
 - PORV setpoint over 10% over the limit or words like "excessive" are considered failures,

NUREG/CR-5497

- * If piece-part(s) are replaced to calibrate a setpoint that was too high, then the PORV is considered failed,
- A stroke time test failure will be considered a failure if it is reported as "excessive, " otherwise it is not a failure, and
- Whenever a PORV is blocked shut.
- OO Failure to Close: Examples are:
 - Valve stays open when it should close,
 - Valve doesn't fully close, and
 - Failure to re-seat.
- VR Failure to Remain Closed: Examples are:
 - Spurious opening,
 - Leakage past the valve seat, and
 - If piece-part(s) are replaced to re-calibrate a setpoint that was low.

Relief valve malfunctions are considered to be failures to open or close on demand, failure to stay open or closed, including excessive leakage through the valve. Valve failures include those failures that are caused by power supplies or sensors that are unique to the valve. Relief valves that open in response to an actual system over pressure are not failures. Subsequent failures to reseat completely are defined as a failure to close event.

Valve operator failures are evaluated to determine the effect on valve operability. In general, if the failure causes the valve to fail to operate, it will be considered a valve failure. Failures of the valve to provide input to other systems (such as limit switches) will not be considered valve failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. The exception to this is if a licensee reported that the valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications (TS) in the proper configuration is not considered a failure, unless the improper configuration would have prevented the valve from operating properly on a safety demand. An example is low temperature/pressure conditions (outages) when the relief valve setpoints are required to be lowered. On occasion, licensees forget to lower the setpoints when they change modes, resulting in a TS violation, and preventing the valve from opening at the outage condition setpoint.

Many LERs reported only one actual failure, but the report information indicated that a second PORV would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another PORV, then the event was identified as a CCF. If, however, the report did not clearly identify that another PORV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to a PORV actuation demand (e.g. the condition was found during inspection, and no actual demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 37-10 through 37-15 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of PORVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the tables. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

PWR Pressurizer PORVs

ALPHA FACTOR DISTRIBUTIONS Pressurizer PORVs

Table 37-10: Alpha Factor Distribution Summary	y - Fail to Open, $CCCG = 2$
--	------------------------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	6
α,	0.8973900	0.9328356	0.9346561	0.9620702	0.9314746	1.4768E+02	1.0633E+01
α,	3.79E-02	6.72E-02	6.54E-02	1.03E-01	6.85E-02	1.0633E+01	1.4768E+02

Table 37-11:	Alpha Factor	Distribution	Summary	- Fail to	Open,	CCCG = 3	3
--------------	--------------	--------------	---------	-----------	-------	----------	---

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b	
α,	0.9001838	0.9297579	0.931008	0.9550983	0.9282503	2.1455E+02	1.6209E+01	
α,	1.21E-02	2.71E-02	2.57E-02	4.66E-02	2.73E-02	6.2432E+00	2.2452E+02	
α,	2.37E-02	4.32E-02	4.19E-02	6.72E-02	4.45E-02	9.9658E+00	2.2079E+02	

ALPHA FACTOR DISTRIBUTIONS Pressurizer PORVs

Table 37-12: Alpha Factor Distribution Summary - Fail to Close, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	A	b
α,	0.9079730	0.9618009	0.9681410	0.9939215	0.9641667	4.5397E+01	1.8030E+00
αη	6.08E-03	3.82E-02	3.19E-02	9.20E-02	3.58E-02	1.8030E+00	4.5397E+01

Alpha Factor	5th%	Mean	Median	95th%	MLE	B	b
α,	0.9166621	0.9604520	0.9647151	0.9896456		6.8000E+01	
α2	2.04E-03	1.96E-02	1.53E-02	5.19E-02	1.83E-02	1.3872E+00	6.9413E+01
α,	2.15E-03	2.00E-02	1.56E-02	5.25E-02	1.83E-02	1.4128E+00	6.9387E+01

.....

ALPHA FACTOR DISTRIBUTIONS Pressurizer PORVs

Table 37-14:	Alpha Factor	Distribution Summa	ry - Fail to Re	emain Closed,	CCCG = 2
--------------	--------------	--------------------	-----------------	---------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9656246	0.9839764	0.9858391	0.9959750	0.9859155	1.6703E+02	2.7200E+00
α,	4.03E-03	1.60E-02	1.42E-02	3.44E-02	1.41E-02	2.7200E+00	1.6703E+02

Table 37-15: Alpha Factor Distribution Summa	ry - Fail to Remain Closed, $CCCG = 3$
--	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α						2.5108E+02	
œ ₂	7.03E-05	3.00E-03	1.84E-03	9.88E-03	1.57E-03	7.6220E-01	2.5362E+02
α,	2.33E-03	9.98E-03	8.72E-03	2.19E-02	8.92E-03	2.5378E+00	2.5184E+02

38. PWR Steam Generator Power Operated Relief Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving steam generator power operated relief valves at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed (spurious opening and leakage past the valve seat). The data cover the time period from 1980 through 1995.

The data review identified 47 common-cause failure to open events, nine common-cause failure to close events, and five common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 38-1 and 38-2, respectively. Table 38-3 contains the average impact vectors (N_1-N_4) and the number of adjusted independent events for this failure mode. Tables 38-4 through 38-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of steam generator power operated relief valves (PORVs) is denoted as CCCG. The alpha factor model parameters are denoted by $\alpha_1-\alpha_4$. Beta (β), gamma (γ), and delta (δ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 38-10 through 38-18.

2. SYSTEM AND COMPONENT DESCRIPTION

The steam generator PORVs actuate to lower pressure in the secondary side of the steam generators prior to safety relief valves lifting. This need to lower pressure is normally the result of a high temperature in the reactor coolant system. Additionally, the valves must reclose following the pressure relief and remain closed during operation in order to preserve the secondary coolant boundary and control the heat removal rate. The steam generator PORVs are actuated by an external motive source such as electrical motor, air, nitrogen, hydraulics, or electrical solenoid. Manual initiation can be accomplished by the control room operator if necessary. Figure 38-1 shows the configuration of the steam generator PORVs and safety valves. The number of steam generator PORVs at a single plant is the same as the number of steam generators at that plant.

ALPHA FACTOR AND MGL PARAMETERS Steam Generator Power Operated Relief Valves

Table 38-1: Summar	y of Alpha Factor	Parameter Estimations -	Fail to Open
--------------------	-------------------	-------------------------	--------------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
α,	0.9126846	0.8864152	0.8829514
α,	8.73E-02	6.97E-02	4.97E-02
α,	CHARLENCE HARLENE SPECTRE, MERS HER, JAHREN HER, JAHREN HARLEN HAR WERK HER SPECTRE SPEC	4.39E-02	3.57E-02
α,	namena anar existenza eta errelaria da en de entre entre antenin en entre antenin de secondo da entre entre en		3.17E-02

Table 38-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.13E-01	8.86E-01	8.83E-01
Beta	8.73E-02	1.14E-01	1.17E-01
Gamma	a ann an A ann an An	3.87E-01	5.76E-01
Delta			4.70E-01

Table 38-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj. Ind. Events	108.93	163.40	217.87
N,	26.1025	22.7447	20.0710
N ₂	12.9184	14.6258	13.3824
N,	e i fan henne fan en annen in de fan in de fan de fan en gerenne annen de state en gerenne	9.2267	9.6206
N4			8.5397

Total Number of Independent Failure Events: 189 Total Number of Common-Cause failure Events: 47

ALPHA FACTOR AND MGL PARAMETERS Steam Generator Power Operated Relief Valves

Table 38-4: Summary of Alpha Factor Parameter Estimations - 1	Fail to Close	
---	---------------	--

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
α,	0.9668929	0.9119550	0.9006279
α2	3.31E-02	8.48E-02	5.61E-02
α,		3.21E-03	4.21E-02
α4			1.19E-03

Table 38-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.67E-01	9.12E-01	9.01E-01
Beta	3.31E-02	8.81E-02	9.94E-02
Gamma		3.65E-02	4.35E-01
Delta		ann ann an ann an Anna an Anna Anna ann an Anna	2.74E-02

Table 38-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj. Ind. Events	24.00	36.00	48.00
N ₁	5.6840	4.2246	3.2677
N ₁	1.0164	3.7419	3.1955
N ₃		0.1416	2.3937
N,	and the of Landscar of the Cole of the Society and the Cole and the Society and the Society of the Society of t	Contraction of the second strength of the sec	0.0675

Total Number of Independent Failure Events: 36 Total Number of Common-Cause Failure Events: 9

ALPHA FACTOR AND MGL PARAMETERS Steam Generator Power Operated Relief Valves

Table 38-7: Summary of Alpha Factor Parameter Es	Estimations - Fail to Remain (losed
--	--------------------------------	-------

Alpha Factor	CCCG=2	CCCG=3	CCCG=4
Ø.,	0.9971518	0.9867363	0.9860369
α,	2.85E-03	1.24E-02	5.33E-03
a,	an a constant any second s	8.50E-04	8.22E-03
, 			4.12E-04

Table 38-8: Summary of MGL Parameter Estimations - Fail to Remain Closed


MGL Parameter	CCCG=2	CCCG=3	CCCG=4
1-Beta	9.97E-01	9.87E-01	9.86E-01
Beta	2.85E-03	1.33E-02	1.40E-02
Gamma	ng banan sanah menangkan pang pang pang pang ng mangkan kanang kanan ang kanang kanang kanang kanang kanang ka	6.41E-02	6.18E-01
Deits			4.77E-02


Table 38-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4
Adj. Ind. Events	133.75	200.63	267.50
N ₁	3.9809	2.4650	1.8407
N ₂	0.3934	2.5550	1.4558
N,	na ana a mangana ana ana ana ana ana ana ana ana a	0.1750	2.2458
N,			0.1125

Total Number of Independent Failure Events: 214 Total Number of Common-Cause Failure Events: 5

NUREG/CR-5497

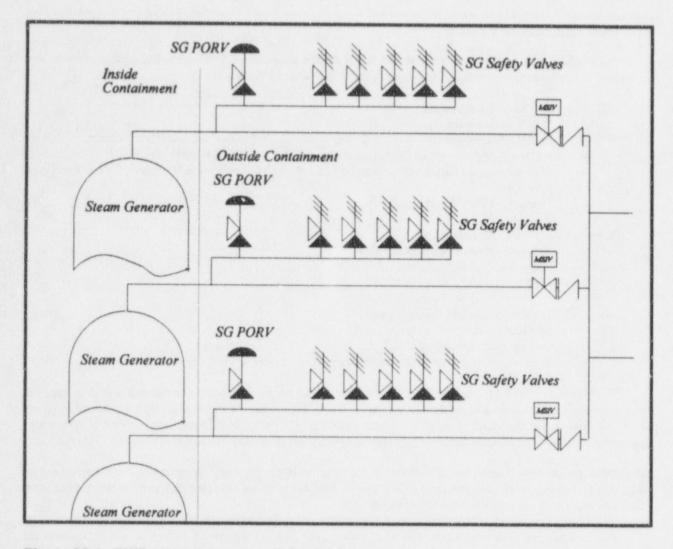



3. COMPONENT BOUNDARIES

The main component of a steam generator PORV is the valve itself. This component is normally operated by a sensor actuating the operating medium such as air or an electric motor which will in turn operate the valve. These valves can also be manually opened and closed via a remote control switch. In addition to opening to lower pressure, the valves are designed to re-close when the desired pressure is achieved. This may be only slightly less than the opening pressure.

The boundaries include the valve itself, the valve operator, any sensing lines, and the auxiliary equipment needed to open the valve or verify the valve position. Only the sensors and power supplies that provide direct input to the individual valves are included. Air or nitrogen lines leading directly to a single valve are included with the valve; failures of the air or nitrogen systems are not included with the valve. Other valve actuation logic, breakers, or air systems that affect other valves or other equipment are not considered part of the valve.

4. FAILURE EVENT DEFINITION

Successful operation of a steam generator PORV is defined as opening in response to high system pressure, and reclosing when pressure is reduced. The failure modes used in evaluating the data are:

- CC Failure to Open: Examples are:
 - PORV sticks closed,
 - PORV setpoint over 10% over the limit or words like "excessive" are considered failures,
 - . If piece-part(s) are replaced to calibrate setpoint, then the PORV is considered failed,
 - A stroke time test failure will be considered a failure if it is reported as "excessive, " otherwise it is no failure, and
 - Whenever a PORV is blocked shut.
- OO Failure to Close: Examples are:
 - Valve stays open when it should close,
 - Valve doesn't fully close, and
 - Failure to re-seat.
- VR Failure to Remain Closed: Examples are:
 - Spurious opening,
 - Leakage past the valve seat, and
 - If piece-part(s) are replaced to re-calibrate a setpoint that was low.

Steam generator PORV malfunctions are considered to be failures to open or close on demand, failure to stay open or closed, including excessive leakage through the valve. Valve failures include those failures that are caused by power supplies or sensors that are unique to the valve. Steam generator PORVs that open in response to an actual system over pressure are not failures. Subsequent failures to reseat completely are defined as a failure to close event.

Valve operator failures are evaluated to determine the effect on valve operability. In general, if the failure causes the valve to fail to operate, it will be considered a valve failure. Failures of the valve to provide input to other systems (such as limit switches) will not be considered valve failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. The exception to this is if a licensee reported that the valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the valve from operating properly on a safety demand. An example is low temperature/pressure conditions (outages) when the steam generator PORV setpoints are required to be lowered. On occasion, licensees forget to lower the setpoints when they change modes, resulting in a TS violation, and preventing the valve from opening at the outage condition setpoint.

Many LERs reported only one actual failure, but the report information indicated that a second PORV would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another PORV, then the event was identified as a CCF. If, however, the report did not clearly identify that another PORV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to PORV actuation demand (e.g. the condition was found during inspection, and no actual demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 38-10 through 38-18 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of SG PORVs. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the tables. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Steam Generator Power Operated Relief Valves

Table 38-10:	Alpha Factor	Distribution Summar	y - Fail to	Open,	CCCG = 2	

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8761342	0.9152379	0.9169904	0.9483629	0.9126846	1.4456E+02	1.3388E+01
α,	5.16E-02	8.48E-02	8.30E-02	1.24E-01	8.73E-02	1.3388E+01	1.4456E+02

Table 38-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8550170	0.8909193	0.8920707	0.9228805	0.8864152	2.0135E+02	2.4653E+01
α,	4.16E-02	6.64E-02	6.52E-02	9.56E-02	6.97E-02	1.5013E+01	2.1099E+02
α,	2.31E-02	4.27E-02	4.13E-02	6.68E-02	4.39E-02	9.6395E+00	2.1636E+02

Table 38-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8573968	0.8888513	0.8897316	0.9173110	0.8829514	2.6264E+02	3.2843E+01
α,	2.88E-02	4.72E-02	4.61E-02	6.90E-02	4.97E-02	1.3936E+01	2.8155E+02
α,	1.82E-02	3.35E-02	3.24E-02	5.22E-02	3.57E-02	9.8832E+00	2.8560E+02
α,	1.61E-02	3.05E-02	2.95E-02	4.86E-02	3.17E-02	9.0233E+00	2.8646E+02

ALPHA FACTOR DISTRIBUTIONS Steam Generator Power Operated Relief Valves

Table 38-13: Alpha Factor Distribution Summary	y - Fail to Close,	CCCG = 2
--	--------------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α	0.9062541	0.9634795	0.9707900	0.9956557	0.9668929	3.9214E+01	1.4864E+00
R	4.34E-03	3.65E-02	2.92E-02	9.38E-02	3.31E-02	1.4864E+00	3.9214E+01

1 able 38-14: Alpha Factor Distribution Summary - Fail to Close, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.8587336	0.9220825	0.9267419	0.9694849	0.9119550	5.5425E+01	4.6835E+00
α,	2.48E-02	6.87E-02	6.39E-02	1.29E-01	8.48E-02	4.1291E+00	5.5979E+01
α,	6.15E-05	9.22E-03	4.62E-03	3.40E-02	3.21E-03	5.5440E-01	5.9554E+01

Table 38-15: Alpha Factor Distribution Summary - Fail to Close, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.8612258	0.9161083	0.9194439	0.9595835	0.9006279	7.5968E+01	6.9567E+00
α,	1.51E-02	4.52E-02	4.16E-02	8.77E-02	5.61E-02	3.7493E+00	7.9175E+01
α,	7.94E-03	3.20E-02	2.83E-02	6.88E-02	4.21E-02	2.6563E+00	8.0268E+01
α.,	4.29E-05	6.65E-03	3.31E-03	2.46E-02	1.19E-03	5.5110E-01	8.2374E+01

ALPHA FACTOR DISTRIBUTIONS Steam Generator Power Operated Relief Valves

Table 38-16: Alpha Factor Distribution Summa	ry - Fail to Remain Closed, $CCCG = 2$
--	--

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
	0.9816583	0.9941711	0.9961941	0.9998004	0.9971518	1.4726E+02	8.6340E-01
α,	2.02E-04	5.83E-03	3.81E-03	1.83E-02	2.85E-03	8.6340E-01	1.4726E+02

Table 38-17: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 3

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α.,	0.9682823	0.9840869	0.9855167	0.9950039	0.9867363	2.1830E+02	3.5300E+00
α,	3.58E-03	1.33E-02	1.18E-02	2.79E-02	1.24E-02	2.9422E+00	2.1889E+02
α,	2.29E-05	2.65E-03	1.38E-03	9.59E-03	8.50E-04	5.8780E-01	2.2124E+02

Table 38-18: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9690419	0.9829048	0.9839674	0.9931252	0.9860369	2.9404E+02	5.1141E+00
α,	1.21E-03	6.72E-03	5.66E-03	1.59E-02	5.33E-03	2.0960E+00	2.9715E+02
α,	1.94E-03	8.39E-03	7.32E-03	1.85E-02	8.22E-03	2.5084E+00	2.9665E+02
α,	1.83E-05	1.99E-03	1.05E-03	7.18E-03	4.12E-04	5.9610E-01	2.9856E+02

39. BWR Pressure Relief and ADS Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving relief valves and automatic depressurization system valves (ADS) in the primary cooling system at boiling water reactor (BWR) power plants. Licensee Event Reports (LERs) and failure records from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed (leakage past the valve seat or spurious opening). The data cover the time period from 1980 through 1995.

The data review identified 27 common-cause failure to open events, 1 common-cause failure to close event and 10 common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 39-1 and 39-2, respectively. Table 39-3 contains the average impact vectors ($N_1 \cdot N_6$) and the number of adjusted independent events for this failure mode. Tables 39-4 through 39-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of BWR pressure relief and ADS valves is denoted as CCCG. The alpha factor model parameters are denoted by $\alpha_1 \cdot \alpha_6$. Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 39-10 through 39-18.

2. SYSTEM DESCRIPTION

The BWR pressure relief and ADS valves actuate to lower pressure in the BWR primary system. The number of relief valves range from 4 to 20; a typical number is 11. This need to lower system pressure may be dictated by system pressure being above normal or by the need to allow injection from lower pressure systems. If valves open due to pressure being above normal, the valves must reclose following the pressure relief or remain close during operation in order to preserve the primary coolant boundary. If the valves open to allow injection from lower pressure sources, they will close only when system pressure is reduced to near atmospheric. The valves may also be operated manually via a remote control switch. Some relief valves may be actuated by an external motive source such as air or nitrogen. A typical BWR safety, pressure relief, and ADS valve arrangement is shown in Figure 39-1.

ALPHA FACTOR AND MGL PARAMETERS BWR Pressure Relief and ADS Valves

	Table 39-1:	Summary	of	Alpha Factor	Parameter	Estimations	 Fail to Ope 	n
--	-------------	---------	----	--------------	-----------	-------------	---------------------------------	---

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG-6
α,	0.9544554	0.9375297	0.9084257	0.8964265	0.8853880
α,	4.55E-02	5.16E-02	6.97E-02	7.30E-02	7.19E-02
α,	1	1.08E-02	1.78E-02	2.22E-02	2.83E-02
α ₄	1	Í	4.04E-03	6.87E-03	9.85E-03
œ,			An Indean of the owner owner owner owner owner	1.54E-03	3.93E-03
Ø.	1		and the second se		6.90E-04

Table 39-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.55E-01	9.38E-01	9.08E-01	8.96E-01	8.85E-01
Beta	4.55E-02	6.25E-02	9.16E-02	1.04E-01	1.15E-01
Gamma		1.74E-01	2.39E-01	2.95E-01	3.73E-01
Delta			1.85E-01	2.75E-01	3.38E-01
Epsilon		Contractory of the second s		1.83E-01	3.19E-01
Mu		1			1.49E-01

Table 39-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	28.09	42.14	56.18	70.23	84.27
N,	9.5018	10.6297	10.8739	9.6970	9.0769
N ₂	1.7938	2.9062	5.1471	6.5099	7.5756
N,		0.6100	1.3139	1.9746	2.9831
N,			0.2984	0.6128	1.0384
N ₅				0.1375	0.4138
N,					0.0727

Total Number of Independent Failure Events: 142 Total Number of Common-Cause Failure Events: 27

ALPHA FACTOR AND MGL PARAMETERS BWR Pressure Relief and ADS Valves

Table 39-4:	Summary of	Alpha	Factor	Parameter	Estimations -	Fail to	Close
manus aprimenta da ancienta sen a preserve surante de completa de completa de completa de completa de completa	NE DIS STREET WERE STREET STREET STREET STREET	OR TRACTORY OF TRACTORY	AND ADDRESS TO ADDRESS OF THE	ringe vit monthematics and Second strends with	a dia kampia. Ilay kana dia kampingka panan mini mangka pana kana di	REVER MEND AND DESCRIPTION OF THE PARTY OF	And a lot of the second s

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9963328	0.9926740	0.9889695	0.9852336	0.9814815
α,	3.67E-03	7.33E-03	1.10E-02	1.48E-02	1.85E-02
α,	1	0.00E+00	0.00E+00	0.00E+00	0.00E+00
α ₄			0.00E+00	0.00E+00	0.00E+00
۵				0.00E+00	0.00E+00
CL.6					0.00E+00

Table 39-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.96E-01	9.93E-01	9.89E-01	9.85E-01	9.82E-01
Beta	3.67E-03	7.33E-03	1.10E-02	1.48E-02	1.85E-02
Gamma	Contraction of the operation of the second second	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Delta			0.0CE+00	0.00E+00	0.00E+00
Epsilon			and a second second second second second	0.00E+00	0.00E+00
Mu			anna an an anna an anna a' Anna an anna an an		0.00E+00

Table 39-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	17.67	26.50	35.33	44.17	53.00
N ₁	0.5330	0.6000	0.5330	0.3330	0.0000
N ₂	0.0670	0.2000	0.4000	0.6670	1.0000
N,		0.0000	0.0000	0.0000	0.0000
N,	nin allanyi. Ali kangariya darihigi a separawan ni yaki		0.0000	0.0000	0.0000
Ns				0.0000.0	0.0000
N ₆					0.0000

Yotal Number of Independent Failure Events: 53 Total Number of Common-Cause Failure Events: 1

ALPHA FACTOR AND MGL PARAMETERS BWR Pressure Relief and ADS Valves

Table 39-7: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
α,	0.9899146	0.9829415	0.9733513	0.9665930	0.9683204
α,	1.01E-02	1.63E-02	2.47E-02	3.02E-02	2.04E-02
α,		7.61E-04	1.84E-03	2.94E-03	1.04E-02
CZ.4			1.10E-04	2.83E-04	8.46E-04
α,				1.18E-05	5.76E-05
a.		an an an ann an an an an an an an an an			0.00E+00

Table 39-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG≃3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.90E-01	9.83E-01	9.73E-01	9.67E-01	9.68E-01
Beta	1.01E-02	1.71E-02	2.67E-02	3.34E-02	3.17E-02
Gamma		4.46E-02	7.33E-02	9.69E-02	3.56E-01
Delta		annai 2 bh'ar nachta anni. Bann an airrithe anna an 27,00	5.61E-02	9.11E-02	8.01E-02
Epsilon		an and an an an and a second se	and a second s	4.00E-02	6.38E-02
Mu		AN E AND AN TAKIN AND AN ANY A BALLY SAY AND ANY AND ANY	The second of the second se		0.00E+00

Table 39-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	18.77	28.15	37.53	46.91	56.30
N ₃	1.9403	2.3434	2.4579	2.2486	2.5029
N2	0.2110	0.5056	1.0146	1.5344	1.2387
N,	an definit for the strends of lands and strends with responses	0.0236	0.0757	0.1496	0.6302
N.			0.0045	0.0144	0.0514
N ₅				0.0006	0.0035
N ₆			and the second strengt of subsystems and subsystems and subsystems and subsystems and subsystems and subsystems		0.0000

Total Number of Independent Failure Events: 76 Total Number of Common-Cause Failure Events: 10

4

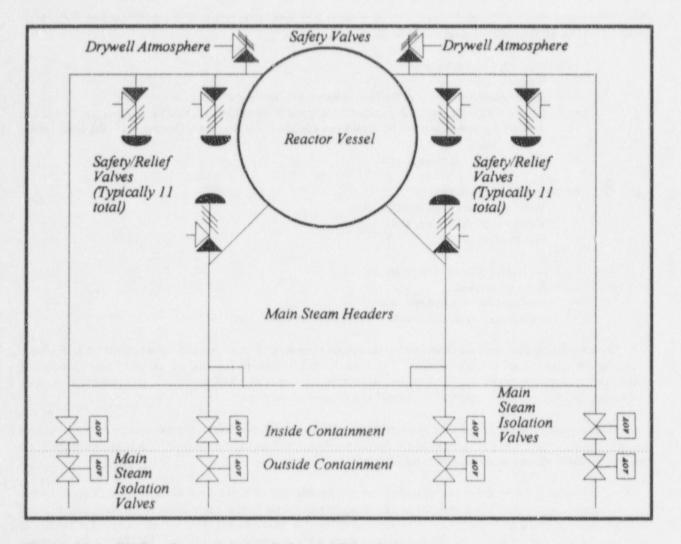


Figure 39-1. BWR safety, pressure relief, and ADS valves.

3. COMPONENT BOUNDARIES

The main component of a relief valve (RV) is the valve itself. This component is normally operated by a sensor actuating the operating medium such as air or nitrogen which will in turn operate the valve. These valves can also typically be manually opened and closed via a remote control switch. In addition to opening to lower pressure, the valves are designed to re-close when the desired pressure is achieved. This may be only slightly less than the opening pressure or in the case of valves which open to reduce pressure in preparation for low pressure injection, may be when system pressure is insufficient to hold the valve open.

The boundaries include the valve itself, the valve operator, any sensing lines, and the auxiliary equipment needed to open the valve or verify the valve position. Only the sensors and power supplies that only provide direct input to the individual valve are included. Air or nitrogen lines leading directly to a single valve are included with the valve; failures of the air or nitrogen systems are not included with the valve. Other valve actuation logic, breakers, or air systems that affect other valves or other equipment are not considered part of the valve.

4. FAILURE EVENT DEFINITION

Successful operation of a relief valve is defined as opening in response to high system pressure, and reclosing when pressure is reduced. The failure modes used in evaluating the data are:

- CC Failure to Open: Examples are:
 - RV sticks closed,
 - RV setpoint over 10% over the limit or words like "excessive" are considered failures,
 - If piece-part(s) are replaced to calibrate a setpoint that was too high, then the RV is considered failed,
 - A stroke time test failure will be considered a failure if it is reported as "excessive, " otherwise it is not a failure, and
 - Whenever a RV is blocked shut.
- OO Failure to Close: Examples are:
 - Valve stays open when it should close,
 - Valve doesn't fully open, and
 - Failure to re-seat.
- VR Failure to Remain Closed: Examples are:
 - Spurious opening,
 - Leakage past the valve seat, and
 - If piece-part(s) are replaced to re-calibrate a setpoint that was too low.

Relief valve malfunctions are considered to be failures to open or close on demand, failure to stay open or closed, including excessive leakage through the valve. Valve failures include those failures that are caused by power supplies or sensors that are unique to the valve. Relief valves that open in response to an actual system over pressure are not failures. Subsequent failures to reseat completely are defined as a failure to close event.

Valve operator failures are evaluated to determine the effect on valve operability. In general, if the failure causes the valve to fail to operate, it will be considered a valve failure. Failures of the valve to provide input to other systems (such as limit switches) will not be considered valve failures.

Administrative inoperability events, such as seismic qualification or Appendix R violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. The exception to this is if a licensee reported that the valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications (TS) in the proper configuration is not considered a failure, unless the improper configuration would have prevented the valve from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that a second RV would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another RV, then the event was identified as a CCF. If, however, the report did not clearly identify that another RV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to an RV actuation demand (e.g. the condition was found during inspection, and no actual demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 39-10 through 39-18 present the alpha factor uncertainty distribution summaries for each failure mode. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. The average CCCG for the BWR relief valve events is over 15, so the parameter estimations using a CCCG of 6 (due to software limitations) are conservative. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

D

ALPHA FACTOR DISTRIBUTIONS BWR Pressure Relief and ADS Valves

Table 39-10: Alpha Factor Distribution Summary - Fail to Open, CCCG = 4

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.8703195	0.9192553	0.9220476	0.9586444	0.9084257	9.1754E+01	8.0594E+00
α,	2.48E-02	5.71E-02	5.42E-02	9.95E-02	6.97E-02	5.709E+00	9.4113E+01
α,	2.03E-03	1.58E-02	1.27E-02	4.02E-02	1.78E-02	1.5765E+00	9.8237E+01
α.,	2.01E-04	7.84E-03	4.88E-03	2.55E-02	4.04E-03	7.8200E-01	9.9031E+01

Table 39-11: Alpha Factor Distribution Summary - Fail to Open, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α,	0.8694438	0.9133463	0.9154745	0.9499641	0.8964265	1.1797E+02	1.1192E+01
α,	2.72E-02	5.60E-02	5.38E-02	9.27E-02	7.30E-02	7.2379E+00	1.2192E+02
α,	4.08E-03	1.85E-02	1.61E-02	4.12E-02	2.22E-02	2.3866E+00	1.2678E+02
α,	2.15E-04	6.55E-03	4.24E-03	2.08E-02	6.87E-03	8.4640E-01	1.2832E+02
α,5	1.09E-04	5.59E-03	3.33E-03	1.88E-02	1.54E-03	7.2150E-01	1.2844E+02

Table 39-12: Alpha Factor Distribution Summary - Fail to Open, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	a	b
α	0.8673607	0.9077758	0.9094923	0.9423348	0.8853880	1.4382E+02	1.4611E+01
α2	2.72E-02	5.27E-02	5.09E-02	8.47E-02	7.19E-02	8.3547E+00	1.508E+02
α.,	7.00E-003	2.22E-002	2.03E-002	4.43E-002	2.83E-002	3.5237E+00	1.5491E+02
α,	8.40E-04	8.53E-03	6.57E-03	2.29E-02	9.85E-03	1.3511E+00	1.5708E+02
α,	5.70E-05	4.15E-03	2.33E-03	1.44E-02	3.93E-03	6.5710E-01	1.5777E+02
α,	9.04E-05	4.57E-03	2.73E-03	1.53E-02	6.90E-04	7.2460E-01	1.5771E+02

ALPHA FACTOR DISTRIBUTIONS BWR Pressure Relief and ADS Valves

Table 39-13: Alpha Factor Distribution Summary	- Fai	il to Close	, $CCCG = 4$
--	-------	-------------	--------------

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9326245	0.9726965	0.9775888	0.9960292	0.9889695	6.0563E+01	1.700E+00
a ₂	7.07E-04	1.53E-02	1.05E-02	4 63E-02	1.10E-02	9.5380E-01	6.1309E+01
α,	1.23E-07	4.22E-03	8.20E-04	2.01E-02	0.00E+00	2.6260E-01	6.200E+01
α,	2.58E-05	7.77E-03	3.46E-03	3.01E-02	0.00E+00	4.8360E-01	6.1779E+01

Table 39-14: Alpha Factor Distribution Summary - Fail to Close, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9335920	0.9691839	0.9727871	0.9924494	0.9852336	8.2545E+01	2.6246E+00
α,	1.72E-03	1.64E-02	1.28E-02	4.34E-02	1.48E-02	1.3950E+00	8.3775E+01
α,	6.15E-06	4.84E-03	1.83E-03	1.99E-02	0.00E+00	4.1200E-01	8.4758E+01
α.,	2.13E-08	2.74E-03	4.18E-04	1.36E-02	0.00E+00	2.3360E-01	8.4936E+01
α,	5.78E-05	6.86E-03	3.57E-03	2.48E-02	0.00E+00	5.8400E-01	8.4586E+01

Table 39-15: Alpha Factor Distribution Summary - Fail to Close, CCCG = 6

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9346811	0.9670311	0.9699000	0.9895600	0.9814815	1.0347E+02	3.5276E+00
α,	2.56E-03	1.66E-02	1.37E-02	4.06E-02	1.85E-02	1.7791E+00	1.0522E+02
α,	2 97E-05	5.05E-03	2.47E-03	1.88E-02	0.00E+00	5.4060E-01	1.0646E+02
α.,	4.57E-07	2.92E-03	7.66E-04	1.32E-02	0.00E+00	3.1270E-01	1.0669E+02
α,	2.84E-08	2.27E-03	3.78E-04	1.11E-02	0.00E+00	2.4330E-01	1.0675E+02
a.	8.14E-05	6.09E-03	3.41E-03	2.12E-02	0.00E+00	6.5190E-01	1.0635E+02

ALPHA FACTOR DISTRIBUTIONS BWR Pressure Relief and ADS Valves

Table 39-16: A	Upha F	actor L	Distribution 3	Summary -	- Fail to l	Remain	Closed,	CCCG = 4	

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α,	0.9211192	0.9643008	0.9688233	0.9920085	0.9733513	6.4688E+01	2.3948E+00
α.,	3.00E-03	2.34E-02	1.88E-02	5.93E-02	2.47E-02	1.5684E+00	6.5514E+01
α,	1.53E-06	5.04E-03	1.49E-03	2.22E-02	1.84E-03	3.3830E-01	6.6745E+01
œ4	2.54E-05	7.28E-03	3.27E-03	2.81E-02	1.10E-04	4.8810E-01	6.6595E+01

Table 39-17: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 5

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9212466	0.9597546	0.9630854	0.9868608	0.9665930	8.7201E+01	3.6566E+00
α1	5.20E-03	2.49E-02	2.15E-02	5.62E-02	3.02E-02	2.2624E+00	8.8595E+0
α,	4.36E-05	6.18E-03	3.12E-03	2.27E-02	2.94E-03	5.6160E-01	9.0296E+0
α.,	4.24E-08	2.73 -03	4.72E-04	1.33E-02	2.83E-04	2.4800E-01	9.0610E+0
α,	5.45E-05	6.43E-03	3.35E-03	2.33E-02	1.18E-05	5.8460E-01	9.0273E+0

Table 39-18: Alpha Factor Distribution Summary - Fail 1	o Remain Closed,	CCCG = 6
---	------------------	----------

Alpha Factor	5th%	Mean	Median	95th%	MLE		b
α	0.9271790	0.9608604	0.9635338	0.9853912	0.9683204	1.0928E+02	4.4514E+00
α,	3.23E-03	1.77E-02	1.50E-02	4.16E-02	2.04E-02	2.0178E+00	1.1171E+02
α,	7.66E-04	1.03E-02	7.60E-03	2.90E-02	1.04E-02	1.1708E+00	1.1256E+02
œ,	1.72E-06	3.20E-03	1.04E-03	1.37E-02	8.46E-04	3.6410E-01	1.1337E+02
α,	3.19E-08	2.17E-03	3.71E-04	1.06E-02	5.76E-05	2.4680E-01	1.1349E+02
a.	7.65E-05	5.73E-03	3.21E-03	2.00E-02	0.00E+00	6.5190E-01	1.1308E+02

40. PWR Steam Generator Safety Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving safety valves in the steam generator system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and failure reports from the Nuclear Plant Reliability Data System (NPRDS) have been screened to identify common-cause failure events. Failure modes analyzed are failure to open, failure to close, and failure to remain closed (spurious opening or leakage by the valve seat). The data cover the time period from 1980 through 1995.

The data review identified 23 common-cause failure to open events, one common-cause failure to close event, and eight common-cause failure to remain closed events. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to open are shown in Tables 40-1 and 40-2, respectively. Table 40-3 contains the average impact vectors (N₁-N₆) and the number of adjusted independent events for this failure mode. Tables 40-4 through 40-9 contain the corresponding information for the failure to close and failure to remain closed failure modes. The size of the affected population of for steam generator safety valves is denoted as CCCG. The alpha factor model parameters are denoted by α_1 - α_6 . Beta (β), gamma (γ), delta (δ), epsilon (ε), and mu (μ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 40-10 through 40-12.

2. SYSTEM DESCRIPTION

The steam generator safety valves (SVs) are part of the secondary cooling system. They provide both over pressure protection to the steam generators and additional heat removal capacity. The setpoints for a bank of SVs on a single steam generator are staggered in order to provide the required pressure relief and to prevent exceeding the maximum flow for each valve. Figure 40-1 shows a typical configuration of the steam generator, safety valves, and relief valves. Most PWRs have at least 10 steam generator SVs, but the CCF software is limited to a CCCG of 6 for parameter estimation purposes. Typically, there are four or five SVs for each steam generator. Figure 40-1 shows the configuration of the steam generator safety and relief valves for a three-loop plant.

NUREG/CR-5497

Table 40-1: Summary of Alpha Factor Parameter Estimations - Fail to Open **Alpha Factor** CCCG=2 CCCG=3 CCCG=4 CCCG=5 CCCG=6 0.7521875 0.7736847 0.7494543 0.7388031 0.74,0038 α, 2.48E-01 6.64E-02 1.06E-01 1.12E-01 α, 1.03E-01 1.60E-01 2.31E-02 4.10E-02 α, 5.55E-02 a4 1.21E-01 4.31E-03 1.13E-02 1.04E-01 9.88E-05 α, a. 8.98E-02

ALPHA FACTOR AND MGL PARAMETERS Steam Generator Safety Valves

Table 40-2: Summary of MGL Parameter Estimations - Fail to Open

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	7.52E-01	7.74E-01	7.50E-01	7.39E-01	7.40E-01
Beta	2.48E-01	2.26E-01	2.51E-01	2.61E-01	2.60E-01
Gamma		7.07E-01	5.76E-01	5.72E-01	6.03E-01
Delta			8.40E-01	7.25E-01	6.46E-01
Epsilon				9.60E-01	8.88E-01
Mu					9.99E-01

Table 40-3: Summary of Average Impact Vectors - Fail to Open

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	3.48	5.22	6.96	8.70	10.44
N ₁	4.1192	5.0061	5.5023	5.5094	6.0424
N ₂	2.5036	0.8777	1.7648	2.1517	2.2992
N3	en e	2.1136	0.3840	0.7886	1.2370
N,			2.0174	0.0829	0.2525
N _s				2.0004	0.0022
N.	A THE REAL PROPERTY OF THE REA				2.0001

Total Number of Independent Failure Events: 27 Total Number of Common-Cause Failure Events: 23

ALPHA FACTOR AND MGL PARAMETERS Steam Generator Safety Valves

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG#5
α.,	0.9975600	0.9967448	0.9934730	0.9918023	0.9904267
α.,	2.44E-03	3.12E-03	6.12E-03	7.38E-03	8.21E-03
α,		1.34E-04	4.03E-04	8.23E-04	1.37E-03
Ø.4			0.00E+00	0.00E+00	0.00E+00
a _s				0.00E+00	0.00E+00
a.		THE CONTRACTOR OF A REAL PROPERTY OF A REAL PROPERTY OF			0.00E+00

Table 40-4 Summary of Alpha Factor Parameter Estimations - Fail to Close

Table 40-5: Summary of MGL Parameter Estimations - Fail to Close

MGL Parameter	CCCG==2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	9.98E-01	9.97E-01	9.94E-01	9.92E-01	9.90E-01
Beta	2.44E-03	3.26E-03	6.53E-03	8.20E-03	9.57E-03
Gamma		4.12E-02	6.17E-02	1.00E-01	1.43E-01
Delta			0.00E+00	0.00E+00	0.00E+00
Epsilon		Constants and a support of the support of the support of the support		0.00E+00	0.00E+00
Mu		and a second sec			0.00E+00

Table 40-6: Summary of Average Impact Vectors - Fail to Close

Avg. Impact Vector	CCCG=2	CCCG=3	CCCGm4	CCCG=5	CCCG-6
Adj. Ind. Events	5.13	7.69	10.25	12.81	15.38
N ₁	0.3483	0.4856	0.6026	0.6920	0.7903
N ₂	0.0134	0.0256	0.0669	0.1004	C.1340
N ₃		0.0011	0.0044	0.0112	0.0223
N ₄			0.0000	0.0000	0.0000
Ns		1	A CONTRACTOR OF A CONTRACTOR O	0.0000	0.0000
N.					0.0000

Total Number of Independent Failure Events: 41 Total Number of Common-Cause Failure Events: 1

ALPHA FACTOR AND MGL PARAMETERS Steam Generator Safety Valves

Table 40-7: Summary	of Alpha Factor	Parameter	Estimations	- Fail to	Remain Closed	1

Alpha Factor	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
ai	0.9997185	0.9994813	0.9992219	0.9989502	0.9986949
α,	2.82E-04	5.19E-04	7.74E-04	1.04E-03	1.29E-03
α,		0.00E+00	3.71E-06	8.90E-06	1.48E-05
œ4			0.00E+00	0.00E+00	0.00E+00
as		and a second sec		0.00E+00	0.00E+00
a.			and a second	1	0.00E+00

Table 40-8: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
1-Beta	1.00E+01	1.00E+01	9.99E-01	9.99E-01	9.99E-01
Beta	2.82E-04	5.19E-04	7.78E-04	1.05E-03	1.31E-03
Gamma		0.00E+00	4.76E-03	8.48E-03	1.14E-02
Deita			0.00E+00	0.00E+00	0.00E+00
Epsilon				0.00E+00	0.00E+00
lviu					0.00E+00

Table 40-9: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG=3	CCCG=4	CCCG=5	CCCG=6
Adj. Ind. Events	13.05	19.58	26.11	32.63	39.16
N,	0.4429	0.6538	0.8575	1.0543	1.2446
N ₂	0.0038	0.0105	0.0209	0.0351	0.0522
N ₃		0.0000	0.0001	0.0003	0.0006
N,	and the second second second second second		0.0000	0.0000	0.0000
Ns				0.0000	0.0000
N ₆	A CONTRACTOR OF	1			0.0000

Total Number of Independent Failure Events: 93 Total Number of Common-Cause Failure Events: 8

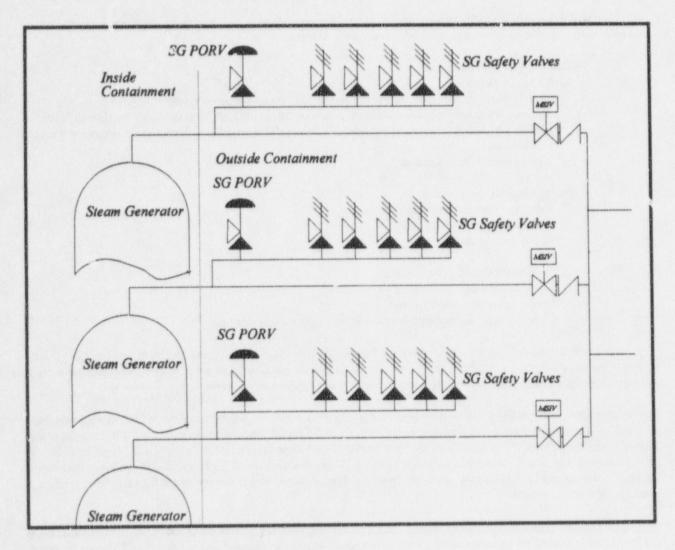


Figure 40-1. Steam generator relief and safety valves.

3. COMPONENT BOUNDARIES

The main component of the safety value is the value body and the mechanical (spring) operator. The operator is an integral part of the value. This component is operated mech inically by the system operating pressure exceeding the spring setpoint. In addition to opening to lower pressure, the values are designed to re-close when the desired pressure is achieved, or when system pressure is insufficient to hold the value open. There are no electrical or instrumentation connections.

4. FAILURE EVENT DEFINITION

Successful operation of a safety valve is defined as opening in response to high system pressure, and reclosing when pressure is reduced. The failure modes used in evaluating the data are:

CC Failure to Open: Examples are:

- SV sticks closed,
- SV setpoint over 10% over the limit or words like "excessive" are considered failures,
- If piece-part(s) are replaced to calibrate a setpoint that is too high, then the SV is considered failed,
- A stroke time test failure will be considered a failure if it is reported as "excessive," otherwise it is not
 a failure, and
- Whenever a SV is blocked shut.
- OO Failure to Close: Examples are:
 - Valve stays open when it should close,
 - Valve doesn't fully close, and
 - Failure to re-seat.
- VR Failure to Remain Closed: Examples are:
 - Spurious opening,
 - Leakage past the valve seat, and
 - If piece-part(s) are replaced to re-calibrate a setpoint that was low.

Safety valve malfunctions are considered to be failures to open or close on demand, failure to stay open or closed, including excessive leakage through the valve. Safety valves that open in response to an actual system over pressure are not failures. Subsequent failures to reseat completely are defined as a failure to close event.

Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. The exception to this is if a licensee reported that the valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis fire or seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the valve from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that a second SV would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another SV, then the event was identified as a CCF. If, however, the report did not clearly indicate that another SV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to an SV actuation demand (e.g. the condition was found during inspection, and no actual demand recurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 40-10 through 40-12 present the alpha factor uncertainty distribution summaries for each failure mode of steam generator safety valves. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the table. The average CCCG for the steam generator safety valves is over 15, so the parameter estimations using a CCCG of six (due to software limitations) are xonservative. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Steam Generator Safety Valves

Table 40-10:	Alpha Factor Distri	bution Summary	- Fail to Op	pen, $CCCG = 6$

Alpha Factor	Sth%	Mean	Median	95th%	MLE		b
GL1	0.8250617	0.8894870	0.8929347	0.9421186	0.7400038	6.6954E+01	8.3186E+00
a2	1.17E-02	4.09E-02	3.69E-02	8.39E-02	1.03E-01	3.0783E+00	7.2194E+01
α,	3.65E-03	2.36E-02	1.95E-02	5.75E-02	5.55E-02	1.7776E+00	7.3495E+01
α.,	5.47E-05	7.51E-03	3.81E-03	2.75E-02	1.13E-02	5.6520E-01	7.4707E+01
Ø.,	4.52E-08	3.26E-03	5.53E-04	1.59E-02	9.88E-05	2.4550E-01	7.5027E+01
α.,	8.74E-03	3.52E-02	3.12E-02	7.56E-02	8.98E-02	2.6520E+00	7.2621E+01

*

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9173890	0.9612858	0.9656478	0.9902697	0.9904267	6.6642E+01	2.6839E+00
α,	5.40E-04	1.32E-02	8.87E-03	4.05E-02	8.21E-03	9.1310E-01	6.8413E+01
α,	5.81E-05	8.12E-03	4.11E-03	2.98E-02	1.37E-03	5.6290E-01	6.8763E+01
α.,	7.07E-07	4.51E-03	1.19E-03	2.03E-02	0.00E+00	3.1270E-01	6.9013E+01
a _s	4.40E-08	3.51E-03	5.85E-04	1.71E-02	0.00E+00	2.4330E-01	6.9083E+01
a.	1.26E-04	9.40E-03	5.29E-03	3.27E-02	0.00E+00	6.5190E-01	6.8674E+01

ALPHA FACTOR DISTRIBUTIONS Steam Generator Safety Valves

NUREG/CR-5497

360

ALPHA FACTOR DISTRIBUTIONS Steam Generator Safety Valves

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9401227	0.9723896	0.9756929	0.9933639	0.9986949	9.0877E+01	2.5804E+00
α,	2.77E-04	8.90E-03	5.72E-03	2.83E-02	1.29E-03	8.3130E-01	9.2626E+01
α,	3.43E-05	5.79E-03	2.84E-03	2.16E-02	1.48E-05	5.4120E-01	9.2916E+01
α.,	5.23E-07	3.35E-03	8.77E-04	1.51E-02	0.00E+00	3.1270E-01	9.3145E+01
α,	3.25E-08	2.60E-03	4.33E-04	1.27E-02	0.00E+00	2.4330E-01	9.3214E+01
a.	9.33E-05	6.98E-03	3.91E-03	2.43E-02	0.00E+00	6.5190E-01	9.2806E+0

Table 40-12: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 6

41. BWR Safety Valves

The data review identified no Boiling Water Reactor (BWR) safety valve CCF events.

NUREG/CR-5497

42. PWR Pressurizer Safety Valves

1. INTRODUCTION

This report documents the results of an AEOD effort to estimate common-cause failure (CCF) parameters of various models using operational data involving pressurizer safety valves in the primary cooling system at pressurized water reactor (PWR) power plants. Licensee Event Reports (LERs) and Nuclear Plant Reliability Data System (NPRDS) data have been screened to identify common-cause failure events. The failure modes used to analyze the safety valves are failure to open, failure to close, and failure to remain closed (spurious opening or leakage past the valve seat). The data cover the time period from 1980 through 1995.

The data review identified six common-cause failure to remain closed events. There were no common-cause failure to open or failure to close events identified. The maximum likelihood estimates (MLE) for the alpha factor and the multiple Greek letter (MGL) parameters for failure to remain closed are shown in Tables 42-1 and 42-2, respectively. Table 42-3 contains the average impact vectors (N₁-N₃) and the number of adjusted independent events for this failure mode. The size of the affected population of pressurizer safety valves is denoted as CCCG and is either 2 or 3 for all plants. The alpha factor model parameters are denoted by α_1 - α_3 . Beta (β) and gamma (γ) are the multiple Greek letter model parameters. The quantity 1- β is defined as the probability that a failure event is an independent failure and is equal to α_1 . The MGL calculations assume a staggered testing scheme. Uncertainty distributions of the mean values of the alpha factors are also included in this report in Tables 42-4 and 42-5.

2. SYSTEM AND COMPONENT DESCRIPTION

The primary coolant system in a PWR consists of the piping and other components necessary to remove heat from the reactor core. Part of the system is the pressurizer which serves to regulate the system pressure, both raising pressure to maintain solid water in the pressurizer flow path, and lowering pressure to control plant operations and prevent system over pressurization. The power operated relief valves (PORV) are used for pressure control and safety valves are used for over pressure protection purposes.

The pressurizer safety valves function to prevent primary plant over pressure. The valves are strictly mechanical in nature and require no external power or control to operate. Since the valves function to provide over pressure protection, no means of valve isolation is provided. Figure 42-1 shows the configuration of the pressurizer relief and safety valves.

ALPHA FACTOR AND MGL PARAMETERS Pressurizer Safety Valves

Table 42-1: Summary of Alpha Factor Parameter Estimations - Fail to Remain Closed

Alpha Factor	CCCG=2	CCCG=3
«1	0.9985231	0.9970754
α,	1.48E-03	2.91E-03
α,	anarayanan kanayat anar ana 'a anara, 'a anarayanan kanaratan kanaratan kanaratan kanaratan kanaratan kanaratan	1.77E-05

Table 42-2: Summary of MGL Parameter Estimations - Fail to Remain Closed

MGL Parameter	CCCG=2	CCCG=3
1-Beta	9.99E-01	9.97E-01
Beta	1.48E-03	2.93E-03
Gamma		6.04E-03

Table 42-3: Summary of Average Impact Vectors - Fail to Remain Closed

Avg. Impact Vector	CCCG=2	CCCG#3
Adj. Ind. Events	74.21	111.13
N,	1.2439	1.5360
Na	0.1116	0.3290
N,	and a subject of the second	0.0020

Total Number of Independent Failure Events: 105 Total Number of Common-Cause Failure Events: 6

1.1.1

9

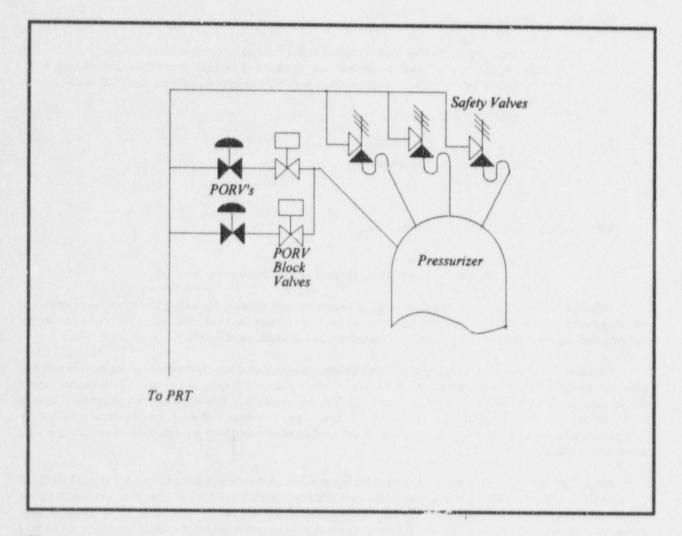


Figure 42-1. Pressurizer PORV and safety valves.

3. COMPONENT BOUNDARIES

The pressurizer safety valve includes only the valve itself and the mechanical (spring) operator. The operator is an integral part of the valve. This component is operated mechanically by the system operating pressure exceeding the spring setpoint. In addition to opening to lower pressure, the valves are designed to re-close when the desired pressure is achieved, or when system pressure is insufficient to hold the valve open. There are no electrical or instrumentation connections.

4. FAILURE EVENT DEFINITION

Successful operation of a safety valve is defined as opening in response to high system pressure, and reclosing when pressure is reduced. The failure modes used in evaluating the data are:

- CC Failure to Open: Examples are:
 - SV sticks closed,
 - SV setpoint over 10% over the limit or words like "excessive" are considered failures,
 - . If piece-part(s) are replaced to calibrate a setpoint that was too high, then the SV is considered failed,
 - A stroke time test failure will be considered a failure if it is reported as "excessive, " otherwise it is not
 a failure, and
 - Whenever a SV is blocked shut.
- OO Failure to Close: Examples are:
 - Valve stays open when it should close,
 - Valve doesn't fully close, and
 - · Failure to re-seat.
- VR Failure to Remain Closed: Examples are:
 - Spurious opening,
 - Leakage past the valve seat, and
 - If piece-part(s) are replaced to re-calibrate a setpoint that was too low.

Safety valve malfunctions are considered to be failures to open or close on demand, failure to stay open or closed, including excessive leakage through the valve. Safety valves that open in response to an actual system over pressure are not failures. Subsequent failures to reseat completely are defined as a failure to close event.

Administrative inoperability events, such as seismic qualification violations, were not considered failures because they are conditional upon the circumstances existing at the time of valve demand. The exception to this is if a licensee reported that the valve "would have" (instead of "may" or "could have") failed to perform its safety function in a design basis seismic event. In this case the event was considered to be a failure. Failure to meet Technical Specifications in the proper configuration is not considered a failure, unless the improper configuration would have prevented the valve from operating properly on a safety demand.

Many LERs reported only one actual failure, but the report information indicated that a second SV would have failed if a demand had occurred. If the cause of the actual failure would have clearly caused failure of another SV, then the event was identified as a CCF. If, however, the report did not clearly identify that another SV would have failed due to the same cause, the event was not considered a CCF, and was counted as an independent failure. Similarly, for reports identifying failures discovered prior to an SV actuation demand (e.g. the condition was found during inspection, and no actual demand occurred), only those cases for which a second failure could be certain were identified as CCF events.

5. ALPHA FACTOR DISTRIBUTION SUMMARIES

Tables 42-4 and 42-5 present the alpha factor uncertainty distribution summaries for each failure mode and each configuration of pressurizer safety valves. CCF and independent failure data were pooled, and do not reflect any variability across plants. For each alpha factor, the results reflect uncertainty about a mean value. The uncertainty distribution in each case is a beta distribution, with parameters a and b provided in the tables. Uncertainty distributions which capture plant-to-plant variability will be provided at a later date.

ALPHA FACTOR DISTRIBUTIONS Pressurizer Safety Valves


Table 42-4: Alpha Factor Distribution Summary - Fail to Remain Closed, CCCG = 2

Alpha Factor	5th%	Mean	Median	95th%	MLE	8	b
α;	0.9753426	0.9932029	0.9964744	0.9999453	0.9985231	8.4984E+01	5.8160E-01
α,	5.63E-05	6.80E-03	3.52E-03	2.47E-02	1.48E-03	5.8160E-01	8.4984E+01

Table 42-5: Alpha I	Factor Distribution	Summary - Fa	il to R	emain Closed.	CCCG = 3

Alpha Facto:	5th%	Mean	Median	95th%	MLE	8	b
α,	0.9749890	0.9912449	0.9936143	0.9993933	0.9970754	1.2805E+02	1.1310E+00
α,	1.05E-04	5.54E-03	3.29E-03	1.87E-02	2.91E-03	7.1620E-01	1.2847E+02
α,	4.25E-06	3.21E-03	1.22E-03	1.32E-02	1.77E-05	4.1480E-01	1.2877E+02

NRC FORM 335 (2-89) NRCM 1102. 3201 3202 U.S. NUCLEAR REGUL BIBLIOGRAPHIC DATA SHE (See Instructions on the reverse)	 REPORT NUMBER (Assigned by 1 RC, Add Vol., Supp., Rev., an 1 Addendum Numbers, if any.) NUREG/CR-5497 INEEL/EXT-97-01328 			
2. TITLE AND SUBTITLE		3. DATE REPORT PUBLISHED		
Common Cause Failure Parameter Estimations		MONTH YEAR October 1998 4. FIN OR GRANT NUMBER E8247		
5. AUTHOR(S)		6. TYPE OF REPORT		
F. M. Marshall, A. Mosleh, University of Maryland, D. M. Rasmuson,	USNRC	Technical 7. PERIOD COVERED (Inclusive Dates)		
 PERFORMING ORGANIZATION - NAME AND ADDRESS (If NRC, provide Div and mailing address; if contractor, provide name and mailing address.) 	vision, Office or Region, U	S. Nuclear Regulatory Commission,		
Idaho National Engineering and Environmental Laboratory	Subcontractor	:		
Lockheed Martin Idaho Technologies Co. P.O. Box 1625	Department of Nuclear Eng	Materials and		
Idaho Falls, ID 83415-3129	University of College Park,	Maryland		
9. SPONSORING ORGANIZATION - NAME AND ADDRESS (If NRC, type "Same U.S. Nuclear Regulatory Commission, and mailing address.)				
Office for Analysis and Evaluation of Operational Data U.S. Nuclear Regulatory Commission Washington, DC 20555-0001 10. SUPPLEMENTARY NOTES				
11. ABSTRACT (200 words or less) This report documents the quantitative results of the common cause failure (CCF) data of	collection effort described i	n Volumes 1 - 4 of the Common Cause		
Failure System Database and Analysis System (References 2-5), as well as some qualitat Probabilistic Risk Assessment (PRA) studies of commercial nuclear power plants in the quantification process, performed on the CCF data, as described in Volume 2 of that series	tive insights about the data U.S. It summarizes the res	. These results are for use in		
Equipment failures that contribute to CCF events are identified during searches of Licen failure reports. Once CCF events are identified by screening reports of equipment failure system. Once all data for a specific system and component data set have been entered, p results of the database analysis are presented here as a summary of the entire database, a combinations describe the system and component boundaries, along with the guidelines	es, they are coded for entry parameter estimations are p and as individual reports for	into a personal computer storage erformed, producing the results. The r individual system/component		
The quantitative results are presented as both alpha factors and multiple Greek letter par also presented.	ameter estimations. The al	pha factor uncertainty distributions are		
12. KEY WORDS/DESCRIPTORS (List words or phrases that will ass locating the report.)	13. AVAILABILITY STATEMENT Unlimited 14. SECURITY CLASSIFICATION			
Common cause failure	(This page) Unclassified (This report) Unclassified 15. NUMBER OF PAGES			
		16. PRICE		
NRC FORM 335 (2-89)		and the state of the		

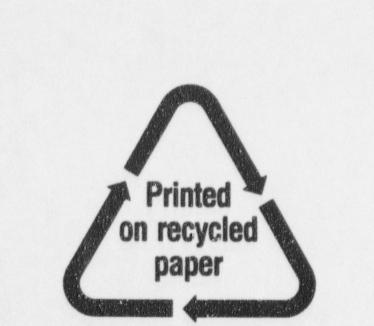

Federal Flecycling Program

UNITED STATES NUCLEAR REGULATORY COMMISSION WASHINGTON, DC 20555-0001

OFFICIAL BUSINESS PENALTY FOR PRIVATE USE, \$300

120555154486 1 1ANICVIRGIXA1 US NRC-OCIO DIV-INFORMATION MANAGEMENT TPS-PDR-NUREG 2WFN-6E7 WASHINGTON DC 20555 SPECIAL STANDARD MAIL POSTAGE AND FEES PAID USNRC PERMIT NO. G-67