


Log # TXX-4770
File # 10110
910.3

TEXAS UTILITIES GENERATING COMPANY
SKYWAY TOWER • 400 NORTH OLIVE STREET, L.B. 81 • DALLAS, TEXAS 75201

April 21, 1986

WILLIAM G. COUNSIL
EXECUTIVE VICE PRESIDENT

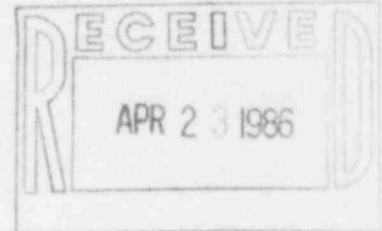

Mr. Eric H. Johnson, Director
Division of Reactor Safety and Projects
U.S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76012

SUBJECT: COMANCHE PEAK STEAM ELECTRIC STATION
DOCKET NOS. 50-445 AND 50-446
PRESSURE INSTRUMENT INSTALLATION
SDAR: CP-86-19 (INTERIM REPORT)

Dear Mr. Johnson:

On March 21, 1986, we verbally notified your Mr. R. Hall of a deficiency involving the installation of steam service pressure transmitters which may be above the root valve without steam traps or wet legs. This is an interim report of a potentially reportable item under the provisions of 10CFR50.55(e).

We are continuing our evaluation and anticipate submitting our next report by May 23, 1986.

Very truly yours,

W G Council

W. G. Council

By: *G S Keeley*
G. S. Keeley
Manager, Licensing

JCH/grr

c - NRC Region IV (0 + 1 copy)

Director, Inspection & Enforcement (15 copies)
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

8604280330 860421
PDR ADOCK 05000445
S PDR

86-404

1/0 IE27