


**TEXAS UTILITIES GENERATING COMPANY**  
SKYWAY TOWER • 400 NORTH OLIVE STREET, L.B. 81 • DALLAS, TEXAS 75201

WILLIAM G. COUNSIL  
EXECUTIVE VICE PRESIDENT

May 9, 1986

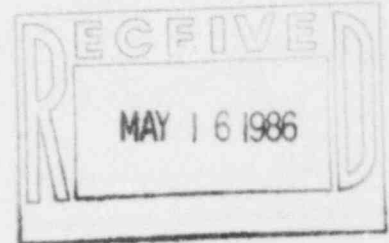

Mr. Eric H. Johnson, Director  
Division of Reactor Safety and Projects  
U.S. Nuclear Regulatory Commission  
611 Ryan Plaza Drive, Suite 1000  
Arlington, TX 76012

SUBJECT: COMANCHE PEAK STEAM ELECTRIC STATION  
DOCKET NOS. 50-445 AND 50-446  
BREAKER/FUSE COORDINATION  
SNAR: CP-86-25 (INTERIM REPORT)

Dear Mr. Johnson:

On April 10, 1986, we verbally notified your Mr. R. Hall of a deficiency involving a possible concern in that without full breaker/fuse coordination, portions of the CPSES damage study could be incorrect. This is an interim report of a potentially reportable item under the provisions of 10CFR50.55(e).

Initial breaker/fuse studies included only the high voltage areas. Currently, certain coordination problems have been provided to damage study for review of uncoordinated loads to determine if additional protection is required for jet impingement or pipe whip.

We are continuing our evaluation and anticipate submitting our next report by July 22, 1986.

Very truly yours,

*W. G. Council*  
W. G. Council

JCH/grr

c - NRC Region IV (0 + 1 copy)

Director, Inspection & Enforcement (15 copies)  
U. S. Nuclear Regulatory Commission  
Washington, D.C. 20555

8605210482 860509  
PDR ADDCK 05000445  
S PDR

86-509

1/0 IE27