


TEXAS UTILITIES GENERATING COMPANY
SKYWAY TOWER • 400 NORTH OLIVE STREET, L.B. 81 • DALLAS, TEXAS 75201

June 26, 1986

WILLIAM G. COUNCIL
EXECUTIVE VICE PRESIDENT

Mr. Eric H. Johnson, Director
Division of Reactor Safety and Projects
U. S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76012

SUBJECT: COMANCHE PEAK STEAM ELECTRIC STATION (CPSES)
DOCKET NOS. 50-445 AND 50-446
TRACEABILITY OF 1E PIGTAIL EXTENSIONS
SDAR: CP-86-38 (INTERIM REPORT)

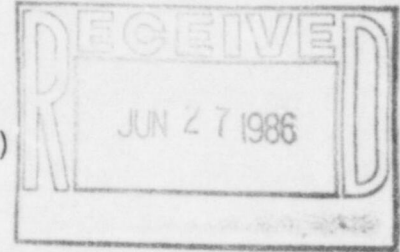

Dear Mr. Johnson:

On May 27, 1986, we verbally notified your Mr. T. F. Westerman of a deficiency involving the failure of project procedures to adequately address the installation and inspection criteria for cable runs used as device pigtail extensions. This is an interim report of a potentially reportable item under the provision of 10CFR50.55(e).

CPSES Engineering is currently conducting an analysis of this issue to evaluate the impact of the lack of traceability of pigtail extensions by cable number. We are continuing our evaluation and anticipate submitting our next report by July 21, 1986.

Very truly yours,

W. G. Council

W. G. Council

By:

G. S. Keeley
G. S. Keeley
Manager, Nuclear Licensing

JCH/arh

c - NRC Region IV (0 + 1 Copy)

Director, Inspection & Enforcement (15 copies)
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

8607010538 860626
PDR ADDCK 05000445
S PDR

86-691

JE-27
1/0