


TEXAS UTILITIES GENERATING COMPANY
SKYWAY TOWER - 400 NORTH OLIVE STREET, L.B. 81 - DALLAS, TEXAS 75201

January 21, 1987

WILLIAM G. COUNSIL
EXECUTIVE VICE PRESIDENT

Mr. Eric H. Johnson, Director
Division of Reactor Safety and Projects
U. S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76011

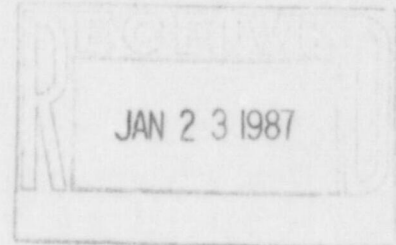

SUBJECT: COMANCHE PEAK STEAM ELECTRIC STATION (CPSES)
DOCKET NOS. 50-445 AND 50-446
WEATHER PROTECTION FOR CLASS 1E COMPONENTS
SDAR: CP-86-68 (INTERIM REPORT)

Dear Mr. Johnson:

On October 2, 1986, we verbally notified your Mr. Ian Barnes of a deficiency regarding provisions for weather protection of Class 1E components used in outdoor installations. This is an interim report of a potentially reportable item under the provisions of 10CFR50.55(e). We have submitted interim reports logged TXX-6081 and TXX-6124 dated October 31, 1986, and November 26, 1986, respectively.

A field verification program is currently being developed to inspect weather proofing on all outdoor Class 1E junction/terminal boxes. The results of these efforts are required prior to our assessment of the possible effects of this issue on the safety of plant operations. Where deficiencies are identified, deficiency and nonconformance reports will be issued.

We anticipate submitting our next report by May 15, 1987.

Very truly yours,

W. G. Council

JCH/mlh

c - NRC Region IV (0 + 1 copy)

Director, Inspection & Enforcement (15 copies)
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

87-084
8701780257 870121
PDR ADOCK 05000445
S PDR